


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

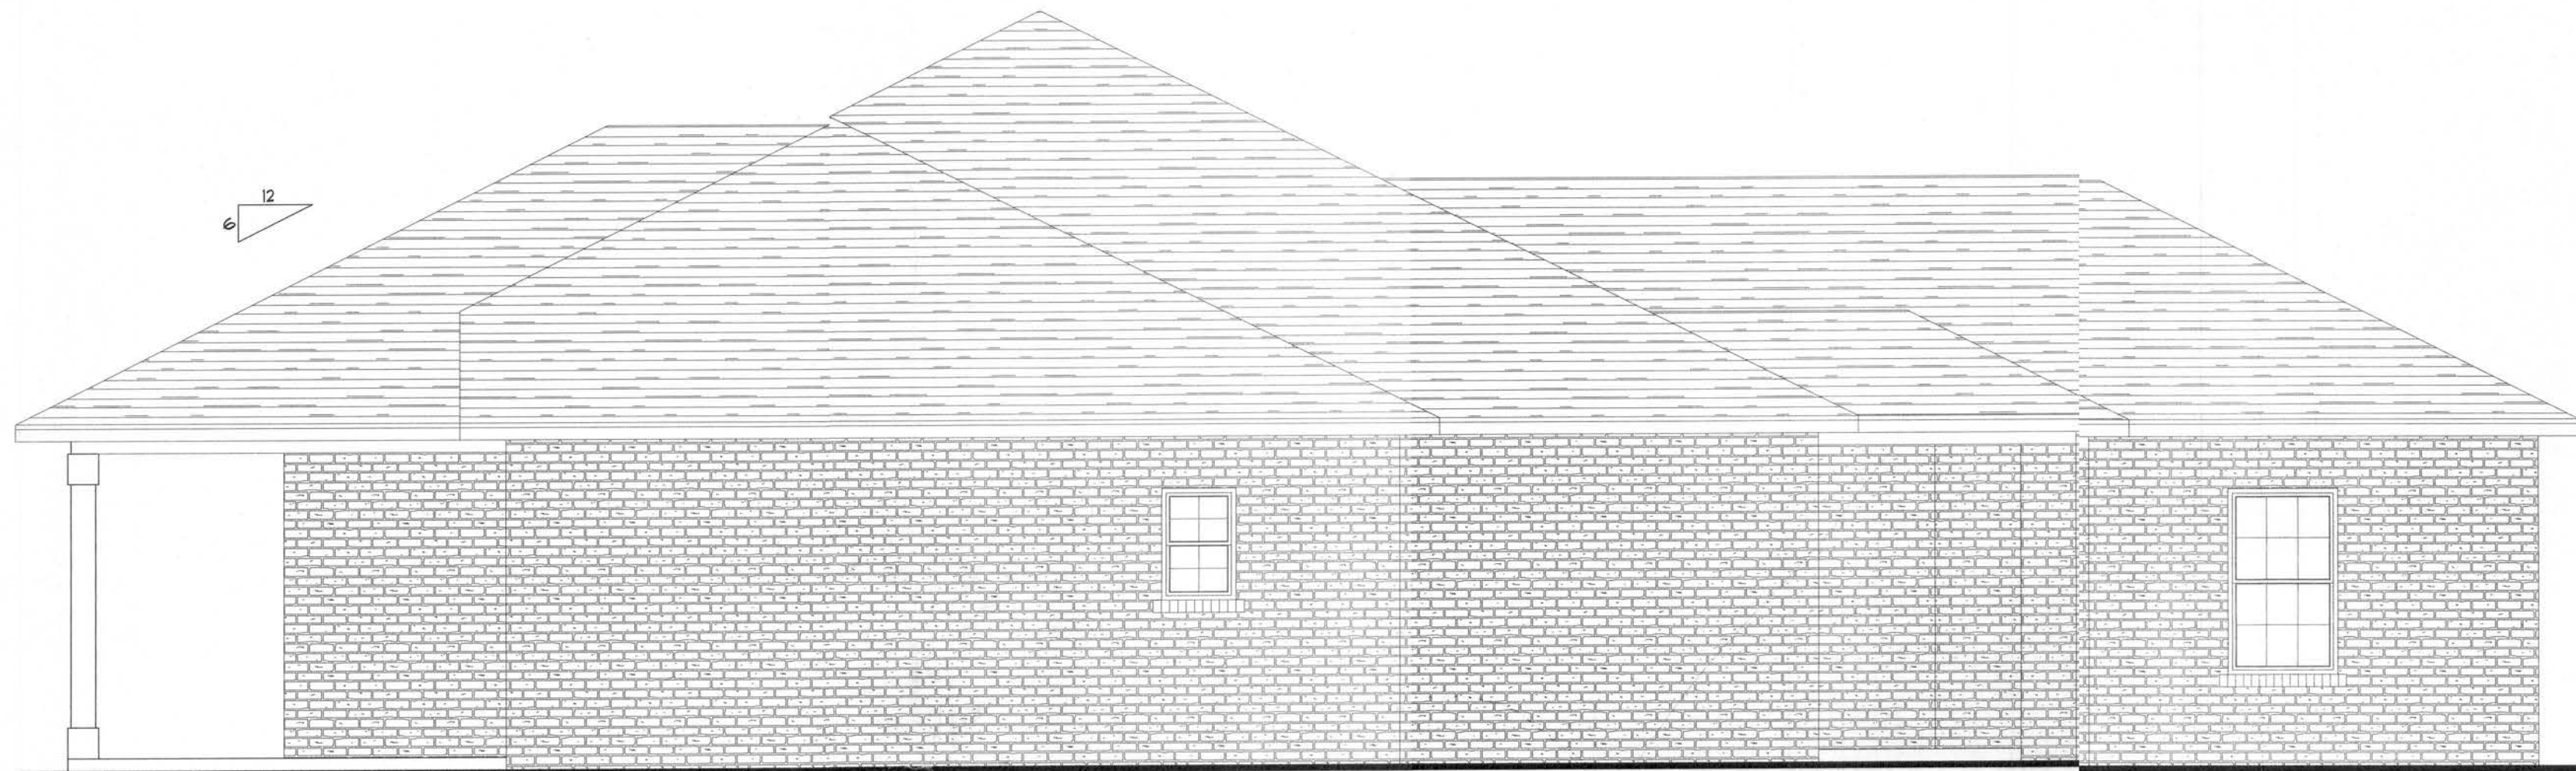

LEFT ELEVATION

SCALE: 1/4" = 1'-0"



RIGHT ELEVATION

SCALE: 1/4" = 1'-0"



REAR ELEVATION

SCALE: 1/4" = 1'-0"

ROOF VENTILATION:
R806.2 Minimum vent area.
The minimum net free ventilating area shall be 1/150 of the area of the vented space.
Exception: The minimum net free ventilation area shall be 1/300 of the vented space provided one or more of the following conditions are met:
1. In Climate Zones 6, 7 and 8, a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.
2. At least 40 percent and not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located no more than 3 feet below the ridge or highest point of the space, measured vertically, with the balance of the required ventilation provided by eave or cornice vents. Where the location of wall or roof framing members conflicts with the installation of upper ventilators, installation more than 3 feet below the ridge or highest point of the space shall be permitted.

Edgley Construction

Wilbur & Sylvia Fender Res.

PROJECT ADDRESS:
Colman County, FL

DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its correct law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined the plan, and that the applicable portions of the plan, relating to wind engineering comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915




Thursday, February 27, 2020

Mark Disosway P.E.
16: SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
200191


1
OF 3 SHEETS

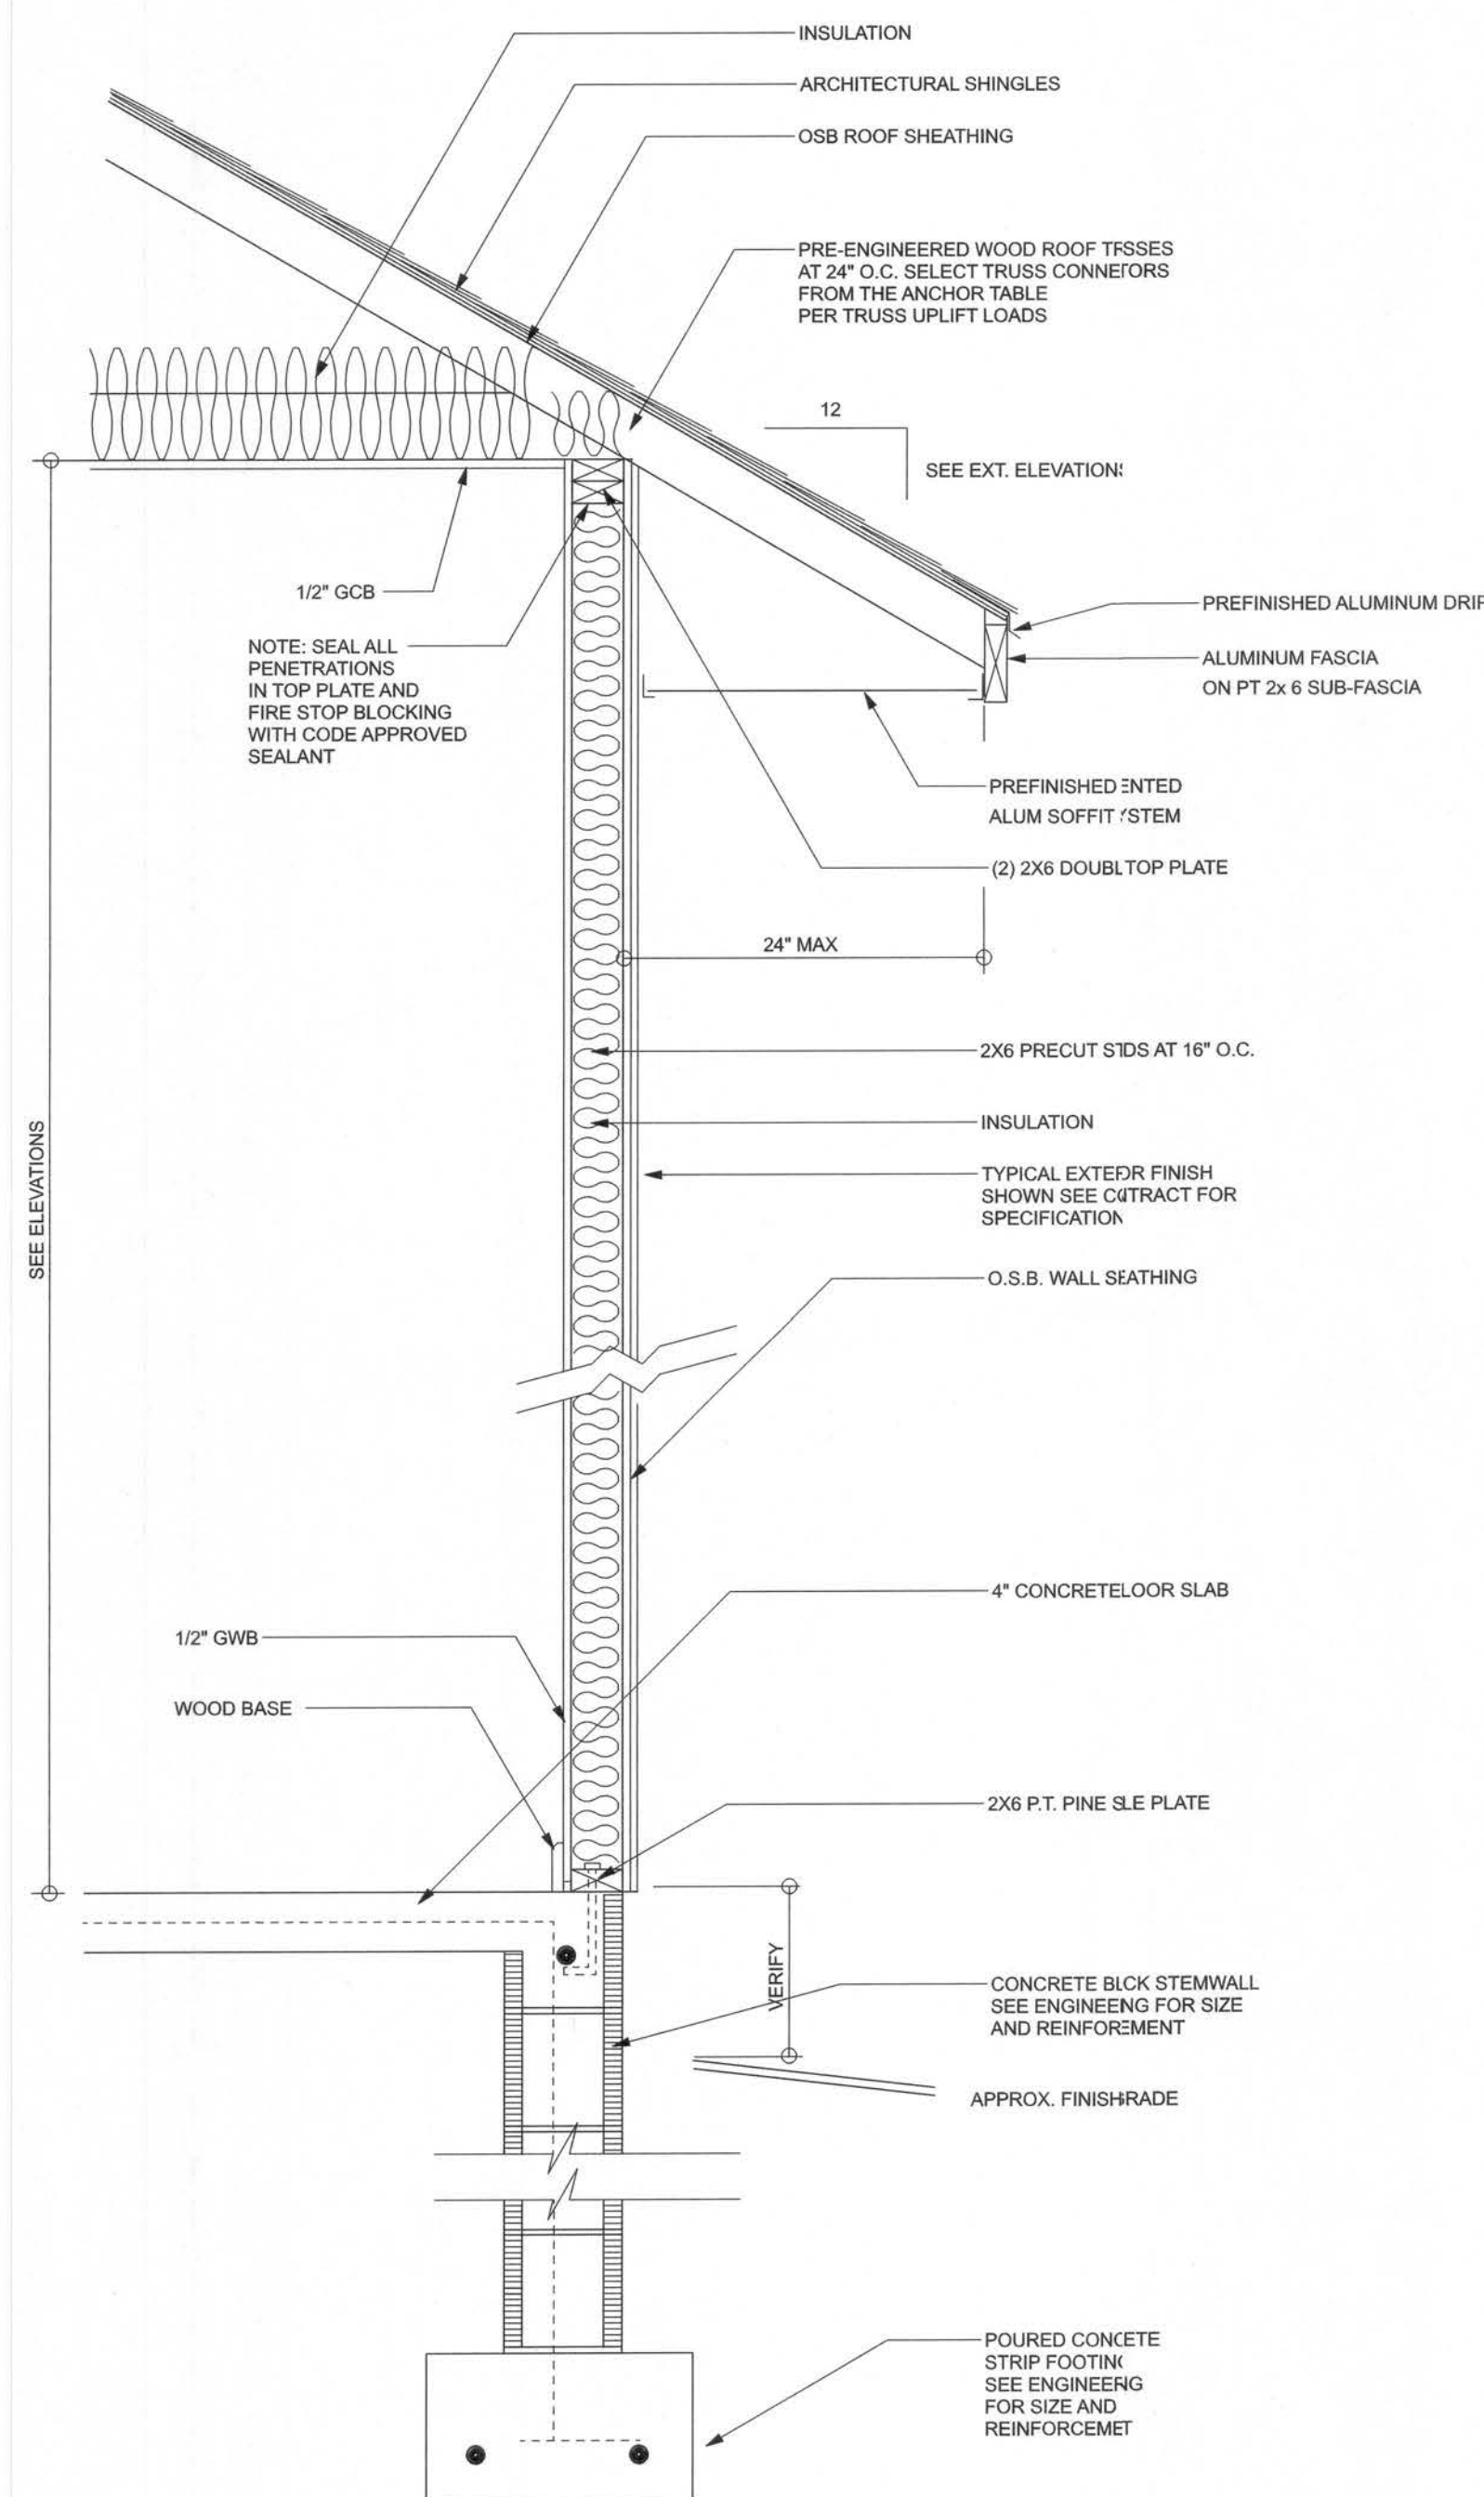

**TYPICAL DESIGN WALL SECTION
NON - STRUCTURAL DATA**

SCALE: 1" = 1'-0"

*Geplac
SYS*

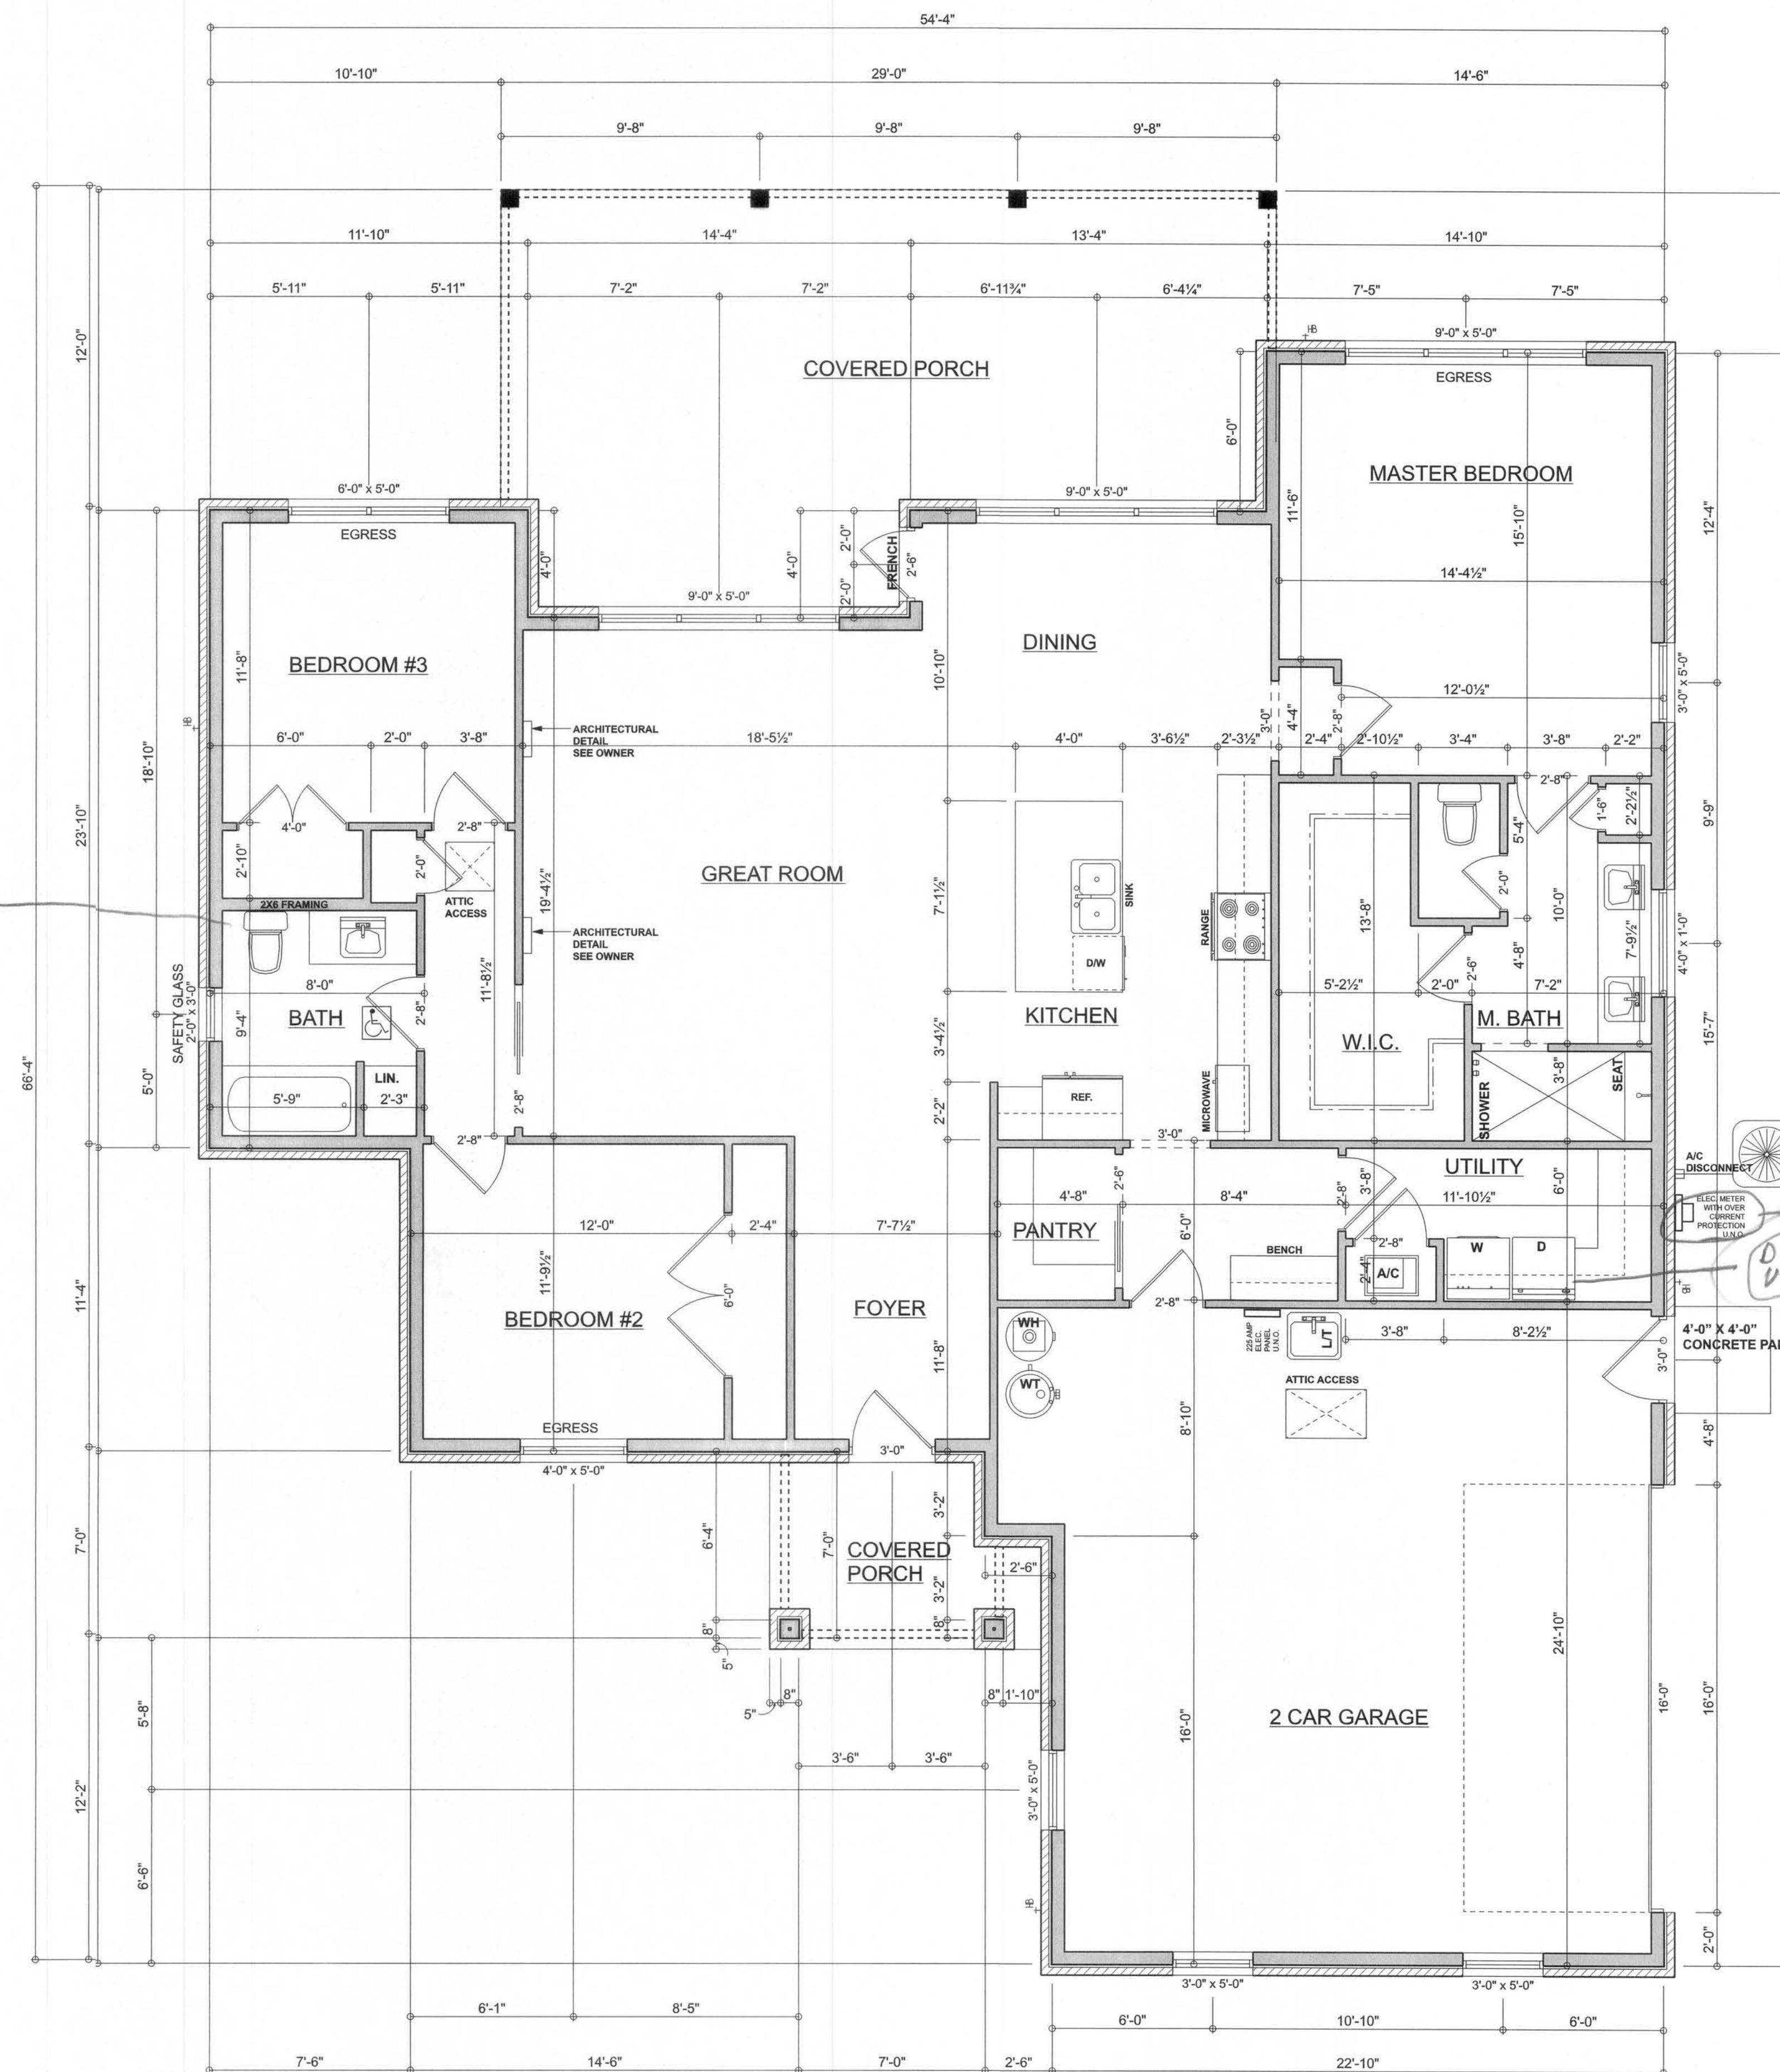

FLOOR PLAN

SCALE: 1/4" = 1'-0"
ALL CEILING HEIGHTS 9'-0" UNLESS NOTED OTHERWISE

R302.5.1 Opening protection:
Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches in thickness, solid or honeycomb-core steel doors not less than 1 3/8 inches thick, or 20-minute fire-rated doors, equipped with a self-closing device.

TABLE R302.6 DWELLING/GARAGE SEPARATION:	
SEPARATION	MATERIAL
From the residence and attics	Not less than 1/2-inch gypsum board or equivalent applied to the garage side
From all habitable rooms above the garage	Not less than 5/8-inch Type X gypsum board or equivalent
Structure(s) supporting floor/ceiling assemblies used for separation required by this section	Not less than 1/2-inch gypsum board or equivalent
Garages located less than 3 feet from a dwelling unit on the same lot	Not less than 1/2-inch gypsum board or equivalent applied to the interior side of exterior walls that are within this area

AREA SUMMARY

LIVING AREA	1715	S. F.
GARAGE AREA	588	S. F.
PORCH AREA	460	S. F.
TOTAL AREA	2763	S. F.

Wick

*200 Amp
W/4000 3 Ton*

*DIYUS
V4.7*

Eddley Construction

Wilbur & Sylvia Fender Res.

PROJECT ADDRESS:
Columbia County, FL


DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building at specified location.

MARK DISOWAY P.E. 53915

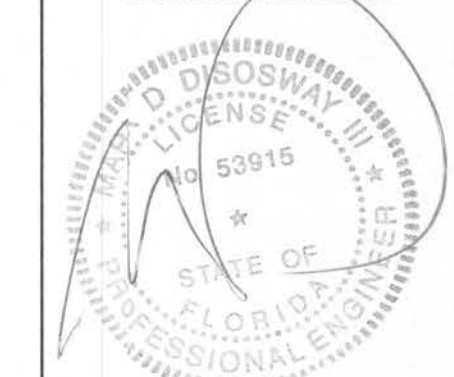

Thursday, February 27, 2020

Mark Disoway P.E.
113 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com


JOB NUMBER:
200191

2
OF 3 SHEETS

ELECTRICAL PLAN NOTES

- E -1 WIRE ALL APPLIANCES, HVAC UNIT AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
- E -2 CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
- E -3 ALL INSTALLATIONS SHALL BE PENAT'L. ELECTRIC CODE.
- E -4 ALL SMOKE DETECTORS SHALL B120V W/ BATTERY BACKUP OF THE PHOTOELECTRICITY, AND SHALL BE INTERLOCKED TOGETHER. INTALL INSIDE AND NEAR ALL BEDROOMS.
- E -5 TELEPHONE, TELEVISION AND OTER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE \$ PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE Y APPLICABLE SECTIONS OF NEC-LATEST EDITIO.
- E -6 ELECTRICAL CONTR SHALL BE RBPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICALSERVICE AND CIRCUITS.
- E -7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER CMpany.
- E -8 ALL 120-VOLT, SINGLE-PHASE, 15-ND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED I DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, FLOORS, LIBRARIES, DENS, BEDROOMS, SUN ROOMS, RECREATION ROOM, CLOSETS, HALLWAYS , OR SIMILAR ROOMS OR AREAS SHALL BE PROECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
- E -9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION
- E -10 A SERVICE DISCONNECT WITH OVR CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THPLACE ELECTRIC CONDUCTORS ENTER THE BUILDIG. SERVICE ENTRANCE CONDUCTOR MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFIAL.
- E -11 CARBON MONOXIDE ALARMS SHA. BE REQUIRED WITHIN 10' OF ALL ROOMS FOR SLEEPING PUPOSES IN BUILDINGS HAVING A FOSSIL-FUEL-BURNING HEATEROR APPLIANCE, A FIREPLACE, OR ATTACHED GARAGE.
- E -12 ALL OUTLETS LOCATED IN RESIDITIAL TO BE TAMPER-RESISTANT PER NC.

ELECTRICAL LEGEND	
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	2X4 FLUORESCENT LIGHT FIXTURE
	RECESSED CAN LIGHT
	BATH EXHAUST FAN WITH LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET
	220v OUTLET
	GFI DUPLEX OUTLET
	SMOKE DETECTOR
	WALL SWITCH
	3 WAY WALL SWITCH
	4 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	PHONE JACK
	TELEVISION JACK
	GARAGE DOOR OPENER
	CARBON MONOXIDE ALARM

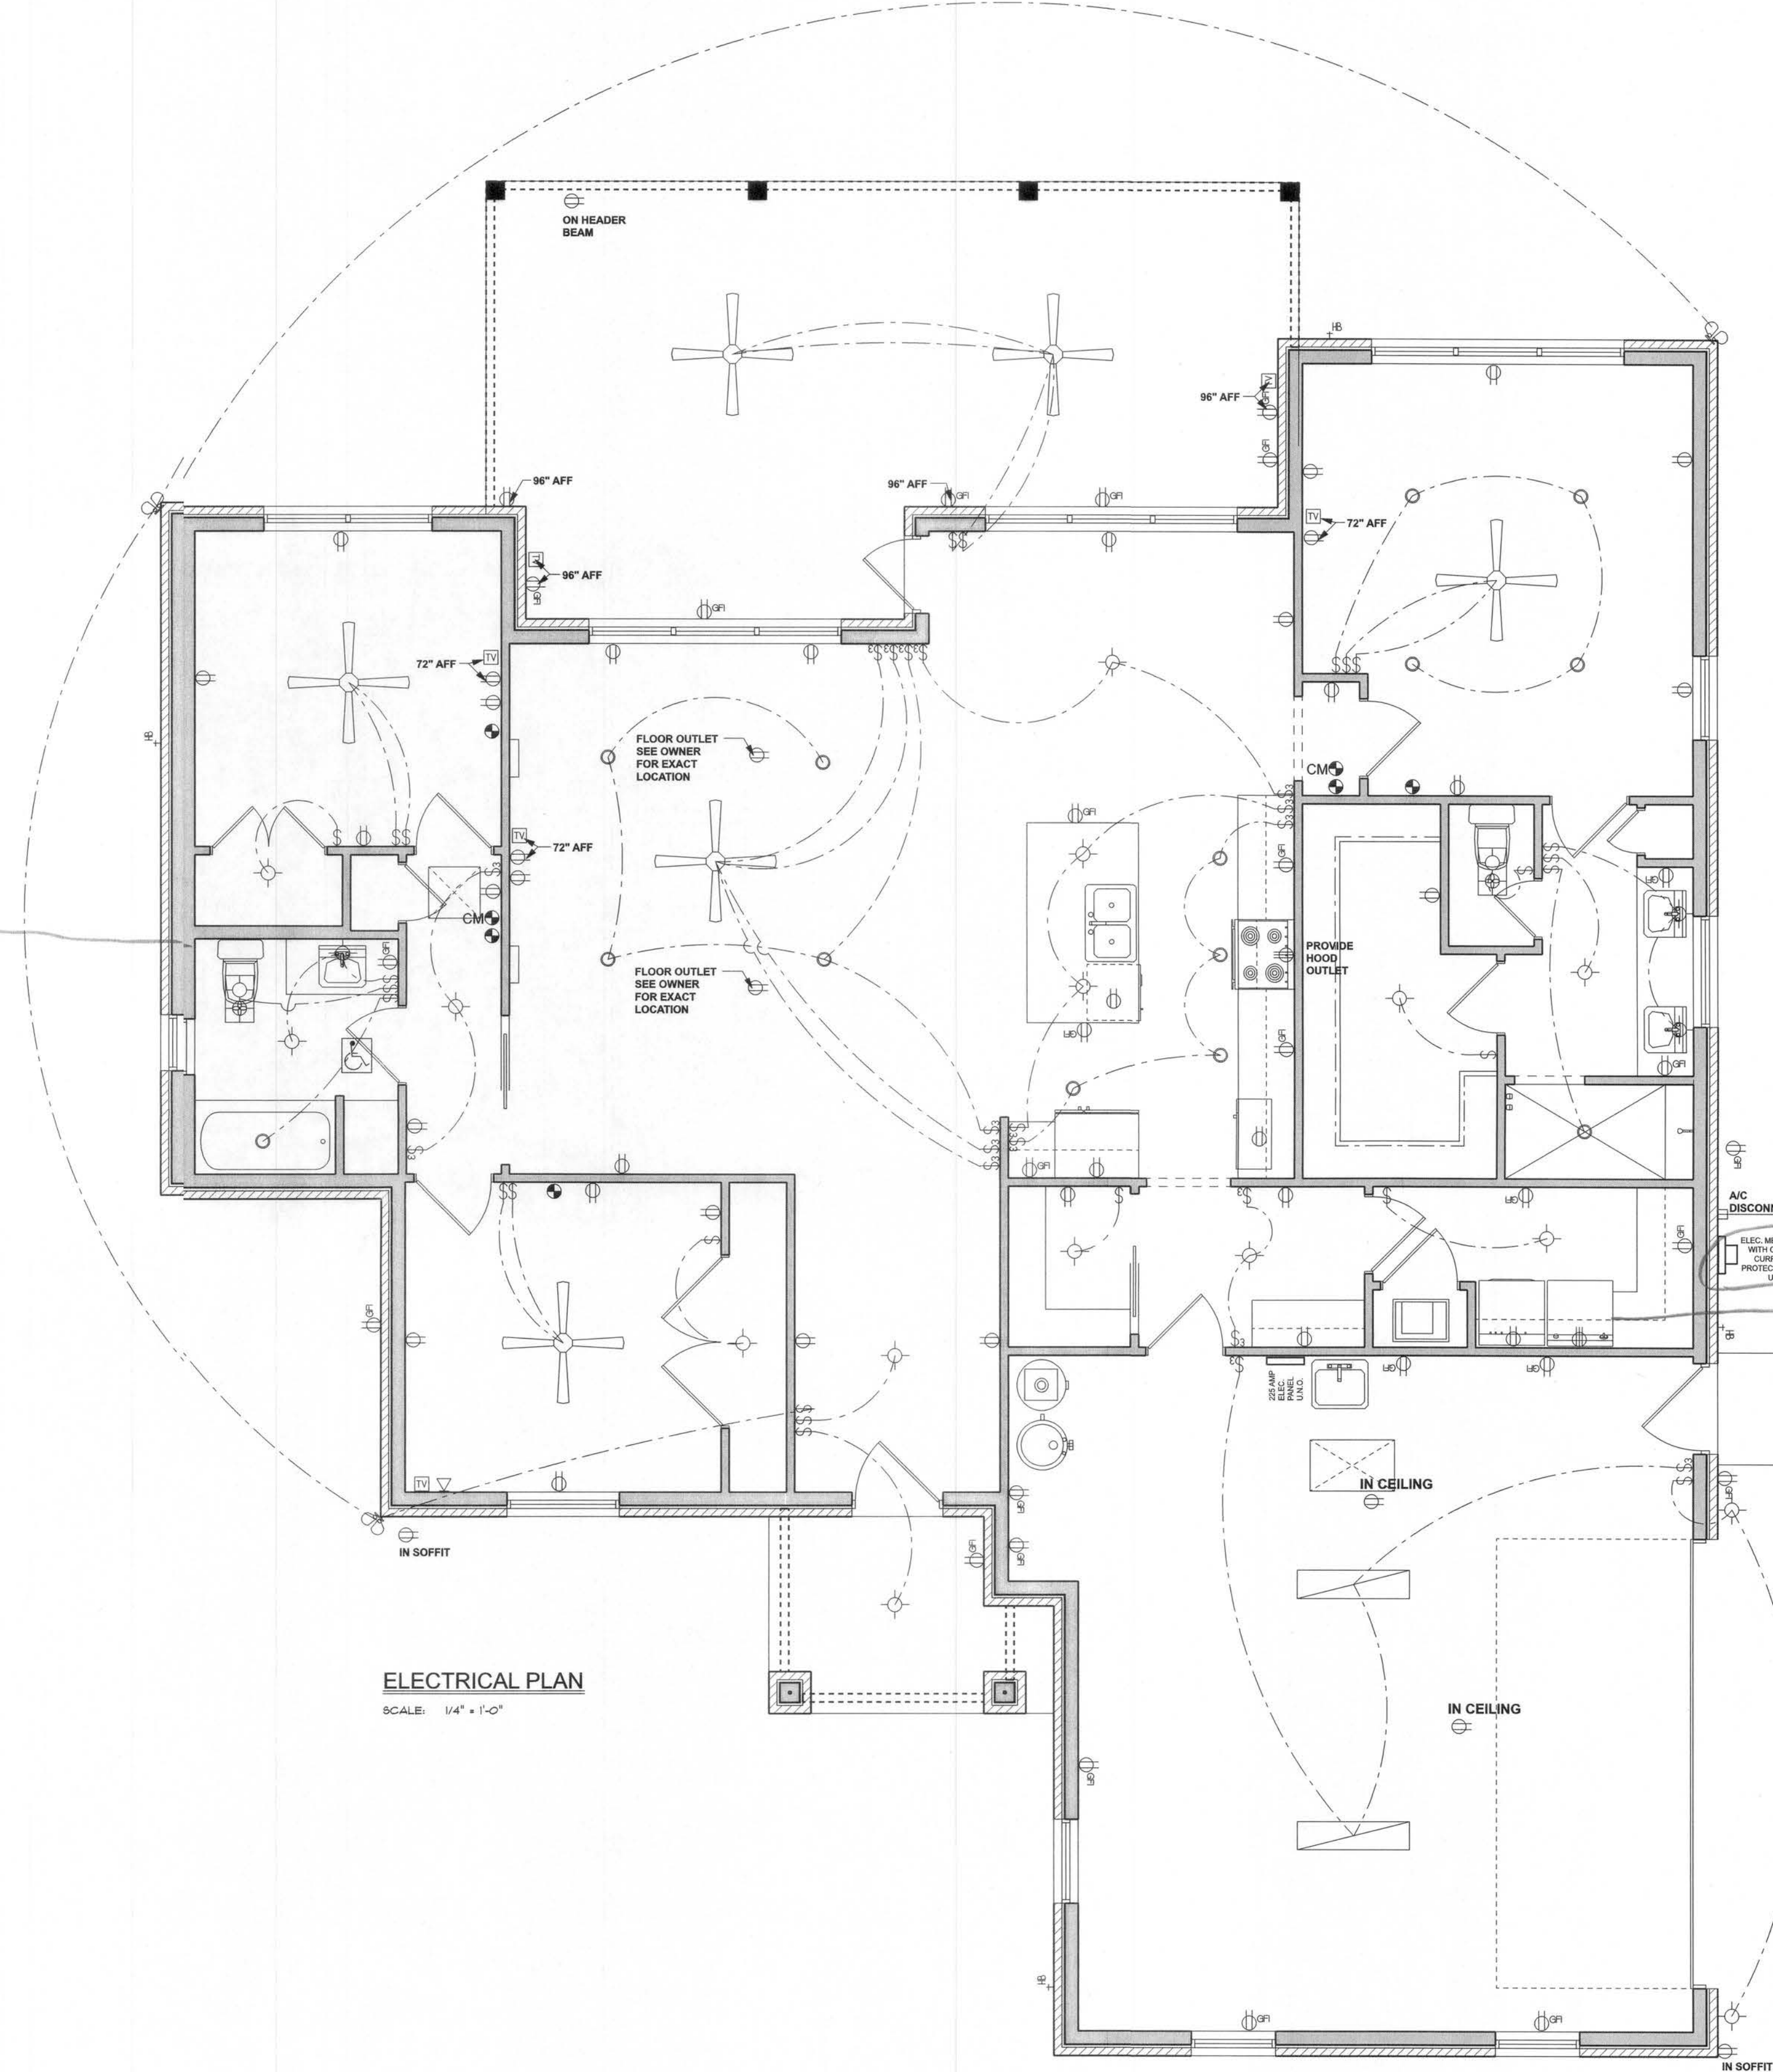

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

Edgley Construction

Wilbur & Sylvia Fender Res.

PROJECT ADDRESS:
Columbia County, FL

DIMENSIONS:
Stated dimensions supercode scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915



Thursday, February 27, 2020

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
200191


3
OF 3 SHEETS



TALL STEM WALL TABLE:

The table assumes 60 ksi reinforcing bars with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC vertically or a horizontal bond beam with #6s continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48




MASONRY NOTE:	
CONTRACTOR CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCI 530.1-102). THE CONTRACTOR AND MASONRY SHALL BE NOTIFIED IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-102 AND THESE DESIGN DRAWINGS.	
ANY EXCEPTIONS TO ACI 530.1-102 SHALL BE APPROVED BY THE ENGINEER IN WRITING.	
ACI530.1-102 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls $F_m = 1500$ psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, minimum required approval
3.1 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface texture, $\sqrt{f'_m} \geq 10$ psi, running bond and 12"x12" or 10"x10" column block
3.2 Clay brick standard	ASTM C 1161-02, Grade SW, Type FBS, 8"x16"x26 1/8" U
4.2 Reinforcing bars, #3 - #11	ASTM B16, Grade 40, $F_y = 40$ ksi, Lap splices 40 bar dia. or greater
2.4 Reinforcing for corrosion protection	ASTM A618, Grade 60, $F_y = 60$ ksi, Lap splices 40 bar dia. or greater Anchors, steel reinforcement is completely embedded in mortar or grout, ASTM A618, Grade 60, 1.00 in. dia. 304SS
2.4 Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, steel mortar ties not completely embedded in mortar or grout, ASTM A153, Grade 2, 1.50 oz/ft ² or 304SS
3.2.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not indicated on project drawings.

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF
12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL
PER FBC 2017-RES. SECTION R403.1.4



FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISMISSAWY DESIGN GROUP OR CONTRACTOR DISMISSAWY, BE RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) FOR ALL INTERIOR BEARING ZONES.
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED W/ 6X6-1/4" LA WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLYESTER BARRIER W/ 1/2" MIN. GAP SEALANT, 1/2" POLY TAPE OVER THE ENTIRE TREATED & COMPACTED FILL.

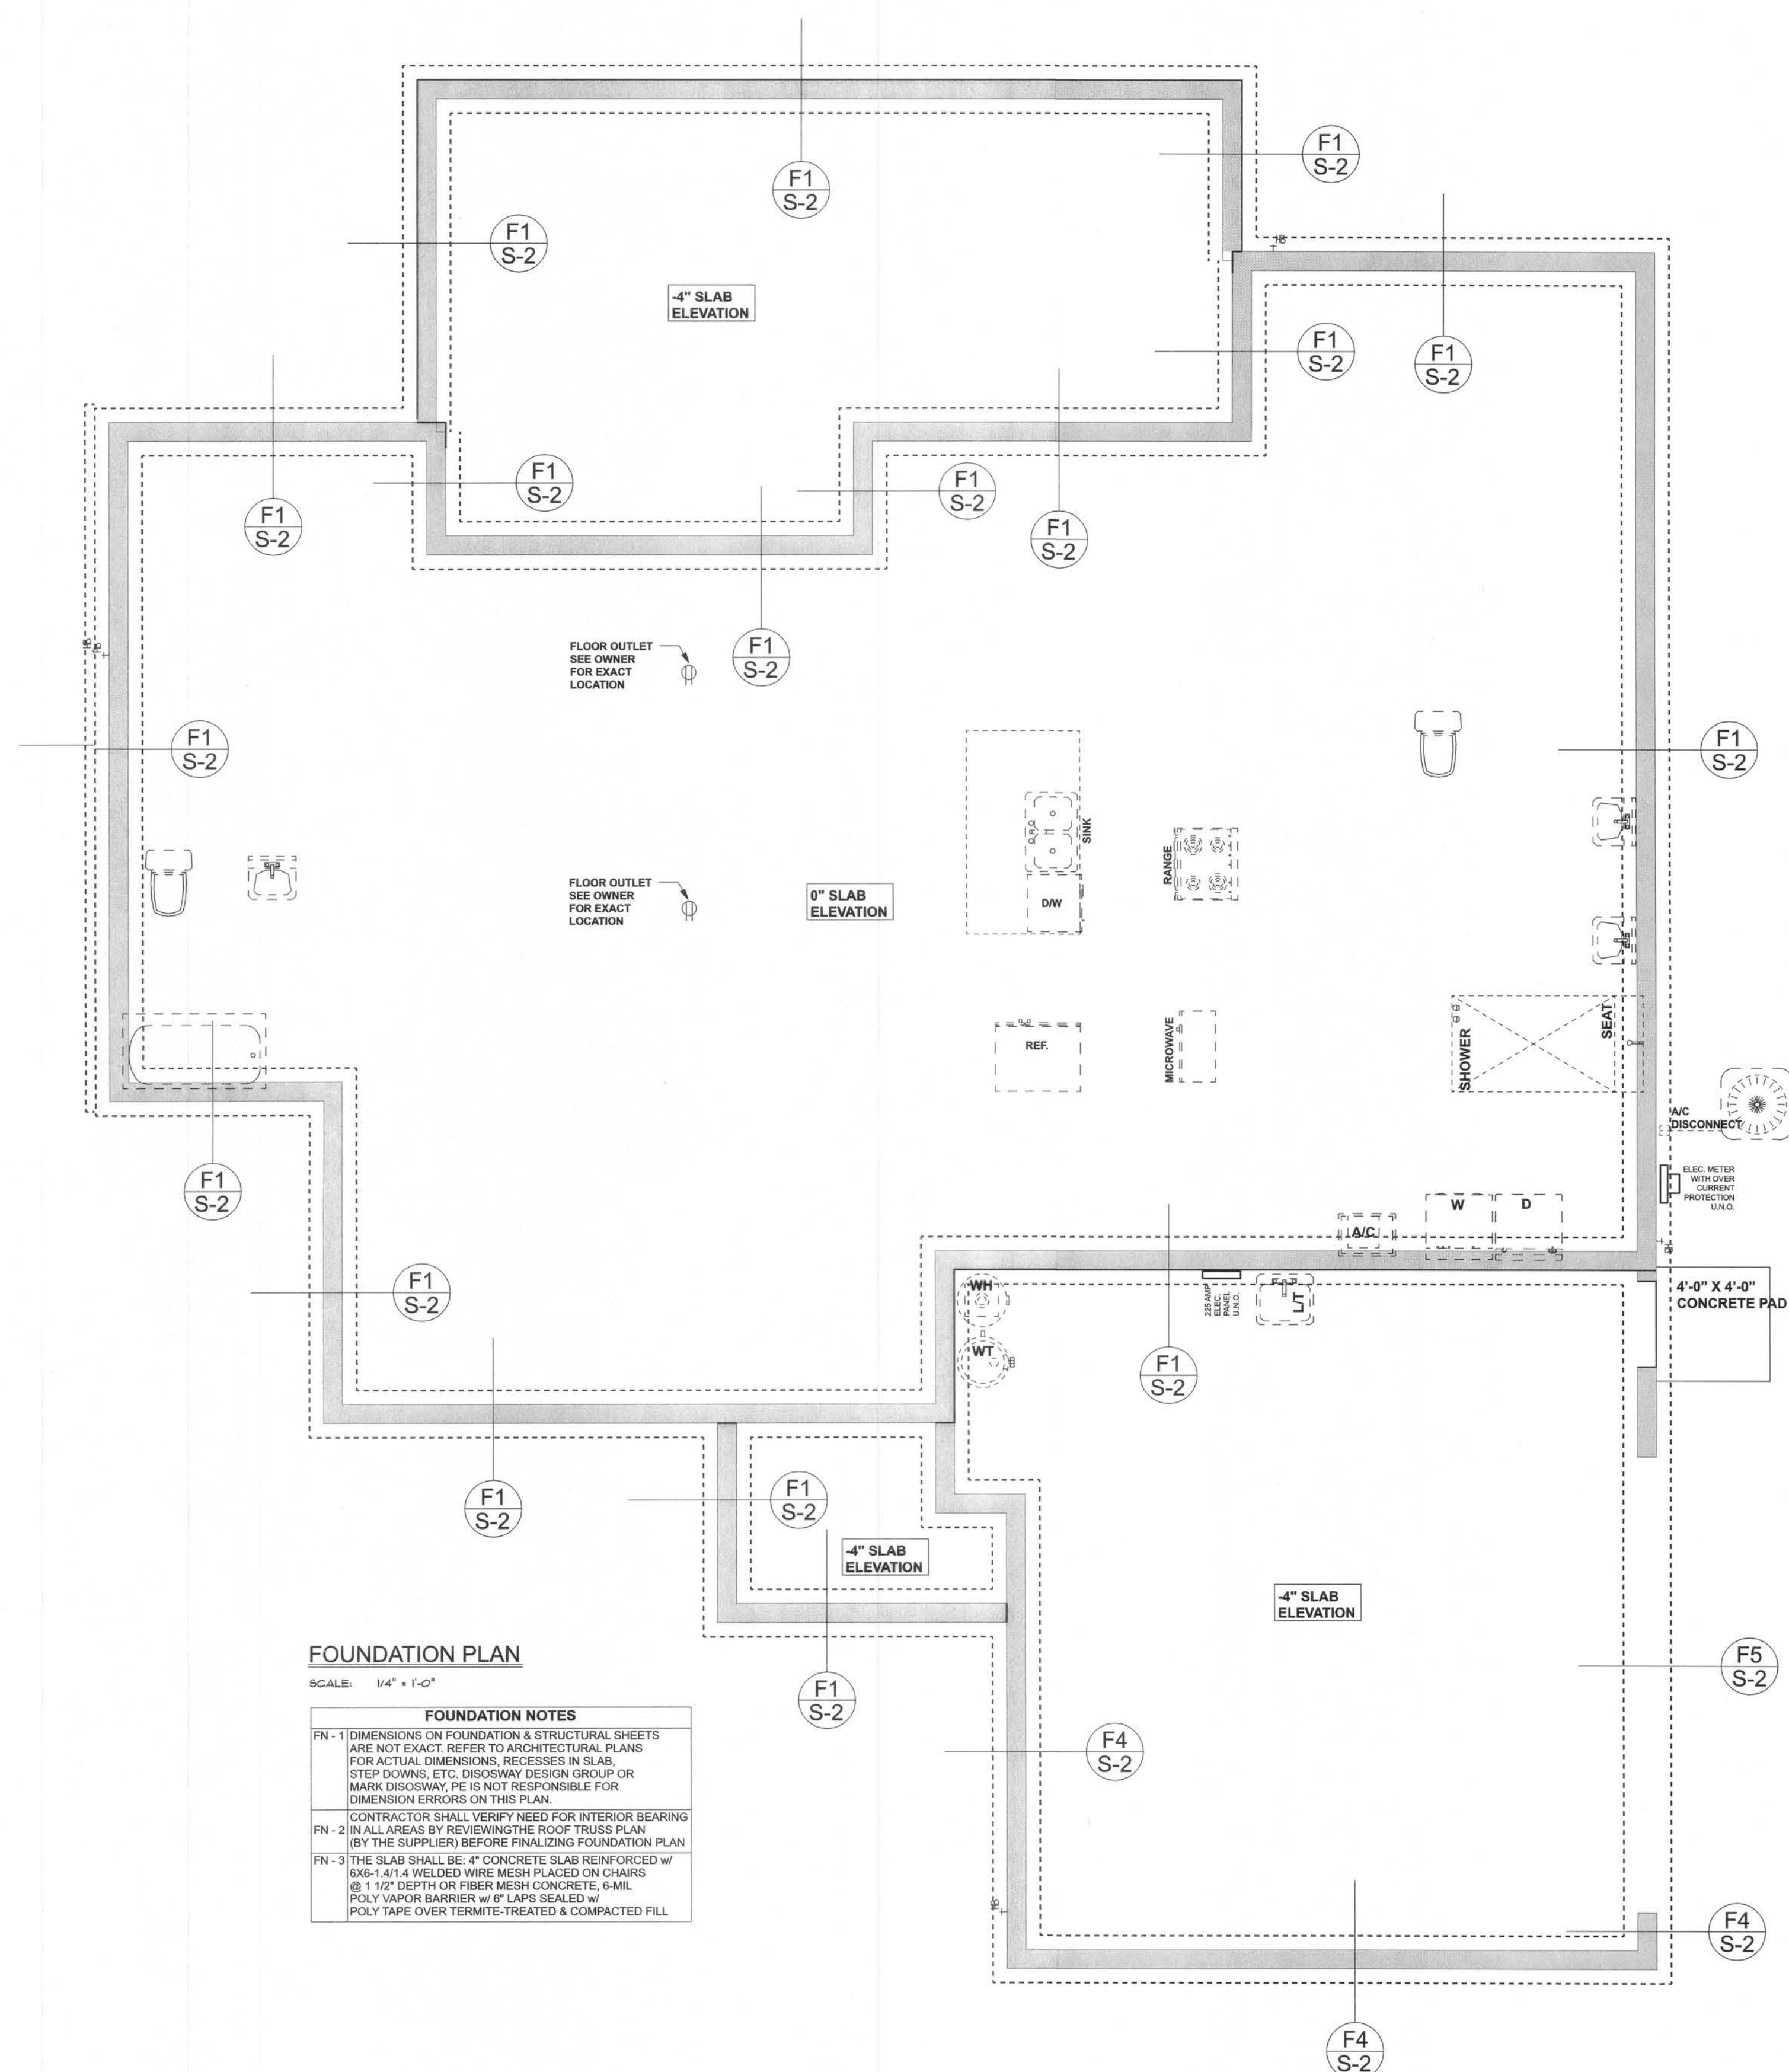

Edgley Construction

Wilbur & Sylvia Fender Res.

PROJECT ADDRESS:

DIMENSIONS:
Stated dimensions supercede scale dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property rights in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering, comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915




Thursday, February 27, 2020

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
200191

S-2

OF 3 SHEETS

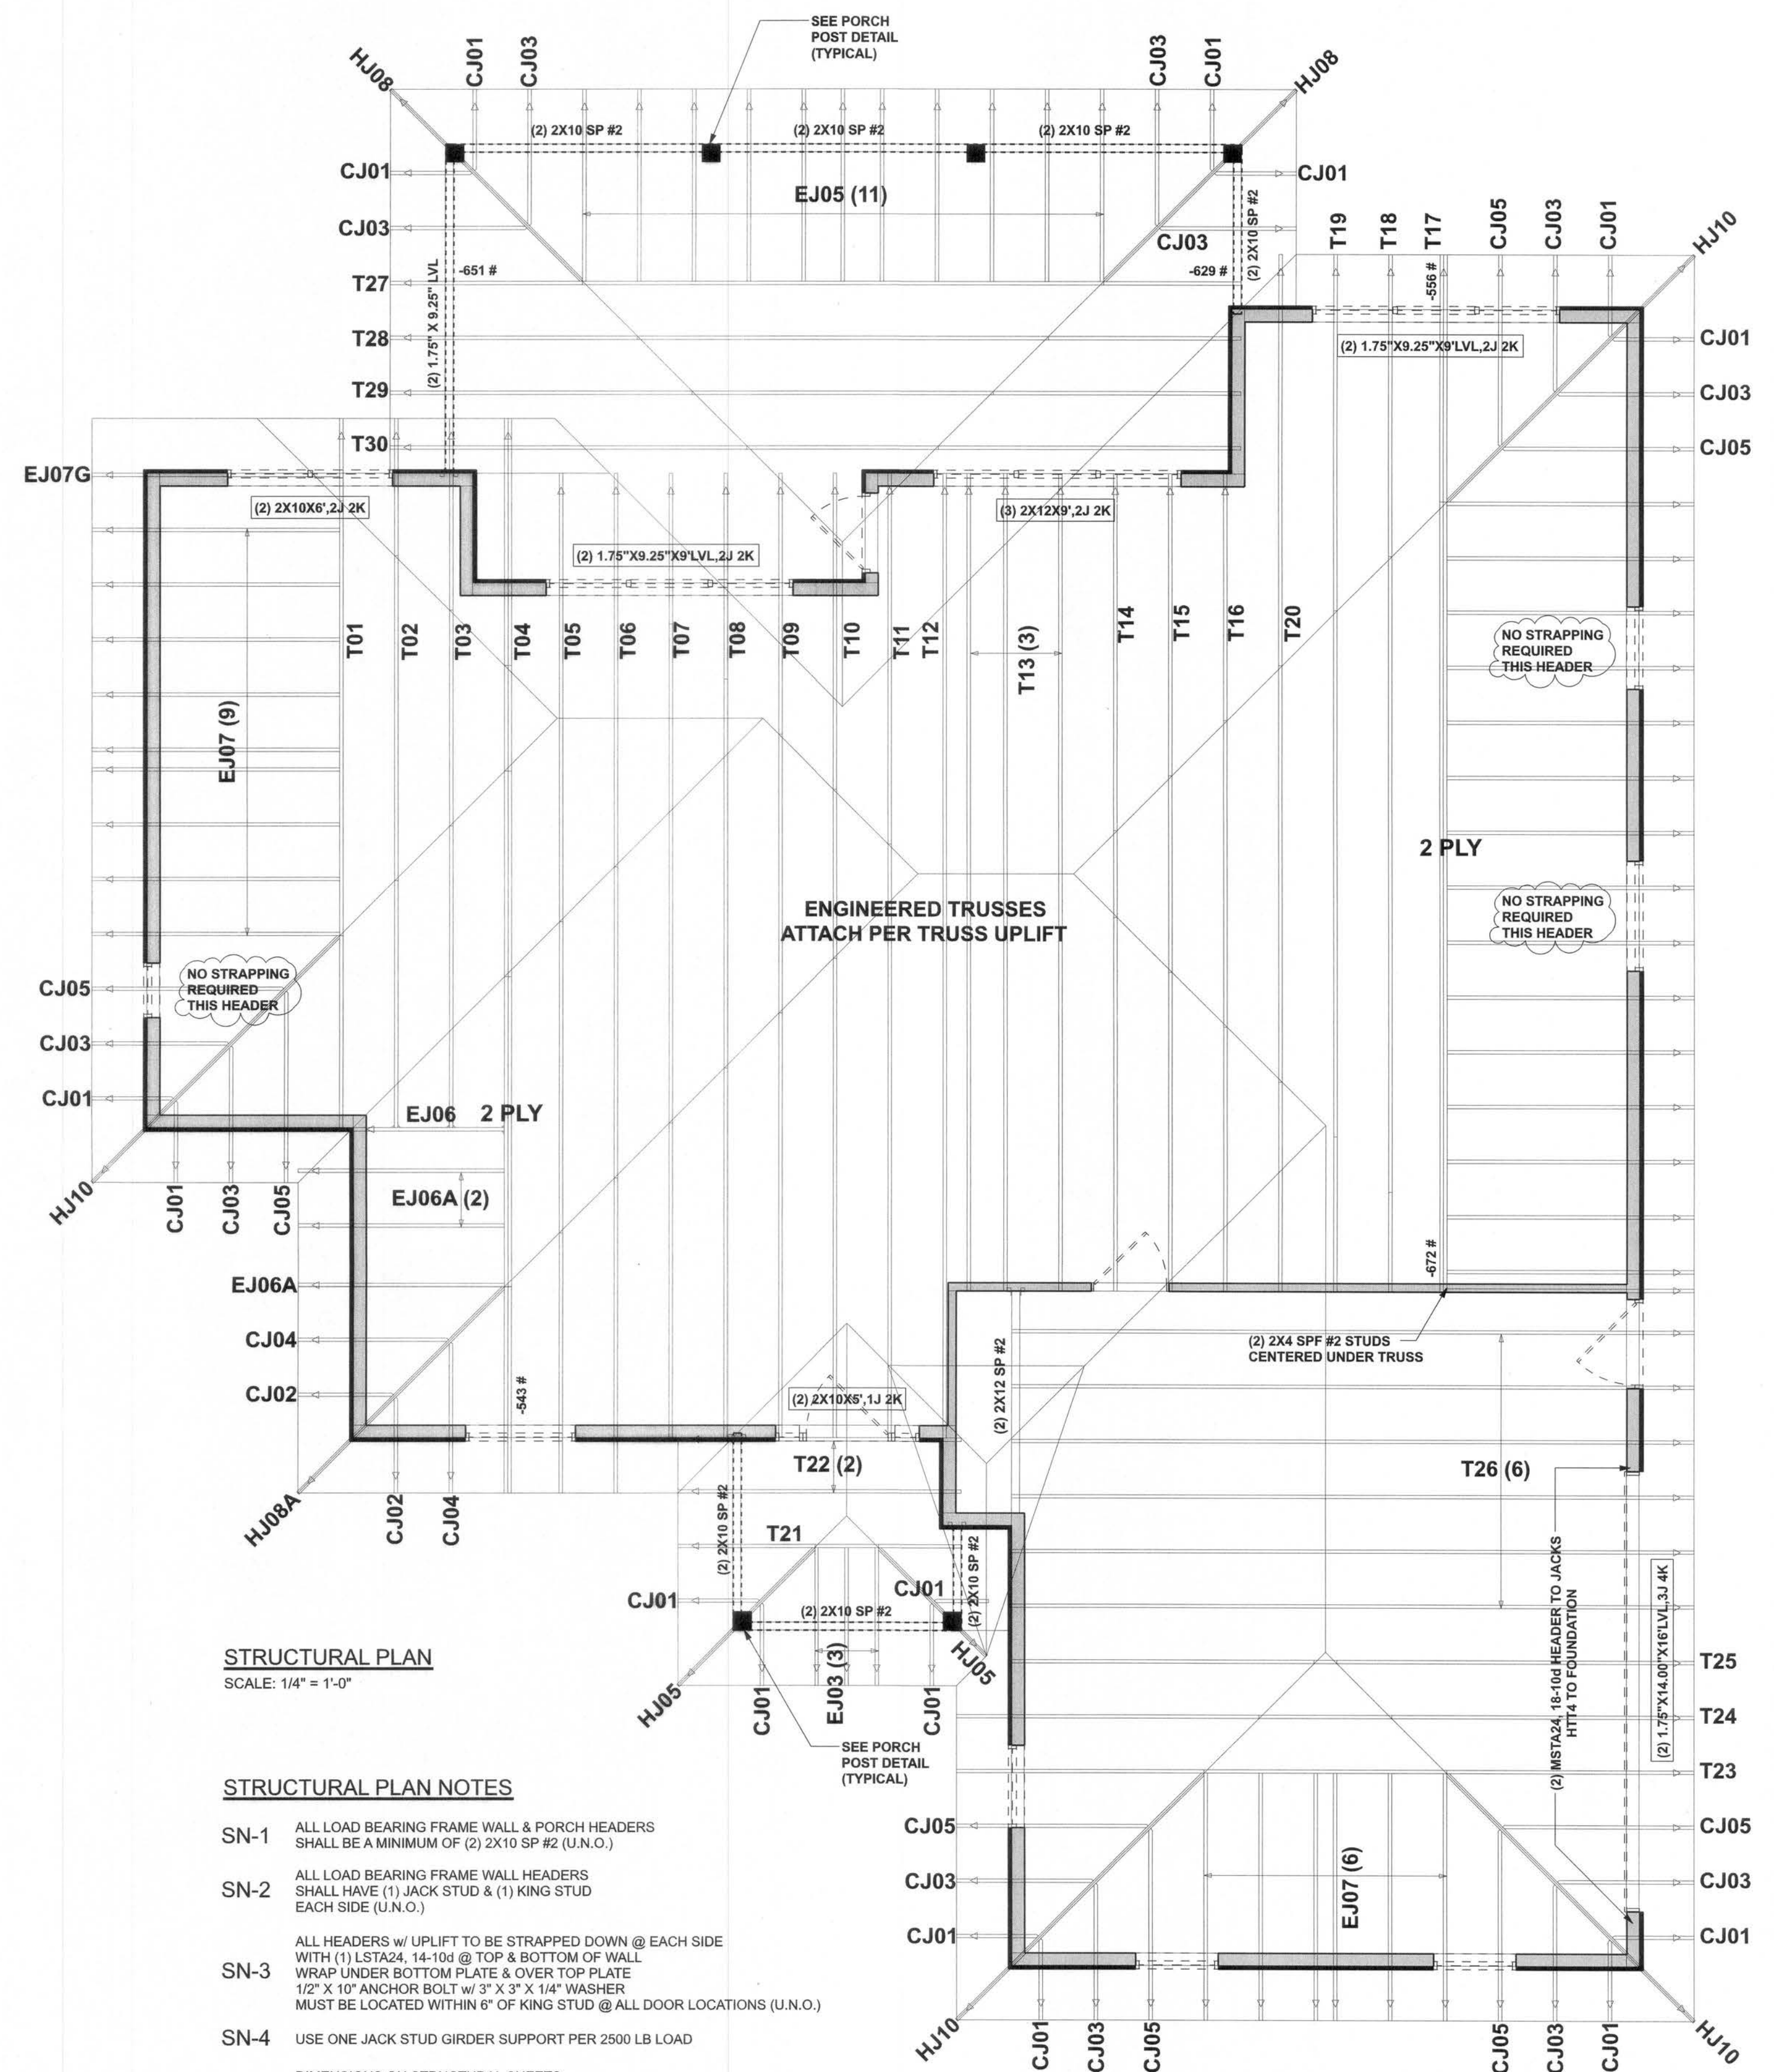


STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 ALL HEADERS w/ UPLIFT TO BE STRAPPED DOWN @ EACH SIDE WITH (1) LSTA24, 14-104 @ TOP & BOTTOM OF WALL WRAP UNDER BOTTOM PLATE & OVER TOP PLATE 1/2" X 10" ANCHOR BOLT w/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
- SN-4 USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
- SN-5 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-6 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI-1-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

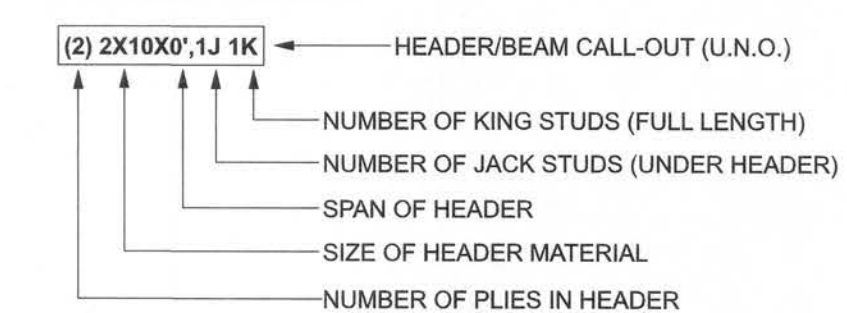

ACTUAL vs REQUIRED SHEARWALL	
TRANSVERSE	LONGITUDINAL
ACTUAL 26232 LBF	14208 LBF
REQUIRED 11017 LBF	12878 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. BUILDERS FIRST SOURCE JOB #883369

Edgley Construction

Wilbur & Sylvia Fender Res.

PROJECT ADDRESS:
Columbia County, FL


DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building at specified location.

MARK DISOWAY P.E. 53915

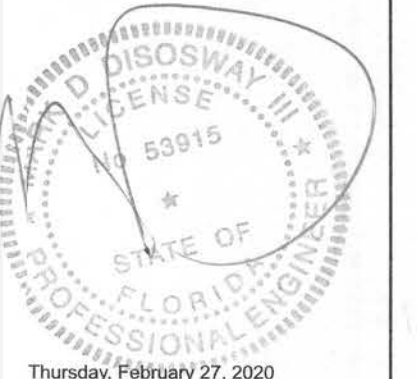

Thursday, February 27, 2020

Mark Disoway P.E.
113 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
200191
S-3
OF 3 SHEETS