




Note:
THIS ELECTRICAL PLAN IS A SCHEMATIC WITH SUGGESTED SWITCH, RECEPTACLE AND LIGHT FIXTURE LOCATIONS, DUE TO VARYING LOCAL AND STATE CODES, REGULATIONS, AND STATUTES. IT IS THE RESPONSIBILITY OF THE OWNER AND/OR CONTRACTOR TO COMPLY WITH ALL LOCAL AND STATE CODES, REGULATIONS AND STATUTES.


ELECTRICAL NOTES:
INSTALLATION SHALL BE PER 2017 NAT'L. ELECTRIC CODE.
NOTE:
CONTRACTORS TO VERIFY ALL DIMENSIONS, CODES AND STRUCTURAL DESIGNS TO COMPLY WITH ALL AUTHORITIES HAVING JURISDICTION.

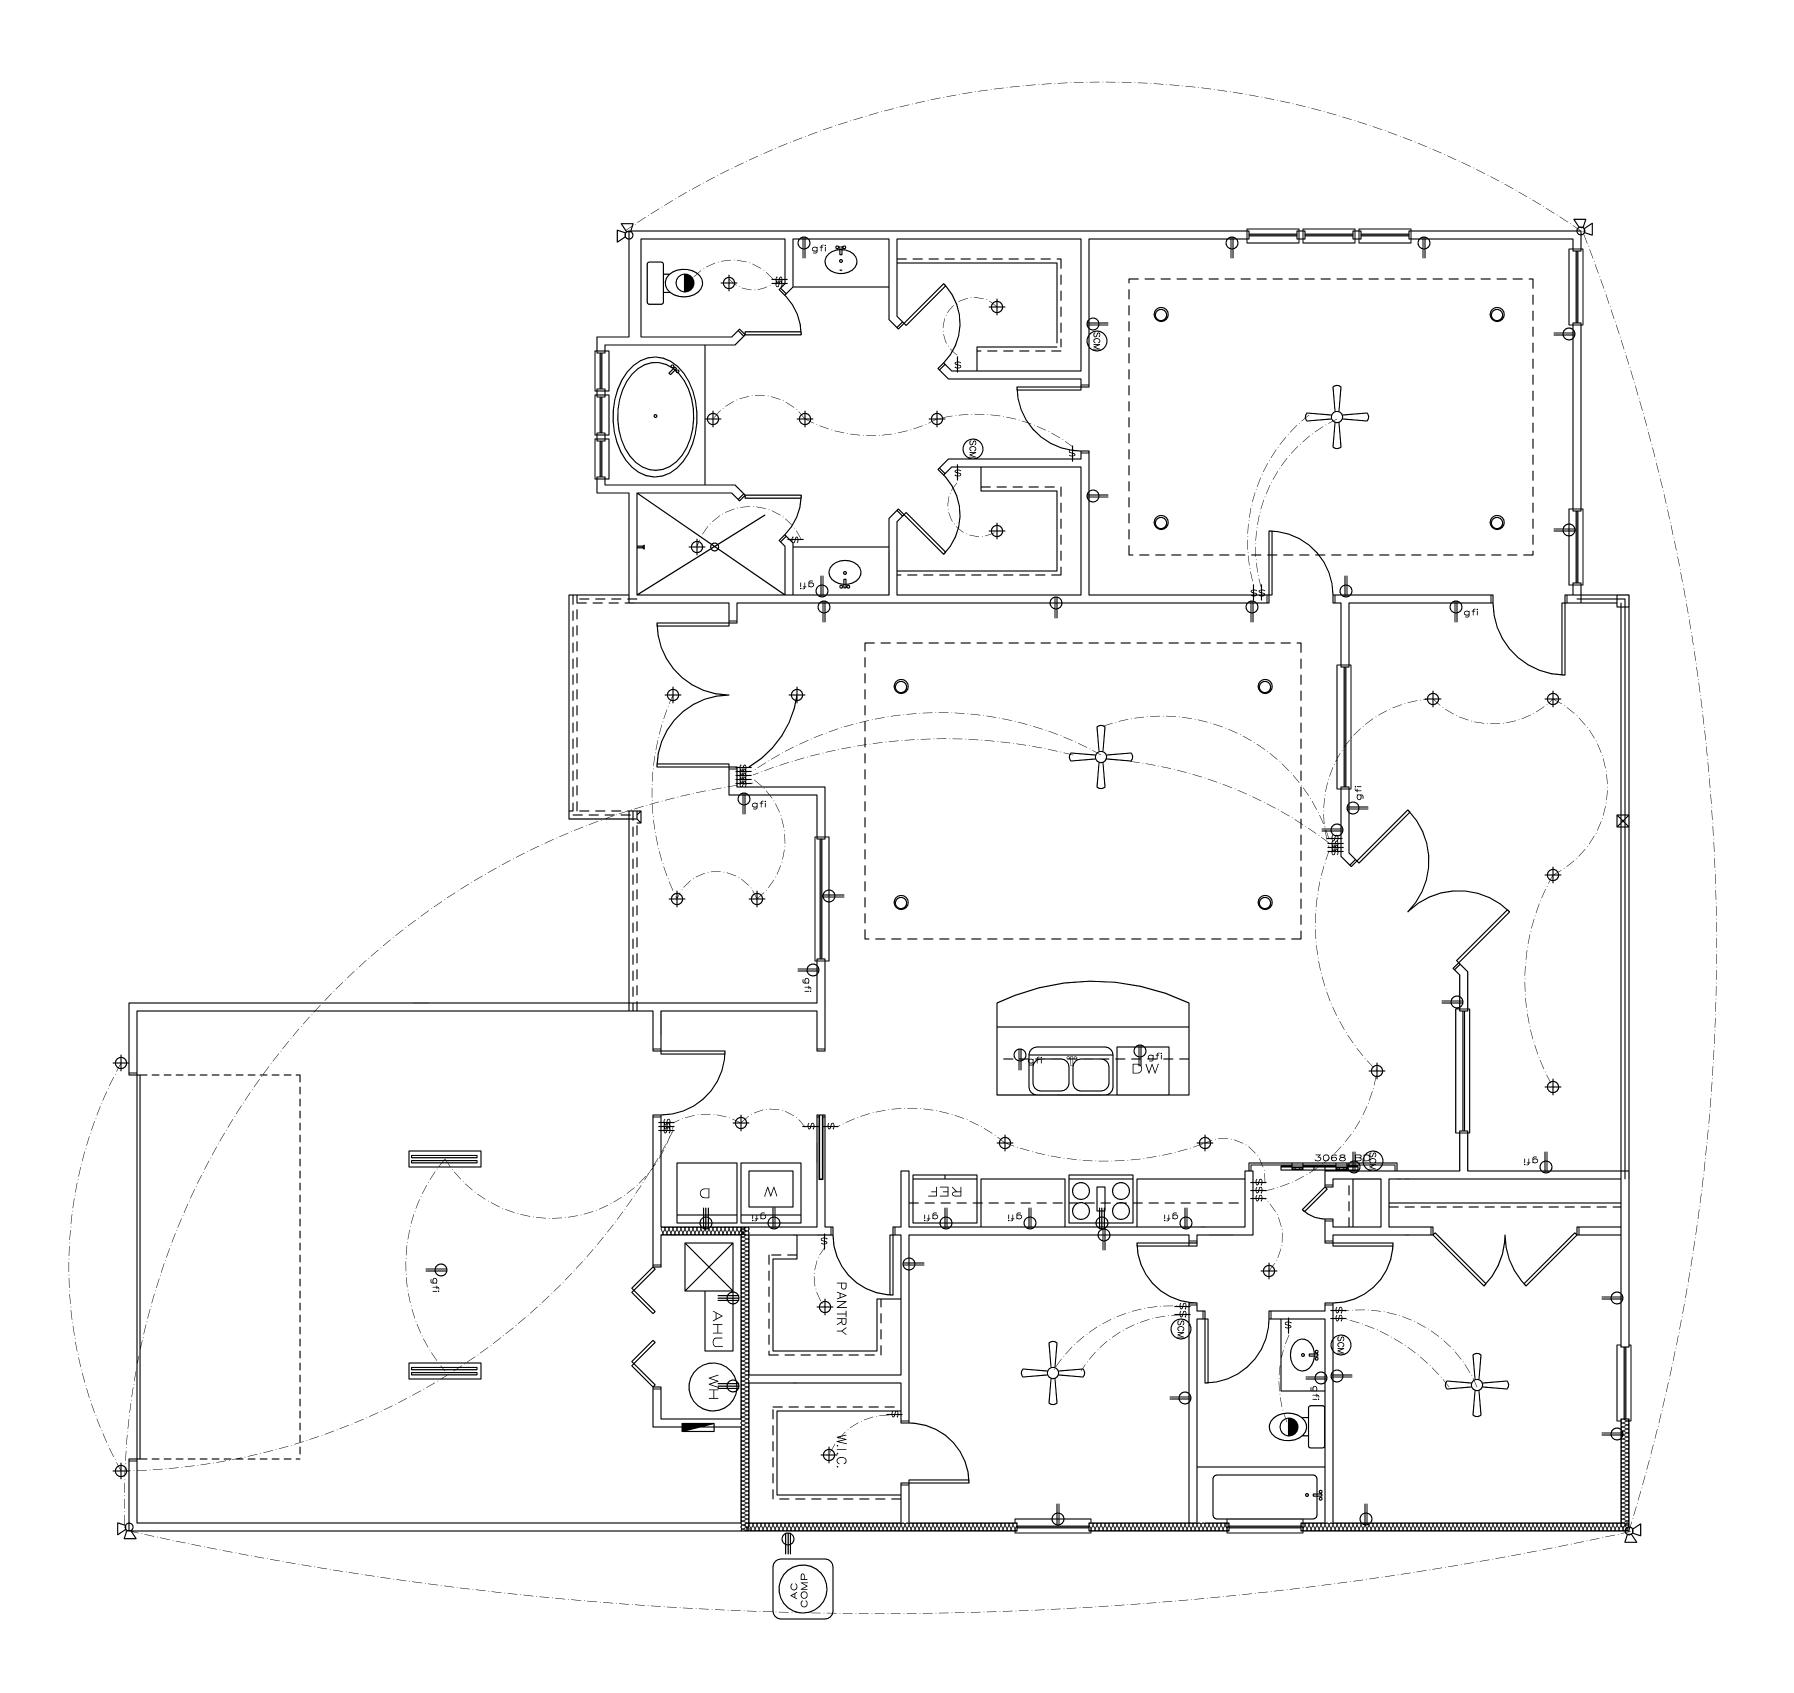


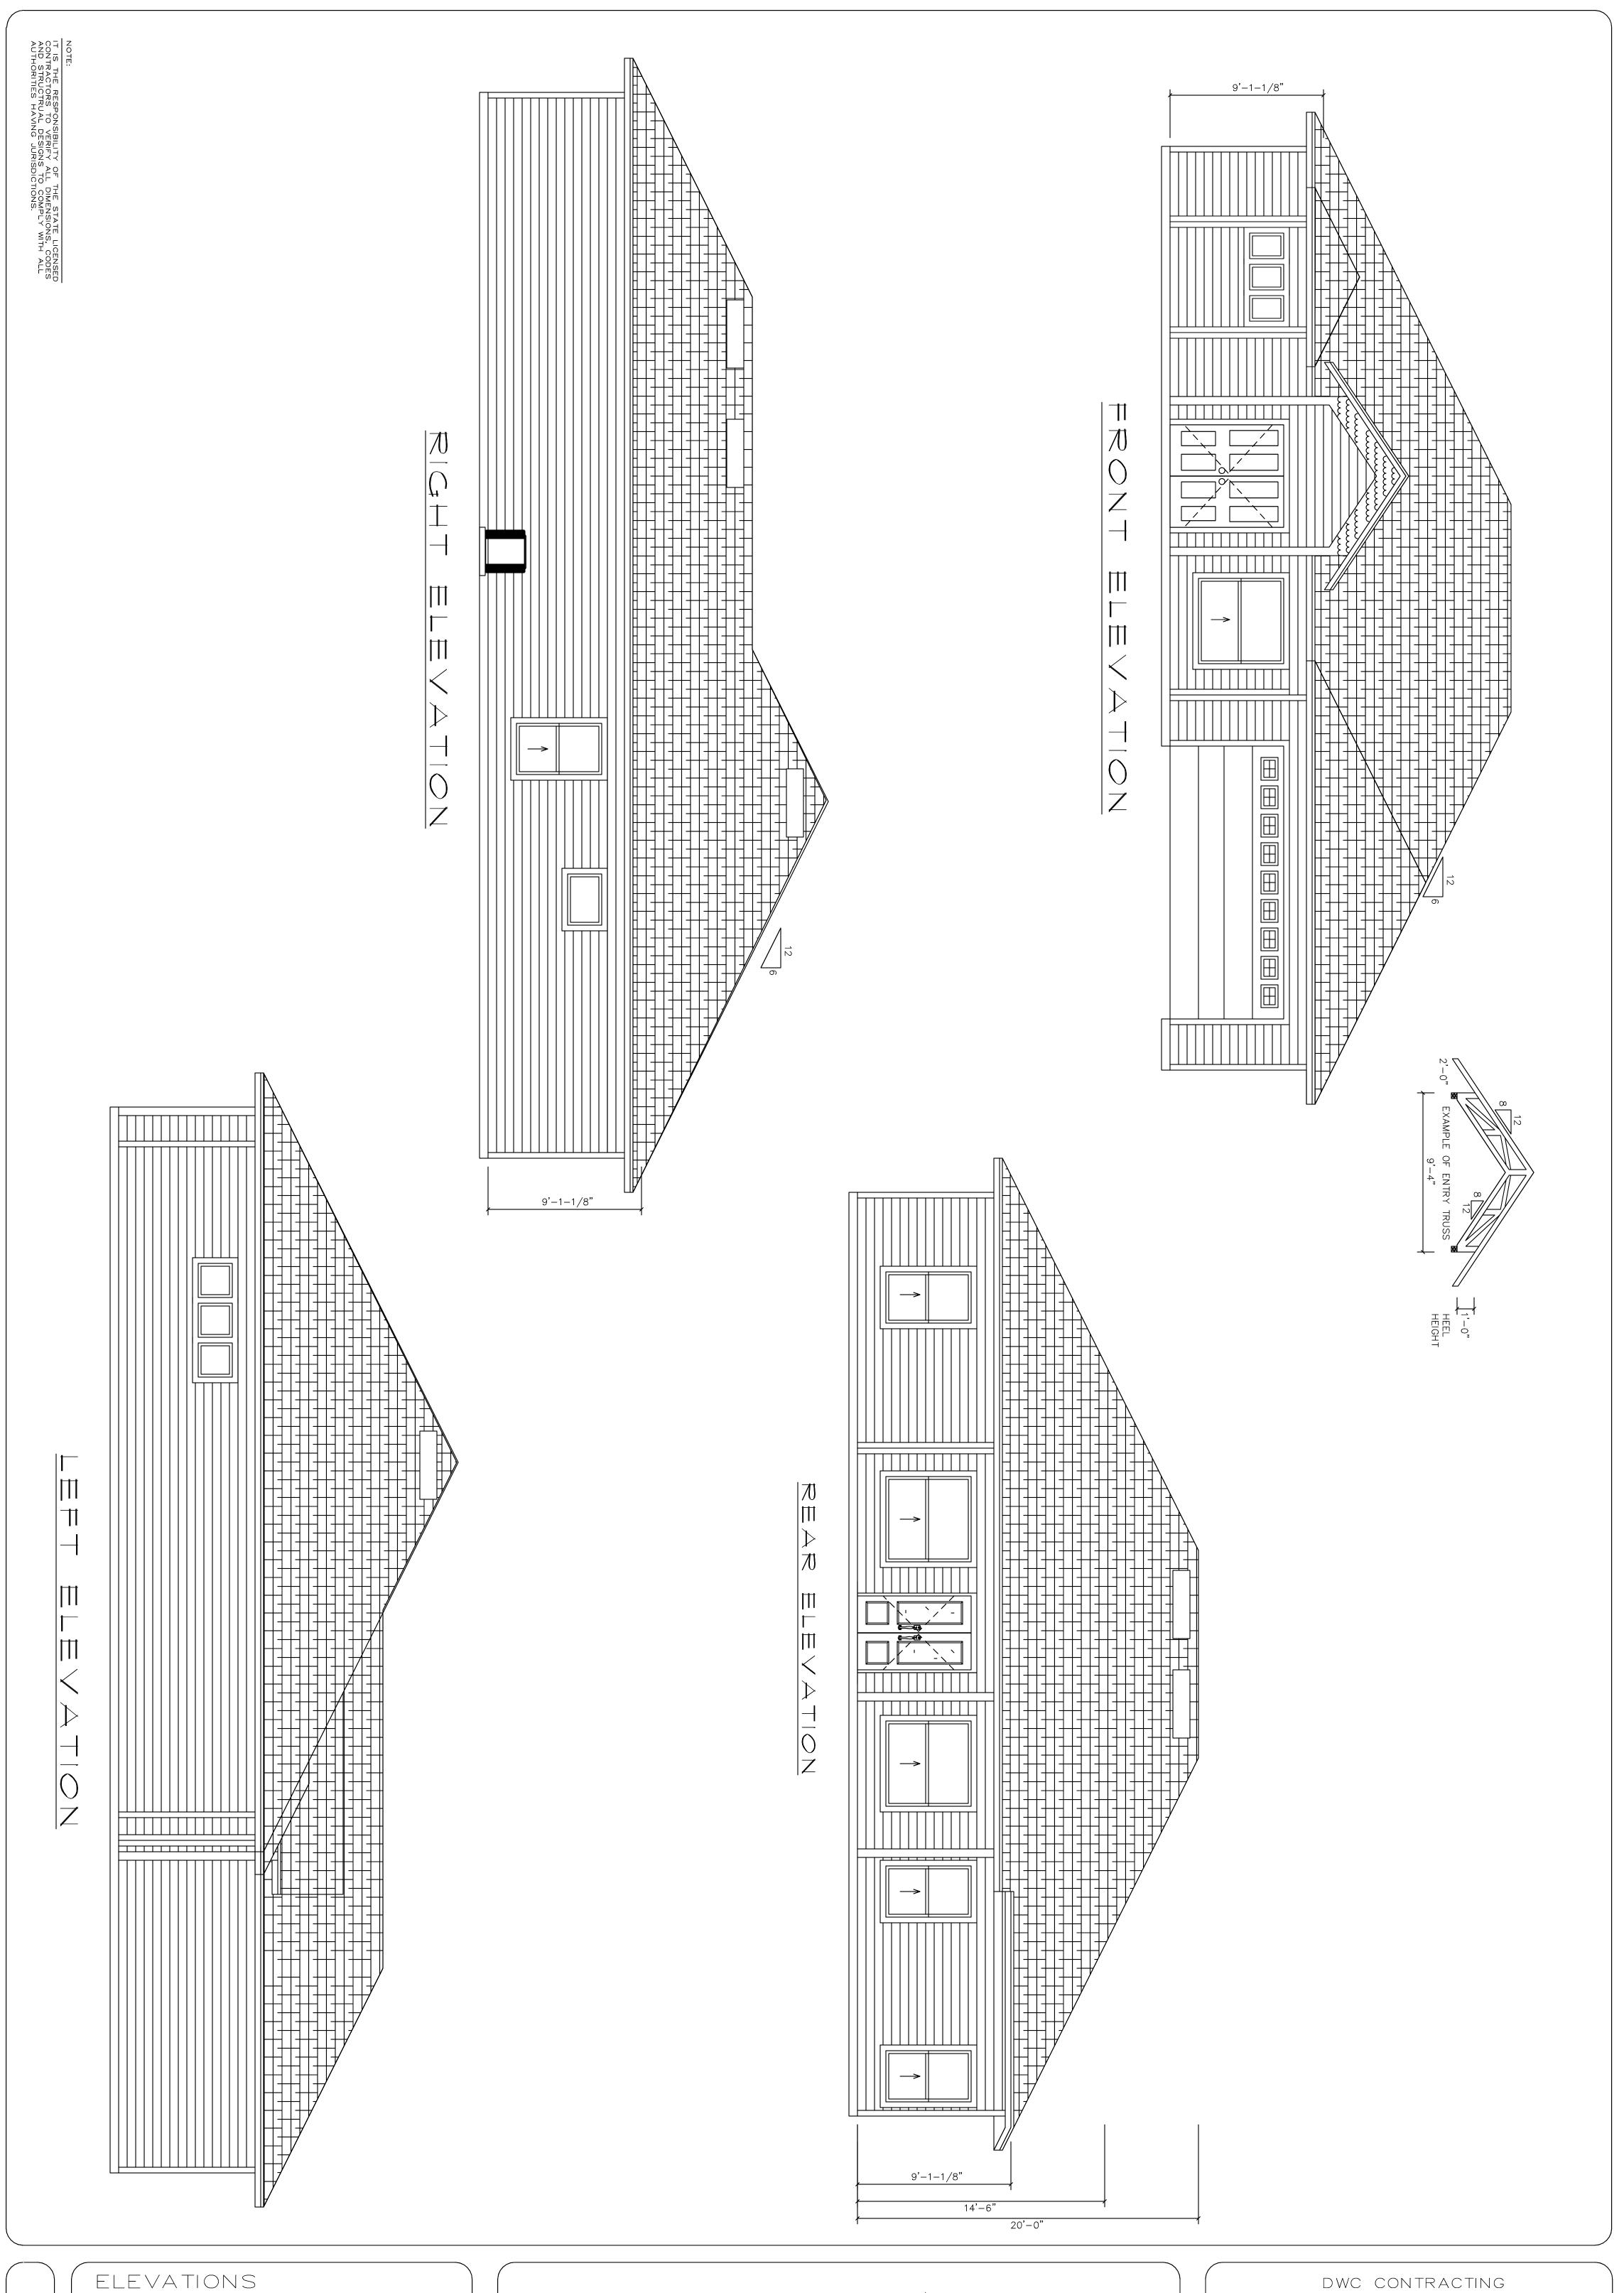

SCALE: 1/4"=1'-0"

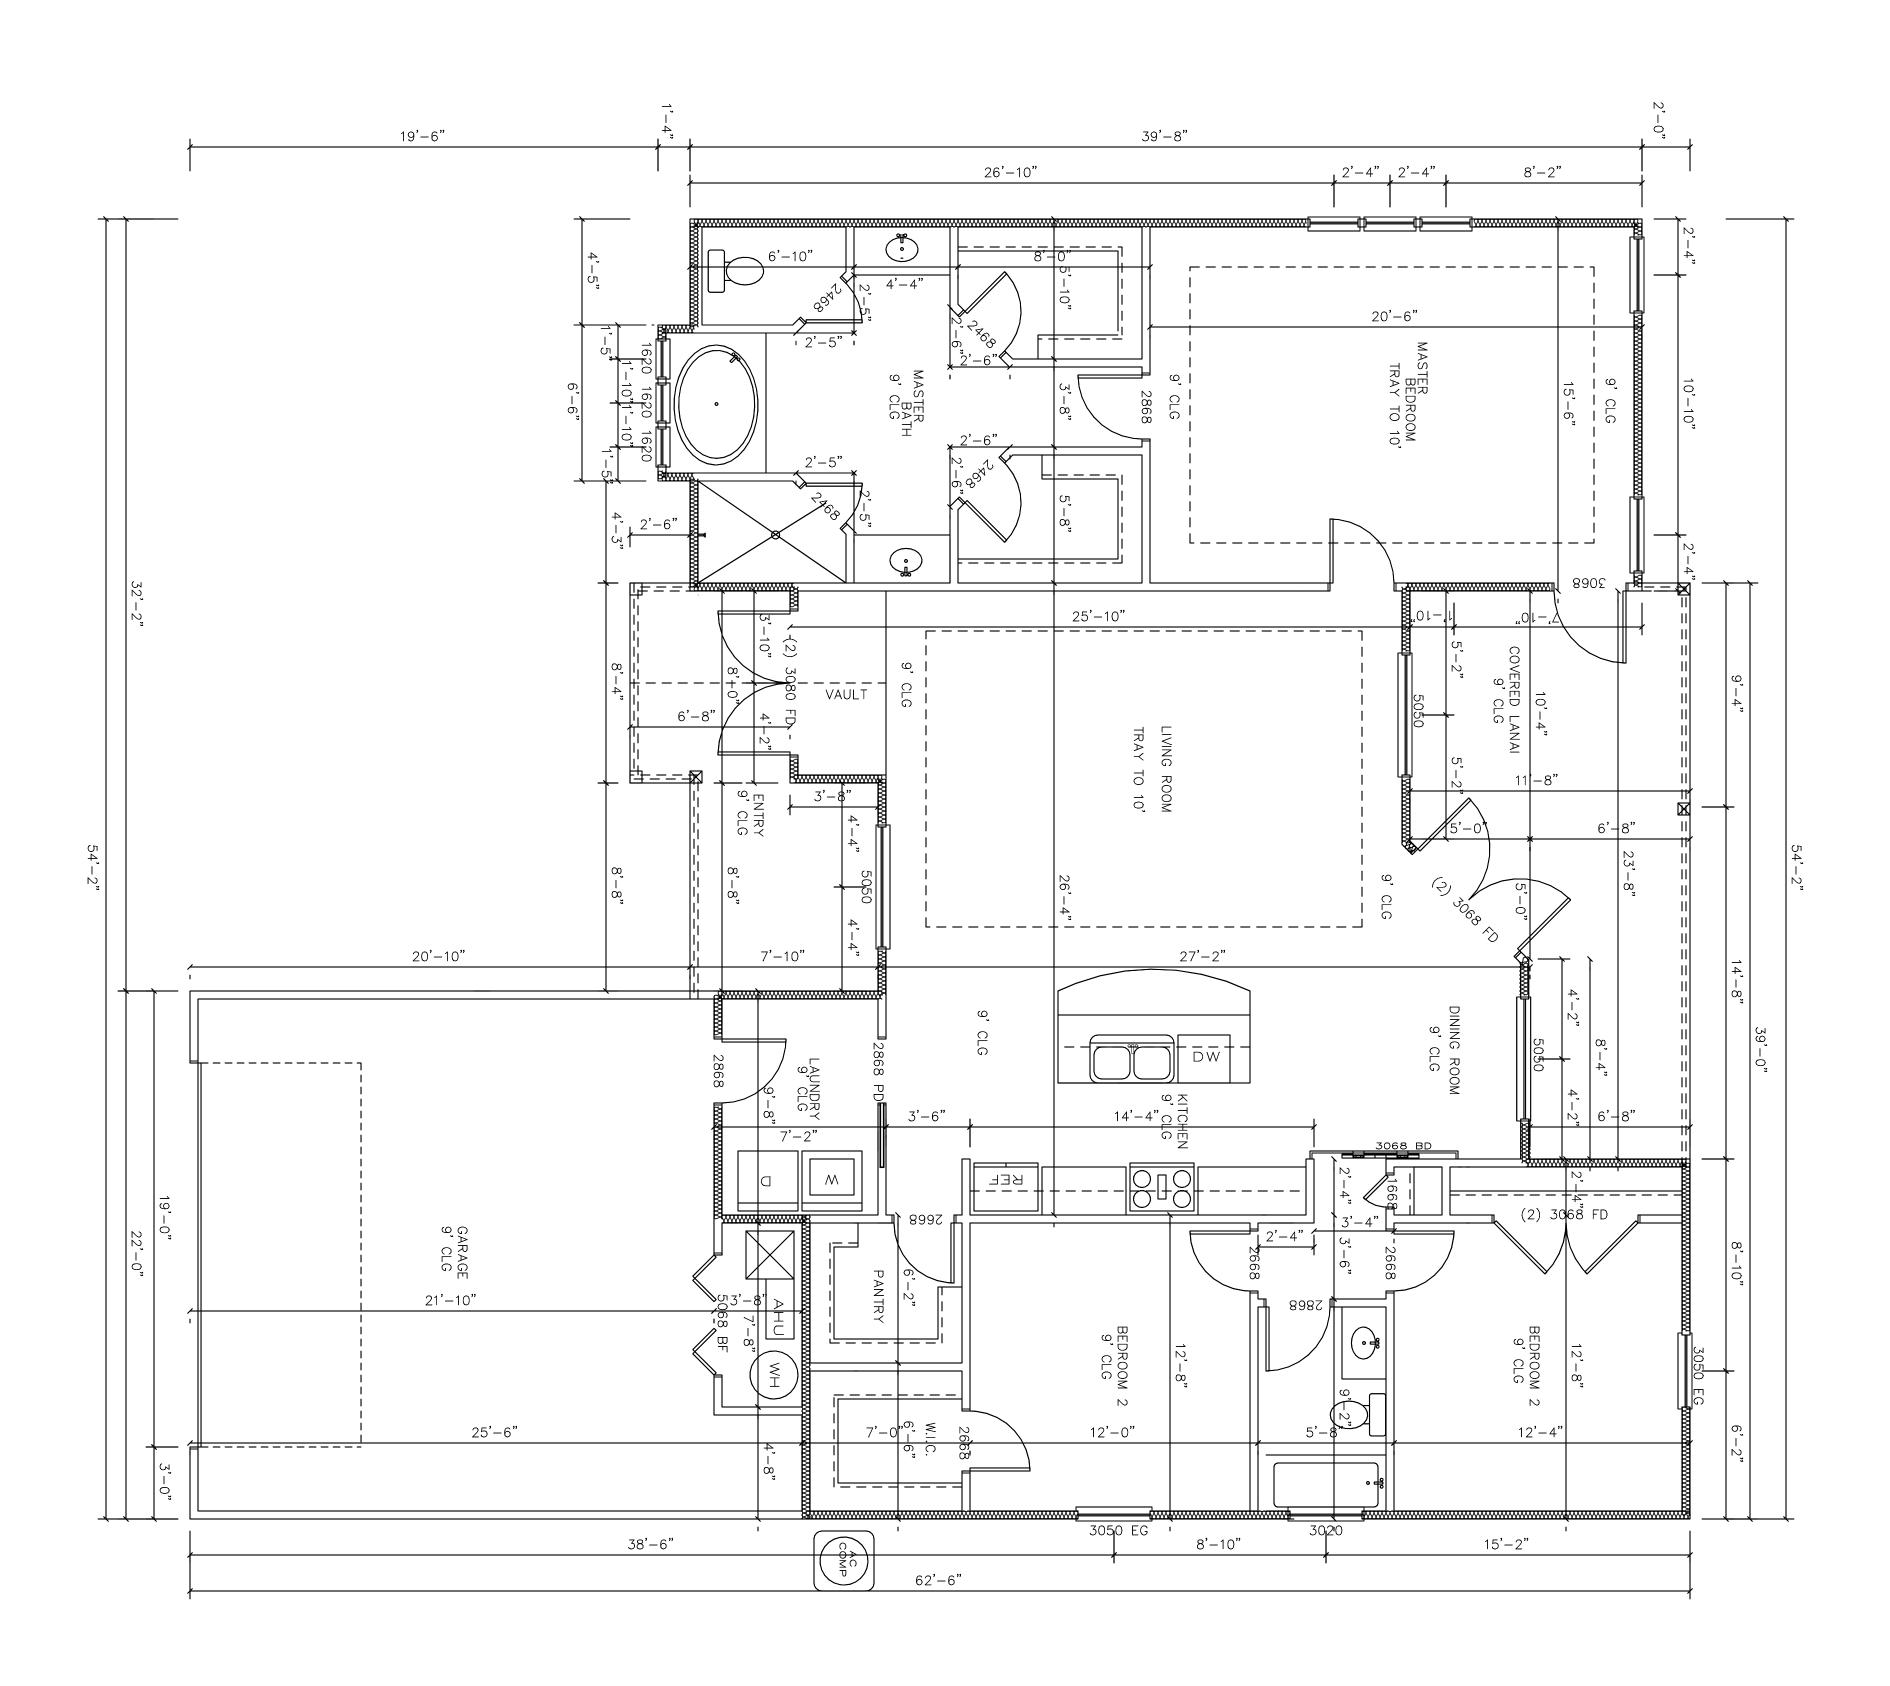

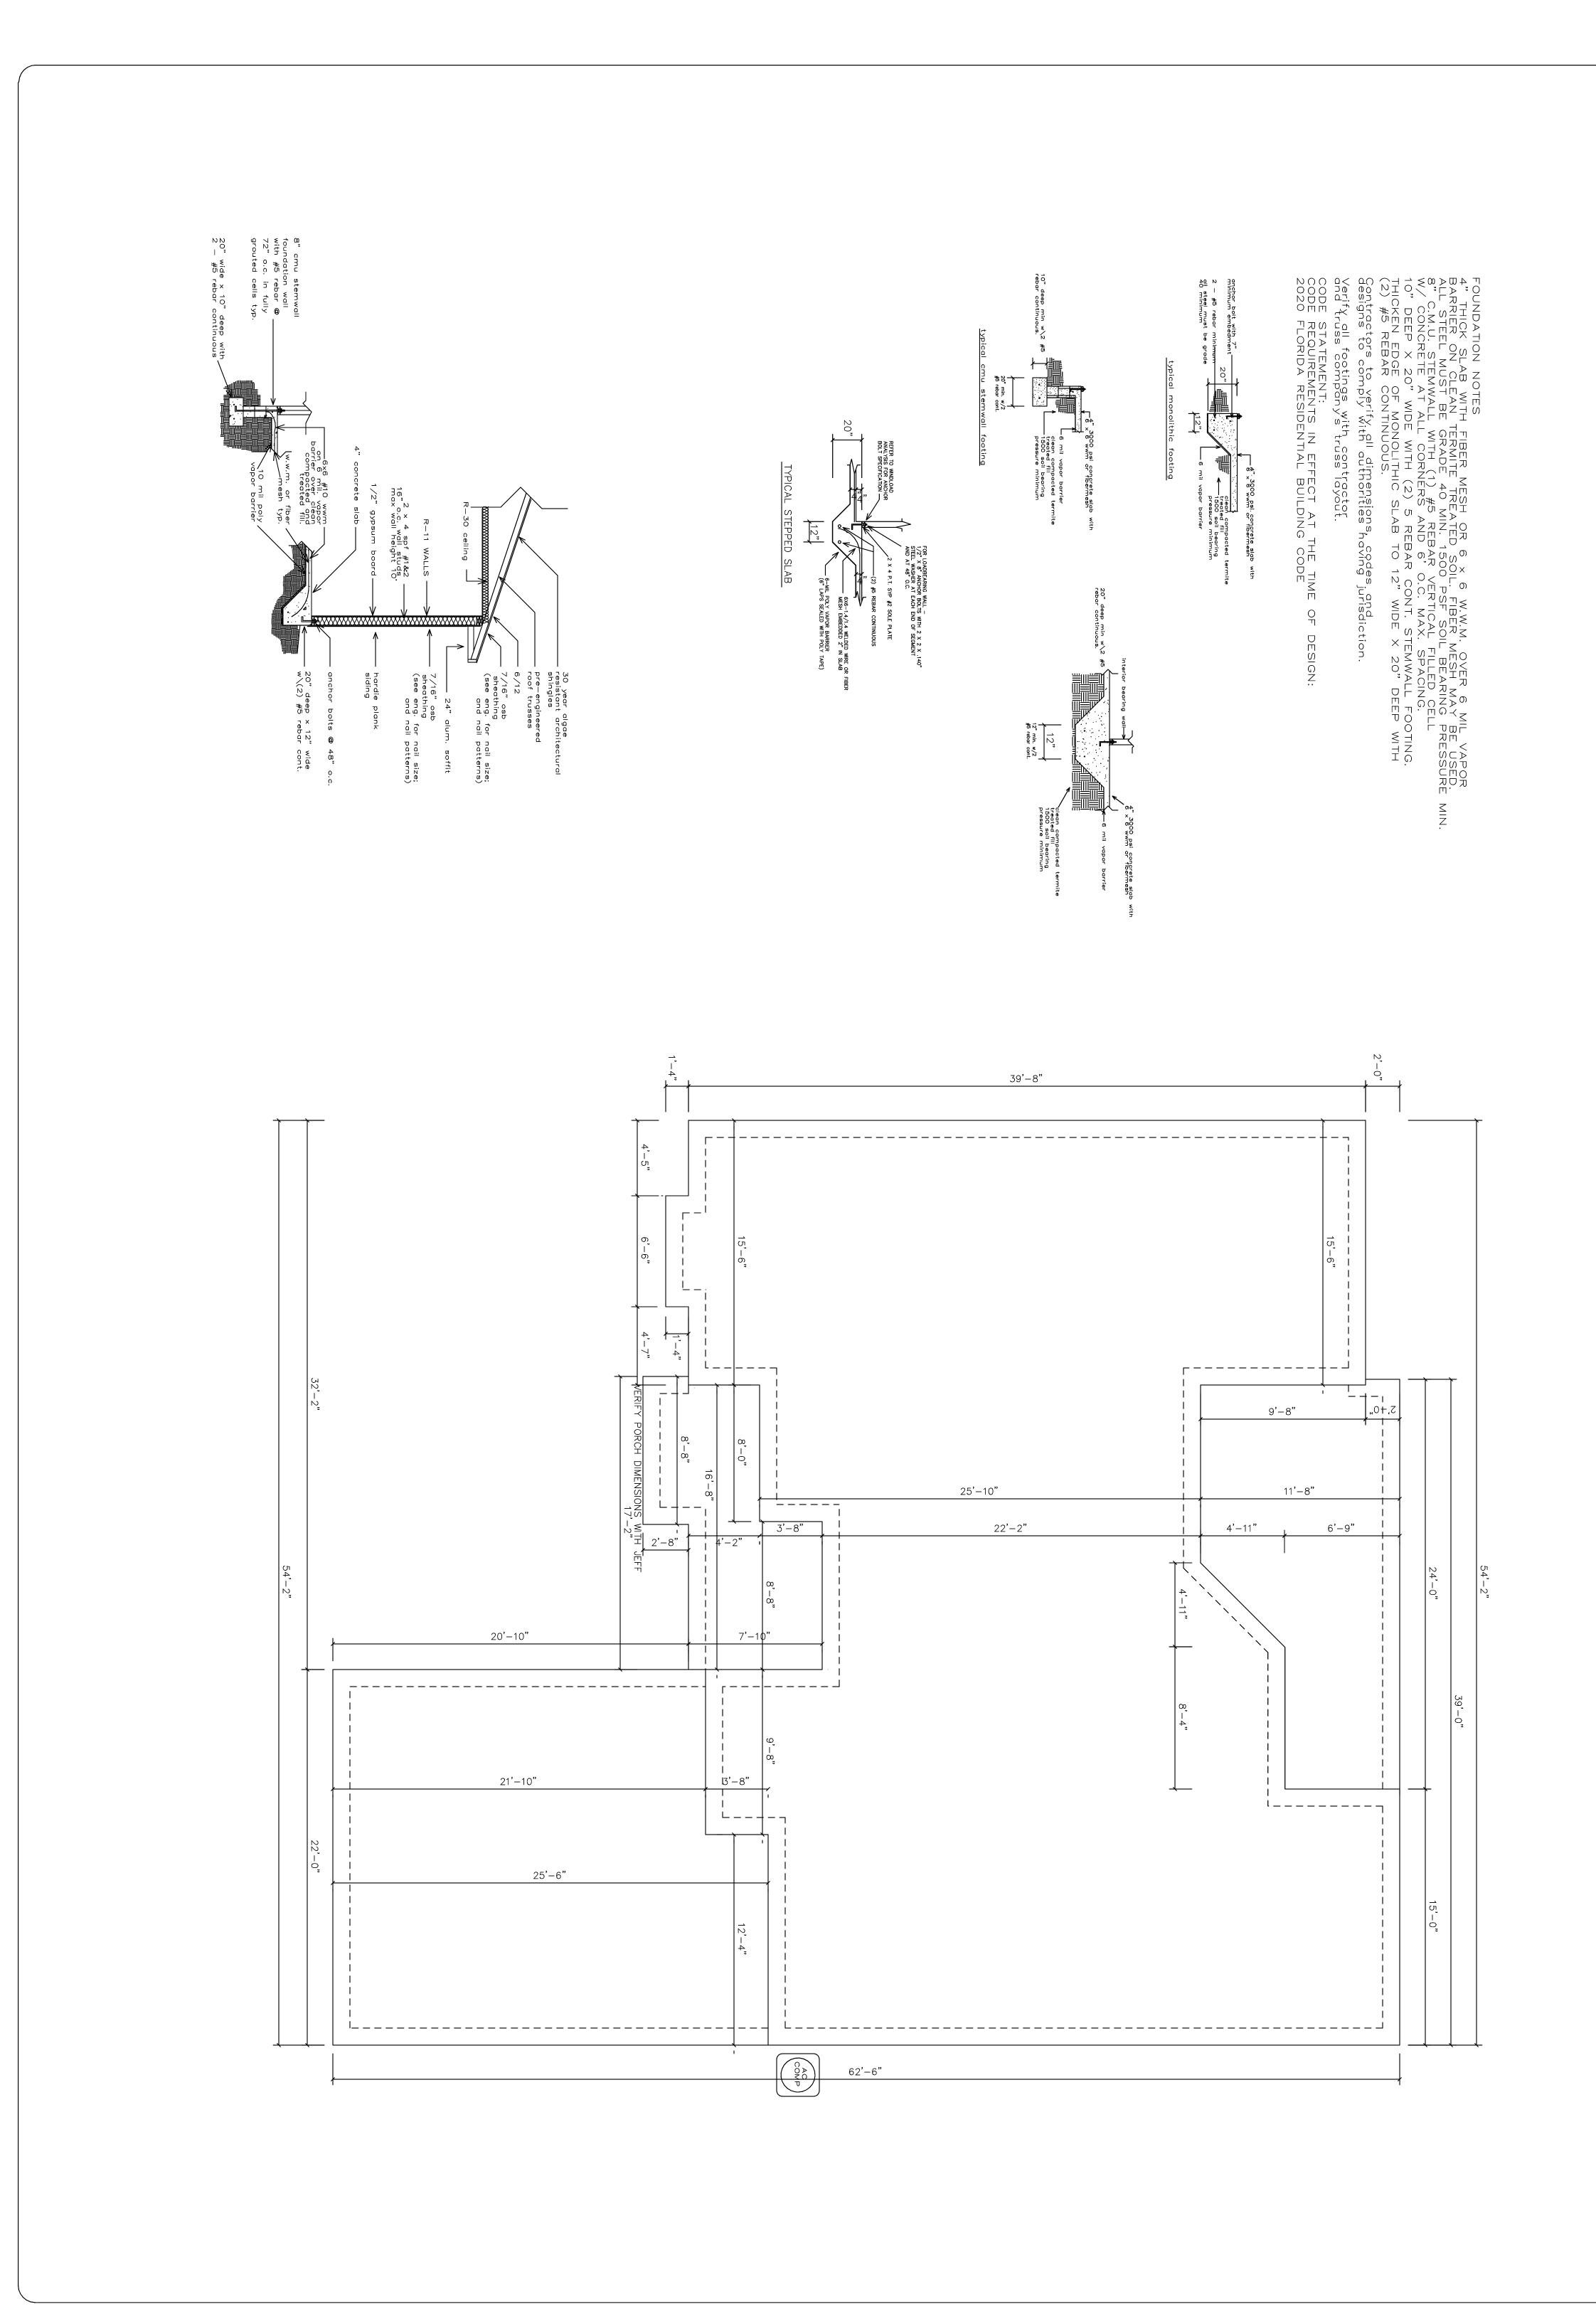




FOUNDATION PLAN

SCALE: 1/4"=1'-0"

NACONEY MALE CONSTRUCTION

NATURE OF SAME WAS CONTROLLED AND ASSAULT OF SAME CONTROLLED TO SAME CONTROLLED T

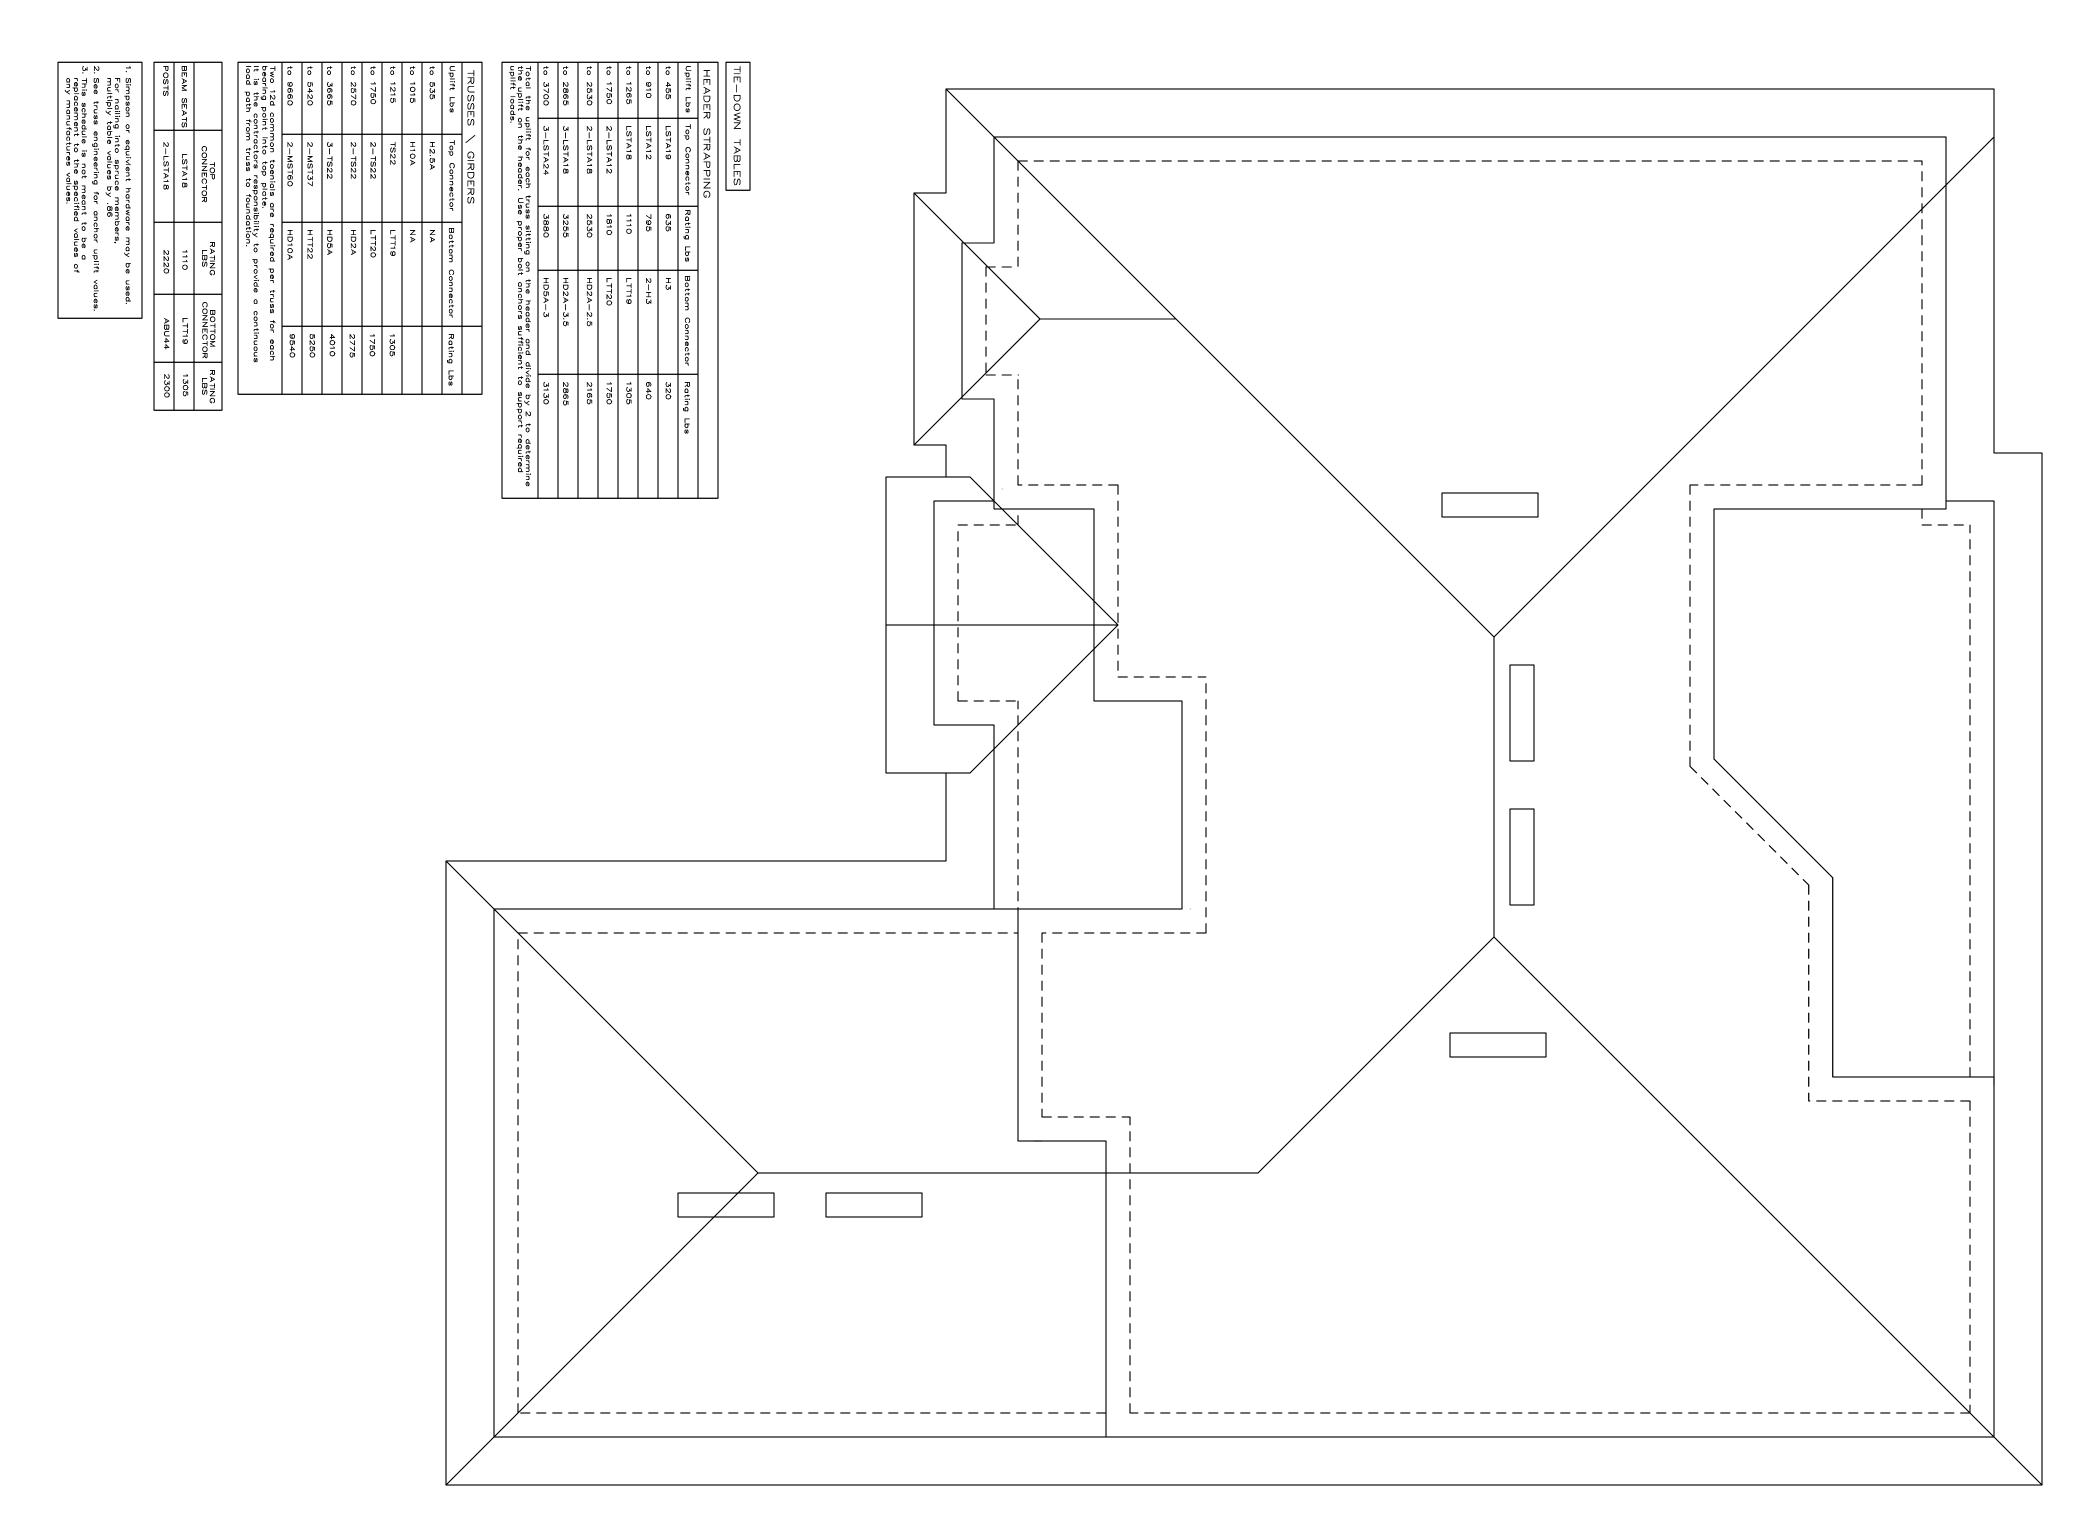

ROOF LAYOUT

SCALE: 1/4"=1'-0"

CAST IN PLACE CONCRETE

1. ALL CONCRETE SHALL HAVE A MIN. COMPRESSIVE
STRENGTH AT 28 DAYS OF 3000 P.S.I. SLUMP OF 4"
AND HAVE 2 TO 4% AIR ENTRAINMENT WITH A CEMENT
/ WATER RATIO OF 0.58 PERCENT.

2. ALL REINFORCING STEEL SHALL BE NEW DOMESTIC DEFORMED
BILLET STEEL CONFORMING TO ASTM—615 GRADE 40.

3. WELDED WIRE MESH SHALL CONFORM TO ASTM A—185, WWM
SHALL BE LAPPED AT LEAST 8". AND CONTAIN AT LEAST ONE
CROSS WIRE WITHIN THE 8". FIBER MESH MAY BE USED IN SLAB.

FOUNDATION

SOIL TO BE COMPACTED TO AT LEAST 95% OF MAX. DRY DENSITY AS DETERMINED BY ASTM-1557

CAST IN PLACE CONCRETE

4. HOOKS SHALL BE PROVIDED AT DISCONTINUED ENDS OF ALL TOP BARS OF BEAMS.
5. HORIZONTAL FOOTING BARS SHALL HAVE A 1'-O" HOOK LENGTH OF CORNER BARS WITH A MIN. 25" LAP PROVIDED.
6. 25" MIN. LAP SPLICES ON ALL REBAR. ALL REBAR TO BE GRADE 40.
7. 3" MIN. CONCRETE COVERAGE WHEN EXPOSED TO EARTH OR 1-1/2" TO FORM.