



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 4424938 - ALBRITTON

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: JOHN NORRIS CONST. Project Name: Albritton Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: TBD, TBD
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8
Wind Code: ASCE 7-22 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 21 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T36618267	EJ01	3/10/25	15	T36618281	T06	3/10/25
2	T36618268	EJ01G	3/10/25	16	T36618282	T06D	3/10/25
3	T36618269	EJ02	3/10/25	17	T36618283	T06G	3/10/25
4	T36618270	PB01	3/10/25	18	T36618284	T07	3/10/25
5	T36618271	PB01G	3/10/25	19	T36618285	T07G	3/10/25
6	T36618272	T01	3/10/25	20	T36618286	T08	3/10/25
7	T36618273	T01G	3/10/25	21	T36618287	T08G	3/10/25
8	T36618274	T02	3/10/25				
9	T36618275	T02G	3/10/25				
10	T36618276	T03	3/10/25				
11	T36618277	T04	3/10/25				
12	T36618278	T04G	3/10/25				
13	T36618279	T05	3/10/25				
14	T36618280	T05G	3/10/25				



This item has been digitally signed and sealed by Velez, Joaquin, PE on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2027.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

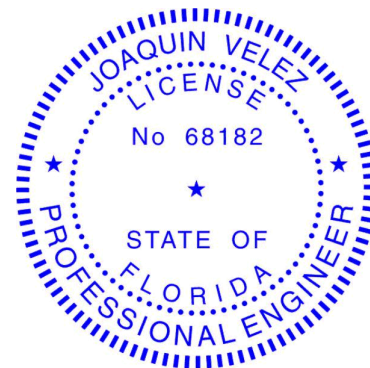


Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

March 10, 2025

Velez, Joaquin

1 of 1

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:20 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDBe_zs9zV-7?ehzQ?yMXZSLSDMGuxEbeelW5FZldmJ1MumNbzdlzb



LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCdL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=-0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 6-0-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 2 and 100 lb uplift at joint 6.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618268
4424938	EJ01G	Monopitch Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:21 2025 Page 1

ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-bCB3Bm0a7rhJzcoYqcST8sAW1VfsU3pSG0eJv2zdlza

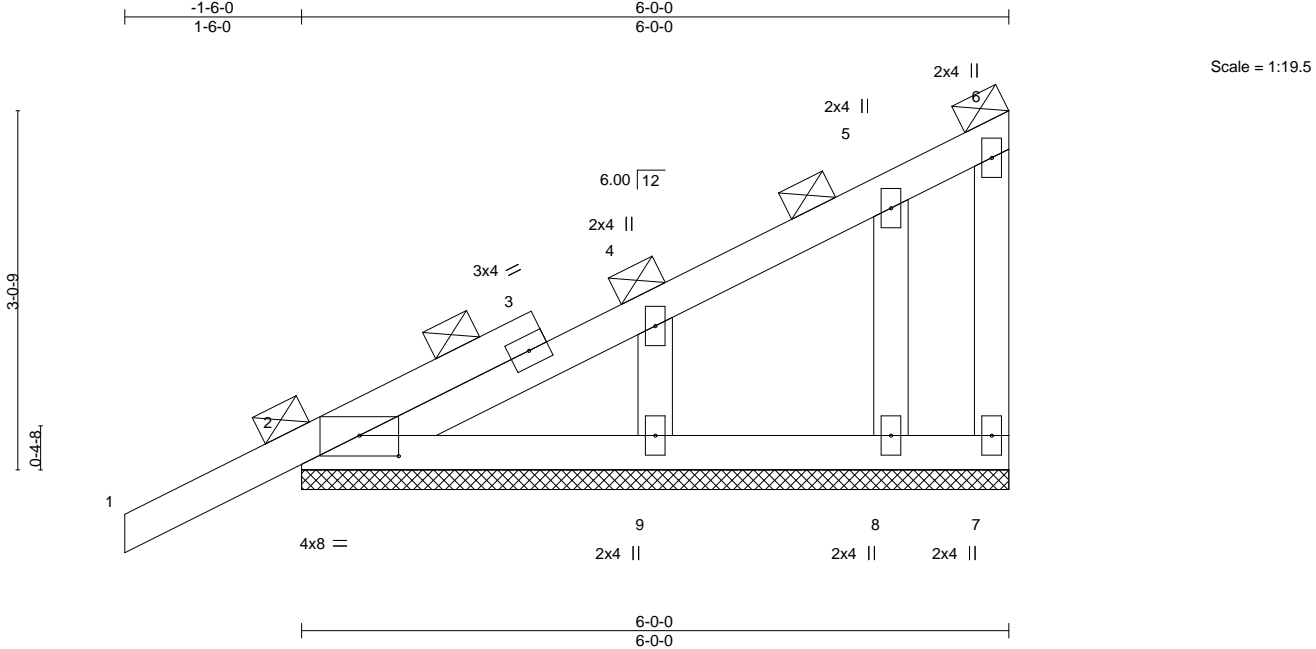


Plate Offsets (X,Y)--		[2:0-4-0.0-2-1]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.22
TCDL 7.0	Lumber DOL	1.25	BC 0.07
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-P
			DEFL.
			in (loc)
			I/defl
			L/d
			VERT(LL)
			VERT(CT)
			HORZ(CT)
			PLATES
			GRIP
			MT20
			244/190
			Weight: 32 lb
			FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 6-0-0.
(lb) - Max Horz 2=126(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 7, 9, 8
Max Grav All reactions 250 lb or less at joint(s) 2, 7, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7, 9, 8.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618269
4424938	EJ02	Monopitch Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:21 2025 Page 1

ID:MLnDgs6VdvpJ9j8aMGDbe_zs9zV-bCB3Bm0a7rhJzcoYqcST8sAWCVfsU2dSG0eJv2zdIza

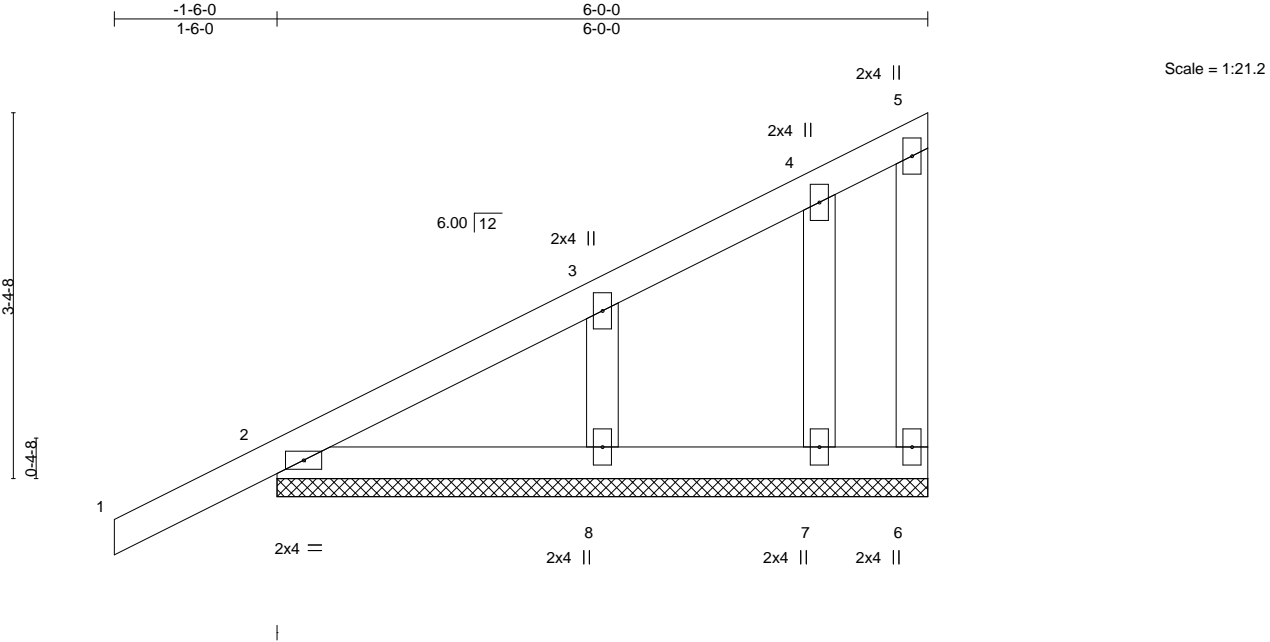

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.21	Vert(LL)	-0.01	1	n/r	120	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.07	Vert(CT)	-0.00	1	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P						
								Weight: 31 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 6-0-0.
(lb) - Max Horz 2=138(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 6, 2, 8, 7
Max Grav All reactions 250 lb or less at joint(s) 6, 2, 8, 7

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 8, 7.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618270
4424938	PB01	Piggyback	14	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,


8.830 s Feb 18 2025 MiTek Industries, Inc.
Fri Mar 7 12:55:22 2025
Page 1
ID:MLnDgs6VdupJ9j8aMGDb_e_zs9zV-3OIRO60Du8pAamNkNJzig3jjxv0WDWZcVgOtSUzdlzZ

3-0-0

3-0-0

6-0-0

3-0-0

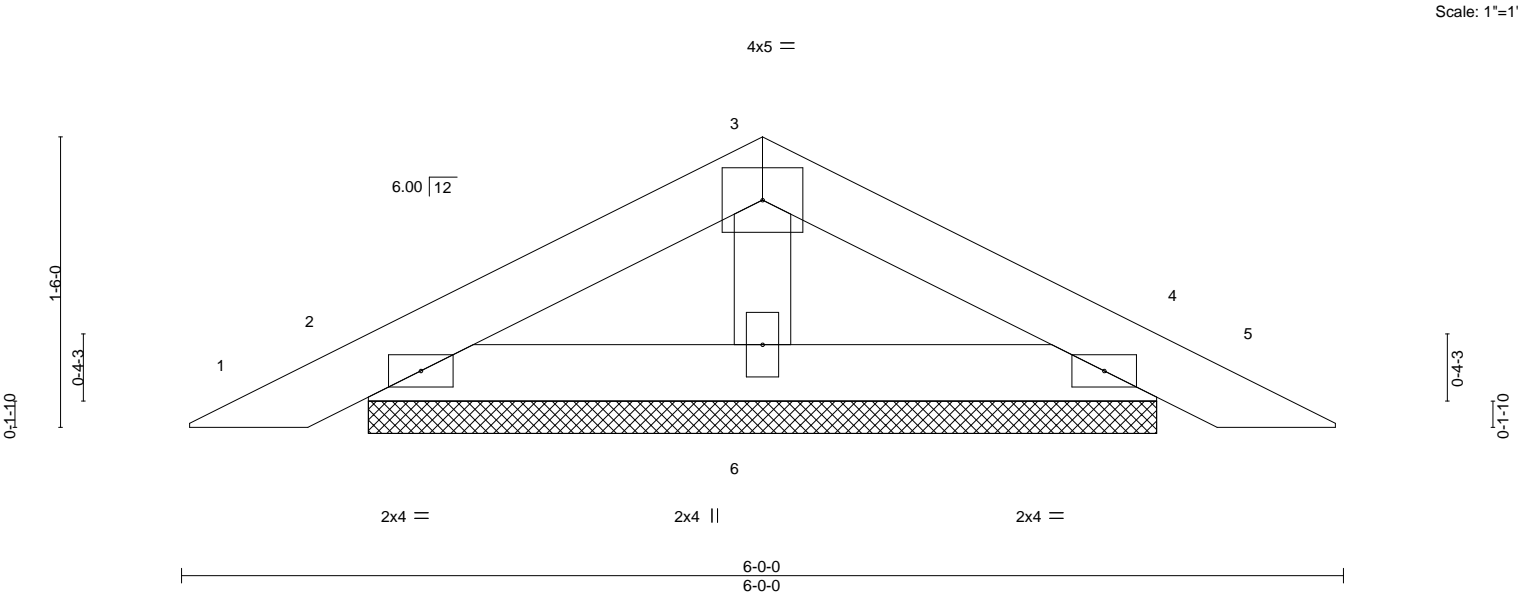

LOADING	(psf)	SPACING-		CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.08	Vert(LL)	0.00	4	n/r	120	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.04	Vert(CT)	0.00	5	n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-P							Weight: 17 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3		

REACTIONS. (size) 2=4-0-14, 4=4-0-14, 6=4-0-14
Max Horz 2=-22(LC 13)
Max Uplift 2=-46(LC 12), 4=-50(LC 13), 6=-17(LC 12)
Max Grav 2=114(LC 1), 4=114(LC 1), 6=141(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618271
4424938	PB01G	PIGGYBACK	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,


8.830 s Feb 18 2025
MiTek Industries, Inc.
Fri Mar 7 12:55:22 2025
Page 1
ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-3OIRO60Du8pAamNkNJzig3jkZv0sDWncVgOtSUzdlzZ

2-4-2

2-4-2

4-8-4

2-4-2

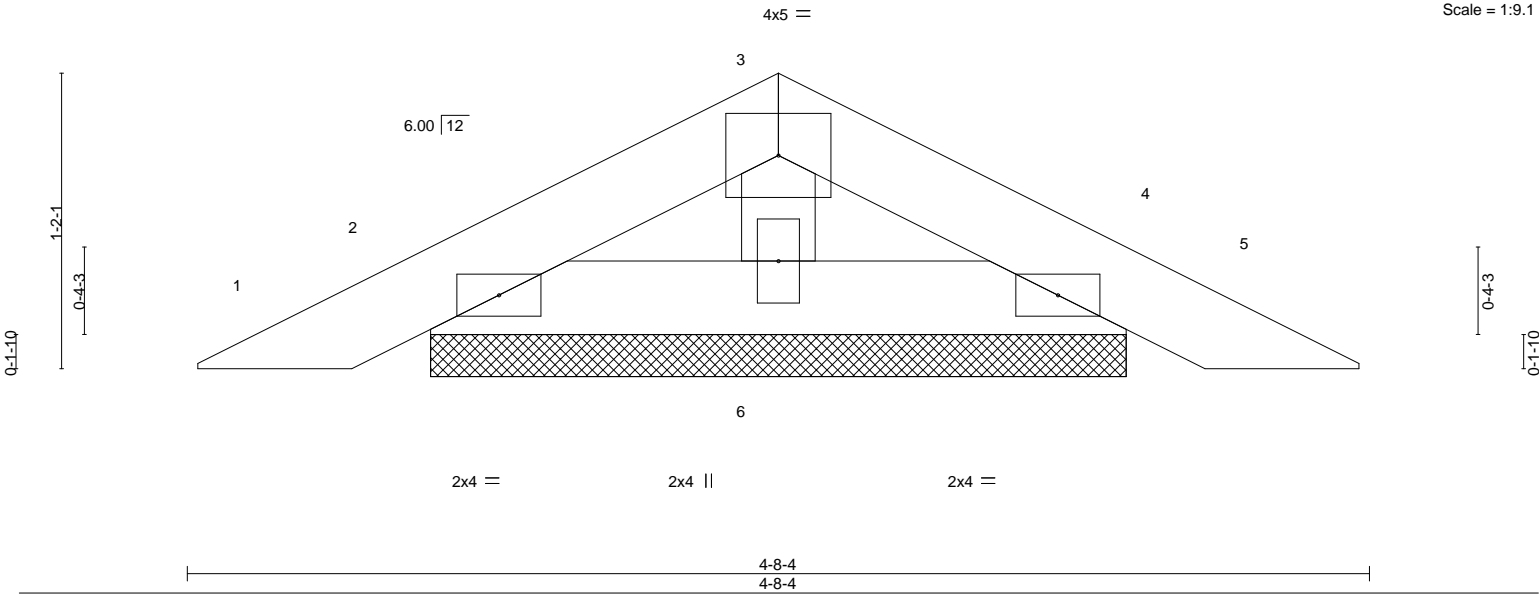

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.04	in	(loc)	l/defl	L/d	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.02	Vert(LL)	-0.00	4	n/r	120			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.02	Vert(CT)	-0.00	4	n/r	120			
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-P		Horz(CT)	0.00	4	n/a	n/a			
											Weight: 12 lb	FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-8-4 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3		

REACTIONS. (size) 2=2-9-2, 4=2-9-2, 6=2-9-2
Max Horz 2=-17(LC 13)
Max Uplift 2=-39(LC 12), 4=-42(LC 13), 6=-8(LC 12)
Max Grav 2=91(LC 1), 4=91(LC 1), 6=89(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been
digitally signed and
sealed by Velez, Joaquin, PE
on the date indicated here.
Printed copies of this
document are not considered
signed and sealed and the
signature must be verified
on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618273
4424938	T01G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:23 2025 Page 1

ID:MLnDgs6VdupJ9j8aMGDb_e_zs9zV-XaJpbS1rfSx1Cwyxx0UxDHGttJLoy7IjK7Q_wzdlzY



Scale = 1:44.7

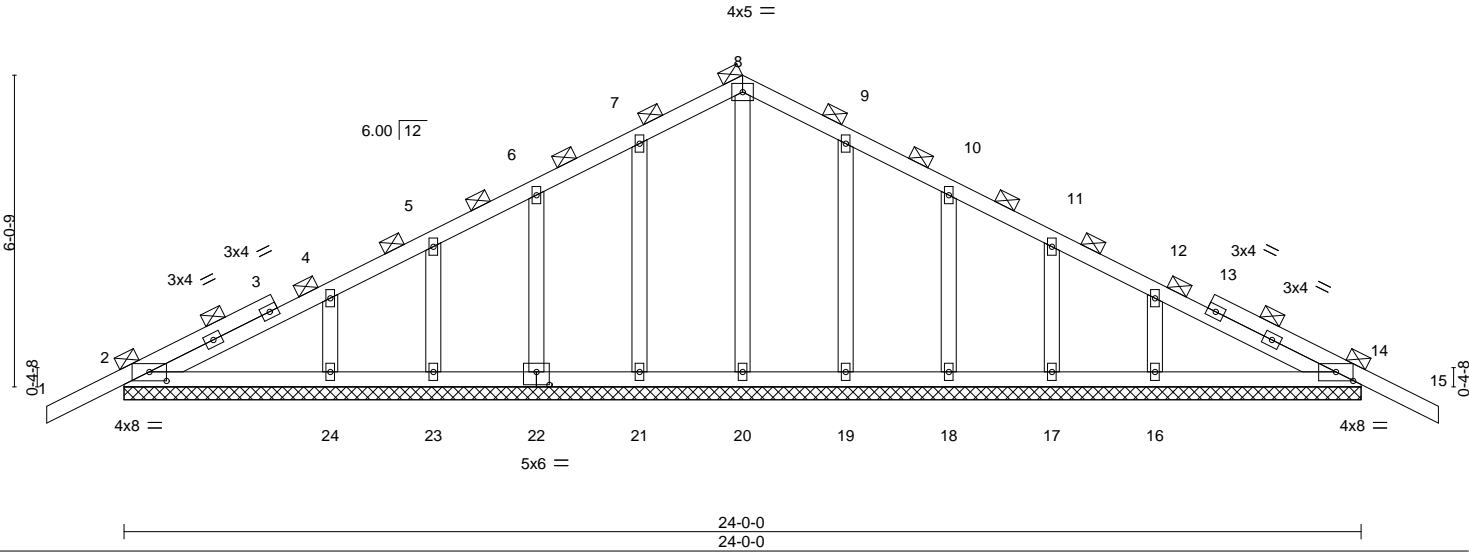


Plate Offsets (X,Y)-- [2:0-4-0,0-2-1], [14:0-4-0,0-2-1], [22:0-3-0,0-3-0]						
LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC 0.13	in (loc) l/defl L/d	GRIP
TCDL	7.0	Lumber DOL	1.25	BC 0.10	Vert(LL) -0.00 15 n/r 120	MT20 244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB 0.07	Vert(CT) -0.00 15 n/r 120	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S	Horz(CT) 0.00 14 n/a n/a	
						Weight: 133 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 24-0-0.
(lb) - Max Horz 2=107(LC 16)
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 21, 22, 23, 24, 19, 18, 17, 16
Max Grav All reactions 250 lb or less at joint(s) 2, 14, 20, 21, 22, 23, 24, 19, 18, 17, 16

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss system has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 21, 22, 23, 24, 19, 18, 17, 16.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 14.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618275
4424938	T02G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:24 2025 Page 1

ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-?mtBpn2TPm3uq4W7Vvk0AIUo1dih1hQqvy_tzWNzdlzX

-1-6-0

1-6-0

8-0-0

8-0-0

16-0-0

8-0-0

17-6-0

1-6-0

Scale = 1:31.5

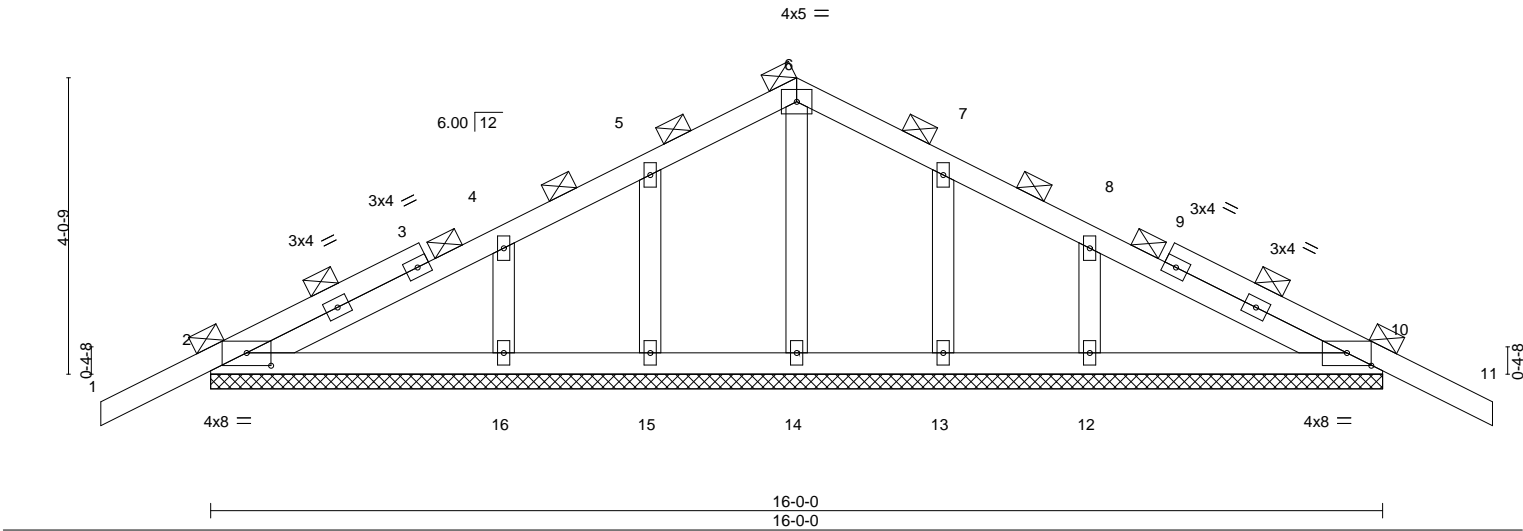


Plate Offsets (X,Y)--		[2:0-4-0,0-2-1], [10:0-4-0,0-2-1]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.13
TCDL 7.0	Lumber DOL	1.25	BC 0.10
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
DEFL.	in (loc)	I/defl	L/d
Vert(LL)	-0.00	11	n/r
Vert(CT)	-0.00	11	n/r
Horz(CT)	0.00	10	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 81 lb	FT = 20%		

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 16-0-0.
(lb) - Max Horz 2=74(LC 16)
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 15, 16, 13, 12
Max Grav All reactions 250 lb or less at joint(s) 2, 10, 14, 15, 16, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 15, 16, 13, 12.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618276
4424938	T03	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:25 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-TzRa0735A3BIRD5J3RXPIiL5U6vNQj52BecX2pzdIzW
4-4-15 8-0-0 11-7-1 16-0-0
4-4-15 3-7-1 3-7-1 4-4-15
Scale = 1:28.4

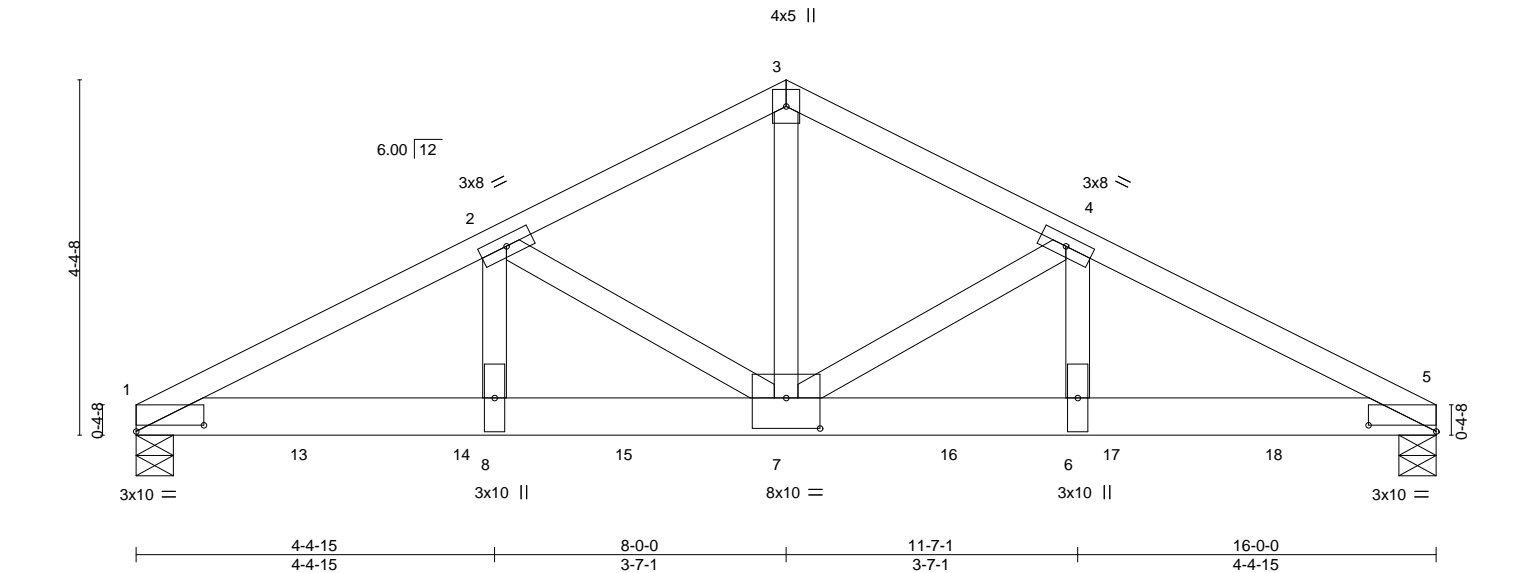


Plate Offsets (X,Y)-- [1:0-10-0,0-0-15], [5:0-10-0,0-0-15], [7:0-5-0,0-4-8]									
LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.64	Vert(LL)	-0.13	7-8	>999	240	MT20 244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.61	Vert(CT)	-0.22	7-8	>865	180	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.68	Horz(CT)	0.06	5	n/a	n/a	
BCDL 10.0	Code FBC2023/TP12014		Matrix-MS						Weight: 173 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-4-1 oc purlins.
BOT CHORD 2x6 SP 2400F 2.0E or 2x6 SP M 26	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	
3-7: 2x4 SP No.2	

REACTIONS.	(size) 1=0-5-8, 5=0-5-8
Max Horz	1=67(LC 8)
Max Uplift	1=1316(LC 8), 5=1331(LC 9)
Max Grav	1=5341(LC 2), 5=5407(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-10050/2465, 2-3=-6999/1734, 3-4=-7000/1735, 4-5=-10045/2464
BOT CHORD	1-8=-2222/8981, 7-8=-2222/8981, 6-7=-2155/8979, 5-6=-2155/8979
WEBS	3-7=-1461/6049, 4-7=-3211/869, 4-6=-658/2847, 2-7=-3214/869, 2-8=-660/2856

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=1316, 5=1331.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1389 lb down and 349 lb up at 2-0-12, 1389 lb down and 349 lb up at 4-0-12, 1389 lb down and 349 lb up at 6-0-12, 1389 lb down and 349 lb up at 8-0-12, 1389 lb down and 349 lb up at 10-0-12, and 1389 lb down and 349 lb up at 12-0-12, and 1389 lb down and 349 lb up at 14-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)	Standard
--------------	----------

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618276
4424938	T03	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.830 s Feb 18 2025
MiTek Industries, Inc.
Fri Mar 7 12:55:25 2025
Page 2
ID:MLnDgs6VdupJ9j8aMGDb_e_zs9zV-TzRa0735A3BIRD5J3RXPiIL5U6vNQj52BecX2pzdIzW

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-54, 3-5=-54, 1-5=-20

Concentrated Loads (lb)

Vert: 7=-1261(F) 13=-1261(F) 14=-1261(F) 15=-1261(F) 16=-1261(F) 17=-1261(F) 18=-1261(F)


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)




16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618277
4424938	T04	Common	15	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),		Lake City, FL - 32055,		8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:26 2025 Page 1			
				ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-x97yET4jxNjC3NgWc92ervuluW9p9DoBQIM4bFzdlzV			
6-0-0	11-5-15	17-4-0	23-2-1	28-8-0	34-8-0	36-2-0	
6-0-0	5-5-15	5-10-1	5-6-0	6-0-0	1-6-0		

Scale = 1:61.0

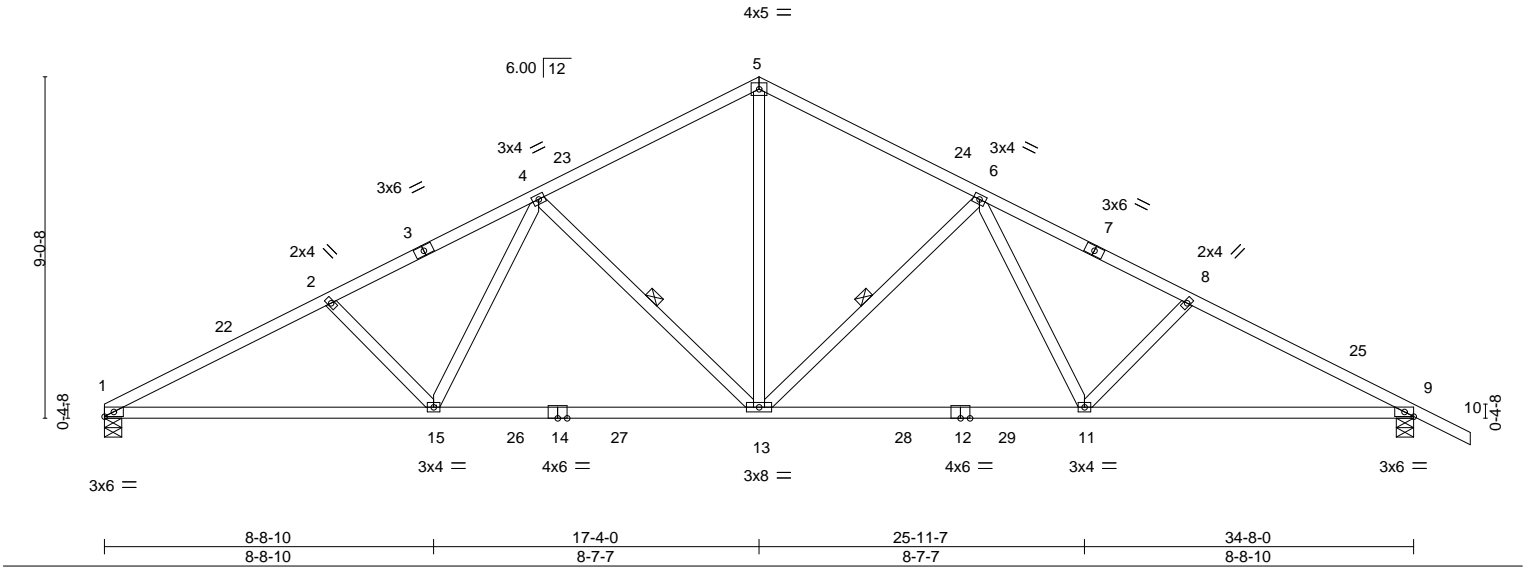

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	-0.25 11-13 >999	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.98	Vert(CT)	-0.42 11-13 >981				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.11 9 n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 178 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-1-5 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 6-13, 4-13

REACTIONS.	
(size)	1=0-5-8, 9=0-5-8
Max Horz	1=-169(LC 13)
Max Uplift	1=-329(LC 12), 9=-367(LC 13)
Max Grav	1=1409(LC 2), 9=1478(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-2620/615, 2-4=-2451/576, 4-5=-1684/428, 5-6=-1684/429, 6-8=-2442/569, 8-9=-2609/606
BOT CHORD	1-15=-615/2317, 13-15=-421/1892, 11-13=-287/1889, 9-11=-448/2304
WEBS	5-13=-248/1210, 6-13=-623/305, 6-11=-111/575, 8-11=-291/204, 4-13=-628/308, 4-15=-118/585, 2-15=-300/209

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-5-10, Zone1 3-5-10 to 17-4-0, Zone2 17-4-0 to 22-2-13, Zone1 22-2-13 to 36-2-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=329, 9=367.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618278
4424938	T04G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:27 2025 Page 1

ID:MLnDgs6VdupJ9j8aMGDBe_zs9zV-QLZKRp4LihRThXFiaSZtN7QYswiCumLLey5e7hzdlzU

17-4-017-4-034-8-036-2-01-6-0

Scale = 1:61.5

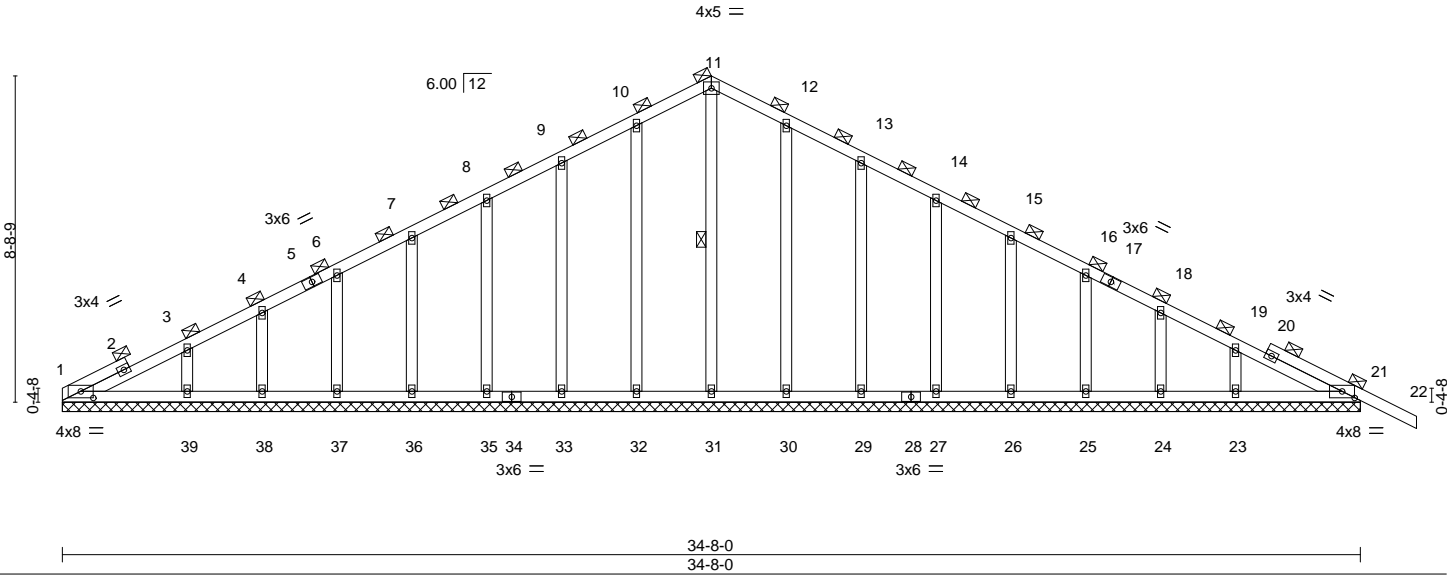


Plate Offsets (X,Y)--		[1:0-4-0,0-2-1], [21:0-4-0,0-2-1]			
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.13	Vert(LL) -0.00 22 n/r 120	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.07	Vert(CT) -0.01 22 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT) 0.01 21 n/a n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-S		Weight: 216 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	WEBS 1 Row at midpt 11-31

REACTIONS. All bearings 34-8-0.
(lb) - Max Horz 1=163(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 1, 32, 33, 35, 36, 37, 38, 39, 30, 29, 27, 26, 25, 24, 23, 21
Max Grav All reactions 250 lb or less at joint(s) 1, 31, 32, 33, 35, 36, 37, 38, 39, 30, 29, 27, 26, 25, 24, 23, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 10-11=100/259, 11-12=100/259

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 32, 33, 35, 36, 37, 38, 39, 30, 29, 27, 26, 25, 24, 23, 21.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618279
4424938	T05	Common Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:27 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDbe_zs9zV-QLZKRp4LihRThXFiAsZtN7QTRwXUuitLey5e7hzdlzU



Scale = 1:63.1

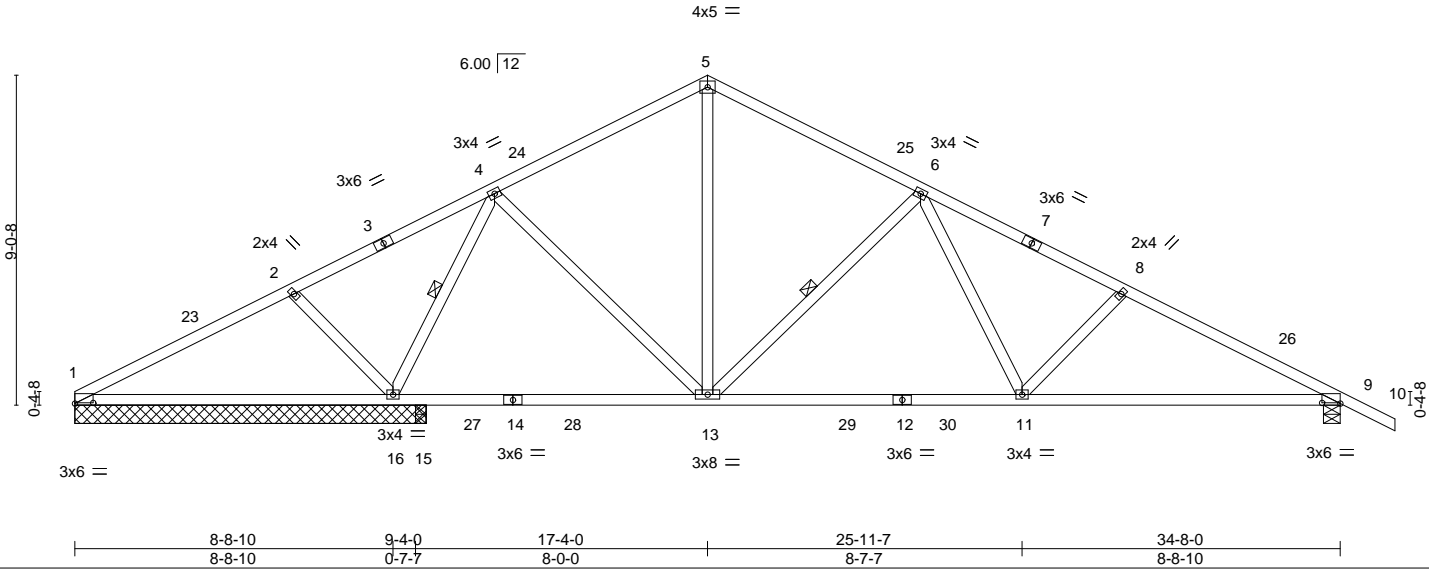

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.48	Vert(LL)	-0.16 11-13 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.82	Vert(CT)	-0.26 11-13 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.34	Horz(CT)	0.03 9 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 178 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-1-10 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3	WEBS	6-0-0 oc bracing: 1-16.
			1 Row at midpt 6-13, 4-16

REACTIONS.		FORCES.	
(lb) - Max Horz 1=169(LC 17)		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
Max Uplift All uplift 100 lb or less at joint(s) 1, 15 except 16=446(LC 12), 9=297(LC 13)		TOP CHORD 1-2=-58/325, 2-4=-100/492, 4-5=-713/272, 5-6=-714/250, 6-8=-1489/415,	
Max Grav All reactions 250 lb or less at joint(s) 1, 15, 1 except 16=1640(LC 2), 9=1042(LC 2)		8-9=-1658/453	
		BOT CHORD 1-16=-257/203, 11-13=-122/1027, 9-11=-312/1458	
		WEBS 5-13=-108/349, 6-13=-632/306, 6-11=-113/591, 8-11=-298/206, 4-13=-79/605,	
		4-16=-1280/317, 2-16=-330/216	

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-5-10, Zone1 3-5-10 to 17-4-0, Zone2 17-4-0 to 22-2-13, Zone1 22-2-13 to 36-2-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 15, 1 except (jt=lb) 16=446, 9=297.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618280
4424938	T05G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:29 2025 Page 2
ID:MLnDgs6VdupJ9j8aMGDBe_zs9zV-Mkg4sV6cElhBwrP4IHbLSYVpXjLNMTZe6GakBazdlzS

NOTES-
12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-54, 6-12=-54, 45-48=-20
Concentrated Loads (lb)
Vert: 22=-191(B) 47=-191(B) 51=-191(B) 52=-191(B) 53=-191(B) 54=-191(B) 55=-191(B) 56=-191(B) 57=-191(B) 58=-191(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618281
4424938	T06	Piggyback Base	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:29 2025 Page 1

ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-Mkg4sV6cElhBwrP4IHbLSYVmsjCUMZQe6GakBazdlzS



4x8 =

4x8 =

Scale = 1:65.3

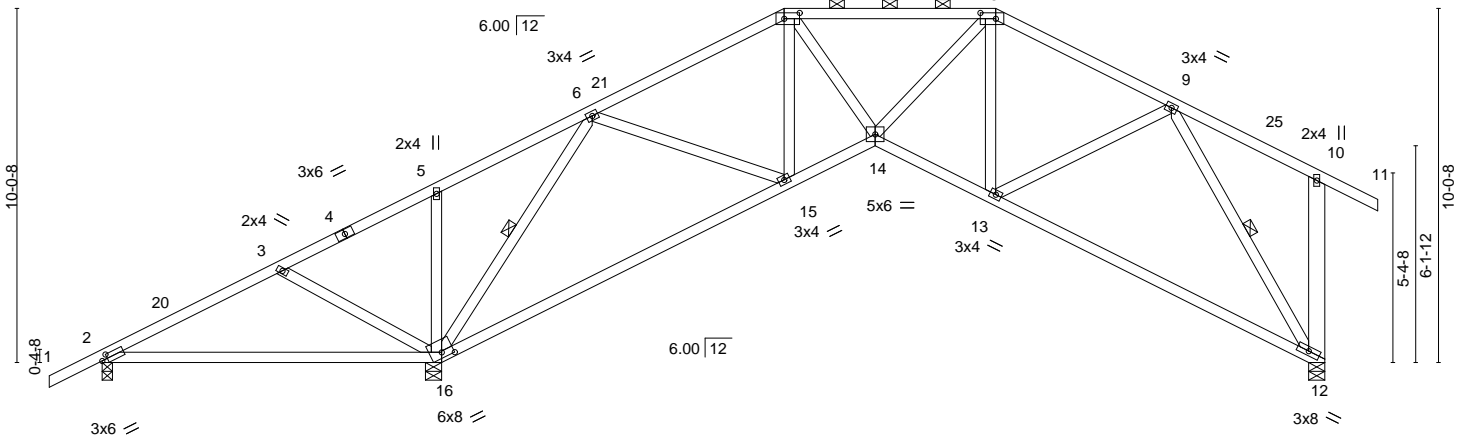


Plate Offsets (X,Y)--	[2:0-1-15,0-1-8], [7:0-5-4,0-2-0], [8:0-5-4,0-2-0], [16:0-4-0,0-1-15]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.68	Vert(LL) 0.24	16-19	>483	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.85	Vert(CT) -0.50	15-16	>596	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.53	Horz(CT) 0.12	12	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 212 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-7-14 oc purlins, except end verticals, and 2-0-0 oc purlins (4-9-0 max.): 7-8.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3 *Except* 10-12: 2x6 SP No.2	WEBS 6-0-0 oc bracing: 2-16. 1 Row at midpt 6-16, 9-12

REACTIONS.	(size) 12=0-5-8, 2=0-3-8, 16=0-5-8
Max Horz 2=270(LC 11)	
Max Uplift 12=-246(LC 13), 2=-128(LC 8), 16=-489(LC 12)	
Max Grav 12=889(LC 1), 2=162(LC 25), 16=1716(LC 1)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-175/447, 3-5=-263/719, 5-6=-211/736, 6-7=-942/242, 7-8=-1084/344, 8-9=-982/272
BOT CHORD	2-16=-328/72, 14-15=-244/836, 13-14=-242/905, 12-13=-204/585
WEBS	3-16=-349/203, 6-16=-1423/405, 6-15=-111/691, 7-15=-349/164, 7-14=-172/538, 8-14=-150/390, 9-13=-85/384, 9-12=-954/282

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-11-10, Zone1 1-11-10 to 19-4-0, Zone2 19-4-0 to 24-2-14, Zone1 24-2-14 to 25-4-0, Zone2 25-4-0 to 30-3-13, Zone1 30-3-13 to 36-2-0 zone; end vertical right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=246, 2=128, 16=489.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618282
4424938	T06D	Piggyback Base	4	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:30 2025 Page 1
ID:MLnDgs6VdubJ9j8aMGDbE_zs9zV-qwET3r7E?cp2Y?_Hr_6a?l2xe7Yj50inKwKlk0zdlzR

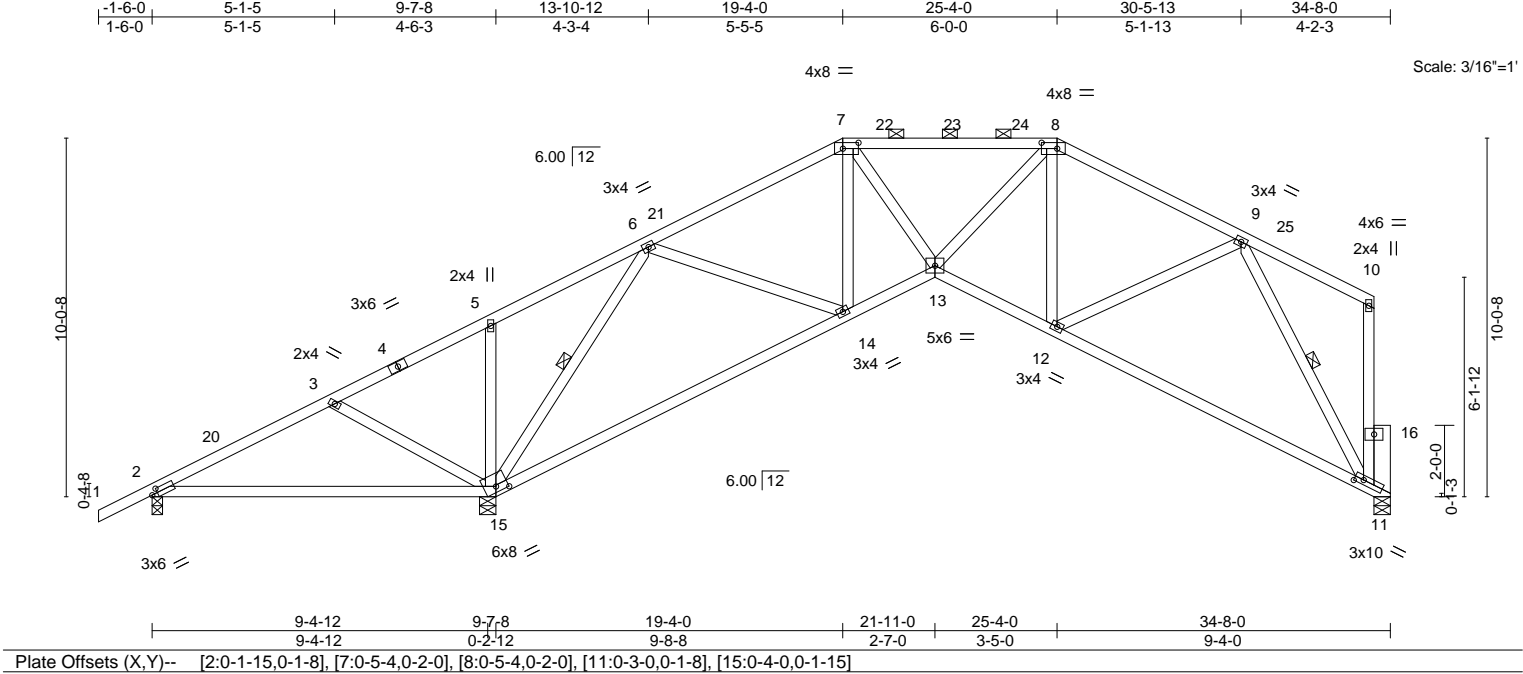

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.67	Vert(LL)	0.24 15-19 >482 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.85	Vert(CT)	-0.50 14-15 >593 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.53	Horz(CT)	0.11 11 n/a n/a				
BCDL	10.0	Code FBC2023/TP12014		Matrix-MS							
								Weight: 208 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-7-9 oc purlins, except end verticals, and 2-0-0 oc purlins (4-9-2 max.): 7-8.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3 "Except"		6-0-0 oc bracing: 2-15.
	10-11: 2x4 SP No.2		1 Row at midpt
OTHERS	2x6 SP No.2		6-15, 9-11

REACTIONS.	
(size)	11=0-5-8, 2=0-3-8, 15=0-5-8
Max Horz	2=275(LC 9)
Max Uplift	11=191(LC 13), 2=119(LC 8), 15=497(LC 12)
Max Grav	11=775(LC 1), 2=166(LC 25), 15=1708(LC 1)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-205/447, 3-5=-304/710, 5-6=-252/727, 6-7=-945/250, 7-8=-1085/370, 8-9=-982/270
BOT CHORD	2-15=-321/64, 13-14=-288/838, 12-13=-292/903, 11-12=-231/567
WEBS	3-15=-348/203, 6-15=-1418/442, 6-14=-132/687, 7-14=-346/186, 7-13=-203/536, 8-13=-167/394, 9-12=-98/390, 9-11=-948/319


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-11-10, Zone1 1-11-10 to 19-4-0, Zone2 19-4-0 to 24-2-14, Zone1 24-2-14 to 25-4-0, Zone2 25-4-0 to 30-5-13, Zone1 30-5-13 to 34-0-12 zone; end vertical right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 11 considers parallel to grain value using ANSI/TP1 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=191, 2=119, 15=497.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

Builders FirstSource (Lake City, FL) Lake City, FL - 32055, 8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:32 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-mJMDUX8UXD3lNl8fzP924A7E7xCOZuT4oEpPovzdZzP

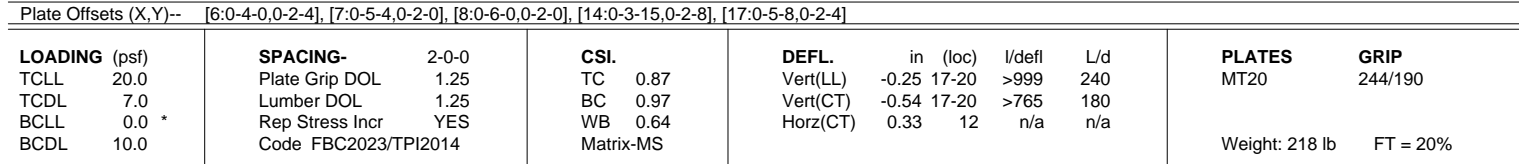

REACTIONS. (size) 12=0-5-8, 2=0-5-8
 Max Horz 2=270(LC 11)
 Max Uplift 12=-333(LC 13), 2=-397(LC 12)
 Max Grav 12=1368(LC 1), 2=1355(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-2371/693, 3-5=-2102/602, 5-6=-2084/687, 6-7=-2566/690, 7-8=-2758/746, 8-9=-1918/488
BOT CHORD	2-17=-717/2093, 16-17=-676/2453, 15-16=-675/2465, 14-15=-638/2490, 13-14=-463/1826, 12-13=-305/1001
WEBS	3-17=-303/188, 6-17=-696/199, 7-14=-223/901, 8-14=-422/1618, 8-13=-632/219, 9-13=-185/908, 9-12=-1711/437

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-11-10, Zone1 1-11-10 to 19-4-0, Zone2 19-4-0 to 24-2-14, Zone1 24-2-14 to 25-4-0, Zone2 25-4-0 to 30-3-13, Zone1 30-3-13 to 36-2-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=333, 2=397.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.
- Joaquin Velez PE No.68182

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618285
4424938	T07G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:33 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDbE_zs9zV-EVwbis96IXCcPSjsX7gHdOgTmLXXIM_D1uYyKLzdlzO



Scale = 1:65.1


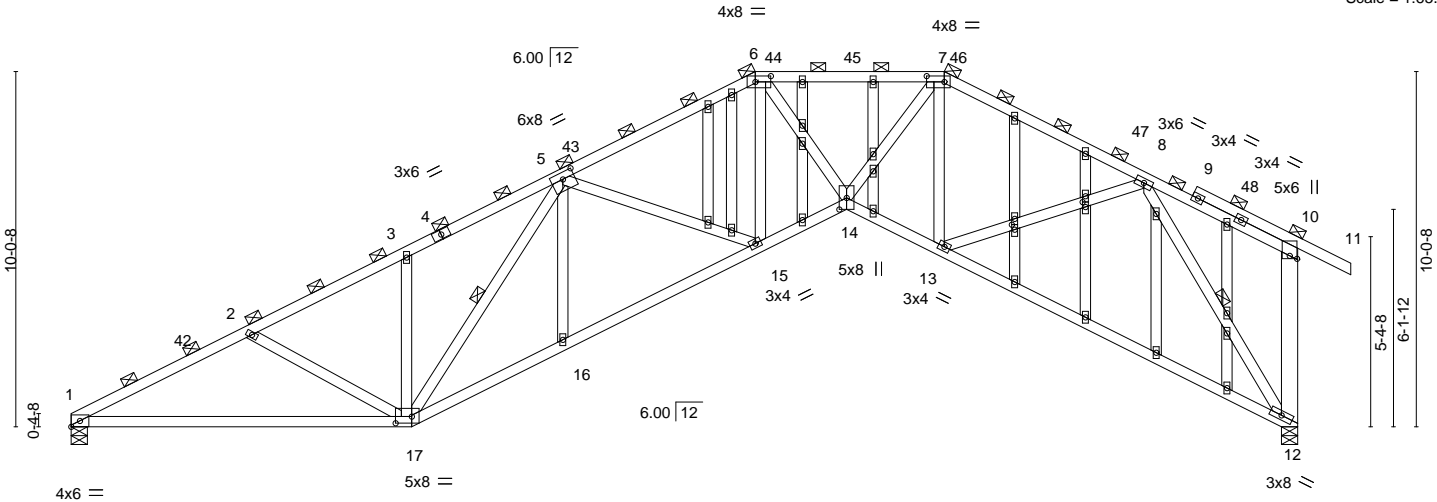


Plate Offsets (X,Y)--		[5:0-4-0,0-2-4], [6:0-5-4,0-2-0], [7:0-6-0,0-2-0], [10:0-1-0,0-2-8], [14:0-3-15,0-2-8], [17:0-5-8,0-2-4], [27:0-1-11,0-1-0], [30:0-1-11,0-1-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.62
TCDL 7.0	Lumber DOL	1.25	BC 0.97
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.62
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.26 12-13 >999 240
			Vert(CT) -0.55 12-13 >752 180
			Horz(CT) 0.33 12 n/a n/a
			PLATES
			MT20
			GRIP
			244/190
			Weight: 268 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (2-11-12 max.), except end verticals.
BOT CHORD 2x4 SP No.2 *Except	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
12-14: 2x4 SP No.1	WEBS 1 Row at midpt 5-17, 8-12
WEBS 2x4 SP No.3 *Except	
10-12: 2x6 SP No.2	
OTHERS 2x4 SP No.3	

REACTIONS.	(size) 12=0-5-8, 1=0-5-8
	Max Horz 1=253(LC 11)
	Max Uplift 12=-336(LC 13), 1=-357(LC 12)
	Max Grav 12=1370(LC 1), 1=1272(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-2391/700, 2-3=-2114/604, 3-5=-2093/687, 5-6=-2570/686, 6-7=-2772/754, 7-8=-2144/536
BOT CHORD	1-17=-728/2115, 16-17=-677/2461, 15-16=-677/2474, 14-15=-642/2491, 13-14=-515/2027, 12-13=-327/1074
WEBS	2-17=-319/197, 5-17=-695/200, 6-14=-232/919, 7-14=-418/1536, 7-13=-577/211, 8-13=-191/992, 8-12=-1762/467

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-5-10, Zone1 3-5-10 to 19-4-0, Zone2 19-4-0 to 24-2-14, Zone1 24-2-14 to 24-8-2, Zone2 24-8-2 to 29-6-15, Zone1 29-6-15 to 36-2-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=336, 1=357.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618286
4424938	T08	MONO TRUSS	14	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:33 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDBe_zs9zV-EVwbis96IXCcPSjsX7gHdOgXQLhHISID1uYyKLzdlzO



Scale = 1:16.3

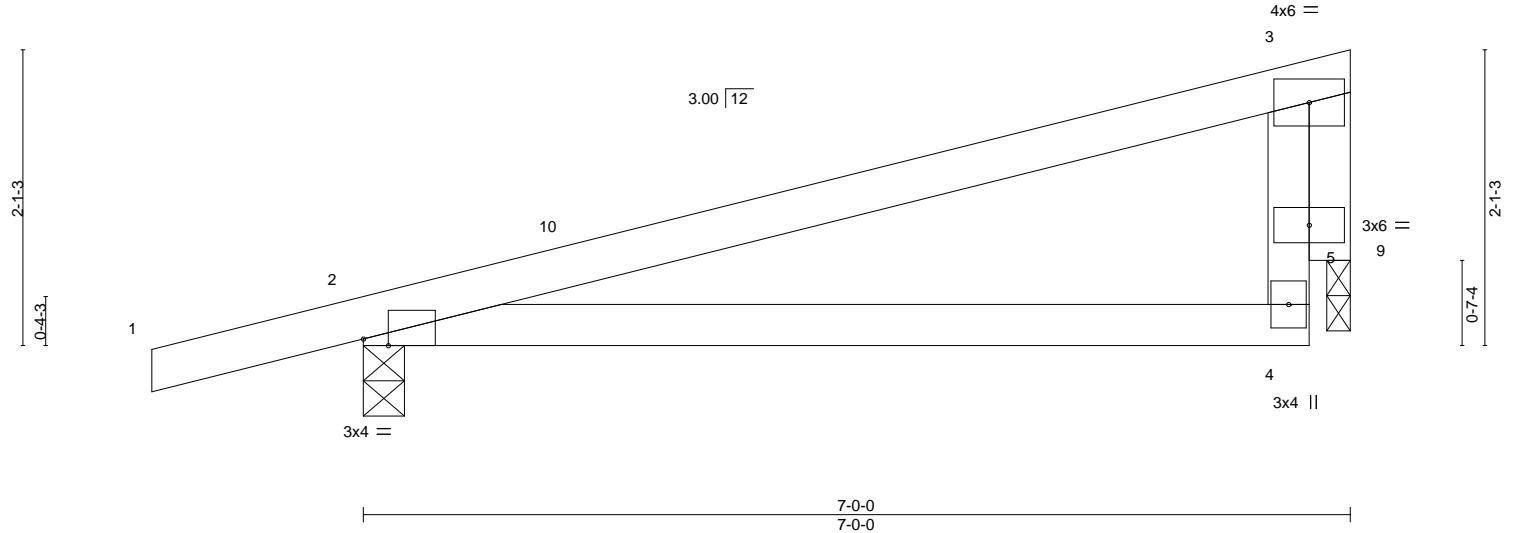


Plate Offsets (X,Y)--		[2:0-2-2,Edge]													
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.38	Vert(LL)	0.09	4-8		>913		240	
TCDL	7.0	Lumber DOL		1.25		BC	0.35	Vert(CT)	-0.11	4-8		>759		180	
BCLL	0.0 *	Rep Stress Incr		YES		WB	0.22	Horz(CT)	0.00	2		n/a		n/a	
BCDL	10.0	Code		FBC2023/TPI2014		Matrix-MR									
														Weight: 27 lb	
														FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS. (size) 2=0-3-8, 9=0-2-0
Max Horz 2=83(LC 8)
Max Uplift 2=211(LC 8), 9=133(LC 8)
Max Grav 2=345(LC 1), 9=222(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 6-6-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 9.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=211, 9=133.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	ALBRITTON	T36618287
4424938	T08G	Monopitch Supported Gable	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Feb 18 2025 MiTek Industries, Inc. Fri Mar 7 12:55:33 2025 Page 1
ID:MLnDgs6VdupJ9j8aMGDBe_zs9zV-EVwbis96IXCcPSjsX7gHdOgU4LwiQQD1uYyKLzdlzO

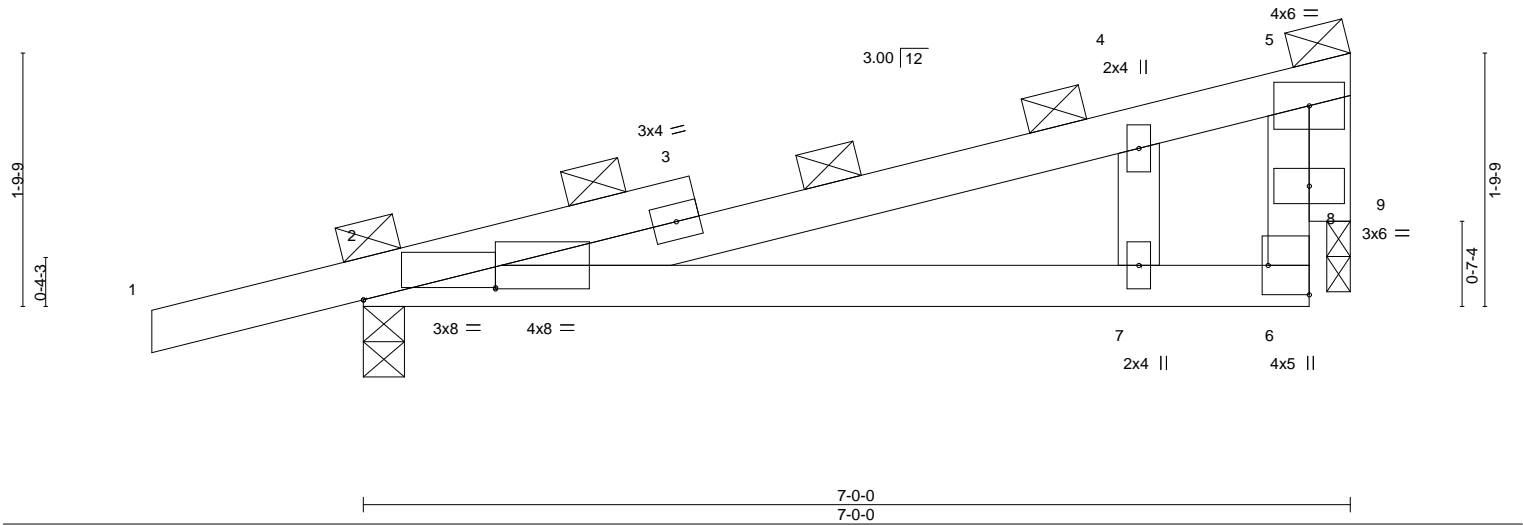


Plate Offsets (X,Y)--		[2:0-11-4,0-1-1], [2:0-11-4,0-0-15], [6:Edge,0-3-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53
TCDL 7.0	Lumber DOL	1.25	BC 0.31
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.34
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-R
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.10 2-7 >851 240
			Vert(CT) -0.09 2-7 >948 180
			Horz(CT) 0.00 9 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 29 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-3-13 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 9=0-2-0
Max Horz 2=70(LC 8)
Max Uplift 2=-218(LC 8), 9=-126(LC 8)
Max Grav 2=350(LC 1), 9=214(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-260/265, 4-5=-225/313, 6-8=-253/163, 5-8=-253/163
BOT CHORD 2-7=-338/232, 6-7=-338/232
WEBS 5-9=-250/368

- NOTES-
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 9.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=218, 9=126.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

March 10,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

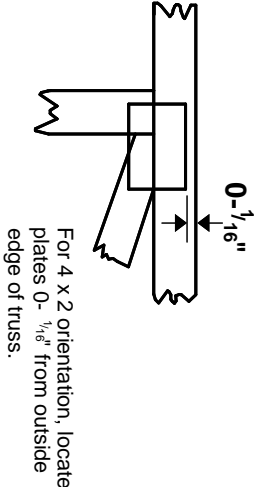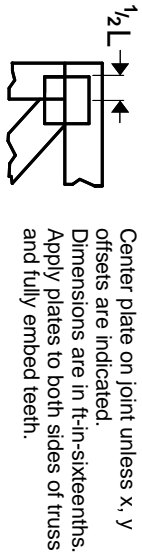

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.


This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.


4 X 4

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

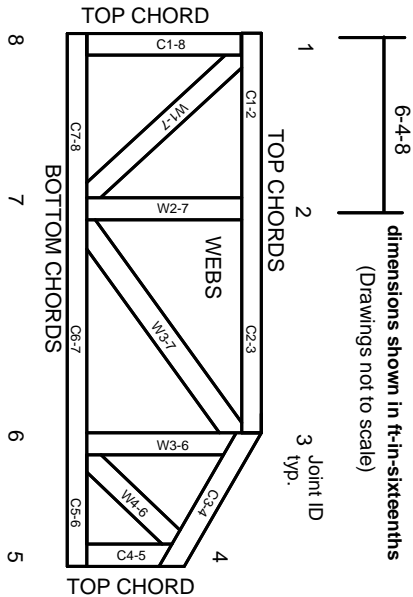

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.