




REAR ELEVATION

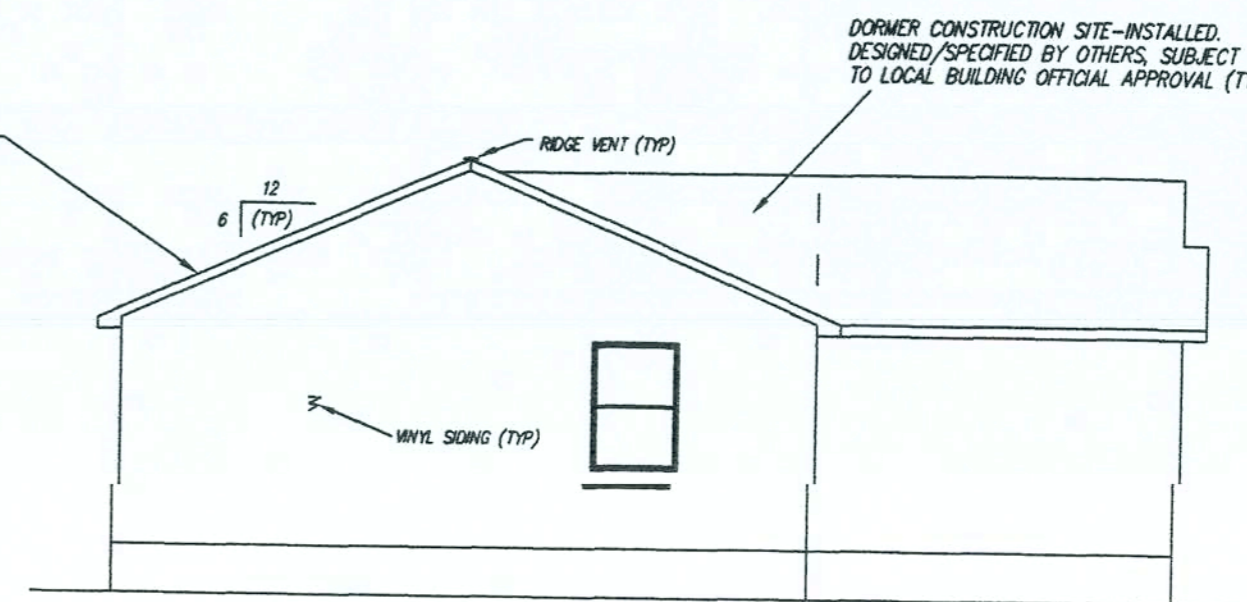

LEFT ELEVATION

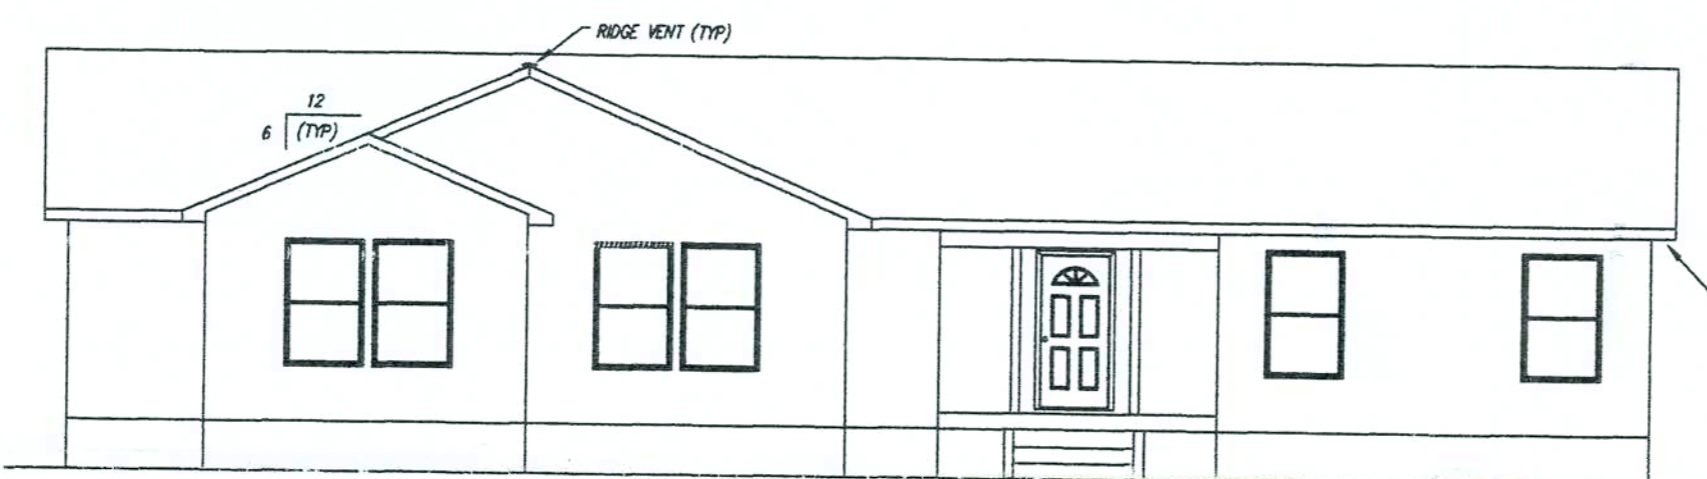

FRONT ELEVATION

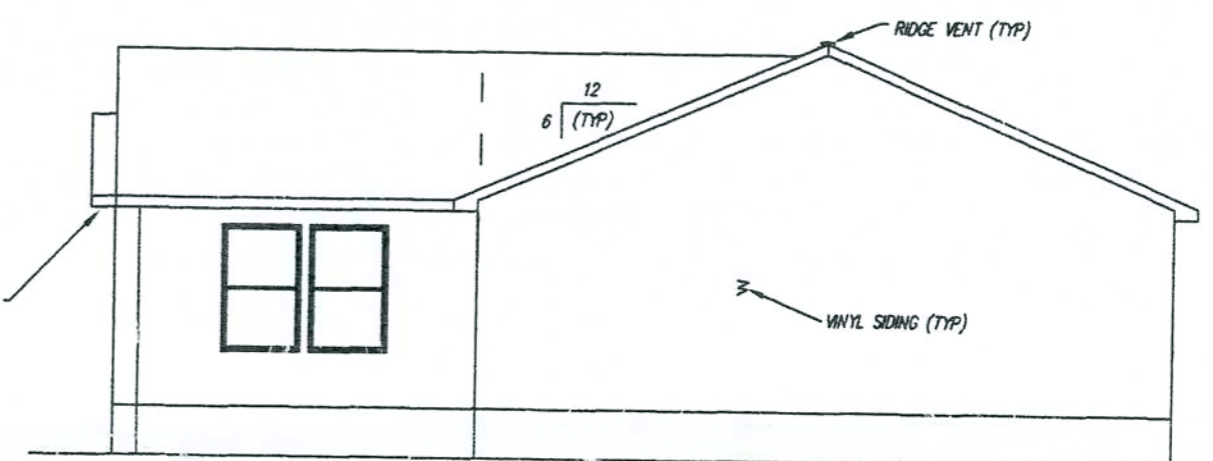

RIGHT ELEVATION

DORMER CONSTRUCTION SITE-INSTALLED, DESIGNED/SPECIFIED BY OTHERS, SUBJECT TO LOCAL BUILDING OFFICIAL APPROVAL (TYP)

ASPHALT SHINGLES (TYP)

12
6 (TYP)

RYL SIDING (TYP)

12" OVER HANG (TYP)

BUILDING SITE INSTALLATION REQUIREMENTS
ATTENTION LOCAL INSPECTIONS DEPARTMENT:

The following items have not been completed by the building manufacturer, have not been inspected by the third party inspection agency and are not certified by the state modular label and/or certification. Code compliance for these items must be determined at the local level:

- 1) The complete foundation support system and tiedown and/or anchorage system.
- 2) Ramps, stairs and general access to the building.
- 3) Building drains, cleanouts and hook-ups to plumbing system, and finish plumbing.
- 4) Electrical service hook-up (including feeders and the main Electrical Panel).
- 5) Connection of electrical circuits crossing over modular mating lines (multi-wide units only).
- 6) Structural and aesthetic interconnections between modules (multi-units only).
- 7) Installation of insulation at floor, ceiling and end-walls at mating lines (multi-wide units only).
- 8) Install R6.5 insulation on all piping installed in unconditioned spaces.
- 9) Install firestopping at all module mate lines at the marriage wall ceiling height and at the floor system.
- 10) Crawl space light and switch.
- 11) HVAC system crossover ducts, and HVAC systems.
- 12) Ridge vents must be installed in accordance with the vent manufacturers instructions.
- 13) Storm Protection Panels Required For Glazed Openings Per FBC-R Section R301.2.1.2
- 14) Plan review and inspection required by Chapter 633 F.S. to be done on-site by local fire safety inspector.
- 15) On-site fastenings and framing at gable walls, truss transitions and/or hinged trusses.
- 16) Fireplace Chimney
- 17) Dormer Construction

* Heat Pump Cooling System Required With a SEER = 14.0 (min) and Programmable Thermostat

NOTE: THESE PLANS HAVE BEEN PREPARED IN COMPLIANCE WITH THE 2004 FLORIDA BUILDING CODE WITH THE 2006 AMENDMENTS.

NOTE: A SET OF THESE DRAWINGS WITH EMBOSSED ENGINEERS SEALS MUST BE ON FILE AT THE THIRD PARTY AGENCIES OFFICE, AS DIRECTED BY THE FLORIDA DCA.

NOTE: ALL MATERIALS USED IN THE CONSTRUCTION OF THIS BUILDING WHICH ARE COVERED BY THE FLORIDA BUILDING COMMISSION CHAPTER 98-72 RULES SHALL HAVE A CURRENT FLORIDA PRODUCT APPROVAL

THIS STRUCTURE CANNOT BE LOCATED ON THE UPPER HALF OF AN "ISOLATED HILL, RIDGE OR ESCARPMENT" WHICH SATISFIES ALL OF THE FOLLOWING:

- (1) HILL, RIDGE OR ESCARPMENT IS HIGHER THAN 30 FEET IN EXPC LOCATIONS AND 60 FEET IN EXPB LOCATIONS
- (2) AVERAGE SLOPE OF HILL EXCEEDS TEN PERCENT
- (3) THE HILL, RIDGE OR ESCARPMENT HAS NO OBSTRUCTIONS TO WIND MOVEMENT BY TOPOGRAPHIC FEATURES FOR A DISTANCE FROM THE HIGH POINT OF THE HILL, RIDGE OR ESCARPMENT EQUAL TO 50 TIMES THE HEIGHT OF THE HILL, RIDGE OR ESCARPMENT OR ONE MILE, WHICHEVER IS LESS

STATE OF FLORIDA

CODE: 2004 FBC, RESIDENTIAL WITH '06 SUPPLEMENT AND 2005 NEC
 FLOOR LIVE LOAD: 40 PSF
 FLOOR DEAD LOAD: 8 PSF
 ROOF LIVE LOAD: 20 PSF
 ROOF DEAD LOAD: 6 PSF
 ATTIC LIVE LOAD: 0 PSF
 ATTIC DEAD LOAD: 10 PSF
 MAX. WIND SPEED: 130 MPH, EXPC, Iw=1.0
 (3 SEC. GUST, ENCLOSED BLDG)
 OCCUPANCY GROUP: SINGLE FAMILY DWELL.

CONSTRUCTION TYPE: WOOD FRAME
 BUILDING CATEGORY: II (PER ASCE 7-02)
 MEAN ROOF HEIGHT NOT TO EXCEED 15' ABOVE GRADE
 COMPONENT & CLADDING DESIGN LOADS:
 WALL ZONE 4: 39.9 PSF WALL ZONE 5: 49.3 PSF
 ROOF ZONE 1: 33.6 PSF ROOF ZONE 2: 58.6 PSF
 ROOF ZONE 3: 86.6 PSF

Not to be located in coastal or flood plain areas or in HIGH VELOCITY HURRICANE ZONES

FOUNDATION NOTES

IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA DEPARTMENT OF COMMUNITY AFFAIRS, THESE BUILDING PLANS DO NOT CONTAIN FOUNDATION SUPPORT AND TIEDOWN SYSTEM DETAILS AND SPECIFICATIONS. THE DESIGNER OF THE BUILDING PLANS SHOULD BE CONTACTED TO OBTAIN APPROPRIATE FOUNDATION PLANS. IF FOUNDATION PLANS ARE DESIGNED BY OTHERS, THE DESIGNER OF THE BUILDING PLANS SHALL NOT BE HELD RESPONSIBLE OR LIABLE FOR THE FOUNDATION DESIGN AND THE CONSEQUENTIAL PERFORMANCE OF THE SUPERSTRUCTURE'S STRUCTURAL COMPONENTS AND SYSTEMS RELATED THERETO.

LISTING AGENCY APPROVAL

These prints comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:

Const. Type: VB
 Occupancy: R3
 Allowable No. of Floors: 1
 Wind Velocity: 130 (Exp) (3 sec)
 Fire Rating of Ext. Walls: 0
 Plan No: 2198-0014F
 Allow. Floor Load: 40
 Approval Date: 1-12-07
 Manufacturer: Town Homes
 Approval for High Velocity Hurricane Zone: No
 HWC COA # 1025

Date 1-12-07 Plan No. 2198-0014F
 Approved By SCOTT S. FRANCIS

Modular Building Plans Examiner
 Florida License No. SMP-42

SEE LISTED FIELD

NOTE THAT THIS LIST DOES NOT NECESSARILY LIMIT THE ITEMS OF WORK AND MATERIALS THAT MAY BE REQUIRED FOR A COMPLETE INSTALLATION. ALL SITE RELATED ITEMS ARE SUBJECT TO LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL.

- 1) THE COMPLETE FOUNDATION SUPPORT AND TIEDOWN SYSTEM
- 2) RAMPS, STAIRS AND GENERAL ACCESS TO THE BUILDING
- 3) PORTABLE FIRE EXTINGUISHER(S)
- 4) BUILDING DRAINS, CLEANOUTS AND HOOK-UP TO PLUMBING SYSTEM
- 5) ELECTRICAL SERVICE HOOK-UP, INCLUDING THE FEEDERS, TO THE BUILDING
- 6) THE MAIN ELECTRICAL PANEL AND SUB-FEEDERS
- 7) CONNECTION OF ELECTRICAL CIRCUITS CROSSING OVER MODULE MATE LINES (MULTI-UNITS ONLY)
- 8) STRUCTURAL AND AESTHETIC INTERCONNECTIONS BETWEEN MODULES (MULTI-UNITS ONLY)

ALSO SEE LIST OF REQUIREMENTS IN LOCAL INSPECTORS NOTES BELOW

NOTE THE BUILDING SPECIFIED ON THESE DRAWINGS IS EXCLUDED FROM COVERAGE OF THE MANUFACTURED HOUSING CONSTRUCTION AND SAFETY STANDARDS ACT, 42 U.S.C. 5401 ET SEQ. UNDER PROVISIONS OF 24 CFR 3282.12, IN THAT THE BUILDING IS:

- 1) INTENDED ONLY FOR ERECTION OR INSTALLATION ON A SITE-BUILT PERMANENT FOUNDATION;
- 2) NOT DESIGNED TO BE MOVED ONCE ERECTED OR INSTALLED; AND
- 3) DESIGNED AND MANUFACTURED TO COMPLY WITH A NATIONALLY RECOGNIZED MODEL BUILDING CODE OR AN EQUIVALENT BUILDING CODE FOR SITE-BUILT HOUSING.

ELEVATION NOTES: Typical

See cross section for method of roof ventilation.

Handicap ramp(s), Stair(s), and Handrails are site installed, designed by others, and subject to local jurisdiction review and approval.


Foundation enclosure (when provided) must have 1 square foot net vent area per 1/150th of the floor area and an 18"x24" minimum crawl space access, site installed by others, subject to local jurisdiction, review & approval. (min 15.5 ft² net vent area req'd)

TOWN HOMES LLC


P.O. BOX 1059
 LAKE CITY, FLORIDA 32056

| | | |
|--|-----------------|--|
| DATE: 10/25/06 | REVISIONS: | DRAWN BY: C.A. LeBlanc |
| CODES: FBC | | |
| LABELS: FL | | |
| SCALE: 1/8" = 1'-0" | | |
| MODEL: 2903-1003 ELEVATIONS | PLAN NO. TH-5FL | SHEET |
| WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER P.E. LICENSE #33841 | | 33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167 |
| | | 1 OF 6 |

FILE COPY

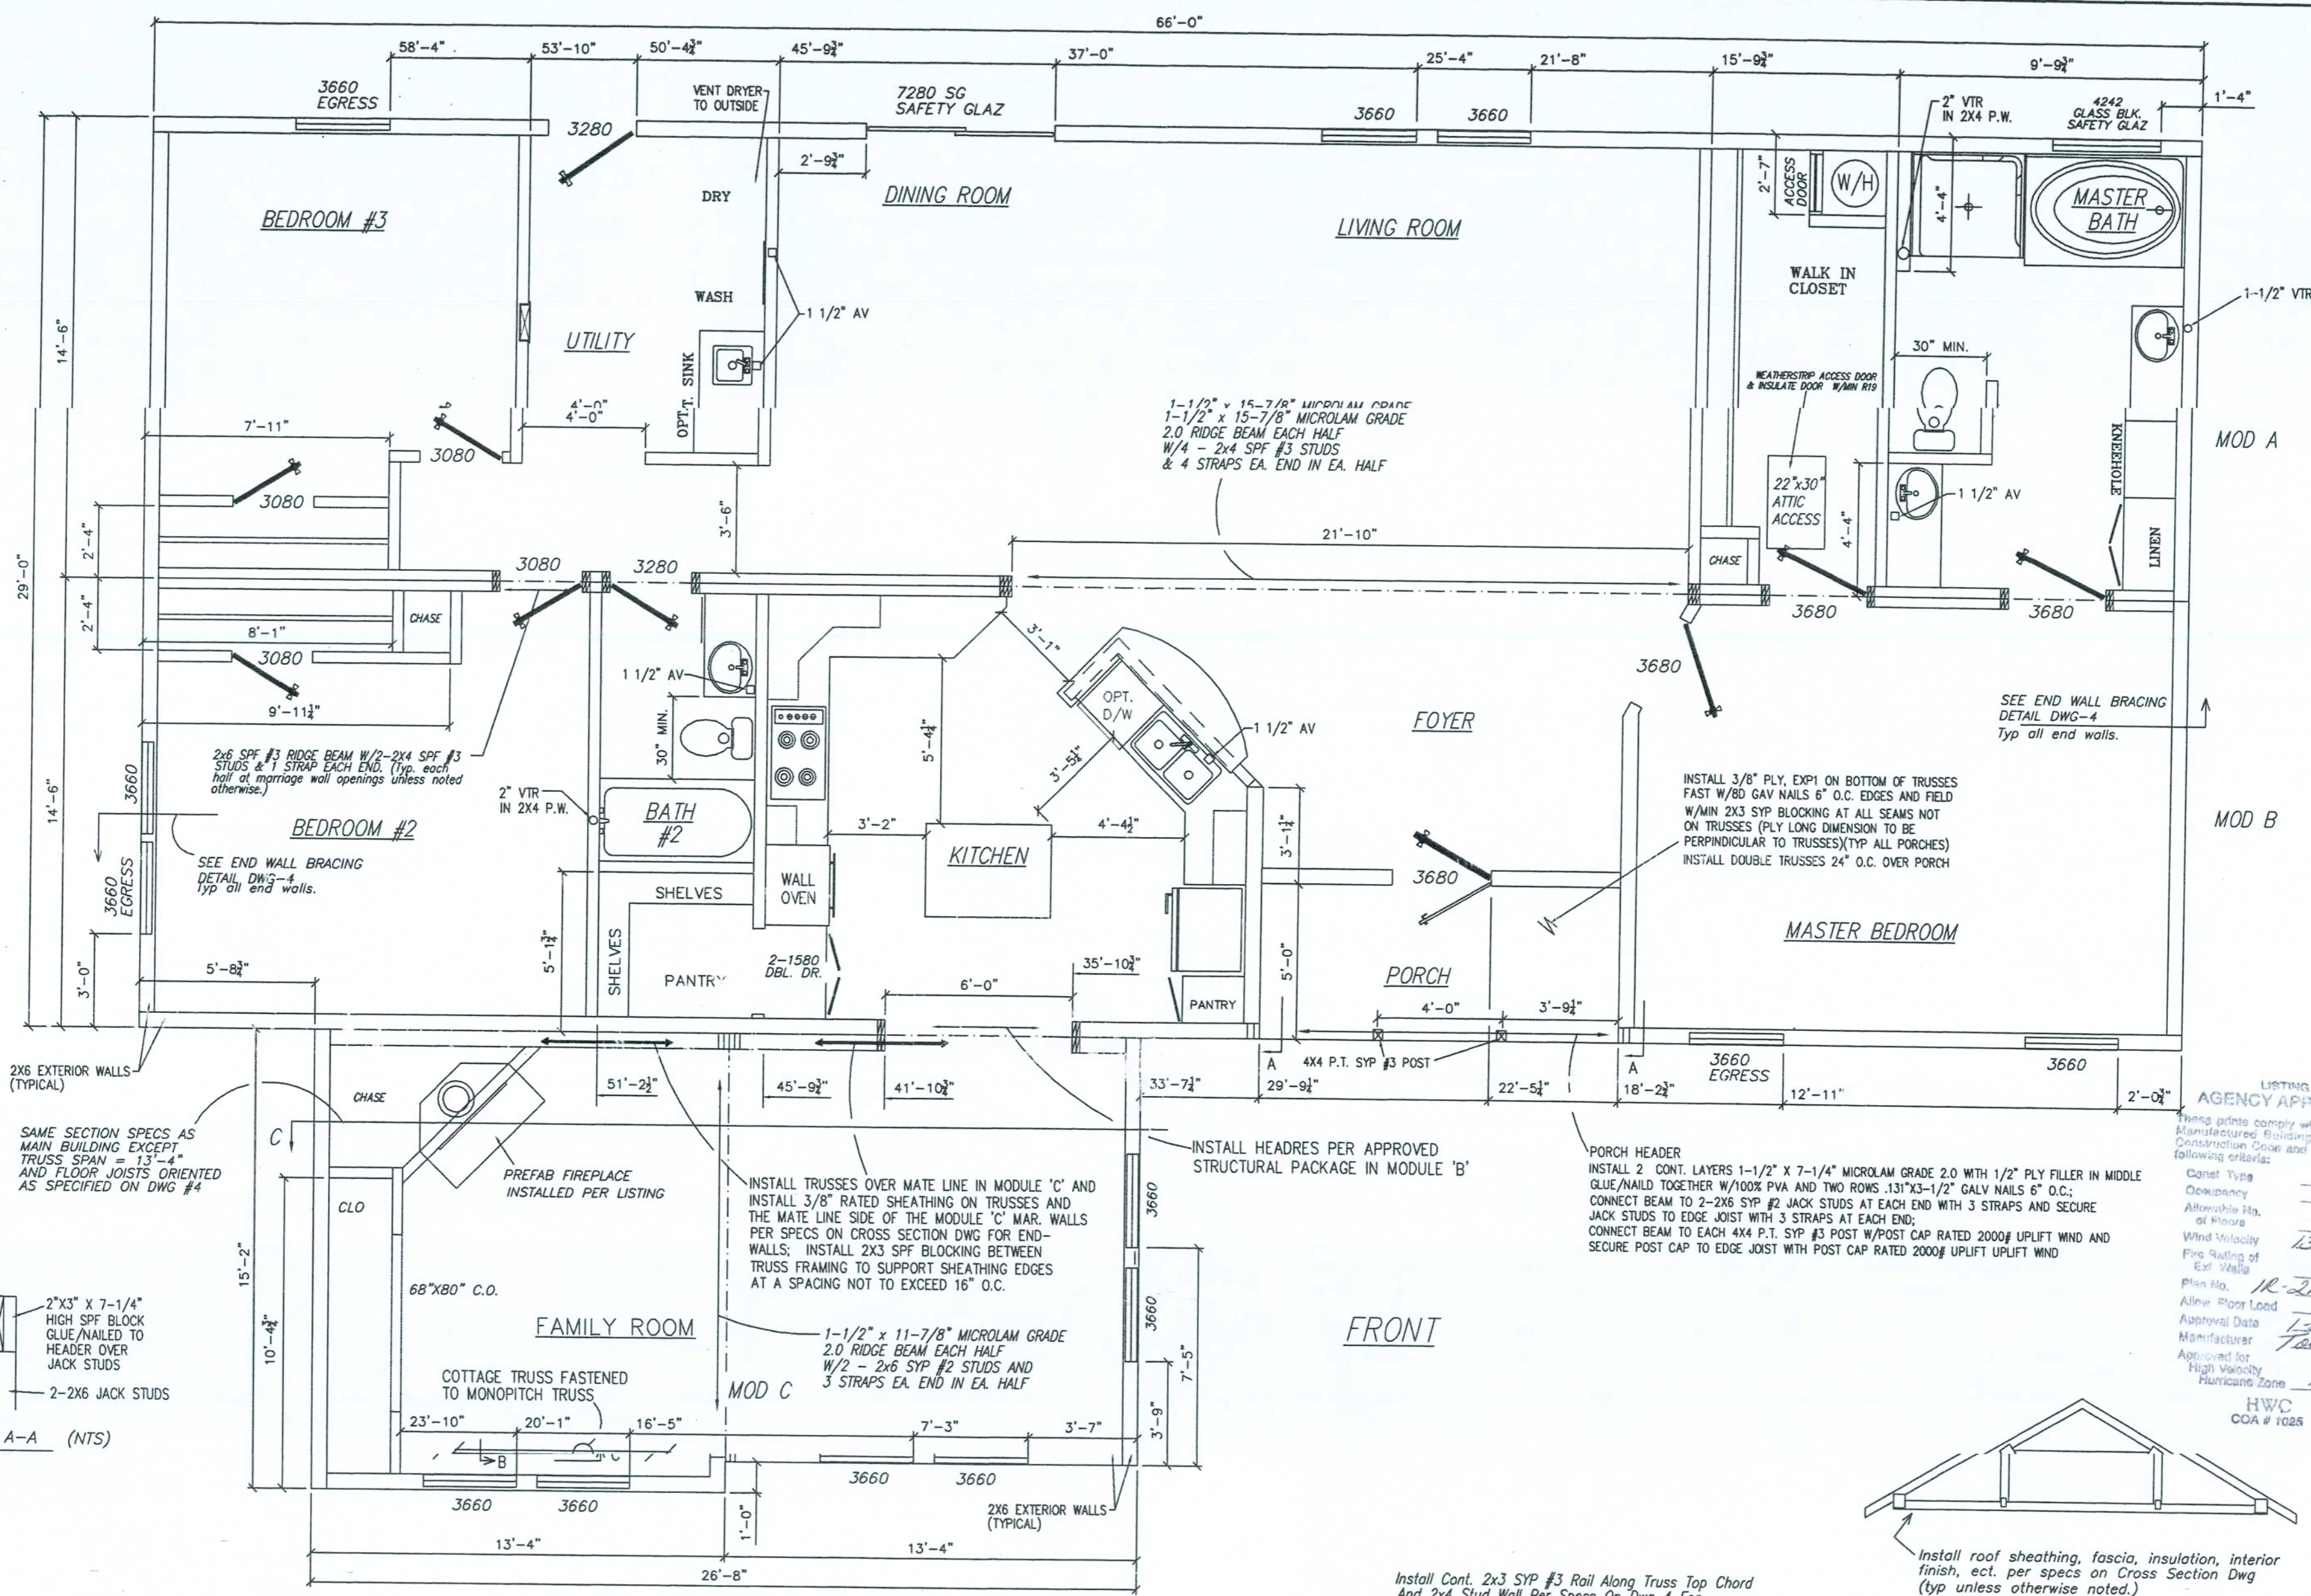

LISTING AGENCY APPROVAL
 Things please comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:
 Cant Typing: VB
 Consistency: R3
 Allowable Itz. of Floor: 1
 Wind Velocity: 130 (3.0)
 Floor No.: 0
 Allow. Floor Load: 20
 Approval Date: 1-20-07
 Manufacturer: Town Homes
 Approved for High Velocity Hurricane Zone: 16
 HWC
 COA # 1025

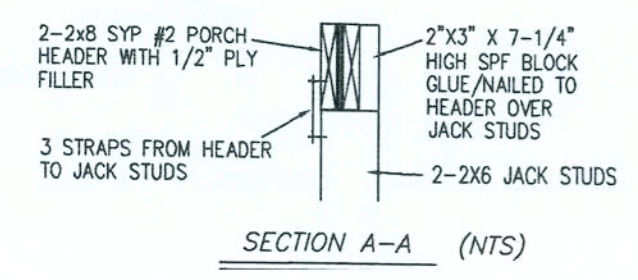

| LIGHT & VENT CHART | FLOOR AREA SQ. FT. | LIGHT | | VENT | |
|-----------------------|--------------------|----------|----------|----------|----------|
| | | REQUIRED | PROVIDED | REQUIRED | PROVIDED |
| MASTER BEDROOM | 231.8 | 18.54 | 9.27 | 24.40 | 12.28 |
| BEDROOM #2 | 190.3 | 15.22 | 7.61 | 24.40 | 12.28 |
| BEDROOM #3 | 139.6 | 11.17 | 5.58 | 12.20 | 6.14 |
| FAMILY ROOM/KITCHEN | 545.3 | 43.62 | 21.81 | 73.20 | 36.84 |
| LIVING RM./DINING RM. | 405.0 | 32.40 | 16.20 | 32.40 | 16.20 |
| | | 232.40 | 116.20 | | |

| WINDOW & DOOR SCHEDULE | | | | | |
|------------------------|--------|-------------|-------------|------------|--|
| WIDTH | HEIGHT | TYPE | LIGHT SQ FT | VENT SQ FT | |
| 24" | 60" | Single hung | 7.69 | 3.93 | |
| 30" | 60" | Single hung | 9.95 | 5.03 | |
| 36" | 60" | Single hung | 12.20 | 6.14 | |
| 40" | 60" | Single hung | 13.71 | 6.87 | |
| 30" | 40" | Single hung | 6.28 | 3.14 | |
| 30" | 27" | Single hung | 3.90 | 1.90 | |
| 34" | 80" | Door | | | |
| 36" | 80" | Door | | | |



NOTE: ALL POST CAPS AND CONNECTORS IN CONTACT WITH P.T. LUMBER MUST BE GALVANIZED PER ASTM A123 OR BE MANUFACTURED FROM STEEL GALVANIZED IN ACCORDANCE WITH ASTM A653, G185

NOTE: ALL FASTENERS USED IN PORCH AREA MUST BE HOT-DIPPED ZINC-COATED GALVANIZED STEEL (ALL FASTENERS IN PORCH MUST BE GALVANIZED PER ASTM A153)

NOTE: All windows to be single hung w/insulated glazing All egress windows must comply w/FBC-R Section R310 (U=.48 max; Kinro series 9750)

All exterior doors to be insulated (U=.52) except Sliding Glass Doors and/or Patio Doors to have U=.70 max unless otherwise noted.

All straps referenced on the floor plan are 1-1/2" x 26 GA steel with 8-15 GA x 1" staples each end from ridge beam to stud and stud to edge joist(s) or from header to stud and stud to edge joist(s) (Fy=44 KSI MIN)

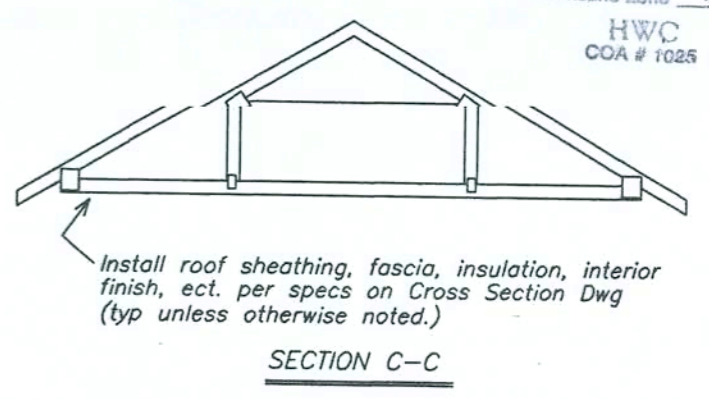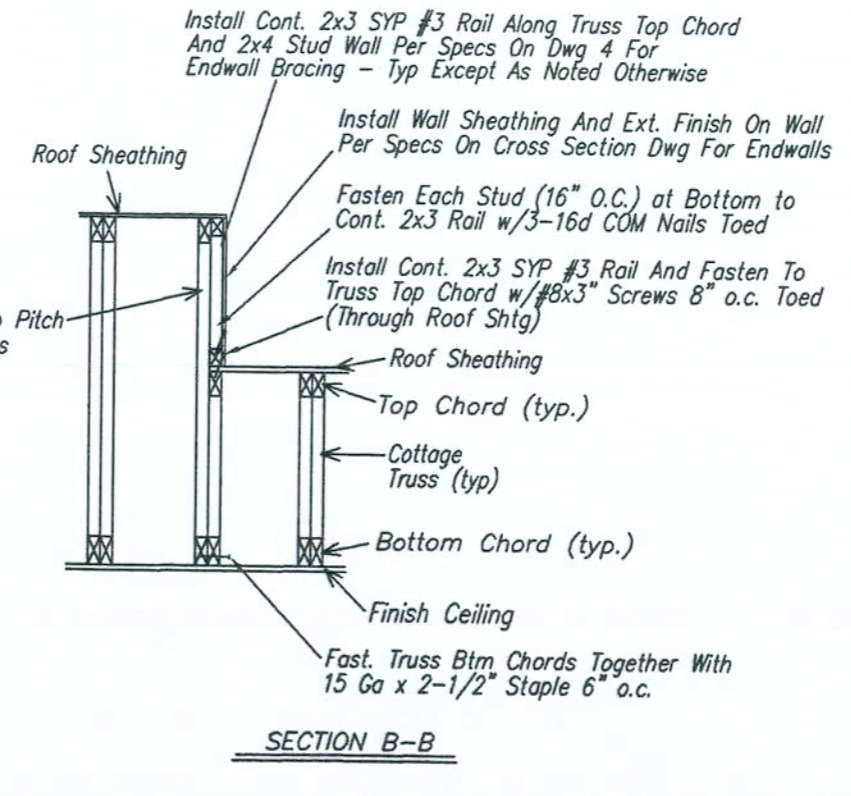


TOWN HOMES LLC
 P.O. BOX 1059
 LAKE CITY, FLORIDA 32056

| | | |
|-----------------|---------------------|-----------------------------|
| DATE: 10/25/06 | REVISIONS: 1/19/07 | DRAWN BY: C.A. Leblanc |
| CODES: FBC | SCALE: 1/4" = 1'-0" | MODEL: 2903-1003 FLOOR PLAN |
| PLAN NO. TH-5FL | SHEET 2 OF 6 | |

WILLIAM J. KALKER, JR., P.E.
 CONSULTING ENGINEER
 P.E. LICENSE #33641

33 ROCKWOOD LANE
 MONROE, CT 06468
 (203) 261-1167

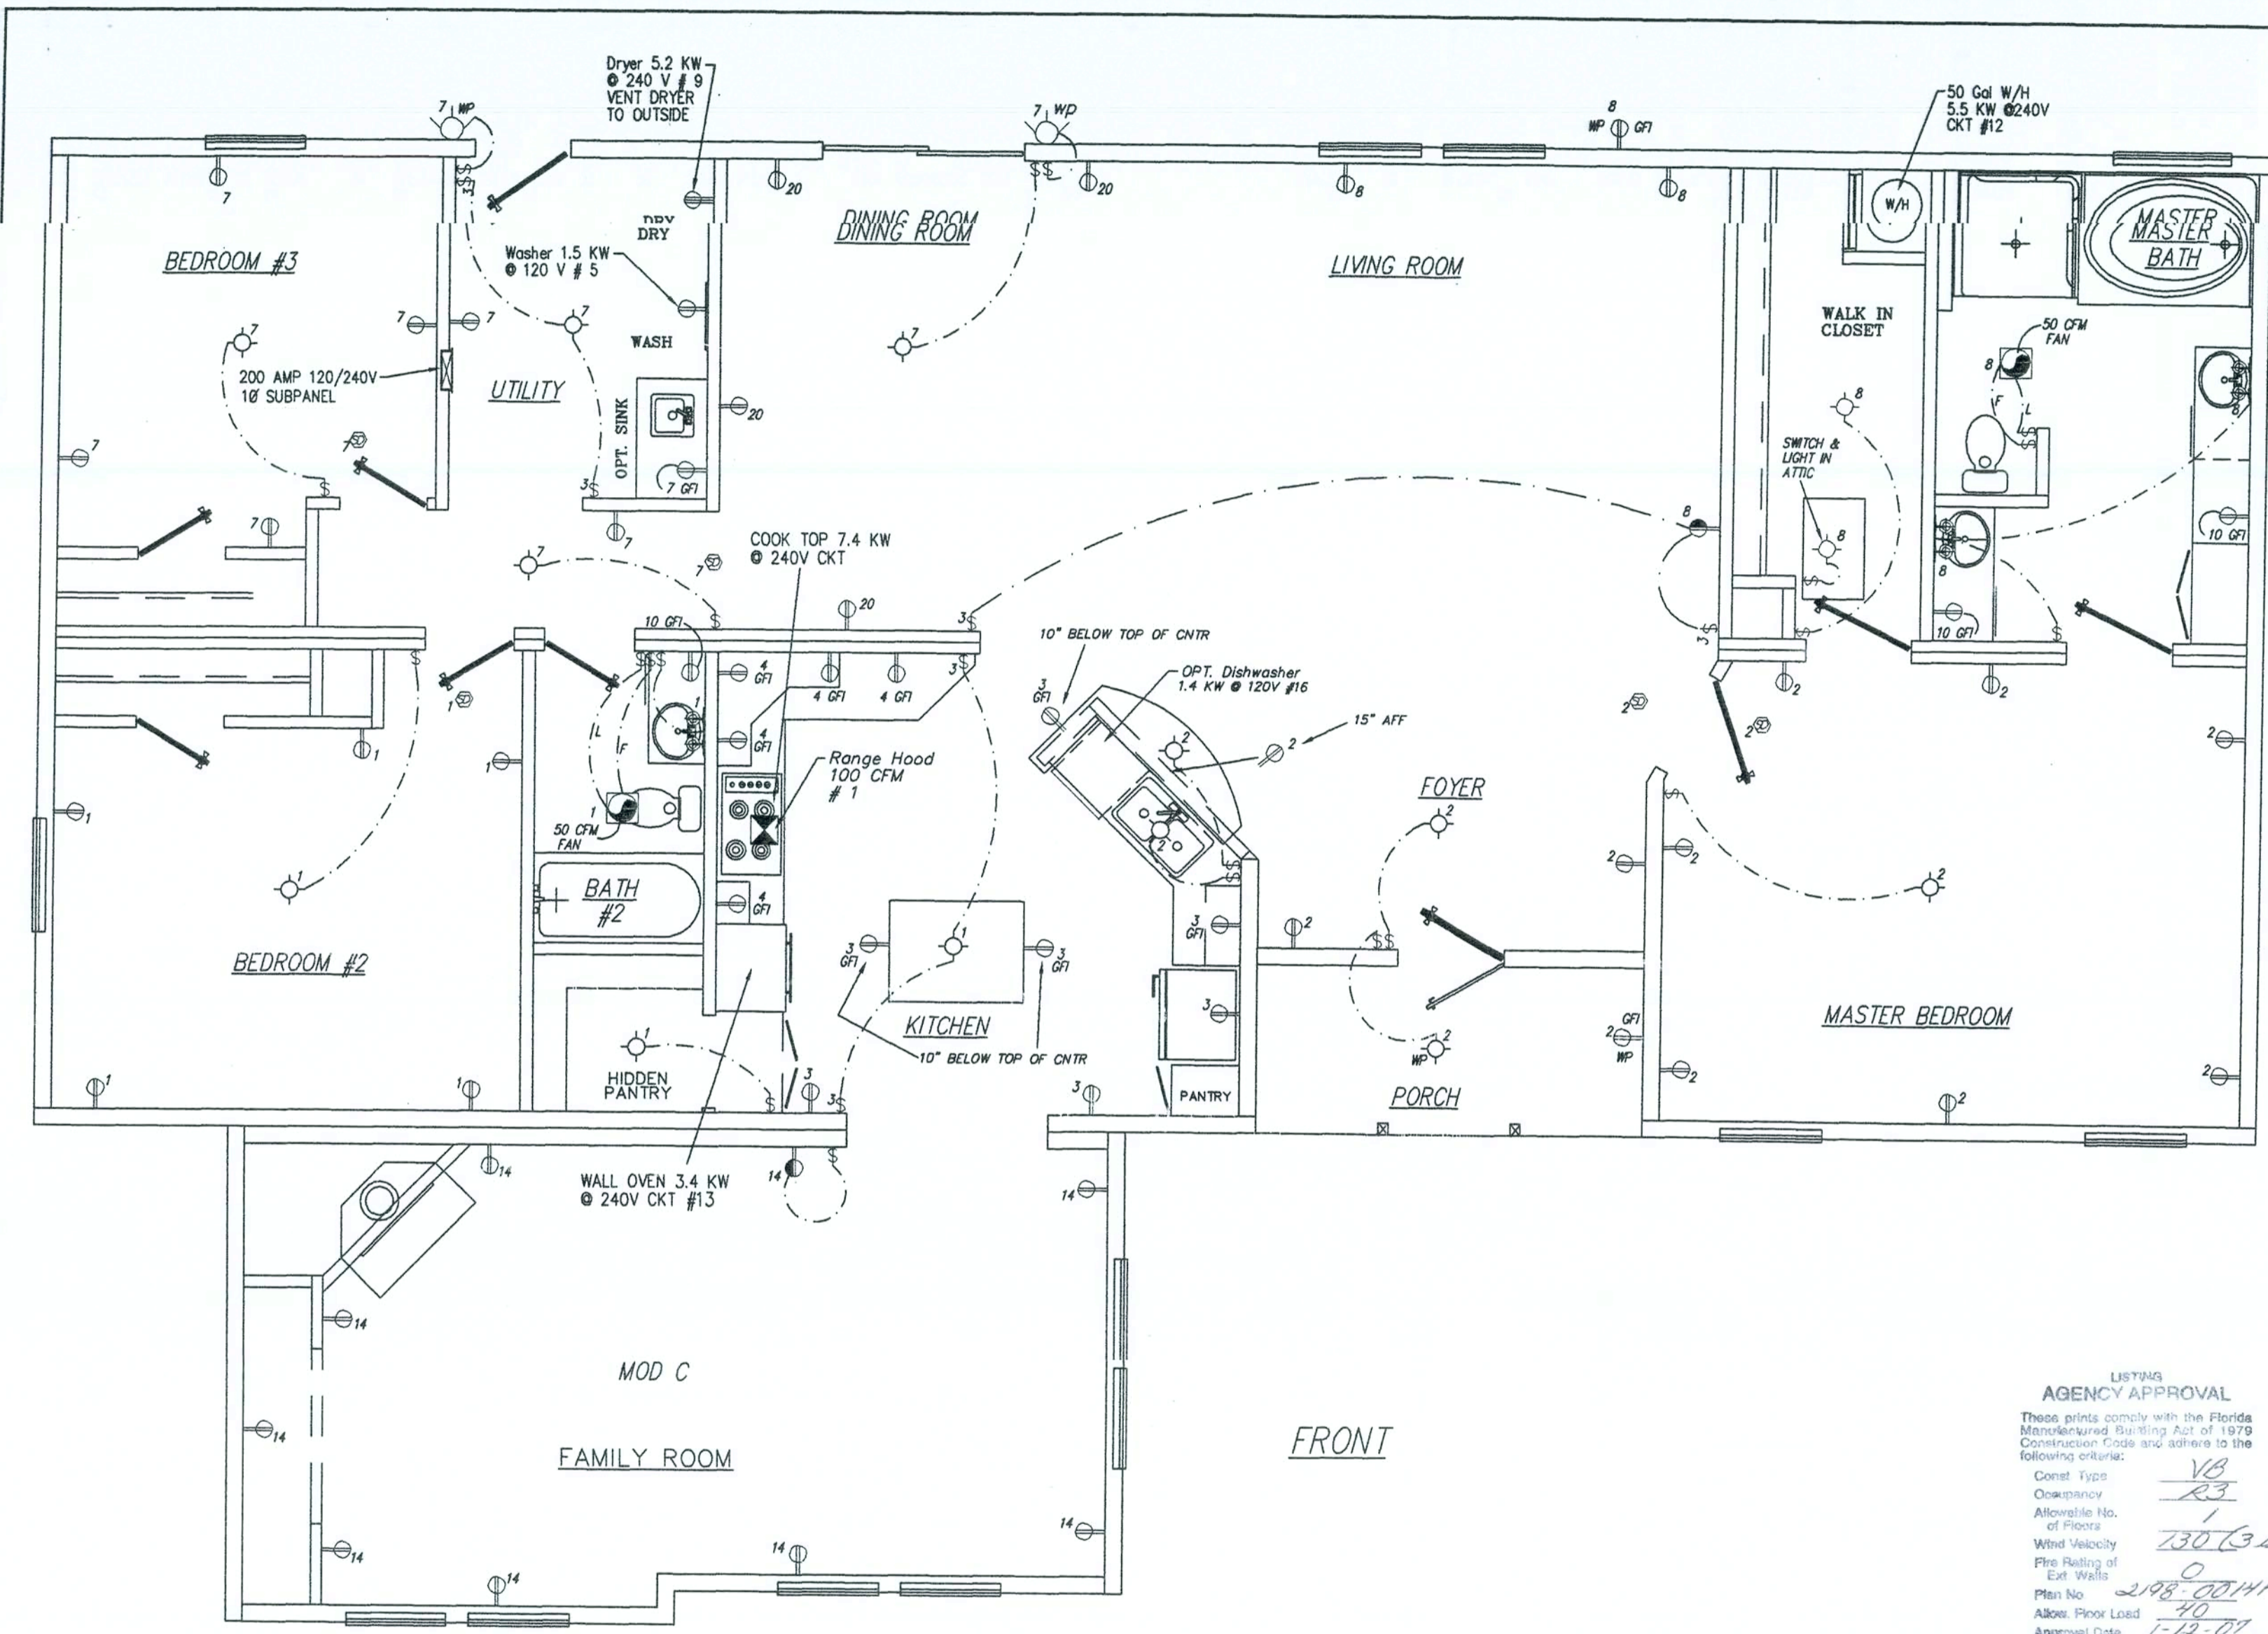

MOD A

MOD B

*NOTE: ALL BRANCH CIRCUITS SUPPLYING 15 AND 20 AMP OUTLETS IN BEDROOMS MUST BE PROTECTED BY AN ARC-FAULT CIRCUIT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC. (CIRCUITS 1, 2, 7 AND 8 MUST BE PROTECTED BY AN ARC-FAULT TYPE CIRCUIT BREAKER)

NOTE: HVAC SYSTEM TO BE SITE INSTALLED AND DESIGNED BY OTHERS, SUBJECT TO LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL.

- ELECTRICAL NOTES: NEC**
- All circuits and equipment shall be grounded in accordance with the appropriate articles of the NEC.
 - When light fixtures are installed in closets they shall be surface mounted or recessed. Incandescent fixtures shall have completely enclosed lamps. Surface mounted incandescent fixtures shall have minimum clearance of 12 inches and all other fixtures shall have a minimum clearance of 8 inches from "Storage Area" as defined by NEC 410-8.
 - When water heaters are installed they shall be provided with readily accessible disconnects adjacent to the water heaters served. The branch circuit switch or circuit breakers shall be permitted to serve as disconnecting means only where the switch or circuit breaker is within sight from the water heater or is capable of being locked in the open position.
 - HVAC equipment shall be provided with readily accessible disconnects adjacent to the equipment served. A unit switch with a marked "OFF" position that is a part of the HVAC equipment and disconnects all ungrounded conductors shall be permitted as the disconnecting means where other disconnecting means are also provided by a readily accessible circuit breaker.
 - Prior to energizing the electrical system the interrupting rating of the main breaker must be designed and verified by us being in compliance with section 110-9 of the NEC by local electrical consultant.
 - Breakers and feeders are site installed, designed by others and subject to local jurisdiction review and approval.
 - All circuits crossing over modular mating line(s) shall be site connected with approved accessible junction boxes, located below the floor or in the attic.
 - All circuits to be copper NM except HVAC and Range circuits to be copper SE cable. (75°C).
 - Light and switch to be site-installed in the crawl space near the crawl space access door (light to be connected to any of the installed general lighting circuits).
 - Receptacles installed in wet locations must be in a weatherproof enclosure the integrity of which is not affected when the attachment plug cap is inserted or removed.
 - Smoke detectors must be wired to activate all alarms simultaneously if any detector is activated. All smoke detectors located within twenty feet of a cooking appliance shall be the photoelectric type.
 - All fans must be ducted to the exterior of the building and terminate at an approved vent cap.


LISTINGS

AGENCY APPROVAL

These prints comply with the Florida Manufactured Building Act of 1979. Construction Code and adhere to the following criteria:

| | |
|---|-------------|
| Const. Type | VB |
| Occupancy | R3 |
| Allowable No. of Floors | 1 |
| Wind Velocity | 130 (3 sec) |
| Fire Rating of Ext. Walls | 0 |
| Plan No. | 298-0014F |
| Allow. Floor Load | 40 |
| Approval Date | 1-12-01 |
| Manufacturer | Town Homes |
| Approved for High Velocity Hurricane Zone | No |

HWC
COR # 1028

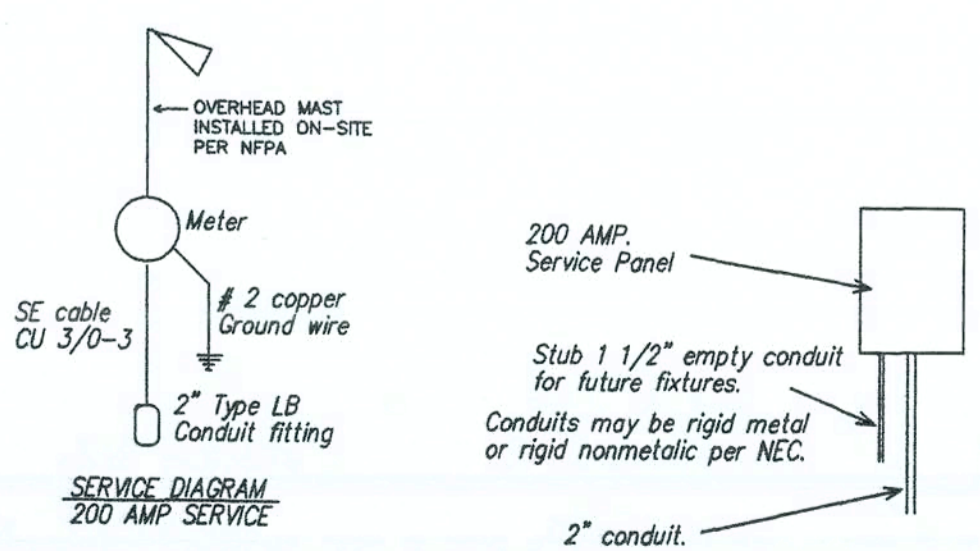

PANEL SIZING (TYPICAL)

| | |
|--------------------------------|-----------------|
| 2318 Sq. Ft. @ 3 watts/Sq. Ft. | 6.95 KW |
| 3-20 AMP Appliance circuits | 4.50 KW |
| Laundry circuit | 1.50 KW |
| Cook Top | 7.40 KW |
| Clothes Dryer | 5.20 KW |
| Water Heater | 5.50 KW |
| Dish Washer | 1.40 KW |
| Wall Oven | 3.40 KW |
| TOTAL | 35.85 KW |

| | |
|--------------------------------|-----------------|
| First 10 KW @ 100% | 10.00 KW |
| Remainder @ 40% (25.85) x .4 = | 10.34 KW |
| Assumed HVAC | 20.90 KW |
| TOTAL | 41.24 KW |

Calculated Load for service size
41240 w/240 volts= 171.8 Amperes
200 AMP service standard

- ELECTRICAL LEGEND**
- Light Switch
 - Duplex Recept
 - 240V Recept
 - Thermostat
 - Smoke Detector w/Battery Backup
 - Porch light W/P
 - Incandescent Light
 - Exhaust fan w/Light
 - Panel box
 - Exhaust fan
 - Fluorescent Light
 - Range hood w/Exhaust Fan and Light

ELECTRICAL CIRCUIT SCHEDULE

| CIR | DESCRIPTION | COND. | SIZE (GU) | BRK(A) |
|-------|------------------|-------|-----------|--------|
| 1,2 | General Lighting | 14-2 | w/GND | 15 |
| 3,4 | Small Appliance | 12-2 | w/GND | 20 |
| 5 | Washer | 12-2 | w/GND | 20 |
| 6 | Cook Top | 8-3 | w/GND | 40 2P |
| 7,8 | General Lighting | 14-2 | w/GND | 15 |
| 9 | Dryer | 10-3 | w/GND | 30 2P |
| 10 | Path | 12-2 | w/GND | 20 |
| 12 | Water Heater | 10-2 | w/GND | 30 2P |
| 13 | Wall Oven | 12-3 | w/GND | 20 2P |
| 14,15 | General Lighting | 14-2 | w/GND | 15 |
| 16 | Dishwasher (opt) | 12-2 | w/GND | 20 |
| 17 | Freezer (opt) | 12-2 | w/GND | 20 |
| 18,19 | General Lighting | 14-2 | w/GND | 15 |
| 20 | Small Appliance | 12-2 | w/GND | 20 |

TOWN HOMES LLC
P.O. BOX 1059
LAKE CITY, FLORIDA 32056

DATE: 10/25/06
CODES: FBC
LABELS: FL
SCALE: 1/4" = 1'-0"

REVISIONS:

DRAWN BY: C.A. LeBlanc
SHEET

MODEL: 2903-1003
ELECTRICAL



PLAN NO. TH-5FL

WILLIAM J. KALKER, JR., P.E.
CONSULTING ENGINEER

33 ROCKWOOD LANE
MONROE, CT 06468
(203) 261-1167

3 OF 6

TYPICAL FLOOR FRAMING PLAN

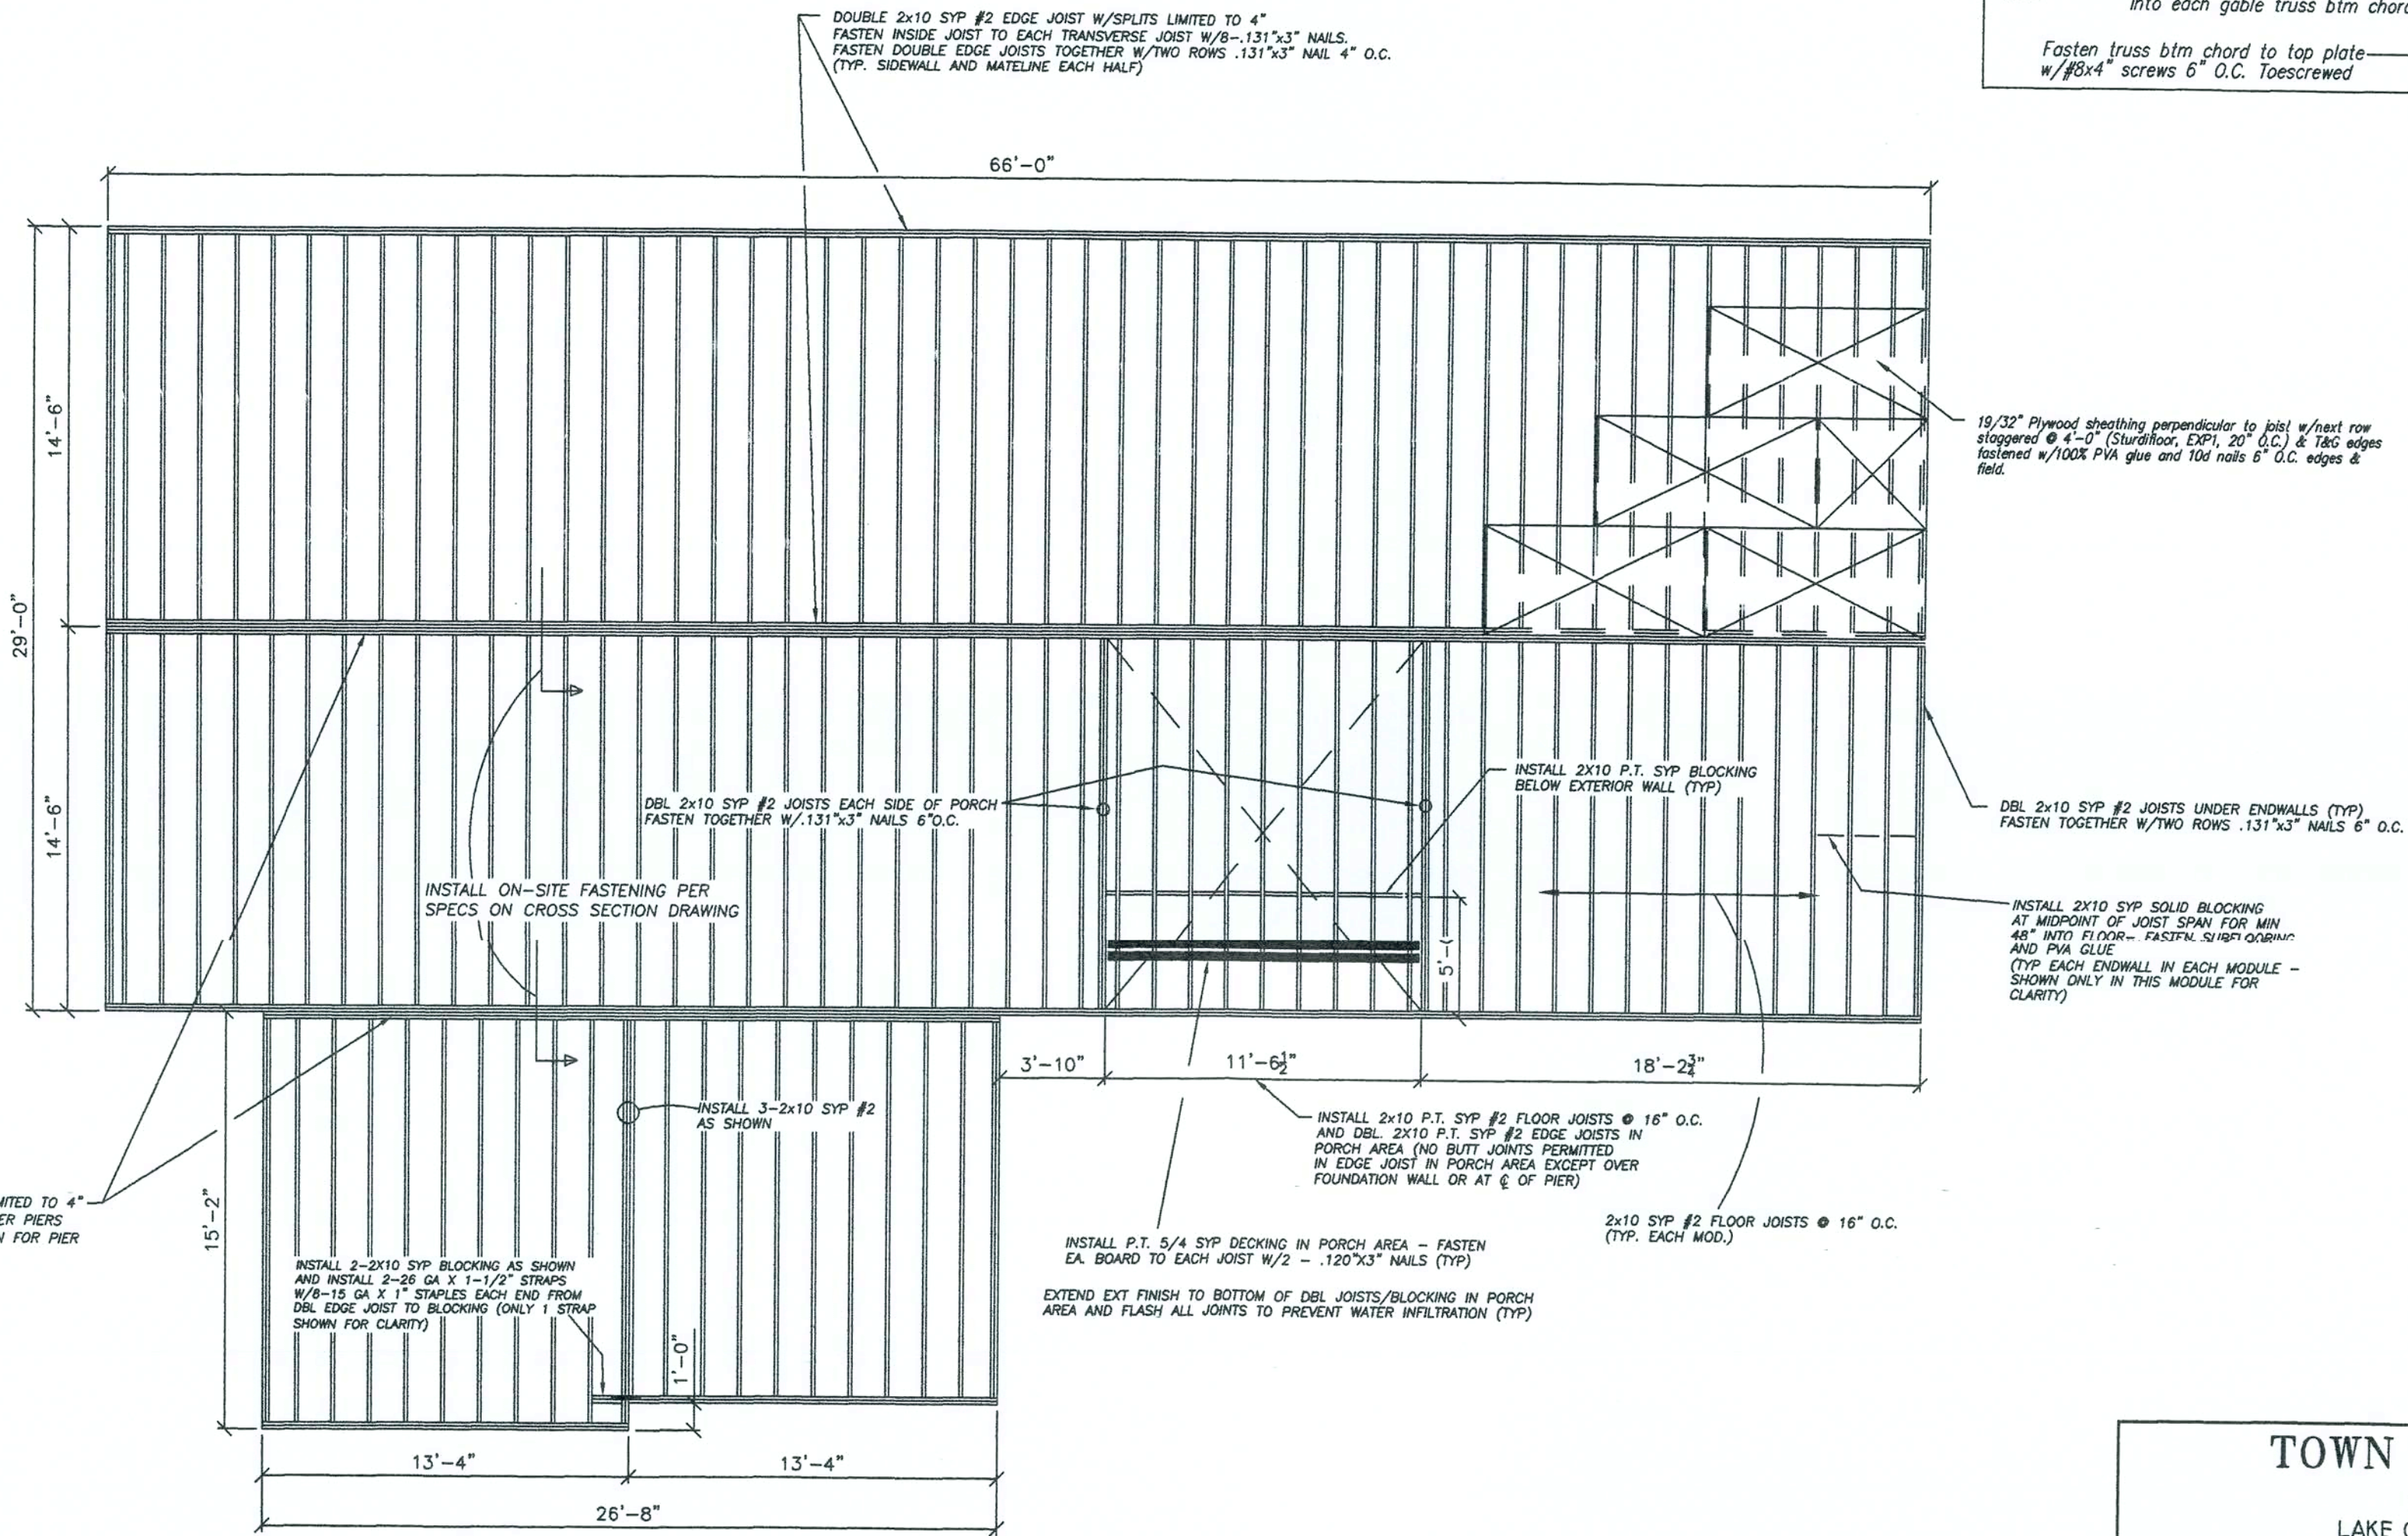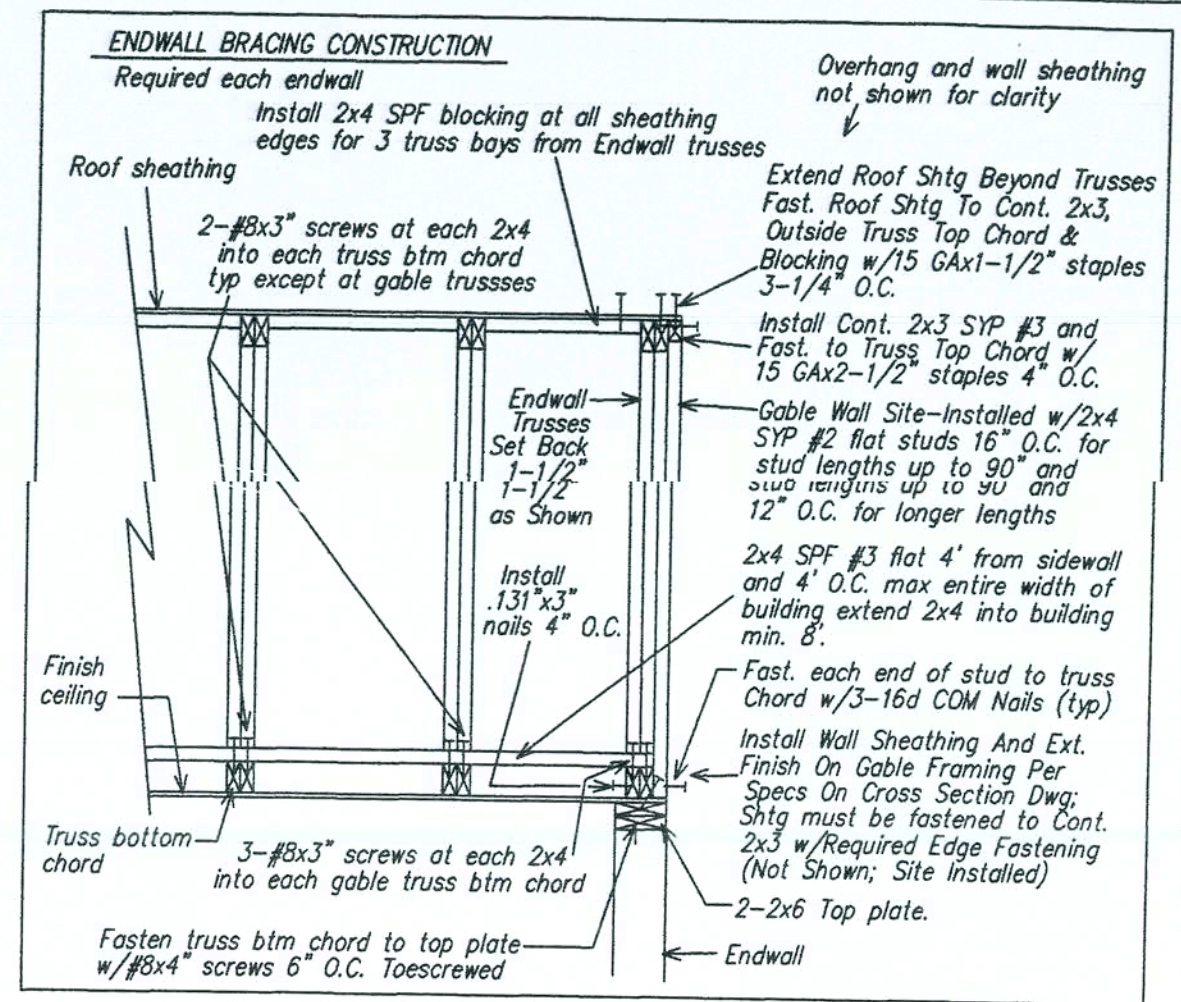

LISTING AGENCY APPROVAL

These plans comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:

Code Type: VB

Occupancy: R-3

Allowable No. of Floors: 1

Wind Velocity: 130 (3 sec)

Fire Rating of Ext. Walls: 0

Plan No.: 2792-00141

Allow. Floor Load: 20

Approval Date: Jan 2006

Approved for High Velocity Hurricane zone: 16


HWC
 GVA # 9025

| | | | |
|--|-----------------|--|------------------------|
| TOWN HOMES LLC | | | |
| P.O. BOX 1059 LAKE CITY, FLORIDA 32056 | | | |
| DATE: 10/25/06 | | | |
| CODES: FBC | | | |
| LABELS: FL | REVISIONS: | | DRAWN BY: C.A. Leblanc |
| SCALE: 3/16" = 1'-0" | | | |
| MODEL: 2903-1003 | PLAN NO. TH-5FL | | SHEET |
| FRAMING | | | 4 OF 6 |
| WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER P.E. LICENSE #33841 | | 33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167 | |

NOTE: ALL POST CAPS AND CONNECTORS IN CONTACT WITH P.T. LUMBER MUST BE GALVANIZED PER ASTM A123 OR BE MANUFACTURED FROM STEEL GALVANIZED IN ACCORDANCE WITH ASTM A653, G185

NOTE: ALL FASTENERS USED IN PORCH AREA MUST BE HOT-DIPPED ZINC-COATED GALVANIZED STEEL (ALL FASTENERS IN PORCH AREA MUST BE GALVANIZED PER ASTM A153)


FRONT

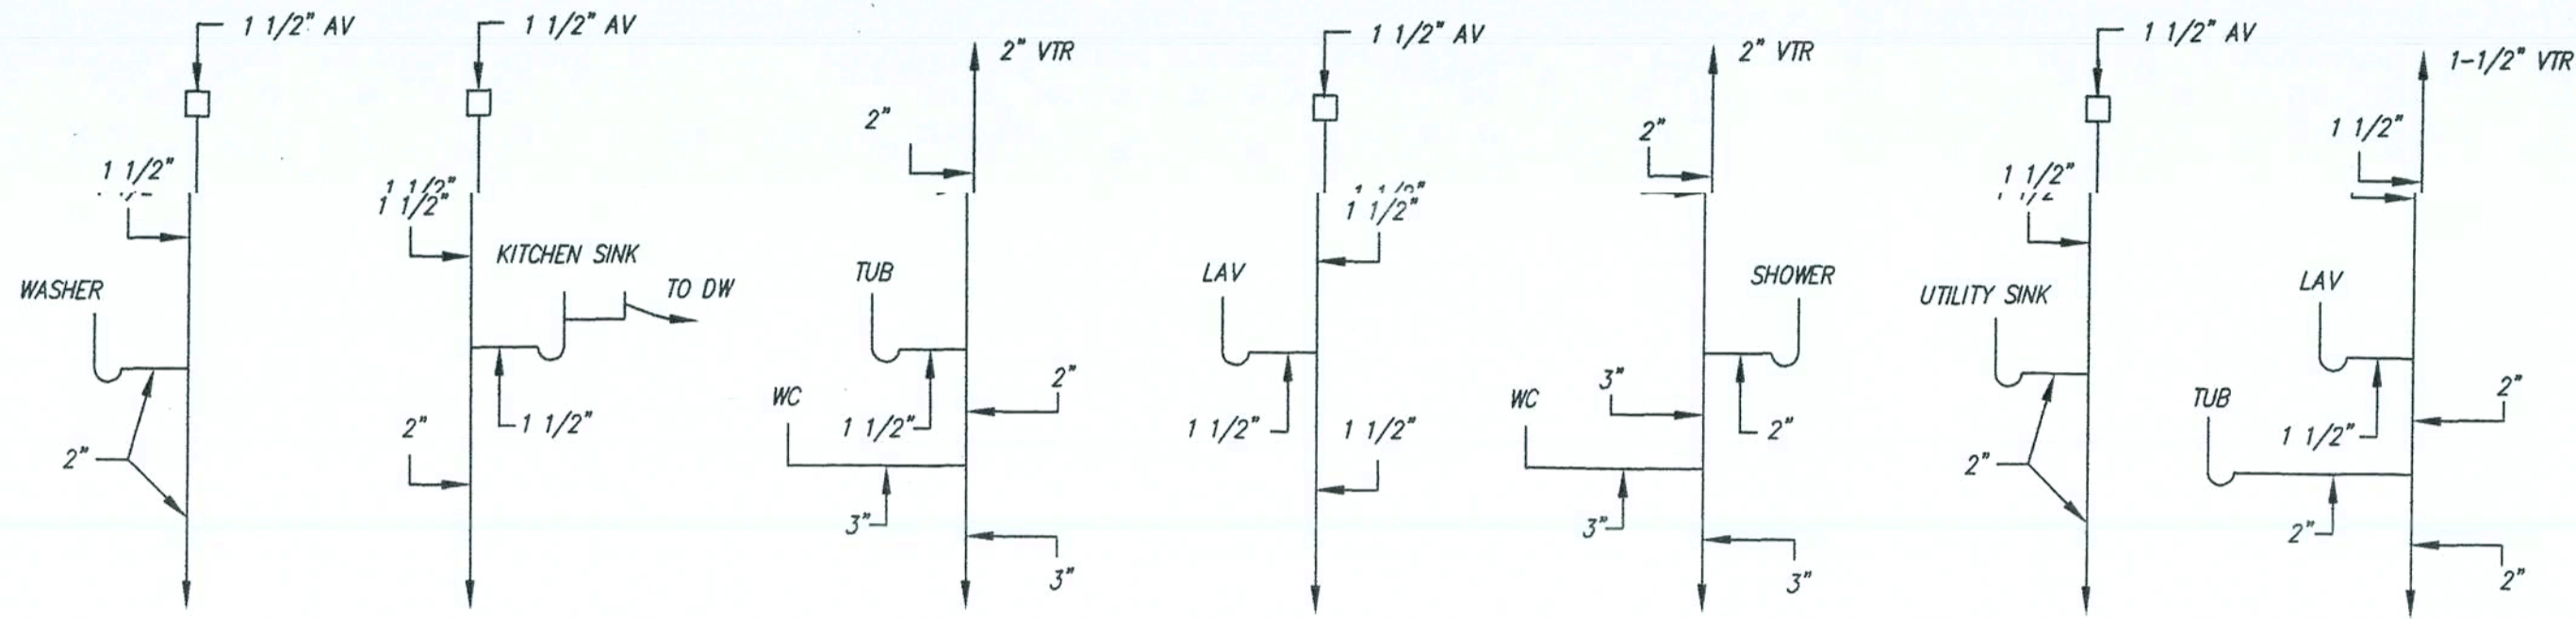

DWV RISER
NTS

Change in direction in Schedule 40 DWV -PVC and ABS drainage piping shall be made by the appropriate use of 45° (0.785 rad) yes, quarter bends or long sweep quarter bends, one-sixth, one-eighth, one-sixteenth bends, or by a combination of these or equivalent fittings. Single and double sanitary tees and quarter bends may be used in drainage lines only where the direction of flow is from the horizontal to the vertical.

Short sweeps not less than 3 inches diameter may be used in soil and waste lines where the change in direction of flow is from the horizontal to the vertical and may be for making necessary offsets between the ceiling and the next floor above.

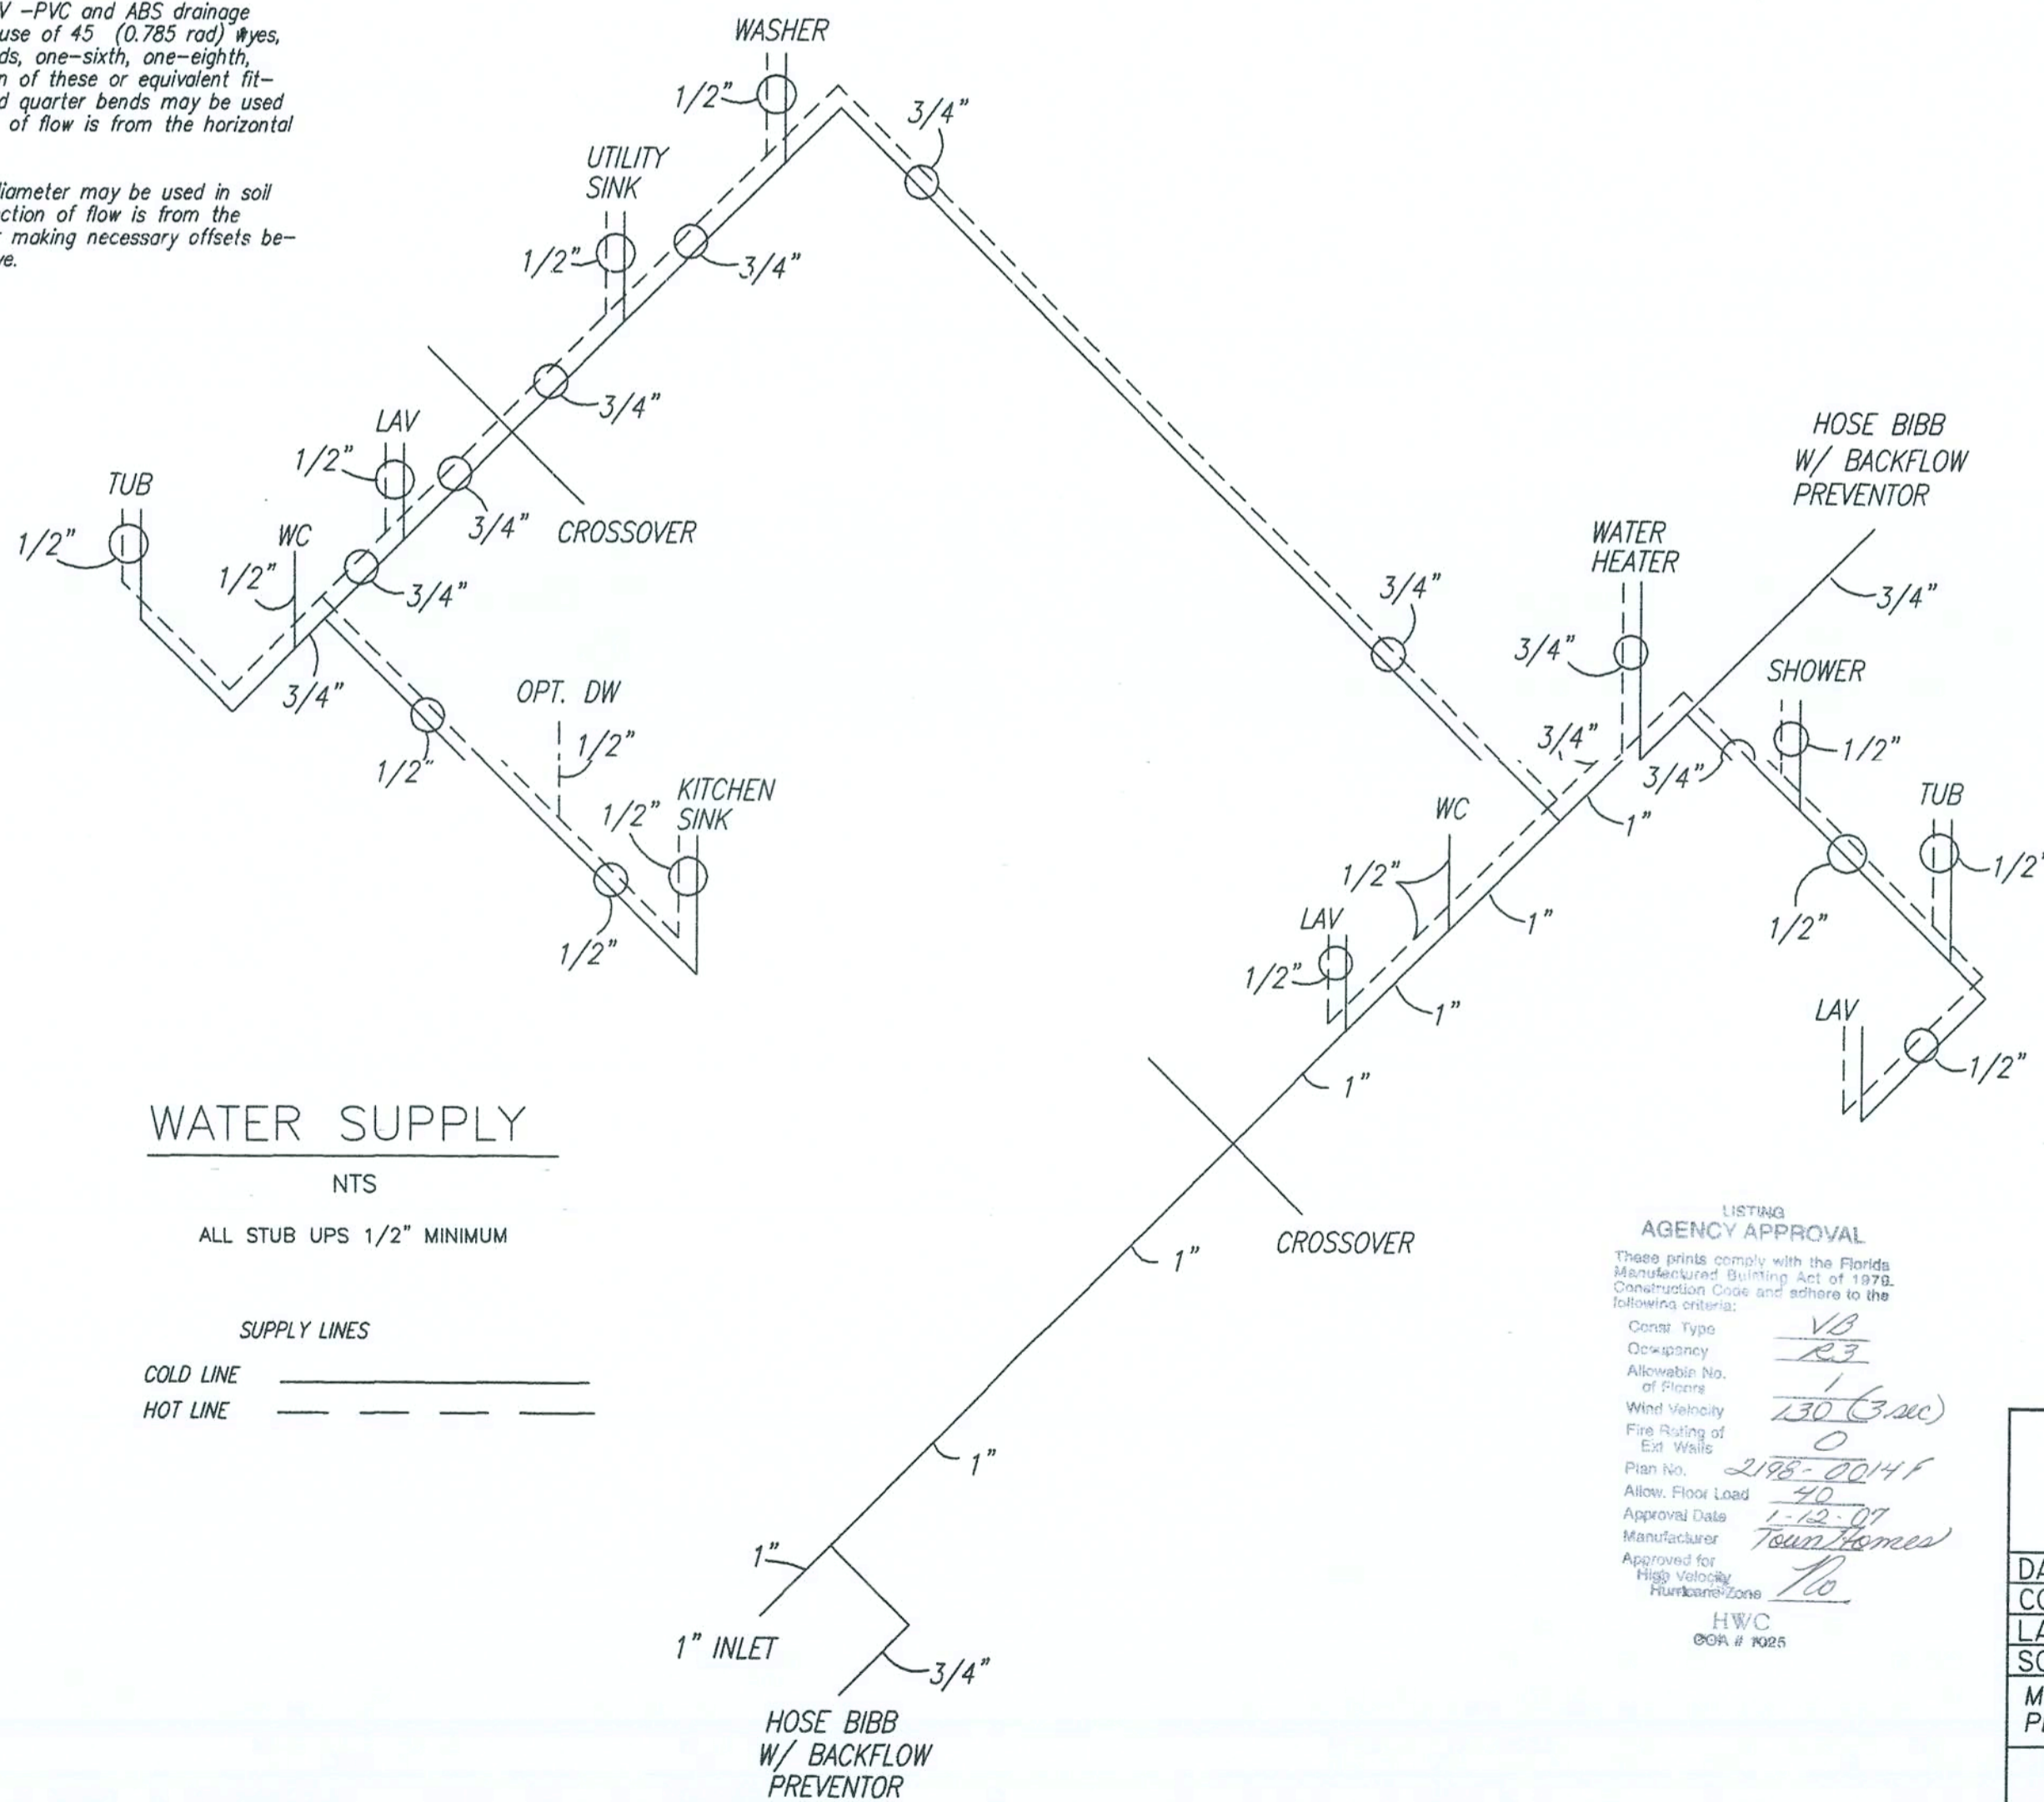


WATER SUPPLY
NTS

ALL STUB UPS 1/2" MINIMUM

SUPPLY LINES
COLD LINE ———
HOT LINE - - - - -

LISTING
AGENCY APPROVAL
These prints comply with the Florida Manufactured Building Act of 1978. Construction Code and adhere to the following criteria:
Code Type: VB
City/County: RB
Allowable No. of Floors: 1 (3.00)
Wind Velocity: 130 (3.00)
Fire Rating of Ext. Walls: 0
Plan No.: 2198-00141
Allow. Floor Load: 50
Approval Date: 1-12-07
Manufacturer: Town Homes
Approved for High Velocity Hurricane Zone: 76
HWC
08A # 9025

- PLUMBING NOTES:**
1. Tub access provided under home unless otherwise noted.
 2. All plumbing fixtures shall have separate shut-off valves.
 3. Water heater shall have safety pan with 1" drain to exterior. T & P relief valve with drain to exterior. And a shut-off valve within 3 feet on the cold water supply line.
 4. DWV system shall be either ABS or PVC-DWV.
 5. Water supply lines shall be CPVC (SCH 40 or SDR11) or PEX. Water supply lines may be stubbed through the floor (only) with the on-site installation of all lines below the floor to be in accordance with the specifications on this drawing.
 6. Water closets average water usage shall not exceed 1.6 gal./flush.
 7. Building drain and cleanouts are designed and site installed by others, subject to local jurisdiction approval. Underfloor trap arms not installed in the factory due to possible in-transit damage are to be site installed in accordance with the specifications on this drawing.
 8. An accessible shut off valve shall be provided ahead of the first outlet or branch connection to the service or distribution pipe. This shut-off valve may be site installed.
 9. Sinks and lavs shall not use more than 2.2 gal./min @ 60 PSI.
 10. Shower heads shall not use more than 2.5 gal./min @ 80 PSI per ANSI Std A 112.18.1M.
 11. All showers to have temperature of water controlled by a balanced pressure, thermostatic or combination balanced-pressure/thermostatic valve to limit the water temp. to 120° F (valve to comply w/ASSE 1016 or CSA CAN/CSA-B125).
 12. Air admittance valves (AV) shall conform to ASSE 1051. The AV valves shall be located a minimum of 4 inches above the horizontal drain or fixture drain being vented and must be installed in well ventilated spaces or provided with ventilated access doors.
 13. When metal water supply lines are installed, water hammer arrestors must also be installed where quick closing valves are utilized (i.e. dishwashers, clothes washers, ice makers or other quick closing devices with solenoid valves). Arrestors must comply with ASSE/ANSI 1010 and must be installed in accordance with the manufacturers instructions.
 14. An approved thermal expansion device shall be installed in the water supply system in accordance with the manufacturers installation instructions. (this device is required when backflow preventors, pressure reducing valves, check valves or storage water heaters are installed in the water supply system which may prevent pressure relief in the system)

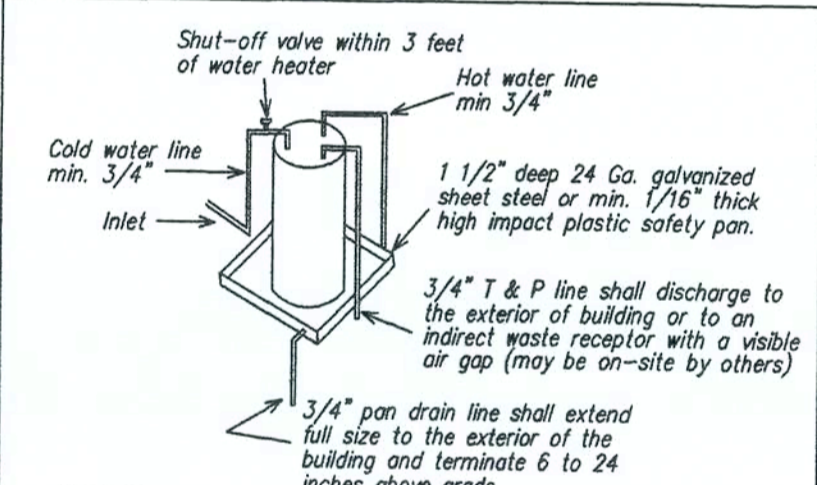

- NOTES:**
1. Water heater shall be provided with a cold water "Dip" tube with a hole at the top or a vacuum relief valve installed in the cold water supply line above the top of the water heater tank; bottom fed water heaters shall have a vacuum relief valve complying with ANSI Z21.22 installed.
 2. Water heaters shall be provided with a temperature and pressure relief valve complying with ANSI Z21.22 installed in the shell of the water heater tank. The valve shall be actuated by the water in the top 6 inches of the tank and shall have a temperature rating of not more than 210° F and a pressure setting not exceeding the tanks rated working pressure or 150 psi, whichever is less.
 3. Water heaters shall be equipped with an energy cutoff device that will cut off the supply of heat energy to the water tank before the temperature of the water in the tank exceeds 210° F.

TYPICAL WATER HEATER DETAIL
NTS

TOWN HOMES LLC
P.O. BOX 1059
LAKE CITY, FLORIDA 32056

| | | |
|--|-----------------|--|
| DATE: 10/25/06 | REVISIONS: | DRAWN BY: C.A. Leblanc |
| CODES: FBC | | |
| LABELS: FL | | |
| SCALE: NTS | | |
| MODEL: 2903-1003 PLUMBING | PLAN NO. TH-5FL | SHEET 5 OF 6 |
| WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER P.E. LICENSE #33841 | | 33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167 |


TRUSS DESIGN LOADS:

20 PSF ROOF LL ON TOP CHORD
6 PSF ROOF DL ON TOP CHORD
0 PSF ATTIC LL ON BTM CHORD
10 PSF ROOF DL ON BTM CHORD

GENERAL NOTES

Exterior joints in the building envelope that are sources of air leakage. Such as around windows and door frames; Between wall cavities and windows or door frames; Between walls and foundations; Between walls and roof/ceiling and between wall panels; Openings at penetrations of utility services through walls, floors and roofs; and all other such openings in the building envelope shall be caulked, gasketed, weather stripped or otherwise sealed in an approved manner.

Soffit vents and ridge vents equal to 1/150 of total roof area (this factor may be reduced to 1/300 when a vapor barrier of 1 perm or less is installed in attic.) (min 7.7 sq. ft. net vent air is required w/vapor barrier.)

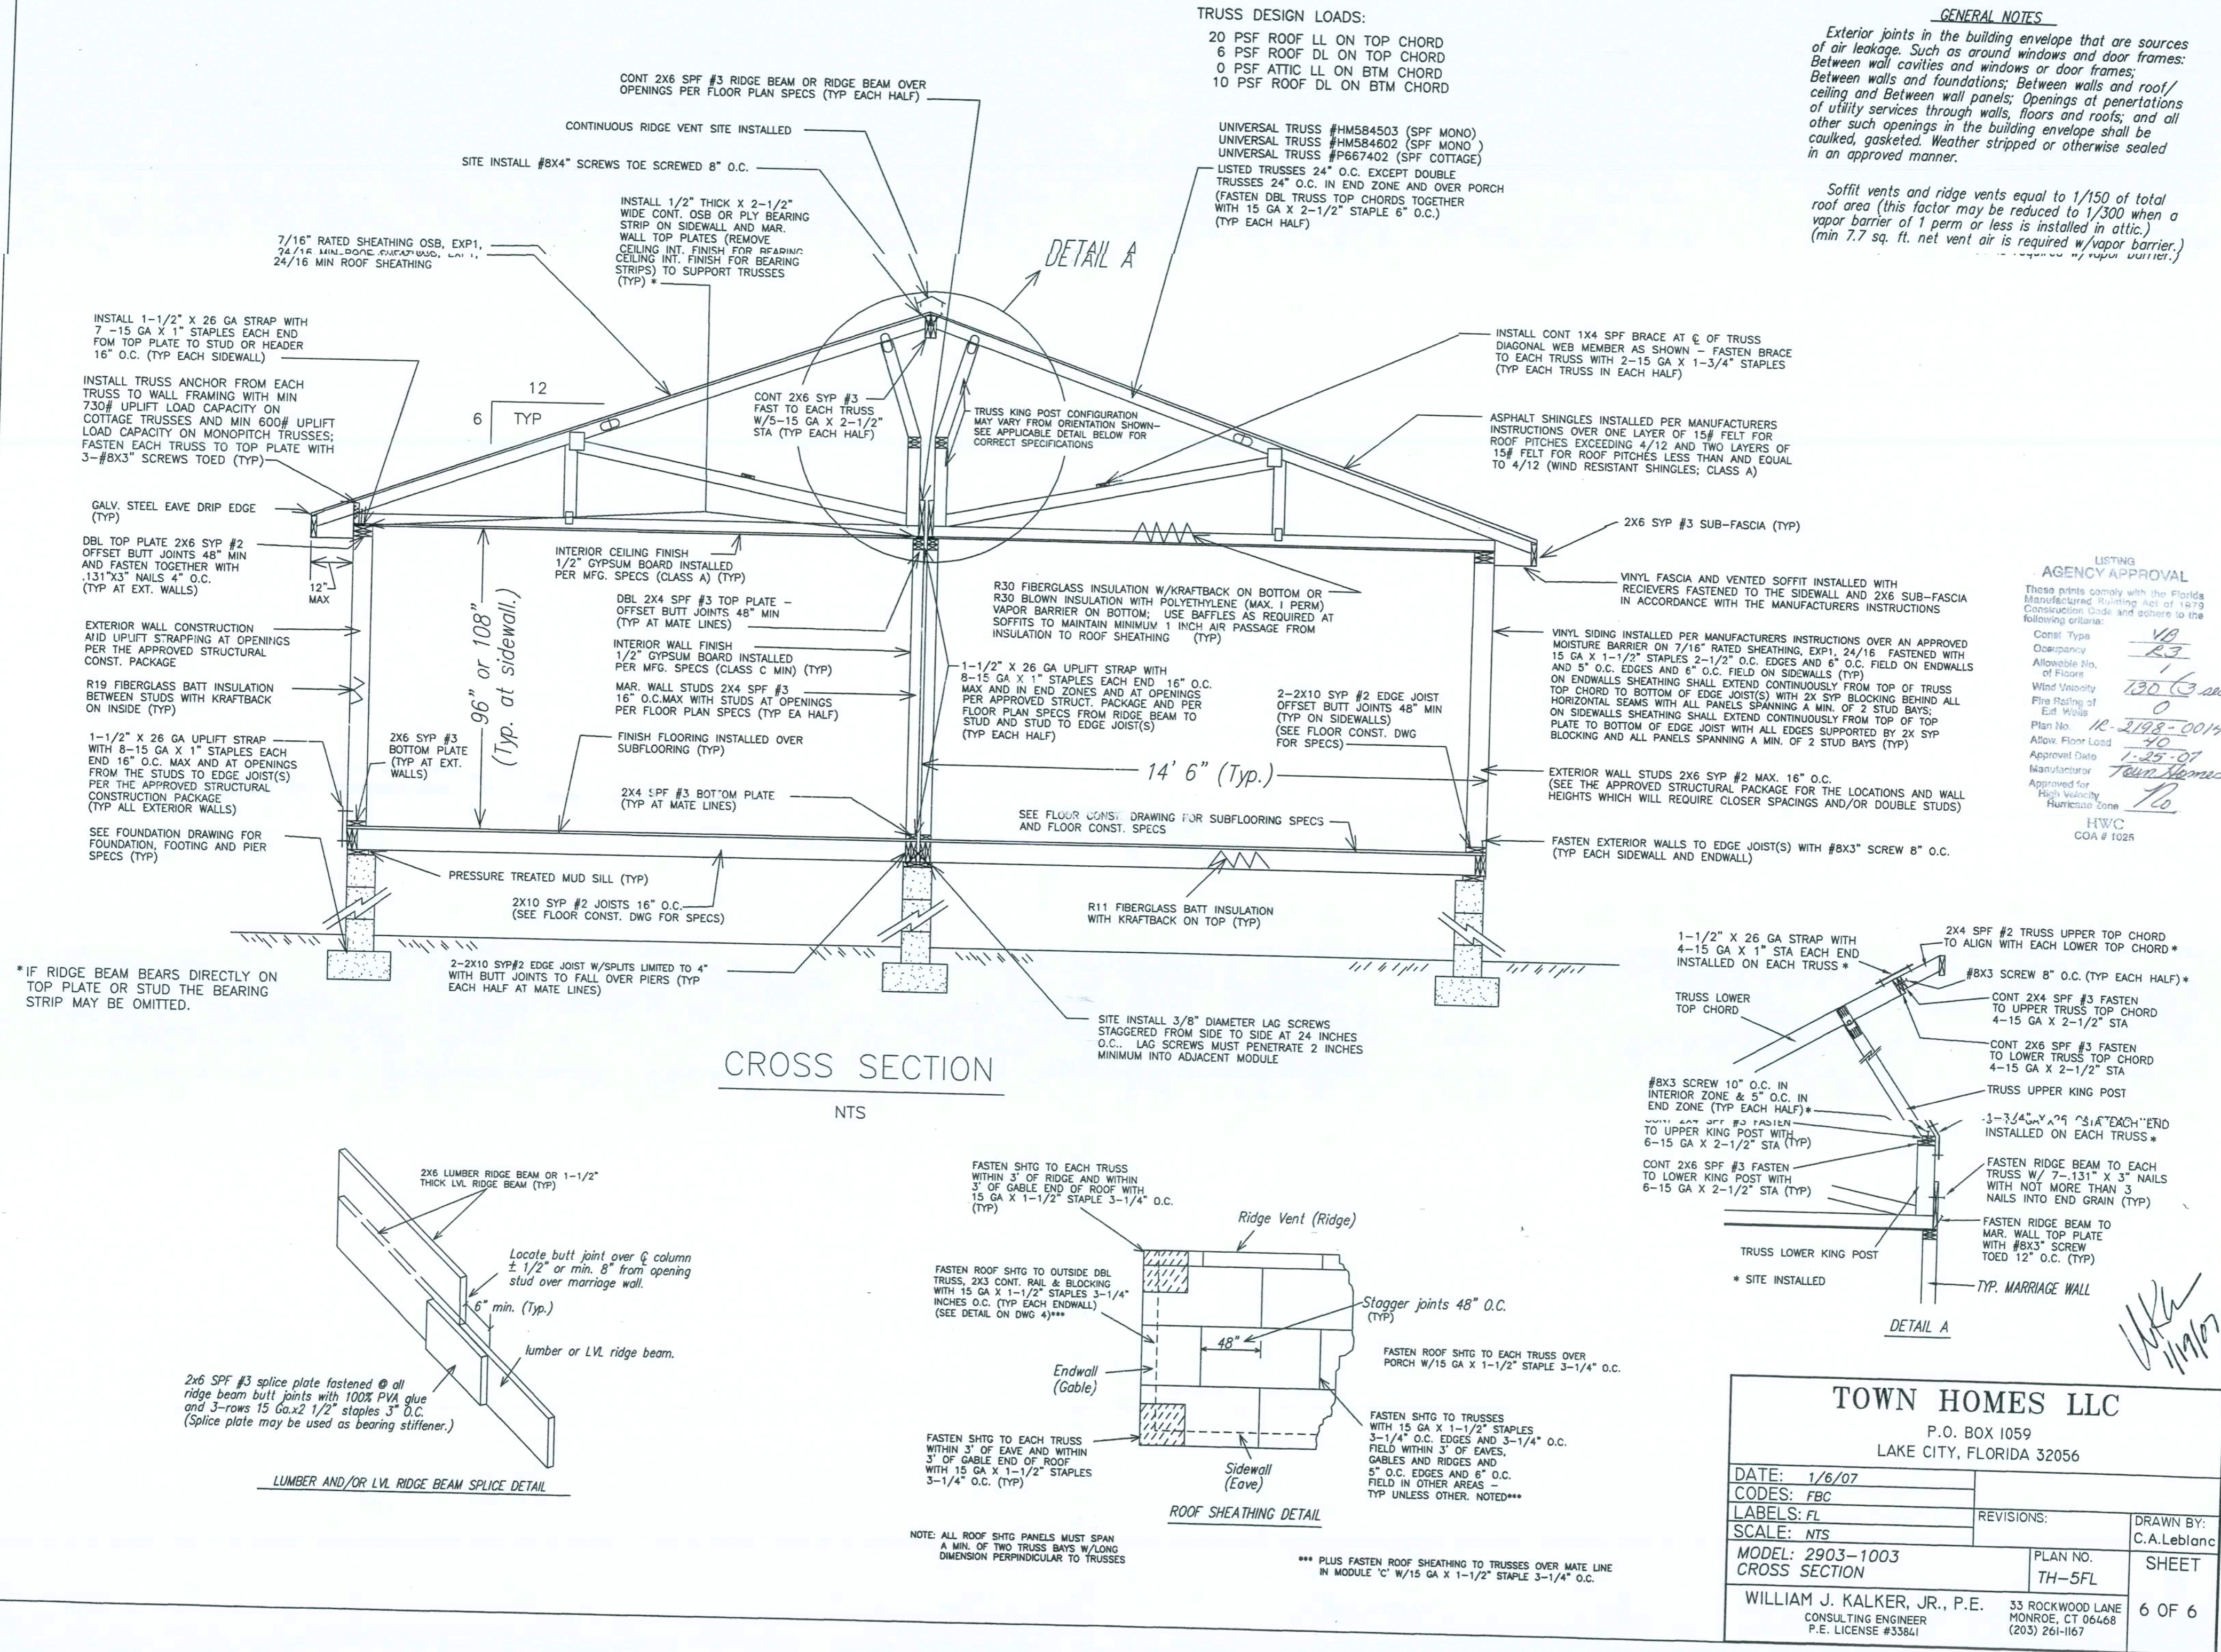


FOUNDATION NOTES:

- FOUNDATION PLAN IS SHOWN AS TYPICAL STANDARD (FOR REFERENCE ONLY)
- CONCRETE TO BE STANDARD WEIGHT CONCRETE (150 PCF) WITH A MINIMUM COMPRESSIVE STRENGTH EQUAL TO 2500 PSI @ 28 DAYS.
- SOIL BEARING CAPACITY TO BE 2000 PSF MINIMUM (ASSUMED).
- FOUNDATION WALL AND FOOTING SIZES ARE SUBJECT TO CHANGE DUE TO LOCAL CODES AND/OR SOIL CONDITIONS.
- THE BOTTOM OF ALL FOOTINGS MUST BE BELOW THE FROST DEPTH AND BE A MIN. OF 12 INCHES BELOW THE NATURAL GRADE.
- WHERE THE INTERIOR GROUND LEVEL IS BELOW THE OUTSIDE FINISH GRADE, ADEQUATE PRECAUTIONARY MEASURES SHALL BE TAKEN TO ASSURE POSITIVE DRAINAGE AT ALL TIMES.
- ALL CONCRETE BLOCKS SHALL BE LAID IN TYPE "M" OR TYPE "S" MORTAR.
- THE FOUNDATION ENCLOSURE MUST HAVE A MINIMUM OF 1 SQUARE FOOT OF NET VENT AREA FOR EACH 150 SQUARE FEET OF ENCLOSED CRAWL SPACE AREA AND MUST BE PROVIDED WITH A 18" X 24" MIN CRAWL SPACE ACCESS DOOR (SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL BUILDING OFFICIAL APPROVAL). VENT OPENINGS MUST PROVIDE CROSS VENTILATION AND BE COVERED WITH CORROSION RESISTANT WIRE MESH OF NOT LESS THAN 1/4" OR MORE THAN 1/2".
- INSTALL P.T. SYP LUMBER MUD SILLS ON ALL CONCRETE BLOCK PIERS.
- THE CRAWL SPACE MUST HAVE A MINIMUM 18" CLEARANCE FROM THE GROUND TO THE BOTTOM OF THE JOISTS. THE CRAWL SPACE GROUND AND/OR FLOOR MUST BE COVERED WITH AN APPROVED VAPOR BARRIER.
- ALL CONCRETE BLOCKS MUST COMPLY WITH ASTM C90 WITH A MINIMUM (f_m) = 2000 PSI (USE STANDARD WEIGHT BLOCKS)
- ALL REINFORCEMENT BARS SHALL COMPLY WITH ASTM A615, GRADE 60. REINFORCEMENT TO BE UNCOATED DEFORMED BARS (NO EPOXY). REINFORCEMENT BARS SHALL BE EQUALLY SPACED AND PLACED WITH 3 INCHES OF CLEARANCE (COVER) FROM THE BOTTOM OF THE FOOTING TO THE BOTTOM LAYER OF REBAR. ALL REBAR MUST BE INSTALLED WITH A MIN. 4 INCHES CLEARANCE FROM THE SIDES OF THE FOOTING.
- LAP ALL #4 BARS A MINIMUM OF 24 INCHES AT SPLICES AND LAP ALL #5 BARS A MINIMUM OF 30 INCHES AT SPLICES WITH ALL SPLICES OFFSET A MINIMUM OF 30 INCHES FROM ADJACENT SPLICES.
- ALL FOUNDATION AND/OR PIER CONSTRUCTION MUST COMPLY WITH THE MINIMUM SPECIFICATIONS PROVIDED ON THIS DRAWING UNLESS THE SITE CONDITIONS PERMIT ALTERNATE METHODS AND/OR THE FOUNDATION HAS BEEN DESIGNED BY OTHERS AND APPROVED BY THE LOCAL BUILDING OFFICIAL.
- TERMITE SHIELDS AND/OR OTHER INSECT PROTECTION TO BE SPECIFIED BY LOCAL DESIGNER

NOTE: THE CONTRACTOR MUST ADJUST THE FOUNDATION DIMENSIONS SPECIFIED ABOVE TO ACCOMMODATE VARIANCES DURING SETUP.

ADD PLATFORMS, STAIRS AND RAILINGS AS REQUIRED FOR ACCESS TO BUILDING - ALL PLATFORMS, STAIRS AND RAILINGS TO BE DESIGNED BY SITE (LOCAL) ENGINEER, SUBJECT TO BUILDING OFFICIAL REVIEW AND APPROVAL - TYP FOR ALL DOORS AND PORCHES (ADJUST CRAWL SPACE VENT LOCATIONS TO ACCOMMODATE PLATFORMS AND STAIRS)

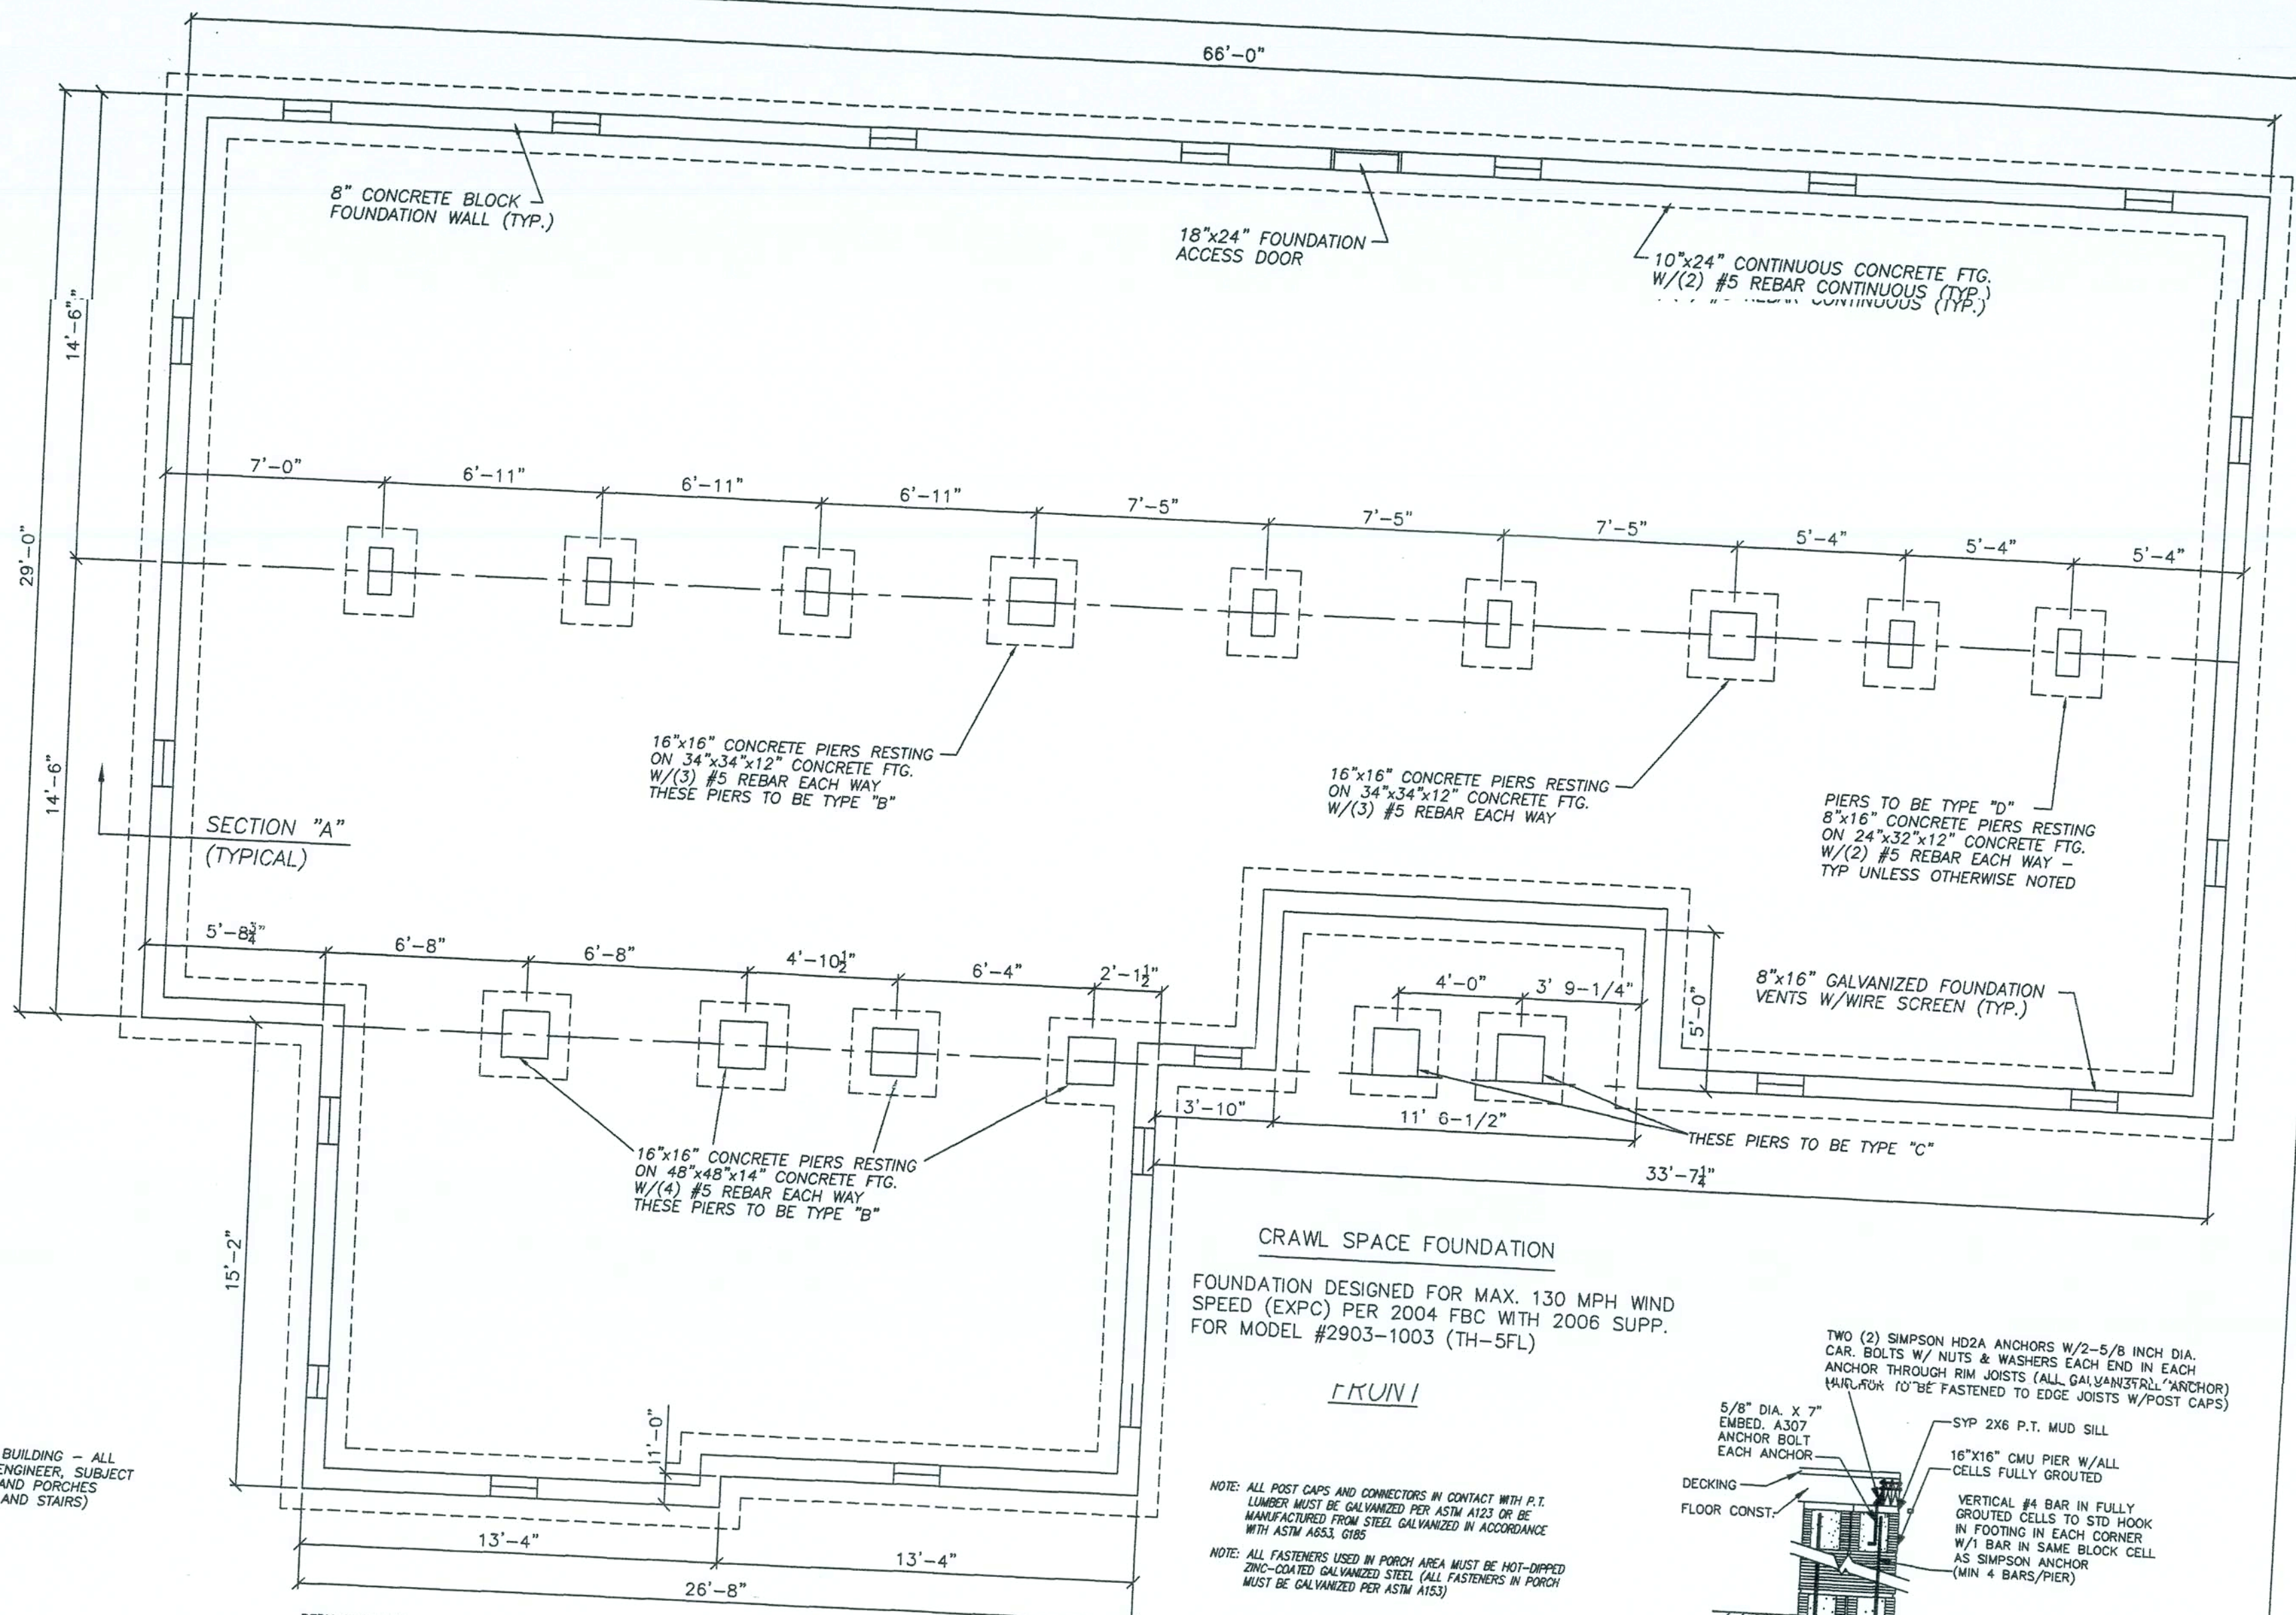


CRAWL SPACE FOUNDATION

FOUNDATION DESIGNED FOR MAX. 130 MPH WIND SPEED (EXPC) PER 2004 FBC WITH 2006 SUPP. FOR MODEL #2903-1003 (TH-5FL)


TRUN!

NOTE: ALL POST CAPS AND CONNECTORS IN CONTACT WITH P.T. LUMBER MUST BE GALVANIZED PER ASTM A123 OR BE MANUFACTURED FROM STEEL GALVANIZED IN ACCORDANCE WITH ASTM A563, G185


NOTE: ALL FASTENERS USED IN PORCH AREA MUST BE HOT-DIPPED ZINC-COATED GALVANIZED STEEL (ALL FASTENERS IN PORCH MUST BE GALVANIZED PER ASTM A153)

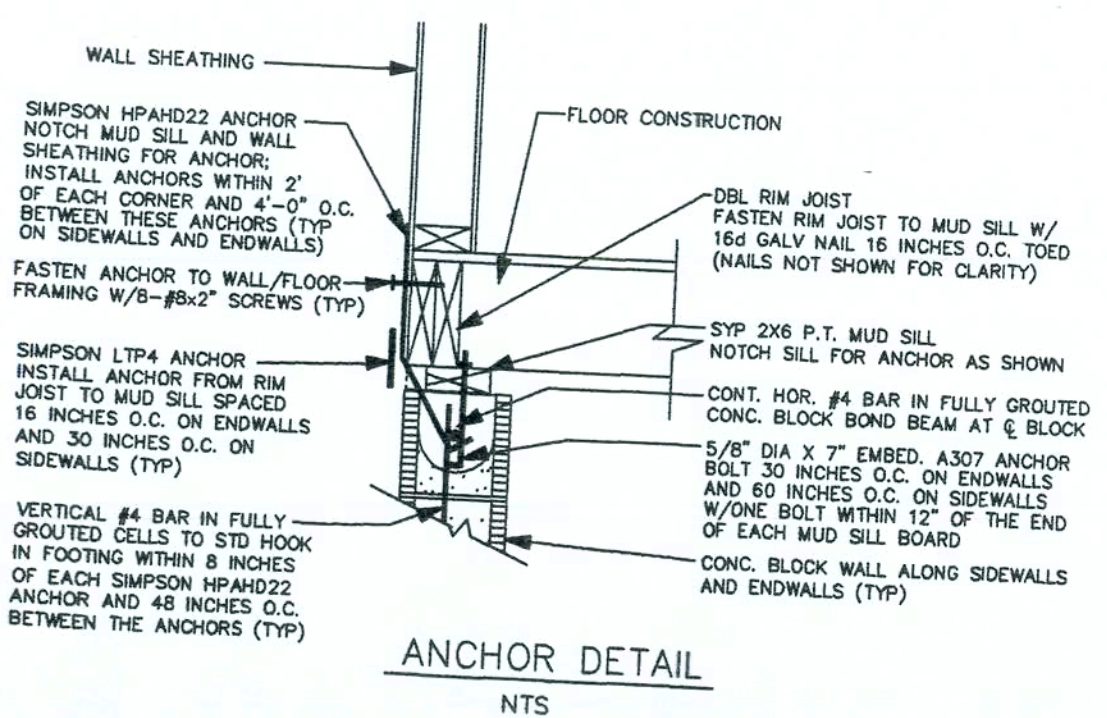


ANCHOR DETAIL
NTS

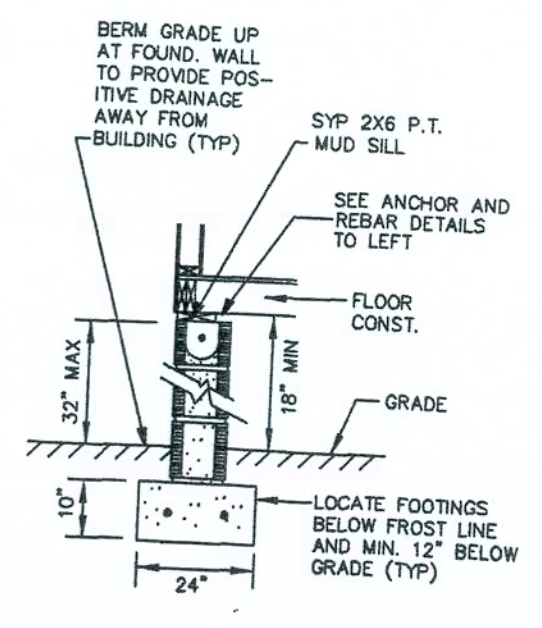


SECTION "A"
NTS

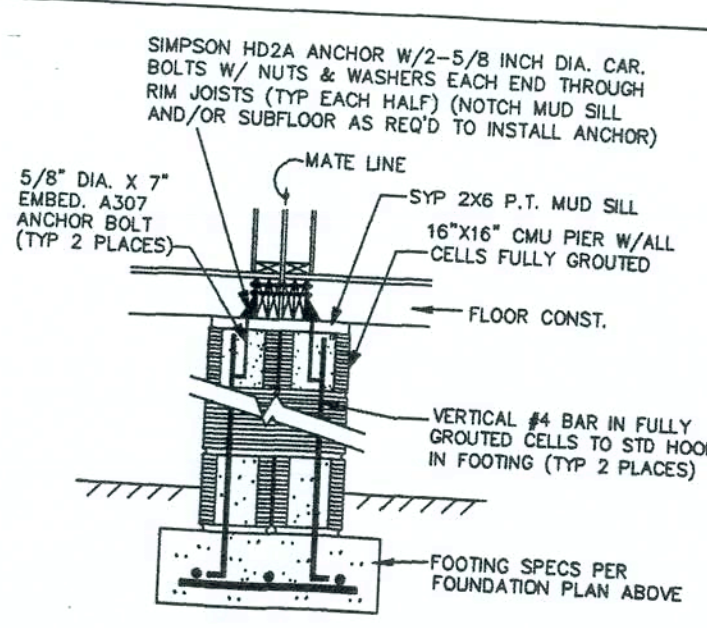

PIER TYPE "B"
NTS

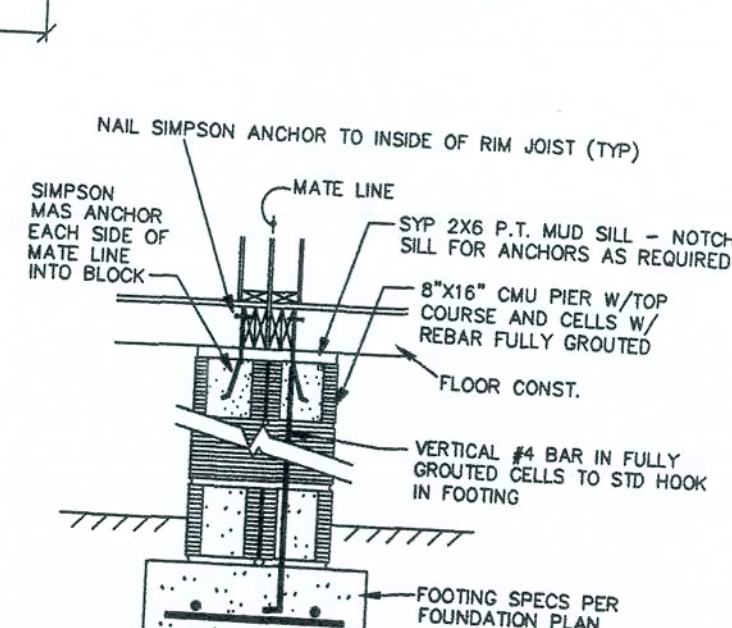

PIER TYPE "D"
NTS

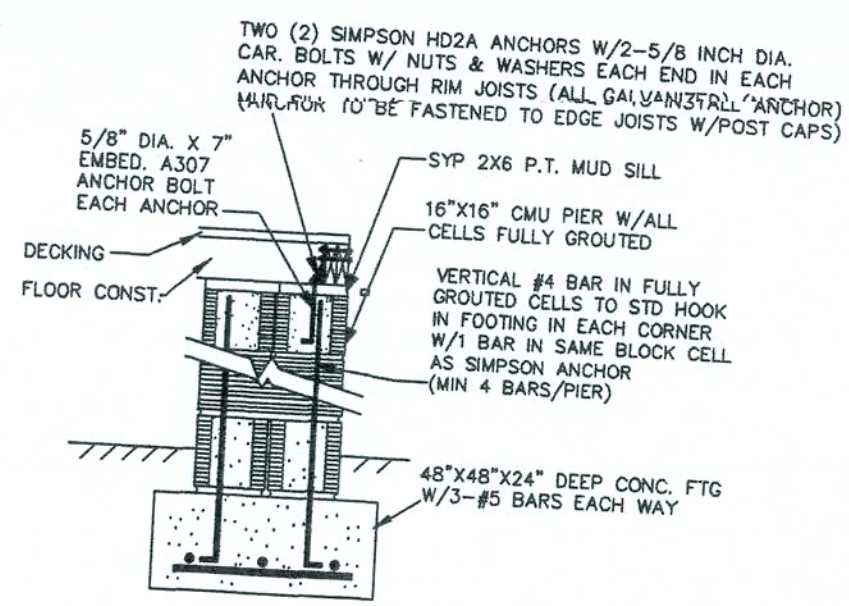

PIER TYPE "C"
NTS

| | | |
|--|--|------------------------|
| TOWN HOMES LLC | | |
| P.O. BOX 1059 LAKE CITY, FLORIDA 32056 | | |
| DATE: 1/6/07 | REVISIONS: | DRAWN BY: C.A. Leblanc |
| CODES: FBC | | |
| LABELS: FL | | |
| SCALE: NTS | | |
| MODEL: 2903-1003 | PLAN NO. TH-5FL | SHEET |
| CRAWL SPACE FOUNDATION | | |
| WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER P.E. LICENSE #33841 | 33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167 | I OF 1 |