

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



FL REG# 278, Yoonhwak Kim, FL PE #86367

Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com

| Site Information: | Page 1: |
|---------------------------------------|---------------------|
| Customer: W. B. Howland Company, Inc. | Job Number: 21-5244 |
| Job Description: Albritton Res | |
| Address: FL | |

| Job Engineering Criteria: |
|--|
| Design Code: FBC 7th Ed. 2020 Res. |
| IntelliVIEW Version: 20.01.01A through 21.01.01A |
| JRef #: 1X892150001 |
| Wind Standard: ASCE 7-16 Wind Speed (mph): 130 |
| Design Loading (psf): 40.00 |
| Building Type: Closed |

This package contains general notes pages, 28 truss drawing(s) and 6 detail(s).

| Item | Drawing Number | Truss |
|------|-------------------|-------|
| 1 | 237.21.1423.02402 | A01 |
| 3 | 237.21.1423.02215 | A03 |
| 5 | 237.21.1423.02590 | A05 |
| 7 | 237.21.1527.34733 | B02 |
| 9 | 237.21.1527.48020 | C01 |
| 11 | 237.21.1527.54453 | C03 |
| 13 | 237.21.1528.07137 | C05 |
| 15 | 237.21.1528.20147 | D01 |
| 17 | 237.21.1423.02387 | HJ01 |
| 19 | 237.21.1423.02059 | J02 |
| 21 | 237.21.1528.52540 | J04 |
| 23 | 237.21.1423.02558 | J06 |
| 25 | 237.21.1528.59870 | PB01 |
| 27 | 237.21.1529.12657 | PB03 |
| 29 | A14015ENC160118 | |
| 31 | BRCLBSUB0119 | |
| 33 | PB160160118 | |

| Item | Drawing Number | Truss |
|------|-------------------|-------|
| 2 | 237.21.1423.02090 | A02 |
| 4 | 237.21.1423.02043 | A04 |
| 6 | 237.21.1527.31037 | B01 |
| 8 | 237.21.1527.38947 | B03 |
| 10 | 237.21.1527.51317 | C02 |
| 12 | 237.21.1528.03673 | C04 |
| 14 | 237.21.1528.15907 | C06 |
| 16 | 237.21.1528.27777 | D02 |
| 18 | 237.21.1423.02184 | J01 |
| 20 | 237.21.1423.02136 | J03 |
| 22 | 237.21.1528.55997 | J05 |
| 24 | 237.21.1423.02605 | J07 |
| 26 | 237.21.1529.09487 | PB02 |
| 28 | 237.21.1529.16977 | PB04 |
| 30 | A14030ENC160118 | |
| 32 | GBLLETIN0118 | |
| 34 | CNNAILSP1014 | |

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 514 Earth City Expressway, Suite 242, Earth City, MO 63045; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpinst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcindustry.com.

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619460 / FROM: CDM | HIPS Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: A01 | Cust: R 215 JRef: 1X892150001 T6 / DrwNo: 237.21.1423.02402 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

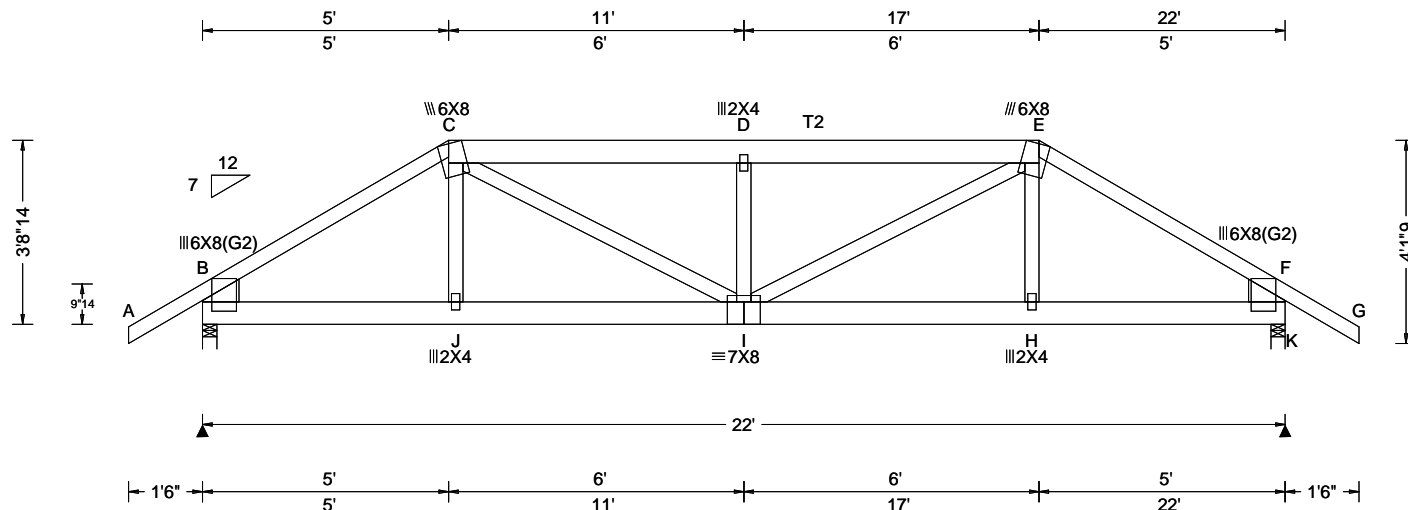

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|---|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.076 D 999 240 VERT(CL): 0.153 D 999 180 HORZ(LL): 0.015 H - - HORZ(TL): 0.030 H - - Creep Factor: 2.0 Max TC CSI: 0.543 Max BC CSI: 0.207 Max Web CSI: 0.415 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1792 -/- /- /- /458 -/ K 1792 -/- /- /- /458 -/ Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 K Brg Width = 3.5 Min Req = 1.5 Bearings B & K are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 711 -2723 D - E 858 -3224 C - D 858 -3224 E - F 711 -2723 |

Lumber

Top chord: 2x4 SP #2; T2 2x6 SP 2400f-2.0E;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at -1.50 to 63 plf at 5.00
TC: From 32 plf at 5.00 to 32 plf at 17.00
TC: From 63 plf at 17.00 to 63 plf at 23.50
BC: From 5 plf at -1.50 to 5 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 5.03
BC: From 10 plf at 5.03 to 10 plf at 16.97
BC: From 20 plf at 16.97 to 20 plf at 22.00
BC: From 5 plf at 22.00 to 5 plf at 23.50
TC: 168 lb Conc. Load at 5.03, 16.97
TC: 138 lb Conc. Load at 7.06, 9.06, 11.00, 12.94
14.94
BC: 275 lb Conc. Load at 5.03, 16.97
BC: 95 lb Conc. Load at 7.06, 9.06, 11.00, 12.94
14.94

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

Additional Notes


The overall height of this truss excluding overhang is 3-8-14.

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - J | 2256 -581 | I - H | 2267 -579 |
| J - I | 2267 -579 | H - F | 2256 -581 |

Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - I | 1090 -318 | D - I | 368 -687 |
| I - E | 1090 -318 | | |

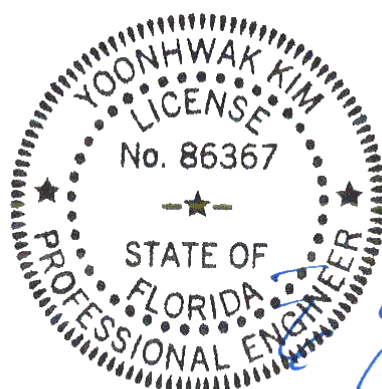

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619463 / FROM: CDM | HIPS Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: A02 | Cust: R 215 JRef: 1X892150001 T2 / DrwNo: 237.21.1423.02090 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

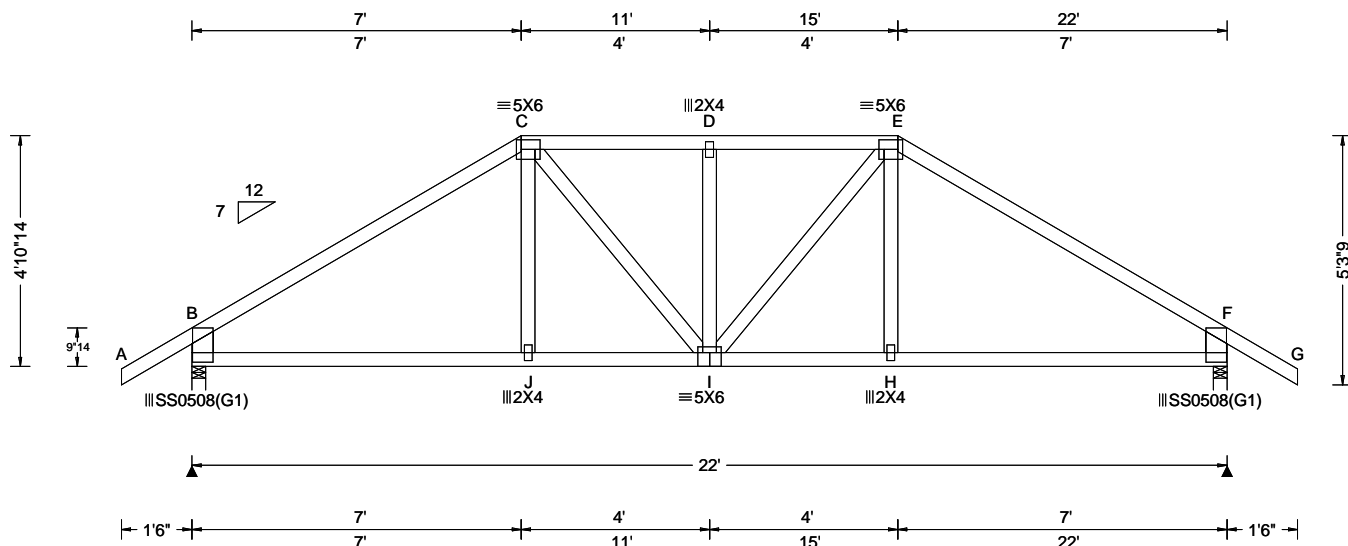

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): 18SS, WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.057 D 999 240 VERT(CL): 0.115 D 999 180 HORZ(LL): 0.026 H - - HORZ(TL): 0.054 H - - Creep Factor: 2.0 Max TC CSI: 0.913 Max BC CSI: 0.742 Max Web CSI: 0.142 VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1016 - / - / - /602 /182 /149 F 1016 - / - / - /602 /182 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 F Brg Width = 3.5 Min Req = 1.5 Bearings B & F are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 548 - 1244 D - E 634 - 1091 C - D 634 - 1091 E - F 548 - 1244 |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 4'-10"-14".

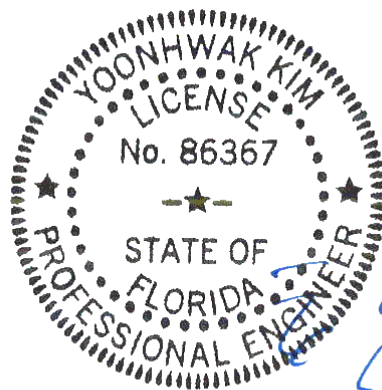

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org


ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

The overall height of this truss excluding overhang is 6-0-14.

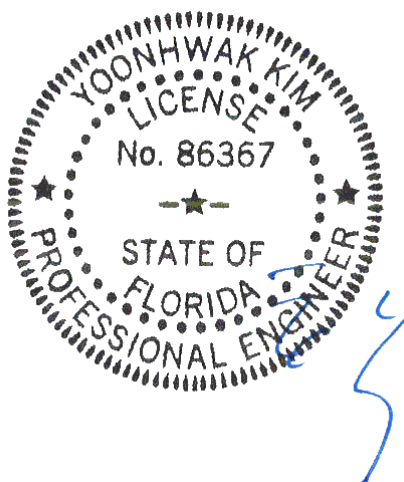

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/ TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpiinst.org; SBCA: sbcdindustry.com; ICC: iccsafe.org; AWC: awc.org

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619469 / FROM: CDM | COMN Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: A04 | Cust: R 215 JRef: 1X892150001 T4 / DrwNo: 237.21.1423.02043 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

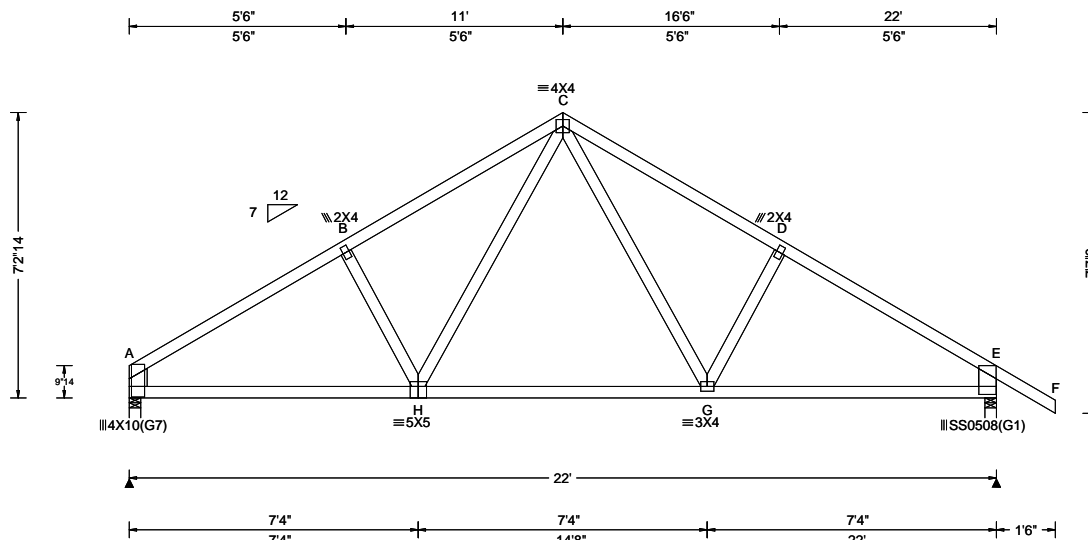

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|--|--|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE, 18SS | PP Deflection in loc L/def L/# VERT(LL): 0.067 G 999 240 VERT(CL): 0.138 G 999 180 HORZ(LL): 0.034 G - - HORZ(TL): 0.070 G - - Creep Factor: 2.0 Max TC CSI: 0.875 Max BC CSI: 0.847 Max Web CSI: 0.152 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL A 911 - / - /521 /149 /193 E 1020 - / - /607 /176 - /- Non-Gravity Wind reactions based on MWFRS A Brg Width = 3.5 Min Req = 1.5 E Brg Width = 3.5 Min Req = 1.5 Bearings A & E are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 270 -1307 C - D 308 -1136 B - C 312 -1147 D - E 267 -1296 |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 7-2-14.

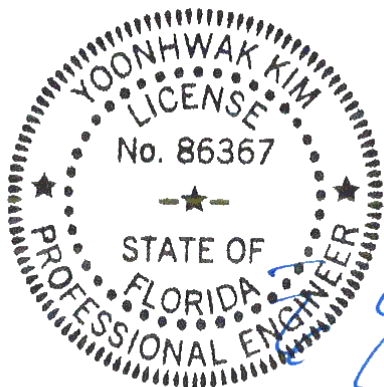

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| A - H | 1038 -131 | G - E | 1024 -127 |
| H - G | 733 -5 | | |


Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| H - C | 399 -92 | C - G | 394 -86 |

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|---|
| SEQN: 619474 / FROM: CDM | COMN Ply: 1 Qty: 4 | Job Number: 21-5244 Albritton Res Truss Label: A05 | Cust: R 215 JRef: 1X892150001 T25 DrwNo: 237.21.1423.02590 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|---|

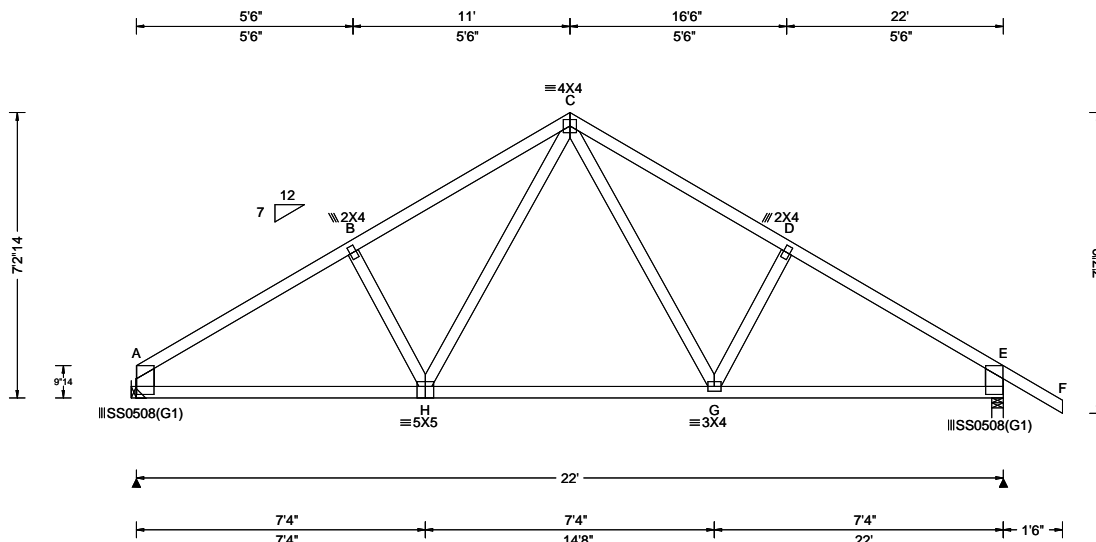

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|--|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): 18SS, WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.084 G 999 240 VERT(CL): 0.162 G 999 180 HORZ(LL): 0.043 G - - HORZ(TL): 0.082 G - - Creep Factor: 2.0 Max TC CSI: 0.982 Max BC CSI: 0.892 Max Web CSI: 0.177 VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 974 -/- /- /521 /149 /193 E 1082 -/- /- /607 /176 -/ Wind reactions based on MWFRS A Brg Width = - Min Req = - E Brg Width = 3.5 Min Req = 1.5 Bearing E is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 270 -1428 C - D 308 -1257 B - C 312 -1268 D - E 267 -1418 |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

Hangers / Ties

(J) Hanger Support Required, by others

Loading


Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 7-2-14.

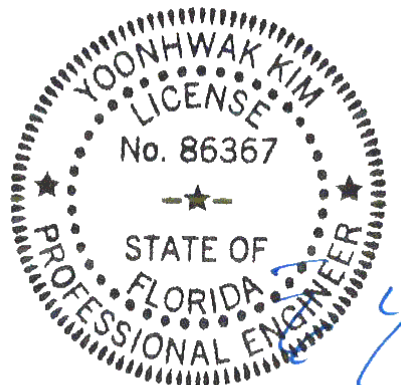

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | | |
|---|---|------------|-------|------------|
| Lumber | C - D | 766 - 2730 | H - I | 770 - 2479 |
| Top chord: 2x4 SP #2; | D - E | 771 - 2488 | I - J | 766 - 2723 |
| Bot chord: 2x4 SP #2; | E - F | 747 - 2057 | J - K | 786 - 2779 |
| Webs: 2x4 SP #3; | F - G | 699 - 1689 | | |
| Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.674' | | | | |
| Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.674' | | | | |
| | Maximum Bot Chord Forces Per Ply (lbs) | | | |

(a) Continuous lateral restraint equally spaced on member

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 10-7-5

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

| Maximum Bot Chord Forces Per Ply (lbs) | | | | | |
|--|------|------------|--------|------|-------------|
| Chords | | Tens.Comp. | Chords | | Tens. Comp. |
| B - R | 2258 | - 521 | O - N | 2063 | - 396 |
| R - Q | 2255 | - 522 | N - M | 2250 | - 529 |
| Q - P | 2072 | - 395 | M - K | 2253 | - 528 |
| P - O | 1694 | - 229 | | | |

| Maximum Web Forces Per Ply (lbs) | | | | | |
|----------------------------------|------------|------|-------|-------------|------|
| Webs | Tens.Comp. | | Webs | Tens. Comp. | |
| E - P | 272 | -614 | O - G | 661 | -158 |
| F - P | 685 | -163 | O - H | 271 | -612 |


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

ALPINE
AN ITW COMPANY

6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392431 FROM: CDM | COMN Ply: 1 Qty: 5 | Job Number: 21-5244 Albritton Res Truss Label: B03 | Cust: R 215 JRef: 1X892150001 T35 DrwNo: 237.21.1527.38947 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

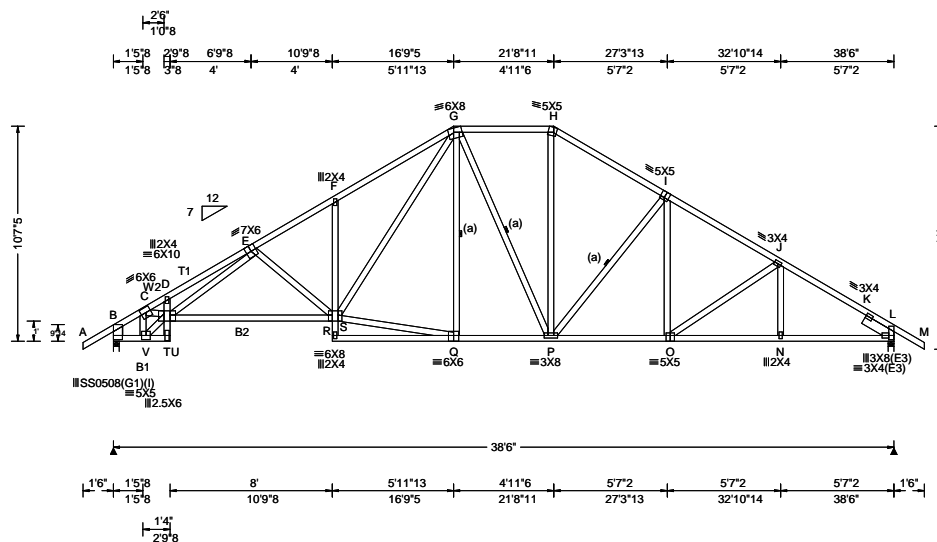

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|--|--|--|
| TCLL: 20.00 TCCL: 10.00 BCCL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.09 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.85 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): 18SS, WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.219 F 999 240 VERT(CL): 0.424 F 999 180 HORZ(LL): 0.140 K - - HORZ(TL): 0.271 K - - Creep Factor: 2.0 Max TC CSI: 0.581 Max BC CSI: 0.672 Max Web CSI: 0.813 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1789 - / - / - / 1025 / 203 / 310 L 1819 - / - / - / 1025 / 203 / - Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 L Brg Width = 3.5 Min Req = 2.1 Bearings B & L are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 229 - 1911 G - H 307 - 1634 C - D 517 - 5095 H - I 309 - 1976 D - E 599 - 5284 I - J 321 - 2418 E - F 339 - 2804 J - K 315 - 2665 F - G 479 - 2817 K - L 332 - 2721 |

Lumber
Top chord: 2x4 SP #2; T1 2x4 SP M-31;
Bot chord: 2x4 SP #2; B1, B2 2x4 SP M-31;
Webs: 2x4 SP #3; W2 2x4 SP #2;
Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.674'
Lt Stub Wedge: 2x6 SP 2400f-2.0E;

Bracing
(a) Continuous lateral restraint equally spaced on member.

Plating Notes
(I) - plates so marked were sized using 0% Fabrication Tolerance, 0 degrees Rotational Tolerance, and/or zero Positioning Tolerance.

Loading
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.


Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes
Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 10'-7.5."

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - V | 1442 - 170 | P - O | 2010 - 51 |
| T - R | 2864 - 205 | O - N | 2201 - 167 |
| Q - P | 1628 0 | N - L | 2204 - 166 |


| Maximum Web Forces Per Ply (lbs) | | | | |
|----------------------------------|------------|-------|-------|-------|
| Webs | Tens.Comp. | Webs | Tens. | Comp. |
| C - V | 170 - 1970 | R - G | 1345 | - 278 |
| C - T | 3134 - 296 | R - Q | 1621 | 0 |
| V - T | 1915 - 229 | P - H | 641 | - 122 |
| T - E | 2134 - 234 | P - I | 218 | - 616 |
| E - R | 172 - 632 | | | |

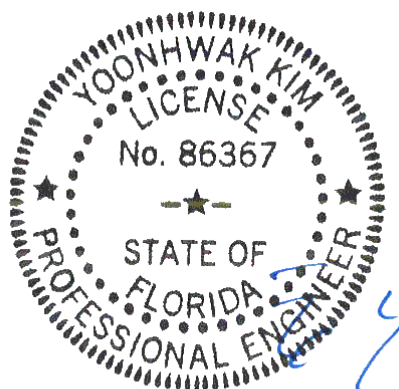

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbccomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

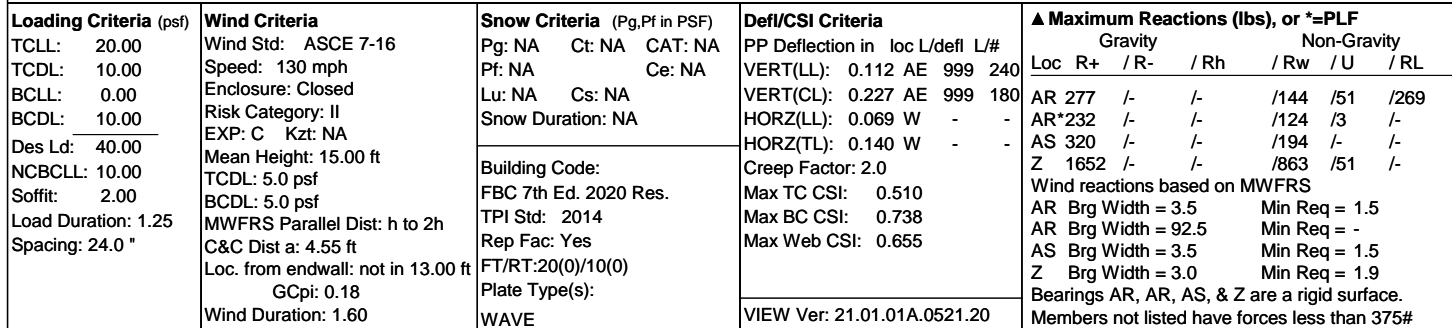

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

(a) Continuous lateral restraint equally spaced on member

(**) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind loads based on MWFRS with additional C&C member design.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

| Chords | Tens.Comp. | Chords | Tens. | Comp. |
|--------|-------------|--------|-------|-------|
| F -AF | 4044 - 1217 | AD-AC | 1406 | - 413 |
| AF-AE | 2021 - 610 | AC-AB | 1639 | - 460 |
| AE-AD | 1771 - 536 | AB-AA | 1641 | - 405 |

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| K -AD | 202 - 596 | AL-AM | 520 - 1846 |
| L -AD | 568 - 107 | AN-AN | 519 - 1890 |
| AC- M | 496 0 | AM-AO | 538 - 1917 |
| AC-AL | 78 - 417 | AO-AP | 455 - 1836 |
| M -AI | 486 - 1586 | AA- Y | 1719 - 416 |
| AI-AJ | 487 - 1591 | AP-AQ | 455 - 1867 |
| AJ-AK | 506 - 1613 | AQ- Y | 456 - 1841 |
| AK-AL | 562 - 1723 | | |

| Gables | Tens.Comp. |
|--------|------------|
| Y - Z | 441 - 1613 |

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinet.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



| | | | | |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 392512 | GABL | Ply: 1 | Job Number: 21-5244 | Cust: R 215 JRef: 1X892150001 T19 |
| FROM: CDM | | Qty: 1 | Albritton Res | DrwNo: 237.21.1527.48020 |
| Page 2 of 2 | | | Truss Label: C01 | / YK 08/25/2021 |

Additional Notes


See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 10-7-5.

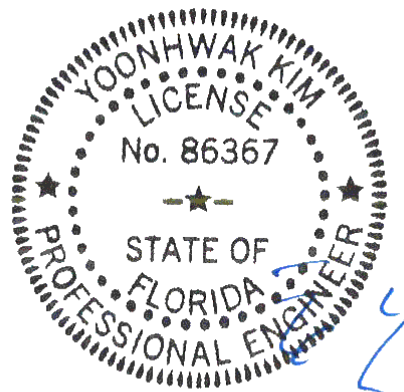

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING! ****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392470 FROM: CDM | SPEC Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: C02 | Cust: R 215 JRRef: 1X892150001 T1 DrwNo: 237.21.1527.51317 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

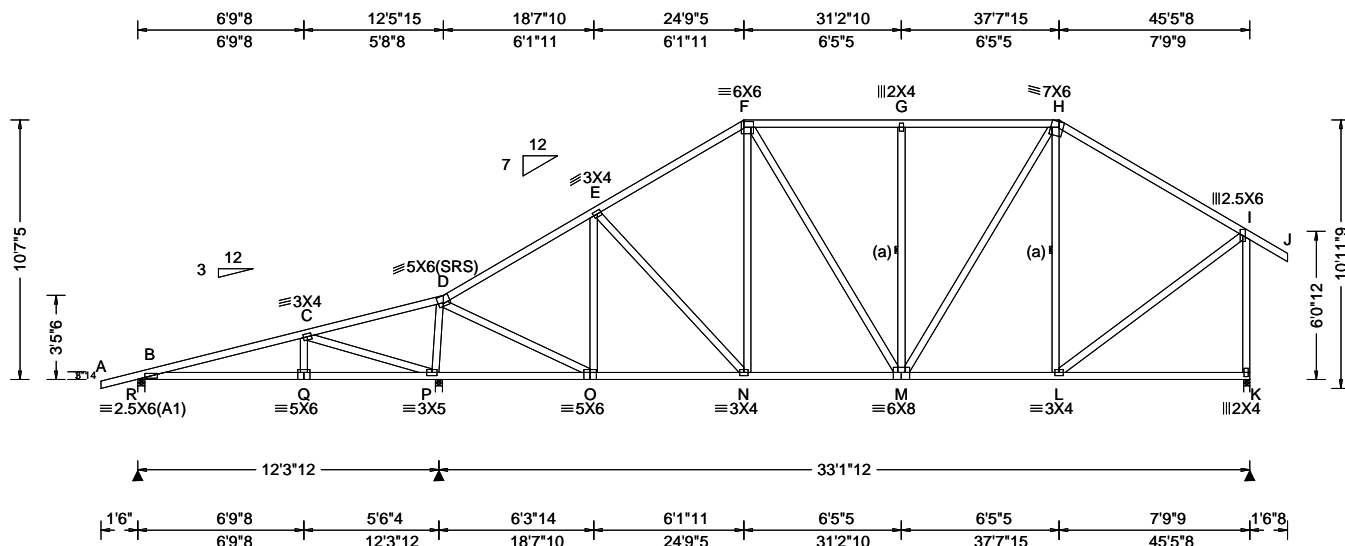

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|--|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 16.25 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.55 ft Loc. from endwall: not in 13.00 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.057 G 999 240 VERT(CL): 0.114 G 999 180 HORZ(LL): 0.018 L - - HORZ(TL): 0.037 L - - Creep Factor: 2.0 Max TC CSI: 0.951 Max BC CSI: 0.817 Max Web CSI: 0.949 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL R 502 - / - / - /237 /90 /296 P 2008 - / - / - /1184 - / - K 1460 - / - / - /829 - / - Non-Gravity Wind reactions based on MWFRS R Brg Width = 3.5 Min Req = 1.5 P Brg Width = 3.5 Min Req = 2.0 K Brg Width = 3.0 Min Req = 1.7 Bearings R, P, & K are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.


Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 10-7-5.

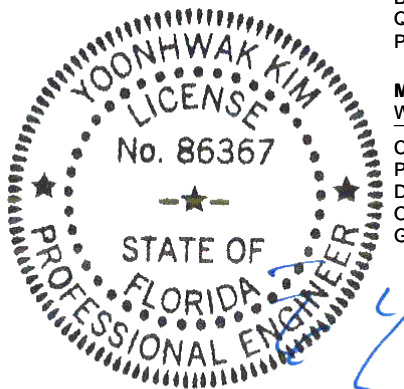

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C | 143 -660 | F - G | 43 -1071 |
| C - D | 483 -186 | G - H | 43 -1071 |
| D - E | 35 -1215 | H - I | 41 -1052 |
| E - F | 67 -1276 | | |


Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - P | 405 -1065 | M - H | 486 0 |
| P - D | 196 -1574 | H - L | 9 -431 |
| D - O | 1237 -12 | L - I | 1010 0 |
| O - E | 79 -523 | I - K | 87 -1397 |
| G - M | 0 -390 | | |

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|---|
| SEQN: 392467 FROM: CDM | SPEC Ply: 1 Qty: 4 | Job Number: 21-5244 Albritton Res Truss Label: C03 | Cust: R 215 JRRef: 1X892150001 T30 DrwNo: 237.21.1527.54453 / YK 08/25/2021 |
|---------------------------|--------------------------|--|---|

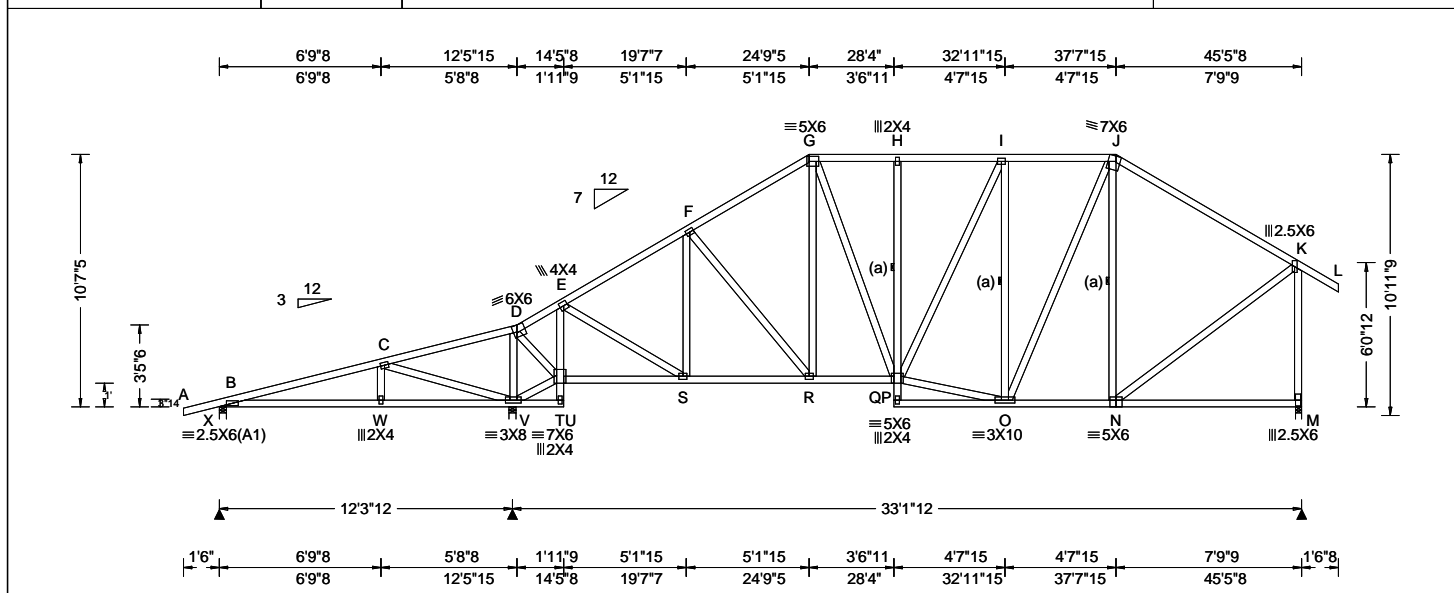

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.55 ft Loc. from endwall: not in 13.00 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.056 H 999 240 VERT(CL): 0.111 H 999 180 HORZ(LL): 0.022 N - - HORZ(TL): 0.042 N - - Creep Factor: 2.0 Max TC CSI: 0.974 Max BC CSI: 0.651 Max Web CSI: 0.974 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity X 442 -/- /- /168 /83 /293 V 2186 -/- /- /1270 /154 -/- M 1573 -/- /- /800 /99 -/- Wind reactions based on MWFRS X Brg Width = 3.5 Min Req = 1.5 V Brg Width = 3.5 Min Req = 2.2 M Brg Width = 3.0 Min Req = 1.9 Bearings X, V, & M are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing
(a) Continuous lateral restraint equally spaced on member.

Plating Notes
All plates are 3X4 except as noted.


Loading
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.
Right end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 10'-7-5/8".

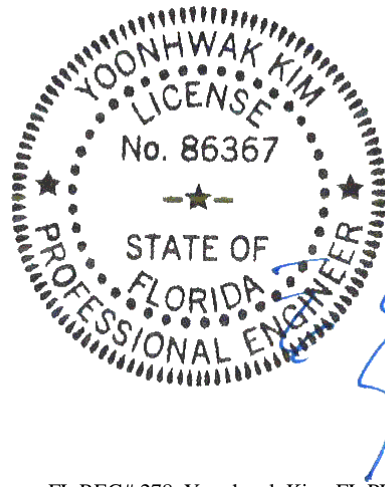

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| S - R | 1031 -310 | O - N | 841 -202 |
| R - P | 1044 -290 | | |

Maximum Web Forces Per Ply (lbs)


| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - V | 398 -1036 | S - F | 219 -446 |
| V - D | 443 -1311 | P - O | 1029 -292 |
| V - T | 260 -912 | I - O | 293 -526 |
| D - T | 1223 -375 | O - J | 414 -203 |
| T - E | 381 -1309 | N - K | 1044 -251 |
| E - S | 1039 -299 | K - M | 500 -1435 |

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392462 FROM: CDM | SPEC Ply: 1 Qty: 5 | Job Number: 21-5244 Albritton Res Truss Label: C04 | Cust: R 215 JRef: 1X892150001 T22 DrwNo: 237.21.1528.03673 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

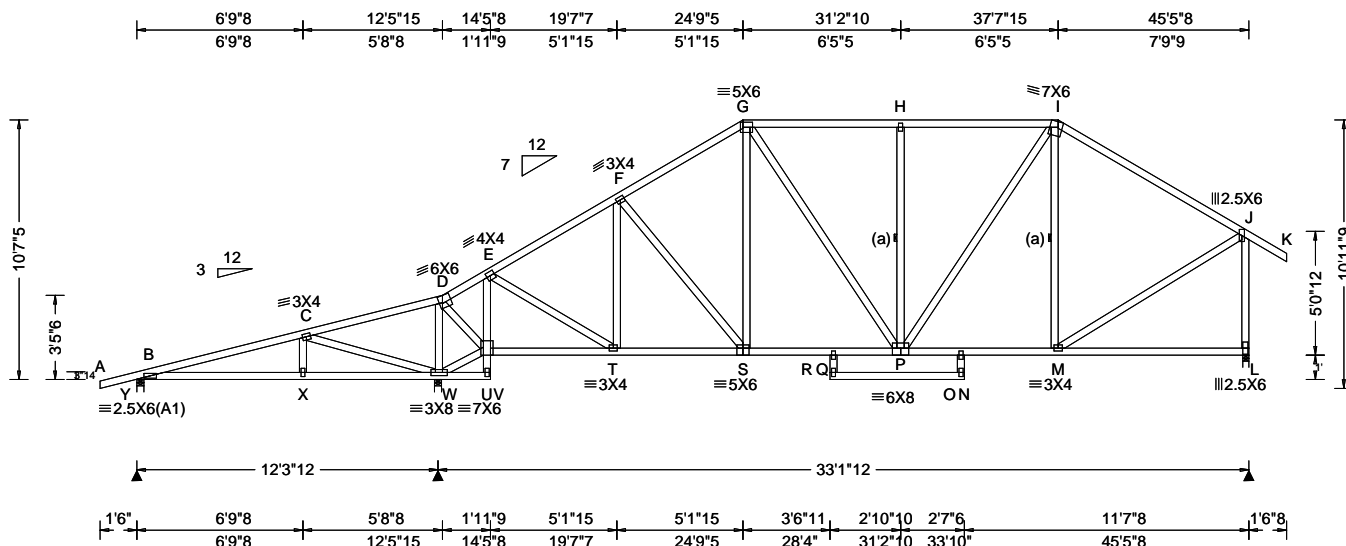

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.55 ft Loc. from endwall: not in 13.00 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.072 R 999 240 VERT(CL): 0.156 R 999 180 HORZ(LL): 0.019 M - - HORZ(TL): 0.035 M - - Creep Factor: 2.0 Max TC CSI: 0.972 Max BC CSI: 0.752 Max Web CSI: 0.672 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Y 447 - / - /170 /83 /293 W 2141 - / - /1266 /152 - /- L 1403 - / - /800 /100 - /- Non-Gravity Y Brg Width = 3.5 Min Req = 1.5 W Brg Width = 3.5 Min Req = 2.2 L Brg Width = 3.0 Min Req = 1.7 Bearings Y, W, & L are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.


Laterally brace top chord below filler and bottom chord above filler at 24" o.c., including a lateral brace at chord ends (If no rigid diaphragm exists at that point).

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 10'-7".

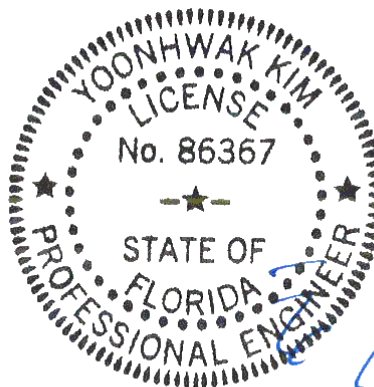

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C | 145 -434 | G - H | 550 -1099 |
| C - D | 875 -327 | H - I | 550 -1099 |
| E - F | 408 -1225 | I - J | 430 -1099 |
| F - G | 525 -1254 | | |

Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - W | 398 -1034 | T - F | 210 -428 |
| W - D | 446 -1284 | H - P | 317 -376 |
| W - U | 247 -876 | P - I | 430 -217 |
| D - U | 1194 -377 | M - J | 999 -263 |
| U - E | 376 -1267 | J - L | 499 -1341 |
| E - T | 991 -289 | | |

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|---|
| SEQN: 392464 FROM: CDM | SPEC Ply: 1 Qty: 5 | Job Number: 21-5244 Albritton Res Truss Label: C05 | Cust: R 215 JRRef: 1X892150001 T15 DrwNo: 237.21.1528.07137 / YK 08/25/2021 |
|---------------------------|--------------------------|--|---|

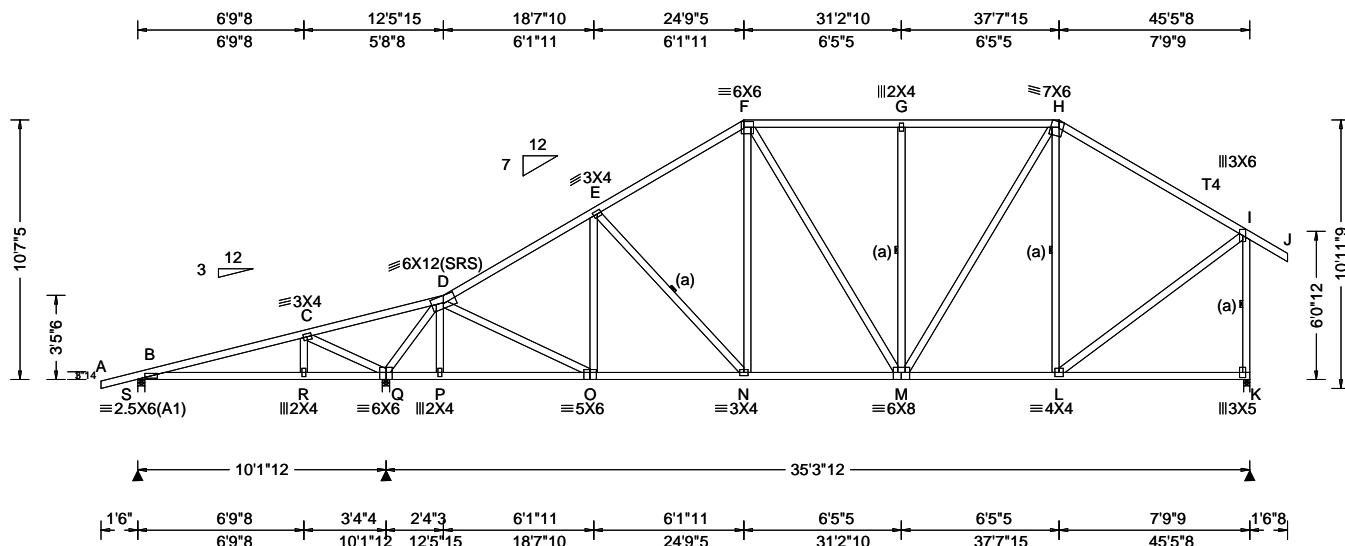

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|--|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 16.25 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.55 ft Loc. from endwall: not in 13.00 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.072 N 999 240 VERT(CL): 0.133 N 999 180 HORZ(LL): 0.024 L - - HORZ(TL): 0.044 L - - Creep Factor: 2.0 Max TC CSI: 0.783 Max BC CSI: 0.745 Max Web CSI: 0.746 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL S 357 - / - / - /136 /97 /296 Q 2345 - / - / - /1238 - / - K 1826 - / - / - /851 - / - Non-Gravity S Brg Width = 3.5 Min Req = 1.5 Q Brg Width = 3.5 Min Req = 2.8 K Brg Width = 3.0 Min Req = 2.2 Wind reactions based on MWFRS Members not listed have forces less than 375# Bearings S, Q, & K are a rigid surface. Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber

Top chord: 2x4 SP #2; T4 2x4 SP M-31;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.


Wind loading based on both gable and hip roof types.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 10-7-5.

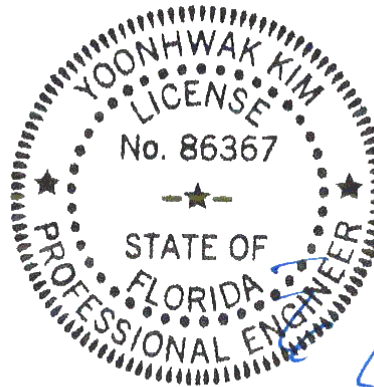

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C | 414 -120 | F - G | 54 -1395 |
| C - D | 963 -196 | G - H | 54 -1395 |
| D - E | 63 -1799 | H - I | 49 -1310 |
| E - F | 82 -1693 | | |


Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - Q | 323 -792 | G - M | 0 -392 |
| Q - D | 187 -2416 | H - L | 12 -463 |
| D - O | 1003 0 | L - I | 1286 0 |
| F - N | 385 -78 | I - K | 97 -1692 |
| M - H | 678 0 | | |

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

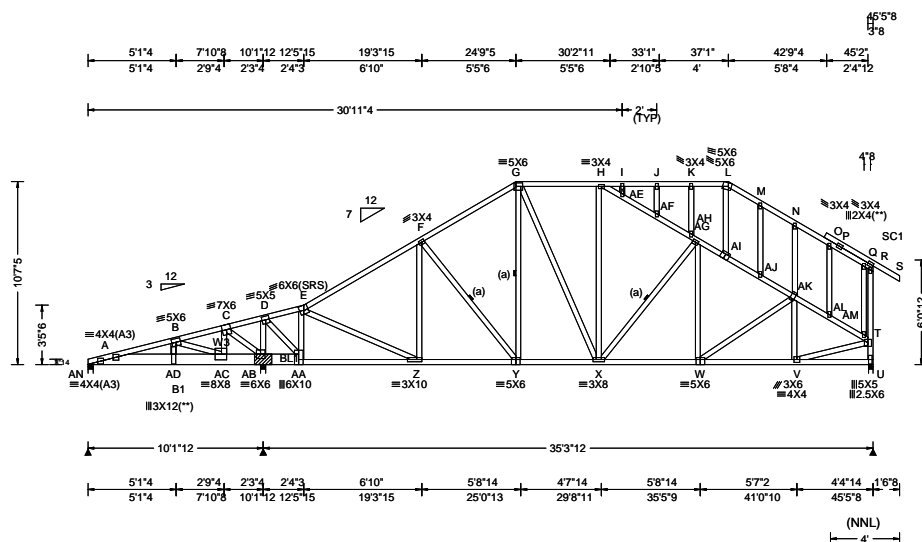


| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | Maximum Reactions (lbs) |
|---|---|--|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 16.26 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 4.55 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.078 A 999 240 VERT(CL): 0.164 A 723 180 HORZ(LL): 0.042 R - - HORZ(TL): 0.086 R - - Creep Factor: 2.0 Max TC CSI: 0.908 Max BC CSI: 0.574 Max Web CSI: 0.842 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL AN 2213 - / - / - / - /381 - / - AB 5577 - / - / - / - /1076 - / - U 1340 - / - / - / - /251 - / - Wind reactions based on MWFRS AN Brg Width = 3.5 Min Req = 1.8 AB Brg Width = 3.5 Min Req = - U Brg Width = 3.0 Min Req = 1.6 Bearings AN, AB, & U are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

| Lumber | Wind | Maximum Bot Chord Forces Per Ply (lbs) |
|---|--|--|
| Top chord: 2x4 SP #2; Bot chord: 2x4 SP #2; B1 2x8 SP 2400f-2.0E; Webs: 2x4 SP #3; W3 2x4 SP #2; Stack Chord: SC1 2x4 SP #2; | Wind loads and reactions based on MWFRS. Right end vertical not exposed to wind pressure. Wind loading based on both gable and hip roof types. | Chords Tens.Comp. Chords Tens. Comp. A - B 633 -3642 E - F 138 -1073 B - C 568 -311 F - G 186 -1006 C - D 3307 -604 G - H 150 -911 D - E 1911 -324 |

| Bracing | Bearing Block(s) | Maximum Bot Chord Forces Per Ply (lbs) |
|--|---|---|
| (a) Continuous lateral restraint equally spaced on member. | Brg blocks: 0.131"x3", min. nails brg x-loc #blocks length/blk #nails/blk wall plate 2 10.000' 1 12" 7 Rigid Surface Brg block to be same size and species as chord. Refer to drawing CNNAIL 901014 for more information. | Chords Tens.Comp. Chords Tens. Comp. A - AD 3530 -609 Z - Y 896 -92 AD-AC 3346 -582 Y - X 830 -127 AC-AB 30 -565 X - W 1208 -206 AB-AA 535 -2944 W - V 1282 -217 AA- Z 266 -1725 |

| Special Loads | Maximum Web Forces Per Ply (lbs) |
|--|---|
| ----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25) TC: From 61 plf at 0.00 to 61 plf at 12.50 TC: From 63 plf at 12.50 to 63 plf at 47.00 BC: From 10 plf at 0.00 to 10 plf at 7.94 BC: From 20 plf at 7.94 to 20 plf at 45.46 BC: From 5 plf at 45.46 to 5 plf at 47.00 BC: 974 lb Conc. Load at 1.06, 3.06, 5.06, 7.06 BC: 1376 lb Conc. Load at 7.94 | Webs Tens.Comp. Webs Tens. Comp. AD- B 1917 -282 H - AE 181 -1061 B - AC 576 -3363 AE- AF 179 -1054 AC- C 3201 -603 AF- AG 188 -1077 C - AB 750 -3732 AG- AH 233 -1193 AB- D 408 -2255 AH- AI 220 -1352 D - AA 2210 -383 AI- AJ 238 -1398 AA- E 423 -1979 AJ- AK 248 -1424 E - Z 2171 -386 AK- AL 233 -1432 Z - F 233 -791 V - T 1345 -227 F - Y 417 -109 AL- AM 244 -1461 X - H 385 0 AM- T 240 -1442 X - AH 88 -481 |

| Plating Notes | Maximum Gable Forces Per Ply (lbs) |
|--|--------------------------------------|
| All plates are 2X4 except as noted. (**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements. | Gables Tens.Comp. T - U 267 -1302 |
| Loading | |
| Gable end supports 8" max rake overhang. Top chord must not be cut or notched. | |
| Purlins | |
| In lieu of structural panels use purlins to brace all flat TC @ 24" oc. | |

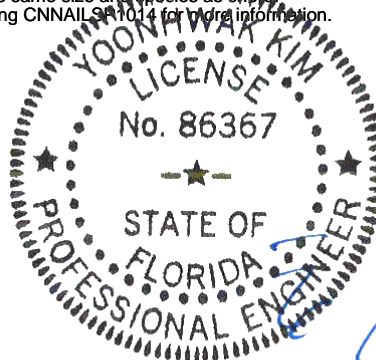

FL REG# 278, Yoonhwak Kim, FL PE
08/25/2021

| | | | | |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 392526 | GABL | Ply: 1 | Job Number: 21-5244 | Cust: R 215 JRef: 1X892150001 T23 |
| FROM: CDM | | Qty: 1 | Albritton Res | DrwNo: 237.21.1528.15907 |
| Page 2 of 2 | | | Truss Label: C06 | / YK 08/25/2021 |

Additional Notes


See DWGS A14030ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 10-7-5.

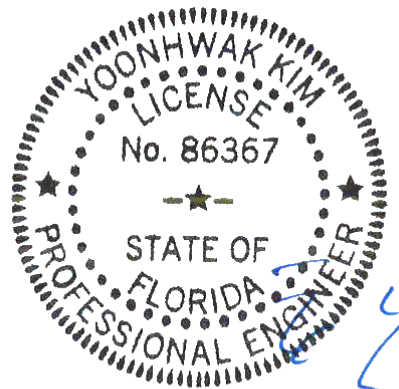

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING! ****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|---|
| SEQN: 392456 FROM: CDM | COMN Ply: 1 Qty: 7 | Job Number: 21-5244 Albritton Res Truss Label: D01 | Cust: R 215 JRRef: 1X892150001 T26 DrwNo: 237.21.1528.20147 / YK 08/25/2021 |
|---------------------------|--------------------------|--|---|

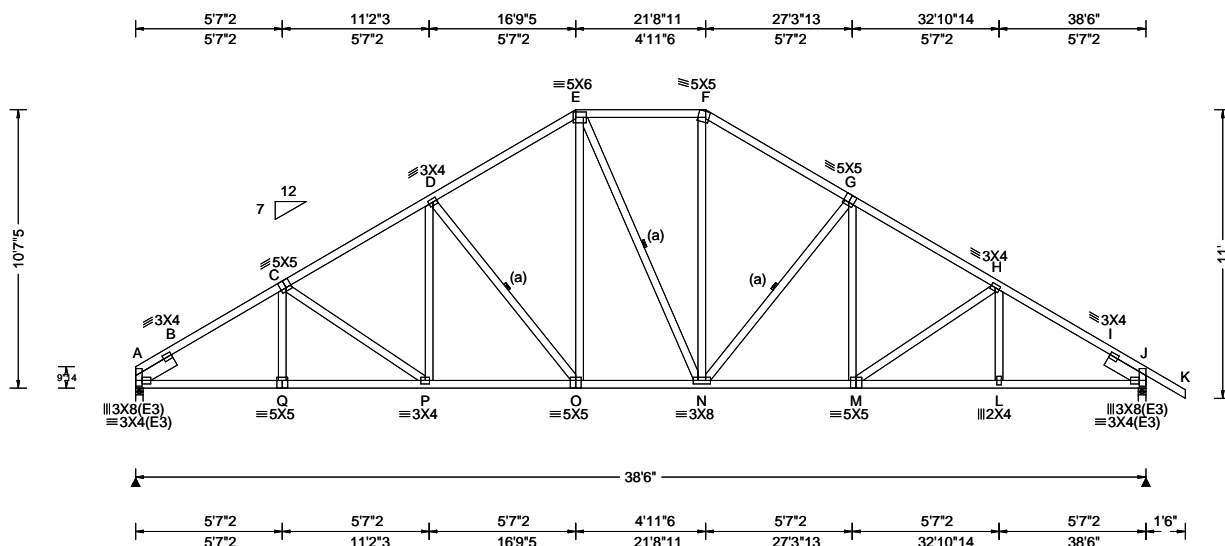

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria | Maximum Reactions (lbs) |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.85 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.150 O 999 240 VERT(CL): 0.285 O 999 180 HORZ(LL): 0.077 I - - HORZ(TL): 0.146 I - - Creep Factor: 2.0 Max TC CSI: 0.526 Max BC CSI: 0.689 Max Web CSI: 0.340 VIEW Ver: 21.01.01A.0521.20 | Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 1753 -/- /- /935 /267 /293 J 1854 -/- /- /1022 /294 -/ Wind reactions based on MWFRS A Brg Width = 3.5 Min Req = 2.1 J Brg Width = 3.5 Min Req = 2.2 Bearings A & J are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Slider: 2x6 SP 2400f-2.0E; block length = 1.674'
Rt Slider: 2x6 SP 2400f-2.0E; block length = 1.674'


Bracing
(a) Continuous lateral restraint equally spaced on member.

Loading
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes
Refer to DWG PB160160118 for piggyback details.
The overall height of this truss excluding overhang is 10'-7.5".

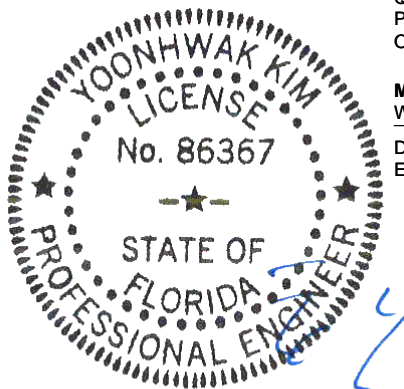

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021


| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| A - B | 759 -2807 | F - G | 746 -2043 |
| B - C | 775 -2749 | G - H | 773 -2482 |
| C - D | 776 -2498 | H - I | 768 -2726 |
| D - E | 750 -2062 | I - J | 788 -2783 |
| E - F | 701 -1692 | | |

| Maximum Web Forces Per Ply (lbs) | Webbs | Tens.Comp. | Webbs | Tens. Comp. |
|----------------------------------|-------|------------|-------|-------------|
| D - O | 274 | -619 | N - F | 663 -160 |
| E - O | 689 | -165 | N - G | 271 -612 |

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392449 FROM: CDM | GABL Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: D02 | Cust: R 215 JRef: 1X892150001 T17 DrwNo: 237.21.1528.27777 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

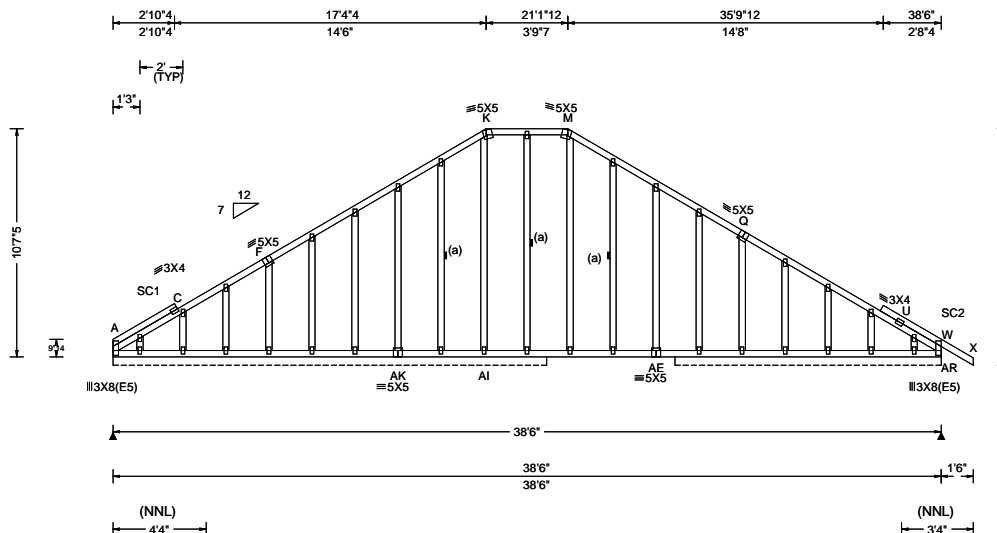

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or *=PLF |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.85 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.053 AF 999 240 VERT(CL): 0.109 AF 756 180 HORZ(LL): -0.021 N - - HORZ(TL): 0.043 N - - Creep Factor: 2.0 Max TC CSI: 0.364 Max BC CSI: 0.722 Max Web CSI: 0.240 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL A* 92 - / - /63 /15 /10 AR*129 - / - /67 /23 - AI - /133 Wind reactions based on MWFRS A Brg Width = 242 Min Req = - AR Brg Width = 148 Min Req = - Bearings A & AE are a rigid surface. Members not listed have forces less than 375# Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. AE- W 477 -86 |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at 0.00 to 63 plf at 40.00
BC: From 20 plf at 0.00 to 20 plf at 38.50
BC: From 5 plf at 38.50 to 5 plf at 40.00
BC: 38 lb Conc. Load at 20.17, 22.17, 24.17, 26.17

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Additional Notes


See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

Refer to DWG PB160160118 for purlin details.

The overall height of this truss excluding overhang is 10'-7-5/8".

WIND LOAD CASE MODIFIED!

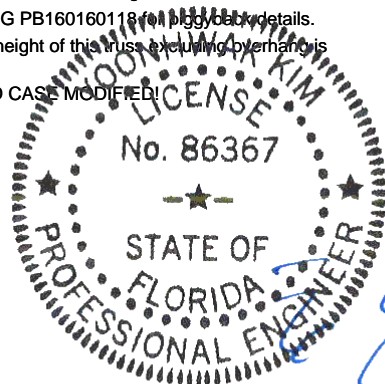

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | | |
|-----------------------------|------|------------------|---|---|
| SEQN: 619456 / FROM: CDM | HIP_ | Ply: 1 Qty: 2 | Job Number: 21-5244 Albritton Res Truss Label: HJ01 | Cust: R 215 JRef: 1X892150001 T10 / DrwNo: 237.21.1423.02387 JB / DF 08/25/2021 |
|-----------------------------|------|------------------|---|---|

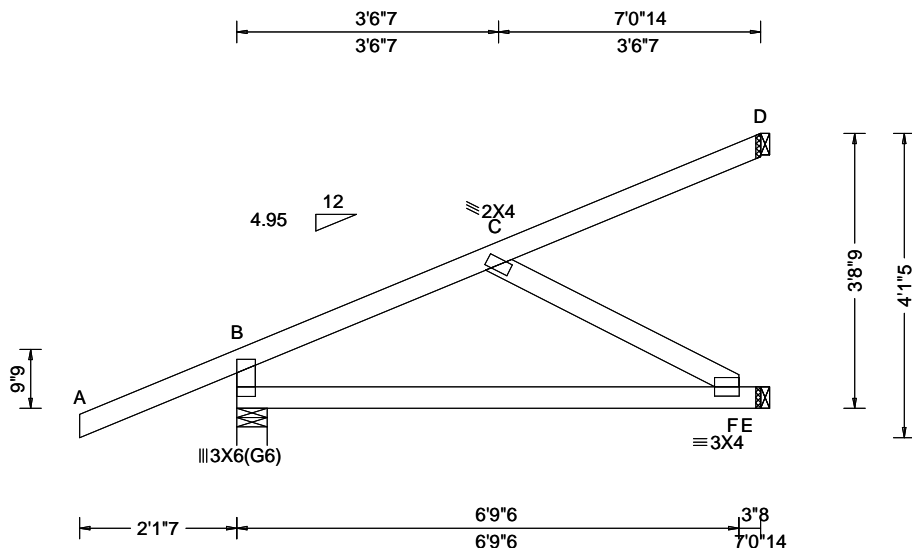

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|--|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.010 F 999 240 VERT(CL): 0.027 F 999 180 HORZ(LL): 0.005 D - - HORZ(TL): 0.016 C - - Creep Factor: 2.0 Max TC CSI: 0.207 Max BC CSI: 0.497 Max Web CSI: 0.192 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 281 /- /- /- /111 /- E 180 /- /- /- /46 /- D 30 /- /- /- /13 /- Wind reactions based on MWFRS B Brg Width = 4.9 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Stub Wedge: 2x4 SP #3;

Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 0 plf at -2.12 to 62 plf at 0.00
TC: From 2 plf at 0.00 to 2 plf at 7.07
BC: From 0 plf at -2.12 to 4 plf at 0.00
BC: From 2 plf at 0.00 to 2 plf at 7.07
TC: -27 lb Conc. Load at 1.48
TC: 144 lb Conc. Load at 4.31
BC: 27 lb Conc. Load at 1.48
BC: 111 lb Conc. Load at 4.31

Wind

Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 3-8-9.

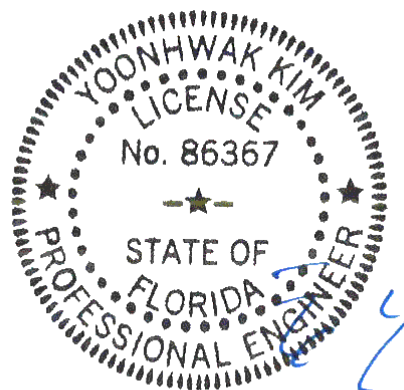

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619450 / FROM: CDM | JACK Ply: 1 Qty: 4 | Job Number: 21-5244 Albritton Res Truss Label: J01 | Cust: R 215 JRef: 1X892150001 T8 / DrwNo: 237.21.1423.02184 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

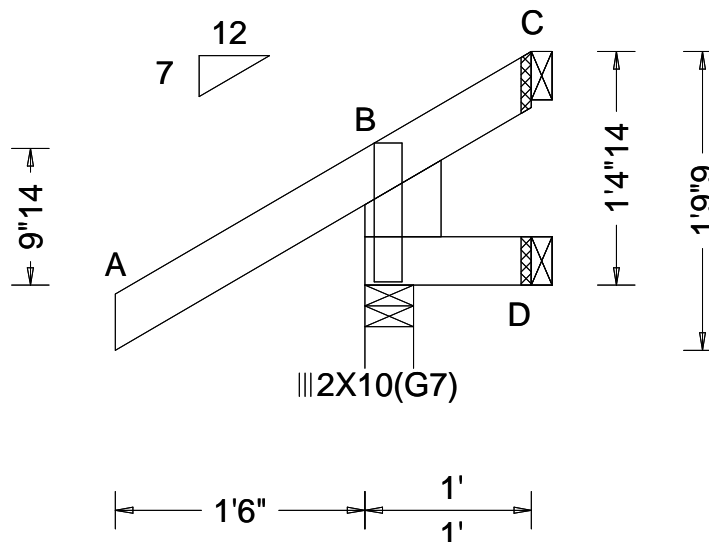

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|---|--|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.300 Max BC CSI: 0.035 Max Web CSI: 0.000 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 220 /- /- /159 /36 /44 D 14 /-4 /- /6 /2 /- C - /-30 /- /23 /33 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 1-4-14.

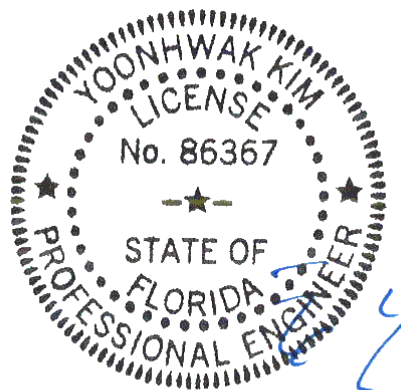

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619452 / FROM: CDM | JACK Ply: 1 Qty: 4 | Job Number: 21-5244 Albritton Res Truss Label: J02 | Cust: R 215 JRef: 1X892150001 T7 / DrwNo: 237.21.1423.02059 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

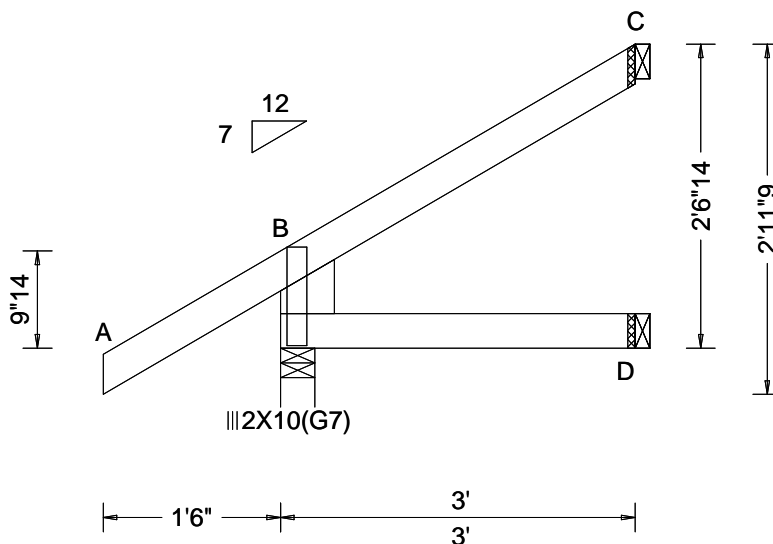

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|---|--|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.003 C - - HORZ(TL): 0.003 C - - Creep Factor: 2.0 Max TC CSI: 0.300 Max BC CSI: 0.118 Max Web CSI: 0.000 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 252 /- /- /174 /20 /86 D 55 /- /- /30 /- /- C 72 /- /- /47 /50 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 2-6-14.

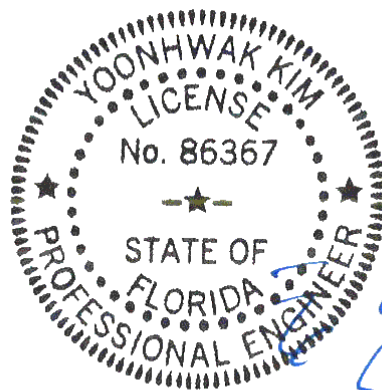

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619454 / FROM: CDM | EJAC Ply: 1 Qty: 7 | Job Number: 21-5244 Albritton Res Truss Label: J03 | Cust: R 215 JRef: 1X892150001 T9 / DrwNo: 237.21.1423.02136 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

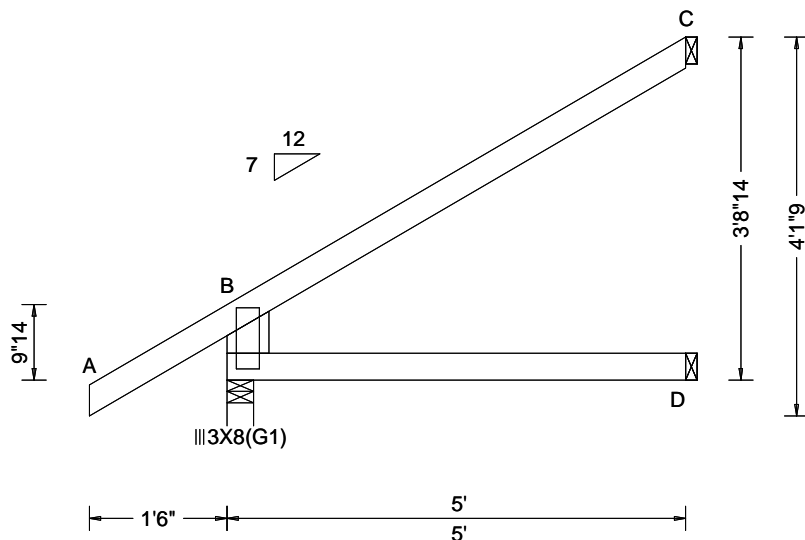

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|--|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.010 D - - HORZ(TL): 0.019 D - - Creep Factor: 2.0 Max TC CSI: 0.440 Max BC CSI: 0.294 Max Web CSI: 0.000 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 325 - / - / - / 219 / 20 / 127 D 95 - / - / - / 54 / - / - C 138 - / - / - / 91 / 82 / - Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;

Wind

Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 3-8-14.

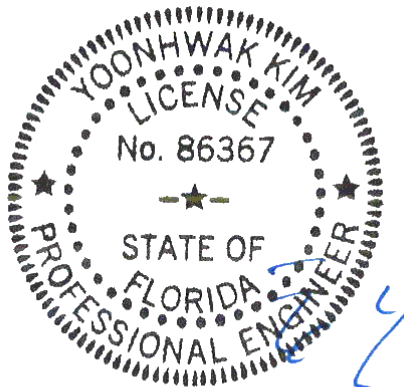

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392314 FROM: CDM | GABL Ply: 1 Qty: 1 | Job Number: 21-5244 Albritton Res Truss Label: J04 | Cust: R 215 JRef: 1X892150001 T16 DrwNo: 237.21.1528.52540 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

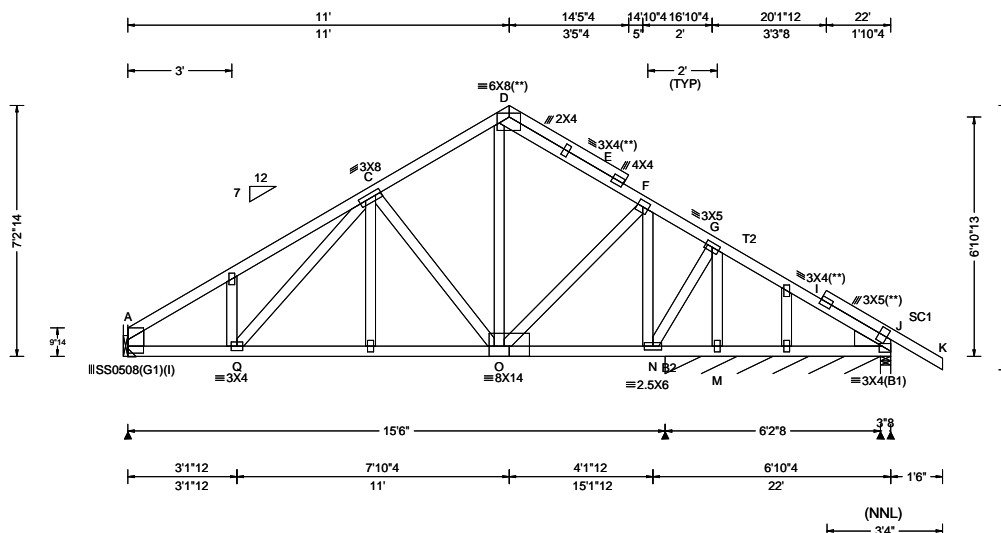

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or *PLF |
|---|---|---|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/10(0) Plate Type(s): 18SS, WAVE | PP Deflection in loc L/def L/# VERT(LL): 0.040 B 999 240 VERT(CL): 0.087 B 999 180 HORZ(LL): -0.011 A - - HORZ(TL): 0.024 A - - Creep Factor: 2.0 Max TC CSI: 0.517 Max BC CSI: 0.564 Max Web CSI: 0.538 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 1376 - / - / - /627 /363 /379 N* 379 - / - / - /161 /34 - /- J 353 - / - / - /325 /210 - /- Wind reactions based on MWFRS A Brg Width = - Min Req = - N Brg Width = 74.5 Min Req = - J Brg Width = 3.5 Min Req = 1.5 Bearings N & J are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. |

Lumber

Top chord: 2x4 SP M-31; T2 2x4 SP #2;
Bot chord: 2x4 SP M-31; B2 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: T3 2x4 SP #2;
Stack Chord: SC1 2x4 SP #2;
Lt Stub Wedge: 2x6 SP 2400f-2.0E;
Rt Stub Wedge: 2x6 SP 2400f-2.0E;

Plating Notes

All plates are 2X4 except as noted.

(**) 4 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Hangers / Ties

(J) Hanger Support Required, by others

Loading

Truss designed to support 2-0-0 top chord outlookers and cladding load not to exceed 10.00 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.

Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

The overall height of this truss excluding overhang is 7-2-14.

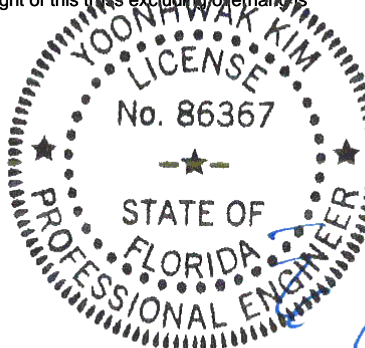

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| A - Q | 1494 -551 | Q - O | 1332 -362 |

Maximum Web Forces Per Ply (lbs)

| Webs | Tens.Comp. | Webs | Tens. Comp. |
|-------|------------|-------|-------------|
| C - O | 407 -808 | N - G | 773 -149 |
| O - F | 713 -190 | | |

Maximum Gable Forces Per Ply (lbs)

| Gables | Tens.Comp. | Gables | Tens. Comp. |
|--------|------------|--------|-------------|
| F - N | 316 -1369 | G - M | 196 -1256 |

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|--|--|
| SEQN: 392445 FROM: CDM | MONO Ply: 1 Qty: 4 | Job Number: 21-5244 Albritton Res Truss Label: J05 | Cust: R 215 JRef: 1X892150001 T14 DrwNo: 237.21.1528.55997 / YK 08/25/2021 |
|---------------------------|--------------------------|--|--|

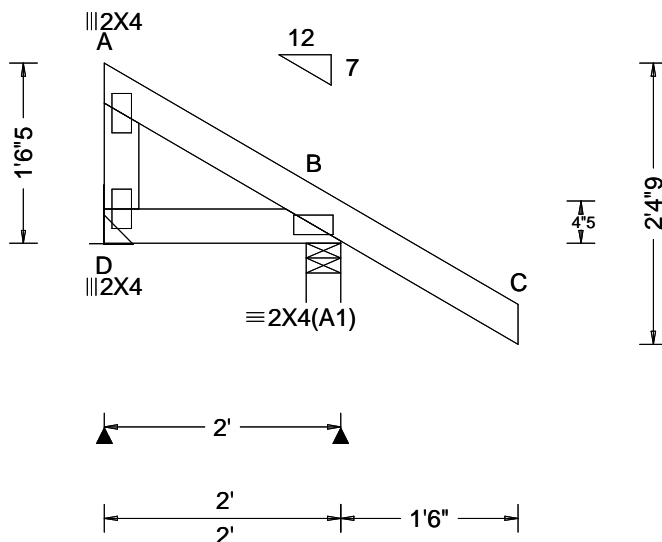

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): -0.000 B 999 240 VERT(CL): -0.001 B 999 180 HORZ(LL): 0.000 B - - HORZ(TL): 0.001 B - - Creep Factor: 2.0 Max TC CSI: 0.300 Max BC CSI: 0.048 Max Web CSI: 0.021 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL D 38 /- /- /23 /6 /71 B 240 /- /- /101 /55 /- Wind reactions based on MWFRS D Brg Width = - Min Req = - B Brg Width = 3.5 Min Req = 1.5 Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 1'6-5.

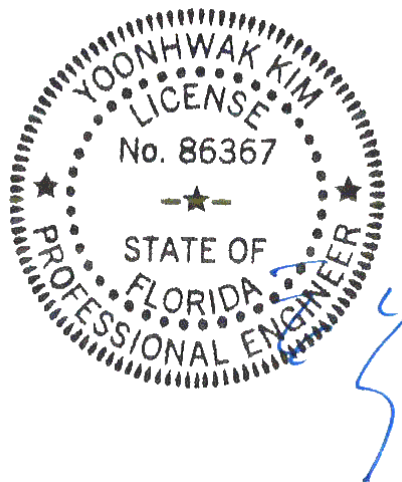

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!** ****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbccomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|--------------------------|--|--|
| SEQN: 619750 / FROM: CDM | GABL Ply: 1 Qty: 2 | Job Number: 21-5244 Albritton Res Truss Label: J06 | Cust: R 215 JRef: 1X892150001 T5 / DrwNo: 237.21.1423.02558 JB / DF 08/25/2021 |
|-----------------------------|--------------------------|--|--|

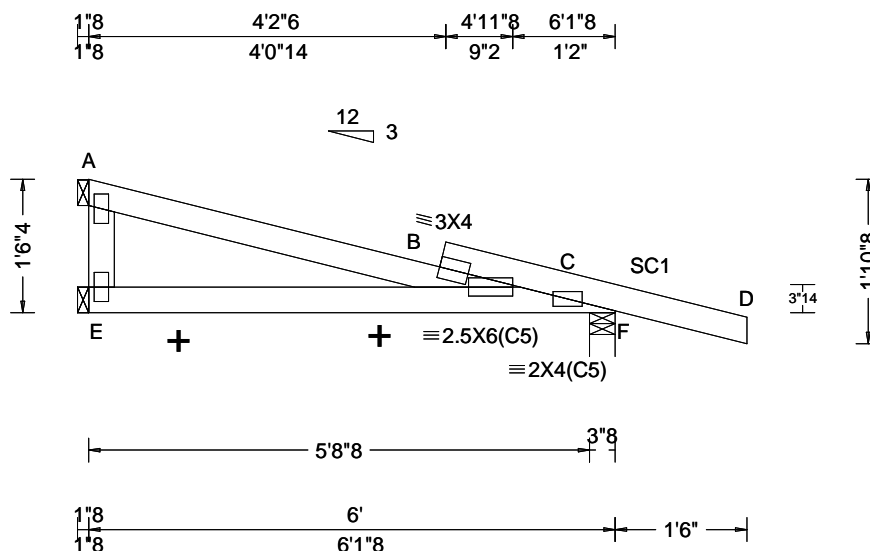

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|--|---|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.050 B 999 240 VERT(CL): 0.097 B 721 180 HORZ(LL): 0.007 A - - HORZ(TL): 0.014 A - - Creep Factor: 2.0 Max TC CSI: 0.420 Max BC CSI: 0.319 Max Web CSI: 0.114 VIEW Ver: 20.01.01A.0724.11 | Gravity Loc R+ / R- / Rh / Rw / U / RL E 107 -/- /- /59 -/- /18 A 137 -/- /- /53 -/- /- F 369 -/- /- /200 /5 -/- Non-Gravity Wind reactions based on MWFRS E Brg Width = 1.5 Min Req = - A Brg Width = 1.5 Min Req = - F Brg Width = 3.5 Min Req = 1.5 Bearing F is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

+ MEMBER TO BE Laterally Braced For
HORIZONTAL WIND LOADS.

B - C 356 -396

Plating Notes

All plates are 2X4 except as noted.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.


Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notched area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notched area using 3x6.

The overall height of this truss excluding overhang is 1'-6-4.

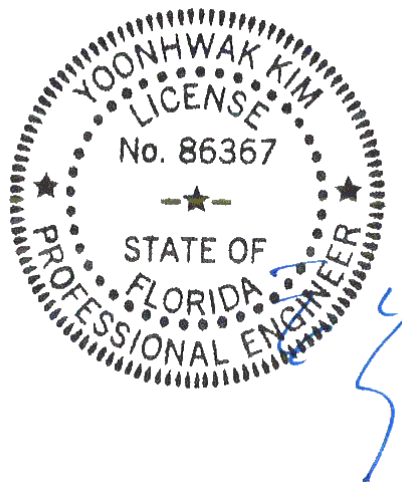

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|-----------------------------|---------------------------|--|---|
| SEQN: 619572 / FROM: CDM | MONO Ply: 1 Qty: 15 | Job Number: 21-5244 Albritton Res Truss Label: J07 | Cust: R 215 JRef: 1X892150001 T21 / DrwNo: 237.21.1423.02605 JB / DF 08/25/2021 |
|-----------------------------|---------------------------|--|---|

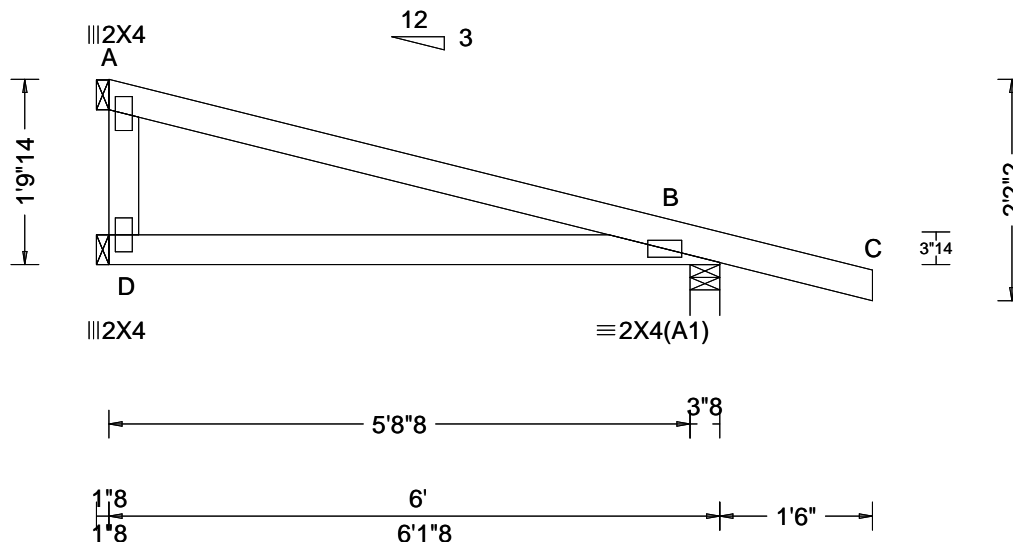

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs) |
|---|---|---|--|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.027 D 999 240 VERT(CL): 0.052 D 999 180 HORZ(LL): -0.008 D - - HORZ(TL): 0.016 D - - Creep Factor: 2.0 Max TC CSI: 0.527 Max BC CSI: 0.320 Max Web CSI: 0.193 VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL D 110 /- /- /60 /- /64 A 148 /- /- /58 /61 /- B 360 /- /- /198 /90 /- Wind reactions based on MWFRS D Brg Width = 1.5 Min Req = - A Brg Width = 1.5 Min Req = - B Brg Width = 3.5 Min Req = 1.5 Bearing B is a rigid surface. Members not listed have forces less than 375# |

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Additional Notes

The overall height of this truss excluding overhang is 1'-9-14.

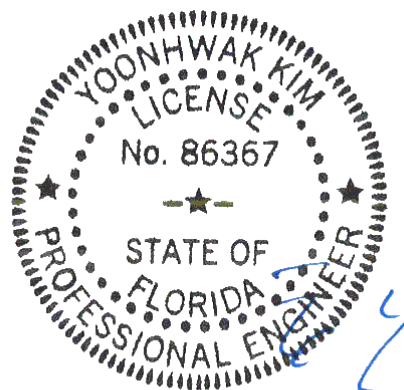

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING! ****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|---------------------------|---|--|
| SEQN: 392472 FROM: CDM | GABL Ply: 1 Qty: 15 | Job Number: 21-5244 Albritton Res Truss Label: PB01 | Cust: R 215 JRef: 1X892150001 T28 DrwNo: 237.21.1528.59870 / YK 08/25/2021 |
|---------------------------|---------------------------|---|--|

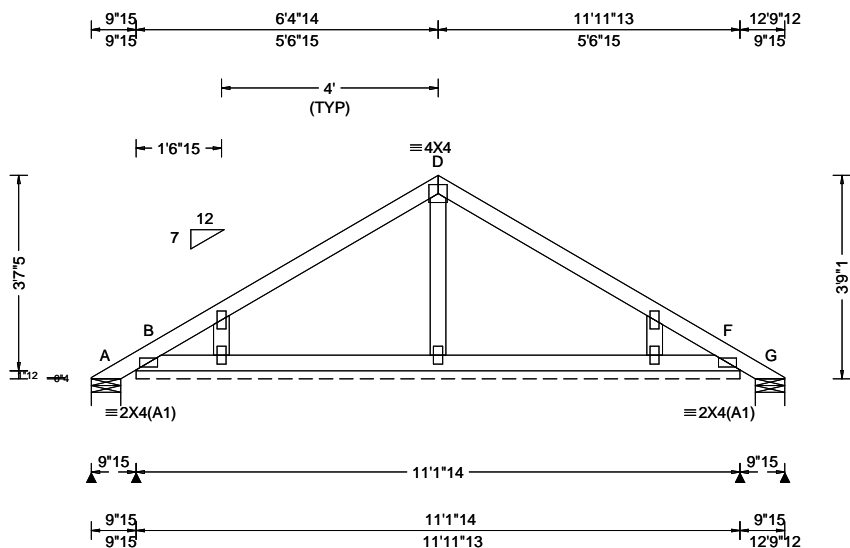

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or *=PLF |
|---|--|--|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 16.25 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.68 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.001 D 999 240 VERT(CL): 0.001 D 999 180 HORZ(LL): 0.001 E - - HORZ(TL): 0.001 E - - Creep Factor: 2.0 Max TC CSI: 0.240 Max BC CSI: 0.068 Max Web CSI: 0.050 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 32 /- /- /63 /44 /100 B* 68 /- /- /50 /7 /- G 32 /- /- /26 /7 /- Wind reactions based on MWFRS A Brg Width = 6.5 Min Req = 1.5 B Brg Width = 133 Min Req = - G Brg Width = 6.5 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375# |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14030ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 3-9-2.

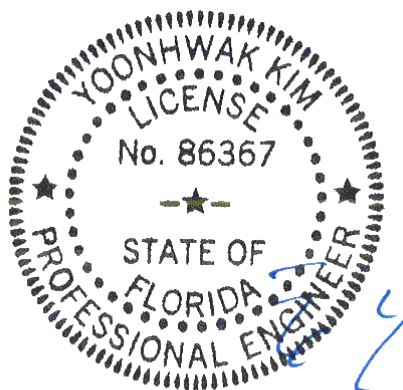

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbccomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|---|--|
| SEQN: 392494 FROM: CDM | GABL Ply: 1 Qty: 2 | Job Number: 21-5244 Albritton Res Truss Label: PB02 | Cust: R 215 JRef: 1X892150001 T13 DrwNo: 237.21.1529.09487 / YK 08/25/2021 |
|---------------------------|--------------------------|---|--|

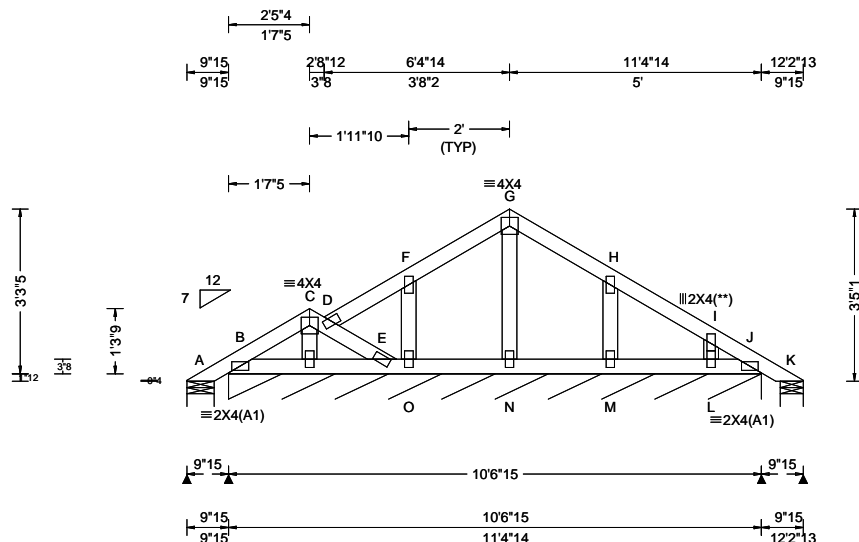

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or *=PLF |
|---|---|---|---|--|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.09 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: No FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.000 D 999 240 VERT(CL): 0.001 D 999 180 HORZ(LL): 0.001 H - - HORZ(TL): 0.001 H - - Creep Factor: 2.0 Max TC CSI: 0.069 Max BC CSI: 0.023 Max Web CSI: 0.032 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 15 /- /- /53 /43 /91 B* 71 /- /- /51 /21 /- K 21 /- /- /18 /7 /- Wind reactions based on MWFRS A Brg Width = 6.5 Min Req = 1.5 B Brg Width = 126 Min Req = - K Brg Width = 5.5 Min Req = 1.5 Bearings A, B, & K are a rigid surface. Members not listed have forces less than 375# |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

(**) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14030ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 3-5-1.

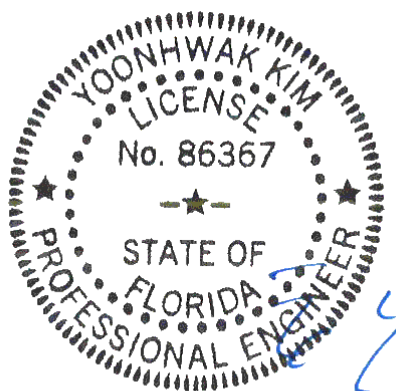

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|---------------------------|---|--|
| SEQN: 392486 FROM: CDM | GABL Ply: 1 Qty: 14 | Job Number: 21-5244 Albritton Res Truss Label: PB03 | Cust: R 215 JRef: 1X892150001 T29 DrwNo: 237.21.1529.12657 / YK 08/25/2021 |
|---------------------------|---------------------------|---|--|

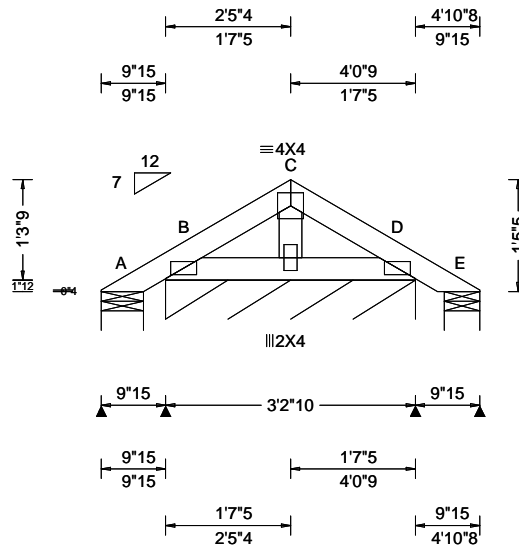

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or *=PLF |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.09 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCp: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.000 B 999 240 VERT(CL): 0.000 B 999 180 HORZ(LL): 0.000 B - - HORZ(TL): 0.000 B - - Creep Factor: 2.0 Max TC CSI: 0.026 Max BC CSI: 0.014 Max Web CSI: 0.010 VIEW Ver: 21.01.01A.0521.20 | Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 15 - / - /26 /14 /34 B* 82 - / - /59 /24 - E 15 - / - /14 /6 - Wind reactions based on MWFRS A Brg Width = 6.5 Min Req = 1.5 B Brg Width = 38.6 Min Req = - E Brg Width = 5.5 Min Req = 1.5 Bearings A, B, & E are a rigid surface. Members not listed have forces less than 375# |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4(A1) except as noted.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS A14030ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 1-5-5.

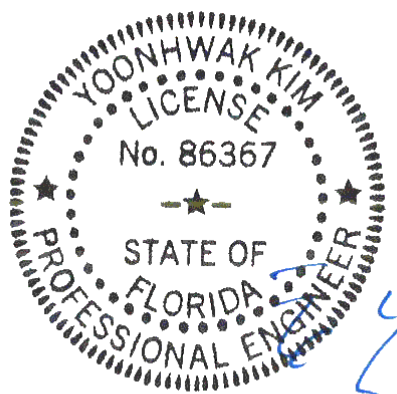

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbccomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

| | | | |
|---------------------------|--------------------------|---|---|
| SEQN: 392476 FROM: CDM | GABL Ply: 1 Qty: 2 | Job Number: 21-5244 Albritton Res Truss Label: PB04 | Cust: R 215 JRRef: 1X892150001 T18 DrwNo: 237.21.1529.16977 / YK 08/25/2021 |
|---------------------------|--------------------------|---|---|

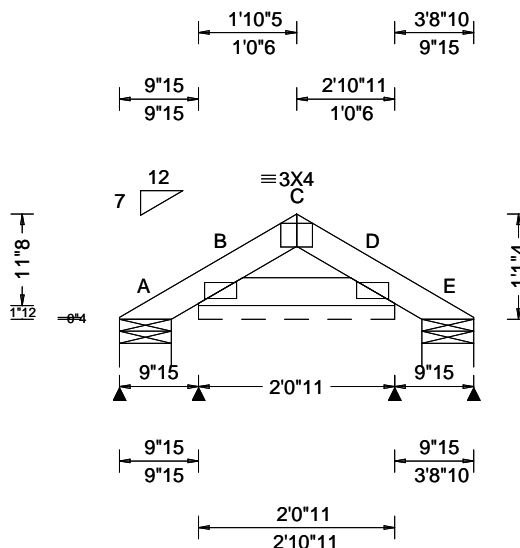

| Loading Criteria (psf) | Wind Criteria | Snow Criteria (Pg, Pf in PSF) | Defl/CSI Criteria | ▲ Maximum Reactions (lbs), or * = PLF |
|---|---|--|---|---|
| TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 " | Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE | PP Deflection in loc L/defl L/# VERT(LL): 0.000 C 999 240 VERT(CL): 0.000 C 999 180 HORZ(LL): 0.000 D - - HORZ(TL): 0.000 D - - Creep Factor: 2.0 Max TC CSI: 0.010 Max BC CSI: 0.012 Max Web CSI: 0.000 VIEW Ver: 21.01.01A.0521.20 | Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 21 - / - /21 /9 /25 B* 85 - / - /62 /22 - E 21 - / - /18 /9 - Wind reactions based on MWFRS A Brg Width = 6.5 Min Req = 1.5 B Brg Width = 24.7 Min Req = - E Brg Width = 6.5 Min Req = 1.5 Bearings A, B, & E are a rigid surface. Members not listed have forces less than 375# |

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;

Plating Notes

All plates are 2X4(A1) except as noted.

Wind


Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 1'-1-4".

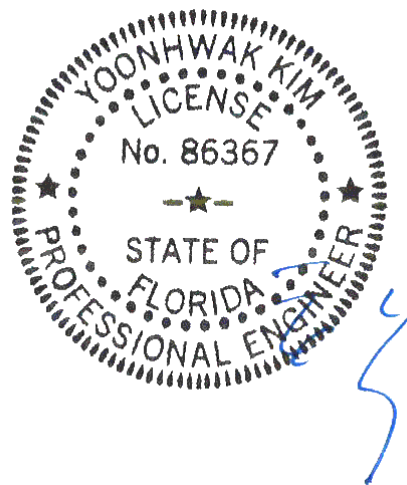

FL REG# 278, Yoonhwak Kim, FL PE #86367
08/25/2021

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Gable Stud Reinforcement Detail

ASCE 7-16: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

| Max Gable Vertical Length | 2x4 Gable Vertical | | Brace Grade | No Braces | (1) 1x4 "L" Brace * | | (1) 2x4 "L" Brace * | | (2) 2x4 "L" Brace ** | | (1) 2x6 "L" Brace * | | (2) 2x6 "L" Brace ** | |
|---------------------------|--------------------|----------|----------------|--------------|---------------------|---------|---------------------|---------|----------------------|---------|---------------------|---------|----------------------|---------|
| | Spacing | Species | | | Group A | Group B | Group A | Group B | Group A | Group B | Group A | Group B | Group A | Group B |
| | | | | | | | | | | | | | | |
| 24" O.C. | SPF HF | #1 / #2 | 4' 3" | 7' 3" | 7' 7" | 8' 7" | 8' 11" | 10' 3" | 10' 8" | 13' 6" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 4' 1" | 6' 7" | 7' 1" | 8' 6" | 8' 10" | 10' 1" | 10' 6" | 13' 4" | 13' 10" | 14' 0" | 14' 0" | |
| | | Stud | 4' 1" | 6' 7" | 7' 0" | 8' 6" | 8' 10" | 10' 1" | 10' 6" | 13' 4" | 13' 10" | 14' 0" | 14' 0" | |
| | | Standard | 4' 1" | 5' 8" | 6' 0" | 7' 7" | 8' 1" | 10' 1" | 10' 6" | 11' 10" | 12' 8" | 14' 0" | 14' 0" | |
| | | #1 | 4' 6" | 7' 4" | 7' 8" | 8' 8" | 9' 0" | 10' 4" | 10' 9" | 13' 8" | 14' 0" | 14' 0" | 14' 0" | |
| | | #2 | 4' 3" | 7' 3" | 7' 7" | 8' 7" | 8' 11" | 10' 3" | 10' 8" | 13' 6" | 14' 0" | 14' 0" | 14' 0" | |
| | SP DFL | #3 | 4' 2" | 6' 0" | 6' 4" | 7' 11" | 8' 6" | 10' 2" | 10' 7" | 12' 5" | 13' 4" | 14' 0" | 14' 0" | |
| | | Stud | 4' 2" | 6' 0" | 6' 4" | 7' 11" | 8' 6" | 10' 2" | 10' 7" | 12' 5" | 13' 4" | 14' 0" | 14' 0" | |
| | | Standard | 4' 0" | 5' 3" | 5' 7" | 7' 0" | 7' 6" | 9' 6" | 10' 2" | 11' 0" | 11' 10" | 14' 0" | 14' 0" | |
| | | #1 / #2 | 4' 11" | 8' 4" | 8' 8" | 9' 10" | 10' 3" | 11' 8" | 12' 2" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 4' 8" | 8' 1" | 8' 8" | 9' 8" | 10' 1" | 11' 7" | 12' 1" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 4' 8" | 8' 1" | 8' 6" | 9' 8" | 10' 1" | 11' 7" | 12' 1" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| 16" O.C. | SPF HF | Standard | 4' 8" | 6' 11" | 7' 5" | 9' 3" | 9' 11" | 11' 7" | 12' 1" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #1 | 5' 1" | 8' 5" | 8' 9" | 9' 11" | 10' 4" | 11' 10" | 12' 4" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #2 | 4' 11" | 8' 4" | 8' 8" | 9' 10" | 10' 3" | 11' 8" | 12' 2" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 4' 9" | 7' 4" | 7' 9" | 9' 9" | 10' 2" | 11' 8" | 12' 1" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 4' 9" | 7' 4" | 7' 9" | 9' 9" | 10' 2" | 11' 8" | 12' 1" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Standard | 4' 8" | 6' 5" | 6' 10" | 8' 7" | 9' 2" | 11' 7" | 12' 1" | 13' 6" | 14' 0" | 14' 0" | 14' 0" | |
| | SP DFL | #1 / #2 | 5' 5" | 9' 2" | 9' 6" | 10' 10" | 11' 3" | 11' 8" | 13' 5" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 5' 1" | 9' 0" | 9' 4" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 5' 1" | 9' 0" | 9' 4" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Standard | 5' 1" | 8' 0" | 8' 6" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #1 | 5' 8" | 9' 3" | 9' 8" | 10' 11" | 11' 4" | 13' 0" | 13' 6" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #2 | 5' 5" | 9' 2" | 9' 6" | 10' 10" | 11' 3" | 12' 11" | 13' 5" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| 12" O.C. | SPF HF | #3 | 5' 3" | 8' 5" | 9' 0" | 10' 9" | 11' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 5' 3" | 8' 5" | 9' 0" | 10' 9" | 11' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Standard | 5' 1" | 7' 5" | 7' 11" | 9' 11" | 10' 7" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #1 / #2 | 5' 5" | 9' 2" | 9' 6" | 10' 10" | 11' 3" | 11' 8" | 13' 5" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 5' 1" | 9' 0" | 9' 4" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 5' 1" | 9' 0" | 9' 4" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | SP DFL | Standard | 5' 1" | 8' 0" | 8' 6" | 10' 8" | 11' 1" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #1 | 5' 8" | 9' 3" | 9' 8" | 10' 11" | 11' 4" | 13' 0" | 13' 6" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #2 | 5' 5" | 9' 2" | 9' 6" | 10' 10" | 11' 3" | 12' 11" | 13' 5" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | #3 | 5' 3" | 8' 5" | 9' 0" | 10' 9" | 11' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Stud | 5' 3" | 8' 5" | 9' 0" | 10' 9" | 11' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |
| | | Standard | 5' 1" | 7' 5" | 7' 11" | 9' 11" | 10' 7" | 12' 9" | 13' 3" | 14' 0" | 14' 0" | 14' 0" | 14' 0" | |

Bracing Group Species and Grades:

| Group A: | | | |
|-------------------|----------|------------------|----------|
| Spruce-Pine-Fir | | Hem-Fir | |
| #1 / #2 | Standard | #2 | Stud |
| #3 | Stud | #3 | Standard |
| Douglas Fir-Larch | | Southern Pine*** | |
| #3 | Stud | #3 | Stud |
| Standard | Standard | Standard | Standard |

| Group B: | | | |
|-------------------|----|------------------|----|
| Hem-Fir | | | |
| #1 & Btr | #1 | | |
| Douglas Fir-Larch | | Southern Pine*** | |
| #1 | #2 | #1 | #2 |

1x4 Braces shall be SRB (Stress-Rated Board).

***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach 'L' braces with 10d (0.128"x3.0" min) nails.

* For (1) 'L' brace: space nails at 2' o.c. in 18' end zones and 4' o.c. between zones.
 ** For (2) 'L' braces: space nails at 3' o.c. in 18' end zones and 6' o.c. between zones.

'L' bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes

| Vertical Length | No Splice |
|--------------------|------------|
| Less than 4' 0" | 1X4 or 2X3 |
| Greater than 4' 0" | 3X4 |



+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 450# at each end. Max web total length is 14'.

Vertical length shown in table above.

Connect diagonal at midpoint of vertical web.

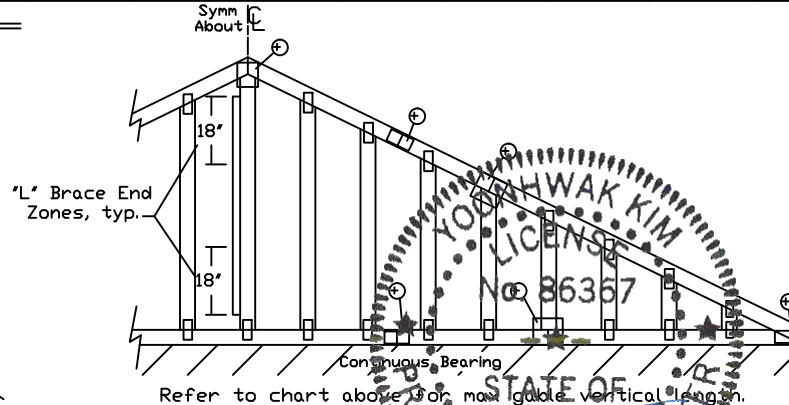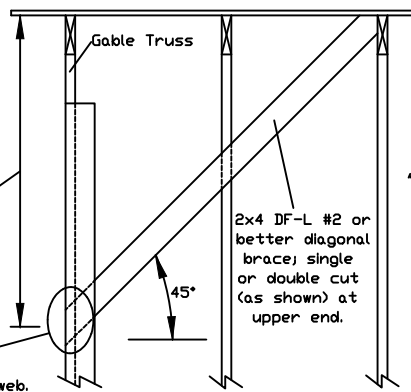

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcaindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
 Suite 242
 Earth City, MO 63045

Yoonhwak Kim, FL PE #86367

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-16-GAB14015

DATE 01/26/2018

DRWG A14015ENC160118

Gable Stud Reinforcement Detail

ASCE 7-16: 140 mph Wind Speed, 30' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Enclosed, Exposure D, Kzt = 1.00



Or: 100 mph wind speed, 30' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

| Max Gable Vertical Length | 2x4 Gable Vertical | | Brace Grade | No Braces | (1) 1x4 'L' Brace * | | (1) 2x4 'L' Brace * | | (2) 2x4 'L' Brace ** | | (1) 2x6 'L' Brace * | | (2) 2x6 'L' Brace ** | |
|---------------------------|--------------------|----------|-------------|-----------|---------------------|---------|---------------------|---------|----------------------|---------|---------------------|---------|----------------------|---------|
| | Spacing | Species | | | Group A | Group B | Group A | Group B | Group A | Group B | Group A | Group B | Group A | Group B |
| | | | | | | | | | | | | | | |
| 24" O.C. | SPF | #1 / #2 | #1 | 4' 1" | 6' 11" | 7' 2" | 8' 2" | 8' 6" | 9' 9" | 10' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" |
| | | | #3 | 3' 10" | 6' 2" | 6' 7" | 8' 1" | 8' 5" | 9' 8" | 10' 0" | 12' 8" | 13' 2" | 14' 0" | 14' 0" |
| | | | Stud | 3' 10" | 6' 2" | 6' 6" | 8' 1" | 8' 5" | 9' 8" | 10' 0" | 12' 8" | 13' 2" | 14' 0" | 14' 0" |
| | | Standard | #1 | 3' 10" | 5' 3" | 5' 7" | 7' 0" | 7' 6" | 9' 6" | 10' 0" | 11' 0" | 11' 10" | 14' 0" | 14' 0" |
| | | | #2 | 4' 2" | 7' 0" | 7' 3" | 8' 3" | 8' 7" | 9' 10" | 10' 3" | 13' 0" | 13' 6" | 14' 0" | 14' 0" |
| | | | #3 | 4' 1" | 6' 11" | 7' 2" | 8' 2" | 8' 6" | 9' 9" | 10' 2" | 12' 10" | 13' 4" | 14' 0" | 14' 0" |
| | SP | DFL | #1 | 4' 0" | 5' 7" | 5' 11" | 7' 5" | 7' 11" | 9' 8" | 10' 1" | 11' 7" | 12' 5" | 14' 0" | 14' 0" |
| | | | Stud | 4' 0" | 5' 7" | 5' 11" | 7' 5" | 7' 11" | 9' 8" | 10' 1" | 11' 7" | 12' 5" | 14' 0" | 14' 0" |
| | | | Standard | 3' 9" | 4' 11" | 5' 13" | 6' 6" | 7' 0" | 8' 10" | 9' 6" | 10' 3" | 13' 11" | 14' 0" | 14' 0" |
| | | Standard | #1 / #2 | 4' 8" | 7' 11" | 8' 3" | 9' 4" | 9' 9" | 11' 2" | 11' 7" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #3 | 4' 5" | 7' 6" | 8' 0" | 9' 3" | 9' 7" | 11' 0" | 11' 6" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Stud | 4' 5" | 7' 6" | 8' 0" | 9' 3" | 9' 7" | 11' 0" | 11' 6" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| 16" O.C. | SPF | #1 | #1 | 4' 10" | 8' 0" | 8' 4" | 9' 6" | 9' 10" | 11' 3" | 11' 9" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #2 | 4' 8" | 7' 11" | 8' 3" | 9' 4" | 9' 9" | 11' 2" | 11' 7" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #3 | 4' 7" | 6' 10" | 7' 3" | 8' 3" | 8' 7" | 10' 10" | 11' 6" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | Standard | #1 | 4' 5" | 6' 0" | 6' 5" | 8' 0" | 8' 7" | 10' 10" | 11' 6" | 12' 7" | 13' 15" | 14' 0" | 14' 0" |
| | | | #2 | 4' 10" | 8' 9" | 9' 1" | 10' 4" | 10' 9" | 12' 2" | 12' 9" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Stud | 4' 10" | 8' 9" | 9' 1" | 10' 4" | 10' 9" | 12' 2" | 12' 9" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| 12" O.C. | SPF | #1 | #1 | 4' 10" | 8' 7" | 8' 11" | 10' 2" | 10' 7" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #2 | 4' 10" | 7' 5" | 7' 11" | 9' 11" | 10' 7" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Stud | 4' 10" | 7' 5" | 7' 11" | 9' 11" | 10' 7" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | Standard | #1 | 5' 4" | 8' 10" | 9' 2" | 10' 5" | 10' 10" | 12' 5" | 12' 11" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #2 | 5' 2" | 8' 9" | 9' 1" | 10' 4" | 10' 9" | 12' 3" | 12' 9" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #3 | 5' 0" | 7' 10" | 8' 4" | 10' 3" | 10' 8" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | SP | DFL | #1 | 5' 0" | 7' 10" | 8' 4" | 10' 3" | 10' 8" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Stud | 5' 0" | 7' 10" | 8' 4" | 10' 3" | 10' 8" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Standard | 4' 10" | 6' 11" | 7' 4" | 9' 3" | 9' 10" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | Standard | #1 / #2 | 4' 10" | 8' 9" | 9' 1" | 10' 4" | 10' 9" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | #3 | 4' 10" | 8' 7" | 8' 11" | 10' 2" | 10' 7" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |
| | | | Stud | 4' 10" | 8' 7" | 8' 11" | 10' 2" | 10' 7" | 12' 2" | 12' 8" | 14' 0" | 14' 0" | 14' 0" | 14' 0" |

Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 525# at each end. Max web total length is 14'.

Vertical length shown in table above.

Connect diagonal at midpoint of vertical web.

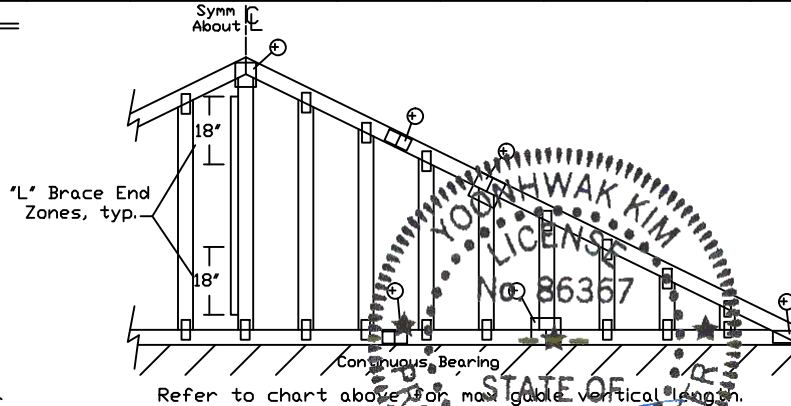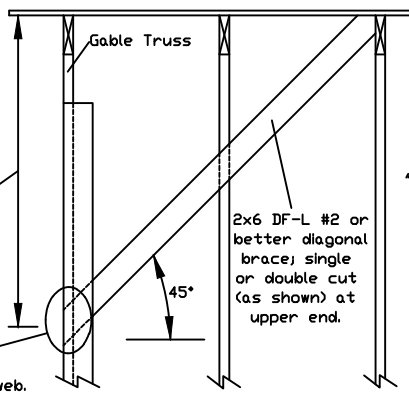

Bracing Group Species and Grades:

| Group A: | | | |
|-------------------|----------|------------------|----------|
| Spruce-Pine-Fir | | Hem-Fir | |
| #1 / #2 | Standard | #2 | Stud |
| #3 | Stud | #3 | Standard |
| Douglas Fir-Larch | | Southern Pine*** | |
| #3 | | #3 | |
| Stud | | Stud | |
| Standard | | Standard | |

| Group B: | | | |
|-------------------|--|------------------|--|
| Hem-Fir | | | |
| #1 & Btr | | | |
| #1 | | | |
| Douglas Fir-Larch | | Southern Pine*** | |
| #1 | | #1 | |
| #2 | | #2 | |

1x4 Braces shall be SRB (Stress-Rated Board).

***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for 100 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach 'L' braces with 10d (0.128"x3.0" min) nails.

* For (1) 'L' brace: space nails at 2' o.c.

in 18' end zones and 4' o.c. between zones.

** For (2) 'L' braces: space nails at 3' o.c.

in 18' end zones and 6' o.c. between zones.

'L' bracing must be a minimum of 80% of web member length.

| Gable Vertical Plate Sizes | |
|---|-----------|
| Vertical Length | No Splice |
| Less than 4' 0" | 2X4 |
| Greater than 4' 0", but less than 11' 6" | 3X4 |
| Greater than 11' 6" | 4X4 |
| + Refer to common truss design for peak, splice, and heel plates. | |

Refer to the Building Designer for conditions not addressed by this detail.



514 Earth City Expressway
Suite 242
Earth City, MO 63045


WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING. FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: www.alpineitw.com; www.tpinet.org; www.sbcindustry.org; www.iccsafe.org

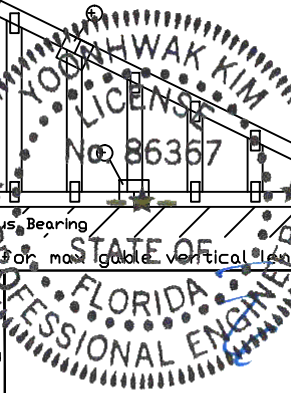

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-16-GAB14030

DATE 01/26/2018

DRWG A14030ENC160118

Yoonhwak Kim, FL PE #86367

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.


| Web Member Size | Specified CLR Restraint | Alternative Reinforcement T- or L- Reinf. | Scab Reinf. |
|-----------------|-------------------------|---|-------------|
| 2x3 or 2x4 | 1 row | 2x4 | 1-2x4 |
| 2x3 or 2x4 | 2 rows | 2x6 | 2-2x4 |
| 2x6 | 1 row | 2x4 | 1-2x6 |
| 2x6 | 2 rows | 2x6 | 2-2x6(X) |
| 2x8 | 1 row | 2x6 | 1-2x8 |
| 2x8 | 2 rows | 2x6 | 2-2x6(X) |

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

(X) Center scab on wide face of web. Apply (1) scab to each face of web.



T-Reinforcement or L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

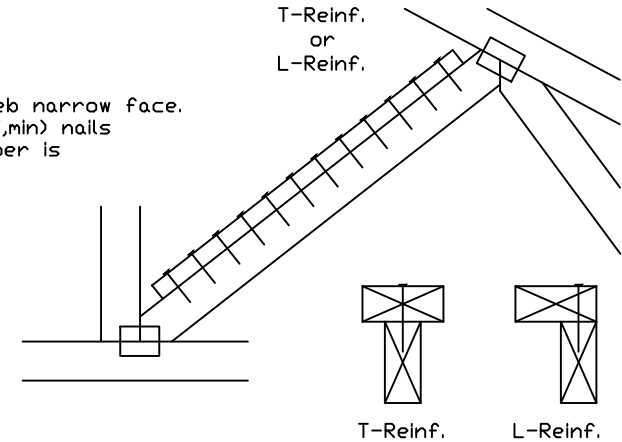

Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

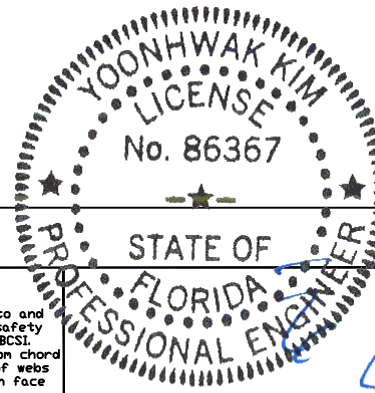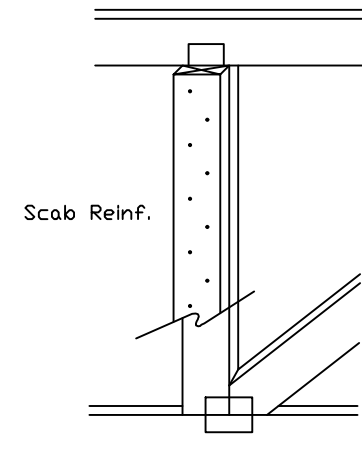

514 Earth City Expressway
Suite 242
Earth City, MO 63045

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING. IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org

| | | | |
|-----------|-----|------|--------------|
| TC LL | PSF | REF | CLR Subst. |
| TC DL | PSF | DATE | 01/02/19 |
| BC DL | PSF | DRWG | BRCLBSUB0119 |
| BC LL | PSF | | |
| TOT. LD. | PSF | | |
| DUR. FAC. | | | |
| SPACING | | | |

Gable Detail For Let-in Verticals

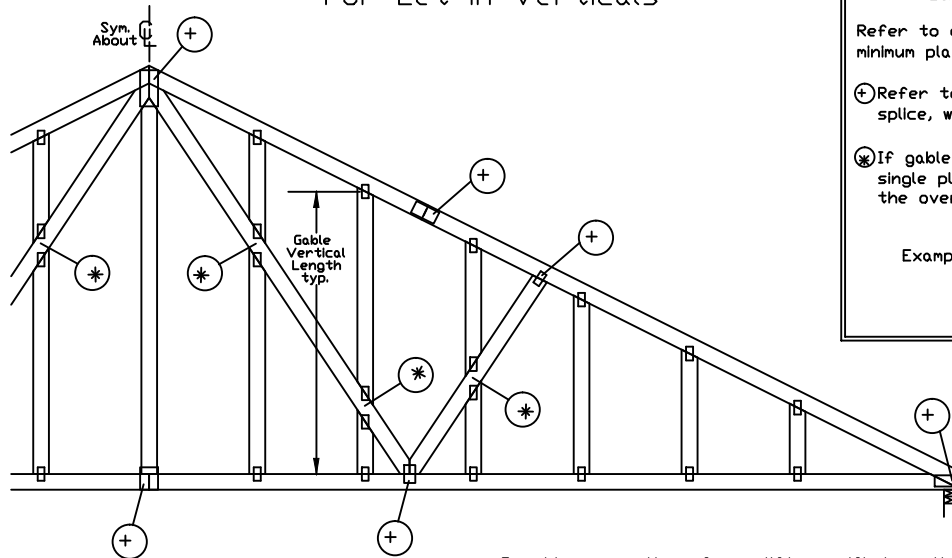


Gable Truss Plate Sizes


Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.

(+) Refer to Engineered truss design for peak, splice, web, and heel plates.

(X) If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.



"T" Reinforcement Attachment Detail

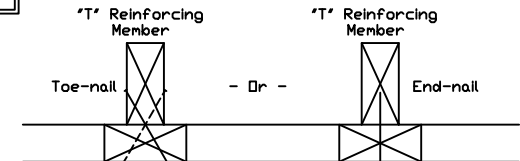

To convert from "L" to "T" reinforcing members, multiply "T" increase by length (based on appropriate Alpine gable detail).

Maximum allowable "T" reinforced gable vertical length is 14' from top to bottom chord.

"T" reinforcing member material must match size, specie, and grade of the "L" reinforcing member.

Web Length Increase w/ "T" Brace

| "T" Reinf. Mbr. Size | "T" Increase |
|----------------------|--------------|
| 2x4 | 30 % |
| 2x6 | 20 % |

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24' o.c. SP #3

"T" Reinforcing Member Size = 2x4

"T" Brace Increase (From Above) = 30% = 1.30

(1) 2x4 "L" Brace Length = 8' 7"

Maximum "T" Reinforced Gable Vertical Length
1.30 x 8' 7" = 11' 2"

Provide connections for uplift specified on the engineered truss design.

Attach each "T" reinforcing member with

End Driven Nails:

10d Common (0.148"x 3", min) Nails at 4' o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148"x 3", min) Toenails at 4' o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.


ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,
A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A10015ENC100118,
A18015ENC100118, A20015ENC100118, A20015END100118, A20015P100118,
A11530ENC100118, A12030ENC100118, A14030ENC100118, A10030ENC100118,
A18030ENC100118, A20030ENC100118, A20030END100118, A20030P100118,
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,
S18015ENC100118, S20015ENC100118, S20015END100118, S20015P100118,
S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,
S18030ENC100118, S20030ENC100118, S20030END100118, S20030P100118

See appropriate Alpine gable detail for maximum unreinforced gable vertical length.

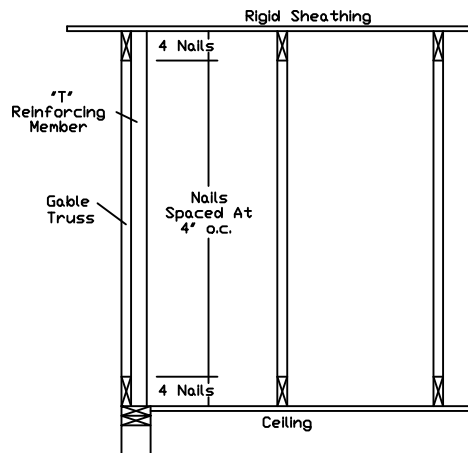

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this Job's general notes page and these web sites: 2/5/2021
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcaindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
Suite 242
Earth City, MO 63045

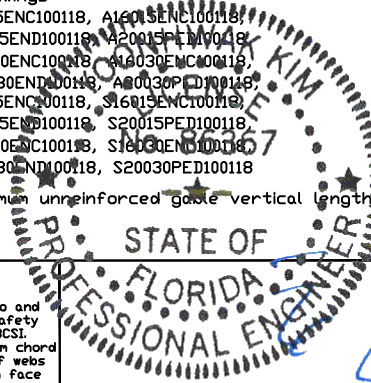

REF LET-IN VERT

DATE 01/02/2018

DRWG GBLLETIN0118

MAX. TOT. LD. 60 PSF

DUR. FAC. ANY

MAX. SPACING 24.0"

Yoonhwak Kim, FL PE #86367

Piggyback Detail - ASCE 7-16: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.
Or 140 mph wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp D, wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Detail A : Purlin Spacing = 24" o.c. or less

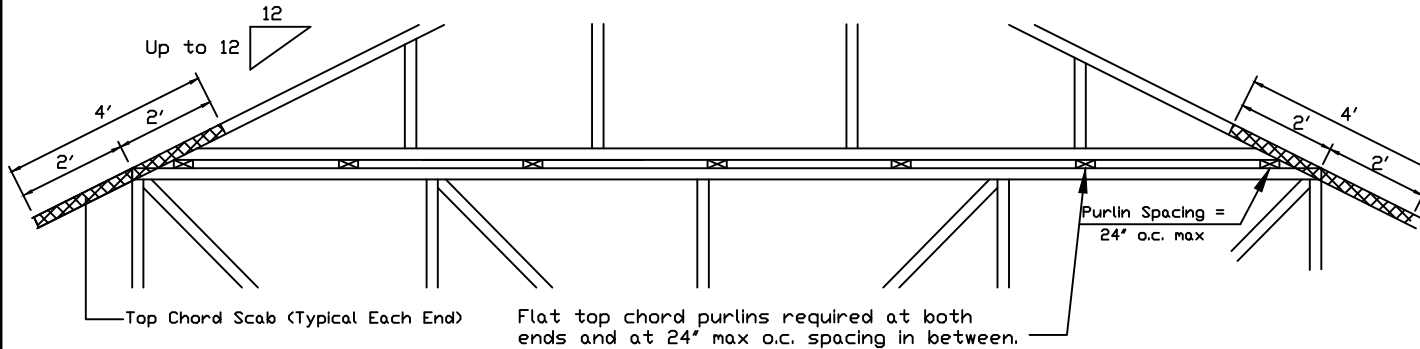


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (8) 0.120x1.375 nails, (4) into cap TC & (4) into base truss TC or (1) 28PB wave piggyback plate plated to the piggyback truss TC and attached to the base truss TC with (4) 0.120x1.375 nails. Note: Nailing thru holes of wave plate is acceptable.

Detail B : Purlin Spacing > 24" o.c.

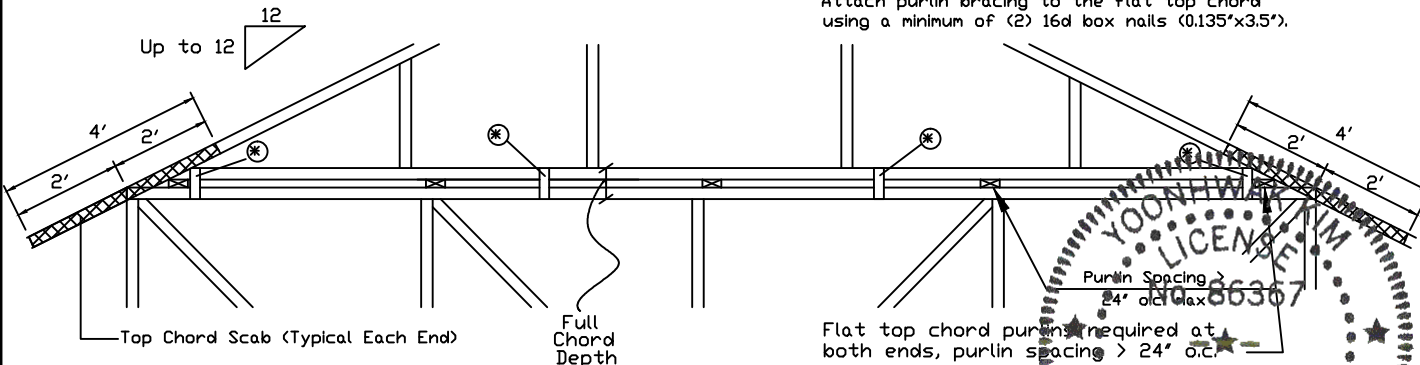

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

* In addition, provide connection with one of the following methods:

| |
|---|
| Trulox Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120x1.375 nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces. |
| APA Rated Gusset 8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces. |
| 2x4 Vertical Scabs 2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces. |
| 28PB Wave Piggyback Plate One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120x1.375 nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces. |

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24' o.c. max. and use Detail A.

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: www.alpineitw.com, www.tpinet.org, www.sbcindustry.org, www.iccsafe.org



13723 Riverport Drive
Suite 200
Maryland Heights, MO 63043

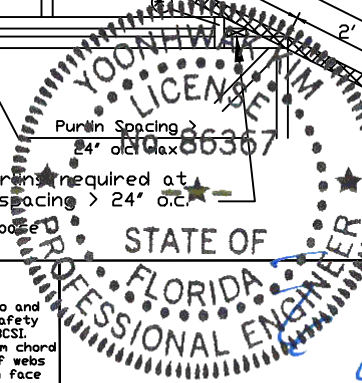

Yoonhwak Kim, FL PE #86367

REF PIGGYBACK

DATE 01/02/2018

DRWG PB160160118

SPACING

24.0"

NAIL SPACING DETAIL

MINIMUM SPACING FOR SINGLE BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

BLOCK LOCATION, SIZE, LENGTH, GRADE AND TOTAL NUMBER AND TYPE OF NAILS ARE TO BE SPECIFIED ON SEALED DESIGN REFERENCING THIS DETAIL.

LOAD PERPENDICULAR TO GRAIN

A - EDGE DISTANCE AND SPACING BETWEEN STAGGERED ROWS OF NAILS (6 NAIL DIAMETERS)

B - SPACING OF NAILS IN A ROW (12 NAIL DIAMETERS)

C - END DISTANCE (15 NAIL DIAMETERS)

LOAD PARALLEL TO GRAIN

A - EDGE DISTANCE (6 NAIL DIAMETERS)


C - SPACING OF NAILS IN A ROW AND END DISTANCE (15 NAIL DIAMETERS)

D - SPACING BETWEEN STAGGERED ROWS OF NAILS (7 1/2 NAIL DIAMETERS)

IF NAIL HOLES ARE PREBORED, SOME SPACING MAY BE REDUCED BY THE AMOUNTS GIVEN BELOW:


* SPACING MAY BE REDUCED BY 50%

** SPACING MAY BE REDUCED BY 33%

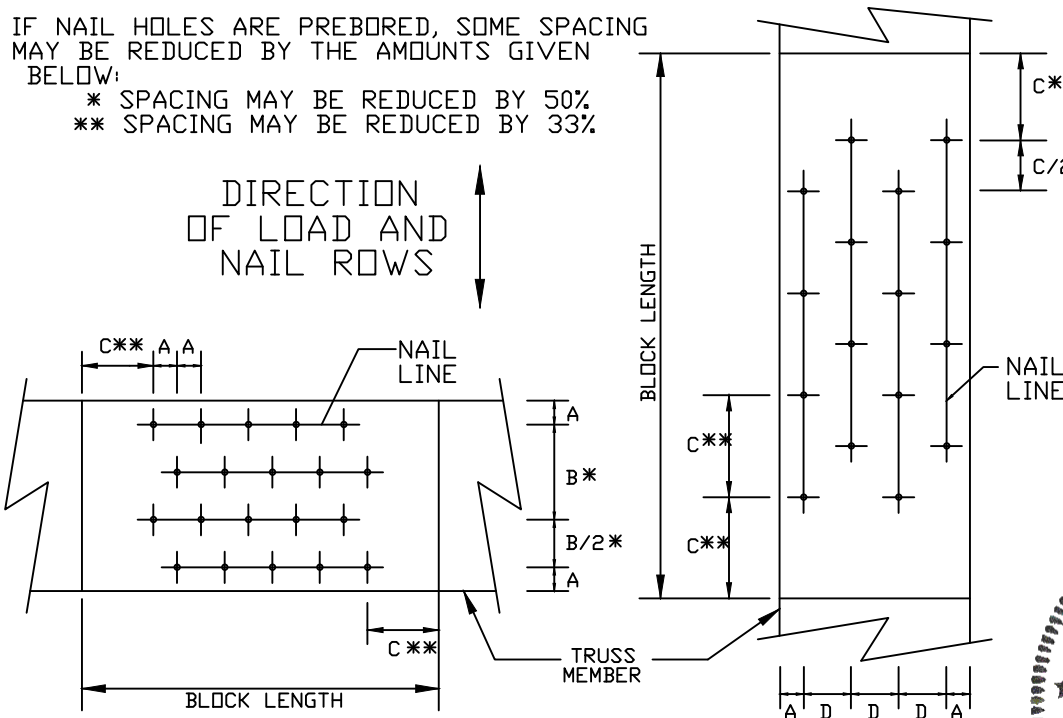

MINIMUM NAIL SPACING DISTANCES

| NAIL TYPE | DISTANCES | | | |
|--------------------------------|-----------|--------|--------|--------|
| | A | B* | C** | D |
| 8d BOX (0.113"X 2.5",MIN) | 3/4" | 1 3/8" | 1 3/4" | 7/8" |
| 10d BOX (0.128"X 3",MIN) | 7/8" | 1 5/8" | 2" | 1" |
| 12d BOX (0.128"X 3.25",MIN) | 7/8" | 1 5/8" | 2" | 1" |
| 16d BOX (0.135"X 3.5",MIN) | 7/8" | 1 5/8" | 2 1/8" | 1 1/8" |
| 20d BOX (0.148"X 4",MIN) | 1" | 1 7/8" | 2 1/4" | 1 1/8" |
| 8d COMMON (0.131"X 2.5",MIN) | 7/8" | 1 5/8" | 2" | 1" |
| 10d COMMON (0.148"X 3",MIN) | 1" | 1 7/8" | 2 1/4" | 1 1/8" |
| 12d COMMON (0.148"X 3.25",MIN) | 1" | 1 7/8" | 2 1/4" | 1 1/8" |
| 16d COMMON (0.162"X 3.5",MIN) | 1" | 2" | 2 1/2" | 1 1/4" |
| GUN (0.120"X 2.5",MIN) | 3/4" | 1 1/2" | 1 7/8" | 1" |
| GUN (0.131"X 2.5",MIN) | 7/8" | 1 5/8" | 2" | 1" |
| GUN (0.120"X 3",MIN) | 3/4" | 1 1/2" | 1 7/8" | 1" |
| GUN (0.131"X 3",MIN) | 7/8" | 1 5/8" | 2" | 1" |

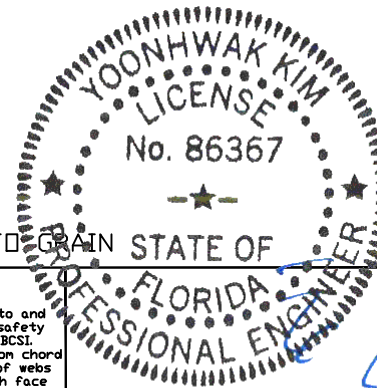

LOAD APPLIED PERPENDICULAR TO GRAIN

LOAD APPLIED PARALLEL TO GRAIN

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: 10/25/2021
 ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
 Suite 242
 Earth City, MO 63045

REF NAIL SPACE
 DATE 10/01/14
 DRWG CNNAILSP1014

Yoonhwak Kim, FL PE #86367