


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

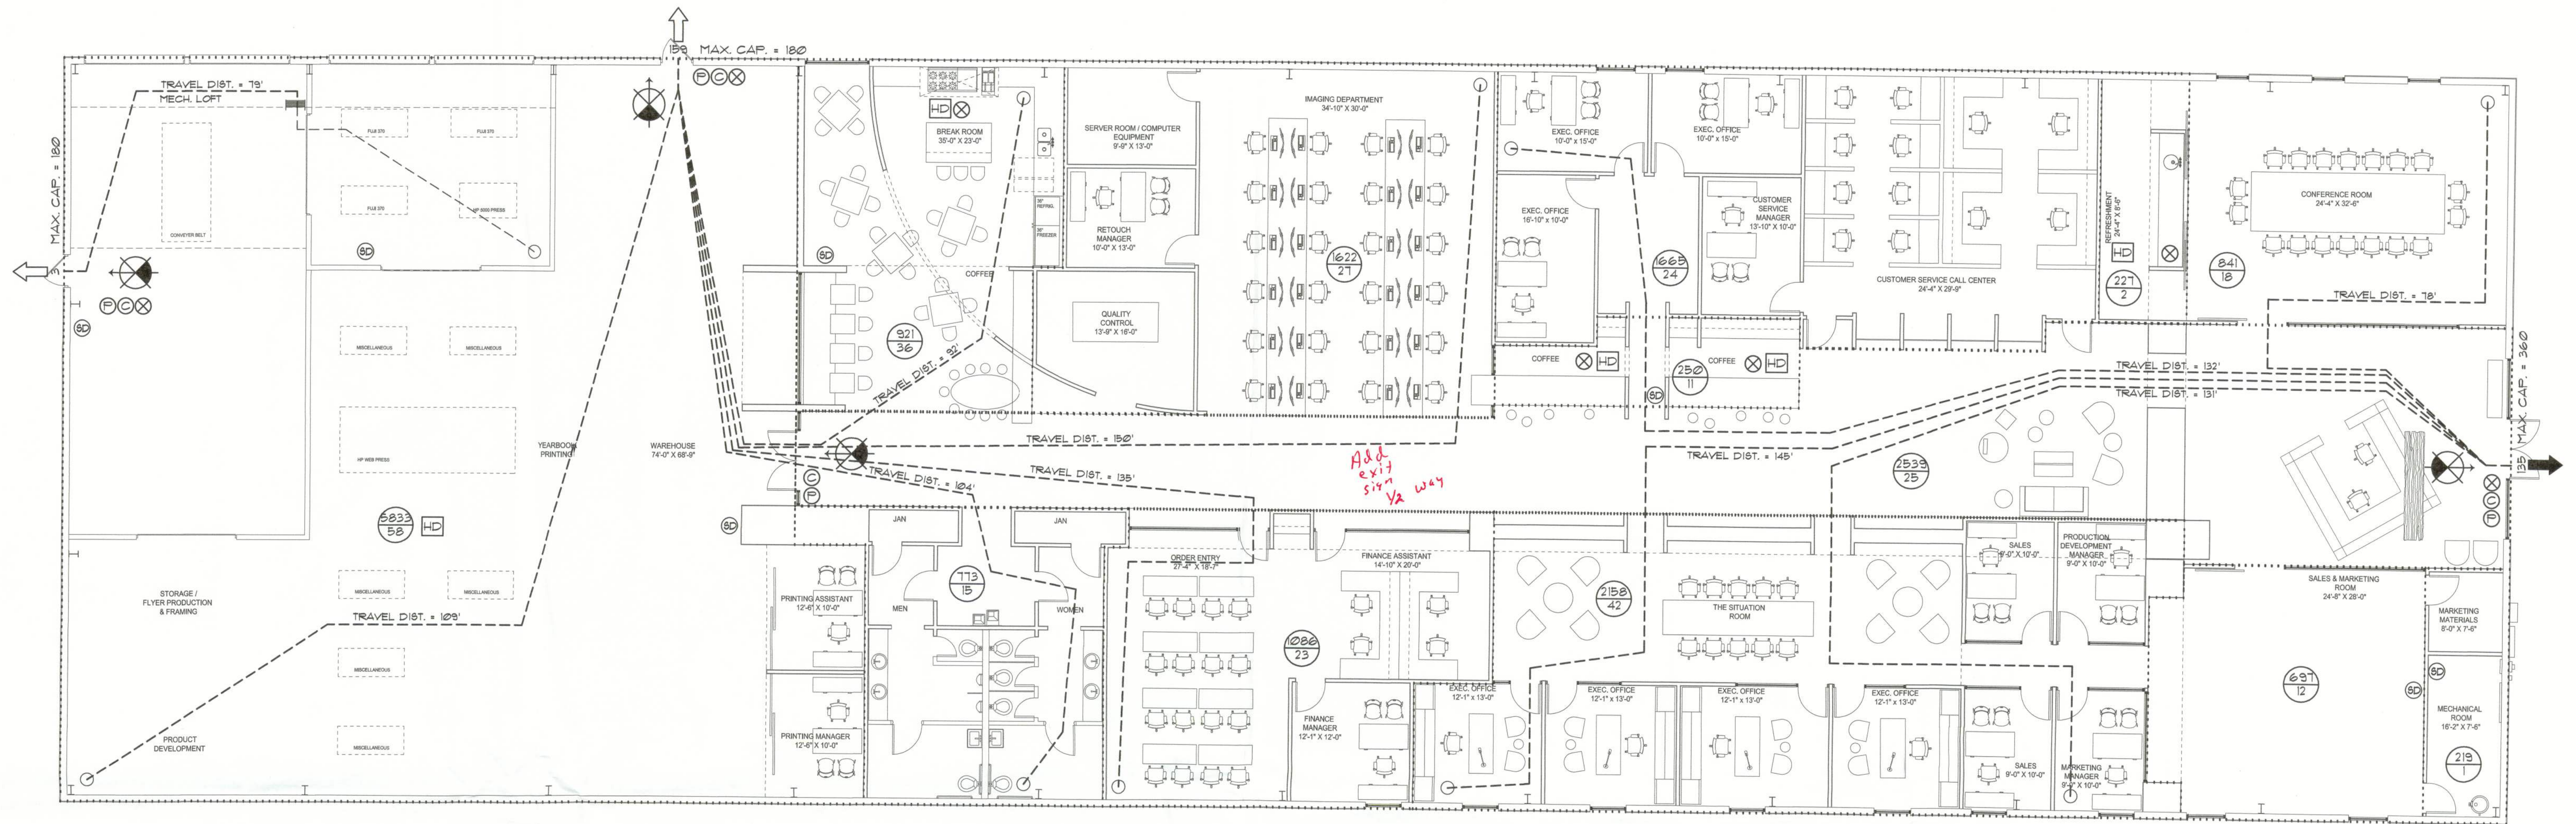

FIRE EXTINGUISHER CABINETS

PROVIDE 10 LB ABC FIRE EXTINGUISHERS IN ALUM. SEMI-RECESSED WALL CABINETS W/ BREAKAWAY GLASS FRONT PANEL. LOCATE 1 CABINET AT EACH EXIT DOOR OF EACH SPACE, WITHIN 10 FEET OF THE DOOR. ANY OTHER LOCATIONS SHALL BE AS DIRECTED BY THE FIRE MARSHAL AND/OR OWNER.

EXIT ACCESS TRAVEL DISTANCE PER FBC 105, TABLE 105.1

OCCUPANCY - BUSINESS:
500 FT. (W/O SPRINKLER SYSTEM)
250 FT. (W/SPRINKLER SYSTEM)

OCCUPANCY LOAD - BUSINESS

AREA	TOTAL SF.	ALLOWABLE	TOTAL OCCUP.
RECEPTION/PASSAGEWAY	2535.49	1/100	25
CONFERENCE	842.88	FURN. PLAN	18 - NON-CONCURRENT
SALES DISPLAY AREA	691.79	1/60	12
BUSINESS AREAS	6532.41	FURN. PLAN	116
REFRESHMENT AREAS	1298.11	FURN. PLAN	49 - NON-CONCURRENT
RESTROOMS	113.18	1/50	15
PRODUCTION AREA	5833.45	1/100	58
TECH. EQ. / STORAGE	215.46	1/300	1
MECH. EQ. LOFT	164.32	1/300	3
BUILDING TOTAL	18898.75		230 - NON-CONCURRENT 291 - CONCURRENT

NOTE!

EMERGENCY LIGHTING AND EXIT SIGNS SHALL BE PROVIDED AS DIRECTED BY THE FIRE MARSHAL, AND SHALL BE WIRED PER NEC 1200-12F.

LEGEND

- EXIT LIGHT - ARROW REPRESENTS DIRECTION OF EXIT
- HD HEAT DETECTOR - COORDINATE WITH ELECTRICAL DWGS
- SD SMOKE DETECTOR - 120V HARD WIRED INTERLOCKED TOGETHER
- WALL HUNG "ABC" FIRE EXTINGUISHER
- DOOR / CLOSER FOR EXITING OR RATING REASONS
- PANIC DEVICE
- ROOM SQUARE FOOTAGE
- ROOM OCCUPANCY LOAD
- PRIMARY EGRESS W/EXIT CAPACITY
- SECONDARY EGRESS


NOTE!

SMOKE DETECTORS SHALL BE MOUNTED NOT LESS THAN 8" ABOVE FINISHED FLOOR AND SHALL BE THE IONIZATION TYPE, INTERLOCKED TOGETHER, POWERED FROM EACH STORE PANEL W/BATTERY BACKUP.

LIFE SAFETY PLAN

SCALE: 1/8" = 1'-0"

OCCUPANCY: 221 OCCUPANTS MAXIMUM TRAVEL DISTANCE = 150'

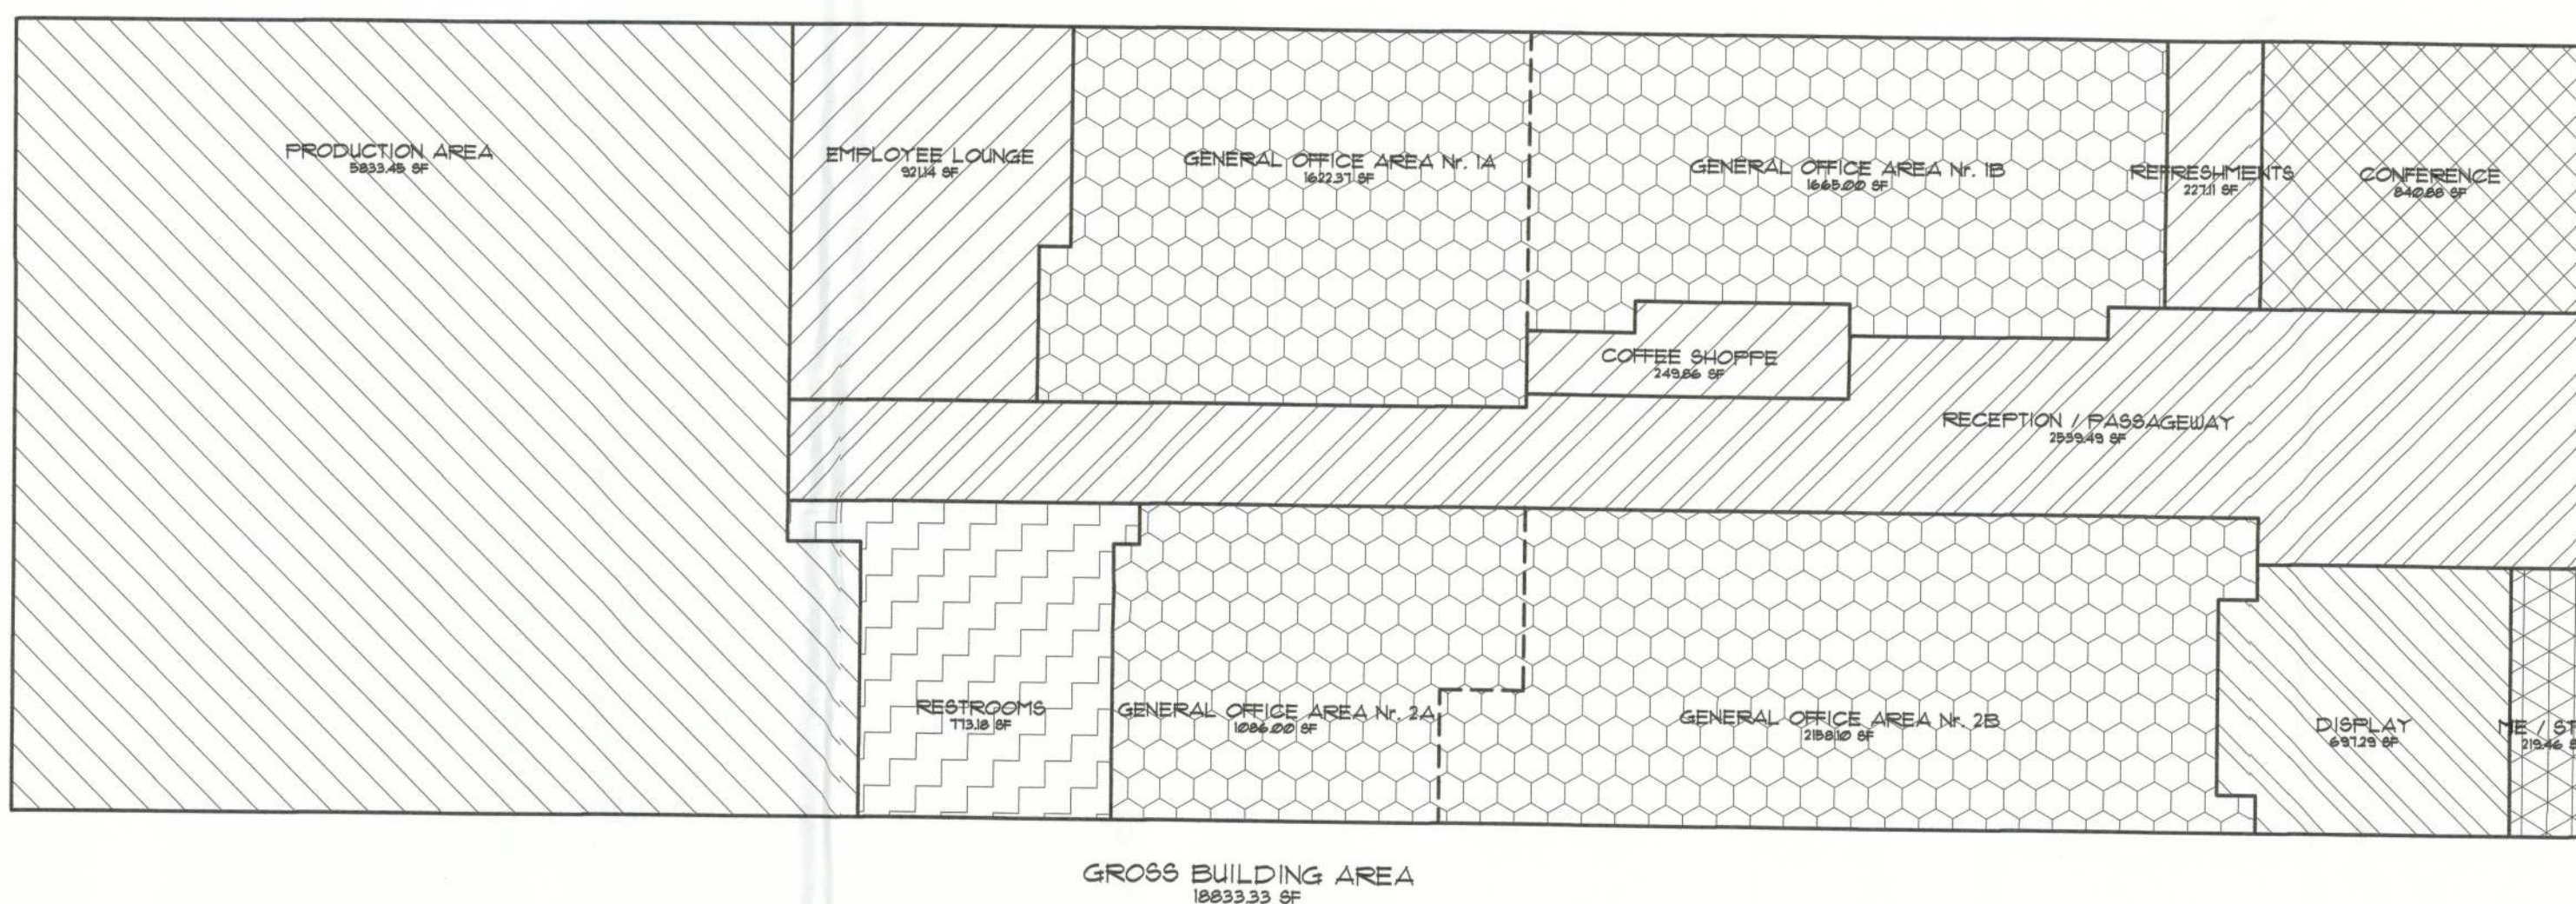


RECEPTION / PASSAGEWAY 2535.49 SF	EMPLOYEE LOUNGE 921.14 SF COFFEE SHOPPE 245.86 SF REFRESHMENTS 2211 SF	GENERAL OFFICE AREA N. 1 3381.37 SF GENERAL OFFICE AREA N. 2 3144.48 SF
CONFERENCE 842.88 SF	PRODUCTION AREA 5833.45 SF	ME / STOR 215.46 SF
DISPLAY 691.79 SF	RESTROOMS 113.18 SF	GROSS BUILDING AREA 18833.33 SF

BUILDING OCCUPANCY PLAN

SCALE: 1/16" = 1'-0"

OCCUPANCY: XXX OCCUPANTS

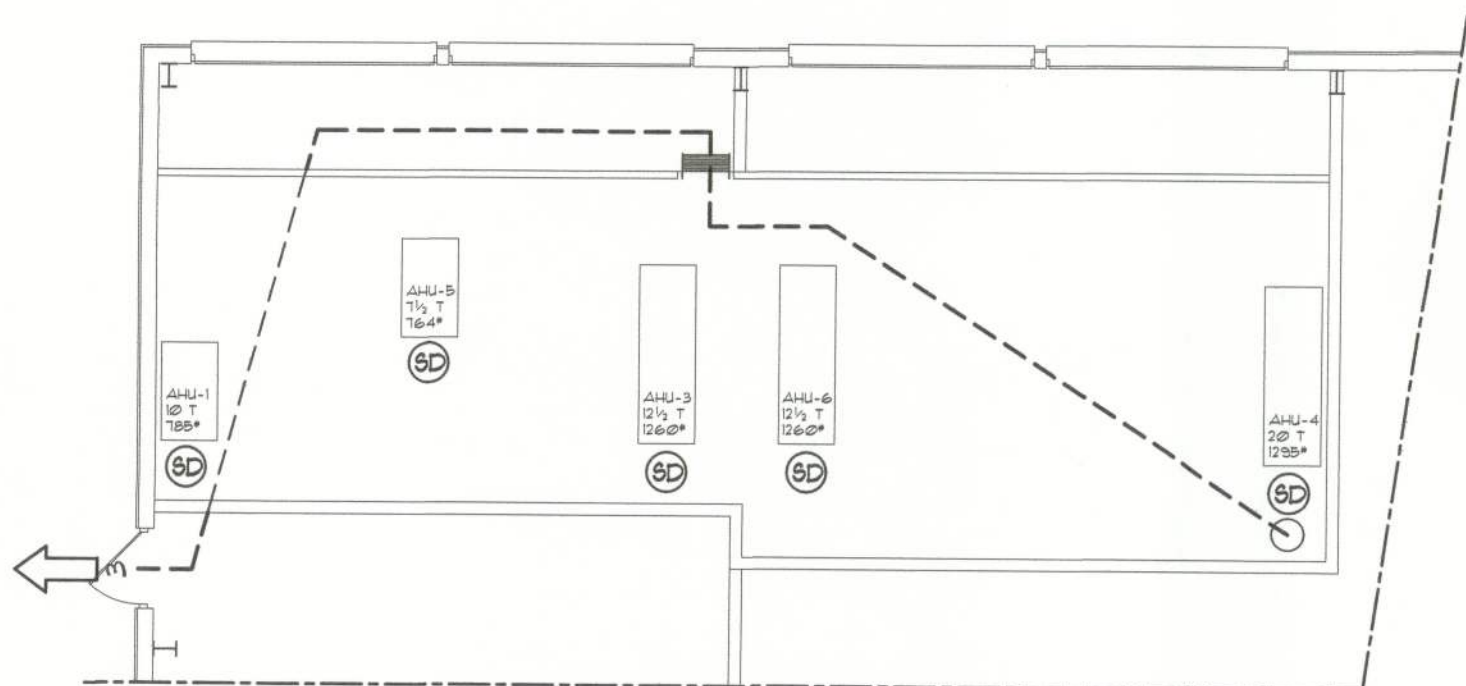


MECH. EQUIP. LOFT PLAN
SCALE: 1/8" = 1'-0"

NOTE!

SMOKE DETECTORS SHALL BE MOUNTED WITHIN RETURN AIR DUCTWORK AND POSITIONED IN THE AIR STREAM - ACTIVATION OF ANY ONE SMOKE DETECTOR SHUTS-DOWN ALL AHUS

WILLIAM MYERS
DESIGN
P.O. BOX 1513
LAKE CITY, FL 32056
(386) 758-8406
will@willmyers.net

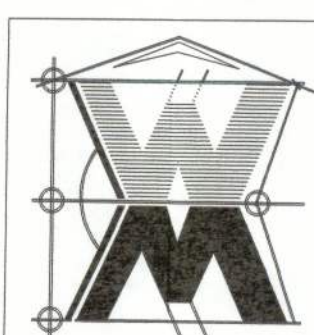

JOINT VENTURE WITH

NICHOLAS PAUL
GEISLER
ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Lake City, FL 32055
386-365-4355

Celebrating
39 Years of Service
1972 - 2011
N.P. Geisler, Architect
AR0007005

AR0007005

TENANT IMPROVEMENTS for:
cady&cady.studios
LAKE CITY, COLUMBIA COUNTY, FLORIDA

art from the heart

REVISIONS
20 JUL 2011
29 JUL 2011
22 SEP 2011

JOB NUMBER
2K1124
DATE:
06 JUL 2011

SHEET NUMBER
LSP.1
OF 1 SHEETS