

ULTIMATE & NOMINAL			
WIND SPEEDS			
ULTIMATE NOMINAL			
120	93		
130	101		
140	108		
150	116		
155	120		
160	124		

DESIGN CRITERIA:

FLORIDA BUILDING CODE 2020 7TH ED. **DESIGN LOADS PER ASCE 7-16 DESIGN SPEED - 130 MPH ROOF LIVE LOAD - 12.5 PSF DEAD LOAD - 2.5 PSF** WIND RISK CATEGORY - I **EXPOSURE CATEGORY - B IMPORTANCE FACTOR - 1.0** INTERNAL WIND PRESSURE - +/- 0.18 PSI

POLE BARN SPECIFICATIONS

GABLE WIDTH : <u>50'</u> **BUILDING LENGTH**: 96'

EAVE HEIGHT : <u>14'</u> POLE SPACING: 12' **ROOF PITCH** : <u>3:12</u> WALLS: OPEN

FLOOR : DIRT

ROOF METAL: 29 GA. SIDE METAL : NONE **POST SIZE : 8"X8"**

POST FOOTING SIZE : 24"X48"

CONCRETE : <u>3,000 PSI</u>

WIND EXPOSURE CATEGORY D

MAIN BUILDING DIMENSIONS D-1		
BARN	6"X6"	8"X8"
WIDTH (FT)	POST	POST
50	-	48'-8"
40	39'-1"	38'-8"
38	37'-1"	36'-8"
36	35'-1"	34'-8"
34	33'-1"	32'-8"
32	31'-1"	30'-8"
30	29'-1"	28'-8"
28	27'-1"	26'-8"
26	25'-1"	24'-8"
24	23'-1"	22'-8"
22	21'-1"	20'-8"
20	19'-1"	18'-8"
18	17'-1"	16'-8"
16	15'-1"	14'-8"
14	13'-1"	12'-8"
12	11'-1"	10'-8"

MAIN	POST F	HEIGHT	(D-3)	
SIZE C	CIRCLE	D OR L	ESS	OTHER
10'	12'	14'	16'	20'

POST	SPACING [<u>D-2</u> (FT)
8	<u> </u>	12

	POST SIZE	•
6"X6"	8"X8"	□ 10"X10"




POST FOOTING SIZE F-1 18" DIA. X 48" DEEP

F-2 24" DIA. X 48" DEEP

	ROOF	PITCH	
3/12	4/14	5/12	6/12

METAL ROOF 26 GA (29 GA)

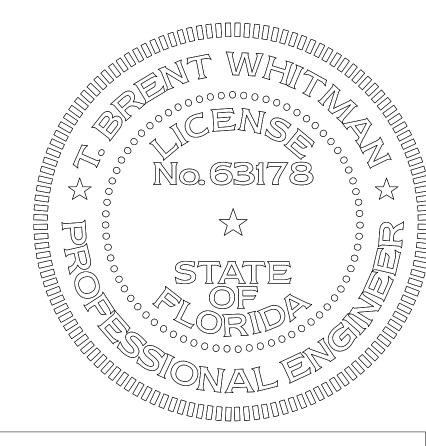




TBW DVD TBW TBW S2231


MADISON ENGINEERING, LLC CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING

CENTRAL MINISTRIES (50X96)


VALID ONLY WITH DATED ORIGINAL SIGNATURE AND INK OR EMBOSSED SEAL

T. BRENT WHITMAN, P.E. FL. P.E. #63178 / GA. P.E. #031609 SHEET NO.

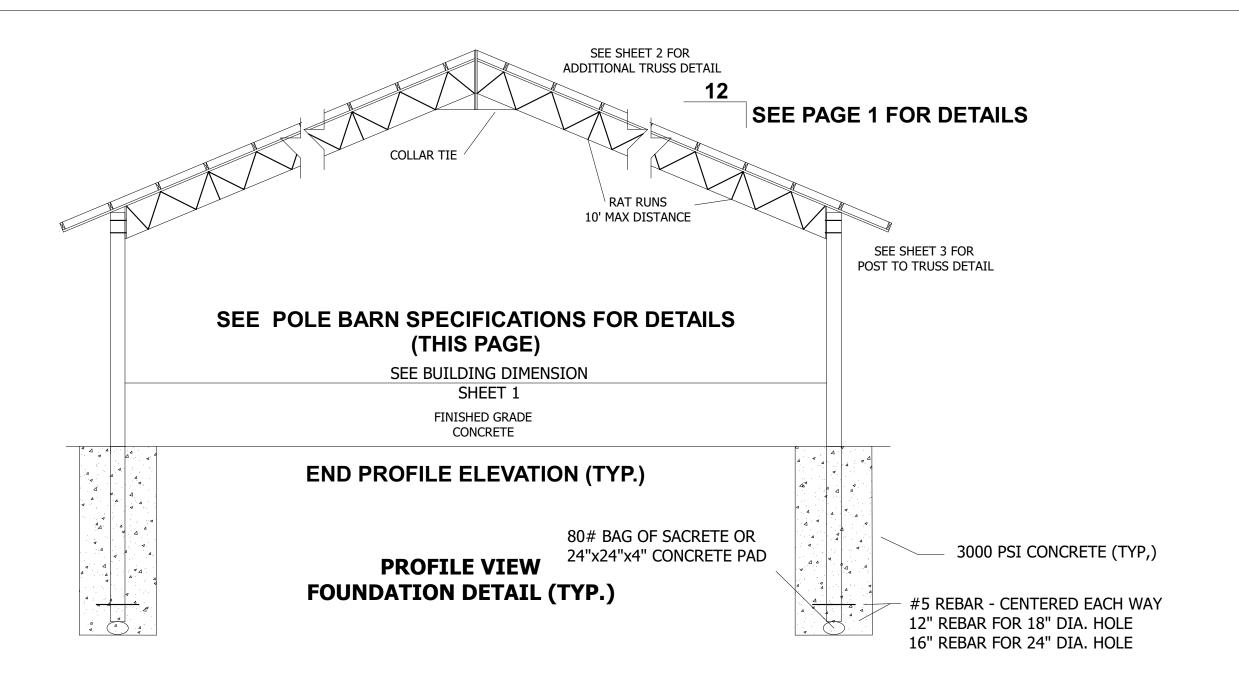

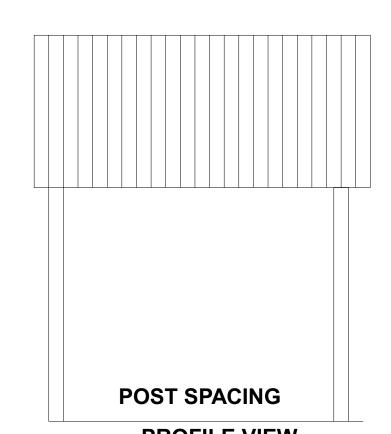

PROFILE VIEW
SIDE ELEVATION (TYP.)
SEE POLE BARN SPECTIFICATIONS FOR DETAILS
(PG 1)

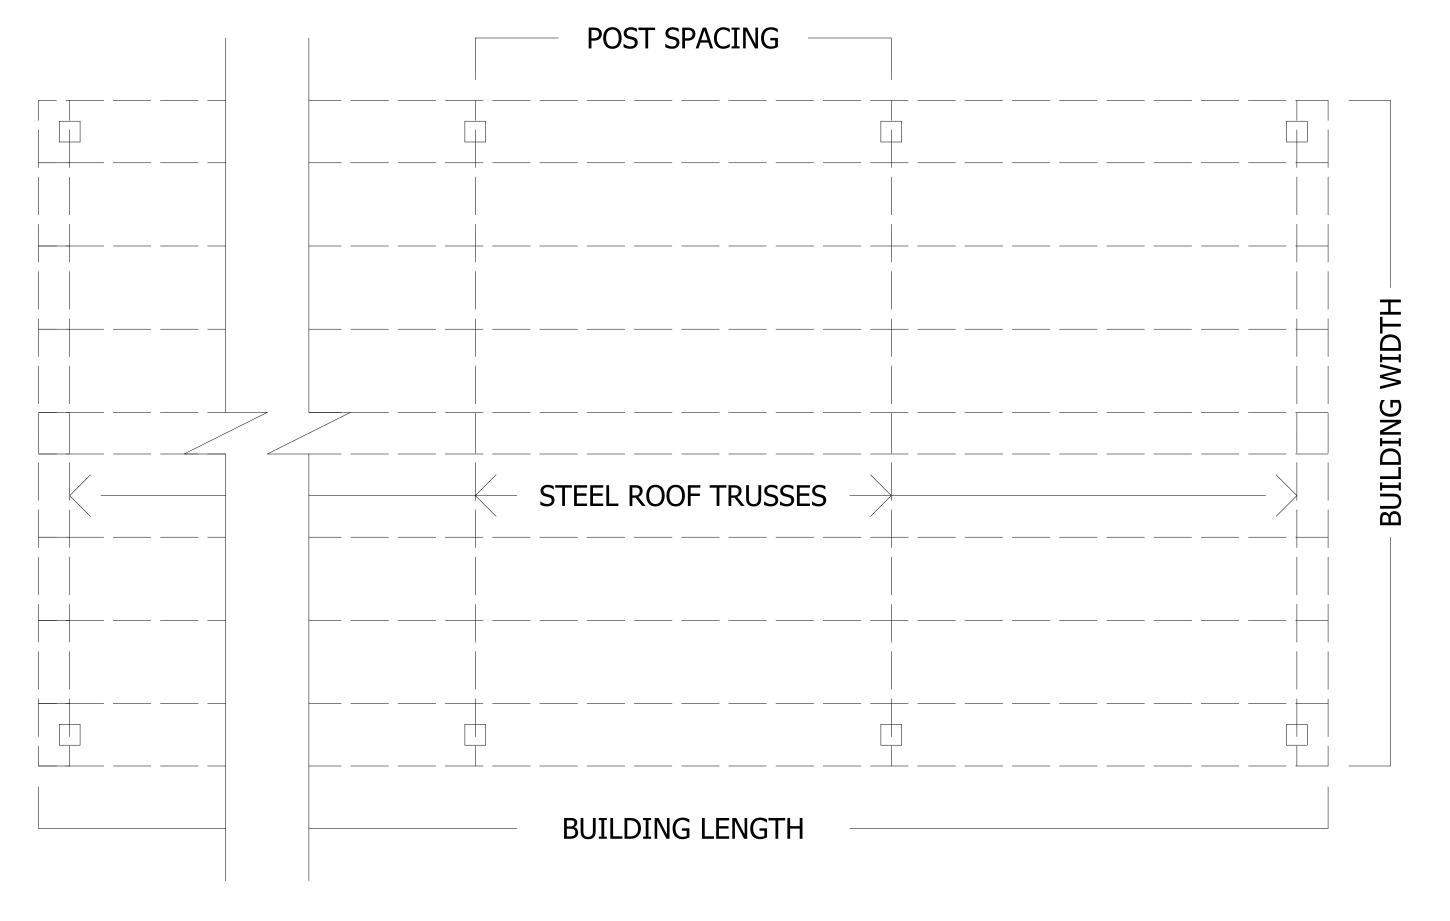

BARN PLAN VIEW (TYP.)

NOTES:

- 1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
- 2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
- 3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
- 4. ALL WELD PER AWS STANDARDS.
- 5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
- 7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
- 8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
- 9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 25 FEET.
- 10. CONCRETE WORK SHALL CONFORM TO 'BUILDING CODE REQUIRMENTS FOR REINFORCED CONCRETE' (ACI-318).
- 11. ALL CONCRETE SHALL BE 3000 PSI MIN. W/ WWF OR FIBER





 ECKED
 TBW

 PROVED
 TBW

 B NO.: 35223102

ENGINEERING, LLC

L & ENVIRONMENTAL ENGINEERING

269 NE Ridge Loop
Addison, Florida 32340
Phone 850.973.7864



IST CENTRAL MINISTRIES (50X96)

VALID ONLY WITH DATED ORIGINAL SIGNATURE AND INK OR EMBOSSED SEAL

T. BRENT WHITMAN, P.E.


SHEET NO.


NOTES: TRUSS CROSS-SECTION

- 1- MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES SHALL BE TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS
- 5- ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6- BOL TS SHALL BE ASTM A325. w/ NUTS & WASHERS. TYP)
- 7- WELD STRENGTH 70 KSI MIN:
- 8- ALL POST SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN
- 11- MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
- 12-THE DESIGNER DISCLAMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBIL TY OR EXERCISES NO CONTROL WITH REGUARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

ITEM			
NO.	<u>DESCRIP</u>	DESCRIPTION	
A1	TOP CHORD	LL 2 X 2 X 3/16*	ASTM 572
A2	BOTTOM CHORD	LL 2 X 2 X 3/16*	ASTM 572
A3	VERTICAL CHORD	LL 3 X 2 X 3/16*	ASTM 572
A4	VERTICAL CHORD	L 1 1/2 X 1 1/2 X 3/16	ASTM 572
A5	TIE	L 2 X 2 X 3/16	ASTM 572
A6	TIE	L 2 X 2 X 3/16	ASTM 572
W1	WEB	L 1-1/4 X 1-1/4 X 3/16	ASTM 572
W2	WEB	L 1-1/4 X 1-1/4 X 3/16	ASTM 572
B1	BASE	LL 2 X 2 X 3/16*	ASTM 572

- 1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
- 2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
- 3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
- 4. ALL WELD PER AWS STANDARDS.
- 5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
- 7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
- 8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
- 9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 50 FEET.
- 10. WELDING ELECTRODES SHALL BE E70XX
- 11. ALL WELDS SHALL BE IN ACCORDANCE WITH AWS REQUIRMENTS.
- 12. ALL POST SHALL BE #2 DENSE PRESSURE TREATED.

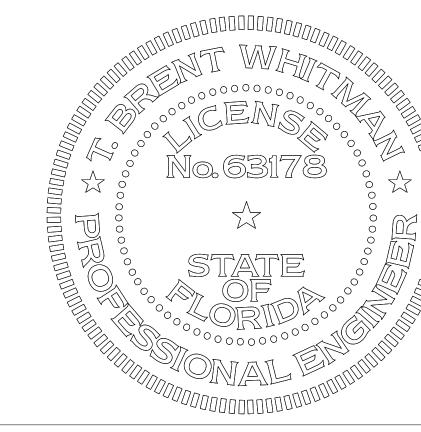

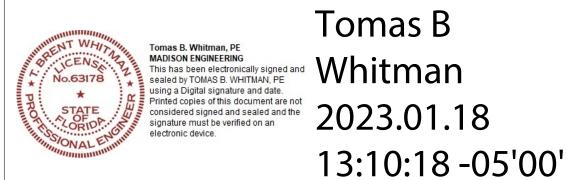

CHECKED TBW
APPROVED TBW

MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING
269 NE Ridge Loop
Madison, Florida 32340
Phone 850.973.7864



©COPYRIGHT 2022 ME

VALID ONLY WITH DATED ORIGINAL SIGNATURE AND INK OR EMBOSSED SEAL

T. BRENT WHITMAN, P.E.
FL. P.E. #63178 / GA. P.E. #0316
SHEET NO.

3