

REVISIONS	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

REQUIRED ROOF VENTILATION:
AS PER FLORIDA BUILDING CODE 2309.7

- RIDGE VENT**
MIN. 50% TOTAL VENT AREA
LOCATED IN THE UPPER PORTION OF ATTIC (MIN. 3" ABOVE EAVE)
2304 S.F. / 300 x 50% = 4 S.F. RIDGE VENT AREA REQUIRED
36 FEET OF RIDGE VENT REQUIRED
- SOFFIT VENT**
2304 S.F. / 300 x 50% = 4 S.F. SOFFIT VENT AREA REQUIRED
133 FEET OF SOFFIT VENT REQUIRED
- BUILDER MUST VERIFY THE FOLLOWING MINIMUM NET FREE VENT AREAS:**
1. RIDGE VENTS = 16 IN²/FT (.11 FT²/FT)
 2. OFF-RIDGE VENTS = .70 FT² PER 4' UNIT
 3. SOFFIT VENTS = 4.3 IN²/FT (.03 FT²/FT)



LEFT ELEVATION
SCALE: 1/4" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"



RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

WINDLOAD ENGINEER: Mark Disosway,
P.E. No. 53915, POB 888, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first its express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that its applicable portions of the plan, relating to wind engineering comply with section R301.2, Florida building code residential 2004, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY
P.E. 53915
Mark Disosway
16/07
SEAL

MARTIN HOME BUILDERS

SPEC HOUSE

ADDRESS
429 SW Morning glory Dr.
Rolling Meadows Lot #15
Columbia County F., U.S.A.

Mark Disosway P.E.
P.O. Box 688
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
May 16, 2007

DRAWN BY: Ben Sparks	STRUCTURAL BY: Ben Sparks
-------------------------	------------------------------

FINALS DATE: 15 / May / 07	
-------------------------------	--


JOB NUMBER:
70409

DRAWING NUMBER
A-1

OF 6 SHEETS


REVISIONS

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

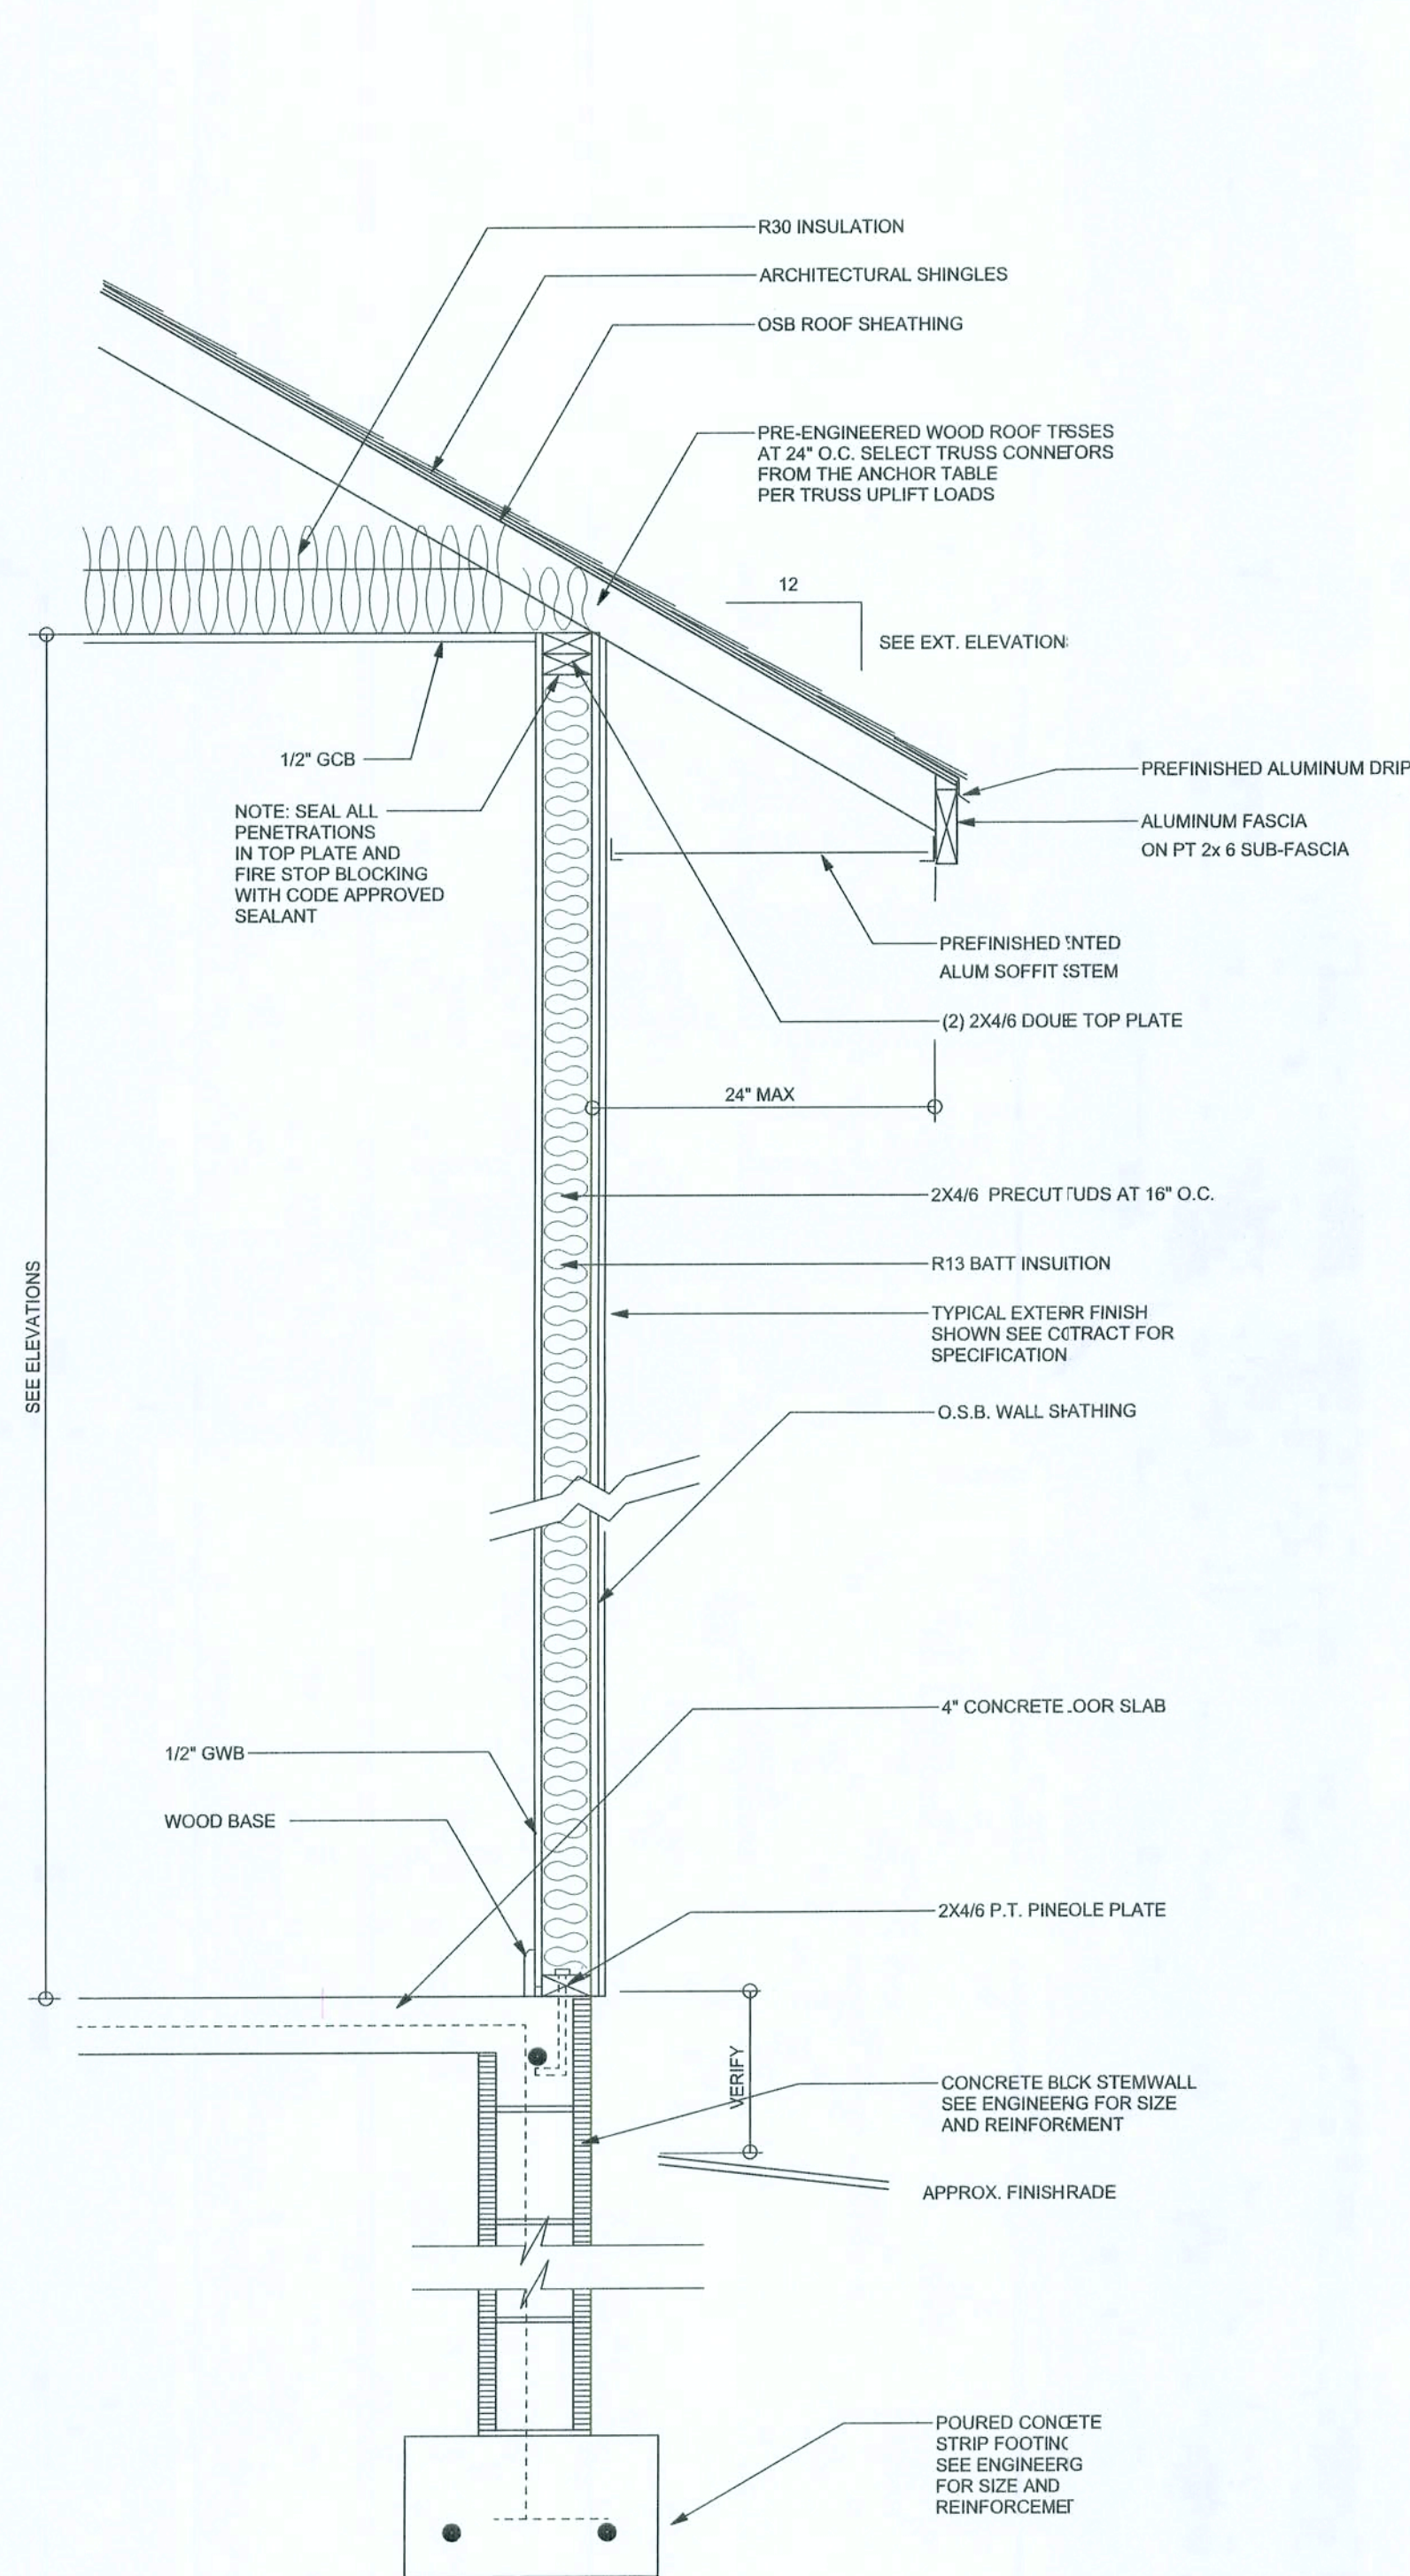

TYPICAL DESIGN WALL SECTION NON - STRUCTURAL DATA

SCALE: 1\"/>

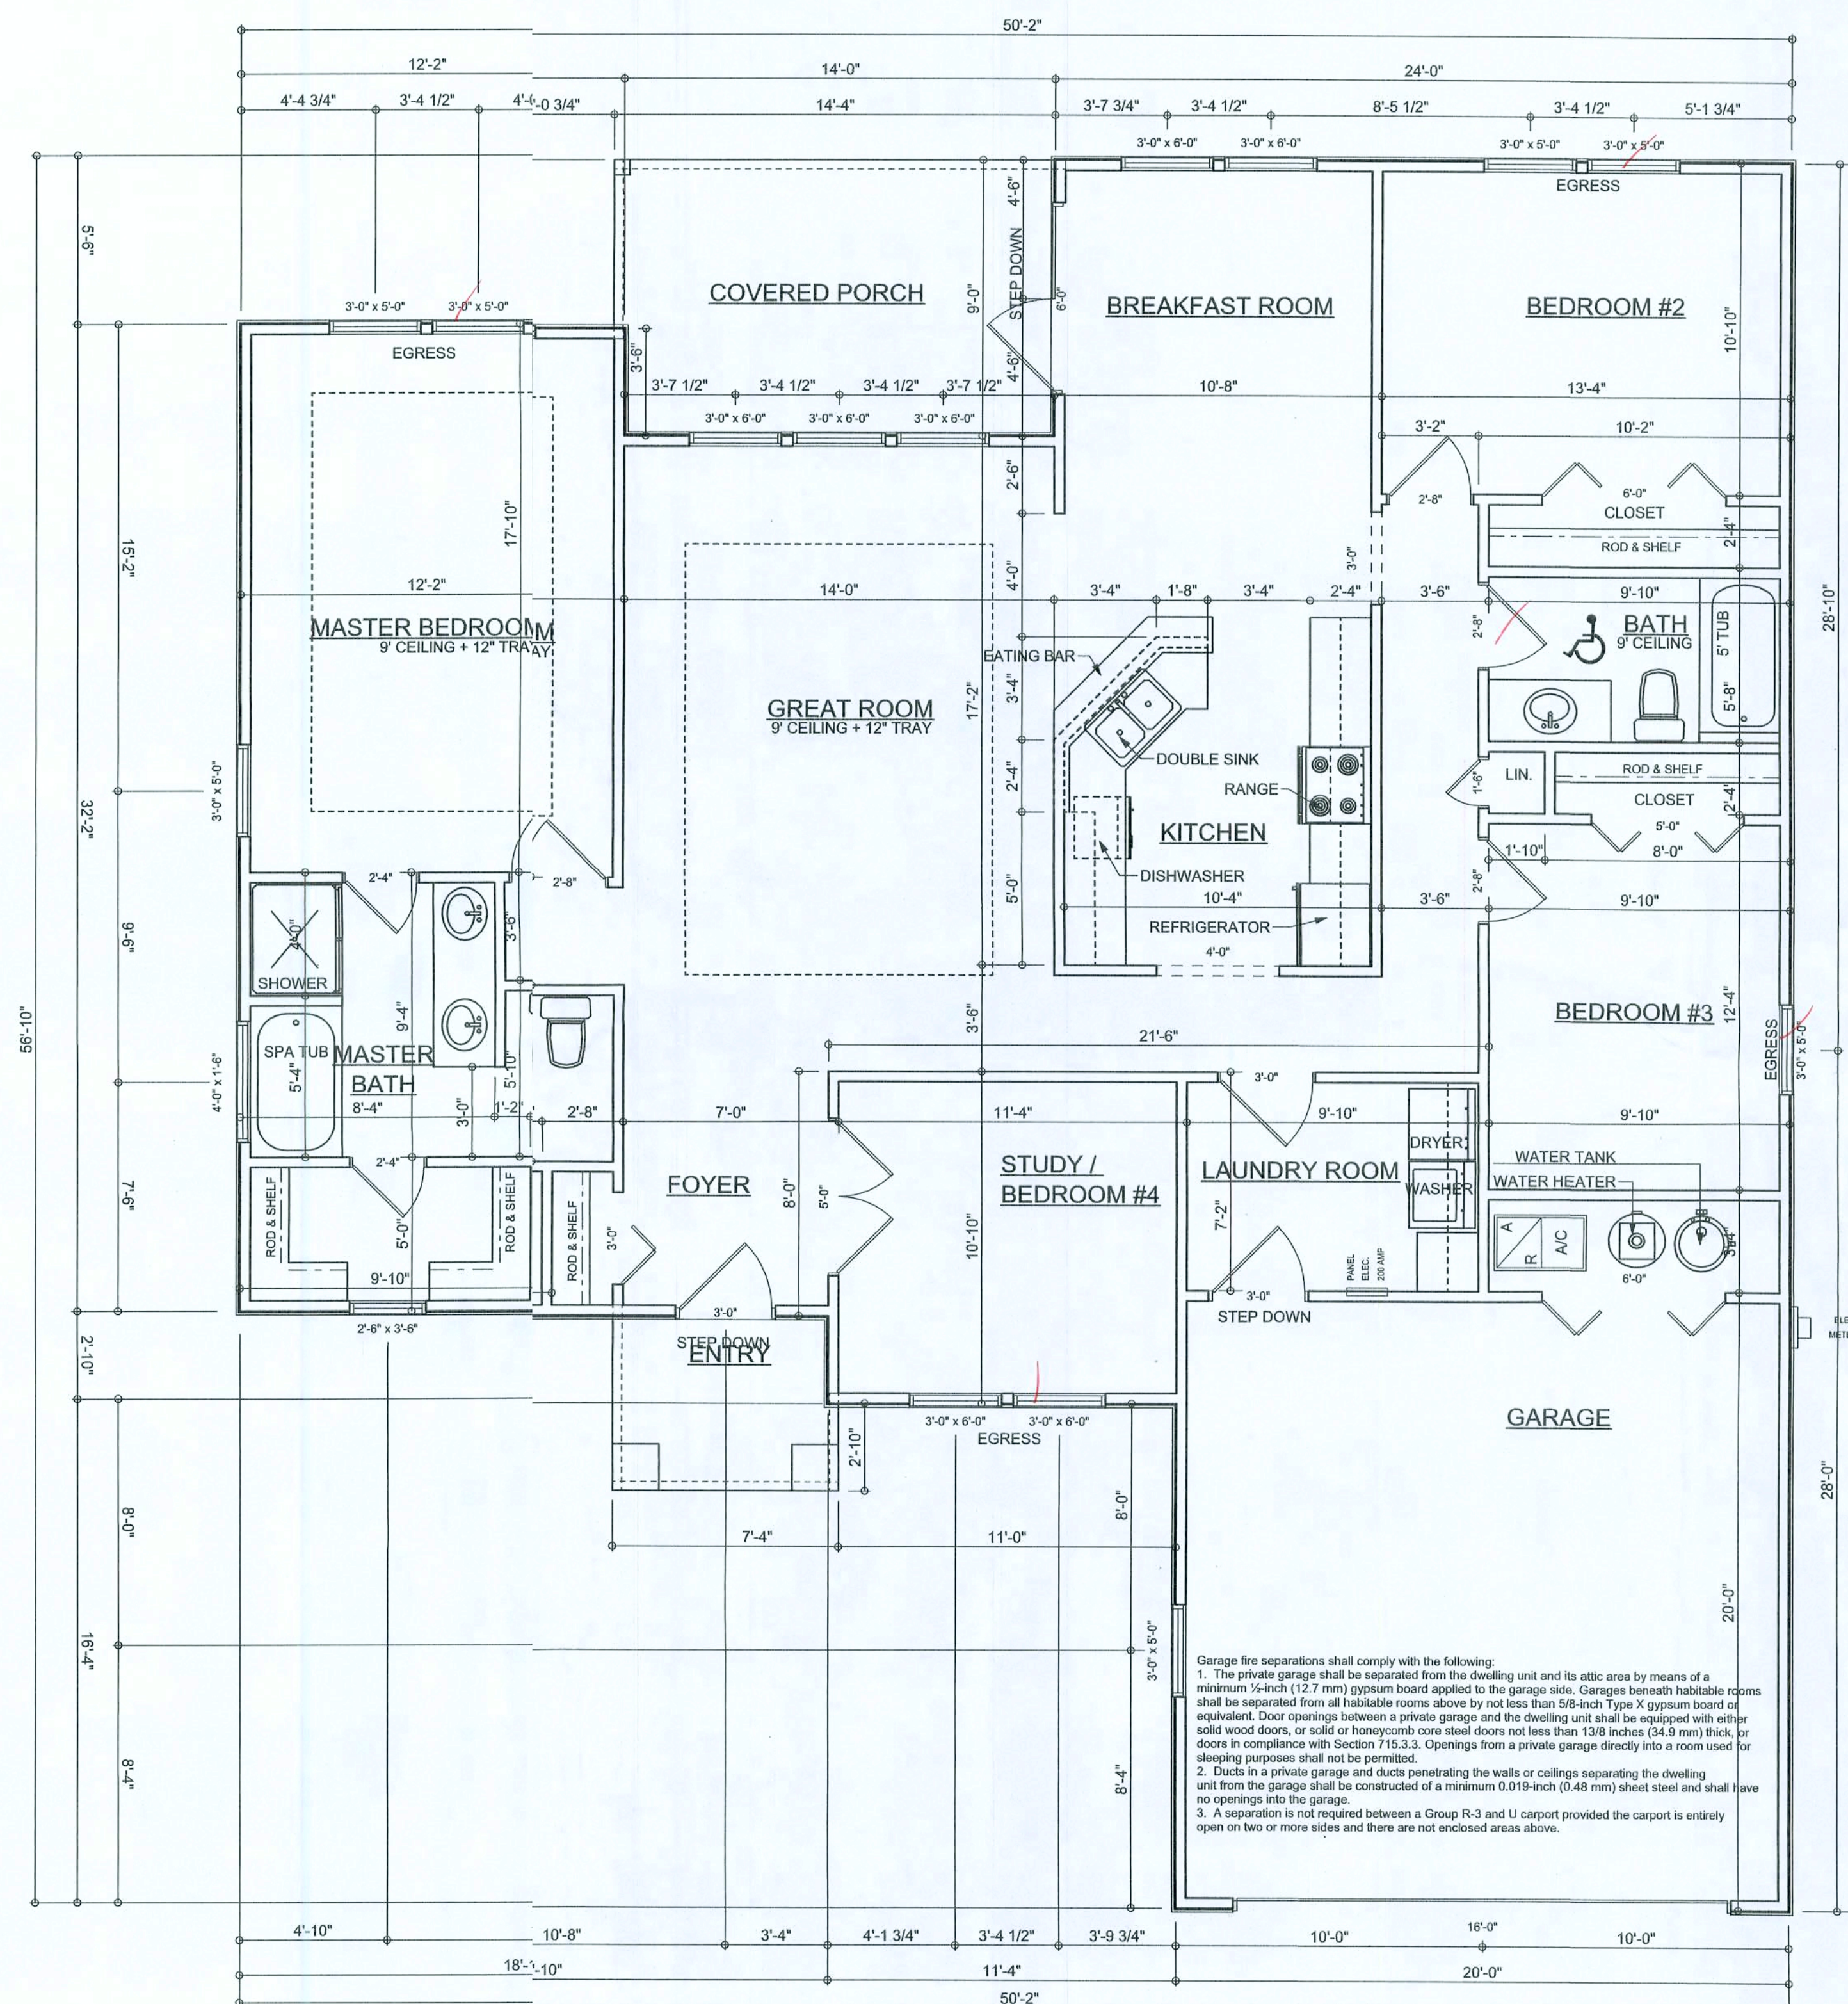

FLOOR PLAN

SCALE: 1/4\"/>

ALL CEILINGS TO BE 9' UNLESS NOTED OTHERWISE

AREA SUMMARY

LIVING AREA	1740	S . F .
GARAGE AREA	399	S . F .
PORCH AREA	165	S . F .
TOTAL AREA	2304	S . F .

WINDLOAD ENGINEER: Mark Disosway,
P.E. No. 53915, P.O. Box 886, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supercede all other
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that to applicable
portions of the plan, relating to wind engineering
comply with section R301.2.1 Florida building
code residential 2004, to the best of my
knowledge.

LIMITATION: This design is valid for one
building, at specified location.

MARK DISOSWAY
P.E. 53915

SEAL

MARTIN HOME BUILDERS

SPEC HOUSE

ADDRESS:
429 SW Morning glory Dr.
Rolling Meadows Lot #15
Columbia County FL, U.S.A.

Mark Disosway P.E.
P.O. Box 468
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 265 - 4871

PRINTED DATE:
May 16, 2007

DRAWN BY: STRUCTURAL BY:
Ben Sparks Ben Sparks

FINALS DATE:
15 / May / 07

JOB NUMBER:
704091


DRAWING NUMBER

A-2

OF 6 SHEETS

REVISIONS

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

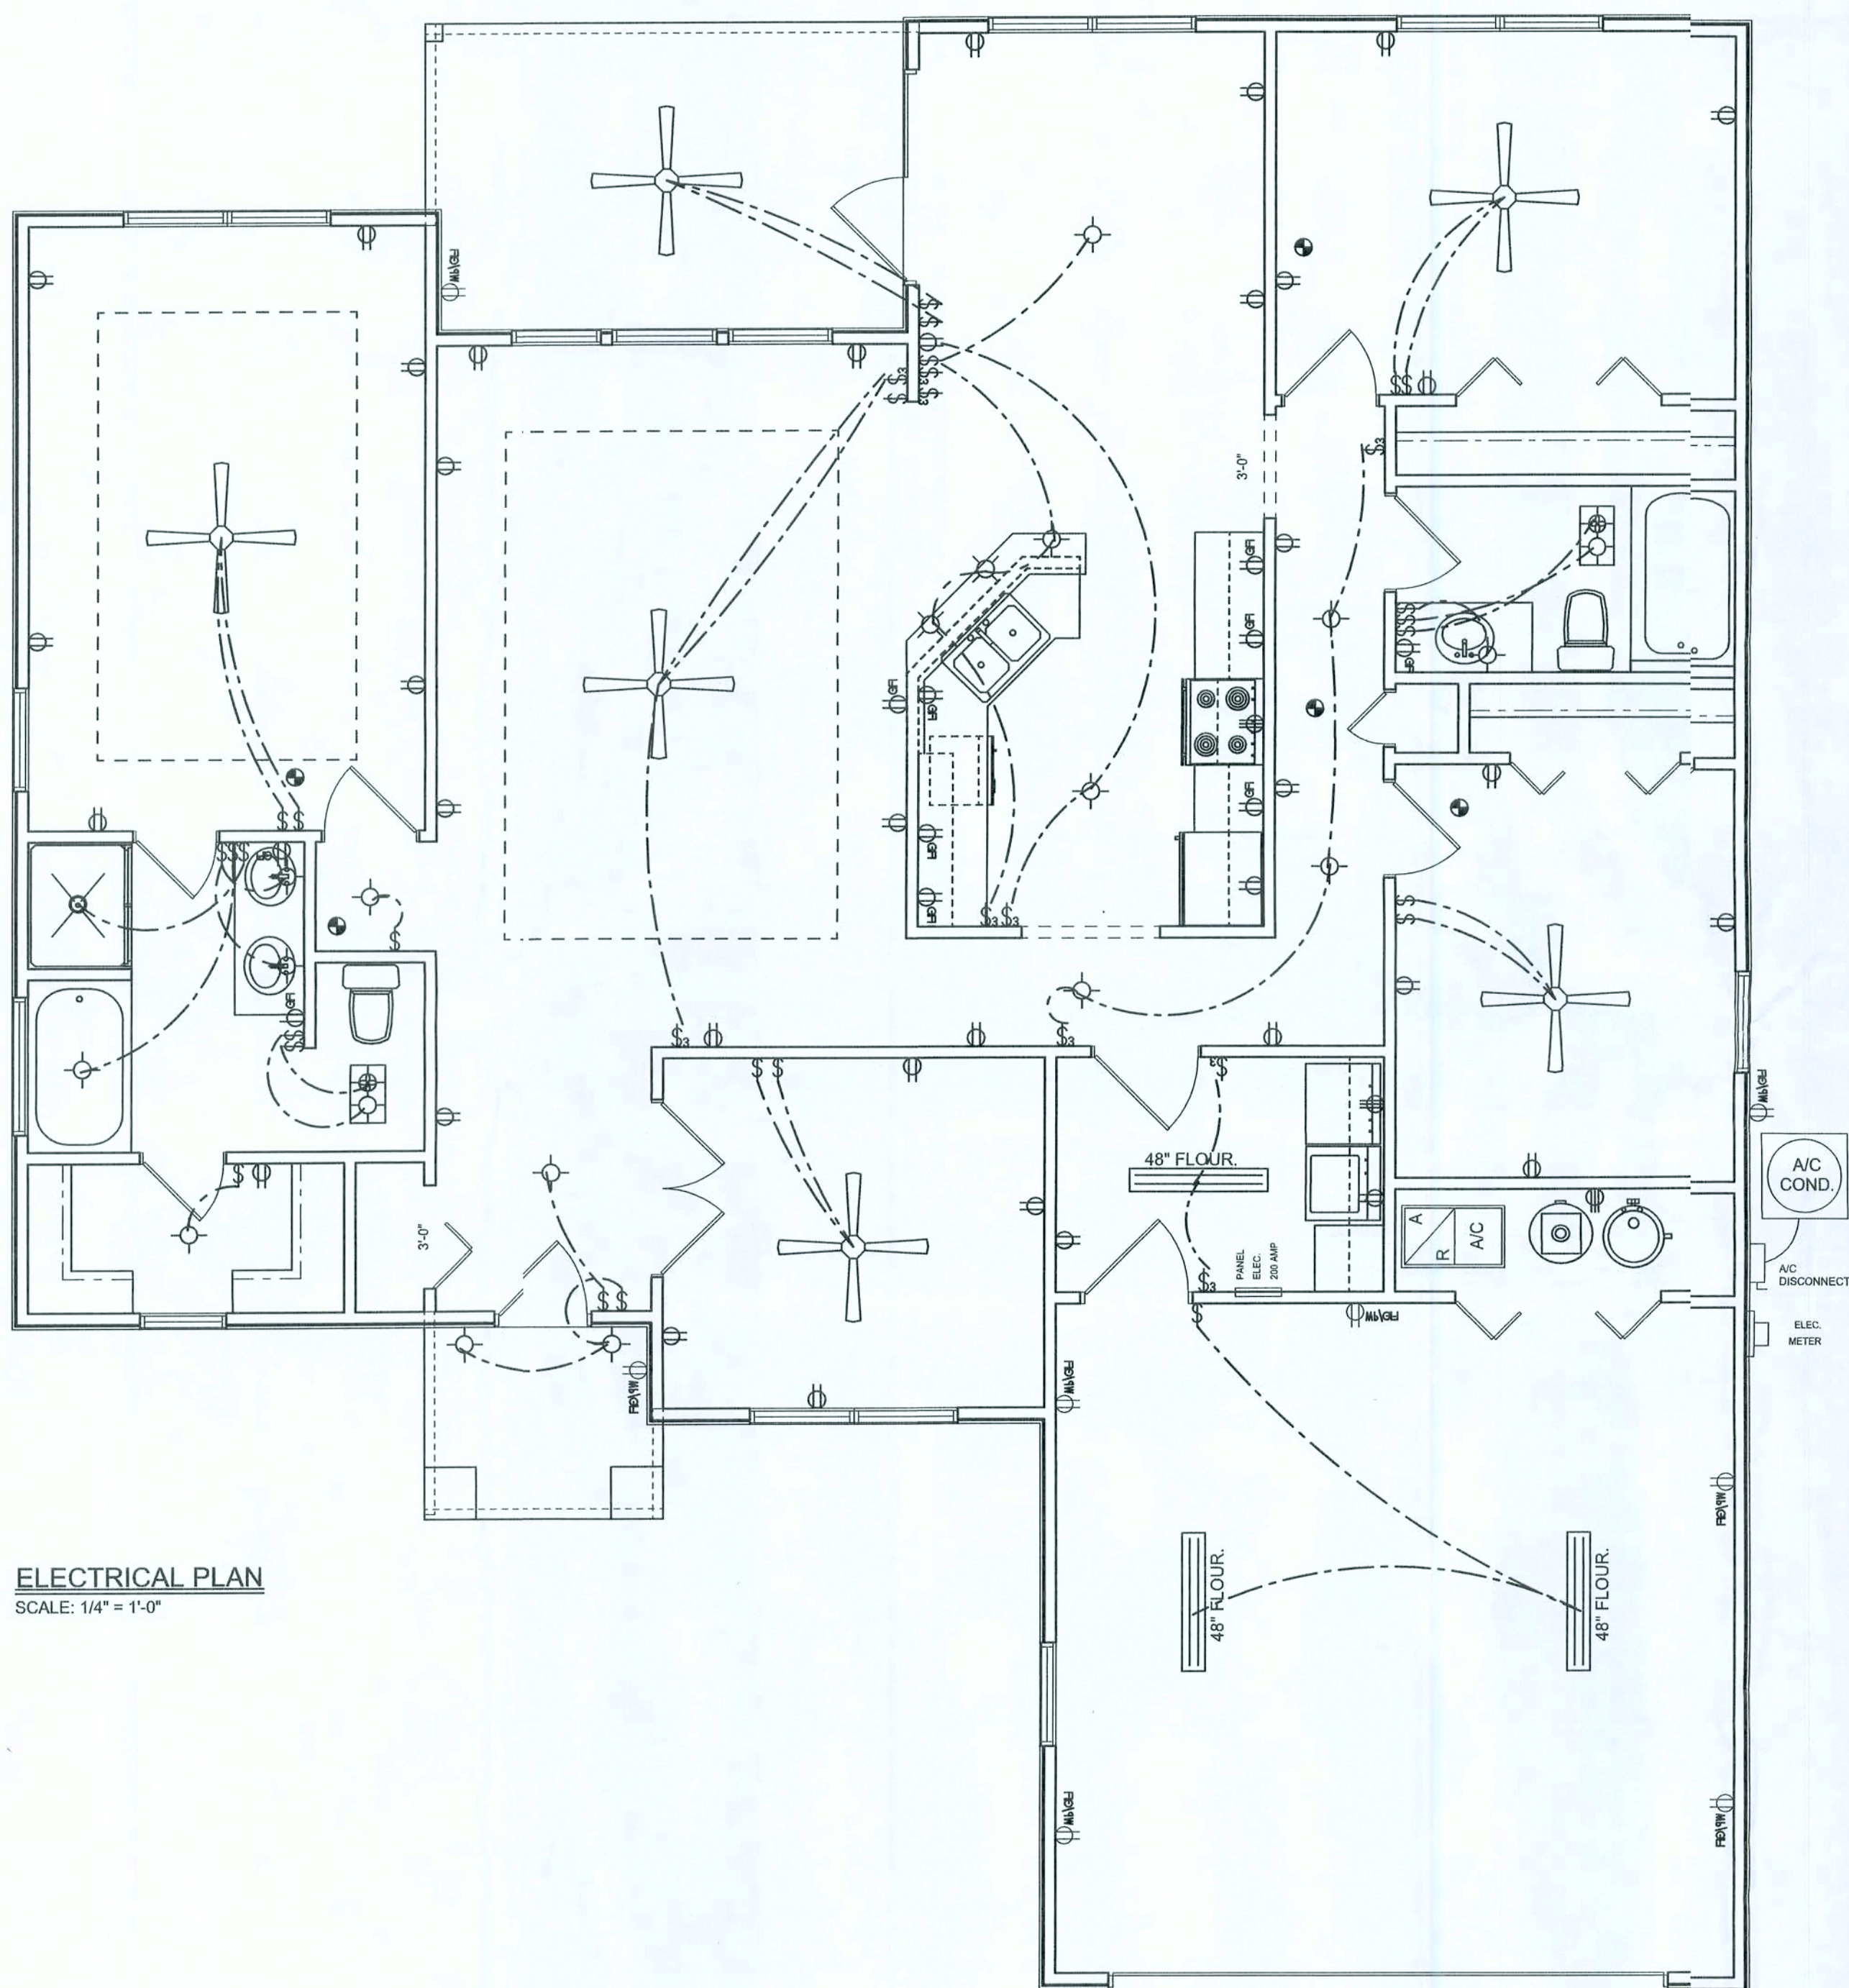

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES

- E -1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
- E -2 CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
- E -3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
- E -4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
- E -5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.
- E -6 ELECTRICAL CONTR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E -7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
- E -8 ALL BEDROOM RECEPTACLES SHALL BE AFCI (ARC FAULT CIRCUIT INTERRUPT)
- E -9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION
- E -10 A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL

ELECTRICAL LEGEND

	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	2X4 FLUORESCENT LIGHT FIXTURE
	RECESSED CAN LIGHT
	BATH EXHAUST FAN WITH LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET
	220v OUTLET
	GFI DUPLEX OUTLET
	SMOKE DETECTOR
	WALL SWITCH
	3 WAY WALL SWITCH
	4 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	PHONE JACK
	TELEVISION JACK
	GARAGE DOOR OPENER
	WALL HEATER

WINDLOAD ENGINEER: Mark Disosway,
PE No. 53915, P.O. Box 368, Lake City, FL
32056, (386) 754-5419

DIMENSIONS:
Stated dimensions superceded/scaled
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
his common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first to express written
permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
portions of the plan, relating to wind engineering
comply with section R301.2.1 Florida building
code residential 2004, to the best of my
knowledge.

LIMITATION: This design is valid for one
building, at specified location

MARK DISOSWAY
P.E. 53915

Mark Disosway
SEAL

MARTIN HOME
BUILDERS

SPEC HOJSE

ADDRESS:
429 SW Morning glory Dr.
Rolling Meadows Lot #15
Columbia County IL, U.S.A.

Mark Disosway P.E.
P.O. Box 368
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 261 - 4871

PRINTED DATE:
May 16, 2007

DRAWN BY: Ben Sparks
STRUCTURAL BY: Ken Sparks


FINALS DATE:
15 / May / 07

JOB NUMBER:
704051

DRAWING NUMBER

A-3

OF 6 SHEETS




(1) 2x4 @ 16" OC	TO 11'-9" STUD HEIGHT
(1) 2x4 @ 12" OC	TO 13'-0" STUD HEIGHT
(1) 2x6 @ 16" OC	TO 18'-10" STUD HEIGHT
(1) 2x6 @ 12" OC	TO 20'-0" STUD HEIGHT

Diagram illustrating the roof truss system with the following labels:


- PRE ENGINEERED ROOF TRUSS
- DOUBLE 2x4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
- 4 MIN LAP w/ (12) - 16d OR 4" LAP w/ CS20 w/ (4) - 16d x (4) - 10d
- INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN
- CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

SCALE: N.T.S.



SCALE: N.T.S.

SCALE: N.T.S.

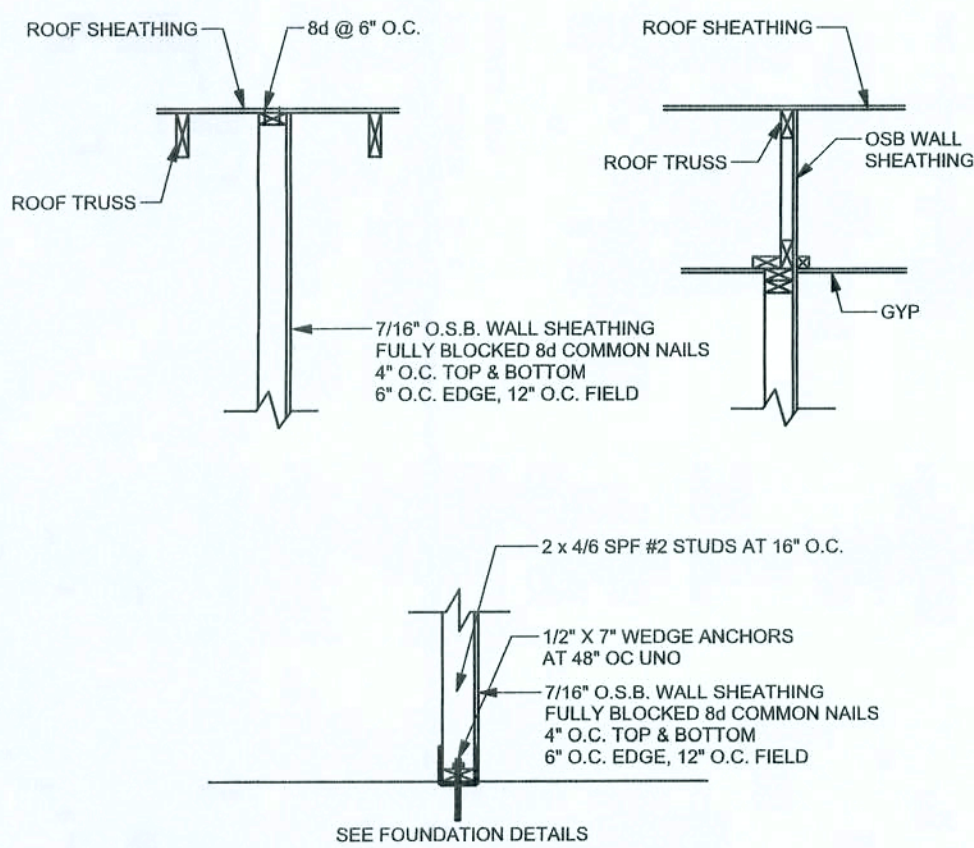

SCALE: 1/2" = 1'-0"



SCALE: 1/2" = 1'-0"

OBTAIN UPLIFT REQUIREMENTS FROM TRUSS MANUFACTURER'S ENGINEERING

UPLIFT LBS. SYP*	UPLIFT LBS. SPF	TRUSS CONNECTOR*	TO PLATES	TO RAFTER/TRUSS	TO STUDS
< 420	< 245	H5A	3-8d	3-8d	
< 455	< 265	H5	4-8d	4-8d	
< 460	< 235	H4	4-8d	4-8d	
< 455	< 320	H3	4-8d	4-8d	
< 415	< 365	H2.5	5-8d	5-8d	
< 600	< 535	H2.5A	5-8d	5-8d	
< 950	< 820	H8	8-8d	8-8d	
< 745	< 565	H8	5-10d, 1 1/2"	5-10d, 1 1/2"	
< 1465	< 1050	H14-1	13-8d	12-8d, 1 1/2"	
< 1465	< 1050	H14-2	15-8d	12-8d, 1 1/2"	
< 990	< 850	H10-1	8-8d, 1 1/2"	8-8d, 1 1/2"	
< 760	< 655	H10-2	6-10d	6-10d	
< 1470	< 1285	H16-1	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1470	< 1285	H16-2	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1000	< 860	MTS24C	7-10d 1 1/2"	7-10d 1 1/2"	
< 1450	< 1245	HTS24	12-10d 1 1/2"	12-10d 1 1/2"	
< 2400	< 2490	2 - HTS24			
< 2050	< 1785	LG12	14 - 16d	14 - 16d	
HEAVY GIRDER TIEDOWNS*					TO FOUNDATION
< 3965	< 3330	MG1		22 - 10d	1-5/8" THREADED ROD 12" EMBEDMENT
< 10980	< 6485	HGT-2		16 - 10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 10530	< 9035	HGT-3		16 - 10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 9250	< 9250	HGT-4		16 - 10d	2-5/8" THREADED ROD 12" EMBEDMENT
STUD STRAP CONNECTOR*					TO STUDS
< 435	< 435	SSP DOUBLE TOP PLATE	3 - 10d		4 - 10d
< 455	< 420	SSP SINGLE SILL PLATE	1 - 10d		4 - 10d
< 825	< 825	DSP DOUBLE TOP PLATE	6 - 10d		8 - 10d
< 825	< 600	DSP SINGLE SILL PLATE	2 - 10d		8 - 10d
< 885	< 760	SP4			6-10d, 1 1/2"
< 1240	< 1065	SPH4			10-10d, 1 1/2"
< 885	< 760	SP6			6-10d, 1 1/2"
< 1240	< 1065	SPH6			10-10d, 1 1/2"
< 1235	< 1165	LSTA18	14-10d		
< 1235	< 1235	LSTA21	16-10d		
< 1030	< 1030	CS20	18-8d		
< 1705	< 1705	CS16	28-8d		
STUD ANCHORS*			TO STUDS		TO FOUNDATION
< 1350	< 1305	LTT19	8-16d		1/2" AB
< 2310	< 2310	LTT31	18-10d, 1 1/2"		1/2" AB
< 2775	< 2570	H02A	2-5/8" BOLTS		5/8" AB
< 4175	< 3695	HTT16	18 - 16d		5/8" AB
< 1400	< 1400	PAHD42	16-16d		
< 3335	< 3335	HPAHQ22	16-16d		
< 2200	< 2200	ABU44	12-16d		1/2" AB
< 2300	< 2300	ABU66	12-16d		1/2" AB
< 2320	< 2320	ABU88	18 - 16d		2-5/8" AB

		Fb (psi)	E (10 ⁶ psi)
2x8	SYR #2	1200	1.6
2x10	SYR #2	1050	1.6
2x12	SYR #2	975	1.6
GLB	24F-V3 SP	2400	1.8
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2900	2.0
PSL	PARALAM	2900	2.0

DOOR WIDTH	3/8" x 4" LAG	16d STAGGER	(2) ROWS OF .131 x 3 1/4" GN
8' - 10'	24" O.C.	5" O.C.	5" O.C.
11' - 15'	18" O.C.	4" O.C.	4" O.C.
16' - 18'	16" O.C.	3" O.C.	3" O.C.



SCALE: NT 9


NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

ROOF SYSTEM DESIGN

TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM BY VISUAL INSPECTION AND BY VISUAL MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBC 2004 REQUIRED LOADS. FOR ANY AND ALL REASON, THE SUBMITTER AGREES TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACINGS. THE BUILDER SHOULD USE CARE CHECKING THE ROOF LAYOUT BECAUSE THE TRUSS LAYOUT WAS NOT THE DESIGNER RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PEN NOTES ON THEIR SEALED TRUSS SHEET.






(ENCLOSED SIMPLE DIAPHRAGM BUILDINGS WITH FLAT, HIPPED, OR GABLE ROOFS; MEAN ROOF HEIGHT NOT EXCEEDING LEAST HORIZONTAL DIMENSION OR 60 FT; NOT ON UPPER HALF OF HILL OR ESCARPMENT 60FT IN EXP. B, 30FT IN EXP. C AND >10% SLOPE AND UNOBSTRUCTED UPWIND FOR 50x HEIGHT OR 1 MILE WHICHEVER IS LESS)

BUILDING IS NOT IN THE HIGH VELOCITY HURRICANE ZONE
BUILDING IS NOT IN THE WIND-BORNE DEBRIS REGION
1.) BASIC WIND SPEED = 110 MPH
2.) WIND EXPOSURE = B
3.) WIND IMPORTANCE FACTOR = 1.0
4.) BUILDING CATEGORY = II
5.) ROOF ANGLE = 10-45 DEGREES
6.) MEAN ROOF HEIGHT = <30 FT
7.) INTERNAL PRESSURE COEFFICIENT = N/A (ENCLOSED BUILDING)
8.) COMPONENTS AND CLADDING DESIGN WIND PRESSURES (TABLE R301.2(2))

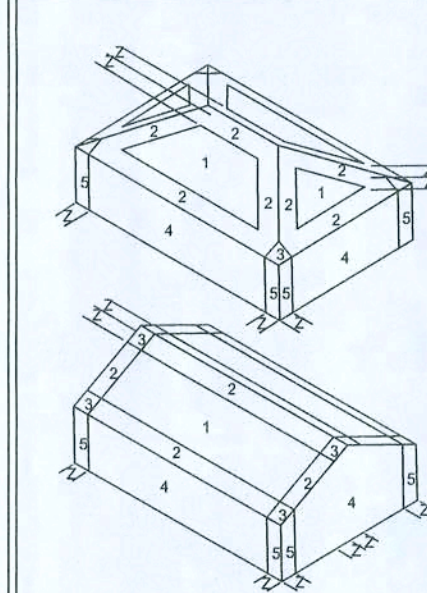
[illegible]

SOIL BEARING CAPACITY 1000PSE

DRAWING NUMBER



STEMWALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEMWALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEMWALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

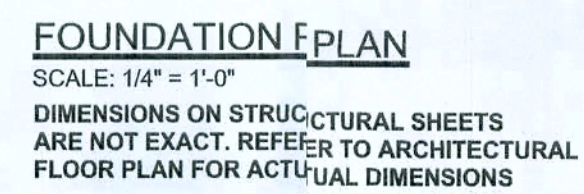

MARK DISOSWAY
P.E. 53915

[Handwritten signature]
16 MAY 1967

SEAL

OF 6 SHEETS

