

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



FL REG# 278, Yoonhwak Kim, FL PE #86367

Alpine, an ITW Company  
6750 Forum Drive, Suite 305  
Orlando, FL 32821  
Phone: (800)755-6001  
www.alpineitw.com




| Site Information:                     | Page 1:             |
|---------------------------------------|---------------------|
| Customer: W. B. Howland Company, Inc. | Job Number: 20-4962 |
| Job Description: Jones Res            |                     |
| Address: FL                           |                     |

| Job Engineering Criteria:         |  |   |  |
|-----------------------------------|--|---|--|
| Design Code: FBC 7th Ed. 2020 Res |  | IntelliVIEW Version: 20.01.01A through 20.02.01A<br>JRef #: 1X3d2150006 |  |
| Wind Standard: ASCE 7-16          |  | Wind Speed (mph): 130   |  |
| Building Type: Closed             |  | Design Loading (psf): 40.00, 55.00                                      |  |

This package contains general notes pages, 103 truss drawing(s) and 5 detail(s).

| Item | Drawing Number    | Truss |
|------|-------------------|-------|
| 1    | 062.21.0902.13167 | A01   |
| 3    | 062.21.0902.19393 | A02   |
| 5    | 062.21.0902.23570 | A04   |
| 7    | 062.21.0902.35617 | A06   |
| 9    | 062.21.0902.42990 | A08   |
| 11   | 062.21.0902.46910 | A10   |
| 13   | 062.21.0902.54860 | A12   |
| 15   | 062.21.0902.59890 | A14   |
| 17   | 062.21.0903.04940 | A16   |
| 19   | 062.21.0903.10440 | B02   |
| 21   | 062.21.0903.13620 | B04   |
| 23   | 062.21.0903.33230 | C02   |
| 25   | 062.21.0903.36380 | C04   |
| 27   | 062.21.0903.40413 | C06   |
| 29   | 062.21.0903.43917 | C08   |
| 31   | 062.21.0903.46420 | C10   |
| 33   | 062.21.0903.49177 | C12   |
| 35   | 062.21.0908.24420 | C14   |
| 37   | 062.21.0908.31237 | C16   |
| 39   | 062.21.0908.37240 | C18   |
| 41   | 062.21.0908.42910 | C20   |
| 43   | 062.21.0908.49573 | C22   |
| 45   | 062.21.0908.53287 | C24   |
| 47   | 062.21.0908.56983 | C26   |
| 49   | 062.21.0909.01363 | C28   |
| 51   | 062.21.0909.05643 | C30   |

| Item | Drawing Number    | Truss |
|------|-------------------|-------|
| 2    | 062.21.0902.17157 | A01A  |
| 4    | 062.21.0902.21540 | A03   |
| 6    | 062.21.0902.25660 | A05   |
| 8    | 062.21.0902.40007 | A07   |
| 10   | 062.21.0902.45063 | A09   |
| 12   | 062.21.0902.48503 | A11   |
| 14   | 062.21.0902.57943 | A13   |
| 16   | 062.21.0903.01617 | A15   |
| 18   | 062.21.0903.08150 | B01   |
| 20   | 062.21.0903.12047 | B03   |
| 22   | 062.21.0903.31517 | C01   |
| 24   | 062.21.0903.34610 | C03   |
| 26   | 062.21.0903.37943 | C05   |
| 28   | 062.21.0903.42347 | C07   |
| 30   | 062.21.0903.45283 | C09   |
| 32   | 062.21.0903.47703 | C11   |
| 34   | 062.21.0903.54953 | C13   |
| 36   | 062.21.0908.27517 | C15   |
| 38   | 062.21.0908.34763 | C17   |
| 40   | 062.21.0908.40030 | C19   |
| 42   | 062.21.0908.46547 | C21   |
| 44   | 062.21.0908.51407 | C23   |
| 46   | 062.21.0908.55210 | C25   |
| 48   | 062.21.0908.59347 | C27   |
| 50   | 062.21.0909.03577 | C29   |
| 52   | 062.21.0909.07857 | C31   |

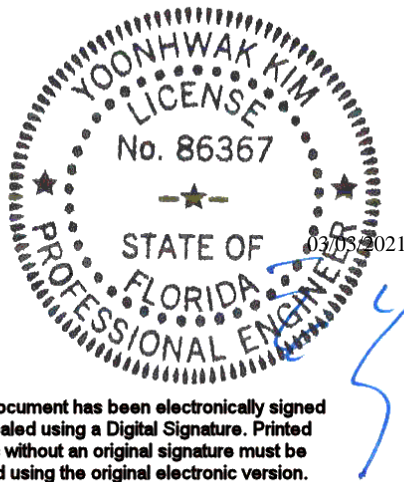

Alpine, an ITW Company  
6750 Forum Drive, Suite 305  
Orlando, FL 32821  
Phone: (800)755-6001  
www.alpineitw.com

This document has been electronically signed  
and sealed using a Digital Signature. Printed  
copies without an original signature must be  
verified using the original electronic version.

| Site Information:                     | Page 2:             |
|---------------------------------------|---------------------|
| Customer: W. B. Howland Company, Inc. | Job Number: 20-4962 |
| Job Description: Jones Res            |                     |
| Address: FL                           |                     |

| Item | Drawing Number    | Truss |
|------|-------------------|-------|
| 53   | 062.21.0909.11097 | C32   |
| 55   | 062.21.0909.17487 | C34   |
| 57   | 062.21.0909.23833 | D01   |
| 59   | 062.21.0909.28933 | D03   |
| 61   | 062.21.0909.34220 | D05   |
| 63   | 062.21.0909.45997 | FT02  |
| 65   | 062.21.0910.00173 | G01   |
| 67   | 062.21.0910.06113 | G03   |
| 69   | 062.21.0910.20980 | H17   |
| 71   | 062.21.0910.24443 | HJ02  |
| 73   | 062.21.0910.27363 | HJ05  |
| 75   | 062.21.0910.29717 | HJ07  |
| 77   | 062.21.0910.32250 | HJ09  |
| 79   | 062.21.0910.35580 | HJ11  |
| 81   | 062.21.0910.39373 | J02   |
| 83   | 062.21.0910.43090 | J03A  |
| 85   | 062.21.0910.46463 | J06   |
| 87   | 062.21.0910.49500 | J08   |
| 89   | 062.21.0910.52180 | J10   |
| 91   | 062.21.0910.54670 | J12   |
| 93   | 062.21.0910.57213 | J14   |
| 95   | 062.21.0911.00060 | J16   |
| 97   | 062.21.0911.34137 | J18   |
| 99   | 062.21.0911.37817 | J20   |
| 101  | 062.21.0911.43980 | J22   |
| 103  | 062.21.0911.50770 | PB02  |
| 105  | PB160160118       |       |
| 107  | A14030ENC160118   |       |

| Item | Drawing Number    | Truss |
|------|-------------------|-------|
| 54   | 062.21.0909.15340 | C33   |
| 56   | 062.21.0909.18730 | C35   |
| 58   | 062.21.0909.26900 | D02   |
| 60   | 062.21.0909.31583 | D04   |
| 62   | 062.21.0909.40843 | FT01  |
| 64   | 062.21.0909.52023 | FT03  |
| 66   | 062.21.0910.04047 | G02   |
| 68   | 062.21.0910.18360 | G04   |
| 70   | 062.21.0910.22673 | HJ01  |
| 72   | 062.21.0910.25893 | HJ04  |
| 74   | 062.21.0910.28563 | HJ06  |
| 76   | 062.21.0910.30907 | HJ08  |
| 78   | 062.21.0910.33870 | HJ10  |
| 80   | 062.21.0910.37530 | J01   |
| 82   | 062.21.0910.41227 | J03   |
| 84   | 062.21.0910.44957 | J05   |
| 86   | 062.21.0910.48040 | J07   |
| 88   | 062.21.0910.50813 | J09   |
| 90   | 062.21.0910.53413 | J11   |
| 92   | 062.21.0910.55997 | J13   |
| 94   | 062.21.0910.58597 | J15   |
| 96   | 062.21.0911.01410 | J17   |
| 98   | 062.21.0911.36140 | J19   |
| 100  | 062.21.0911.39443 | J21   |
| 102  | 062.21.0911.47100 | PB01  |
| 104  | BRCLBSUB0119      |       |
| 106  | CNNAILSP1014      |       |
| 108  | GBLLETIN0118      |       |

## **General Notes**

### **Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:**

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

### **Temporary Lateral Restraint and Bracing:**

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

### **Permanent Lateral Restraint and Bracing:**

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

### **Connector Plate Information:**

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at [www.icc-es.org](http://www.icc-es.org).

### **Fire Retardant Treated Lumber:**

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

## **General Notes** (continued)

### **Key to Terms:**

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.

Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

**References:**

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; [www.awc.org](http://www.awc.org).
2. ICC: International Code Council; [www.iccsafe.org](http://www.iccsafe.org).
3. Alpine, a division of ITW Building Components Group Inc.: 514 Earth City Expressway, Suite 242, Earth City, MO 63045; [www.alpineitw.com](http://www.alpineitw.com).
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; [www.tpinst.org](http://www.tpinst.org).
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; [www.sbcindustry.com](http://www.sbcindustry.com).

|  |  |   |            |        |             |
|--|--|---|------------|--------|-------------|
| <b>Lumber</b>  | <b>Additional Notes</b>  | C - D   | 38 - 1946  | E - F  | 91 - 1822   |
| Top chord: 2x4 SP #2;<br>Bot chord: 2x4 SP #2;<br>Webs: 2x4 SP #3; | The overall height of this truss excluding overhang is 6-5-14. | <b>Maximum Bot Chord Forces Per Ply (lbs)</b> |            |        |             |
|  |  | Chords  | Tens.Comp. | Chords | Tens. Comp. |
|  |  | K - L   | 1388 - 47  | L - L  | 1388 - 47   |

BC: From 26 plf at 21.92 to 26 plf at 23.46  
 BC: From 5 plf at 21.92 to 5 plf at 23.46  
 PLB: From 20 plf at 5.25 to 20 plf at 7.32  
 PLB: From 20 plf at 14.60 to 20 plf at 16.67  
 TC: 382 lb Conc. Load at 4.99,16.93  
 TC: 162 lb Conc. Load at 7.02, 9.02,10.96,12.90  
 14.90  
 BC: 138 lb Conc. Load at 4.99,16.93  
 BC: 100 lb Conc. Load at 7.02, 9.02,10.96,12.90  
 14.90




**Wind**  
Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [toint.org](http://toint.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |   |   |
|---------------------------|--------------------------|---|---|
| SEQN: 339493<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A01A | Cust: R 215 JRef: 1X3d2150006 T9<br>DrwNo: 062.21.0902.17157<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|---|---|

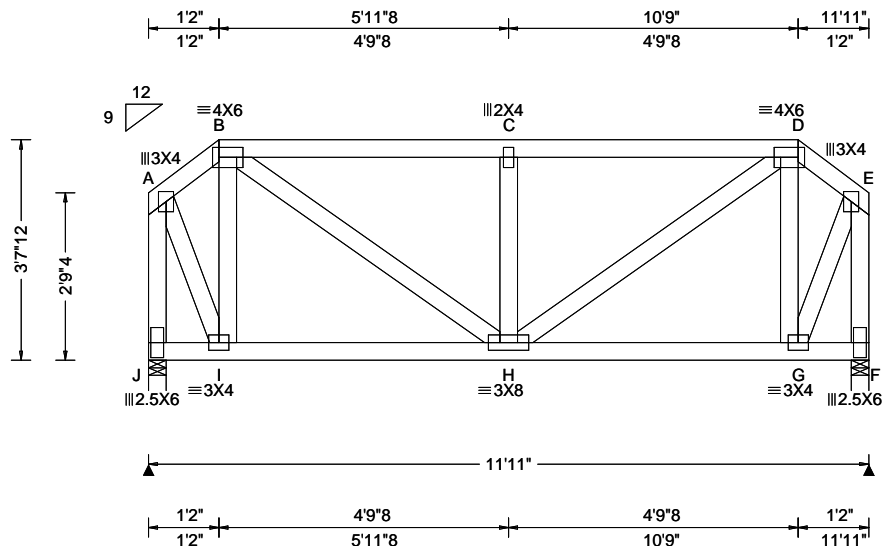

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): -0.020 C 999 480<br>VERT(CL): 0.036 C 999 360<br>HORZ(LL): 0.005 B - -<br>HORZ(TL): 0.010 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.305<br>Max BC CSI: 0.607<br>Max Web CSI: 0.304<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>J 854 -/- /- /466 -/<br>F 854 -/- /- /466 -/<br>Wind reactions based on MWFRS<br>J Brg Width = 3.5 Min Req = 1.5<br>F Brg Width = 3.5 Min Req = 1.5<br>Bearings J & F are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 219 -445 C - D 515 -912<br>B - C 515 -912 D - E 219 -445 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 65 plf at 0.00 to 65 plf at 1.17  
TC: From 32 plf at 1.17 to 32 plf at 10.75  
TC: From 65 plf at 10.75 to 65 plf at 11.92  
BC: From 10 plf at 0.00 to 10 plf at 11.92  
TC: -39 lb Conc. Load at 1.20,10.72  
TC: -16 lb Conc. Load at 3.23, 5.23, 6.69, 8.69  
BC: 55 lb Conc. Load at 1.20,10.72  
BC: 212 lb Conc. Load at 2.02, 4.02, 5.96, 7.90  
9.90  
BC: 23 lb Conc. Load at 3.23, 5.23, 6.69, 8.69

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3'-7-12".

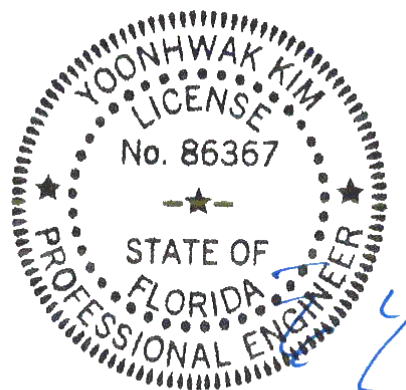


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339474<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A02 | Cust: R 215 JRef: 1X3d2150006 T92<br>DrwNo: 062.21.0902.19393<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

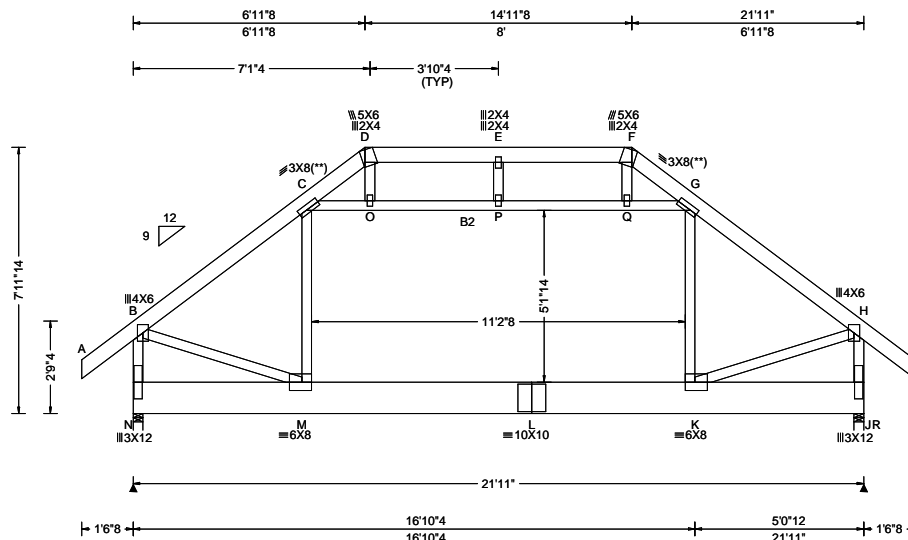

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.051 L 999 480<br>VERT(CL): 0.097 L 999 360<br>HORZ(LL): 0.013 M - -<br>HORZ(TL): 0.030 M - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.102<br>Max BC CSI: 0.225<br>Max Web CSI: 0.590<br><br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1819 - / - /616 /157 /206<br>R 1816 - / - /616 /157 -<br>Wind reactions based on MWFRS<br>N Brg Width = 3.5 Min Req = 1.5<br>R Brg Width = 3.5 Min Req = 1.5<br>Bearings N & R are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 363 -1910 E - F 522 -799<br>C - D 584 -949 F - G 584 -946<br>D - E 522 -799 G - H 363 -1910 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Plating Notes

(\*\*) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

#### Loading

Attic room loading from 5-4-4 to 16-6-12: Live Load: 40 PSF. Dead Load: 10 PSF Ceiling: 10 PSF, Kneewalls: 10 PSF

#### Purlins

Collar-tie braced with continuous lateral bracing at 24" oc. or rigid ceiling.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7'-11-14".

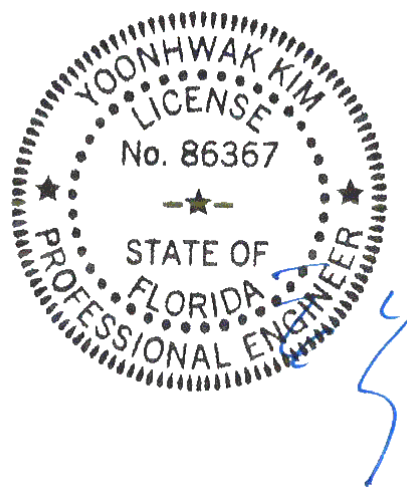

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339469<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A03 | Cust: R 215 JRef: 1X3d2150006 T93<br>DrwNo: 062.21.0902.21540<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

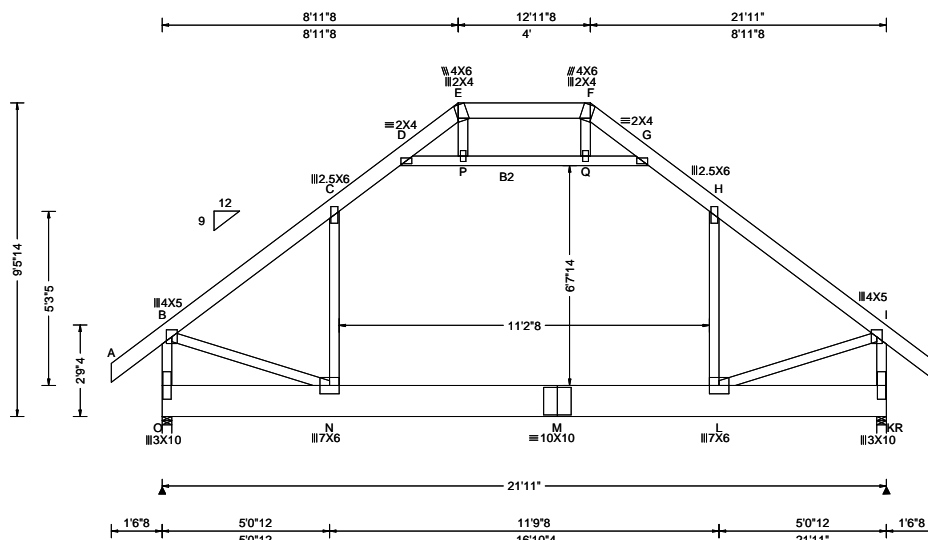

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.060 L 999 480<br>VERT(CL): 0.127 L 999 360<br>HORZ(LL): 0.051 C - -<br>HORZ(TL): 0.114 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.294<br>Max BC CSI: 0.227<br>Max Web CSI: 0.526<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>O 1825 - / - / - /620 /152 /248<br>R 1825 - / - / - /620 /152 - / -<br>Wind reactions based on MWFRS<br>O Brg Width = 3.5 Min Req = 1.5<br>R Brg Width = 3.5 Min Req = 1.5<br>Bearings O & R are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 254 -1785 G - H 350 -1335<br>C - D 350 -1335 H - I 254 -1785 |


**Lumber**  
Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3;

**Loading**  
Attic room loading from 5-4-4 to 16-6-12: Live Load: 40 PSF. Dead Load: 10 PSF Ceiling: 10 PSF, Kneewalls: 10 PSF

**Purlins**  
Collar-tie braced with continuous lateral bracing at 24" oc. or rigid ceiling.

**Wind**  
Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

**Additional Notes**  
The overall height of this truss excluding overhang is 9'-5-14."

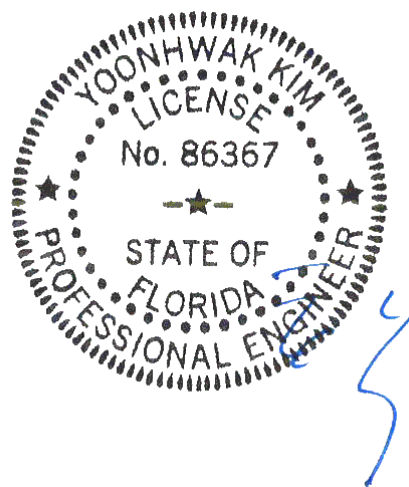


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339467<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A04 | Cust: R 215 JRef: 1X3d2150006 T94<br>DrwNo: 062.21.0902.23570<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

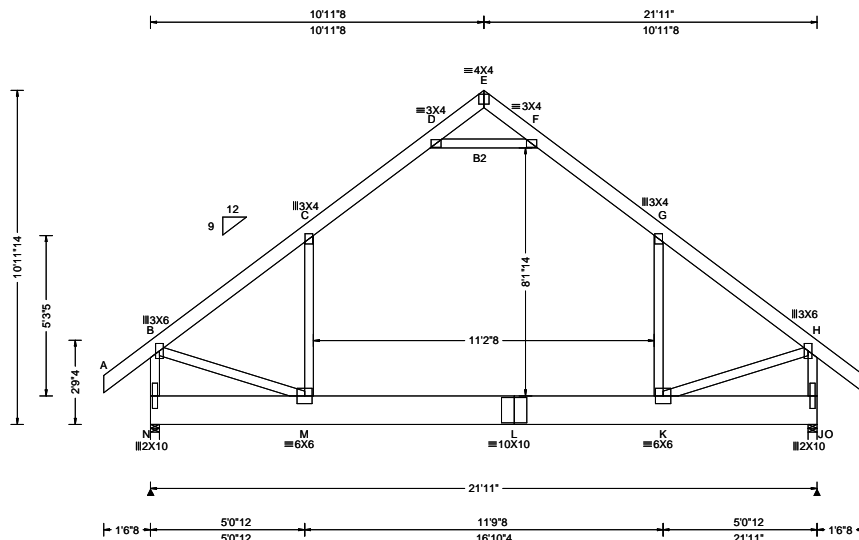

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.141 K 999 480<br>VERT(CL): 0.275 K 955 360<br>HORZ(LL): 0.146 C - -<br>HORZ(TL): 0.289 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.481<br>Max BC CSI: 0.311<br>Max Web CSI: 0.443<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1835 - / - /617 /146 /290<br>O 1835 - / - /617 /146 -<br>Wind reactions based on MWFRS<br>N Brg Width = 3.5 Min Req = 1.5<br>O Brg Width = 3.5 Min Req = 1.5<br>Bearings N & O are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 122 -1586 E - F 710 -91<br>C - D 222 -1183 F - G 222 -1183<br>D - E 710 -91 G - H 122 -1586 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Loading

Attic room loading from 5-4-4 to 16-6-12: Live Load: 40  
PSF. Dead Load: 10 PSF Ceiling: 10 PSF, Kneewalls:  
10 PSF

#### Purlins

Collar-tie braced with continuous lateral bracing at 24"  
oc. or rigid ceiling.

#### Wind

Wind loads based on MWFRS with additional C&C  
member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is  
10-11-14.

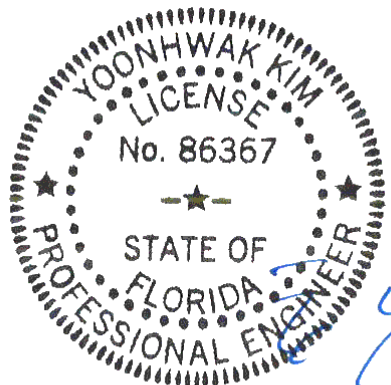


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339465<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A05 | Cust: R 215 JRef: 1X3d2150006 T23<br>DrwNo: 062.21.0902.25660<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

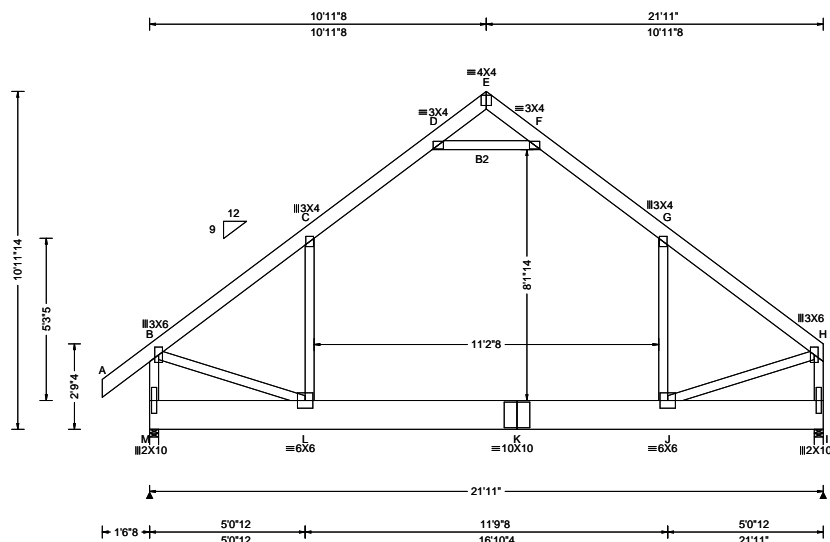

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|---|---|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.141 J 999 480<br>VERT(CL): 0.281 J 936 360<br>HORZ(LL): -0.145 G - -<br>HORZ(TL): 0.292 G - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.488<br>Max BC CSI: 0.313<br>Max Web CSI: 0.453<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>M 1863 -/- /- /619 -/- /269<br>N 1748 -/- /- /526 -/- /-<br>Wind reactions based on MWFRS<br>M Brg Width = 3.5 Min Req = 1.5<br>N Brg Width = 3.5 Min Req = 1.5<br>Bearings M & N are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 118 -1617 E - F 723 -88<br>C - D 219 -1216 F - G 220 -1217<br>D - E 720 -90 G - H 108 -1606 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Loading

Attic room loading from 5-4-4 to 16-6-12: Live Load: 40  
PSF. Dead Load: 10 PSF Ceiling: 10 PSF, Kneewalls:  
10 PSF

#### Purlins


Collar-tie braced with continuous lateral bracing at 24"  
oc. or rigid ceiling.

#### Wind

Wind loads based on MWFRS with additional C&C  
member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is  
10-11-14.

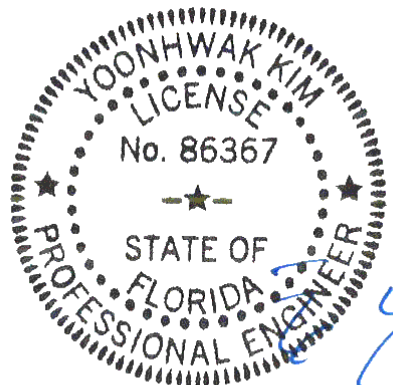


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 360364<br>FROM: CDM | COMN<br>Ply: 3<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A06 | Cust: R 215 JRef: 1X3d2150006 T57<br>DrwNo: 062.21.0902.35617<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

3 Complete Trusses Required

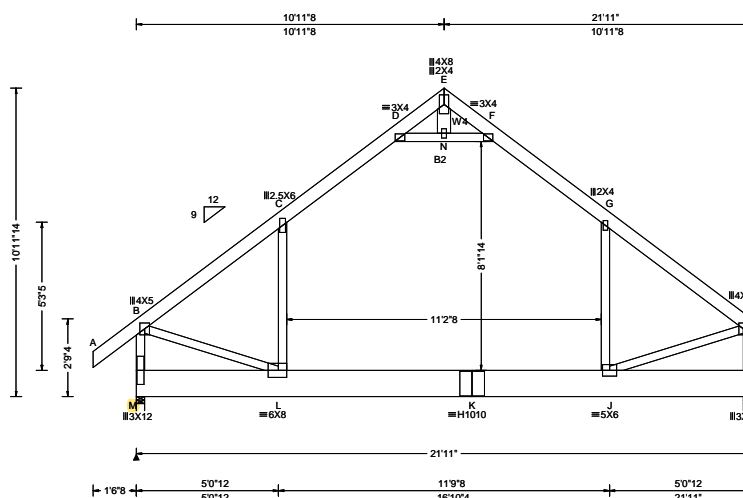

| Loading Criteria (psf)   | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|--|---|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE, HS | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.199 J 999 480<br>VERT(CL): 0.342 J 769 360<br>HORZ(LL): -0.207 G - -<br>HORZ(TL): 0.355 G - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.597<br>Max BC CSI: 0.330<br>Max Web CSI: 0.473<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>M 5040 -/- /- /- /1531 -/<br>O 6947 -/- /- /- /2076 -/<br>Non-Gravity<br>Wind reactions based on MWFRS<br>M Brg Width = 3.5 Min Req = 1.5<br>O Brg Width = 3.5 Min Req = 1.9<br>Bearings M & O are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 490 - 1629 F - G 328 - 1164<br>C - D 327 - 1155 G - H 526 - 1817 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3; W4 2x6 SP 2400f-2.0E;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 4.25" o.c.  
Bot Chord: 1 Row @ 6.00" o.c.  
Webs : 1 Row @ 4" o.c.  
Repeat nailing as each layer is applied. Use equal spacing between rows and stagger nails in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 200 plf at 17.32 to 200 plf at 21.92  
TC: From 40 plf at -1.54 to 40 plf at 21.92  
TC: From 200 plf at 17.32 to 200 plf at 21.92  
TC: From 25 plf at -1.54 to 25 plf at 21.92  
PLT: From 25 plf at 5.35 to 25 plf at 9.19  
PLT: From 20 plf at 9.19 to 20 plf at 12.72  
PLT: From 25 plf at 12.72 to 25 plf at 16.56  
PLT: From 100 plf at 5.35 to 100 plf at 16.56  
BC: From 5 plf at -1.54 to 5 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 21.92  
BC: From 75 plf at 6.30 to 75 plf at 21.63  
BC: From 200 plf at 6.30 to 200 plf at 21.63  
TC: 1200 lb Conc. Load at 10.96  
BC: 1121 lb Conc. Load at 5.23  
BC: 106 lb Conc. Load at 5.35,16.56

#### Purlins

Collar-tie braced with continuous lateral bracing at 24" oc. or rigid ceiling.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes


The overall height of this truss excluding overhang is 10-11-14.  
WIND LOAD CASE MODIFIED

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| L - K  | 1165 -345  | K - J  | 1165 -345   |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| B - M | 505 -1654  | E - N | 403 -129    |
| B - L | 1241 -367  | N - F | 565 -1712   |
| L - C | 678 -232   | J - H | 1231 -364   |
| D - N | 565 -1712  | H - I | 552 -1929   |

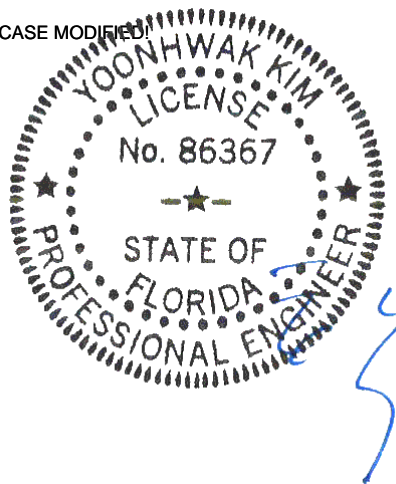

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 360370<br>FROM: CDM | COMN<br>Ply: 2<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A07 | Cust: R 215 JRef: 1X3d2150006 T44<br>DrwNo: 062.21.0902.40007<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

2 Complete Trusses Required

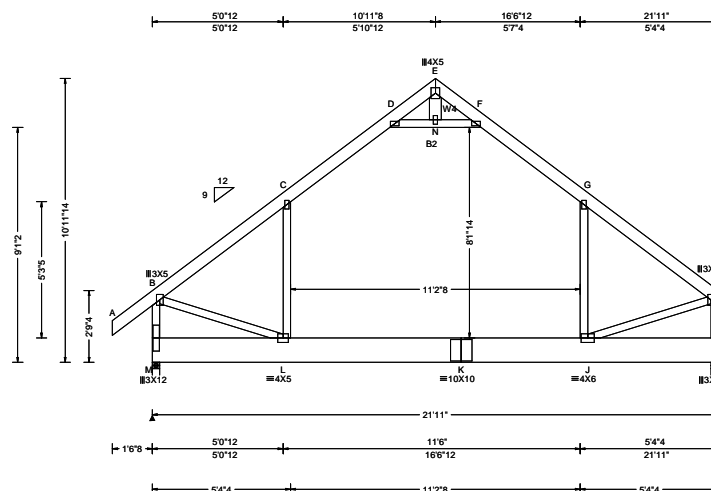

| Loading Criteria (psf)   | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|--|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: No<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.130 J 999 480<br>VERT(CL): 0.220 J 999 360<br>HORZ(LL): -0.132 G - -<br>HORZ(TL): 0.223 G - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.341<br>Max BC CSI: 0.277<br>Max Web CSI: 0.379<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>M 2610 - / - / - / 647 - / -<br>O 2800 - / - / - / 781 - / -<br>Wind reactions based on MWFRS<br>M Brg Width = 3.5 Min Req = 1.5<br>O Brg Width = 3.5 Min Req = 1.5<br>Bearings M & O are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 354 - 1299 F - G 265 - 993<br>C - D 270 - 1001 G - H 359 - 1304 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x12 SP 2400f-2.0E; B2 2x4 SP #2;  
Webs: 2x4 SP #3; W4 2x6 SP 2400f-2.0E;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 8.25" o.c.  
Webs : 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails  
in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 65 plf at -1.54 to 65 plf at 21.92  
BC: From 5 plf at -1.54 to 5 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 10.96  
BC: From 260 plf at 10.96 to 260 plf at 16.56  
BC: From 20 plf at 16.56 to 20 plf at 21.92  
PLB: From 40 plf at 5.35 to 40 plf at 16.56  
TC: 900 lb Conc. Load at 10.96  
BC: 498 lb Conc. Load at 7.25  
BC: 248 lb Conc. Load at 16.69

#### Plating Notes

All plates are 2X4 except as noted.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes


WARNING: 20 psf additional bottom chord live load  
check has been modified  
The overall height of this truss excluding overhang is  
10-11-14.  
WIND LOAD CASE MODIFIED!

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| L - K  | 934 - 252  | K - J  | 934 - 252   |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| B - M | 372 - 1342 | N - F | 333 - 1118  |
| B - L | 996 - 269  | J - H | 994 - 268   |
| D - N | 333 - 1118 | H - I | 361 - 1296  |

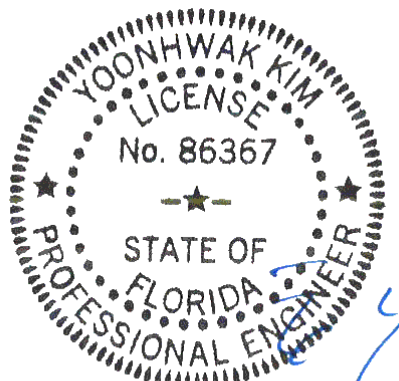

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 360372<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A08 | Cust: R 215 JRef: 1X3d2150006 T97<br>DrwNo: 062.21.0902.42990<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

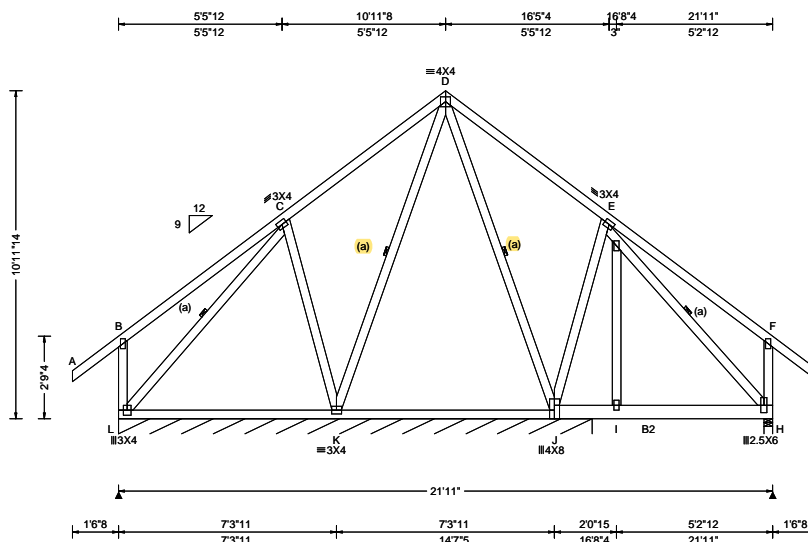

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs), or *=PLF   |
|---|--|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.004 I 999 480<br>VERT(CL): 0.008 I 999 360<br>HORZ(LL): -0.001 B - -<br>HORZ(TL): 0.002 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.500<br>Max BC CSI: 0.754<br>Max Web CSI: 0.299<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>L* 137 /- /- /- /22 /-<br>H 431 /- /- /- /105 /-<br>Wind reactions based on MWFRS<br>L Brg Width = 190 Min Req = -<br>H Brg Width = 3.5 Min Req = 1.5<br>Bearings L & H are a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2; B2 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Additional Notes

The overall height of this truss excluding overhang is 10-11-14.

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 65 plf at -1.54 to 65 plf at 23.46  
BC: From 5 plf at -1.54 to 5 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 21.92  
BC: From 5 plf at 21.92 to 5 plf at 23.46  
PLB: From 40 plf at 3.51 to 40 plf at 6.21  
PLB: From 40 plf at 8.70 to 40 plf at 13.22  
BC: 237 lb Conc. Load at 16.69

#### Plating Notes


All plates are 2X4 except as noted.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

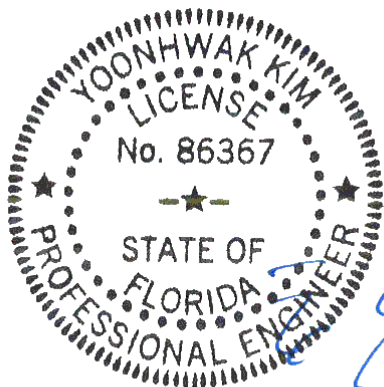

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339528<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A09 | Cust: R 215 JRef: 1X3d2150006 T104<br>DrwNo: 062.21.0902.45063<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

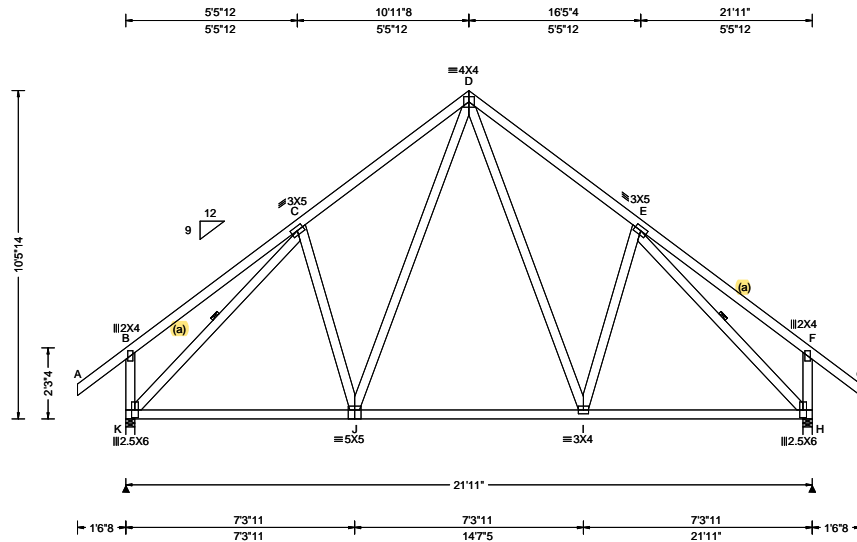

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.030 I 999 480<br>VERT(CL): 0.053 I 999 360<br>HORZ(LL): 0.018 F - -<br>HORZ(TL): 0.033 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.338<br>Max BC CSI: 0.617<br>Max Web CSI: 0.410<br><br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>K 1221 - / - / /619 - / /291<br>H 1221 - / - / /619 - / -<br>Wind reactions based on MWFRS<br>K Brg Width = 3.5 Min Req = 1.5<br>H Brg Width = 3.5 Min Req = 1.5<br>Bearings K & H are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>C - D 313 - 1074 D - E 313 - 1076 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10-5-14.

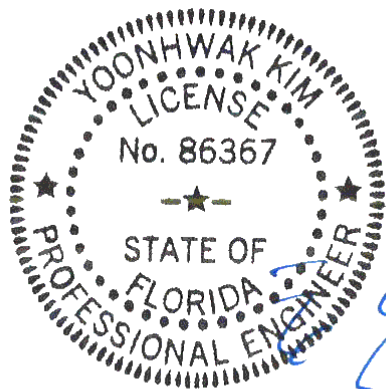

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| K - J  | 795 -148   | I - H  | 796 -37     |
| J - I  | 626 -53    |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| K - C | 55 -1153   | D - I | 429 -121    |
| J - D | 425 -121   | E - H | 54 -1155    |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339525<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A10 | Cust: R 215 JRef: 1X3d2150006 T103<br>DrwNo: 062.21.0902.46910<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

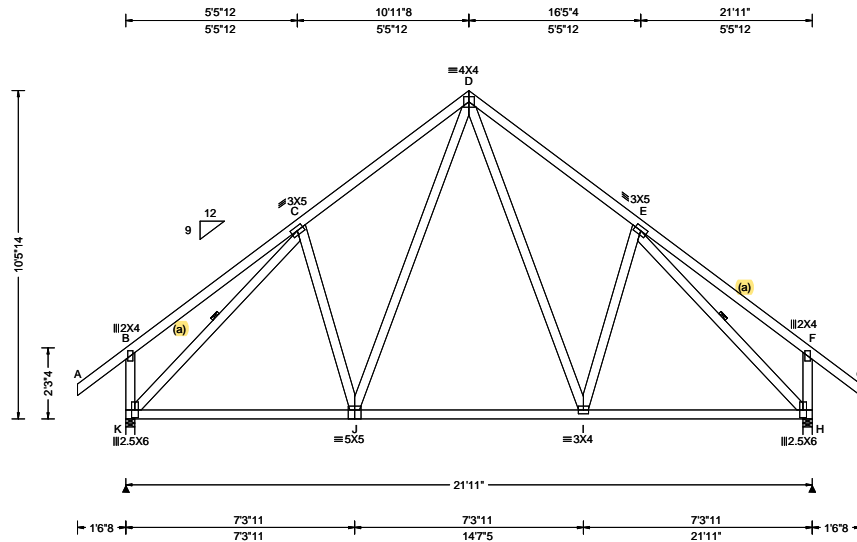

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.030 I 999 480<br>VERT(CL): 0.053 I 999 360<br>HORZ(LL): 0.018 F - -<br>HORZ(TL): 0.033 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.338<br>Max BC CSI: 0.617<br>Max Web CSI: 0.410<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>K 1221 - / - / 619 - / 291<br>H 1221 - / - / 619 - / -<br>Wind reactions based on MWFRS<br>K Brg Width = 3.5 Min Req = 1.5<br>H Brg Width = 3.5 Min Req = 1.5<br>Bearings K & H are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>C - D 313 - 1074 D - E 313 - 1076 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10-5-14.

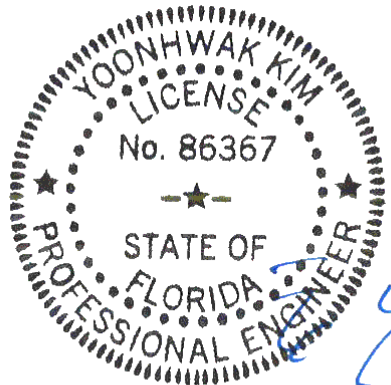

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339522<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A11 | Cust: R 215 JRef: 1X3d2150006 T5<br>DrwNo: 062.21.0902.48503<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

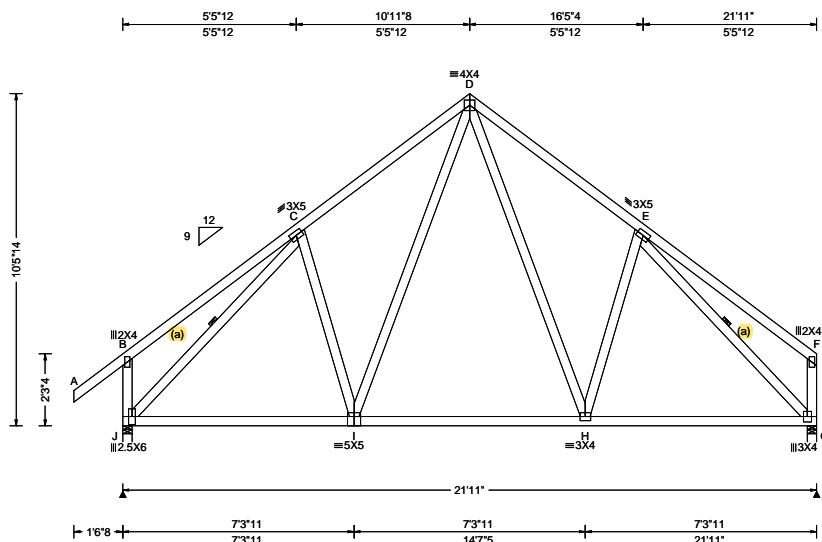

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.030 H 999 480<br>VERT(CL): 0.054 H 999 360<br>HORZ(LL): 0.019 F - -<br>HORZ(TL): 0.033 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.373<br>Max BC CSI: 0.620<br>Max Web CSI: 0.413<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>J 1225 - / - / 621 - / 270<br>G 1109 - / - / 527 - / -<br>Non-Gravity<br>Wind reactions based on MWFRS<br>J Brg Width = 3.5 Min Req = 1.5<br>G Brg Width = 3.5 Min Req = 1.5<br>Bearings J & G are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>C - D 310 - 1079 D - E 310 - 1089 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10-5-14.

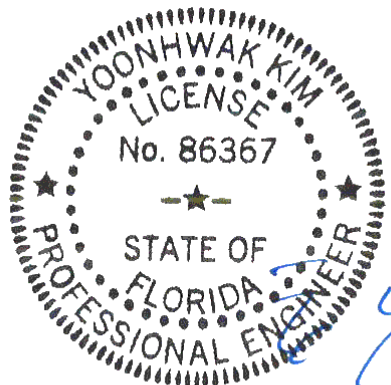

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| J - I  | 799 - 108  | H - G  | 809 - 75    |
| I - H  | 630 - 14   |        |             |


#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| J - C | 52 - 1158  | D - H | 444 - 119   |
| I - D | 425 - 123  | E - G | 105 - 1164  |


**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339519<br>FROM: CDM | COMN<br>Ply: 3<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A12 | Cust: R 215 JRef: 1X3d2150006 T123<br>DrwNo: 062.21.0902.54860<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|



3 Complete Trusses Required

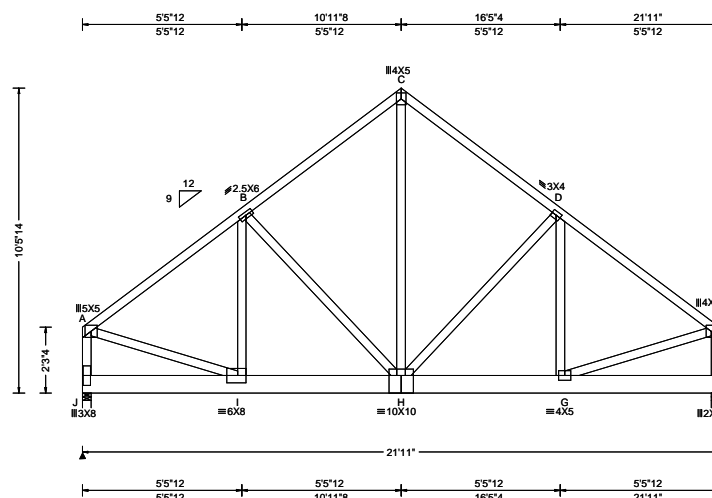

| Loading Criteria (psf)   | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|--|---|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.47 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.057 H 999 480<br>VERT(CL): 0.115 H 999 360<br>HORZ(LL): 0.022 B - -<br>HORZ(TL): 0.043 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.265<br>Max BC CSI: 0.576<br>Max Web CSI: 0.806<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>J 7856 -/- /- /- /938 -/-<br>F 5669 -/- /- /- /742 -/-<br>Non-Gravity<br>Wind reactions based on MWFRS<br>J Brg Width = 3.5 Min Req = 3.1<br>F Brg Width = 3.5 Min Req = 2.2<br>Bearings J & F are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 337 -2401 C - D 274 -1834<br>B - C 273 -1832 D - E 284 -2004 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x8 SP #2;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 2 Rows @ 5.50" o.c. (Each Row)  
Webs : 1 Row @ 4" o.c.  
Repeat nailing as each layer is applied. Use equal spacing between rows and stagger nails in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 33 plf at 0.00 to 33 plf at 18.54  
TC: From 65 plf at 18.54 to 65 plf at 21.92  
BC: From 10 plf at 0.00 to 10 plf at 21.92  
BC: 1309 lb Conc. Load at 0.81, 2.81, 4.81  
BC: 1515 lb Conc. Load at 6.81  
BC: 1584 lb Conc. Load at 8.81  
BC: 1458 lb Conc. Load at 10.81  
BC: 1605 lb Conc. Load at 12.81  
BC: 1373 lb Conc. Load at 14.81  
BC: 564 lb Conc. Load at 18.54  
BC: 456 lb Conc. Load at 20.54

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes


The overall height of this truss excluding overhang is 10'-5-14".

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| I - H  | 1881 -263  | H - G  | 1572 -219   |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - J | 297 -2093  | C - H | 2116 -300   |
| A - I | 1995 -277  | G - E | 1651 -227   |
| I - B | 753 -70    | E - F | 254 -1761   |
| B - H | 73 -634    |       |             |

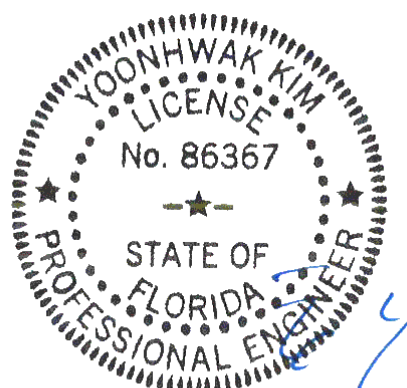

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339514<br>FROM: CDM | MONO<br>Ply: 1<br>Qty: 6 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A13 | Cust: R 215 JRef: 1X3d2150006 T3<br>DrwNo: 062.21.0902.57943<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

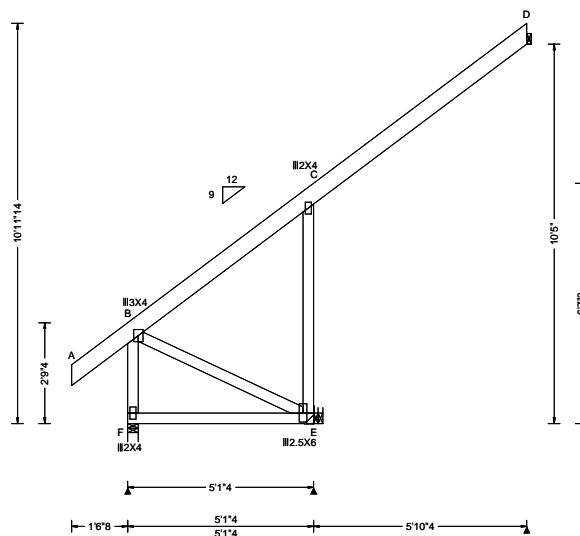

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.002 C 999 480<br>VERT(CL): 0.005 C 999 360<br>HORZ(LL): -0.005 C - -<br>HORZ(TL): 0.007 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.094<br>Max BC CSI: 0.291<br>Max Web CSI: 0.297<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>F 316 /- /- /224 /- /224<br>E 470 /- /- /450 /252 /-<br>D 161 /- /- /120 /62 /-<br>Wind reactions based on MWFRS<br>F Brg Width = 3.5 Min Req = 1.5<br>E Brg Width = - Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing F is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. |

#### Lumber

Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=4'10"4 uses the following support conditions: 4'10"4

Bearing E (4'10"4, 8'7"2) LUS26  
Supporting Member: (2)2x6 SP 2400F-2.0E  
(4) 0.148"x3" nails into supporting member,  
(3) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 10-11-14.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

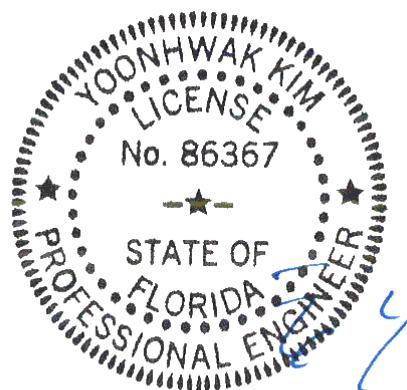

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

B - C 176 -430

#### Maximum Bot Chord Forces Per Ply (lbs)

Chords Tens.Comp.

F - E 176 -484

#### Maximum Web Forces Per Ply (lbs)


Webs Tens.Comp. Webs Tens. Comp.

B - E 533 -193 C - E 426 -419

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339504<br>FROM: CDM | MONO<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A14 | Cust: R 215 JRef: 1X3d2150006 T54<br>DrwNo: 062.21.0902.59890<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

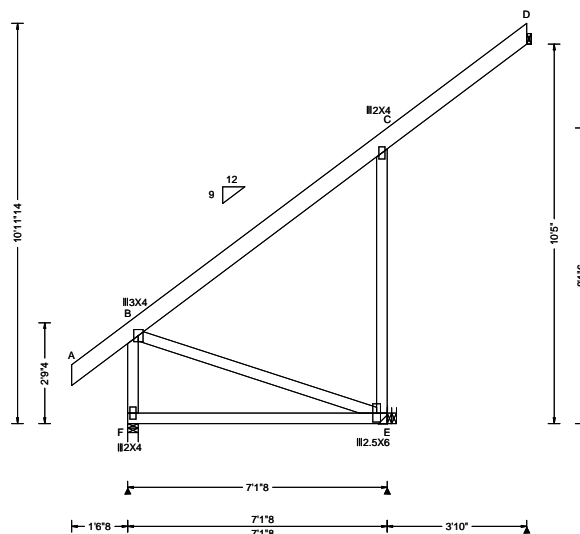

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.003 C 999 480<br>VERT(CL): 0.006 C 999 360<br>HORZ(LL): -0.006 C - -<br>HORZ(TL): 0.008 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.112<br>Max BC CSI: 0.575<br>Max Web CSI: 0.494<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>F 389 -/- /- /224 -/- /224<br>E 521 -/- /- /472 /226 -/-<br>D 93 -/14 -/- /45 /22 -/-<br>Wind reactions based on MWFRS<br>F Brg Width = 3.5 Min Req = 1.5<br>E Brg Width = - Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing F is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. |

#### Lumber

Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=6'10"8 uses the following support conditions: 6'10"8

Bearing E (6'10"8, 8'7"2) LUS26  
Supporting Member: (2)2x6 SP 2400F-2.0E  
(4) 0.148"x3" nails into supporting member,  
(3) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 10-11-14.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

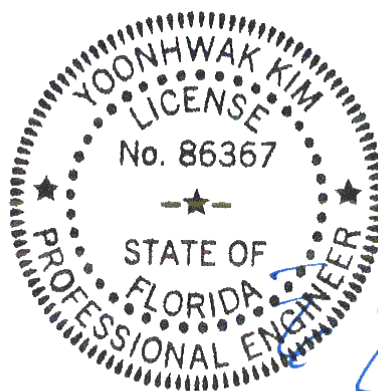

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

B - C 175 -388

#### Maximum Bot Chord Forces Per Ply (lbs)

Chords Tens.Comp.

F - E 185 -485

#### Maximum Web Forces Per Ply (lbs)

Webs Tens.Comp. Webs Tens. Comp.

B - E 510 -195 C - E 455 -448

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339508<br>FROM: CDM | MONO<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A15 | Cust: R 215 JRef: 1X3d2150006 T2<br>DrwNo: 062.21.0903.01617<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

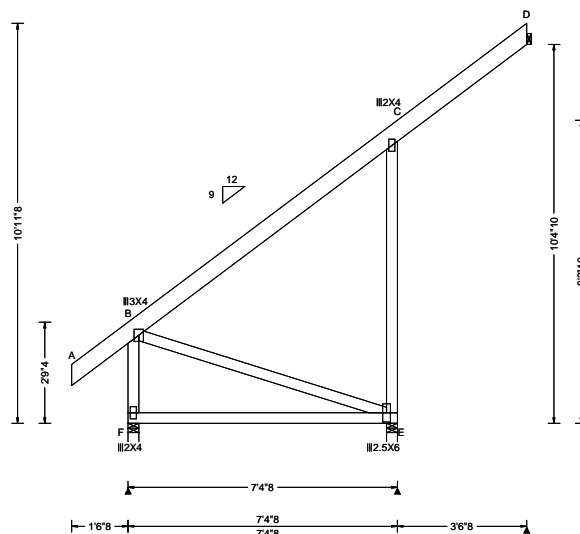

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.003 C 999 480<br>VERT(CL): 0.006 C 999 360<br>HORZ(LL): -0.006 C - -<br>HORZ(TL): 0.008 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.121<br>Max BC CSI: 0.614<br>Max Web CSI: 0.531<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>F 397 /- /- /230 /- /223<br>E 534 /- /- /481 /226 /-<br>D 80 /-30 /- /30 /13 /-<br>Wind reactions based on MWFRS<br>F Brg Width = 3.5 Min Req = 1.5<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>Bearings F & E are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. |

#### Lumber


Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10-11-8.

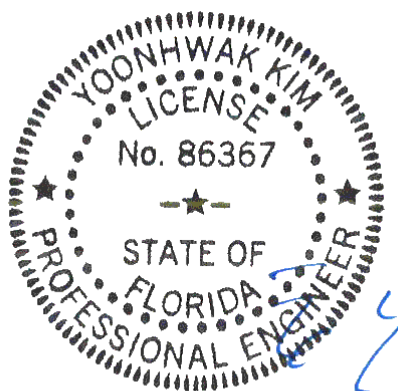

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

B - C 176 -383

#### Maximum Bot Chord Forces Per Ply (lbs)

Chords Tens.Comp.

F - E 186 -484

#### Maximum Web Forces Per Ply (lbs)


Webs Tens.Comp. Webs Tens. Comp.

B - E 508 -196 C - E 467 -459

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339512<br>FROM: CDM | MONO<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: A16 | Cust: R 215 JRef: 1X3d2150006 T99<br>DrwNo: 062.21.0903.04940<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

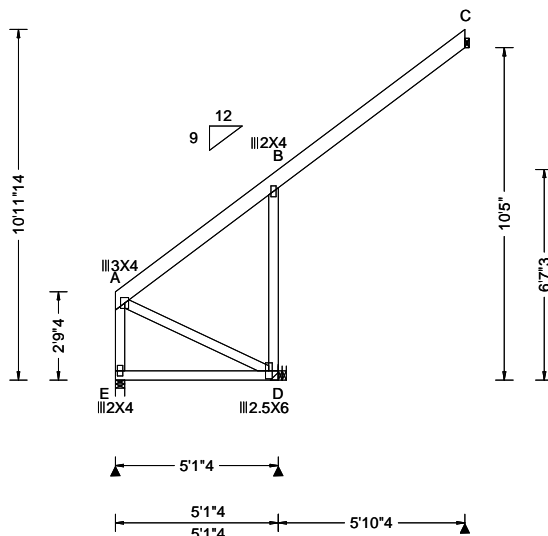

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.47 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.003 B 999 480<br>VERT(CL): 0.005 B 999 360<br>HORZ(LL): -0.005 B - -<br>HORZ(TL): 0.006 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.102<br>Max BC CSI: 0.291<br>Max Web CSI: 0.312<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 188 -/- /- /227 /67 /204<br>D 492 -/- /- /454 /249 -/-<br>C 160 -/- /- /117 /62 -/-<br>Wind reactions based on MWFRS<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = - Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. |

#### Lumber

Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=4'10"4 uses the following support conditions: 4'10"4

Bearing D (4'10"4, 8'7"2) LUS26  
Supporting Member: (2)2x6 SP 2400F-2.0E  
(4) 0.148"x3" nails into supporting member,  
(3) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 10-11-14.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

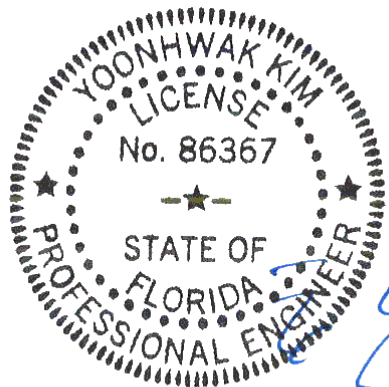

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

Chords Tens.Comp.

E - D 138 -405

#### Maximum Web Forces Per Ply (lbs)

Webs Tens.Comp. Webs Tens. Comp.

A - E 94 -378 B - D 445 -441  
A - D 446 -151

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 614323<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: B01 | Cust: R 215 JRef: 1X3d2150006 T34<br>DrwNo: 062.21.0903.08150<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

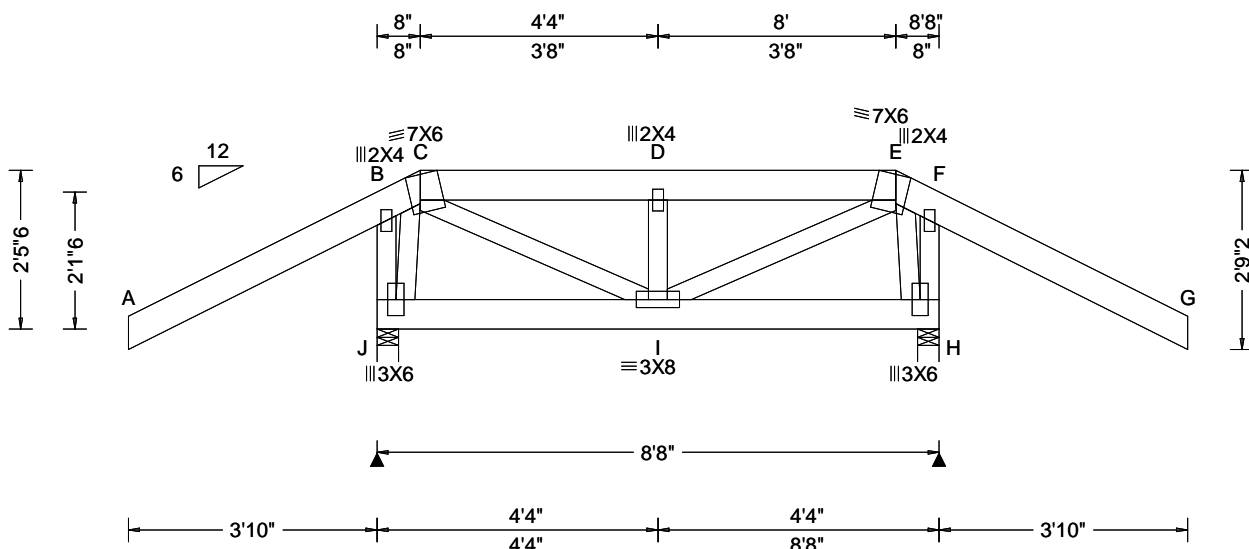

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.42 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.006 D 999 480<br>VERT(CL): 0.011 D 999 360<br>HORZ(LL): -0.002 F - -<br>HORZ(TL): 0.003 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.259<br>Max BC CSI: 0.045<br>Max Web CSI: 0.216<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>J 893 /- /- /- /158 /-<br>H 893 /- /- /- /158 /-<br>Wind reactions based on MWFRS<br>J Brg Width = 4.0 Min Req = 1.5<br>H Brg Width = 4.0 Min Req = 1.5<br>Bearings J & H are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>C - D 0 -411 D - E 0 -411 |

#### Lumber

Top chord: 2x6 SP 2400f-2.0E;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 62 plf at -3.83 to 62 plf at 0.67  
TC: From 31 plf at 0.67 to 31 plf at 8.00  
TC: From 62 plf at 8.00 to 62 plf at 12.50  
BC: From 4 plf at -3.83 to 4 plf at 0.00  
BC: From 10 plf at 0.00 to 10 plf at 8.67  
BC: From 4 plf at 8.67 to 4 plf at 12.50  
TC: 101 lb Conc. Load at 0.70, 7.97  
TC: 69 lb Conc. Load at 2.73, 4.33, 5.94  
BC: 143 lb Conc. Load at 0.70, 7.97  
BC: 60 lb Conc. Load at 2.73, 4.33, 5.94

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2'-5-6.

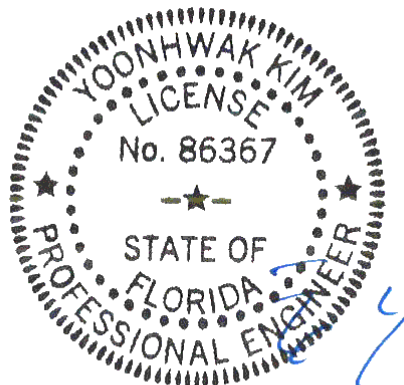


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609163<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: B02 | Cust: R 215 JRef: 1X3d2150006 T49<br>DrwNo: 062.21.0903.10440<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

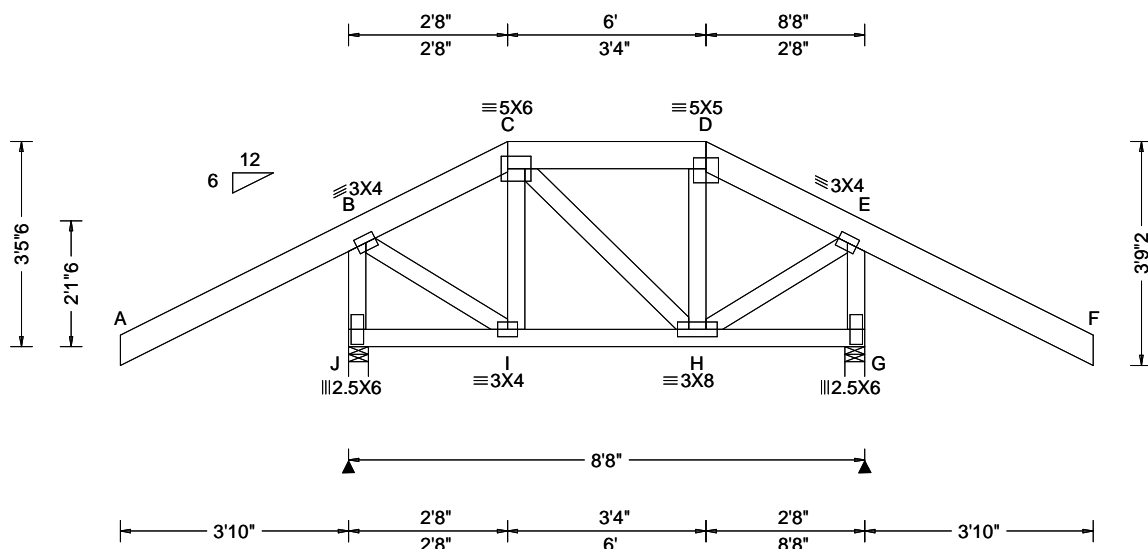

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|---|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.92 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.002 I 999 480<br>VERT(CL): 0.003 I 999 360<br>HORZ(LL): -0.001 E - -<br>HORZ(TL): 0.001 E - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.235<br>Max BC CSI: 0.089<br>Max Web CSI: 0.199<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>J 613 -/- /- /429 /111 /126<br>G 613 -/- /- /429 /111 /-<br>Wind reactions based on MWFRS<br>J Brg Width = 4.0 Min Req = 1.5<br>G Brg Width = 4.0 Min Req = 1.5<br>Bearings J & G are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Web Forces Per Ply (lbs)<br>Webs Tens.Comp. Webs Tens. Comp.<br>B - J 546 -591 E - G 546 -590 |

#### Lumber


Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3'-5-6.

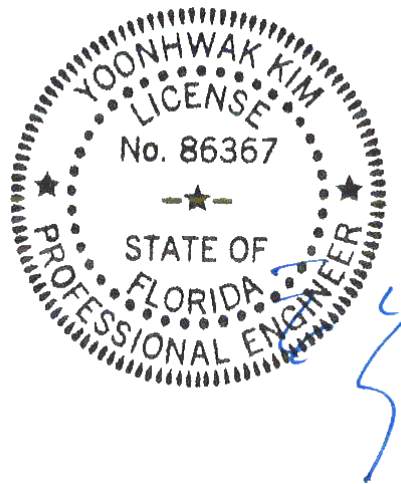

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609161<br>FROM: CDM | COMN<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: B03 | Cust: R 215 JRef: 1X3d2150006 T48<br>DrwNo: 062.21.0903.12047<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

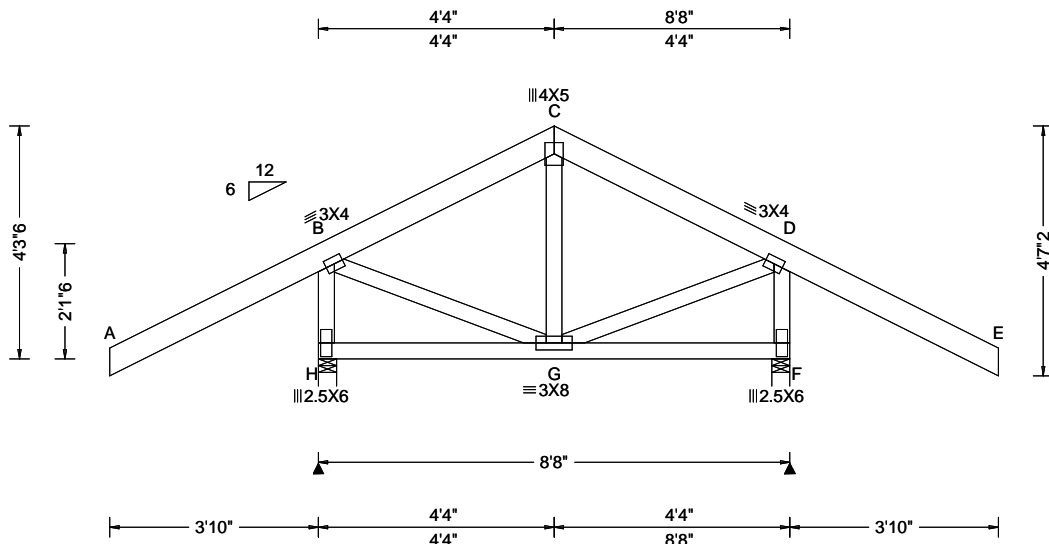

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 16.33 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.002 G 999 480<br>VERT(CL): 0.003 G 999 360<br>HORZ(LL): 0.001 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.236<br>Max BC CSI: 0.171<br>Max Web CSI: 0.201<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>H 613 - / - / - / 428 / 88 / 147<br>F 613 - / - / - / 252 / 156 / -<br>Wind reactions based on MWFRS<br>H Brg Width = 4.0 Min Req = 1.5<br>F Brg Width = 4.0 Min Req = 1.5<br>Bearings H & F are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Web Forces Per Ply (lbs)<br>Webs Tens.Comp. Webs Tens. Comp.<br>B - H 468 -579 D - F 468 -579 |

#### Lumber


Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4'-3.6".

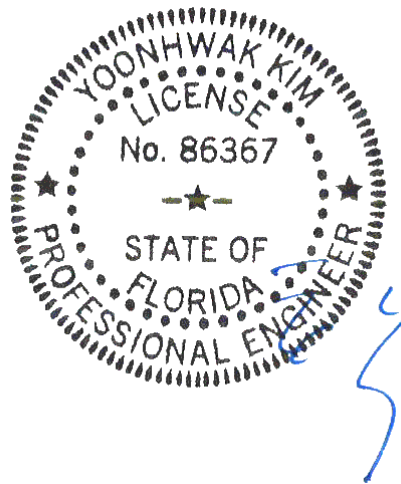

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609049<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: B04 | Cust: R 215 JRef: 1X3d2150006 T33<br>DrwNo: 062.21.0903.13620<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

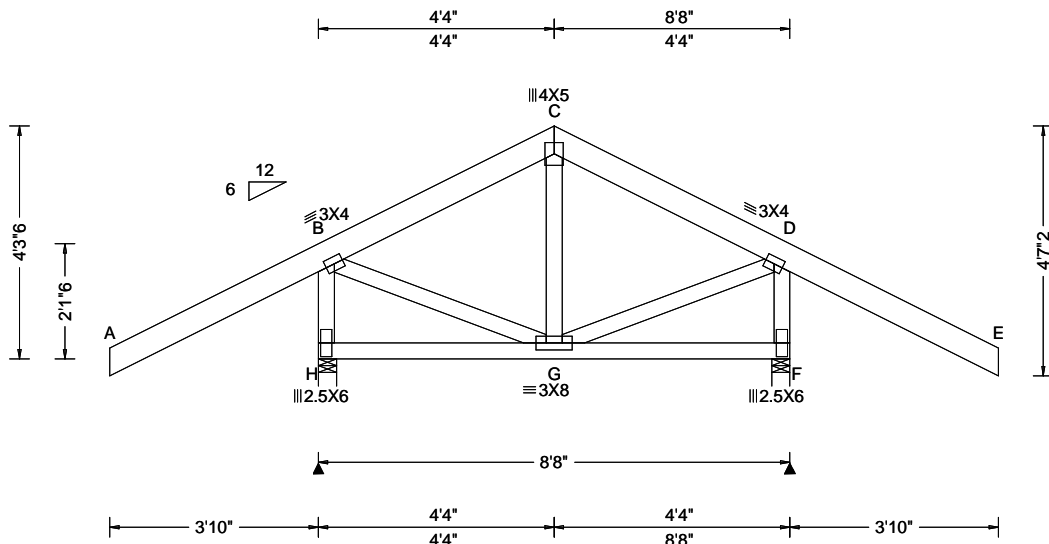

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 16.33 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.002 G 999 480<br>VERT(CL): 0.003 G 999 360<br>HORZ(LL): 0.001 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.236<br>Max BC CSI: 0.171<br>Max Web CSI: 0.201<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>H 613 - / - / 428 / 88 / 147<br>F 613 - / - / 252 / 156 / -<br>Wind reactions based on MWFRS<br>H Brg Width = 4.0 Min Req = 1.5<br>F Brg Width = 4.0 Min Req = 1.5<br>Bearings H & F are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Web Forces Per Ply (lbs)<br>Webs Tens.Comp. Webs Tens. Comp.<br>B - H 468 -579 D - F 468 -579 |

#### Lumber


Top chord: 2x6 SP 2400F-2.0E;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4'-3\"/>

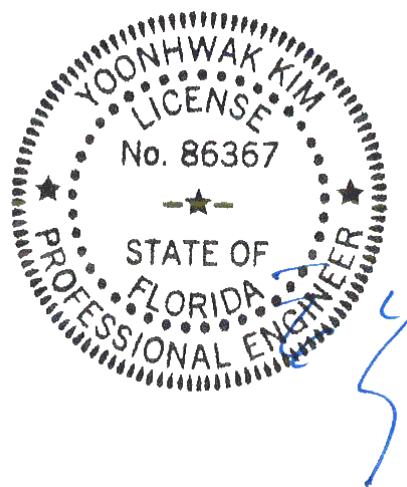

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 614331<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C01 | Cust: R 215 JRef: 1X3d2150006 T53<br>DrwNo: 062.21.0903.31517<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

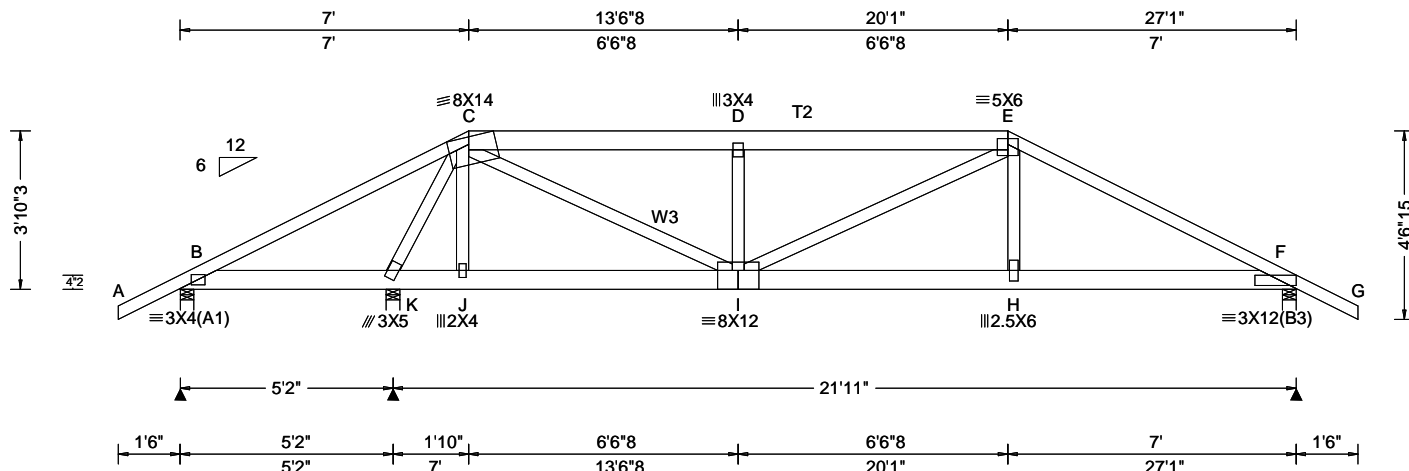

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.096 D 999 480<br>VERT(CL): 0.192 D 999 360<br>HORZ(LL): 0.017 H - -<br>HORZ(TL): 0.033 H - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.849<br>Max BC CSI: 0.302<br>Max Web CSI: 0.889<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 294 /-78 /- /1 /- /-<br>K 3028 /- /- /- /626 /-<br>F 1973 /- /- /- /428 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>K Brg Width = 4.0 Min Req = 2.1<br>F Brg Width = 4.0 Min Req = 1.6<br>Bearings B, K, & F are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2; T2 2x6 SP 2400f-2.0E;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3; W3 2x4 SP #2;

#### Special Loads

----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 62 plf at -1.50 to 62 plf at 7.00  
TC: From 31 plf at 7.00 to 31 plf at 20.09  
TC: From 62 plf at 20.09 to 62 plf at 28.59  
BC: From 4 plf at -1.50 to 4 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 7.03  
BC: From 10 plf at 7.03 to 10 plf at 20.05  
BC: From 20 plf at 20.05 to 20 plf at 27.09  
BC: From 4 plf at 27.09 to 4 plf at 28.59  
TC: 252 lb Conc. Load at 7.03  
TC: 187 lb Conc. Load at 9.06,11.06,13.06,14.02  
16.02,18.02  
TC: 263 lb Conc. Load at 20.05  
BC: 154 lb Conc. Load at 7.03  
BC: 129 lb Conc. Load at 9.06,11.06,13.06,14.02  
16.02,18.02  
BC: 467 lb Conc. Load at 20.05

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-10-3.

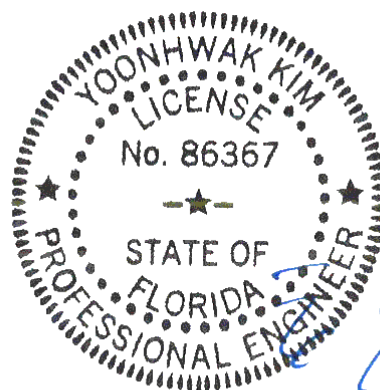


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608837<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C02 | Cust: R 215 JRef: 1X3d2150006 T26<br>DrwNo: 062.21.0903.33230<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

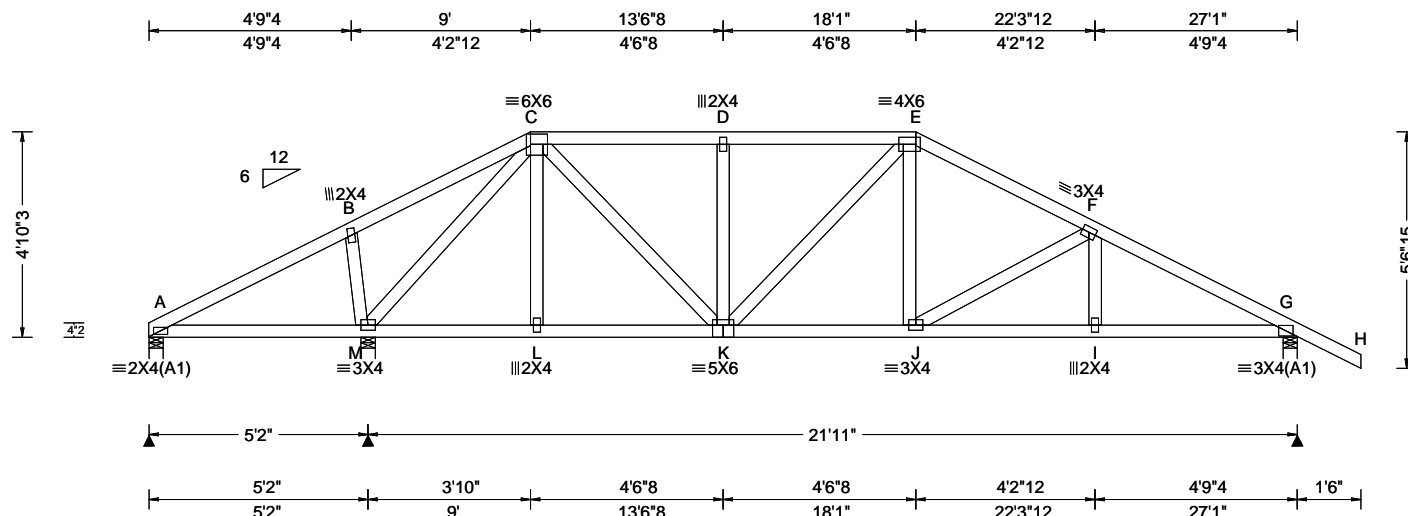

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.040 J 999 480<br>VERT(CL): 0.083 J 999 360<br>HORZ(LL): 0.015 I - -<br>HORZ(TL): 0.030 I - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.447<br>Max BC CSI: 0.387<br>Max Web CSI: 0.811<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>A 145 /-51 /- /47 /3 /134<br>M 1294 /- /- /724 /215 /-<br>G 976 /- /- /607 /164 /-<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>M Brg Width = 4.0 Min Req = 1.5<br>G Brg Width = 4.0 Min Req = 1.5<br>Bearings A, M, & G are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4'-10"-3".

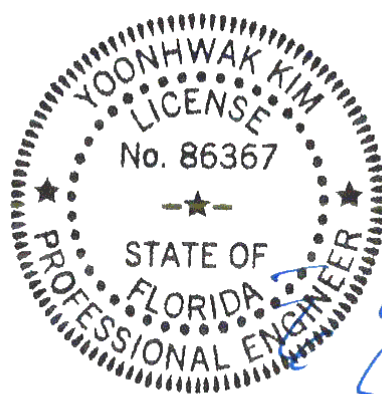

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| M - L  | 478 -104   | J - I  | 1273 -416   |
| L - K  | 480 -102   | I - G  | 1275 -414   |
| K - J  | 977 -315   |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| M - C | 463 -1153  | C - K | 644 -338    |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608840<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C03 | Cust: R 215 JRef: 1X3d2150006 T84<br>DrwNo: 062.21.0903.34610<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

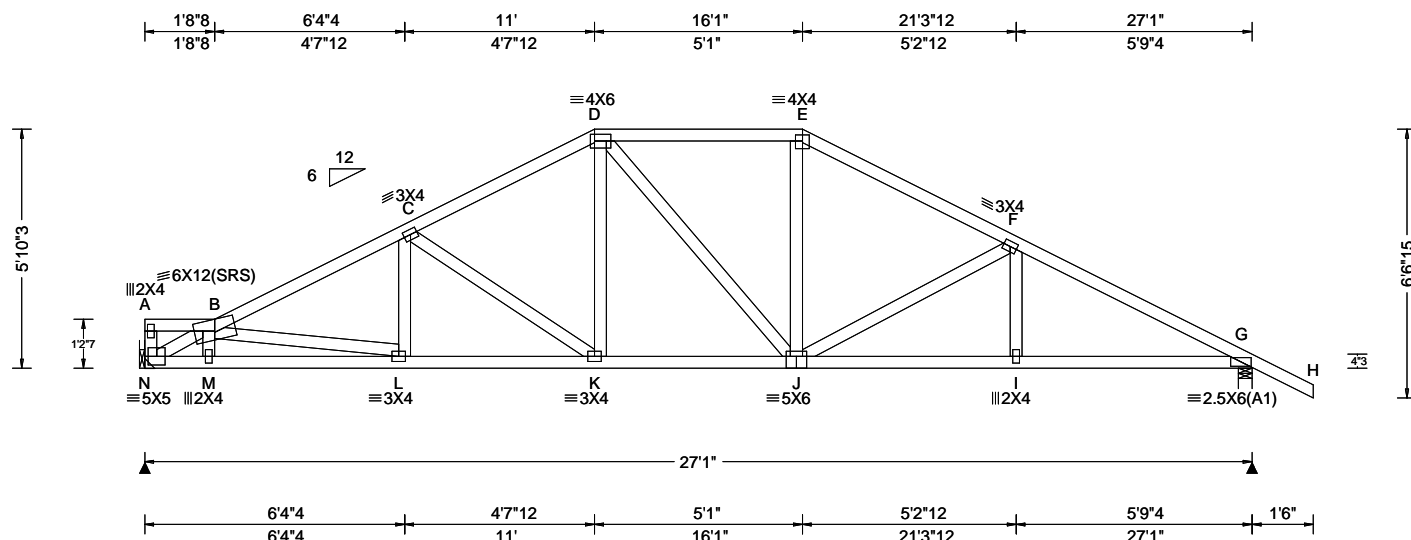

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.081 K 999 480<br>VERT(CL): 0.166 K 999 360<br>HORZ(LL): 0.036 I - -<br>HORZ(TL): 0.074 I - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.328<br>Max BC CSI: 0.553<br>Max Web CSI: 0.403<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1106 - / - / - /614 /177 /150<br>G 1225 - / - / - /726 /202 - / -<br>Wind reactions based on MWFRS<br>N Brg Width = - Min Req = -<br>G Brg Width = 4.0 Min Req = 1.5<br>Bearing G is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 638 -1978 E - F 592 -1538<br>C - D 597 -1542 F - G 621 -1989<br>D - E 581 -1318 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing N (0', 9'1"2) LUS26

Supporting Member: (2)2x6 SP 2400F-2.0E

(4) 0.148"x3" nails into supporting

member,

(4) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 5-10-3.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

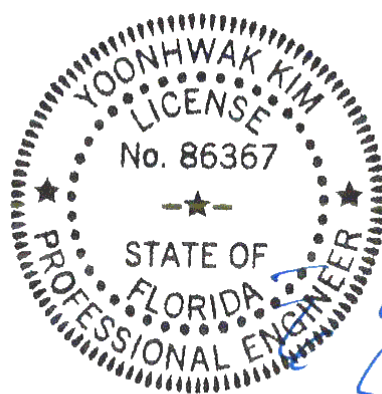

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| N - M  | 1919 -521  | K - J  | 1318 -326   |
| M - L  | 1916 -530  | J - I  | 1708 -460   |
| L - K  | 1712 -464  | I - G  | 1710 -458   |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| N - B | 654 -2155  | J - E | 381 -35     |
| C - K | 169 -483   | J - F | 149 -456    |
| D - K | 396 -48    |       |             |

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCEA: sbceindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608843<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C04 | Cust: R 215 JRef: 1X3d2150006 T16<br>DrwNo: 062.21.0903.36380<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

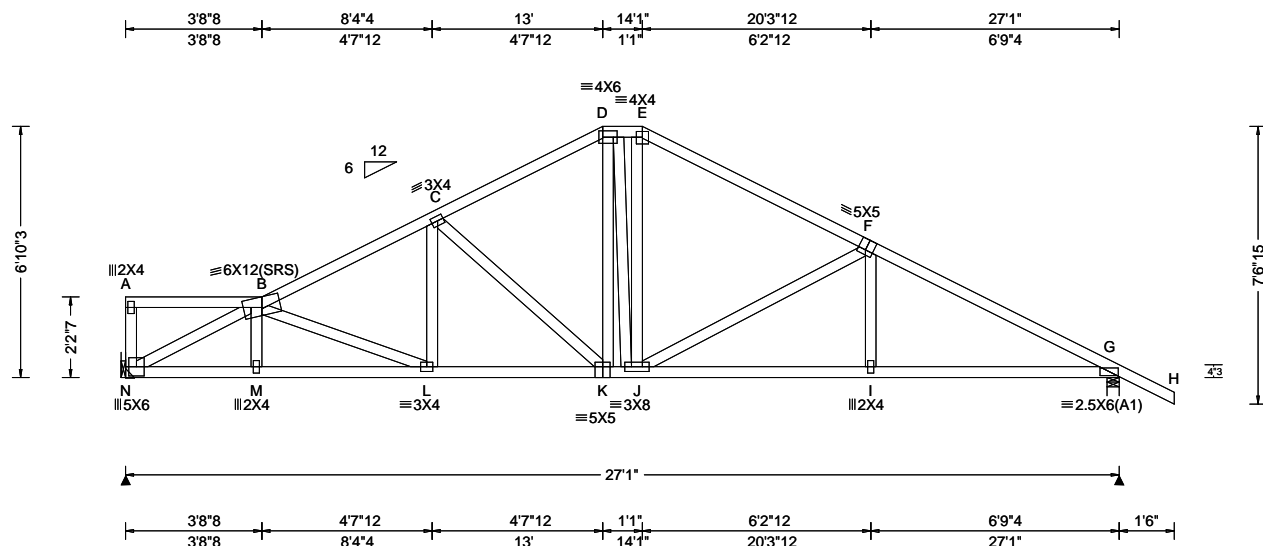

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.081 K 999 480<br>VERT(CL): 0.165 K 999 360<br>HORZ(LL): 0.036 I - -<br>HORZ(TL): 0.073 I - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.437<br>Max BC CSI: 0.620<br>Max Web CSI: 0.656<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1106 - / - / 590 / 179 / 175<br>G 1225 - / - / 730 / 198 - / -<br>Wind reactions based on MWFRS<br>N Brg Width = - Min Req = -<br>G Brg Width = 4.0 Min Req = 1.5<br>Bearing G is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 499 - 1792 E - F 435 - 1382<br>C - D 450 - 1353 F - G 481 - 1955<br>D - E 438 - 1160 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing N (0', 9'1"2) LUS26

Supporting Member: (2)2x6 SP 2400F-2.0E

(4) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 6-10-3.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

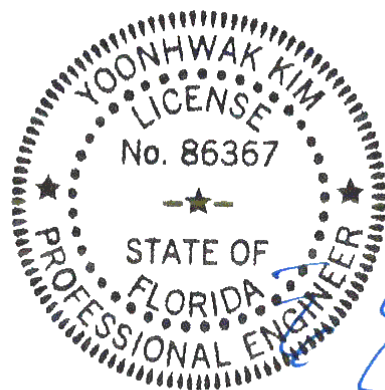

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| N - M  | 1860 - 416 | K - J  | 1144 - 143  |
| M - L  | 1855 - 420 | J - I  | 1669 - 325  |
| L - K  | 1544 - 294 | I - G  | 1672 - 324  |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| N - B | 581 - 2076 | D - K | 379 - 119   |
| C - K | 208 - 547  | J - F | 199 - 589   |


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608869<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C05 | Cust: R 215 JRRef: 1X3d2150006 T75<br>DrwNo: 062.21.0903.37943<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

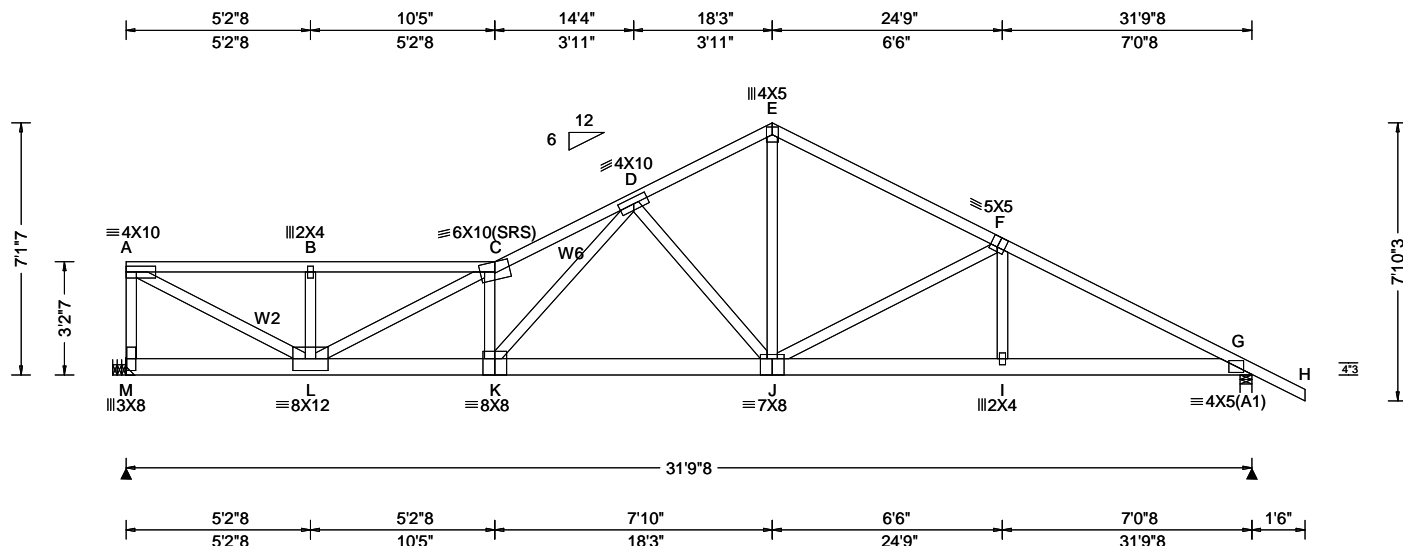

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.240 C 999 480<br>VERT(CL): 0.485 C 782 360<br>HORZ(LL): 0.065 A - -<br>HORZ(TL): 0.132 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.738<br>Max BC CSI: 0.340<br>Max Web CSI: 0.999<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>M 2515 -/- /- /- /404 -/<br>G 1596 -/- /- /- /292 -/<br>Wind reactions based on MWFRS<br>M Brg Width = - Min Req = -<br>G Brg Width = 4.0 Min Req = 1.5<br>Bearing G is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 625 -3777 D - E 370 -2158<br>B - C 625 -3778 E - F 388 -2205<br>C - D 855 -5102 F - G 487 -2779 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3; W2,W6 2x4 SP #2;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 31 plf at 0.00 to 31 plf at 4.65  
TC: From 62 plf at 4.65 to 62 plf at 33.29  
BC: From 10 plf at 0.00 to 10 plf at 4.65  
BC: From 20 plf at 4.65 to 20 plf at 31.79  
BC: From 4 plf at 31.79 to 4 plf at 33.29  
BC: 213 lb Conc. Load at 0.65, 2.65  
BC: 1158 lb Conc. Load at 4.65

#### Hangers / Ties


(J) Hanger Support Required, by others

#### Wind

Wind loads and reactions based on MWFRS.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7'-1-7.

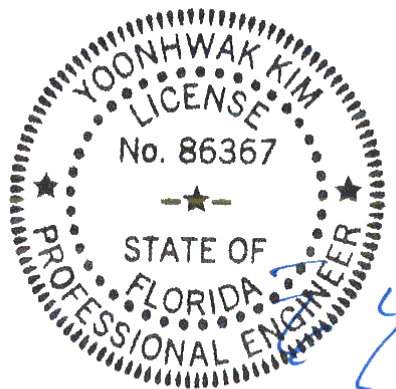


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608849<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C06 | Cust: R 215 JRRef: 1X3d2150006 T68<br>DrwNo: 062.21.0903.40413<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

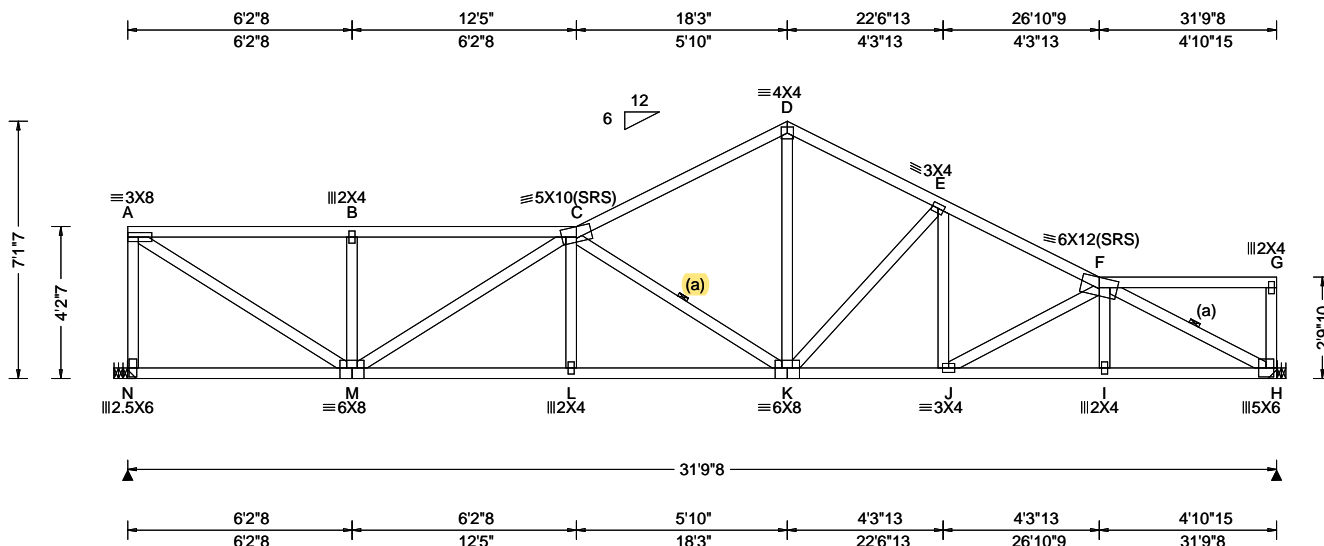

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.153 C 999 480<br>VERT(CL): 0.315 C 999 360<br>HORZ(LL): 0.047 H - -<br>HORZ(TL): 0.097 H - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.500<br>Max BC CSI: 0.766<br>Max Web CSI: 0.968<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1309 - / - / - /670 /139 /107<br>H 1309 - / - / - /695 /40 - /-<br>Wind reactions based on MWFRS<br>N Brg Width = - Min Req = -<br>H Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 700 -1751 D - E 604 -1754<br>B - C 700 -1751 E - F 663 -2151<br>C - D 605 -1782 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others

Bearing H (31'6"8, 9'1"2) HUS26

Supporting Member: (3)2x8 SP #2

(14) 0.148"x3" nails into supporting

member,

(4) 0.148"x3" nails into supported member.

#### Additional Notes

The overall height of this truss excluding overhang is 7-1-7.

#### Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.


Uplifts based on an elevation at or above 1000 ft.

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| M - L  | 2588 -857  | J - I  | 2208 -701   |
| L - K  | 2584 -859  | I - H  | 2213 -698   |
| K - J  | 1856 -532  |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - N | 573 -1255  | D - K | 1192 -382   |
| A - M | 2054 -819  | K - E | 187 -498    |
| B - M | 378 -434   | J - F | 194 -395    |
| M - C | 244 -989   | F - H | 775 -2467   |
| C - K | 539 -1277  |       |             |

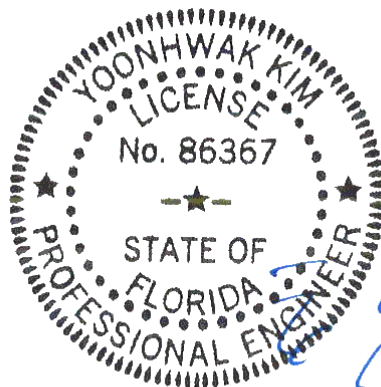

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608852<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C07 | Cust: R 215 JRRef: 1X3d2150006 T69<br>DrwNo: 062.21.0903.42347<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

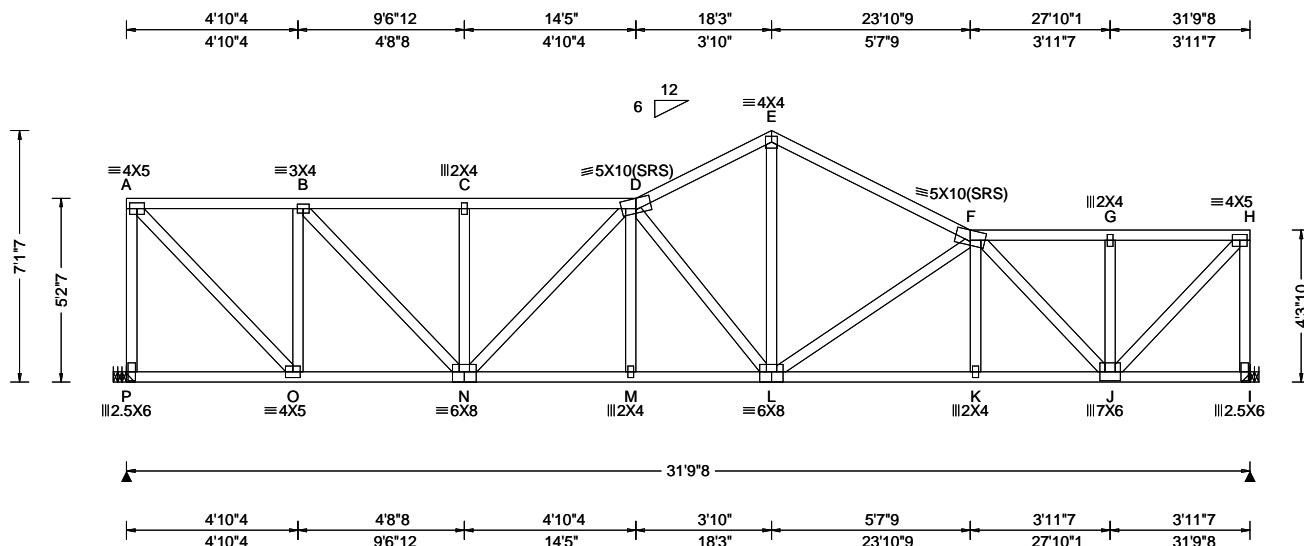

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|---|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.115 M 999 480<br>VERT(CL): 0.237 M 999 360<br>HORZ(LL): 0.038 A - -<br>HORZ(TL): 0.079 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.417<br>Max BC CSI: 0.567<br>Max Web CSI: 0.720<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>P 1309 - / - / - / 670 / 160 / 69<br>I 1309 - / - / - / 674 / 87 / -<br>Wind reactions based on MWFRS<br>P Brg Width = - Min Req = -<br>I Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 502 - 1096 E - F 723 - 1775<br>B - C 805 - 1812 F - G 486 - 1157<br>C - D 805 - 1812 G - H 486 - 1157<br>D - E 740 - 1744 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others  
Bearing I (31'6"8, 9'1"2) HUS26  
Supporting Member: (3)2x8 SP #2  
(14) 0.148"x3" nails into supporting member,  
(4) 0.148"x3" nails into supported member.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7-1-7.

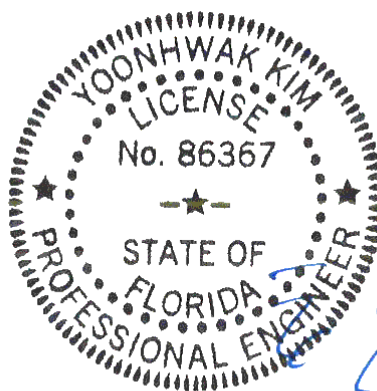

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| O - N  | 1158 - 505 | L - K  | 1974 - 785  |
| N - M  | 2120 - 866 | K - J  | 1977 - 783  |
| M - L  | 2118 - 868 |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - P | 632 - 1271 | E - L | 1195 - 465  |
| A - O | 1584 - 725 | L - F | 258 - 555   |
| O - B | 579 - 1039 | F - J | 423 - 1167  |
| B - N | 961 - 394  | J - H | 1647 - 692  |
| N - D | 132 - 438  | H - I | 579 - 1274  |
| D - L | 466 - 969  |       |             |

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbicindustry.com](http://sbicindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608855<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C08 | Cust: R 215 JRef: 1X3d2150006 T72<br>DrwNo: 062.21.0903.43917<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

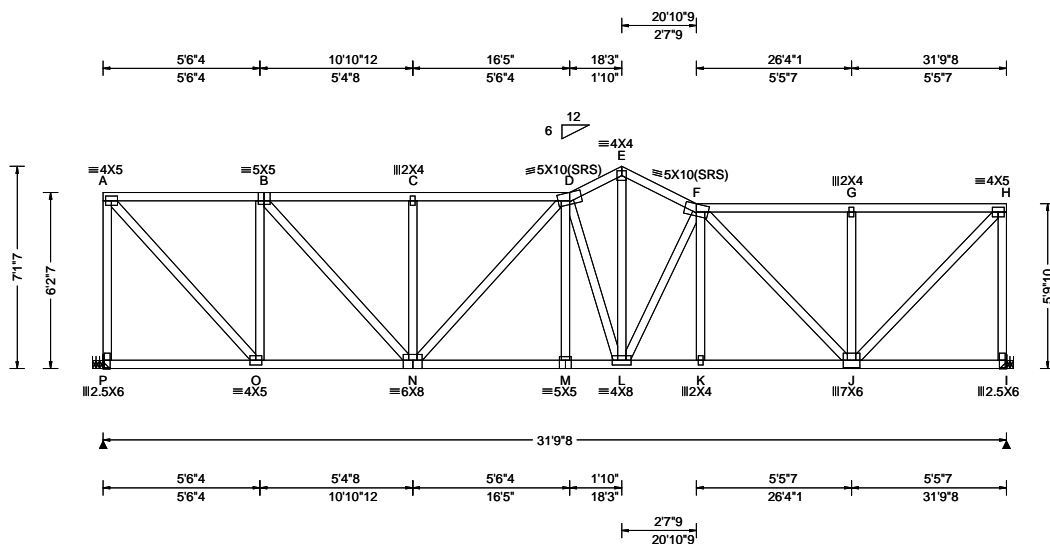

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.55 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.100 M 999 480<br>VERT(CL): 0.206 M 999 360<br>HORZ(LL): 0.034 A - -<br>HORZ(TL): 0.070 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.510<br>Max BC CSI: 0.589<br>Max Web CSI: 0.934<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>P 1309 - / - / /662 /197 /32<br>I 1309 - / - / /658 /184 - / -<br>Wind reactions based on MWFRS<br>P Brg Width = - Min Req = -<br>I Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 506 - 1019 E - F 824 - 1717<br>B - C 792 - 1620 F - G 545 - 1122<br>C - D 792 - 1620 G - H 545 - 1122<br>D - E 836 - 1708 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others  
Bearing I (31'6"8, 9'1"2) HUS26  
Supporting member: (3)2x8 SP #2  
(14) 0.148"x3" nails into supporting member,  
(4) 0.148"x3" nails into supported member.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7'-1-7/8".

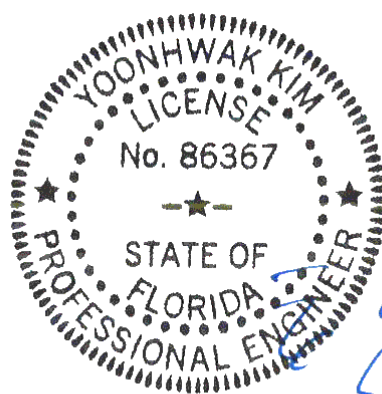

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| O - N  | 1069 - 516 | L - K  | 1718 - 809  |
| N - M  | 1777 - 830 | K - J  | 1720 - 807  |
| M - L  | 1775 - 831 |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - P | 681 - 1266 | L - F | 263 - 497   |
| A - O | 1515 - 751 | F - J | 373 - 850   |
| O - B | 618 - 1001 | G - J | 350 - 404   |
| B - N | 832 - 391  | J - H | 1594 - 774  |
| D - L | 466 - 916  | H - I | 661 - 1265  |
| E - L | 1367 - 674 |       |             |

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608858<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C09 | Cust: R 215 JRRef: 1X3d2150006 T76<br>DrwNo: 062.21.0903.45283<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

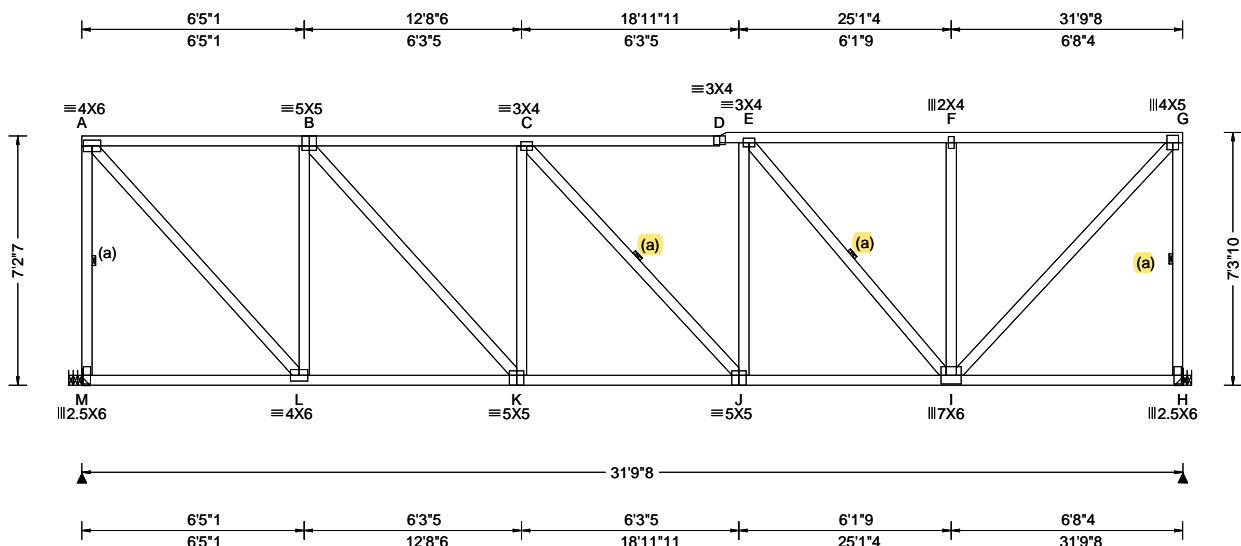

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | Maximum Reactions (lbs)  |
|---|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 16.35 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 21.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.100 C 999 480<br>VERT(CL): 0.171 C 999 360<br>HORZ(LL): 0.033 A - -<br>HORZ(TL): 0.057 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.677<br>Max BC CSI: 0.716<br>Max Web CSI: 0.937<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>M 1547 - / - / - / 652 / 230 - / -<br>H 1515 - / - / - / 652 / 233 - / -<br>Wind reactions based on MWFRS<br>M Brg Width = - Min Req = -<br>H Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 354 - 1153 D - E 445 - 1663<br>B - C 456 - 1697 E - F 369 - 1167<br>C - D 448 - 1669 F - G 369 - 1167 |

**Lumber**  
Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

**Bracing**  
(a) Continuous lateral restraint equally spaced on member.


**Hangers / Ties**  
Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.  
Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.  
Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.  
(J) Hanger Support Required, by others  
Bearing H (31'6"8, 9'1"2) HUS26  
Supporting Member: (3)2x8 SP #2  
(14) 0.148"x3" nails into supporting member,  
(4) 0.148"x3" nails into supported member.

**Loading**  
Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

**Wind**  
Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Uplifts based on an elevation at or above 1000 ft.

**Additional Notes**  
Truss must be installed as shown with top chord up.  
The overall height of this truss excluding overhang is 7'-3"-10".

| Maximum Bot Chord Forces Per Ply (lbs) |            |        |             |
|--|------------|--------|-------------|
| Chords                                 | Tens.Comp. | Chords | Tens. Comp. |
| L - K                                  | 1196 - 373 | J - I  | 1654 - 451  |
| K - J                                  | 1712 - 463 |        |             |
| Maximum Web Forces Per Ply (lbs)       |            |        |             |
| Webs                                   | Tens.Comp. | Webs   | Tens. Comp. |
| A - M                                  | 527 - 1429 | E - I  | 240 - 761   |
| A - L                                  | 1715 - 526 | F - I  | 363 - 429   |
| L - B                                  | 461 - 1011 | I - G  | 1691 - 535  |
| B - K                                  | 765 - 239  | G - H  | 527 - 1387  |

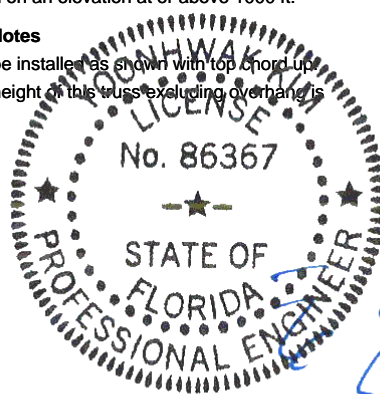


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608861<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C10 | Cust: R 215 JRRef: 1X3d2150006 T13<br>DrwNo: 062.21.0903.46420<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

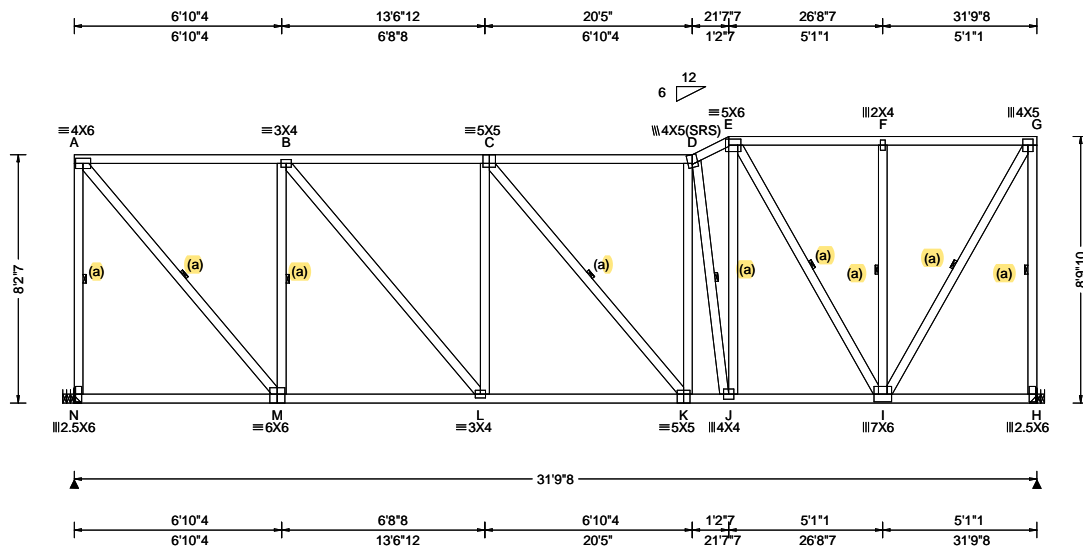

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 17.60 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.107 C 999 480<br>VERT(CL): 0.185 C 999 360<br>HORZ(LL): 0.037 A - -<br>HORZ(TL): 0.064 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.769<br>Max BC CSI: 0.745<br>Max Web CSI: 0.728<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>N 1628 - / - / - / 655 / 231 / 15<br>H 1584 - / - / - / 664 / 245 / -<br>Wind reactions based on MWFRS<br>N Brg Width = - Min Req = -<br>H Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 480 - 1118 D - E 651 - 1467<br>B - C 689 - 1597 E - F 369 - 812<br>C - D 634 - 1481 F - G 369 - 812 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others  
Bearing H (31'6"8, 9'1"2) HUS26

Supporting Member: (3)2x8 SP #2  
(14) 0.148"x3" nails into supporting member,  
(4) 0.148"x3" nails into supported member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 8-9-10.

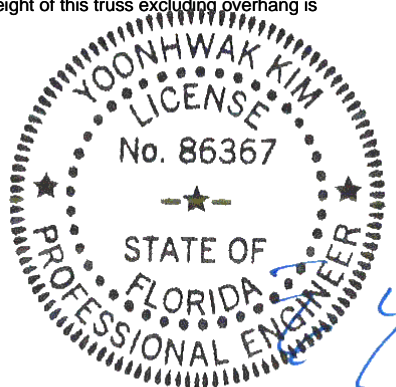

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| M - L  | 1156 - 533 | K - J  | 1470 - 659  |
| L - K  | 1607 - 725 | J - I  | 1295 - 578  |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - N | 723 - 1494 | E - J | 1275 - 522  |
| A - M | 1729 - 742 | E - I | 407 - 940   |
| M - B | 642 - 1024 | I - G | 1583 - 719  |
| B - L | 699 - 297  | G - H | 729 - 1484  |
| D - J | 537 - 1168 |       |             |

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 609039<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C11 | Cust: R 215 JRRef: 1X3d2150006 T86<br>DrwNo: 062.21.0903.47703<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

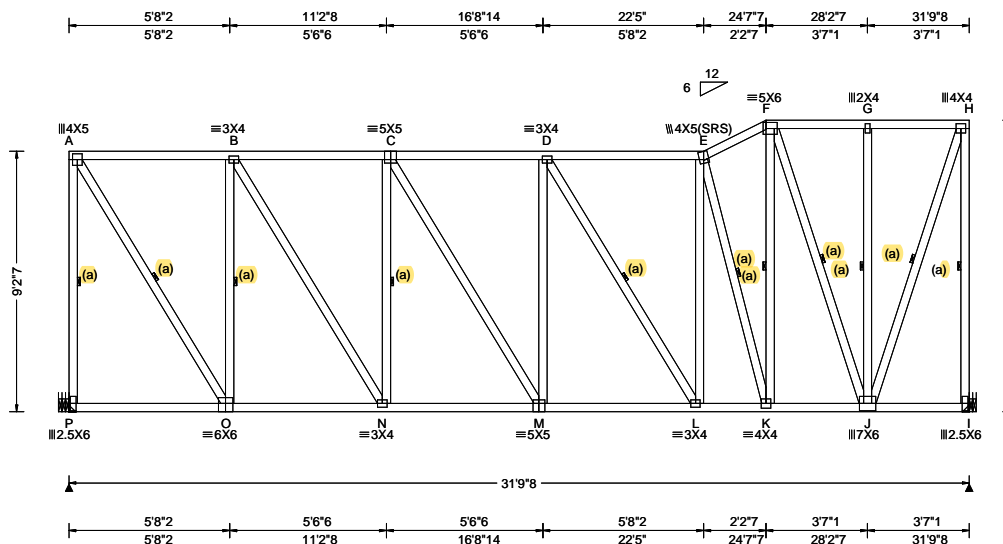

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 18.85 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.105 M 999 480<br>VERT(CL): 0.186 M 999 360<br>HORZ(LL): 0.035 A - -<br>HORZ(TL): 0.061 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.437<br>Max BC CSI: 0.598<br>Max Web CSI: 0.972<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>P 1631 - / - / - / 656 / 273 / 28<br>I 1458 - / - / - / 678 / 275 - / -<br>Wind reactions based on MWFRS<br>P Brg Width = - Min Req = -<br>I Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 365 -853 E - F 424 -971<br>B - C 557 -1308 F - G 231 -480<br>C - D 608 -1424 G - H 230 -480<br>D - E 485 -1160 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others

Bearing I (31'6"8, 9'1"2) HUS26

Supporting Member: (3)2x8 SP #2

(14) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10-3-10.

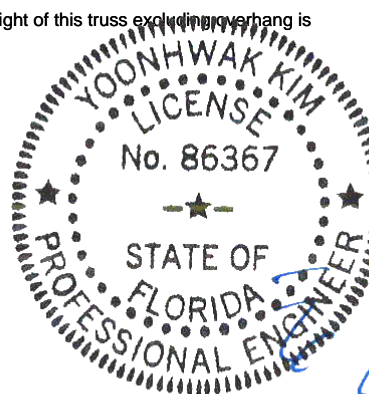

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| O - N  | 890 -442   | L - K  | 1141 -527   |
| N - M  | 1324 -617  | K - J  | 839 -393    |
| M - L  | 1422 -660  |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - P | 719 -1519  | L - E | 575 -172    |
| A - O | 1617 -691  | E - K | 559 -1257   |
| O - B | 650 -1117  | F - K | 1253 -523   |
| B - N | 825 -345   | F - J | 481 -1065   |
| N - C | 352 -492   | J - H | 1422 -683   |
| D - L | 255 -517   | H - I | 724 -1429   |

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608872<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C12 | Cust: R 215 JRef: 1X3d2150006 T74<br>DrwNo: 062.21.0903.49177<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

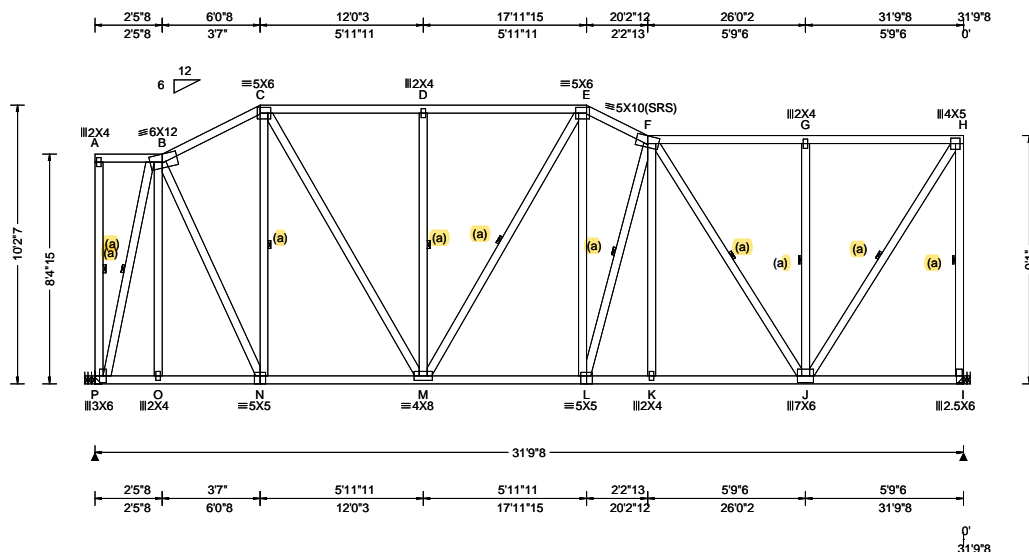

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|---|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 18.40 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.075 K 999 480<br>VERT(CL): 0.131 K 999 360<br>HORZ(LL): 0.026 C - -<br>HORZ(TL): 0.046 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.578<br>Max BC CSI: 0.645<br>Max Web CSI: 0.967<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>P 1519 - / - / - /674 /166 /45<br>I 1605 - / - / - /656 /236 - / -<br>Non-Gravity<br>Wind reactions based on MWFRS<br>P Brg Width = - Min Req = -<br>I Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 398 -927 E - F 634 -1446<br>C - D 585 -1224 F - G 392 -888<br>D - E 585 -1224 G - H 392 -888<br><br><b>Maximum Bot Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>P - O 428 -222 M - L 1273 -541<br>O - N 428 -223 L - K 1343 -574<br>N - M 797 -365 K - J 1346 -574<br><br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp. Webs Tens. Comp.<br>P - B 599 -1476 E - L 459 -103<br>B - N 914 -363 F - J 331 -833<br>C - N 378 -624 G - J 388 -429<br>C - M 826 -384 J - H 1615 -713<br>D - M 372 -404 H - I 722 -1490 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others

Bearing I (31'6"8, 9'1"2) HUS26

Supporting Member: (3)2x8 SP #2

(14) 0.148"x3" nails into supporting

member,

(4) 0.148"x3" nails into supported

member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-2".

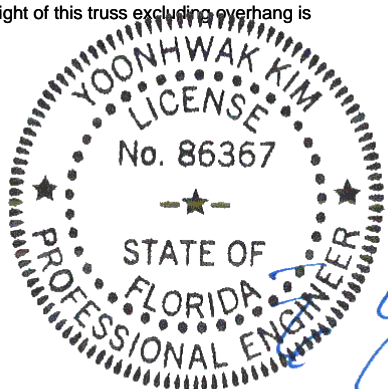

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608875<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C13 | Cust: R 215 JRef: 1X3d2150006 T50<br>DrwNo: 062.21.0903.54953<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

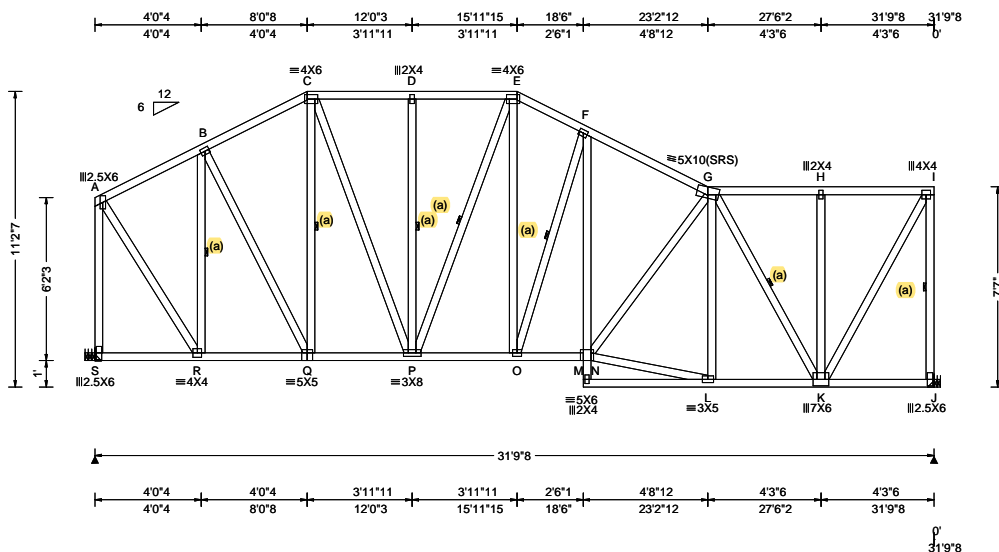

| Loading Criteria (psf) |  | Wind Criteria                     |  | Snow Criteria (Pg,Pf in PSF)  |  |  | Defl/CSI Criteria               |  |  | ▲ Maximum Reactions (lbs)                     |            |        |             |      |      |      |
|------------------------|--|-----------------------------------|--|---|--|--|---------------------------------|--|--|---|------------|--------|-------------|------|------|------|
| TCLL: 20.00            |  | Wind Std: ASCE 7-16               |  | Pg: NA Ct: NA CAT: NA   |  |  | PP Deflection in loc L/defl L/# |  |  | Gravity                                       |            |        | Non-Gravity |      |      |      |
| TCDL: 10.00            |  | Speed: 130 mph                    |  | Pf: NA Ce: NA   |  |  | VERT(LL): 0.070 M 999 480       |  |  | Loc   | R+         | / R-   | / Rh        | / Rw | / U  | / RL |
| BCLL: 0.00             |  | Enclosure: Closed                 |  | Lu: NA Cs: NA   |  |  | VERT(CL): 0.136 M 999 360       |  |  | S   | 1413       | -/-    | -/-         | /694 | /98  | /100 |
| BCDL: 10.00            |  | Risk Category: II                 |  | Snow Duration: NA   |  |  | HORZ(LL): 0.025 K - -           |  |  | J   | 1373       | -/-    | -/-         | /678 | /165 | -/-  |
| Des Ld: 40.00          |  | EXP: C Kzt: NA                    |  | Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE |  |  | HORZ(TL): 0.048 K - -           |  |  | Wind reactions based on MWFRS                 |            |        |             |      |      |      |
| NCBCLL: 10.00          |  | Mean Height: 18.28 ft             |  |   |  |  | Creep Factor: 2.0               |  |  | S Brg Width = - Min Req = -                   |            |        |             |      |      |      |
| Soffit: 2.00           |  | TCDL: 5.0 psf                     |  |   |  |  | Max TC CSI: 0.260               |  |  | J Brg Width = - Min Req = -                   |            |        |             |      |      |      |
| Load Duration: 1.25    |  | BCDL: 5.0 psf                     |  |   |  |  | Max BC CSI: 0.390               |  |  | Members not listed have forces less than 375# |            |        |             |      |      |      |
| Spacing: 24.0 "        |  | MWFRS Parallel Dist: h to 2h      |  |   |  |  | Max Web CSI: 0.971              |  |  | Maximum Top Chord Forces Per Ply (lbs)        |            |        |             |      |      |      |
|                        |  | C&C Dist a: 3.18 ft               |  |   |  |  |                                 |  |  | Chords  | Tens.Comp. | Chords | Tens. Comp. |      |      |      |
|                        |  | Loc. from endwall: not in 9.00 ft |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  | GCpi: 0.18                        |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  | Wind Duration: 1.60               |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  | VIEW Ver: 20.01.01A.0724.11     |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |
|                        |  |                                   |  |   |  |  |                                 |  |  |   |            |        |             |      |      |      |

**Lumber**  
 Top chord: 2x4 SP #2;  
 Bot chord: 2x4 SP #2;  
 Webs: 2x4 SP #3;

**Bracing**  
 (a) Continuous lateral restraint equally spaced on member.


**Plating Notes**  
 All plates are 3X4 except as noted.

**Hangers / Ties**  
 Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.  
 Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.  
 Hanger information assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.  
 (J) Hanger Support Required, by others  
 Bearing J (31'6"8, 9'1"2) HUS26  
 Supporting Member: (3)2x8 SP #2  
 (14) 0.148"x3" nails into supporting member,  
 (4) 0.148"x3" nails into supported member.

**Loading**  
 Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

**Wind**  
 Wind loads based on MWFRS with additional C&C member design.  
 End verticals not exposed to wind pressure.  
 Wind loading based on both gable and hip roof types.  
 Uplifts based on an elevation of 1000 ft.

**Additional Notes**  
 The overall height of this truss excluding overhang is 10-2-7.

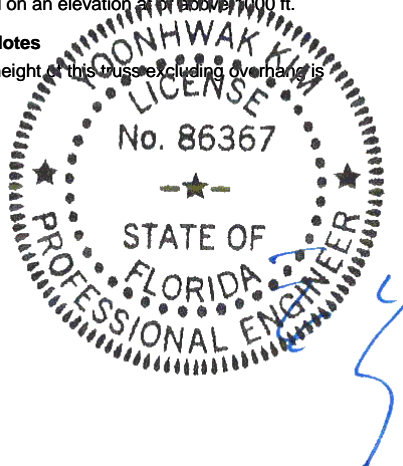


FL REG# 278, Yoonhwak Kim, FL PE #86367  
 03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCEA: sbceindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
 AN ITW COMPANY  
 6750 Forum Drive  
 Suite 305  
 Orlando FL, 32821

[illegible]

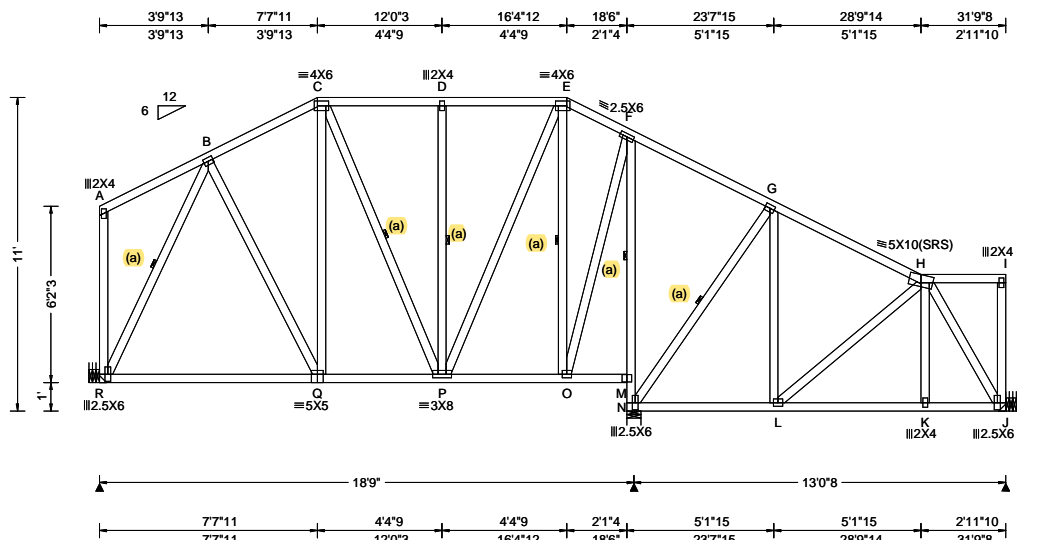

| Loading Criteria (psf) | Wind Criteria                     | Snow Criteria (Pg,Pf in PSF) | Defl/CSI Criteria               | ▲ Maximum Reactions (lbs)  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
|------------------------|-----------------------------------|------------------------------|---------------------------------|--|---------|------------|--------|-------------|-------|-----|-------|-----|-------|------|-------|-----|------|---|-----|----|----|------|-----|------|---|------|----|----|------|-----|----|---|-----|----|----|------|-----|----|
| TCLL: 20.00            | Wind Std: ASCE 7-16               | Pg: NA Ct: NA CAT: NA        | PP Deflection in loc L/defl L/# | <table><tr><th colspan="3">Gravity</th><th colspan="3">Non-Gravity</th></tr><tr><th>Loc</th><th>R+</th><th>/ R-</th><th>/ Rh</th><th>/ Rw</th><th>/ U</th><th>/ RL</th></tr><tr><td>R</td><td>963</td><td>/-</td><td>/-</td><td>/421</td><td>/71</td><td>/156</td></tr><tr><td>M</td><td>1510</td><td>/-</td><td>/-</td><td>/698</td><td>/64</td><td>/-</td></tr><tr><td>J</td><td>564</td><td>/-</td><td>/-</td><td>/325</td><td>/37</td><td>/-</td></tr></table> | Gravity |            |        | Non-Gravity |       |     | Loc   | R+  | / R-  | / Rh | / Rw  | / U | / RL | R | 963 | /- | /- | /421 | /71 | /156 | M | 1510 | /- | /- | /698 | /64 | /- | J | 564 | /- | /- | /325 | /37 | /- |
| Gravity                |                                   |                              | Non-Gravity                     |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Loc                    | R+                                | / R-                         | / Rh                            | / Rw   | / U     | / RL       |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| R                      | 963                               | /-                           | /-                              | /421   | /71     | /156       |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| M                      | 1510                              | /-                           | /-                              | /698   | /64     | /-         |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| J                      | 564                               | /-                           | /-                              | /325   | /37     | /-         |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| TCDL: 10.00            | Speed: 130 mph                    | Pf: NA Ce: NA                | VERT(CL): 0.026 D 999 480       | Wind reactions based on MWFRS  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| BCLL: 0.00             | Enclosure: Closed                 | Lu: NA Cs: NA                | VERT(LL): 0.046 D 999 360       | R Brg Width = - Min Req = -  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| BCDL: 10.00            | Risk Category: II                 | Snow Duration: NA            | HORZ(LL): 0.017 J - -           | M Brg Width = 6.0 Min Req = 1.8  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
|                        | EXP: C Kzt: NA                    |                              | HORZ(TL): 0.031 J - -           | J Brg Width = - Min Req = -  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Des Ld: 40.00          | Mean Height: 16.99 ft             | Building Code:               | Creep Factor: 2.0               | Bearing M is a rigid surface.  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| NCBCLL: 10.00          | TCDL: 5.0 psf                     | FBC 7th Ed. 2020 Res.        | Max TC CSI: 0.308               | Members not listed have forces less than 375#  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Soffit: 2.00           | BCDL: 5.0 psf                     | TPI Std: 2014                | Max BC CSI: 0.693               | <b>Maximum Top Chord Forces Per Ply (lbs)</b>  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Load Duration: 1.25    | MWFRS Parallel Dist: > 2h         | Rep Fac: Yes                 | Max Web CSI: 0.401              | <table><tr><th>Chords</th><th>Tens.Comp.</th><th>Chords</th><th>Tens. Comp.</th></tr><tr><td>B - C</td><td>294</td><td>D - E</td><td>325</td></tr><tr><td>C - D</td><td>325</td><td>G - H</td><td>147</td></tr></table>  | Chords  | Tens.Comp. | Chords | Tens. Comp. | B - C | 294 | D - E | 325 | C - D | 325  | G - H | 147 |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Chords                 | Tens.Comp.                        | Chords                       | Tens. Comp.                     |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| B - C                  | 294                               | D - E                        | 325                             |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| C - D                  | 325                               | G - H                        | 147                             |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
| Spacing: 24.0 "        | C&C Dist a: 3.18 ft               | FT/RT:20(0)/10(0)            |                                 |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
|                        | Loc. from endwall: not in 9.00 ft | Plate Type(s):               |                                 |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
|                        | GCpi: 0.18                        | WAVE                         | VIEW Ver: 20.01.01A.0724.11     |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |
|                        | Wind Duration: 1.60               |                              |                                 |  |         |            |        |             |       |     |       |     |       |      |       |     |      |   |     |    |    |      |     |      |   |      |    |    |      |     |    |   |     |    |    |      |     |    |

#### Lumber

Top chord: 2x4 SP #2;  
 Bot chord: 2x4 SP #2;  
 Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 3X4 except as noted.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-0".

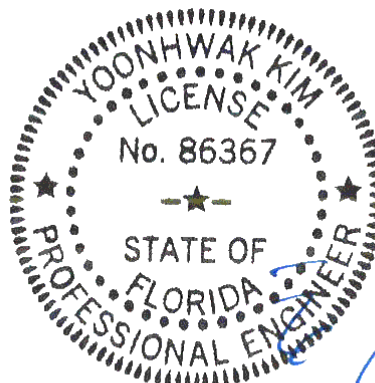

FL REG# 278, Yoonhwak Kim, FL PE #86367  
 03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
 For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
 AN ITW COMPANY  
 6750 Forum Drive  
 Suite 305  
 Orlando FL, 32821



|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 609142 | SPEC | Ply: 1 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T71 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0908.27517          |
| Page 2 of 2  |      |        | Truss Label: C15    | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended connection based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information. Additional connection required to evenly distribute hanger reaction throughout all plies of supporting girder.


Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others  
Bearing J (31'6"8, 9'1"2) LUS26

Supporting Member: (3)2x8 SP #2

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

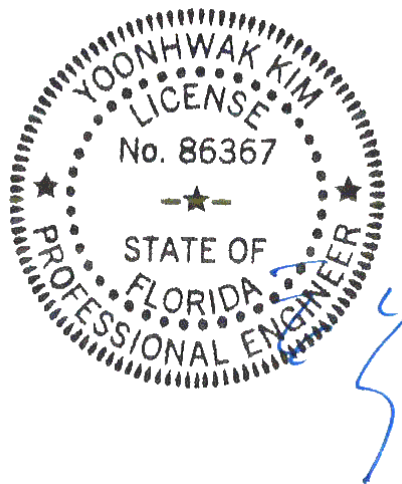

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING! **\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



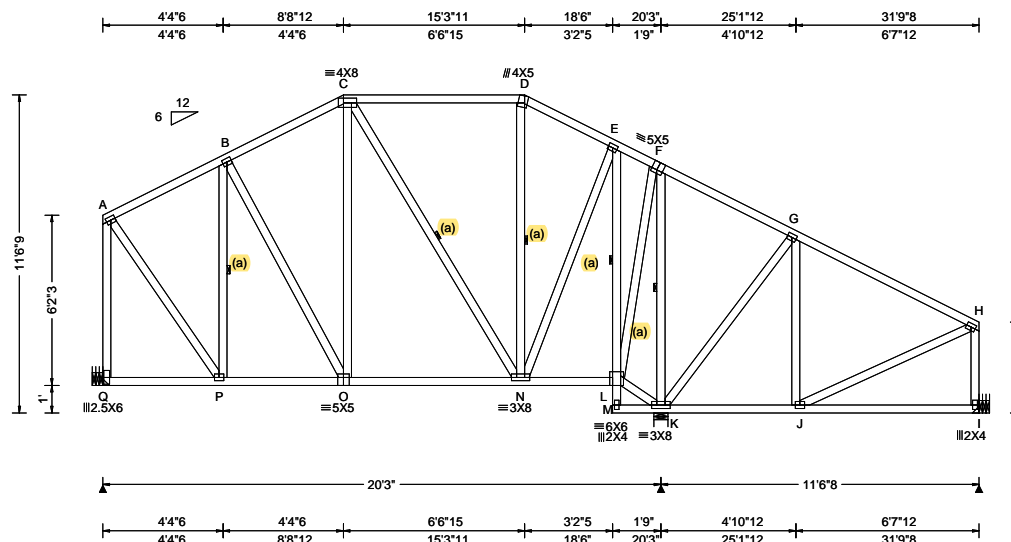

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|--|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 16.52 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.18 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.024 O 999 480<br>VERT(CL): 0.045 O 999 360<br>HORZ(LL): 0.014 I - -<br>HORZ(TL): 0.027 I - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.551<br>Max BC CSI: 0.463<br>Max Web CSI: 0.660<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Q 971 -/- /- /463 /54 /207<br>K 1443 -/- /- /791 /103 -/<br>I 456 -/- /- /273 -/- -/<br>Non-Gravity<br>Wind reactions based on MWFRS<br>Q Brg Width = - Min Req = -<br>K Brg Width = 6.0 Min Req = 1.7<br>I Brg Width = - Min Req = -<br>Bearing K is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 3X4 except as noted.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-6".

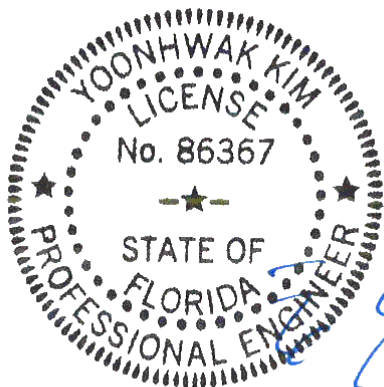

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 609147 | HIPS | Ply: 1 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T22 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0908.31237          |
| Page 2 of 2  |      |        | Truss Label: C16    | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended connection based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information. Additional connection required to evenly distribute hanger reaction throughout all plies of supporting girder.


Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

(J) Hanger Support Required, by others  
Bearing I (31'6"8, 9'1"2) LUS26

Supporting Member: (3)2x8 SP #2

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

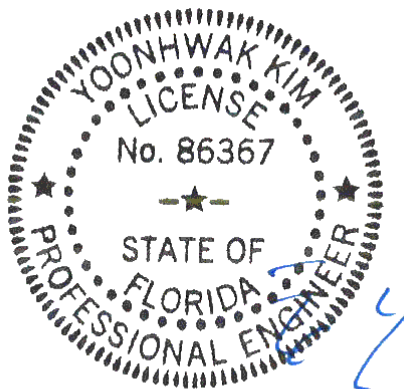

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609150<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C17 | Cust: R 215 JRef: 1X3d2150006 T17<br>DrwNo: 062.21.0908.34763<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

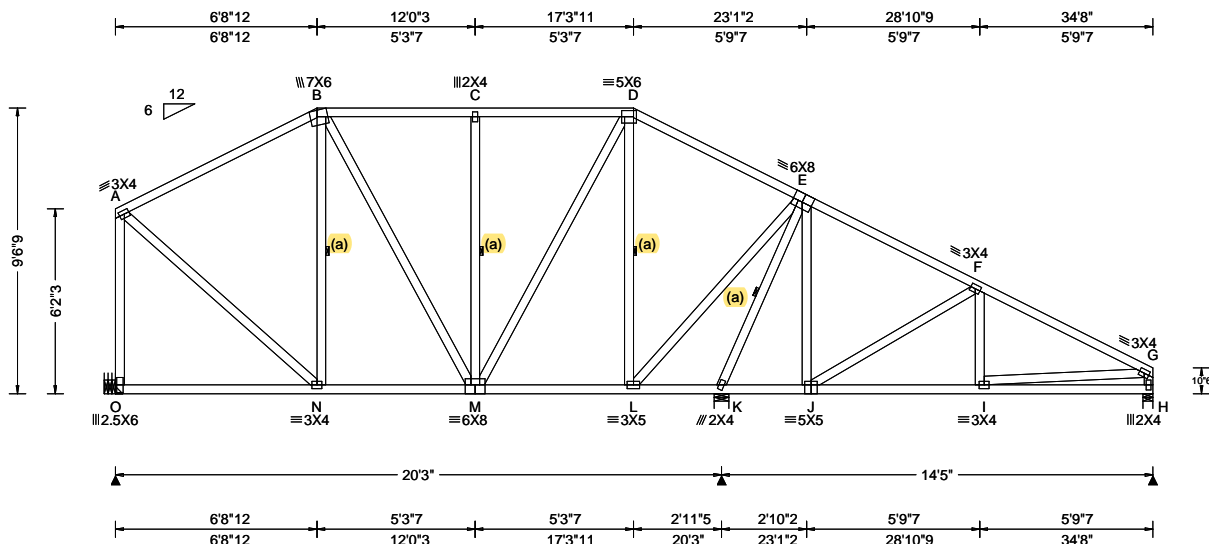

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.30 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.032 C 999 480<br>VERT(CL): 0.055 C 999 360<br>HORZ(LL): 0.011 B - -<br>HORZ(TL): 0.021 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.707<br>Max BC CSI: 0.490<br>Max Web CSI: 0.656<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>O 1050 - / - / - / 469 / 53 / 217<br>K 1524 - / - / - / 838 / 97 / -<br>H 619 - / - / - / 380 / 19 / -<br>Non-Gravity<br>O Brg Width = - Min Req = -<br>K Brg Width = 6.0 Min Req = 1.8<br>H Brg Width = 4.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9'-6".

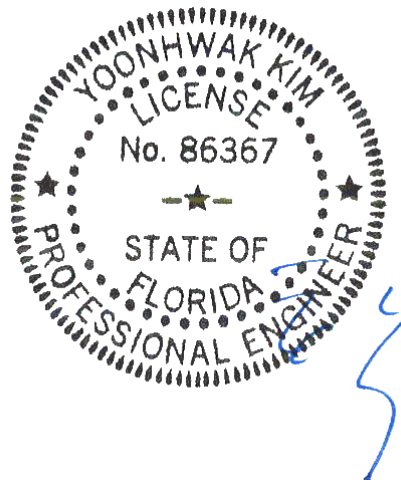

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 609172<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C18 | Cust: R 215 JRRef: 1X3d2150006 T62<br>DrwNo: 062.21.0908.37240<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

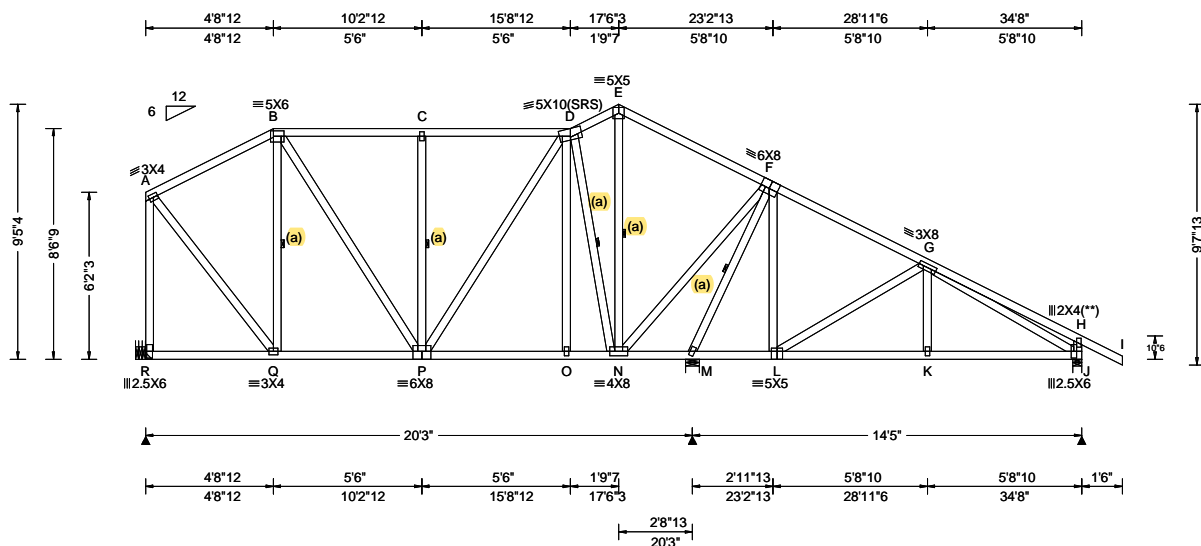

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.032 C 999 480<br>VERT(CL): 0.059 C 999 360<br>HORZ(LL): 0.012 B - -<br>HORZ(TL): 0.023 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.359<br>Max BC CSI: 0.429<br>Max Web CSI: 0.634<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>R 931 -/- /- /430 /71 /227<br>M 1606 -/- /- /858 /86 -/-<br>J 655 -/- /- /446 /25 -/-<br>Wind reactions based on MWFRS<br>R Brg Width = - Min Req = -<br>M Brg Width = 6.0 Min Req = 1.9<br>J Brg Width = 4.0 Min Req = 1.5<br>Bearings M & J are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

(\*\*) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9-5-4.

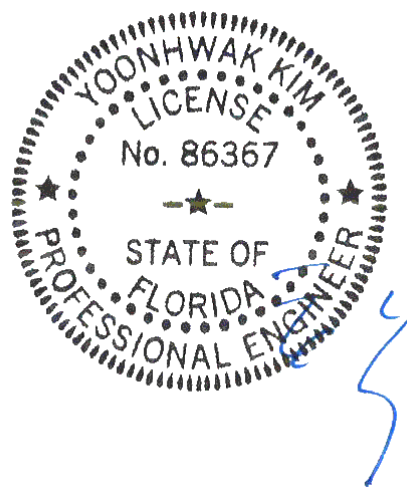

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609170<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C19 | Cust: R 215 JRef: 1X3d2150006 T83<br>DrwNo: 062.21.0908.40030<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

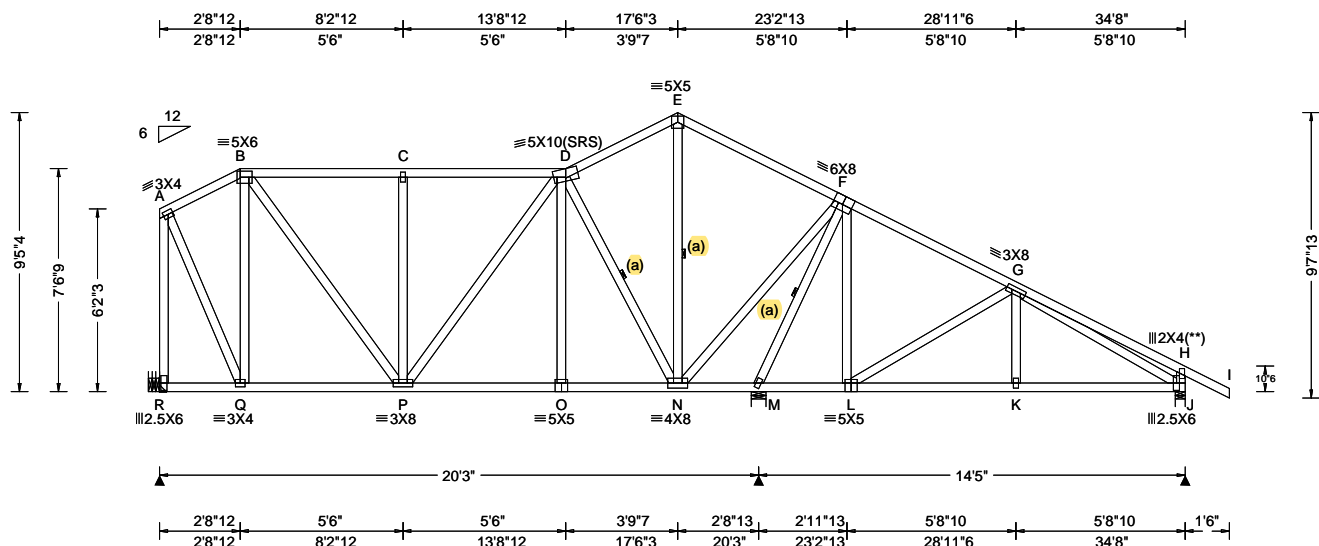

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.031 C 999 480<br>VERT(CL): 0.058 C 999 360<br>HORZ(LL): 0.011 H - -<br>HORZ(TL): 0.022 H - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.359<br>Max BC CSI: 0.423<br>Max Web CSI: 0.644<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>R 916 - / - / - /407 /91 /227<br>M 1622 - / - / - /868 /69 - /-<br>J 627 - / - / - /433 /24 - /-<br>Non-Gravity<br>R Brg Width = - Min Req = -<br>M Brg Width = 6.0 Min Req = 1.9<br>J Brg Width = 4.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

(\*\*) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9'-5".

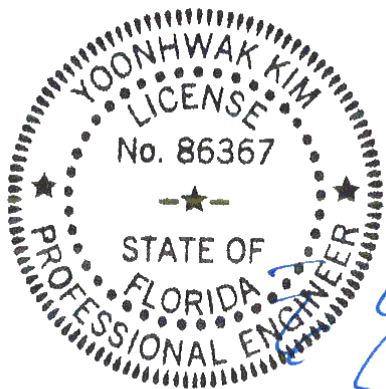

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 609159<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C20 | Cust: R 215 JRRef: 1X3d2150006 T78<br>DrwNo: 062.21.0908.42910<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

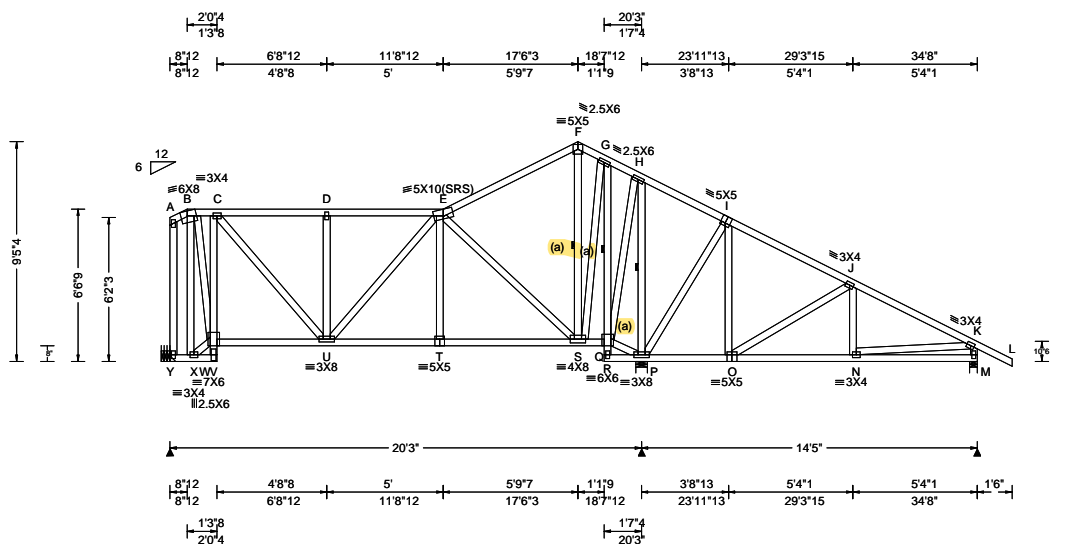

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.051 D 999 480<br>VERT(CL): 0.109 D 999 360<br>HORZ(LL): 0.015 M - -<br>HORZ(TL): 0.032 P - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.495<br>Max BC CSI: 0.721<br>Max Web CSI: 0.898<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Y 670 - / - / - /324 /95 /227<br>P 1885 - / - / - /1036 /92 - /-<br>M 520 - / - / - /328 /38 - /-<br>Non-Gravity<br>Wind reactions based on MWFRS<br>Y Brg Width = - Min Req = -<br>P Brg Width = 6.0 Min Req = 2.2<br>M Brg Width = 4.0 Min Req = 1.5<br>Bearings P & M are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties


(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9'-5-4.

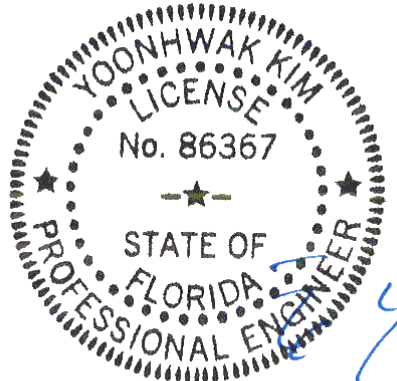


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbicindustry.com](http://sbicindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 351656<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C21 | Cust: R 215 JRRef: 1X3d2150006 T64<br>DrwNo: 062.21.0908.46547<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

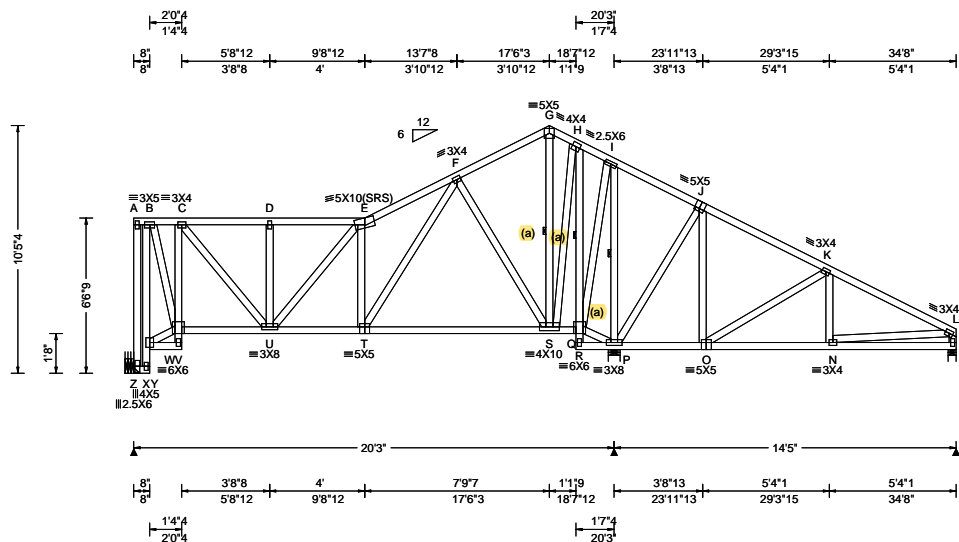

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.25 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: > 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.057 E 999 480<br>VERT(CL): 0.116 E 999 360<br>HORZ(LL): 0.058 K - -<br>HORZ(TL): 0.094 K - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.979<br>Max BC CSI: 0.544<br>Max Web CSI: 0.838<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Z 711 - / - / - /339 /105 /214<br>P 1969 - / - / - /999 /49 - /-<br>M 413 - / - / - /255 /37 - /-<br>Non-Gravity<br>Z Min Req = -<br>P Brg Width = 6.0 Min Req = 2.3<br>M Brg Width = 4.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br>Bearing P & M are a rigid surface.<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-5".

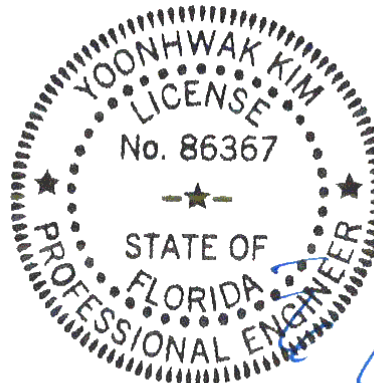


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbicindustry.com](http://sbicindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609136<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C22 | Cust: R 215 JRef: 1X3d2150006 T88<br>DrwNo: 062.21.0908.49573<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

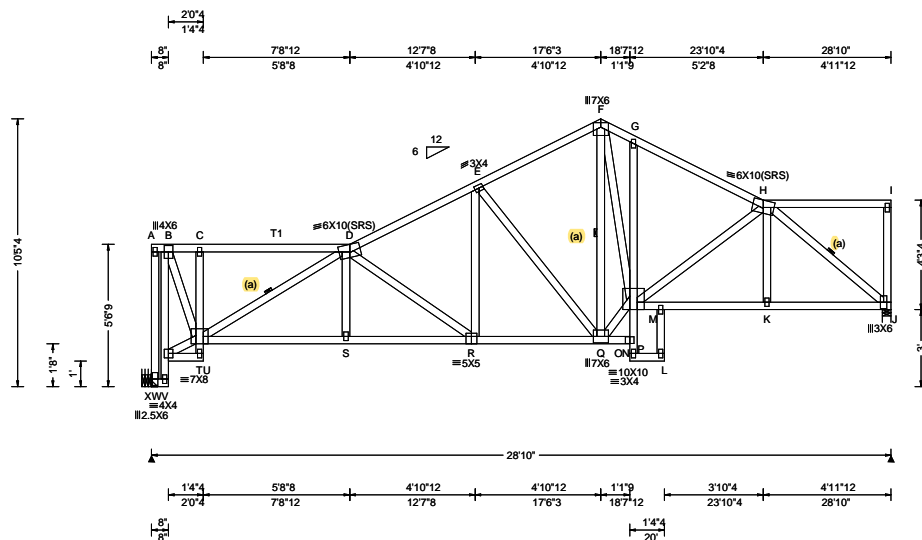

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 17.09 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.113 R 999 480<br>VERT(CL): 0.226 D 999 360<br>HORZ(LL): 0.082 J - -<br>HORZ(TL): 0.168 J - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.665<br>Max BC CSI: 0.729<br>Max Web CSI: 0.801<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>X 1187 -/- /- /619 /95 /122<br>J 1187 -/- /- /628 /92 -/<br>Wind reactions based on MWFRS<br>X Brg Width = - Min Req = -<br>J Brg Width = 4.0 Min Req = 1.5<br>Bearing J is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 304 -651 E - F 430 -1170<br>C - D 308 -660 F - G 548 -1399<br>D - E 523 -1670 G - H 486 -1469 |

#### Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties


(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
End verticals not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-5-4.

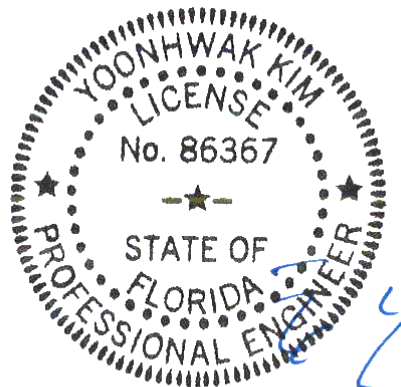


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609132<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C23 | Cust: R 215 JRef: 1X3d2150006 T24<br>DrwNo: 062.21.0908.51407<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

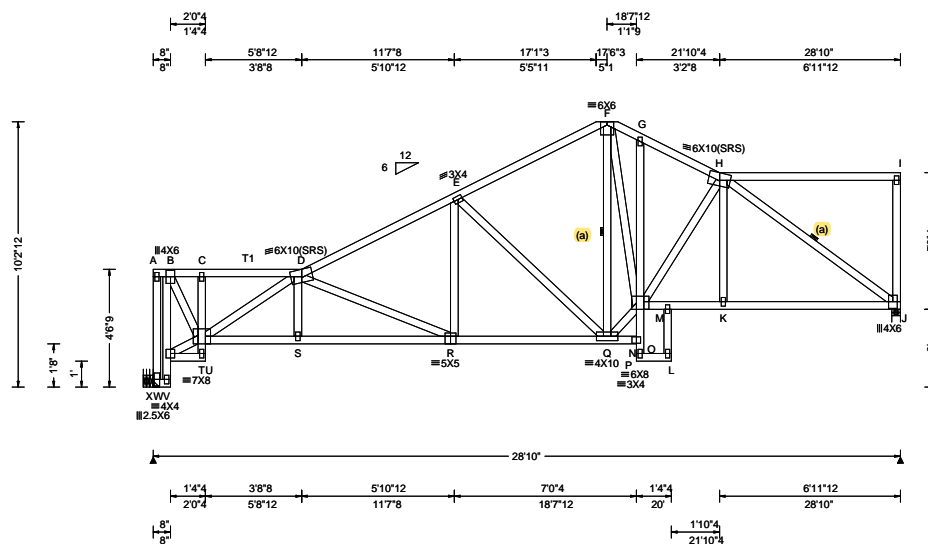

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 16.48 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.114 R 999 480<br>VERT(CL): 0.235 R 999 360<br>HORZ(LL): 0.078 J - -<br>HORZ(TL): 0.160 J - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.704<br>Max BC CSI: 0.644<br>Max Web CSI: 0.923<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>X 1187 - / - / - / 647 / 39 / 143<br>J 1187 - / - / - / 649 / 121 / -<br>Wind reactions based on MWFRS<br>X Brg Width = - Min Req = -<br>J Brg Width = 4.0 Min Req = 1.5<br>Bearing J is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 390 -873 E - F 401 -1193<br>C - D 396 -885 F - G 477 -1289<br>D - E 497 -1804 G - H 499 -1429 |

#### Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 10'-2-12.

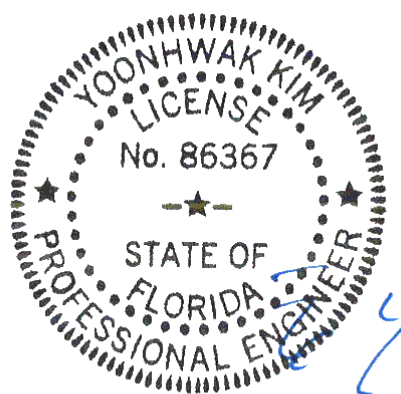

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| T - S  | 2161 -820  | N - M  | 1305 -463   |
| S - R  | 2157 -823  | M - K  | 1319 -467   |
| R - Q  | 1531 -502  | K - J  | 1321 -464   |


#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - X | 403 -1065  | E - Q | 286 -746    |
| B - T | 1905 -767  | Q - N | 1418 -430   |
| C - T | 394 -770   | F - Q | 177 -413    |
| T - D | 340 -1502  | F - N | 1146 -422   |
| D - R | 352 -668   | H - J | 570 -1622   |
| R - E | 454 -81    |       |             |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbicindustry.com](http://sbicindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609128<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C24 | Cust: R 215 JRef: 1X3d2150006 T85<br>DrwNo: 062.21.0908.53287<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

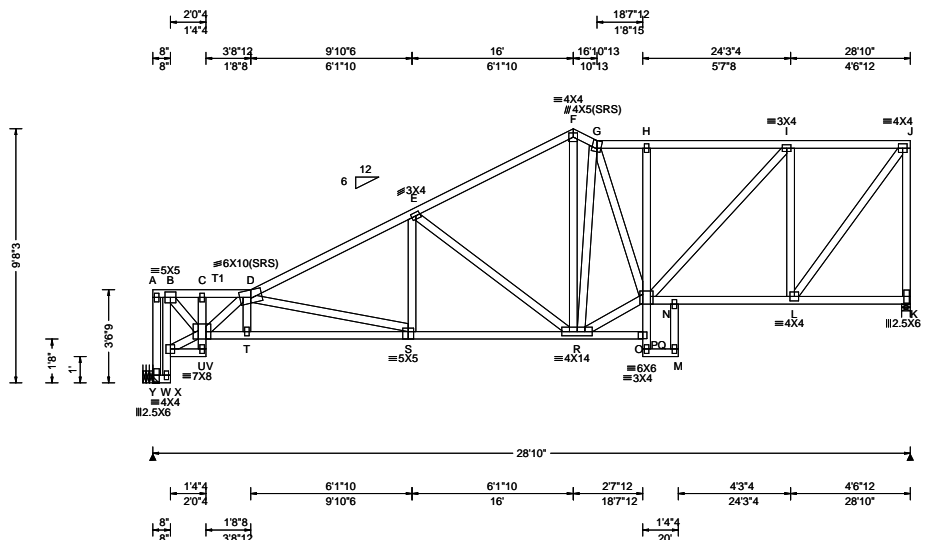

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.71 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.120 S 999 480<br>VERT(CL): 0.241 S 999 360<br>HORZ(LL): 0.079 L - -<br>HORZ(TL): 0.164 L - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.466<br>Max BC CSI: 0.756<br>Max Web CSI: 0.870<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Y 1187 - / - / - /680 /42 /153<br>K 1187 - / - / - /663 /188 - / -<br>Wind reactions based on MWFRS<br>Y Brg Width = - Min Req = -<br>K Brg Width = 4.0 Min Req = 1.5<br>Bearing K is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 695 - 1439 F - G 485 - 1170<br>C - D 710 - 1465 G - H 604 - 1359<br>D - E 618 - 2010 H - I 606 - 1363<br>E - F 498 - 1335 I - J 363 - 771 |

#### Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9'-8-3/4".

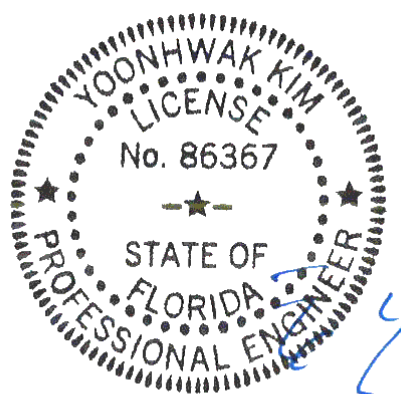

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp.  | Chords | Tens. Comp. |
|--------|-------------|--------|-------------|
| U - T  | 2494 - 1133 | O - N  | 810 - 377   |
| T - S  | 2497 - 1141 | N - L  | 818 - 391   |
| S - R  | 1714 - 689  |        |             |


#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| A - Y | 385 - 987  | R - G | 418 - 804   |
| B - U | 2104 - 895 | R - O | 1355 - 559  |
| C - U | 246 - 544  | G - O | 476 - 297   |
| U - D | 256 - 1279 | O - I | 837 - 319   |
| D - S | 465 - 793  | I - L | 566 - 949   |
| S - E | 423 - 56   | L - J | 1292 - 609  |
| E - R | 285 - 751  | J - K | 591 - 1149  |
| F - R | 685 - 258  |       |             |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609121<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C25 | Cust: R 215 JRef: 1X3d2150006 T63<br>DrwNo: 062.21.0908.55210<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

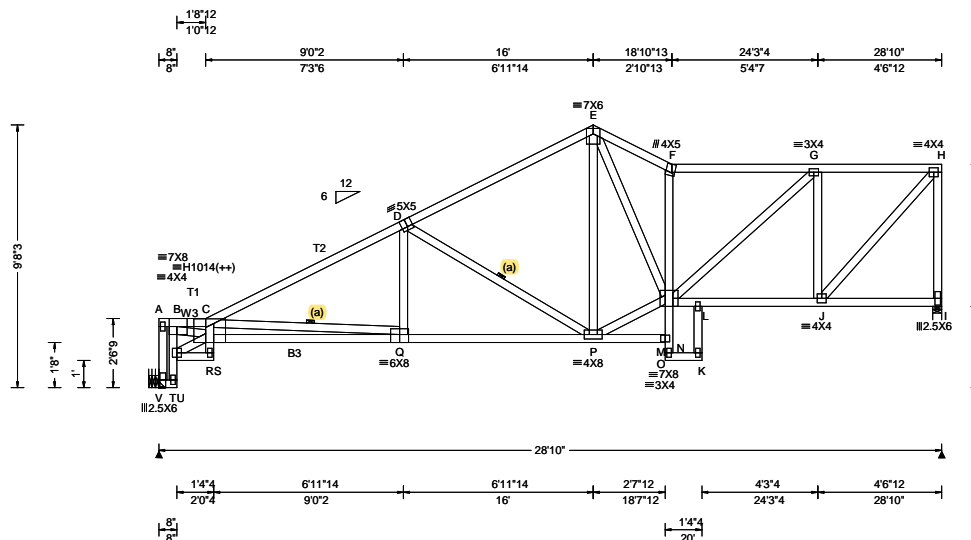

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.21 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE, HS | PP Deflection in loc L/def L/#<br>VERT(LL): 0.218 R 999 480<br>VERT(CL): 0.444 R 779 360<br>HORZ(LL): 0.228 A - -<br>HORZ(TL): 0.469 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.724<br>Max BC CSI: 0.844<br>Max Web CSI: 0.970<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>V 1185 - / - / - / 693 / 27 / 178<br>I 1186 - / - / - / 657 / 153 / -<br>Wind reactions based on MWFRS<br>V Brg Width = - Min Req = -<br>I Brg Width = 4.0 Min Req = 1.5<br>Bearing I is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 1783 - 4182 E - F 744 - 1832<br>C - D 594 - 2148 F - G 639 - 1640<br>D - E 479 - 1364 G - H 397 - 926 |

#### Lumber

Top chord: 2x4 SP #2; T1, T2 2x4 SP M-31;  
Bot chord: 2x4 SP #2; B3 2x4 SP M-31;  
Webs: 2x4 SP #3; W3 2x4 SP #2;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

(++) - This plate works for both joints covered.

#### Hangers / Ties

(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 9-8-3.

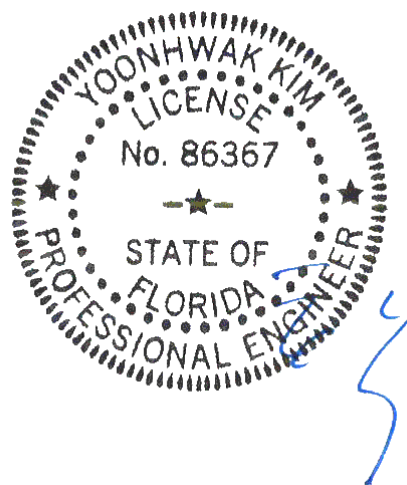

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609115<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C26 | Cust: R 215 JRef: 1X3d2150006 T30<br>DrwNo: 062.21.0908.56983<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

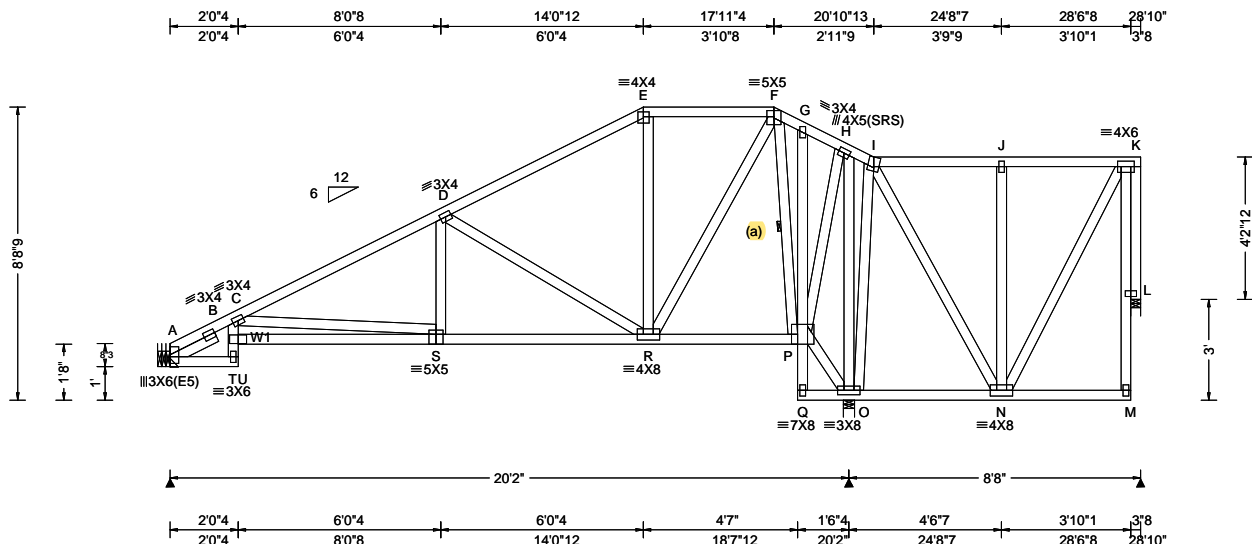

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|---|---|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.067 C 999 480<br>VERT(CL): 0.138 C 999 360<br>HORZ(LL): 0.042 P - -<br>HORZ(TL): 0.087 P - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.489<br>Max BC CSI: 0.607<br>Max Web CSI: 0.690<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 590 -/- /- /356 -/- /175<br>O 2005 -/- /- /1195 /220 -/-<br>L 53 -/-389 -/- /80 /209 -/-<br>Non-Gravity<br>A Brg Width = - Min Req = -<br>O Brg Width = 4.0 Min Req = 2.0<br>L Brg Width = 3.5 Min Req = 1.5<br>Bearings O & L are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3; W1 2x4 SP M-31;  
Lt Slider: 2x4 SP #3; block length = 1.500'  
Rt Bearing Leg: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Hangers / Ties

(J) Hanger Support Required, by others


#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Right end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Negative reaction(s) of -389# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

The overall height of this truss excluding overhang is 7-8-9.

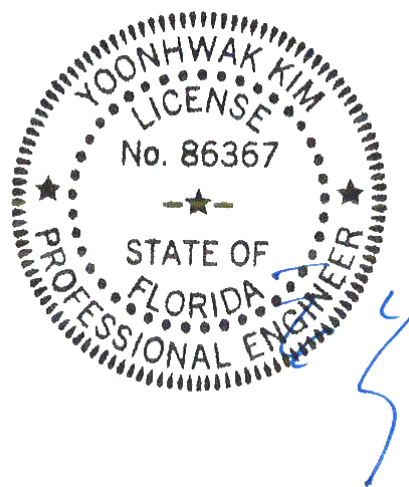


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609079<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C27 | Cust: R 215 JRef: 1X3d2150006 T11<br>DrwNo: 062.21.0908.59347<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

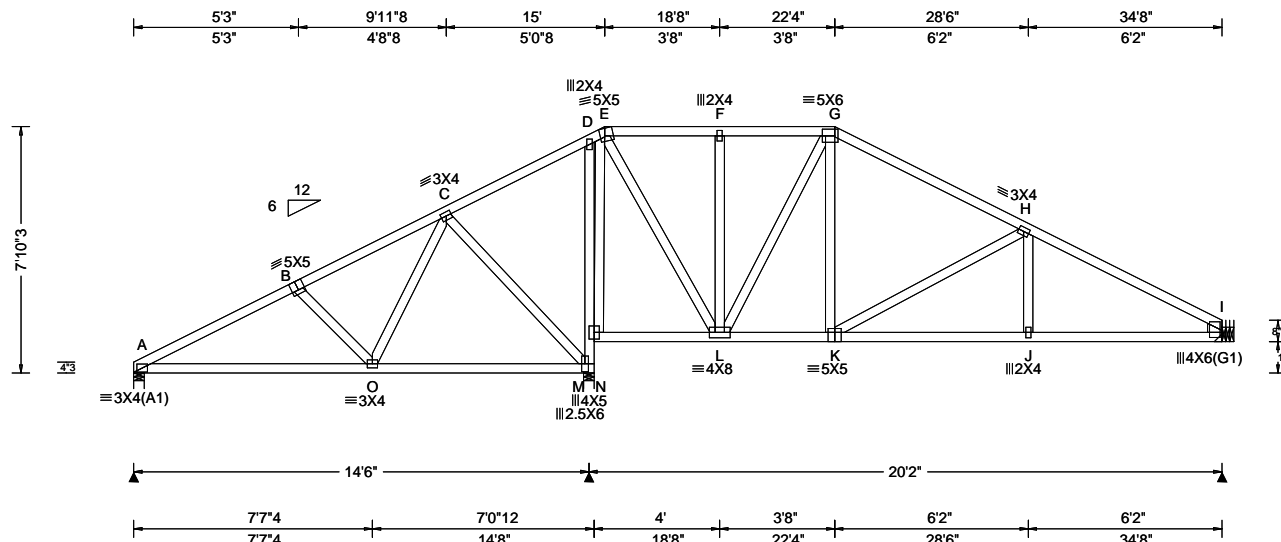

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.47 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.032 J 999 480<br>VERT(CL): 0.067 J 999 360<br>HORZ(LL): -0.012 L - -<br>HORZ(TL): 0.025 L - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.419<br>Max BC CSI: 0.653<br>Max Web CSI: 0.614<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>A 567 -/- /- /323 /21 /186<br>N 1493 -/- /- /887 /62 -/<br>I 815 -/- /- /539 /50 -/<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>N Brg Width = 4.0 Min Req = 1.8<br>I Brg Width = - Min Req = -<br>Bearings A & N are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;  
Rt Stub Wedge: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7'-10-3/8\"/>

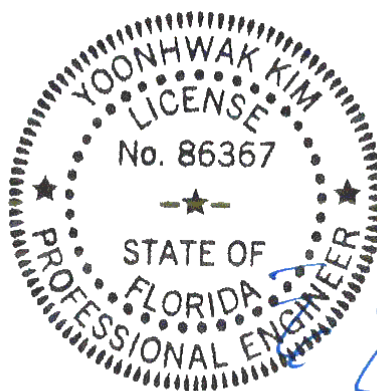


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608604<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C28 | Cust: R 215 JRef: 1X3d2150006 T12<br>DrwNo: 062.21.0909.01363<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

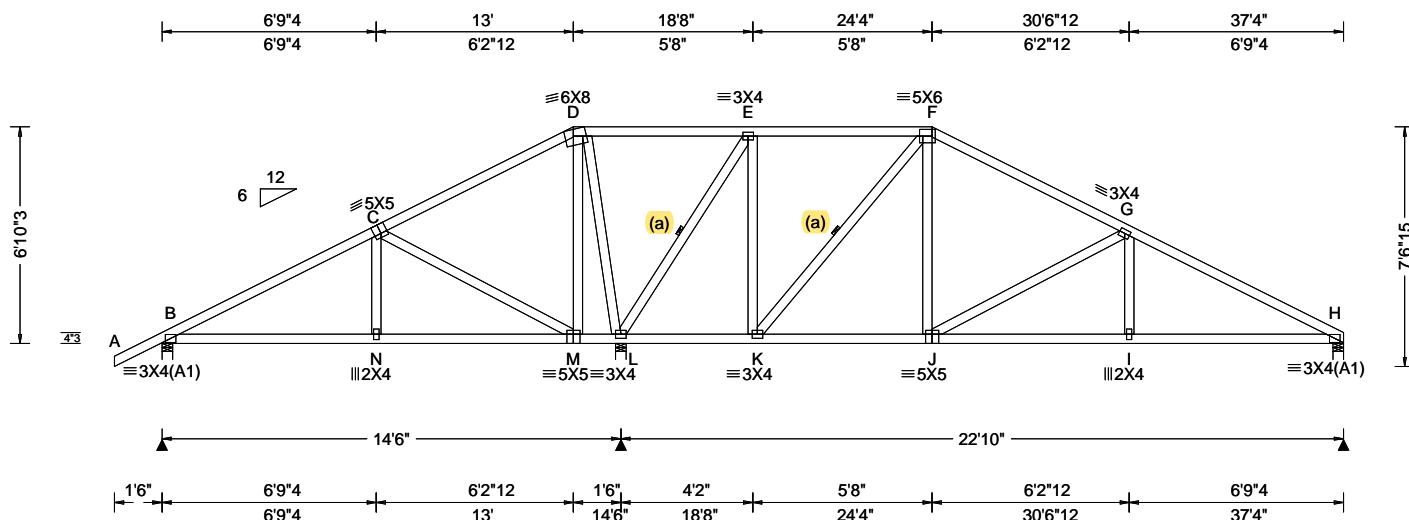

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.73 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.039   999 480<br>VERT(CL): 0.080   999 360<br>HORZ(LL): 0.014   - -<br>HORZ(TL): 0.029   - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.751<br>Max BC CSI: 0.514<br>Max Web CSI: 0.753<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 522 -/- /- /328 /34 /191<br>L 2016 -/- /- /1053 /77 -/<br>H 835 -/- /- /524 /40 -/<br>Non-Gravity<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>L Brg Width = 4.0 Min Req = 2.0<br>H Brg Width = 4.0 Min Req = 1.5<br>Bearings B, L, & H are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6'-10"-3.

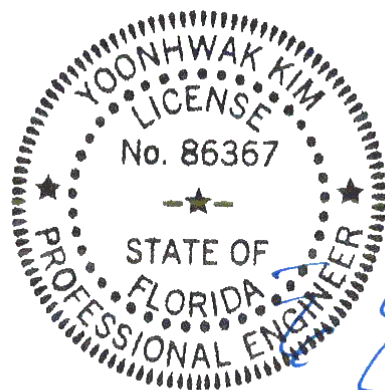

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 609066<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C29 | Cust: R 215 JRRef: 1X3d2150006 T61<br>DrwNo: 062.21.0909.03577<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

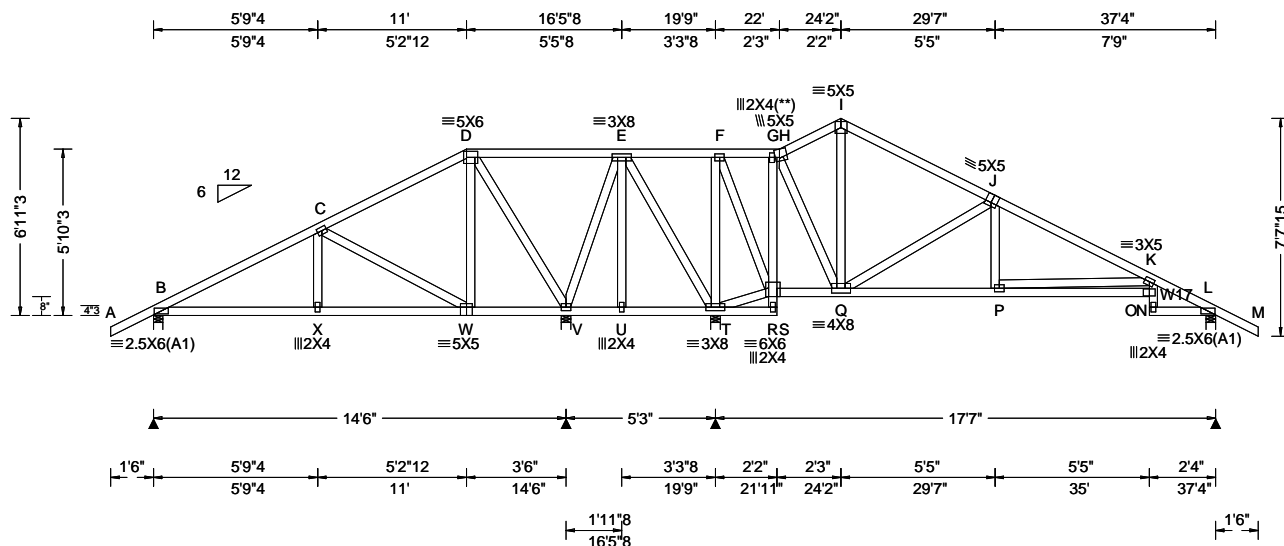

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.73 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.072 K 999 480<br>VERT(CL): 0.149 K 999 360<br>HORZ(LL): 0.034 N - -<br>HORZ(TL): 0.070 N - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.636<br>Max BC CSI: 0.512<br>Max Web CSI: 0.972<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 546 -/- /- /335 /39 /207<br>V 857 -/- /- /502 /105 -/-<br>T 1738 -/- /- /1014 /124 -/-<br>L 533 -/- /- /378 /28 -/-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>V Brg Width = 4.0 Min Req = 1.5<br>T Brg Width = 4.0 Min Req = 1.7<br>L Brg Width = 4.0 Min Req = 1.5<br>Bearings B, V, T, & L are a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3; W17 2x4 SP #2;

#### Plating Notes

All plates are 3X4 except as noted.

(\*\*) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

#### Wind


Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6-11-3.

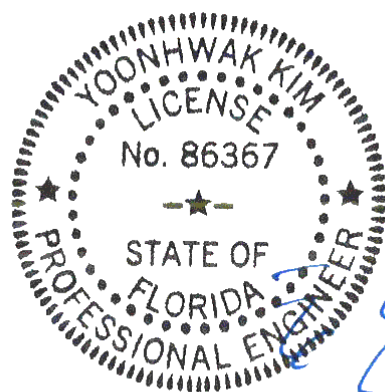

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - X  | 437 -162   | R - Q  | 263 -729    |
| X - W  | 434 -163   | P - N  | 1139 -184   |
| V - U  | 223 -662   | O - L  | 517 -85     |
| U - T  | 223 -662   |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| C - W | 194 -549   | F - R | 644 -146    |
| D - W | 376 -49    | G - R | 293 -1012   |
| D - V | 233 -828   | H - Q | 1101 -202   |
| V - E | 405 -167   | I - Q | 113 -547    |
| E - T | 194 -699   | Q - J | 197 -645    |
| T - F | 215 -676   | P - K | 200 -831    |
| T - R | 339 -1025  |       |             |


**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 609072<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C30 | Cust: R 215 JRRef: 1X3d2150006 T18<br>DrwNo: 062.21.0909.05643<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

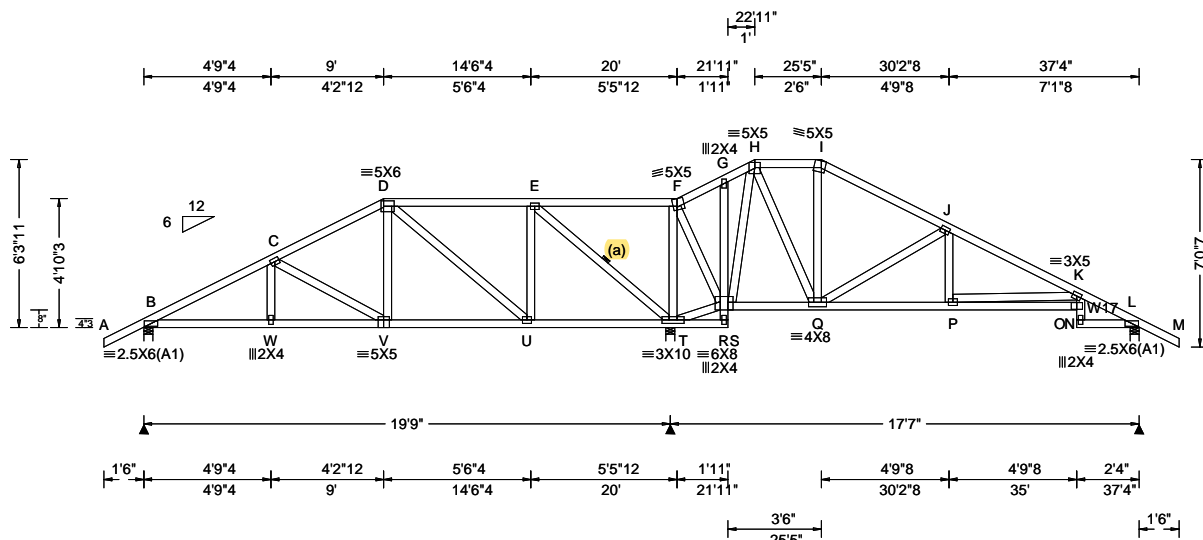

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.73 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.063 K 999 480<br>VERT(CL): 0.142 K 999 360<br>HORZ(LL): 0.037 N - -<br>HORZ(TL): 0.075 N - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.700<br>Max BC CSI: 0.427<br>Max Web CSI: 0.998<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 755 -/- /- /454 /116 /191<br>T 2103 -/- /- /1087 /334 -/<br>L 556 -/- /- /384 /92 -/<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>T Brg Width = 4.0 Min Req = 2.1<br>L Brg Width = 4.0 Min Req = 1.5<br>Bearings B, T, & L are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |


**Lumber**  
Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3; W17 2x4 SP #2;

**Bracing**  
(a) Continuous lateral restraint equally spaced on member.

**Plating Notes**  
All plates are 3X4 except as noted.

**Wind**  
Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

**Additional Notes**  
The overall height of this truss excluding overhang is 6-3-11.

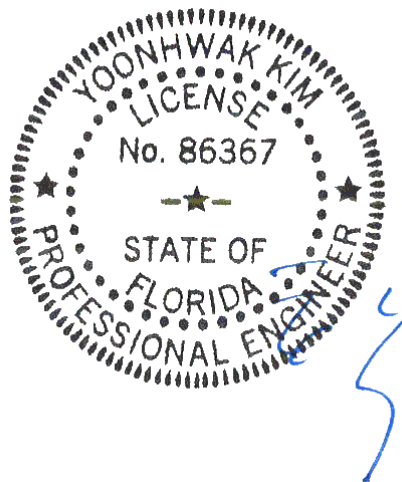


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 609076<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C31 | Cust: R 215 JRef: 1X3d2150006 T10<br>DrwNo: 062.21.0909.07857<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

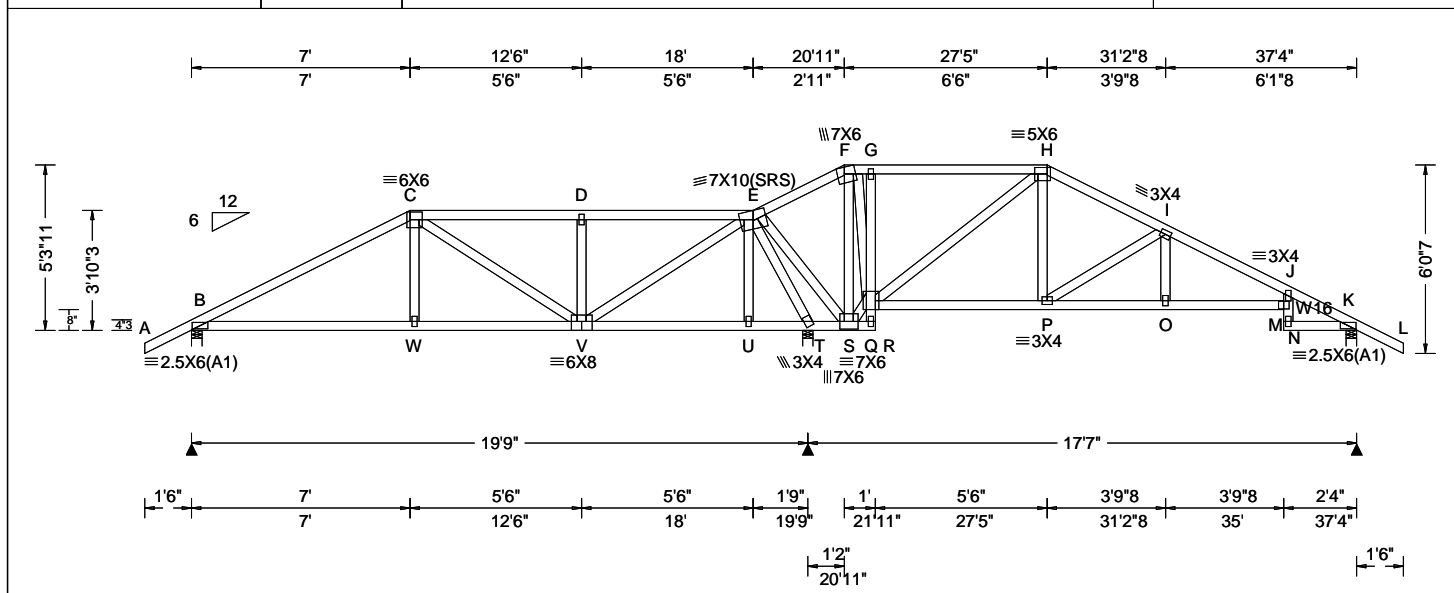

| Loading Criteria (psf) |        | Wind Criteria        |                | Snow Criteria (Pg,Pf in PSF) |        | Defl/CSI Criteria     |                  | ▲ Maximum Reactions (lbs) |        |     |         |   |                 |             |      |               |      |      |
|------------------------|--------|----------------------|----------------|------------------------------|--------|-----------------------|------------------|---------------------------|--------|-----|---------|---|-----------------|-------------|------|---------------|------|------|
| TCLL:                  | 20.00  | Wind Std:            | ASCE 7-16      | Pg: NA                       | Ct: NA | CAT: NA               | PP Deflection in | loc                       | L/defl | L/# | Gravity |   |                 | Non-Gravity |      |               |      |      |
| TCDL:                  | 10.00  | Speed:               | 130 mph        | Pf: NA                       |        | Ce: NA                | VERT(LL):        | 0.137                     | M      | 999 | 480     | Loc   | R+              | / R-        | / Rh | / Rw          | / U  | / RL |
| BCLL:                  | 0.00   | Enclosure:           | Closed         | Lu: NA                       | Cs: NA |                       | VERT(CL):        | 0.297                     | M      | 704 | 360     | B   | 766             | /-          | /-   | /452          | /123 | /165 |
| BCDL:                  | 10.00  | Risk Category:       | II             | Snow Duration:               | NA     |                       | HORZ(LL):        | 0.053                     | M      | -   | -       | T   | 2053            | /-          | /-   | /1055         | /323 | /-   |
|                        |        | EXP: C               | Kzt: NA        |                              |        |                       | HORZ(TL):        | 0.110                     | M      | -   | -       | K   | 583             | /-          | /-   | /397          | /102 | /-   |
| Des Ld:                | 40.00  | Mean Height:         | 15.00 ft       |                              |        |                       | Creep Factor:    | 2.0                       |        |     |         | Wind reactions based on MWFRS                 |                 |             |      |               |      |      |
| NCBCLL:                | 10.00  | TCDL:                | 5.0 psf        |                              |        | Building Code:        |                  |                           |        |     |         | B   | Brg Width = 4.0 |             |      | Min Req = 1.5 |      |      |
| Soffit:                | 2.00   | BCDL:                | 5.0 psf        |                              |        | FBC 7th Ed. 2020 Res. |                  |                           |        |     |         | T   | Brg Width = 4.0 |             |      | Min Req = 2.0 |      |      |
| Load Duration:         | 1.25   | MWFRS Parallel Dist: | h/2 to h       |                              |        | TPI Std: 2014         |                  |                           |        |     |         | K   | Brg Width = 4.0 |             |      | Min Req = 1.5 |      |      |
| Spacing:               | 24.0 " | C&C Dist a:          | 3.73 ft        |                              |        | Rep Fac: Yes          |                  |                           |        |     |         | Bearings B, T, & K are a rigid surface.       |                 |             |      |               |      |      |
|                        |        | Loc. from endwall:   | not in 9.00 ft |                              |        | FT/RT:20(0)/10(0)     |                  |                           |        |     |         | Members not listed have forces less than 375# |                 |             |      |               |      |      |
|                        |        | GCpi:                | 0.18           |                              |        | Plate Type(s):        |                  |                           |        |     |         | Maximum Top Chord Forces Per Ply (lbs)        |                 |             |      |               |      |      |
|                        |        | Wind Duration:       | 1.60           |                              |        | WAVE                  |                  |                           |        |     |         | Chords Tens.Comp. Chords Tens. Comp.          |                 |             |      |               |      |      |
|                        |        |                      |                |                              |        |                       |                  |                           |        |     |         | VIEW Ver: 20.01.01A.0724.11                   |                 |             |      |               |      |      |

**Lumber**  
 Top chord: 2x4 SP #2;  
 Bot chord: 2x4 SP #2;  
 Webs: 2x4 SP #3; W16 2x4 SP #2;

#### Plating Notes


All plates are 2X4 except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
 Wind loading based on both gable and hip roof types.  
 Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 5-3-11.

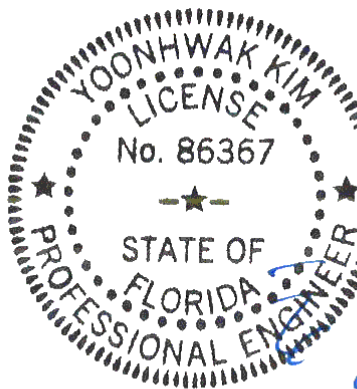


FL REG# 278, Yoonhwak Kim, FL PE #86367  
 03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
 AN ITW COMPANY  
 6750 Forum Drive  
 Suite 305  
 Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608584<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C32 | Cust: R 215 JRRef: 1X3d2150006 T6<br>DrwNo: 062.21.0909.11097<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

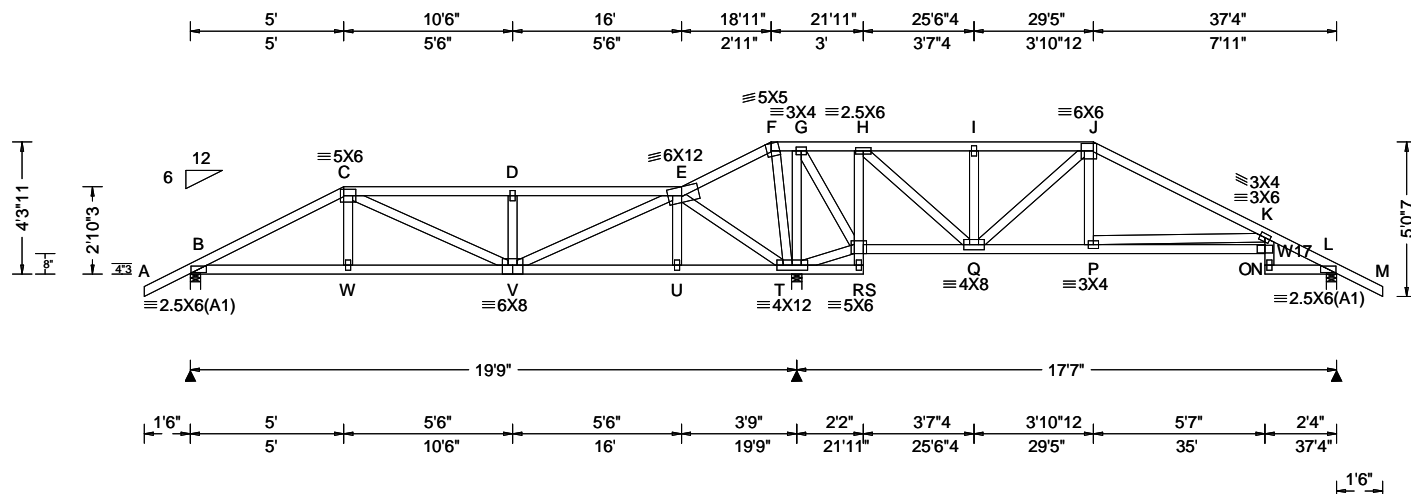

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.73 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.073 K 999 480<br>VERT(CL): 0.170 K 999 360<br>HORZ(LL): 0.034 N - -<br>HORZ(TL): 0.076 N - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.517<br>Max BC CSI: 0.492<br>Max Web CSI: 0.694<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 730 -/- /- /425 /117 /139<br>T 2065 -/- /- /1059 /336 -/-<br>L 613 -/- /- /394 /99 -/-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>T Brg Width = 4.0 Min Req = 2.1<br>L Brg Width = 4.0 Min Req = 1.5<br>Bearings B, T, & L are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3; W17 2x4 SP M-31;

#### Plating Notes


All plates are 2X4 except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4'-3-11".

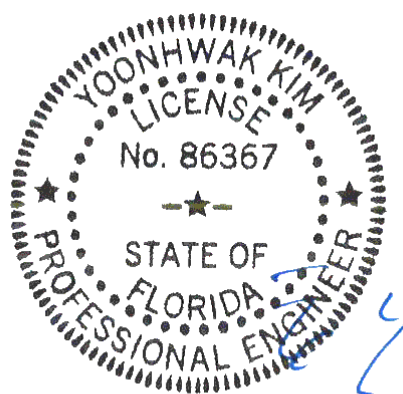

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C  | 394 -973   | F - G  | 1256 -371   |
| C - D  | 412 -823   | G - H  | 940 -246    |
| D - E  | 412 -823   | J - K  | 170 -579    |
| E - F  | 1309 -401  | K - L  | 238 -790    |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| B - W | 814 -284   | R - Q | 426 -913    |
| W - V | 820 -281   | Q - P | 459 -18     |
| V - U | 291 -775   | P - N | 1482 -363   |
| U - T | 289 -781   | O - L | 666 -166    |

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!

#### \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608579<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C33 | Cust: R 215 JRef: 1X3d2150006 T81<br>DrwNo: 062.21.0909.15340<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

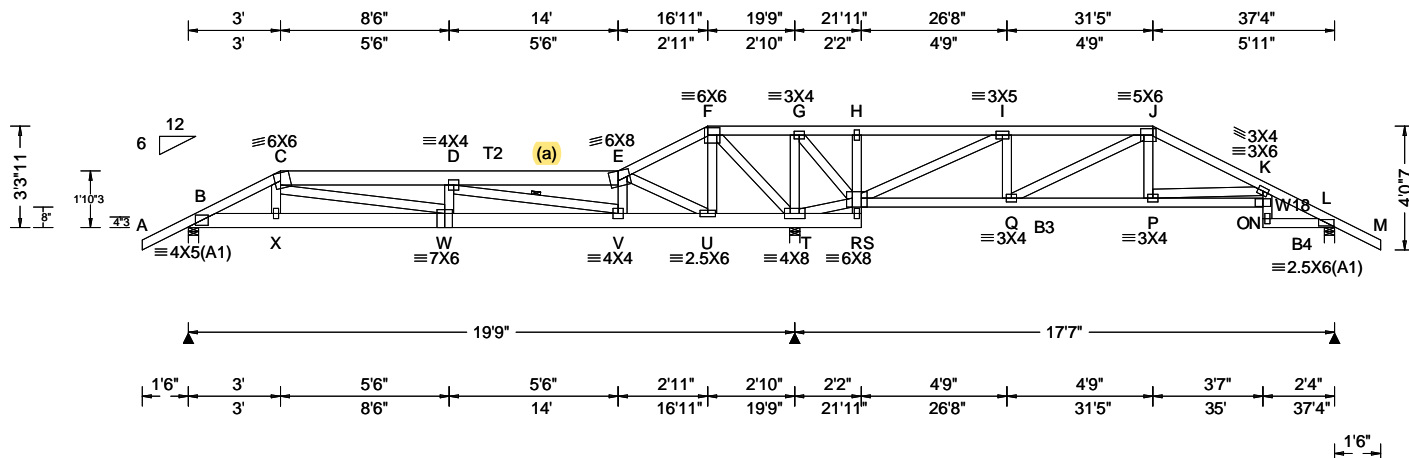

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|---|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.73 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.075 D 999 480<br>VERT(CL): 0.139 K 999 360<br>HORZ(LL): 0.031 N - -<br>HORZ(TL): 0.078 N - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.681<br>Max BC CSI: 0.397<br>Max Web CSI: 0.875<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 967 -/- /- /- /216 -/<br>T 2249 -/- /- /- /397 -/<br>L 659 -/- /- /- /112 -/<br>Non-Gravity<br>B Brg Width = 4.0 Min Req = 1.5<br>T Brg Width = 4.0 Min Req = 1.5<br>L Brg Width = 4.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

**Lumber**  
Top chord: 2x4 SP #2; T2 2x6 SP 2400f-2.0E;  
Bot chord: 2x6 SP 2400f-2.0E; B3,B4 2x4 SP #2;  
Webs: 2x4 SP #3; W18 2x4 SP M-31;


**Bracing**  
(a) Continuous lateral restraint equally spaced on member.

**Special Loads**  
----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 62 plf at -1.50 to 62 plf at 3.00  
TC: From 31 plf at 3.00 to 31 plf at 10.88  
TC: From 62 plf at 10.88 to 62 plf at 38.83  
BC: From 4 plf at -1.50 to 4 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 3.03  
BC: From 10 plf at 3.03 to 10 plf at 10.88  
BC: From 20 plf at 10.88 to 20 plf at 37.33  
BC: From 4 plf at 37.33 to 4 plf at 38.83  
TC: 102 lb Conc. Load at 3.03  
TC: 62 lb Conc. Load at 5.06, 7.06, 9.06  
TC: 90 lb Conc. Load at 10.88  
BC: 118 lb Conc. Load at 3.03  
BC: 49 lb Conc. Load at 5.06, 7.06, 9.06  
BC: 160 lb Conc. Load at 10.88

**Plating Notes**  
All plates are 2X4 except as noted.

**Wind**  
Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

**Additional Notes**  
The overall height of this truss excluding overhang is 3-3-11.

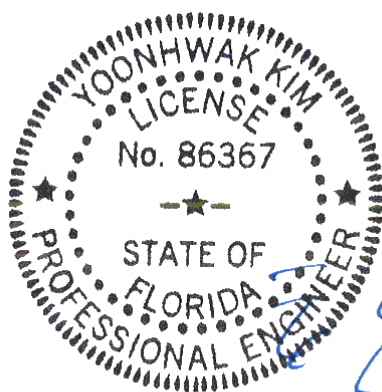

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C  | 331 -1649  | G - H  | 1432 -251   |
| C - D  | 424 -2170  | H - I  | 1443 -253   |
| D - E  | 500 -619   | I - J  | 35 -537     |
| E - F  | 807 -148   | J - K  | 99 -900     |
| F - G  | 1684 -299  | K - L  | 100 -818    |


| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - X  | 1460 -289  | R - Q  | 512 -67     |
| X - W  | 1439 -292  | Q - P  | 782 -75     |
| W - V  | 2165 -443  | P - N  | 1486 -170   |
| V - U  | 618 -500   | O - L  | 669 -76     |
| U - T  | 121 -693   |        |             |

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| C - W | 755 -136   | T - G | 108 -509    |
| D - V | 339 -1599  | T - R | 305 -1705   |
| E - V | 674 -63    | G - R | 576 -66     |
| E - U | 263 -1459  | R - I | 268 -1558   |
| F - U | 536 -67    | Q - J | 96 -528     |
| F - T | 255 -1422  | P - K | 96 -710     |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608569<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: C34 | Cust: R 215 JRef: 1X3d2150006 T47<br>DrwNo: 062.21.0909.17487<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

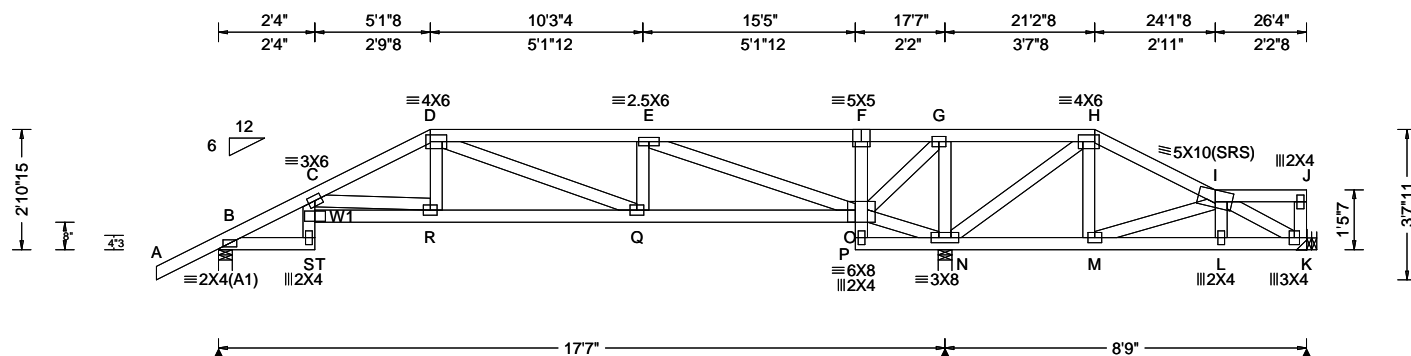

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.068 R 999 480<br>VERT(CL): 0.140 R 999 360<br>HORZ(LL): 0.038 O - -<br>HORZ(TL): 0.080 O - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.485<br>Max BC CSI: 0.417<br>Max Web CSI: 0.898<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 676 -/- /- /416 /112 /77<br>N 1569 -/- /- /798 /274 -/-<br>K 178 -/132 -/- /47 /23 -/-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>N Brg Width = 4.0 Min Req = 1.5<br>K Brg Width = - Min Req = -<br>Bearings B & N are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3; W1 2x4 SP M-31;

#### Plating Notes


All plates are 3X4 except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Right end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2-10-15.

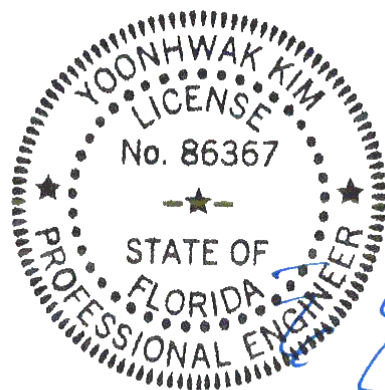

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C  | 332 -833   | F - G  | 640 -261    |
| C - D  | 488 -1055  | G - H  | 1063 -511   |
| D - E  | 483 -806   | H - I  | 535 -237    |
| E - F  | 644 -264   |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| B - T | 675 -307   | Q - O | 786 -434    |
| S - R | 1501 -686  | N - M | 236 -468    |
| R - Q | 941 -431   |       |             |

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!

**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

| <b>▲ Maximum Reactions (lbs)</b> |         |     |     |             |      |     |
|----------------------------------|---------|-----|-----|-------------|------|-----|
| Loc                              | Gravity |     |     | Non-Gravity |      |     |
|                                  | R+      | /R- | /Rh | /Rw         | /U   | /RL |
| A                                | 824     | -/- | -/- | -/-         | /204 | -/- |
| L                                | 1551    | -/- | -/- | -/-         | /348 | -/- |
| I                                | 395     | -/- | -/- | -/-         | /96  | -/- |

Wind reactions based on MWFRS

|   |                 |               |
|---|-----------------|---------------|
| A | Brg Width = 4.0 | Min Req = 1.5 |
| L | Brg Width = 4.0 | Min Req = 1.5 |
| I | Brg Width = 4.0 | Min Req = 1.5 |

Bearings A, L, & I are a rigid surface.

Members not listed have forces less than 375#

**Maximum Top Chord Forces Per Ply (lbs)**

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C  | 541 - 2458 | E - F  | 519 - 2334  |
| C - D  | 576 - 2616 | F - G  | 551 - 133   |
| D - E  | 576 - 2616 | H - I  | 165 - 607   |

| Maximum Bot Chord Forces Per Ply (lbs) |      |      |             |     |      |
|--|------|------|-------------|-----|------|
| Chords                                 |      |      | Tens. Comp. |     |      |
| B - P                                  | 2705 | -606 | K - J       | 502 | -140 |
| P - O                                  | 2616 | -576 | J - I       | 519 | -138 |
| Q - M                                  | 2618 | -576 |             |     |      |

| Maximum Web Forces Per Ply (lbs) |            |        |       |             |       |
|----------------------------------|------------|--------|-------|-------------|-------|
| Webs                             | Tens.Comp. |        | Webs  | Tens. Comp. |       |
| E - M                            | 282        | - 1048 | F - L | 202         | - 778 |
| M - F                            | 3004       | - 676  | L - G | 192         | - 760 |
| M - L                            | 113        | - 445  | K - H | 117         | - 394 |


**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [toint.org](http://toint.org); SBCA: [sbcdistrv.com](http://sbcdistrv.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608461<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: D01 | Cust: R 215 JRef: 1X3d2150006 T80<br>DrwNo: 062.21.0909.23833<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

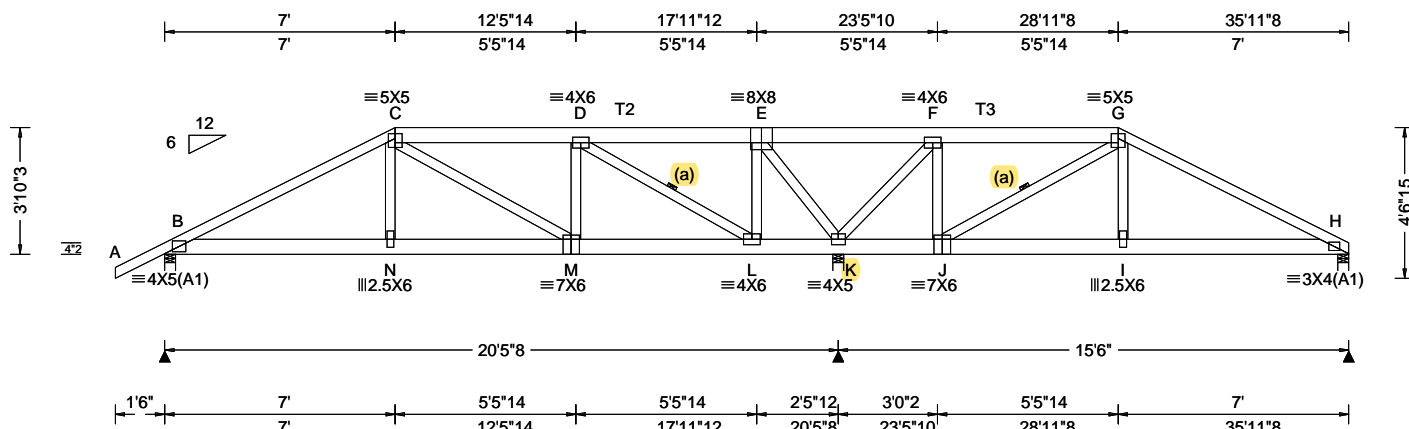

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.60 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.061 N 999 480<br>VERT(CL): 0.123 N 999 360<br>HORZ(LL): 0.018 I - -<br>HORZ(TL): 0.036 I - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.548<br>Max BC CSI: 0.222<br>Max Web CSI: 0.946<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 1526 -/- /- /- /329 -/<br>K 4421 -/- /- /- /959 -/<br>H 812 -/- /- /- /159 -/<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>K Brg Width = 4.0 Min Req = 3.3<br>H Brg Width = 4.0 Min Req = 1.5<br>Bearings B, K, & H are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2; T2,T3 2x6 SP 2400f-2.0E;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 62 plf at -1.50 to 62 plf at 7.00  
TC: From 31 plf at 7.00 to 31 plf at 28.96  
TC: From 62 plf at 28.96 to 62 plf at 35.96  
BC: From 4 plf at -1.50 to 4 plf at 0.00  
BC: From 20 plf at 0.00 to 20 plf at 7.03  
BC: From 10 plf at 7.03 to 10 plf at 28.93  
BC: From 20 plf at 28.93 to 20 plf at 35.96  
TC: 264 lb Conc. Load at 7.03, 28.93  
TC: 187 lb Conc. Load at 9.06, 11.06, 13.06, 15.06  
17.06, 18.90, 20.90, 22.90, 24.90, 26.90  
BC: 445 lb Conc. Load at 7.03  
BC: 129 lb Conc. Load at 9.06, 11.06, 13.06, 15.06  
17.06, 18.90, 20.90, 22.90, 24.90, 26.90  
BC: 423 lb Conc. Load at 28.93

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3'-10-3/4\"/>

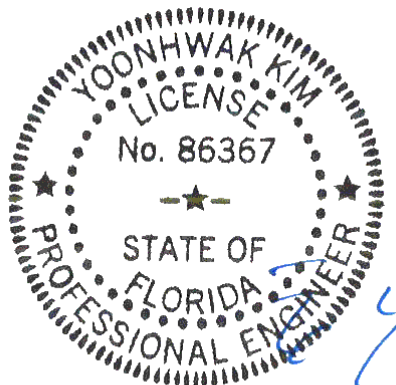


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608471<br>FROM: CDM | HIPS<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: D02 | Cust: R 215 JRef: 1X3d2150006 T7<br>DrwNo: 062.21.0909.26900<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

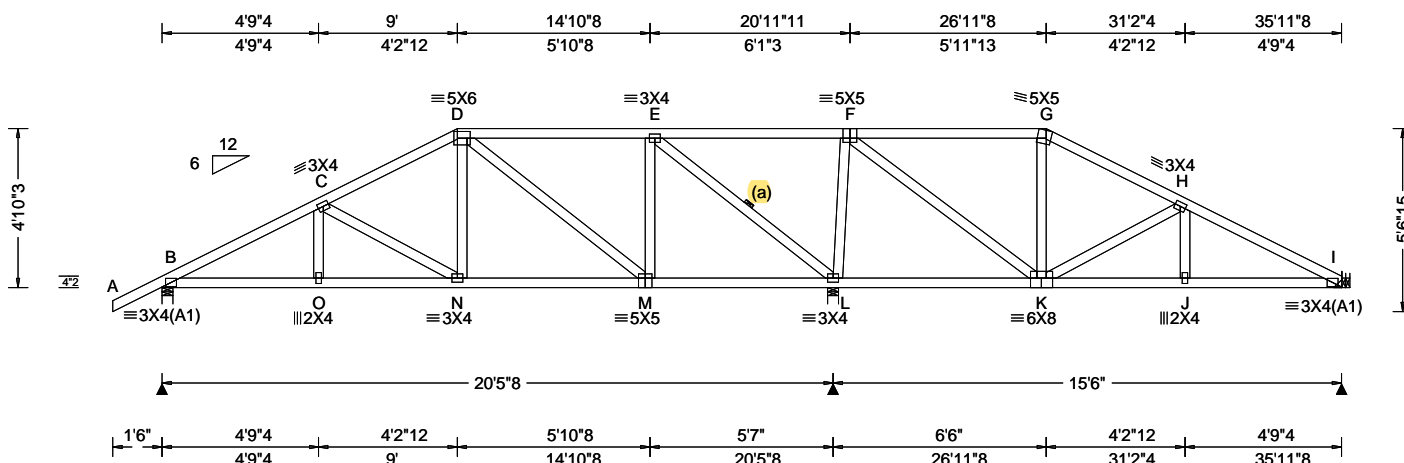

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|--|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.60 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.029 N 999 480<br>VERT(CL): 0.063 N 999 360<br>HORZ(LL): 0.012 J - -<br>HORZ(TL): 0.024 L - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.638<br>Max BC CSI: 0.401<br>Max Web CSI: 0.443<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 826 - / - / /519 /137 /138<br>L 1819 - / - / /930 /302 - / -<br>I 506 - / - / /316 /69 - / -<br>Non-Gravity<br>B Brg Width = 4.0 Min Req = 1.5<br>L Brg Width = 4.0 Min Req = 1.8<br>I Brg Width = - Min Req = -<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=35'8"8 uses the following support conditions: 35'8"8

Bearing I (35'8"8, 9'1"2) LUS26

Supporting Member: (2)2x6 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting member,  
(3) 0.148"x3" nails into supported member.

#### Wind


Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4-10-3.

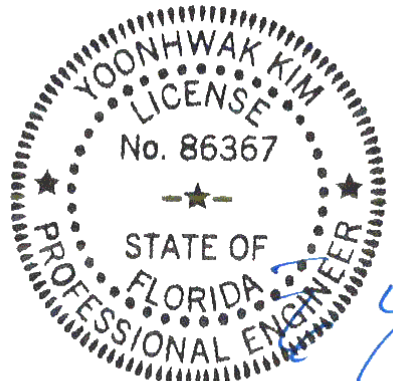

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - C  | 370 -1171  | E - F  | 637 -137    |
| C - D  | 349 -831   | H - I  | 179 -761    |
| D - E  | 252 -386   |        |             |

#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| D - M | 137 -440   | L - F | 479 -925    |
| M - E | 434 -26    | F - K | 864 -290    |
| E - L | 505 -1193  | K - H | 146 -409    |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.


For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCEA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821





|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608479<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: D04 | Cust: R 215 JRef: 1X3d2150006 T39<br>DrwNo: 062.21.0909.31583<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

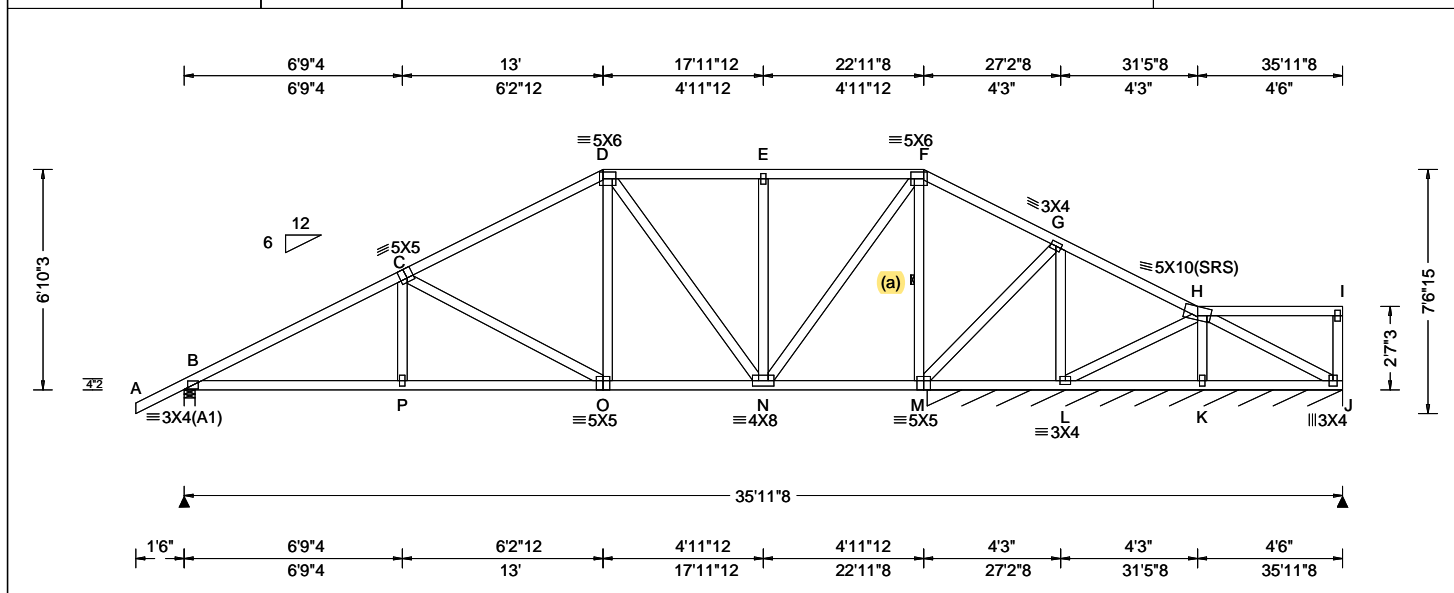

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs), or *PLF   |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.60 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br><br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.044 P 999 480<br>VERT(CL): 0.090 P 999 360<br>HORZ(LL): 0.014 N - -<br>HORZ(TL): 0.030 N - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.440<br>Max BC CSI: 0.570<br>Max Web CSI: 0.626<br><br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 980 - / - / - /626 /156 /178<br>J* 162 - / - / - /85 /27 -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>J Brg Width = 154 Min Req = -<br>Bearings B & M are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - C 383 -1430 D - E 268 -376<br>C - D 339 -850 E - F 268 -376 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6-10-3.

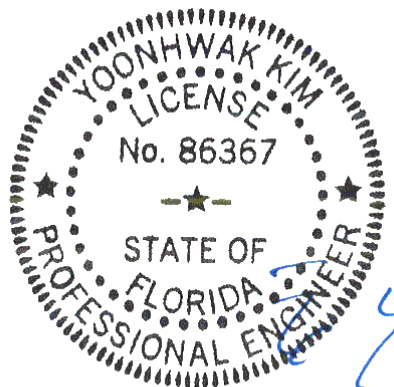

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021


**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608482<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: D05 | Cust: R 215 JRef: 1X3d2150006 T40<br>DrwNo: 062.21.0909.34220<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

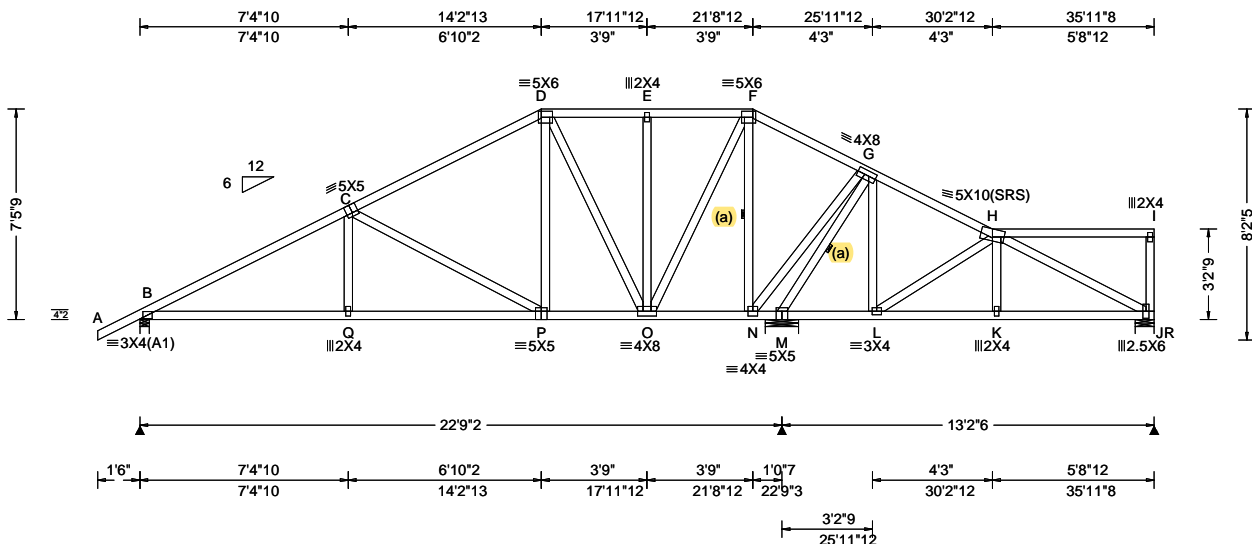

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCCL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.60 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.048 Q 999 480<br>VERT(CL): 0.098 Q 999 360<br>HORZ(LL): 0.017 J - -<br>HORZ(TL): 0.034 J - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.558<br>Max BC CSI: 0.668<br>Max Web CSI: 0.812<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 1001 - / - / /637 /39 /193<br>N 1657 - / - / /859 /58 - /-<br>R 443 - / - / /237 /45 - /-<br>Non-Gravity<br>B Brg Width = 4.0 Min Req = 1.5<br>N Brg Width = 14.1 Min Req = 2.0<br>R Brg Width = 8.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br>Bearings B, N, & R are a rigid surface.<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 7'-5-9.

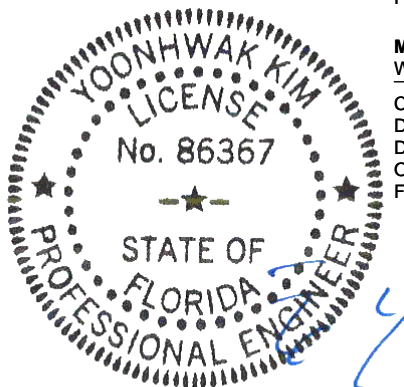


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

2 Complete Trusses Required

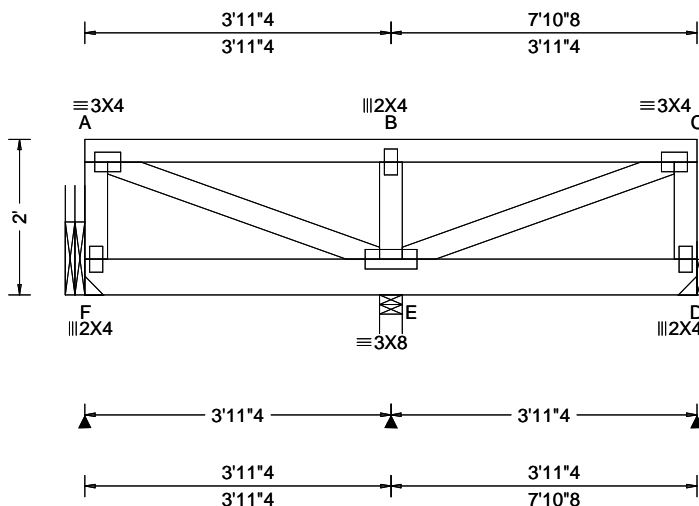

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|---|---|--|--|---|
| TCLL: 40.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 5.00<br>Des Ld: 55.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.00<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 3.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.25 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.000 B 999 480<br>VERT(CL): 0.001 B 999 360<br>HORZ(LL): 0.000 C - -<br>HORZ(TL): 0.000 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.222<br>Max BC CSI: 0.103<br>Max Web CSI: 0.055<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>F 248 - / - / - /97 -<br>E 1380 - / - / - /633 -<br>D 237 - / - / - /99 -<br>Wind reactions based on MWFRS<br>F Brg Width = - Min Req = -<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = - Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 6.50" o.c.  
Webs: 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.00 / Plate Dur.Fac.=1.00)  
TC: From 50 plf at 0.00 to 50 plf at 7.87  
BC: From 5 plf at 0.00 to 5 plf at 7.87  
BC: 492 lb Conc. Load at 1.94  
BC: 470 lb Conc. Load at 3.94, 5.94

#### Purlins


The TC of this truss shall be braced with attached spans at 24" oc in lieu of structural sheathing.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Truss must be installed as shown with top chord up.  
The overall height of this truss excluding overhang is 2'-0".

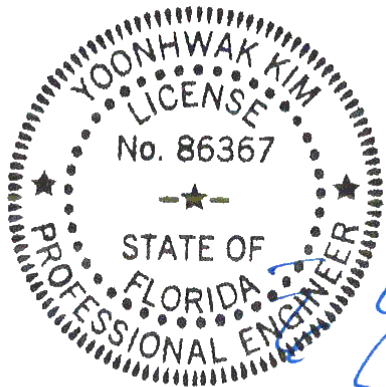

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                    |
|--------------|------|--------|---------------------|------------------------------------|
| SEQN: 360368 | FLAT | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T101 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0909.40843           |
| Page 2 of 2  |      |        | Truss Label: FT01   | / YK 03/03/2021                    |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' ,y=8'7"2 uses the following support conditions: 0'

Bearing F (0', 8'7"2) LUS26-2

Supporting Member: (2)2x12 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting member,


(3) 0.148"x3" nails into supported member.

Bearing D (7'7"8, 8'7"2) LUS26-2

Supporting Member: (1)2x6 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

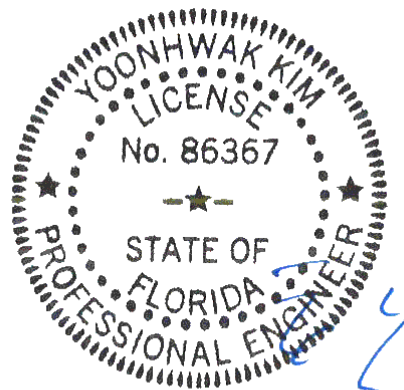

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING! **\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



2 Complete Trusses Required

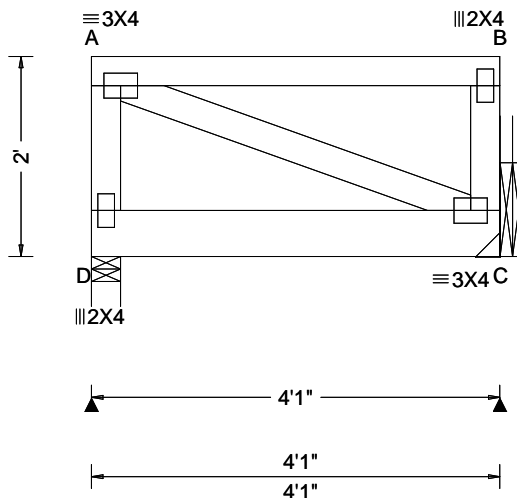

| Loading Criteria (psf) |        | Wind Criteria        |           | Snow Criteria (Pg,Pf in PSF) |        | Defl/CSI Criteria     |                                 | ▲ Maximum Reactions (lbs)                     |                 |      |               |      |      |      |
|------------------------|--------|----------------------|-----------|------------------------------|--------|-----------------------|---------------------------------|---|-----------------|------|---------------|------|------|------|
| TCLL:                  | 40.00  | Wind Std:            | ASCE 7-16 | Pg: NA                       | Ct: NA | CAT: NA               | PP Deflection in loc L/defl L/# | Gravity                                       |                 |      | Non-Gravity   |      |      |      |
| TCDL:                  | 10.00  | Speed:               | 130 mph   | Pf: NA                       | Ce: NA |                       | VERT(LL): 0.000 A 999 480       | Loc   | R+              | / R- | / Rh          | / Rw | / U  | / RL |
| BCLL:                  | 0.00   | Enclosure:           | Closed    | Lu: NA                       | Cs: NA |                       | VERT(CL): 0.000 A 999 360       | D   | 472             | /-   | /-            | /-   | /147 | /-   |
| BCDL:                  | 5.00   | Risk Category:       | II        | Snow Duration: NA            |        |                       | HORZ(LL): -0.000 B - -          | C   | 498             | /-   | /-            | /-   | /158 | /-   |
| Des Ld:                | 55.00  | EXP: C               | Kzt: NA   |                              |        | Building Code:        | HORZ(TL): 0.000 B - -           | Wind reactions based on MWFRS                 |                 |      |               |      |      |      |
| NCBCLL:                | 0.00   | Mean Height:         | 15.00 ft  |                              |        | FBC 7th Ed. 2020 Res. | Creep Factor: 2.0               | D   | Brg Width = 3.5 |      | Min Req = 1.5 |      |      |      |
| Soffit:                | 2.00   | TCDL:                | 5.0 psf   |                              |        | TPI Std: 2014         | Max TC CSI: 0.264               | C   | Brg Width = -   |      | Min Req = -   |      |      |      |
| Load Duration:         | 1.00   | BCDL:                | 3.0 psf   |                              |        | Rep Fac: Yes          | Max BC CSI: 0.151               | Bearing D is a rigid surface.                 |                 |      |               |      |      |      |
| Spacing:               | 24.0 " | MWFRS Parallel Dist: | 0 to h/2  |                              |        | FT/RT:20(0)/10(0)     | Max Web CSI: 0.057              | Members not listed have forces less than 375# |                 |      |               |      |      |      |
|                        |        | C&C Dist a:          | 3.00 ft   |                              |        | Plate Type(s):        |                                 |   |                 |      |               |      |      |      |
|                        |        | Loc. from endwall:   | Any       |                              |        | WAVE                  |                                 |   |                 |      |               |      |      |      |
|                        |        | GCpi:                | 0.18      |                              |        |                       |                                 |   |                 |      |               |      |      |      |
|                        |        | Wind Duration:       | 1.25      |                              |        |                       | VIEW Ver: 20.01.01A.0724.11     |   |                 |      |               |      |      |      |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 9.25" o.c.  
Webs : 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.00 / Plate Dur.Fac.=1.00)  
TC: From 100 plf at 0.00 to 100 plf at 4.08  
BC: From 10 plf at 0.00 to 10 plf at 4.08  
BC: 521 lb Conc. Load at 2.14

#### Purlins


The TC of this truss shall be braced with attached spans at 24" oc in lieu of structural sheathing.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Truss must be installed as shown with top chord up.  
The overall height of this truss excluding overhang is 2'-0".

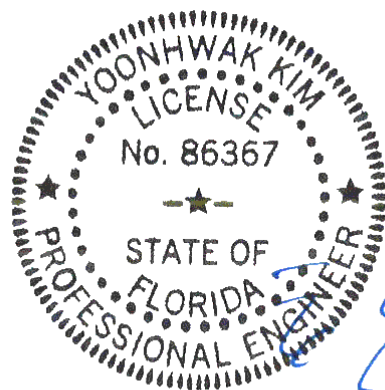

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 360366 | FLAT | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T56 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0909.45997          |
| Page 2 of 2  |      |        | Truss Label: FT02   | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.


Bearing at location  $x=3'10"$  ,  $y=8'7"2$  uses the following support conditions: 3'10"

Bearing C (3'10", 8'7"2) LUS26-2

Supporting Member: (2)2x12 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

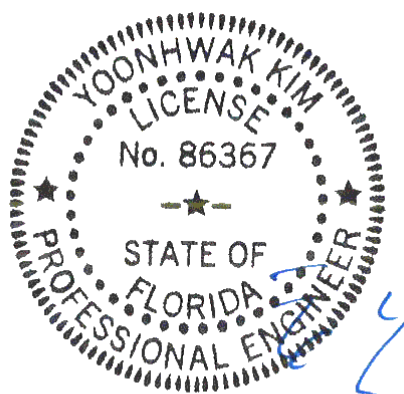

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

2 Complete Trusses Required

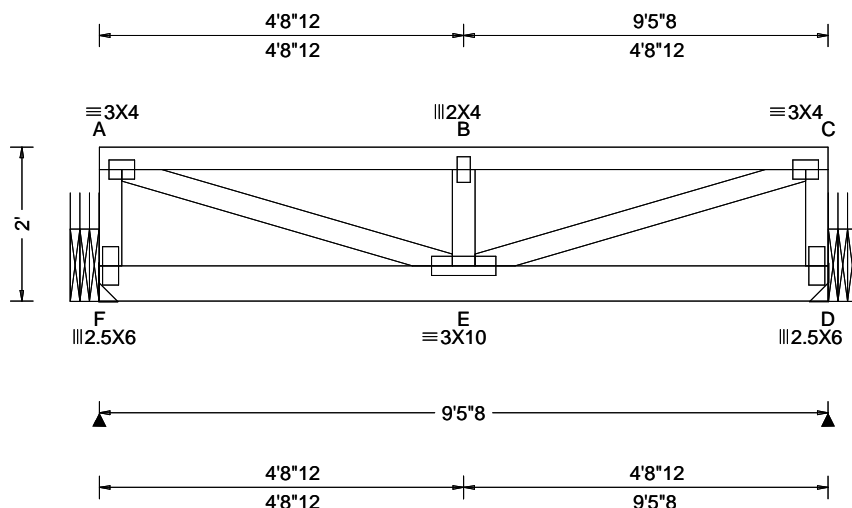

| Loading Criteria (psf)   | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|--|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: No<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.027 B 999 480<br>VERT(CL): 0.054 B 999 360<br>HORZ(LL): 0.004 A - -<br>HORZ(TL): 0.008 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.123<br>Max BC CSI: 0.152<br>Max Web CSI: 0.413<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>F 1121 - / - / - /537 -/<br>D 1138 - / - / - /546 -/<br>Wind reactions based on MWFRS<br>F Brg Width = - Min Req = -<br>D Brg Width = - Min Req = -<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>A - B 504 - 1036 B - C 504 - 1036<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp. Webs Tens. Comp.<br>A - F 187 - 388 E - C 1084 - 527<br>A - E 1084 - 527 C - D 187 - 388 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 7.50" o.c.  
Webs : 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails  
in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 30 plf at 0.00 to 30 plf at 9.46  
BC: From 10 plf at 0.00 to 10 plf at 9.46  
BC: 470 lb Conc. Load at 1.77, 3.77, 5.77, 7.77

#### Purlins


The TC of this truss shall be braced with attached  
spans at 24" oc in lieu of structural sheathing.

#### Wind

Wind loads and reactions based on MWFRS.  
End verticals not exposed to wind pressure.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Truss must be installed as shown with top chord up.  
The overall height of this truss excluding overhang is  
2'-0".

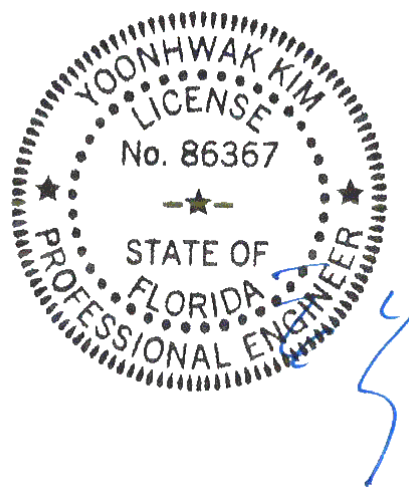

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 360362 | FLAT | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T58 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0909.52023          |
| Page 2 of 2  |      |        | Truss Label: FT03   | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended connection based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information. Additional connection required to evenly distribute hanger reaction throughout all plies of supporting girder.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing F (0', 8'7"2) HGUS28-2

Supporting Member: (3)2x12 SP 2400f-2.0E

(36) 0.148"x3" nails into supporting member,


(6) 0.148"x3" nails into supported member.

Bearing D (9'2"8, 8'7"2) HGUS28-2

Supporting Member: (3)2x12 SP 2400f-2.0E

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

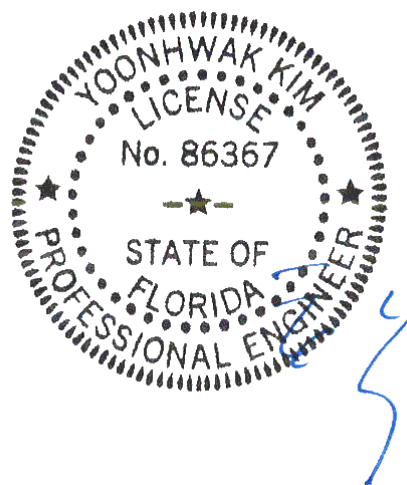

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING! **\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

| <b>Lumber</b><br>Top chord: 2x4 SP #2; T2 2x6 SP 2400f-2.0E;<br>Bot chord: 2x6 SP 2400f-2.0E;<br>Webs: 2x4 SP #3;  | <b>Loading</b><br>Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.  | B - C 457 - 2218 D - E 469 - 2361<br>C - D 469 - 2361 F - G 696 - 136  |             |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |
|--|---|--|-------------|------------|--------|-------------|-------|------------|-------|-----------|-------|------------|-------|----------|-------|-----------|-------|-----------|------|------------|------|-------------|
| <b>Nailnote</b><br>Nail Schedule:0.128"x3", min. nails<br>Top Chord: 1 Row @12.00" o.c.<br>Bot Chord: 1 Row @12.00" o.c.<br>Webs : 1 Row @ 4" o.c.<br>Use equal spacing between rows and stagger nails in each row to avoid splitting. | <b>Wind</b><br>Wind loads and reactions based on MWFRS.<br>Wind loading based on both gable and hip roof types.<br>Uplifts based on an elevation at or above 1000 ft. | <b>Maximum Bot Chord Forces Per Ply (lbs)</b><br><table><tr><th>Chords</th><th>Tens.Comp.</th><th>Chords</th><th>Tens. Comp.</th></tr><tr><td>B - S</td><td>1952 - 396</td><td>Q - P</td><td>846 - 164</td></tr><tr><td>S - R</td><td>1936 - 396</td><td>P - O</td><td>95 - 530</td></tr><tr><td>R - Q</td><td>840 - 164</td><td>O - N</td><td>111 - 605</td></tr></table><br><b>Maximum Web Forces Per Ply (lbs)</b><br><table><tr><th>Webs</th><th>Tens.Comp.</th><th>Webs</th><th>Tens. Comp.</th></tr></table> | Chords      | Tens.Comp. | Chords | Tens. Comp. | B - S | 1952 - 396 | Q - P | 846 - 164 | S - R | 1936 - 396 | P - O | 95 - 530 | R - Q | 840 - 164 | O - N | 111 - 605 | Webs | Tens.Comp. | Webs | Tens. Comp. |
| Chords   | Tens.Comp.  | Chords   | Tens. Comp. |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |
| B - S  | 1952 - 396  | Q - P  | 846 - 164   |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |
| S - R  | 1936 - 396  | P - O  | 95 - 530    |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |
| R - Q  | 840 - 164   | O - N  | 111 - 605   |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |
| Webs   | Tens.Comp.  | Webs   | Tens. Comp. |            |        |             |       |            |       |           |       |            |       |          |       |           |       |           |      |            |      |             |


|                          |            |          |           |       |
|--------------------------|------------|----------|-----------|-------|
| BC: From                 | 32 plf at  | 1.50 to  | 32 plf at | 31.91 |
| BC: From                 | 4 plf at   | -1.50 to | 4 plf at  | 0.00  |
| BC: From                 | 20 plf at  | 0.00 to  | 20 plf at | 7.03  |
| BC: From                 | 10 plf at  | 7.03 to  | 10 plf at | 14.00 |
| BC: From                 | 20 plf at  | 14.00 to | 20 plf at | 29.79 |
| BC: From                 | 60 plf at  | 29.79 to | 60 plf at | 31.91 |
| BC: From                 | 20 plf at  | 31.91 to | 20 plf at | 49.96 |
| BC: From                 | 4 plf at   | 49.96 to | 4 plf at  | 51.46 |
| TC: 264 lb Conc. Load at | 7.03       |          |           |       |
| TC: 187 lb Conc. Load at | 9.06,11.06 |          |           |       |
| TC: 194 lb Conc. Load at | 13.06      |          |           |       |
| BC: 423 lb Conc. Load at | 7.03       |          |           |       |
| BC: 129 lb Conc. Load at | 9.06,11.06 |          |           |       |
| BC: 131 lb Conc. Load at | 13.06      |          |           |       |
| BC: 828 lb Conc. Load at | 13.88      |          |           |       |

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tjoinst.org](http://tjoinst.org); SBCA: [sbcdinustrv.com](http://sbcdinustrv.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)



6750 Forum Drive  
 Suite 305  
 Orlando FL, 32821




|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 351663 | SPEC | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T41 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0910.00173          |
| Page 2 of 2  |      |        | Truss Label: G01    | / YK 03/03/2021                   |

#### Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 8-1-3.

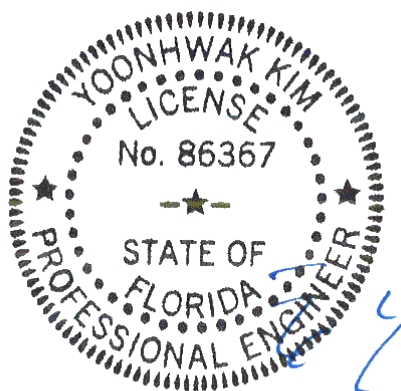

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING! **\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608495<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: G02 | Cust: R 215 JRRef: 1X3d2150006 T29<br>DrwNo: 062.21.0910.04047<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

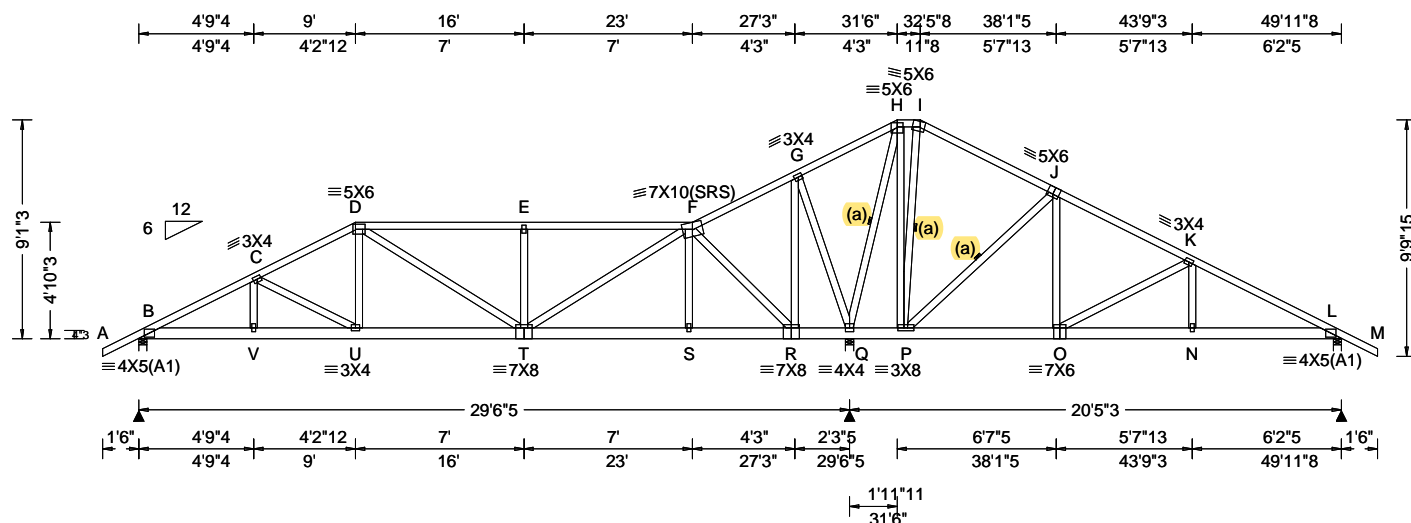

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 5.00 ft<br>Loc. from endwall: not in 13.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.060 E 999 480<br>VERT(CL): 0.125 E 999 360<br>HORZ(LL): 0.013 C - -<br>HORZ(TL): 0.027 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.573<br>Max BC CSI: 0.134<br>Max Web CSI: 0.817<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 1079 -/- /- /666 /39 /274<br>Q 2736 -/- /- /1439 /112 -/<br>L 757 -/- /- /470 /73 -/<br>Non-Gravity<br>B Brg Width = 4.0 Min Req = 1.5<br>Q Brg Width = 4.0 Min Req = 1.9<br>L Brg Width = 4.0 Min Req = 1.5<br>Wind reactions based on MWFRS<br>Members not listed have forces less than 375#<br>Bearings B, Q, & L are a rigid surface.<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Plating Notes

All plates are 2X4 except as noted.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 9-1-3.

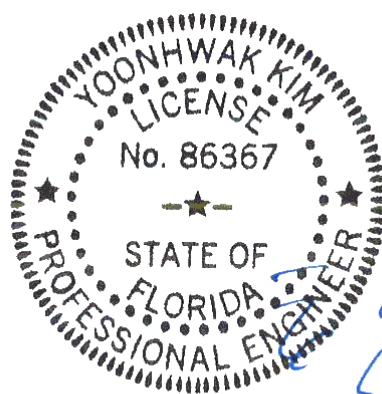

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| B - V  | 1493 -405  | Q - P  | 452 -649    |
| V - U  | 1491 -407  | O - N  | 812 -55     |
| U - T  | 1222 -280  | N - L  | 816 -54     |
| R - Q  | 420 -702   |        |             |


#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| E - T | 333 -475   | H - P | 974 -297    |
| T - F | 1217 -459  | P - I | 252 -530    |
| F - R | 460 -1137  | P - J | 244 -799    |
| R - G | 713 -243   | J - O | 480 -22     |
| G - Q | 377 -862   | O - K | 155 -524    |
| Q - H | 368 -1558  |       |             |

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 608498<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: G03 | Cust: R 215 JRRef: 1X3d2150006 T31<br>DrwNo: 062.21.0910.06113<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

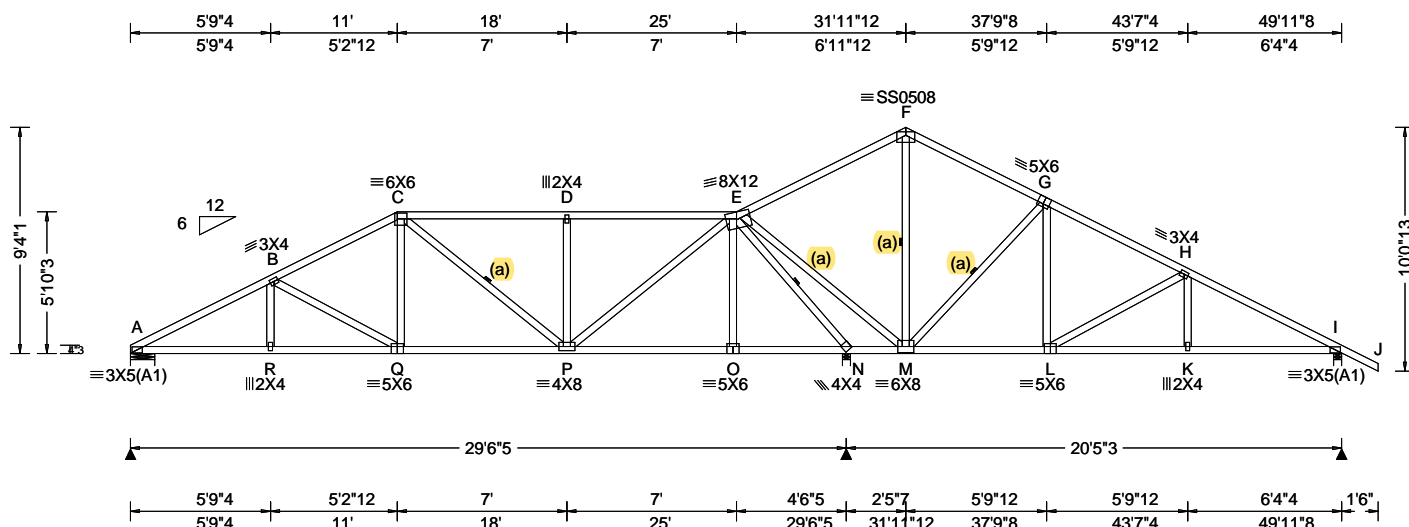

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 5.00 ft<br>Loc. from endwall: not in 13.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE, 18SS | PP Deflection in loc L/def L/#<br>VERT(LL): 0.076 Q 999 480<br>VERT(CL): 0.150 Q 999 360<br>HORZ(LL): 0.031 K - -<br>HORZ(TL): 0.061 K - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.618<br>Max BC CSI: 0.659<br>Max Web CSI: 0.925<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 1092 -/- /- /657 /32 /267<br>N 2423 -/- /- /1274 /95 /-<br>I 870 -/- /- /566 /60 /-<br>Non-Gravity<br>Wind reactions based on MWFRS<br>A Brg Width = 12.0 Min Req = 1.5<br>N Brg Width = 4.0 Min Req = 2.5<br>I Brg Width = 4.0 Min Req = 1.5<br>Bearings A, N, & I are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp. Chords Tens. Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Bracing

(a) Continuous lateral restraint equally spaced on member.

#### Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 9'-4-1/2".

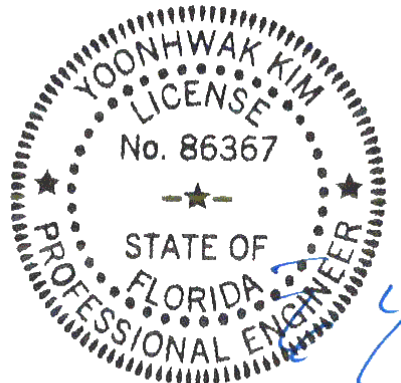

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### Maximum Bot Chord Forces Per Ply (lbs)

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| A - R  | 1682 -455  | M - L  | 532 0       |
| R - Q  | 1679 -457  | L - K  | 1006 -55    |
| Q - P  | 1281 -305  | K - I  | 1009 -54    |
| N - M  | 554 -1582  |        |             |


#### Maximum Web Forces Per Ply (lbs)

| Webs  | Tens.Comp. | Webs  | Tens. Comp. |
|-------|------------|-------|-------------|
| B - Q | 185 -461   | E - M | 1828 -409   |
| C - Q | 417 -33    | F - M | 160 -545    |
| D - P | 319 -454   | M - G | 226 -764    |
| P - E | 1115 -398  | G - L | 475 -26     |
| E - N | 900 -2947  | L - H | 162 -536    |

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

### 3 Complete Trusses Required

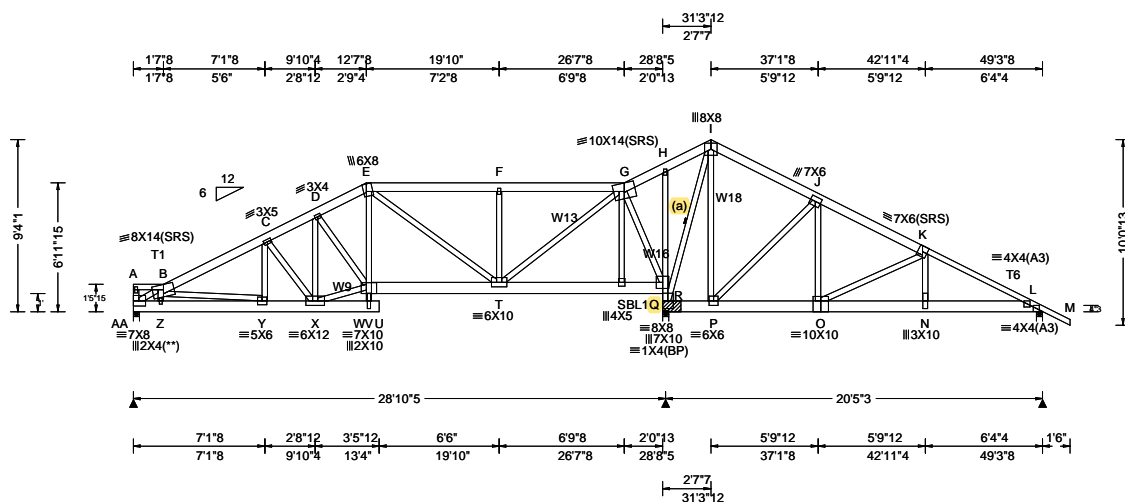

| Loading Criteria (psf)   | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | Maximum Reactions (lbs)   |
|--|--|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 4.93 ft<br>Loc. from endwall: not in 13.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.108 U 999 480<br>VERT(CL): 0.216 U 999 360<br>HORZ(LL): 0.031 S - -<br>HORZ(TL): 0.062 S - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.385<br>Max BC CSI: 0.347<br>Max Web CSI: 0.920<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>AA 8281 -/- /- /- /577 -/<br>Q 17912 -/- /- /- /1929 -/<br>L 5375 -/- /- /- /842 -/<br>Wind reactions based on MWFRS<br>AA Brg Width = 4.0 Min Req = 2.3<br>Q Brg Width = 4.0 Min Req = -<br>L Brg Width = 4.0 Min Req = 1.5<br>Bearings AA, Q, & L are a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp. |

**Lumber**  
Top chord: 2x6 SP 2400f-2.0E; T1, T6 2x4 SP #2;  
Bot chord: 2x8 SP 2400f-2.0E;  
Webs: 2x4 SP #3; W9, W13, W18 2x4 SP #2;  
W16 2x4 SP M-31;

**Bracing**  
(a) Continuous lateral restraint equally spaced on member.


**Nailnote**  
Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 2 Rows @ 5.50" o.c. (Each Row)  
Webs : 1 Row @ 4" o.c.  
Repeat nailing as each layer is applied. Use equal spacing between rows and stagger nails in each row to avoid splitting.

**Plating Notes**  
All plates are 2X4 except as noted.  
(\*\*) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

**Wind**  
Wind loads and reactions based on MWFRS.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

**Bearing Block(s)**  
Brg blocks: 0.128"x3", min. nails  
brg x-loc #blocks length/blk #nails/blk wall plate  
2 28.692' 1 12" 7 Rigid Surface  
Brg block to be same size and species as chord.  
Refer to drawing CNNAILSP1014 for more information.

**Additional Notes**  
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.  
The overall height of this truss excluding overhangs 9'-4-1.

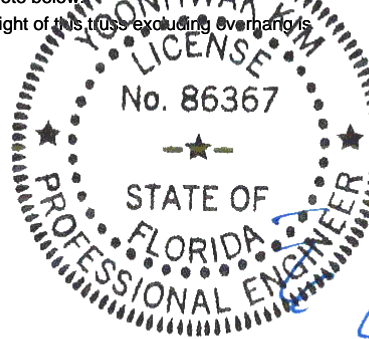

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| AA - Z | 3739 -251  | S - R  | 585 -28     |
| Z - Y  | 3698 -255  | P - O  | 1890 -294   |
| Y - X  | 3901 -304  | O - N  | 3248 -488   |
| V - T  | 3402 -297  | N - L  | 3307 -495   |
| T - S  | 579 -25    |        |             |

| Chords | Tens.Comp. | Chords | Tens. Comp. |
|--------|------------|--------|-------------|
| AA - B | 292 -4358  | H - R  | 59 -449     |
| Y - C  | 944 -4     | R - Q  | 227 -2921   |
| C - X  | 48 -995    | Q - I  | 391 -2766   |
| X - V  | 3556 -295  | I - P  | 2721 -383   |
| E - V  | 1941 -151  | P - J  | 328 -2271   |
| E - T  | 88 -715    | J - O  | 2328 -302   |
| T - G  | 2874 -258  | O - K  | 211 -1470   |
| S - G  | 746 0      | K - N  | 1263 -153   |
| G - R  | 158 -2424  |        |             |

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBICA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 614335 | SPEC | Ply: 3 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T89 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0910.18360          |
| Page 2 of 2  |      |        | Truss Label: G04    | / YK 03/03/2021                   |

### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 62 plf at 0.00 to 62 plf at 50.79

BC: From 20 plf at 0.00 to 20 plf at 49.29

BC: From 4 plf at 49.29 to 4 plf at 50.79

BC: 815 lb Conc. Load at 0.06

BC: 590 lb Conc. Load at 1.79

BC: 1185 lb Conc. Load at 3.79

BC: 1187 lb Conc. Load at 5.79, 7.79, 9.79

BC: 711 lb Conc. Load at 11.79

BC: 670 lb Conc. Load at 13.79

BC: 916 lb Conc. Load at 15.79

BC: 931 lb Conc. Load at 17.79

BC: 1050 lb Conc. Load at 19.79

BC: 971 lb Conc. Load at 21.79

BC: 963 lb Conc. Load at 23.79

BC: 865 lb Conc. Load at 25.52

BC: 1413 lb Conc. Load at 27.52

BC: 1519 lb Conc. Load at 29.52


BC: 1631 lb Conc. Load at 31.52

BC: 1628 lb Conc. Load at 33.52

BC: 1547 lb Conc. Load at 35.52

BC: 1309 lb Conc. Load at 37.52, 39.52, 41.52

BC: 2515 lb Conc. Load at 43.52

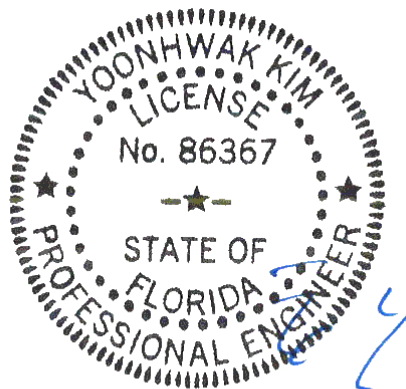

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

#### **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608503<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: H17 | Cust: R 215 JRef: 1X3d2150006 T65<br>DrwNo: 062.21.0910.20980<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

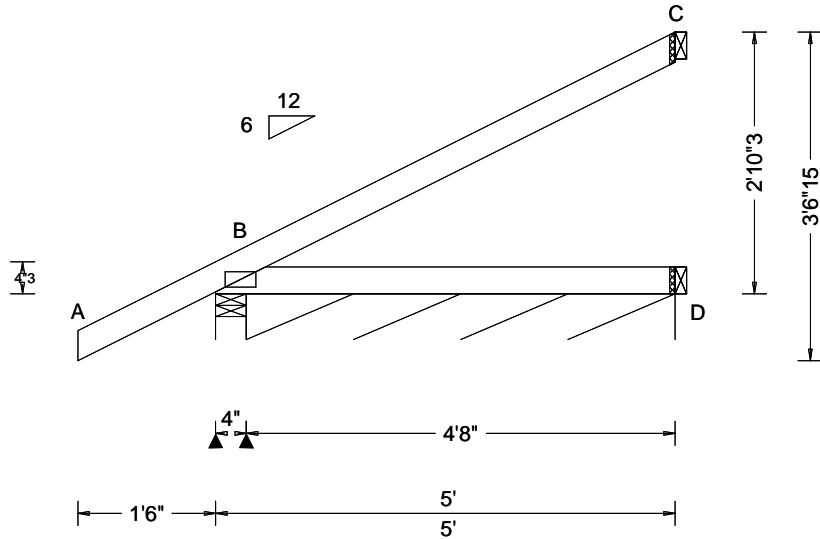

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs), or *=PLF  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.002 D - -<br>HORZ(TL): 0.004 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.291<br>Max BC CSI: 0.183<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 283 - / - /191 /38 /105<br>D* 28 - / - /17 /0 -<br>D 33 - / - /15 - / -<br>C 119 - / - /72 /61 -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 56.0 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearings B & B are a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Plating Notes

All plates are 2X4(A1) except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Shim all supports to solid bearing.

The overall height of this truss excluding overhang is 2-10-3.

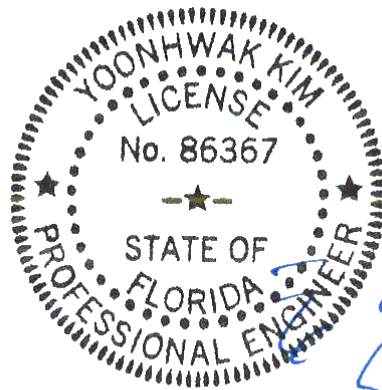

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!

#### \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)



6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 339483<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ01 | Cust: R 215 JRef: 1X3d2150006 T95<br>DrwNo: 062.21.0910.22673<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

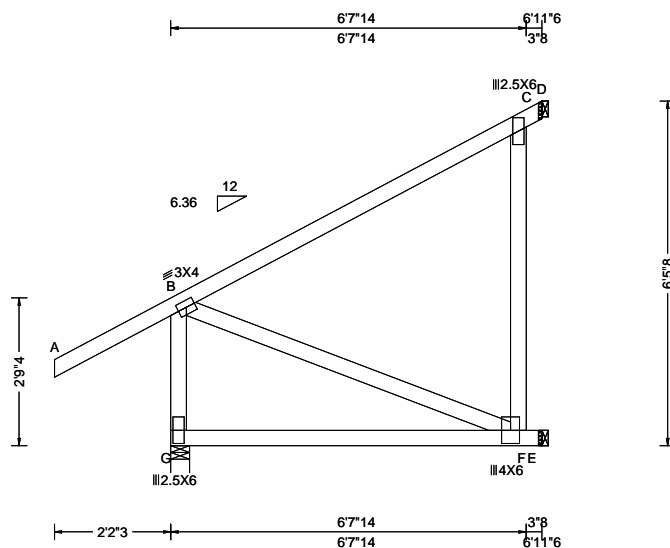

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.014 F 999 480<br>VERT(CL): 0.028 F 999 360<br>HORZ(LL): 0.013 C - -<br>HORZ(TL): 0.024 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.568<br>Max BC CSI: 0.598<br>Max Web CSI: 0.199<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>G 286 -/- /- /- /201 -/<br>E 39 -/13 -/- /- /332 -/<br>D 221 -/- /- /280 -/- /-<br>Wind reactions based on MWFRS<br>G Brg Width = 4.2 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing G is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 0 plf at -2.18 to 63 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 6.95  
BC: From 0 plf at -2.18 to 5 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 6.95  
TC: -50 lb Conc. Load at 1.36  
TC: 136 lb Conc. Load at 4.18  
BC: 38 lb Conc. Load at 1.36  
BC: 118 lb Conc. Load at 4.18

#### Wind

Wind loads and reactions based on MWFRS.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6'-5-8.

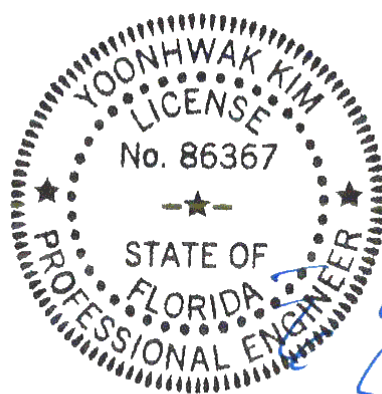

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |      |                  |   |   |
|---------------------------|------|------------------|---|---|
| SEQN: 339491<br>FROM: CDM | HIP_ | Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ02 | Cust: R 215 JRRef: 1X3d2150006 T82<br>DrwNo: 062.21.0910.24443<br>/ YK 03/03/2021 |
|---------------------------|------|------------------|---|---|

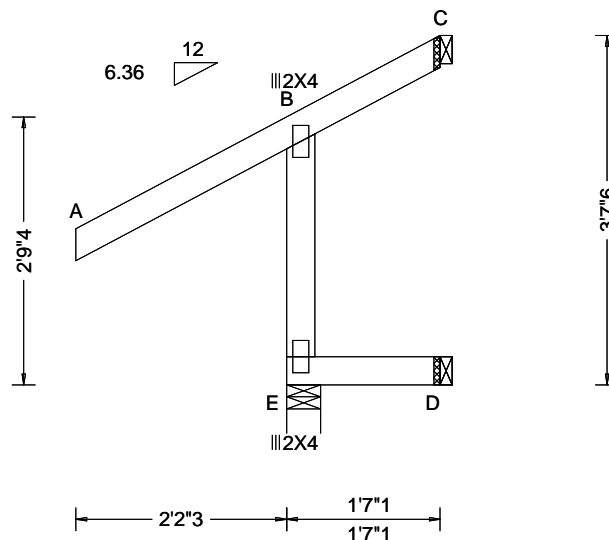

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 B 999 480<br>VERT(CL): 0.001 B 999 360<br>HORZ(LL): 0.000 B - -<br>HORZ(TL): 0.000 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.142<br>Max BC CSI: 0.024<br>Max Web CSI: 0.025<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 150 /- /- /- /37 /-<br>D 32 /- /- /1 /- /-<br>C - /-32 /- /13 /- /-<br>Wind reactions based on MWFRS<br>E Brg Width = 4.2 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads and reactions based on MWFRS.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3'-7.6."

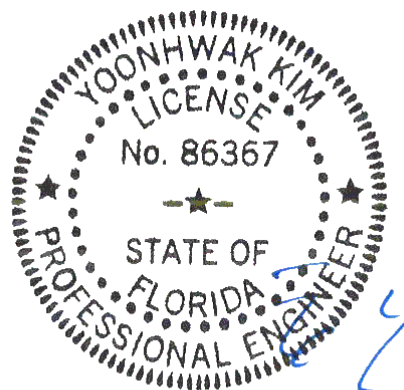

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)



6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |   |
|---------------------------|-----------------------|---|---|
| SEQN: 614315<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ04 | Cust: R 215 JRRef: 1X3d2150006 T52<br>DrwNo: 062.21.0910.25893<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|---|

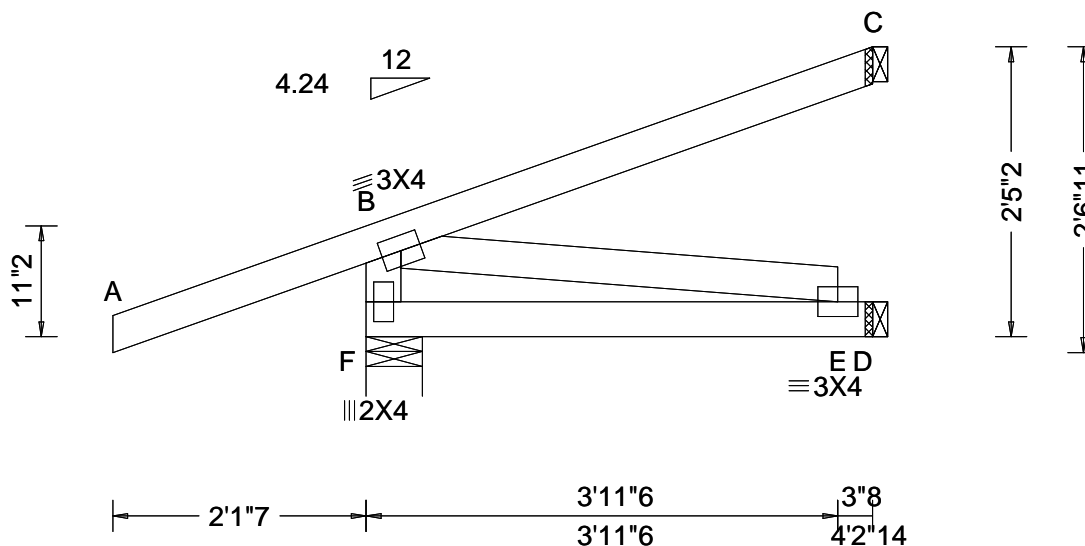

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.39 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.001 E 999 480<br>VERT(CL): 0.005 E 999 360<br>HORZ(LL): 0.000 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.189<br>Max BC CSI: 0.156<br>Max Web CSI: 0.207<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>F 197 /- /- /- /99 /-<br>D 83 /- /- /2 /- /-<br>C 33 /-16 /- /- /31 /-<br>Wind reactions based on MWFRS<br>F Brg Width = 5.6 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing F is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From -0 plf at -2.12 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 4.24  
BC: From 0 plf at -2.12 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 4.24  
TC: -38 lb Conc. Load at 1.48  
BC: 40 lb Conc. Load at 1.48

#### Wind

Wind loads and reactions based on MWFRS.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2'-5-2.



FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 608577<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ05 | Cust: R 215 JRef: 1X3d2150006 T28<br>DrwNo: 062.21.0910.27363<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

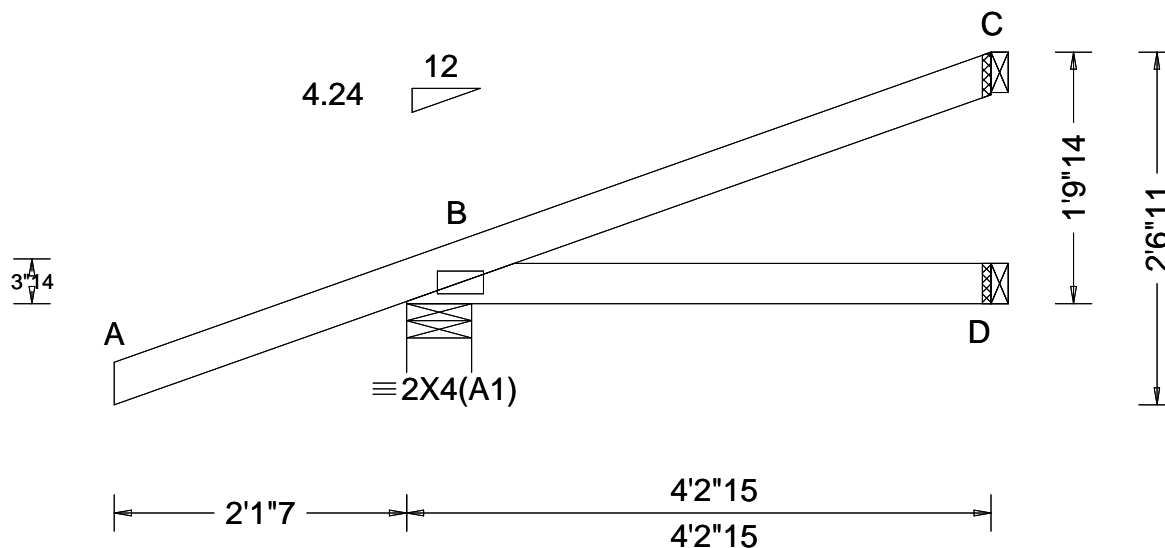

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): -0.003 D - -<br>HORZ(TL): 0.003 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.146<br>Max BC CSI: 0.148<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh<br>Non-Gravity<br>/ Rw / U / RL<br>B 204 /- /- /- /115 /-<br>D 69 /-6 /- /- /13 /-<br>C 40 /-11 /- /- /20 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 5.7 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 0 plf at -2.12 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 4.24  
BC: From 0 plf at -2.12 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 4.24  
TC: -41 lb Conc. Load at 1.48  
BC: 8 lb Conc. Load at 1.48

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1'-9-14.

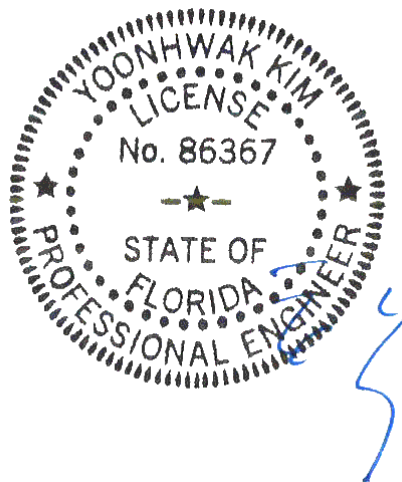

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 339557<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ06 | Cust: R 215 JRef: 1X3d2150006 T21<br>DrwNo: 062.21.0910.28563<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

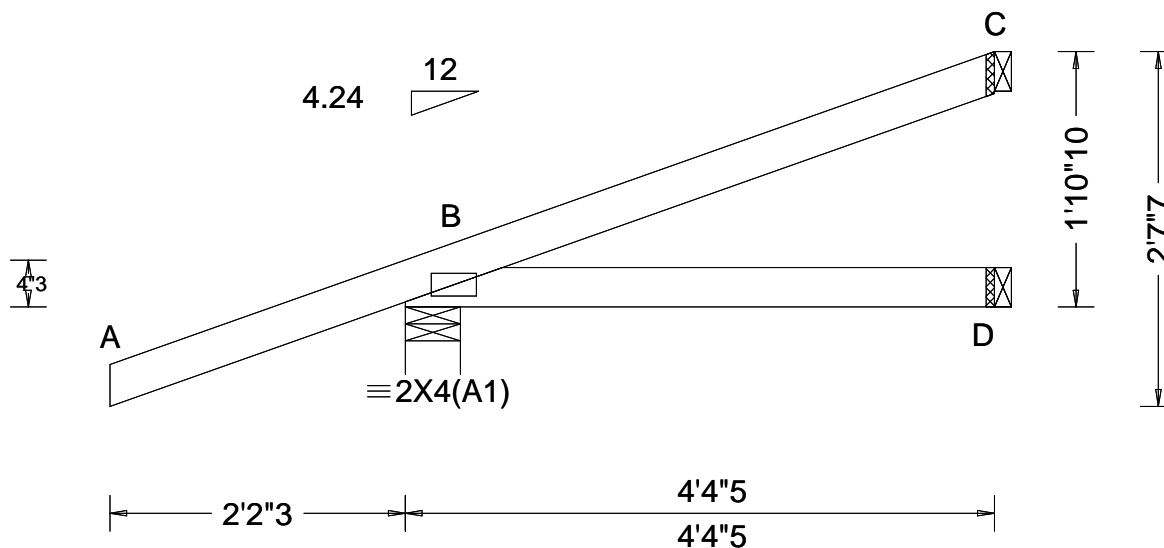

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|---|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): -0.003 D - -<br>HORZ(TL): 0.003 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.131<br>Max BC CSI: 0.144<br>Max Web CSI: 0.000<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh<br>Non-Gravity<br>/ Rw / U / RL<br>B 210 /- /- /- /120 /-<br>D 71 /-5 /- /- /12 /-<br>C 48 /- /- /- /48 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.9 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 0 plf at -2.18 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 4.36  
BC: From 0 plf at -2.18 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 4.36  
TC: -41 lb Conc. Load at 1.41  
TC: 60 lb Conc. Load at 4.31  
BC: 8 lb Conc. Load at 1.41

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1-10-10.

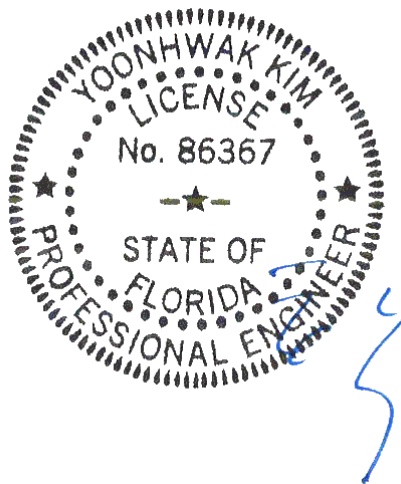

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 608560<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ07 | Cust: R 215 JRef: 1X3d2150006 T14<br>DrwNo: 062.21.0910.29717<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

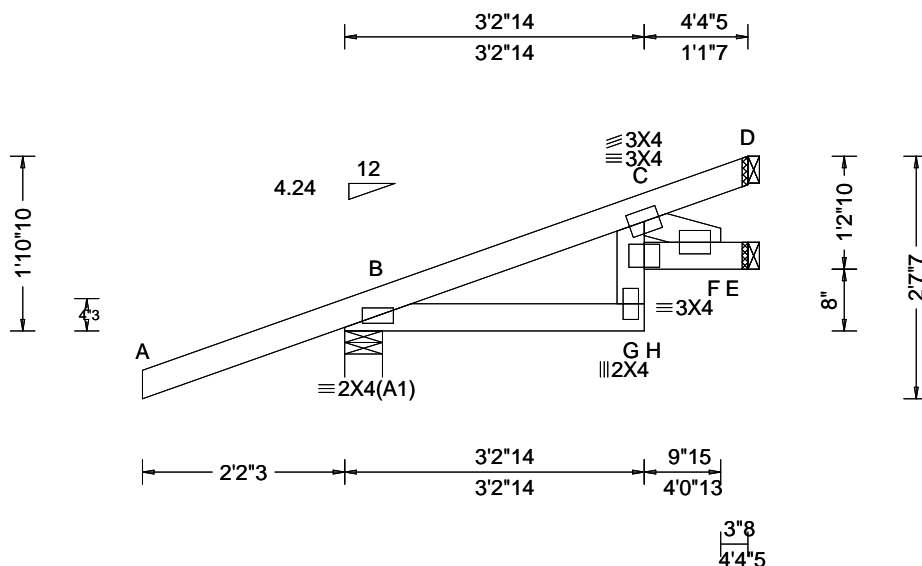

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|---|---|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): -0.004 G 999 480<br>VERT(CL): 0.007 G 999 360<br>HORZ(LL): -0.002 F - -<br>HORZ(TL): 0.004 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.155<br>Max BC CSI: 0.076<br>Max Web CSI: 0.175<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 210 /- /- /- /120 /-<br>E 88 /-24 /0 /- /39 /0<br>D 79 /- /- /- /12 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.9 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 0 plf at -2.18 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 4.36  
BC: From 0 plf at -2.18 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 4.36  
TC: -41 lb Conc. Load at 1.41  
TC: 72 lb Conc. Load at 4.31  
BC: 8 lb Conc. Load at 1.41

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1'-10"-10.

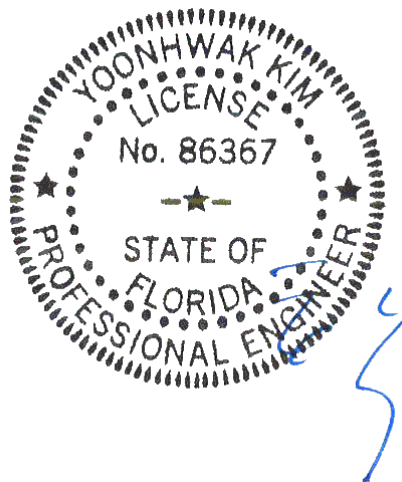

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 608485<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ08 | Cust: R 215 JRef: 1X3d2150006 T45<br>DrwNo: 062.21.0910.30907<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

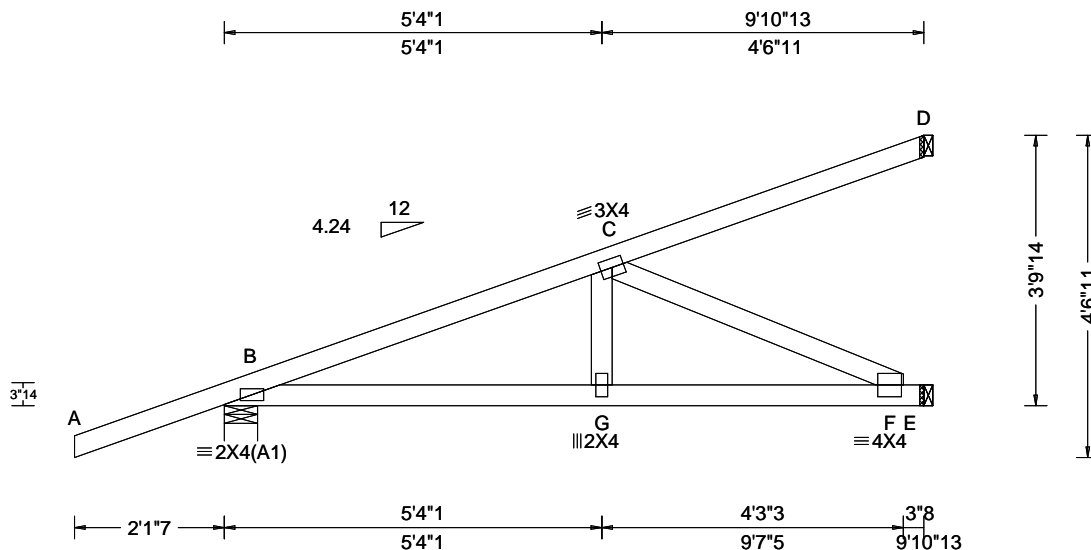

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.020 G 999 480<br>VERT(CL): 0.039 G 999 360<br>HORZ(LL): 0.004 F - -<br>HORZ(TL): 0.009 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.559<br>Max BC CSI: 0.662<br>Max Web CSI: 0.266<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 368 -/- /- /195 -/<br>E 294 -/- /- /77 -/<br>D 77 -/- /- /25 -/<br>Wind reactions based on MWFRS<br>B Brg Width = 5.7 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


|   |  |
|---|--|
| TC: From 0 plf at -2.12 to 61 plf at 0.00 |  |
| TC: From 2 plf at 0.00 to 2 plf at 9.90   |  |
| BC: From 0 plf at -2.12 to 4 plf at 0.00  |  |
| BC: From 2 plf at 0.00 to 2 plf at 9.90   |  |
| TC: -41 lb Conc. Load at 1.48             |  |
| TC: 120 lb Conc. Load at 4.31             |  |
| TC: 255 lb Conc. Load at 7.13             |  |
| BC: 8 lb Conc. Load at 1.48               |  |
| BC: 179 lb Conc. Load at 7.13             |  |

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-9-14.

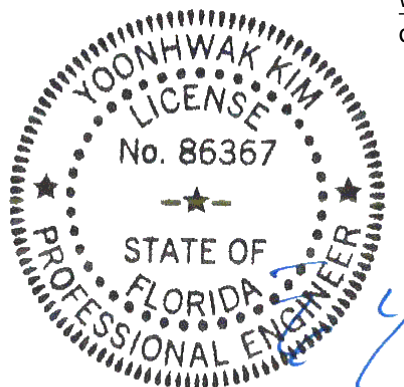


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 608455<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ09 | Cust: R 215 JRef: 1X3d2150006 T25<br>DrwNo: 062.21.0910.32250<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

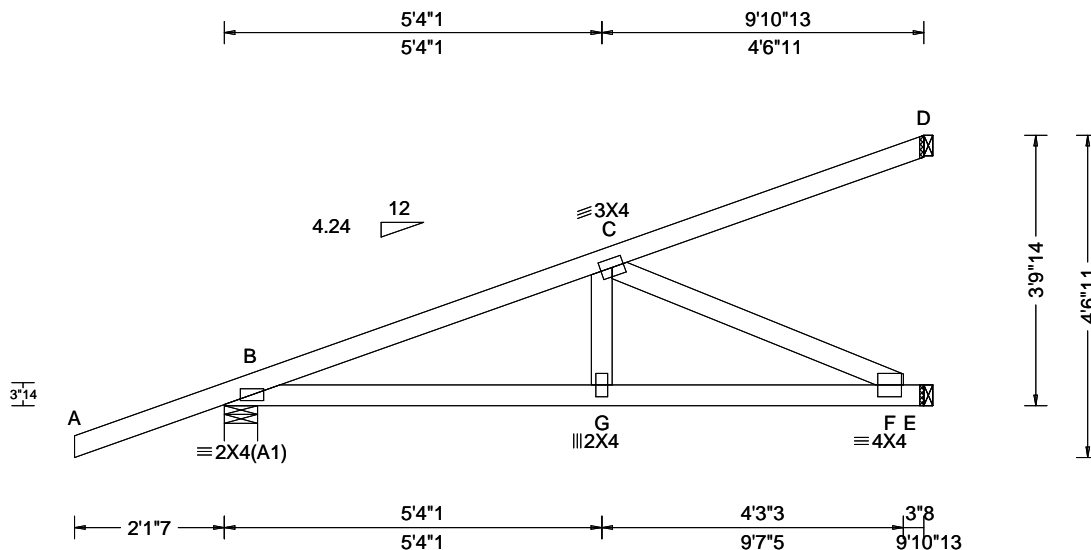

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.021 G 999 480<br>VERT(CL): 0.041 G 999 360<br>HORZ(LL): 0.005 F - -<br>HORZ(TL): 0.009 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.557<br>Max BC CSI: 0.655<br>Max Web CSI: 0.295<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 368 -/- /- /192 -/<br>E 316 -/- /- /75 -/<br>D 76 -/- /- /25 -/<br>Wind reactions based on MWFRS<br>B Brg Width = 5.7 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp.<br>B - C 238 -634<br><b>Maximum Bot Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - G 602 -200 G - F 592 -200<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp.<br>C - F 221 -654 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


TC: From 0 plf at -2.12 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 9.90  
BC: From 0 plf at -2.12 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 9.90  
TC: -41 lb Conc. Load at 1.48  
TC: 122 lb Conc. Load at 4.31  
TC: 255 lb Conc. Load at 7.13  
BC: 8 lb Conc. Load at 1.48  
BC: 49 lb Conc. Load at 4.31  
BC: 179 lb Conc. Load at 7.13

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-9-14.

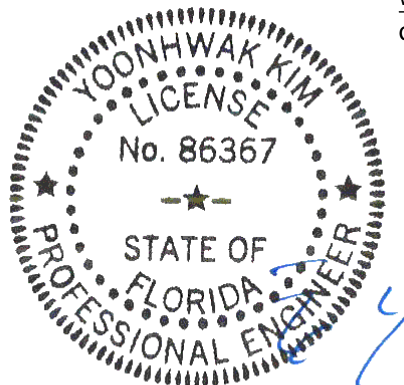

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 614327<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ10 | Cust: R 215 JRef: 1X3d2150006 T32<br>DrwNo: 062.21.0910.33870<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

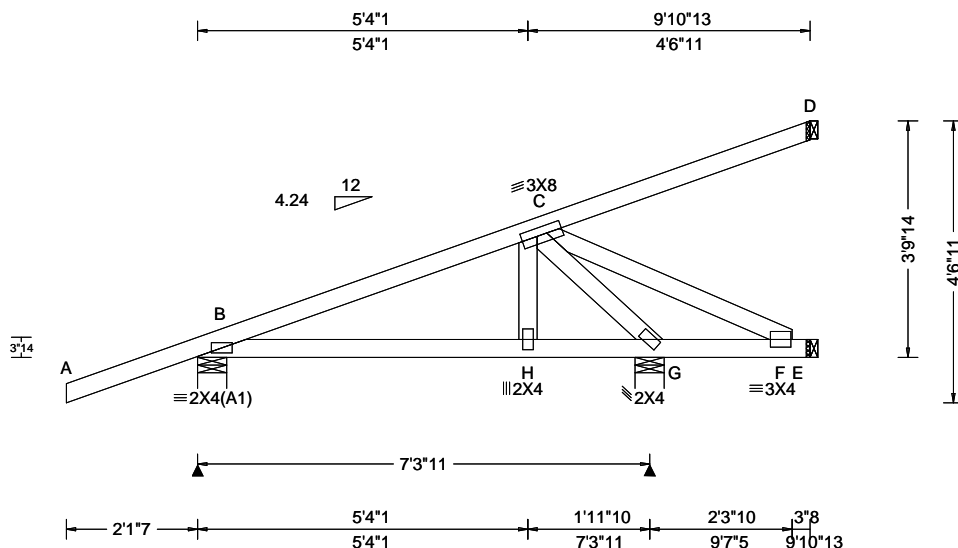

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): -0.008 H 999 480<br>VERT(CL): 0.012 H 999 360<br>HORZ(LL): -0.003 H - -<br>HORZ(TL): 0.004 H - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.466<br>Max BC CSI: 0.214<br>Max Web CSI: 0.090<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 284 /- /- /- /164 /-<br>G 414 /- /- /- /114 /-<br>E 26 /-20 /- /1 /- /-<br>D 65 /- /- /- /23 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 5.7 Min Req = 1.5<br>G Brg Width = 5.7 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearings B & G are a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Web Forces Per Ply (lbs)<br>Webs Tens.Comp.<br>C - G 189 -394 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From -0 plf at -2.12 to 61 plf at 0.00  
TC: From 2 plf at 0.00 to 2 plf at 9.90  
BC: From 0 plf at -2.12 to 4 plf at 0.00  
BC: From 2 plf at 0.00 to 2 plf at 9.90  
TC: -41 lb Conc. Load at 1.48  
TC: 122 lb Conc. Load at 4.31  
TC: 246 lb Conc. Load at 7.13  
BC: 8 lb Conc. Load at 1.48  
BC: 49 lb Conc. Load at 4.31  
BC: 123 lb Conc. Load at 7.13

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-9-14.

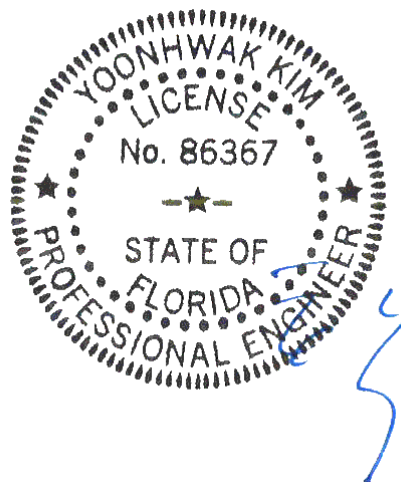

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                       |   |  |
|---------------------------|-----------------------|---|--|
| SEQN: 614329<br>FROM: CDM | HIP_ Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: HJ11 | Cust: R 215 JRef: 1X3d2150006 T59<br>DrwNo: 062.21.0910.35580<br>/ YK 03/03/2021 |
|---------------------------|-----------------------|---|--|

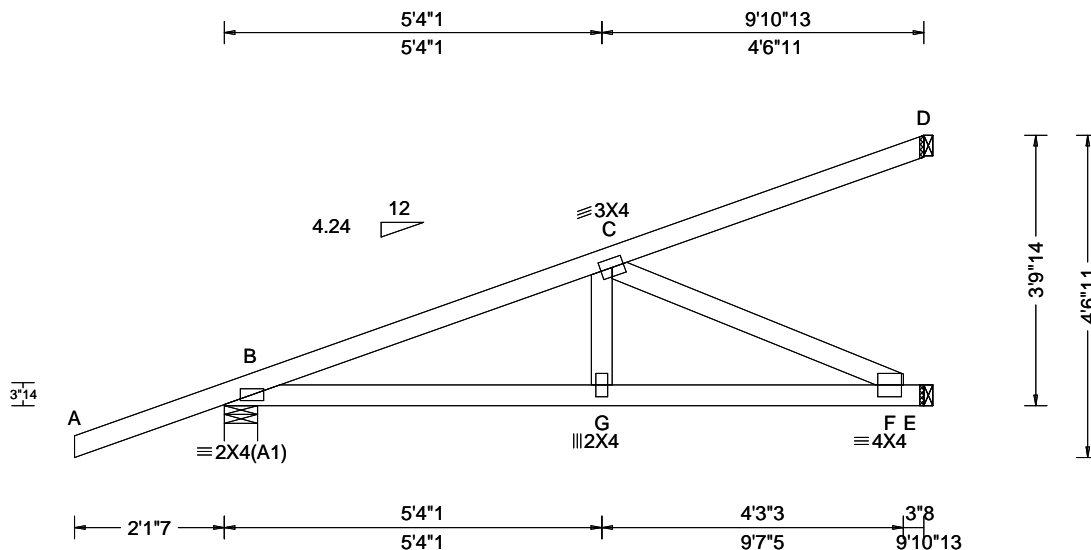

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): 0.022 G 999 480<br>VERT(CL): 0.044 G 999 360<br>HORZ(LL): 0.005 F - -<br>HORZ(TL): 0.010 F - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.554<br>Max BC CSI: 0.649<br>Max Web CSI: 0.324<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 368 -/- /- /189 -/<br>E 338 -/- /- /73 -/<br>D 76 -/- /- /25 -/<br>Wind reactions based on MWFRS<br>B Brg Width = 5.7 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Top Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp.<br>B - C 232 -699<br><b>Maximum Bot Chord Forces Per Ply (lbs)</b><br>Chords Tens.Comp. Chords Tens. Comp.<br>B - G 663 -194 G - F 651 -195<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp.<br>C - F 215 -719 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)


|   |   |
|---|---|
| TC: From 0 plf at -2.12 to 61 plf at 0.00 | TC: From 2 plf at 0.00 to 2 plf at 9.90 |
| BC: From 0 plf at -2.12 to 4 plf at 0.00  | BC: From 2 plf at 0.00 to 2 plf at 9.90 |
| TC: -41 lb Conc. Load at 1.48             | TC: 124 lb Conc. Load at 4.31           |
| TC: 255 lb Conc. Load at 7.13             | BC: 8 lb Conc. Load at 1.48             |
| BC: 98 lb Conc. Load at 4.31              | BC: 179 lb Conc. Load at 7.13           |

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-9-14.

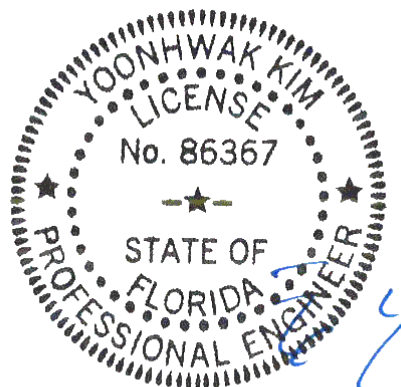

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339476<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 4 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J01 | Cust: R 215 JRef: 1X3d2150006 T77<br>DrwNo: 062.21.0910.37530<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

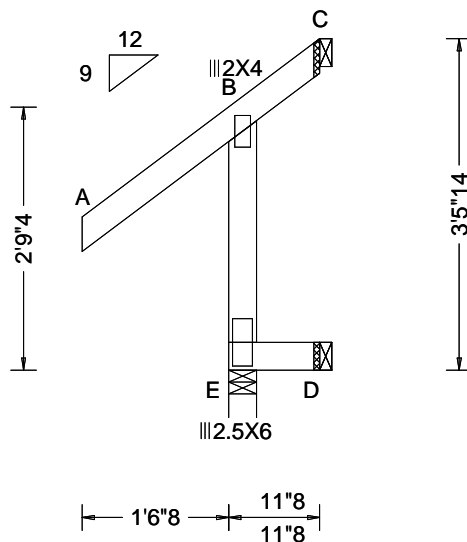

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.001 B 999 480<br>VERT(CL): 0.001 B 999 360<br>HORZ(LL): 0.001 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.289<br>Max BC CSI: 0.009<br>Max Web CSI: 0.148<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 235 /- /- /243 /90 /-<br>D 19 /- /- /10 /- /-<br>C - /-56 /- /67 /107 /54<br>Wind reactions based on MWFRS<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp. |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3'-5-14.

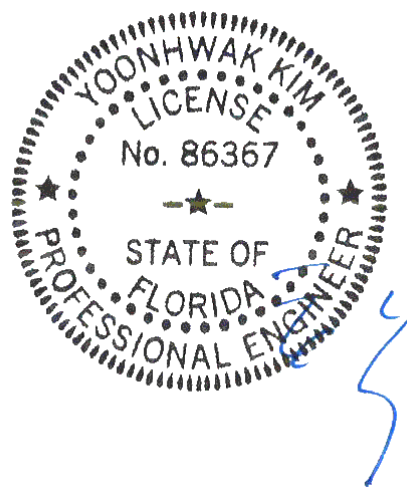


FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339478<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 4 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J02 | Cust: R 215 JRef: 1X3d2150006 T90<br>DrwNo: 062.21.0910.39373<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

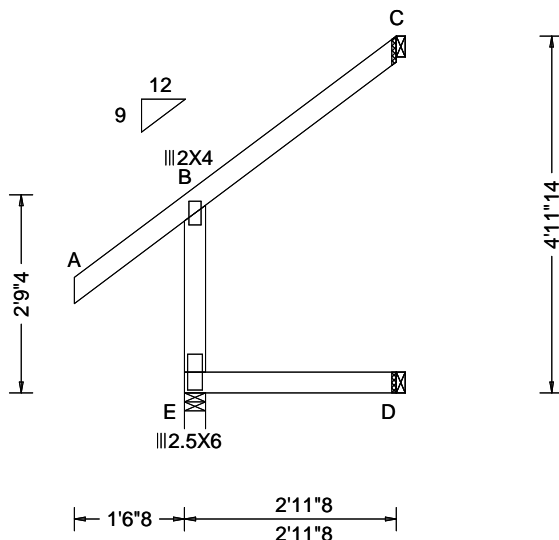

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 B 999 480<br>VERT(CL): 0.001 B 999 360<br>HORZ(LL): 0.001 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.248<br>Max BC CSI: 0.096<br>Max Web CSI: 0.117<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 262 -/- /- /252 /99 -/<br>D 59 -/- /- /30 -/- /-<br>C 68 -/- /- /70 /33 /105<br>Wind reactions based on MWFRS<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp. |

B - E 391 -232

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 4'-11-14".

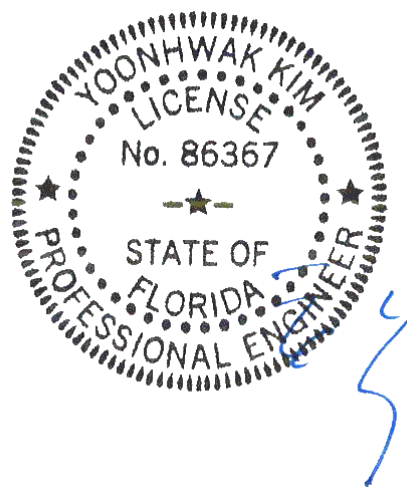

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339487<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J03 | Cust: R 215 JRef: 1X3d2150006 T98<br>DrwNo: 062.21.0910.41227<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

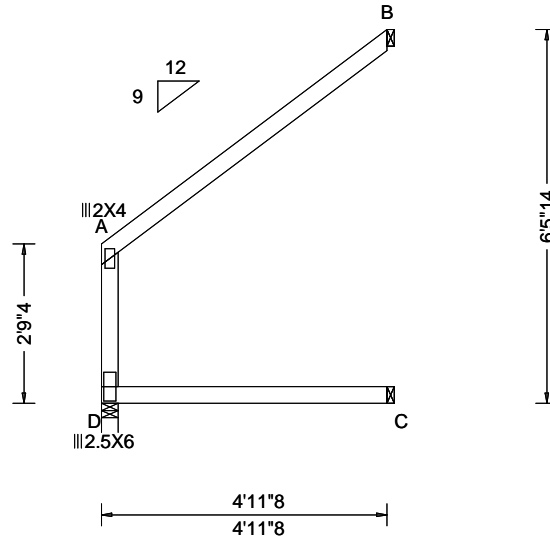

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|--|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 A 999 480<br>VERT(CL): 0.001 A 999 360<br>HORZ(LL): -0.001 A - -<br>HORZ(TL): 0.001 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.587<br>Max BC CSI: 0.293<br>Max Web CSI: 0.070<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>D 211 /- /- /172 /72 /-<br>C 99 /- /- /50 /- /-<br>B 161 /- /- /80 /8 /125<br>Wind reactions based on MWFRS<br>D Brg Width = 3.5 Min Req = 1.5<br>C Brg Width = 1.5 Min Req = -<br>B Brg Width = 1.5 Min Req = -<br>Bearing D is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6'-5-14.

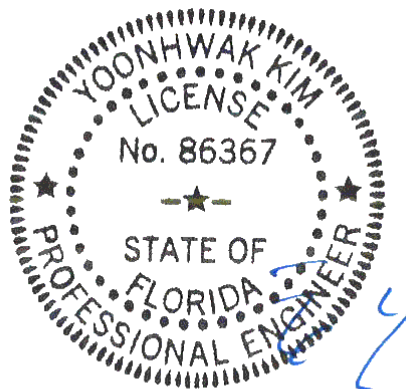

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |   |   |
|---------------------------|--------------------------|---|---|
| SEQN: 339485<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 5 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J03A | Cust: R 215 JRef: 1X3d2150006 T100<br>DrwNo: 062.21.0910.43090<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|---|---|

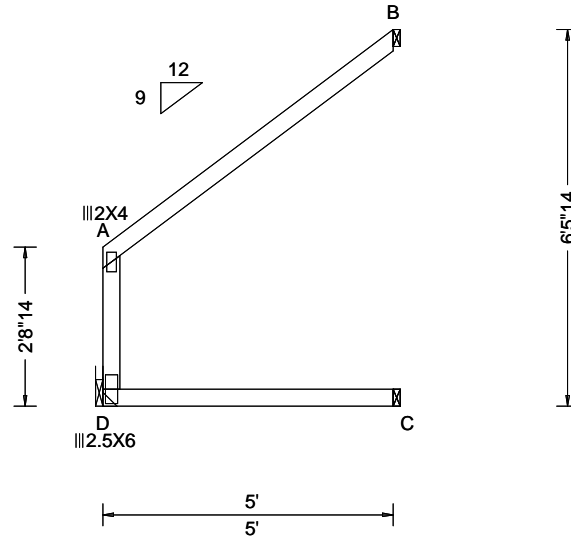

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 A 999 480<br>VERT(CL): 0.001 A 999 360<br>HORZ(LL): -0.001 A - -<br>HORZ(TL): 0.001 A - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.598<br>Max BC CSI: 0.298<br>Max Web CSI: 0.071<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>D 212 /- /- /174 /72 /-<br>C 100 /- /- /50 /- /-<br>B 162 /- /- /81 /8 /126<br>Wind reactions based on MWFRS<br>D Brg Width = - Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>B Brg Width = 1.5 Min Req = -<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties


(J) Hanger Support Required, by others

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 6'-5-14".

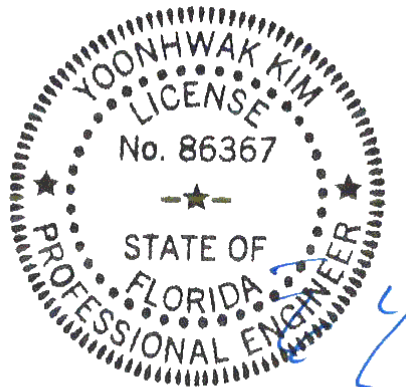

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339480<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 6 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J05 | Cust: R 215 JRRef: 1X3d2150006 T96<br>DrwNo: 062.21.0910.44957<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

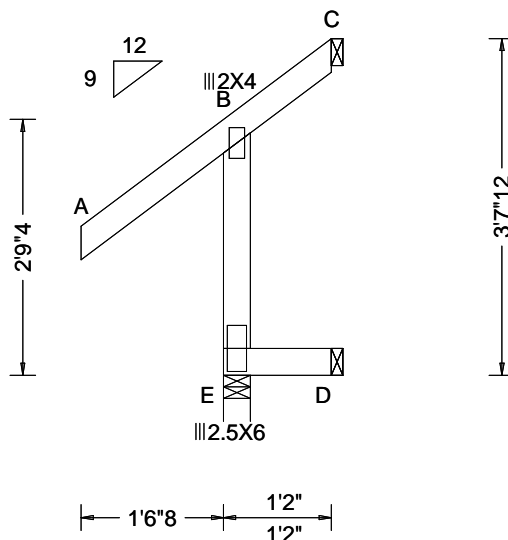

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.001 B 999 480<br>VERT(CL): 0.001 B 999 360<br>HORZ(LL): 0.001 B - -<br>HORZ(TL): 0.001 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.223<br>Max BC CSI: 0.013<br>Max Web CSI: 0.112<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 229 -/- /- /234 /87 -/<br>D 23 -/- /- /12 -/- /-<br>C - /-33 -/- /62 /88 /60<br>Wind reactions based on MWFRS<br>E Brg Width = 3.5 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375#<br><b>Maximum Web Forces Per Ply (lbs)</b><br>Webs Tens.Comp.<br>B - E 375 -223 |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-7-12.

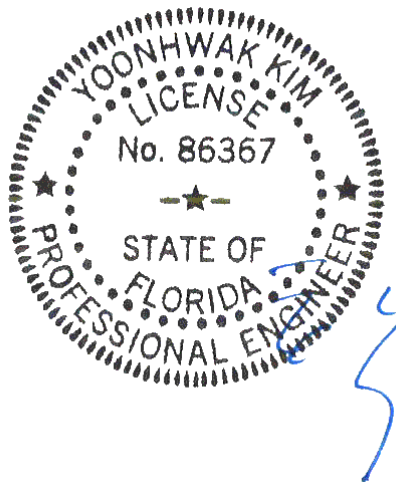

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339561<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 4 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J06 | Cust: R 215 JRef: 1X3d2150006 T51<br>DrwNo: 062.21.0910.46463<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

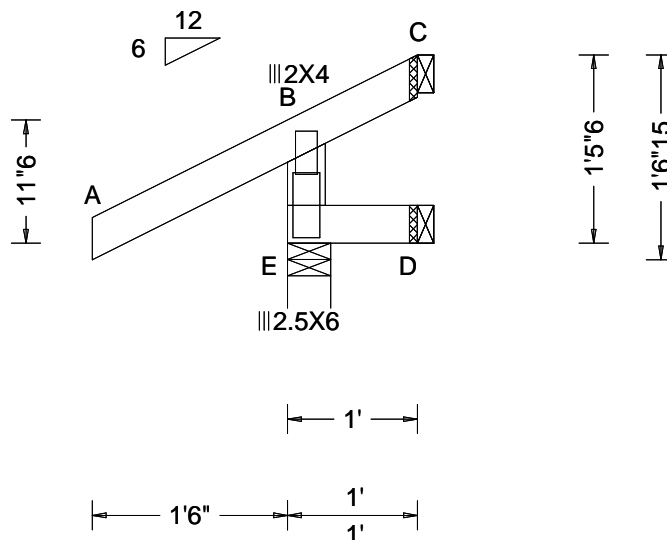

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 B 999 480<br>VERT(CL): 0.000 B 999 360<br>HORZ(LL): 0.000 B - -<br>HORZ(TL): 0.000 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.174<br>Max BC CSI: 0.010<br>Max Web CSI: 0.096<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 217 /- /- /184 /72 /-<br>D 20 /- /- /10 /- /-<br>C - /-44 /- /47 /60 /32<br>Wind reactions based on MWFRS<br>E Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1'-5-6".

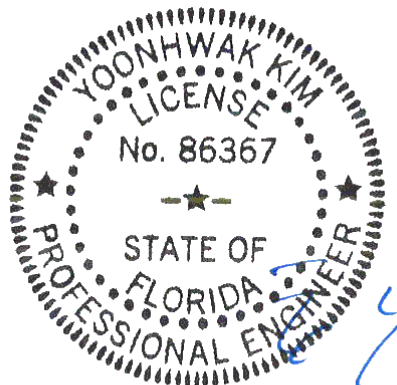

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339545<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 5 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J07 | Cust: R 215 JRef: 1X3d2150006 T55<br>DrwNo: 062.21.0910.48040<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

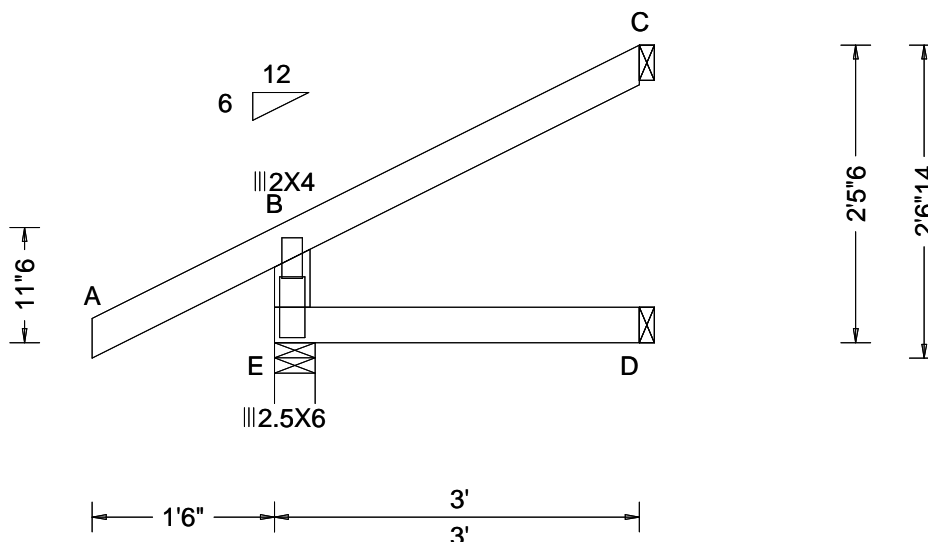

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.42 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.000 B 999 480<br>VERT(CL): 0.000 B 999 360<br>HORZ(LL): 0.000 B - -<br>HORZ(TL): 0.000 B - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.177<br>Max BC CSI: 0.098<br>Max Web CSI: 0.089<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>E 249 -/- /- /199 /50 -/<br>D 60 -/- /- /30 -/- /-<br>C 69 -/- /- /37 /12 /51<br>Wind reactions based on MWFRS<br>E Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing E is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Left end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2'-5-6".

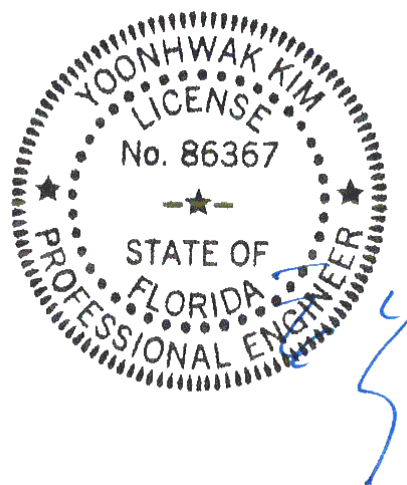

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                           |  |   |
|---------------------------|---------------------------|--|---|
| SEQN: 339563<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 16 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J08 | Cust: R 215 JRef: 1X3d2150006 T8<br>DrwNo: 062.21.0910.49500<br>/ YK 03/03/2021 |
|---------------------------|---------------------------|--|---|

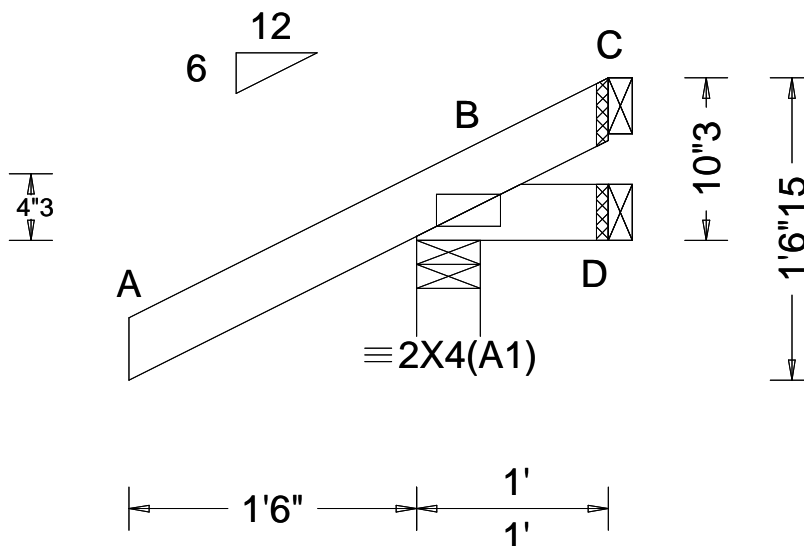

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)   |
|---|---|---|--|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: Any<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): -0.000 D - -<br>HORZ(TL): 0.001 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.240<br>Max BC CSI: 0.034<br>Max Web CSI: 0.000<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 254 /- /- /198 /65 /37<br>D 4 /-18 /- /15 /15 /-<br>C - /-53 /- /33 /50 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 0-10-3.

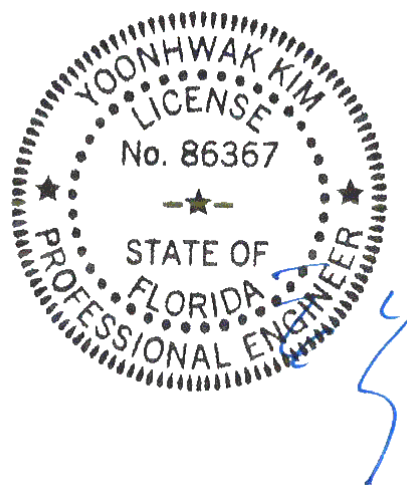

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608509<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 6 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J09 | Cust: R 215 JRef: 1X3d2150006 T19<br>DrwNo: 062.21.0910.50813<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

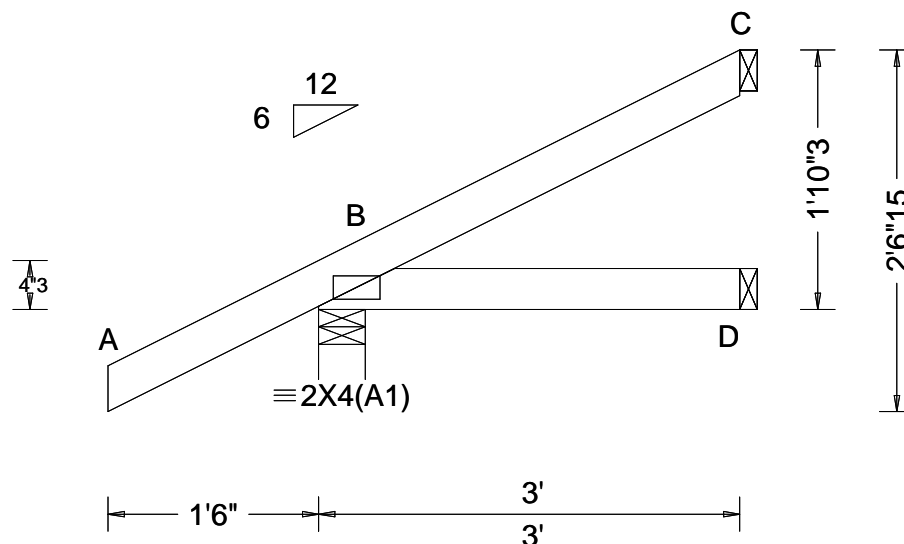

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.001 D - -<br>HORZ(TL): 0.001 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.196<br>Max BC CSI: 0.072<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 262 /- /- /187 /38 /71<br>D 49 /- /- /26 /- /-<br>C 62 /- /- /35 /33 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1-10-3.

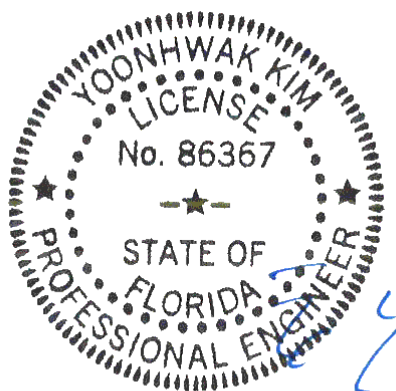

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.


For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608571<br>FROM: CDM | EJAC<br>Ply: 2<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J10 | Cust: R 215 JRef: 1X3d2150006 T15<br>DrwNo: 062.21.0910.52180<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

2 Complete Trusses Required

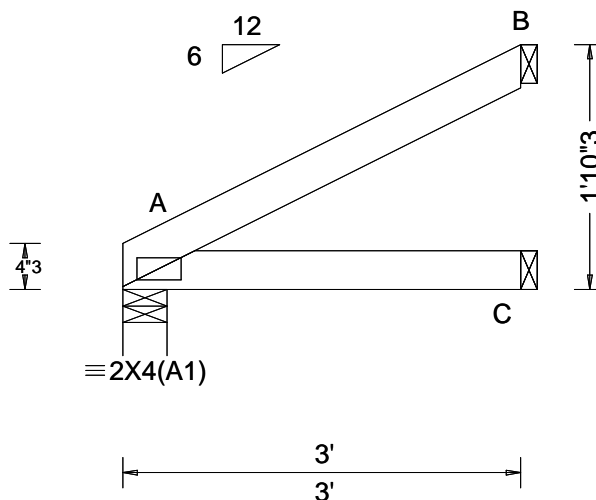

| Loading Criteria (psf)   | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)   | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|--|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: No<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.001 C - -<br>HORZ(TL): 0.002 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.086<br>Max BC CSI: 0.152<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 175 -/- /- /28 -/<br>C 160 -/- /- /8 -/<br>B 90 -/- /- /30 -/<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>C Brg Width = 1.5 Min Req = -<br>B Brg Width = 1.5 Min Req = -<br>Bearing A is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @12.00" o.c.  
Bot Chord: 1 Row @12.00" o.c.  
Webs : 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails  
in each row to avoid splitting.

#### Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 62 plf at 0.00 to 62 plf at 3.00  
BC: From 20 plf at 0.00 to 20 plf at 3.00  
BC: 178 lb Conc. Load at 2.27

#### Wind

Wind loads and reactions based on MWFRS.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1'-10-3/4".



FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339551<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 4 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J11 | Cust: R 215 JRef: 1X3d2150006 T1<br>DrwNo: 062.21.0910.53413<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

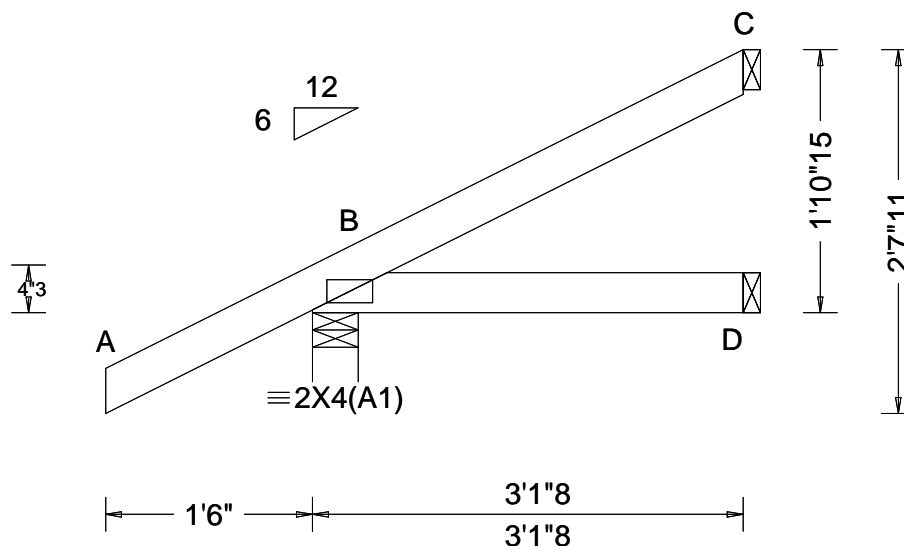

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.001 D - -<br>HORZ(TL): 0.001 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.159<br>Max BC CSI: 0.071<br>Max Web CSI: 0.000<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 265 /- /- /189 /38 /73<br>D 52 /- /- /28 /- /-<br>C 67 /- /- /38 /35 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1-10-15.

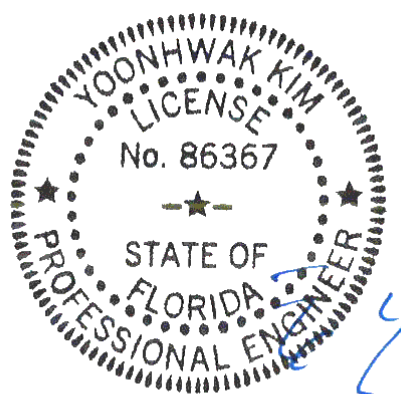

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |   |
|---------------------------|--------------------------|--|---|
| SEQN: 339553<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 7 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J12 | Cust: R 215 JRRef: 1X3d2150006 T20<br>DrwNo: 062.21.0910.54670<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|---|

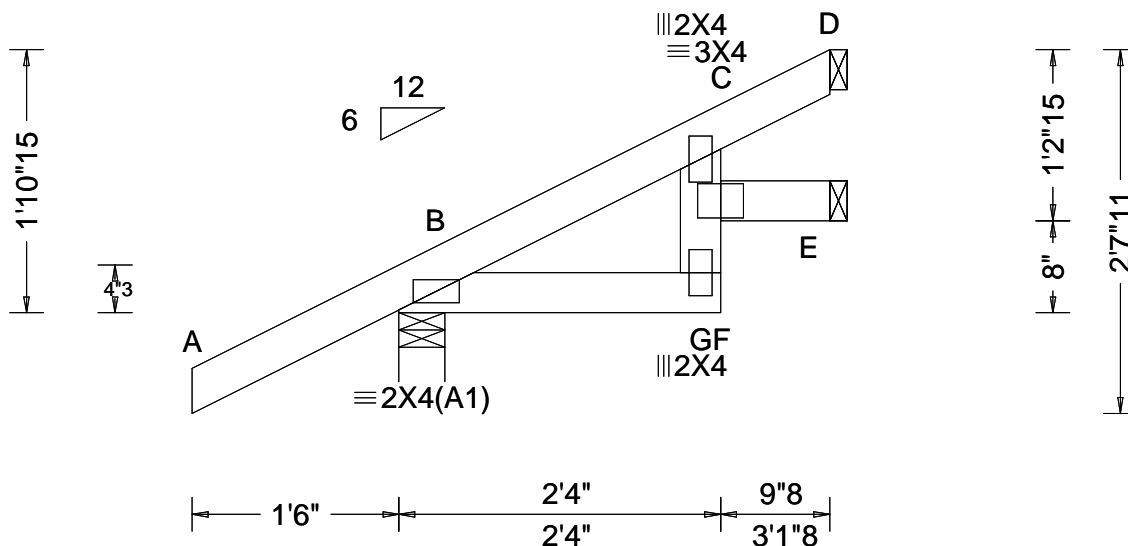

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.004 F 999 480<br>VERT(CL): 0.007 F 999 360<br>HORZ(LL): 0.002 C - -<br>HORZ(TL): 0.004 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.159<br>Max BC CSI: 0.037<br>Max Web CSI: 0.031<br>VIEW Ver: 20.02.01A.1209.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>B 265 - / - /189 /38 /73<br>E 23 - / - /13 - /-<br>D 77 - / - /49 /26 -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>E Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1'-10-15.

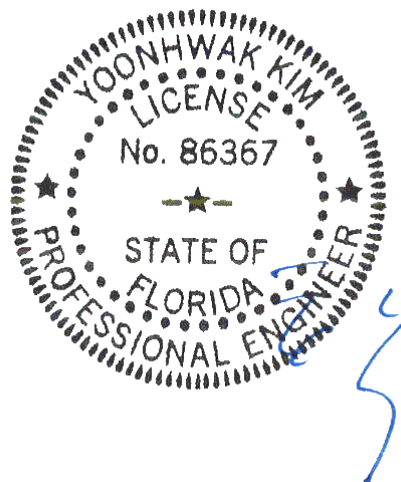

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 339559<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 6 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J14 | Cust: R 215 JRef: 1X3d2150006 T46<br>DrwNo: 062.21.0910.57213<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

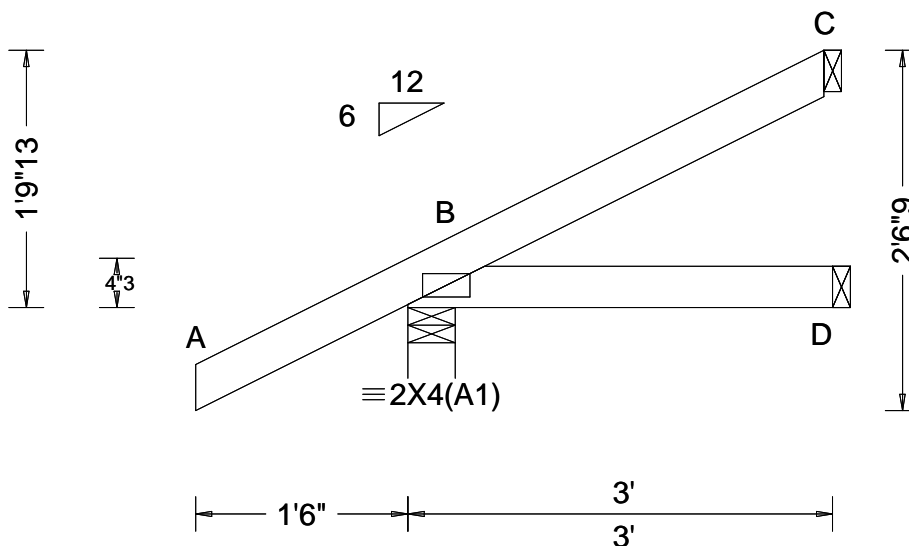

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.001 D - -<br>HORZ(TL): 0.001 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.159<br>Max BC CSI: 0.063<br>Max Web CSI: 0.000<br>VIEW Ver: 20.02.01A.1209.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 260 - / - /187 /38 /70<br>C 60 - / - /34 /32 -<br>D 49 - / - /26 - / -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>C Brg Width = 1.5 Min Req = -<br>D Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1-9-13.

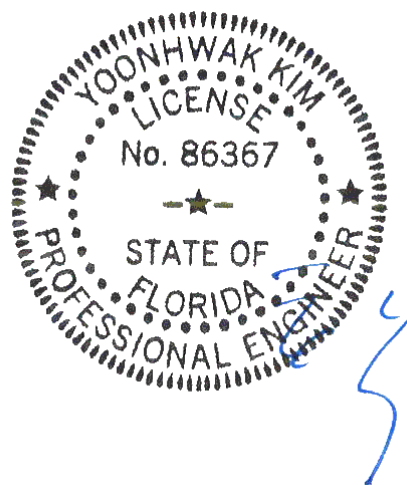

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608449<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 7 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J15 | Cust: R 215 JRef: 1X3d2150006 T36<br>DrwNo: 062.21.0910.58597<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

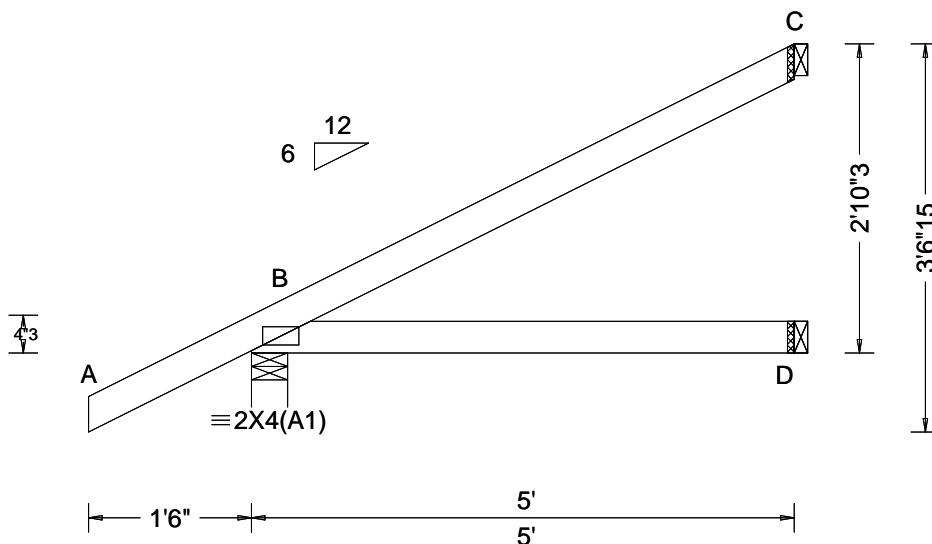

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.004 D - -<br>HORZ(TL): 0.008 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.310<br>Max BC CSI: 0.247<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 331 - / - / - / 228 / 39 / 105<br>D 89 - / - / - / 48 / - / -<br>C 127 - / - / - / 78 / 62 / -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2-10-3.

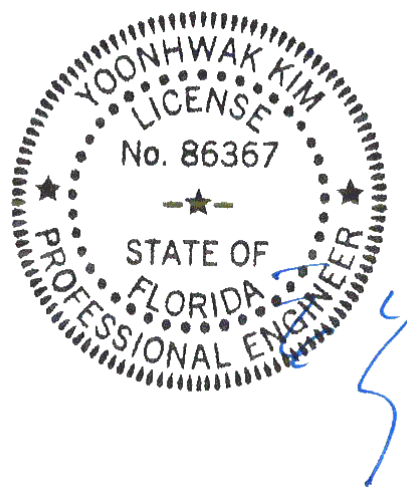

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                           |  |  |
|---------------------------|---------------------------|--|--|
| SEQN: 608453<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 23 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J16 | Cust: R 215 JRef: 1X3d2150006 T37<br>DrwNo: 062.21.0911.00060<br>/ YK 03/03/2021 |
|---------------------------|---------------------------|--|--|

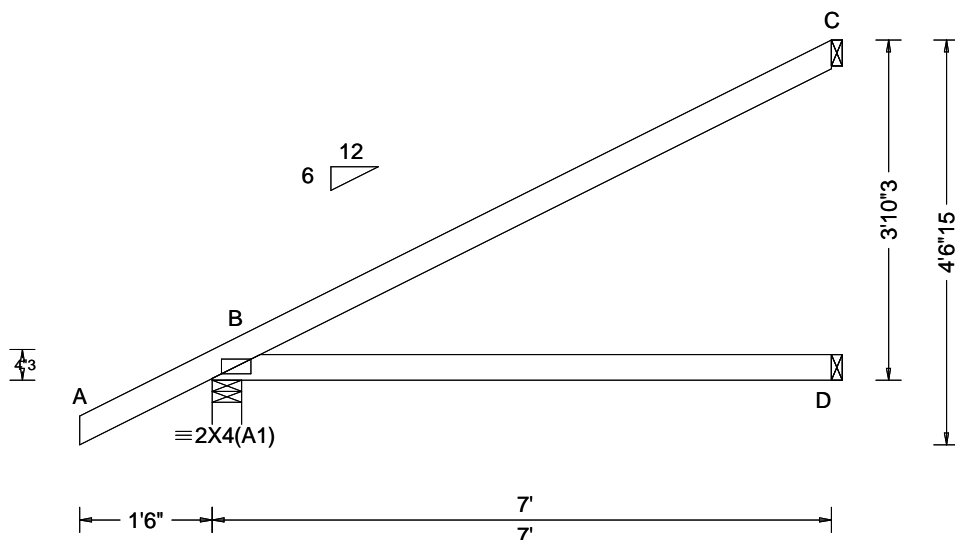

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp1: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.014 D - -<br>HORZ(TL): 0.028 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.713<br>Max BC CSI: 0.512<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 408 - / - / - /275 /42 /139<br>D 129 - / - / - /72 - / -<br>C 187 - / - / - /116 /89 -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-10-3.

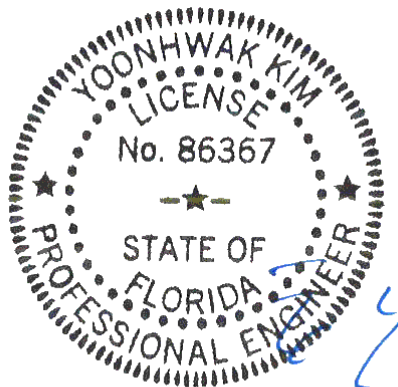

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608473<br>FROM: CDM | EJAC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J17 | Cust: R 215 JRef: 1X3d2150006 T38<br>DrwNo: 062.21.0911.01410<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

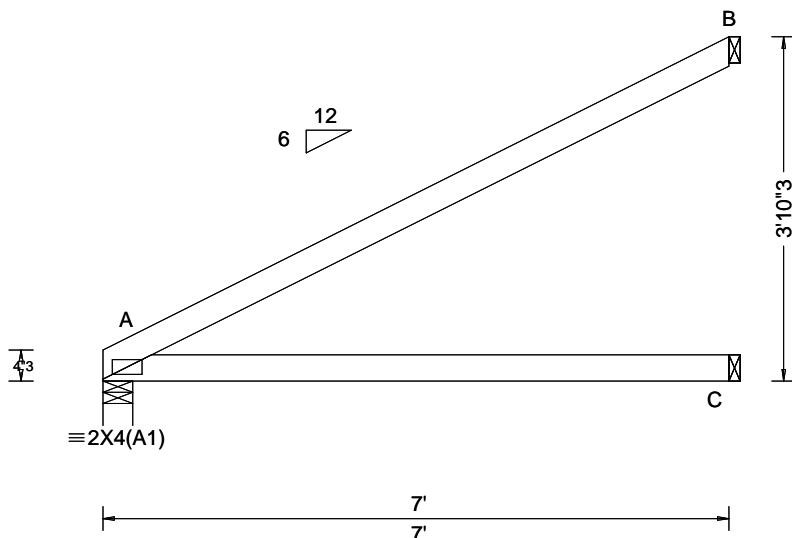

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|--|---|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h/2 to h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.016 C - -<br>HORZ(TL): 0.034 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.766<br>Max BC CSI: 0.532<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 294 -/- /- /184 /13 /118<br>C 131 -/- /- /78 -/- /-<br>B 194 -/- /- /122 /91 -/-<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>C Brg Width = 1.5 Min Req = -<br>B Brg Width = 1.5 Min Req = -<br>Bearing A is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-10-3.

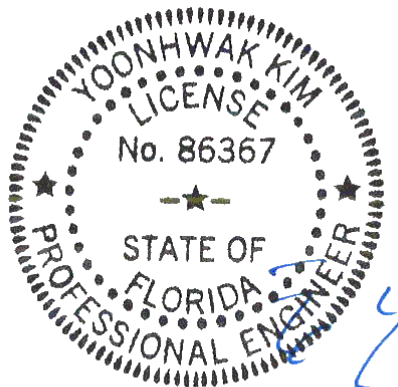

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

2 Complete Trusses Required

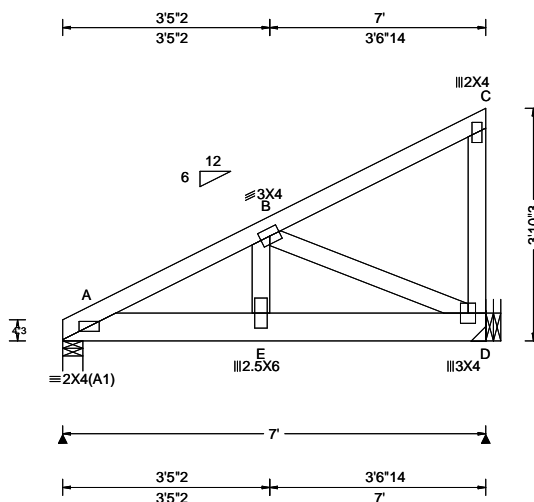

| Loading Criteria (psf)   | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)   | Defl/CSI Criteria  | ▲ Maximum Reactions (lbs)  |
|--|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 0.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: No<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.010 E 999 480<br>VERT(CL): 0.020 E 999 360<br>HORZ(LL): -0.003 C - -<br>HORZ(TL): 0.006 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.150<br>Max BC CSI: 0.241<br>Max Web CSI: 0.281<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 1702 -/- /- /282 -/<br>D 828 -/- /- /140 -/<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = - Min Req = -<br>Bearing A is a rigid surface.<br>Members not listed have forces less than 375#<br>Maximum Top Chord Forces Per Ply (lbs)<br>Chords Tens.Comp.<br>A - B 162 -947 |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 5.25" o.c.  
Webs : 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails  
in each row to avoid splitting.

#### Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)  
TC: From 62 plf at 0.00 to 62 plf at 7.00  
BC: From 10 plf at 0.00 to 10 plf at 2.56  
BC: From 20 plf at 2.56 to 20 plf at 7.00  
BC: 506 lb Conc. Load at 0.56  
BC: 1472 lb Conc. Load at 2.56

#### Wind

Wind loads and reactions based on MWFRS.  
Right end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-10-3.

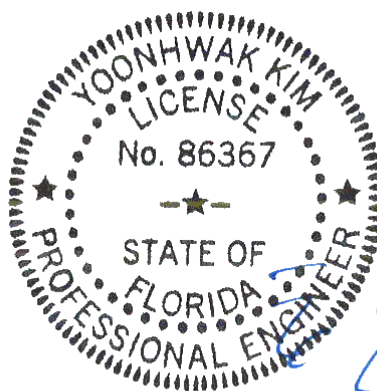

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 351661 | EJAC | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T87 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0911.34137          |
| Page 2 of 2  |      |        | Truss Label: J18    | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.


Bearing at location x=6'9" uses the following support conditions: 6'9"

Bearing D (6'9", 9'1"2) LUS26-2

Supporting Member: (2)2x6 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

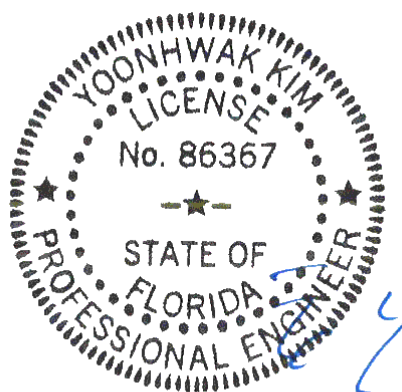

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608444<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J19 | Cust: R 215 JRef: 1X3d2150006 T43<br>DrwNo: 062.21.0911.36140<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

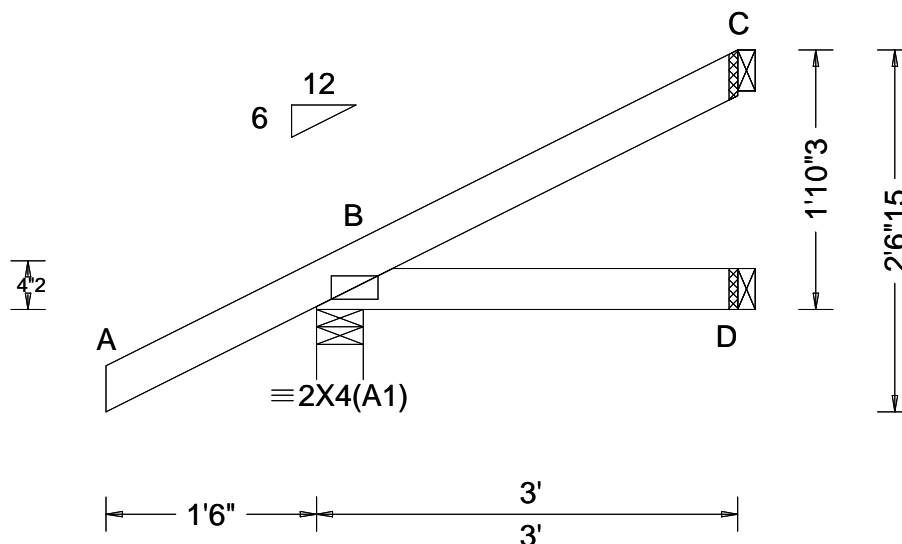

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|--|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.001 D - -<br>HORZ(TL): 0.001 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.195<br>Max BC CSI: 0.072<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 261 /- /- /187 /38 /71<br>D 49 /- /- /26 /- /-<br>C 62 /- /- /35 /33 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 1-10-3.

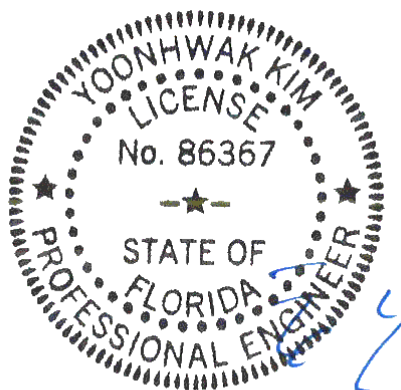

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608446<br>FROM: CDM | JACK<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J20 | Cust: R 215 JRef: 1X3d2150006 T42<br>DrwNo: 062.21.0911.37817<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

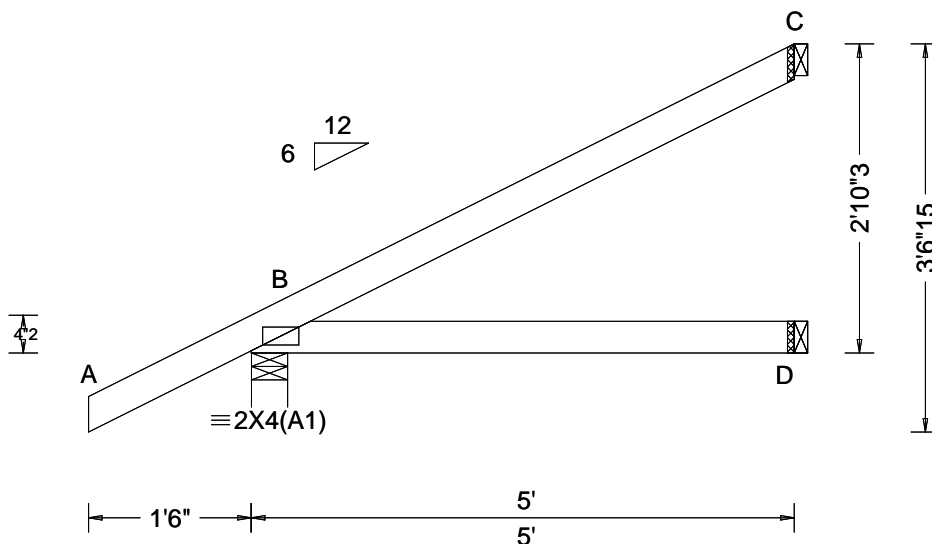

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg,Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)  |
|---|---|---|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 4.50 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT:20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.004 D - -<br>HORZ(TL): 0.008 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.310<br>Max BC CSI: 0.248<br>Max Web CSI: 0.000<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 331 /- /- /228 /39 /105<br>D 89 /- /- /48 /- /-<br>C 127 /- /- /78 /62 /-<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = 1.5 Min Req = -<br>C Brg Width = 1.5 Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber


Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 2-10-3.

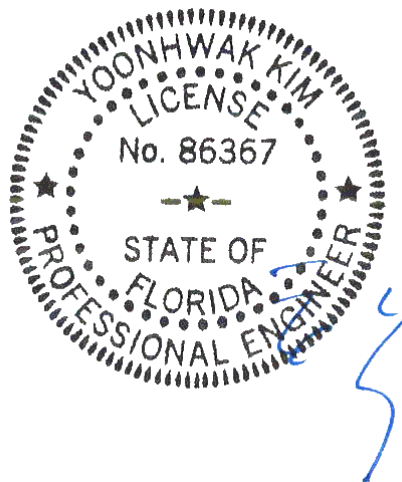

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### \*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING! \*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821



|                           |                          |  |  |
|---------------------------|--------------------------|--|--|
| SEQN: 608442<br>FROM: CDM | MONO<br>Ply: 1<br>Qty: 2 | Job Number: 20-4962<br>Jones Res<br>Truss Label: J21 | Cust: R 215 JRef: 1X3d2150006 T60<br>DrwNo: 062.21.0911.39443<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|--|--|

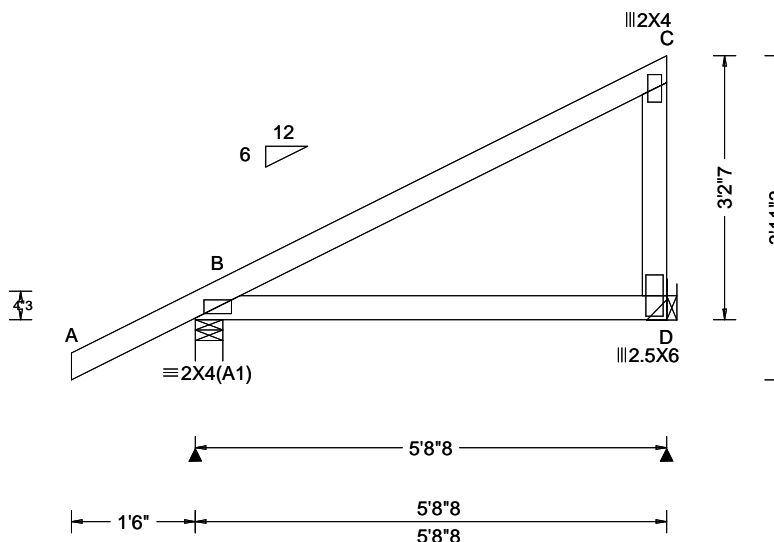

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs)   |
|---|---|--|---|---|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.006 D - -<br>HORZ(TL): 0.012 D - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.395<br>Max BC CSI: 0.305<br>Max Web CSI: 0.168<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>B 358 - / - /244 /8 /84<br>D 213 - / - /149 /27 -<br>Wind reactions based on MWFRS<br>B Brg Width = 4.0 Min Req = 1.5<br>D Brg Width = - Min Req = -<br>Bearing B is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=5'5"8" uses the following support conditions: 5'5"8"

Bearing D (5'5"8", 9'1"2) LUS26

Supporting Member: (1)2x6 SP 2400f-2.0E

(4) 0.148"x3" nails into supporting

member,

(3) 0.148"x3" nails into supported

member.

#### Additional Notes

The overall height of this truss excluding overhang is 3-2-7.


#### Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical not exposed to wind pressure.

Wind loading based on both gable and hip roof types.

Uplifts based on an elevation at or above 1000 ft.

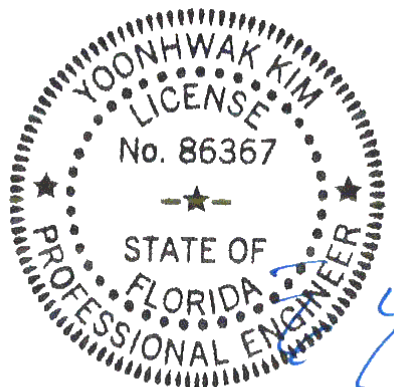

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

2 Complete Trusses Required

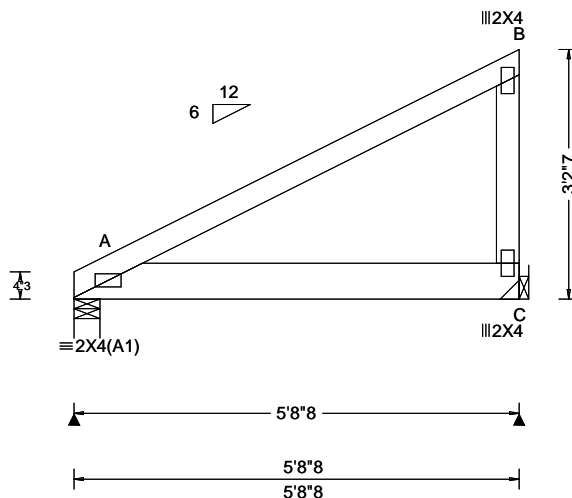

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria  | Maximum Reactions (lbs)  |
|---|--|--|--|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 15.00 ft<br>TCDL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: 0 to h/2<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/def L/#<br>VERT(LL): NA<br>VERT(CL): NA<br>HORZ(LL): 0.013 C - -<br>HORZ(TL): 0.027 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.427<br>Max BC CSI: 0.510<br>Max Web CSI: 0.130<br>VIEW Ver: 20.01.01A.0724.11 | Gravity Non-Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>A 1289 -/- /- /- /209 -/<br>C 1158 -/- /- /- /188 -/<br>Wind reactions based on MWFRS<br>A Brg Width = 4.0 Min Req = 1.5<br>C Brg Width = - Min Req = -<br>Bearing A is a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x6 SP 2400f-2.0E;  
Webs: 2x4 SP #3;

#### Nailnote

Nail Schedule: 0.128"x3", min. nails  
Top Chord: 1 Row @ 12.00" o.c.  
Bot Chord: 1 Row @ 3.75" o.c.  
Webs: 1 Row @ 4" o.c.  
Use equal spacing between rows and stagger nails  
in each row to avoid splitting.

#### Special Loads


----- (Lumber Dur. Fac. = 1.25 / Plate Dur. Fac. = 1.25)  
TC: From 31 plf at 0.00 to 31 plf at 5.71  
BC: From 10 plf at 0.00 to 10 plf at 5.71  
BC: 1106 lb Conc. Load at 1.77, 3.77

#### Wind

Wind loads and reactions based on MWFRS.  
Right end vertical not exposed to wind pressure.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

The overall height of this truss excluding overhang is 3-2-7.

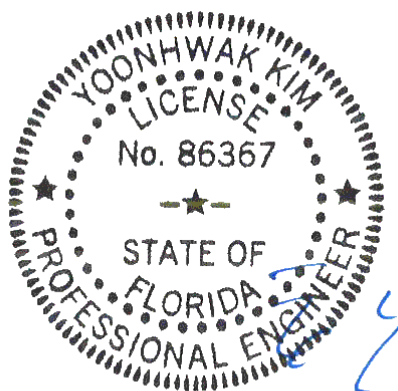

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|              |      |        |                     |                                   |
|--------------|------|--------|---------------------|-----------------------------------|
| SEQN: 608846 | MONO | Ply: 2 | Job Number: 20-4962 | Cust: R 215 JRef: 1X3d2150006 T27 |
| FROM: CDM    |      | Qty: 1 | Jones Res           | DrwNo: 062.21.0911.43980          |
| Page 2 of 2  |      |        | Truss Label: J22    | / YK 03/03/2021                   |

#### Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.


Bearing at location x=5'5"8 uses the following support conditions: 5'5"8

Bearing C (5'5"8, 9'1"2) LUS26-2

Supporting Member: (1)2x6 SP 2400f-2.0E

(4) 0.162"x3.5" nails into supporting member,

(4) 0.162"x3.5" nails into supported member.

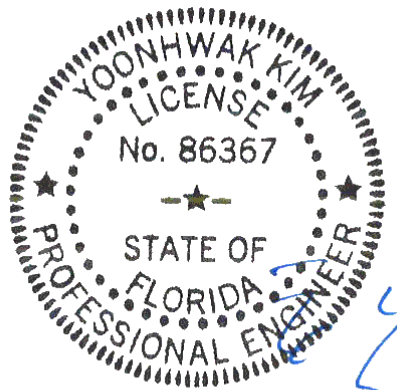

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

#### **\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!** **\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |   |  |
|---------------------------|--------------------------|---|--|
| SEQN: 608986<br>FROM: CDM | GABL<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: PB01 | Cust: R 215 JRef: 1X3d2150006 T91<br>DrwNo: 062.21.0911.47100<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|---|--|

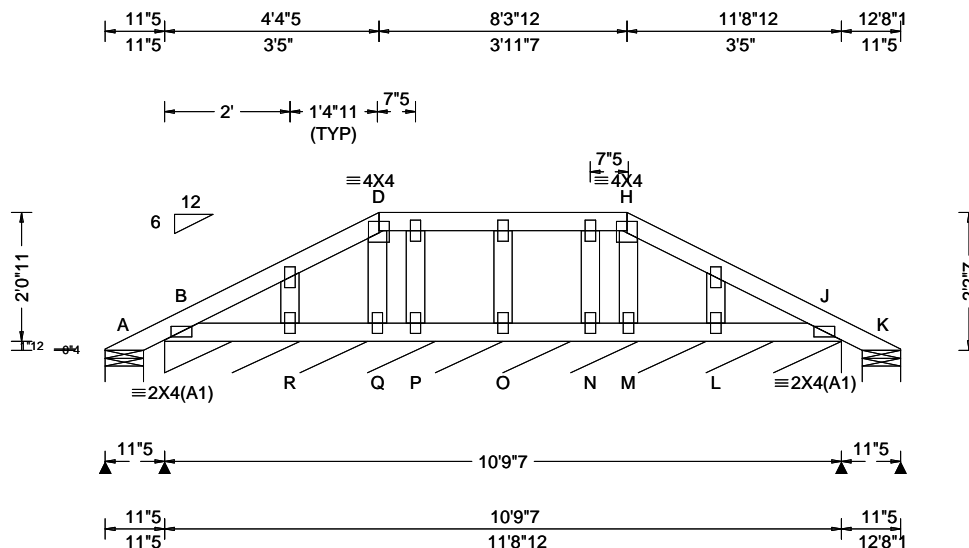

| Loading Criteria (psf)  | Wind Criteria  | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs), or *PLF  |
|---|--|--|---|---|
| TCLL: 20.00<br>TCCL: 10.00<br>BCCL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 18.24 ft<br>TCCL: 5.0 psf<br>BCDL: 5.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCp: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Varies by Ld Case<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.001 R 999 480<br>VERT(CL): 0.001 R 999 360<br>HORZ(LL): 0.001 L - -<br>HORZ(TL): 0.001 L - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.083<br>Max BC CSI: 0.043<br>Max Web CSI: 0.049<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>A 39 /- /- /58 /42 /106<br>B* 180 /- /- /73 /55 /-<br>K 39 /- /- /23 /14 /-<br>B /-105<br>R /-202<br>P /-120<br>O /-172<br>N /-119<br>L /-166<br>Wind reactions based on MWFRS<br>A Brg Width = 7.3 Min Req = 1.5<br>B Brg Width = 129 Min Req = -<br>K Brg Width = 7.3 Min Req = 1.5<br>Bearings A, B, & K are a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Plating Notes

All plates are 2X4 except as noted.

#### Loading

Truss designed to support 2-0-0 top chord outlookers and cladding load not to exceed 2.30 PSF one face and 24.0" span opposite face. Top chord must not be cut or notched, unless specified otherwise.

#### Wind

Wind loads based on MWFRS with additional C&C member design.


Wind loading based on both gable and hip roof types.

#### Additional Notes

See DWGS A14030ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Refer to DWG PB160160118 for piggyback details.

The overall height of this truss excluding overhang is 11-2-7.

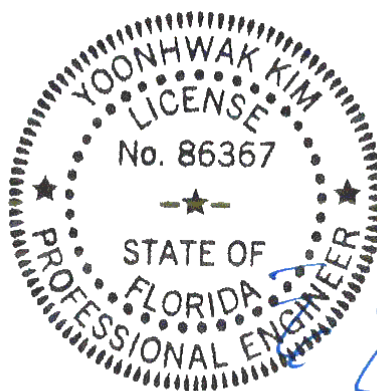

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING!**  
**\*\*IMPORTANT\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBCA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

|                           |                          |   |  |
|---------------------------|--------------------------|---|--|
| SEQN: 609144<br>FROM: CDM | SPEC<br>Ply: 1<br>Qty: 1 | Job Number: 20-4962<br>Jones Res<br>Truss Label: PB02 | Cust: R 215 JRef: 1X3d2150006 T70<br>DrwNo: 062.21.0911.50770<br>/ YK 03/03/2021 |
|---------------------------|--------------------------|---|--|

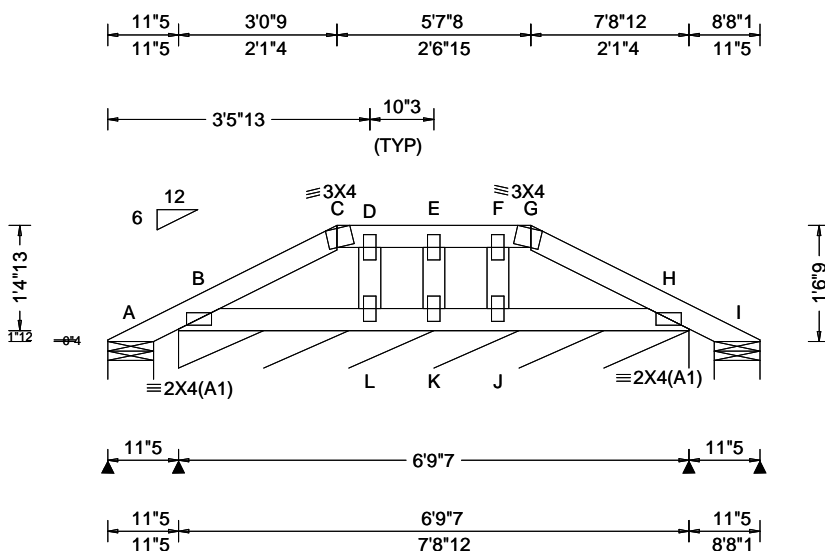

| Loading Criteria (psf)  | Wind Criteria   | Snow Criteria (Pg, Pf in PSF)  | Defl/CSI Criteria   | ▲ Maximum Reactions (lbs), or *=PLF  |
|---|---|--|---|--|
| TCLL: 20.00<br>TCDL: 10.00<br>BCLL: 0.00<br>BCDL: 10.00<br>Des Ld: 40.00<br>NCBCLL: 10.00<br>Soffit: 2.00<br>Load Duration: 1.25<br>Spacing: 24.0 " | Wind Std: ASCE 7-16<br>Speed: 130 mph<br>Enclosure: Closed<br>Risk Category: II<br>EXP: C Kzt: NA<br>Mean Height: 20.88 ft<br>TCDL: 5.0 psf<br>BCDL: 2.0 psf<br>MWFRS Parallel Dist: h to 2h<br>C&C Dist a: 3.00 ft<br>Loc. from endwall: not in 9.00 ft<br>GCpi: 0.18<br>Wind Duration: 1.60 | Pg: NA Ct: NA CAT: NA<br>Pf: NA Ce: NA<br>Lu: NA Cs: NA<br>Snow Duration: NA<br>Building Code:<br>FBC 7th Ed. 2020 Res.<br>TPI Std: 2014<br>Rep Fac: Yes<br>FT/RT: 20(0)/10(0)<br>Plate Type(s):<br>WAVE | PP Deflection in loc L/defl L/#<br>VERT(LL): 0.001 G 999 480<br>VERT(CL): 0.002 G 999 360<br>HORZ(LL): 0.000 J - -<br>HORZ(TL): 0.001 C - -<br>Creep Factor: 2.0<br>Max TC CSI: 0.042<br>Max BC CSI: 0.034<br>Max Web CSI: 0.033<br>VIEW Ver: 20.01.01A.0724.11 | Gravity<br>Loc R+ / R- / Rh / Rw / U / RL<br>Non-Gravity<br>A 9 /- /- /16 /16 /34<br>B* 76 /- /- /48 /17 /-<br>I 9 /- /- /2 /3 /-<br>Wind reactions based on MWFRS<br>A Brg Width = 7.3 Min Req = 1.5<br>B Brg Width = 81.4 Min Req = -<br>I Brg Width = 7.3 Min Req = 1.5<br>Bearings A, B, & I are a rigid surface.<br>Members not listed have forces less than 375# |

#### Lumber

Top chord: 2x4 SP #2;  
Bot chord: 2x4 SP #2;  
Webs: 2x4 SP #3;

#### Plating Notes


All plates are 2X4 except as noted.

#### Wind

Wind loads based on MWFRS with additional C&C member design.  
Wind loading based on both gable and hip roof types.  
Uplifts based on an elevation at or above 1000 ft.

#### Additional Notes

Refer to DWG PB160160118 for piggyback details.  
The overall height of this truss excluding overhang is 1'-6"-9".

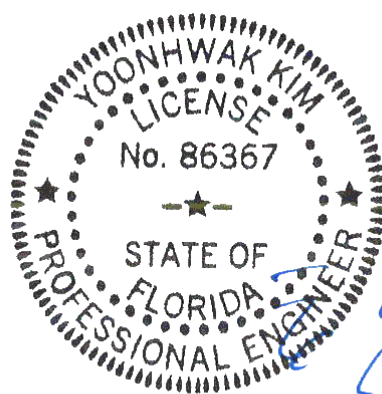

FL REG# 278, Yoonhwak Kim, FL PE #86367  
03/03/2021

**\*\*WARNING\*\*** READ AND FOLLOW ALL NOTES ON THIS DRAWING!  
**\*\*IMPORTANT\*\*** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: [alpineitw.com](http://alpineitw.com); TPI: [tpinst.org](http://tpinst.org); SBICA: [sbcindustry.com](http://sbcindustry.com); ICC: [iccsafe.org](http://iccsafe.org); AWC: [awc.org](http://awc.org)

**ALPINE**  
AN ITW COMPANY  
6750 Forum Drive  
Suite 305  
Orlando FL, 32821

# CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

## Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.


| Web Member Size | Specified CLR Restraint | Alternative Reinforcement T- or L- Reinf. | Scab Reinf. |
|-----------------|-------------------------|---|-------------|
| 2x3 or 2x4      | 1 row                   | 2x4                                       | 1-2x4       |
| 2x3 or 2x4      | 2 rows                  | 2x6                                       | 2-2x4       |
| 2x6             | 1 row                   | 2x4                                       | 1-2x6       |
| 2x6             | 2 rows                  | 2x6                                       | 2-2x4(X)    |
| 2x8             | 1 row                   | 2x6                                       | 1-2x8       |
| 2x8             | 2 rows                  | 2x6                                       | 2-2x6(X)    |

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

(X) Center scab on wide face of web. Apply (1) scab to each face of web.



## T-Reinforcement or L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

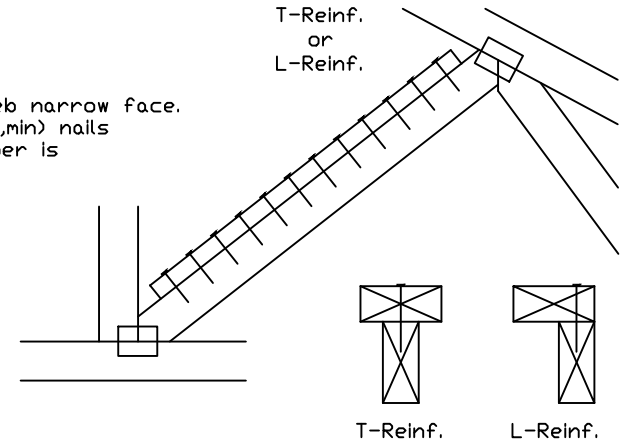

## Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

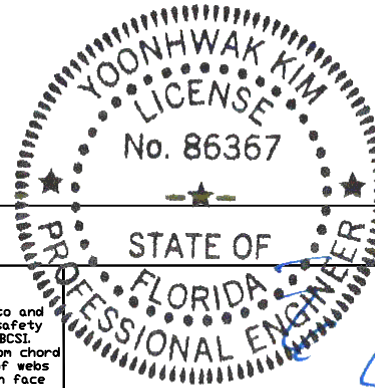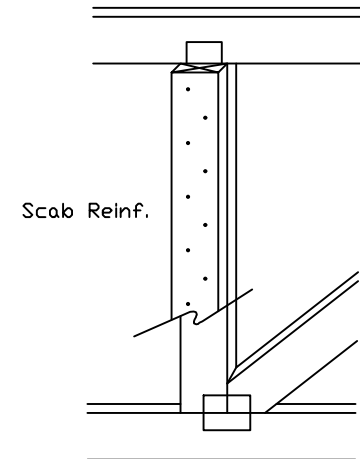

514 Earth City Expressway  
Suite 242  
Earth City, MO 63045

**WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING**  
**IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.  
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.  
A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.  
For more information see this job's general notes page and these web sites:  
ALPINE: [www.alpineitw.com](http://www.alpineitw.com) TPI: [www.tpinet.org](http://www.tpinet.org) SBCA: [www.sbcindustry.org](http://www.sbcindustry.org) ICC: [www.iccsafe.org](http://www.iccsafe.org)

|           |     |      |              |
|-----------|-----|------|--------------|
| TC LL     | PSF | REF  | CLR Subst.   |
| TC DL     | PSF | DATE | 01/02/19     |
| BC DL     | PSF | DRWG | BRCLBSUB0119 |
| BC LL     | PSF |      |              |
| TOT. LD.  | PSF |      |              |
| DUR. FAC. |     |      |              |
| SPACING   |     |      |              |

PE-RB-01-078, Yoonhwak Kim, FL PE #86367



# Piggyback Detail - ASCE 7-16: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.  
Or 140 mph wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp D, wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

\*\* Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

## Detail A : Purlin Spacing = 24" o.c. or less

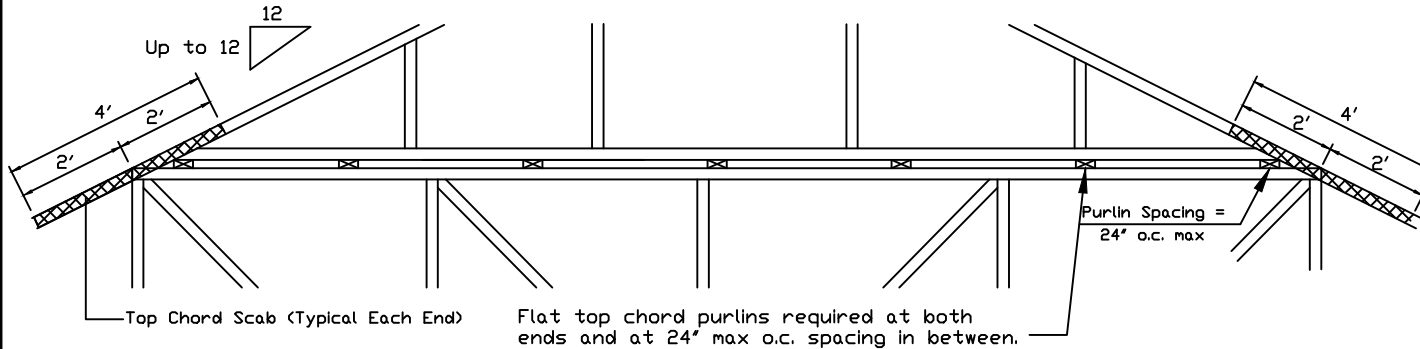


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (8) 0.120x1.375 inch nails, (4) into cap TC & (4) into base truss TC or (1) 28PB wave piggyback plate plated to the piggyback truss TC and attached to the base truss TC with (4) 0.120x1.375 inch nails. Note: Nailing thru holes of wave plate is acceptable.

## Detail B : Purlin Spacing > 24" o.c.

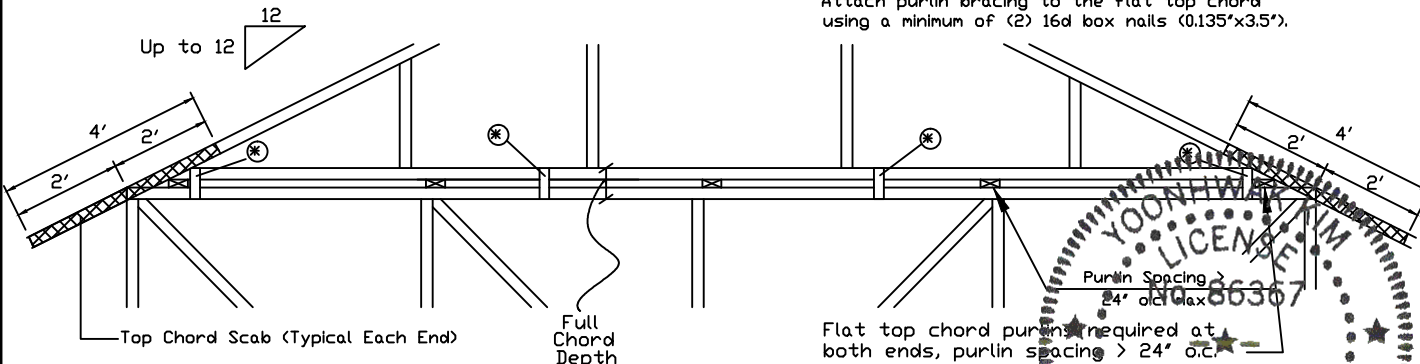

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

\* In addition, provide connection with one of the following methods:

|  |
|--|
| <b>Trulox</b><br>Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120x1.375 inch nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces. |
| <b>APA Rated Gusset</b><br>8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces.                                 |
| <b>2x4 Vertical Scabs</b><br>2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.  |
| <b>28PB Wave Piggyback Plate</b><br>One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120x1.375 inch nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.                 |

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24' o.c. max. and use Detail A.

**WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING! FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: 03/2021  
ALPINE: [www.alpineitw.com](http://www.alpineitw.com); TPI: [www.tpinet.org](http://www.tpinet.org); SBCA: [www.sbcindustry.org](http://www.sbcindustry.org); ICC: [www.iccsafe.org](http://www.iccsafe.org)



13723 Riverport Drive  
Suite 200  
Maryland Heights, MO 63043

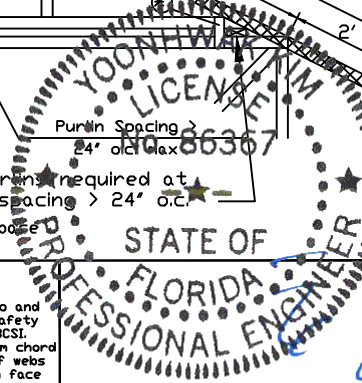

REF PIGGYBACK  
DATE 01/02/2018  
DRWG PB160160118

SPACING 24.0"

Yoonhwak Kim, FL PE #86367

# NAIL SPACING DETAIL

MINIMUM SPACING FOR SINGLE BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

BLOCK LOCATION, SIZE, LENGTH, GRADE AND TOTAL NUMBER AND TYPE OF NAILS ARE TO BE SPECIFIED ON SEALED DESIGN REFERENCING THIS DETAIL.

LOAD PERPENDICULAR TO GRAIN

A - EDGE DISTANCE AND SPACING BETWEEN STAGGERED ROWS OF NAILS (6 NAIL DIAMETERS)

B - SPACING OF NAILS IN A ROW (12 NAIL DIAMETERS)

C - END DISTANCE (15 NAIL DIAMETERS)

LOAD PARALLEL TO GRAIN

A - EDGE DISTANCE (6 NAIL DIAMETERS)


C - SPACING OF NAILS IN A ROW AND END DISTANCE (15 NAIL DIAMETERS)

D - SPACING BETWEEN STAGGERED ROWS OF NAILS (7 1/2 NAIL DIAMETERS)

IF NAIL HOLES ARE PREBORED, SOME SPACING MAY BE REDUCED BY THE AMOUNTS GIVEN BELOW:


\* SPACING MAY BE REDUCED BY 50%

\*\* SPACING MAY BE REDUCED BY 33%

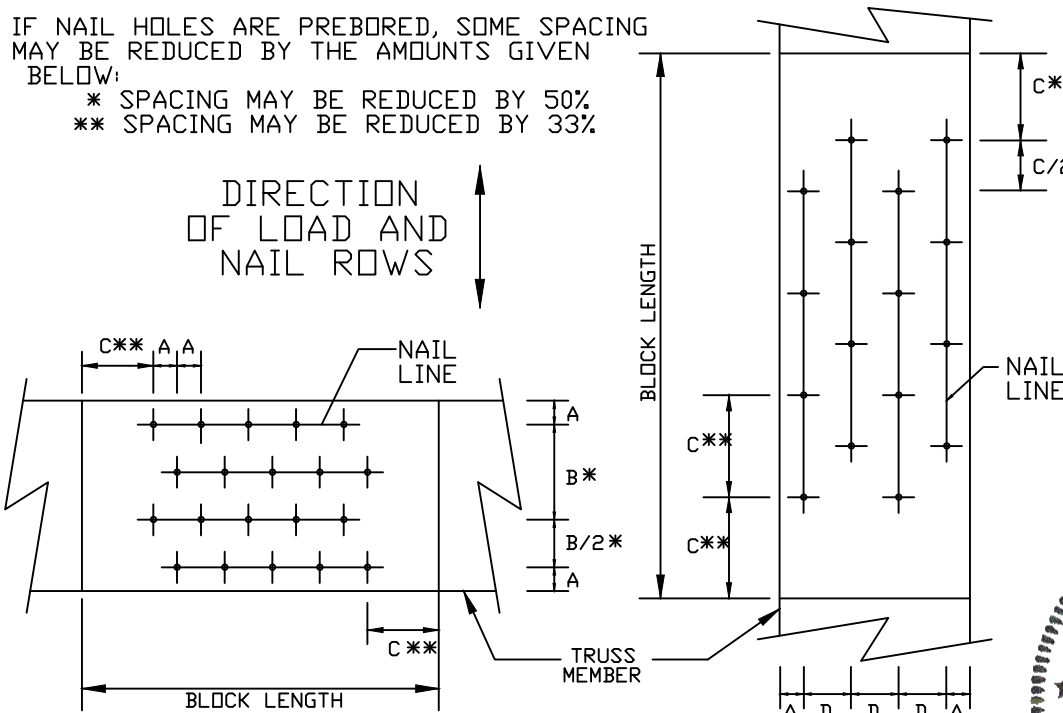

MINIMUM NAIL SPACING DISTANCES

| NAIL TYPE                      | DISTANCES |        |        |        |
|--------------------------------|-----------|--------|--------|--------|
|                                | A         | B*     | C**    | D      |
| 8d BOX (0.113"X 2.5",MIN)      | 3/4"      | 1 3/8" | 1 3/4" | 7/8"   |
| 10d BOX (0.128"X 3",MIN)       | 7/8"      | 1 5/8" | 2"     | 1"     |
| 12d BOX (0.128"X 3.25",MIN)    | 7/8"      | 1 5/8" | 2"     | 1"     |
| 16d BOX (0.135"X 3.5",MIN)     | 7/8"      | 1 5/8" | 2 1/8" | 1 1/8" |
| 20d BOX (0.148"X 4",MIN)       | 1"        | 1 7/8" | 2 1/4" | 1 1/8" |
| 8d COMMON (0.131"X 2.5",MIN)   | 7/8"      | 1 5/8" | 2"     | 1"     |
| 10d COMMON (0.148"X 3",MIN)    | 1"        | 1 7/8" | 2 1/4" | 1 1/8" |
| 12d COMMON (0.148"X 3.25",MIN) | 1"        | 1 7/8" | 2 1/4" | 1 1/8" |
| 16d COMMON (0.162"X 3.5",MIN)  | 1"        | 2"     | 2 1/2" | 1 1/4" |
| GUN (0.120"X 2.5",MIN)         | 3/4"      | 1 1/2" | 1 7/8" | 1"     |
| GUN (0.131"X 2.5",MIN)         | 7/8"      | 1 5/8" | 2"     | 1"     |
| GUN (0.120"X 3",MIN)           | 3/4"      | 1 1/2" | 1 7/8" | 1"     |
| GUN (0.131"X 3",MIN)           | 7/8"      | 1 5/8" | 2"     | 1"     |

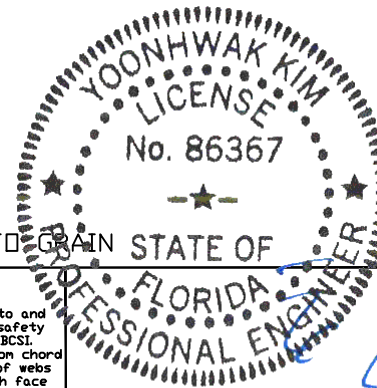

LOAD APPLIED PERPENDICULAR TO GRAIN

LOAD APPLIED PARALLEL TO GRAIN

\*\*\*WARNING\*\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING  
 \*\*\*IMPORTANT\*\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: 03/2021  
 ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway  
 Suite 242  
 Earth City, MO 63045

REF NAIL SPACE  
 DATE 10/01/14  
 DRWG CNNAILSP1014

Yoonhwak Kim, FL PE #86367

# Gable Stud Reinforcement Detail

ASCE 7-16: 140 mph Wind Speed, 30' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph wind speed, 30' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

| Max Gable Vertical Length | 2x4 Gable Vertical     |          | Brace<br>Grade | No Braces | (1) 1x4 "L" Brace * |         | (1) 2x4 "L" Brace * |         | (2) 2x4 "L" Brace ** |         | (1) 2x6 "L" Brace * |         | (2) 2x6 "L" Brace ** |         |
|---------------------------|------------------------|----------|----------------|-----------|---------------------|---------|---------------------|---------|----------------------|---------|---------------------|---------|----------------------|---------|
|                           | Spacing                | Species  |                |           | Group A             | Group B | Group A             | Group B | Group A              | Group B | Group A             | Group B | Group A              | Group B |
|                           |                        |          |                |           |                     |         |                     |         |                      |         |                     |         |                      |         |
| 24" O.C.                  | SPF<br>HF<br>SP<br>DFL | #1 / #2  | #1             | 4' 1"     | 6' 11"              | 7' 2"   | 8' 2"               | 8' 6"   | 9' 9"                | 10' 2"  | 12' 10"             | 13' 4"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 3' 10"    | 6' 2"               | 6' 7"   | 8' 1"               | 8' 5"   | 9' 8"                | 10' 0"  | 12' 8"              | 13' 2"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Stud           | 3' 10"    | 6' 2"               | 6' 6"   | 8' 1"               | 8' 5"   | 9' 8"                | 10' 0"  | 12' 8"              | 13' 2"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Standard       | 3' 10"    | 5' 3"               | 5' 7"   | 7' 0"               | 7' 6"   | 9' 6"                | 10' 0"  | 11' 0"              | 11' 10" | 14' 0"               | 14' 0"  |
|                           |                        | #1       | 4' 2"          | 7' 0"     | 7' 3"               | 8' 3"   | 8' 7"               | 9' 10"  | 10' 3"               | 13' 0"  | 13' 6"              | 14' 0"  | 14' 0"               |         |
|                           |                        |          | #2             | 4' 1"     | 6' 11"              | 7' 2"   | 8' 2"               | 8' 6"   | 9' 9"                | 10' 2"  | 12' 10"             | 13' 4"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 4' 0"     | 5' 7"               | 5' 11"  | 7' 5"               | 7' 11"  | 9' 8"                | 10' 1"  | 11' 7"              | 12' 5"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Stud           | 4' 0"     | 5' 7"               | 5' 11"  | 7' 5"               | 7' 11"  | 9' 8"                | 10' 1"  | 11' 7"              | 12' 5"  | 14' 0"               | 14' 0"  |
|                           |                        | Standard | 3' 9"          | 4' 11"    | 5' 13"              | 6' 6"   | 7' 0"               | 8' 10"  | 9' 6"                | 10' 3"  | 11' 0"              | 13' 11" | 14' 0"               | 14' 0"  |
|                           |                        |          | #1 / #2        | 4' 8"     | 7' 11"              | 8' 3"   | 9' 4"               | 9' 9"   | 11' 2"               | 11' 7"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 4' 5"     | 7' 6"               | 8' 3"   | 9' 3"               | 9' 7"   | 11' 0"               | 11' 6"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Stud           | 4' 5"     | 7' 6"               | 8' 0"   | 9' 3"               | 9' 7"   | 11' 0"               | 11' 6"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
| 16" O.C.                  | SPF<br>HF<br>SP<br>DFL | #1 / #2  | #1             | 4' 10"    | 8' 0"               | 8' 4"   | 9' 6"               | 9' 10"  | 11' 3"               | 11' 9"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #2             | 4' 8"     | 7' 11"              | 8' 3"   | 9' 4"               | 9' 9"   | 11' 2"               | 11' 7"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 4' 7"     | 6' 10"              | 7' 3"   | 9' 1"               | 9' 8"   | 11' 1"               | 11' 6"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Stud           | 4' 7"     | 6' 10"              | 7' 3"   | 9' 1"               | 9' 8"   | 11' 1"               | 11' 6"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        | Standard | 4' 5"          | 6' 0"     | 6' 5"               | 8' 0"   | 8' 7"               | 10' 10" | 11' 6"               | 12' 7"  | 13' 15'             | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #1 / #2        | 5' 2"     | 8' 9"               | 9' 1"   | 10' 4"              | 10' 9"  | 11' 2"               | 12' 9"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 4' 10"    | 8' 7"               | 8' 11"  | 10' 2"              | 10' 7"  | 12' 2"               | 12' 8"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | Stud           | 4' 10"    | 8' 7"               | 8' 11"  | 10' 2"              | 10' 7"  | 12' 2"               | 12' 8"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        | Standard | 4' 10"         | 7' 5"     | 7' 11"              | 9' 11"  | 10' 7"              | 12' 2"  | 12' 8"               | 14' 0"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #1             | 5' 4"     | 8' 10"              | 9' 2"   | 10' 5"              | 10' 10" | 12' 5"               | 12' 11" | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #2             | 5' 2"     | 8' 9"               | 9' 1"   | 10' 4"              | 10' 9"  | 12' 3"               | 12' 9"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
|                           |                        |          | #3             | 5' 0"     | 7' 10"              | 8' 4"   | 10' 3"              | 10' 8"  | 12' 2"               | 12' 8"  | 14' 0"              | 14' 0"  | 14' 0"               | 14' 0"  |
| Stud                      | 5' 0"                  | 7' 10"   | 8' 4"          | 10' 3"    | 10' 8"              | 12' 2"  | 12' 8"              | 14' 0"  | 14' 0"               | 14' 0"  | 14' 0"              | 14' 0"  |                      |         |
|                           | Standard               | 4' 10"   | 6' 11"         | 7' 4"     | 9' 3"               | 9' 10"  | 12' 2"              | 12' 8"  | 14' 0"               | 14' 0"  | 14' 0"              | 14' 0"  |                      |         |

## Bracing Group Species and Grades:

| Group A:          |          |                  |          |
|-------------------|----------|------------------|----------|
| Spruce-Pine-Fir   |          | Hem-Fir          |          |
| #1 / #2           | Standard | #2               | Stud     |
| #3                | Stud     | #3               | Standard |
| Douglas Fir-Larch |          | Southern Pine*** |          |
| #3                | Stud     | #3               | Stud     |
| Standard          | Standard | Standard         | Standard |

|                   |                  |
|-------------------|------------------|
| Group B:          |                  |
| Hem-Fir           |                  |
| #1 & Btr          |                  |
| #1                |                  |
| Douglas Fir-Larch | Southern Pine*** |
| #1                | #1               |
| #2                | #2               |

1x4 Braces shall be SRB (Stress-Rated Board).

\*\*\*For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

## Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for 100 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach 'L' braces with 10d (0.128"x3.0" min) nails.

\* For (1) 'L' brace: space nails at 2' o.c. in 18' end zones and 4' o.c. between zones.  
 \*\* For (2) 'L' braces: space nails at 3' o.c. in 18' end zones and 6' o.c. between zones.

'L' bracing must be a minimum of 80% of web member length.

## Gable Vertical Plate Sizes

| Vertical Length                          | No Splice |
|--|-----------|
| Less than 4' 0"                          | 2X4       |
| Greater than 4' 0", but less than 11' 6" | 3X4       |
| Greater than 11' 6"                      | 4X4       |



+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 525# at each end. Max web total length is 14'.

Vertical length shown in table above.

Connect diagonal at midpoint of vertical web.

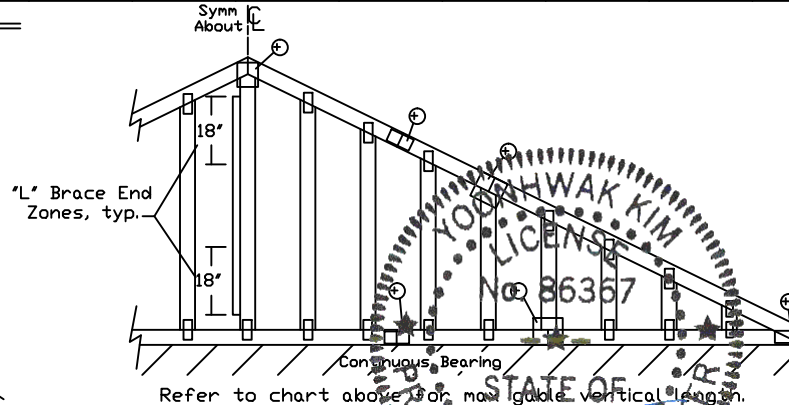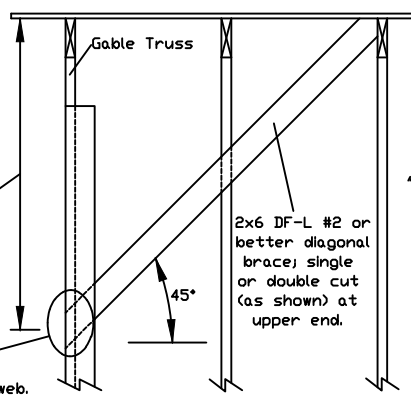

Refer to chart above for max gable vertical length.

\*\*\*WARNING\*\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING  
 \*\*\*IMPORTANT\*\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: 03/2021  
 ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcaindustry.org ICC: www.iccsafe.org



514 Earth City Expressway  
 Suite 242  
 Earth City, MO 63045

Yoonhwak Kim, FL PE #86367

MAX. TOT. LD. 60 PSF


MAX. SPACING 24.0'

REF ASCE7-16-GAB14030

DATE 01/26/2018

DRWG A14030ENC160118

# Gable Detail For Let-in Verticals

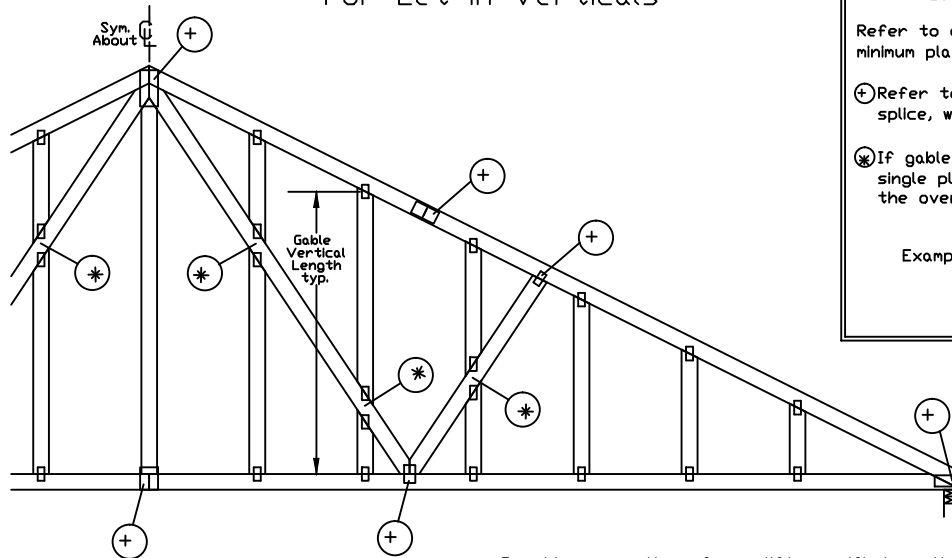


## Gable Truss Plate Sizes


Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.

(+) Refer to Engineered truss design for peak, splice, web, and heel plates.

(X) If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.



## "T" Reinforcement Attachment Detail

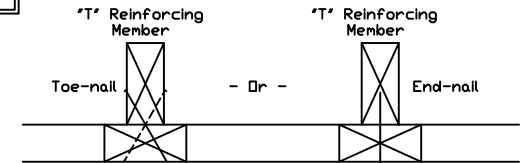

To convert from "L" to "T" reinforcing members, multiply "T" increase by length (based on appropriate Alpine gable detail).

Maximum allowable "T" reinforced gable vertical length is 14' from top to bottom chord.

"T" reinforcing member material must match size, specie, and grade of the "L" reinforcing member.

## Web Length Increase w/ "T" Brace

| "T" Reinf. Mbr. Size | "T" Increase |
|----------------------|--------------|
| 2x4                  | 30 %         |
| 2x6                  | 20 %         |

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24' o.c. SP #3

"T" Reinforcing Member Size = 2x4

"T" Brace Increase (From Above) = 30% = 1.30

(1) 2x4 "L" Brace Length = 8' 7"

Maximum "T" Reinforced Gable Vertical Length  
1.30 x 8' 7" = 11' 2"

Provide connections for uplift specified on the engineered truss design.

Attach each "T" reinforcing member with

End Driven Nails:

10d Common (0.148"x 3", min) Nails at 4' o.c. plus  
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148"x 3", min) Toenails at 4' o.c. plus  
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.


## ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,  
A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

## ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A10015ENC100118,  
A18015ENC100118, A20015ENC100118, A20015END100118, A20015P100118,  
A11530ENC100118, A12030ENC100118, A14030ENC100118, A10030ENC100118,  
A18030ENC100118, A20030ENC100118, A20030END100118, A20030P100118,  
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,  
S18015ENC100118, S20015ENC100118, S20015END100118, S20015P100118,  
S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,  
S18030ENC100118, S20030ENC100118, S20030END100118, S20030P100118

See appropriate Alpine gable detail for maximum unreinforced gable vertical length.

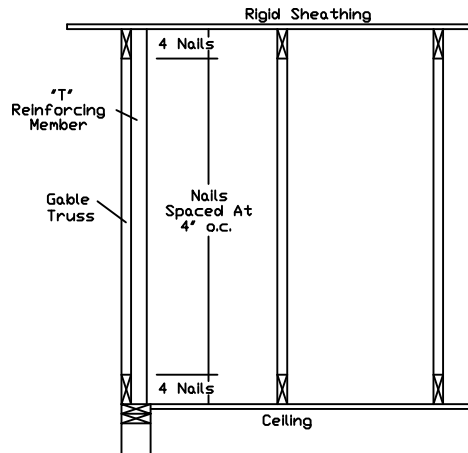

\*\*\*WARNING\*\*\* READ AND FOLLOW ALL NOTES ON THIS DRAWING  
\*\*\*IMPORTANT\*\*\* FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:  
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.internationalcc.org



514 Earth City Expressway  
Suite 242  
Earth City, MO 63045

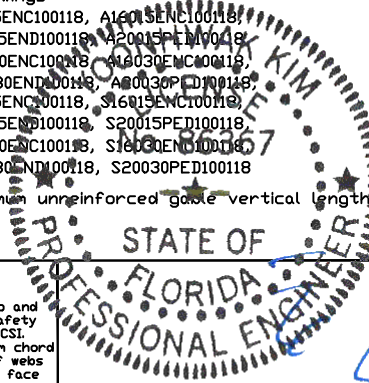

REF LET-IN VERT

DATE 01/02/2018

DRWG GBLLETIN0118

MAX. TOT. LD. 60 PSF

DUR. FAC. ANY

MAX. SPACING 24.0"

278, Yoonhwak Kim, FL PE #86367