

DESIGN SPECIFICATIONS				USP CONNECTORS																																																																																											
DESIGN CODE: 2017 FLORIDA BUILDING CODE - RESIDENTIAL DESIGN IS VOID ONE YEAR AFTER THE DATE OF THE ORIGINAL PLANS, UNLESS PLANS HAVE BEEN REVIEWED FOR CODE COMPLIANCE. DESIGN LOADS: ACTUAL AND UNIFORM		COMPONENTS & CLADDING ALLOWABLE DESIGN PRESSURES		GARAGE DOOR PRESSURES (PSF)		CONNECTOR																																																																																									
ROOF: ROOF LOADING (cd=1.25) TOP CHORD LIVE LOAD 20 psf TOP CHORD DEAD LOAD 7 psf (ARCH SHINGLES) BOTTOM CHORD LIVE LOAD 20 psf (TILE SHINGLES) BOTTOM CHORD DEAD LOAD 5 psf FLOOR: FLOOR LOADING (cd=1.00) TOP CHORD LIVE LOAD 40 psf TOP CHORD DEAD LOAD 10 psf BOTTOM CHORD LIVE LOAD 5 psf BOTTOM CHORD DEAD LOAD 5 psf		<table><tr><th>INTERIOR</th><th>EDGE STRIP (PSF):</th><th>GARAGE DOOR PRESSURES (PSF)</th></tr><tr><td>10</td><td>+25.6 -27.7</td><td>+22.9</td></tr><tr><td>50</td><td>+22.9 -25.0</td><td>+21.8</td></tr><tr><td>100</td><td>+21.8 -23.9</td><td>+21.8</td></tr></table>		INTERIOR	EDGE STRIP (PSF):	GARAGE DOOR PRESSURES (PSF)	10	+25.6 -27.7	+22.9	50	+22.9 -25.0	+21.8	100	+21.8 -23.9	+21.8	<table><tr><td>1 CAR GARAGE DOOR (8'x7')</td><td>+22.9</td></tr><tr><td>2 CAR GARAGE DOOR (16'x7')</td><td>+21.8</td></tr><tr><td></td><td>-23.9</td></tr></table>		1 CAR GARAGE DOOR (8'x7')	+22.9	2 CAR GARAGE DOOR (16'x7')	+21.8		-23.9	<table><tr><th>UPLIFT</th><th>FASTENERS</th><th>FL# CODE</th></tr><tr><td>SYP</td><td>SYP</td><td></td></tr><tr><td>SPF</td><td>SPF</td><td></td></tr></table>		UPLIFT	FASTENERS	FL# CODE	SYP	SYP		SPF	SPF																																																														
INTERIOR	EDGE STRIP (PSF):	GARAGE DOOR PRESSURES (PSF)																																																																																													
10	+25.6 -27.7	+22.9																																																																																													
50	+22.9 -25.0	+21.8																																																																																													
100	+21.8 -23.9	+21.8																																																																																													
1 CAR GARAGE DOOR (8'x7')	+22.9																																																																																														
2 CAR GARAGE DOOR (16'x7')	+21.8																																																																																														
	-23.9																																																																																														
UPLIFT	FASTENERS	FL# CODE																																																																																													
SYP	SYP																																																																																														
SPF	SPF																																																																																														
DEFLECTION CRITERIA: ROOF FRAMING: LIVE LOAD L/240 TOTAL LOAD L/180 FLOOR FRAMING: LIVE LOAD L/360 & TOTAL LOAD L/240 0.75" MAX ANY CASE		<ul style="list-style-type: none">THE VALUES ABOVE ARE ALLOWABLE MIN PRESSURE VALUES (ASD). THE ABOVE WIND PRESSURES HAVE BEEN REDUCED BY 0.80 AS PERMITTED BY THE ALLOWABLE STRESS DESIGN METHODOLOGY. NO FURTHER REDUCTION SHALL BE PERMITTED.COMPONENT & CLADDING WALL ELEMENTS SHALL BE DESIGNED FOR BOTH POSITIVE AND NEGATIVE PRESSURES SHOWN IN TABLE ABOVE.LINEAR INTERPOLATION IS PERMISSIBLE.PLUS = PRESSURE AND MINUS = SUCTION.DESIGN OF WINDOWS/DOORS FASTENING TO THE WALL FRAMING IS THE RESPONSIBILITY OF THE WINDOW/DOOR MANUF./SUPPLIER & SHALL MEET THE ABOVE NOTED POSITIVE AND NEGATIVE PRESSURES.		<table><tr><td>USP A35</td><td>450</td><td>450</td><td>(9)10dX1 1/2"</td><td></td></tr><tr><td>USP RT7</td><td>585</td><td>495</td><td>(5)8d EA. END</td><td></td></tr><tr><td>USP RT8A</td><td>775</td><td>650</td><td>(5)10dX1 1/2" EA. END</td><td></td></tr><tr><td>USP MTW12</td><td>1195</td><td>860</td><td>(7)10dX1 1/2" EA. END</td><td></td></tr><tr><td>USP HTW20</td><td>1450</td><td>1245</td><td>(12)10dX1 1/2" EA. END</td><td></td></tr><tr><td>USP MSTA24</td><td>1640</td><td>1455</td><td>(9)10d EA. END</td><td></td></tr><tr><td>USP MSTA36</td><td>2065</td><td>2065</td><td>(13)10d EA. END</td><td></td></tr><tr><td>USP LTS208</td><td>1105</td><td>1105</td><td>1/2" #8 ROD TO FTG.</td><td></td></tr><tr><td>USP JUS28</td><td>1305</td><td>1305</td><td>(6)10d TO HEADER</td><td></td></tr><tr><td>USP HTT16</td><td>4290</td><td>4290</td><td>3/4" #8 ROD TO FTG.</td><td></td></tr><tr><td>USP HTT22</td><td>5370</td><td>5370</td><td>3/4" #8 ROD TO FTG.</td><td></td></tr><tr><td>USP PAU44</td><td>2535</td><td></td><td>3/4" #8 ROD w/ (12)16d</td><td></td></tr><tr><td>USP PAU66</td><td>2535</td><td></td><td>3/4" #8 ROD w/ (12)16d</td><td></td></tr><tr><td>USP MSTA24</td><td>1545</td><td>1455</td><td>(5)1/4"x2-1/4" TAPCONS</td><td></td></tr></table>		USP A35	450	450	(9)10dX1 1/2"		USP RT7	585	495	(5)8d EA. END		USP RT8A	775	650	(5)10dX1 1/2" EA. END		USP MTW12	1195	860	(7)10dX1 1/2" EA. END		USP HTW20	1450	1245	(12)10dX1 1/2" EA. END		USP MSTA24	1640	1455	(9)10d EA. END		USP MSTA36	2065	2065	(13)10d EA. END		USP LTS208	1105	1105	1/2" #8 ROD TO FTG.		USP JUS28	1305	1305	(6)10d TO HEADER		USP HTT16	4290	4290	3/4" #8 ROD TO FTG.		USP HTT22	5370	5370	3/4" #8 ROD TO FTG.		USP PAU44	2535		3/4" #8 ROD w/ (12)16d		USP PAU66	2535		3/4" #8 ROD w/ (12)16d		USP MSTA24	1545	1455	(5)1/4"x2-1/4" TAPCONS																					
USP A35	450	450	(9)10dX1 1/2"																																																																																												
USP RT7	585	495	(5)8d EA. END																																																																																												
USP RT8A	775	650	(5)10dX1 1/2" EA. END																																																																																												
USP MTW12	1195	860	(7)10dX1 1/2" EA. END																																																																																												
USP HTW20	1450	1245	(12)10dX1 1/2" EA. END																																																																																												
USP MSTA24	1640	1455	(9)10d EA. END																																																																																												
USP MSTA36	2065	2065	(13)10d EA. END																																																																																												
USP LTS208	1105	1105	1/2" #8 ROD TO FTG.																																																																																												
USP JUS28	1305	1305	(6)10d TO HEADER																																																																																												
USP HTT16	4290	4290	3/4" #8 ROD TO FTG.																																																																																												
USP HTT22	5370	5370	3/4" #8 ROD TO FTG.																																																																																												
USP PAU44	2535		3/4" #8 ROD w/ (12)16d																																																																																												
USP PAU66	2535		3/4" #8 ROD w/ (12)16d																																																																																												
USP MSTA24	1545	1455	(5)1/4"x2-1/4" TAPCONS																																																																																												
WIND LOADING: ASCE 7/10 FOR WIND UPLIFT, TRUSSES SHALL BE DESIGNED WITH A MIN. DEAD LOAD CONDITION OF 5 PSF TOP CHORD AND 5 PSF BOTTOM CHORD. REACTIONS CALCULATED FOR THE BEARING POINTS OF ROOF TRUSSES SHALL BE REDUCED. SPECIFICALLY, ATTIC FLOOR LIVE LOADS COMBINED WITH ROOF LIVE LOADS SHALL BE MULTIPLIED BY 0.75 WHEN COMBINED w/ DEAD LOAD.				SIMPSON CONNECTORS																																																																																											
BASIC WIND SPEED (ASCE 7-10) 130 MPH IMPORTANCE FACTOR 1.00 MEAN ROOF HEIGHT 20.0 FT ROOF PITCH 6/12 BUILDING CATEGORY II EXPOSURE CATEGORY C ENCLOSURE CLASSIFICATION ENCLOSED INTERNAL PRESSURE COEFFICIENT ± 18		SCOPE OF SERVICE MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE FOR ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. LIMITS OF STRUCTURAL ENGINEERING DESIGN RESPONSIBILITIES: THE ITEMS SPECIFICALLY DESIGNED BY THE STRUCTURAL ENGINEER ARE LIMITED TO THE FOLLOWING: CONTINUOUS LOAD PATH FOR WIND UPLIFT; WOOD PANEL SHEARWALLS, WALL FRAMING AND REQUIRED SHEATHING AND HEADERS DIRECTLY SUPPORTING ROOF FRAMING; ITEMS NOT DESIGNED PRE-ENGINEERED WOOD FLOOR AND ROOF TRUSSES, FLOOR FRAMING NOT SPECIFICALLY ADDRESSED, TRUSS-TO-TRUSS CONNECTION, AND ANY ARCHITECTURAL, MECHANICAL OR ELECTRICAL SYSTEM.		<table><tr><th>CONNECTOR</th><th>SYP</th><th>SPF</th><th>FASTENERS</th><th>FL# CODE</th></tr><tr><td>A35</td><td>450</td><td>450</td><td>12-8dX1 1/2"</td><td>10446.4</td></tr><tr><td>H2.5T</td><td>600</td><td>520</td><td>5-8d EA. END</td><td>11478.3</td></tr><tr><td>HTS16</td><td>1150</td><td>1085</td><td>16-10d EA. END</td><td>10456.6</td></tr><tr><td>MTS12</td><td>1000</td><td>860</td><td>7-10dX1 1/2" EA. END</td><td>10456.3</td></tr><tr><td>HTS20</td><td>1450</td><td>1245</td><td>24-10dX1 1/2" EA. END</td><td>13872.3</td></tr><tr><td>MSTA24</td><td>1765</td><td>1270</td><td>9-10d EA. END</td><td>13872.4</td></tr><tr><td>MSTA36</td><td>2050</td><td>1870</td><td>13-10d EA. END</td><td>13872.8</td></tr><tr><td>HTT4</td><td>3480</td><td>3080</td><td>1-5/8" #8 ROD TO FTG.</td><td>11496.2</td></tr><tr><td>HTT5</td><td>5250</td><td>4670</td><td>32-16d TO TRUSS/BEAM</td><td>11496.2</td></tr><tr><td>LU528</td><td>930</td><td>780</td><td>6-10d TO JOIST</td><td>10655.113</td></tr><tr><td>HU410</td><td>905</td><td>785</td><td>14-16d TO HEADER</td><td>10531.36</td></tr><tr><td>AJU44</td><td>2200</td><td></td><td>3/4" #8 ROD EPOXY 6" MIN</td><td>10849.6</td></tr><tr><td>AJU66</td><td>2300</td><td></td><td>3/4" #8 ROD EPOXY 6" MIN</td><td>10849.6</td></tr><tr><td>SET</td><td>N/A</td><td>N/A</td><td>9/16" #8 EPOXY-TIE</td><td>11506.4</td></tr><tr><td>LTT208</td><td>1675</td><td>1675</td><td>10-16d TO STUD/BEAM/POST</td><td>11496.3</td></tr><tr><td>LSTA12</td><td>805</td><td>695</td><td>1-1/2" #8 ROD TO FTG.</td><td>13872.5</td></tr><tr><td>CS16</td><td>1705</td><td>1705</td><td>13-8d</td><td>10852.1</td></tr></table>		CONNECTOR	SYP	SPF	FASTENERS	FL# CODE	A35	450	450	12-8dX1 1/2"	10446.4	H2.5T	600	520	5-8d EA. END	11478.3	HTS16	1150	1085	16-10d EA. END	10456.6	MTS12	1000	860	7-10dX1 1/2" EA. END	10456.3	HTS20	1450	1245	24-10dX1 1/2" EA. END	13872.3	MSTA24	1765	1270	9-10d EA. END	13872.4	MSTA36	2050	1870	13-10d EA. END	13872.8	HTT4	3480	3080	1-5/8" #8 ROD TO FTG.	11496.2	HTT5	5250	4670	32-16d TO TRUSS/BEAM	11496.2	LU528	930	780	6-10d TO JOIST	10655.113	HU410	905	785	14-16d TO HEADER	10531.36	AJU44	2200		3/4" #8 ROD EPOXY 6" MIN	10849.6	AJU66	2300		3/4" #8 ROD EPOXY 6" MIN	10849.6	SET	N/A	N/A	9/16" #8 EPOXY-TIE	11506.4	LTT208	1675	1675	10-16d TO STUD/BEAM/POST	11496.3	LSTA12	805	695	1-1/2" #8 ROD TO FTG.	13872.5	CS16	1705	1705	13-8d	10852.1
CONNECTOR	SYP	SPF	FASTENERS	FL# CODE																																																																																											
A35	450	450	12-8dX1 1/2"	10446.4																																																																																											
H2.5T	600	520	5-8d EA. END	11478.3																																																																																											
HTS16	1150	1085	16-10d EA. END	10456.6																																																																																											
MTS12	1000	860	7-10dX1 1/2" EA. END	10456.3																																																																																											
HTS20	1450	1245	24-10dX1 1/2" EA. END	13872.3																																																																																											
MSTA24	1765	1270	9-10d EA. END	13872.4																																																																																											
MSTA36	2050	1870	13-10d EA. END	13872.8																																																																																											
HTT4	3480	3080	1-5/8" #8 ROD TO FTG.	11496.2																																																																																											
HTT5	5250	4670	32-16d TO TRUSS/BEAM	11496.2																																																																																											
LU528	930	780	6-10d TO JOIST	10655.113																																																																																											
HU410	905	785	14-16d TO HEADER	10531.36																																																																																											
AJU44	2200		3/4" #8 ROD EPOXY 6" MIN	10849.6																																																																																											
AJU66	2300		3/4" #8 ROD EPOXY 6" MIN	10849.6																																																																																											
SET	N/A	N/A	9/16" #8 EPOXY-TIE	11506.4																																																																																											
LTT208	1675	1675	10-16d TO STUD/BEAM/POST	11496.3																																																																																											
LSTA12	805	695	1-1/2" #8 ROD TO FTG.	13872.5																																																																																											
CS16	1705	1705	13-8d	10852.1																																																																																											
MATERIAL SPECIFICATIONS HARDWARE AND ANCHORS: ANCHOR BOLTS & THREADED ROD: SHALL BE IN ACCORDANCE WITH ASTM A 307 OR ASTM F 1554 GRADE 36. WASHERS: SHALL BE IN ACCORDANCE WITH ASTM A500 (GRADE B). NUTS: SHALL BE IN ACCORDANCE WITH ASTM A 563 GRADE A HEX. METAL CONNECTORS: ALL METAL CONNECTORS WHICH ARE EXPOSED TO EXTERIOR SHALL BE GALVANIZED. REINFORCING STEEL: EMBEDMENT OF RODS OR REBAR DOWELS SHALL BE 12 BAR DIAMETER MINIMUM. HOLES SHALL BE 1/4" LARGER THAN REBAR SIZE AND 1/2" LARGER THAN THREADED ROD SIZE (O.D.). ANCHORING ADHESIVE: SHALL BE ONE OF THE FOLLOWING PRODUCTS (QUAL CARTRIDGE INSTALLATION ONLY): EPOXY: 1W RED HEAD A7 REINFORCING STEEL SHALL BE ASTM A615, GRADE 60. STRUCTURAL STEEL: SHALL BE ASTM A592, GRADE 50. WELDED WIRE FABRIC (WWF): SHALL BE ASTM A185. LAMINATED VENEER LUMBER (LVL): ALL LAMINATED VENEER LUMBER SHALL MEET OR EXCEED THE FOLLOWING DESIGN PROPERTIES - ELASTIC MODULUS (E) 1,900ksi, BENDING STRESS (Fb) 2600psi																																																																																															

GENERAL NOTES & CONSTRUCTION SPECIFICATIONS			
FLOOR SHEATHING SPECIFICATIONS: 23/32" T&G OSB OR PLYWOOD SHEATHING, GLUE AND NAIL WITH 10d COMMON @ 6" O.C. EDGE & FIELD. ROOF SHEATHING SPECIFICATIONS: SHINGLE - MIN. 7/8", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, NAILED w/ 0.113x2" RING SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE). TILE - MIN. 15/32" 32/16, APA RATED PLYWOOD SHEATHING, NAILED w/ 0.113x2" RING SHANK @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE). METAL - MIN. 1/2", 24/16, APA RATED PLYWOOD SHEATHING, NAILED w/ 0.113x2" RING SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE). WALL SHEATHING SPECIFICATIONS: FLEXIBLE FINISH: MIN. 7/8", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED W/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL EXTEND FULL HEIGHT FROM BOTTOM PLATE TO UPPER TOP PLATE. FLEXIBLE FINISH WALLS INCLUDE: WOOD, CEMENT, OR VINYL SIDING. HARD PANEL & BRICK. ALL OTHER WALL SHALL BE CONSIDERED BRITTLE FINISH. STUCCO FINISH: MIN. 7/8", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED W/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL ORIENTED WITH THE LONG DIMENSION PERPENDICULAR TO THE STUDS. CONTRACTOR MAY USE 3/4" STRUCTURAL 1 GRADE SHEATHING OR 1/2" OSB SHEATHING AND ORIENT THE PANELS VERTICALLY.			
MASONRY SPECIFICATIONS: MASONRY HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 530-05, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 530.1-02. GROUT SHALL BE IN ACCORDANCE WITH ASTM C476 WITH A MINIMUM OF 28 DAY COMPRESSIVE STRENGTH OF 2000 psi PER ASTM C1019. GROUT SHALL HAVE A MAXIMUM COURSE AGGREGATE SIZE OF 3/4" PLACED AT AN 8" TO 11" SLUMP. MORTAR SHALL CONFORM TO ASTM C270 AND TYPE M OR S. TYPE N MORTAR MAY BE USED IN BRICK VENEER. CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL FLASHING. CONCRETE MASONRY UNITS (CMU): CMU SHALL BE IN ACCORDANCE WITH ASTM C90-75, HOLLOW LOAD-BEARING (CMU), TYPE 1, GRADE N-1, NORMAL WEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 1900 psi (f'm=1500 psi). GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT IN 5'-0" MAXIMUM LIFTS PROVIDE CLEANOUTS PER ACI 530.1-02 IN THE BOTTOM OF COURSE OF MASONRY WHEN THE WALL HEIGHT EXCEEDS 5'-0". MASONRY STEINWALLS: ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, E GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE 'S' MORTAR. WALL COURSING SHALL BE RUNNING BONDS, STACK BOND SHALL NOT BE USED. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI FEA ROUGH CONCRETE GROUT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT WITH #4 @ 4'-0" O.C. MAX. AND AT EACH CORNER, WALL END, AND WALL INTERSECTIONS, PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR MASONRY ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. AT STEINWALL, CONSTRUCTED OF 5 OR MORE COURSES, PROVIDE HORIZONTAL JOINT REINFORCEMENT AT 16" O.C. VERTICALLY. (EVERY OTHER COURSE), AND VERTICAL REINF. SHALL BE INCREASED AS NOTED ON S/I.S.O. UNLESS NOTED OTHERWISE. LAP JOINT REINFORCING SHALL BE A MINIMUM OF 6". CONCRETE SPECIFICATIONS: ALL CONCRETE HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 318-08, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 301. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS. CONCRETE AT GARAGE AND PORCH SLABS SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI.			
GENERAL NOTES: FOOTING AND FOUNDATIONS: FOOTINGS AND FOUNDATIONS SHALL BE IN ACCORDANCE WITH LOCAL BUILDING CODES. FOOTING HAVE BEEN DESIGNED WITH A SOIL BEARING (DESIGN MAXIMUM) OF 2000 PSF. A SOILS INVESTIGATION REPORT IS RECOMMENDED TO VERIFY SUITABLE SUBSURFACE CONDITIONS. IF THE FOOTING ELEVATIONS SHOWN OCCUR IN A DISTURBED OR UNSTABLE SOIL, THE ENGINEER SHALL BE NOTIFIED. SOIL SHALL BE FREE OF ORGANIC MATERIAL AND COHESIVE (CLAY) SOILS. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557. FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFORMATION. FOR GENERAL FEATURES, CONDUITS, ELECTRICAL EMBEDS, STEP HEIGHTS, ETC., SEE ARCHITECTURAL PLANS. DO NOT SCALE FOOTING DIMENSIONS AND LOCATION FROM THE FOUNDATION PLAN SHOWN ON S.I.O. DO NOT DETERMINE FOOTING LOCATION BASED ON EITHER THE ARCHITECTURAL PLAN OR FRAMING PLAN, BUT BY DIMENSIONS PROVIDED ON FOUNDATION PLAN. IF FOOTING SIZE OR LOCATION IS NOT DETERMINED ON PLAN THEN CONTACT ENGINEER OF RECORD (EOR) UNLESS OTHERWISE NOTED ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 3" IN FOOTINGS AND MESH SHALL BE CENTERED IN SLAB ON GRADE. IN ALL CONTINUOUS FOOTINGS PROVIDE #3 @ 48" O.C. OR ROD CHAIRS. PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR CONCRETE ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS. CONCRETE SLABS ON GRADE: SHALL BE INSTALLED OVER MINIMUM 6 MIL POLYETHYLENE VAPOR RETARDER WITH JOINTS LAPPED 6" AND SEALED OVER CLEAN, COMPACTED EARTH OR FILL WITH APPROVED CHEMICAL SOIL TREATMENT FOR PREVENTION OF SUBTERRANEAN TERMITES. SAWCUTS FOR CONTROLLED CRACKING CUT A 1" SAWCUT INTO SLAB IN A 12x12 GRID WITHIN 12 HOURS OF CONCRETE PLACEMENT, PROVIDE SAWCUTS THROUGH OUT SLAB CALL FOR ALTERNATIVE METHODS. WOOD FRAMING SPECIFICATIONS: ALL WOOD FRAMING HAS BEEN DESIGNED IN ACCORDANCE WITH NATIONAL DESIGN SPECIFICATIONS (NDS) FOR WOOD CONSTRUCTION, LATEST EDITION. ALL WOOD MEMBERS EXPOSED TO WEATHER OR IN CONTACT WITH MASONRY, CONCRETE OR SOIL SHALL BE PRESSURE-TREATED, F, ACQ OR NON-TOX BORATE PRESERVATIVE TREATMENT IS USED. ALL ATTACHED FASTENERS SHALL BE HOT DIPPED GALVANIZED. IF ACZA PRESERVATIVE IS USED, ALL ATTACHED FASTENERS SHALL BE STAINLESS STEEL. PRE-ENGINEERED WOOD TRUSSES: SHALL BEAR THE SEAL OF AN ENGINEER IN THE STATE WHERE PROJECT IS BEING BUILT AND SHALL COMPLY WITH NFPA, TPI, AND AITC 100. CONTRACTOR SHALL VERIFY THAT ADEQUATE TRUSS BEARING IS INSTALLED AT ALL TRUSSES AS INSTALLED IN THE TRUSS SHOP DRAWINGS. ALL TRUSS-TO-TRUSS CONNECTIONS AND TRUSS PROFILES ARE THE RESPONSIBILITY OF THE DELEGATED TRUSS ENGINEER. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY" AND RECOMMENDATION FOR HANDLING, INCLUDING & BRACING METAL PLATE CONNECTED WOOD TRUSSES, 8d-19." AT MULTIPLE STRAP CONNECTIONS, SPREAD STRAPS TO AVOID NAILING CLEFTS THROUGH TRUSSES. WHEN USING (2) STRAPS ON SINGLE PLY TRUSSES, PLACE STRAPS DIAGONALLY ACROSS DBL. TOP PLATE FROM EA. OTHER. ROOF COVERING SPECIFICATIONS: THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF THE ROOF COVERING SYSTEM. ASPHALT SHINGLES SHALL COMPLY WITH ASTM D3161 AND BE INSTALLED ACCORDING TO THE MANUFACTURER'S REQUIREMENTS. CLAY AND TILE ROOFS SHALL BE INSTALLED PER THE "CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL" AND THE MANUFACTURER'S REQUIREMENTS. STANDING SEAM METAL ROOFS SHALL COMPLY WITH ASTM E1514 AND BE INSTALLED ACCORDING TO THE MANUFACTURER'S REQUIREMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL METAL FLASHING AND VALLEY MATERIALS. WATERPROOFING: THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN/INSTALLATION OF ALL WATER PROOFING.			

WOOD FASTENING SCHEDULE			BRICK NOTES / LINTEL SCHD			PLAN LEGEND AND ABBREVIATIONS		
MEMBERS	CONNECTION	FASTENER	LINTEL DIMENSION	MIN. BRG.	MAX. SPAN	INTERIOR LOAD BEARING WALL	BUILT-UP POST IN THE WALL	
TOP PLATE TO TOP PLATE	FACE NAIL	2-GUN NAILS @ 12" STAG.	13/16x3 1/2x1/4	4"	6'-0"			
TOP PLATE, LAPS/INTERSECTION	FACE NAIL	(2-16d) 3-GUN NAILS	14x3 1/2x1/4	6"	8'-0"			
DBL. TOP PLATE TO STUD	FACE NAIL	(2-16d) 3-GUN NAILS	14x3 1/2x1/4	6"	10'-0"			
RM JOIST TO TOP PLATE	TOE NAIL	(8d @ 6") GUN NAIL @ 6"	16x3 1/2x1/4	6"	12'-0"			
CEILING JOIST TO TOP PLATE	TOE NAIL	(3-8d) 5-GUN NAIL	17x3 1/2x1/4	6"	16'-0"			
CEILING JOIST, OVER PARTITIONS	FACE NAIL	(3-16d) 4-GUN NAILS						
CEILING JOIST TO ROOF RAFTER	FACE NAIL	(6-16d) 8-GUN NAILS						
JOIST/TRUSS TO PLATE	TOE NAIL	(2-16d) 3-GUN NAILS						
RAFTER TO PLATE	TOE NAIL	(3-8d) 3-GUN NAILS						
JACK RAFTER TO HIP	TOE NAIL	(3-10d) 4-GUN NAILS						
ROOF RAFTER TO 2x... RIDGE BM.	TOE NAIL	(2-16d) 3-GUN NAILS						
CONT. HEADER, TWO PIECES	FACE NAIL	16d @ 16" O.C. @ EDGE						
CONT. HEADER TO STUD	TOE NAIL	(3-16d) 4-GUN NAILS						
STUD TO SOLE PLATE	TOE NAIL	(3-16d) 4-GUN NAILS						
SOLE PLATE TO JOIST/BLOCKING	FACE NAIL	(16d @ 16") GUN NAIL @ 8"						
NAIL SPECIFICATIONS 3"x0.131" = GUN NAILS 2"x0.113" = 6d 3"x0.148" = 10d 1 1/2"x0.148" = 10dX1 1/2"			2"x0.113" = RINK SHANK 2 1/2"x0.131" = 8d 3 1/2"x0.162" = 16d 1 1/2"x0.131" = 8dX1 1/2"			SECTION VIEW OF BRICK LINTEL BRICK LINTEL, SEE SCHEDULE FLASHING BRICK LINTEL, SEE SCHEDULE		
						PLAN LEGEND AND ABBREVIATIONS ADJ - ADJACENT BM - BEAM BOT - BOTTOM BRG - BEARING CMU - CONCRETE MASONRY UNIT DBL - DOUBLE DIA - DIAMETER EA - EACH END - END EOR - ENGINEER OF RECORD EQ - EQUAL EXT - EXTERIOR FBC - FLORIDA BUILDING CODE FT - FOUNDATION FT - FOOT FTG - FOOTING HOR - HEADER HORIZ - HORIZONTAL LBS - POUNDS LG - Long MANUF - Manufacture MONO - Monolithic OC - On Center OSB - Oriented Strand Board PERP - Perpendicular PRE ENG - Pre Engineered PSF - Pounds per Square Foot PT - PRESSURE TREATED QT - Quick Tie EXT - EXTERIOR SF - Square Foot SPF - Spruce Pine Fir SYP - Southern Yellow Pine TRU - Through TYP - Typical UNO - Unless Otherwise Noted VERT - Vertical WWF - Welded Wire Fabric		

TYPICAL WALL FRAMING NOTES:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.
2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.
3. USE SYP#2 FOR ALL HEADERS.
4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.
5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB w/ 10d MASONRY CUT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL STUD NAILING:
0.131x3" END NAILS:
(2) @ 2x4,
(3) @ 2x6,
(4) @ 2x8.

TYPICAL HEADER NAILING:
0.131x3" TOE NAILS
2x6, 2x8 = (5) NAILS
2x10, 2x12 = (7) NAILS
9" LVL, 11" LVL = (7) NAILS
14" LVL, 16" LVL = (9) NAILS

TYPICAL TOP PLATE NAILING:
FASTEN ALL TOP PLATES TOGETHER w/ (3) ROWS OF .131x3 @ 12" O.C. STAGGERED.

WINDOW SILL SCHEDULE:

ROUGH OPENING OR SILL PLATES	DROPPED HEAD	MINIMUM END	FASTENER EACH END
≤ 4'-4"	(1)2x4 SPF #2	(4)12d TOE NAILS	
≤ 6'-4"	(2)2x4 SPF #2	(5)12d TOE NAILS	
≤ 8'-4"	(3)2x4 SYP #2	(1)A35 + (4)12d TOE NAILS	
≤ 12'-0"	(3)2x6 SYP #2	(1)A35 + (4)12d TOE NAILS	

ARCHED TRANSOM OPTION:
2x SYP DIAGONAL BLOCKING FASTENED w/ 3-0.131x3" EA. END TYPICAL. SHEATHING MAY EXTEND 2" PAST BLOCKING WINDOW ATTACHMENTS MUST ANCHOR INTO 2x MATERIAL. JACK AND KING STUDS, SEE PLAN.

AT TWO STORY CONDITIONS, PROVIDE SOLID BLOCKING WITHIN FLOOR SYSTEM AT UPPER LEVEL POSTS & JACK STUDS.

INTERIOR BEARING WALL:
SEE PLAN FOR STUD SIZE AND O.C. SPACING.
FULL HEIGHT ANCHOR AT INTERIOR WALLS
TYPICALLY 1x4 FULL HEIGHT THREADED RODS @ 6'-0" O.C.
BLOCKING ONLY REQUIRED AT SHEARWALLS AND STUCCO FINISH.
16d COMMONS @ 8" O.C.
FLOOR SHEATHING, SEE SPECIFICATIONS.
WALL SHEATHING SEE DETAIL 1/SO.1 FOR SPACING OPTIONS.
CONTINUOUS BLOCKING WITHIN FLOOR SYSTEM WHERE POST IS ABOVE.
8d @ 3"
SYP#2 DBL. TOP PLATE.
SEE 5/SO.0.
FULL HEIGHT SHEATHING TO BE CONTINUOUS TO UPPER TOP PLATE.
SEE DETAILS ON S1.01.
INTERIOR BEARING WALL SEE SCHEDULE FOR STUD SIZE AND O.C. SPACING.
WALL SHEATHING TO SOLE PLATE
RAISE 1" FROM BOTTOM OF SOLE PLAN AND FASTEN w/ 8d @ 3" O.C.

WALL FRAMING AT PLATE CHANGE CONDITION

WALL FRAMING AT RAISED HEADER CONDITION
BUILDER MAY CHOOSE EITHER THE DROPPED HEADER CONDITION OR RAISED HEADER CONDITION.

WALL FRAMING AT DROPPED HEADER CONDITION

2 TYPICAL WALL FRAMING

SOLE PLATE ANCHOR DETAIL

SOLE PLATE ANCHOR SCHEDULE

ANCHOR	EXT. WALL SPACING	SHEARWALLS	WASHER SPEC	EMBEDMENT DEPTH	MIN. EDGE DISTANCE
TITEN HD	42"	24"	2x2x1/8" 3x3x0.229"	4"	2"
EPOXY	42"	24"	2x2x1/8" 3x3x0.229"	4"	2"
L-BOLT	42"	24"	2x2x1/8" 3x3x0.229"	7"	2"

NOTES:

1. SOLE PLATE ANCHORS ARE REQUIRED AT ALL EXTERIOR WALLS AND ADJACENT TO CORNERS AND PLATE BREAKS.
2. 3x3 WASHERS SHALL BE SLOTTED.
3. AS AN ALTERNATE TO THE 3"x3"x1/8" W/ 1 1/2" ROUND STEEL WASHER MAY BE USED.

SOLE PLATE ANCHOR DETAIL & SCHEDULE
SCALE: 3/4" = 1'-0"

4 ROOF AND FLOOR SHEATHING NAILING
SCALE: 3/4" = 1'-0"

BOUNDARY OF SHEATHING, SEE GENERAL NOTES.

EXAMPLE OF PANEL EDGE W/ BLOCKING WHERE REQUIRED BY GENERAL NOTES.

NAIL SPACING AT SUPPORTED EDGES, GENERAL NOTES:

EXAMPLE OF UNSUPPORTED (UNBLOCKED) PANEL EDGE (TYPICAL).

NAILING TO INTERMEDIATE SUPPORT IS 6" O.C. MAX. (UON).

ROOF TRUSSES OR FLOOR JOISTS.

1 TYP. WALL SECTIONS

3 SINGLE STORY

3 MULTY STORY

5 ROOF TRUSS CONNECTION

2 & 3 PLY BEAMS

2x4 OR 2x6 POST

2x8 POST

14" LVL AND GREATER

NOTES:

1. TYP. CONNECTION AT STUD COLUMNS, JACK-TO-KING ASSEMBLIES, CORNER POST, ETC.
2. SPECIFIED NAILING REQUIRED FOR EVERY PLY IN ADDITION TO (2) PLYS

7 FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

NOTES:

1. OVERLAP TOP PLATES AT CORNERS AND INTERSECTIONS
2. — DENOTES 3"x10x1" DON NAILS @ 8" O.C. VERTICAL
3. • DENOTES SOLE PLATE ANCHOR, SEE SCHEDULE.
4. SOLE PLATE ANCHOR NOT REQUIRED WHEN HOLD DOWN IS INSTALLED.
5. CONTRACTOR MAY CHOOSE EITHER OPTION WHERE MULTIPLE OPTIONS ARE SHOWN.

3 BUILT-UP MEMBER FASTENING

7 FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

8 TYPICAL HEADER STRAPPING

9 FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

10 SINGLE STORY

11 MULTY STORY

12 TYPICAL HEADER STRAPPING

13 MULTY STORY (STACKED WINDOWS)

14 MULTY STORY (UNSTACKED WINDOWS)

SOLE PLATE ANCHOR DETAIL & SCHEDULE
SCALE: 3/4" = 1'-0"

4 ROOF AND FLOOR SHEATHING NAILING
SCALE: 3/4" = 1'-0"

5 ROOF TRUSS CONNECTION

2 & 3 PLY BEAMS

2x4 OR 2x6 POST

2x8 POST

14" LVL AND GREATER

NOTES:

1. TYP. CONNECTION AT STUD COLUMNS, JACK-TO-KING ASSEMBLIES, CORNER POST, ETC.
2. SPECIFIED NAILING REQUIRED FOR EVERY PLY IN ADDITION TO (2) PLYS

7 FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

NOTES:

1. OVERLAP TOP PLATES AT CORNERS AND INTERSECTIONS
2. — DENOTES 3"x10x1" DON NAILS @ 8" O.C. VERTICAL
3. • DENOTES SOLE PLATE ANCHOR, SEE SCHEDULE.
4. SOLE PLATE ANCHOR NOT REQUIRED WHEN HOLD DOWN IS INSTALLED.
5. CONTRACTOR MAY CHOOSE EITHER OPTION WHERE MULTIPLE OPTIONS ARE SHOWN.

8 TYPICAL HEADER STRAPPING

9 FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

10 SINGLE STORY

11 MULTY STORY

12 TYPICAL HEADER STRAPPING

13 MULTY STORY (STACKED WINDOWS)

14 MULTY STORY (UNSTACKED WINDOWS)

CHRISTOPHER J. SABOURIN

FL 071720

Christopher J Sabourin

FL PE#71461

PLAN NAME

BZEC MODEL HOME

SSE NO.

20-0187

ISSUE

DATE

PERMIT

07.17.20

REVISIONS

DATE

STRUCTURAL ENGINEERING FOR

THE LANCASTER 1752F-L

MODEL AT WOOBOROUGH

FIELD ALTERATION

CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING


DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.B.

DESIGN CRITERIA AND GENERAL NOTES

SHEET

So.o


SHEET 1 OF 7

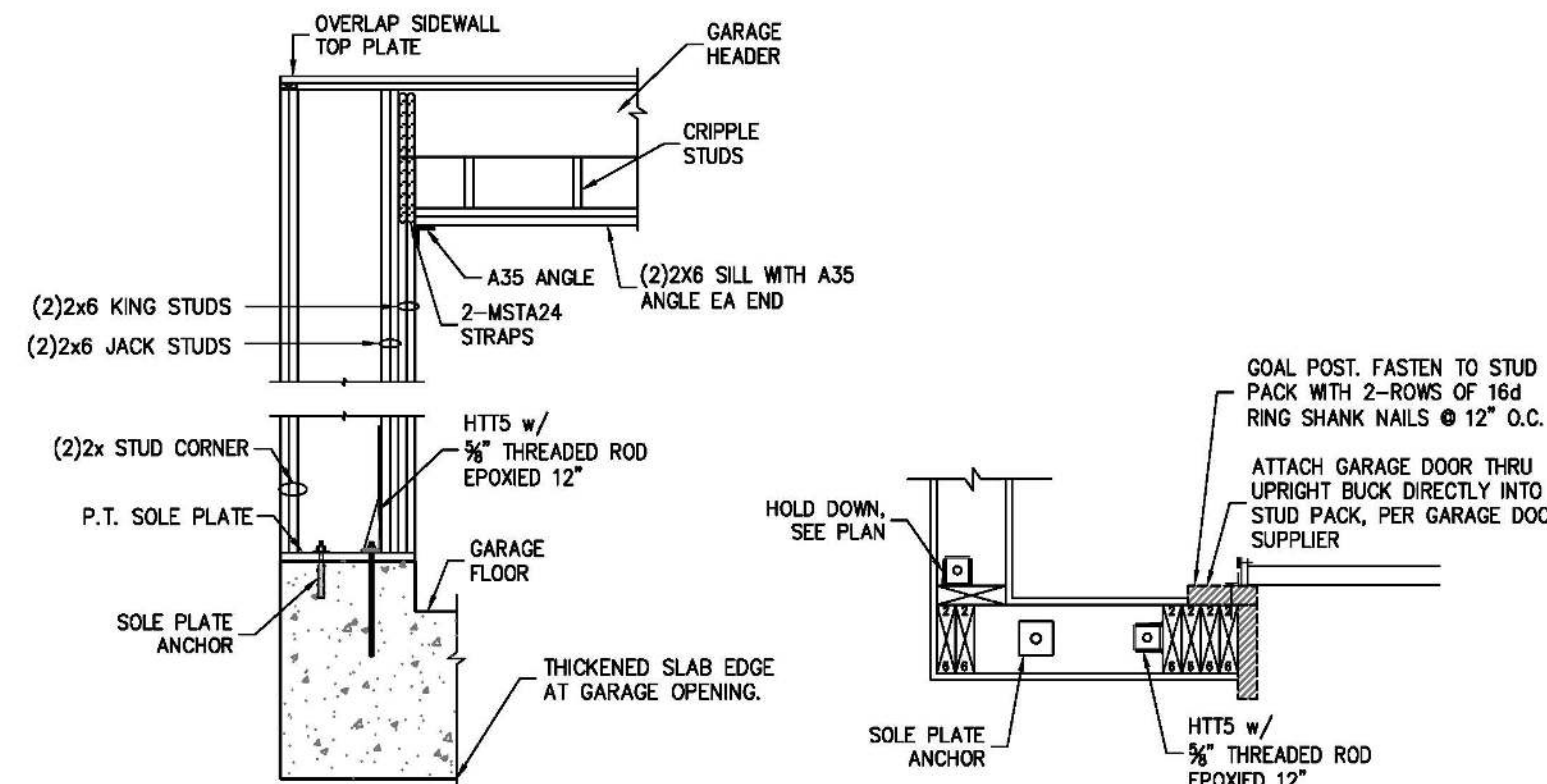


GARAGE WING WALL ELEVATION

GARAGE WING WALL SECTION


1 WHEN NOTED SO.1 GARAGE HEADER FRAMING SCALE: N.T.S.

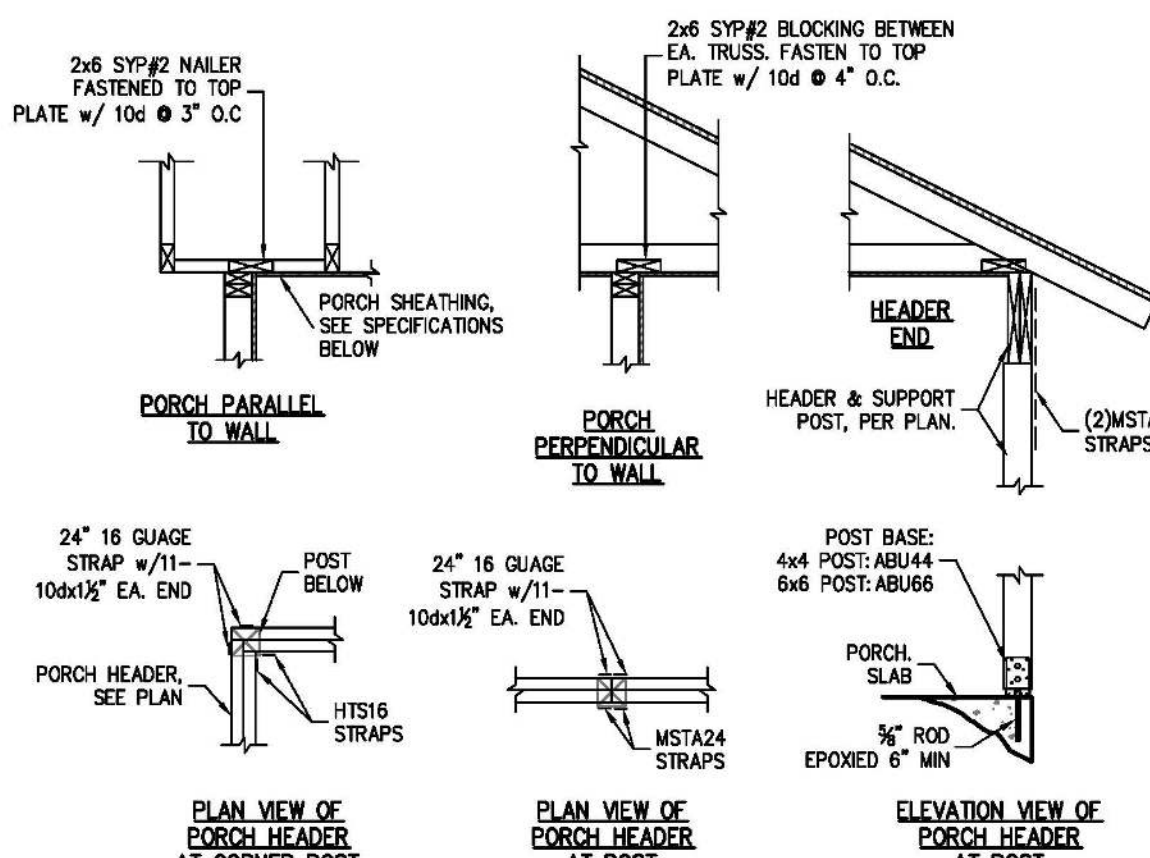


2 TYPICAL PORCH FRAMING DETAILS SO.1 SCALE: N.T.S.

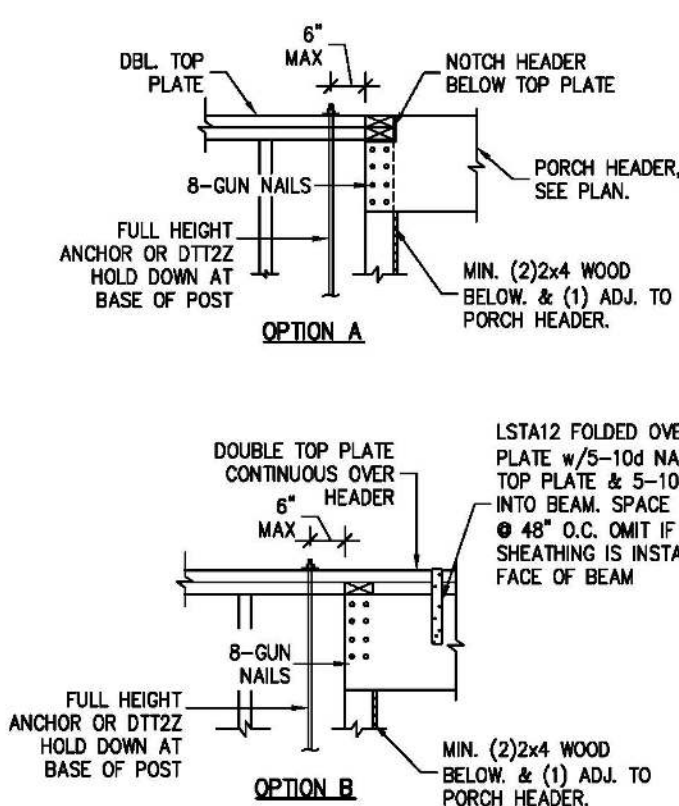


3 TYPICAL PORCH BEAM CONNECTION SO.1 SCALE: N.T.S.

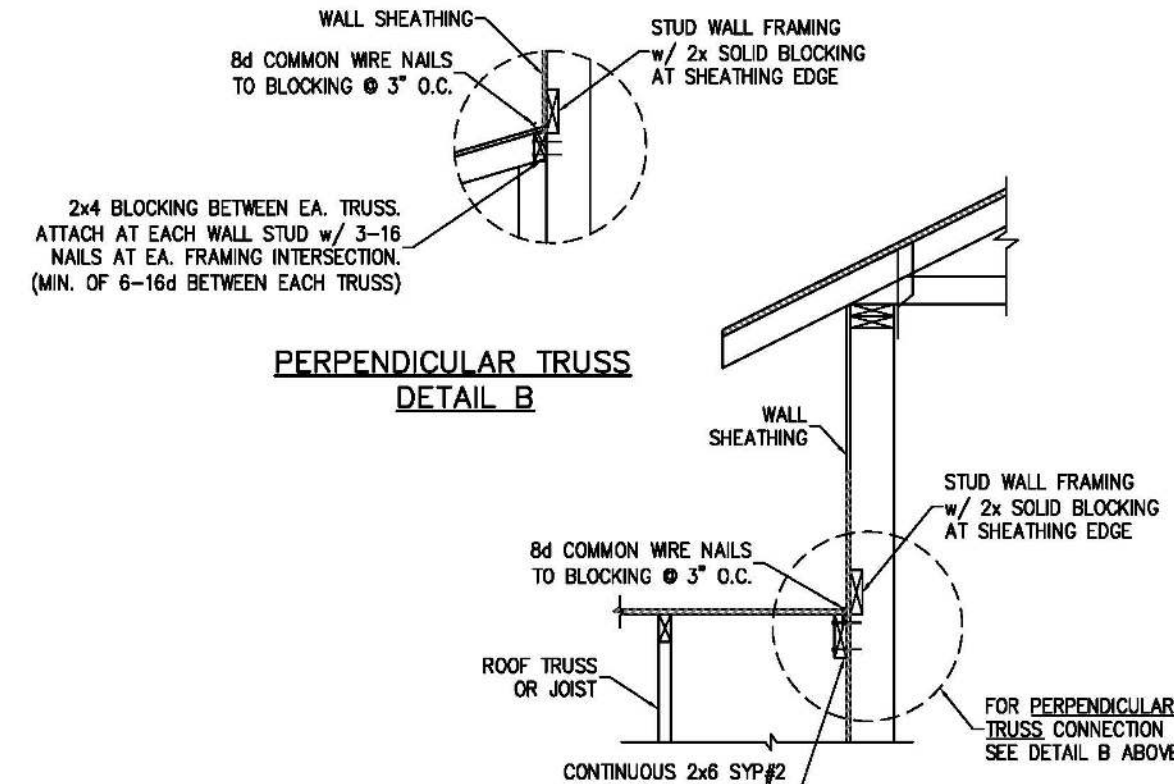


4 WALL ADJ. TO ROOF CONNECTION WHEN NOTED SO.1 SEE CONSTRUCTION SPECIFICATIONS FOR ROOF AND WALL SHEATHING AND STUD FRAMING.

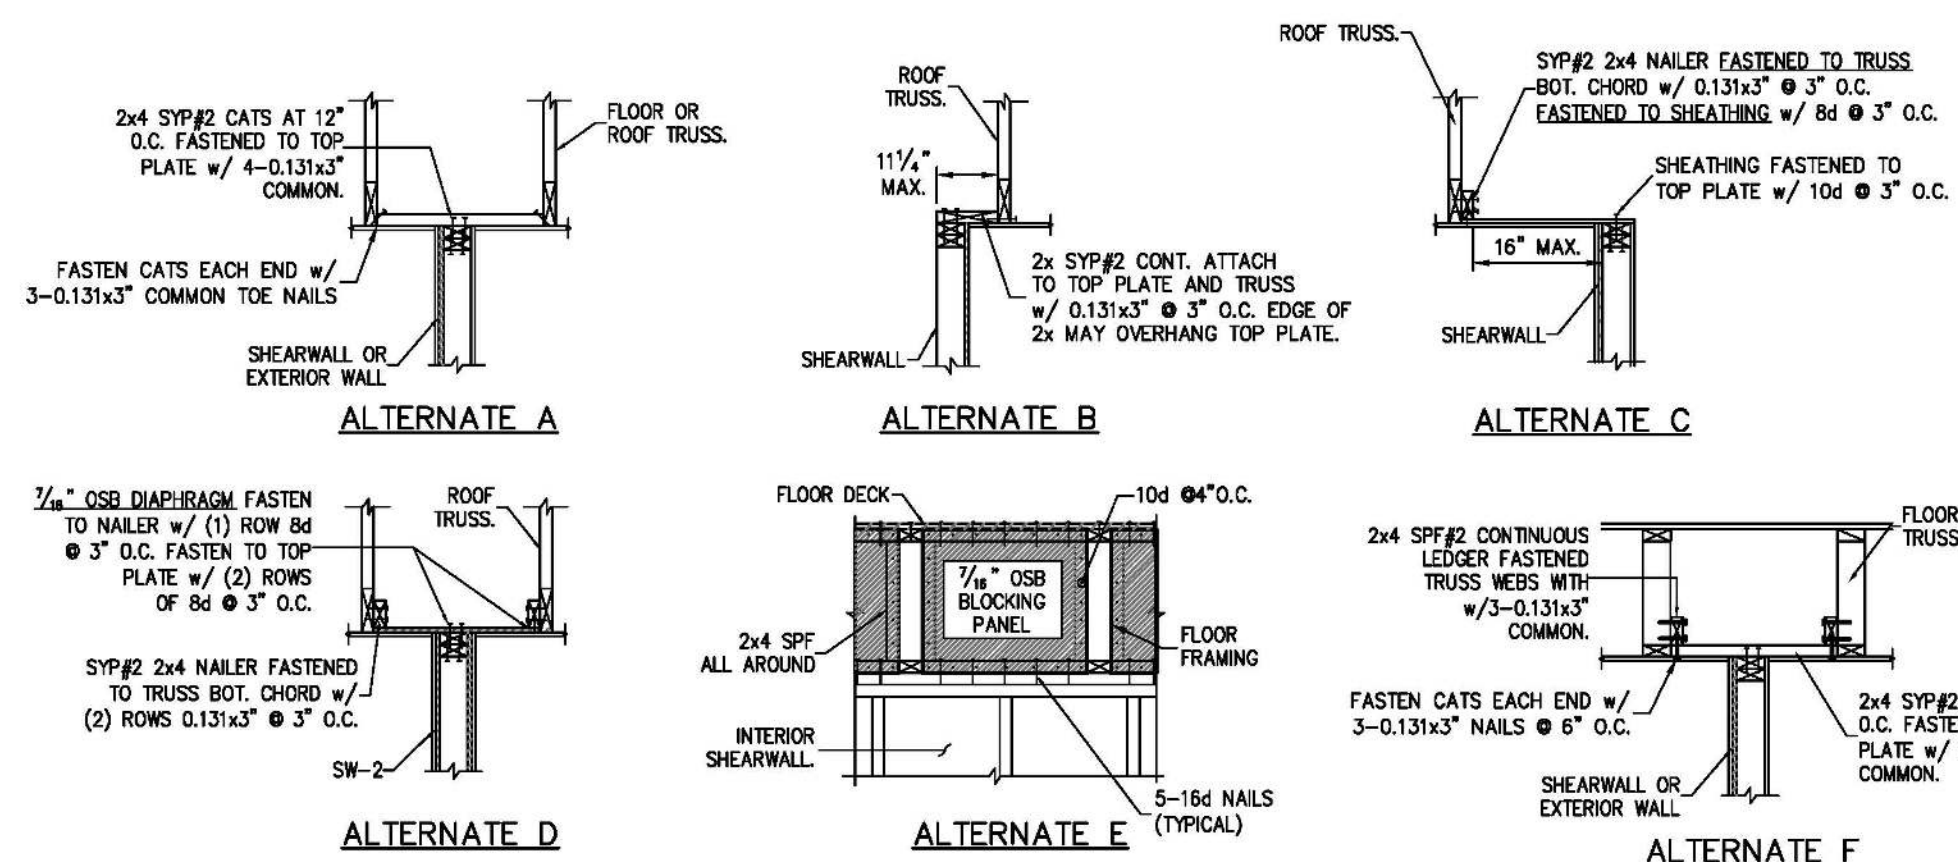


5 SHEARWALL ATTACHMENT AT ROOF & FLOOR SO.1

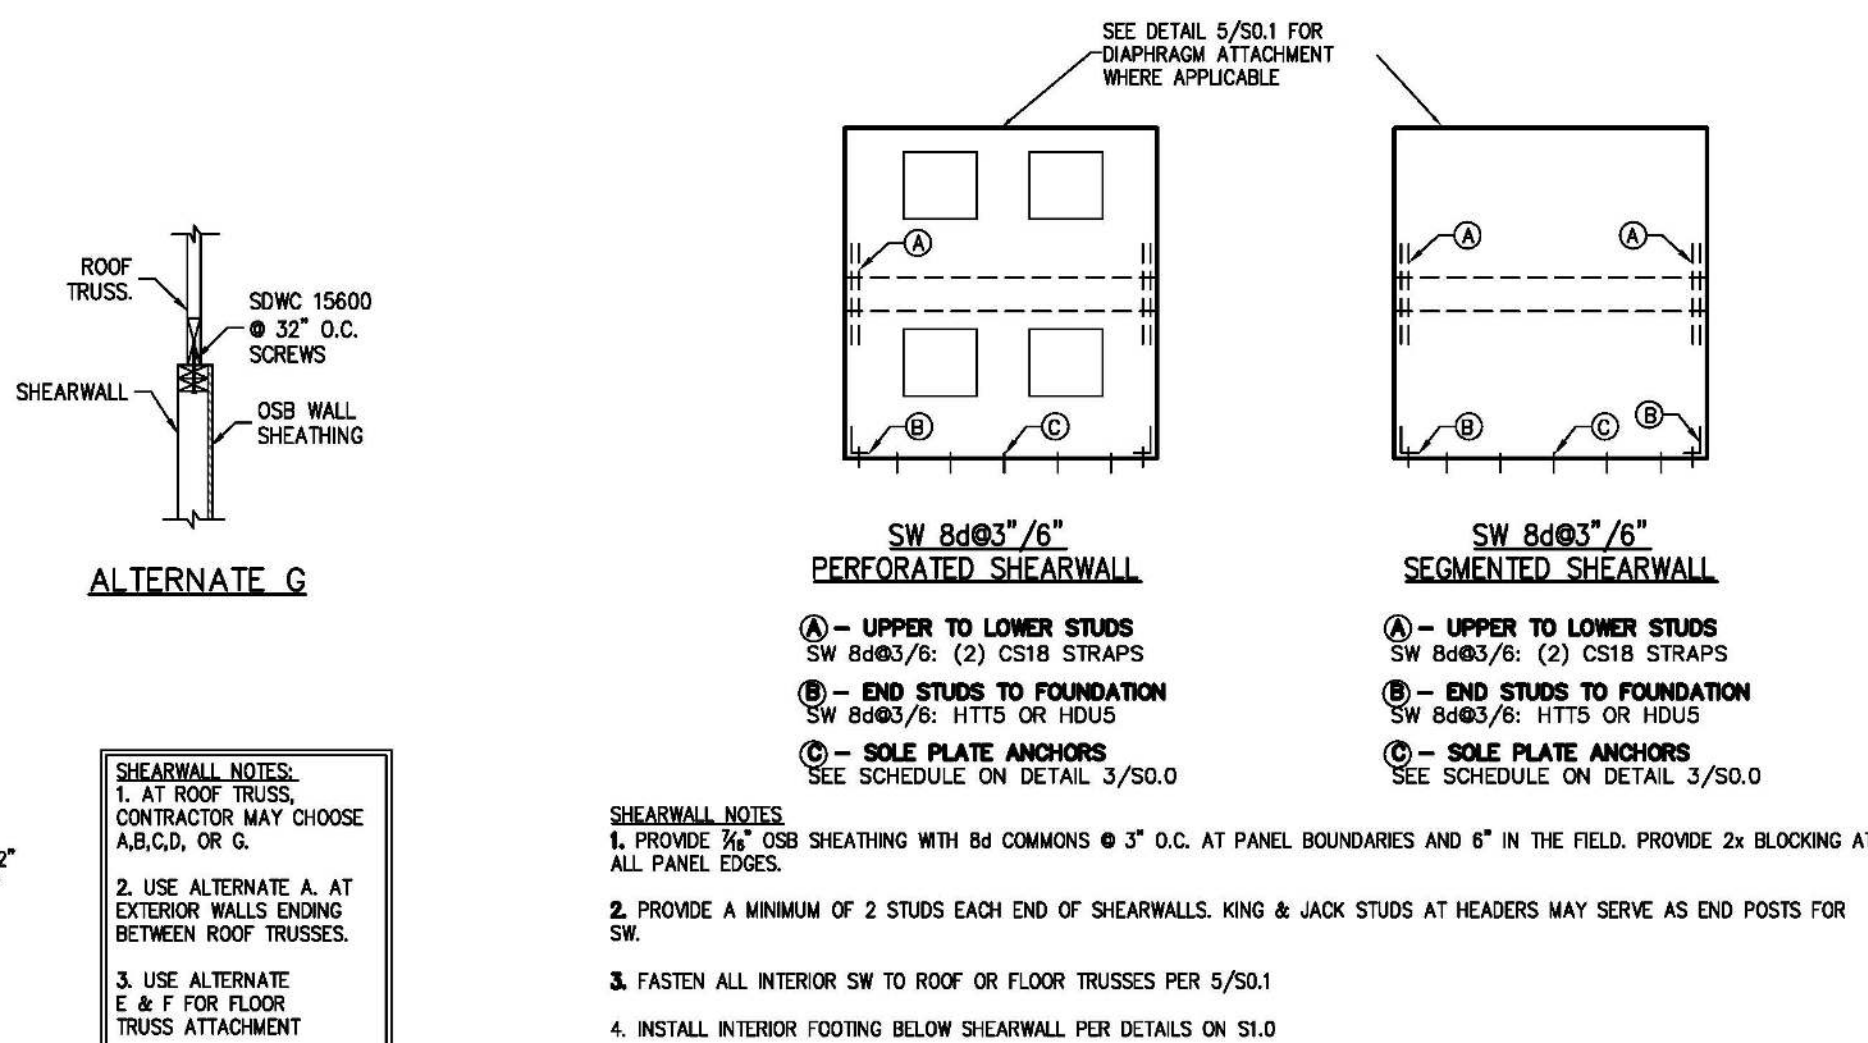

6 TYPICAL SHEARWALL ELEVATION SO.1 PROVIDE SOLID BLOCKING WITHIN FLOOR SYSTEM AT SW END POSTS.

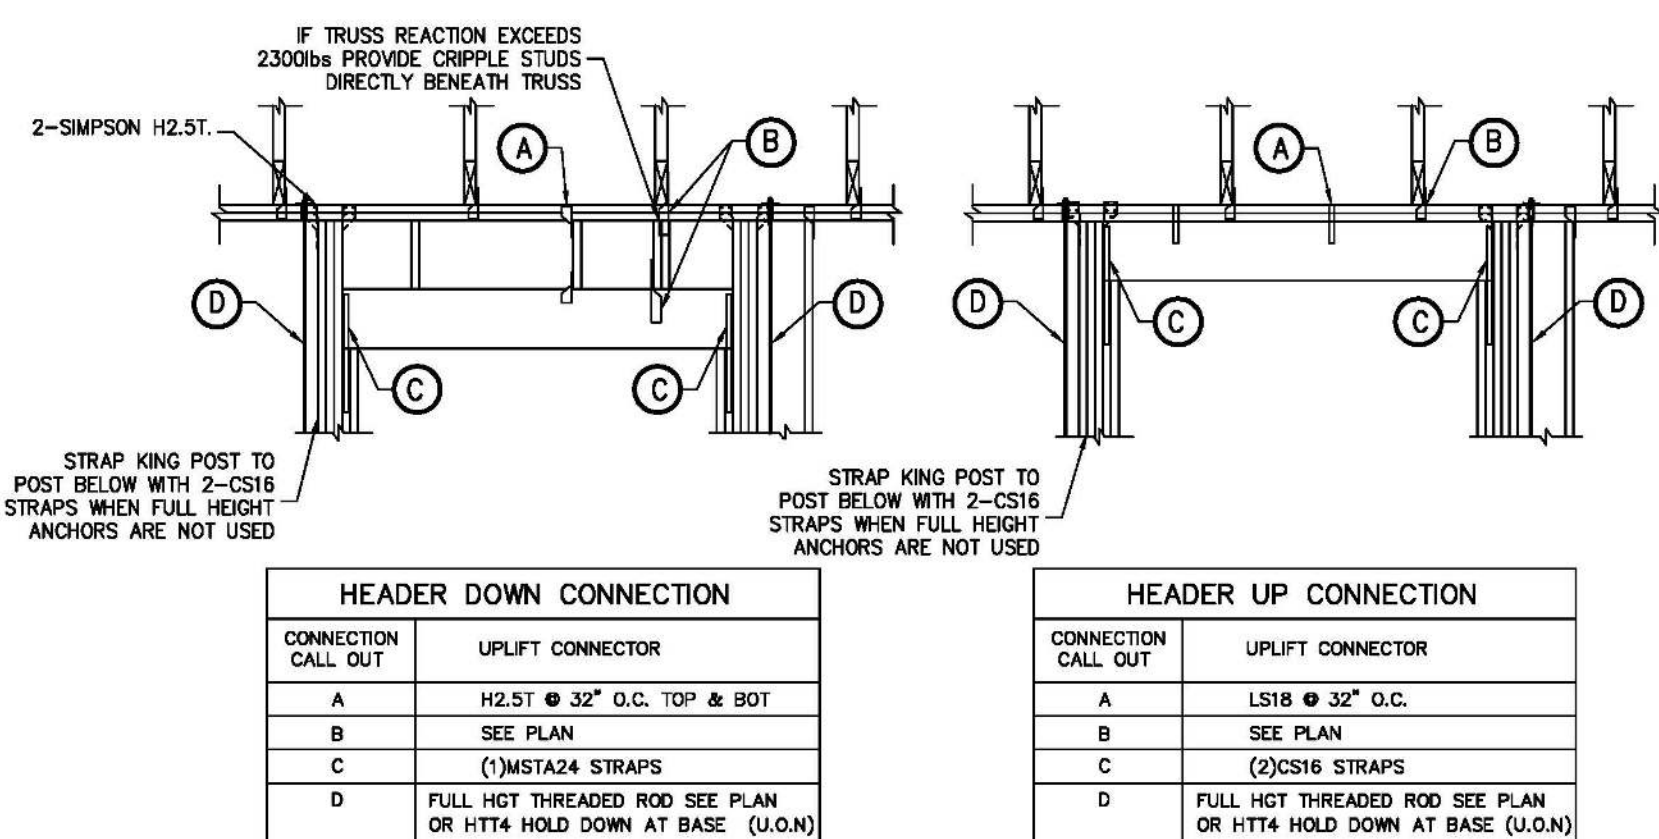


7 HEADER TIE DOWN WHEN NOTED SO.1 THIS DETAIL ONLY APPLIES WHEN NOTED ON PLAN

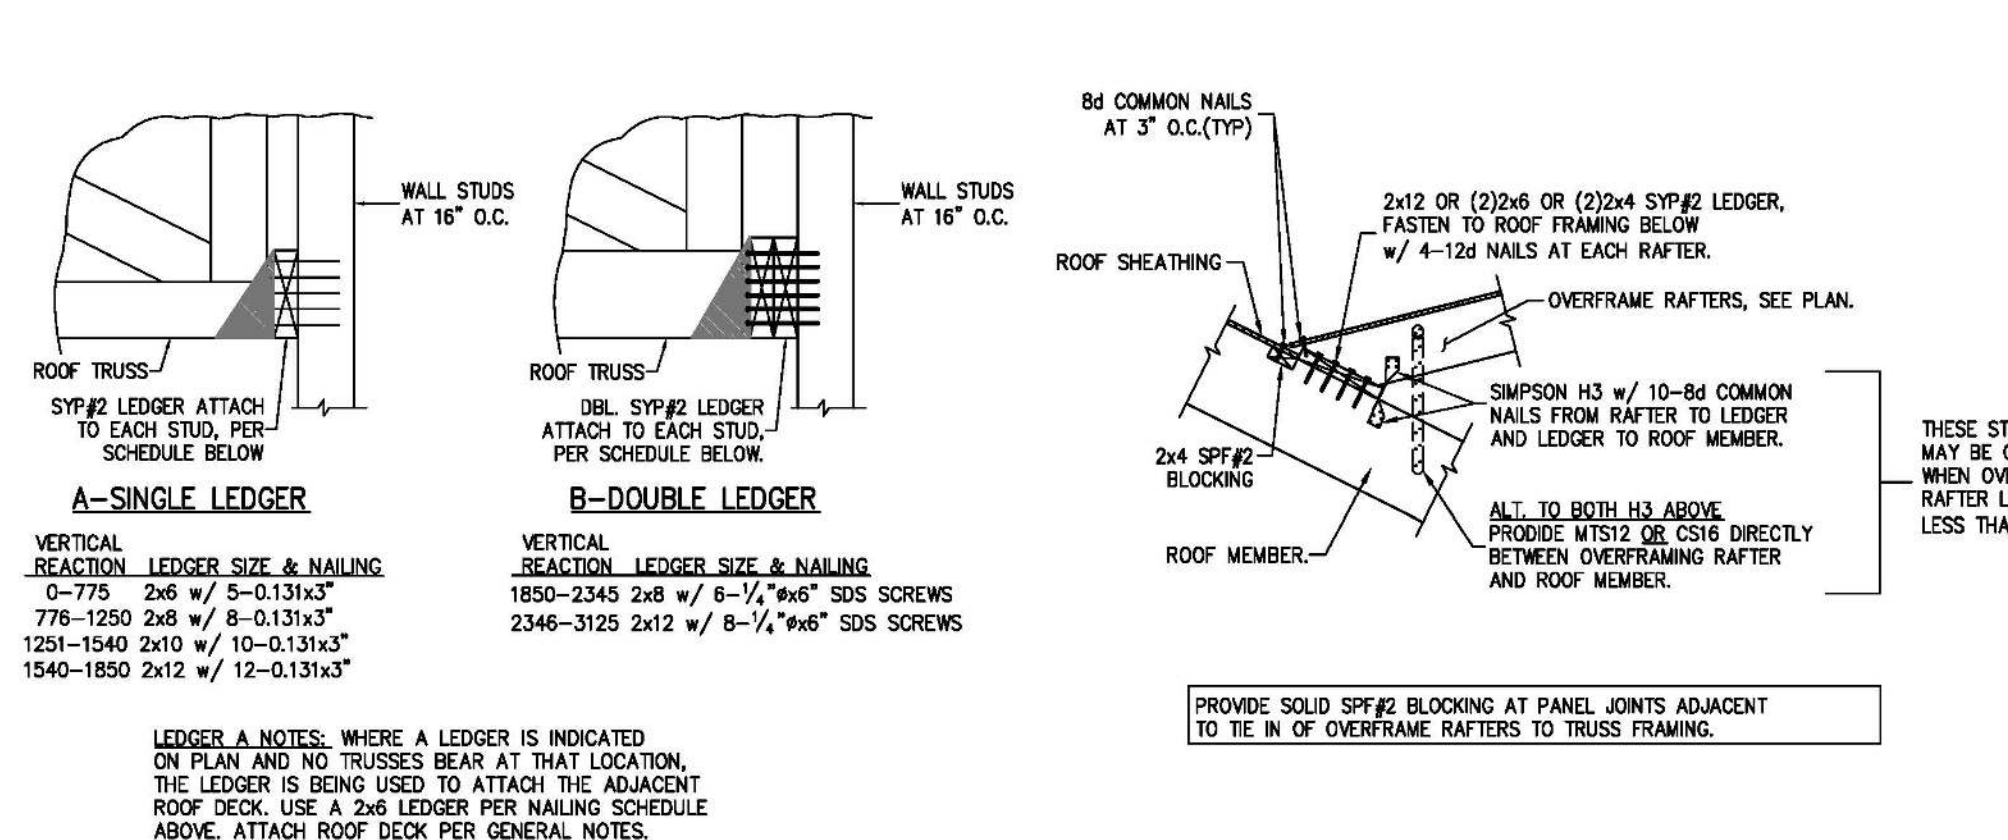


8 LEDGER CONNECTION WHEN NOTED SO.1 TRUSS TO LEDGER CONNECTION BY TRUSS ENGINEER, NOT SHOWN FOR CLARITY


9 DECK LEDGER AT OVERFRAME RAFTERS WHEN NOTED SO.1 USE THIS DETAIL TO FASTEN OVERFRAMED ROOFS, VALLEYS, ETC.

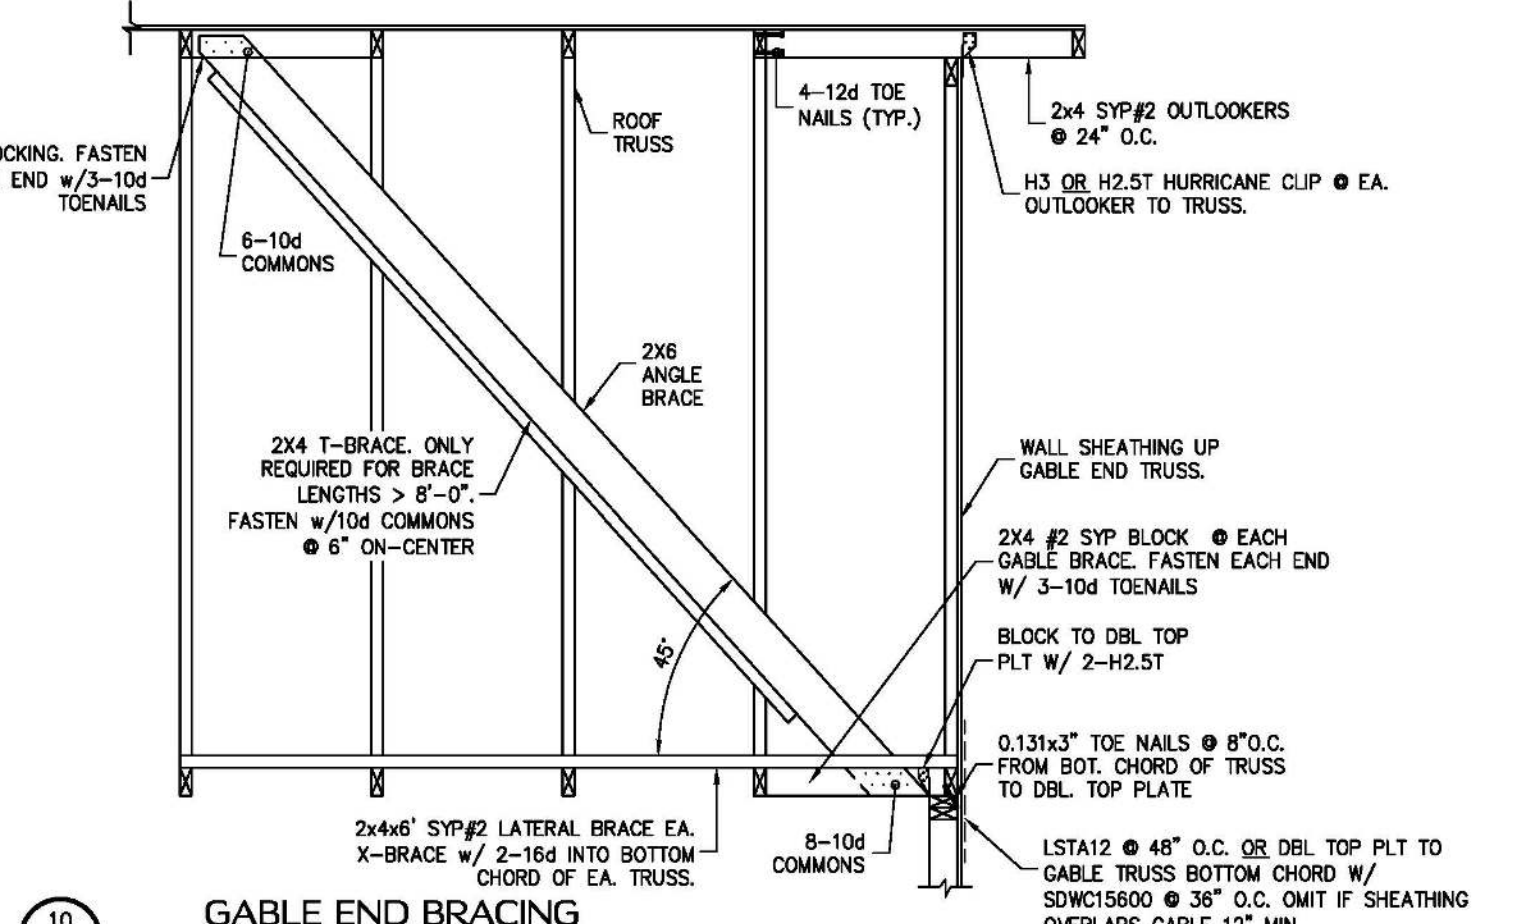


10 GABLE END BRACING SO.1 NOTES: 1. SPACE GABLE END BRACING @ 4'-6" MAX. 2. ALL MATERIAL TO BE SYP#2

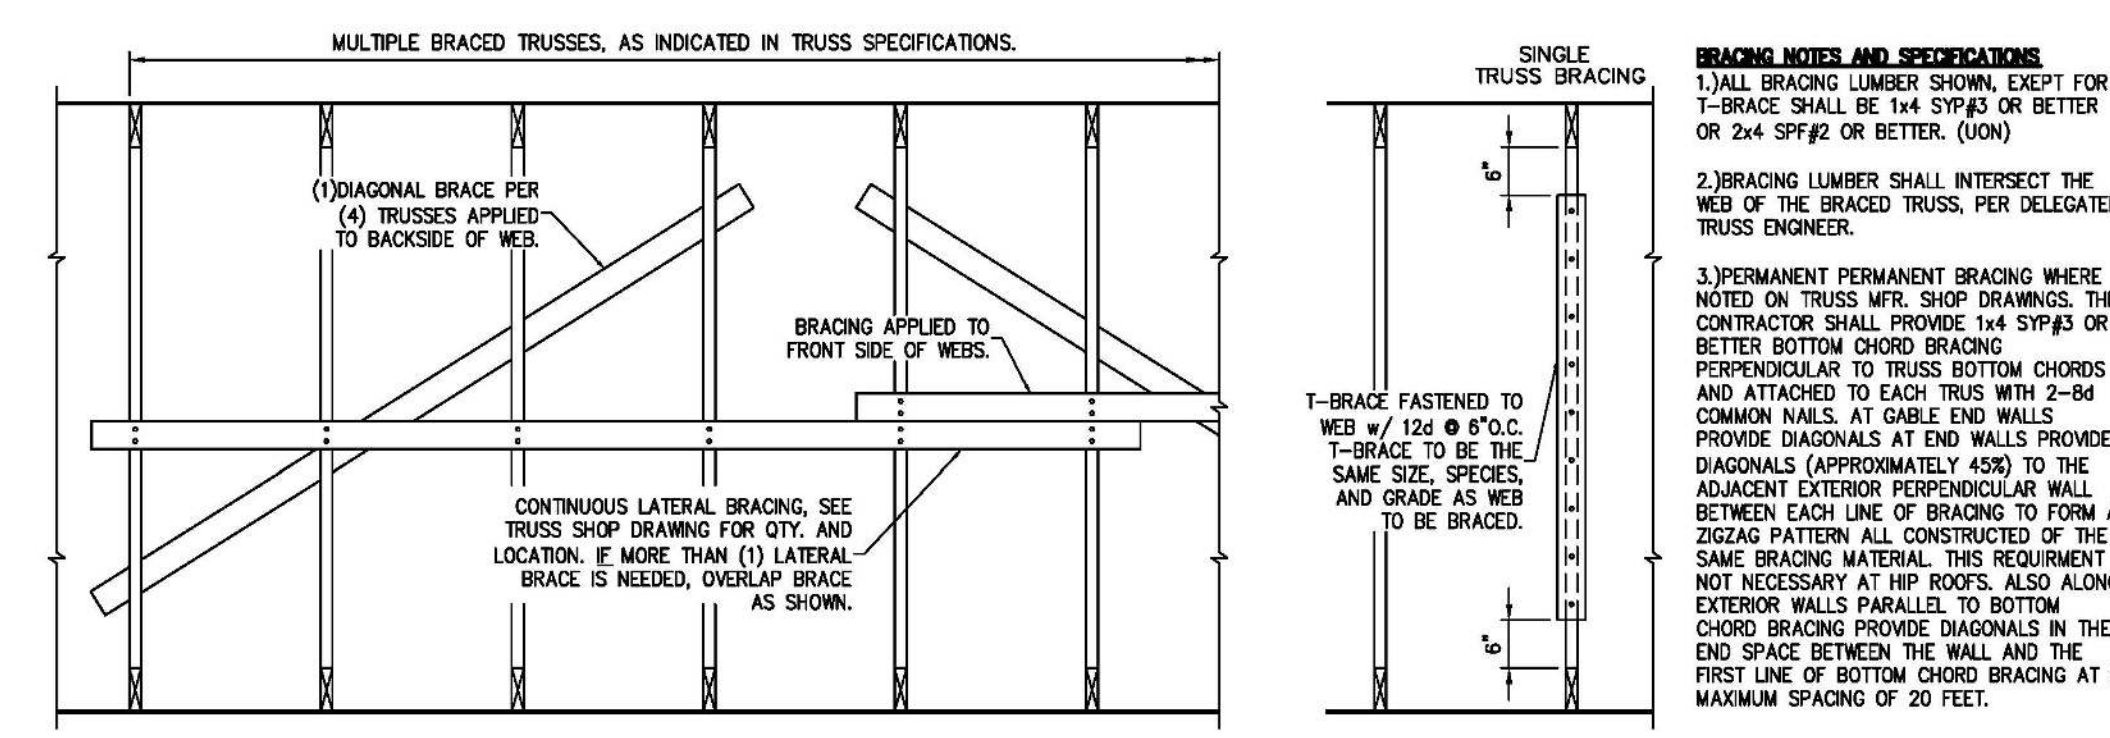

11 PERMANENT TRUSS BRACING SO.1 SCALE: 3/4" = 1'-0"

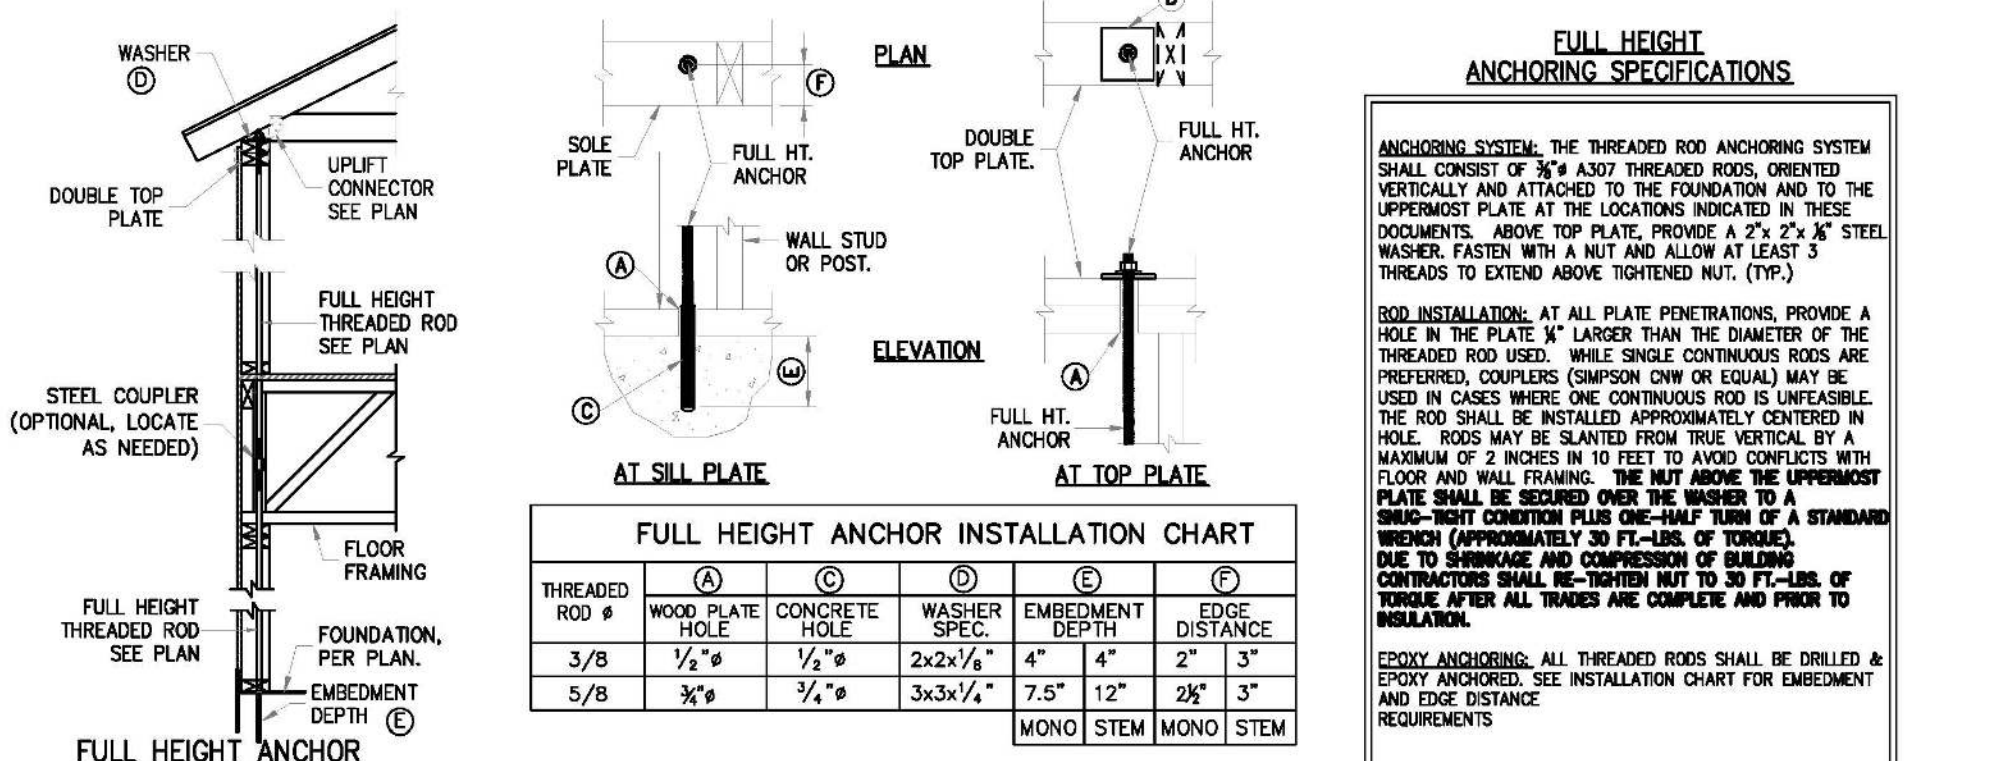


12 FULL HEIGHT WOOD FRAME WALL ANCHORING SYSTEM SO.1 THIS DETAIL ONLY APPLIES WHEN NOTED ON PLAN

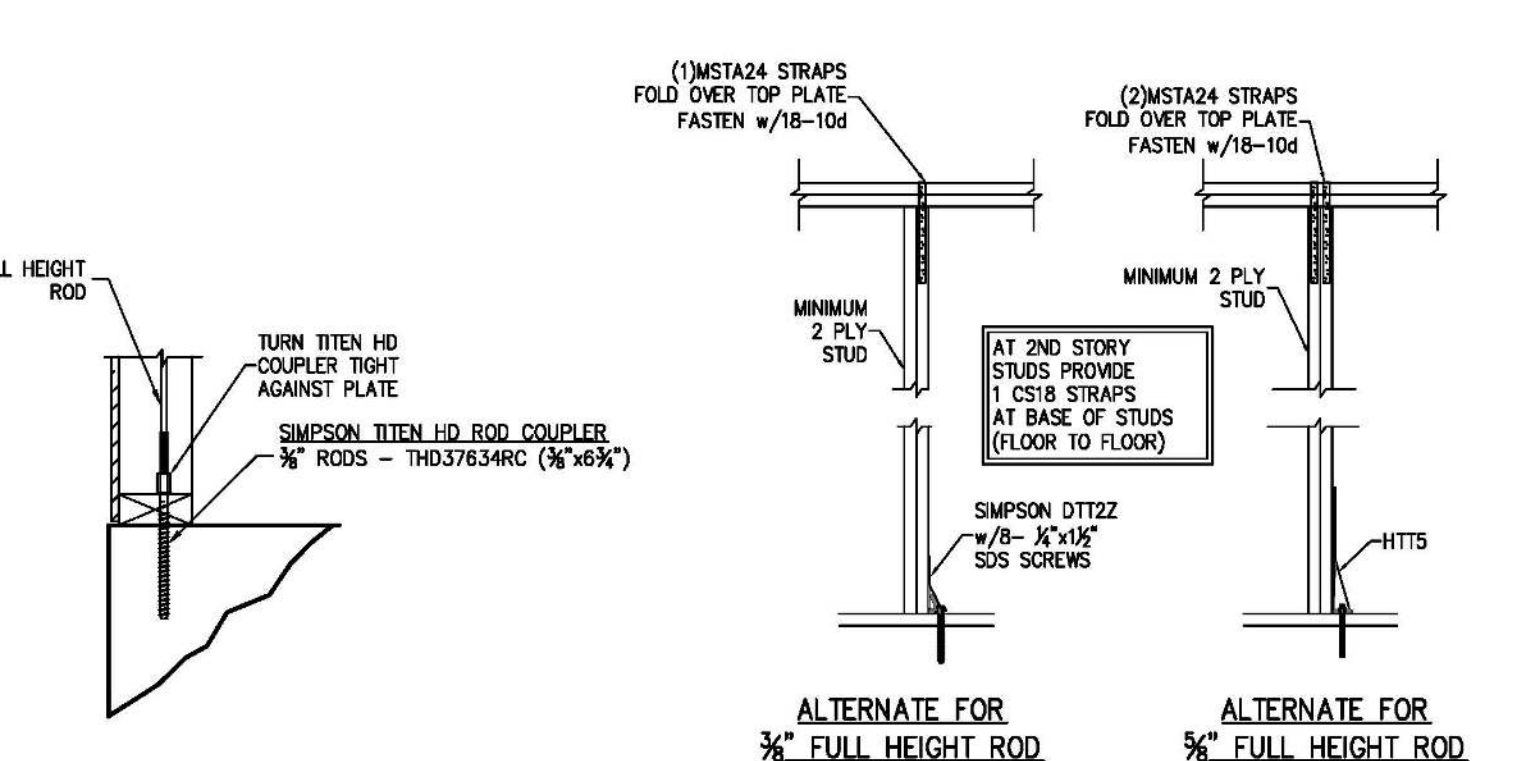

13 3/8" FULL HEIGHT ROD ALTERNATE ATTACHMENT SO.1

14 FULL HEIGHT THREADED ROD ALTERNATE SO.1

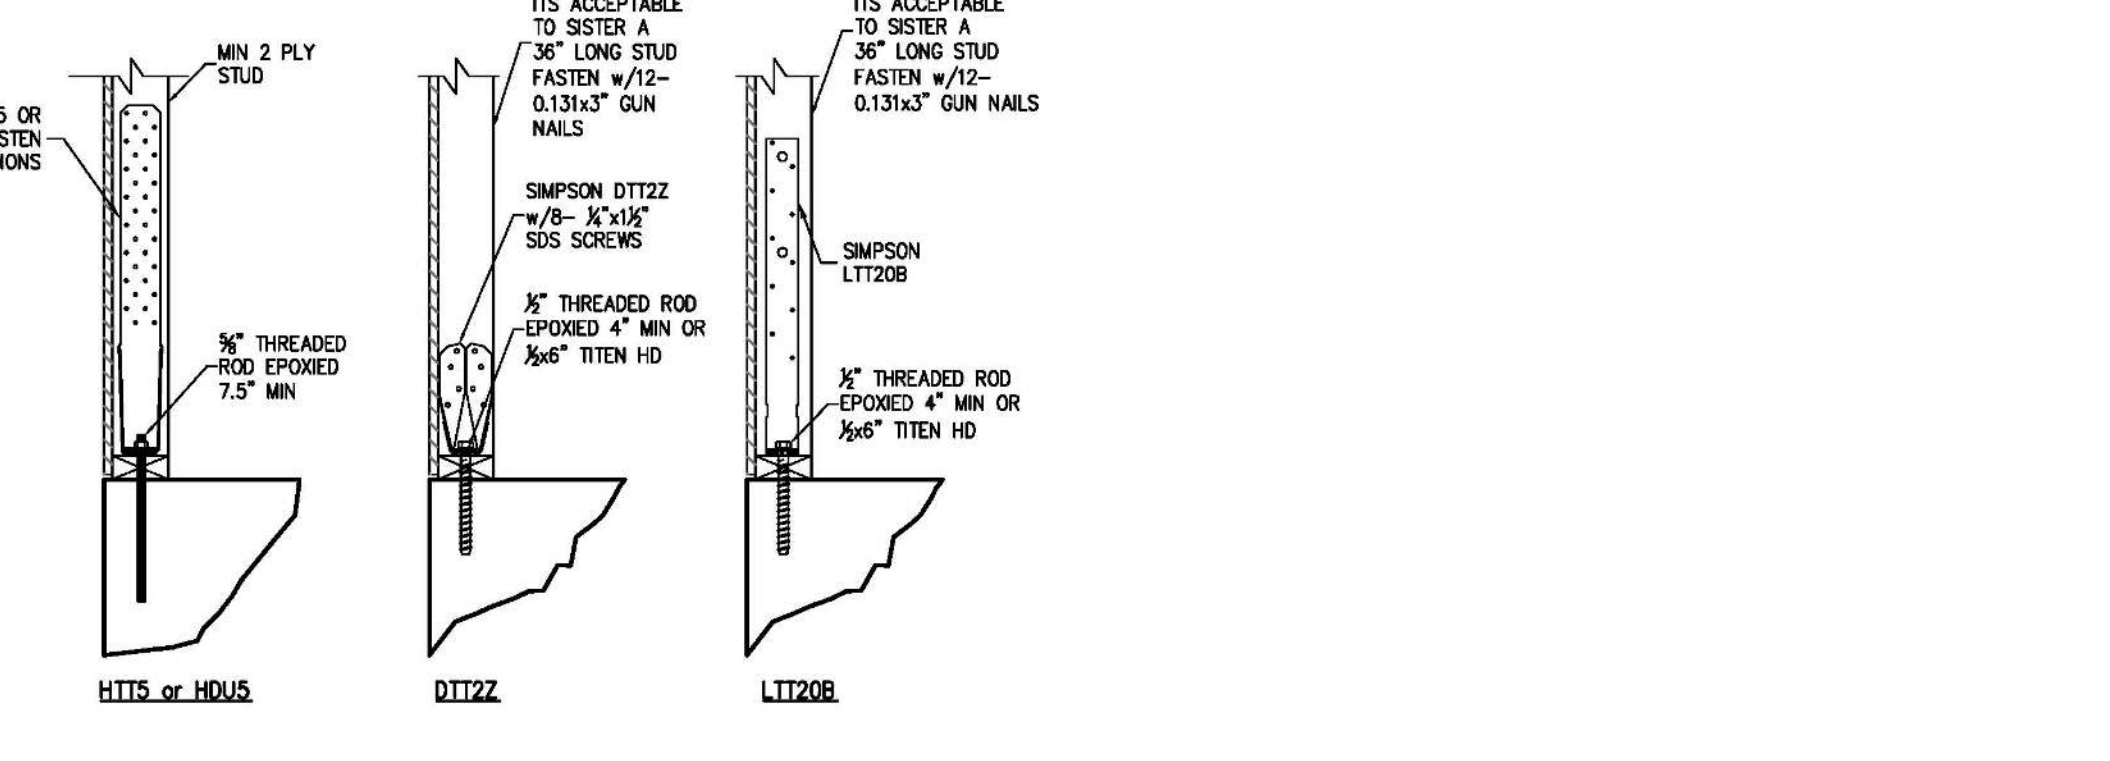

15 HOLD DOWN ATTACHMENT DETAIL SO.1



Christopher J. Sabourin
FL PE#71461

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
BZEC MODEL HOME
SSE No.
20-0187

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR
THE LANCASTER 1752F-L
MODEL AT WOOBOROUGH

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO
STRUCTURAL ENGINEERING PRIOR TO
MAKING ANY STRUCTURAL FIELD
MODIFICATIONS WHICH MAY VARY
FROM THE INTENT OF THE ORIGINAL
CONSTRUCTION DOCUMENTS. ANY
FIELD ALTERATIONS MADE PRIOR TO
BEING APPROVED BY CHRISTOPHER
SABOURIN MAY RESULT IN ADDITIONAL
ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM
THESE DRAWINGS. IF A DIMENSION IS
UNCLEAR, REFER TO THE
ARCHITECTURAL DRAWINGS OR
CONTACT THE E.O.B.

DESIGN
CRITERIA
AND
GENERAL
NOTES

SHEET
So.1
SHEET 2 OF 7

SYMBOLS LEGEND	
	DESIGNATES FOOTING LINE
	DESIGNATES SAWCUT LINE
	INTERIOR LOAD BEARING WALL
	DESIGNATES SLAB RECESS



07.17.20
Christopher J Sabourin
FL PE#71461

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME BZEC MODEL HOME	
SSE No. 20-0187	

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE


STRUCTURAL ENGINEERING FOR
THE LANCASTER 1752F-L
MODEL AT WOOBOROUGH

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO
STRUCTURAL ENGINEERING PRIOR TO
MAKING ANY STRUCTURAL FIELD
MODIFICATIONS WHICH MAY VARY
FROM THE INTENT OF THE ORIGINAL
CONSTRUCTION DOCUMENTS. ANY
FIELD ALTERATIONS MADE PRIOR TO
BEING APPROVED BY CHRISTOPHER
SABOURIN MAY RESULT IN ADDITIONAL
ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM
THESE DRAWINGS. IF A DIMENSION IS
UNCLEAR REFER TO THE
ARCHITECTURAL DRAWINGS OR
CONTACT THE E.O.B.


FOUNDATION
PLAN

SHEET
S1.0
SHEET 3 OF 7

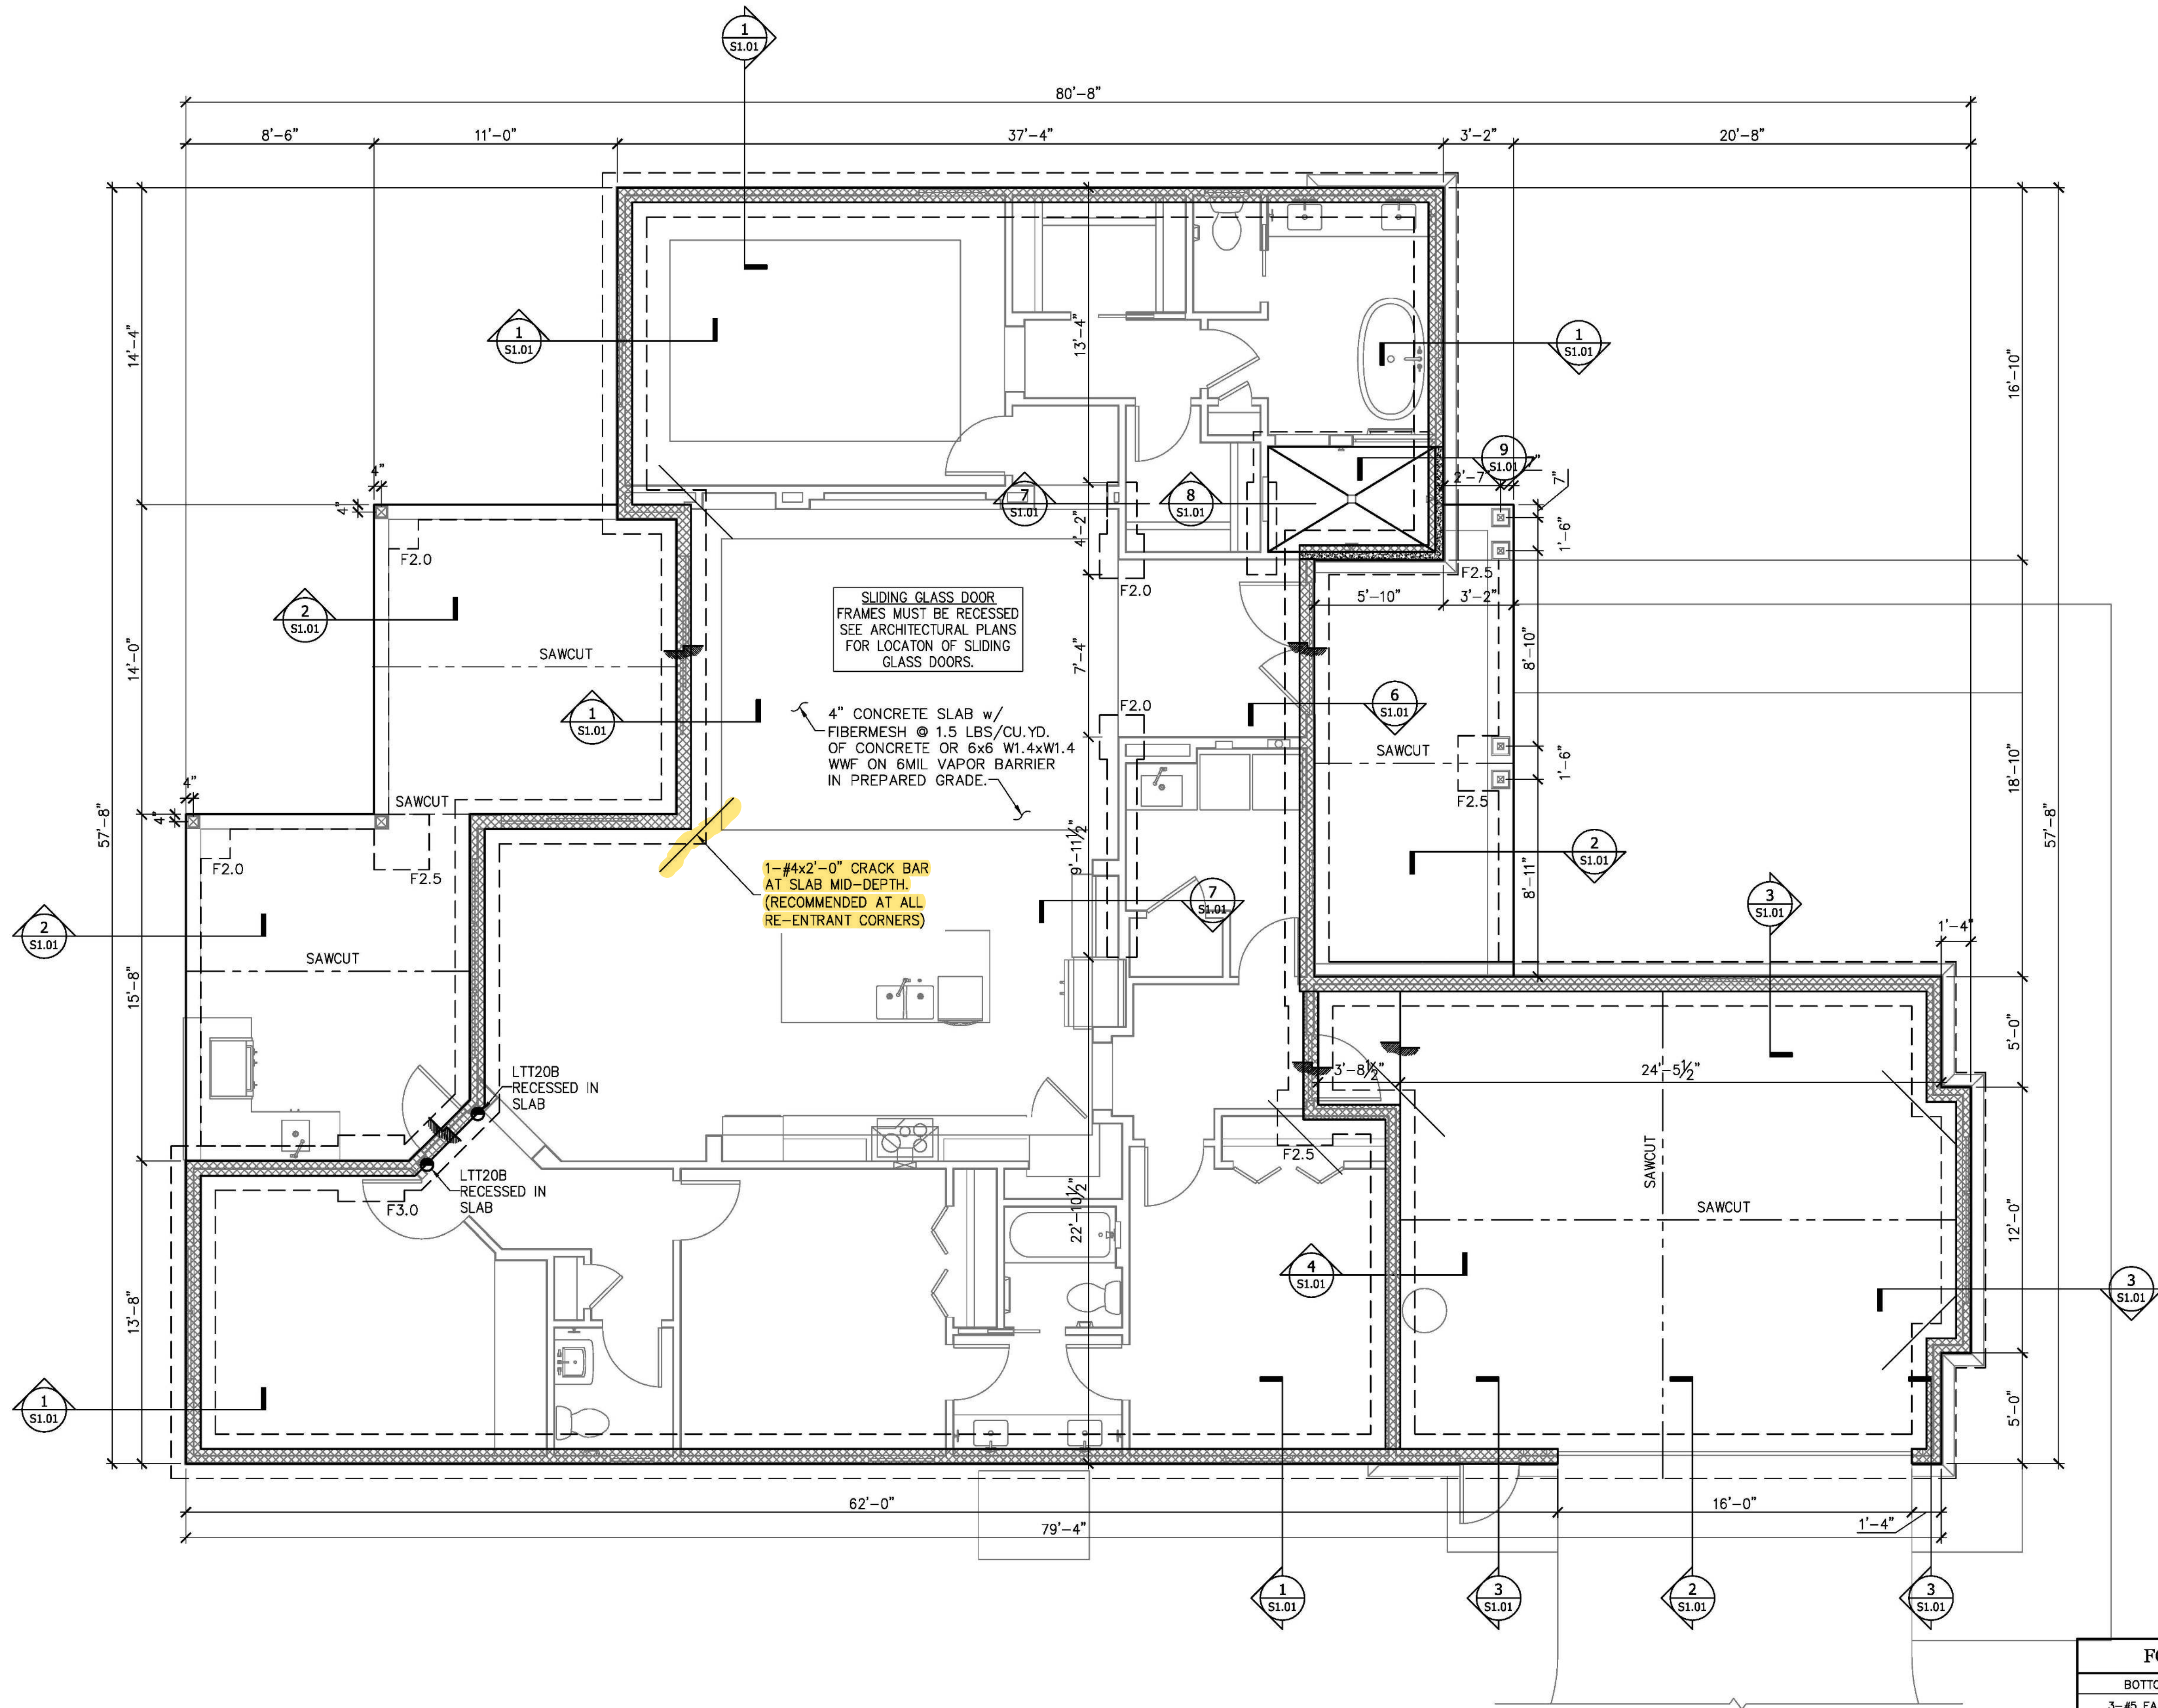


FOUNDATION PLAN
SCALE: 1/4" = 1'-0"


FOOTING SCHEDULE AND NOTES				
BOTTOM BARS	DEPTH	WIDTH	LENGTH	TYPE
3-#5 EA. WAY BOT.	1'-0"	2'-0"	2'-0"	F2.0
3-#5 EA. WAY BOT.	1'-0"	2'-6"	2'-6"	F2.5
3-#5 EA. WAY BOT.	1'-0"	3'-0"	3'-0"	F3.0
4-#5 EA. WAY BOT.	1'-0"	3'-6"	3'-6"	F3.5
4-#5 EA. WAY BOT.	1'-0"	4'-0"	4'-0"	F4.0
4-#5 EA. WAY BOT.	1'-0"	4'-6"	4'-6"	F4.5
1. THIS FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFO. RELATED TO THE FOUNDATION. FOR GENERAL FEATURES, DIMENSIONS, CONDUITS, ELECTRICAL EMBEDS, STEP HEIGHTS, ECT., SEE ARCH. PLAN. ARCHITECTURAL PLAN SHOWN HERE IN FOR REFERENCE ONLY.				
2. FTGS. & FND. SHALL BE IN ACCORDANCE W/ LOCAL BUILDING CODES.				
3. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557.				

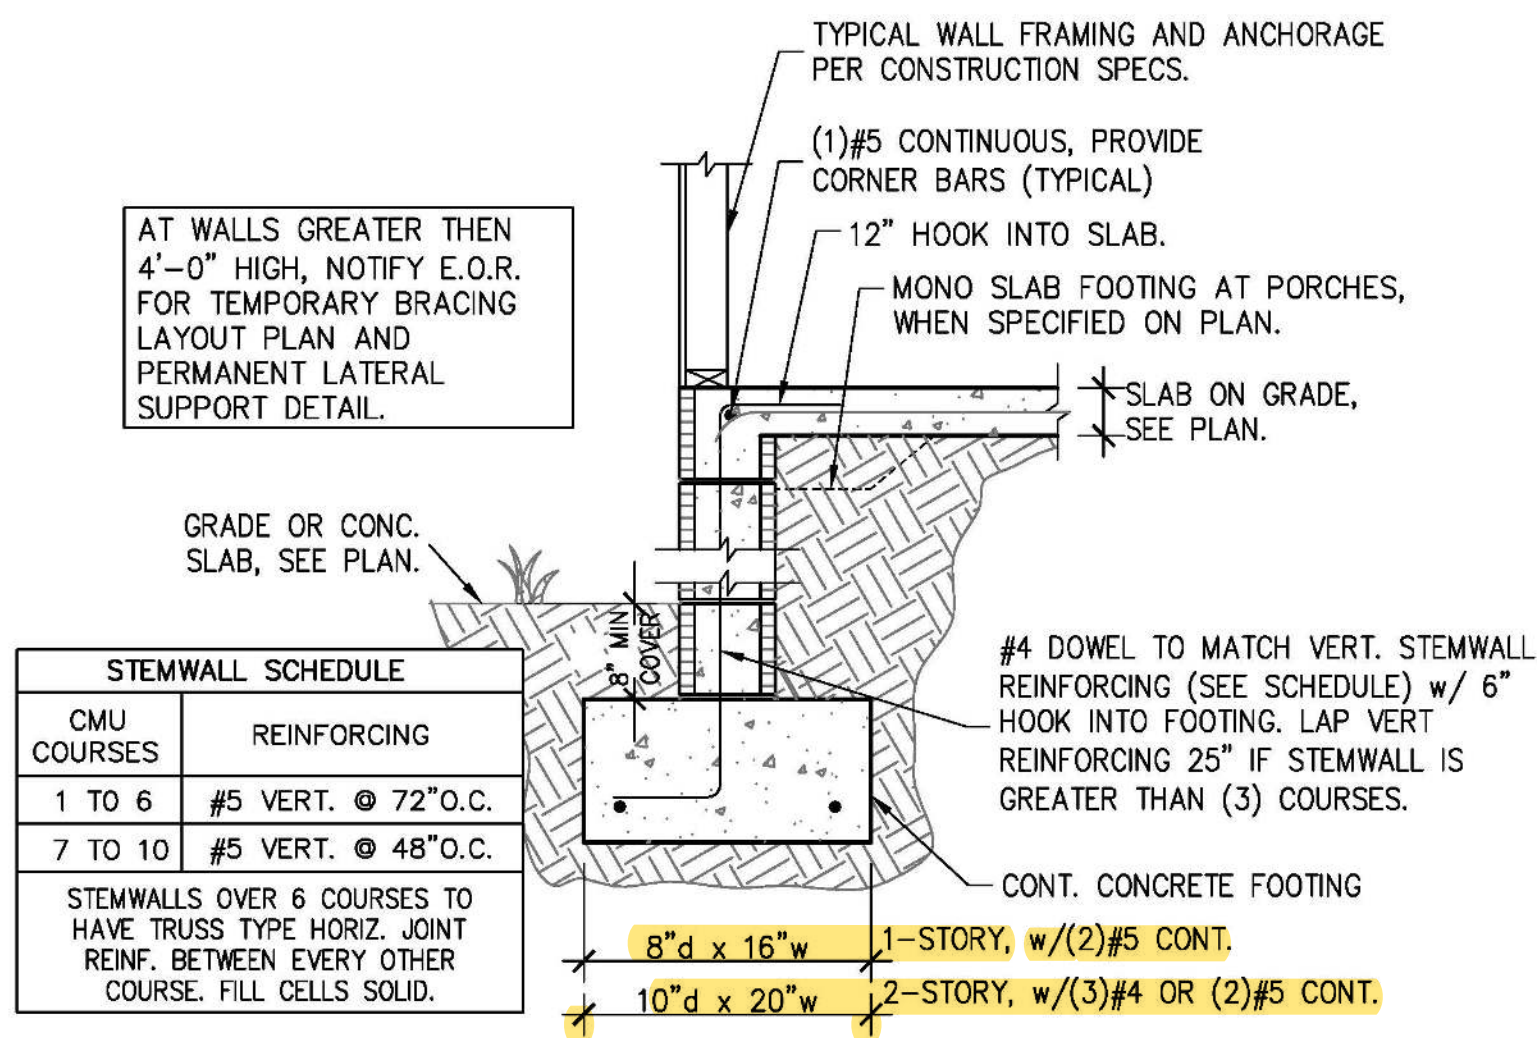


1 STEMWALL FOOTING
S1.01 SCALE: 3/4" = 1'-0"

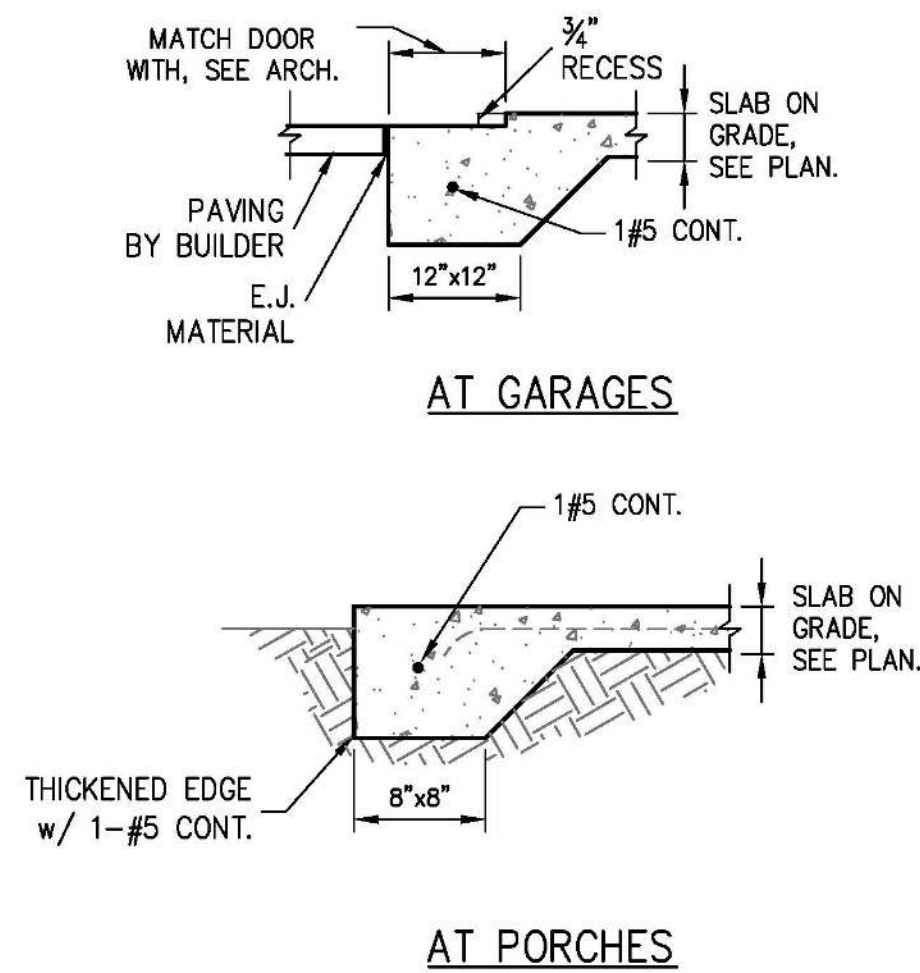


2 THICKENED SLAB
S1.01 SCALE: 3/4" = 1'-0"

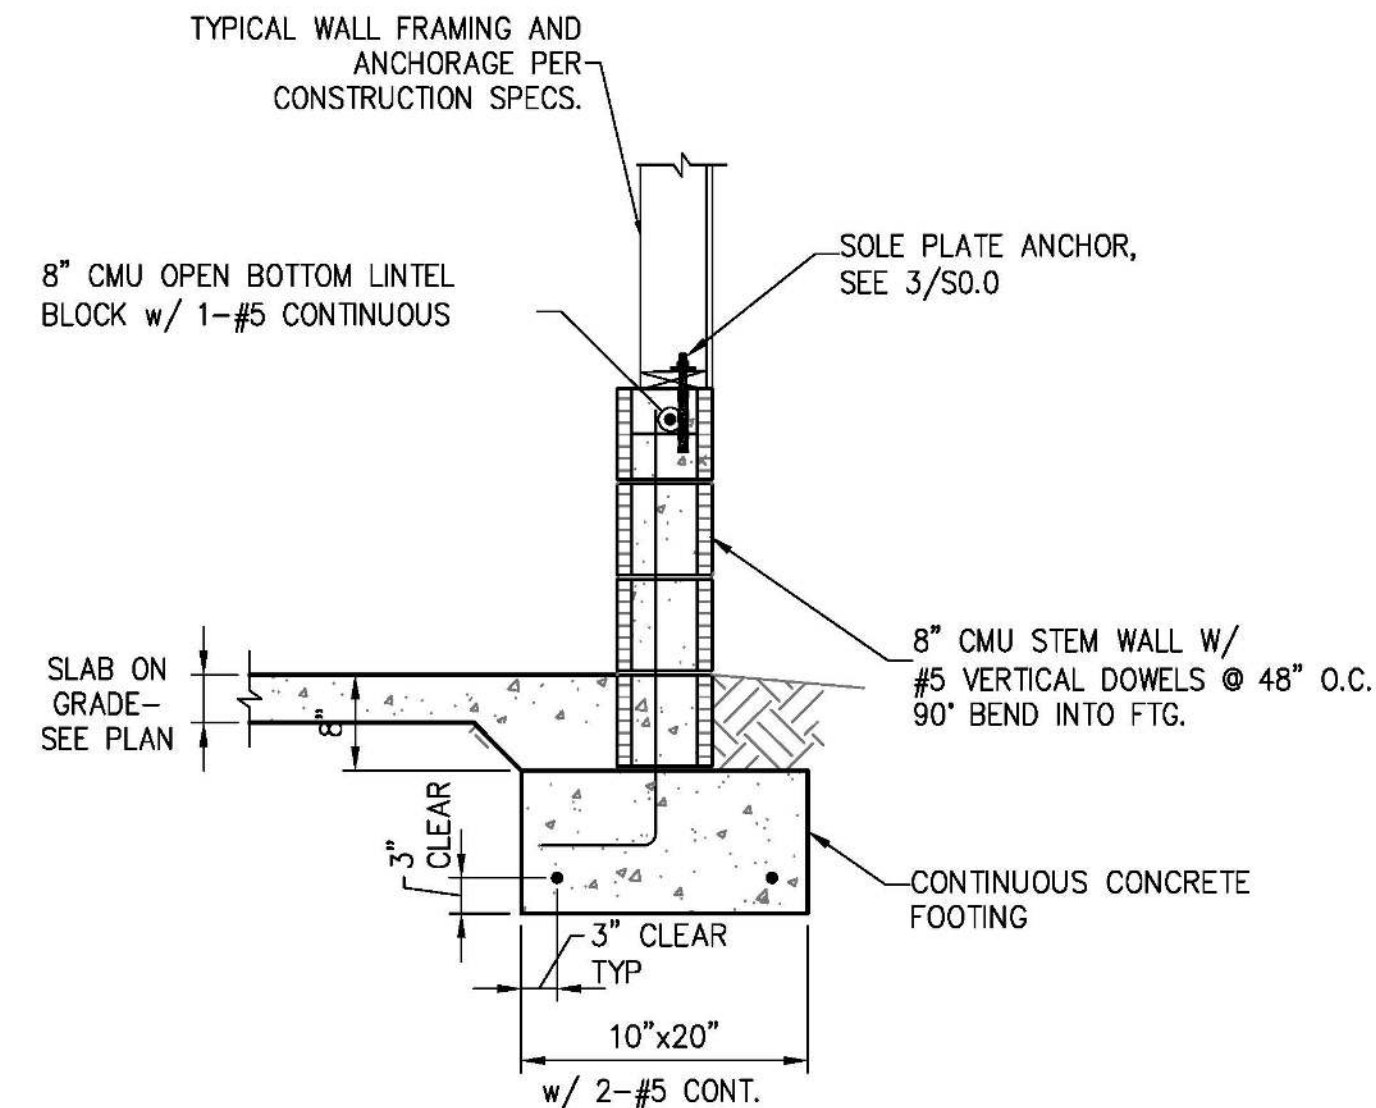


3 GARAGE STEM WALL
S1.01 SCALE: 3/4" = 1'-0"

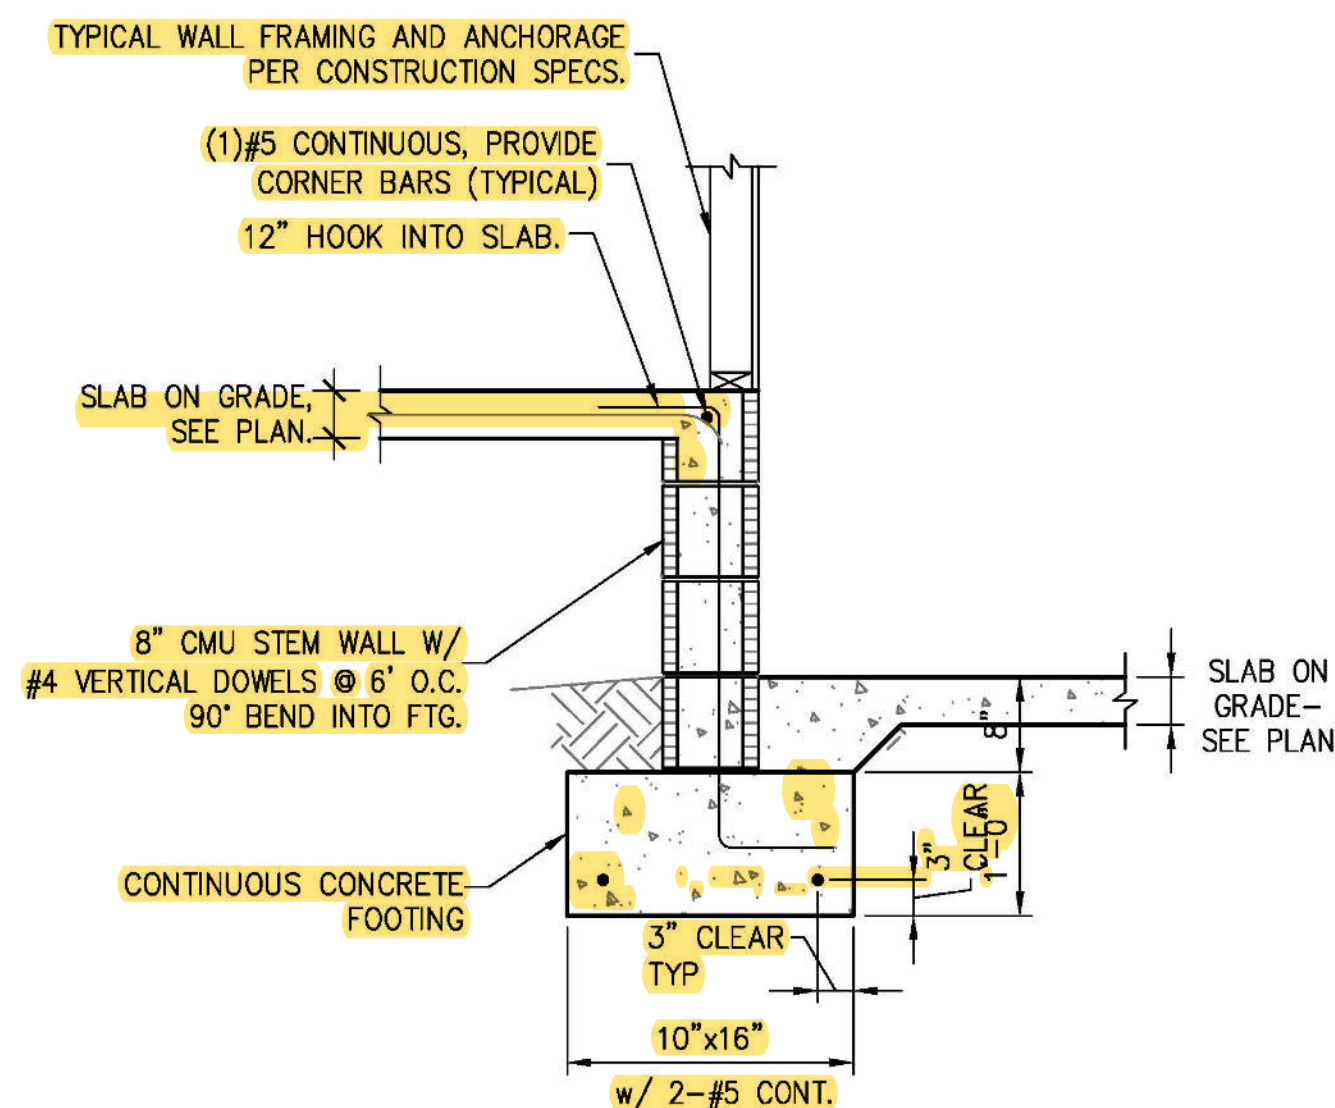


4 STEMWALL AT GARAGE
S1.01 SCALE: 3/4" = 1'-0"

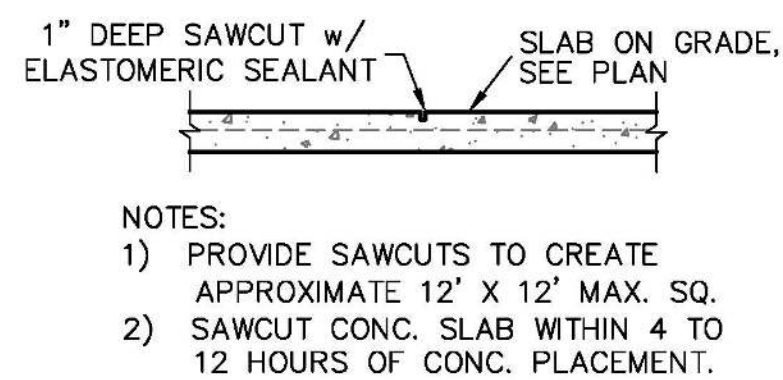


5 SAW CUT DETAIL
S1.01 SCALE: 3/4" = 1'-0"

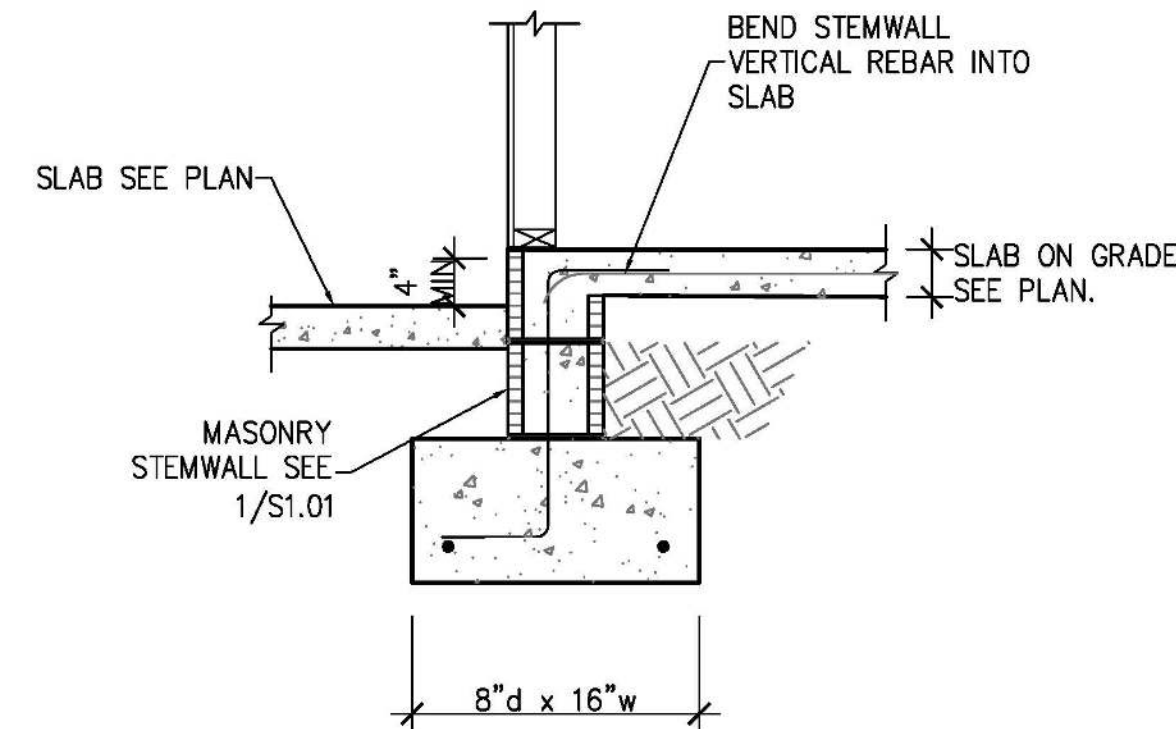


6 STEMWALL FOOTING AT PORCH
S1.01 SCALE: 3/4" = 1'-0"

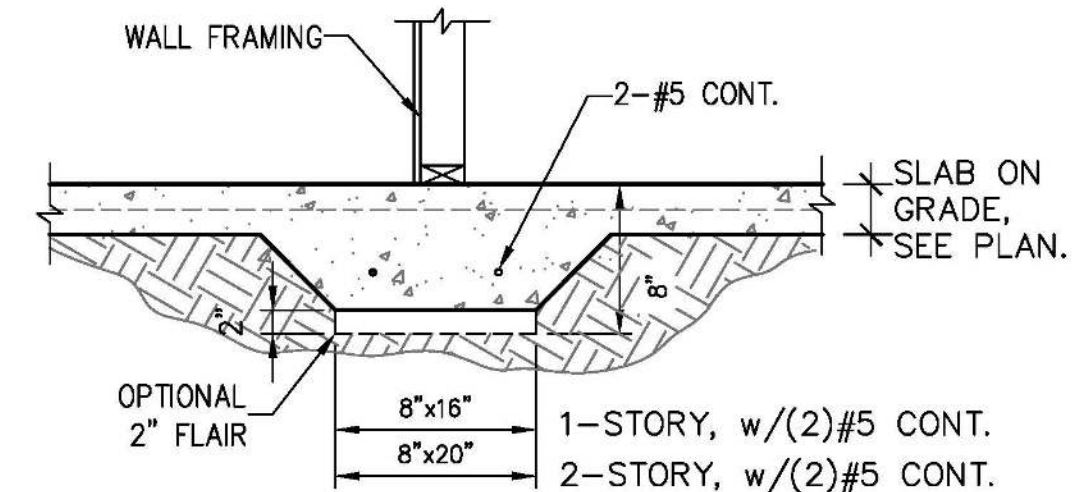


7 BEARING AT INTERIOR
S1.01 SCALE: 3/4" = 1'-0"

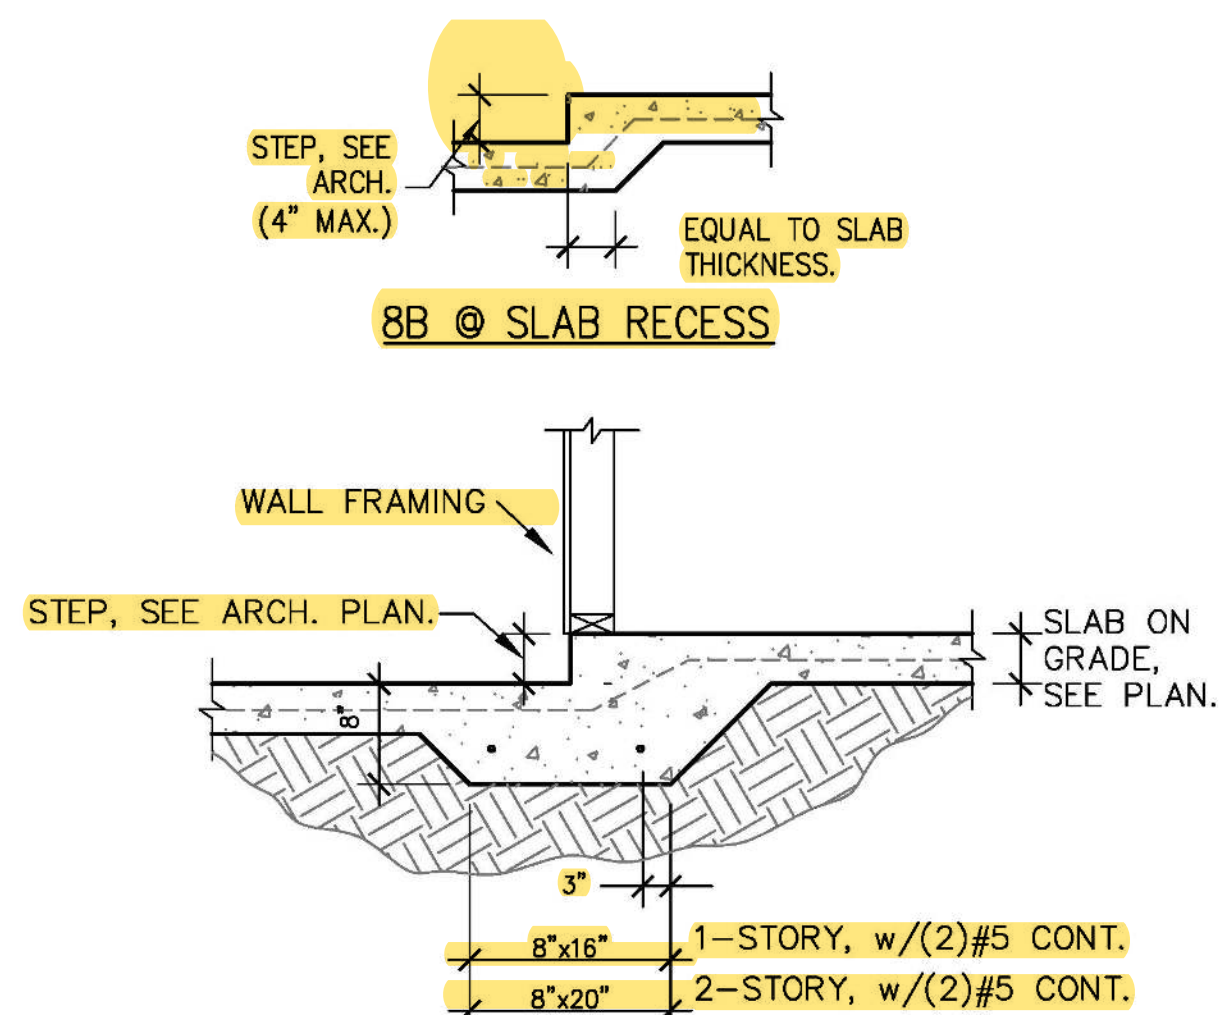

8 MONO. FOOTING AT STEP-DOWN
S1.01 SCALE: 3/4" = 1'-0"

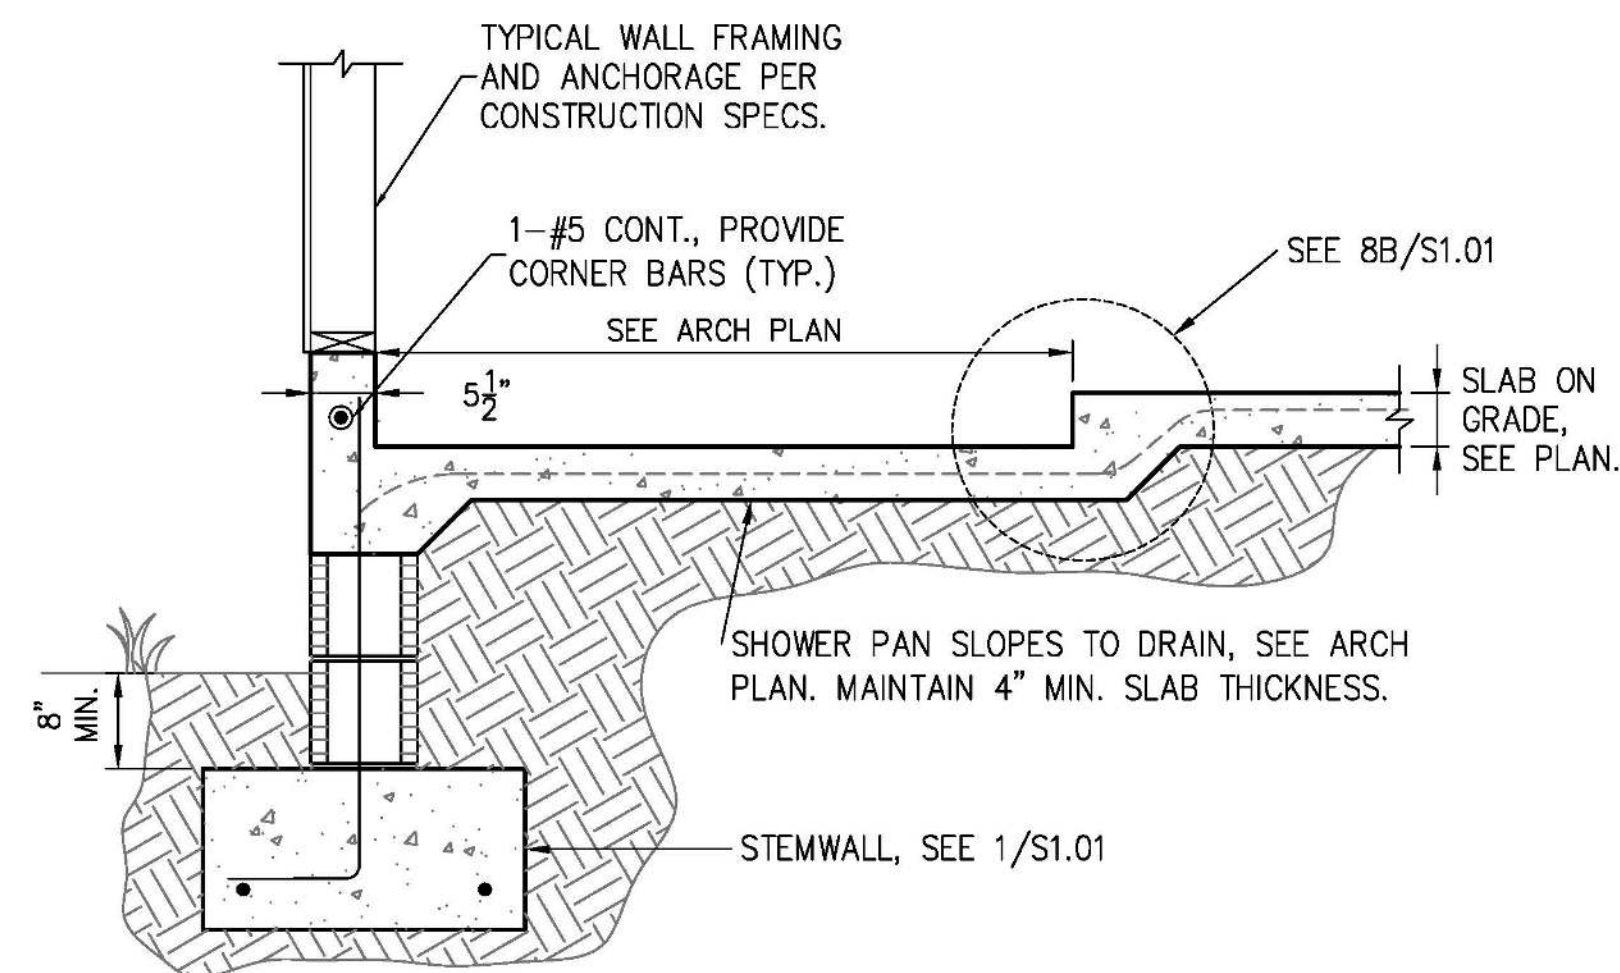

9 FOOTING W/ SHOWER RECESS
S1.01 SCALE: 3/4" = 1'-0"

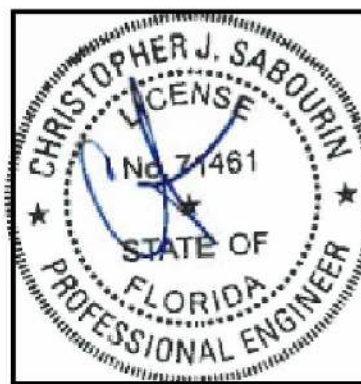

Christopher J. Sabourin
FL PE#71461

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
BZEC MODEL HOME
SSE No.
20-0187

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE


STRUCTURAL ENGINEERING FOR
THE LANCASTER 1752F-L
MODEL AT WOOBOROUGH

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.B.

FOUNDATION
DETAILS

SHEET
S1.01
SHEET 4 OF 7

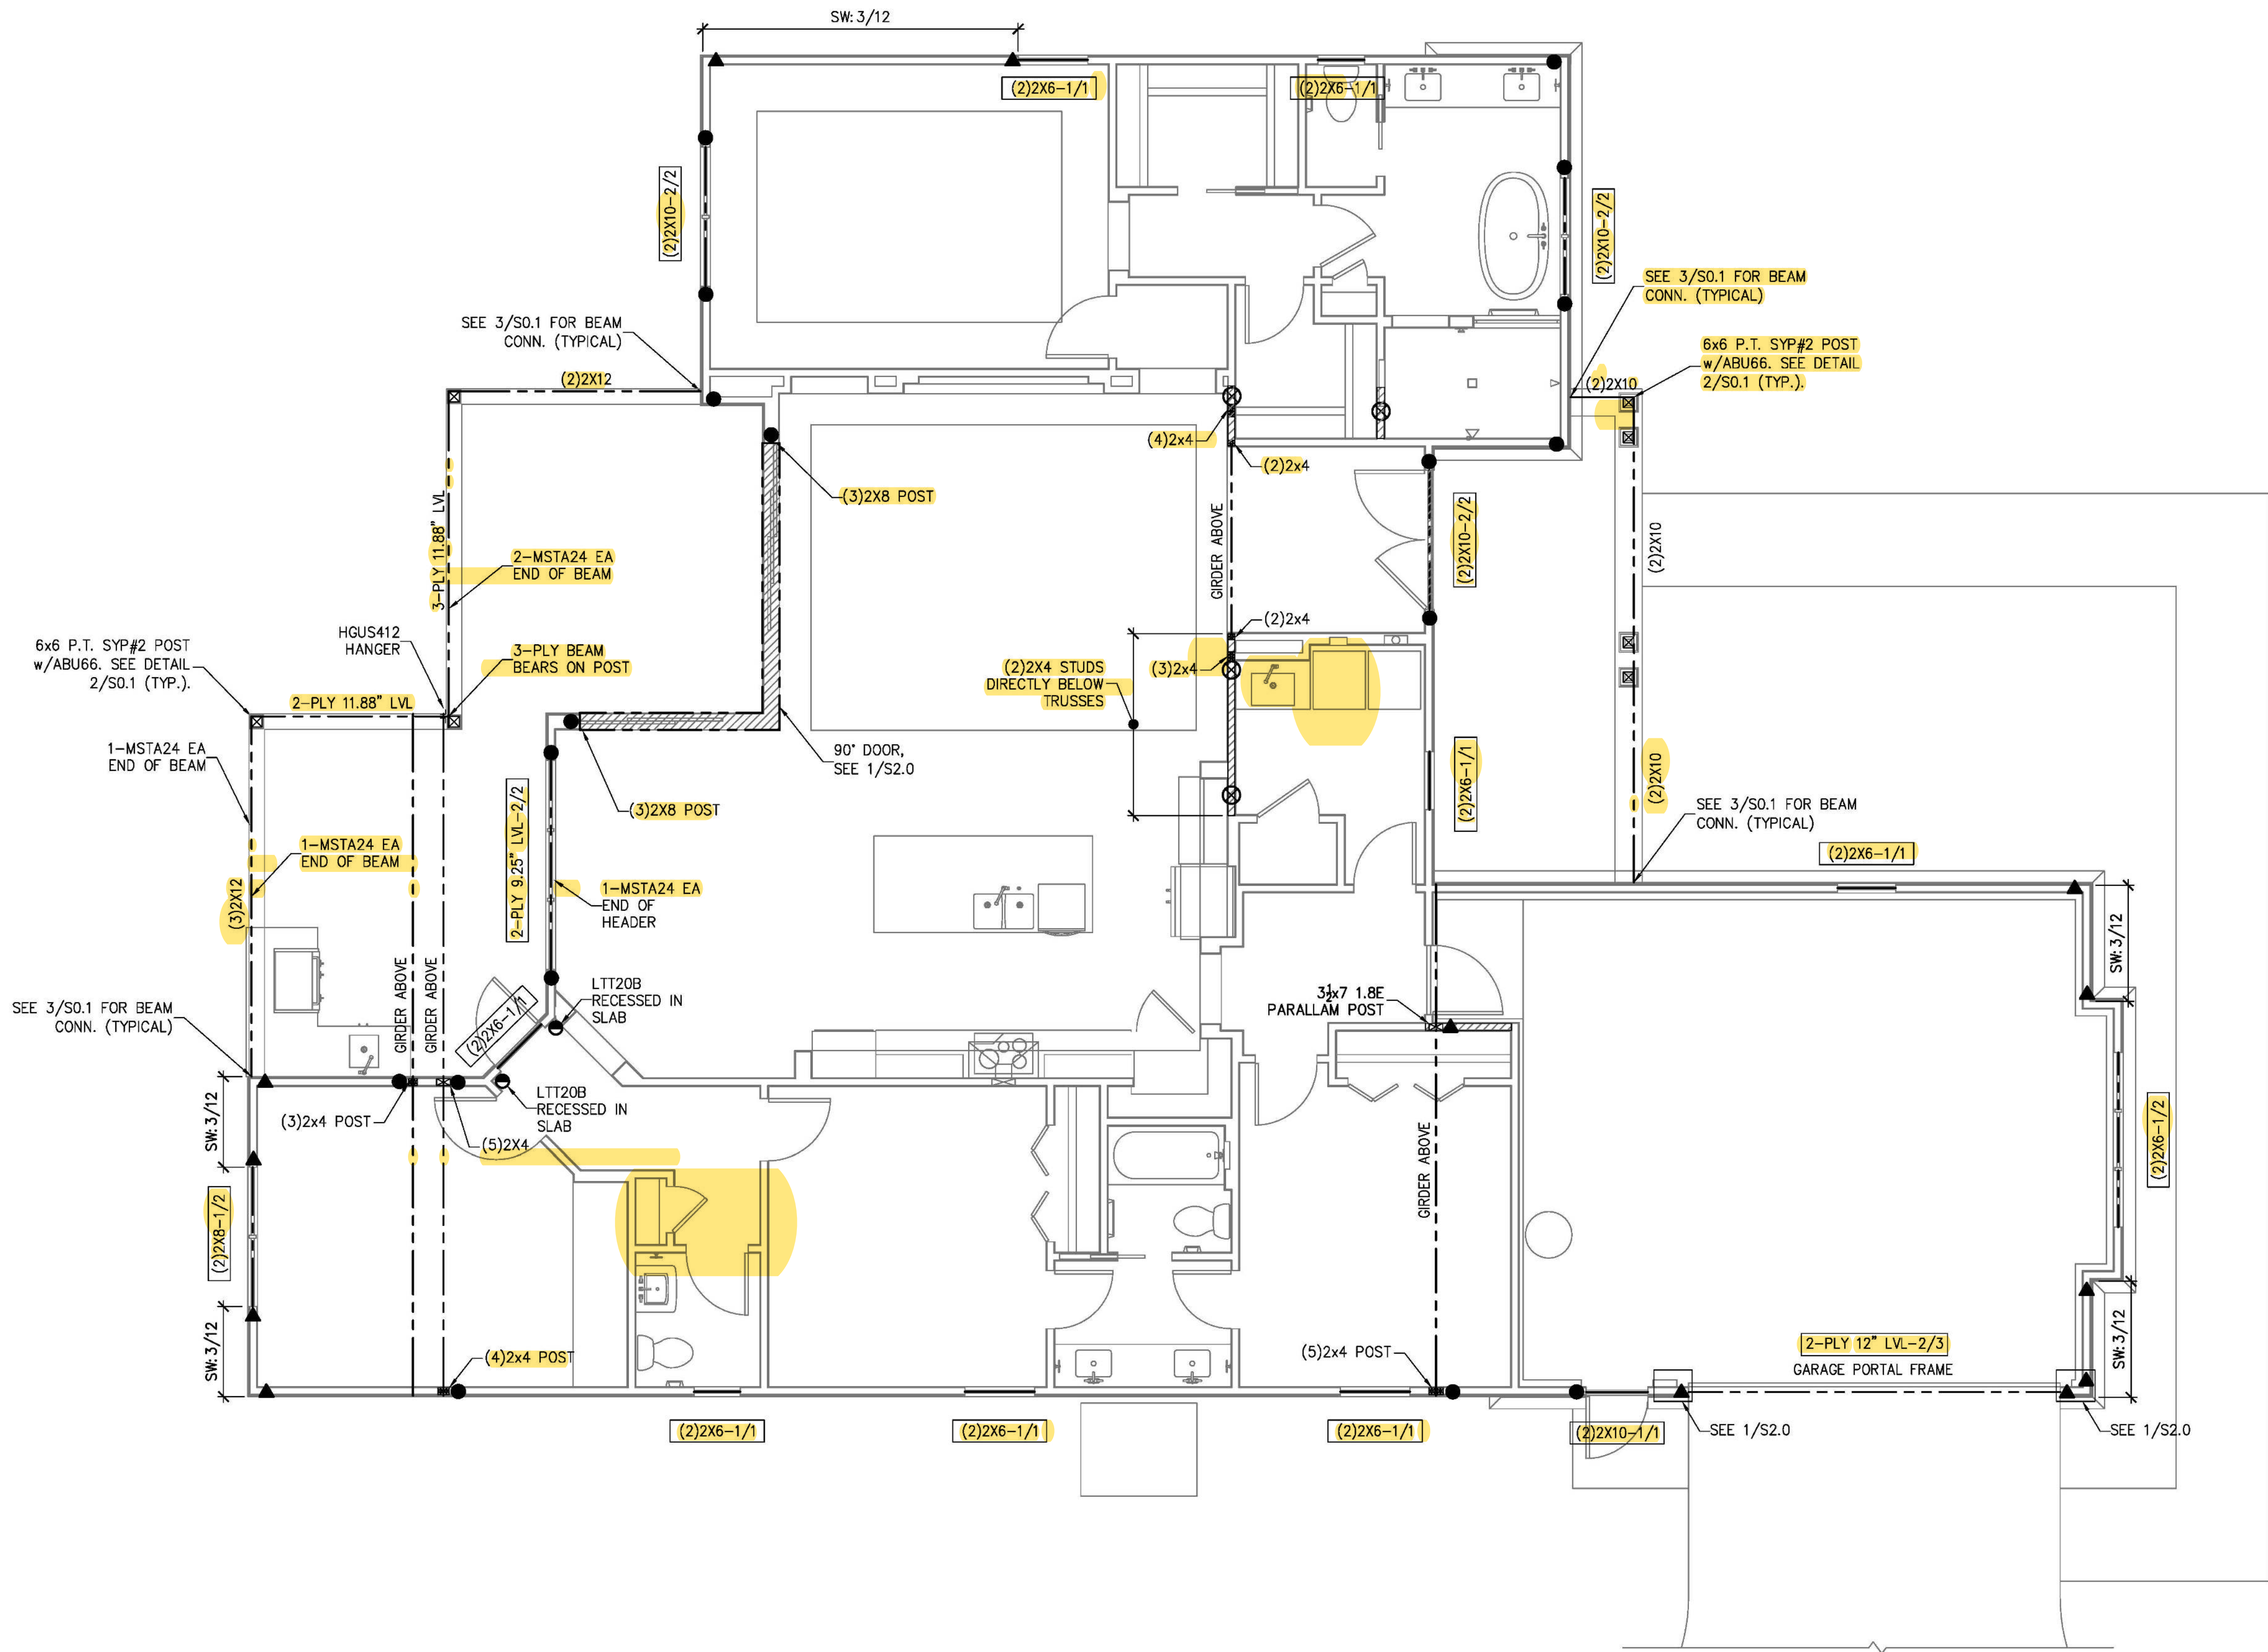

FIRST LEVEL WALL FRAMING PLAN
SCALE: 1/4" = 1'-0"

SYMBOLS LEGEND

	DESIGNATES OSB SHEARWALL. THE HIDDEN LINE DESIGNATES SIDE OF WALL. THE SHEARWALL SHEATHING TO BE APPLIED. 8d @ 1' DESIGNATES 8d COMMONS @ 3' O.C. EDGE & 6' O.C. "IN THE FIELD"
	DESIGNATES THE HEADER SIZE, NUMBER OF PLYS & JACK/KING STUDS NEEDED FOR SUPPORT HEADER.
	BEAM OR TRUSS, SEE PLAN
ANCHOR LEGEND	
	3/8\"/>
	3/8\"/>
	3/8\"/>
	3/8\"/>
	SIMPSON HTTS SEE DETAIL 15/SO.1
	SIMPSON DTT22 SEE DETAIL 15/SO.1
	SIMPSON LTT20B SEE DETAIL 15/SO.1

WALL STUD SCHEDULE

LOCATION	PLATE HEIGHT	STUD SIZE & SPACING
EXTERIOR	9'-1" MAX	2x4 SPF#2 @ 16" O.C.
EXTERIOR	10'-1" MAX	2x6 SPF#2 @ 16" O.C. @ 2x4 SPF#2 @ 12" O.C.
EXTERIOR	10'-1" TO 14'-0"	2x6 SPF#2 @ 16" O.C.
INTERIOR	10'-0" MAX	2x4 SPF#2 @ 16" O.C.
INTERIOR	12'-0" MAX	2x6 SPF#2 @ 16" O.C. @ 2x4 SPF#2 @ 12" O.C.

- STUD NOTES:
- 1.) WALL STUDS SPECIFIED ON PLAN SUPERSEDE THIS TABLE.
 - 2.) MINIMUM STUD SIZE AND SPACING ARE SHOWN. CONTRACTOR MAY INCREASE STUD SIZE TO MEET ARCHITECTURAL REQUIREMENTS.
 - 3.) SPF DENOTES SPRUCE PINE FIR. SYP DENOTES SOUTHERN YELLOW PINE.
 - 4.) USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.
 - 5.) FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB w/16d MASONRY CUT NAILS @ 16" O.C. MINIMUM. SEE 3/SO.0 FOR ADDITIONAL ANCHORS AT SHEARWALLS.


COMBINED USE PANEL NOTES

1. EXTERIOR WALL SHEATHING SHALL BE CONTINUOUS FROM BOTTOM PLATE TO UPPER MOST TOP PLATE. SEE DETAIL 1/SO.1 FOR SHEATHING SPLICE LOCATIONS FOR MULTI STORY CONDITIONS.
 2. SEE SHEET SO.0 FOR WALL SHEATHING SPECIFICATIONS.
 3. UPPER MOST TOP PLATE SUPPORTING ROOF MEMBERS SHALL BE STRAPPED AS SHOWN IN DETAIL 1/SO.0.
 4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0.
- GENERAL NOTES
1. SEE DETAIL 2/SO.0 FOR WALL FRAMING DETAIL. SEE WALL STUD SCHEDULE. THIS SHEET SHOWS STUD SIZES AND SPACING. AT GIRDERS AND BEAMS, PROVIDE STUDS BELOW TO MATCH BEAM/GIRDER PLIES.
 2. SEE SHEET SO.0 FOR ROOF AND FLOOR SHEATHING SPECIFICATIONS.
 3. WHERE FRAMING MEMBERS CONSIST OF MULTIPLE PLIES (BEAMS, HEADER, AND STUDS) FASTEN PLIES TOGETHER PER DETAIL 6/SO.0.
 4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0.
 5. AT SHEARWALLS, PROVIDE DIAPHRAGM ATTACHMENT PER DETAIL 5/SO.1.
 6. FOR ATTACHMENT OF EXTERIOR WALLS THAT TERMINATE BETWEEN TRUSSES, SEE 5A/SO.1.
 7. AT PORCHES, SEE DETAIL 2/SO.1 FOR FRAMING AND HOLD DOWNS.

SOLE PLATE ANCHOR SPACING SCHD

ALL EXTERIOR WALL UNLESS OTHER NOTED	42" O.C.
SHEARWALLS (SW 8d@3"/6")	24" O.C.
SOLE PLT @ 1'	WHEN NOTED ON PLAN SEE NOTE 2

1. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0.
2. ANCHOR SPACING SHALL BE AS NOTED. FOR EXAMPLE - SOLE PLT @ 36" = 36" ON-CENTER SPACING

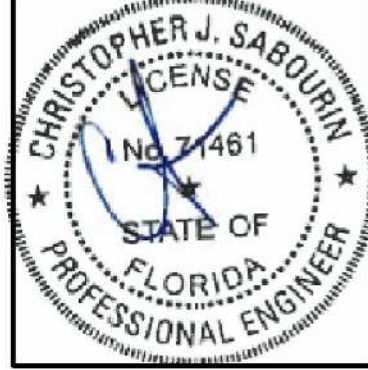

07.17.20
Christopher J Sabourin
FL PE#71461

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
BZEC MODEL HOME
SSE No.
20-0187

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE


STRUCTURAL ENGINEERING FOR
THE LANCASTER 1752F-L
MODEL AT WOOBOROUGH

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.B.

FIRST LEVEL
WALL
FRAMING
PLAN

SHEET
S1.1
SHEET 5 OF 7

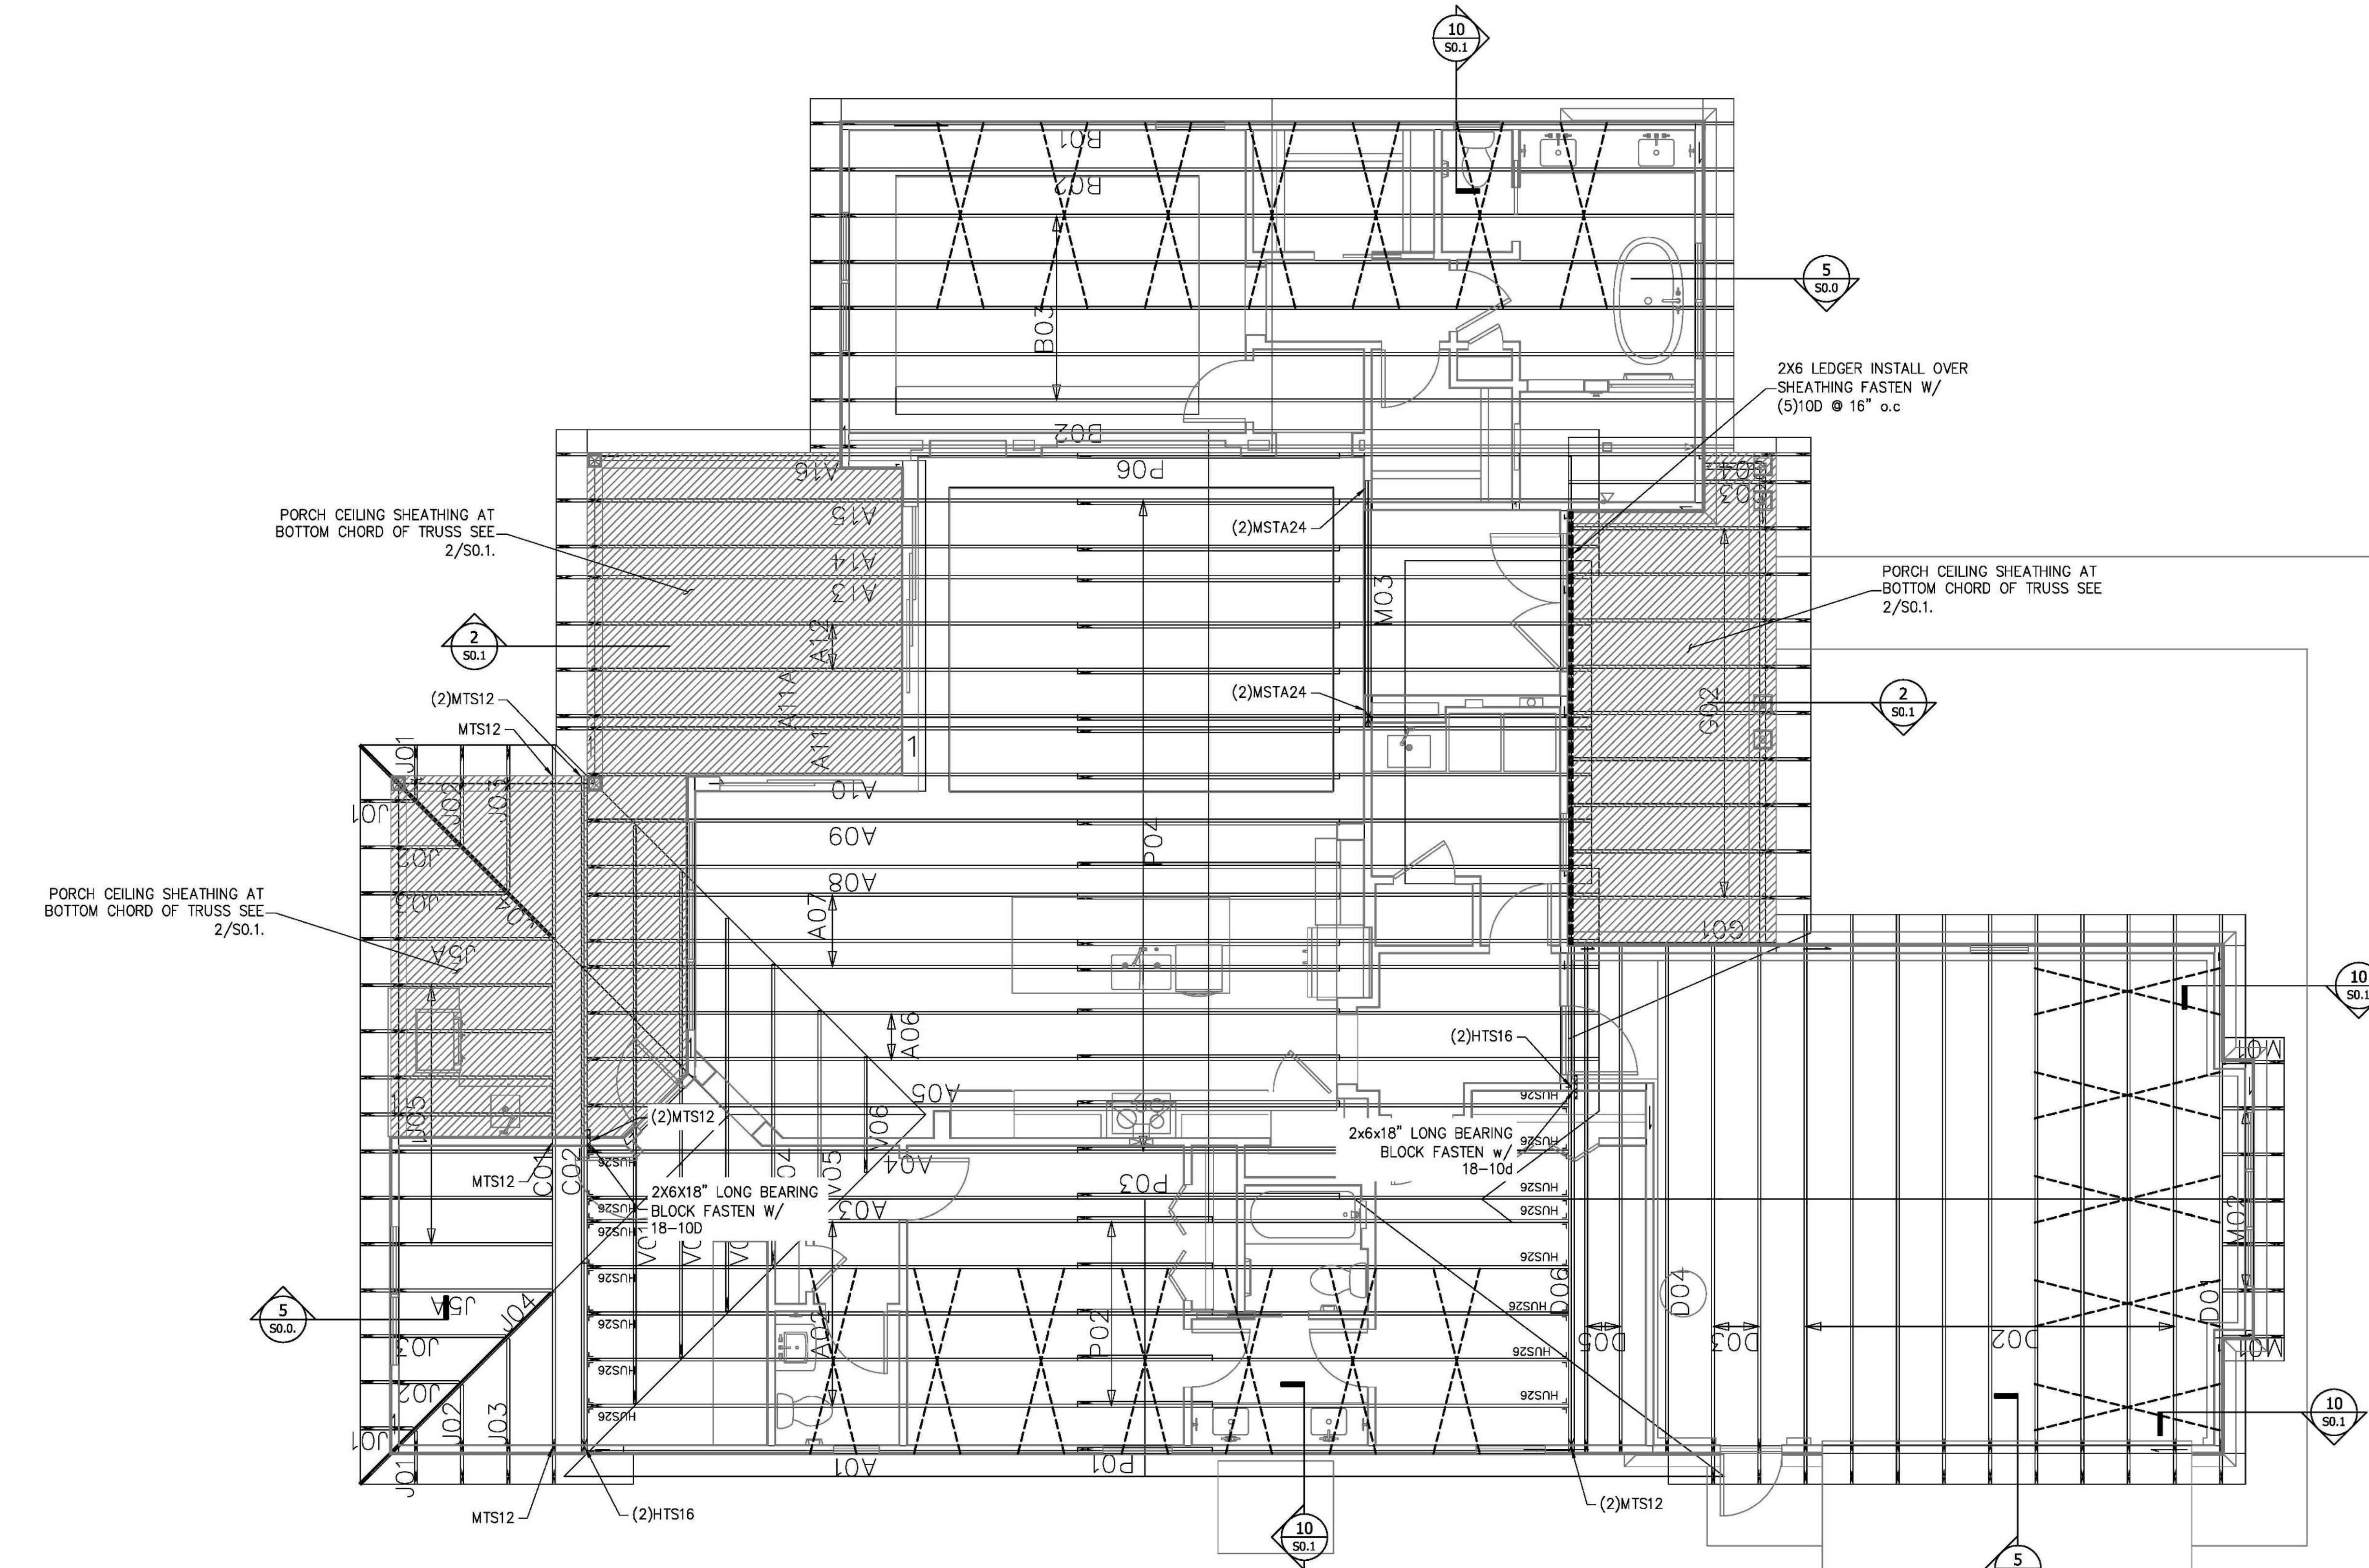

- TRUSS / ROOF RAFTER NOTES: STRAPPING NOTES
- FASTEN TRUSSES AND ROOF RAFTERS TO BEARING WITH 2-12D TOENAILS & 1-SIMPSON SDWC15600 SCREW UNLESS OTHERWISE NOTED
 - A SIMPSON H2.5 UPLIFT STRAP MAY BE USED AS AN ALTERNATE TO THE SDWC15600 SCREW. SEE NOTE 2 ON DETAIL 5/S0.0

2ND FLOOR TRUSS FRAMING PLAN
SCALE: 1/4" = 1'-0"

(#)HTS20

DESIGNATES NUMBER OF HTS20 STRAPS AT BEAM/TRUSS

(#)SDWC

DESIGNATES NUMBER OF SDWC15600 AT BEAM/TRUSS

HTS16

DESIGNATES UPLIFT CONNECTION.

FRAMING PLAN NOTES:

1. FOR TYPICAL ROOF SHEATHING AND FRAMING, SEE SHEET S0.0.

2. FOR SPECIFIC UPLIFT CONNECTIONS, SEE PLAN MIN. (1)SDWC CONNECTOR.

3. FOR GENERAL DESIGN SPECIFICATIONS SEE SHEET S0.0.

4. WHEN USING (2)H2.5T CLIPS ON 1/2" WIDE LUMBER, PLACE CLIPS DIAGONALLY ACROSS DOUBLE TOP PLATE FROM EACH OTHER.

TRUSS FASTENING DETAILS

STUD DIRECTLY BELOW TRUSS

SDWC15600

TOP PLATE TO STUD SDWC15600

2X6 LEDGER INSTALL OVER SHEATHING FASTEN W/ (5)10D @ 16" o.c

TRUSS TIE DOWN WITH SIMPSON SDWC

Rafter to Top Plate shown Truss to Top Plate similar

Optimal 22 1/2°

30°

10°

0°

1/2" Max

STUD DIRECTLY BELOW TRUSS

SDWC15600

TOP PLATE TO STUD SDWC15600

Note:

1. Sloped-roof rafters may be sloped up to and including a 12:12 pitch and must be "birdsmouth" cut.

2. Reference detail 4 for installation instructions.

SIMPSON SDWC INSTALLATION RANGE

STUD NOT DIRECTLY BELOW TRUSS

SDWC15600

Note:

Reference detail 2a for installation angle limit

SDWC INSTALLATION

Rafter to Top Plate shown (Truss to Top Plate similar)

1/2" max

Do not install SDWC in hatched area

SDWC15600

Overhang 1 1/2" MIN 2" MAX

STUD NOT DIRECTLY BELOW TRUSS

SDWC INSTALLATION RANGE

x" minimum edge distance for full values (with or without a plate splice)

Rafter or Truss

Splice may be in upper or lower plate

x" from top plate splice Offset for full values

STUD NOT DIRECTLY BELOW TRUSS

SDWC AT TOP PLATE SPLICE

CHRISTOPHER J. SABOURIN

FLORIDA

PROFESSIONAL ENGINEER

07.17.20

Christopher J Sabourin

FL PE#71461

SABO

STRUCTURAL

ENGINEERING

CA#32529

235 9TH AVE N

JAX BEACH, FL 32250

904-712-5750

CHRIS@SABOENG.COM

PLAN NAME

BZEC MODEL HOME

SSE No.

20-0187

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR

THE LANCASTER 1752F-L

MODEL AT WOODBOROUGH

FIELD ALTERATION

CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING

DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.B.

2nd

FLOOR TRUSS


FRAMING

PLAN

SHEET


S1.2

SHEET 6 OF 7

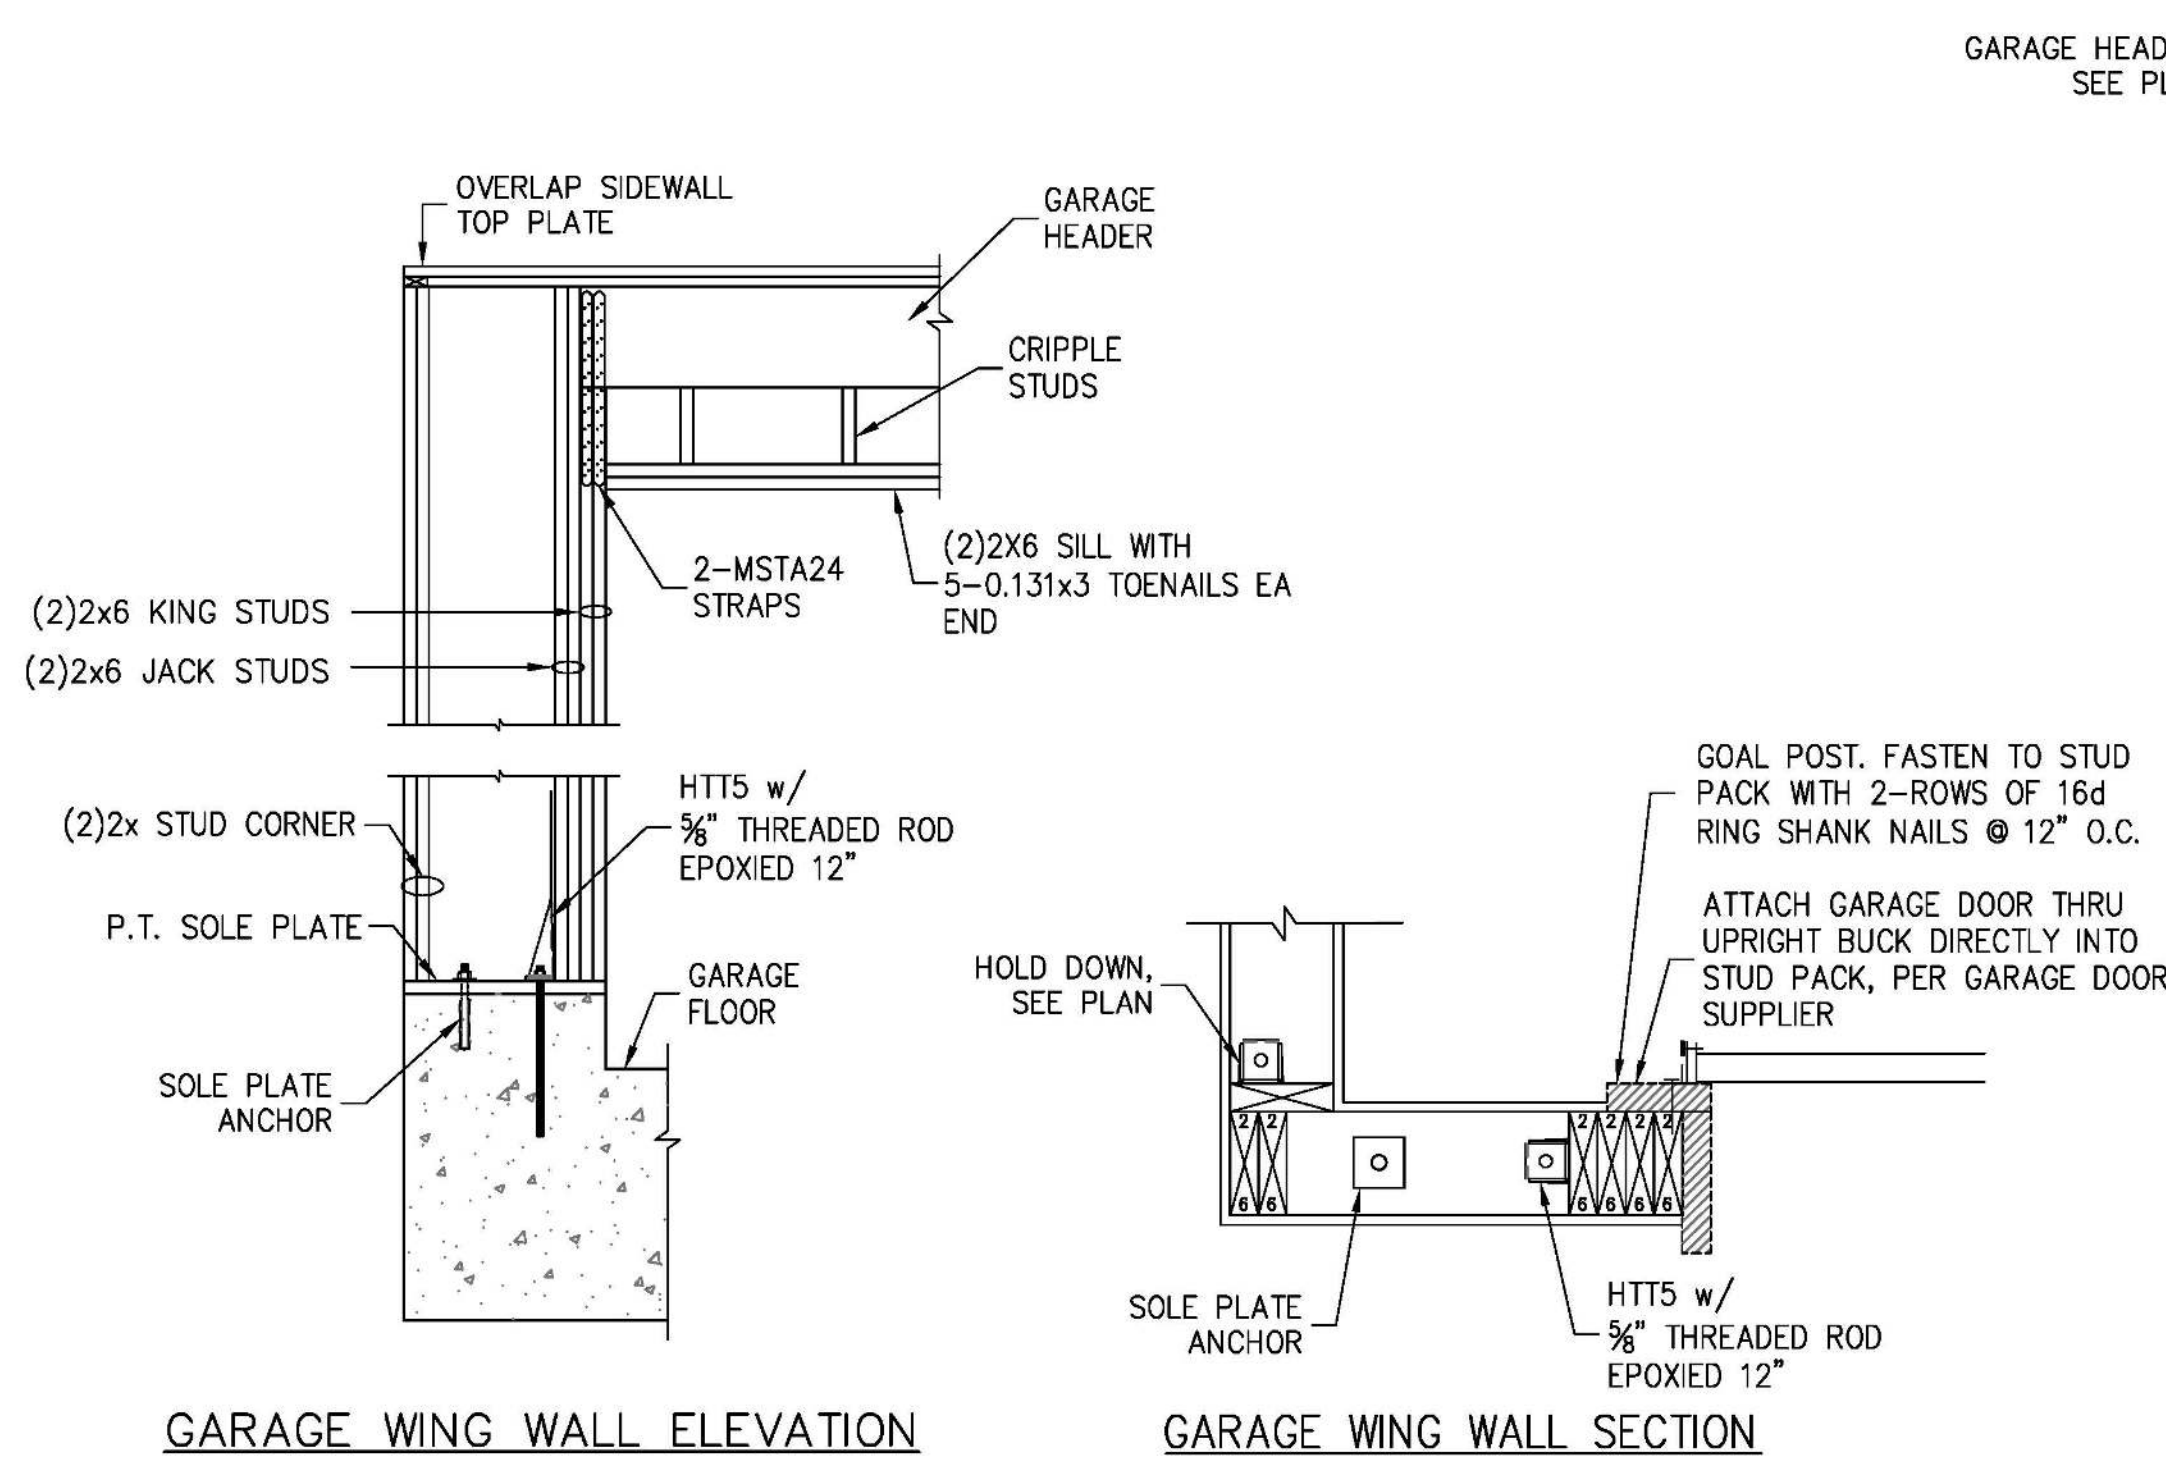


GARAGE WING WALL ELEVATION

GARAGE WING WALL SECTION

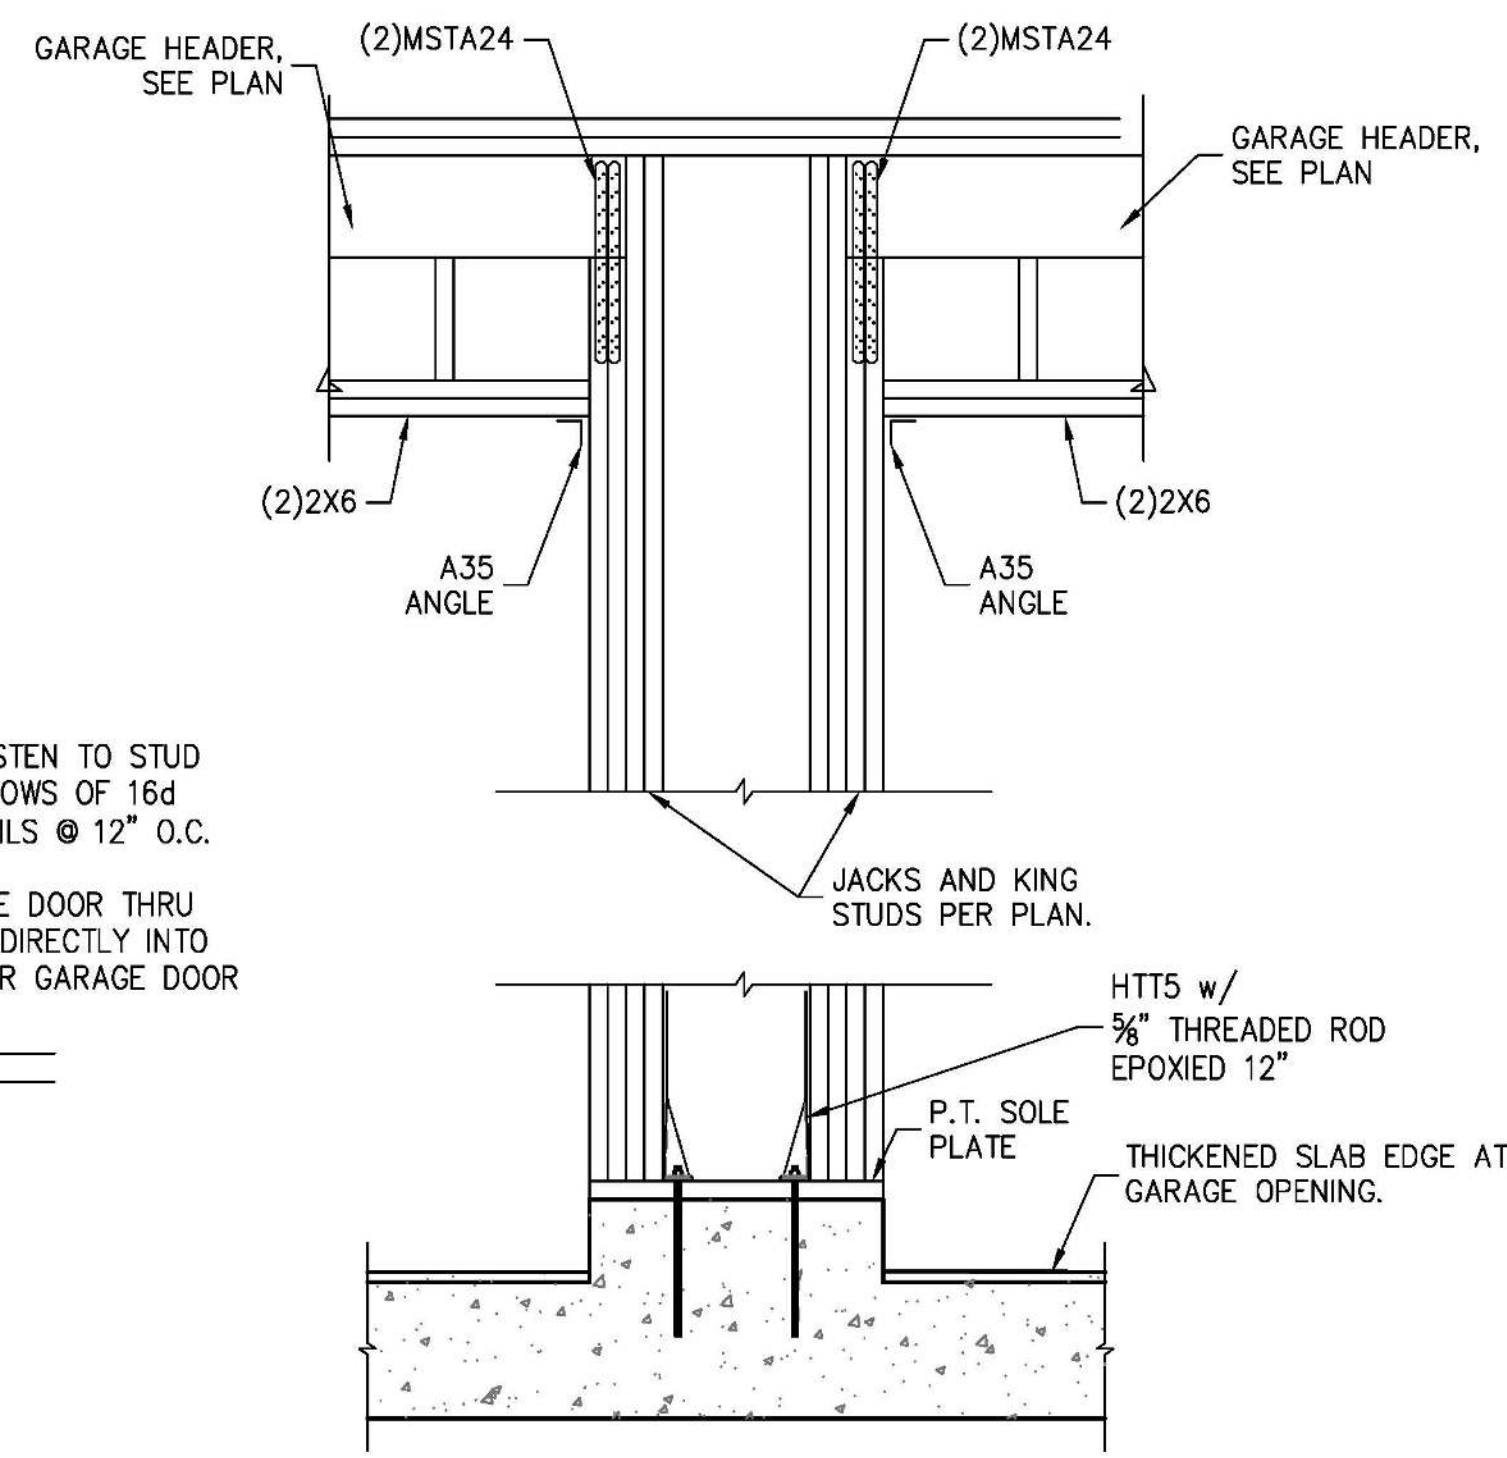

GARAGE CENTER WALL FRAMING

SCALE: NTS

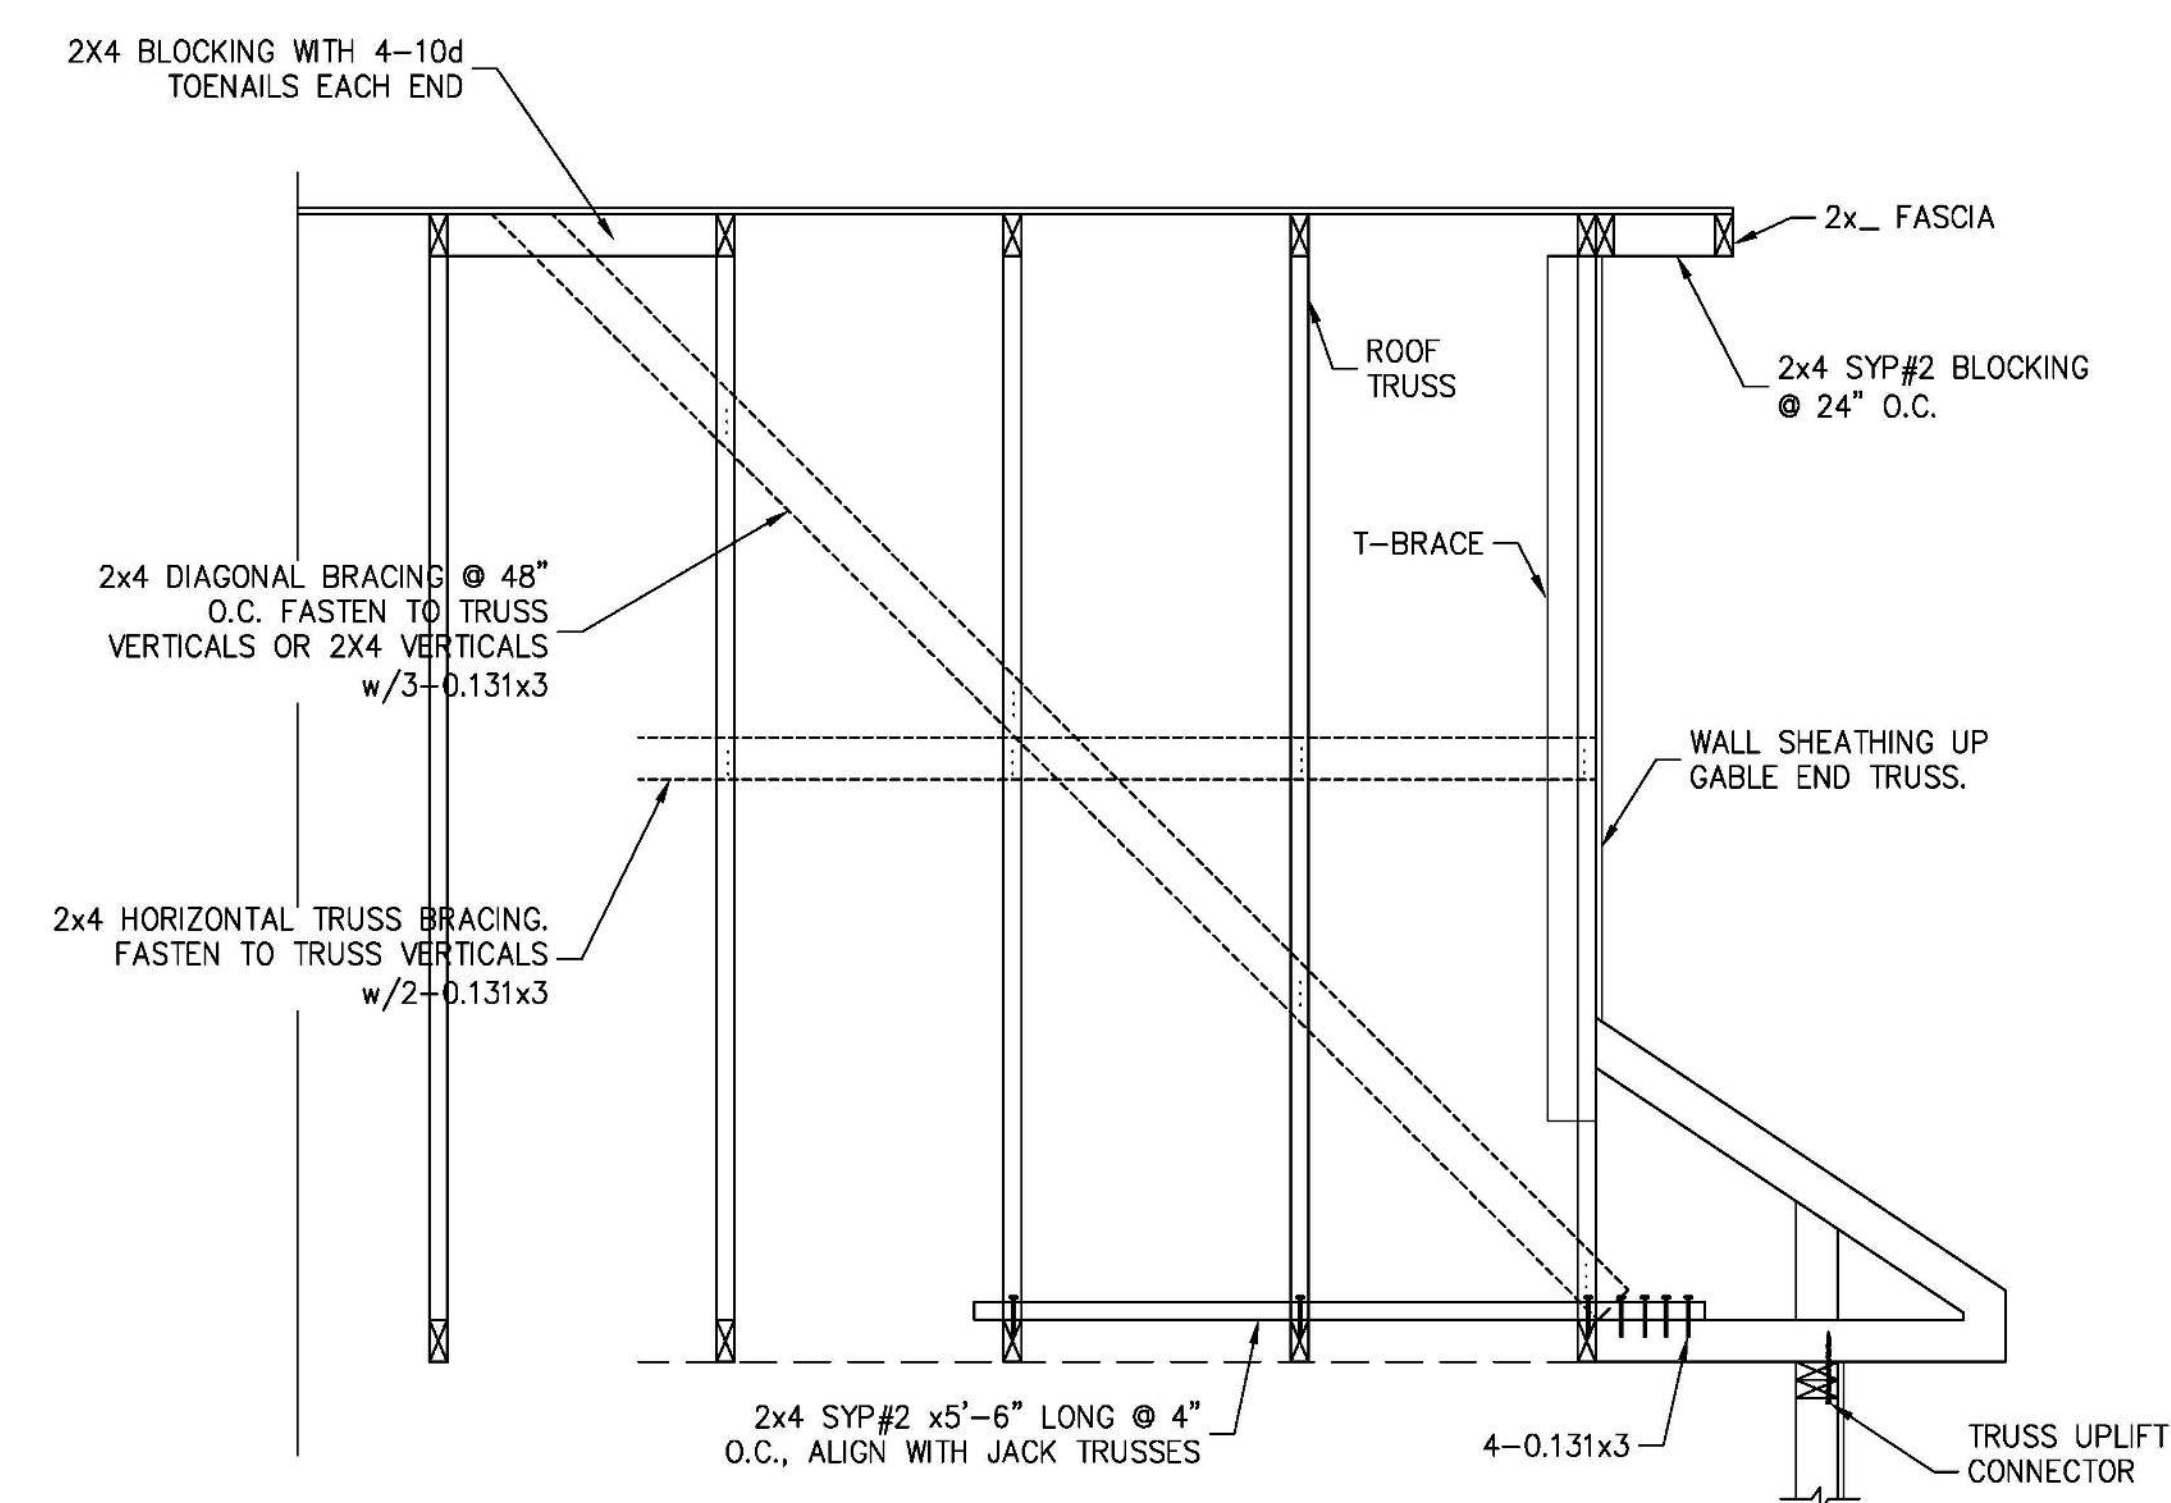


GABLE END BRACE DETAIL

1 TYPICAL GARAGE HEADER/JACK CONNECTION
SCALE: 3/4" = 1'-0"


2 GARAGE CENTER WALL FRAMING
SCALE: NTS

3 GABLE END BRACE DETAIL

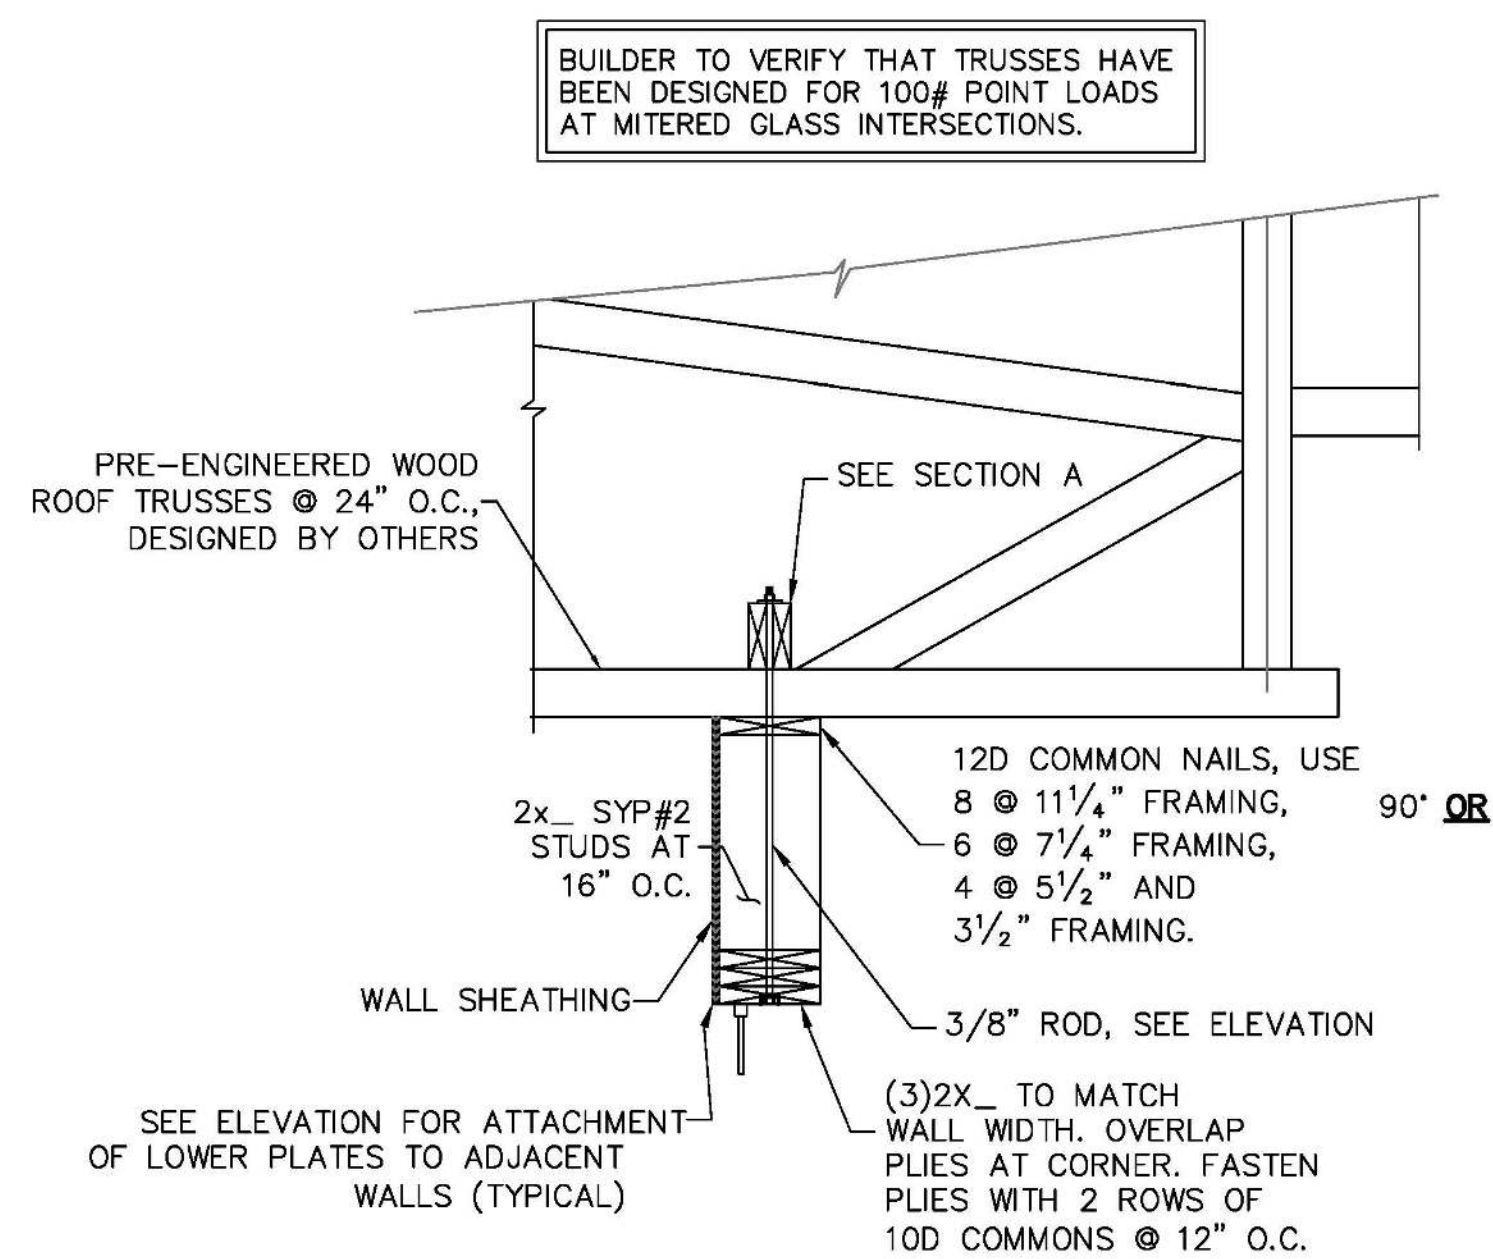


4 MITERED WINDOW HEAD FRAMING

SCALE: N.T.S.

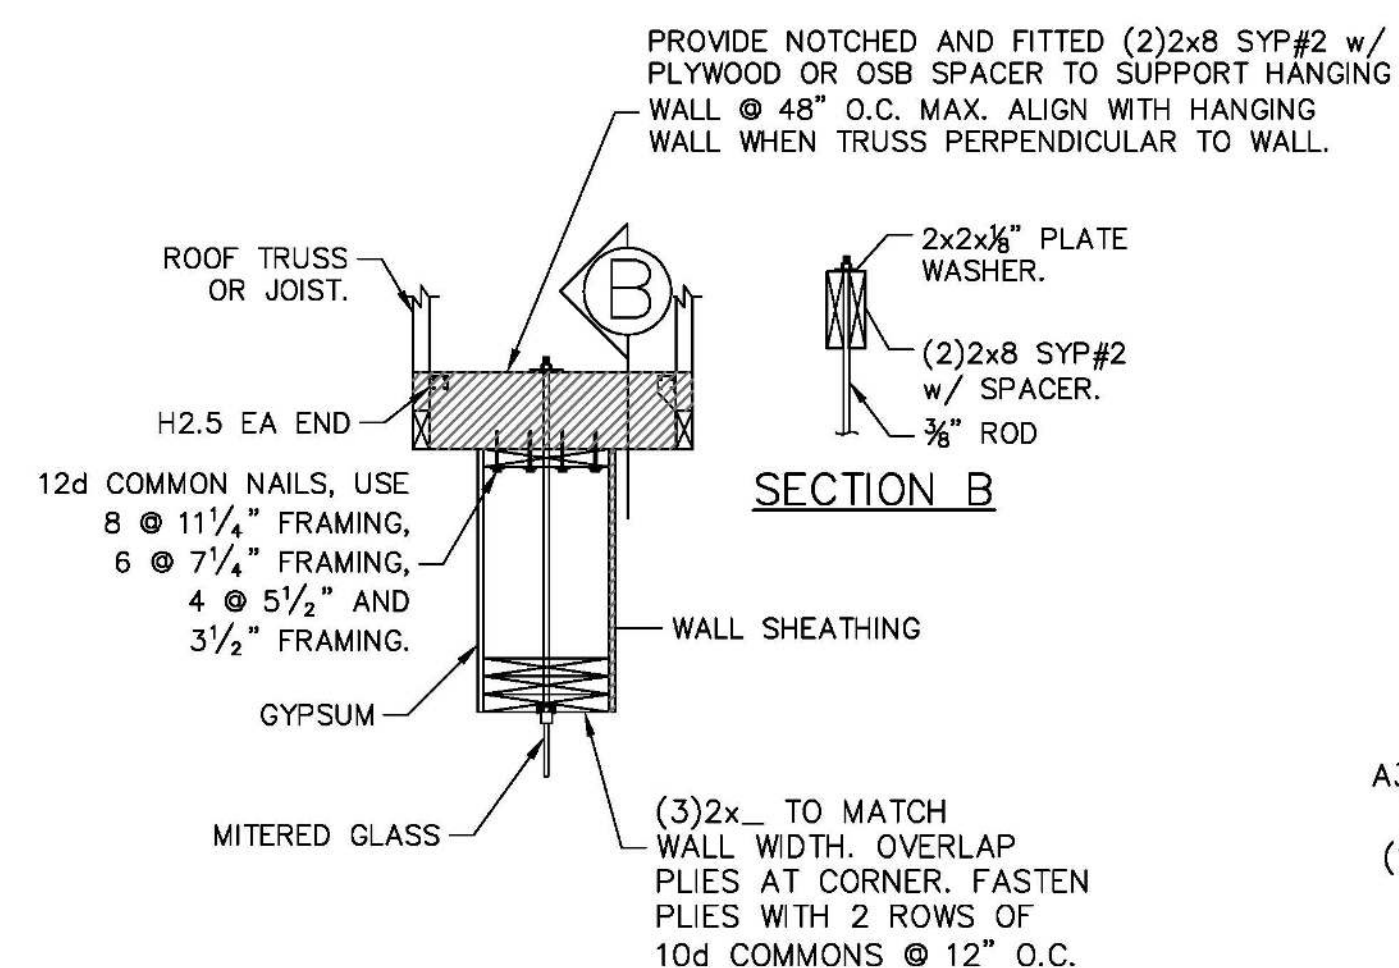


SECTION A


SECTION B

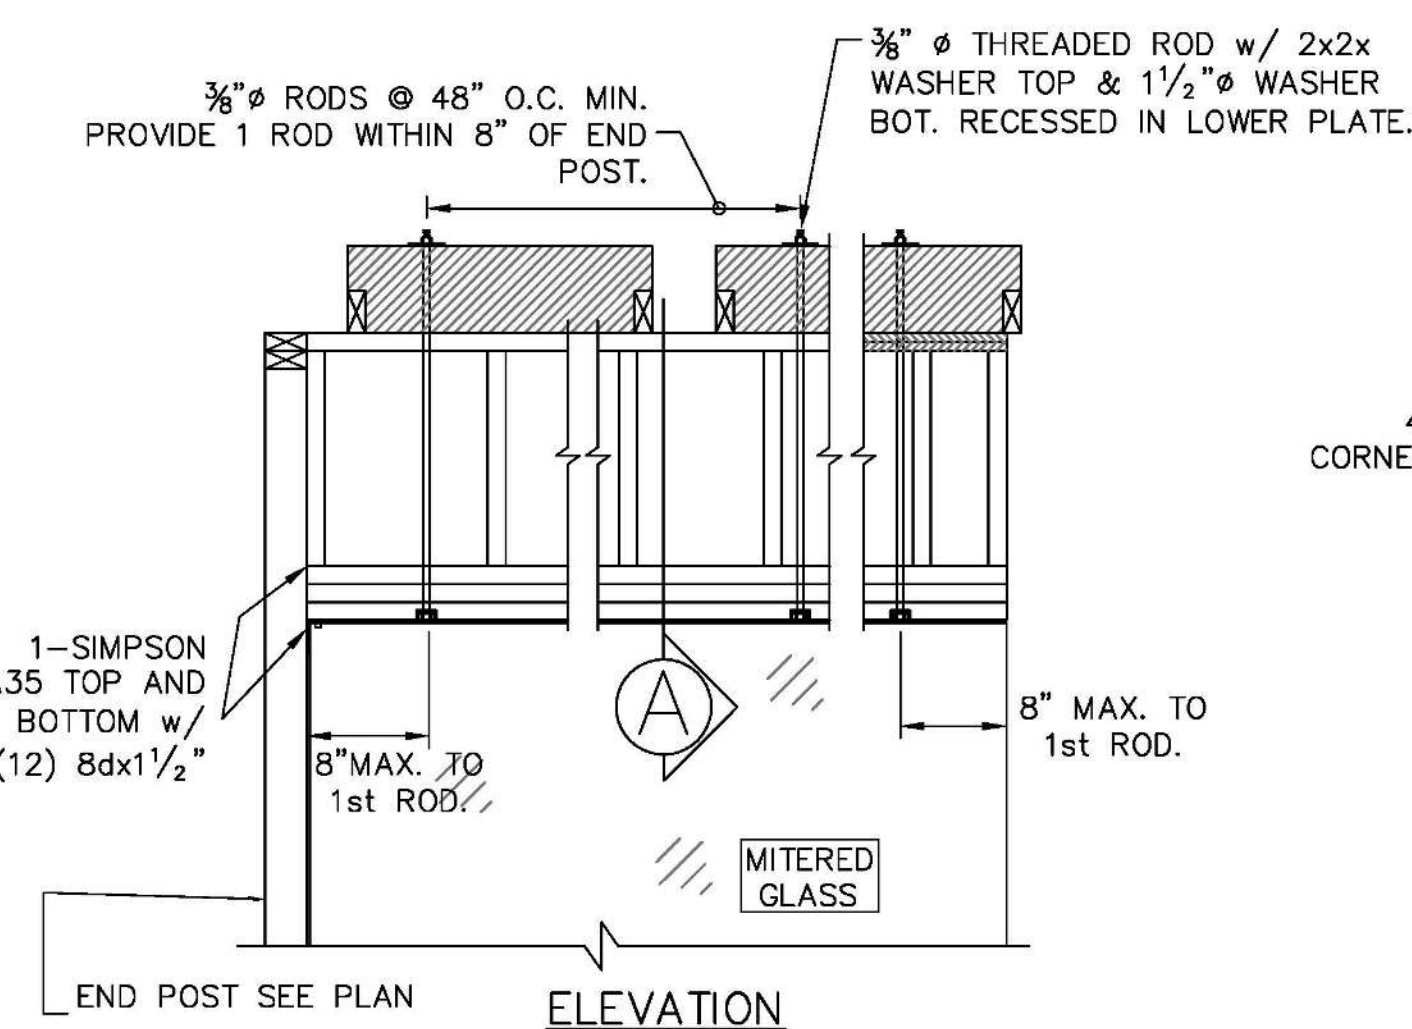

ELEVATION

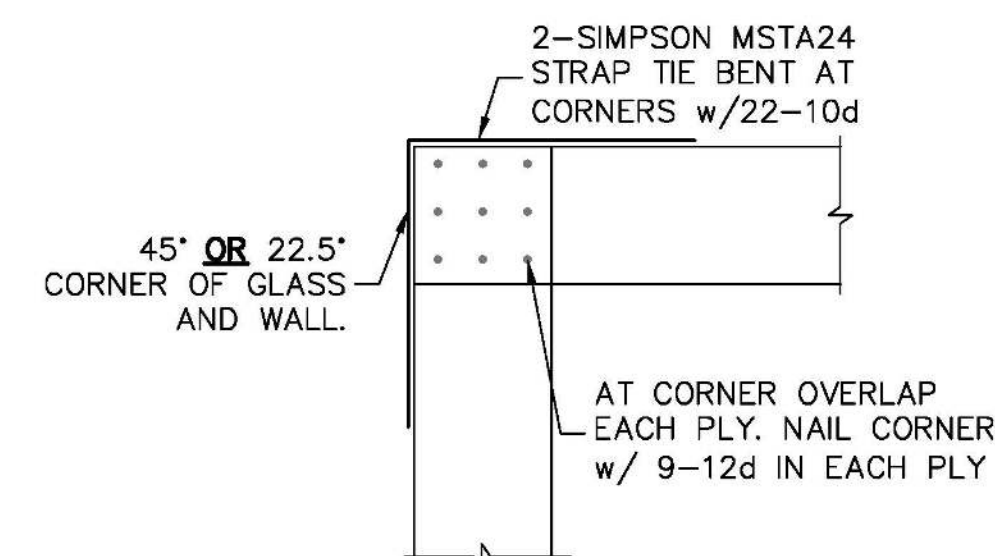

C SECTION AT CORNER

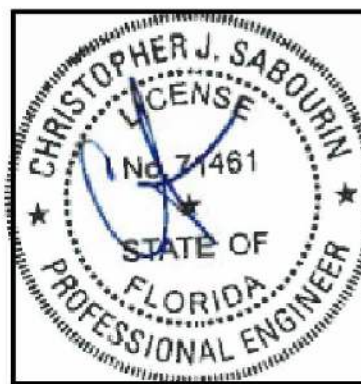

07.17.20
Christopher J Sabourin
FL PE#71461

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
BZEC MODEL HOME
SSE No.
20-0187

ISSUE	DATE
PERMIT	07.17.20
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR
THE LANCASTER 1752F-L
MODEL AT WOOBOROUGH

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.B.

MISC. FRAMING
DETAILS

SHEET
S2.0
SHEET 7 OF 7