



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: FRED_PERRY - FRED PERRY

MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: FRED PERRY Project Name: . Model: .
Lot/Block: . Subdivision: .
Address: ., .
City: COLUMBIA CO. State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.5
Wind Code: ASCE 7-16 Wind Speed: 140 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 58 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T28314020	A01	7/20/22	23	T28314042	G04	7/20/22
2	T28314021	A02	7/20/22	24	T28314043	G05	7/20/22
3	T28314022	A03	7/20/22	25	T28314044	G06	7/20/22
4	T28314023	A04	7/20/22	26	T28314045	G07	7/20/22
5	T28314024	A05	7/20/22	27	T28314046	H01	7/20/22
6	T28314025	A06	7/20/22	28	T28314047	H2GR	7/20/22
7	T28314026	A07	7/20/22	29	T28314048	H03	7/20/22
8	T28314027	A08	7/20/22	30	T28314049	H04	7/20/22
9	T28314028	A09	7/20/22	31	T28314050	H05	7/20/22
10	T28314029	B01	7/20/22	32	T28314051	H6GE	7/20/22
11	T28314030	B02	7/20/22	33	T28314052	H12	7/20/22
12	T28314031	C01	7/20/22	34	T28314053	J01	7/20/22
13	T28314032	C02	7/20/22	35	T28314054	J02	7/20/22
14	T28314033	C03	7/20/22	36	T28314055	J03	7/20/22
15	T28314034	C4GE	7/20/22	37	T28314056	J04	7/20/22
16	T28314035	CJ01	7/20/22	38	T28314057	J05	7/20/22
17	T28314036	D01	7/20/22	39	T28314058	J06	7/20/22
18	T28314037	D02	7/20/22	40	T28314059	J07	7/20/22
19	T28314038	D3GE	7/20/22	41	T28314060	J08	7/20/22
20	T28314039	G01	7/20/22	42	T28314061	J09	7/20/22
21	T28314040	G02	7/20/22	43	T28314062	J10	7/20/22
22	T28314041	G03	7/20/22	44	T28314063	J11	7/20/22




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Lee, Julius

My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

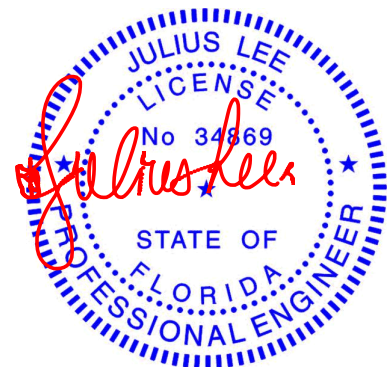

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

Lee, Julius

1 of 2



RE: FRED_PERRY - FRED PERRY

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:


Customer Info: FRED PERRY Project Name: . Model: .
Lot/Block: . Subdivision: .
Address: ., .
City: COLUMBIA CO. State: FL

No.	Seal#	Truss Name	Date
45	T28314064	J12	7/20/22
46	T28314065	J13	7/20/22
47	T28314066	J14	7/20/22
48	T28314067	K01	7/20/22
49	T28314068	K02	7/20/22
50	T28314069	K03	7/20/22
51	T28314070	K04	7/20/22
52	T28314071	K05	7/20/22
53	T28314072	K06	7/20/22
54	T28314073	K07	7/20/22
55	T28314074	K08	7/20/22
56	T28314075	K09	7/20/22
57	T28314076	K10	7/20/22
58	T28314077	K11	7/20/22

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314020
FRED_PERRY	A01	Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:45 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzyzwB6i-qeTj1q60Sxxfir5?7fIDRSI3??1WNKJ_IIRJ?Boyw86W



Scale = 1:56.6

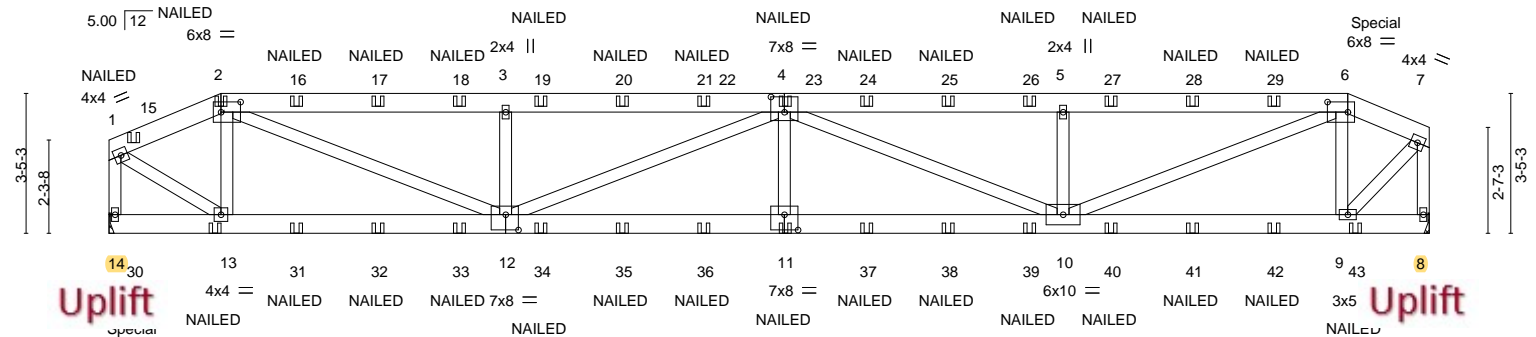


Plate Offsets (X,Y)--	[2:0-5-12,0-3-0], [4:0-4-0,0-4-8], [6:0-6-0,0-3-0], [11:0-4-0,0-4-8], [12:0-3-12,0-4-8]
-----------------------	---

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.38	Vert(LL)	0.22	11	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.80	Vert(CT)	-0.42	11-12	>916		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.55	Horz(CT)	0.07	8	n/a		
BCDL 10.0	Code FBC2020/TP12014		Matrix-MS						
								Weight: 453 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-8-3 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 14=Mechanical, 8=Mechanical
Max Horz 14=127(LC 7)
Max Uplift 14=-697(LC 8), 8=-768(LC 8)
Max Grav 14=2935(LC 1), 8=2789(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2752/638, 2-3=-6599/1665, 3-4=-6599/1665, 4-5=-6309/1561, 5-6=-6309/1561, 6-7=-2075/571, 1-14=-2782/612, 7-8=-2841/724
BOT CHORD 12-13=-527/2473, 11-12=-1752/7675, 10-11=-1752/7675, 9-10=-476/1857
WEBS 2-13=-1307/526, 2-12=-1166/4492, 3-12=-980/535, 4-12=-1178/220, 4-11=0/533, 4-10=-1491/325, 5-10=-975/536, 6-10=-1114/4842, 6-9=-1571/418, 1-13=-635/3020, 7-9=-703/2813

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=32ft; eave=4ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 697 lb uplift at joint 14 and 768 lb uplift at joint 8.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 194 lb down and 20 lb up at 30-5-0 on top chord, and 240 lb down and 79 lb up at 0-7-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314020
FRED_PERRY	A01	Hip Girder	1	2	Job Reference (optional)	

LOAD CASE(S)
Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-2=-60, 2-6=-60, 6-7=-60, 8-14=-20

Concentrated Loads (lb)

Vert: 2=-131(F) 6=20(F) 13=-62(F) 4=-131(F) 11=-62(F) 16=-131(F) 17=-131(F) 18=-131(F) 19=-131(F) 20=-131(F) 21=-131(F) 24=-131(F) 25=-131(F) 26=-131(F) 27=-131(F) 28=-131(F) 29=-131(F) 30=-240(F) 31=-62(F) 32=-62(F) 33=-62(F) 34=-62(F) 35=-62(F) 36=-62(F) 37=-62(F) 38=-62(F) 39=-62(F) 40=-62(F) 41=-62(F) 42=-62(F) 43=-230(F)


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314021
FRED_PERRY	A02	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:46 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-Ir15EA7eCF3WJ?gBhMlg_Vc3WRqR3nrv_53ZjFyw86V



Scale = 1:56.4

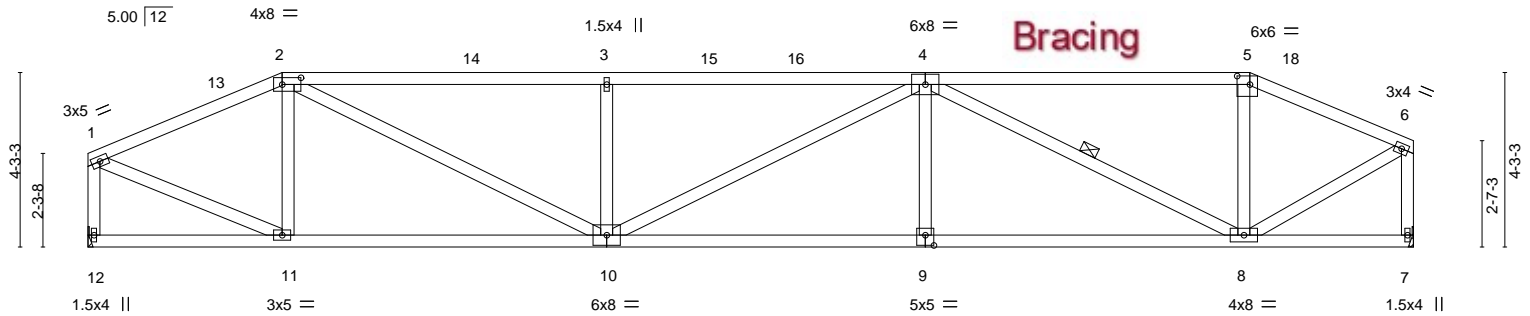

4-9-0	12-8-4	20-5-12	28-5-0	32-5-0
4-9-0	7-11-4	7-9-8	7-11-4	4-0-0
Plate Offsets (X,Y)-- [2:0-5-8,0-2-0], [5:0-3-12,0-2-8], [9:0-2-8,0-3-0]				

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.85	Vert(LL)	-0.26	9-10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.87	Vert(CT)	-0.60	9-10	>647	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.51	Horz(CT)	0.07	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 176 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
4-5: 2x4 SP No.1
BOT CHORD 2x4 SP No.2 *Except*
9-10: 2x4 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-8

REACTIONS.


(size) 12=Mechanical, 7=Mechanical
Max Horz 12=158(LC 11)
Max Uplift 12=274(LC 12), 7=274(LC 12)
Max Grav 12=1285(LC 1), 7=1285(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1517/417, 2-3=-2571/758, 3-4=-2571/758, 4-5=-1207/387, 5-6=-1320/378,
1-12=-1256/374, 6-7=-1271/369
BOT CHORD 10-11=-394/1342, 9-10=-656/2412, 8-9=-656/2412
WEBS 2-11=-412/244, 2-10=-385/1412, 3-10=-559/295, 4-9=0/283, 4-8=-1377/344,
1-11=-358/1440, 6-8=-368/1393

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=32ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-4-10, Interior(1) 3-4-10 to 4-9-0, Exterior(2R) 4-9-0 to 9-4-0, Interior(1) 9-4-0 to 28-5-0, Exterior(2E) 28-5-0 to 32-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 274 lb uplift at joint 12 and 274 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

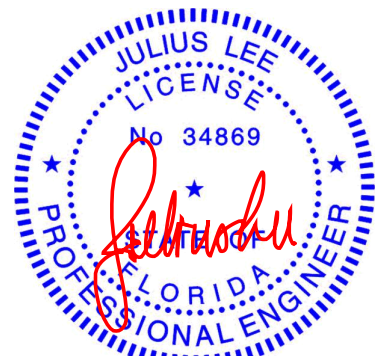

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314022
FRED_PERRY	A03	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:47 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAyzwB6i-n1bTSW7GzYBNx9FNE4GvXj9HggBSo6O2Dlo6Fhyw86U



Scale = 1:56.0

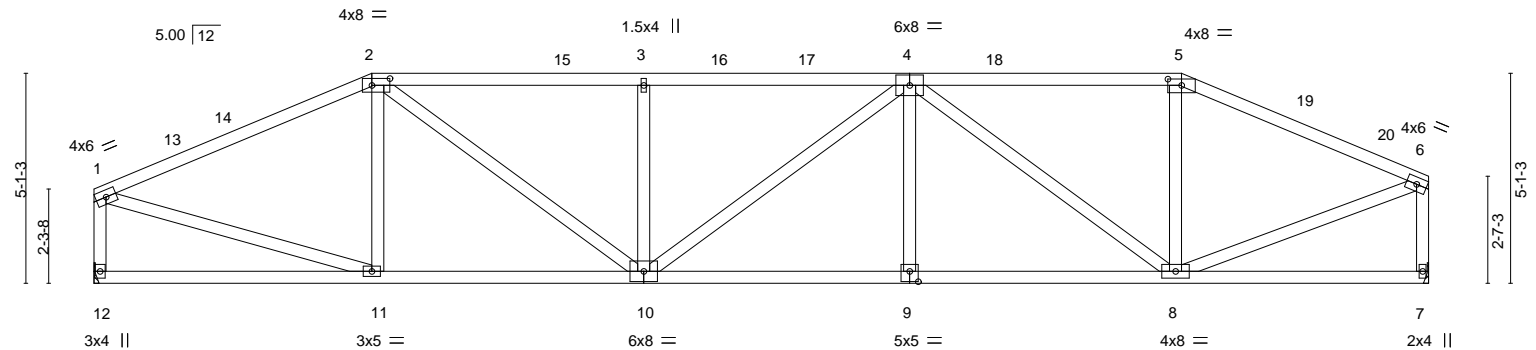


Plate Offsets (X,Y)--	[2:0-5-4,0-2-0], [5:0-4-0,0-1-13], [9:0-2-8,0-3-0]
-----------------------	--

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.69	Vert(LL) -0.16	9-10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.82	Vert(CT) -0.36	9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 1.00	Horz(CT) 0.06	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS					Weight: 184 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.


(size) 12=Mechanical, 7=Mechanical
Max Horz 12=180(LC 11)
Max Uplift 12=274(LC 12), 7=274(LC 12)
Max Grav 12=1285(LC 1), 7=1285(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1660/470, 2-3=-2133/669, 3-4=-2133/669, 4-5=-1352/461, 5-6=-1523/445,
1-12=-1221/396, 6-7=-1230/393
BOT CHORD 10-11=-424/1453, 9-10=-563/2038, 8-9=-563/2038
WEBS 2-11=-264/199, 2-10=-241/905, 3-10=-463/241, 4-8=-901/223, 5-8=0/288,
1-11=-348/1420, 6-8=-358/1385

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=32ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-4-10, Interior(1) 3-4-10 to 6-9-0, Exterior(2R) 6-9-0 to 11-4-0, Interior(1) 11-4-0 to 26-5-0, Exterior(2R) 26-5-0 to 31-0-0, Interior(1) 31-0-0 to 32-3-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 274 lb uplift at joint 12 and 274 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

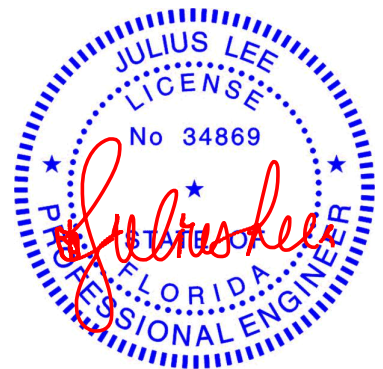

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314023
FRED_PERRY	A04	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:49 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-jQjEsC9XVAR5BTPmMVINc8EYpetZG32Lg2HDKZyw86S



Scale = 1:66.1

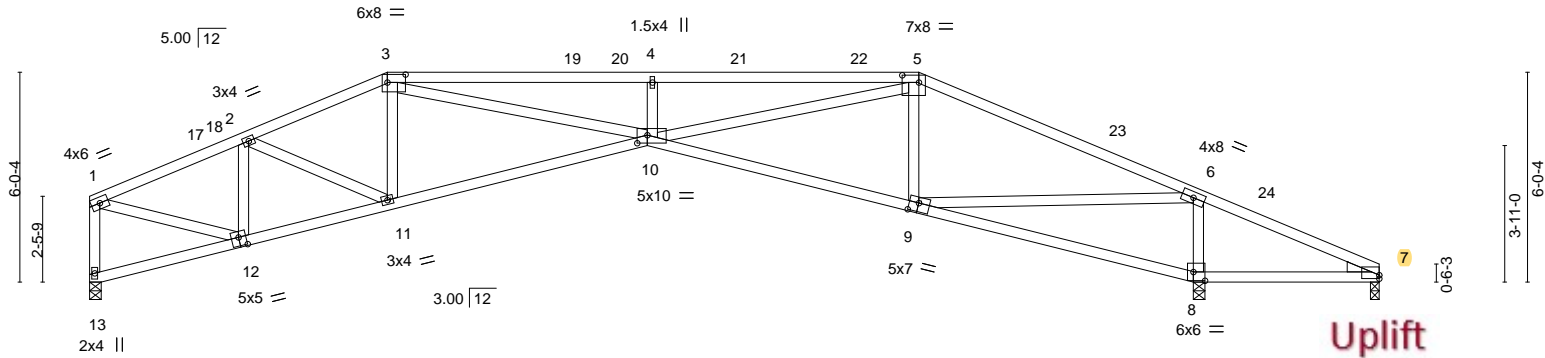


Plate Offsets (X,Y)--	[3:0-6-4,0-2-12], [5:0-5-12,0-2-8], [7:0-0-0,0-1-3], [8:0-4-0,0-3-0], [9:0-3-4,0-3-0], [10:0-3-8,0-2-12], [12:0-2-8,0-3-0]
-----------------------	--

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.97	Vert(LL)	-0.39	10	>978	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.78	Vert(CT)	-0.82	9-10	>463	180		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.80	Horz(CT)	0.40	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 185 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1 *Except*
1-3: 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
8-9: 2x4 SP No.1
WEBS 2x4 SP No.2
WEDGE
Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 7=0-3-0, 8=0-4-0, 13=0-4-0
Max Horz 13=-212(LC 10)
Max Uplift 7=-901(LC 21), 8=-547(LC 12), 13=-236(LC 12)
Max Grav 7=154(LC 12), 8=2751(LC 1), 13=1076(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1455/452, 2-3=-1957/571, 3-4=-4005/1025, 4-5=-4043/1046, 5-6=-1060/353,
6-7=-539/2419, 1-13=-1036/323
BOT CHORD 11-12=-312/1411, 10-11=-331/1832, 9-10=-136/922, 8-9=-2347/580, 7-8=-2132/516
WEBS 2-12=-632/220, 2-11=-55/542, 3-10=-478/2308, 4-10=-490/264, 5-10=-691/3252,
5-9=-804/284, 6-9=-682/3139, 6-8=-1967/634, 1-12=-338/1308

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-10-2, Interior(1) 3-10-2 to 8-6-8, Exterior(2R) 8-6-8 to 13-9-5, Interior(1) 13-9-5 to 23-9-8, Exterior(2R) 23-9-8 to 29-0-5, Interior(1) 29-0-5 to 37-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 901 lb uplift at joint 7, 547 lb uplift at joint 8 and 236 lb uplift at joint 13.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314024
FRED_PERRY	A05	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:50 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-BcGc4YA9GTZyoc_ywCpc9Lnnq2HA?b1Uvi1ms0yw86R

5-3-12	10-4-0	16-0-0	22-0-0	26-10-0	31-8-0	31-10-0	37-0-0	38-0-0
5-3-12	5-0-4	5-8-0	6-0-0	4-10-0	4-10-0	5-4-0	1-0-0	

Scale = 1:66.3

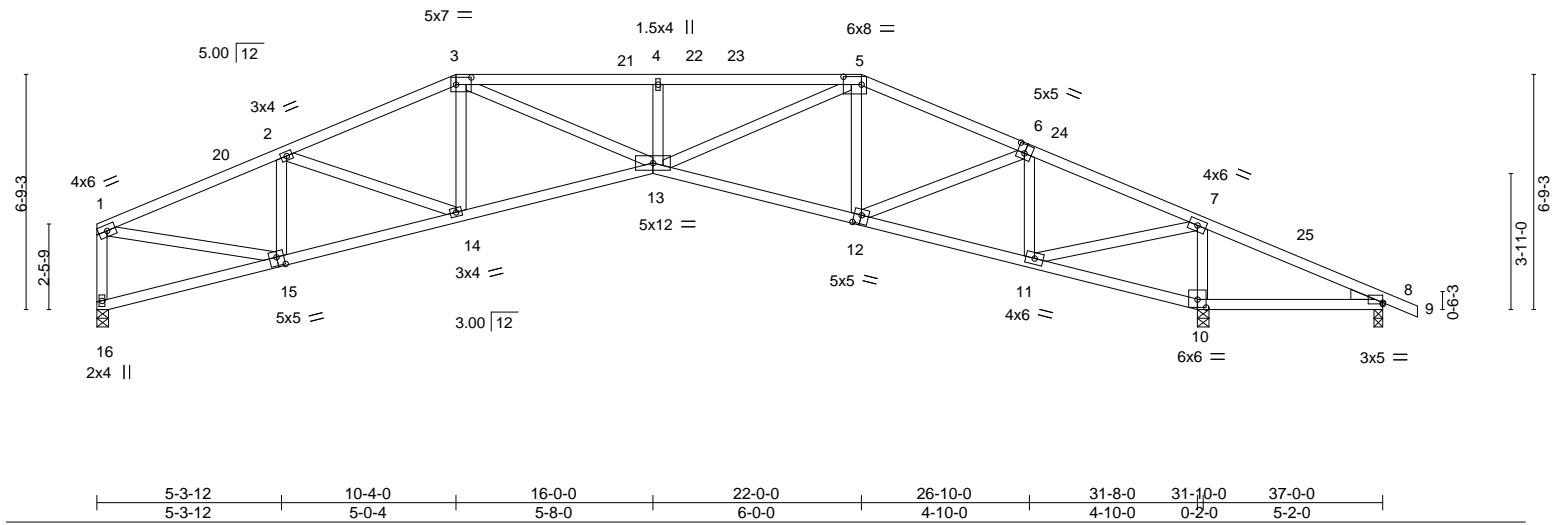


Plate Offsets (X,Y)--										[3:0-5-4,0-2-8], [5:0-6-4,0-2-12], [6:0-2-8,0-3-0], [8:0-0-0,0-0-7], [10:0-3-0,0-2-12], [12:0-2-8,0-3-0], [15:0-2-8,0-3-0]									
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.76	Vert(LL)	-0.21	13	>999	240		MT20		244/190			
TCDL	10.0	Lumber DOL		1.25		BC	0.57	Vert(CT)	-0.43	12-13	>879	180							
BCLL	0.0	Rep Stress Incr		YES		WB	0.49	Horz(CT)	0.25	10	n/a	n/a							
BCDL	10.0	Code FBC2020/TPI2014				Matrix-AS								Weight: 194 lb		FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 10=0-4-0, 8=0-3-0, 16=0-4-0
Max Horz 16=-242(LC 10)
Max Uplift 10=-456(LC 12), 8=-533(LC 21), 16=-248(LC 12)
Max Grav 10=2345(LC 1), 8=25(LC 12), 16=1134(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1739/514, 2-3=-2132/599, 3-4=-3157/813, 4-5=-3178/825, 5-6=-1592/491,
6-7=-689/237, 7-8=-357/1683, 1-16=-1088/342
BOT CHORD 15-16=-156/255, 14-15=-331/1683, 13-14=-295/1978, 12-13=-209/1492, 11-12=-68/614,
10-11=-1645/439, 8-10=-1471/386
WEBS 2-15=-593/225, 2-14=-15/445, 3-13=-266/1379, 4-13=-371/207, 5-13=-367/1897,
5-12=-481/159, 6-12=-173/933, 6-11=-955/297, 7-11=-469/2192, 7-10=-1782/525,
1-15=-387/1526

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-10-2, Interior(1) 3-10-2 to 10-4-0, Exterior(2R) 10-4-0 to 15-6-13, Interior(1) 15-6-13 to 22-0-0, Exterior(2R) 22-0-0 to 27-2-13, Interior(1) 27-2-13 to 38-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 16 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 456 lb uplift at joint 10, 533 lb uplift at joint 8 and 248 lb uplift at joint 16.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:51 2022 Page 1
 ID:obm8e8iJ6kih6VZ2?kAyzywB6i-foq_HtAn1nhpQmY9TwrKrhZJvCSctk29e8MmKOSy8w6Q
 6-3-12 12-4-0 20-0-0 25-10-0 31-8-0 37-0-0 38-0-0
 6-3-12 6-0-4 7-8-0 5-10-0 5-10-0 5-4-0 1-0-0

The diagram illustrates a roof truss system with the following components and dimensions:

- Members:**
 - Top chord: 19, 20, 21, 22, 23, 24, 25
 - Bottom chord: 15, 14, 13, 12, 11, 10, 9, 8
 - Verticals: 1, 2, 3, 4, 5, 6, 7
 - Diagonals: 16, 17, 18, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100
- Dimensions:**
 - Overall height: 7'-7.3"
 - Overall width: 3'-11.0"
 - Vertical spacing: 2'-5.9", 0'-6.3", 3'-11.0", 7'-7.3"
 - Horizontal spacing: 5.00' @ 12", 3.00' @ 12"
- Supports:**
 - Fixed support at the bottom left corner (Member 15).
 - Roller support at the bottom right corner (Member 8).
- Labels:**
 - Members are labeled with numbers 1 through 100.
 - Dimensions are given in feet and inches.
 - Supports are indicated by symbols: a fixed support (a square with a cross) and a roller support (a square with a circle).

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.92	Vert(LL) -0.15 12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.60	Vert(CT) -0.30 11-12	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.50	Horz(CT) 0.19 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS				Weight: 195 lb	FT = 20%

BRACING-	
TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1979/577, 2-3=-2222/625, 3-4=-2425/646, 4-5=-1931/574, 5-6=-1254/358,
6-7=-250/1196, 1-15=-1117/348

BOT CHORD 14-15=-172/299, 13-14=-382/1907, 12-13=-294/2049, 11-12=-263/1802, 10-11=-174/1139,
9-10=-1176/338, 7-9=-1023/287

WEBS 2-14=-532/223, 2-13=0/354, 3-12=-62/622, 4-12=-103/937, 4-11=-297/109,
5-11=-111/693, 5-10=-774/273, 6-10=-463/2226, 6-9=-1672/512, 1-14=-423/1697

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. I; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-10-2, Interior(1) 3-10-2 to 12-4-0, Exterior(2R) 12-4-0 to 17-6-13, Interior(1) 17-6-13 to 20-0-0, Exterior(2R) 20-0-0 to 25-2-13, Interior(1) 25-2-13 to 38-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 15 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 419 lb uplift at joint 9, 317 lb uplift at joint 7 and 253 lb uplift at joint 15.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 21, 2022



WARNING – verify design parameters READ NOTES ON THIS AND INCLUDED WITH REFERENCE AISC MHF-75-167, JF-8/2020 (BY ONE USER). Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2670 Cran Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314026
FRED_PERRY	A07	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:52 2022 Page 1
ID:obm8e8iJ6kih6vZ2?kAyzwB6i-7?OMVDBPo5pg2w7L1ds4Ems4jrwntUEnM0Wtxuyw86P

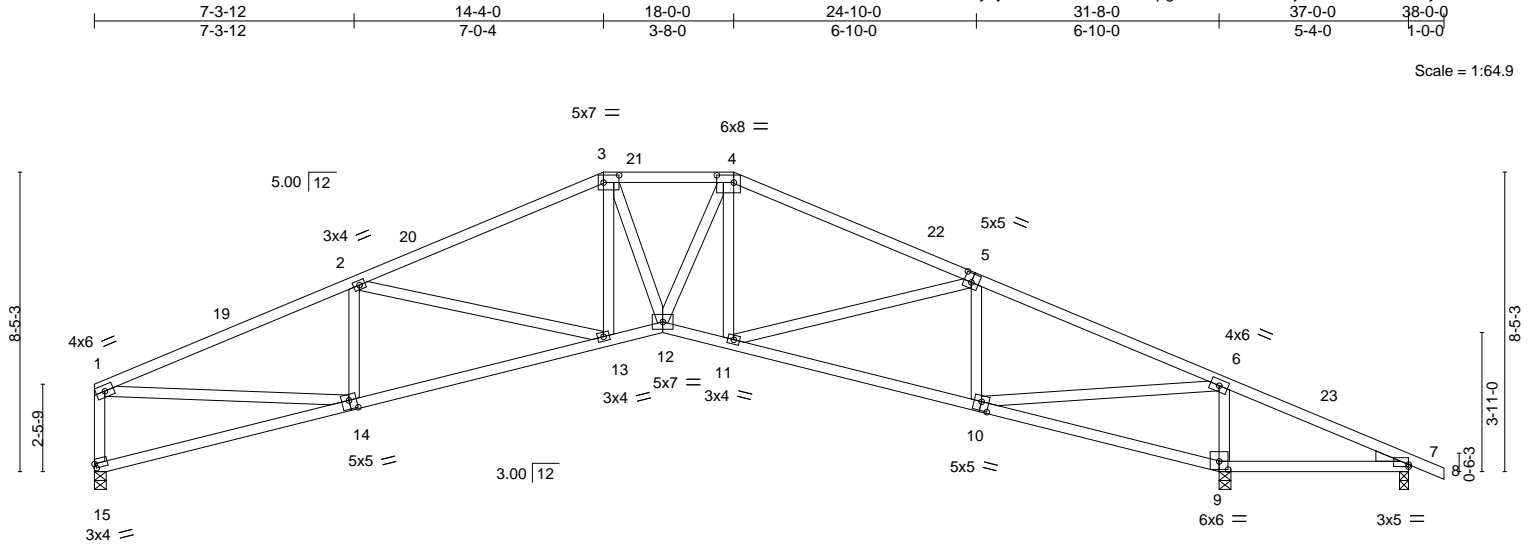


Plate Offsets (X,Y)--	[3:0-5-4,0-2-8], [4:0-5-12,0-2-8], [5:0-2-8,0-3-0], [7:0-0-0,0-0-11], [9:0-3-0,0-2-12], [10:0-2-8,0-3-0], [14:0-2-8,0-3-0], [15:0-0-6,0-1-8]
-----------------------	--


LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.93	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.75	Vert(LL) -0.15 13-14 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.51	Vert(CT) -0.36 13-14 >999 180		
BCDL 10.0	Code FBC2020/TP12014	Matrix-AS	Horz(CT) 0.18 9 n/a n/a		
				Weight: 201 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	
WEDGE	
Right: 2x4 SP No.3	

REACTIONS. (size) 9=0-4-0, 7=0-3-0, 15=0-4-0
Max Horz 15=-289(LC 10)
Max Uplift 9=-414(LC 12), 7=-242(LC 17), 15=-254(LC 12)
Max Grav 9=2040(LC 1), 15=1178(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2151/609, 2-3=-2161/571, 3-4=-2037/599, 4-5=-2021/545, 5-6=-1500/416,
6-7=-218/1034, 1-15=-1120/363
BOT CHORD 14-15=-189/343, 13-14=-402/2069, 12-13=-216/1953, 11-12=-212/1853, 10-11=-218/1392,
9-10=-1020/301, 7-9=-870/254
WEBS 2-14=-470/216, 3-13=0/374, 3-12=-114/387, 4-12=-126/602, 5-11=-0/565,
5-10=-695/237, 6-10=-469/2273, 6-9=-1628/523, 1-14=-445/1819

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-10-2, Interior(1) 3-10-2 to 14-4-0, Exterior(2E) 14-4-0 to 18-0-0, Exterior(2R) 18-0-0 to 23-2-13, Interior(1) 23-2-13 to 38-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 15 considers parallel to grain value using ANSI/TP1 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 414 lb uplift at joint 9, 242 lb uplift at joint 7 and 254 lb uplift at joint 15.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

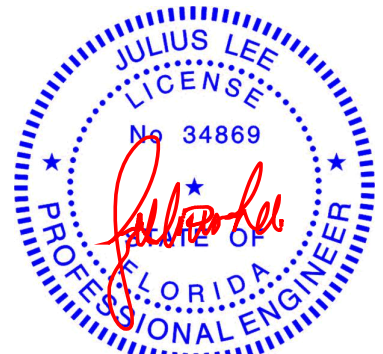

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314027
FRED_PERRY	A08	Roof Special	7	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:54 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAzywB6i-3NW7wvDfKi3OHEHj92uYJBxQ7fZixNW4qK?_?nyw86N

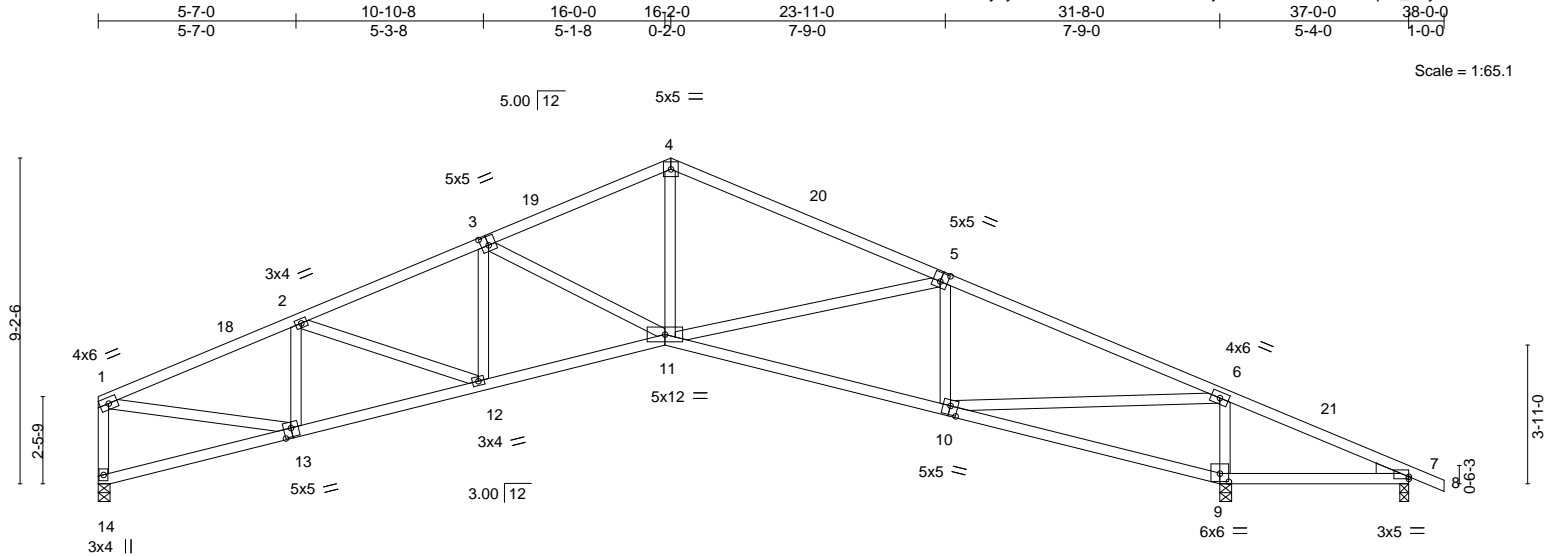


LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.94	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.88	Vert(LL) -0.24 10-11 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.53	Vert(CT) -0.53 10-11 >708 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.18 9 n/a n/a		
	Code FBC2020/TPI2014			Weight: 194 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 4-5: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	
WEDGE	
Right: 2x4 SP No.3	

REACTIONS. (size) 9=0-4-0, 7=0-3-0, 14=0-4-0
Max Horz 14=-310(LC 10)
Max Uplift 9=-411(LC 12), 7=-210(LC 17), 14=-255(LC 12)
Max Grav 9=2002(LC 1), 14=1184(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1889/517, 2-3=-2247/591, 3-4=-2017/547, 4-5=-2007/535, 5-6=-1696/443,
6-7=-187/930, 1-14=-1135/347
BOT CHORD 13-14=-225/328, 12-13=-340/1878, 11-12=-296/2101, 10-11=-225/1562, 9-10=-919/274,
7-9=-771/226
WEBS 2-13=-609/229, 2-12=0/318, 5-10=-599/221, 6-10=-441/2336, 6-9=-1610/521,
1-13=-409/1658, 4-11=-116/1054, 3-11=-309/159, 5-11=-52/431

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-10-2, Interior(1) 3-10-2 to 16-2-0, Exterior(2R) 16-2-0 to 19-10-7, Interior(1) 19-10-7 to 38-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 411 lb uplift at joint 9, 210 lb uplift at joint 7 and 255 lb uplift at joint 14.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

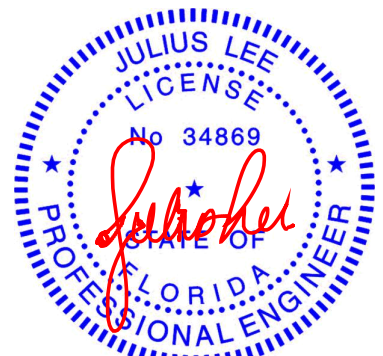

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314028
FRED_PERRY	A09	Common Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:55 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-YZ4V7FEI50BFvOswilPnsPUgd3u6govD2_kXXDyW86M



Scale = 1:67.8

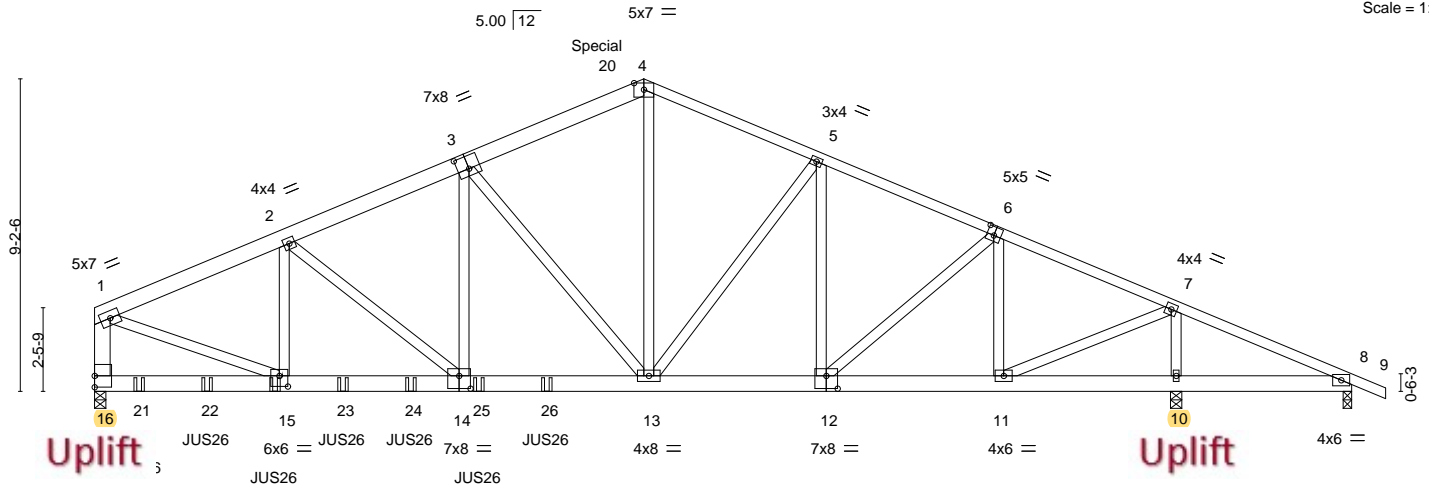


Plate Offsets (X,Y)--	[3:0-4-0,0-4-8], [6:0-2-8,0-3-0], [12:0-4-0,0-4-8], [14:0-4-0,0-4-8], [15:0-3-0,0-3-12]
-----------------------	---


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.63	Vert(LL) 0.13	13-14	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.90	Vert(CT) -0.22	13-14	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.65	Horz(CT) 0.04	10	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014	Matrix-MS					Weight: 543 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 4-6,6-9: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-9-2 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2 *Except* 12-14: 2x6 SP SS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 10-11,8-10.
WEBS 2x4 SP No.2 *Except* 1-16: 2x6 SP No.2	

REACTIONS. (size) 16=0-4-0, 10=0-4-0, 8=0-3-0
Max Horz 16=-304(LC 23)
Max Uplift 16=-1529(LC 8), 10=-1056(LC 8), 8=-382(LC 17)
Max Grav 16=5392(LC 1), 10=3827(LC 1), 8=184(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-6199/1863, 2-3=-5934/1872, 3-4=-4524/1466, 4-5=-4463/1456, 5-6=-4070/1270,
6-7=-2966/864, 7-8=-342/1211, 1-16=-4627/1392
BOT CHORD 15-16=-268/476, 14-15=-1555/5653, 13-14=-1455/5379, 12-13=-926/3742,
11-12=-631/2699, 10-11=-1055/375, 8-10=-1055/375
WEBS 2-15=-359/324, 2-14=-364/144, 3-14=-525/1692, 3-13=-2157/740, 4-13=-594/1893,
5-13=-529/755, 5-12=-894/328, 6-12=-387/1378, 6-11=-1610/533, 7-11=-1087/4062,
7-10=-3553/1068, 1-15=-1659/5729

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1529 lb uplift at joint 16, 1056 lb uplift at joint 10 and 382 lb uplift at joint 8.
 - Use MiTek JUS26 (With 4-10d nails into Girder & 4-10d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-3-12

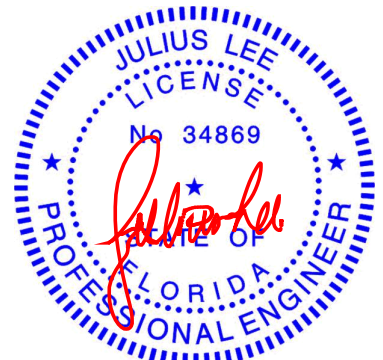

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314028
FRED_PERRY	A09	Common Girder	1	2	Job Reference (optional)	

- NOTES-**
- 10) Fill all nail holes where hanger is in contact with lumber.
 - 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1491 lb down and 493 lb up at 15-4-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-60, 4-9=-60, 16-17=-20

Concentrated Loads (lb)

Vert: 15=-638(B) 20=-1455(B) 21=-638(B) 22=-638(B) 23=-638(B) 24=-638(B) 25=-638(B) 26=-638(B)




Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314029
FRED_PERRY	B01	Half Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:04:59 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzyywB6i-QLJ0zcHo8EigN?AhxbUj0FfPQgGBcYYpzcilg_yw86l

1-0-0	3-8-9	7-2-8	13-2-4	19-0-4	24-10-4	30-8-4	36-8-0
1-0-0	3-8-9	3-5-15	5-11-12	5-10-0	5-10-0	5-10-0	5-11-12

Scale: 3/16"=1'

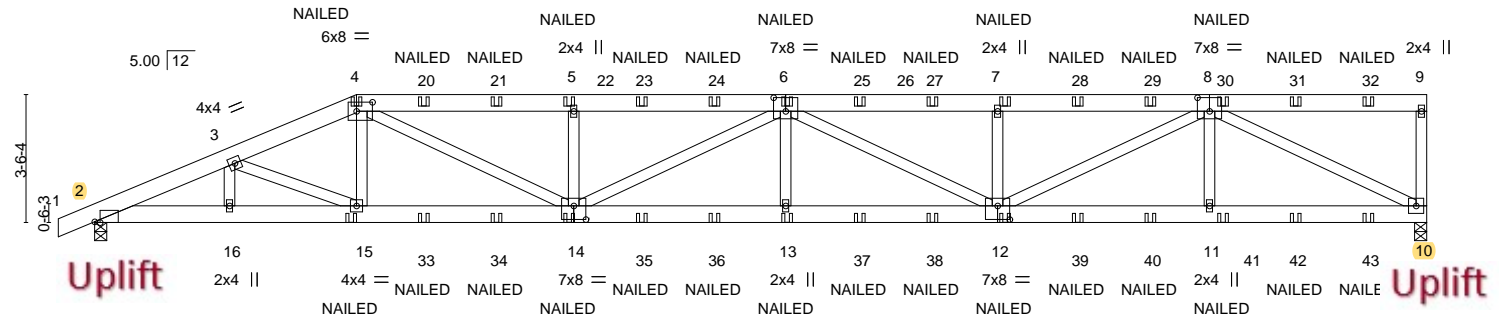

3-8-9	7-2-8	13-2-4	19-0-4	24-10-4	30-8-4	36-8-0
3-8-9	3-5-15	5-11-12	5-10-0	5-10-0	5-10-0	5-11-12

LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) I/defl L/d				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.39	Vert(LL)	0.31	13	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.89	Vert(CT)	-0.58	13-14	>755	180			
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.92	Horz(CT)	0.13	10	n/a	n/a			
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 503 lb	FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	


REACTIONS. (size) 10=0-4-0, 2=0-4-0
Max Horz 2=167(LC 7)
Max Uplift 10=738(LC 8), 2=675(LC 8)
Max Grav 10=3205(LC 1), 2=2802(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-6240/1433, 3-4=-6365/1462, 4-5=-8816/2126, 5-6=-8816/2126, 6-7=-8493/2055, 7-8=-8493/2055, 9-10=-370/194
BOT CHORD 2-16=-1292/5711, 15-16=-1292/5711, 14-15=-1274/5884, 13-14=-2103/9567, 12-13=-2103/9567, 11-12=-1104/5212, 10-11=-1104/5212
WEBS 3-15=-263/364, 4-15=0/482, 4-14=-842/3295, 5-14=-829/461, 6-14=-849/105, 6-13=0/560, 6-12=-1213/170, 7-12=-864/476, 8-12=-962/3705, 8-11=0/554, 8-10=-5790/1273

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCCL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 738 lb uplift at joint 10 and 675 lb uplift at joint 2.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

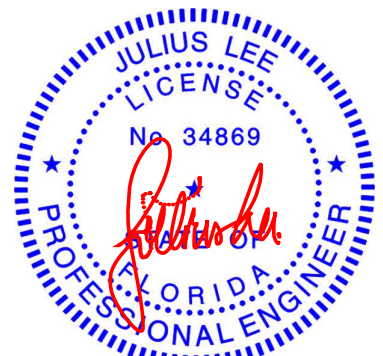

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314029
FRED_PERRY	B01	Half Hip Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-4=-60, 4-9=-60, 10-17=-20
- Concentrated Loads (lb)
- Vert: 4=-137(B) 15=-65(B) 14=-65(B) 5=-137(B) 6=-137(B) 13=-65(B) 12=-65(B) 7=-137(B) 20=-137(B) 21=-137(B) 23=-137(B) 24=-137(B) 25=-137(B) 27=-137(B) 28=-137(B) 29=-137(B) 30=-137(B) 31=-137(B) 32=-137(B) 33=-65(B) 34=-65(B) 35=-65(B) 36=-65(B) 37=-65(B) 38=-65(B) 39=-65(B) 40=-65(B) 41=-65(B) 42=-65(B) 43=-65(B)

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314030
FRED_PERRY	B02	Half Hip	1	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:01 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAzywB6i-MjRmOI13gsyOdJJ430WB5gkexUza4WG6RwBslyw86G



Scale: 3/16"=1'

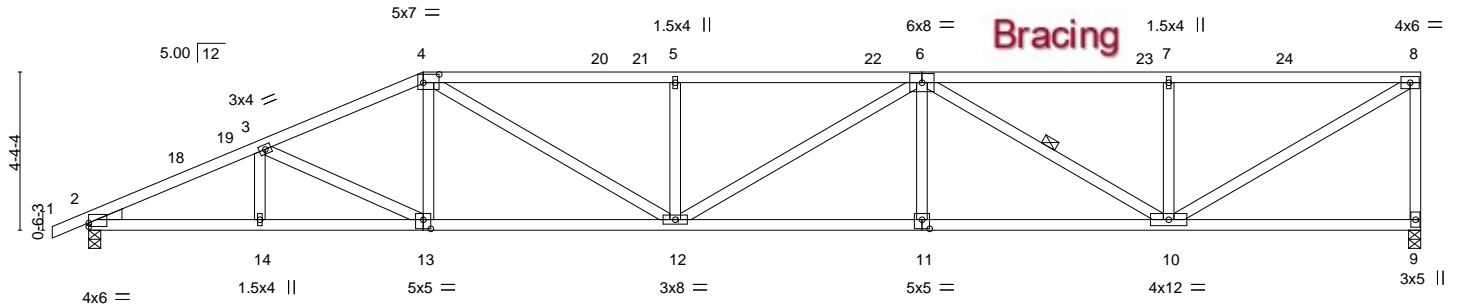

4-8-9	9-2-8	16-1-12	22-11-4	29-8-12	36-8-0
4-8-9	4-5-15	6-11-4	6-9-8	6-9-8	6-11-4


Plate Offsets (X,Y)-- [2:0-0-0,0-1-3], [4:0-5-4,0-2-12], [11:0-2-8,0-3-0], [13:0-2-8,0-3-0]					
LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.77	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.77	Vert(LL) 0.26 11-12 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.65	Vert(CT) -0.53 11-12 >828 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.12 9 n/a n/a		
	Code FBC2020/TP12014			Weight: 196 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 6-10
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. (size) 9=0-4-0, 2=0-4-0
Max Horz =2=216(LC 11)
Max Uplift 9=312(LC 12), 2=361(LC 12)
Max Grav 9=1460(LC 1), 2=1522(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3009/779, 3-4=-2745/778, 4-5=-3330/935, 5-6=-3330/935, 6-7=-2081/594,
7-8=-2081/594, 8-9=-1396/422
BOT CHORD 2-14=-918/2705, 13-14=-918/2705, 12-13=-806/2504, 11-12=-849/3065, 10-11=-849/3065
WEBS 3-13=-265/125, 4-13=-9/280, 4-12=-213/1056, 5-12=-482/265, 6-12=-112/308,
6-10=-1147/308, 7-10=-481/262, 8-10=-613/2379

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-8-0, Interior(1) 2-8-0 to 9-2-8, Exterior(2R) 9-2-8 to 14-4-12, Interior(1) 14-4-12 to 36-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 312 lb uplift at joint 9 and 361 lb uplift at joint 2.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

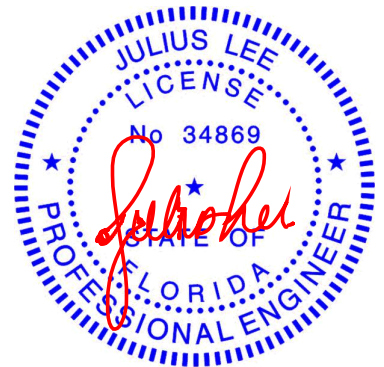

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314031
FRED_PERRY	C01	Common	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:02 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-qw?8beJhR94FESuGdj1QetGw_tOup1YFfaxPHJyw86F

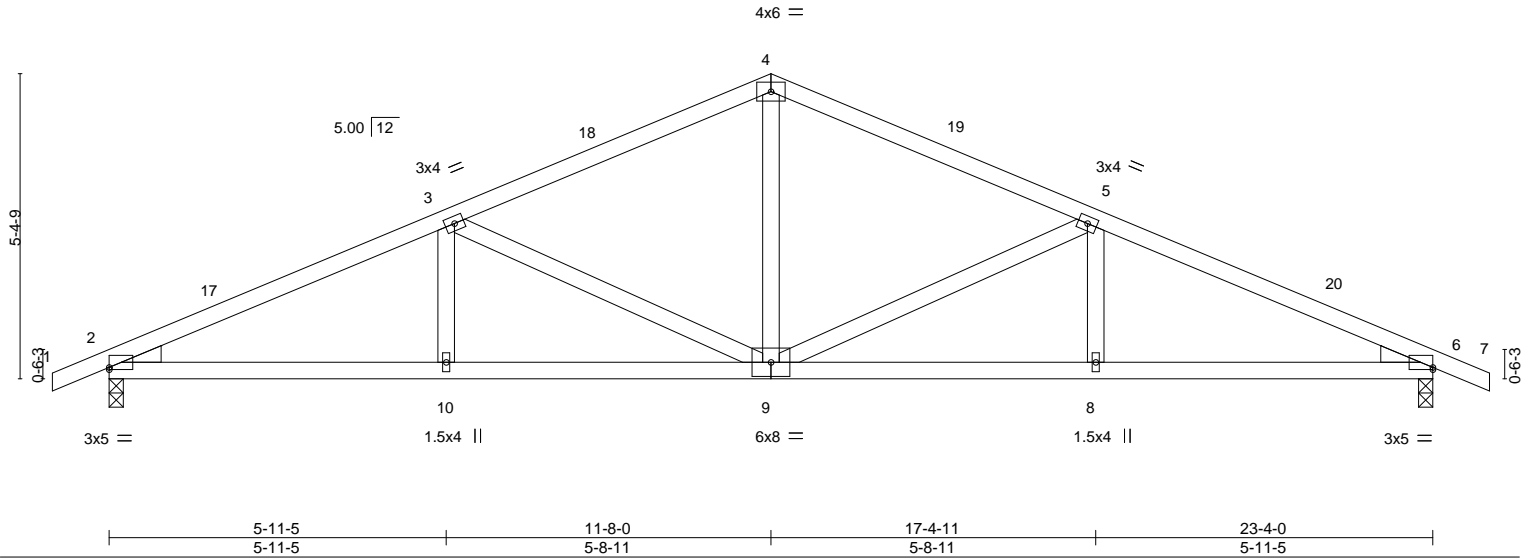

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.37	Vert(LL)	-0.08	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.19				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.40	Horz(CT)	0.06				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							
								Weight: 110 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2		
WEDGE			
Left: 2x4 SP No.3 , Right: 2x4 SP No.3			

REACTIONS.	
(size)	2=0-3-0, 6=0-3-0
Max Horz	2=-128(LC 10)
Max Uplift	2=-250(LC 12), 6=-250(LC 12)
Max Grav	2=993(LC 1), 6=993(LC 1)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-1790/591, 3-4=-1249/498, 4-5=-1249/498, 5-6=-1790/591
BOT CHORD	2-10=-447/1586, 9-10=-447/1586, 8-9=-456/1586, 6-8=-456/1586
WEBS	4-9=-144/568, 5-9=-579/240, 3-9=-579/240

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 11-8-0, Exterior(2R) 11-8-0 to 14-8-0, Interior(1) 14-8-0 to 24-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 250 lb uplift at joint 2 and 250 lb uplift at joint 6.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:03 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzyywB6i-J6ZWp_KJCTC6scTSARyFA5p54Hk9YUhPuEgypmyw86E

5-11-5	11-8-0	17-4-11	23-4-0
5-11-5	5-8-11	5-8-11	5-11-5

The diagram illustrates a roof truss system with the following components:


- Members:**
 - Top chord: 15, 16, 17, 18
 - Bottom chord: 3x5 =
 - Vertical supports: 1.5x4 ||, 6x8 =, 1.5x4 ||, 3x5 =
 - Diagonal bracing: 2, 4
- Joints:** 1, 2, 3, 4, 6, 7, 8
- Supports:**
 - Left support: 3x5 =
 - Right support: 3x5 =
- Dimensions:**
 - Horizontal spans: 5-11-5, 11-8-0, 17-4-11, 23-4-0
 - Vertical height: 5-4-9
 - Roof pitch: 5.00 | 12

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied. Rigid ceiling directly applied.
BOT CHORD	2x4 SP No.2	BOT CHORD	
WEBS	2x4 SP No.2		
WEDGE			
Left: 2x4 SP No.3 , Right: 2x4 SP No.3			

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-1804/605, 2-3=-1256/505, 3-4=-1256/505, 4-5=-1804/605
BOT CHORD	1-8=-491/1600, 7-8=-491/1600, 6-7=-482/1600, 5-6=-482/1600
WEBS	3-7=-151/574, 4-7=-588/244, 2-7=-588/244

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl.; GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-8-0, Exterior(2R) 11-8-0 to 14-8-0, Interior(1) 14-8-0 to 23-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 199 lb uplift at joint 1 and 199 lb uplift at joint 5.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

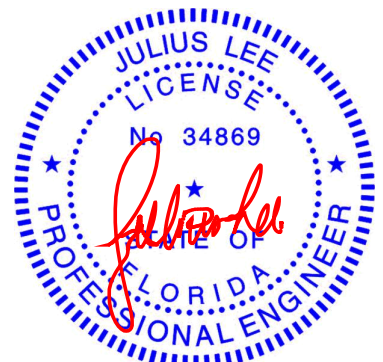

July 21, 2022



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314033
FRED_PERRY	C03	Common	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:05 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-FVhHDg LZk4Sq5wdrIsa7GWuRD5Q30PlIMY93ueyw86C

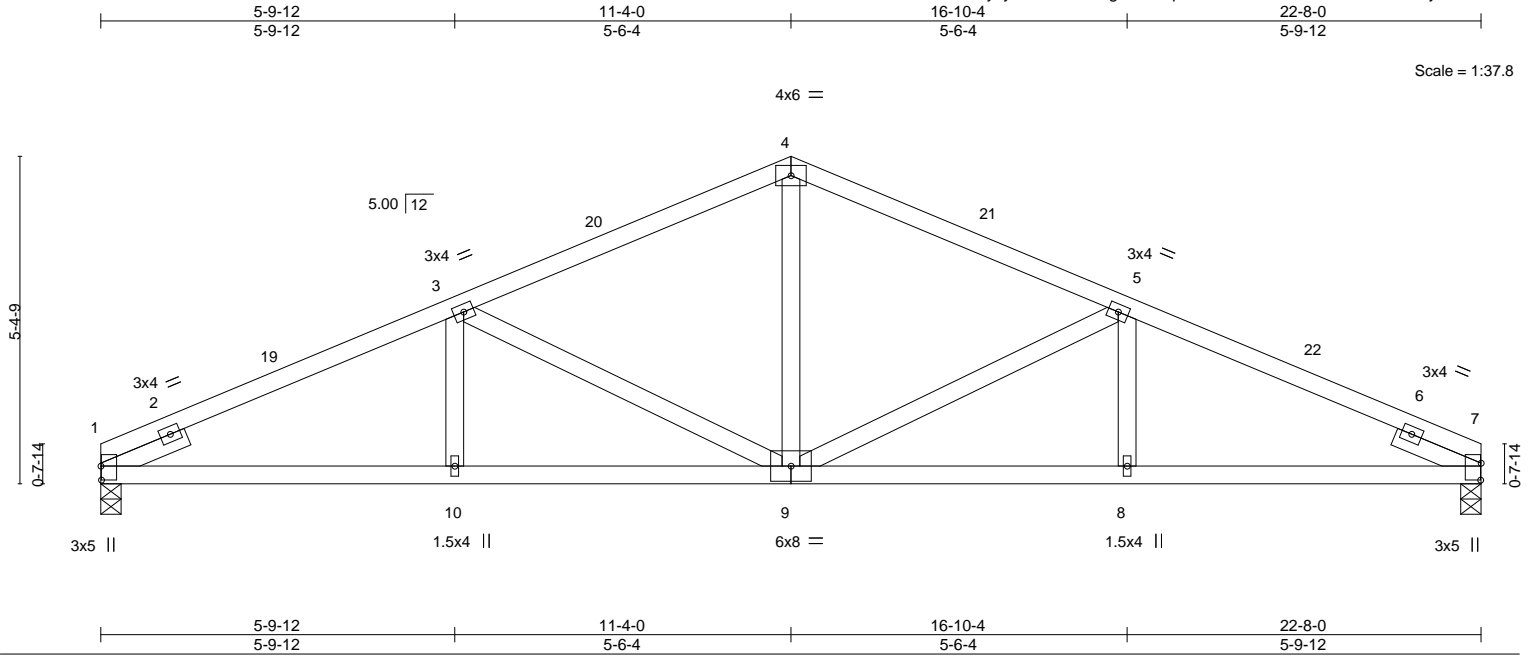


Plate Offsets (X,Y)-- [1:0-2-12,0-0-2], [5:0-0-0,0-0-0], [7:0-0-0,0-0-0], [7:0-3-5,0-0-2]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.37	Vert(LL) -0.07	8-9	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.48	Vert(CT) -0.17	8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.33	Horz(CT) 0.05	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS					Weight: 107 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
SLIDER Left 2x4 SP No.2 1-6-0, Right 2x4 SP No.2 1-6-0


BRACING-
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 1=0-4-0, 7=0-4-0
Max Horz 1=115(LC 11)
Max Uplift 1=193(LC 12), 7=193(LC 12)
Max Grav 1=907(LC 1), 7=907(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-1635/574, 3-4=-1186/492, 4-5=-1186/492, 5-7=-1634/574
BOT CHORD 1-10=-457/1455, 9-10=-457/1455, 8-9=-449/1455, 7-8=-449/1455
WEBS 3-9=-508/219, 4-9=-142/522, 5-9=-508/219

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-4-0, Exterior(2R) 11-4-0 to 14-4-0, Interior(1) 14-4-0 to 22-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 193 lb uplift at joint 1 and 193 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

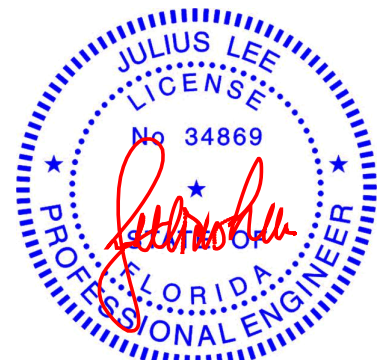

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314034
FRED_PERRY	C4GE	Common Supported Gable	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:07 2022 Page 1

ID:obm8e8iJ6kih6vZZ2?kAyzywB6i-Bto1eMNPgiiYLEnDPHdbLx_rGuBfUOL_pseAyXyw86A

23-4-0 24-4-0 1-0-0

Scale = 1:42.0

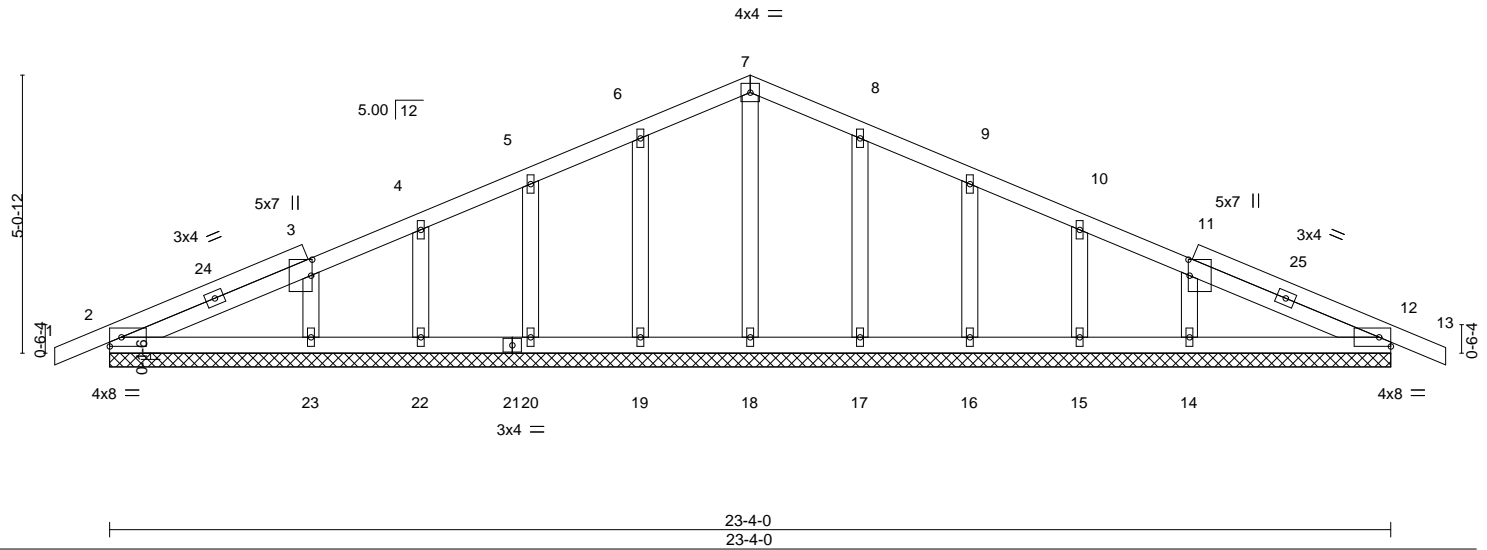


Plate Offsets (X,Y)-- [3:0-3-8,0-0-4], [11:0-3-8,0-0-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.08	Vert(LL)	0.00	12	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	0.00	13	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	12	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 122 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 23-4-0.
(lb) - Max Horz 2=120(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 19, 20, 22, 23, 17, 16, 15, 14
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 18, 19, 20, 22, 17, 16, 15 except 23=260(LC 17),
14=258(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) -1-0-0 to 2-0-0, Exterior(2N) 2-0-0 to 11-8-0, Corner(3R) 11-8-0 to 14-8-0, Exterior(2N) 14-8-0 to 24-4-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 19, 20, 22, 23, 17, 16, 15, 14.

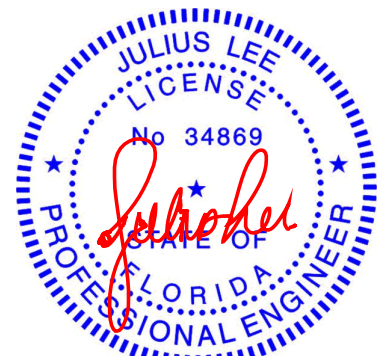

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314035
FRED_PERRY	CJ01	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:09 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-7Gwo31O4oJyFaXxcXhf3QM34cil_yDrHGA7H1Pyw868



Scale: 1/2"=1'

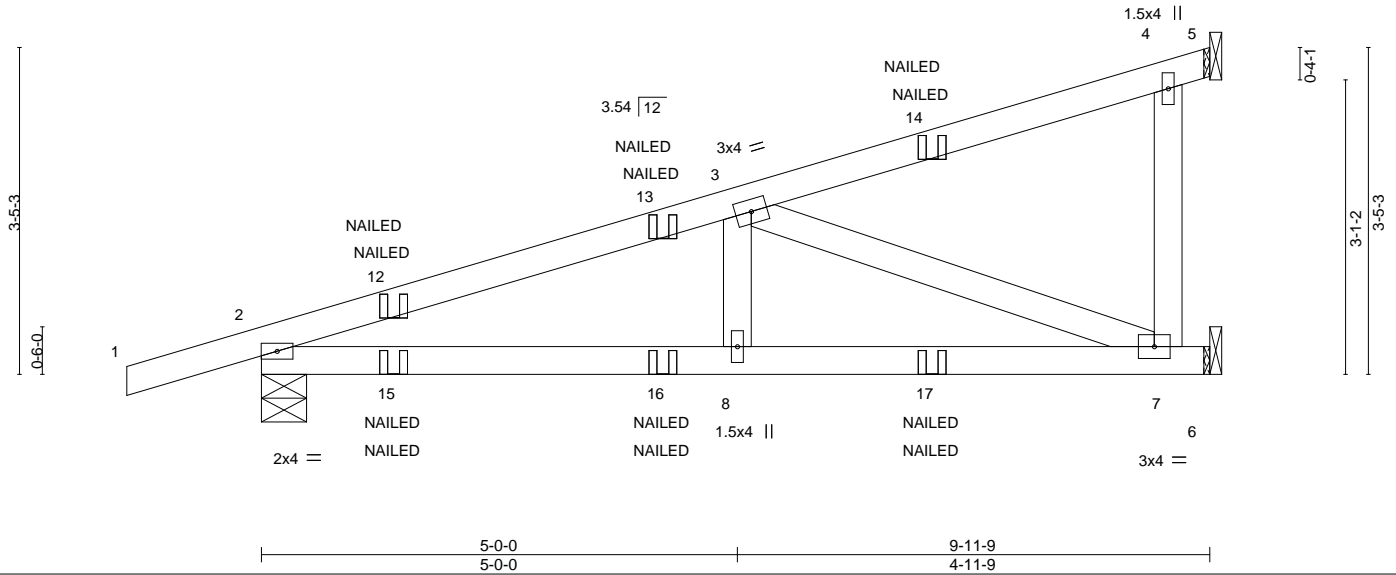

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.53	Vert(LL) -0.05	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.61	Vert(CT) -0.12	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.36	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 45 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-5-11, 6=Mechanical
Max Horz 2=146(LC 8)
Max Uplift 2=-153(LC 8), 6=-212(LC 8)
Max Grav 5=225(LC 3), 2=530(LC 1), 6=367(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-922/139
BOT CHORD 2-8=-213/849, 7-8=-213/849
WEBS 3-8=0/267, 3-7=-905/227

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=153, 6=212.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 14=-95(F=-48, B=-48) 15=10(F=5, B=5) 16=-11(F=-5, B=-5) 17=-61(F=-31, B=-31)

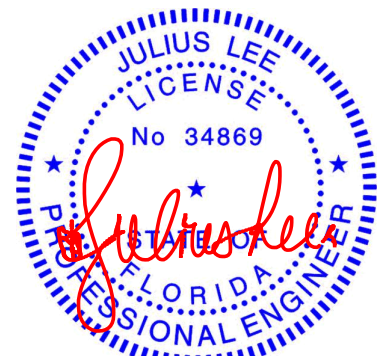

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314036
FRED_PERRY	D01	Common	9	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:10 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-bSUAHNPIZd46ChVo5PAIzZcI9677hg4RVqtqZsyw867

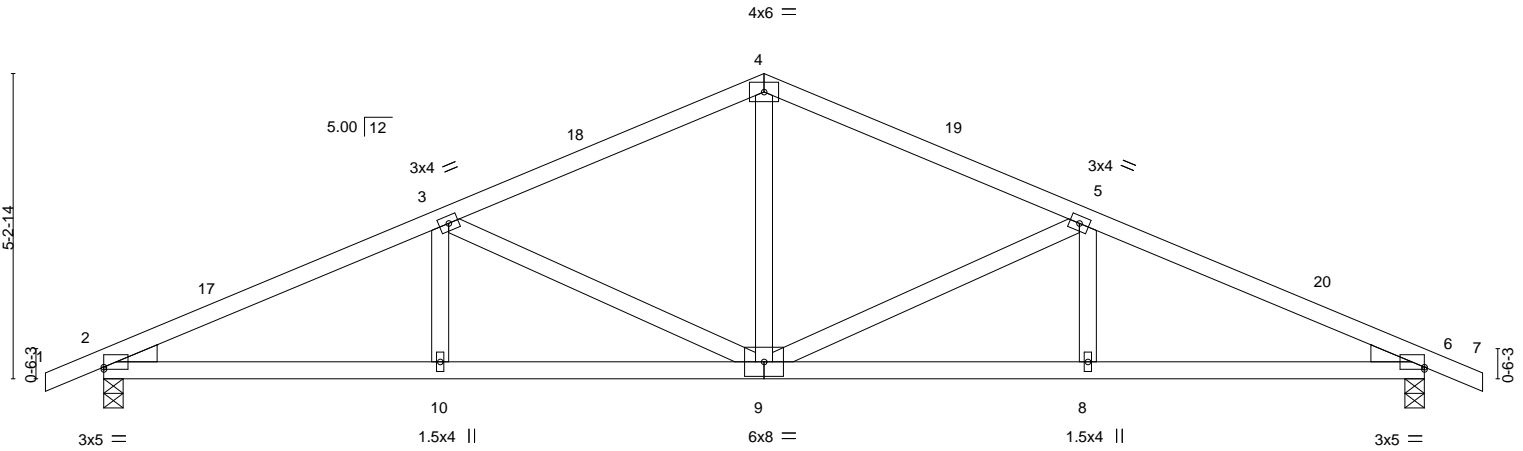


Plate Offsets (X,Y)--	[2:0-0-0,0-0-7], [6:Edge,0-0-7]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.49	Vert(LL) -0.08 9-10 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.36	Vert(CT) -0.18 9-10 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.05 6 n/a n/a		
	Code FBC2020/TPI2014			Weight: 107 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3, Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-4-0, 6=0-4-0
Max Horz 2=125(LC 11)
Max Uplift 2=244(LC 12), 6=244(LC 12)
Max Grav 2=967(LC 1), 6=967(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1732/585, 3-4=-1212/492, 4-5=-1212/493, 5-6=-1732/585
BOT CHORD 2-10=-441/1535, 9-10=-441/1535, 8-9=-451/1535, 6-8=-451/1535
WEBS 4-9=-144/549, 5-9=-558/237, 3-9=-558/237

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 11-4-0, Exterior(2R) 11-4-0 to 14-4-0, Interior(1) 14-4-0 to 23-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=244, 6=244.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314037
FRED_PERRY	D02	Common	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:11 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-4e2YUjQKKwCzpr4?e6hXVn8TuWTMQ6EakUcN6lyw866

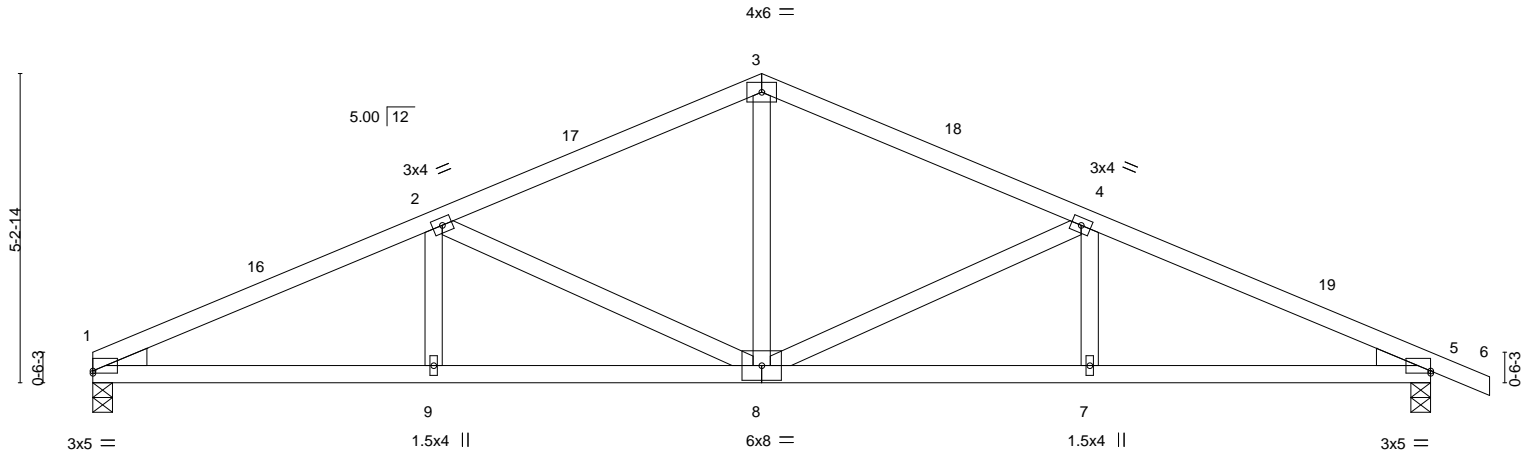

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	-0.08	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.18				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.37	Horz(CT)	0.05				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							
								Weight: 105 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

REACTIONS.

(size) 1=0-4-0, 5=0-4-0
Max Horz 1=-124(LC 10)
Max Uplift 1=-192(LC 12), 5=-245(LC 12)
Max Grav 1=905(LC 1), 5=968(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1743/598, 2-3=-1215/498, 3-4=-1215/494, 4-5=-1735/590
BOT CHORD 1-9=-450/1546, 8-9=-450/1546, 7-8=-456/1537, 5-7=-456/1537
WEBS 3-8=-150/552, 4-8=-558/237, 2-8=-567/241

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-4-0, Exterior(2R) 11-4-0 to 14-4-0, Interior(1) 14-4-0 to 23-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=192, 5=245.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314038
FRED_PERRY	D3GE	Common Supported Gable	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:12 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-Yrcwh3Ry5ELqR?fBCqCm2_hi7vu39eekz8Mxekyw865



Scale = 1:40.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.07	Vert(LL)	0.00	14	n/r	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.07	Vert(CT)	0.00	14	n/r		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.04	Horz(CT)	0.00	14	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						
	Code FBC2020/TPI2014						Weight: 118 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 22-8-0.
(lb) - Max Horz 2=117(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 21, 22, 24, 25, 19, 18, 17, 16
Max Grav All reactions 250 lb or less at joint(s) 2, 14, 20, 21, 22, 24, 25, 19, 18, 17, 16

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) -1-0-0 to 2-0-0, Exterior(2N) 2-0-0 to 11-4-0, Corner(3R) 11-4-0 to 14-4-0, Exterior(2N) 14-4-0 to 23-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 21, 22, 24, 25, 19, 18, 17, 16.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314039
FRED_PERRY	G01	Common	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:13 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-019lvPSarYTh39ENmXk?acEgnJ51u2BtBn5UAAyW864

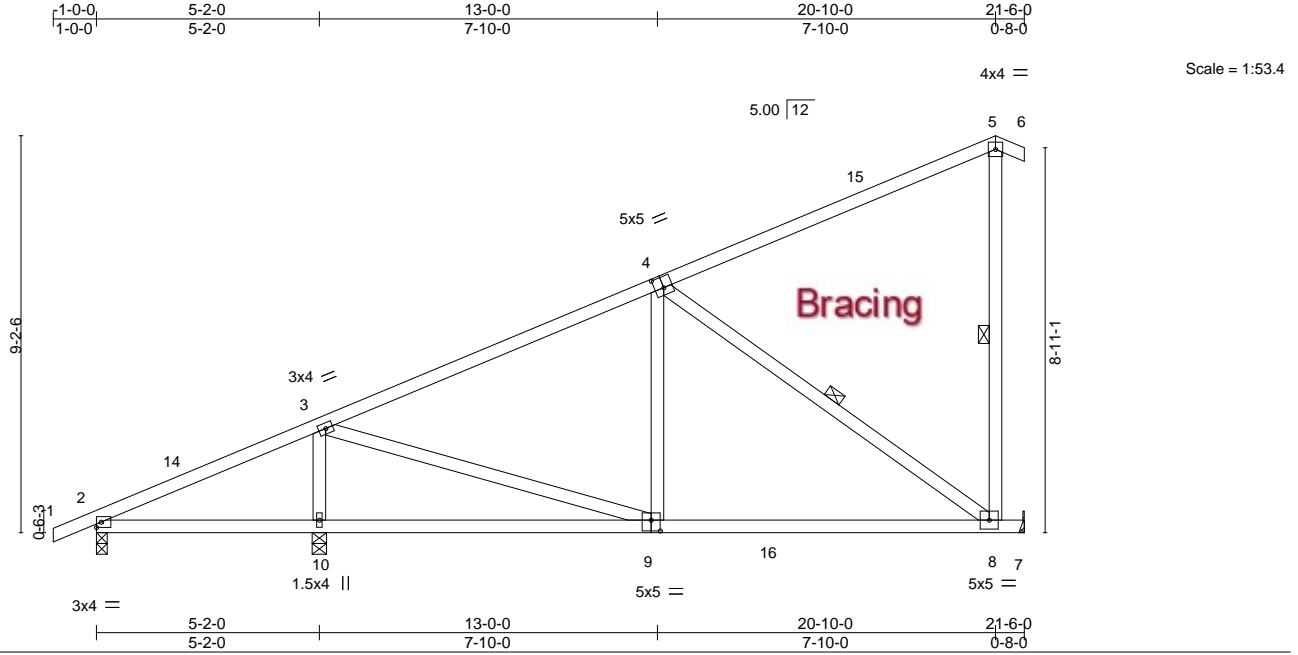


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0], [9:0-2-8,0-3-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.91	Vert(LL)	-0.40	8-9	>485	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.66	Vert(CT)	-0.78	8-9	>249	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	-0.01	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 118 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
7-9: 2x4 SP SS
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-8, 5-8

REACTIONS.


(size) 2=0-3-0, 10=0-4-0, 7=Mechanical
Max Horz 2=357(LC 12)
Max Uplift 2=-127(LC 16), 10=-253(LC 12), 7=-221(LC 12)
Max Grav 2=31(LC 9), 10=1496(LC 17), 7=659(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-341/726, 3-4=-478/0
BOT CHORD 2-10=-538/0, 9-10=-538/0, 8-9=-207/394
WEBS 3-10=-1187/486, 3-9=-126/973, 4-8=-488/257, 5-8=-274/253

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 20-10-0, Exterior(2E) 20-10-0 to 21-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=127, 10=253, 7=221.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

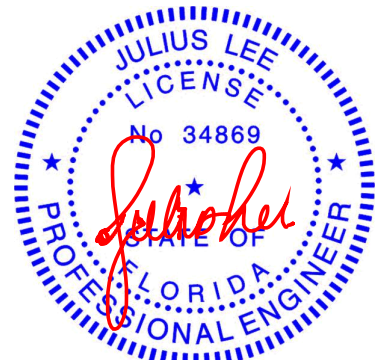

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314040
FRED_PERRY	G02	Common	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:14 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-UDjh6iSCcrbYglpZKFFE7PmsljQHdU00QRr2idyw863

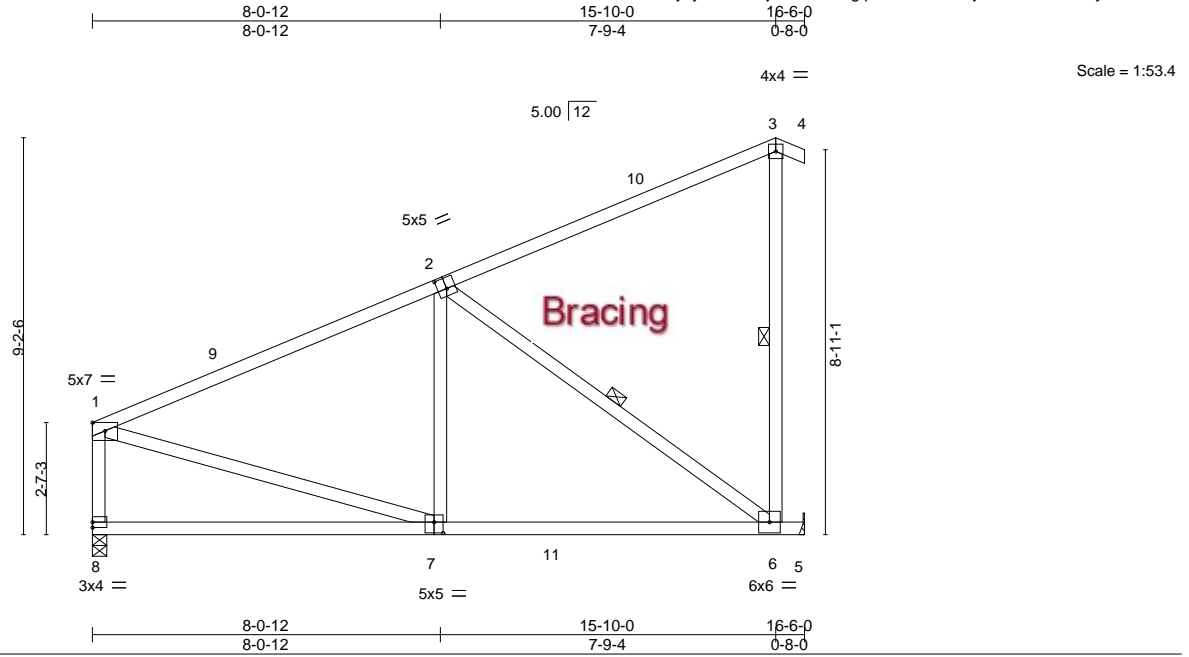


Plate Offsets (X,Y)-- [1:Edge,0-2-5], [2:0-2-8,0-3-0], [7:0-2-8,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.89	Vert(LL)	-0.43	6-7	>457	240	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.73	Vert(CT)	-0.83	6-7	>235	180		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.30	Horz(CT)	-0.01	5	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS						Weight: 101 lb	FT = 20%
	Code FBC2020/TPI2014								

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
5-7: 2x4 SP SS
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 3-6, 2-6

REACTIONS.

(size) 8=0-4-0, 5=Mechanical
Max Horz 8=322(LC 12)
Max Uplift 8=55(LC 12), 5=259(LC 12)
Max Grav 8=747(LC 17), 5=787(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-684/106, 1-8=-588/215
BOT CHORD 7-8=-490/323, 6-7=-340/580
WEBS 2-7=0/294, 1-7=0/382, 3-6=-272/293, 2-6=-722/423

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 15-10-0, Exterior(2E) 15-10-0 to 16-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 5=259.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314041
FRED_PERRY	G03	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:15 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-yQH3K5TrN9jPISOmtyTgdJ697paMyQAf5abF3yw862

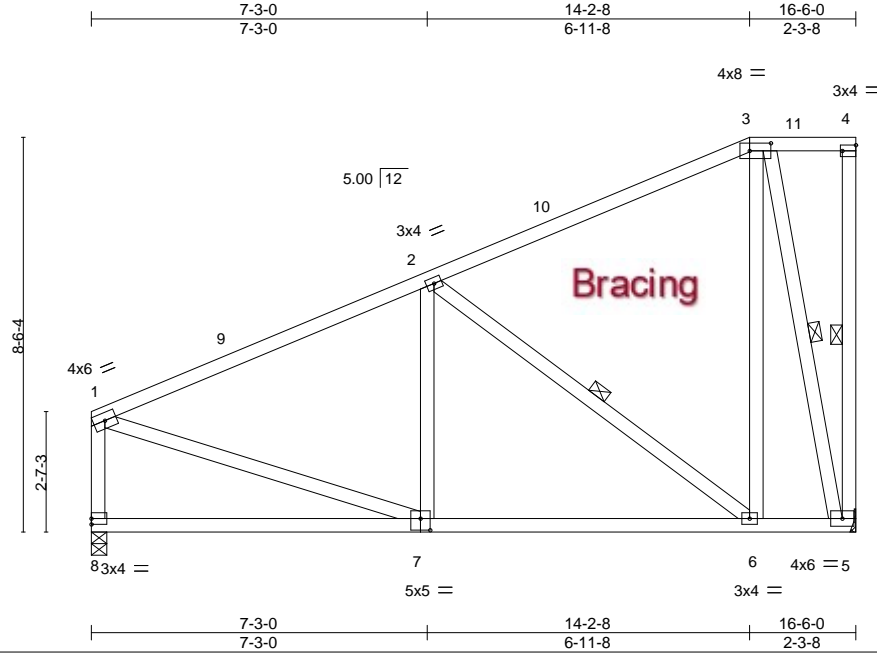


Plate Offsets (X,Y)-- [3:0-5-8,0-2-0], [4:Edge,0-1-8], [7:0-2-8,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.53	Vert(LL)	-0.10	6-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.53	Vert(CT)	-0.20	6-7	>963	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.23	Horz(CT)	0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 121 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-5, 2-6, 3-5

REACTIONS.

(size) 5=Mechanical, 8=0-4-0
Max Horz 8=417(LC 9)
Max Uplift 5=185(LC 9), 8=124(LC 12)
Max Grav 5=650(LC 17), 8=648(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-659/246, 2-3=-332/212, 1-8=-567/277
BOT CHORD 7-8=-589/519, 6-7=-486/659, 5-6=-220/300
WEBS 2-6=-491/333, 3-6=-145/500, 3-5=-694/407, 1-7=-147/478

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 14-2-8, Exterior(2E) 14-2-8 to 16-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=185, 8=124.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314043
FRED_PERRY	G05	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:17 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-uoPplmV5vmz7YmY8?Noxl2OU3wX8qsWT6P3iJyyw860

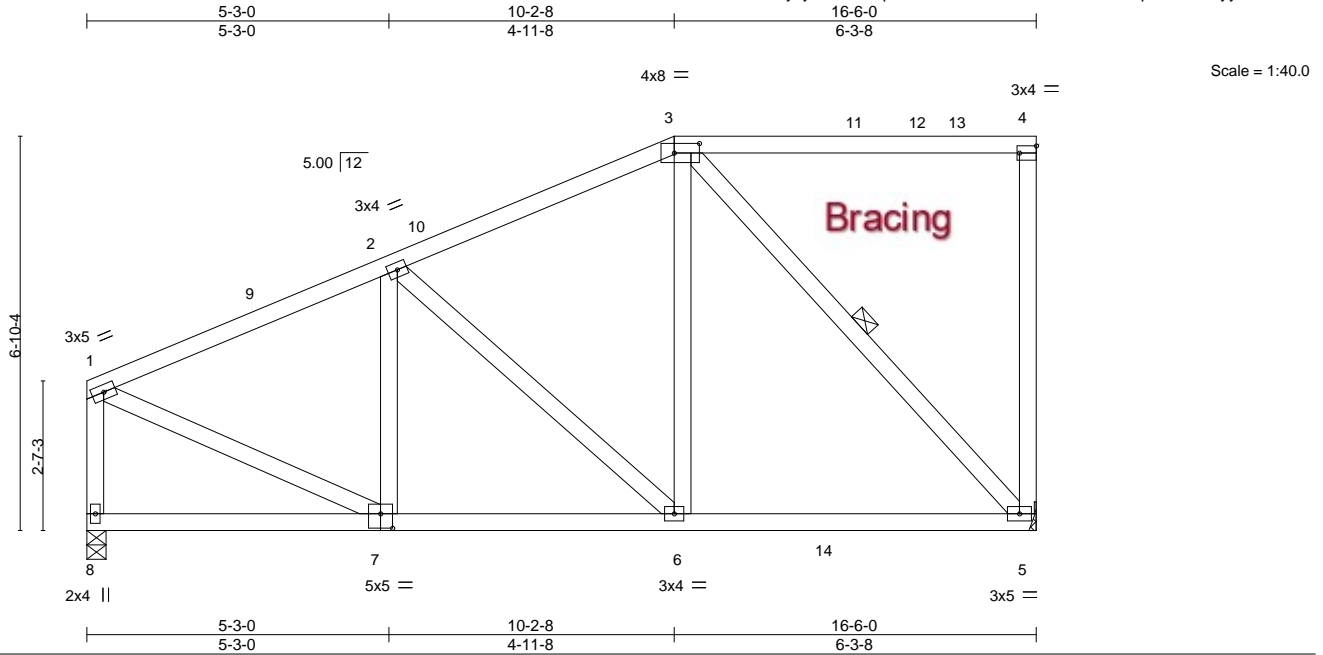


Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [4:Edge,0-1-8], [7:0-2-8,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.38	Vert(LL)	-0.05	5-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.40	Vert(CT)	-0.08	5-6	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.25	Horz(CT)	0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 109 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 5=Mechanical, 8=0-4-0
Max Horz 8=331(LC 9)
Max Uplift 5=190(LC 9), 8=130(LC 12)
Max Grav 5=767(LC 17), 8=728(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-701/238, 2-3=-563/269, 1-8=-629/276
BOT CHORD 7-8=-466/395, 6-7=-491/685, 5-6=-339/531
WEBS 3-6=-36/405, 3-5=-710/350, 1-7=-179/582

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 10-2-8, Exterior(2R) 10-2-8 to 14-5-7, Interior(1) 14-5-7 to 16-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=190, 8=130.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314044
FRED_PERRY	G06	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:18 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-M?zBy6Vjg45_9w7LZ4JAHFxfakvFZJkcL3pFrOyw86?

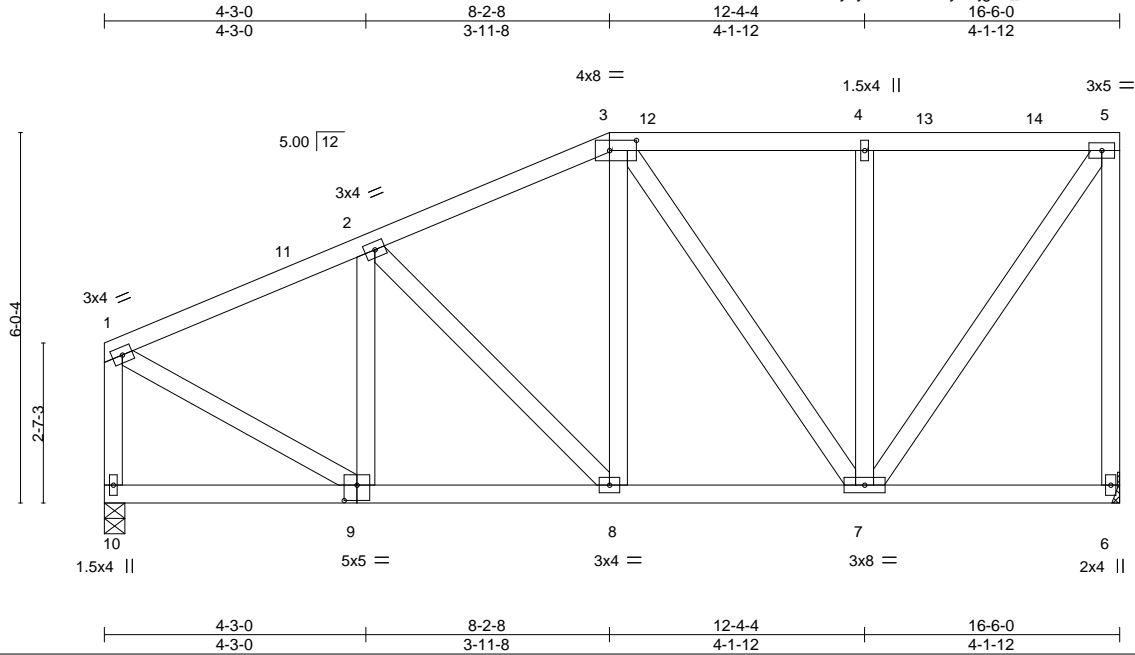


Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [9:0-2-8,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.33	Vert(LL)	-0.02	8-9	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.21	Vert(CT)	-0.04	8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.01	6	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-AS						Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 6=Mechanical, 10=0-4-0
Max Horz 10=287(LC 9)
Max Uplift 6=-188(LC 9), 10=-132(LC 12)
Max Grav 6=648(LC 1), 10=648(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-587/226, 2-3=-561/282, 3-4=-382/260, 4-5=-382/260, 5-6=-609/327,
1-10=-602/277
BOT CHORD 9-10=-401/335, 8-9=-468/614, 7-8=-363/544
WEBS 4-7=-272/183, 5-7=-308/618, 1-9=-196/548

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 8-2-8, Exterior(2R) 8-2-8 to 12-4-4, Interior(1) 12-4-4 to 16-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=188, 10=132.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314045
FRED_PERRY	G07	Flat	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:19 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzzywB6i-rBXa9SWLRODm4hX6orPqTUpbkDdlghmajYpOqyw86_

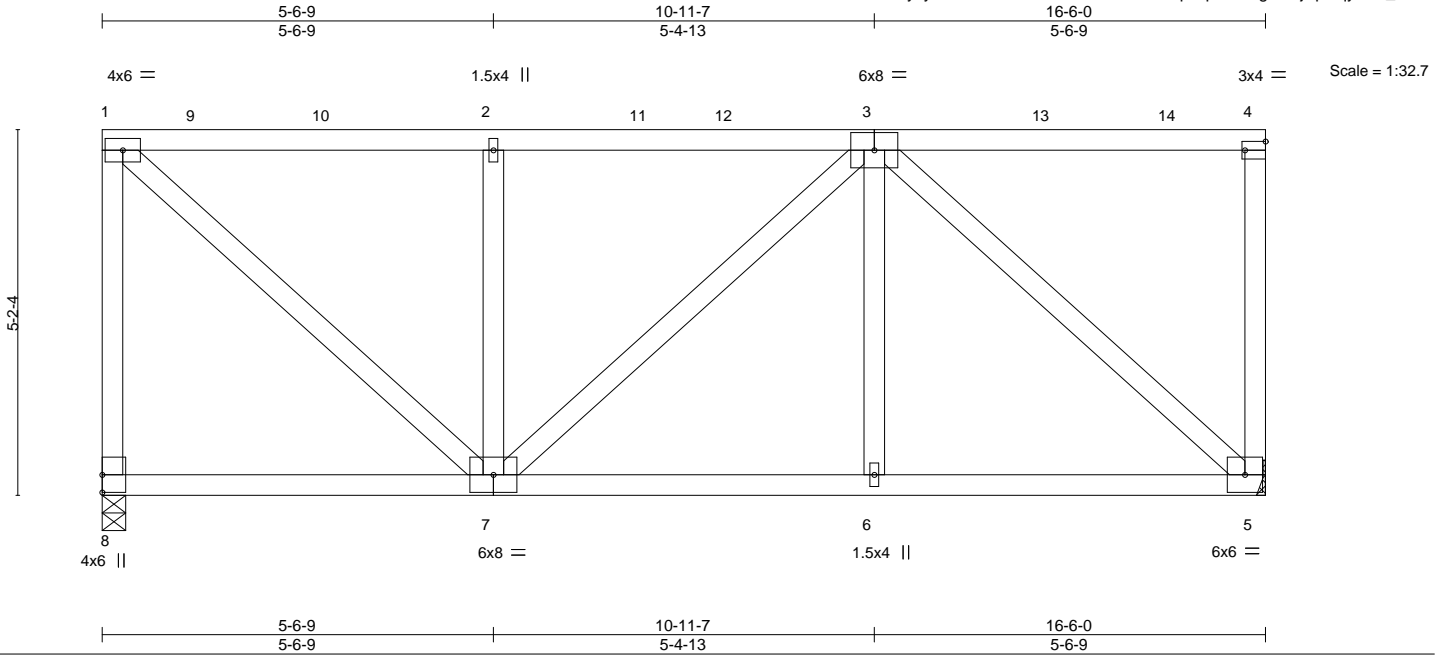


Plate Offsets (X,Y)-- [4:Edge,0-1-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.44	Vert(LL)	-0.04	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.33	Vert(CT)	-0.08	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.59	Horz(CT)	-0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 107 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 8=0-4-0, 5=Mechanical
Max Horz 8=235(LC 11)
Max Uplift 8=190(LC 8), 5=190(LC 9)
Max Grav 8=648(LC 1), 5=648(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-8=-587/636, 1-2=-518/490, 2-3=-518/490, 4-5=-178/266
BOT CHORD 7-8=-280/293, 6-7=-504/491, 5-6=-504/491
WEBS 1-7=-659/672, 2-7=-388/505, 3-6=0/257, 3-5=-627/551

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 13-4-4, Corner(3) 13-4-4 to 16-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=190, 5=190.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314046
FRED_PERRY	H01	Common	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:20 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-JN5yNoXzChLiPDGjgVMeMg0_78Yy1GEvoNILvGyw85z

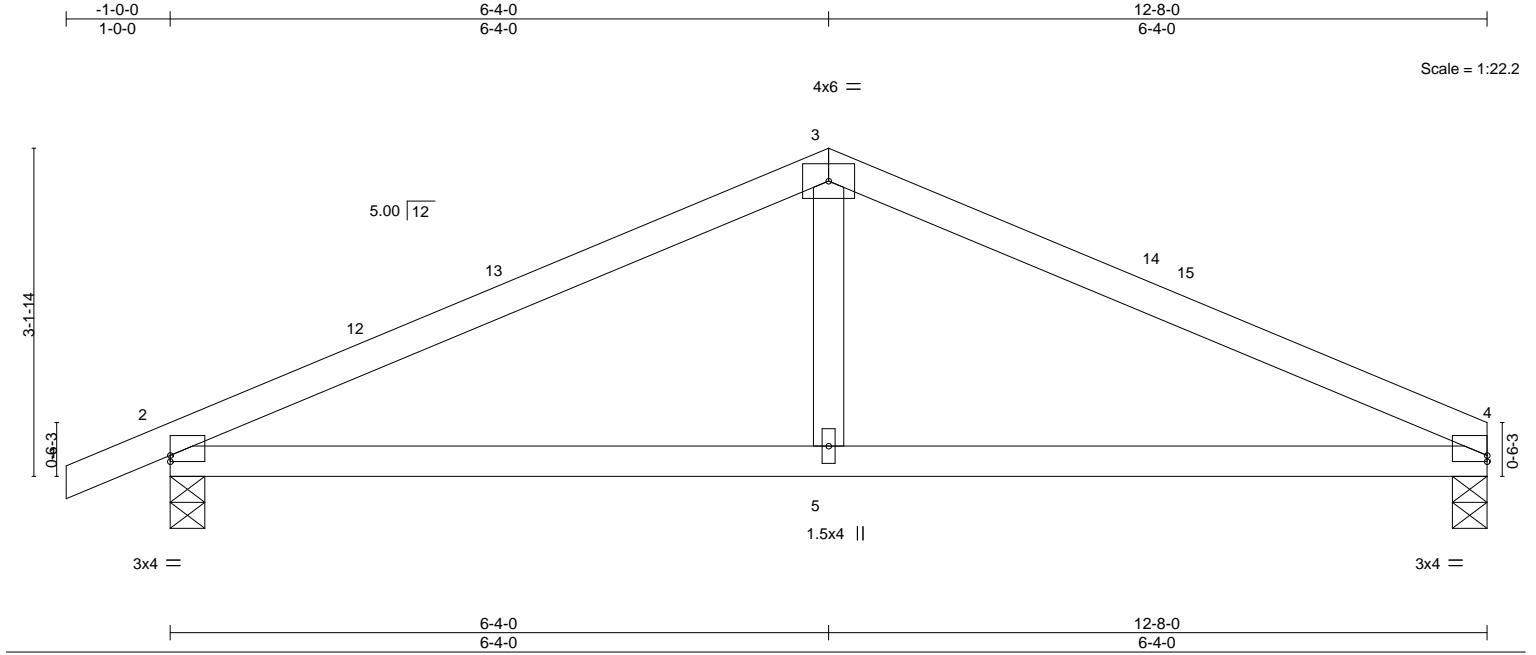

LOADING (psf)		SPACING-		CSL.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.39	Vert(LL)	-0.04	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.39	Vert(CT)	-0.08				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.01				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-AS							
								Weight: 45 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 4=0-4-0, 2=0-4-0
Max Horz 2=73(LC 11)
Max Uplift 4=106(LC 12), 2=161(LC 12)
Max Grav 4=504(LC 1), 2=569(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-768/435, 3-4=-767/444
BOT CHORD 2-5=-306/645, 4-5=-306/645
WEBS 3-5=0/272

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-4-0, Exterior(2R) 6-4-0 to 9-4-0, Interior(1) 9-4-0 to 12-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=106, 2=161.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

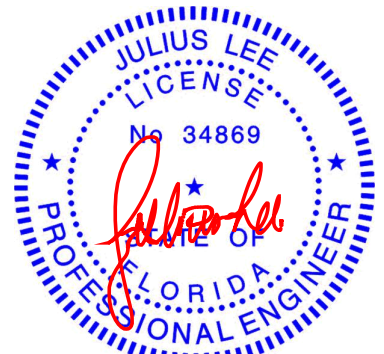

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:26 2022 Page 1
ID:obm8e8iJ6kih6vZ2?kAyzywB6i-7XSDrckoX5r78kt1mT2cxG2uZT1RuYnBJlf6wyw85t

-1-0-0	3-3-5	6-4-0	9-4-11	12-8-0
1-0-0	3-3-5	3-0-11	3-0-11	3-3-5



July 21, 2022

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria, DSB-89 and BCSI Building Component**



Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314047
FRED_PERRY	H2GR	Common Girder	1	2	Job Reference (optional)	

LOAD CASE(S)
 Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-4=-60, 4-7=-60, 12-15=-20
 Concentrated Loads (lb)
 Vert: 9=-2769(B) 18=-1265(B) 19=-1265(B)




Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:21 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-naeKa8Ybz?TY0NrwEDttvuZB?Ymfmrd62111uRjyw85y



July 21, 2022

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314048
FRED_PERRY	H03	Common Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-4=-60, 4-7=-60, 12-15=-20
- Concentrated Loads (lb)
- Vert: 9=-2915(F) 18=-1265(F) 19=-1265(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
 ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd

Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314049
FRED_PERRY	H04	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:22 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-FmCioUZEKJbPeXQ6owO6S55Okx15VAHCGhnSz9yw85x



Scale = 1:23.0

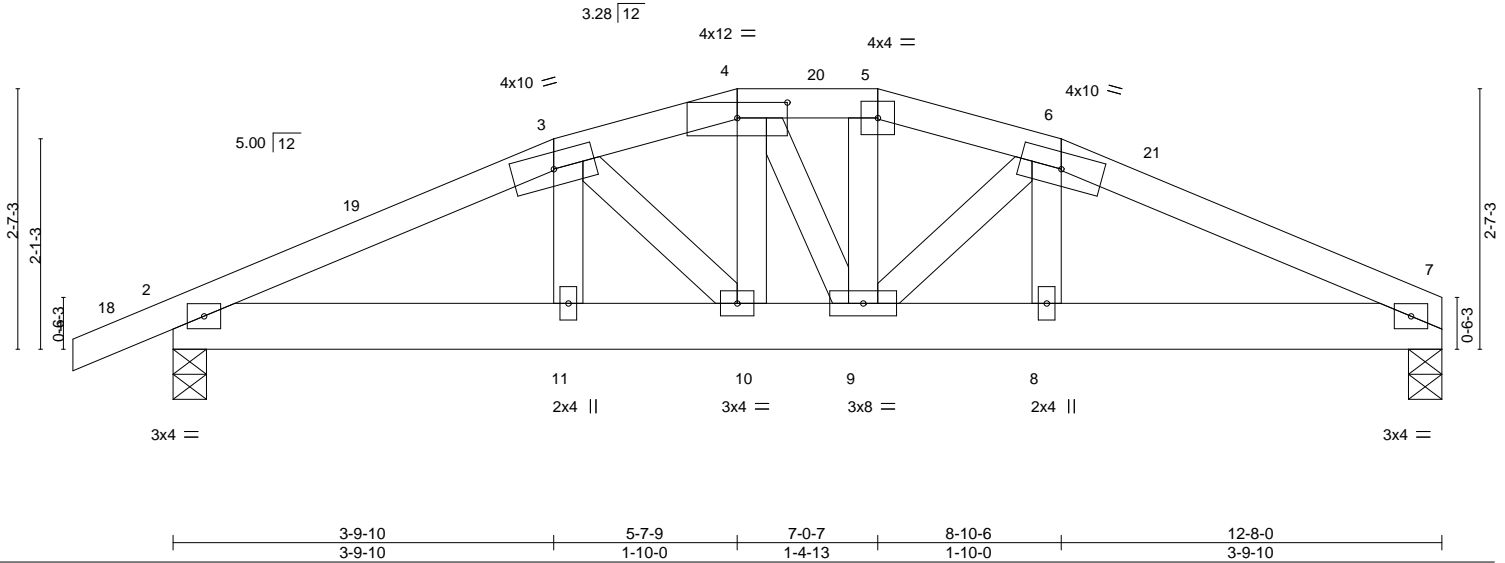


Plate Offsets (X,Y)-- [4:0-6-0,0-1-14]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.19	Vert(LL) 0.02	10	>999	240		MT20	244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.16	Vert(CT) -0.03	10	>999	180			
BCLL 0.0 *	Rep Stress Incr YES		WB 0.03	Horz(CT) 0.01	7	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 71 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 7=0-4-0, 2=0-4-0
Max Horz 2=54(LC 11)
Max Uplift 7=106(LC 12), 2=161(LC 12)
Max Grav 7=504(LC 1), 2=569(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-873/646, 3-4=-740/598, 4-5=-708/590, 5-6=-744/593, 6-7=-884/614
BOT CHORD 2-11=-537/768, 10-11=-535/772, 9-10=-447/704, 8-9=-491/783, 7-8=-493/779

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 3-9-10, Exterior(2E) 3-9-10 to 12-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=106, 2=161.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

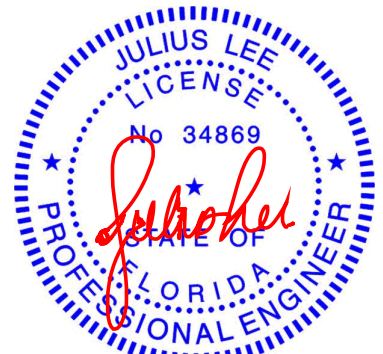

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314050
FRED_PERRY	H05	Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:23 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-jym4?qZsVcjGGH?iLevL_JeZVLc7EdILULW?Wbyw85w



Scale = 1:22.4

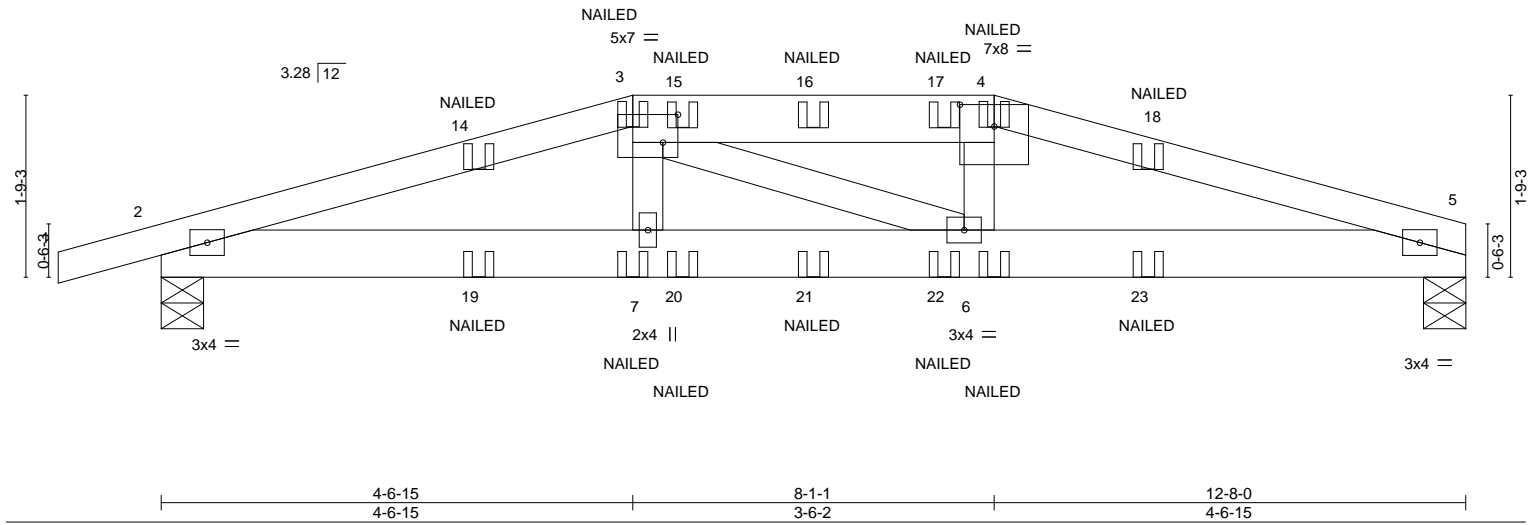


Plate Offsets (X,Y)-- [3:0-1-12,0-3-4], [4:0-4-0,0-2-9]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.19	Vert(LL)	-0.03	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.07	6-7	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 61 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
3-4: 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 5=0-4-15, 2=0-4-15
Max Horz 2=26(LC 21)
Max Uplift 5=120(LC 8), 2=175(LC 8)
Max Grav 5=582(LC 1), 2=644(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=1371/286, 3-4=1320/292, 4-5=1388/294
BOT CHORD 2-7=238/1292, 6-7=232/1303, 5-6=246/1308

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=120, 2=175.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-60, 4-5=-60, 8-11=-20
Concentrated Loads (lb)
Vert: 3=-16(B) 4=-16(B) 7=-15(B) 6=-15(B) 15=-14(B) 16=-14(B) 17=-14(B) 19=-2(B) 20=-13(B) 21=-13(B) 22=-13(B) 23=-7(B)

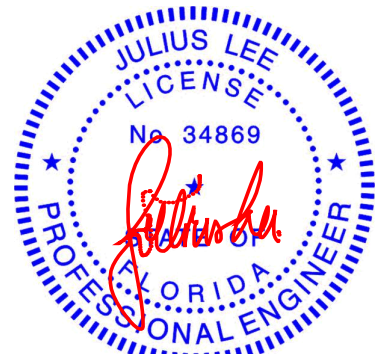

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314051
FRED_PERRY	H6GE	Common Supported Gable	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:28 2022 Page 1

ID:obm8e8iJ6kih6vZZ2?kAzywB6i-4wZz2Xd_J9MZMStG8BVWhMLR5MNLvud4edEmBpyw85r



Scale = 1:22.3

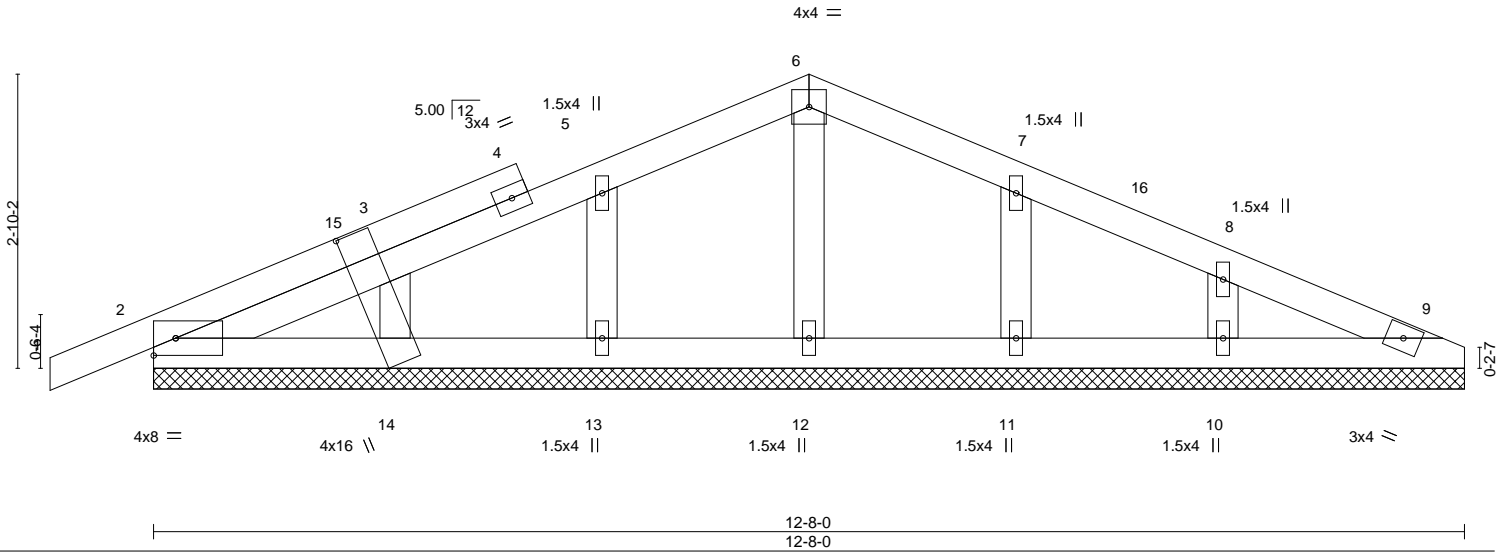


Plate Offsets (X,Y)-- [14:0-3-4,1-9-8]

LOADING (psf)	SPACING-		CSL.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.07	Vert(LL)	-0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 56 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 12-8-0.
(lb) - Max Horz 2=66(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 9, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 9, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) -1-0-0 to 2-0-0, Exterior(2N) 2-0-0 to 6-4-0, Corner(3R) 6-4-0 to 9-4-0, Exterior(2N) 9-4-0 to 12-5-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9, 13, 14, 11, 10.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

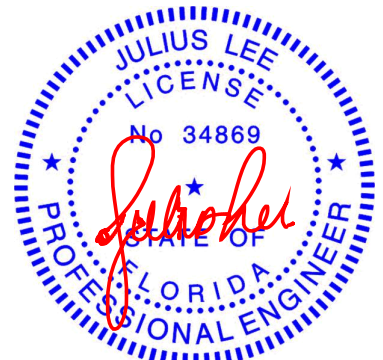

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314052
FRED_PERRY	H12	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:24 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-B9KTDAAUGwr7traUvLQaXWBdwlvOz3tVj?GY22yw85v

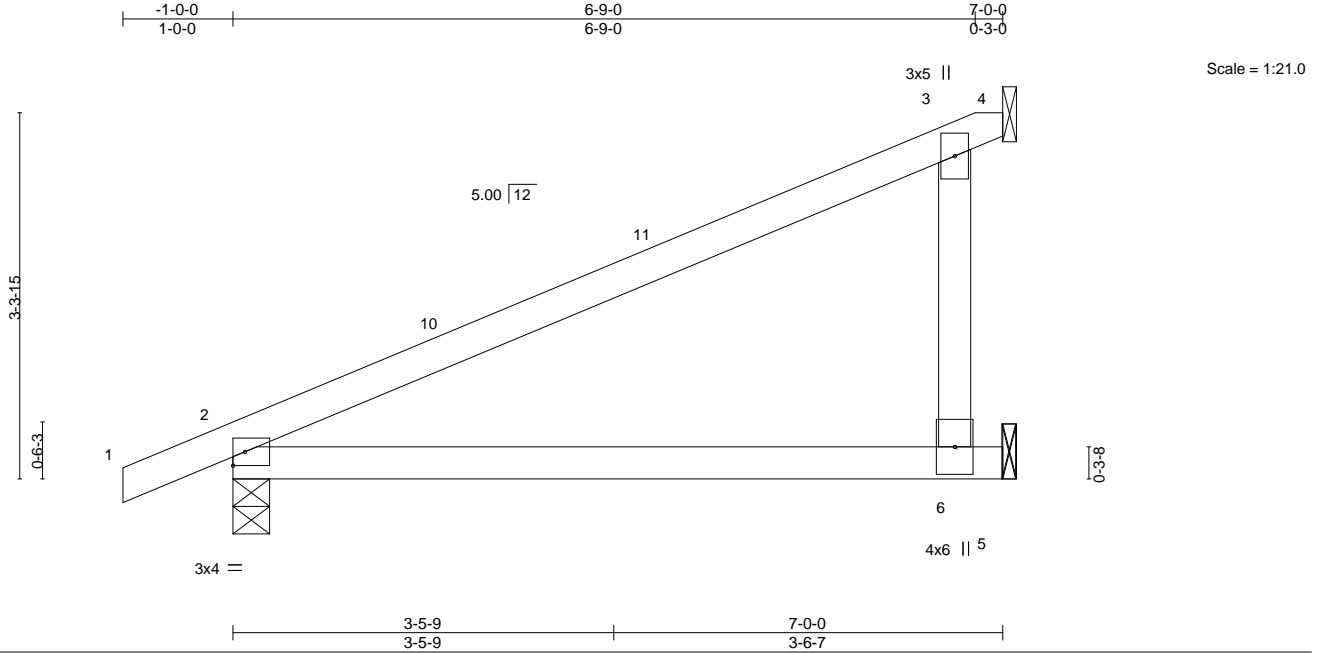


Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314054
FRED_PERRY	J02	Jack-Open	5	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:29 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-Y67LGted4SUQ_cSSiu0IEauc?mieaKPEtHzJfFyw85q

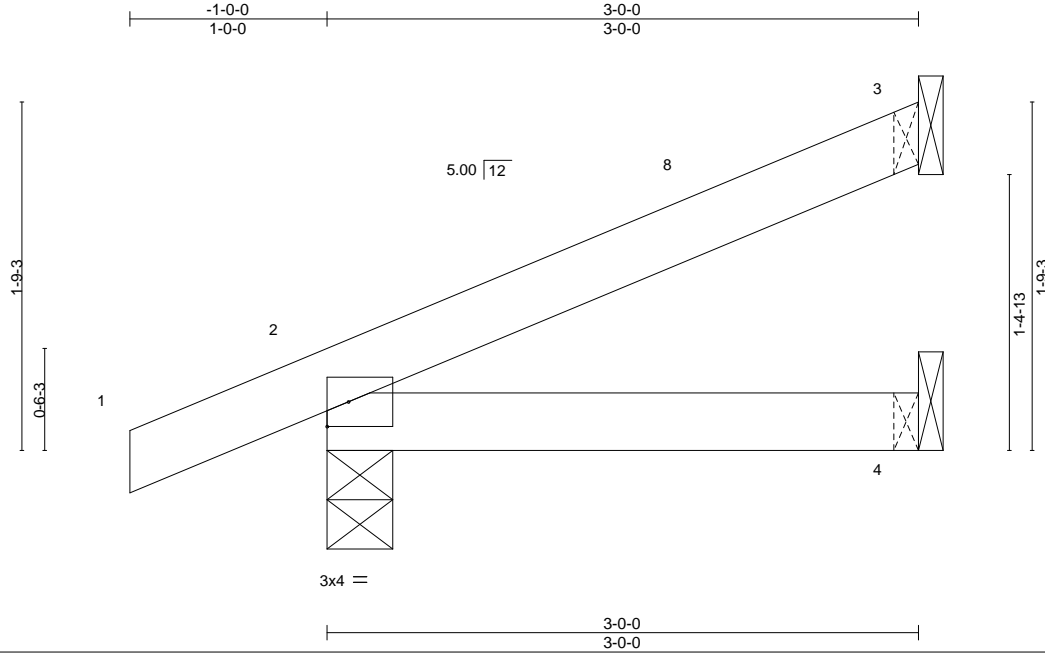

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.12	Vert(LL)	0.01	4-7	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.10	Vert(CT)	-0.01	4-7	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 11 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=76(LC 12)
Max Uplift 3=-40(LC 12), 2=-70(LC 12)
Max Grav 3=74(LC 1), 2=188(LC 1), 4=53(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 2-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

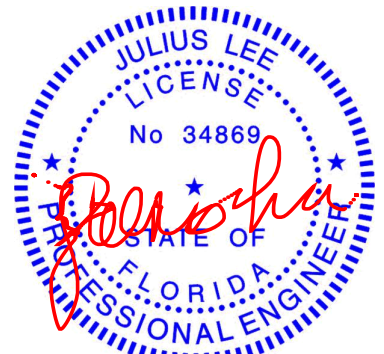

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314055
FRED_PERRY	J03	Jack-Open	2	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:30 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-0lhkTDfFrmchbm1eGcX_mnRjJA_GNnfN6xjtFhyw85p

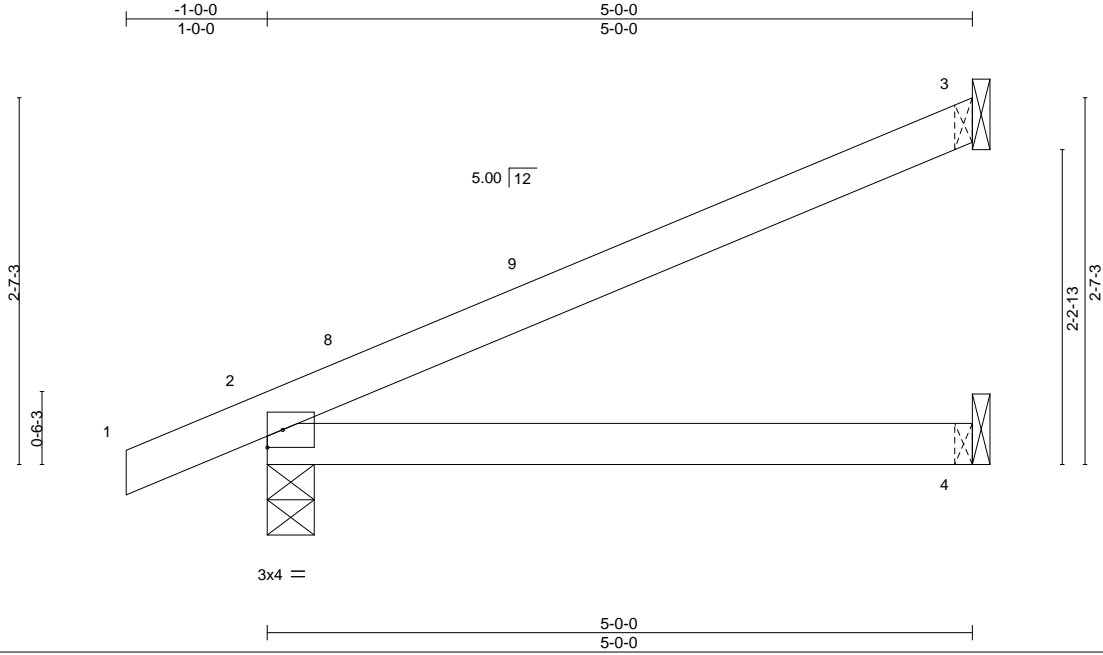

Scale = 1:16.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0 1.25	TC 0.38	Vert(LL) 0.05	4-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.33	Vert(CT) -0.06	4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.01	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS					Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=111(LC 12)
Max Uplift 3=-73(LC 12), 2=-77(LC 12)
Max Grav 3=133(LC 1), 2=264(LC 1), 4=90(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 4-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) This truss requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

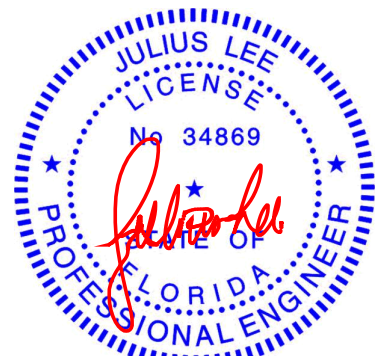

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314056
FRED_PERRY	J04	Jack-Open	15	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:31 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-UVF6hZftc4k8DwcrpJ2DJ?zoDZG?6EvXKbSQo8yw85o

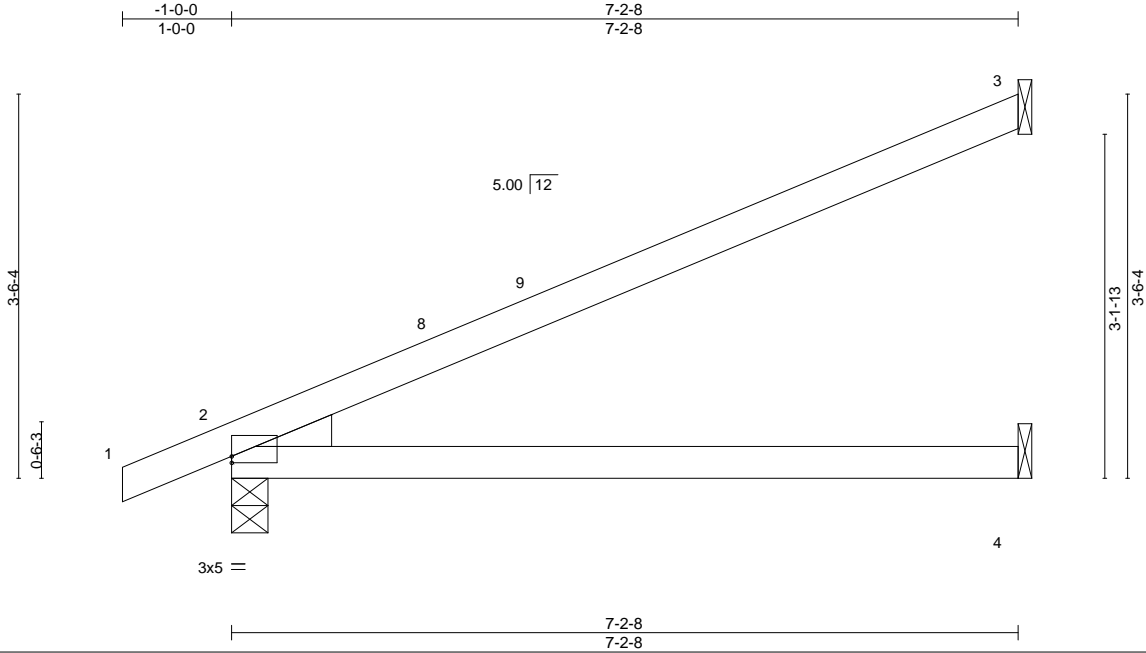


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.72	Vert(LL)	0.15	4-7	>575	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.55	Vert(CT)	-0.24	4-7	>352	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.03	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=148(LC 12)
Max Uplift 3=108(LC 12), 2=86(LC 12)
Max Grav 3=197(LC 1), 2=350(LC 1), 4=130(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 7-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 3=108.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314057
FRED_PERRY	J05	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:32 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-yhpUuvgVNNs?r3B1N1ZSsCW6Czk9rh9gZFC_Kayw85n

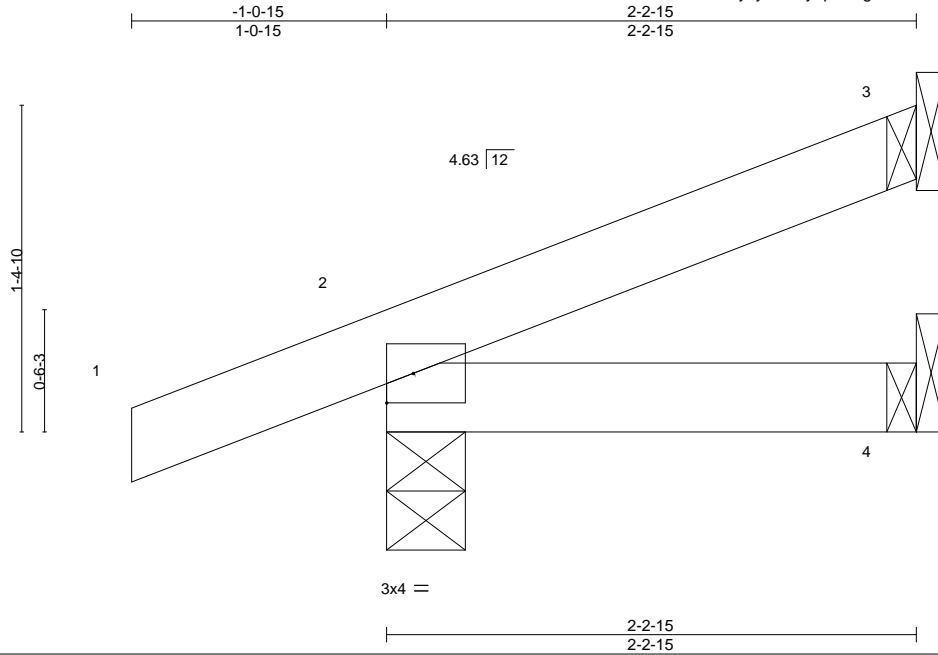

Scale = 1:9.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.12	Vert(LL)	-0.00	7	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.04	Vert(CT)	-0.00	4-7	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 9 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=61(LC 12)
Max Uplift 3=-25(LC 12), 2=-77(LC 12)
Max Grav 3=50(LC 1), 2=168(LC 1), 4=38(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

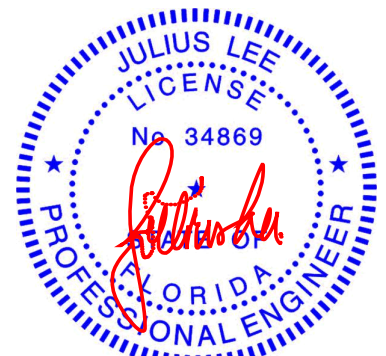

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314059
FRED_PERRY	J07	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:33 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-QtNs6Fh78h_rSDmDxk5hOQ3HsN30a8PpovXs0yw85m

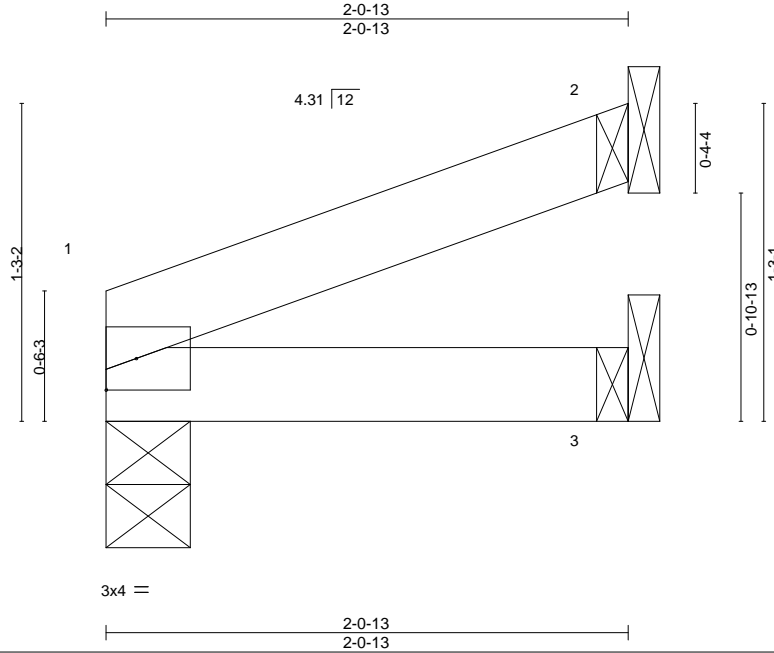

Scale = 1:9.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.07	Vert(LL)	-0.00	6	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.07	Vert(CT)	-0.00	3-6	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	-0.00	2	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 6 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=0-4-0, 2=Mechanical, 3=Mechanical
Max Horz 1=30(LC 12)
Max Uplift 1=-9(LC 12), 2=-28(LC 12)
Max Grav 1=80(LC 1), 2=53(LC 1), 3=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 2.

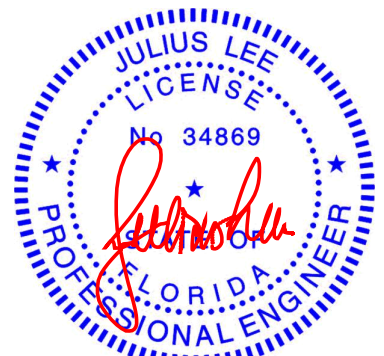

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314060
FRED_PERRY	J08	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:34 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-u4xEJailv?6i4NLPVRcwxdbRcnQjJbfz0Zh4PTyw85l

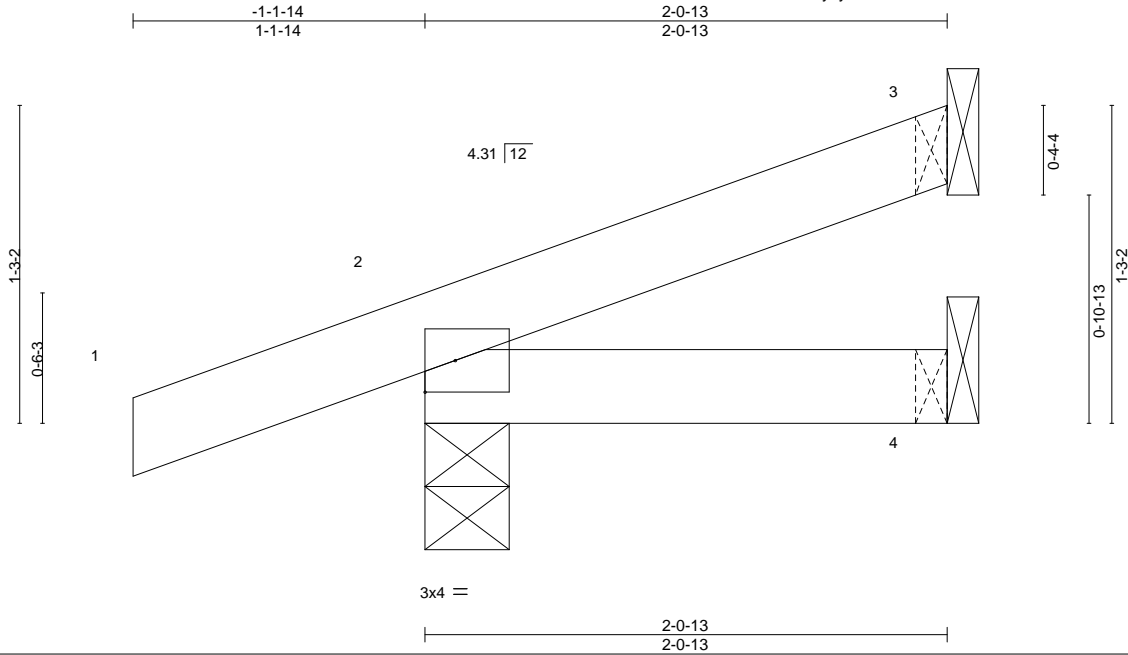

Scale = 1:9.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.13	Vert(LL) -0.00	7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.04	Vert(CT) -0.00	7	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 8 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=56(LC 12)
Max Uplift 3=-20(LC 12), 2=-84(LC 12)
Max Grav 3=44(LC 1), 2=169(LC 1), 4=34(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314061
FRED_PERRY	J09	Jack-Open	3	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:35 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-NGVdWwjNgIEZIXwc2979Tr8dcBI412u6FDRexvyw85k

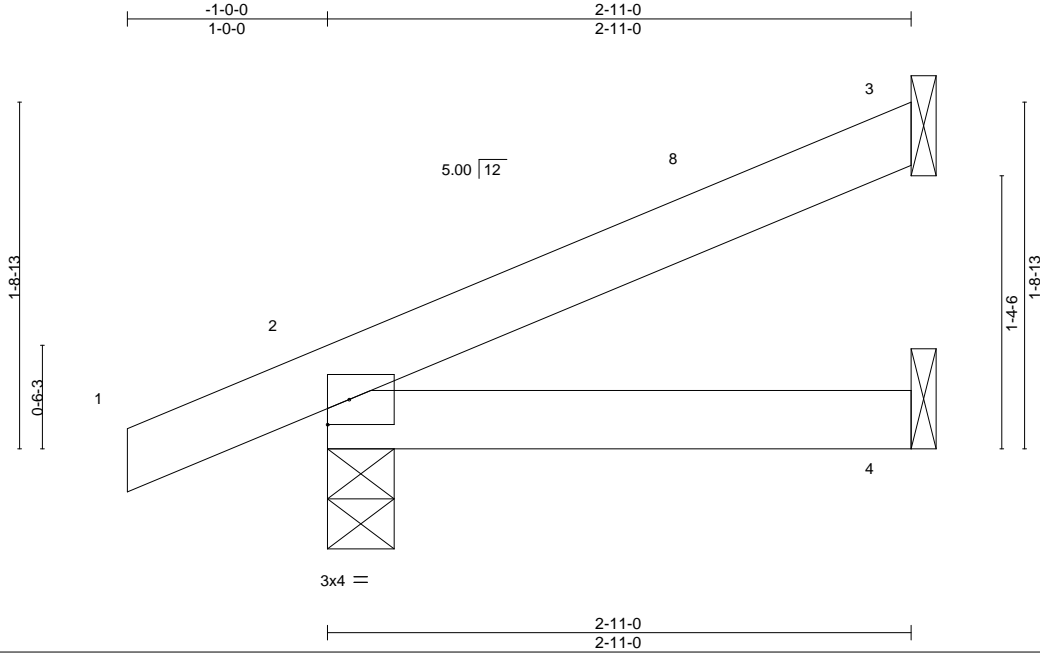

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.11	Vert(LL)	-0.00	4-7	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.09	Vert(CT)	-0.01	4-7	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 11 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-11-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=75(LC 12)
Max Uplift 3=-39(LC 12), 2=-70(LC 12)
Max Grav 3=71(LC 1), 2=185(LC 1), 4=52(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 2-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

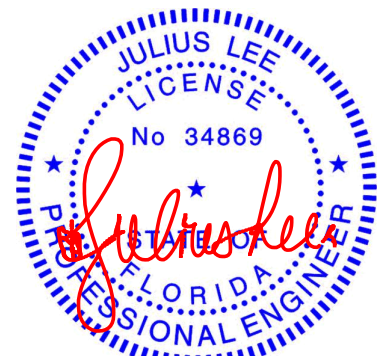

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314062
FRED_PERRY	J10	Jack-Open	2	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:36 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-rS2?kGj0RcMQJhVocseO02hooa6BmV8GUsABTLyw85j

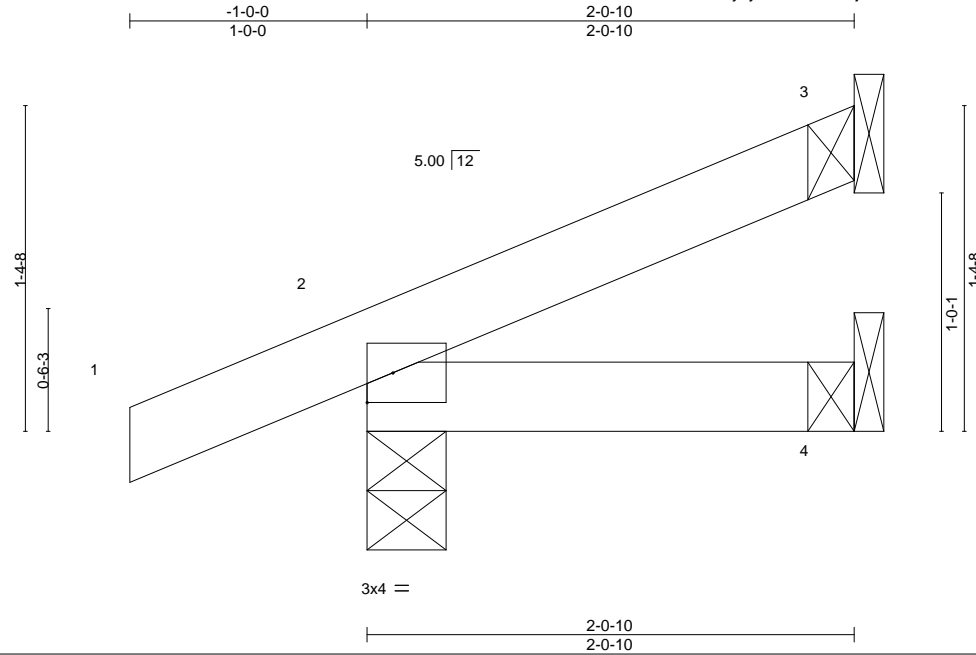

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.09	Vert(LL)	-0.00	7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.00	7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 8 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=60(LC 12)
Max Uplift 3=-24(LC 12), 2=-70(LC 12)
Max Grav 3=46(LC 17), 2=155(LC 1), 4=35(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

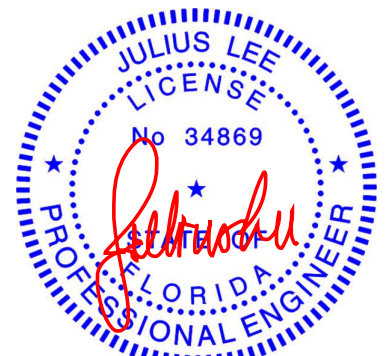

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314063
FRED_PERRY	J11	Jack-Open	14	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:37 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAzywB6i-JfcNxckeCwUHxr3_Aa9dZGDqD_JvVyOPjWwl?nyw85i

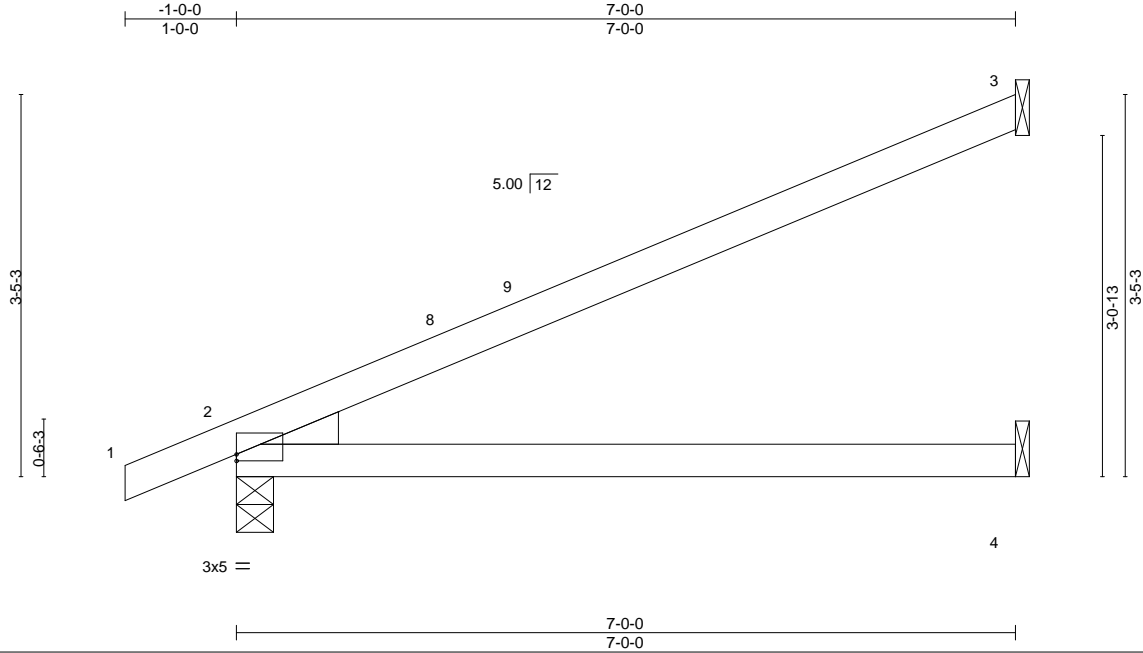

Scale = 1:20.7

Plate Offsets (X,Y)-- [2:0-0-0,0-0-11]

LOADING (psf)	SPACING-		CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.68	Vert(LL)	0.14	4-7	>611	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.52	Vert(CT)	-0.22	4-7	>383	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=145(LC 12)
Max Uplift 3=104(LC 12), 2=-85(LC 12)
Max Grav 3=191(LC 1), 2=342(LC 1), 4=126(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 3=104.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

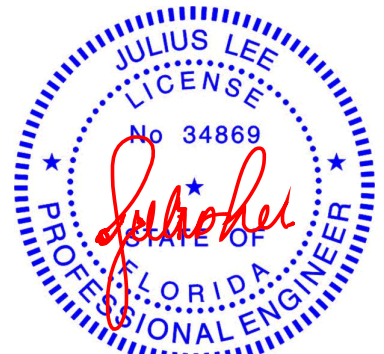

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314064
FRED_PERRY	J12	Jack-Open Girder	2	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:38 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-nrAl9yIGzDc8Z_eBkHgs5Tm7uOI9EPeYxAflYEyw85h

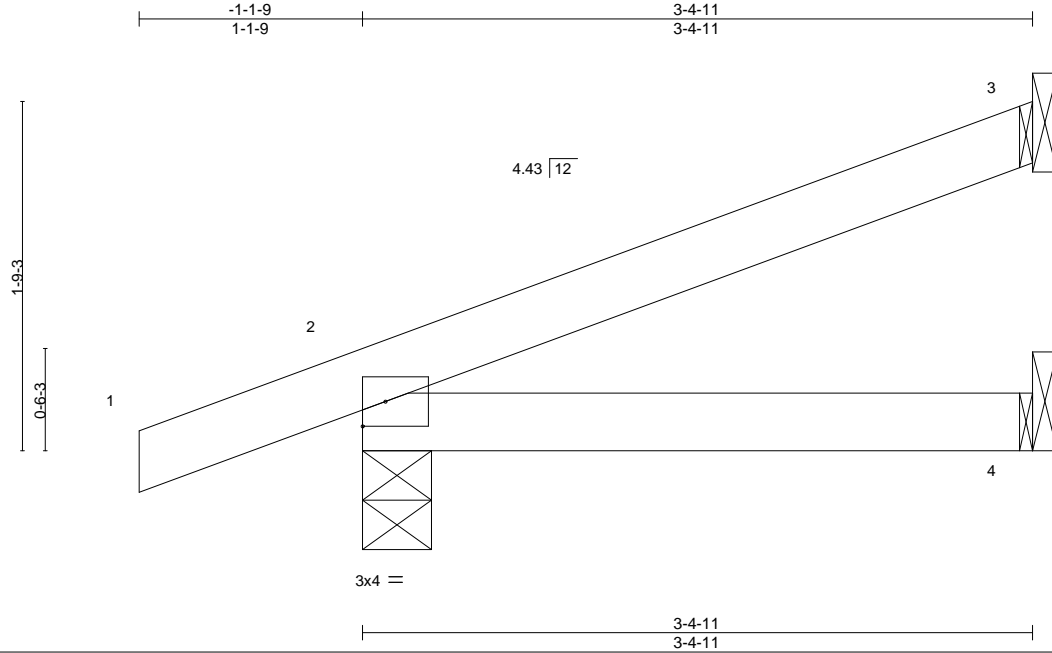

Scale = 1:11.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.18	Vert(LL) 0.01	4-7	>999	240		MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.13	Vert(CT) -0.01	4-7	>999	180			
BCLL 0.0 *	Rep Stress Incr NO	WB 0.00	Horz(CT) 0.00	3	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP						Weight: 12 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-3, 4=Mechanical
Max Horz 2=77(LC 12)
Max Uplift 3=43(LC 12), 2=83(LC 12)
Max Grav 3=84(LC 1), 2=212(LC 1), 4=60(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314065
FRED_PERRY	J13	Jack-Open Girder	2	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:39 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-F1k7MImukXk?A8DNH?B5ehJlXo6czsuiAqPr4gyw85g

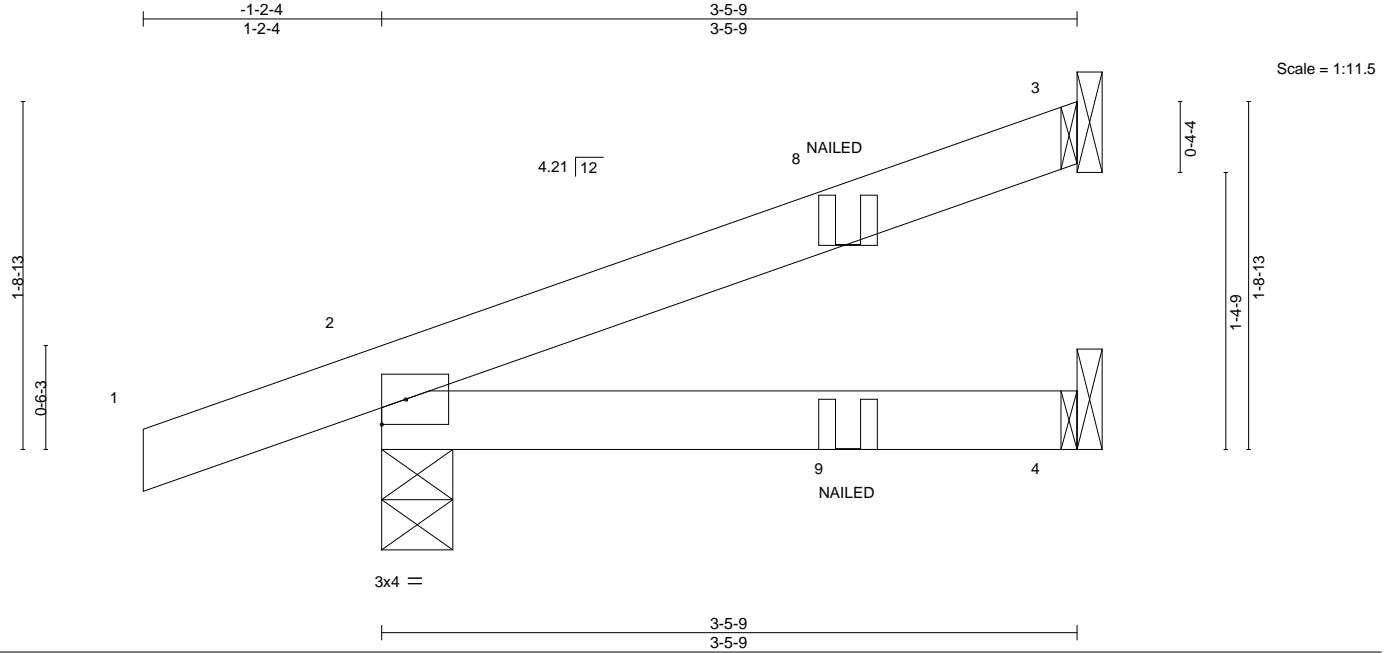

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.16	Vert(LL)	-0.01 4-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.12	Vert(CT)	-0.01 4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.00	Horz(CT)	0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-4, 4=Mechanical
Max Horz 2=75(LC 8)
Max Uplift 3=43(LC 8), 2=88(LC 8)
Max Grav 3=86(LC 1), 2=220(LC 1), 4=62(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
Vert: 1-3=-60, 4-5=-20
Concentrated Loads (lb)
Vert: 9=-1(B)

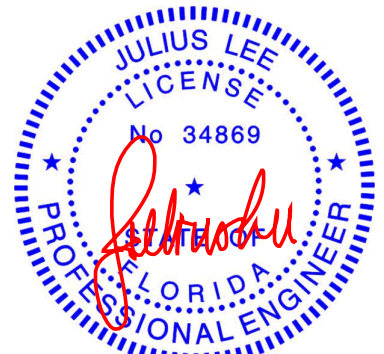

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314066
FRED_PERRY	J14	Common	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:40 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-jEIWaeMwVrssloloZrijKAurMSCLtiJKrPU8Pc6yw85f

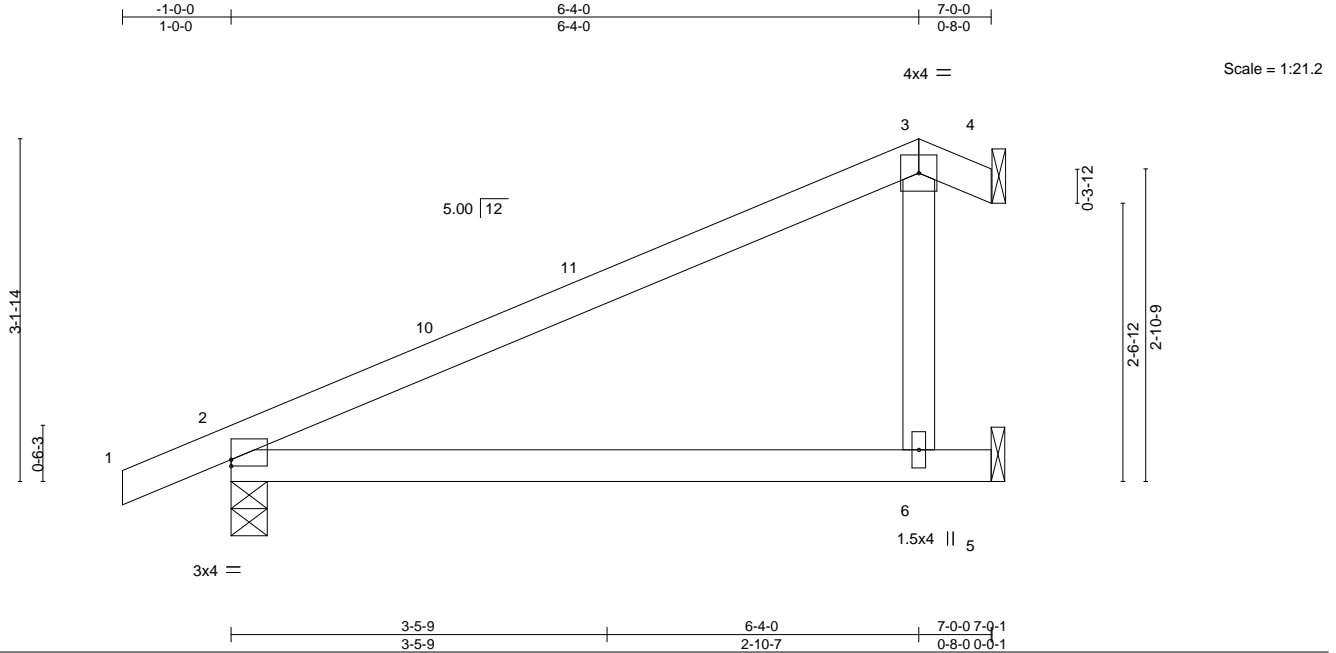


Plate Offsets (X,Y)--		[2:0-0-0,0-0-11]													
LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.62	Vert(LL)	0.19	in (loc)	6-9	I/defl	>427	L/d	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.57	Vert(CT)	-0.24	6-9	>341	180					
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.09	4	n/a	n/a					
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-AS										Weight: 27 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS.

(size) 4=Mechanical, 2=0-4-0, 5=Mechanical
Max Horz 2=124(LC 12)
Max Uplift 4=11(LC 12), 2=94(LC 12), 5=64(LC 12)
Max Grav 4=18(LC 1), 2=342(LC 1), 5=255(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-6=198/300

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-4-0, Exterior(2E) 6-4-0 to 6-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2, 5.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

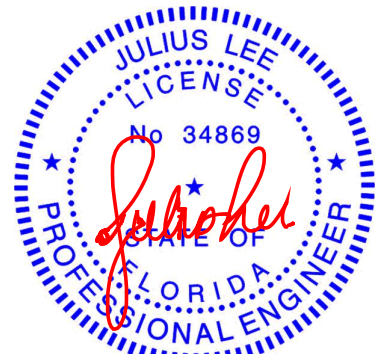

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314067
FRED_PERRY	K01	Roof Special Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:42 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzwB6i-fcQG_Kom0S6a1cyyz7loGJxoW?59AD88sodVh?yw85d

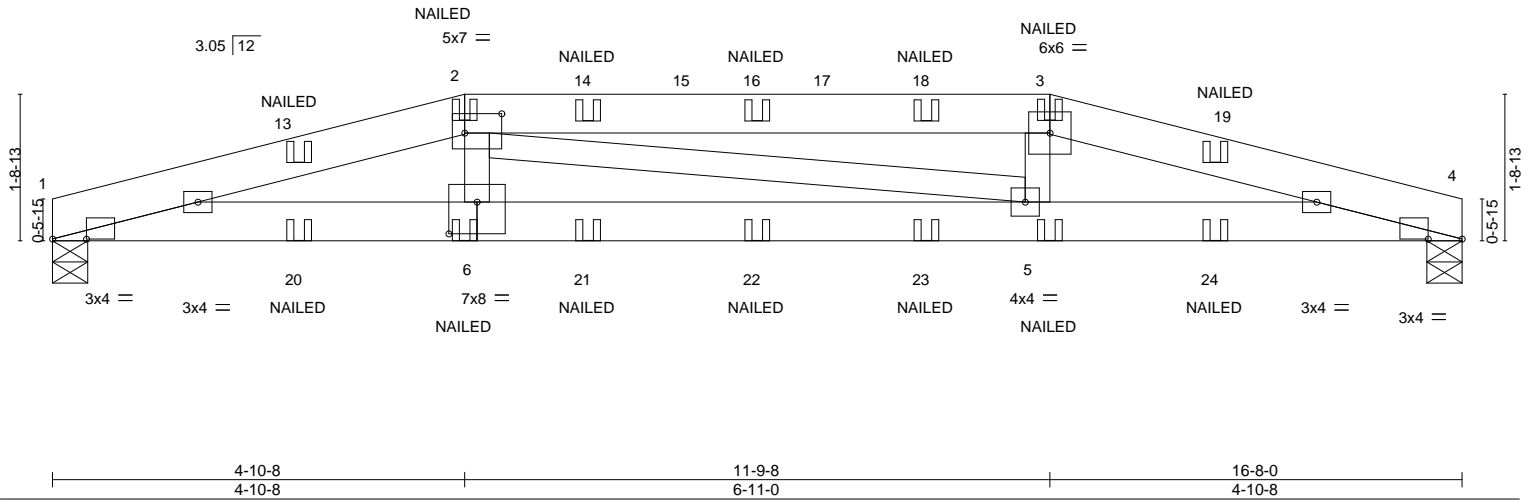

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.20	Vert(LL)	-0.04	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.26	Vert(CT)	-0.09				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.03	Horz(CT)	0.02				
BCDL	10.0	Code FBC2020/TP12014		Matrix-MS							
								Weight: 182 lb FT = 20%			

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 1=0-5-0, 4=0-5-0
Max Horz 1=16(LC 7)
Max Uplift 1=154(LC 8), 4=154(LC 8)
Max Grav 1=737(LC 1), 4=733(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2204/500, 2-3=-2144/444, 3-4=-2201/449
BOT CHORD 1-6=-450/2129, 5-6=-444/2147, 4-5=-403/2126
WEBS 3-5=0/282

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-3-0 oc, Except member 5-2 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=154, 4=154.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform loads (plf)
Vert: 1-2=-60, 2-3=-60, 3-4=-60, 7-10=-20

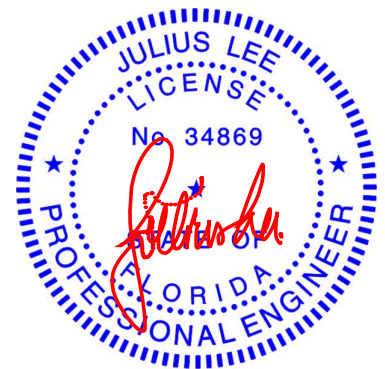

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314067
FRED_PERRY	K01	Roof Special Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 2=-14(B) 3=-14(B) 6=-15(B) 5=-15(B) 14=-11(B) 16=-11(B) 18=-11(B) 20=-7(B) 21=-12(B) 22=-12(B) 23=-12(B) 24=0(B)

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314069
FRED_PERRY	K03	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:44 2022 Page 1
ID:obm8e8iJ6kih6vZ2?kAyzywB6i-c?X0P?q1Y3NIHv6K4YnGLk03Zpf1e6uRK66cctyw85b

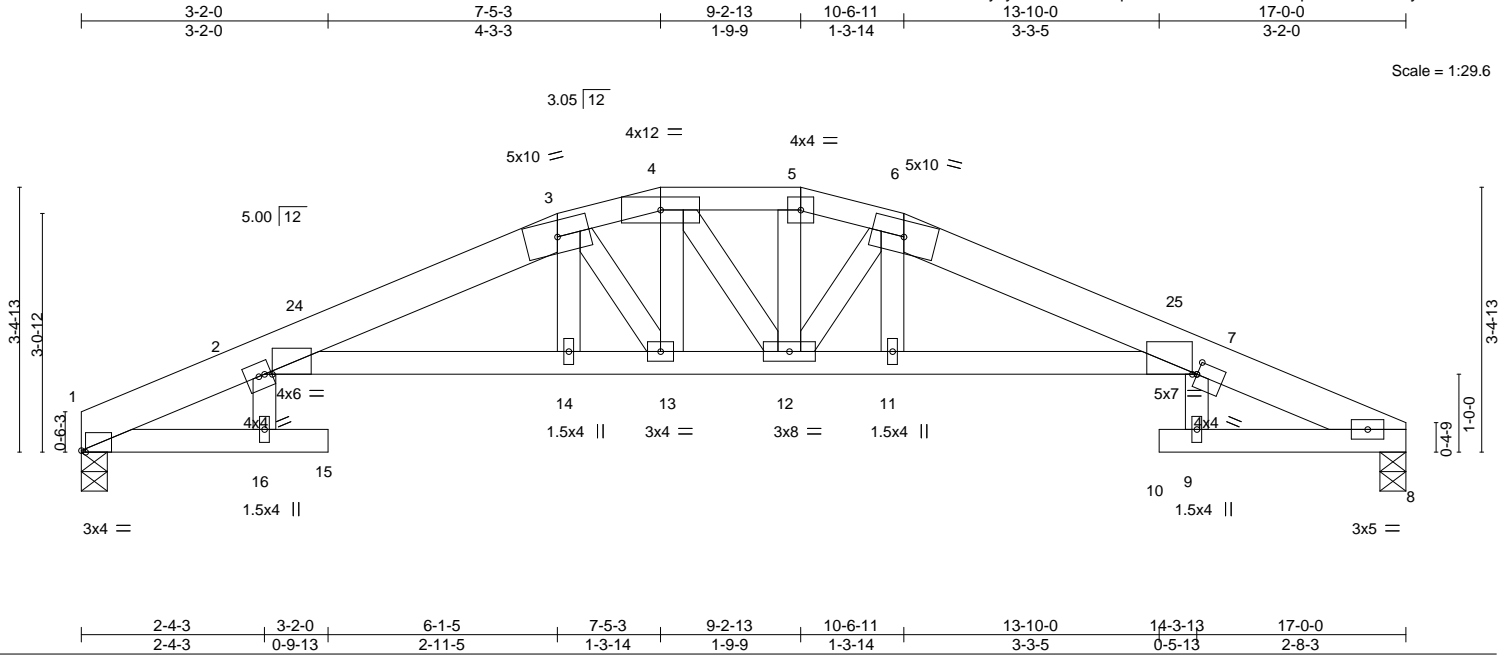


Plate Offsets (X,Y)-- [1:0-0-10,Edge], [2:0-1-3,0-0-0], [7:0-0-11,0-0-0], [7:0-0-1,0-2-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.55	Vert(LL)	0.23	15	>884	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.74	Vert(CT)	-0.39	15	>517	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.29	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 87 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
1-3,6-8: 2x6 SP SS
BOT CHORD 2x4 SP No.2 *Except*
2-7: 2x4 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 1=0-4-0, 8=0-4-0
Max Horz 1=70(LC 10)
Max Uplift 1=131(LC 12), 8=132(LC 12)
Max Grav 1=693(LC 1), 8=692(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1711/928, 3-4=-1391/822, 4-5=-1345/791, 5-6=-1401/807, 6-7=-1726/882
BOT CHORD 2-14=-806/1629, 13-14=-810/1648, 12-13=-623/1335, 11-12=-743/1668, 7-11=-740/1649
WEBS 3-14=-50/262, 3-13=-525/313, 4-13=-188/339, 5-12=-164/353, 6-12=-542/309,
6-11=-45/260

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 6-1-5, Exterior(2E) 6-1-5 to 10-6-11, Exterior(2R) 10-6-11 to 14-6-12, Interior(1) 14-6-12 to 16-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=131, 8=132.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314070
FRED_PERRY	K04	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:46 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzyzwB6i-YNfngH4gd?WDGjCzqkQ95VucSH6zcknQbjqmyw85Z



Scale = 1:29.9

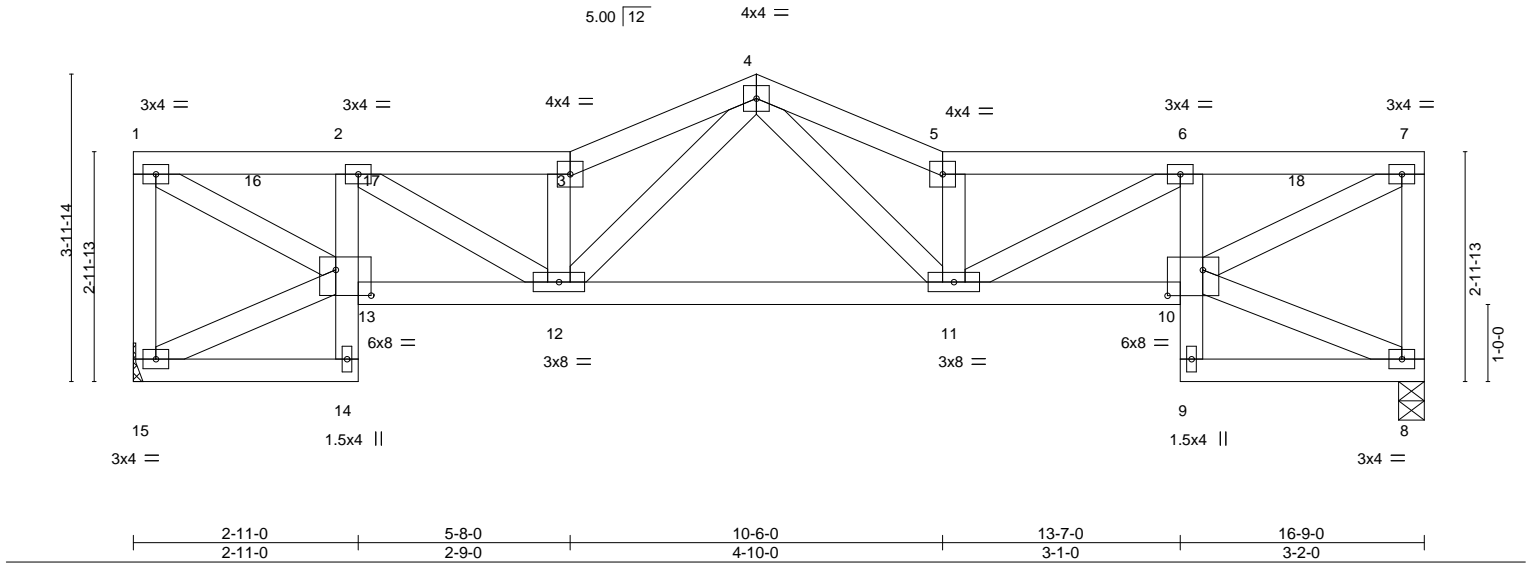

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.17	Vert(LL)	0.07 11-12 >999 240	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.31	Vert(CT)	-0.13 11-12 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.07 8 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							
								Weight: 104 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 15=Mechanical, 8=0-4-0
Max Horz 15=-153(LC 10)
Max Uplift 15=-140(LC 12), 8=-140(LC 12)
Max Grav 15=658(LC 1), 8=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-15=613/344, 1-2=-956/566, 2-3=-1411/704, 3-4=-1605/840, 4-5=-1686/803,
5-6=-1481/679, 6-7=-1027/491, 7-8=-611/334
BOT CHORD 2-13=-431/273, 12-13=-690/1014, 11-12=-583/1009, 10-11=-592/1091, 6-10=-420/255
WEBS 1-13=-570/1081, 2-12=-226/470, 3-12=-722/435, 4-12=-360/671, 4-11=-308/779,
5-11=-763/405, 6-11=-189/449, 7-10=-588/1139

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 8-1-0, Exterior(2E) 8-1-0 to 10-6-0, Interior(1) 10-6-0 to 16-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 15=140, 8=140.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Jan 6 2022 MiTek Industries, Inc. Thu Jul 21 08:57:05 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzyywB6i-CSXonoYoxoHtMCZch8ei2dhfhCTLPnUPeAdAvwy2yC

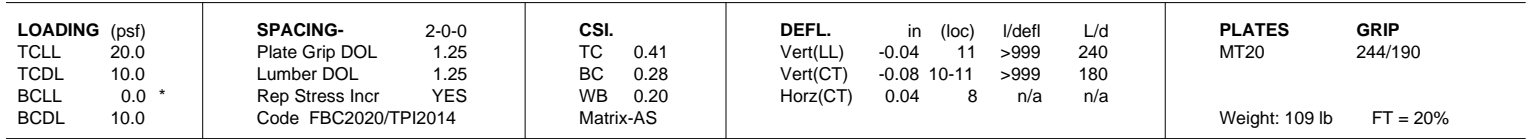

REACTIONS. (size) 15=Mechanical, 8=0-4-0
 Max Horz 15=-173(LC 10)
 Max Uplift 15=-169(LC 8), 8=-170(LC 9)
 Max Grav 15=658(LC 1), 8=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-15=-622/334, 1-16=-648/406, 2-16=-648/406, 2-17=-1083/504, 3-17=-1083/504, 3-4=-1032/479, 4-5=-1023/492, 5-18=-1085/504, 6-18=-1085/504, 6-19=-700/309, 7-19=-700/309, 7-8=-621/332
BOT CHORD	2-13=-472/333, 12-13=-536/790, 11-12=-611/1093, 10-11=-430/756, 6-10=-455/314
WEBS	1-13=-427/855, 2-12=-252/443, 6-11=-195/386, 7-10=-459/891

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 8-1-0, Exterior(2E) 8-1-0 to 8-6-0, Interior(1) 8-6-0 to 16-7-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 169 lb uplift at joint 15 and 170 lb uplift at joint 8.
 - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI-1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314072
FRED_PERRY	K06	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:48 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-UmnXFntXcltjmXP6JOsCVaAmnQ8xasS1Ek4qufyw85X

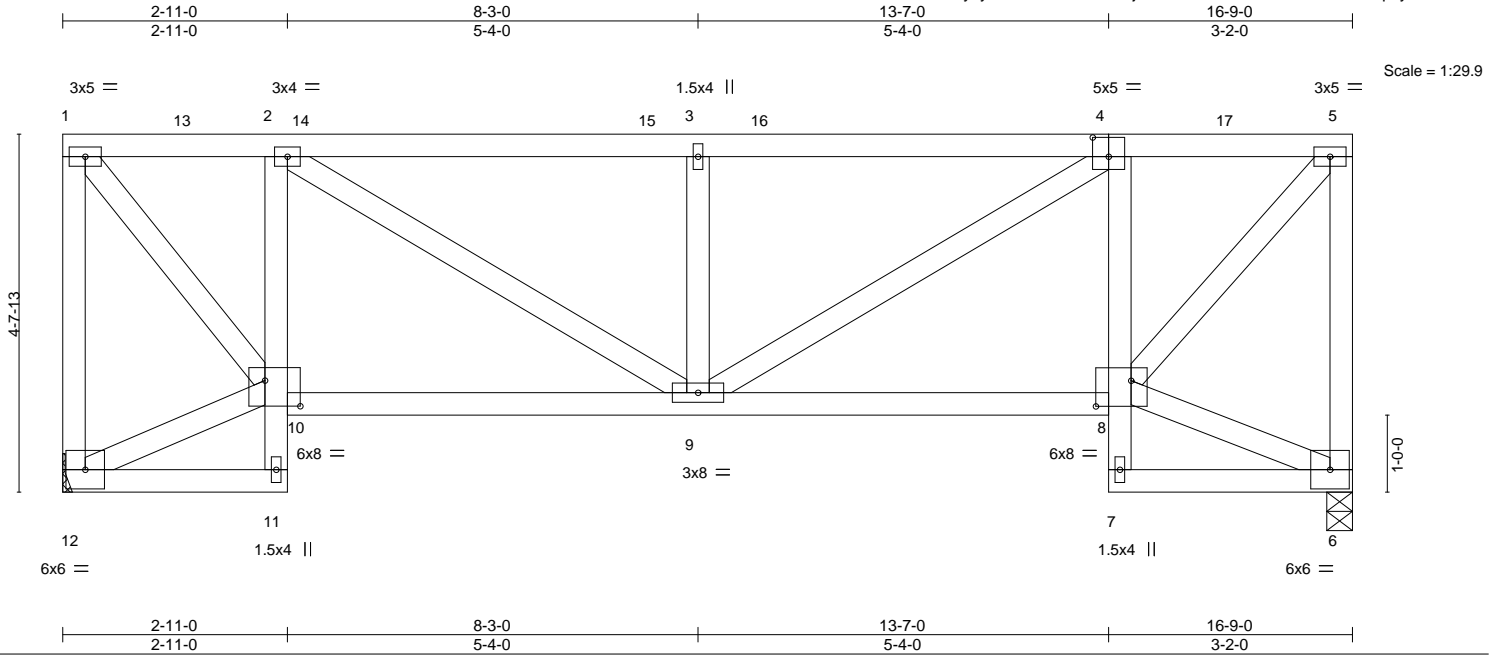


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0], [8:0-5-8,0-4-0], [10:0-5-8,0-4-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	0.04	9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.06	8-9	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.30	Horz(CT)	0.03	6	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-AS							Weight: 116 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 12=Mechanical, 6=0-4-0
Max Horz 12=-209(LC 8)
Max Uplift 12=-184(LC 8), 6=-184(LC 9)
Max Grav 12=658(LC 1), 6=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-12=-627/631, 1-2=-502/545, 2-3=-875/762, 3-4=-875/762, 4-5=-493/418,
5-6=-630/626
BOT CHORD 2-10=-479/586, 9-10=-693/648, 8-9=-542/523, 4-8=-432/504
WEBS 10-12=-266/304, 1-10=-682/744, 2-9=-430/432, 3-9=-370/456, 4-9=-407/418,
5-8=-658/719

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 13-7-4, Corner(3) 13-7-4 to 16-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=184, 6=184.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314073
FRED_PERRY	K07	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:49 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzwB6i-yyLvSjt9Nb?aNh_it5NR2ojzeqUIJJZATQnQ5yw85W

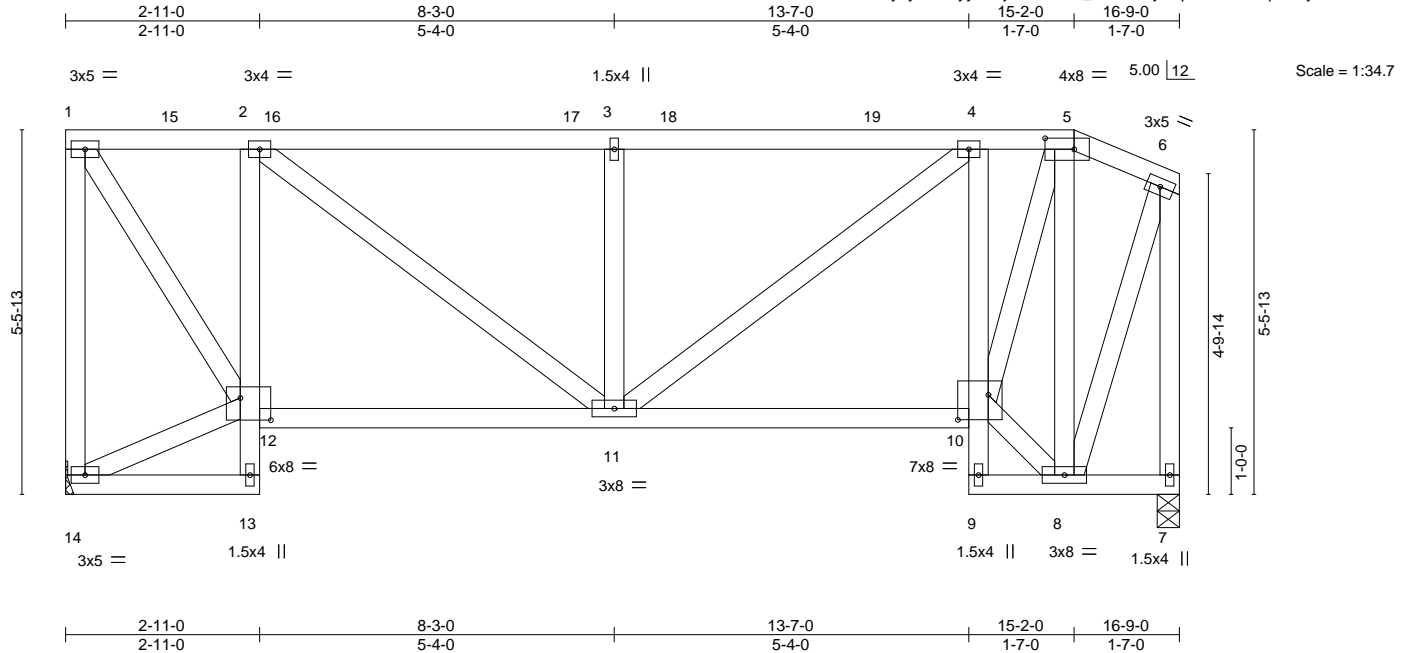


Plate Offsets (X,Y)-- [5:0-5-4,0-2-0], [10:0-5-8,0-4-8], [12:0-5-8,0-4-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	0.03 11	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.29	Vert(CT)	-0.06 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.03 7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 136 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.


(size) 14=Mechanical, 7=0-4-0
Max Horz 14=-251(LC 8)
Max Uplift 14=-197(LC 8), 7=-158(LC 9)
Max Grav 14=658(LC 1), 7=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-14=-628/349, 1-2=-440/311, 2-3=-697/379, 3-4=-697/379, 4-5=-413/222,
5-6=-258/202, 6-7=-634/327
BOT CHORD 2-12=-489/390, 11-12=-415/597, 10-11=-329/485, 4-10=-456/326
WEBS 12-14=-301/358, 1-12=-336/691, 2-11=-264/397, 3-11=-343/257, 4-11=-181/338,
8-10=-155/275, 5-10=-461/729, 5-8=-659/458, 6-8=-297/523

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 15-2-0, Exterior(2E) 15-2-0 to 16-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=197, 7=158.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

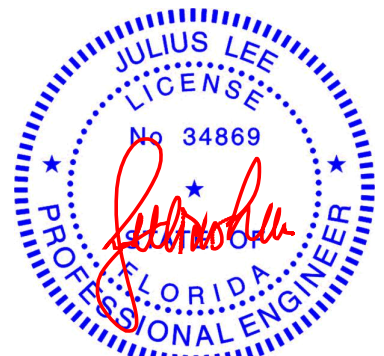

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314074
FRED_PERRY	K08	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:50 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-Q9vlg3uo8v7R?gZURpuga?G6NEnv2mYKl2ZxzYw85V

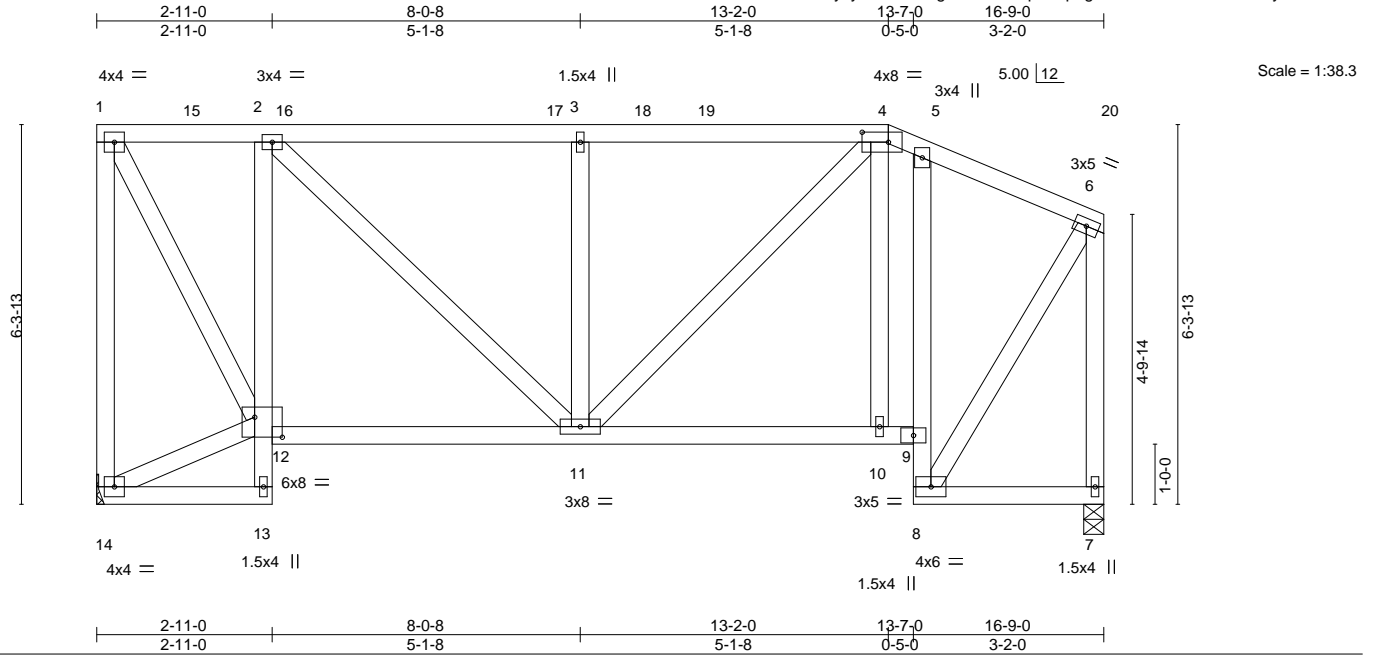


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [12:0-5-8,0-4-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.40	Vert(LL)	0.04 10-11	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.39	Vert(CT)	-0.08 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.26	Horz(CT)	0.06 7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 135 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 14=Mechanical, 7=0-4-0
Max Horz 14=-295(LC 8)
Max Uplift 14=-209(LC 8), 7=-137(LC 12)
Max Grav 14=658(LC 1), 7=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-14=-628/354, 1-2=-396/294, 2-3=-584/373, 3-4=-584/373, 4-5=-499/309,
5-6=-359/221, 6-7=-672/387
BOT CHORD 2-12=-493/432, 11-12=-345/529, 10-11=-272/412, 9-10=-273/409, 8-9=-418/285,
5-9=-456/312
WEBS 12-14=-330/429, 1-12=-308/652, 2-11=-290/389, 3-11=-353/273, 6-8=-339/577,
4-11=-198/357

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 13-2-0, Exterior(2R) 13-2-0 to 16-2-0, Interior(1) 16-2-0 to 16-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=209, 7=137.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314075
FRED_PERRY	K09	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:51 2022 Page 1

ID:obm8e8iJ6kih6vVZ2?kAzywB6i-vLSgtOvQvDFld_8h_WPv7DoFPd8SnDXTxiJUVzyw85U

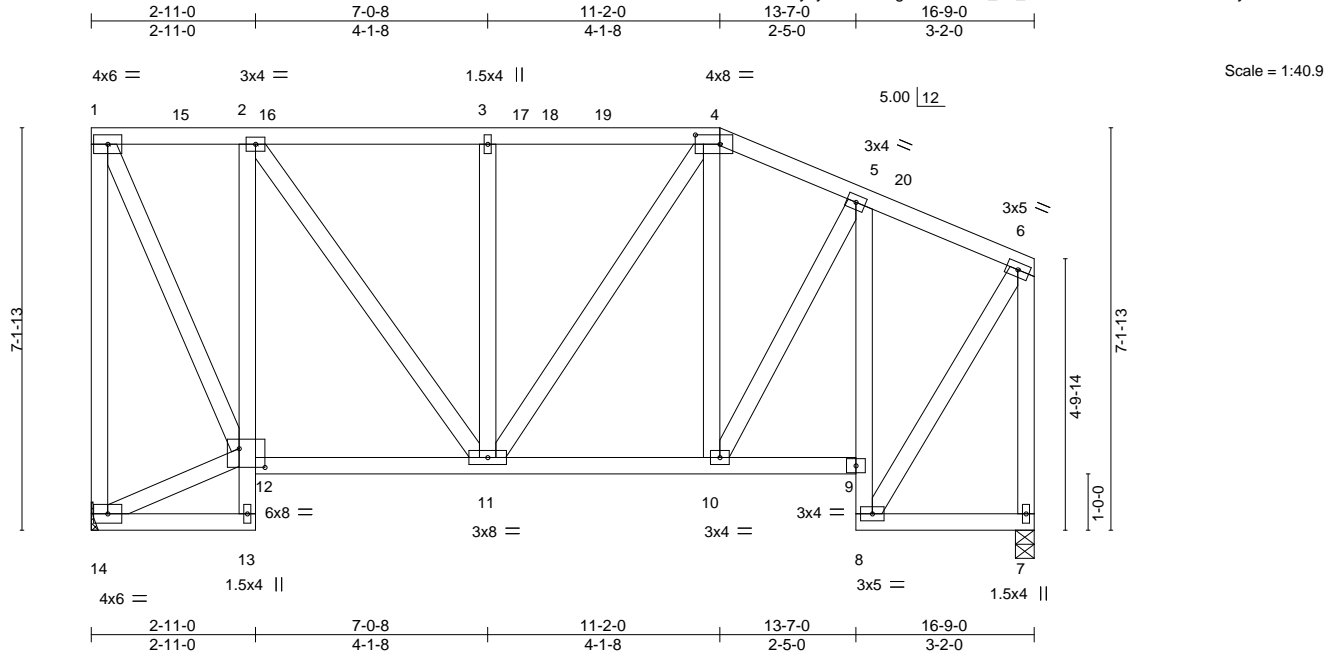


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [12:0-5-8,0-4-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.57	Vert(LL) 0.03	9-10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.37	Vert(CT) -0.04	9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.28	Horz(CT) 0.05	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS					Weight: 149 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 14=Mechanical, 7=0-4-0
Max Horz 14=-338(LC 8)
Max Uplift 14=-220(LC 8), 7=-135(LC 12)
Max Grav 14=658(LC 1), 7=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-14=-628/365, 1-2=-368/287, 2-3=-477/357, 3-4=-477/357, 4-5=-492/315,
5-6=-357/204, 6-7=-665/376
BOT CHORD 2-12=-508/467, 11-12=-290/480, 10-11=-306/496, 9-10=-248/379, 8-9=-388/259,
5-9=-411/310
WEBS 12-14=-360/478, 1-12=-287/623, 2-11=-312/386, 3-11=-271/224, 5-10=-122/261,
6-8=-305/534

NOTES-

- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 11-2-0, Exterior(2R) 11-2-0 to 14-2-0, Interior(1) 14-2-0 to 16-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=220, 7=135.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

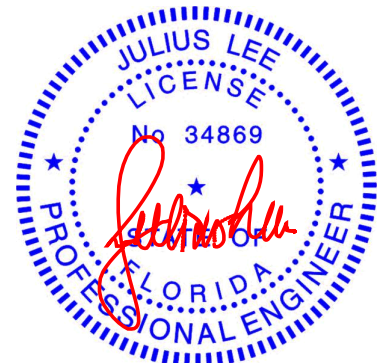

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314076
FRED_PERRY	K10	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:52 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAzywB6i-NX025kw2gWN9E8jtYDw8fQLR71UgWdec9M211Qyw85T

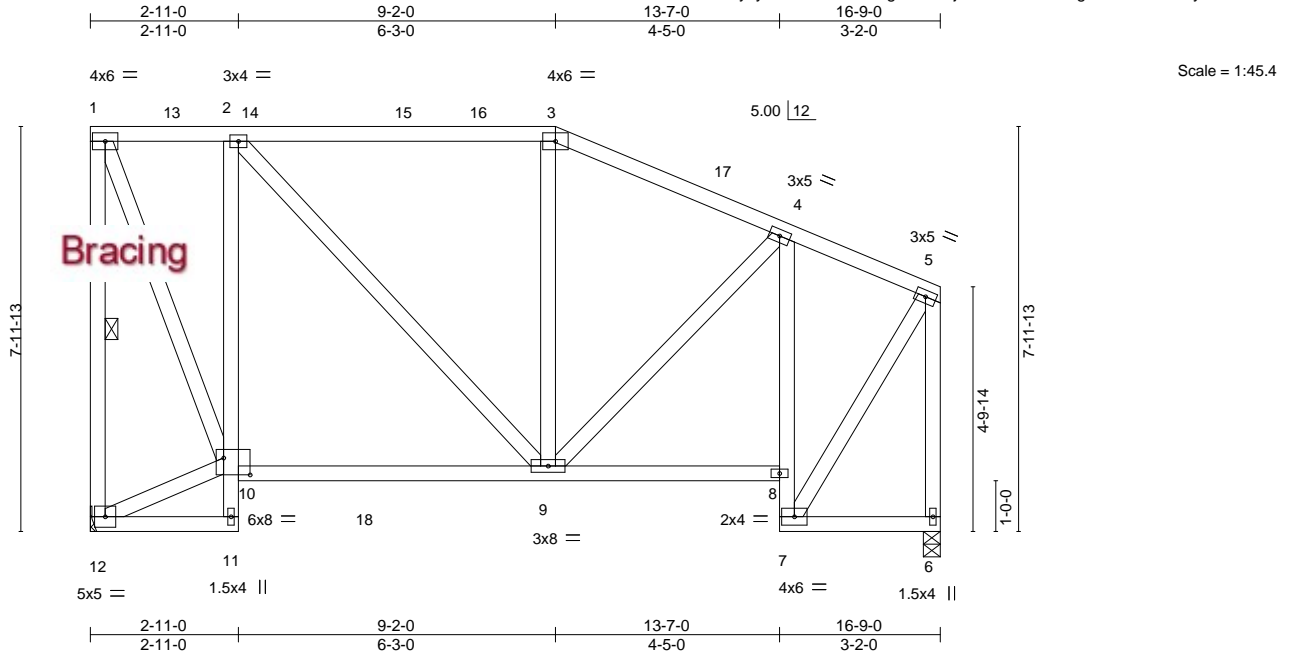


Plate Offsets (X,Y)-- [10:0-6-4,0-4-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.51	Vert(LL)	-0.05	9-10	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.38	Vert(CT)	-0.10	9-10	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.48	Horz(CT)	0.06	6	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS						
	Code FBC2020/TPI2014						Weight: 141 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 1-12

REACTIONS.

(size) 12=Mechanical, 6=0-4-0
Max Horz 12=-381(LC 8)
Max Uplift 12=-232(LC 8), 6=-132(LC 12)
Max Grav 12=789(LC 18), 6=717(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-12=-729/363, 1-2=-377/297, 2-3=-493/348, 3-4=-586/331, 4-5=-426/184,
5-6=-713/370
BOT CHORD 2-10=-546/545, 9-10=-258/469, 8-9=-256/399, 7-8=-425/260, 4-8=-386/297
WEBS 10-12=-378/557, 1-10=-299/758, 2-9=-333/354, 5-7=-308/615

NOTES-

- 1) Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 9-2-0, Exterior(2R) 9-2-0 to 12-2-0, Interior(1) 12-2-0 to 16-7-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=232, 6=132.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314077
FRED_PERRY	K11	Roof Special Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Wed Jul 20 15:05:53 2022 Page 1
ID:obm8e8iJ6kih6vVZ2?kAyzywB6i-rkaQl4xgRqV0slI36xSNCeuWKRtxF7WmO0obasyw85S

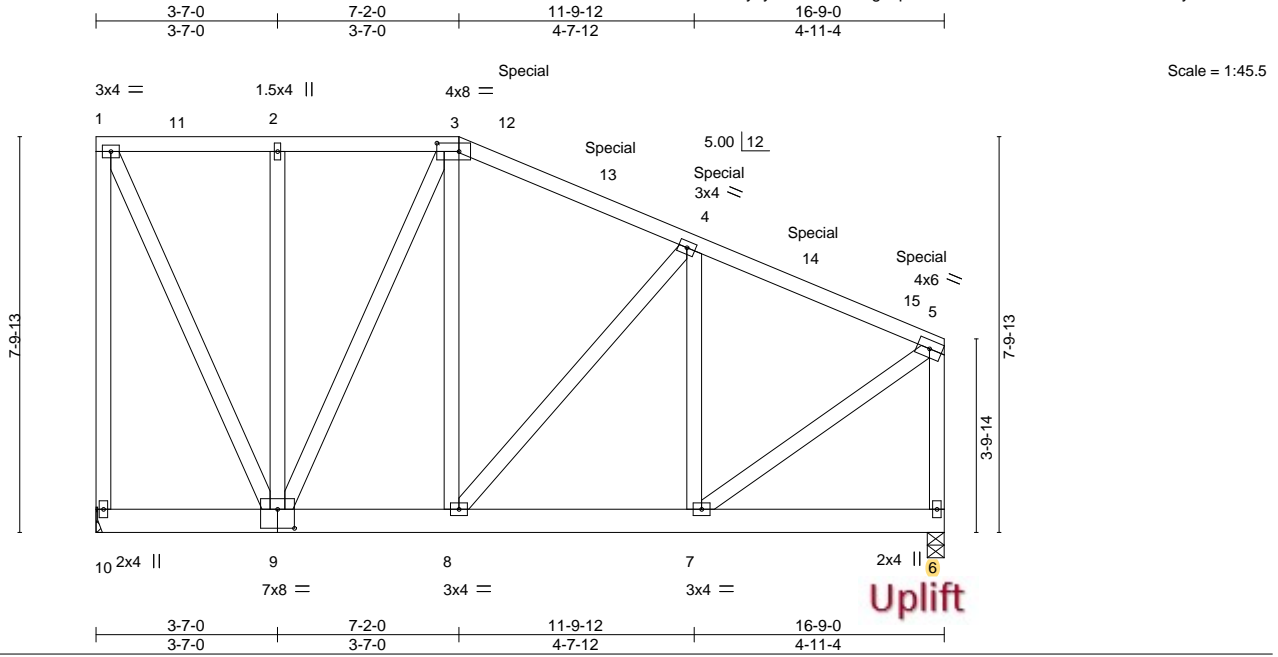


Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [9:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.87	Vert(LL)	-0.02	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.18	Vert(CT)	-0.04	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.31	Horz(CT)	0.01	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 301 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 10=Mechanical, 6=0-4-0
Max Horz 10=-372(LC 4)
Max Uplift 10=-462(LC 4), 6=-700(LC 8)
Max Grav 10=1515(LC 1), 6=2750(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-10=-1476/463, 1-2=-646/289, 2-3=-646/289, 3-4=-1540/473, 4-5=-2163/599, 5-6=-2682/720
BOT CHORD 9-10=-207/289, 8-9=-333/1191, 7-8=-465/1724
WEBS 1-9=-473/1515, 3-9=-1268/388, 3-8=-174/706, 4-8=-831/306, 4-7=-1120/371, 5-7=-497/2026

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-6-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=140mph (3-second gust) Vasd=108mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=462, 6=700.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 588 lb down and 214 lb up at 7-9-12, 588 lb down and 218 lb up at 9-9-12, 665 lb down and 220 lb up at 11-9-12, and 588 lb down and 218 lb up at 13-9-12, and 595 lb down and 217 lb up at 15-9-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 21, 2022

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	FRED PERRY	T28314077
FRED_PERRY	K11	Roof Special Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-3=-60, 3-5=-60, 6-10=-20
- Concentrated Loads (lb)
- Vert: 4=-588(F) 12=-588(F) 13=-588(F) 14=-588(F) 15=-595(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION

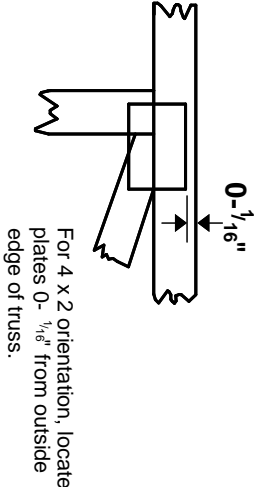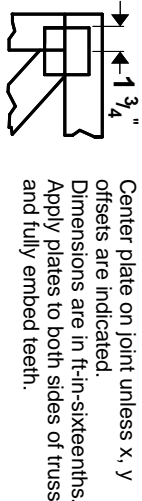

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.


This symbol indicates the required direction of slots in connector plates.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING

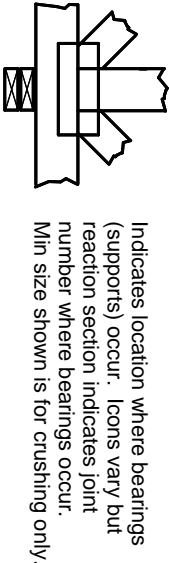

Industry Standards:
ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

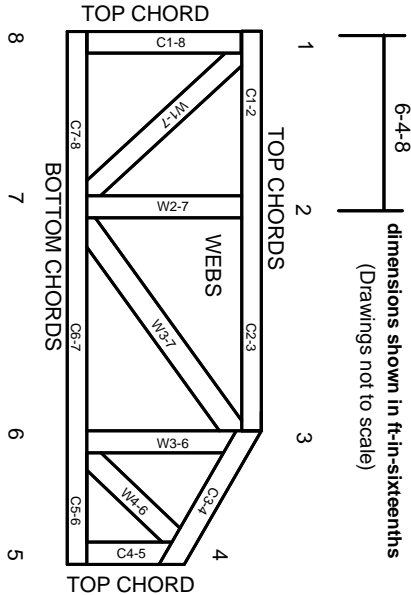

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

