



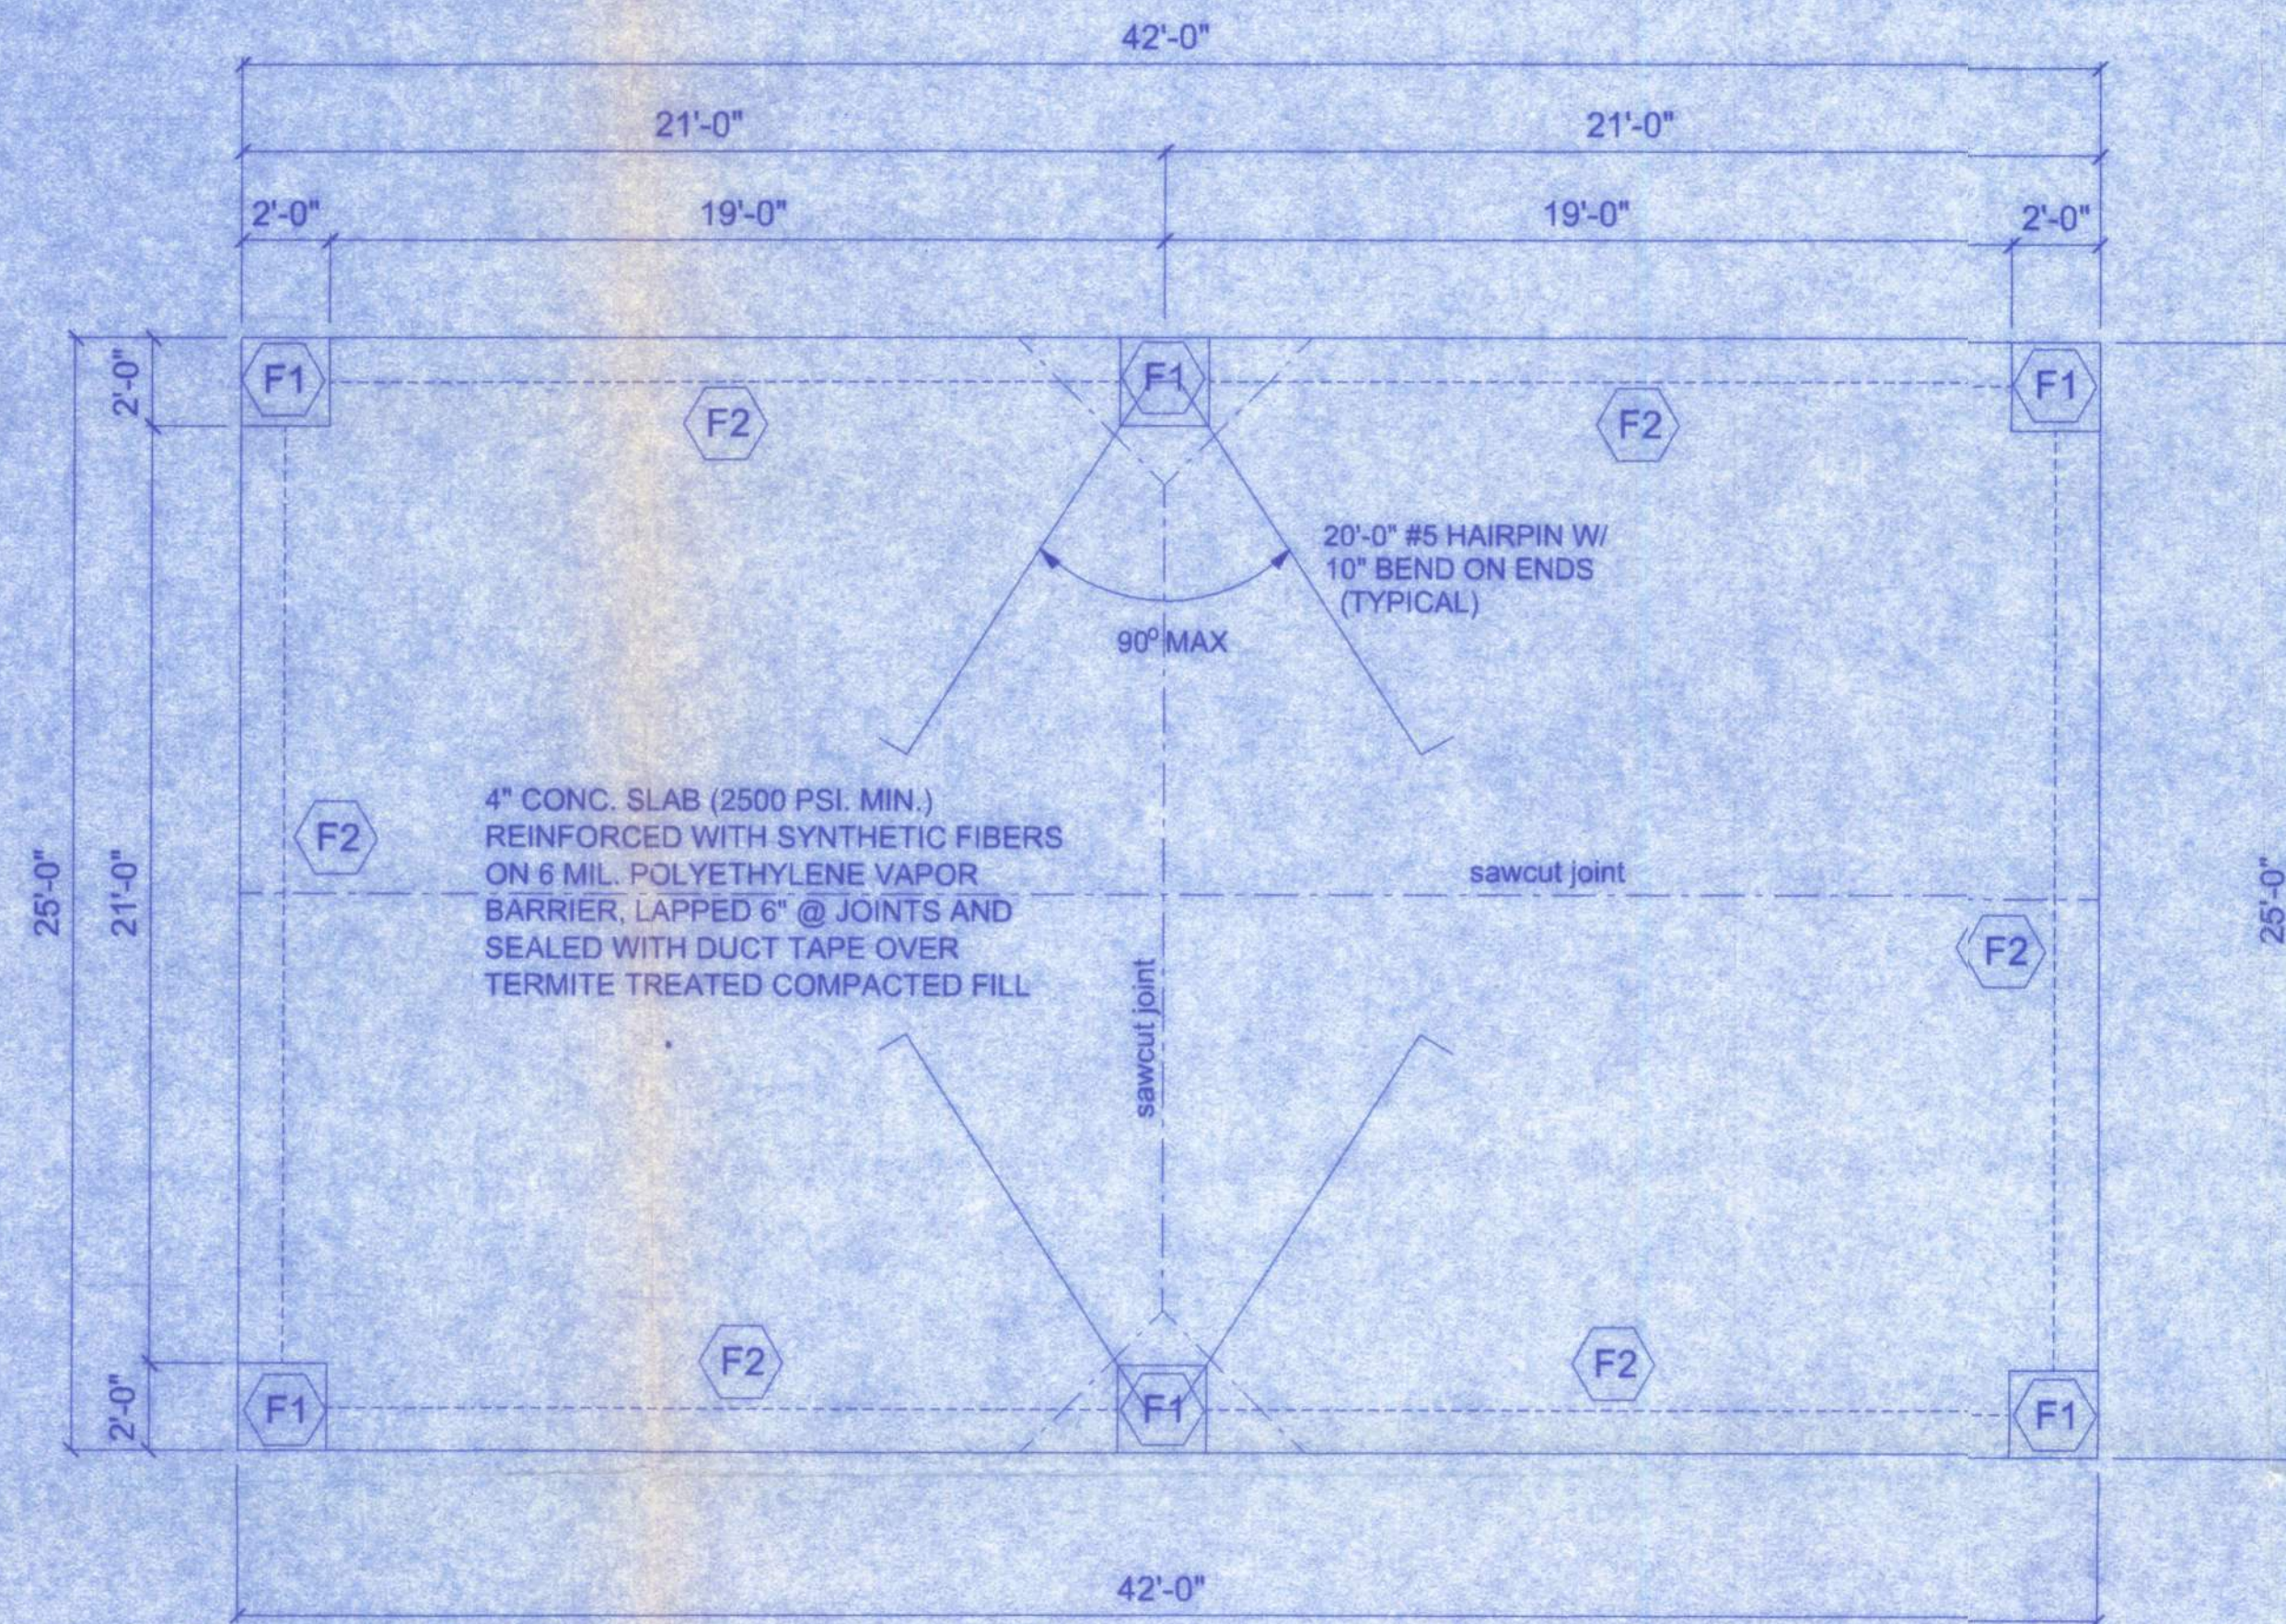

FOUNDATION PLAN


SCALE: 1/4" = 1'-0"

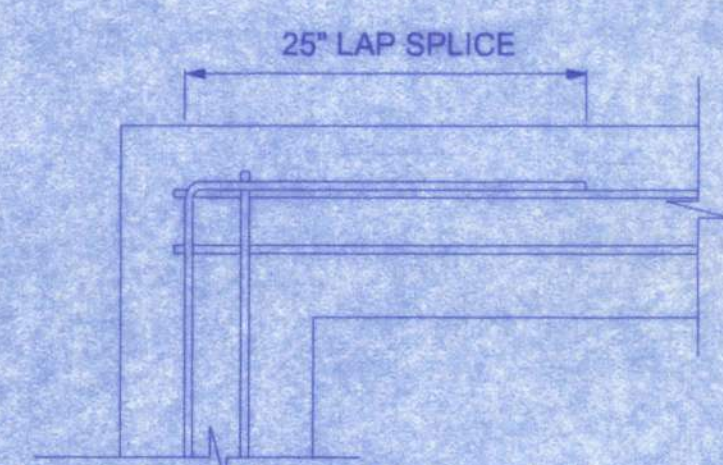

CORNER REINF. DETAIL

SCALE: 3/4" = 1'-0"

NOTE:
SAW CUT SHALL BE MADE
WITHIN 24 HOURS OF POUR

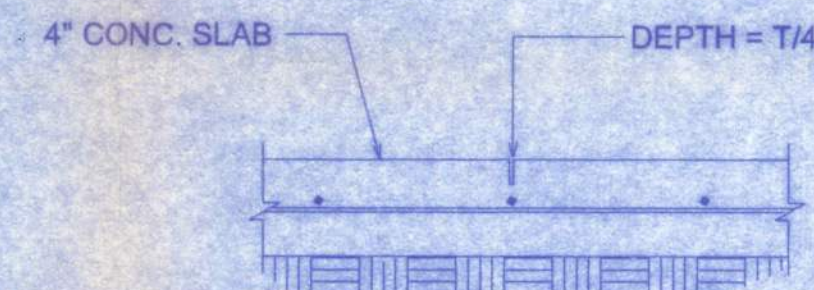

SAWCUT DETAIL

SCALE: 3/4" = 1'-0"

FOUNDATION NOTES

CONCRETE:
CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH
OF 2500 PSI AT 28 DAYS.


COVER OVER REINFORCING STEEL
FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS
SHALL BE:
3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND
PERMANENTLY IN CONTACT WITH THE EARTH OR EXPOSED TO THE EARTH
OR WEATHER AND 1 1/2 INCHES ELSEWHERE. REINFORCING BARS EMBEDDED
IN GROUTED CELLS; SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4 INCH FOR
FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS
AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS
SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN
2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER
1 1/2 INCHES FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER.

GALVANIZATION:
METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT
DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE
WITH ASTM A 153, CLASS B-2. METAL PLATE CONNECTORS, SCREWS, BOLTS
AND NAILS EXPOSED DIRECTLY TO THE WEATHER SHALL BE STAINLESS
STEEL OR HOT DIPPED GALVANIZED.

REINFORCING STEEL:
THE REINFORCING STEEL SHALL BE MINIMUM GRADE 40.


REINFORCEMENT MAY BE BENT IN THE SHOP OR THE FIELD PROVIDED:

1. ALL REINFORCEMENT IS BENT COLD.
 2. THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS
NOT LESS THAN SIX BAR DIAMETERS AND
 3. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE
FIELD BENT.
- EXCEPTION: WHERE BENDING IS NECESSARY TO ALIGN DOWEL BARS WITH
A VERTICAL CELL, BARS PARTIALLY EMBEDDED IN CONCRETE SHALL BE
PERMITTED TO BE BENT AT A SLOPE OF NOT MORE THAN 1 INCH OF
HORIZONTAL DISPLACEMENT TO 6 INCHES OF VERTICAL BAR LENGTH.

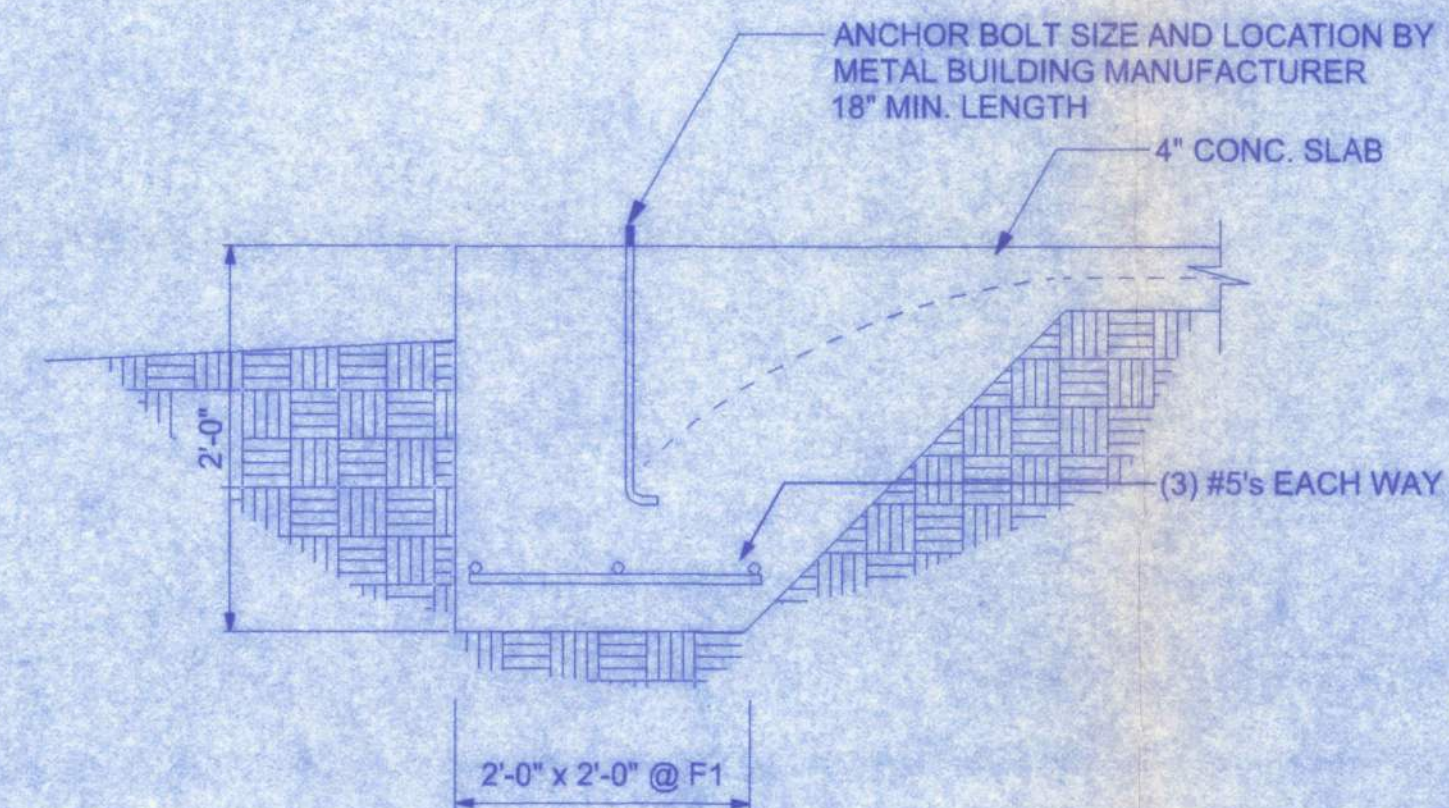

TYPE F1 FOOTING (COLUMN FOOTING)

SCALE: 3/4" = 1'-0"

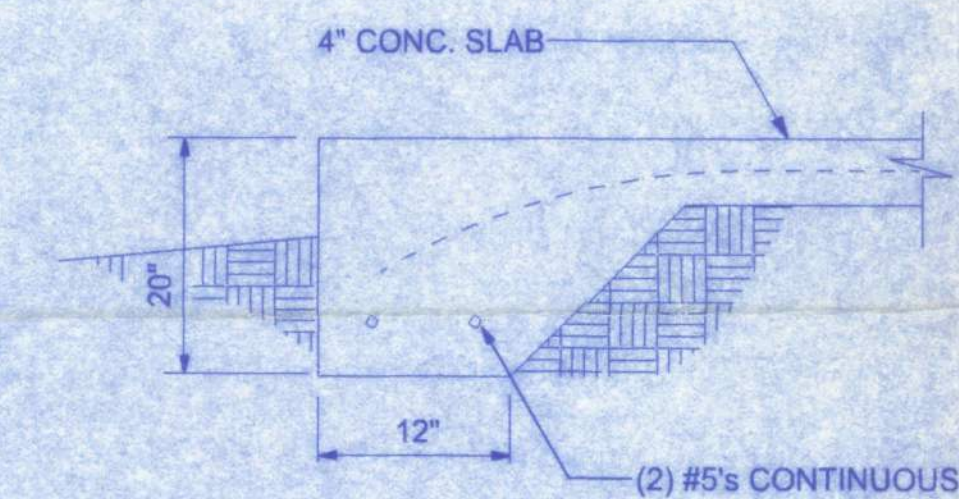

TYPE F2 FOOTING

SCALE: 3/4" = 1'-0"


NOTE:

SEE PLANS FROM STEEL BUILDING
MANUFACTURER FOR EXACT ANCHOR
BOLT SPACING AND LAYOUT.

J. T. D.
1/25/06

NORTH FLORIDA TRUCK PARTS TRUCK WASH FOUNDATION

161 NW MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(886) 758-4209



Freeman
Design Group Inc.

CERTIFICATE OF AUTHORIZATION # 00008701

DATE
10/25/06

DRAWN BY
J.T.D.

APPROVED
W.H.F.

REVISIONS

SHEET F-1

OF 1

PROJECT NO.
06.C010-F