


Building Opt - Fax # 758-2160

31936



- Engineering
 - Geotechnical
 - Environmental
- Laboratories**

Cal-Tech Testing, Inc.

P.O. Box 1026 • Lake City, FL 32066-1026 • Tel(386)755-3833 • Fax(386)752-5456

480 SR 13 N., Suite 205, #300, Jacksonville, FL 32259 • Tel(904)391-8801 • Fax(904)381-8802

JOB NO.: 14-00174-01

REPORT OF IN-PLACE DENSITY TEST

DATE TESTED: 5/7/14

DATE REPORTED: 5/8/14

PROJECT:	Lot 1 Cannon Creek Place	
CLIENT:	Mike Roberts Framing, 657 SW Catherine Lane, Lake City, Florida 32025	
GENERAL CONTRACTOR:	Mike Roberts Framing	
EARTHWORK CONTRACTOR:	Mike Roberts Framing	
INSPECTOR:	D. King	
ASTM METHOD	SOIL USE	
(D-6938) Nuclear	BUILDING FILL	
SPECIFIED REQUIREMENTS: 95%		

TEST NO.	TEST LOCATION	TEST DEPTH	WET DENSITY (lb/ft ³)	MOISTURE PERCENT	DRY DENSITY (lb/ft ³)	PROCTOR TEST NO.	PROCTOR VALUE	% MAXIMUM DENSITY
1	South End Approximate Center 10' North	0-12"	112.9	6.2	106.3	1	104.0	102%
2	North End Approximate Center 15' South	0-12"	112.3	4.3	107.7	1	104.0	104%


REMARKS: The Above Tests Meet Specified Requirements.

PROCTORS				
PROCTOR NO.	SOIL DESCRIPTION	MAXIMUM DRY UNIT WEIGHT (lb/ft ³)	OPT. MOIST.	TYPE
1	Tannish, Brown Sand (SP) Refer to CTI Job No.: 12-00234-01, Richardson Site Prep, Ft. White Plt Proctor #1	104.0	10.0	MODIFIED (ASTM D-1557)

Respectfully Submitted,
CAL-TECH TESTING, INC.

Reviewed By:

Linda Creamer, CEO, DBE
Linda M. Creamer
President - CEO

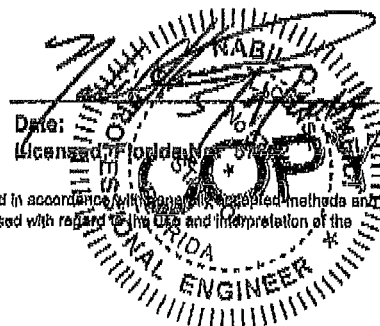

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with the specified methods and standards. Since material conditions can vary between test locations and change with time, sound judgement should be exercised with regard to the use and interpretation of the data. This report shall not be reproduced without prior approval of the author.