



THE HOME DEPOT #6864 - 215 SW HOME DEPOT DR, LAKE CITY, FL 32025 - SITE PLAN

THIS DRAWING IS FOR CONCEPTUAL PURPOSES ONLY. DUE TO CONSTRUCTION CONSTRAINTS, SIZES AND OR LAYOUTS MAY CHANGE SLIGHTLY.

ID. ASSOCIATES
BRINGING THE WORLD'S BRANDS TO LIFE
1771 INDUSTRIAL ROAD • DOTHAN, ALABAMA • 36303
PH (888) 303-5534 • FAX (334) 836-1401
www.idassociatesinc.com

CLIENT: **THE HOME DEPOT**
LOCATION: **LAKE CITY, FL** 215 SW HOME DEPOT DR
LAKE CITY, FL 32025
ACCOUNT REP: **R. BOUTWELL**
DRAWING NO: **THE HOME DEPOT-LAKE CITY, FL #6864-TRC**

STORE NO. **6864**
DATE: **11/22/22**
DRAWN BY: **PNS**


REV.	REV.	REV.	REV.



EXHIBIT APPROVED BY:

This document has been digitally signed and sealed by Christian Langley, PE on the date noted in this digital signature. Printed copies of this document are not considered signed & sealed, & the signature must be verified on any electronic copies.
Serial: 44 49 8F 53 22 18 30 0D 22 90 96 67



Digitally signed by
Christian Langley
Date: 2023.06.16
13:30:21 -04'00'

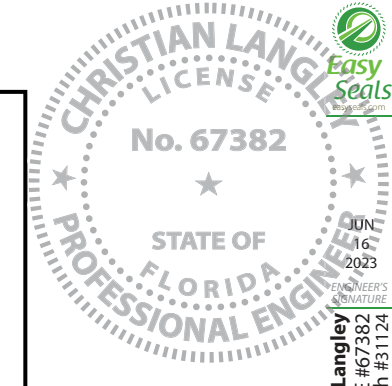



ASCE 7-16 • V=130 mph • Risk Category 2 Struct. • Sign Height = 30 ft max • Wall components & cladding:
WIND LOADS: • Exposure 'C' • ASD Load Coeff = 0.6 • Zone 4: ± 23.8 psf • Zone 5: ± 30.3 psf

General • Design is in accordance with the requirements of the Fla Bldg Code 7th Ed (2020) for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISI 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.C.

NEW TRC SIGN & PLACARDS

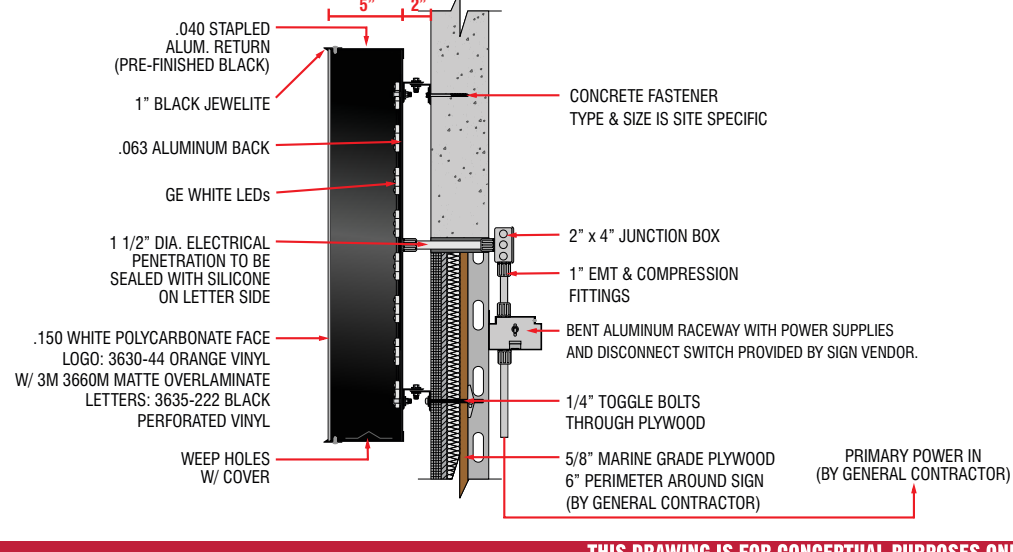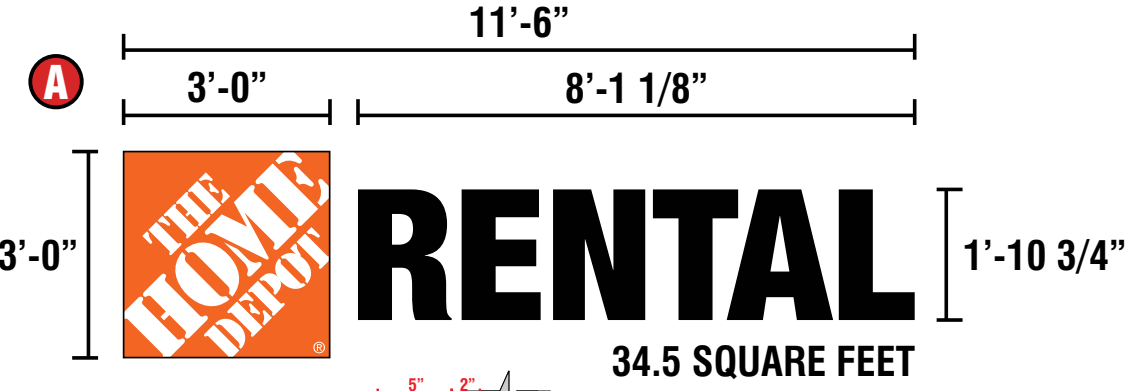

LOCATION OF DOOR TO BE DETERMINED

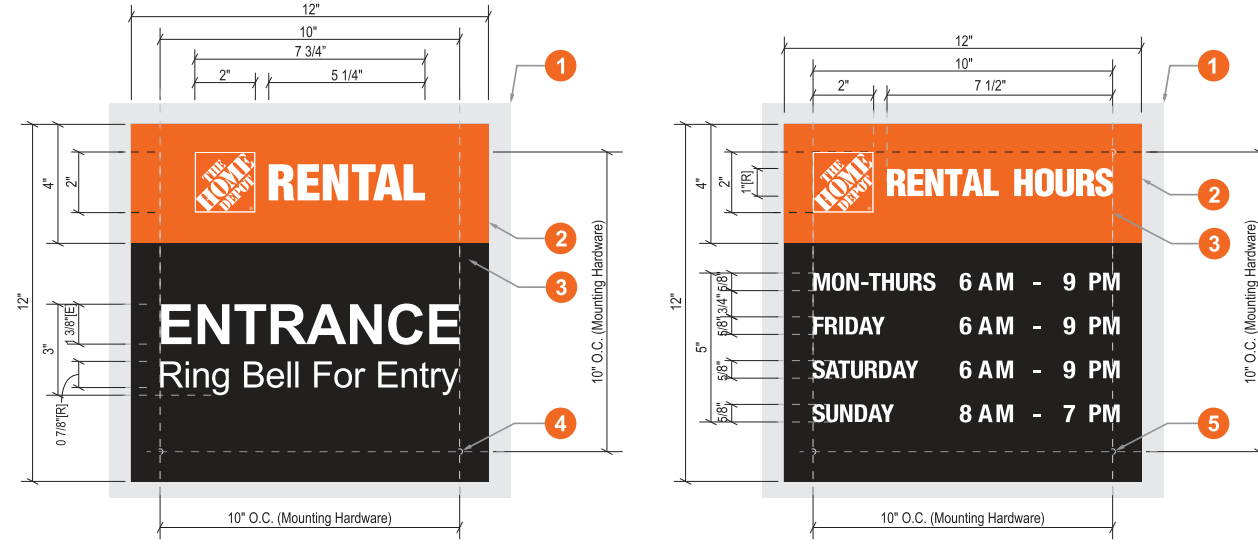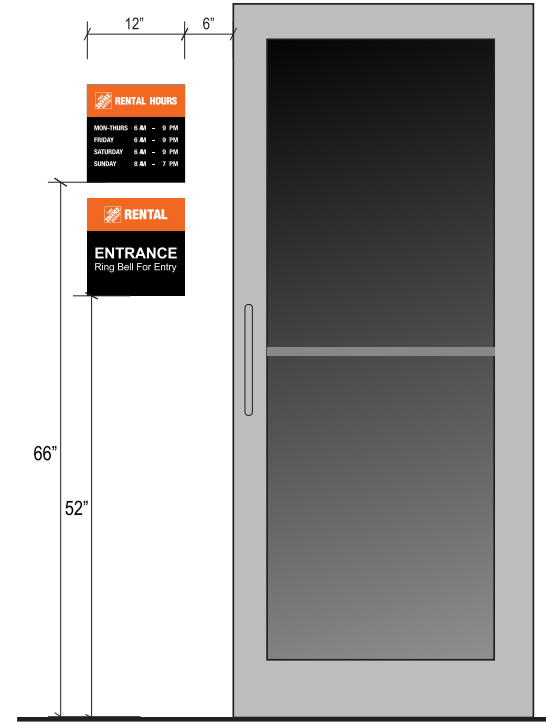

Specifications:


1. Facade: Concrete / Metal
2. ACM Steel panel w/ applied digital print graphics including standard hours.
3. First surface applied digital printed graphics:
 ■ 3M-3630-44 Orange
 ■ 3M-7725-12 Black
 with applied 3M 3660m Matt Clear Overlay
4. Additional Hours / Numbers are magnetic.
5. Mounting Hardware: Stud mounted with 3/16" studs

THIS DRAWING IS FOR CONCEPTUAL PURPOSES ONLY. DUE TO CONSTRUCTION CONSTRAINTS, SIZES AND OR LAYOUTS MAY CHANGE SLIGHTLY.




CLIENT:	THE HOME DEPOT	STORE NO.:	6864
LOCATION:	LAKE CITY, FL	DATE:	11/22/22
ACCOUNT REP.:	R. BOUTWELL	DRAWN BY:	PNS
DRAWING NO.:	THE HOME DEPOT-LAKE CITY, FL #6864-TRC		

REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.

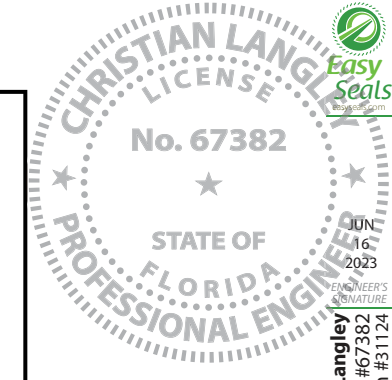


ASCE 7-16 • V=130 mph • Risk Category 2 Struct. • Sign Height = 30 ft max • Wall components & cladding:
 WIND LOADS: • Exposure 'C' • ASD Load Coeff = 0.6 • Zone 4: ± 23.8 psf • Zone 5: ± 30.3 psf

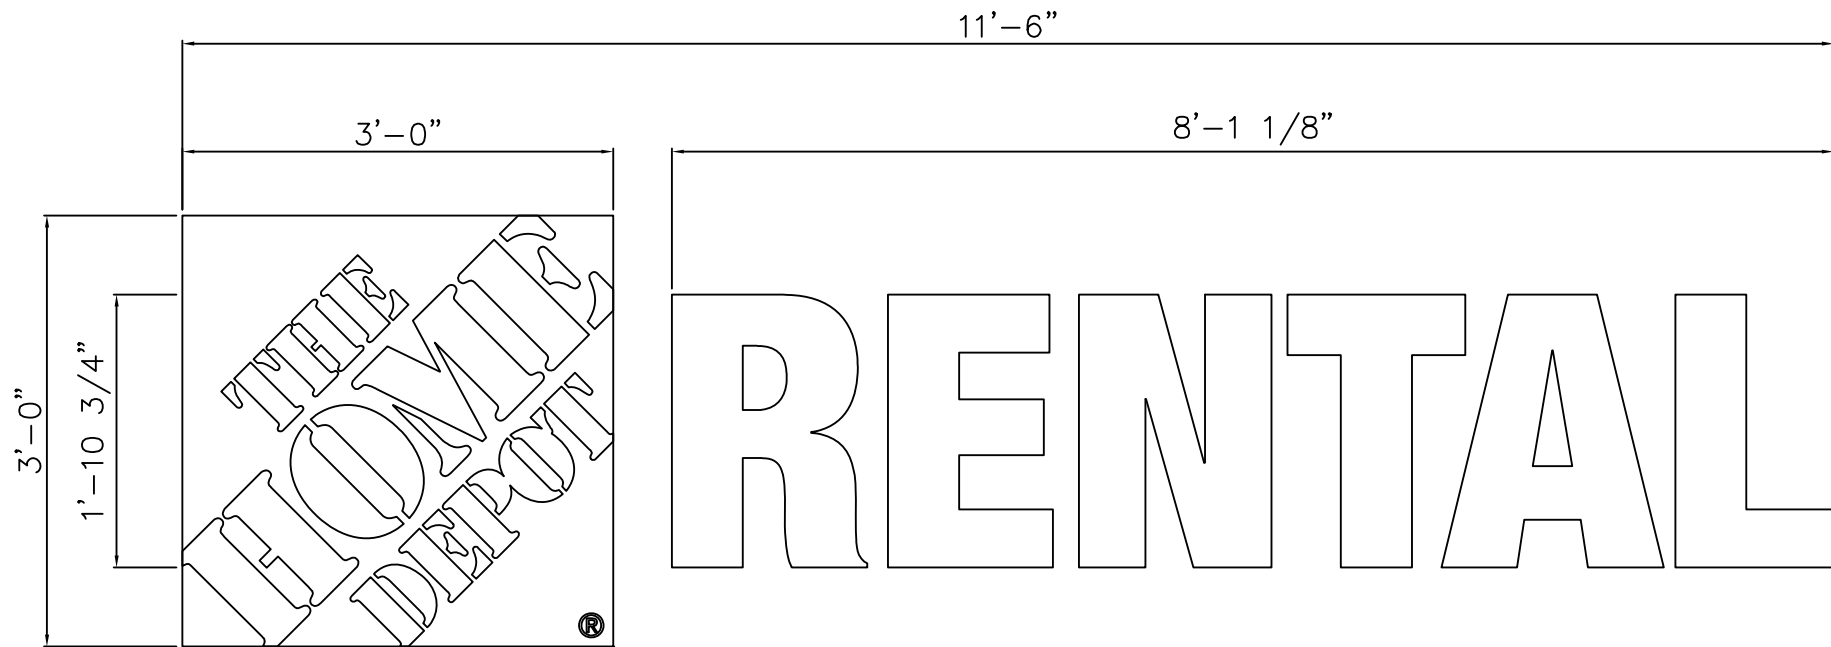


FRONT VIEW

BACK VIEW

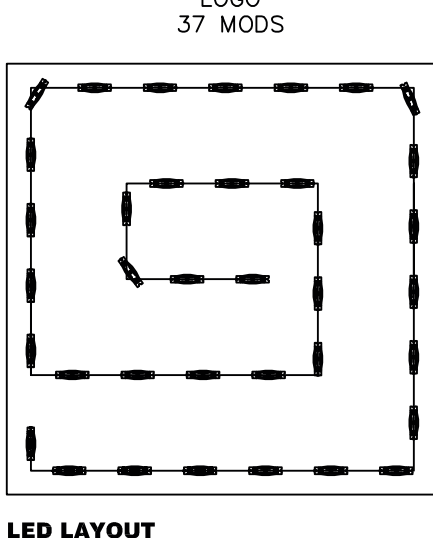


LED LAYOUT

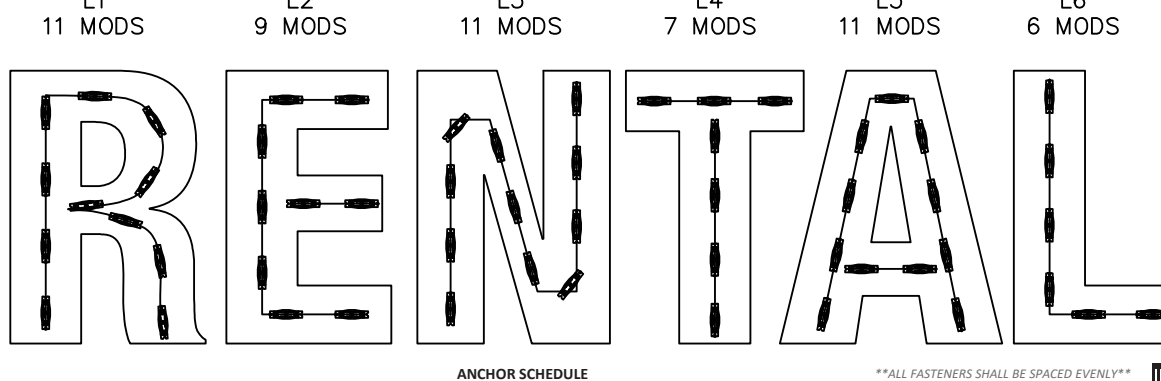

UL DISCONNECT SWITCH PER NEC 600.6- REQUIRED PER SIGN COMPONENT BEFORE LEAVING MANUFACTURER

ANCHOR SCHEDULE		**ALL FASTENERS SHALL BE SPACED EVENLY**	QTY or SPACING
WALL MATERIAL	ANCHOR TYPE		
CONCRETE (3ksi) or HOLLOW MASONRY	1/4" THREADED RODS WITH MIN 2" EMBED IN ADHESIVE		--NOT APPLICABLE--
	1/4" TAPCONS (OR EQUIV) WITH 1.75" EMBED		MIN (3) PER LETTER
	1/4" EXPANSION ANCHORS WITH 2.5" EMBED		MIN (3) PER LETTER
1/2" PLYWOOD (NO ACCESS BEHIND)	1/4" TOGGLE BOLTS		MIN (3) PER LETTER
	1/4" WOOD SCREWS, FULL EMBED		MIN (3) PER LETTER
METAL STUDS / PANELS	#14 METAL SCREWS TO MIN 18ga STEEL OR 0.090" ALUM		MIN (3) PER LETTER
HOLLOW WALL + BLOCKING	1/4" THRU BOLTS OR LAGS TO SOLID BLOCKING BEHIND		MIN (3) PER LETTER

AT LOGO, USE ANY ANCHOR OPTION SHOWN: MIN (4) TOTAL

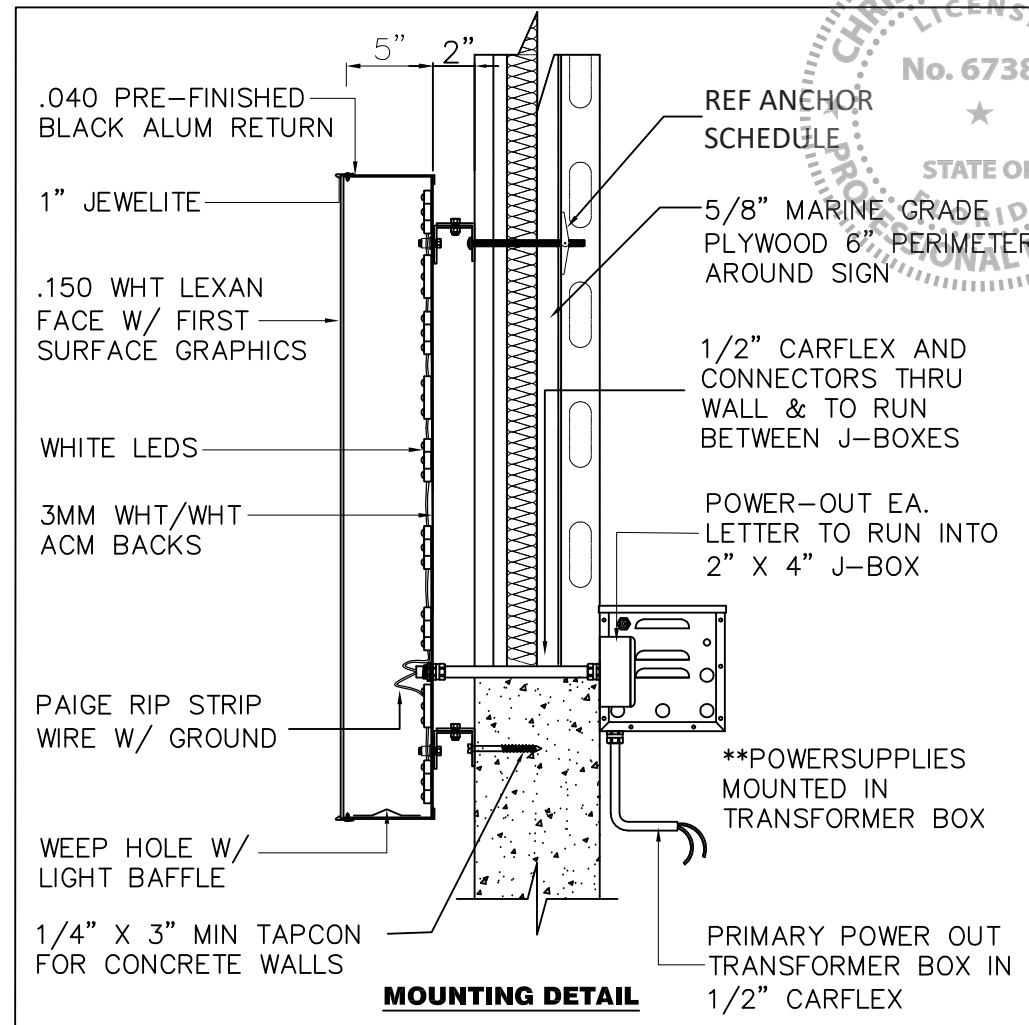

MOUNTING DETAIL

NOTES
3'-0" X 3'-0" X 5" DP. "THD" LOGO W/ 1'-10 3/4" X 8'-1 1/8" X 5" DP. CHANNEL LETTERS
.040 ALUM RETURNS
3MM WHT/WHT ACM BACKS
FACES TO BE .150 WHITE LEXAN W/ FIRST SURFACE VINYL GRAPHICS
REMOTE MOUNTED USING 2" CLIPS ON EA. LETTER & LOGO
INTERNALLY ILLUMINATED USING WHITE LEDS
COLORS
RETURN/JEWELITE- PRE-FINISHED BLACK
LOGO FACE- 3M 3630-44 ORANGE VINYL W/ WEEDED OUT COPY LETTER FACE- 3M 3635-222 DUAL COLOR VINYL
ELECTRICAL
(92) TOTAL MODS OF GEMX71-W1 WHITE LEDS
(1) GEPS12-60U-NA POWER SUPPLIES
0.65 MAX AMPS
(1) 15 AMP DISCONNECT SWITCH ON TRANSFORMER BOX

ID. ASSOCIATES BRINGING THE WORLD'S BRANDS TO LIFE 1771 INDUSTRIAL RD. DOTHAN, AL 36303 PHONE: (334) 836-1400 FAX: (334) 836-1401		CUSTOMER: THE HOME DEPOT	
LOCATION: 215 SW HOME DEPOT DR LAKE CITY, FL 32025		ACCOUNT MANAGER: HOLDERFIELD	
Date: 9/26/18 Revised: 3/4/21 POWER AT BOTTOM Revised: 8/20/21 ADD SWITCH NOTE Revised:		BY: RES MRJ RES	
ESTIMATED WEIGHT:		WIND LOAD:	
APPROVED BY:		APPROVED DATE:	
ITEM NUMBER: THD-36-RENTAL-CL		Underwriters Laboratories Inc.	

General • Design is in accordance with the requirements of the **Fla Bldg Code 7th Ed (2020)** for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISI 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.O.

Notes: as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.O.