



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 3125356 - IC CONST. - ROBERTS RES.

MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: IC CONSTRUCTION Project Name: Roberts Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: TBD, TBD
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.5
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 60 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T29350261	CJ01	12/7/22	15	T29350275	HJ12	12/7/22
2	T29350262	CJ01A	12/7/22	16	T29350276	T01	12/7/22
3	T29350263	CJ02	12/7/22	17	T29350277	T02	12/7/22
4	T29350264	CJ03	12/7/22	18	T29350278	T03	12/7/22
5	T29350265	CJ03A	12/7/22	19	T29350279	T04	12/7/22
6	T29350266	CJ04	12/7/22	20	T29350280	T05	12/7/22
7	T29350267	CJ05	12/7/22	21	T29350281	T06	12/7/22
8	T29350268	CJ06	12/7/22	22	T29350282	T07	12/7/22
9	T29350269	EJ01	12/7/22	23	T29350283	T08	12/7/22
10	T29350270	EJ02	12/7/22	24	T29350284	T09	12/7/22
11	T29350271	EJ03	12/7/22	25	T29350285	T10	12/7/22
12	T29350272	HJ06	12/7/22	26	T29350286	T11	12/7/22
13	T29350273	HJ07	12/7/22	27	T29350287	T12	12/7/22
14	T29350274	HJ10	12/7/22	28	T29350288	T13	12/7/22




This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: O'Regan, Philip

My license renewal date for the state of Florida is February 28, 2023.

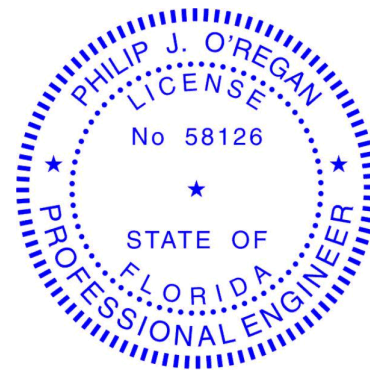


Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

December 7, 2022

O'Regan, Philip

1 of 2



RE: 3125356 - IC CONST. - ROBERTS RES.

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:


Customer Info: IC CONSTRUCTION Project Name: Roberts Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: TBD, TBD
City: Columbia Cty State: FL

No.	Seal#	Truss Name	Date
29	T29350289	T14	12/7/22
30	T29350290	T15	12/7/22
31	T29350291	T17	12/7/22
32	T29350292	T18	12/7/22
33	T29350293	T19	12/7/22
34	T29350294	T20	12/7/22
35	T29350295	T21	12/7/22
36	T29350296	T22	12/7/22
37	T29350297	T23	12/7/22
38	T29350298	T24	12/7/22
39	T29350299	T25	12/7/22
40	T29350300	T26	12/7/22
41	T29350301	T27	12/7/22
42	T29350302	T28	12/7/22
43	T29350303	T28G	12/7/22
44	T29350304	T29	12/7/22
45	T29350305	T29G	12/7/22
46	T29350306	T30	12/7/22
47	T29350307	T31	12/7/22
48	T29350308	T32	12/7/22
49	T29350309	T33	12/7/22
50	T29350310	V01	12/7/22
51	T29350311	V02	12/7/22
52	T29350312	V03	12/7/22
53	T29350313	V04	12/7/22
54	T29350314	V05	12/7/22
55	T29350315	V06	12/7/22
56	T29350316	V07	12/7/22
57	T29350317	V08	12/7/22
58	T29350318	V09	12/7/22
59	T29350319	V10	12/7/22
60	T29350320	V11	12/7/22

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.
3125356	CJ01	Jack-Open	4	1	T29350261

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:07 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-rcwKtOOkrKCKE9HFHACiGa4sPgtf1JEaHj8u9yBbx2

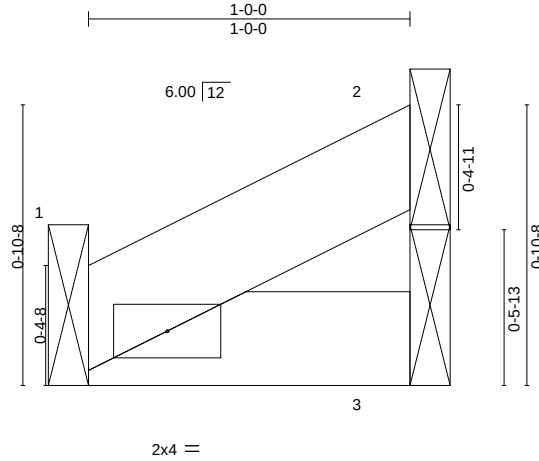

Scale = 1:7.2

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	2-0-0	Plate Grip DOL	1.25	TC	0.02	in (loc)	l/defl	L/d	MT20	244/190
TCDL	7.0		Lumber DOL	1.25	BC	0.03	Vert(LL)	-0.00	6		
BCLL	0.0 *		Rep Stress Incr	YES	WB	0.00	Vert(CT)	-0.00	6		
BCDL	10.0		Code	FBC2020/TPI2014	Matrix-MP		Horz(CT)	-0.00	2		
										Weight: 3 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=Mechanical, 2=Mechanical, 3=Mechanical
Max Horz 3=25(LC 12)
Max Uplift 1=-15(LC 9), 2=-18(LC 12), 3=-12(LC 9)
Max Grav 1=37(LC 1), 2=21(LC 1), 3=17(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1, 18 lb uplift at joint 2 and 12 lb uplift at joint 3.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.
3125356	CJ01A	Jack-Open	8	1	T29350262

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:08 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-J6Ai4kPMceKBrJsRrtjxonc1H4D8mmTKoxThQcyBbx1

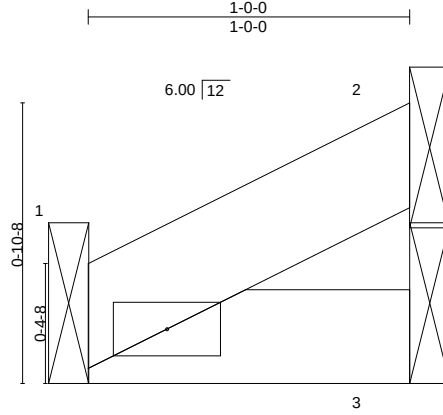

Scale = 1:7.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.01	Vert(LL)	-0.00	6	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.01	Vert(CT)	-0.00	6	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 1=Mechanical, 2=Mechanical
Max Horz 1=25(LC 12)
Max Uplift 3=-7(LC 12), 1=-10(LC 12), 2=-18(LC 12)
Max Grav 3=17(LC 3), 1=37(LC 1), 2=21(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3, 10 lb uplift at joint 1 and 18 lb uplift at joint 2.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350264
3125356	CJ03	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:11 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMXEEZke8Z-khrqilREuZimimb0W?GeQQETkHA6z5AmVvhM1xyBbx_

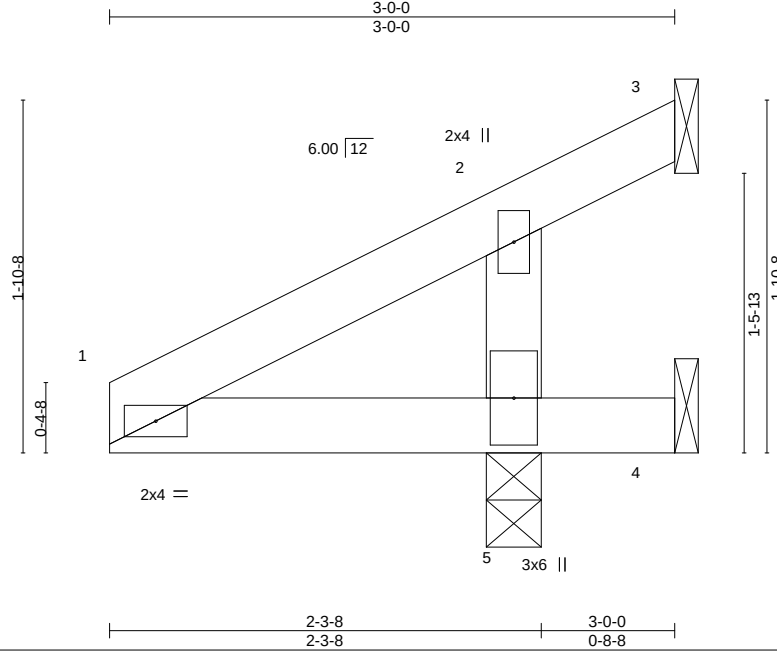

Scale = 1:12.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.31	Vert(LL)	0.00	5	>999	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.38	Vert(CT)	0.00	4-5	>999		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.13	Horz(CT)	0.04	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8
Max Horz 5=73(LC 12)
Max Uplift 3=-125(LC 1), 4=-156(LC 1), 5=-181(LC 12)
Max Grav 3=21(LC 12), 4=39(LC 12), 5=533(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-270/442

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left exposed ; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 125 lb uplift at joint 3, 156 lb uplift at joint 4 and 181 lb uplift at joint 5.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 35 lb down and 34 lb up at 0-0-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-6=-20
Concentrated Loads (lb)
Vert: 1=-35

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350265
3125356	CJ03A	Jack-Open	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:12 2022 Page 1
ID:Q7RwmdgDYh8qcXUfiYMxEeZke8Z-CtPDw5SsfsqdKwAC4jntzdniPhbUiaUvjZRvYNyBbwz

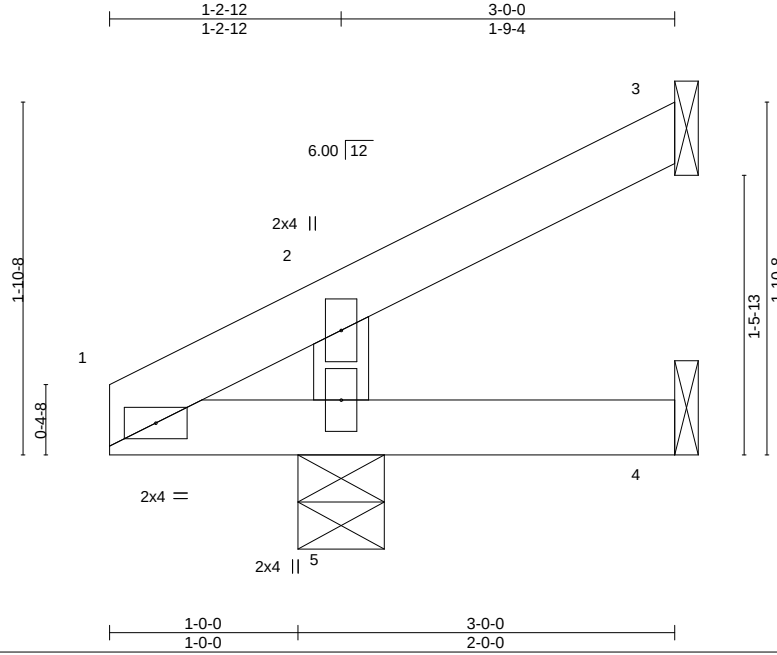

Scale = 1:12.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	Vert(LL)	0.00	5	>999	MT20	244/190
TCDL 7.0	1.25	BC 0.05	Vert(CT)	0.00	5	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 10 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-5-8
Max Horz 5=73(LC 12)
Max Uplift 3=-45(LC 12), 4=-4(LC 12), 5=-55(LC 12)
Max Grav 3=28(LC 1), 4=19(LC 3), 5=187(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 3, 4 lb uplift at joint 4 and 55 lb uplift at joint 5.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350267
3125356	CJ05	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:14 2022 Page 1

ID:Q7RwmdgDYh8qcxUfYmxEeZke8Z-8GXzLnU7BU4LZEJbB8qL22s?oUEGAToCBtw0dFyBbwX

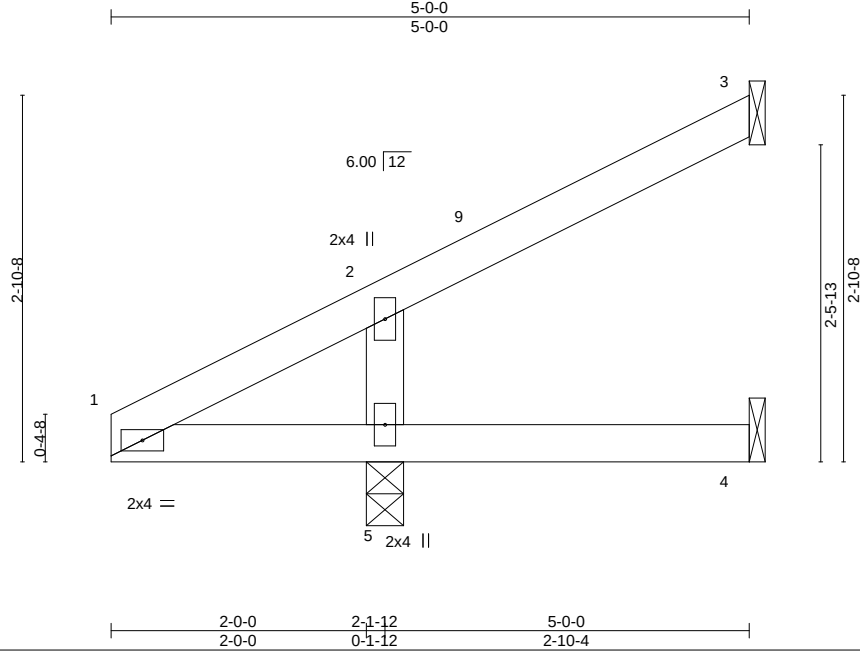

Scale = 1:18.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	Vert(LL)	0.00	4-5	>999	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.16	Vert(CT)	0.01	4-5	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT)	-0.03	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8
Max Horz 5=123(LC 12)
Max Uplift 3=-72(LC 12), 4=-5(LC 12), 5=-97(LC 12)
Max Grav 3=42(LC 1), 4=29(LC 3), 5=323(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-207/255

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-11-4 zone; porch right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 3, 5 lb uplift at joint 4 and 97 lb uplift at joint 5.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350268
3125356	CJ06	Jack-Open	12	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:15 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-cS5LY7VlynCCBNunlrLabGPAruaHwvRMPxfZ9iyBbww

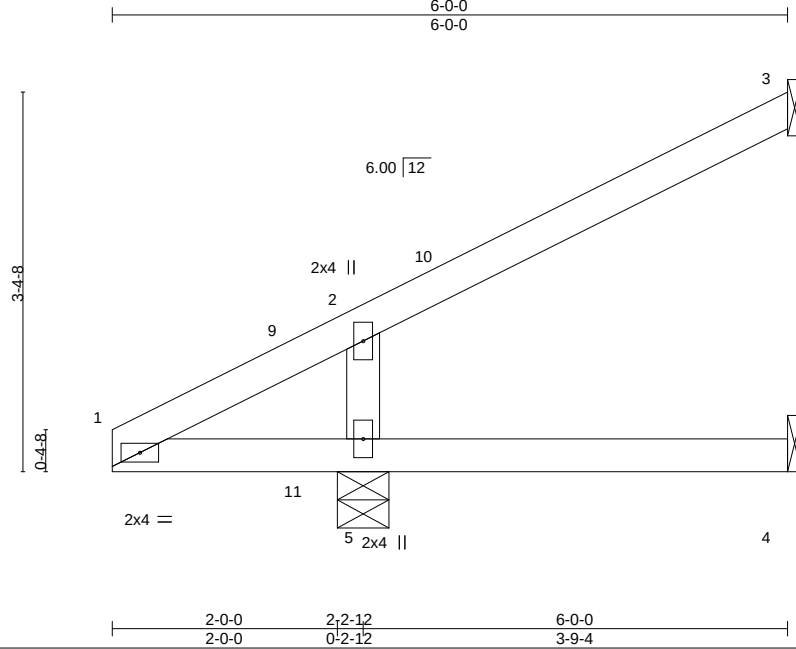

Scale = 1:20.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.24	Vert(LL) 0.01	4-5	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.17	Vert(CT) -0.01	4-5	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) -0.04	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 21 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-5-8
Max Horz 5=148(LC 12)
Max Uplift 3=-96(LC 12), 4=-8(LC 12), 5=-106(LC 12)
Max Grav 3=70(LC 1), 4=51(LC 3), 5=352(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-254/103
WEBS 2-5=-241/382

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 5-11-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 3, 8 lb uplift at joint 4 and 106 lb uplift at joint 5.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350269
3125356	EJ01	Jack-Partial	19	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:16 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-4fejTVNj5K2pXT_JZsp7TyGSluceMNVeBP6h8yBbwv

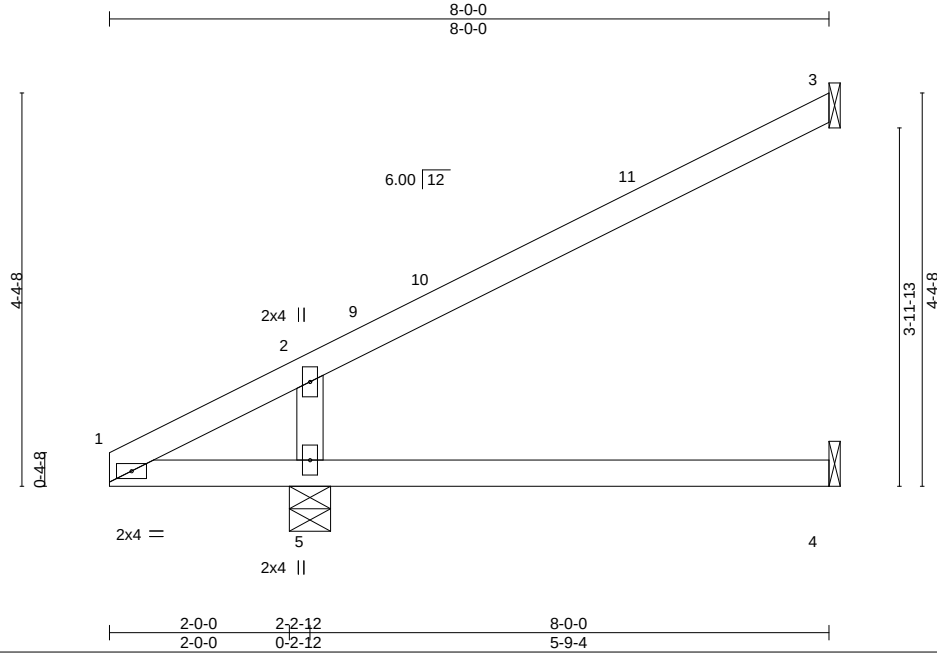

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.57	Vert(LL)	0.06	4-5	>999	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.29	Vert(CT)	-0.08	4-5	>867		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.13	Horz(CT)	-0.09	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 27 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-5-8
Max Horz 5=183(LC 12)
Max Uplift 3=-114(LC 12), 4=-9(LC 12), 5=-128(LC 12)
Max Grav 3=128(LC 1), 4=95(LC 3), 5=408(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-322/136
BOT CHORD 1-5=-118/264
WEBS 2-5=-323/449

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-11-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 114 lb uplift at joint 3, 9 lb uplift at joint 4 and 128 lb uplift at joint 5.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350270
3125356	EJ02	Jack-Partial	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:17 2022 Page 1

ID:Q7RwmdgDYh8qcxUfrYMxEEzke8Z-ZrC6zpW?UPSvRh2AsGN2ghUTqiF5Nqnfr8gDayBbwu

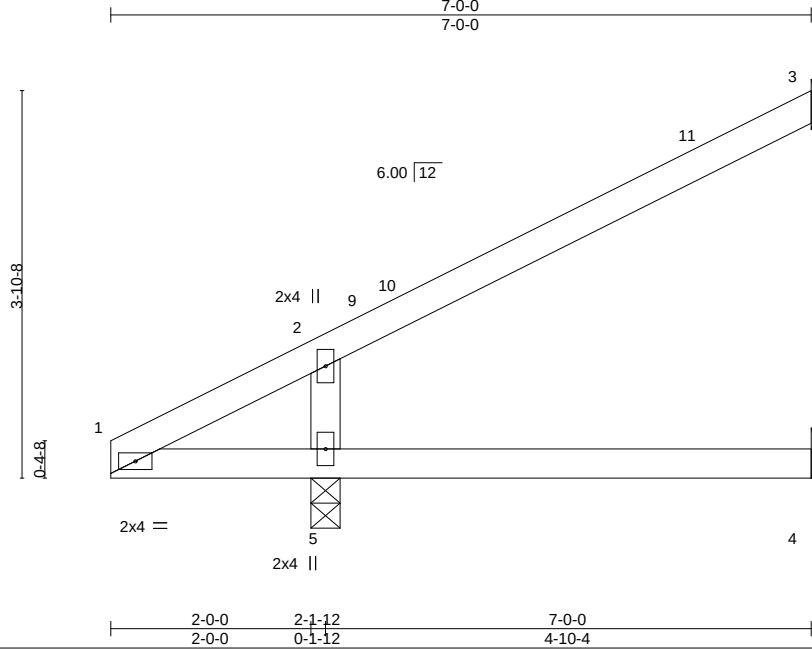

Scale = 1:23.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.40	Vert(LL) 0.03	4-5	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.21	Vert(CT) -0.04	4-5	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT) -0.06	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8
Max Horz 5=165(LC 12)
Max Uplift 3=-106(LC 12), 4=-9(LC 12), 5=-116(LC 12)
Max Grav 3=104(LC 1), 4=77(LC 3), 5=372(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-292/121
WEBS 2-5=-280/414

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 6-11-4 zone; cantilever left exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 106 lb uplift at joint 3, 9 lb uplift at joint 4 and 116 lb uplift at joint 5.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350271
3125356	EJ03	Jack-Partial	6	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc.
Tue Dec 6 18:35:19 2022
Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-VDKsOVYF00idg?CZ_hPWl6ar_vvarlCxK8dnlTyBbws
5-0-0
2-4-13

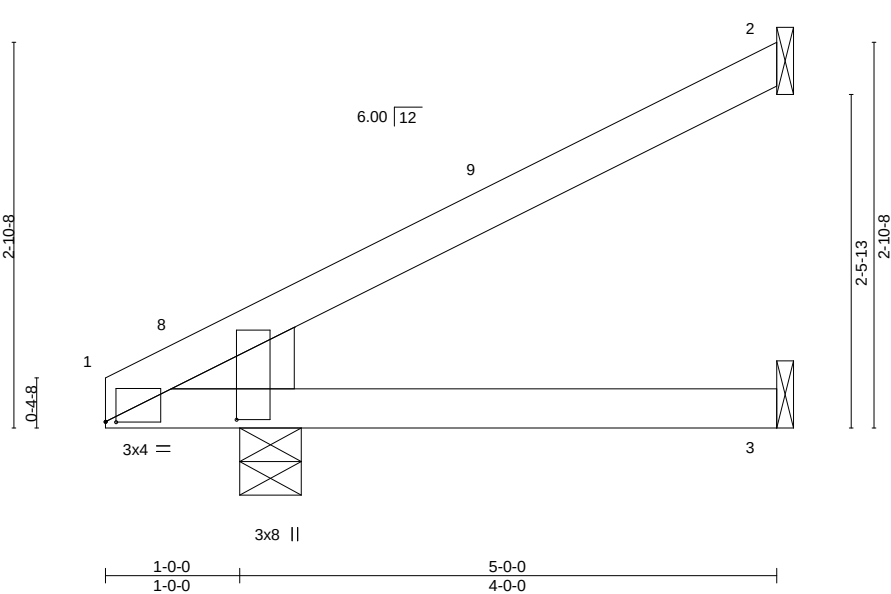


Plate Offsets (X,Y)-- [1:0-0-15,0-0-1], [1:0-0-3,0-11-11]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.30	Vert(LL)	-0.03	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.28	Vert(CT)	-0.03		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.02		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MP				Weight: 18 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEDGE			
Left: 2x6 SP No.2			

REACTIONS. (size) 2=Mechanical, 3=Mechanical, 1=0-5-8
Max Horz 1=123(LC 12)
Max Uplift 2=-95(LC 12), 3=-6(LC 12), 1=-73(LC 12)
Max Grav 2=87(LC 1), 3=64(LC 3), 1=243(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-11-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 2, 6 lb uplift at joint 3 and 73 lb uplift at joint 1.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


December 7,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350272
3125356	HJ06	Diagonal Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:20 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-zQuEbqYunKrUI9nlYOxIHJ61cviSaAp5ZoNKqvyBbwr

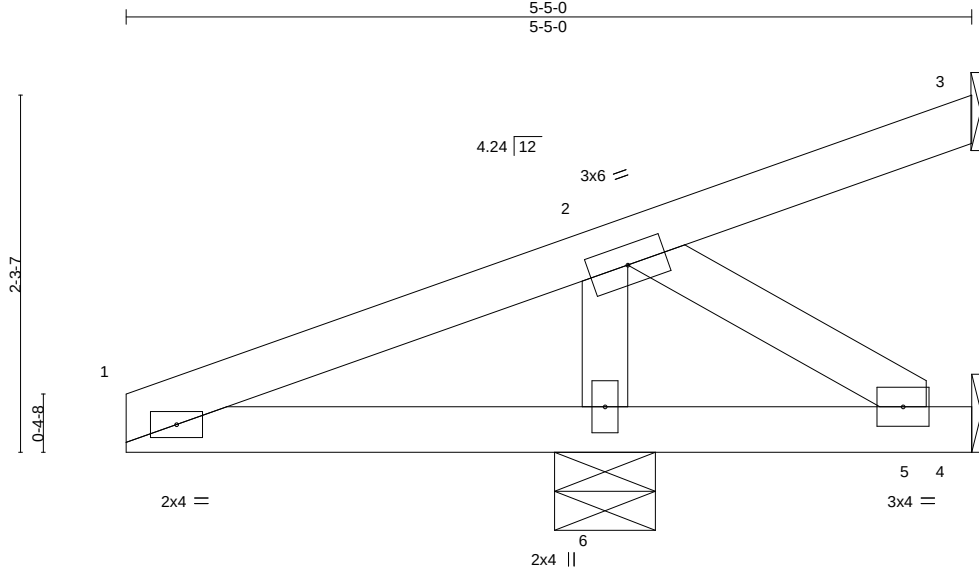

			2-8-15	3-0-13	5-4-3	5-5-0				
			2-8-15	0-3-14	2-3-6	0-0-13				
LOADING (psf)		SPACING-	2-0-0	CSI.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0		Plate Grip DOL	1.25	TC 0.24	Vert(LL) -0.01	5-6	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.11	Vert(CT) 0.00	5-6	>999	180		
BCLL 0.0 *		Rep Stress Incr	NO	WB 0.17	Horz(CT) -0.01	3	n/a	n/a		
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MP					Weight: 21 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 6=0-7-12
Max Horz 6=94(LC 4)
Max Uplift 3=-35(LC 8), 4=-190(LC 1), 6=-378(LC 4)
Max Grav 3=34(LC 1), 4=113(LC 4), 6=635(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-278/445
BOT CHORD 1-6=-388/282, 5-6=-388/188
WEBS 2-5=-216/445, 2-6=-546/337

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 35 lb uplift at joint 3, 190 lb uplift at joint 4 and 378 lb uplift at joint 6.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 66 lb down and 32 lb up at 0-0-0, and 15 lb down and 13 lb up at 2-11-0, and 15 lb down and 13 lb up at 2-11-0 on top chord, and 10 lb down and 13 lb up at 2-11-0, and 10 lb down and 13 lb up at 2-11-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-7=-20
Concentrated Loads (lb)
Vert: 1=-66 6=-16(F=-8, B=-8)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350273
3125356	HJ07	Diagonal Hip Girder	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:21 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMXEEzke8Z-RcScpAZWYdzLvlMx56S_qXf9qJbvJfhEoS6tMLyBbwq

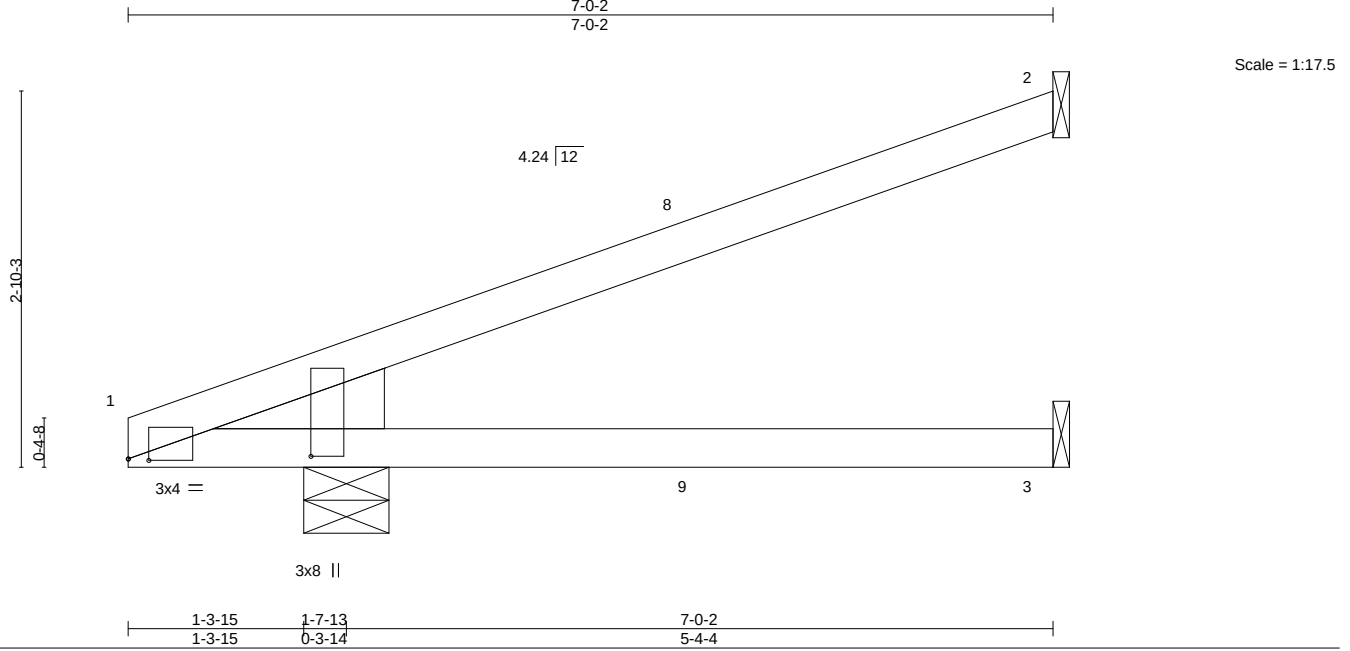


Plate Offsets (X,Y)--		[1:0-1-14,0-0-2], [1:0-0-4,1-4-10]											
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.40	Vert(LL)	-0.07	4	>999	240	MT20	244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.29	Vert(CT)	-0.06	3-7	>999	180			
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.03	2	n/a	n/a			
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 25 lb	FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=Mechanical, 3=Mechanical, 1=0-7-12
Max Horz 1=122(LC 4)
Max Uplift 2=-115(LC 4), 3=-4(LC 4), 1=-159(LC 4)
Max Grav 2=125(LC 1), 3=91(LC 3), 1=346(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 2, 4 lb uplift at joint 3 and 159 lb uplift at joint 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 13 lb down and 13 lb up at 1-6-1, 13 lb down and 13 lb up at 1-6-1, and 17 lb down and 38 lb up at 4-4-0, and 17 lb down and 38 lb up at 4-4-0 on top chord, and 6 lb down and 10 lb up at 1-6-1, 6 lb down and 10 lb up at 1-6-1, and 6 lb down and 6 lb up at 4-4-0, and 6 lb down and 6 lb up at 4-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-2=-54, 3-4=-20
Concentrated Loads (lb)
Vert: 6=-12(F=-6, B=-6) 9=9(F=5, B=5)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350274
3125356	HJ10	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:22 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-vo0?0Wa8Jx5CXSw7fpzDNkCHjix8254O06sRvovBbwp

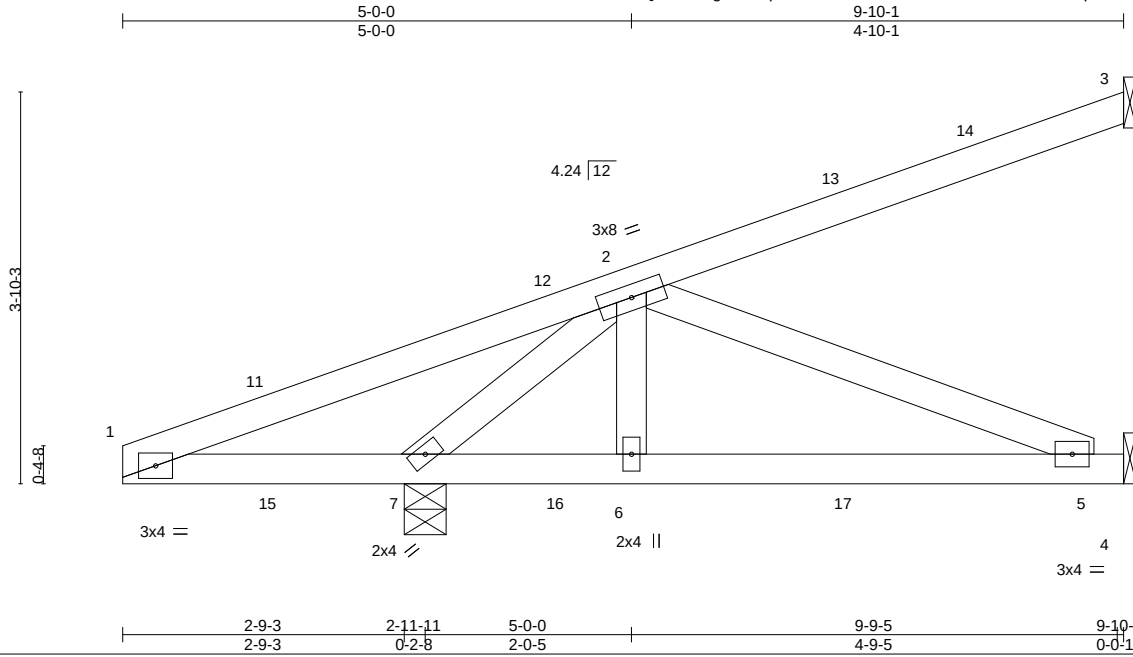

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.59	Vert(LL)	-0.02	5-6	>999	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.29	Vert(CT)	-0.04	5-6	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.12	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS					Weight: 43 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except:
10-0-0 oc bracing: 4-5.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 7=0-4-15
Max Horz 7=165(LC 22)
Max Uplift 3=-78(LC 8), 4=-75(LC 17), 7=-401(LC 4)
Max Grav 3=113(LC 19), 4=58(LC 35), 7=487(LC 35)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-280/525
BOT CHORD 1-7=-451/300, 6-7=-290/53, 5-6=-290/53
WEBS 2-7=-570/401, 2-5=-57/313

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left exposed ; porch right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 3, 75 lb uplift at joint 4 and 401 lb uplift at joint 7.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 70 lb down and 33 lb up at 0-0-0, 13 lb down and 13 lb up at 1-6-1, 13 lb down and 13 lb up at 1-6-1, 77 lb down and 157 lb up at 4-4-0, 77 lb down and 157 lb up at 4-4-0, and 21 lb down and 67 lb up at 7-1-15, and 21 lb down and 67 lb up at 7-1-15 on top chord, and 6 lb down and 15 lb up at 1-6-1, 6 lb down and 15 lb up at 1-6-1, 21 lb down and 133 lb up at 4-4-0, 21 lb down and 133 lb up at 4-4-0, and 4 lb down and 13 lb up at 7-1-15, and 4 lb down and 13 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-8=-20
Concentrated Loads (lb)
Vert: 1=-70 12=118(F=59, B=59) 15=-12(F=-6, B=-6) 16=149(F=74, B=74) 17=18(F=9, B=9)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350275
3125356	HJ12	Diagonal Hip Girder	6	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:24 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-rB7IRCcOrYLwmm4WnE?hS9HekWasWzGhUQLYzgyBbwn

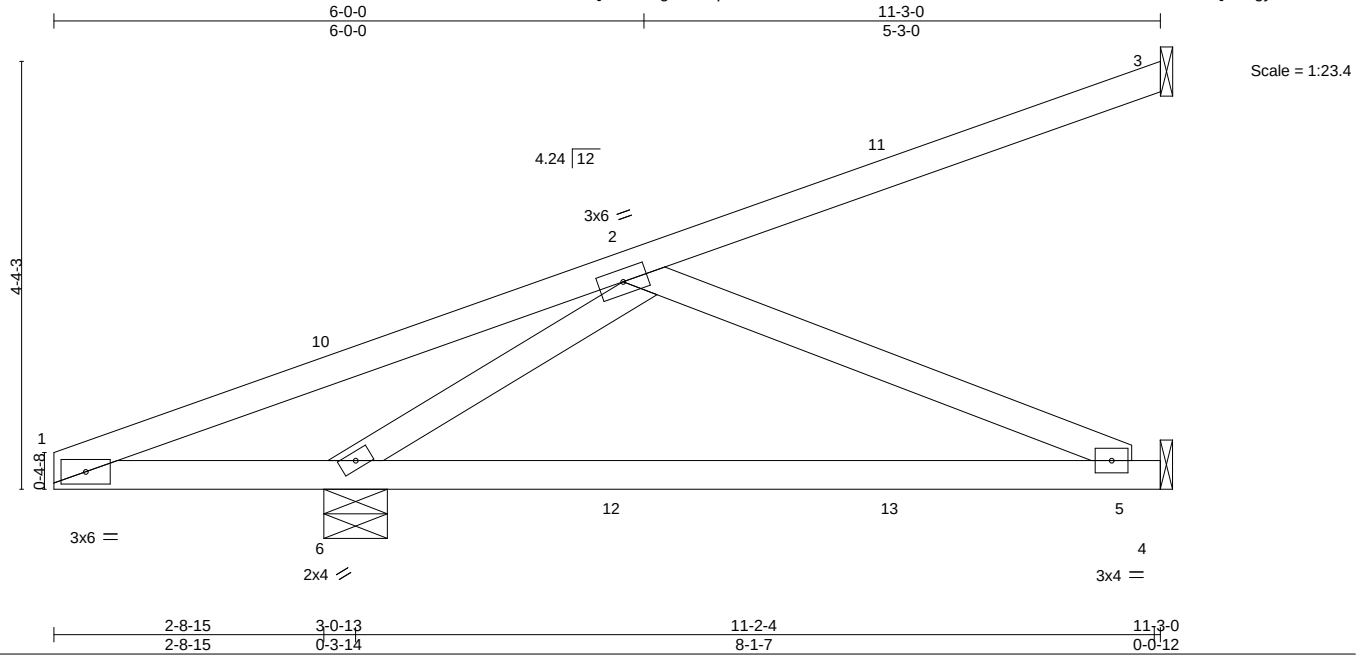

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.55	Vert(LL)	-0.16	5-6	>636	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.46	Vert(CT)	-0.18	5-6	>545		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.20	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 48 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 6=0-7-12
Max Horz 6=183(LC 4)
Max Uplift 3=-110(LC 10), 4=-153(LC 8), 6=-458(LC 4)
Max Grav 3=109(LC 1), 4=96(LC 35), 6=542(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-428/649
BOT CHORD 1-6=-559/444, 5-6=-373/87
WEBS 2-5=-94/406, 2-6=-678/529

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 3, 153 lb uplift at joint 4 and 458 lb uplift at joint 6.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 66 lb down and 32 lb up at 0-0-0, 15 lb down and 13 lb up at 2-11-0, 15 lb down and 13 lb up at 2-11-0, 53 lb down and 105 lb up at 5-8-15, 53 lb down and 105 lb up at 5-8-15, and 30 lb down and 96 lb up at 8-6-14, and 30 lb down and 96 lb up at 8-6-14 on top chord, and 10 lb down and 13 lb up at 2-11-0, 10 lb down and 13 lb up at 2-11-0, 7 lb down and 88 lb up at 5-8-15, 7 lb down and 88 lb up at 5-8-15, and 24 lb down and 14 lb up at 8-6-14, and 24 lb down and 14 lb up at 8-6-14 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-7=-20
Concentrated Loads (lb)
Vert: 1=-66 6=-16(F=-8, B=-8) 2=80(F=40, B=40) 12=97(F=48, B=48) 13=10(F=5, B=5)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350276
3125356	T01	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:26 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEZke8Z-0aFVsudeMAbe04Evuf19XaMxqKH3_I9zxkqe2ZyBbwI



Scale = 1:44.2

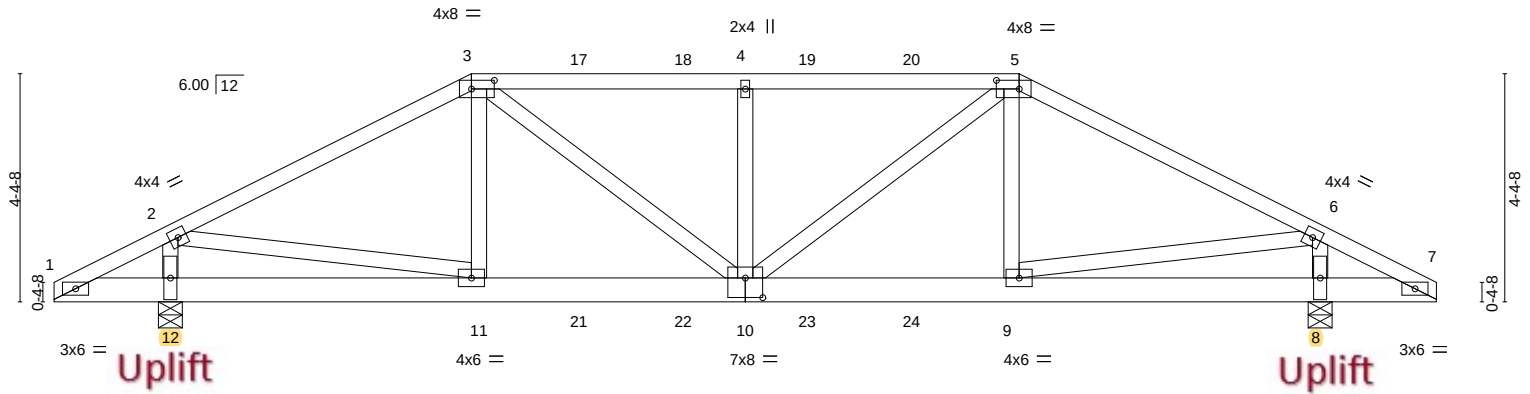

2-0-0	2-2-12	8-0-0	13-3-0	18-6-0	24-3-4	24-6-0	26-6-0
2-0-0	0-2-12	5-9-4	5-3-0	5-3-0	5-9-4	0-2-12	2-0-0
Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [5:0-5-4,0-2-0], [10:0-4-0,0-4-8]							

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.64	Vert(LL)	0.11	10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.35	Vert(CT)	-0.13	10	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.69	Horz(CT)	0.02	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 158 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 7-3-3 oc bracing.

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=86(LC 8)
Max Uplift 12=-915(LC 8), 8=-932(LC 9)
Max Grav 12=1437(LC 1), 8=1453(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1771/1228, 3-4=-2055/1483, 4-5=-2055/1483, 5-6=-1796/1255
BOT CHORD 10-11=-1039/1513, 9-10=-1023/1535
WEBS 2-12=-1293/941, 2-11=-961/1421, 3-10=-517/728, 4-10=-601/526, 5-10=-458/688,
6-9=-1014/1442, 6-8=-1307/954

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 915 lb uplift at joint 12 and 932 lb uplift at joint 8.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 93 lb down and 114 lb up at 8-0-0, 74 lb down and 114 lb up at 10-0-12, 74 lb down and 114 lb up at 12-0-12, 74 lb down and 104 lb up at 13-2-4, 74 lb down and 114 lb up at 14-5-4, and 74 lb down and 114 lb up at 16-5-4, and 154 lb down and 220 lb up at 18-6-0 on top chord, and 128 lb down and 179 lb up at 8-0-0, 55 lb down and 24 lb up at 10-0-12, 55 lb down and 24 lb up at 12-0-12, 55 lb down and 24 lb up at 13-2-4, 55 lb down and 24 lb up at 14-5-4, and 55 lb down and 24 lb up at 16-5-4, and 128 lb down and 179 lb up at 18-5-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 5-7=-54, 1-7=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350276
3125356	T01	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:26 2022 Page 2
ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-0aFVsudeMAbe04Evuf19XaMxqKH3_I9zxkqe2ZyBbwl

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-74(F) 5=-107(F) 11=-111(F) 10=-31(F) 4=-74(F) 9=-111(F) 17=-74(F) 18=-74(F) 19=-74(F) 20=-74(F) 21=-31(F) 22=-31(F) 23=-31(F) 24=-31(F)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350277
3125356	T02	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:28 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeEzke8Z-kyNGHafvunrMFNOH044dc?Rjt7wxSiHGP2Jl6RyBbwj



Scale = 1:44.5


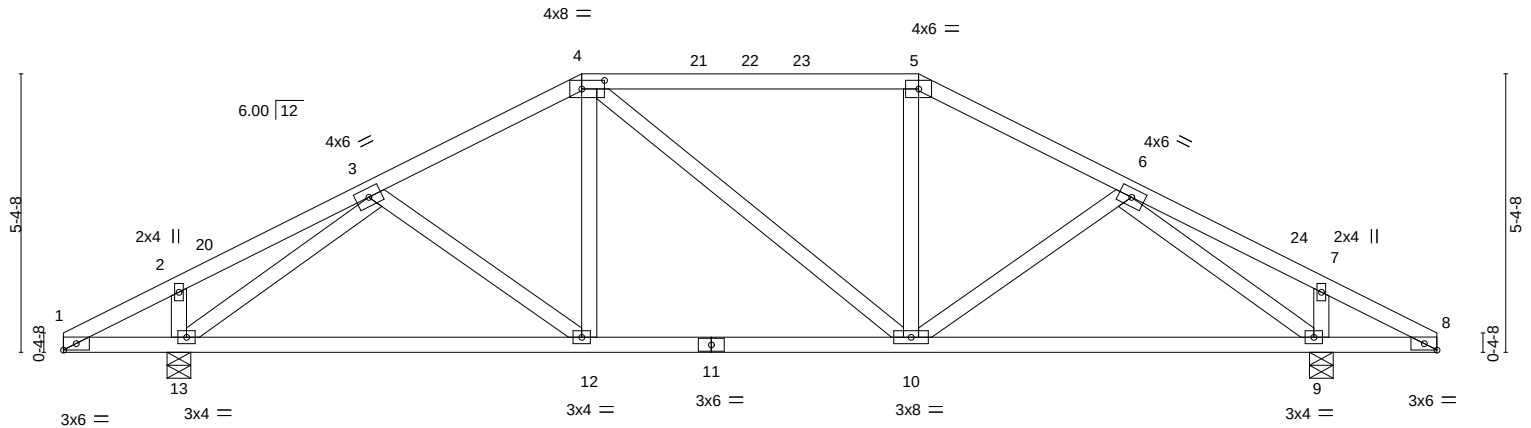


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [8:0-2-15,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.54	Vert(LL)	-0.08 12-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.52	Vert(CT)	-0.17 12-13	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.46	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 139 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 13=0-5-8, 9=0-5-8
Max Horz 13=-108(LC 13)
Max Uplift 13=-399(LC 12), 9=-399(LC 13)
Max Grav 13=981(LC 1), 9=981(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-945/393, 4-5=-808/394, 5-6=-945/393
BOT CHORD 12-13=-347/764, 10-12=-254/808, 9-10=-239/764
WEBS 3-13=-1000/510, 6-9=-1000/510

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-0-0, Exterior(2R) 10-0-0 to 14-2-15, Interior(1) 14-2-15 to 16-6-0, Exterior(2R) 16-6-0 to 20-6-12, Interior(1) 20-6-12 to 26-6-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 399 lb uplift at joint 13 and 399 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350278
3125356	T03	ATTIC	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:29 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-C9xeUvXf5zCtXzUznbs9D_W4XJMB7gQdi2lfuyBbwi

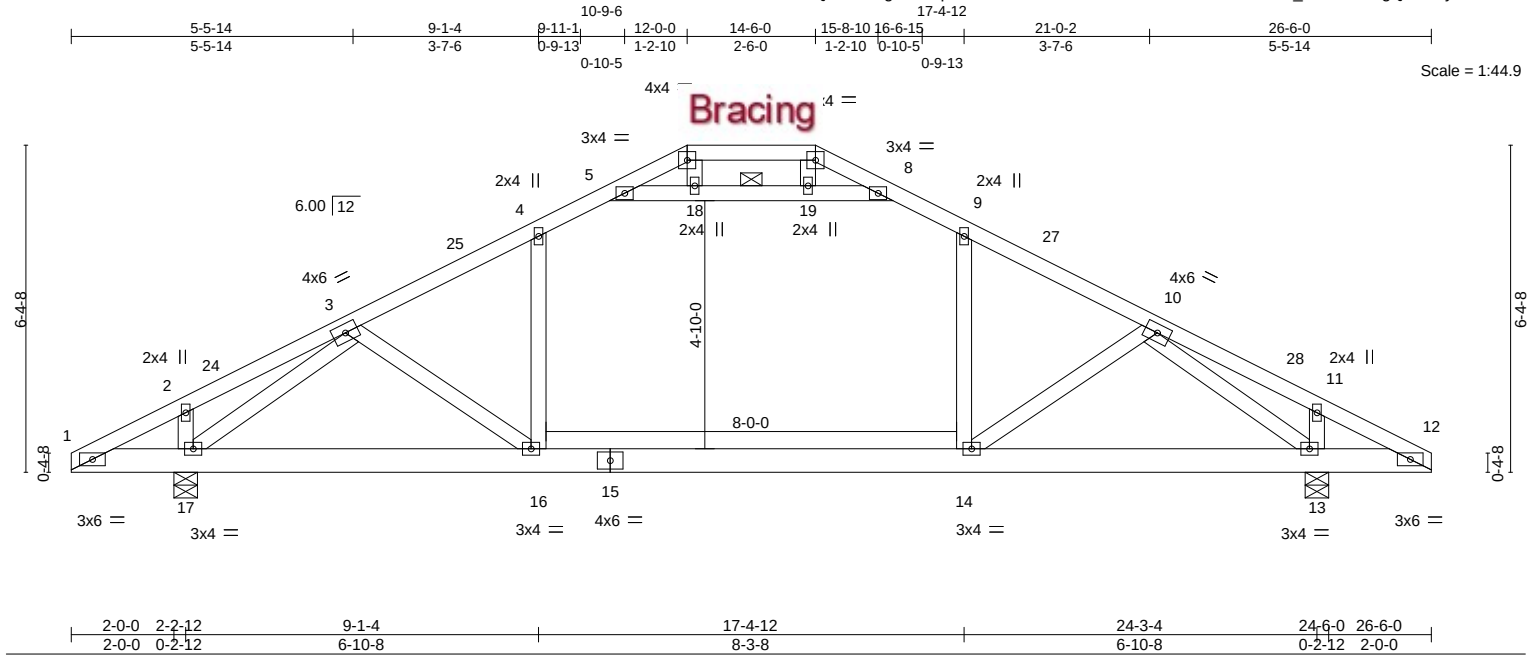

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.39	Vert(LL)	-0.17 14-16	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.38	Vert(CT)	-0.28 14-16	>946	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.58	Horz(CT)	0.02 13	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS	Attic	-0.11 14-16	933	360		
							Weight: 155 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP M 31 *Except*
6-7: 2x4 SP No.2
BOT CHORD 2x6 SP M 26
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 5-8

REACTIONS.

(size) 17=0-5-8, 13=0-5-8
Max Horz 17=-129(LC 13)
Max Uplift 17=-274(LC 12), 13=-274(LC 13)
Max Grav 17=1266(LC 2), 13=1266(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1589/172, 4-5=-1305/213, 5-6=-53/286, 6-7=0/343, 7-8=-53/286, 8-9=-1305/213,
9-10=-1589/172
BOT CHORD 16-17=-206/1212, 14-16=-48/1347, 13-14=-77/1212
WEBS 3-16=-4/259, 4-16=0/510, 5-18=-1580/131, 18-19=-1573/126, 8-19=-1580/130,
9-14=0/510, 10-14=-4/259, 3-17=-1650/314, 10-13=-1650/314

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2E) 12-0-0 to 14-6-0, Exterior(2R) 14-6-0 to 18-8-15, Interior(1) 18-8-15 to 26-6-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 8-9, 5-18, 18-19, 8-19; Wall dead load (5.0psf) on member(s).4-16, 9-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 14-16
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 274 lb uplift at joint 17 and 274 lb uplift at joint 13.
- ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350279
3125356	T04	ATTIC	6	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:31 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-8X3OvbhnBiDw6r7shCdKEe3jBL_gf17i50XPjmyBbwg

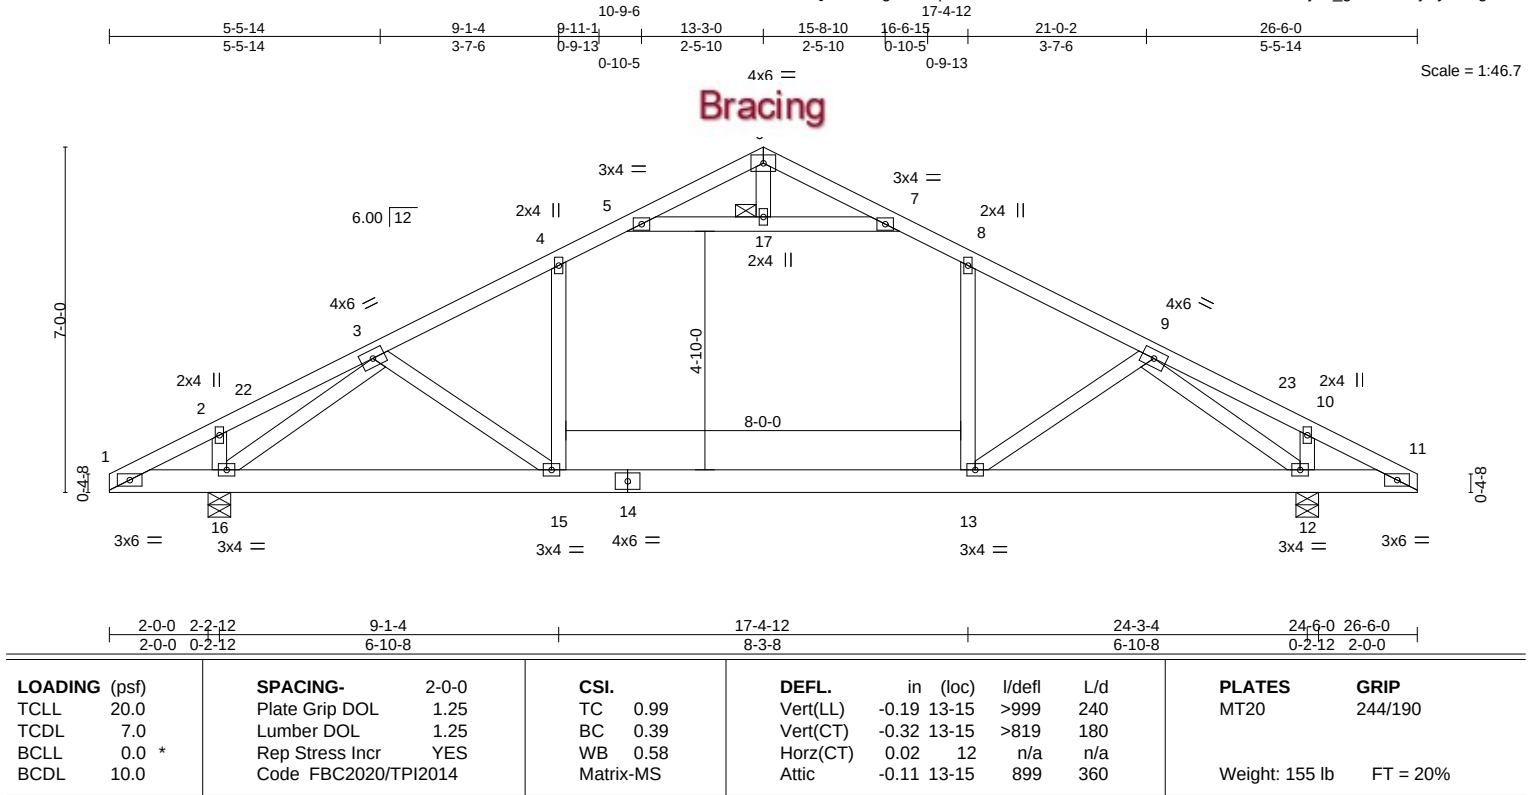

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP M 26
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 17

REACTIONS.

(size) 16=0-5-8, 12=0-5-8
Max Horz 16=-142(LC 17)
Max Uplift 16=-270(LC 12), 12=-270(LC 13)
Max Grav 16=1266(LC 2), 12=1266(LC 2)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-1583/182, 4-5=-1298/239, 7-8=-1298/239, 8-9=-1583/182
BOT CHORD 15-16=-211/1243, 13-15=-56/1339, 12-13=-82/1216
WEBS 8-13=0/514, 4-15=0/514, 5-17=-1465/159, 7-17=-1465/159, 3-16=-1661/338, 9-12=-1661/338

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-3-0, Exterior(2R) 13-3-0 to 16-0-9, Interior(1) 16-0-9 to 26-6-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 5-17, 7-17; Wall dead load (5.0psf) on member(s).8-13, 4-15
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 270 lb uplift at joint 16 and 270 lb uplift at joint 12.
- ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350280
3125356	T05	Common	9	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:32 2022 Page 1
ID:Q7RwmdgDYh8qcXUfiYMxEEzke8Z-ckcn6xiPy0Lnk?h2Fw8Znrc0xlFZOSasKgzHzFDyBbwf

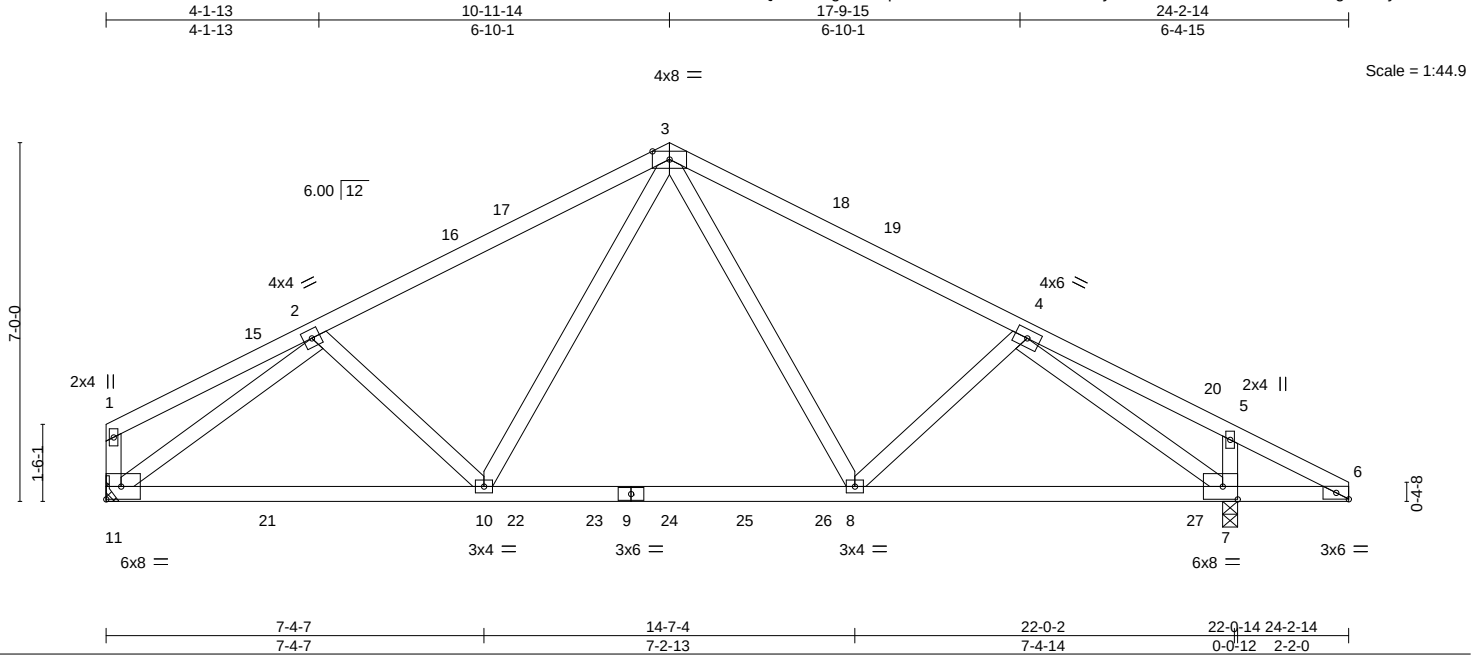

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	0.19 10-11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.67	Vert(CT)	0.17 10-11 >999 180				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.76	Horz(CT)	-0.05 7 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 129 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP M 31
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-0-5 oc bracing.

REACTIONS.

(size) 11=Mechanical, 7=0-3-8
Max Horz 11=-176(LC 13)
Max Uplift 11=-479(LC 9), 7=-520(LC 8)
Max Grav 11=1046(LC 2), 7=1247(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1342/2017, 3-4=-1329/2000
BOT CHORD 10-11=-1527/1119, 8-10=-1272/959, 7-8=-1509/1101
WEBS 3-10=-593/364, 3-8=-563/339, 2-11=-1360/1876, 4-7=-1465/1973

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-14 to 3-4-14, Interior(1) 3-4-14 to 11-3-0, Exterior(2R) 11-3-0 to 14-3-0, Interior(1) 14-3-0 to 24-6-0 zone; cantilever right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 479 lb uplift at joint 11 and 520 lb uplift at joint 7.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-16=-54, 3-16=-104, 3-19=-104, 6-19=-54, 11-12=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350281
3125356	T06	Roof Special	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:34 2022 Page 1

ID:Q7RwmdgDYh8qcxUffYMxEEzke8Z-Z6kXXdjgUdbVzlrRMLB1sGhNWY?VsOU9n_m3K5yBbwd



Scale = 1:46.7


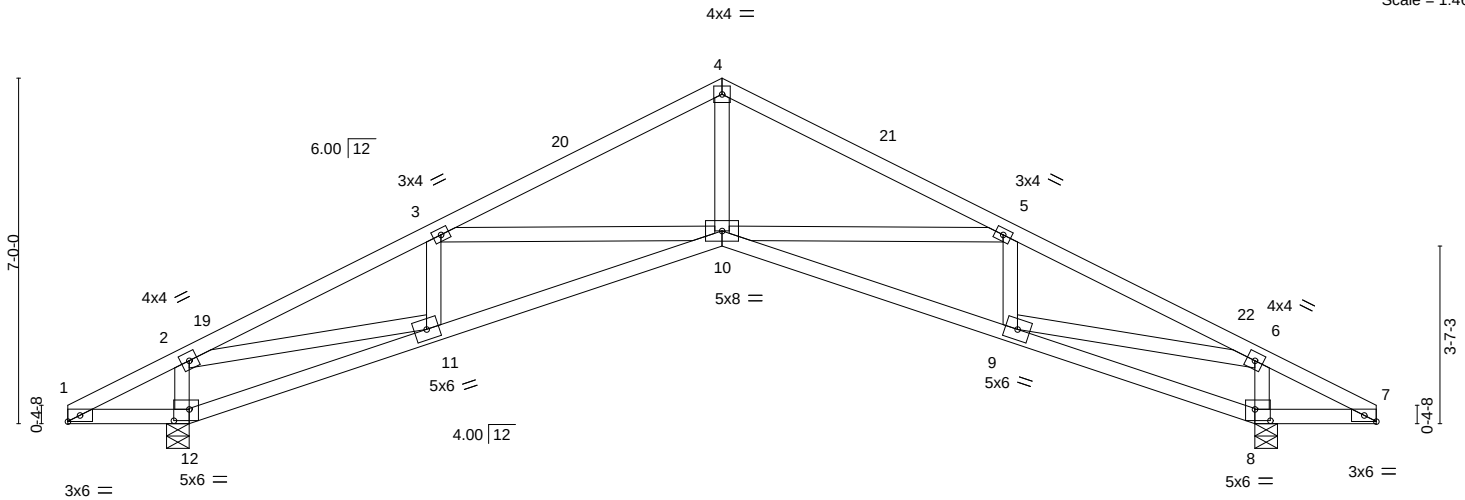


Plate Offsets (X,Y)-- [7:0-2-15,Edge], [8:0-3-12,0-2-12], [12:0-3-12,0-2-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.41	Vert(LL)	-0.10	10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.44	Vert(CT)	-0.21	9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.60	Horz(CT)	0.15	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 130 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=-142(LC 13)
Max Uplift 12=-391(LC 12), 8=-391(LC 13)
Max Grav 12=981(LC 1), 8=981(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1656/667, 3-4=-1598/521, 4-5=-1598/550, 5-6=-1656/543
BOT CHORD 11-12=-206/284, 10-11=-648/1512, 9-10=-384/1512, 8-9=-176/272
WEBS 4-10=-303/1062, 5-10=-191/329, 5-9=-274/184, 6-9=-579/1585, 6-8=-850/442,
3-10=-191/273, 3-11=-274/185, 2-11=-581/1585, 2-12=-850/438

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-3-0, Exterior(2R) 13-3-0 to 16-3-0, Interior(1) 16-3-0 to 26-6-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 391 lb uplift at joint 12 and 391 lb uplift at joint 8.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350282
3125356	T07	Roof Special	7	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:35 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEZke8Z-1lIvzklFjMbSQdw2iGOUEYxyK9brPI0eVdsYyBbwc

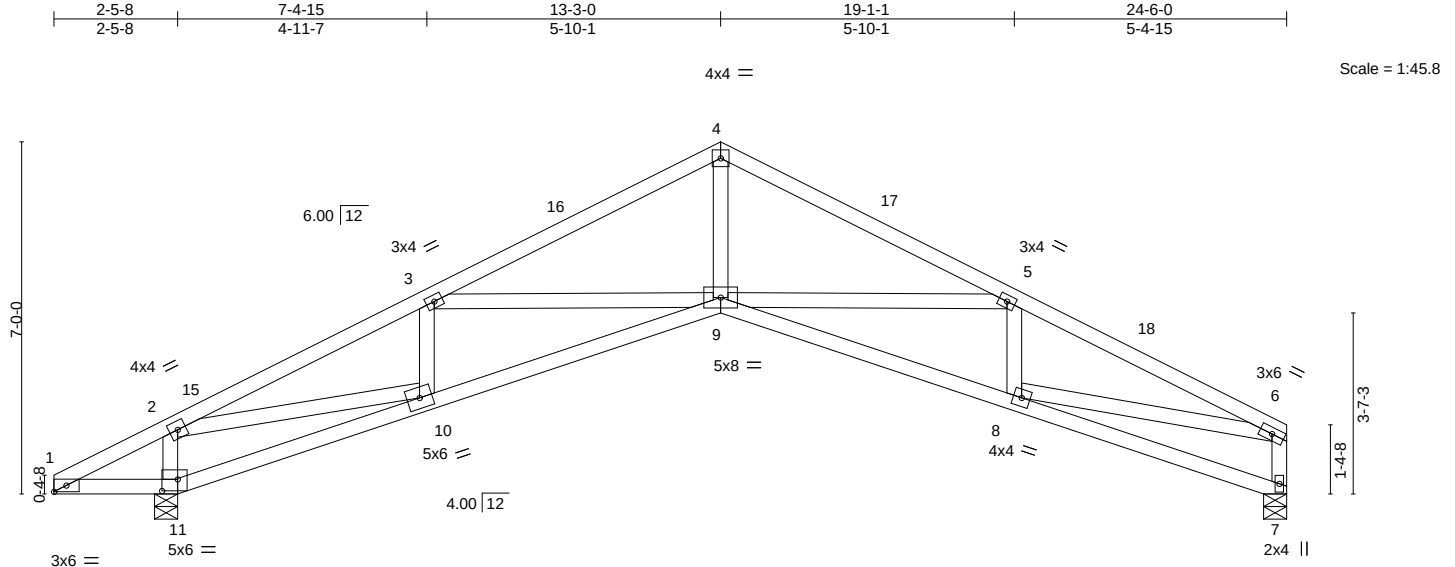


Plate Offsets (X,Y)--		[11:0-3-12,0-2-12]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.43	Vert(LL)	-0.11	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.48	Vert(CT)	-0.23				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.62	Horz(CT)	0.17				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 124 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 11=0-5-8, 7=0-5-8
Max Horz 11=173(LC 12)
Max Uplift 11=-395(LC 12), 7=-307(LC 13)
Max Grav 11=1002(LC 1), 7=800(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1713/704, 3-4=-1682/634, 4-5=-1683/649, 5-6=-1850/739, 6-7=-774/356
BOT CHORD 9-10=-715/1566, 8-9=-630/1700
WEBS 2-11=-871/483, 2-10=-692/1638, 3-10=-287/212, 3-9=-178/256, 4-9=-355/1140, 5-9=-287/347, 6-8=-556/1526

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-3-0, Exterior(2R) 13-3-0 to 16-3-0, Interior(1) 16-3-0 to 24-4-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 395 lb uplift at joint 11 and 307 lb uplift at joint 7.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350283
3125356	T08	Common	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:37 2022 Page 1

ID:Q7RwmdgDYh8qcxUffYMxEEZke8Z-zhQgAemYnY_4qma01TkkUvJtKm?e3l3bTy_kxQyBbwa



4x6 =

Scale = 1:46.3

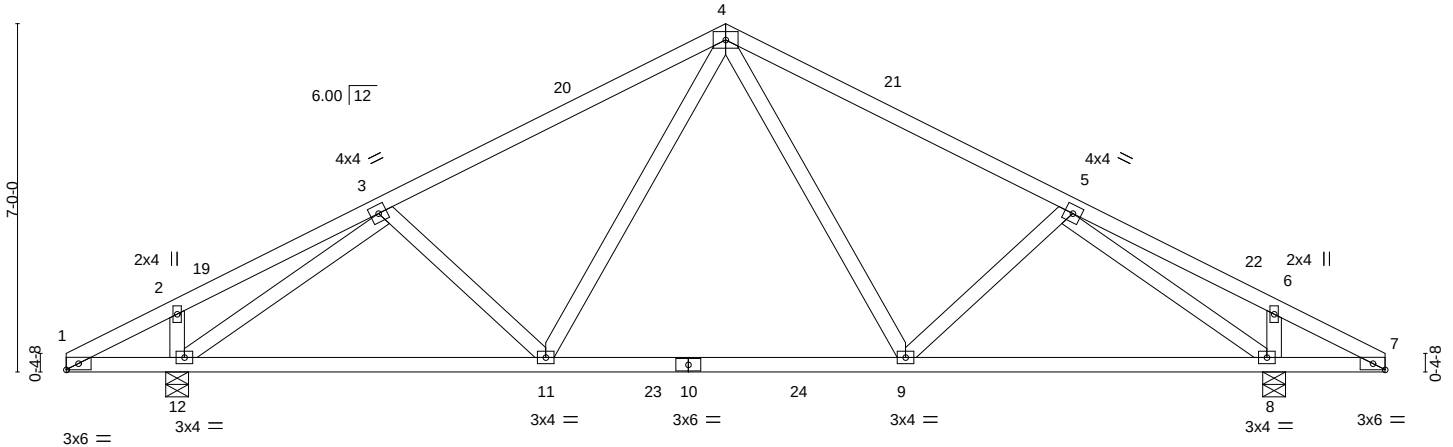


Plate Offsets (X,Y)-- [7:0-2-15,Edge]		2-0-0 2-2-12 2-0-0 0-2-12		9-7-10 7-4-14		16-10-6 7-2-12		24-3-4 7-4-14		24-6-0 26-6-0 0-2-12 2-0-0	
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.50	Vert(LL)	-0.10 9-11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.54	Vert(CT)	-0.16 9-11 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.03 8 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 136 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=-142(LC 13)
Max Uplift 12=-390(LC 12), 8=-390(LC 13)
Max Grav 12=1069(LC 2), 8=1069(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1053/410, 4-5=-1053/410
BOT CHORD 11-12=-410/921, 9-11=-173/726, 8-9=-268/888
WEBS 4-9=-136/361, 4-11=-136/361, 3-12=-1157/588, 5-8=-1157/588

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-3-0, Exterior(2R) 13-3-0 to 16-3-0, Interior(1) 16-3-0 to 26-6-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 390 lb uplift at joint 12 and 390 lb uplift at joint 8.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350284
3125356	T09	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:39 2022 Page 1

ID:Q7RwmdgDYh8qcxUffYMxEeZke8Z-v4XQaKnoI9Eo34kP9umCZKPDJZkNXgRuxGTq?JyBbwY



Scale = 1:39.9


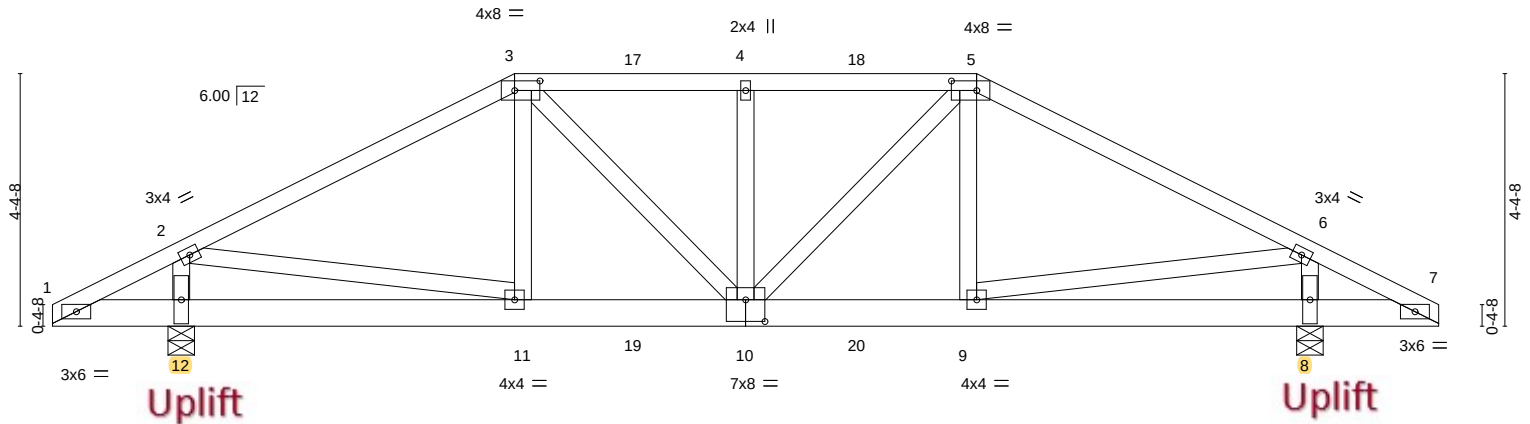


Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [5:0-5-4,0-2-0], [10:0-4-0,0-4-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.47	Vert(LL)	0.07	10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	-0.08	10	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.56	Horz(CT)	0.01	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 145 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-5-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 8-0-6 oc bracing.

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=-86(LC 28)
Max Uplift 12=-785(LC 8), 8=-797(LC 9)
Max Grav 12=1240(LC 1), 8=1254(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1444/1012, 3-4=-1498/1121, 4-5=-1498/1121, 5-6=-1466/1030
BOT CHORD 10-11=-846/1221, 9-10=-830/1240
WEBS 2-12=-1107/821, 2-11=-773/1133, 3-10=-326/441, 4-10=-404/352, 5-10=-269/403,
6-9=-820/1151, 6-8=-1119/829

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 785 lb uplift at joint 12 and 797 lb uplift at joint 8.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 93 lb down and 114 lb up at 8-0-0, 74 lb down and 114 lb up at 10-0-12, 74 lb down and 103 lb up at 12-0-0, and 74 lb down and 114 lb up at 13-11-4, and 154 lb down and 220 lb up at 16-0-0 on top chord, and 128 lb down and 179 lb up at 8-0-0, 55 lb down and 24 lb up at 10-0-12, 55 lb down and 24 lb up at 12-0-0, and 55 lb down and 24 lb up at 13-11-4, and 128 lb down and 179 lb up at 15-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 5-7=-54, 1-7=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350284
3125356	T09	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.530 s Aug 11 2022 MiTek Industries, Inc.
Tue Dec 6 18:35:39 2022
Page 2
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-v4XQaKnol9Eo34kP9umCZKPDJZkNXgRuxGTq?JyBbwY

LOAD CASE(S)
Standard
Concentrated Loads (lb)


Vert: 3=-74(F) 5=-107(F) 11=-111(F) 10=-31(F) 4=-74(F) 9=-111(F) 17=-74(F) 18=-74(F) 19=-31(F) 20=-31(F)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350285
3125356	T10	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:40 2022 Page 1

ID:Q7RwmdgDYh8qcXUfiYMxEEzke8Z-NG5oogoQ3TMfhDJbHSS5XxSzz0kGBa19wDOXlyBbwX



Scale = 1:40.7

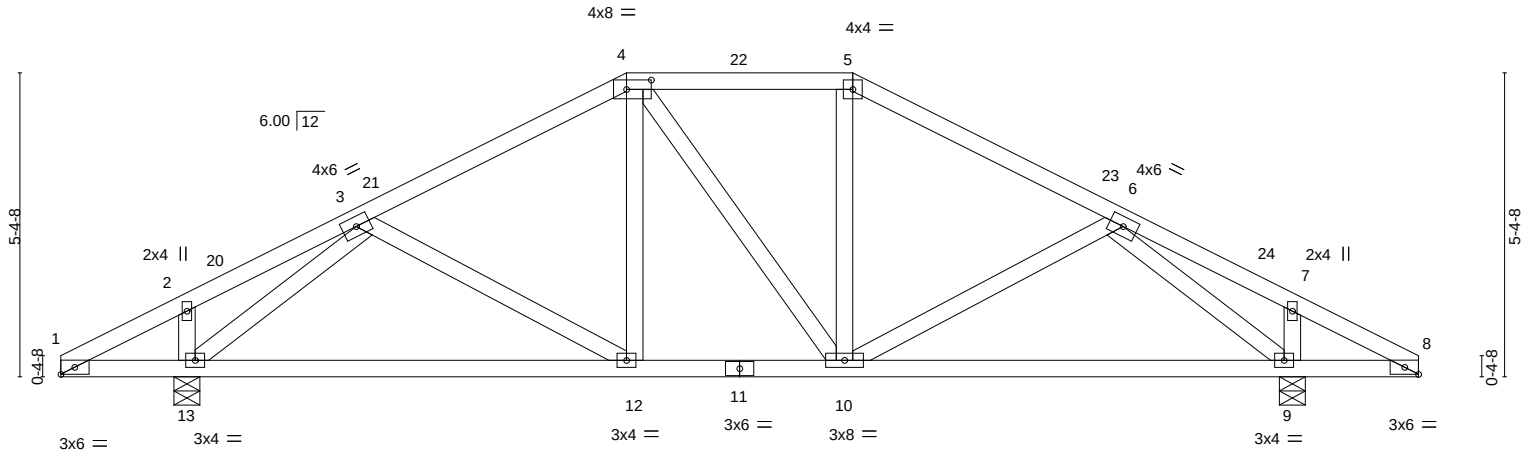

2-0-0	2-2-12	10-0-0	14-0-0	21-9-4	22-0-0	24-0-0
2-0-0	0-2-12	7-9-4	4-0-0	7-9-4	0-2-12	2-0-0

Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [8:0-2-15,Edge]

LOADING (psf)	SPACING-		CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.22	Vert(LL)	-0.09 12-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.52	Vert(CT)	-0.18 12-13	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.02 9	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS					Weight: 128 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 13=0-5-8, 9=0-5-8
Max Horz 13=-108(LC 13)
Max Uplift 13=-360(LC 12), 9=-360(LC 13)
Max Grav 13=888(LC 1), 9=888(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-252/64, 3-4=-789/322, 4-5=-654/333, 5-6=-790/322, 7-8=-252/64
BOT CHORD 12-13=-309/631, 10-12=-191/654, 9-10=-201/631
WEBS 3-13=-888/502, 6-9=-888/502

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-0-0, Exterior(2E) 10-0-0 to 14-0-0, Exterior(2R) 14-0-0 to 18-2-15, Interior(1) 18-2-15 to 24-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 360 lb uplift at joint 13 and 360 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350286
3125356	T11	Common	19	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:41 2022 Page 1

ID:Q7RwmdgDYh8qcXUfiYMxEeZke8Z-sSfA?0p3qnUVJNtnGJphelUZ4NM_?baBOZyx4ByBbwW

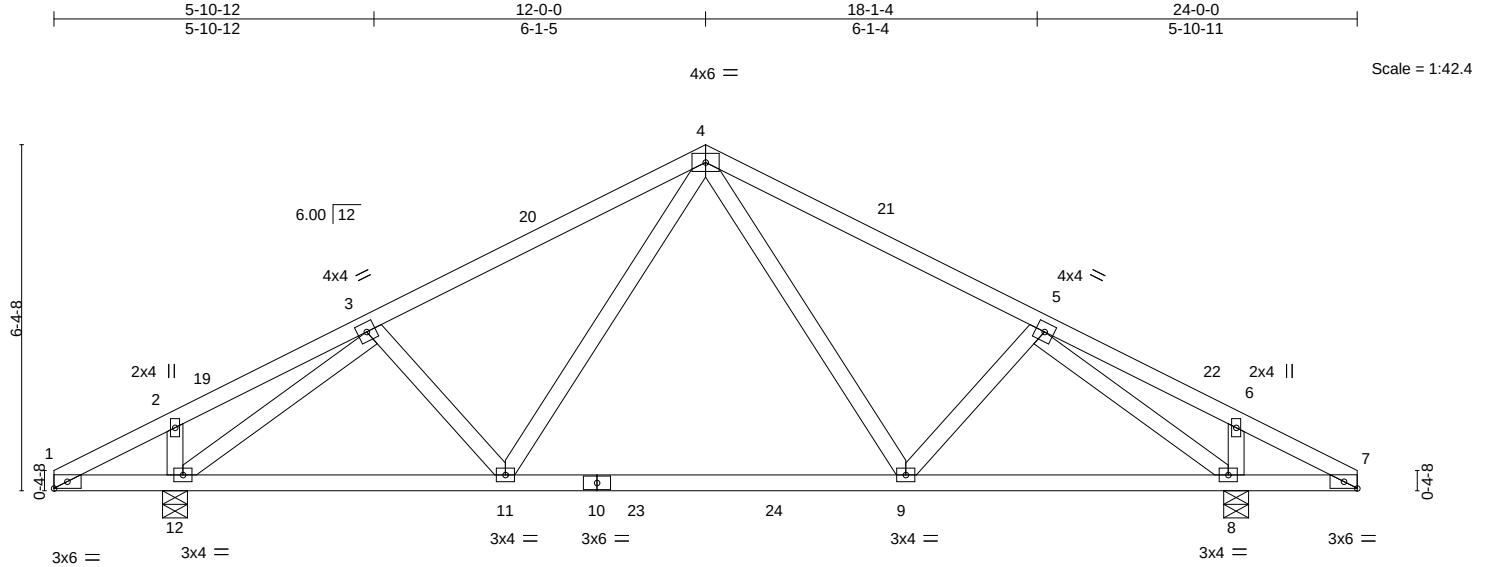

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	-0.11 9-11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.52	Vert(CT)	-0.18 9-11 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.02 8 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 123 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=-129(LC 13)
Max Uplift 12=-354(LC 12), 8=-354(LC 13)
Max Grav 12=967(LC 2), 8=967(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-915/372, 4-5=-915/372
BOT CHORD 11-12=-342/780, 9-11=-147/619, 8-9=-214/745
WEBS 4-9=-125/320, 4-11=-125/320, 3-12=-1058/537, 5-8=-1058/537

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 24-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 354 lb uplift at joint 12 and 354 lb uplift at joint 8.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350287
3125356	T12	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:43 2022 Page 1
ID: Q7RwmdgDYh8qcxUfiYMxEeZke8Z-ormxQiqJMOKDYh1AOKr9jAZvYA2HTUyTstR284yBbwU

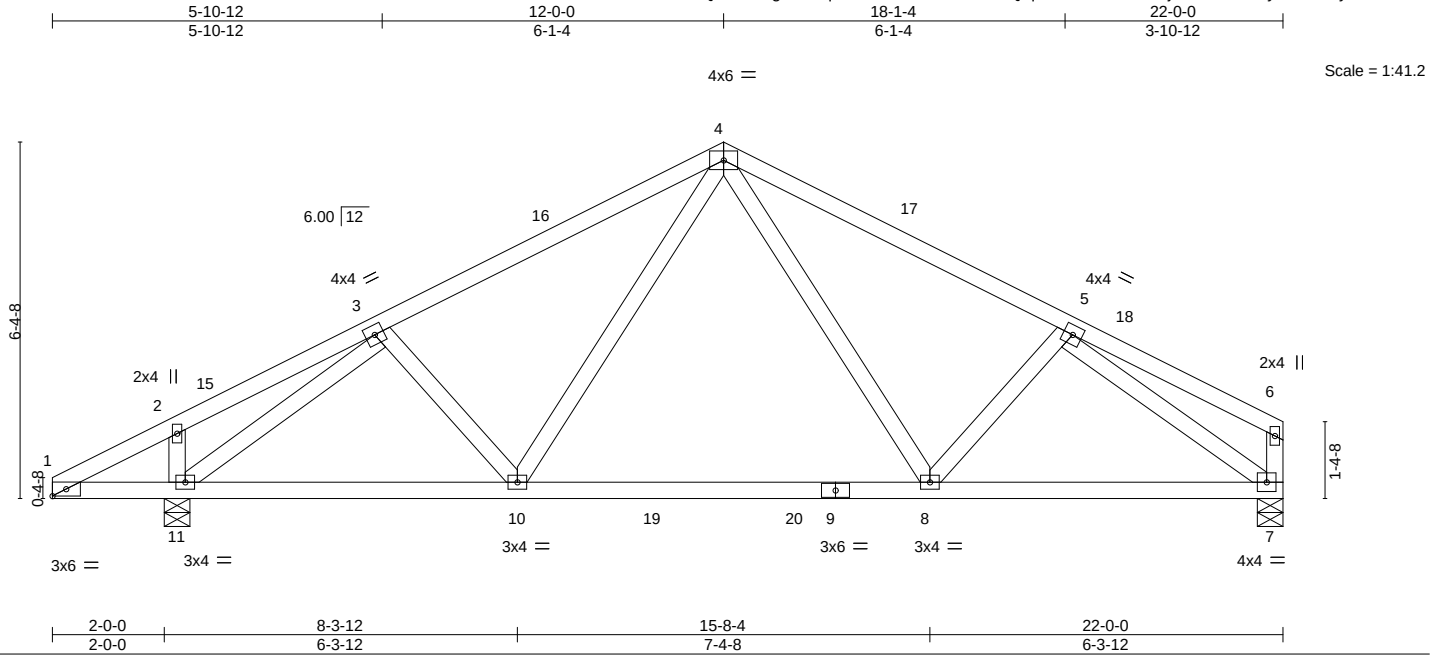

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.39	Vert(LL)	-0.11	8-10	>999	MT20	244/190
TCDL 7.0	6-3-12	BC 0.53	Vert(CT)	-0.17	8-10	>999		
BCLL 0.0 *	8-3-12	WB 0.46	Horz(CT)	0.02	7	n/a		
BCDL 10.0	6-3-12	Matrix-MS					Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 11=0-5-8, 7=0-5-8
Max Horz 11=159(LC 12)
Max Uplift 11=-356(LC 12), 7=-274(LC 13)
Max Grav 11=980(LC 2), 7=784(LC 2)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-935/412, 4-5=-966/448
BOT CHORD 10-11=-375/781, 8-10=-180/633, 7-8=-337/814
WEBS 4-10=-125/315, 4-8=-138/364, 3-11=-1077/578, 5-7=-974/427

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 21-10-4 zone; cantilever left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 356 lb uplift at joint 11 and 274 lb uplift at joint 7.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350288
3125356	T13	COMMON	10	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:44 2022 Page 1
ID:Q7RwmDgDYh8qcxUfiYMxEeZke8Z-G1LJe2rx7is4ArcMyRMOGN64JaOaCxEd4XBgWyBbwT

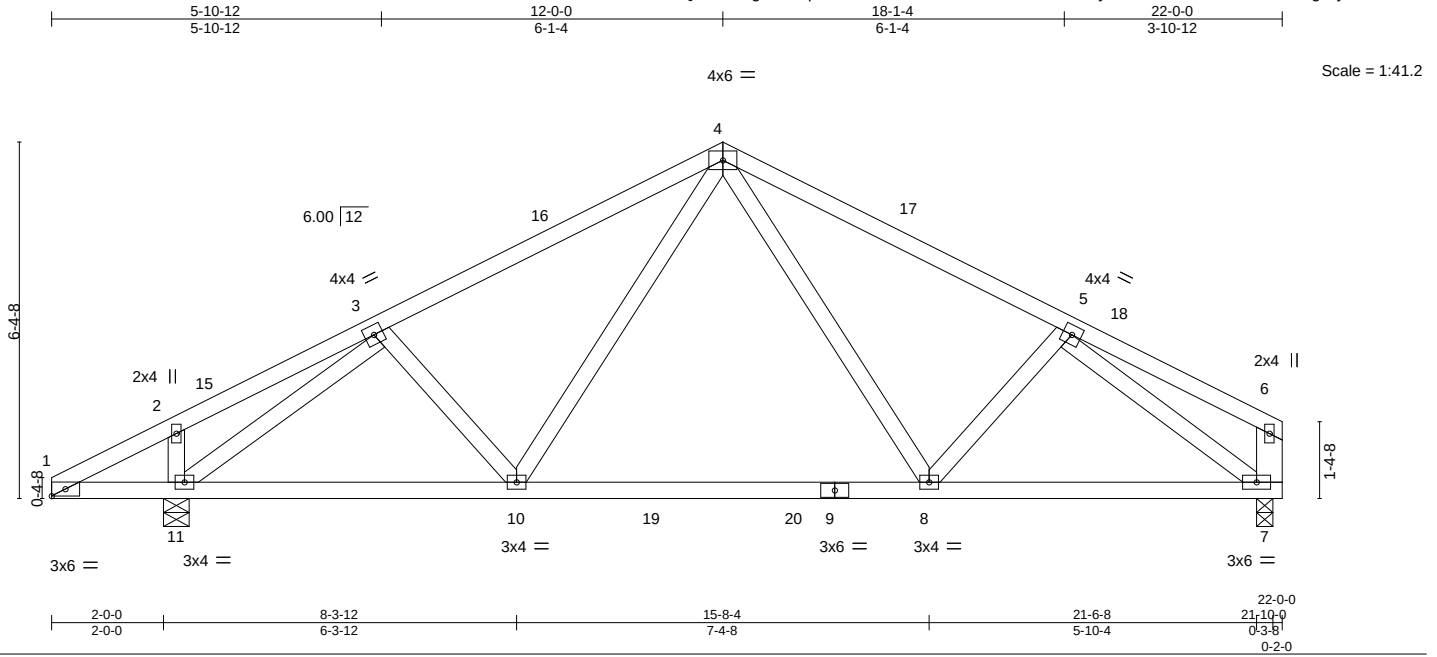

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.38	Vert(LL)	-0.11	8-10	>999	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.52	Vert(CT)	-0.17	8-10	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.46	Horz(CT)	0.02	7	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
6-7: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 11=0-5-8, 7=0-3-8
Max Horz 11=160(LC 12)
Max Uplift 11=-355(LC 12), 7=-273(LC 13)
Max Grav 11=977(LC 2), 7=781(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-930/410, 4-5=-953/443
BOT CHORD 10-11=-375/777, 8-10=-180/627, 7-8=-331/797
WEBS 4-10=-125/316, 4-8=-134/354, 3-11=-1072/576, 5-7=-960/425

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 21-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 355 lb uplift at joint 11 and 273 lb uplift at joint 7.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350289
3125356	T14	Attic	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,



8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:46 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMXeEzke8Z-CQT32jtBfJ6oP8ml3sOsLoBOBO50ggPwYrgilPyBbwR



4x6 =

Scale = 1:41.0

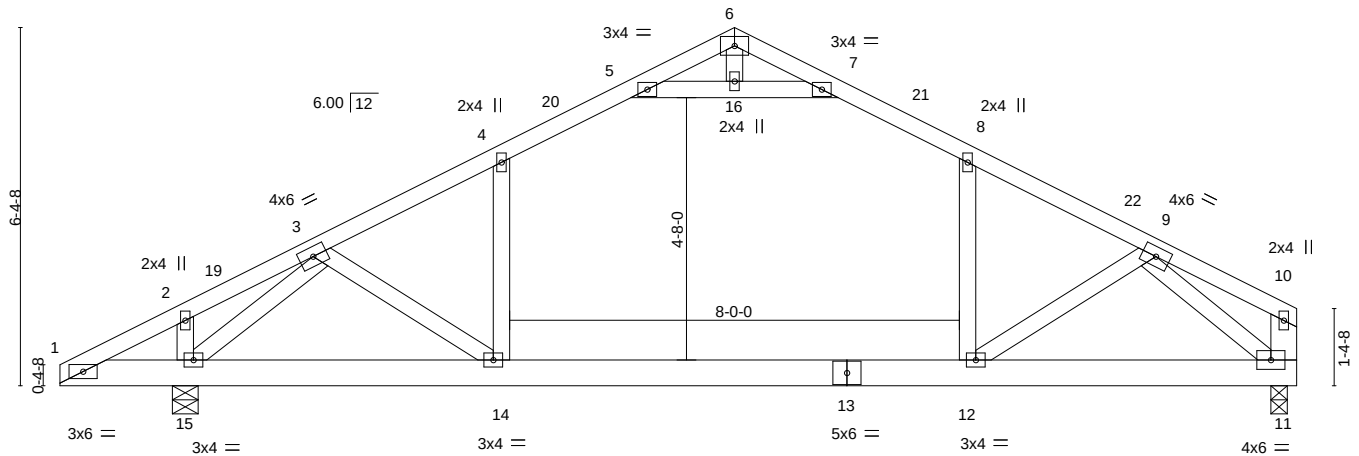

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.55	Vert(LL)	-0.22 12-14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.40	Vert(CT)	-0.37 12-14	>626	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.54	Horz(CT)	0.02 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS	Attic	-0.12 12-14	860	360	Weight: 128 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP M 31
BOT CHORD 2x6 SP M 26
WEBS 2x4 SP No.3 *Except*
10-11: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-8-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 1-15.

REACTIONS.

(size) 15=0-5-8, 11=0-3-8
Max Horz 15=160(LC 12)
Max Uplift 15=-242(LC 12), 11=-159(LC 13)
Max Grav 15=1188(LC 2), 11=1029(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1419/193, 4-5=-1146/262, 5-6=0/479, 6-7=0/480, 7-8=-1144/264, 8-9=-1422/205
BOT CHORD 14-15=-199/1046, 12-14=-76/1168, 11-12=-169/1070
WEBS 4-14=0/527, 5-16=-1658/241, 7-16=-1658/241, 8-12=0/533, 3-15=-1556/361, 9-11=-1451/198

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 21-9-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 5-16, 7-16; Wall dead load (5.0psf) on member(s).4-14, 8-12
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 242 lb uplift at joint 15 and 159 lb uplift at joint 11.
- ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350290
3125356	T15	ATTIC	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:47 2022 Page 1

ID:Q7RwmdgDYh8qcXUfiYMxEEzke8Z-gc0RG3tpQdEf1ILxdZw5u0kZ3oRGPHn3mVPFHryBbwQ



4x6 =

Scale = 1:42.1

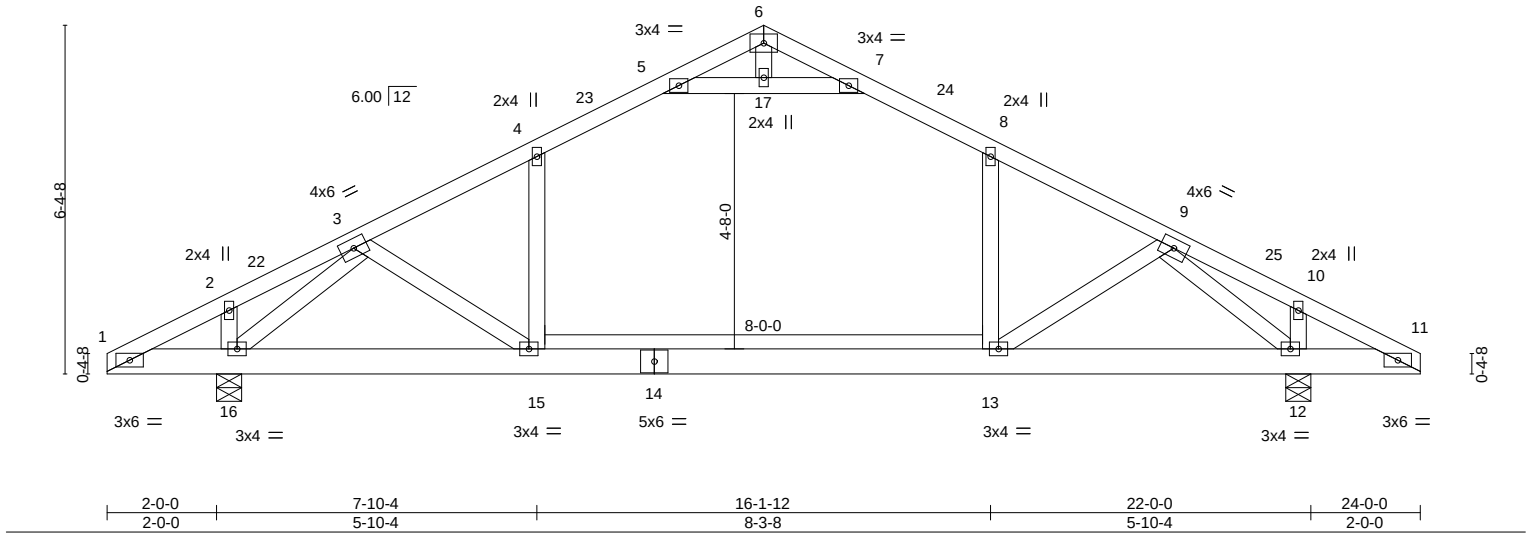

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	Vert(LL)	-0.22 13-15	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.40	Vert(CT)	-0.37 13-15	>630	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.53	Horz(CT)	0.02 12	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS	Attic	-0.11 13-15	865	360	Weight: 135 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP M 31
BOT CHORD 2x6 SP M 26
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-8-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 16=0-5-8, 12=0-5-8
Max Horz 16=-129(LC 13)
Max Uplift 16=-241(LC 12), 12=-241(LC 13)
Max Grav 16=1180(LC 2), 12=1180(LC 2)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-1399/150, 4-5=-1129/223, 5-6=0/474, 6-7=0/474, 7-8=-1129/223, 8-9=-1399/150
BOT CHORD 15-16=-167/1051, 13-15=-38/1151, 12-13=-49/1014
WEBS 5-17=-1629/166, 7-17=-1629/166, 8-13=0/524, 4-15=0/524, 3-16=-1533/308, 9-12=-1533/308

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 24-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 5-17, 7-17; Wall dead load (5.0psf) on member(s).8-13, 4-15
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 241 lb uplift at joint 16 and 241 lb uplift at joint 12.
- ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350291
3125356	T17	Hip Girder	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:49 2022 Page 1

ID:Q7RwmDgDYh8qcxUfiYMxEeZke8Z-d?8Chlv4yEUNGcVKk_yZzRpv2b7Uit8dMEpuMMkyBbwO



Scale = 1:46.7

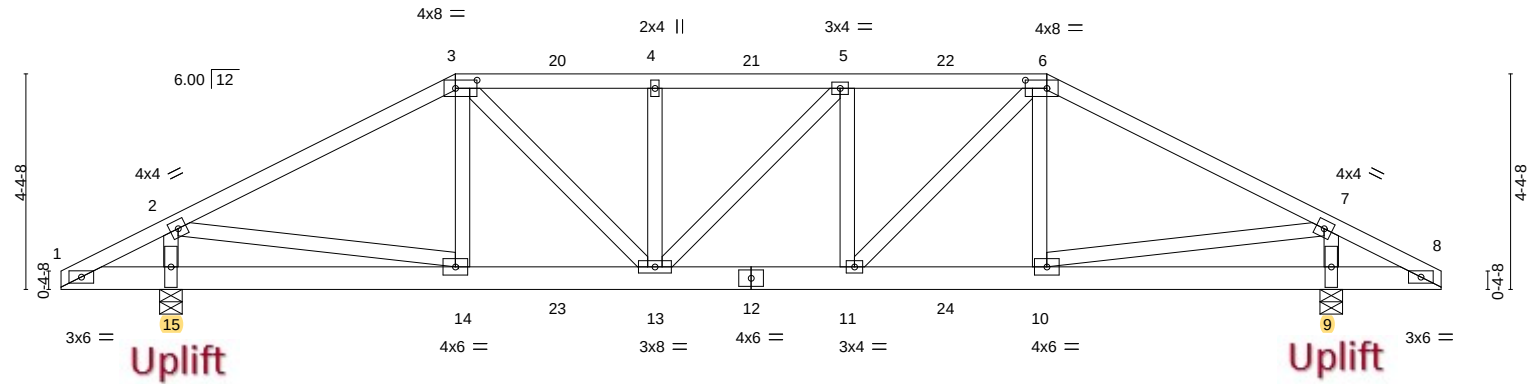

2-0-0	2-2-12	8-0-0	12-0-9	15-11-7	20-0-0	25-9-4	26-0-0	28-0-0
2-0-0	0-2-12	5-9-4	4-0-9	3-10-13	4-0-9	5-9-4	0-2-12	2-0-0
Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [6:0-5-4,0-2-0]								

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.51	Vert(LL) 0.12	11-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.41	Vert(CT) -0.14	11-13	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.70	Horz(CT) 0.02	9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 174 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-8-11 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-3-6 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 15=0-5-8, 9=0-5-8
Max Horz 15=-86(LC 9)
Max Uplift 15=-936(LC 8), 9=-954(LC 9)
Max Grav 15=1492(LC 1), 9=1509(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1851/1257, 3-4=-2108/1485, 4-5=-2108/1485, 5-6=-2123/1485, 6-7=-1877/1285
BOT CHORD 13-14=-1063/1582, 11-13=-1404/2123, 10-11=-1054/1604
WEBS 2-15=-1339/961, 2-14=-981/1476, 3-13=-530/784, 4-13=-384/328, 5-11=-383/321,
6-11=-492/764, 7-10=-1036/1495, 7-9=-1352/974

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 936 lb uplift at joint 15 and 954 lb uplift at joint 9.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 93 lb down and 114 lb up at 8-0-0, 74 lb down and 114 lb up at 10-0-12, 74 lb down and 114 lb up at 12-0-12, 74 lb down and 103 lb up at 14-0-0, 74 lb down and 114 lb up at 15-11-4, and 74 lb down and 114 lb up at 17-11-4, and 154 lb down and 220 lb up at 20-0-0 on top chord, and 128 lb down and 179 lb up at 8-0-0, 55 lb down and 24 lb up at 10-0-12, 55 lb down and 24 lb up at 12-0-12, 55 lb down and 24 lb up at 14-0-0, 55 lb down and 24 lb up at 15-11-4, and 55 lb down and 24 lb up at 17-11-4, and 128 lb down and 179 lb up at 19-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-6=-54, 6-8=-54, 1-8=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350291
3125356	T17	Hip Girder	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:49 2022 Page 2
ID:Q7RwmdgDYh8qcxUfiYMxEEzke8Z-d?8Chlv4yEUNGcVKk_yZzRpv2b7Ut8dMEpuMMkyBbwO

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-74(B) 6=-107(B) 12=-31(B) 14=-111(B) 13=-31(B) 4=-74(B) 5=-74(B) 11=-31(B) 10=-111(B) 20=-74(B) 21=-74(B) 22=-74(B) 23=-31(B) 24=-31(B)



Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:51 2022 Page 1
 ID:Q7RwmdgDYh8qcxUfiYmxEzke8Z-ZNGy6RwKrk5Vwweis_P_12su9CPmqL8Bfh7NTQcyBbwM
 5-4-9 10-0-0 18-0-0 22-7-7 28-0-0
 5-4-9 4-7-7 8-0-0 4-7-7 5-4-9
 Scale = 1:47.3

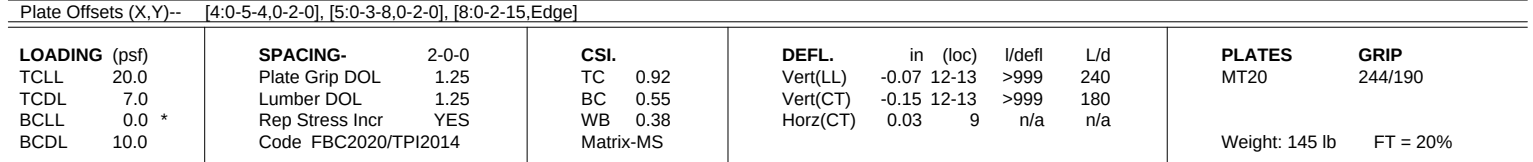

REACTIONS. (size) 13=0-5-8, 9=0-5-8
 Max Horz 13=108(LC 16)
 Max Uplift 13=-414(LC 12), 9=-414(LC 13)
 Max Grav 13=1036(LC 1), 9=1036(LC 1)

TOP CHORD 3-4=-1060/415, 4-5=-907/421, 5-6=-1060/415
BOT CHORD 12-13=-363/787, 10-12=-281/907, 9-10=-256/787
WEBS 3-13=-1094/553, 6-9=-1094/553

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-0-0, Exterior(2R) 10-0-0 to 14-2-15, Interior(1) 14-2-15 to 18-0-0, Exterior(2R) 18-0-0 to 22-2-15, Interior(1) 22-2-15 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 414 lb uplift at joint 13 and 414 lb uplift at joint 9.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE 181-7473 (rev. 3/19/2020) BEFORE USE.

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350293
3125356	T19	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:52 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-1aqKJnxyF9ty73DuQ7VGB3RT?p2l4Ytown70z2yBbwL



Scale = 1:46.9

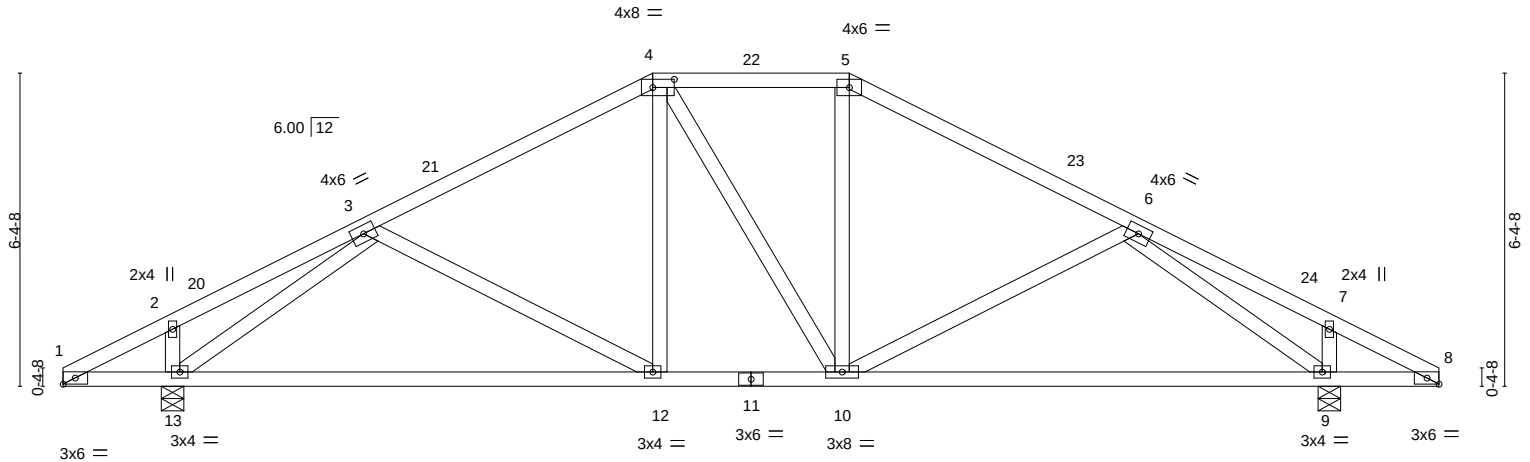

2-0-0 2-2-12 2-0-0 0-2-12	12-0-0 9-9-4	16-0-0 4-0-0	25-9-4 9-9-4	26-0-0 28-0-0 0-2-12 2-0-0
Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [8:0-2-15,Edge]				

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.34	Vert(LL)	-0.20 12-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.82	Vert(CT)	-0.41 12-13	>693	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.54	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 152 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-6-4 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-0-6 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 13=0-5-8, 9=0-5-8
Max Horz 13=129(LC 12)
Max Uplift 13=-417(LC 12), 9=-417(LC 13)
Max Grav 13=1036(LC 1), 9=1036(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-264/0, 3-4=-988/400, 4-5=-819/411, 5-6=-988/400, 7-8=-264/0
BOT CHORD 12-13=-417/865, 10-12=-237/818, 9-10=-289/865
WEBS 3-13=-1075/605, 6-9=-1075/605

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2E) 12-0-0 to 16-0-0, Exterior(2R) 16-0-0 to 20-2-15, Interior(1) 20-2-15 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 417 lb uplift at joint 13 and 417 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350294
3125356	T20	Common	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:53 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEzke8Z-VmOjX7ya?T?plDo5zq0V7H_chCQlpvcy9RsaVvYBbwK

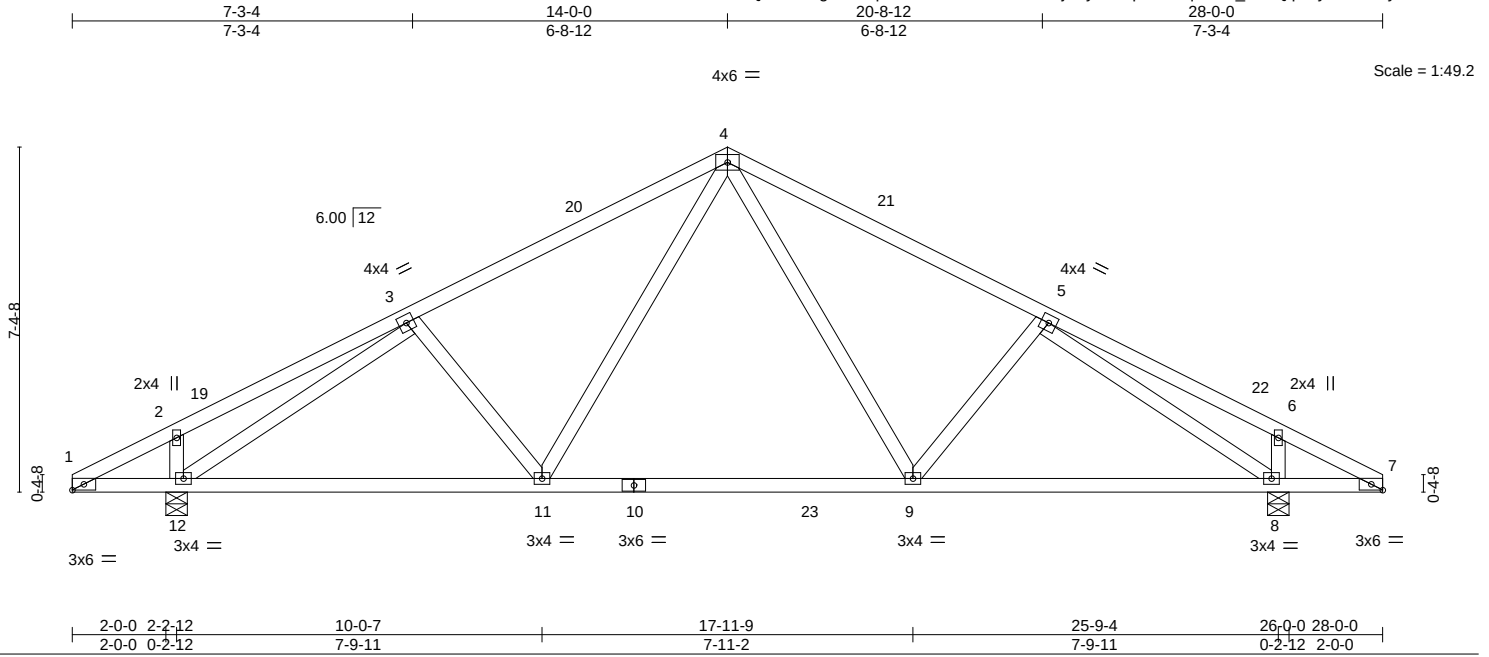

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	-0.15 9-11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.65	Vert(CT)	-0.23 9-11 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.90	Horz(CT)	0.04 8 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 145 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 12=0-5-8, 8=0-5-8
Max Horz 12=-150(LC 13)
Max Uplift 12=-411(LC 12), 8=-411(LC 13)
Max Grav 12=1134(LC 2), 8=1134(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1163/451, 4-5=-1162/451
BOT CHORD 11-12=-431/1032, 9-11=-187/788, 8-9=-281/1003
WEBS 4-9=-173/423, 5-9=-161/256, 4-11=-173/426, 3-11=-161/256, 3-12=-1231/570, 5-8=-1229/570

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 14-0-0, Exterior(2R) 14-0-0 to 17-0-0, Interior(1) 17-0-0 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 411 lb uplift at joint 12 and 411 lb uplift at joint 8.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350295
3125356	T21	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:55 2022 Page 1
ID:Q7RwmdgDYh8qcxUfYMxEEzke8Z-R9VTxo_rX4FW_XyT5F3zCi3?Y04jHvcFclLhZNyBbwI

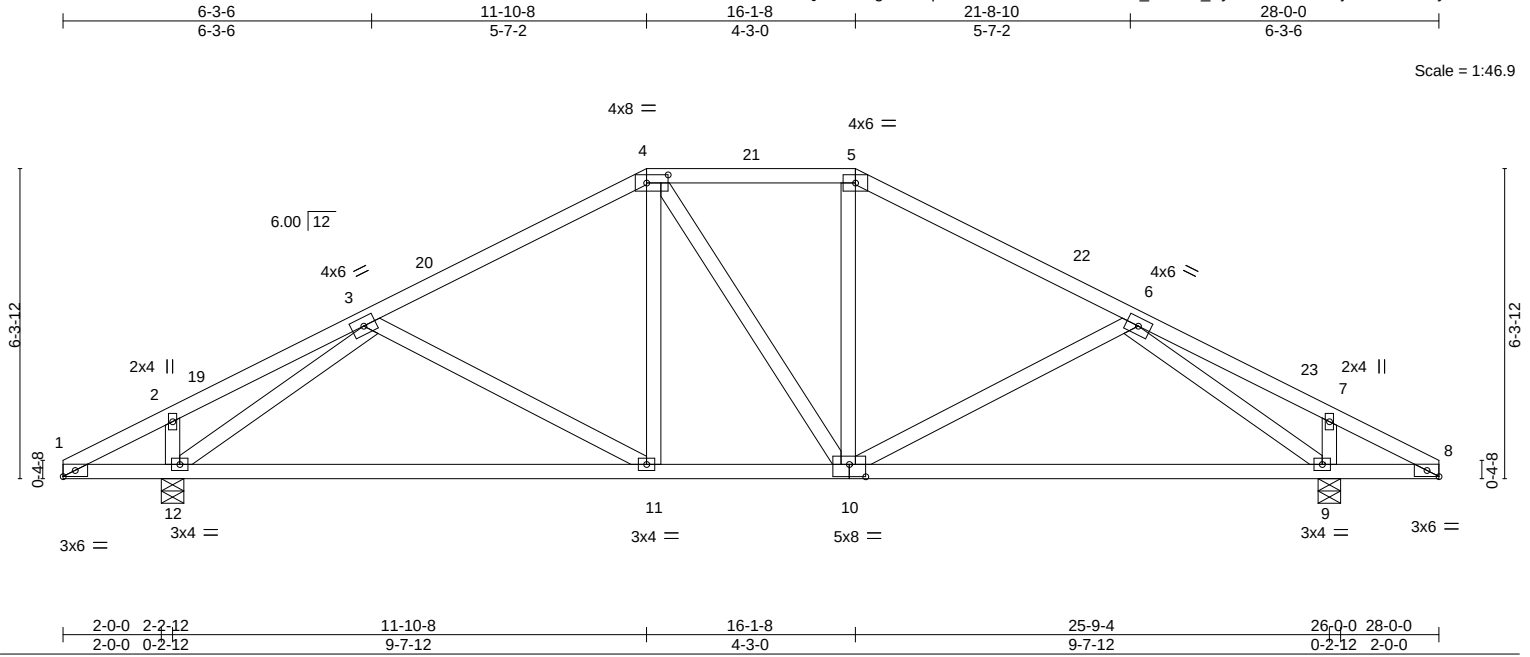


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [8:0-2-15,Edge], [10:0-4-0,0-3-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d
TCLL	20.0	Plate Grip DOL	1.25	TC	0.32	Vert(LL)	-0.19 11-12	>999	240
TCDL	7.0	Lumber DOL	1.25	BC	0.81	Vert(CT)	-0.39 11-12	>723	180
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.03 9	n/a	n/a
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS					
								PLATES	GRIP
								MT20	244/190
								Weight: 151 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-6-11 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 9-0-11 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 12=0-5-8, 9=0-5-8
Max Horz 12=128(LC 16)
Max Uplift 12=-417(LC 12), 9=-417(LC 13)
Max Grav 12=1036(LC 1), 9=1036(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-262/0, 3-4=-991/403, 4-5=-823/413, 5-6=-991/403, 7-8=-262/0
BOT CHORD 11-12=-414/863, 10-11=-240/823, 9-10=-287/863
WEBS 3-12=-1073/601, 6-9=-1074/601

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-10-8, Exterior(2E) 11-10-8 to 16-1-8, Exterior(2R) 16-1-8 to 20-4-7, Interior(1) 20-4-7 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 417 lb uplift at joint 12 and 417 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Lake City, FL) Lake City, FL - 32055, 8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:56 2022 Page 1
 ID: Q7RwmdgDYh8qcxUfiYmXEEzke8Z-vL3r98_TIONNchXgfyaCivc9?QQM0MnOrP5E6qyBbwH
 5-4-10 9-10-8 13-10-8 16-0-0 21-8-10 28-0-0
 5-4-10 4-5-14 4-0-0 2-1-8 5-8-10 6-3-6

The diagram illustrates a roof truss system with the following dimensions and member labels:

- Overall Dimensions:**
 - Span: 28'-0"
 - Peak Height: 6'-4"
 - Truss Depth: 5'-3"
 - Overhang: 0'-4"
- Member Labels:**
 - Top Chords: 21, 23, 24
 - Bottom Chords: 20, 22, 25
 - Verticals: 4, 6, 7, 8
 - Diagonals: 3, 5, 10, 11, 12, 13
- Supports:**
 - Left Support: 3x6 =
 - Right Support: 3x6 =
- Intermediate Connections:**
 - 4x4 =
 - 4x6 =
 - 2x4 =
 - 3x4 =
 - 5x8 =
 - 3x8 =

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-3-8 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3		


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	3-4=-1046/452, 4-5=-889/452, 5-6=-929/467, 6-7=-993/431, 8-9=-261/8
BOT CHORD	12-13=-413/795, 11-12=-345/991, 10-11=-280/865
WEBS	4-12=-58/265, 5-11=-448/302, 6-11=-254/584, 3-13=-1101/605, 7-10=-1083/632

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 9-10-8 to 12-10-8, Interior(1) 12-10-8 to 16-0-0, Exterior(2R) 16-0-0 to 19-0-0, Interior(1) 19-0-0 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 437 lb uplift at joint 13 and 394 lb uplift at joint 10.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

December 7, 2022




Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350297
3125356	T23	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:58 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-skBcaq0jq?d5r_h2mNcgqKhUVD6PUGChIjaLAiyBbwF



Scale: 1/4"=1'

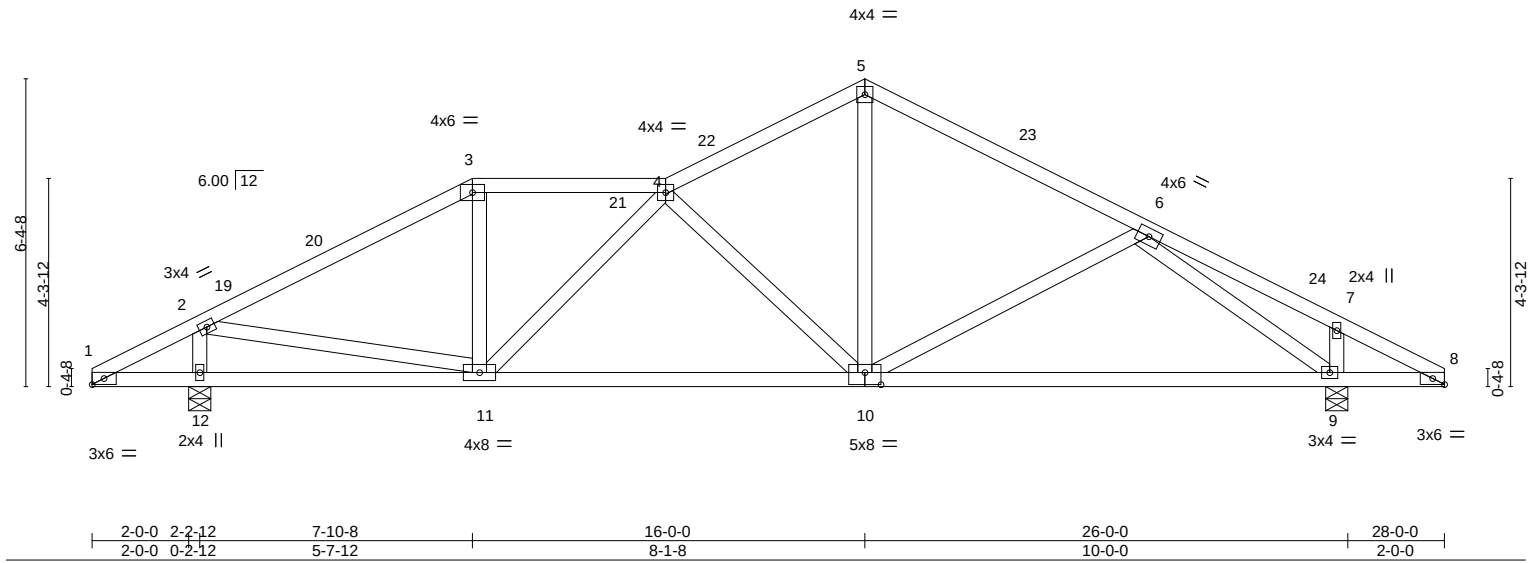


Plate Offsets (X,Y)-- [8:0-2-15,Edge], [10:0-4-0,0-3-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.34	Vert(LL)	-0.16	9-10	>999	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.74	Vert(CT)	-0.34	9-10	>843		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.55	Horz(CT)	0.03	9	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS					Weight: 146 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-3-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
8-6-8 oc bracing: 10-11.

REACTIONS.

(size) 12=0-5-8, 9=0-5-8
Max Horz 12=129(LC 12)
Max Uplift 12=-437(LC 12), 9=-394(LC 13)
Max Grav 12=1036(LC 1), 9=1036(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1111/447, 3-4=-938/454, 4-5=-967/448, 5-6=-998/432, 7-8=-257/18
BOT CHORD 10-11=-472/1183, 9-10=-275/866
WEBS 2-12=-944/564, 2-11=-409/922, 3-11=-43/281, 4-11=-360/187, 4-10=-499/342,
5-10=-206/554, 6-9=-1093/628

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-10-8, Exterior(2R) 7-10-8 to 10-10-8, Interior(1) 10-10-8 to 16-0-0, Exterior(2R) 16-0-0 to 19-0-0, Interior(1) 19-0-0 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 437 lb uplift at joint 12 and 394 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350298
3125356	T24	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:35:59 2022 Page 1

ID:Q7RwmdgDyh8qcxUfiYMxEEZke8Z-Kwl_nA1LbJlyT8GFK57vNYEdmdRBDhxqXNJui8yBbwE



Scale: 1/4"=1'

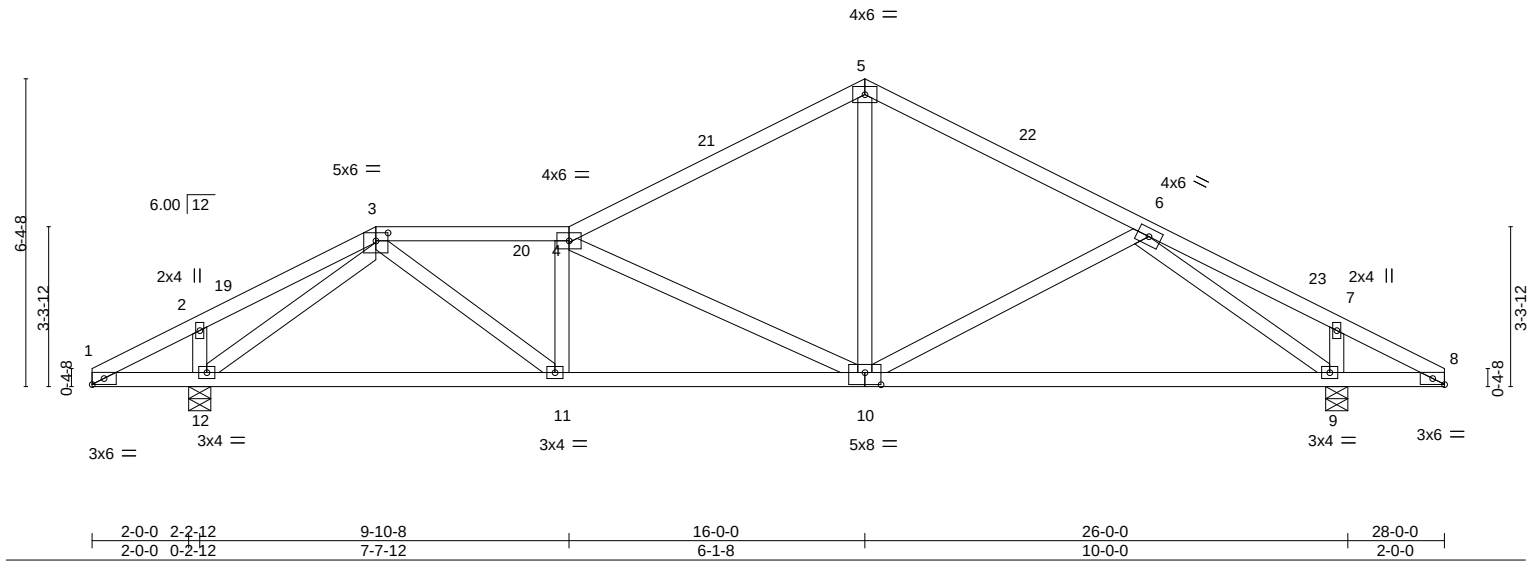


Plate Offsets (X,Y)--												[3:0-3-0,0-2-0], [8:0-2-15,Edge], [10:0-4-0,0-3-0]											
LOADING (psf)				SPACING- 2-0-0				CSI.				DEFL. in (loc) l/defl L/d				PLATES				GRIP			
TCLL 20.0				Plate Grip DOL 1.25				TC 0.50				Vert(LL) -0.18 9-10 >999 240				MT20				244/190			
TCDL 7.0				Lumber DOL 1.25				BC 0.77				Vert(CT) -0.37 9-10 >760 180											
BCLL 0.0 *				Rep Stress Incr YES				WB 0.65				Horz(CT) 0.04 9 n/a n/a											
BCDL 10.0				Code FBC2020/TPI2014				Matrix-MS												Weight: 143 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 12=0-5-8, 9=0-5-8
Max Horz 12=129(LC 16)
Max Uplift 12=-437(LC 12), 9=-394(LC 13)
Max Grav 12=1036(LC 1), 9=1036(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1451/620, 4-5=-997/431, 5-6=-998/428, 7-8=-258/10
BOT CHORD 11-12=-397/818, 10-11=-612/1470, 9-10=-269/862
WEBS 3-12=-1069/576, 3-11=-296/805, 4-11=-377/226, 4-10=-715/420, 5-10=-155/535, 6-9=-1078/617

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 5-10-8, Exterior(2R) 5-10-8 to 8-10-8, Interior(1) 8-10-8 to 16-0-0, Exterior(2R) 16-0-0 to 19-0-0, Interior(1) 19-0-0 to 28-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 437 lb uplift at joint 12 and 394 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:01 2022 Page 1

ID:Q7RwmdgDYh8qccUfiYMxEZke8Z-GJtkCs2c7w?giSPdRWANsSzJ07RE1hf97_ho?n1yBbWc

2-2-12 3-10-8 7-10-8 11-10-4 16-0-0 20-1-12 28-0-0 7-10-4

2-2-12 1-7-12 4-0-0 3-11-12 4-1-12 4-1-12 7-10-4

Scale: 1/4"=1'

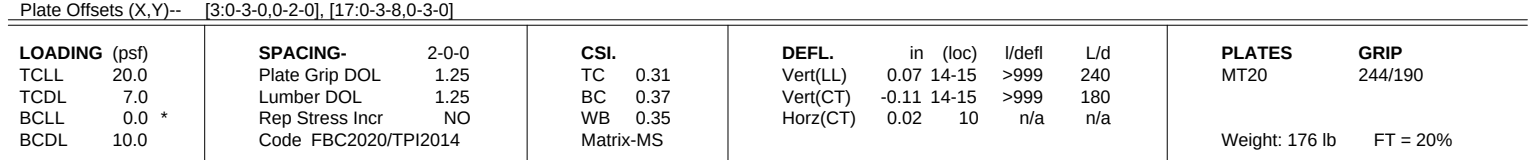

REACTIONS. (size) 17=0-5-8, 10=0-5-8
 Max Horz 17=129(LC 34)
 Max Uplift 17=-522(LC 8), 10=-401(LC 9)
 Max Grav 17=937(LC 1), 10=1029(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	3-4=-897/499, 4-5=-1403/594, 5-6=-952/419, 6-7=-955/440, 7-8=-1101/401
BOT CHORD	16-17=-382/559, 15-16=-836/1753, 14-15=-839/1750, 12-14=-514/1220, 11-12=-275/922
WEBS	3-17=-986/458, 3-16=-287/651, 4-16=-1068/424, 4-14=-589/362, 5-14=-139/362, 5-12=-575/371, 6-12=-268/607, 8-11=-259/874, 8-10=-895/445

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 522 lb uplift at joint 17 and 401 lb uplift at joint 10.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 28 lb down and 22 lb up at 3-10-8 on top chord, and 104 lb down and 218 lb up at 3-10-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-4=-54, 4-6=-54, 6-9=-54, 1-9=-20
Concentrated Loads (lb)
Vert: 22=106(F)

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022



WARNING – verify design parameters and READ NOTES ON THIS AND INCLUDED WITH REFERENCE TO AISC MH-433 (Rev. 3/25/2020) BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2662 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350300
3125356	T26	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),	Lake City, FL - 32055,	8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:03 2022 Page 1
7-0-0	11-0-8	ID:Q7RwmdgDYh8qcxUfrYMxEeZke8Z-Ch_VdX4sfXFOymZ0ZwCrXOOLIEyu9ZUQS?H6rwyBbwA
7-0-0	4-0-8	15-1-0
		4-0-8
		22-1-0
		7-0-0

Scale = 1:36.7

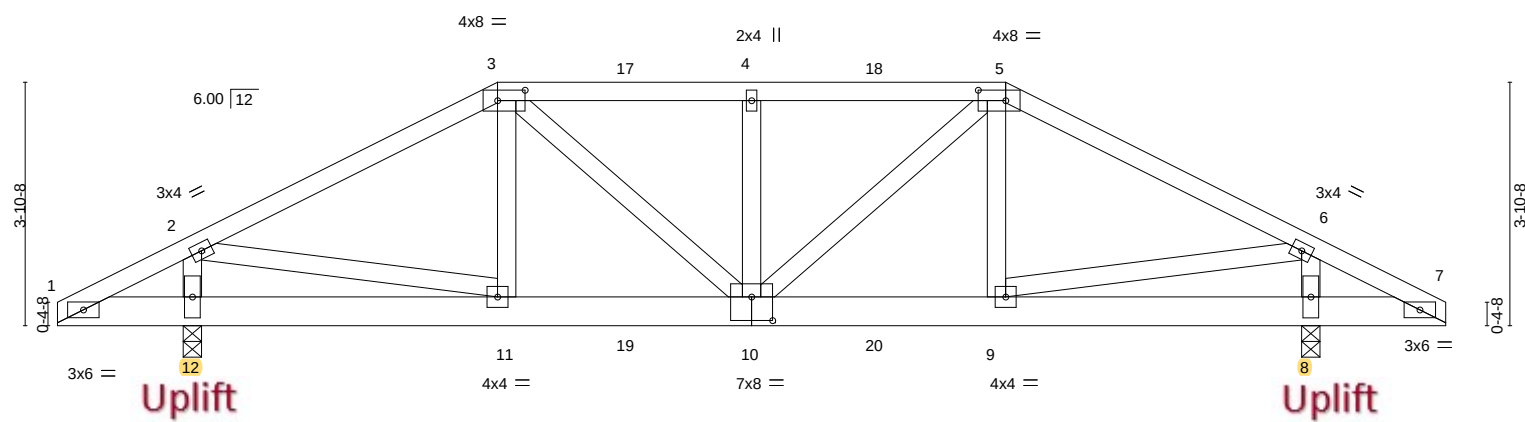

2-0-0	2-1-12	7-0-0	11-0-8	15-1-0	19-11-4	20-1-0	22-1-0
2-0-0	0-1-12	4-10-4	4-0-8	4-0-8	4-10-4	0-1-12	2-0-0
Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [5:0-5-4,0-2-0], [10:0-4-0,0-4-8]							
LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl
TCLL	20.0	Plate Grip DOL	1.25	TC	0.37		L/d
TCDL	7.0	Lumber DOL	1.25	BC	0.21		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.36		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS			
						PLATES	GRIP
						MT20	244/190
						Weight: 132 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-1-14 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 8-5-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 12=0-3-8, 8=0-3-8
Max Horz 12=-76(LC 9)
Max Uplift 12=-684(LC 5), 8=-697(LC 4)
Max Grav 12=1026(LC 1), 8=1043(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1102/894, 3-4=-1203/1049, 4-5=-1203/1049, 5-6=-1127/914
BOT CHORD 10-11=-773/924, 9-10=-762/946
WEBS 2-11=-700/896, 3-10=-342/404, 4-10=-356/336, 5-10=-310/364, 6-9=-732/917,
2-12=-899/675, 6-8=-914/674

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed ; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 684 lb uplift at joint 12 and 697 lb uplift at joint 8.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 68 lb down and 106 lb up at 7-0-0, 50 lb down and 106 lb up at 9-0-12, 50 lb down and 95 lb up at 11-0-8, and 50 lb down and 106 lb up at 13-0-4, and 133 lb down and 184 lb up at 15-1-0 on top chord, and 158 lb down and 129 lb up at 7-0-0, 62 lb down and 10 lb up at 9-0-12, 62 lb down and 20 lb up at 11-0-8, and 62 lb down and 20 lb up at 13-0-4, and 158 lb down and 129 lb up at 15-0-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 5-7=-54, 1-7=-20

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350300
3125356	T26	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:03 2022 Page 2
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-Ch_VdX4sfXFOymZ0ZwCrXOOLIEyu9ZUQS?H6rwyBbwA

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-50(B) 5=-86(B) 11=-48(B) 10=-18(B) 4=-50(B) 9=-48(B) 17=-50(B) 18=-50(B) 19=-18(B) 20=-18(B)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350301
3125356	T27	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:04 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-guYtqt5UQrNFZv8C7ej44bxXVeDCu12Zhf1fOMyBbw9

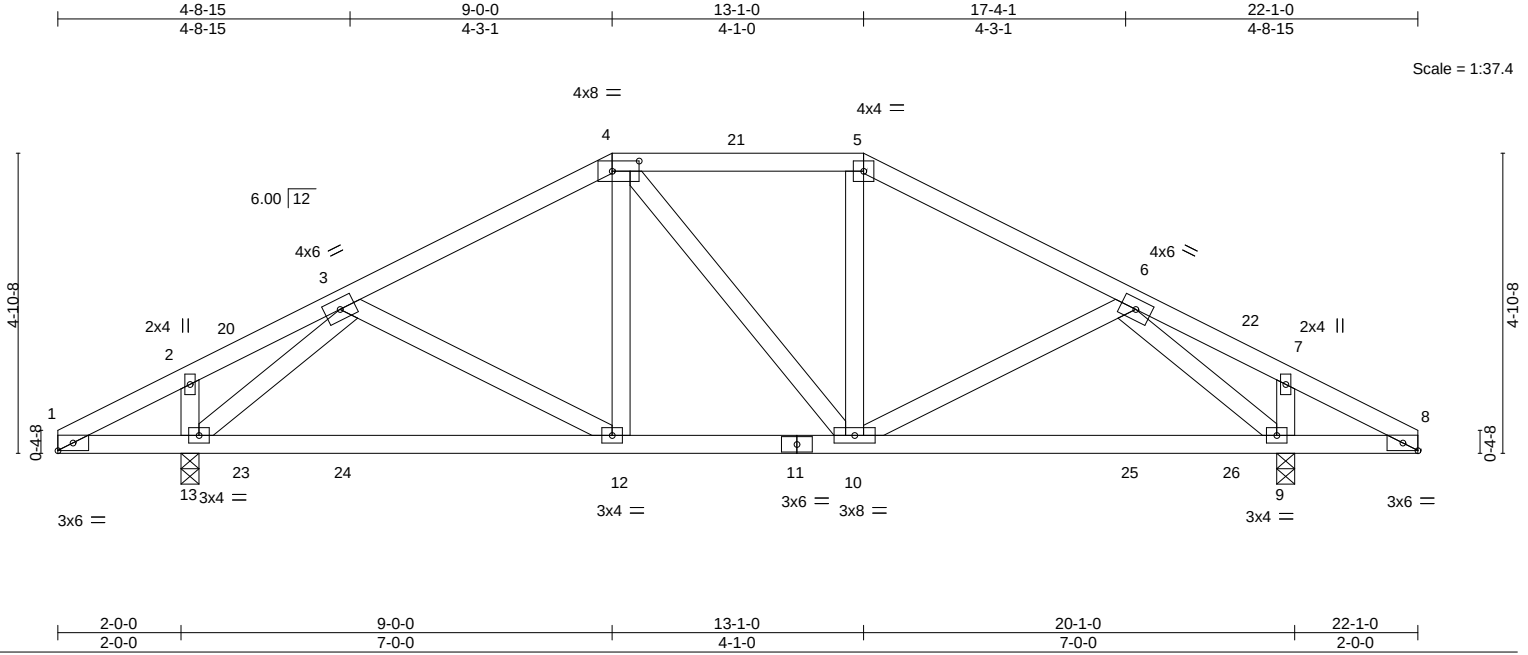

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.31	Vert(LL)	0.15 12-13 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.46	Vert(CT)	0.14 12-13 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.28	Horz(CT)	-0.02 9 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 117 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

REACTIONS.

(size) 13=0-3-8, 9=0-3-8
Max Horz 13=97(LC 12)
Max Uplift 13=-396(LC 9), 9=-396(LC 8)
Max Grav 13=817(LC 1), 9=817(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-714/1070, 4-5=-592/1011, 5-6=-714/1071
BOT CHORD 12-13=-710/533, 10-12=-820/591, 9-10=-702/533
WEBS 4-12=-344/162, 5-10=-320/163, 3-13=-806/924, 6-9=-806/925

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 9-0-0, Exterior(2E) 9-0-0 to 13-1-0, Exterior(2R) 13-1-0 to 17-5-3, Interior(1) 17-5-3 to 22-1-0 zone; cantilever left and right exposed ; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 396 lb uplift at joint 13 and 396 lb uplift at joint 9.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350302
3125356	T28	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:06 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-dGgdFZ6kySdypDlbE3IY900oCSnrMu8s8yWmSFyBbw7



Scale = 1:37.3

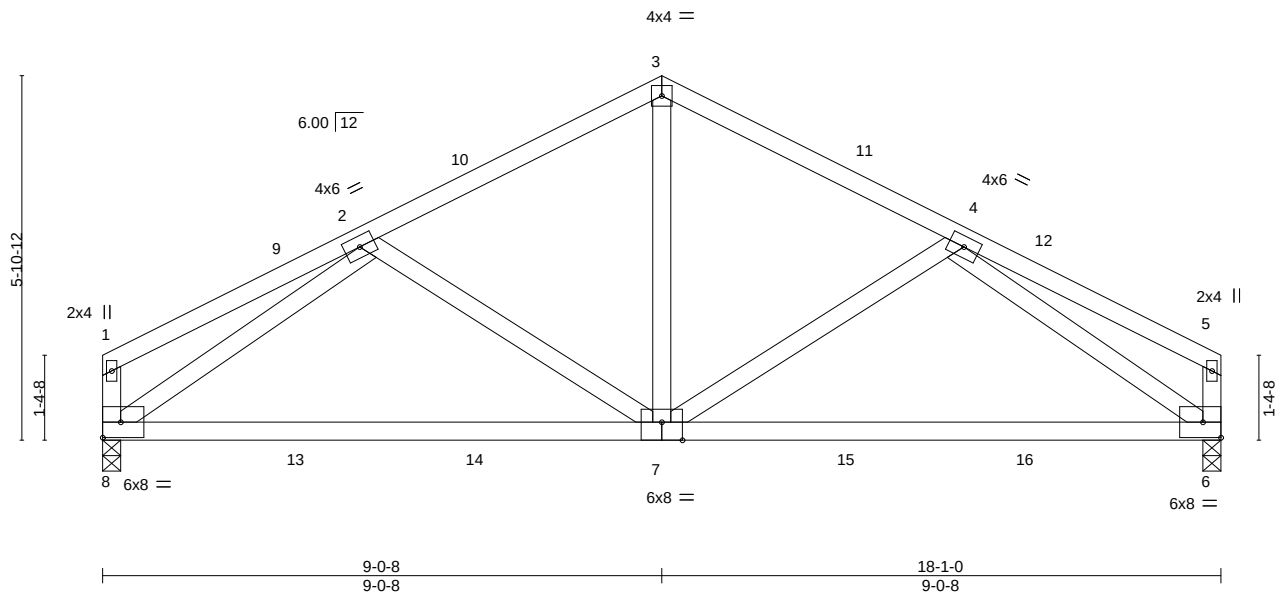


Plate Offsets (X,Y)-- [7:0-4-0,Edge]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES	GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.61	Vert(LL)	0.36	7-8	>594	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.96	Vert(CT)	0.32	7-8	>668	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.49	Horz(CT)	-0.02	6	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014		Matrix-MS						Weight: 99 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS.

(size) 8=0-3-8, 6=0-3-8
Max Horz 8=-96(LC 13)
Max Uplift 8=-305(LC 9), 6=-305(LC 8)
Max Grav 8=658(LC 1), 6=658(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-146/322, 2-3=-693/1175, 3-4=-693/1175, 4-5=-146/322
BOT CHORD 7-8=-938/655, 6-7=-929/655
WEBS 3-7=-825/379, 2-8=-718/891, 4-6=-718/891

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 9-0-8, Exterior(2R) 9-0-8 to 12-0-8, Interior(1) 12-0-8 to 17-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 305 lb uplift at joint 8 and 305 lb uplift at joint 6.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350303
3125356	T28G	COMMON GIRDER	1	2	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:08 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEEZke8Z-ZfoOgF8?T4ug2XSzMUo0ER5CEFWVqh39bG?tx7yBbw5

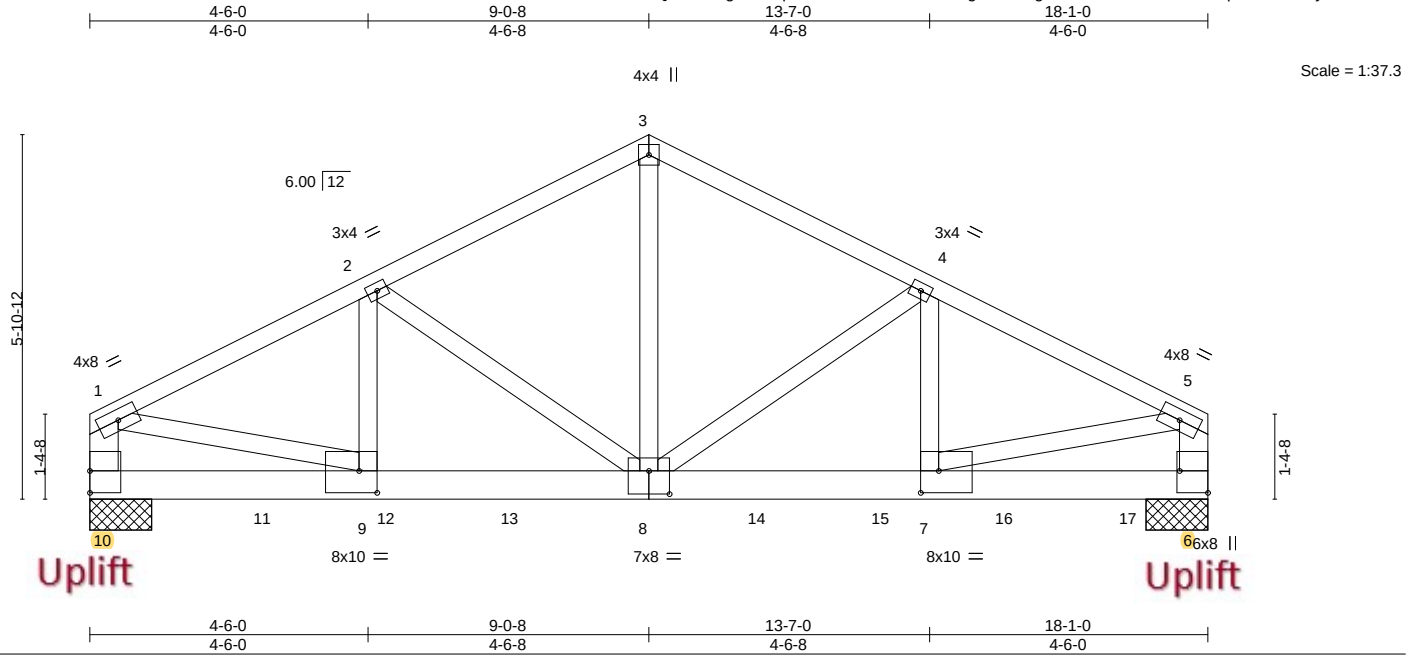


Plate Offsets (X,Y)-- [6:Edge,0-5-8], [7:0-3-8,0-4-4], [8:0-4-0,0-4-8], [9:0-3-8,0-4-4]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.32	Vert(LL)	0.09	7-8	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.82	Vert(CT)	-0.14	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.91	Horz(CT)	0.03	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 240 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.3 *Except*
 1-10,5-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 10=1-0-0, 6=1-0-0
 Max Horz 10=-95(LC 9)
 Max Uplift 10=-2012(LC 8), 6=-2365(LC 9)
 Max Grav 10=4297(LC 2), 6=5042(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-5773/2702, 2-3=-4751/2271, 3-4=-4751/2271, 4-5=-5979/2800, 1-10=-3866/1838, 5-6=-3961/1882
 BOT CHORD 9-10=-328/481, 8-9=-2452/5117, 7-8=-2444/5301, 6-7=-319/657
 WEBS 3-8=-1881/3994, 4-8=-1352/742, 4-7=-587/1201, 2-8=-1126/635, 2-9=-483/976, 1-9=-2192/4786, 5-7=-2194/4795

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2012 lb uplift at joint 10 and 2365 lb uplift at joint 6.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1026 lb down and 500 lb up at 2-9-12, 1026 lb down and 500 lb up at 4-9-12, 1026 lb down and 500 lb up at 6-9-12, 1026 lb down and 500 lb up at 8-9-12, 1026 lb down and 500 lb up at 10-9-12, 1026 lb down and 500 lb up at 12-9-12, and 1026 lb down and 500 lb up at 14-9-12, and 1026 lb down and 500 lb up at 16-9-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

December 7, 2022

LOAD CASE(S) Standard

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350303
3125356	T28G	COMMON GIRDER	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.530 s Aug 11 2022 MiTek Industries, Inc.
Tue Dec 6 18:36:08 2022
Page 2
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-ZfoOgF8?T4ug2XSzMUo0ER5CEFWVqh39bG?tX7yBbw5

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-54, 3-5=-54, 6-10=-20


Concentrated Loads (lb)

Vert: 8=-978(F) 11=-978(F) 12=-978(F) 13=-978(F) 14=-978(F) 15=-978(F) 16=-978(F) 17=-978(F)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350306
3125356	T30	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:12 2022 Page 1
ID:Q7RwmdgDYh8qcxUfrYMxEeZke8Z-RQ1uWcBVXI06X8lkbJsyOHGqxt1TmgftWuz4guyBbw1

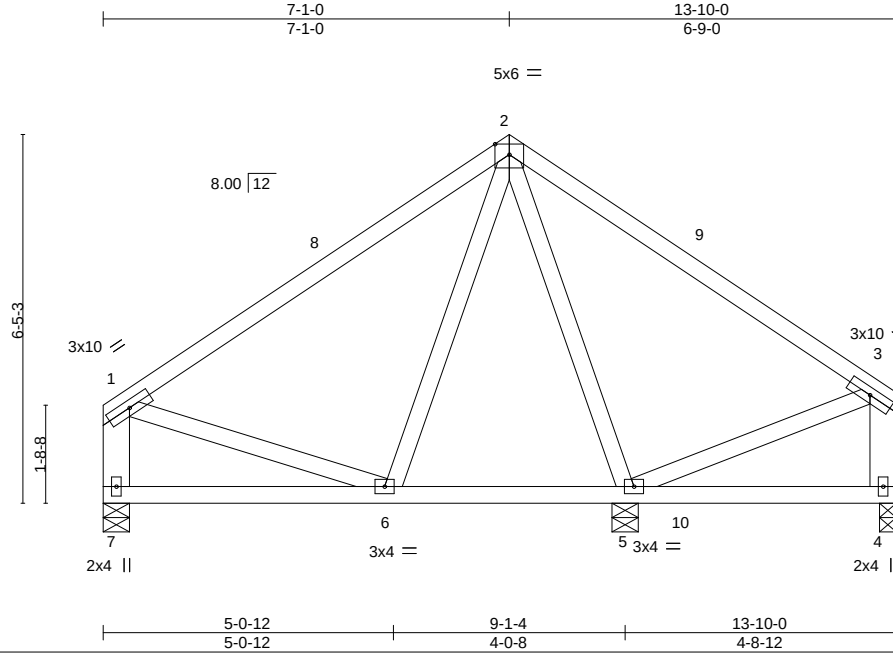

Scale = 1:40.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.53	Vert(LL)	0.03	4-5	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.18	Vert(CT)	-0.03	6-7	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.23	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 85 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
1-7,3-4: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=0-5-8, 4=0-3-8, 5=0-5-8
Max Horz 7=145(LC 9)
Max Uplift 7=-139(LC 12), 4=-107(LC 13), 5=-102(LC 12)
Max Grav 7=370(LC 1), 4=245(LC 1), 5=374(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-312/154, 1-7=-324/179
WEBS 2-5=-292/130

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-2-12 to 3-2-12, Interior(1) 3-2-12 to 7-1-0, Exterior(2R) 7-1-0 to 10-1-0, Interior(1) 10-1-0 to 13-7-4 zone; porch right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 139 lb uplift at joint 7, 107 lb uplift at joint 4 and 102 lb uplift at joint 5.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350307
3125356	T31	Common Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:14 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-Op9fxlCl3weqmSv7ikvQuiLDlgipEQZ2_CSBknyBbw?

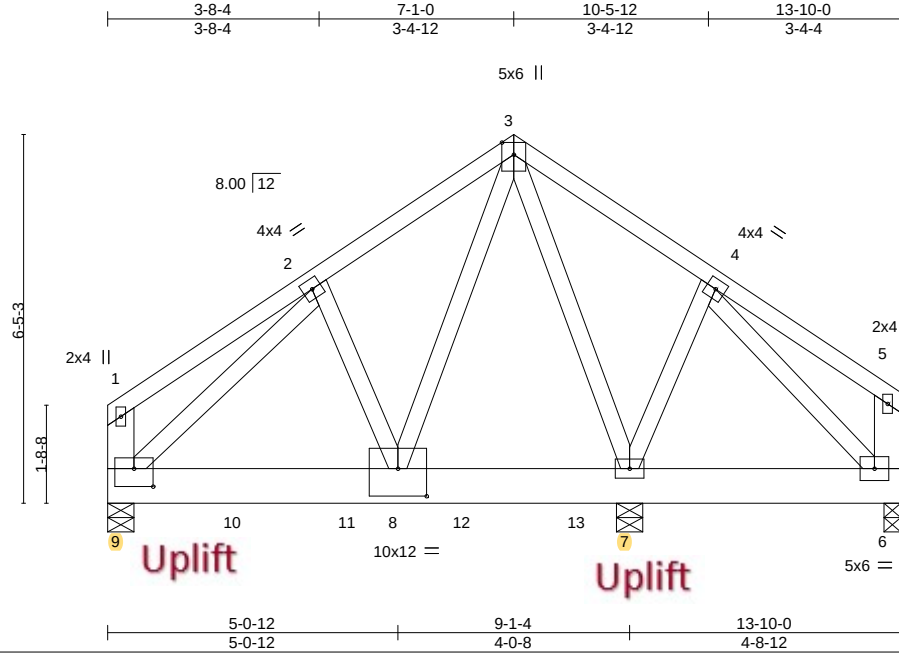

Scale = 1:40.2

Plate Offsets (X,Y)-- [8:0-6-0,0-5-12], [9:0-4-0,0-3-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.32	Vert(LL)	-0.03	8-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.25	Vert(CT)	-0.05	8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.85	Horz(CT)	0.00	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 114 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
1-9,5-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-11-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=0-5-8, 9=0-5-8, 6=0-3-8
Max Horz 9=145(LC 5)
Max Uplift 7=-898(LC 9), 9=-671(LC 8), 6=-46(LC 8)
Max Grav 7=2209(LC 1), 9=1715(LC 1), 6=185(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-379/197, 2-3=-1356/617, 1-9=-275/167
BOT CHORD 8-9=-479/1038, 7-8=-215/500
WEBS 2-8=-228/305, 3-8=-807/1827, 3-7=-1158/474, 2-9=-1130/417, 4-6=-275/97

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 898 lb uplift at joint 7, 671 lb uplift at joint 9 and 46 lb uplift at joint 6.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 780 lb down and 327 lb up at 2-2-4, 780 lb down and 327 lb up at 4-2-4, and 780 lb down and 327 lb up at 6-2-4, and 780 lb down and 327 lb up at 8-2-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 6-9=-20
Concentrated Loads (lb)
Vert: 10=-780(F) 11=-780(F) 12=-780(F) 13=-780(F)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350308
3125356	T32	Common	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:15 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-s?j18eDOqDmhOcUJGSQf0vuNc40cz3qBCsBkHDyBbw_

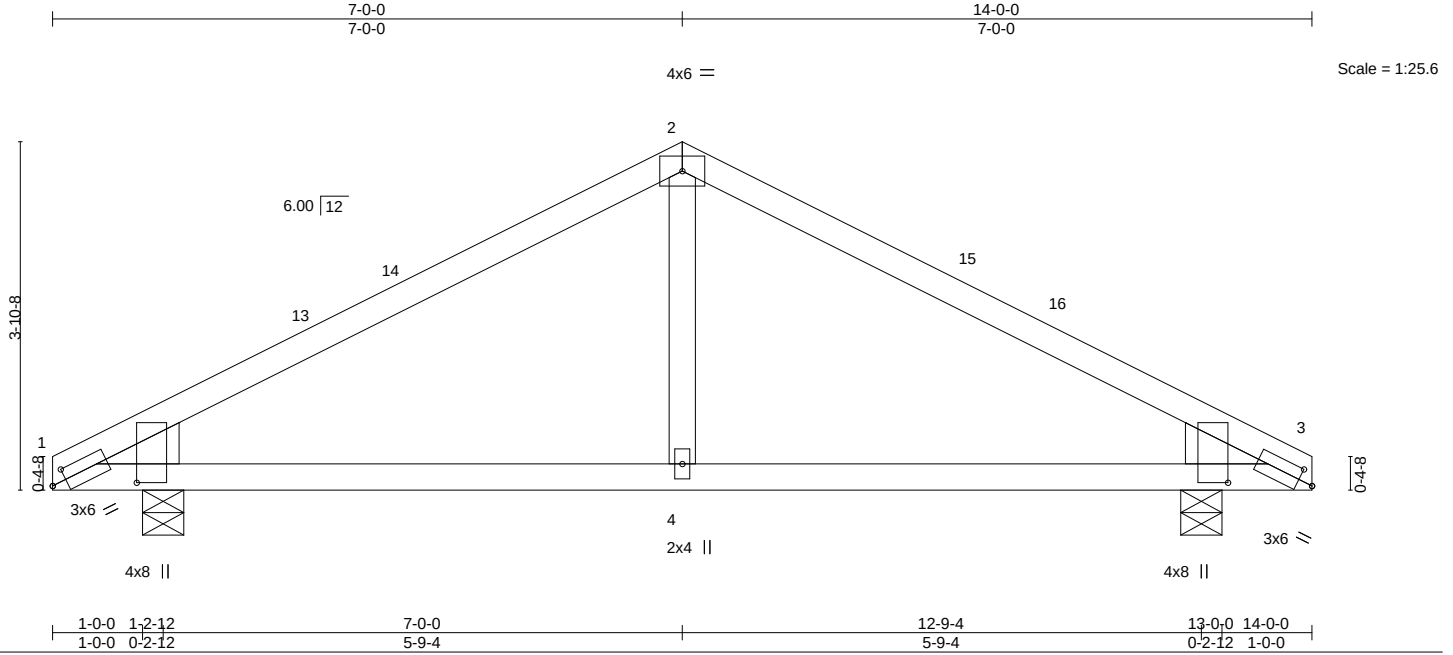

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.44	Vert(LL)	-0.03	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.35	Vert(CT)	-0.04				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.01				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 54 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x6 SP No.2 , Right: 2x6 SP No.2

REACTIONS.

(size) 1=0-5-8, 3=0-5-8
Max Horz 1=75(LC 12)
Max Uplift 1=-206(LC 12), 3=-206(LC 13)
Max Grav 1=518(LC 1), 3=518(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-480/312, 2-3=-480/312
BOT CHORD 1-4=-144/354, 3-4=-144/354

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-0-0, Exterior(2R) 7-0-0 to 10-0-0, Interior(1) 10-0-0 to 14-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 206 lb uplift at joint 1 and 206 lb uplift at joint 3.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350309
3125356	T33	Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc.
Tue Dec 6 18:36:17 2022
Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-oQqnZKFeMr0PdveiNtS75Kzl2ug2R_cUgAgqK6yBbvy

5-0-0
5-0-0
9-0-0
4-0-0
14-0-0
5-0-0

Scale = 1:23.1

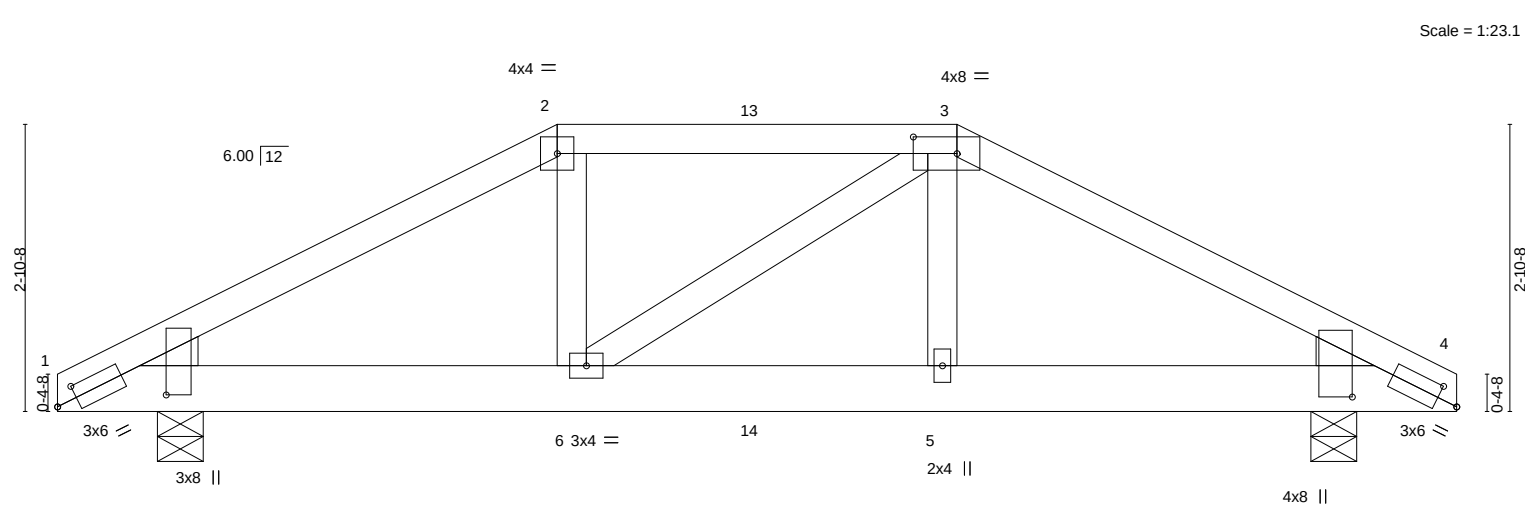

1-0-0	1-2-12	5-0-0	9-0-0	12-9-4	13-0-0	14-0-0
1-0-0	0-2-12	3-9-4	4-0-0	3-9-4	0-2-12	1-0-0
Plate Offsets (X,Y)-- [1:0-1-7,1-1-1], [1:0-2-8,0-1-8], [3:0-5-4,0-2-0], [4:0-2-8,0-1-8], [4:0-1-3,1-0-9]						

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	0.04	5-6	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.41	Vert(CT)	-0.05	5-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.06	Horz(CT)	0.01	4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 70 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.
WEBS	2x4 SP No.3		
WEDGE			
Left: 2x4 SP No.3 , Right: 2x4 SP No.3			

REACTIONS.	(size)	1=0-5-8, 4=0-5-8
	Max Horz	1=54(LC 12)
	Max Uplift	1=-364(LC 8), 4=-374(LC 9)
	Max Grav	1=624(LC 1), 4=641(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-688/441, 2-3=-563/428, 3-4=-715/470
BOT CHORD	1-6=-359/561, 5-6=-362/585, 4-5=-365/584

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 364 lb uplift at joint 1 and 374 lb uplift at joint 4.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 52 lb down and 95 lb up at 5'-0-0, and 38 lb down and 84 lb up at 7'-0-0, and 129 lb down and 210 lb up at 9'-0-0 on top chord, and 68 lb down and 34 lb up at 5'-0-0, and 27 lb down and 16 lb up at 7'-0-0, and 68 lb down and 34 lb up at 8'-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1) Dead + Roof Live (balanced):	Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)	
	Vert: 1-2=-54, 2-3=-54, 3-4=-54, 1-4=-20
Concentrated Loads (lb)	
	Vert: 2=-33(B) 3=-82(B) 6=-33(B) 5=-33(B) 13=-33(B) 14=-15(B)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


December 7,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350310
3125356	V01	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:18 2022 Page 1

ID:Q7RwmdgDYh8qcxUfrYMxEZke8Z-GaOAmgFG788FF3CuxazMeYWyEH5yAQbdvqQNsYyBbvX

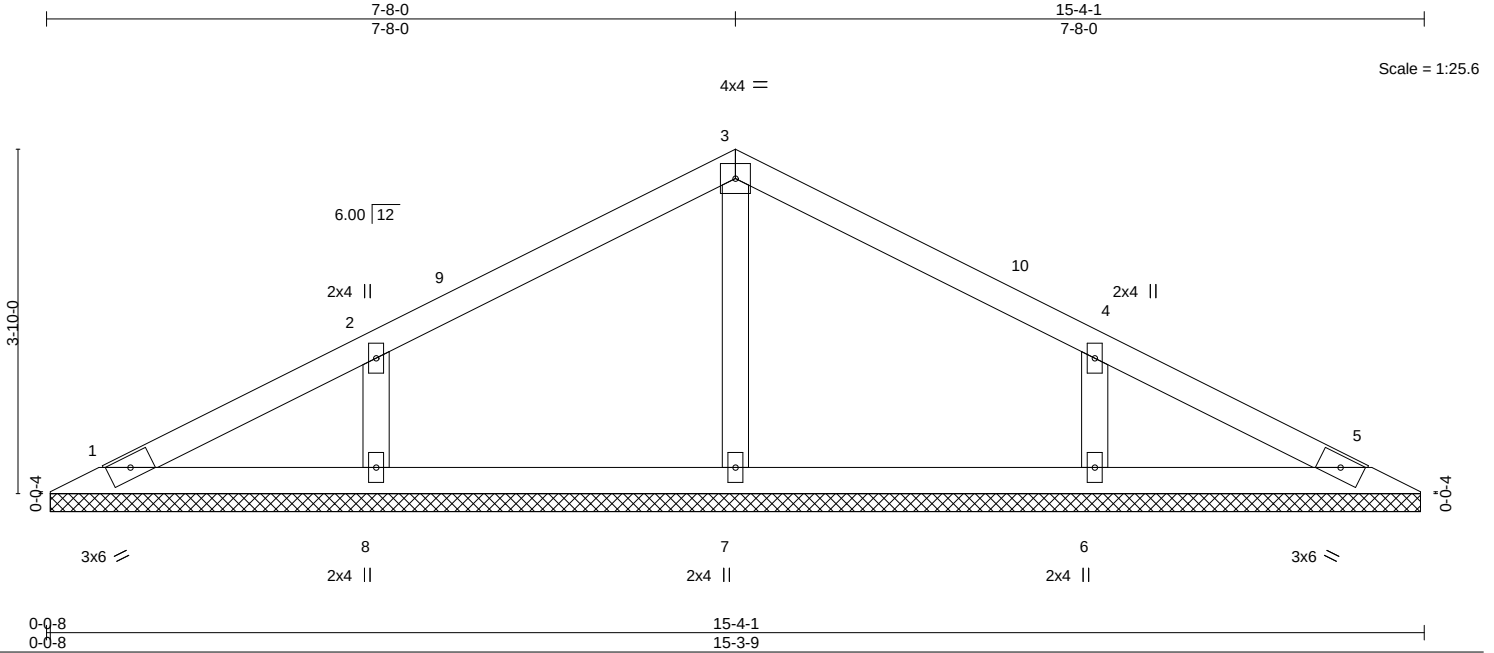

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.11	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 55 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 15-3-1.

(lb) - Max Horz 1=76(LC 16)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 7 except 8=204(LC 12), 6=204(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=257(LC 1), 8=309(LC 23), 6=309(LC 24)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-229/264, 4-6=-229/264

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-8-0, Interior(1) 3-8-0 to 7-8-0, Exterior(2R) 7-8-0 to 10-8-0, Interior(1) 10-8-0 to 14-8-8 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 7 except (jt=lb) 8=204, 6=204.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350311
3125356	V02	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:19 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-kmyY_0GuuSG6tDn5VHUbBI34MhP5vtpn7U9xP_yBbww

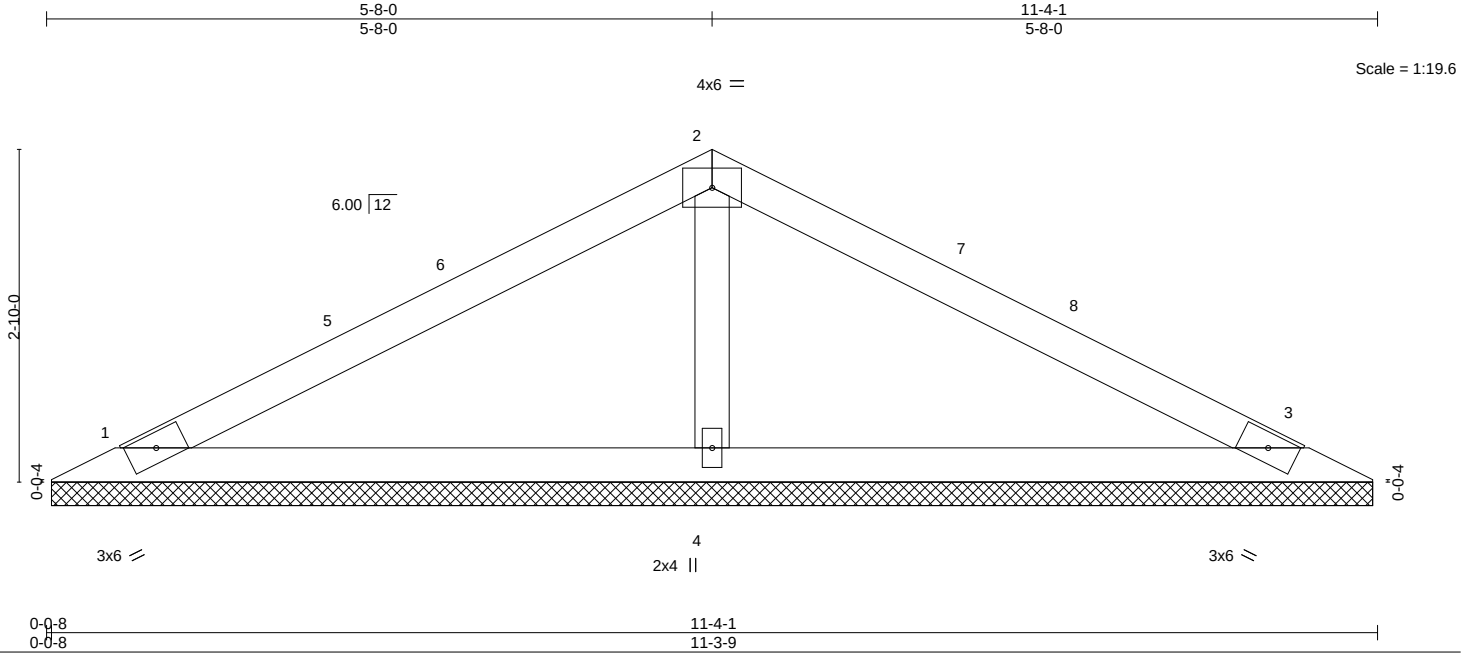

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.33	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.25	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 37 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=11-3-1, 3=11-3-1, 4=11-3-1
Max Horz 1=54(LC 16)
Max Uplift 1=-83(LC 12), 3=-93(LC 13), 4=-122(LC 12)
Max Grav 1=171(LC 23), 3=171(LC 24), 4=407(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-262/265

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-8-0, Exterior(2R) 5-8-0 to 8-8-0, Interior(1) 8-8-0 to 10-8-8 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3 except (jt=lb) 4=122.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350312
3125356	V03	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:20 2022 Page 1

ID:Q7RwmdgDYh8qcxUfiYMxEEZke8Z-CzWwBLHWemOzUNMH3??qjzbls5nmeKKwM8vUxRyBbv



Scale = 1:13.9

4x4 =

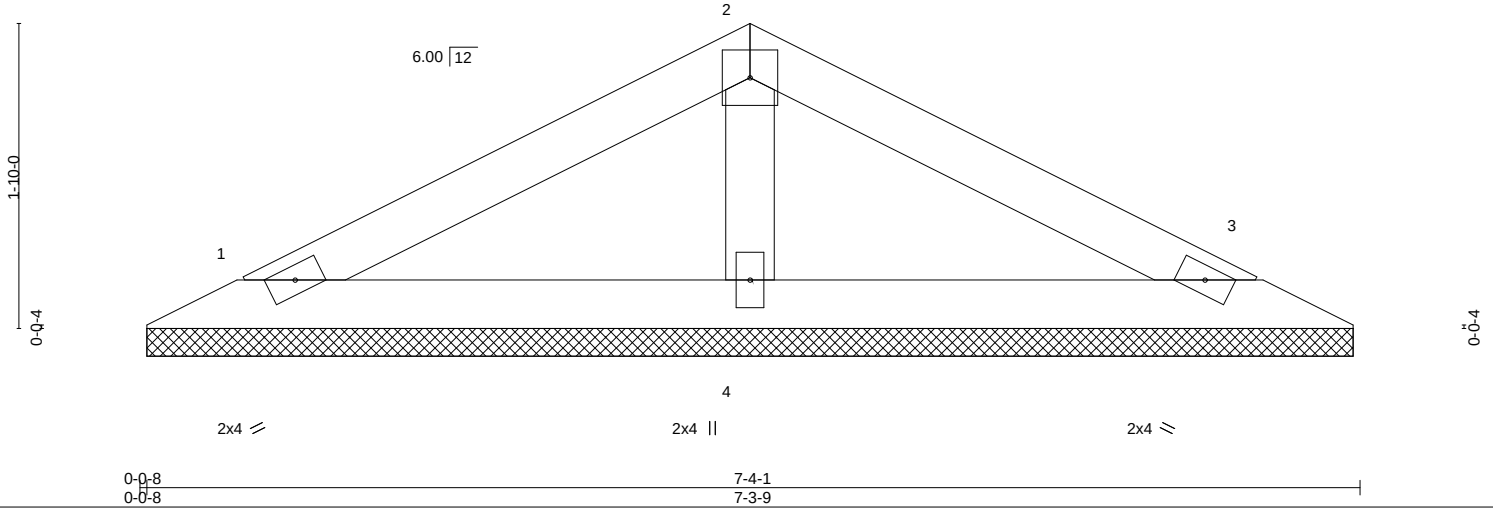

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.15	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.09	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 23 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=7-3-1, 3=7-3-1, 4=7-3-1
Max Horz 1=33(LC 16)
Max Uplift 1=-50(LC 12), 3=-56(LC 13), 4=-73(LC 12)
Max Grav 1=103(LC 23), 3=103(LC 24), 4=245(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:21 2022 Page 1
 ID:Q7RwmdgDYh8qcxUfiYMxEzke8Z-h94lPhl8P3Wq6XxTciX3GA8P_V4jNmL3boe2TyBbv
 6-0-5 12-0-11
 6-0-5 6-0-5

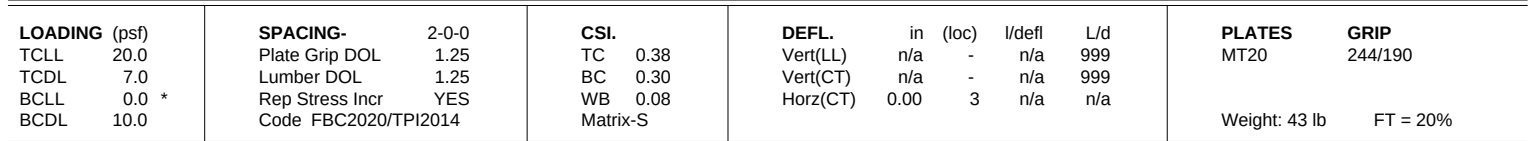

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.



Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350314
3125356	V05	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:23 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEeZke8Z-dXC3pNJPhnYLq5sk7ZXLbDoKInNrhLM2678YlyBbvs

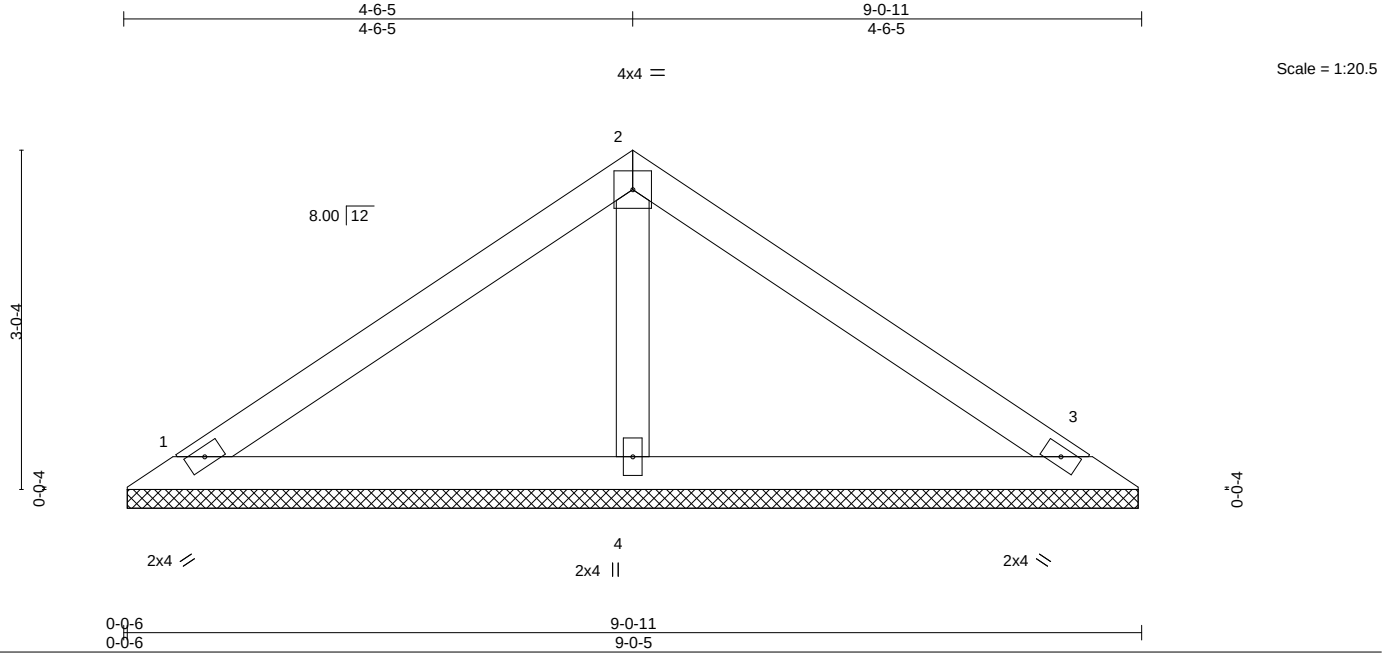

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.20	Vert(LL)	n/a	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.16	Vert(CT)	n/a				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-S							
								Weight: 31 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=8-11-15, 3=8-11-15, 4=8-11-15
Max Horz 1=-86(LC 8)
Max Uplift 1=-68(LC 12), 3=-79(LC 13), 4=-87(LC 12)
Max Grav 1=147(LC 1), 3=148(LC 20), 4=306(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 4-6-5, Exterior(2R) 4-6-5 to 7-6-5, Interior(1) 7-6-5 to 8-6-14 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350315
3125356	V06	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:24 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMxEZke8Z-5kiR1jK1i_vPz_g2lr4mupm_vl85a8nWHmti4CyBbvr

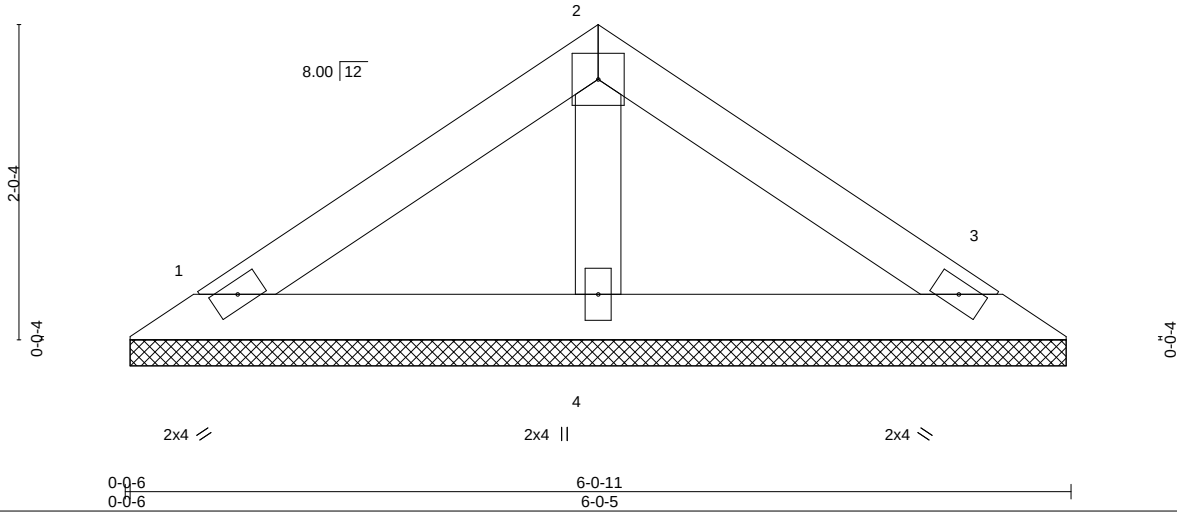

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.15	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-P					Weight: 20 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=5-11-15, 3=5-11-15, 4=5-11-15
Max Horz 1=54(LC 9)
Max Uplift 1=-51(LC 12), 3=-58(LC 13), 4=-38(LC 12)
Max Grav 1=101(LC 1), 3=101(LC 1), 4=175(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350317
3125356	V08	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:27 2022 Page 1
ID:Q7RwmdgDYh8qcxUfiYMXEEzke8Z-VJRZfIMv?vH_qSPdzzdTVROU?w9QnUkyzk5MhXyBbvo

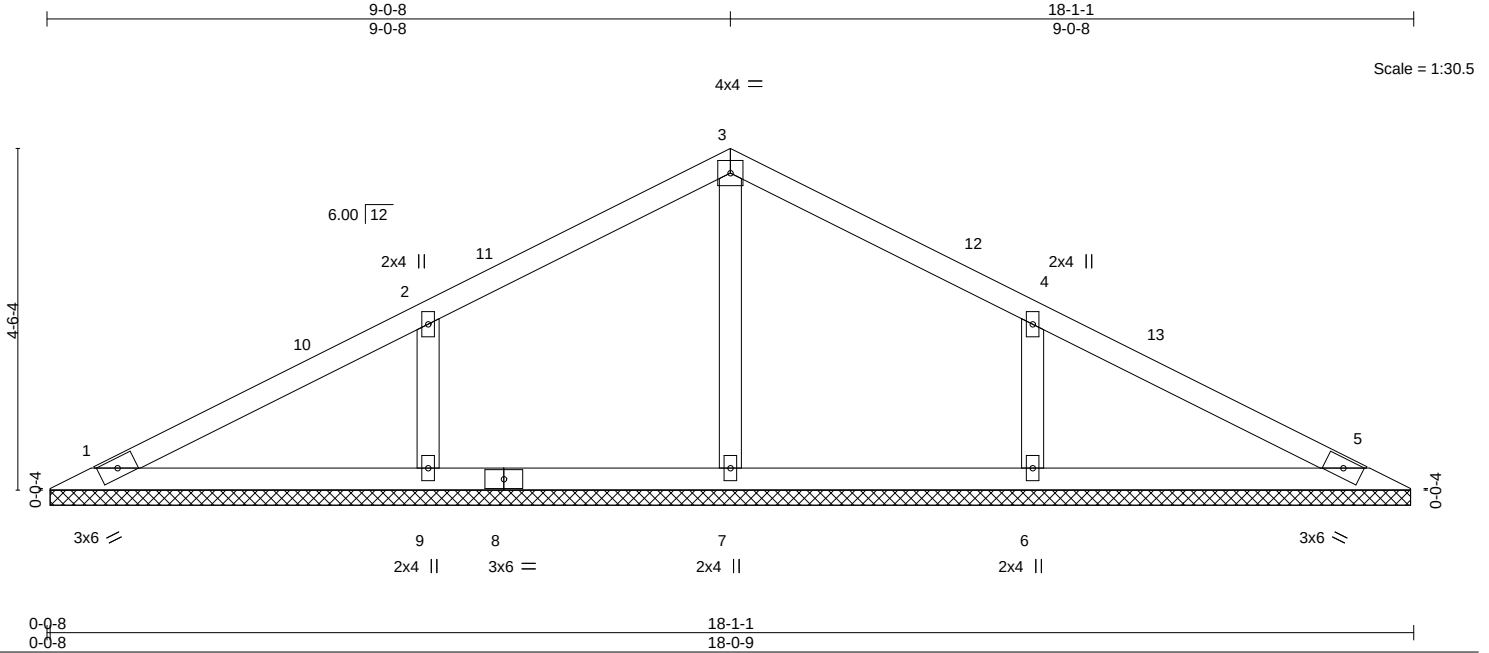

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.22	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.15	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 66 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 18-0-1.

(lb) - Max Horz 1=91(LC 16)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 7 except 9=246(LC 12), 6=246(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 9=376(LC 23), 6=376(LC 24)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-272/281, 4-6=-272/281

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 9-0-8, Exterior(2R) 9-0-8 to 12-0-8, Interior(1) 12-0-8 to 17-5-8 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 7 except (jt=lb) 9=246, 6=246.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350318
3125356	V09	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:28 2022 Page 1
ID: Q7RwmdgDYh8qcXUfiYMxEEzke8Z-zV?xt5NXmDPsBzpXg9i2fwfdJWCWx35CNrvDzyBbnv

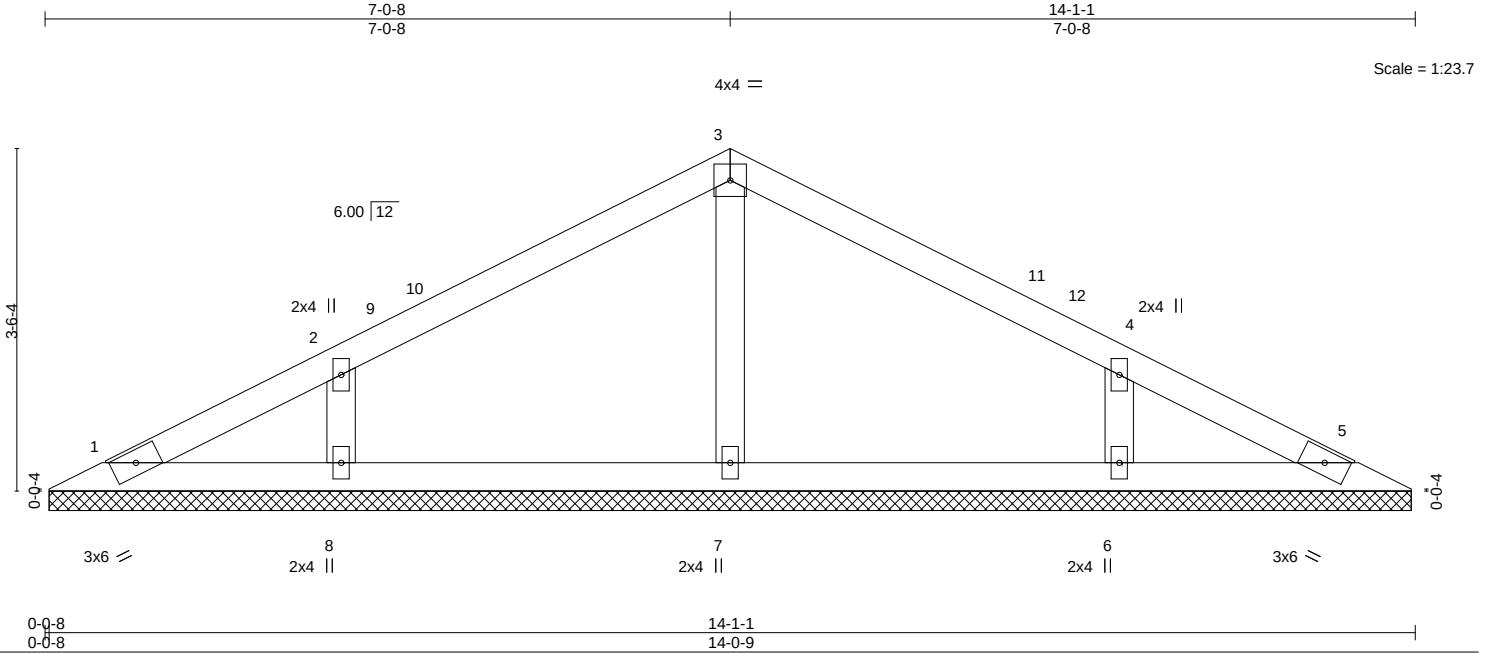

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.17	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.12	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 49 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 14-0-1.
(lb) - Max Horz 1=69(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 7 except 8=191(LC 12), 6=191(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=265(LC 1), 8=286(LC 23), 6=286(LC 24)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-215/264, 4-6=-215/264

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 7-0-8, Exterior(2R) 7-0-8 to 10-0-8, Interior(1) 10-0-8 to 13-5-8 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 7 except (jt=lb) 8=191, 6=191.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:29 2022 Page 1
 ID:Q7RwmdgDyH8qcxUfiYMXeEzke8Z-ShZK4QOAXXi3lY04OgxasTohjQKFONFQ1aTlPyBbvm
 5-0-8 10-1-1
 5-0-8 5-0-8

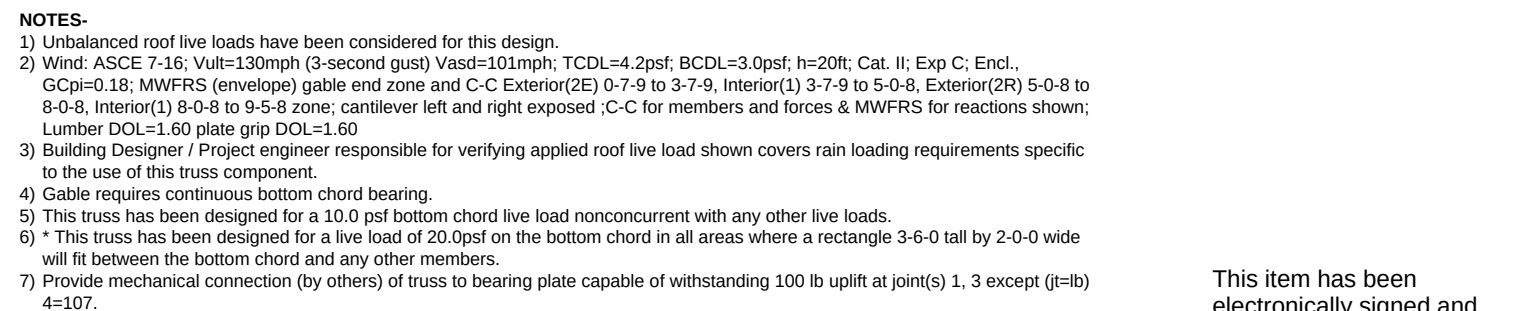


16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - ROBERTS RES.	T29350320
3125356	V11	Valley	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Dec 6 18:36:30 2022 Page 1
ID:Q7RwmdgDYh8qcXUfiYMxEZEke8Z-wu7ilmPolqfZhv7Ce5BA740?r78v_snOfhK0IryBbvl



3x6 =

Scale = 1:12.1

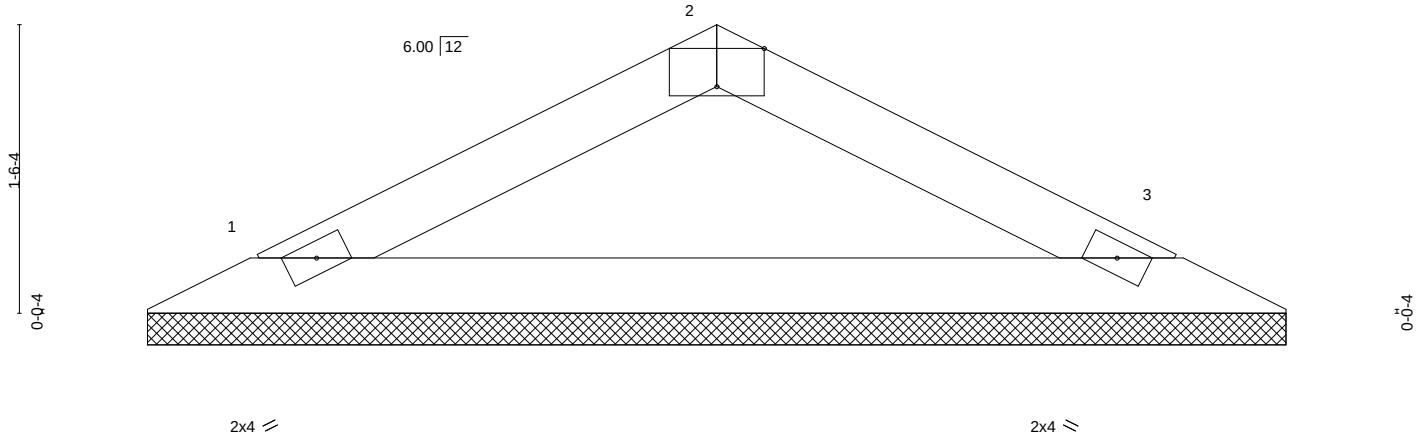

0-0.8		6-1-1								
0-0.8		6-0-9								
Plate Offsets (X,Y)-- [2:0-3-0,Edge]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	n/a - n/a	999	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	n/a - n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00 3 n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-P					Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-0-1, 3=6-0-1
Max Horz 1=26(LC 16)
Max Uplift 1=-69(LC 12), 3=-69(LC 13)
Max Grav 1=179(LC 1), 3=179(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 7,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless X, Y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

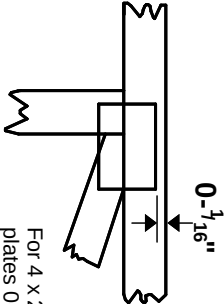

For 4 x 2 orientation, locate plates 0- $\frac{3}{16}$ " from outside edge of truss.

— This symbol indicates the required direction of slots in connector plates.

*** Plate location details available in MITek 20120 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

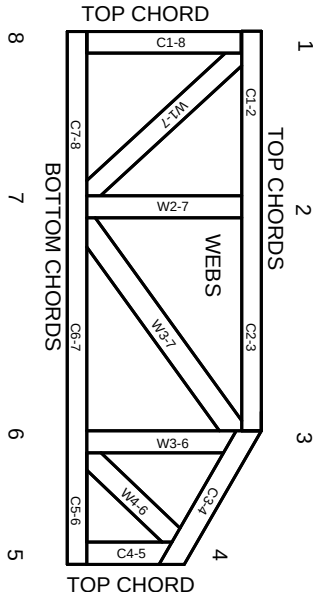

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.