


END WALL BRACING FOR CEILING DIAPHRAGM

(ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1			6 in. o.c. EDGE 6 in. o.c. FIELD
2	7/16 " 0.9.B. OR 15/32 CDX	2 ½"XO.131" RING SHANK NAILS or 3"XO.120" RING SHANK NAILS	6 in. o.c. EDGE 6 in. o.c. FIELD
3			4 in. o.c. @ GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 6 in. o.c. FIELD

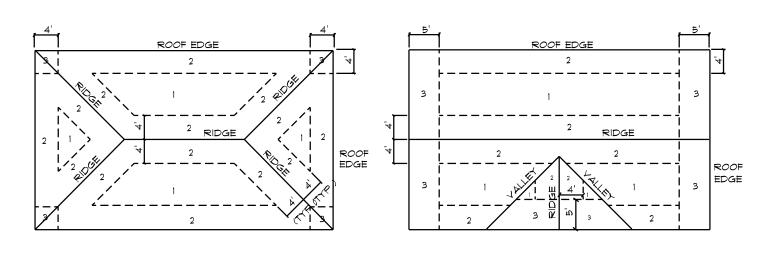

Roof Nail Pattern DET.

ROOF SHEATHING NAILING ZONES

(HIP ROOF)

SCALE: NONE




W/BLOCK'G

NOTE: ALL INTERIOR DOOR


OPENINGS SHOULD BE FRAMED 2" WIDER THAN THEIR SPECIFIED SIZE,


ROOF SHEATHING NAILING ZONES


(GABLE ROOF)

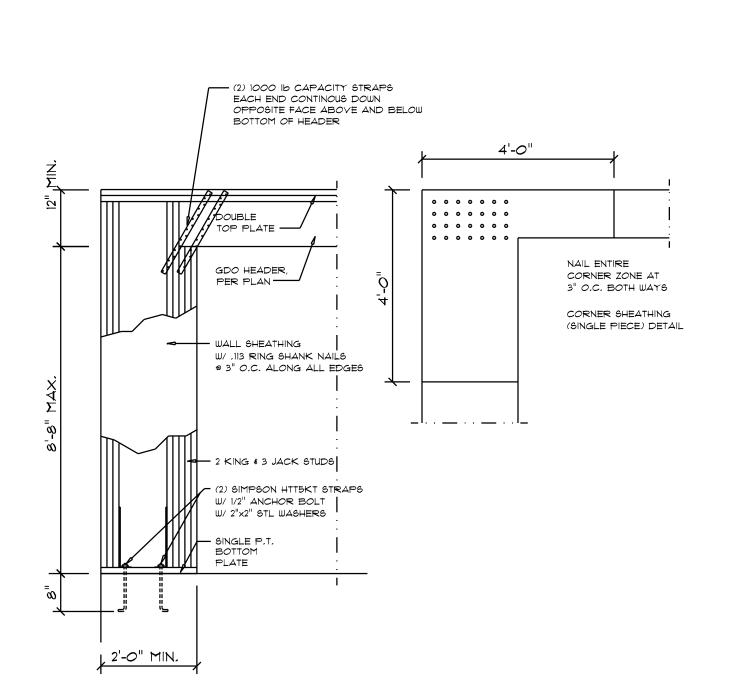


Garage End Wall DETAILS SCALE: 1/2" = 1'-0"

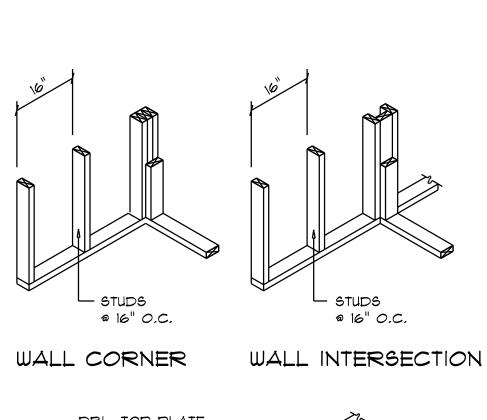

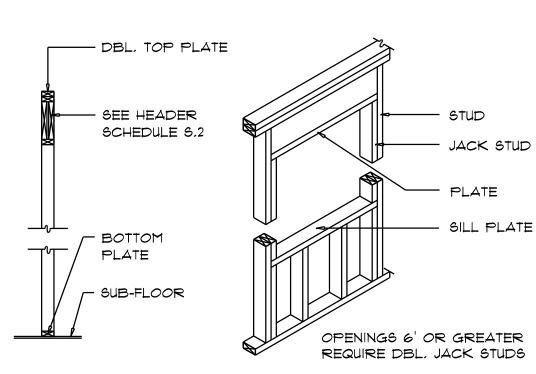

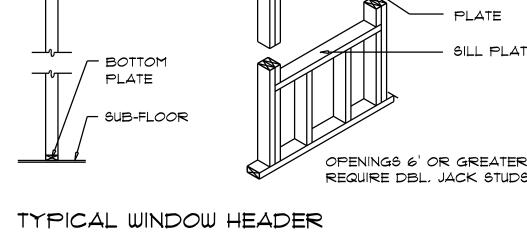

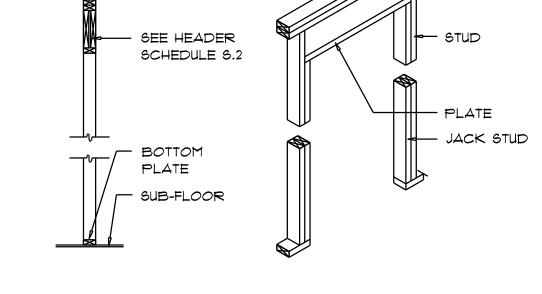

BEARING WALL HEADER

- DBL, TOP PLATE

HEADER

PLATE


SUB-FLOOR

NON-BEARING WALL HEADER


- DBL TOP PLATE

W/ BLOCKING



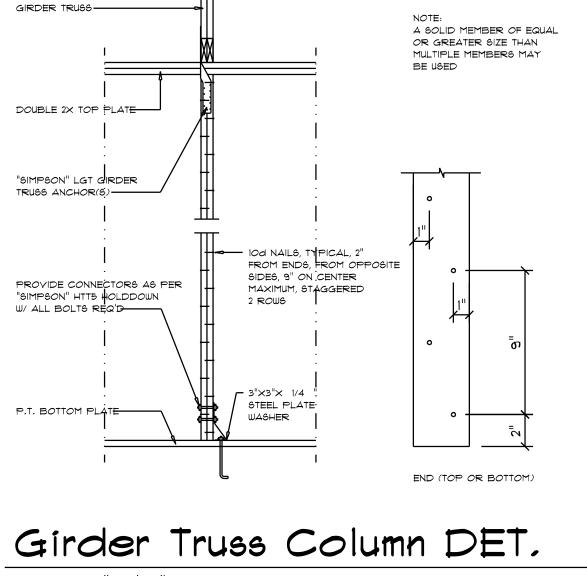




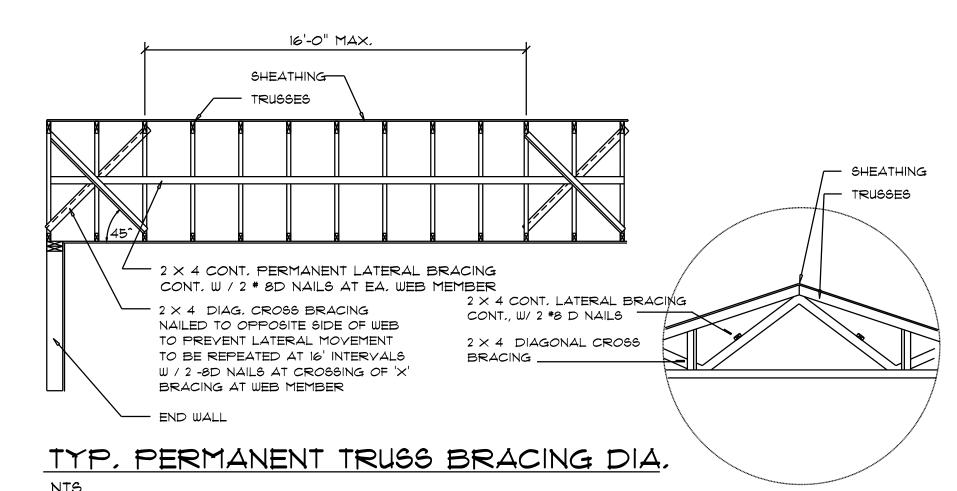

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE



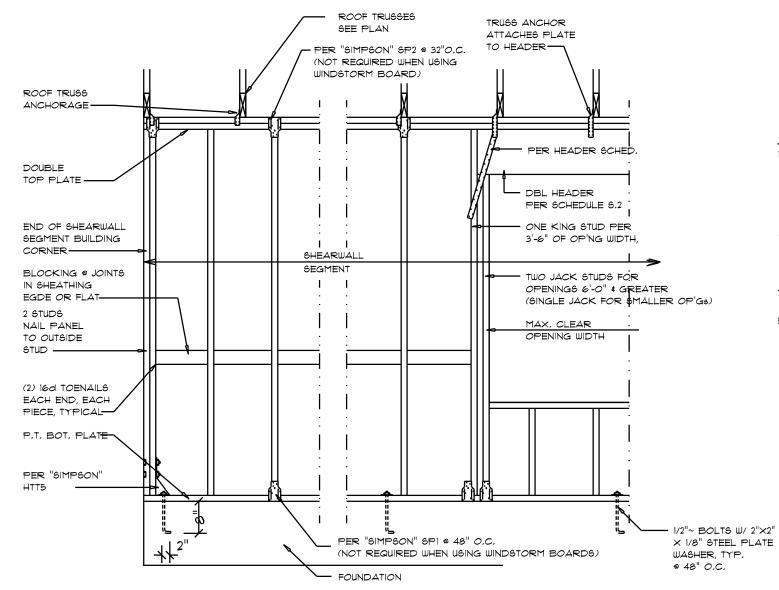

SHEARWALL NOTES: 1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS

- 2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/16" WINDSTORM BD INCLUDING AREAS ABOVE AND BELOW OPENINGS
- 3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING. 4. NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.
- 5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS, MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3"),

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0" > 6' TO 9'-0" > 9' TO 12'-0"	(1) 2x4 OR (1) 2x6 (3) 2x4 OR (1) 2x6 (5) 2x4 OR (2) 2x6	-

Shear Wall DETAILS

SCALE: NONE



THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. THE SIGNATURE MUST BE VERIFIED ON

