



END WALL BRACING FOR CEILING DIAPHRAGM

(ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

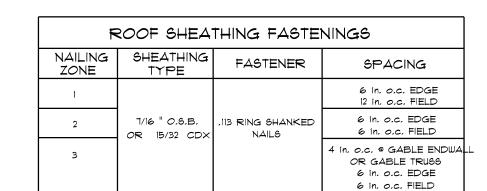

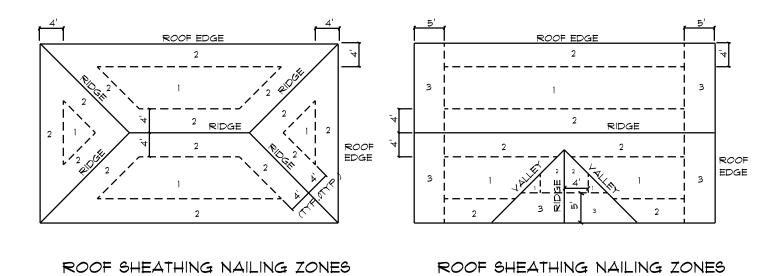

Roof Nail Pattern DET.


(HIP ROOF)





DBL. TOP PLATE


HEADER


W/ BLOCKING

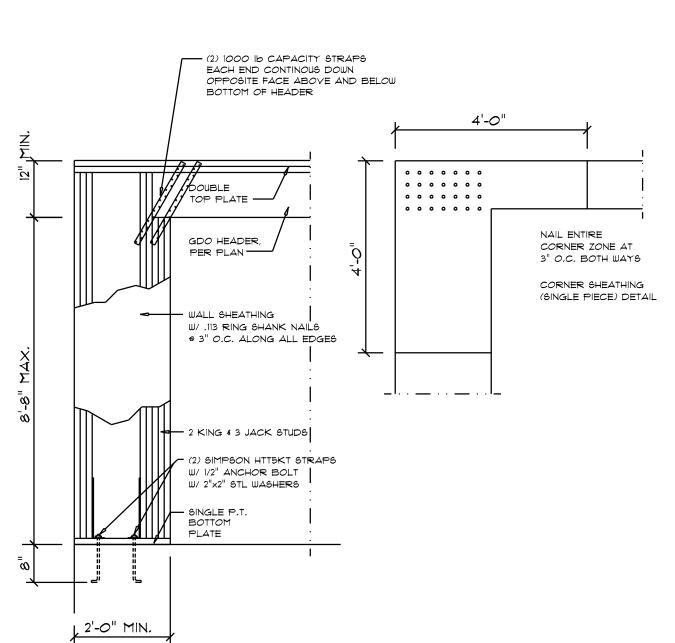

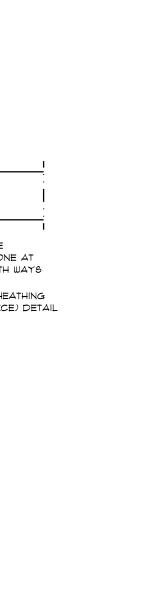

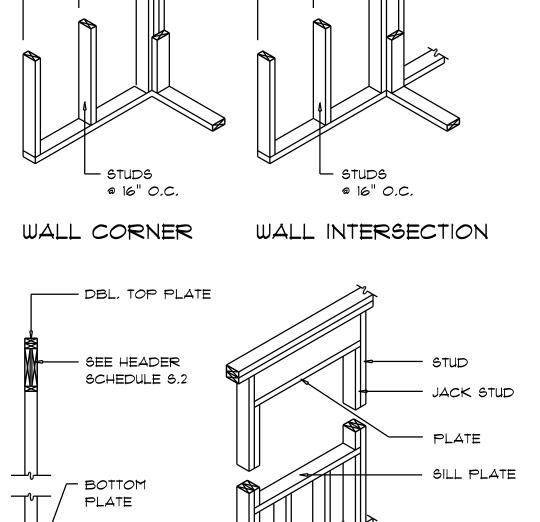


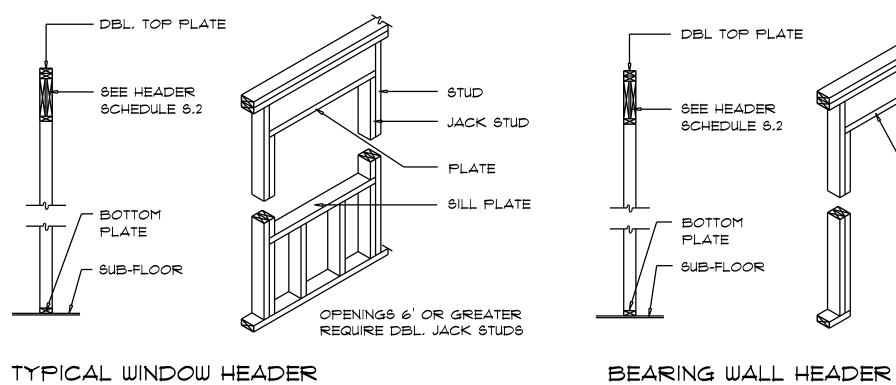

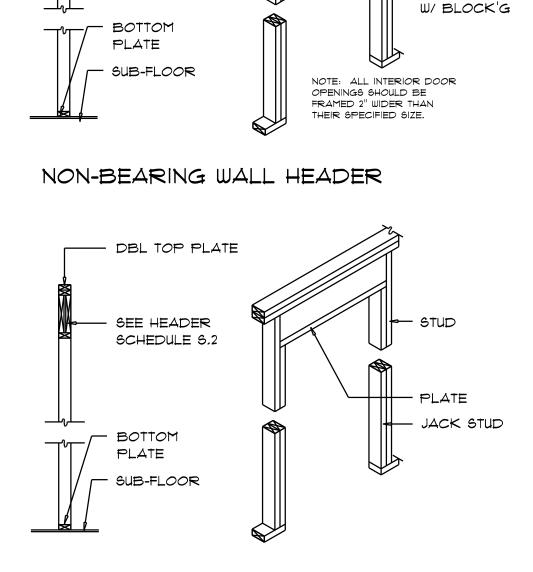


(GABLE ROOF)



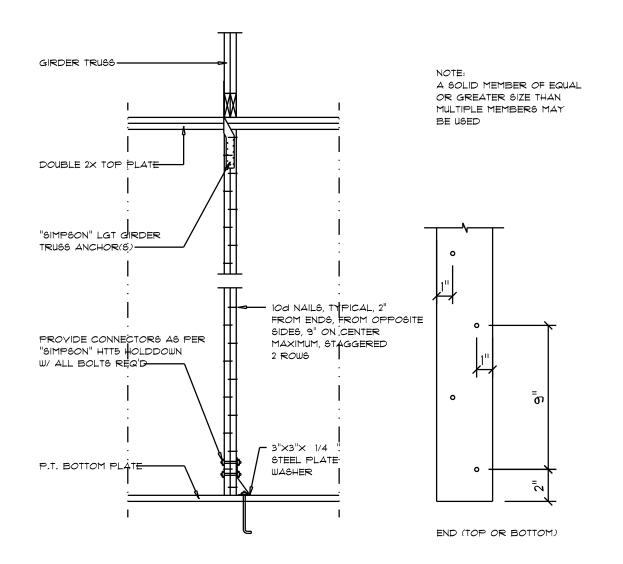




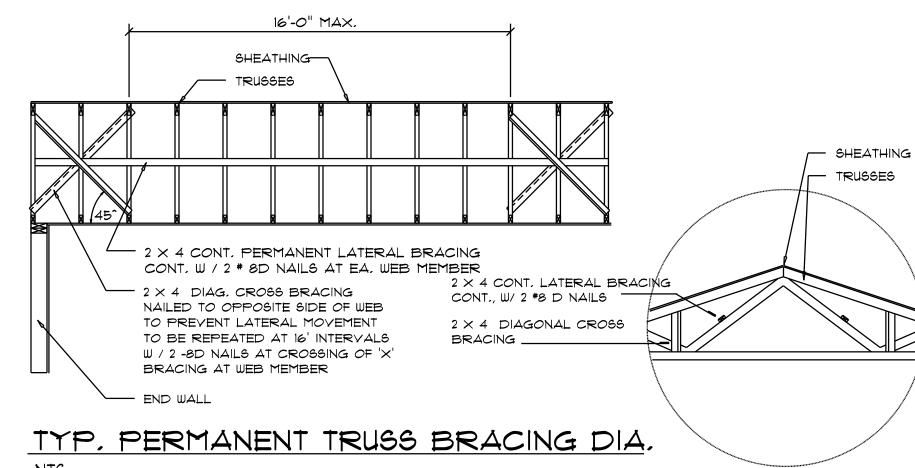

NTS NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE



SCALE: AS NOTED

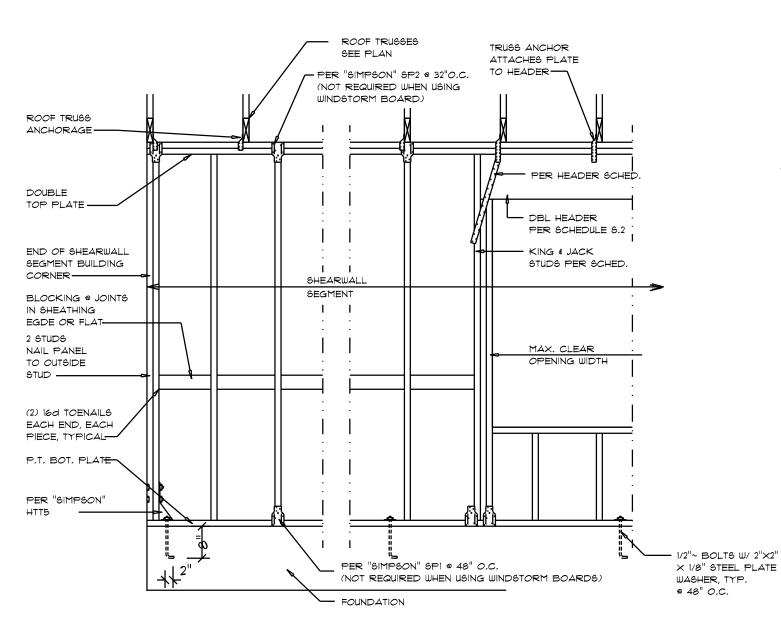

SHEARWALL NOTES: 1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS


- 2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/16" WINDSTORM BD INCLUDING AREAS ABOVE AND BELOW OPENINGS
- 3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
- 4. NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.

D


5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS, MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT, THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3,5 FOR 8'-0" WALLS (2'-3"),

OPENING WIDTH	SILL PLATES	IGA TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3







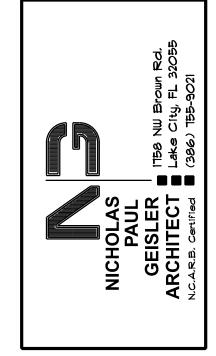

SHEET NUMBER OF 4 SHEETS

Digitally signed by Nicholas as 2025.05.23 Geisler 15:41:04 -04'00'

