


56

# Application for Onsite Sewage Disposal System Construction Permit. Part II Site Plan

Permit Application Number: 12-0402

**ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT**

CR# 10-5507

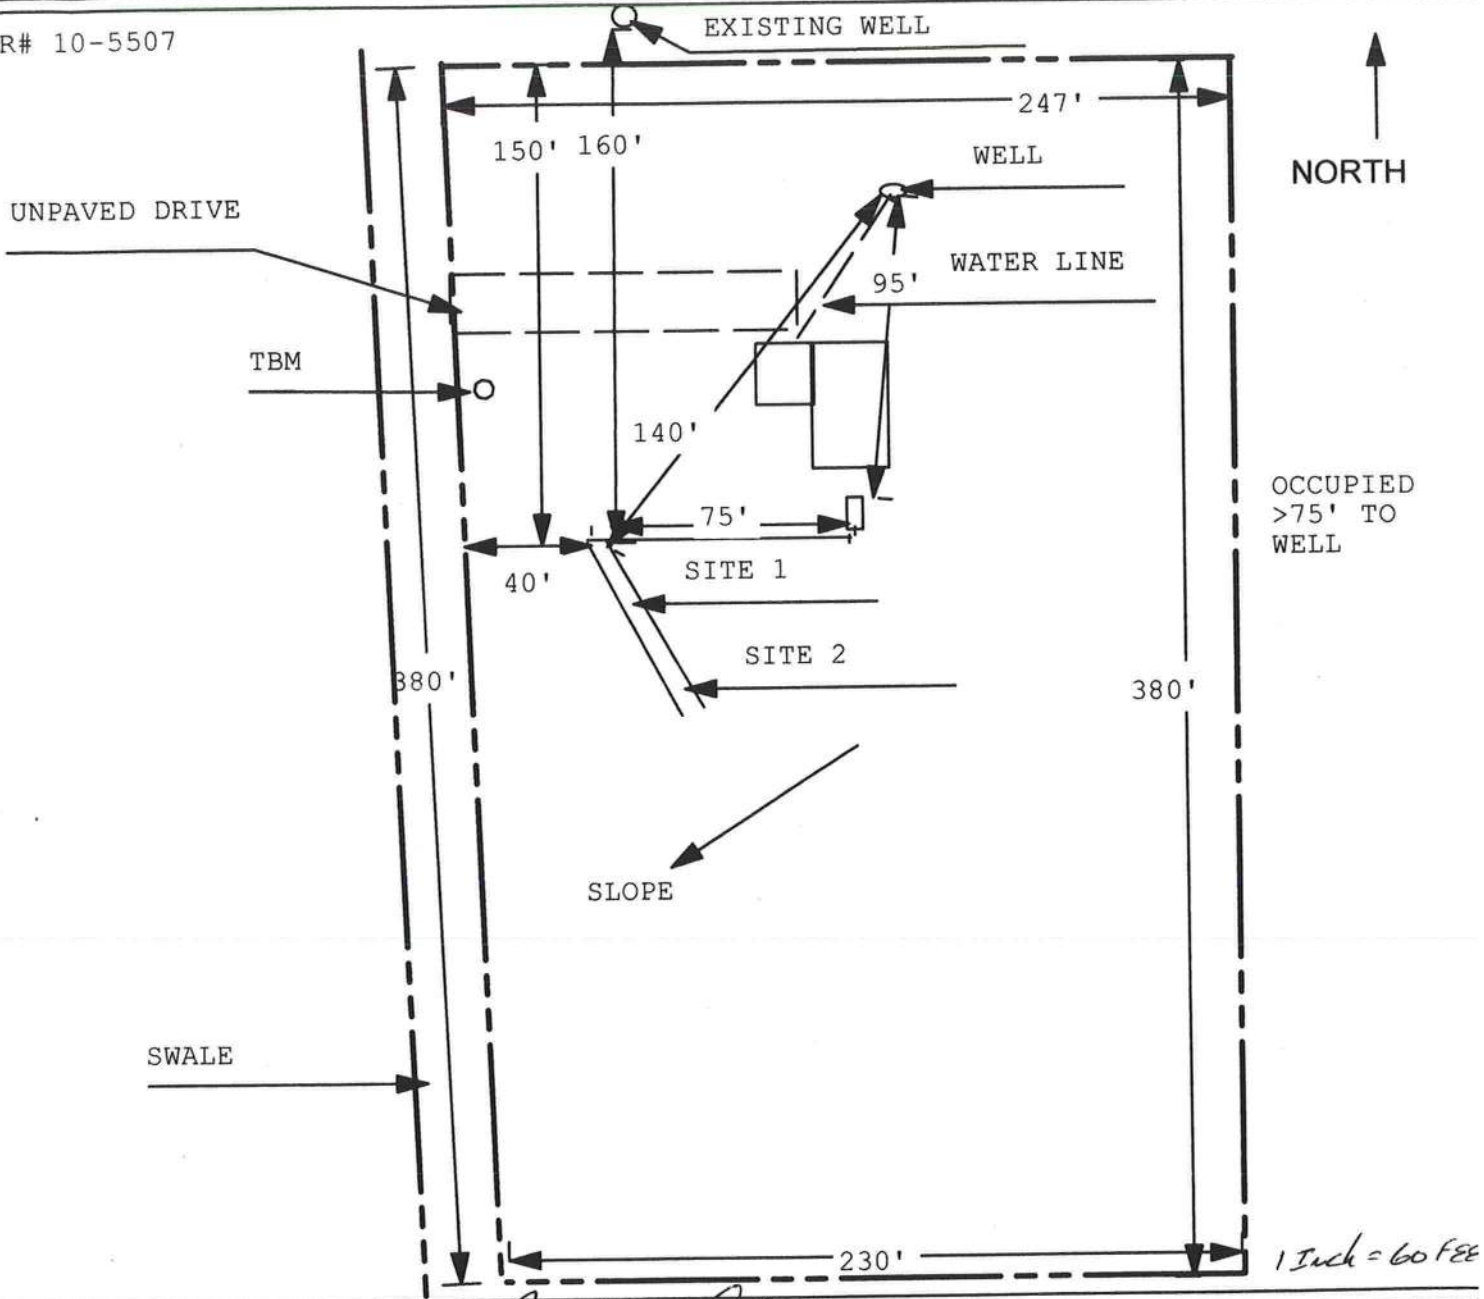

Site Plan Submitted By Paul R. Rapp Date 9/3/12  
 Plan Approved X Not Approved            Date 9/3/12

**Columbia CHD** CPHU

By [Signature]

Notes:

[Signature]



56

STATE OF FLORIDA  
DEPARTMENT OF HEALTH  
ONSITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM  
APPLICATION FOR CONSTRUCTION PERMIT

CR # 10-5507

PERMIT NO. 12-0402  
DATE PAID: 9/4/12  
FEE PAID: 310.00  
RECEIPT #: 199330  
AP 1082140

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative  
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: WILLIAM ROBINSON

AGENT: PAUL LLOYD

TELEPHONE: (386) 623-3143

MAILING ADDRESS: 4984 BURLEY AVE.

LAKE CITY FL 32024

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: N/A BLOCK: N/A SUBDIVISION: METES AND BOUNDS PLATTED: \_\_\_\_\_

PROPERTY ID #: 07-05S-17-09252-008 ZONING: RES I/M OR EQUIVALENT: ☐ NO ☐

PROPERTY SIZE: 2.090 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐  $\leq 2000$  GPD ☐  $> 2000$  GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☐ NO ☐ DISTANCE TO SEWER: N/A FT

PROPERTY ADDRESS: 333 SW LITTLE RD.

DIRECTIONS TO PROPERTY: SR 47 SOUTH TO COLUMBIA CITY, TURN LEFT ON CR 240 TURN LEFT ON LITTLE RD. AROUND CURVE SITE ON RIGHT.

BUILDING INFORMATION ☒ RESIDENTIAL ☐ COMMERCIAL

Unit No.	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	<u>HOUSE</u>	<u>3</u>	<u>1,715</u>	
2				
3				
4				

☐ Floor/Equipment Drains ☒ Other (Specify) \_\_\_\_\_

SIGNATURE: Paul Lloyd

DATE: 9/3/12

56



STATE OF FLORIDA  
DEPARTMENT OF HEALTH  
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM  
CONSTRUCTION PERMIT

PERMIT #: 12-SC-1428377  
APPLICATION #: AP1082190  
DATE PAID: 9/4/12  
FEE PAID: 310.00  
RECEIPT #: 1993910  
DOCUMENT #: PR884427

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: WILLIAM\*\*12-0402 ROBINSON

PROPERTY ADDRESS: 333 SW LITTLE Rd Lake City, FL 32024

LOT: \_\_\_\_\_ BLOCK: \_\_\_\_\_ SUBDIVISION: \_\_\_\_\_

PROPERTY ID #: 09252-008

[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]  
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [ 900 ] GALLONS / GPD \_\_\_\_\_ Septic \_\_\_\_\_ CAPACITY  
A [ ] GALLONS / GPD \_\_\_\_\_ N/A \_\_\_\_\_ CAPACITY  
N [ ] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]  
K [ ] GALLONS DOSING TANK CAPACITY [ ] GALLONS @ [ ] DOSES PER 24 HRS #Pumps [ ]

D [ 375 ] SQUARE FEET \_\_\_\_\_ Drainfield \_\_\_\_\_ SYSTEM  
R [ ] SQUARE FEET \_\_\_\_\_ N/A \_\_\_\_\_ SYSTEM

A TYPE SYSTEM: [x] STANDARD [ ] FILLED [ ] MOUND [ ]  
I CONFIGURATION: [x] TRENCH [ ] BED [ ]

F LOCATION OF BENCHMARK: Nail in 4" Oak tree north of system site.

I ELEVATION OF PROPOSED SYSTEM SITE [ 24.00 ] [ INCHES ] FT [ ] ABOVE [ ] BELOW BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [ 38.00 ] [ INCHES ] FT [ ] ABOVE [ ] BELOW BENCHMARK/REFERENCE POINT

L  
D FILL REQUIRED: [ 4.00 ] INCHES EXCAVATION REQUIRED: [ 0.00 ] INCHES

O The licensed contractor installing the system is responsible for installing the minimum category of tank in accordance with s. 64E-6.013(3)(f), FAC.

T  
H  
E  
R  
(\*) Note solid pipe required (site plan)

SPECIFICATIONS BY: PAUL LLOYD TITLE: PSE

APPROVED BY: Jeremy X Gifford TITLE: Environmental Specialist I Columbia CHD

DATE ISSUED: 09/07/2012 EXPIRATION DATE: 03/07/2014

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

Page 1 of 3

1.1.4

AP1082190

SE878413

56