

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and approval numbers on the building components listed below if they will be utilized on the construction project for which you are applying for a building permit. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. Statewide approved products are listed online @ [www.floridabuilding.org](http://www.floridabuilding.org)

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
<b>1. EXTERIOR DOORS</b>			
A. SWINGING	Jeld-Wen	Entry Door	13541.4
B. SLIDING			
C. SECTIONAL/ROLL UP			
D. OTHER			
<b>2. WINDOWS</b>			
A. SINGLE/DOUBLE HUNG			
B. HORIZONTAL SLIDER			
C. CASEMENT			
D. FIXED			
E. MULLION			
F. SKYLIGHTS			
G. OTHER			
<b>3. PANEL WALL</b>			
A. SIDING			
B. SOFFITS			
C. STOREFRONTS			
D. GLASS BLOCK			
E. OTHER			
<b>4. ROOFING PRODUCTS</b>			
A. ASPHALT SHINGLES			
B. NON-STRUCTURAL METAL			
C. ROOFING TILES			
D. SINGLE PLY ROOF			
E. OTHER			
<b>5. STRUCTURAL COMPONENTS</b>			
A. WOOD CONNECTORS			
B. WOOD ANCHORS			
C. TRUSS PLATES			
D. INSULATION FORMS			
E. LINTELS			
F. OTHERS			
<b>6. NEW EXTERIOR</b>			
<b>ENVELOPE PRODUCTS</b>			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.

Further, I understand these products may have to be removed if approval cannot be demonstrated during inspection.


  
 Contractor OR Agent Signature

6/27/2025

Date

NOTES: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > 
 [Product or Application Search](#) > 
 **Application List**

► OFFICE OF THE  
SECRETARY

## Search Criteria

[Refine Search](#)

Code Version	2023	FL#	13541.4
Application Type	ALL	Product Manufacturer	ALL
Category	ALL	Subcategory	ALL
Application Status	ALL	Compliance Method	ALL
Quality Assurance Entity	ALL	Quality Assurance Entity Contract Expired	ALL
Product Model, Number or Name	ALL	Product Description	ALL
Approved for use in HVHZ	ALL	Approved for use outside HVHZ	ALL
Impact Resistant	ALL	Design Pressure	ALL
Other	ALL		

## Search Results - Applications

FL#	Type	Manufacturer	Validated By	Status
<a href="#">FL13541-R19</a> <a href="#">History</a>	Affirmation	Jeld-Wen <b>FL#:</b> FL13541.4 <b>Model:</b> D. Design Pro / Smooth Pro Fiberglass <b>Description:</b> Double (XX) Glazed Fiberglass Door, 6'-0" x 6'-8" and 6'-0" x 8'-0", Inswing and Outswing <b>Category:</b> Exterior Doors <b>Subcategory:</b> Swinging Exterior Door Assemblies	National Accreditation & Management Institute (804) 684-5124	Approved

\*Approved by DBPR. Approvals by DBPR shall be reviewed and ratified by the POC and/or the Commission if necessary.

[Contact Us](#) :: 2601 Blair Stone Road, Tallahassee FL 32399 Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. \*Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

### Product Approval Accepts:





# JELD-WEN® WINDOWS & DOORS

## DESIGN PRO / SMOOTH PRO FULL LITE NON-IMPACT FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE (HVHZ)

### GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT INTERNATIONAL BUILDING CODE (IBC), INTERNATIONAL RESIDENTIAL CODE (IRC), AND FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - ASTM E2330-02
  - ASTM E283-04
  - AAMA 1304-02
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY OR 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS **REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.
- FULL LITE APPROVAL COVERS USE OF FRACTIONAL GLAZING, INCLUDING INTERNAL GRID, BLINDS BETWEEN GLASS, DECORATIVE, AND EXTERNAL AND INTERNAL WROUGHT IRON. RADIUS (SHAPED) LITES ARE QUALIFIED FOR 6'-8" DOORS AT DP +/-50 PSF ONLY.
- NOTE: AFCO H-497 SILL MEETS WATER INFILTRATION AT WATER TEST PRESSURE (WTP) OF 9.0 PSF. REMAINING SILLS NOT RATED FOR WATER INFILTRATION. IF AUTHORITY HAVING JURISDICTION REQUIRES THAT PRODUCT MEETS THIS REQUIREMENT, PRODUCT SHALL BE USED WHEN INSTALLED AT LOCATION PROTECTED BY OVERHANG SUCH THAT OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥ 1.0

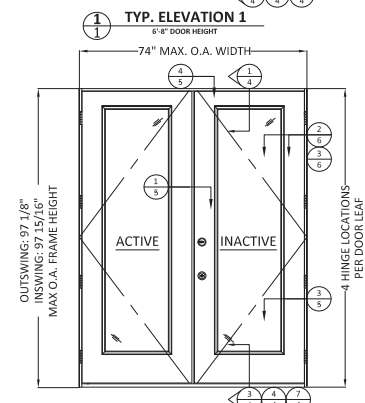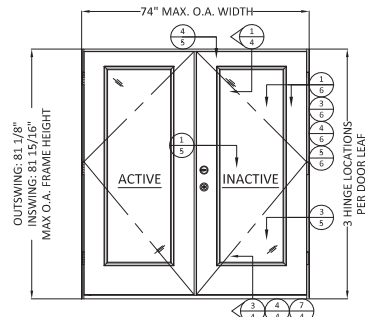

**NOTE:**  
INACTIVE AND ACTIVE DOOR PANEL  
ORIENTATION IS INTERCHANGEABLE.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	A	TYPICAL ELEVATIONS, DESIGN PRESSURES, AND GENERAL NOTES
2	A	TYPICAL ANCHOR LAYOUTS AND NOTES
3	-	OPTIONAL 2X BUCK ANCHORING DETAILS
4	-	VERTICAL ASSEMBLIES
5	A	HORIZONTAL ASSEMBLIES
6	A	GLAZING DETAILS
7	-	WOOD SUBSTRATES
8	-	CONCRETE SUBSTRATES
9	A	COMPONENTS & BILL OF MATERIALS

CONFIGURATION	MAX. OVERALL NOMINAL SIZE		DESIGN PRESSURE (PSF)				MISSILE IMPACT RATING
	WIDTH	HEIGHT	INSWING		OUTSWING		
			POS.	NEG.	POS.	NEG.	
XX	6'-0"	6'-8"	50*	50	50*	50	NON-IMPACT
XX RADIUS	6'-0"	6'-8"	50*	50	50*	50	NON-IMPACT
XX	6'-0"	8'-0"	50*	50	50*	50	NON-IMPACT

\*SEE GENERAL NOTE 7, SHEET 1, FOR WATER INFILTRATION APPROVED SILLS.

PREPARED BY:  
  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399 8470  
FAX: (954) 744 4730  
WEB: www.buildingdrops.com

TITLE: DESIGN PRO / SMOOTH PRO FULL LITE  
NON-IMPACT  
TYPICAL ELEVATIONS, DESIGN  
PRESSURES, AND GENERAL NOTES

3737 LANEPOR BLVD.  
KIAMATH FALLS, OR 97601  
PH: (541) 882-3451  
FAX: (541) 850-2609

**JELD-WEN®  
WINDOWS & DOORS**

REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A010834A	AM	09/04/19

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



Digitally signed by Hermes F. Norero  
Reason: I am approving this document  
Date: 2019.12.12 13:19:12 -05'00'


DATE: 02.05.14  
DWG. BY: GL/TJM  
CHK. BY: SS/MSS  
SCALE: NTS  
DWG. #: D015689

SHEET: OF 9

1

# INSTALLATION NOTES:




- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE A NON-COMPRESSIBLE COMPOSITE OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING, AND SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- FOR 2X STUD CONSTRUCTION, ANCHORING OF THESE PRODUCTS SHALL BE THE SAME AS FOR 2X BUCK CONCRETE/MASONRY CONSTRUCTION.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:  
A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.  
B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.  
C. GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.  
D. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
- SEE SHEETS 7 AND 8 FOR MORE DETAILS OF THE INSTALLATION REQUIREMENTS, INCLUDING ANCHOR LOCATIONS, EDGE DISTANCES, EMBEDMENTS, AND SHIM SPACING.
- OPTIONALLY, ANCHORS CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT AND EDGE DISTANCE ARE ACHIEVED.

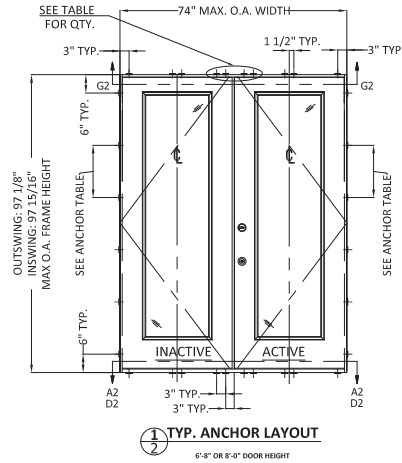

NOTE:  
INACTIVE AND ACTIVE DOOR PANEL  
ORIENTATION IS INTERCHANGEABLE.

ANCHOR TABLE

ANCHOR TYPE	ANCHOR SIZE	SUBSTRATE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	6'8" DOORS		8'0" DOORS	
					MAX. O.C. SPACING AT JAMBS	# OF ANCHORS AT HEAD/SILL CLUSTERS	MAX. O.C. SPACING AT JAMBS	# OF ANCHORS AT HEAD/SILL CLUSTERS
WOOD SCREW	#10	2X WOOD BUCK OR FRAMING	1-1/2"	3/4"	17-1/2"	4	17-1/4"	4
ITW TAPCON	3/16"	CONCRETE/CMU	1-1/4"	2-1/2"	17-1/2"	4	17-1/4"	4
ELCO ULTRACON	1/4"	CONCRETE/CMU	1-3/8" - CONC. 1-1/4" - CMU	1"	17-1/2"	4	17-1/4"	4
ITW TAPCON	3/16"	CONCRETE/CMU	1-1/4"	1"	11-5/8"	8	14-3/8"	6

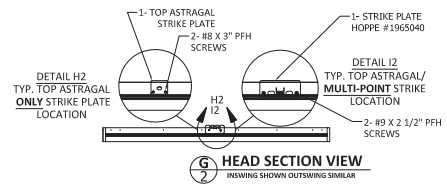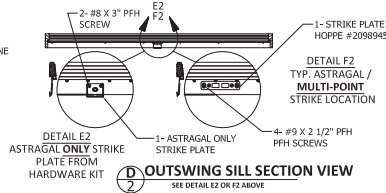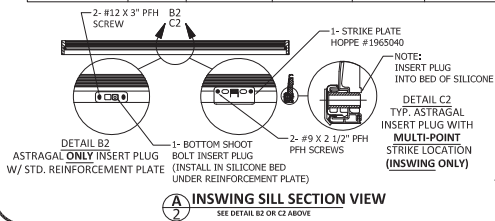

PREPARED BY:



**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 359-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

TITLE: DESIGN PRO/SMOOTH PRO FULL LITE NON-IMPACT ANCHOR LAYOUTS AND NOTES


3737 LAKEPORT BLVD.,  
KILAMATH FALLS, OR 97601  
PH: (541) 882-3451  
FAX: (541) 850-2609  
**JELD-WEN**  
WINDOWS & DOORS

REMARKS BY DATE

Add Multi-Point Lock GL 06/12/14

Reference DWG. #A010834A AM 09/04/19

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS.



DATE: 02.05.14


DWG. BY: GL/TJM CHK. BY: SS/MSS

SCALE: NTS


DWG. #: D015689

SHEET: OF 9


2

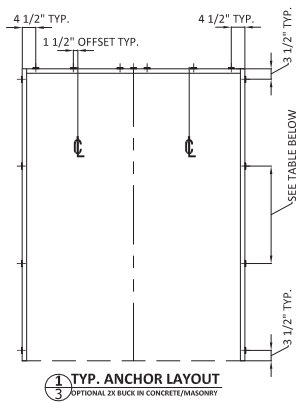

1 TYP. ANCHOR LAYOUT  
OPTIONAL 2X BUCK IN CONCRETE/MASONRY



3 2X WOOD BUCK INSTALL.  
CROSS SECTION



4 2X WOOD BUCK INSTALL.  
SIDE VIEW

- NOTES:
- 2X BUCK IS NOT FOR INSTALLATION AT SILL. THRESHOLD SHALL BE FASTENED IN ACCORDANCE WITH ANCHOR LOCATIONS SHOWN ON SHEET 2.
  - ANCHORS MAY BE STAGGERED AS SHOWN IN DETAIL 4/3.

2X BUCK ANCHOR TABLE							
ANCHOR TYPE	ANCHOR SIZE	SUBSTRATE	MIN. EMBEDMENT	MIN. EDGE DIST. TO SUBSTRATE	MIN. CENTER TO CENTER DISTANCE	6'8" DOORS	8'0" DOORS
						MAX. O.C. SPACING AT JAMBS	MAX. O.C. SPACING AT JAMBS
ITW TAPCON	1/4"	CONCRETE/CMU	1-1/4"	2-1/2"	4"	25"	30-1/4"
ELCO ULTRACON	1/4"	CONCRETE/CMU	1-3/8" - CONC. 1-3/4" - CMU	1"	4"	25"	30-1/4"

PREPARED BY:

**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

TITLE:

DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT  
OPTIONAL 2X BUCK  
ANCHORING DETAILS

3977 LAKEPORT BLVD.  
KIAMATH FALLS, OR 97001  
PH: (541)882-3451  
FAX: (541)850-2609

**JELD-WEN**  
WINDOWS & DOORS


REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A010834A	AM	09/04/19

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE MODIFICATION TO BE MADE FROM THE REQUIREMENTS DETAIL HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTATION.


HERMES P. NORERO  
LICENSED PROFESSIONAL ENGINEER  
No. 73778  
STATE OF FLORIDA  
EXPIRATION DATE: 12/31/2018  
FIRM: BUILDING DROPS, INC.

DATE:	02.05.14
DWG. BY:	GL/TJM
CHK. BY:	SS/MSS
SCALE:	NTS
DWG. #:	D015689
SHEET:	OF 9


3




**1**  
**4** **OPERABLE HEAD**  
OUTSWING SHOWN - INSWING SIMILAR




**3**  
**4** **OPERABLE SILL**  
INSWING



**4**  
**4** **OPERABLE SILL**  
OUTSWING



**5**  
**4** **OPERABLE ADA SILL**  
INSWING/OUTSWING



**7**  
**4** **OPERABLE SILL**  
OUTSWING  
OPTIONAL AFCH H-497

PREPARED BY:



**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

TITLE: DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT


VERTICAL ASSEMBLIES

3737 LAKEPORT BLVD.  
SUITE 200  
DADE CITY, FL 34601  
PH: (841)882-3451  
FAX: (841)850-2609

**JELD-WEN**  
WINDOWS & DOORS


REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A01083AA	AM	09/04/10

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN. A LICENSED ENGINEER SHALL PREPARE SITE SPECIFIC DOCUMENT.



DATE: 02.05.14	
DWG. BY: GL/TJM	CHK. BY: SS/MSS
SCALE: NTS	
DWG. #: D015689	
SHEET: OF 9	


4




**1**  
**5** **MEETING STILE**  
OUTSWING SHOWN - INSWING SIMILAR

HINGE SCHEDULE	
DOOR HEIGHT	QUANTITY
6'-8"	3
8'-0"	4

HINGE DETAIL AT JAMB:  
PLACE #9 X 2-1/2" PFH SCREW NEXT TO WEATHERSTRIP

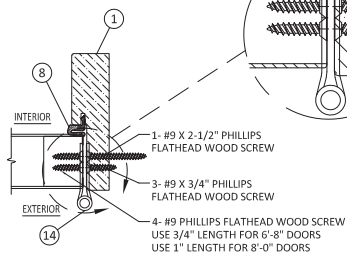

**3**  
**5** **HINGE JAMB**  
OUTSWING SHOWN - INSWING SIMILAR

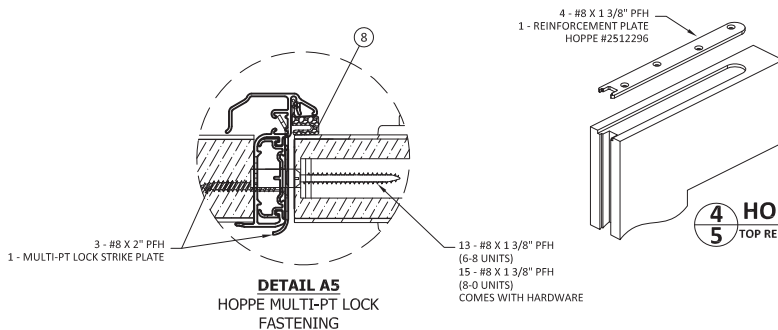


**4**  
**5** **HOPPE MULTI-POINT LOCK**  
TOP REINFORCEMENT PLATE - ACTIVE PANEL ONLY

PREPARED BY:  
  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com


TITLE: **DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT  
HORIZONTAL ASSEMBLIES**  
3737 LANEPOR BLVD.  
KALAMATH FALLS, OR 97601  
PH: (541) 882-9451  
FAX: (541) 850-2609  
**JELD-WEN**  
WINDOWS & DOORS

REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A010834A	AM	09/04/19


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAIL HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO REFLECT THE SAME.




DATE: 02.05.14	
DWG. BY: GL/TJM	CHK. BY: SS/MSS
SCALE: NTS	
DWG. #: D015689	
SHEET: OF9	




**1 6'-8" GLAZING DETAIL**  
20 1/2" MAX. D.L.O. WIDTH  
62 1/2" MAX. D.L.O. HEIGHT




**2 8'-0" GLAZING DETAIL**  
20 1/2" MAX. D.L.O. WIDTH  
78 1/2" MAX. D.L.O. HEIGHT



**3 FLUSH GLAZE DETAIL**  
23 7/8" MAX. D.L.O. WIDTH  
78 7/8" MAX. D.L.O. HEIGHT



**4 GLAZING DETAIL**  
FOR OVAL, SUNBURST, AND ROUND TOPS  
ONLY IN 6'8" UNITS AT DP+/- 50 PSF




**5 GLAZING DETAIL OPTION**  
20 1/2" MAX D.L.O. WIDTH  
78 1/2" MAX D.L.O. HEIGHT  
3-0 X 6-8 - DP 50  
6-0 X 6-8 - DP 50  
3-0 X 8-0 - DP 50  
6-0 X 8-0 - DP 45

NOTE:  
FRACTIONAL GLAZING, INCLUDING INTERNAL GRID, BLINDS  
BETWEEN GLASS, DECORATIVE, EXTERNAL AND INTERNAL  
WROUGHT IRON AND RADIUS (SHAPED) LITES ARE APPROVED  
IN ALL GLAZING DETAILS SHOWN ABOVE.







PREPARED BY:  
  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

TITLE: DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT  
GLAZING DETAILS  
3737 LANEFORT BLVD.  
KAMATH FALLS, OR 97051  
PH: (541)882-9451  
FAX: (541)850-2609  
**JELD-WEN**  
WINDOWS & DOORS

REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A010834A	AM	09/04/19
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE MODIFICATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO REFLECT THE MODIFICATIONS.		
		

DATE: 02.05.14	
DWG. BY: GL/TJM	CHK. BY: SS/MSS
SCALE: NTS	
DWG. #: D015689	
SHEET: OF9	



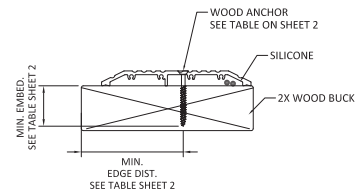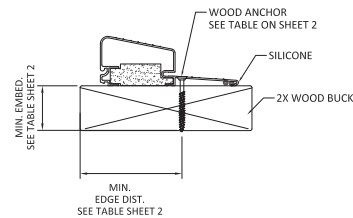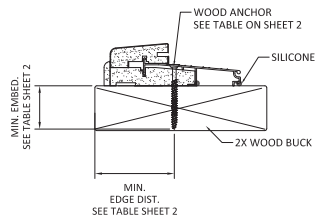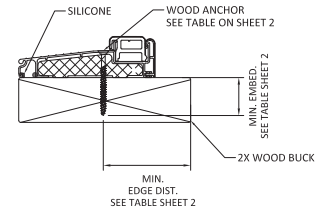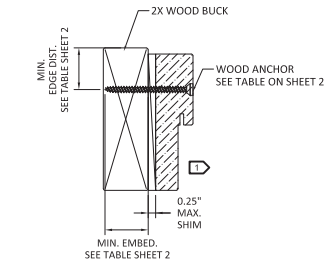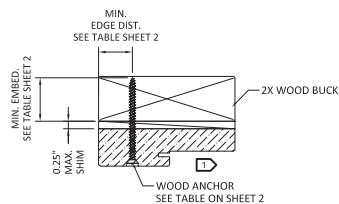

**1** OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT AND EDGE DISTANCE ARE ACHIEVED.

PREPARED BY:

**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: [www.buildingdrops.com](http://www.buildingdrops.com)

**TITLE:** DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT  
WOOD INSTALLATION

3737 LAKEPORT BLVD.,  
AMATH FALLS, OR 97601  
PH: (541)882-3451  
FAX: (541)850-2609

Downloaded from <http://ajph.org/> at University of California, San Diego on September 11, 2014


REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. #A010834A	AM	09/04/19
<p>THIS INSTALLATION OF LOCKS/DEVICES HEREIN ARE GENERAL AND MAY NOT REFLECT ALL ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTABILITY OR DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT MUST PREPARE A SITE SPECIFIC DOCUMENTS TO CORRECT THE DOCUMENT.</p>		

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




DATE: 02.05.14	
DWG. BY: GL/TJM	CHK. BY: SS/MSS
SCALE: NTS	
DWG. #: D015689	
SHEET: OF 9	


7

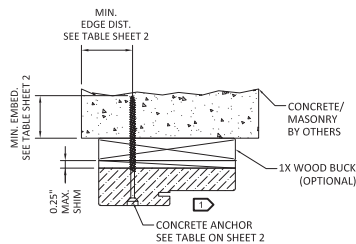


**1**  
**8** HEAD (TYPICAL)  
OUTSWING SHOWN - INSWING SIMILAR

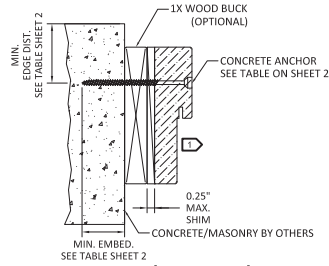


**2**  
**8** JAMB (TYPICAL)  
OUTSWING SHOWN - INSWING SIMILAR

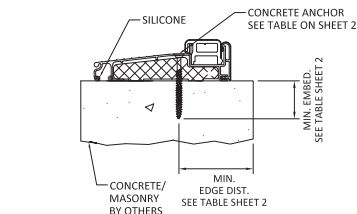


**3**  
**8** OPERABLE SILL  
INSWING

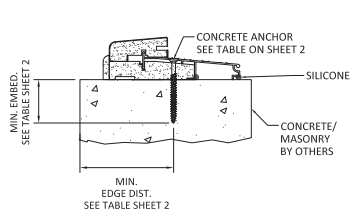

**4**  
**8** OPERABLE SILL  
OUTSWING

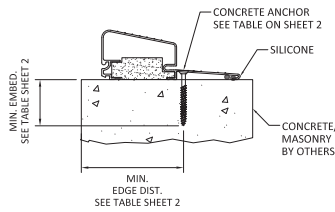

**5**  
**8** OPERABLE SILL  
HIGH BUMP OUTSWING  
AFCD H-497

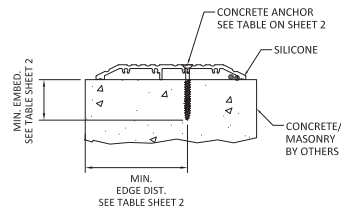

**6**  
**8** OPERABLE SILL  
ADA SILL

OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT AND EDGE DISTANCE ARE ACHIEVED.

PREPARED BY:

**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33504  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

TITLE: DESIGN PRO/SMOOTH PRO FULL LITE  
NON-IMPACT  
CONCRETE INSTALLATION

3737 LAKEPORT BLVD.  
KLAMATH FALLS, OR 97601  
PH: (541) 882-3451  
FAX: (541) 850-2609

REMARKS	BY	DATE
Add Multi-Point Lock	GL	06/12/14
Reference DWG. 8A010834A	AM	09/04/19

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT'S SHALL PREPARE SITE SPECIFIC DOCUMENTS TO REFLECT THE ACTUAL CONDITIONS.



DATE:	02.05.14
DWG. BY:	GL/TJM
CHK. BY:	SS/MSS
SCALE:	NTS
DWG. #:	D015689
SHEET:	OF 9

