



Scott E. Wyssling, PE  
Jon P. Ward, SE, PE  
Gregory T. Elvestad, PE

76 North Meadowbrook Drive  
Alpine, UT 84004  
office (201) 874-3483  
swyssling@wysslingconsulting.com

November 17, 2021

Ken Trappen  
Advanced Solar Solutions  
39650 Mallard  
Bass Lake, CA 93604

Scott E  
Wyssling

Digitally signed by Scott E Wyssling  
DN: C=US, S=Utah, L=Alpine, O=Wyssling  
Consulting, CN=Scott E Wyssling +  
E=swyssling@wysslingconsulting.com  
Reason: I am the author of this document  
Location: your signing location here  
Date: 2021.11.17 13:57:17-07'00'  
Foxit PDF Editor Version: 11.1.0

Re: Engineering Services  
Dodsworth Residence  
3035 County Road 18, Lake City FL  
6.500 kW System

To Whom It May Concern:

Pursuant to your request, we have reviewed the following information regarding ground mount solar panel installation at the above referenced location:


1. Structural calculations/requirements prepared by IronRidge identifying specific site requirements for the proposed ground mount system.
2. Design drawings of the proposed system including a site plan, and details for the solar panels. This information was prepared by Advanced Solar Solutions and will be utilized for approval and construction of the proposed system.

Based on our review of the Photovoltaic Array installed at 5 modules high and 4 modules wide. The PV array shall have an East/West spacing of 13'-4" feet on center and a North/South spacing of 9'-0" feet max. Based on a wind speed of 120 mph, Exposure C, it was determined that the minimum required footing depth is 60 inches below grade with a 18" diameter pier footing and the min post size is 2" Dia. The footing size based upon the worst case loading due to horizontal and vertical wind loading.




Based on the above evaluation, it is the opinion of this office that with appropriate construction the footing and post assembly will adequately support the proposed solar array. This evaluation is in conformance with the FBC 2020, 7<sup>th</sup> Edition, current industry and standards, and based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Very truly yours,

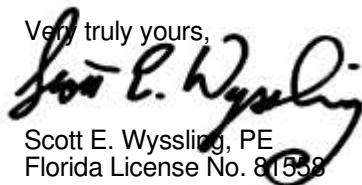  
Scott E. Wyssling, PE  
Florida License No. 81538

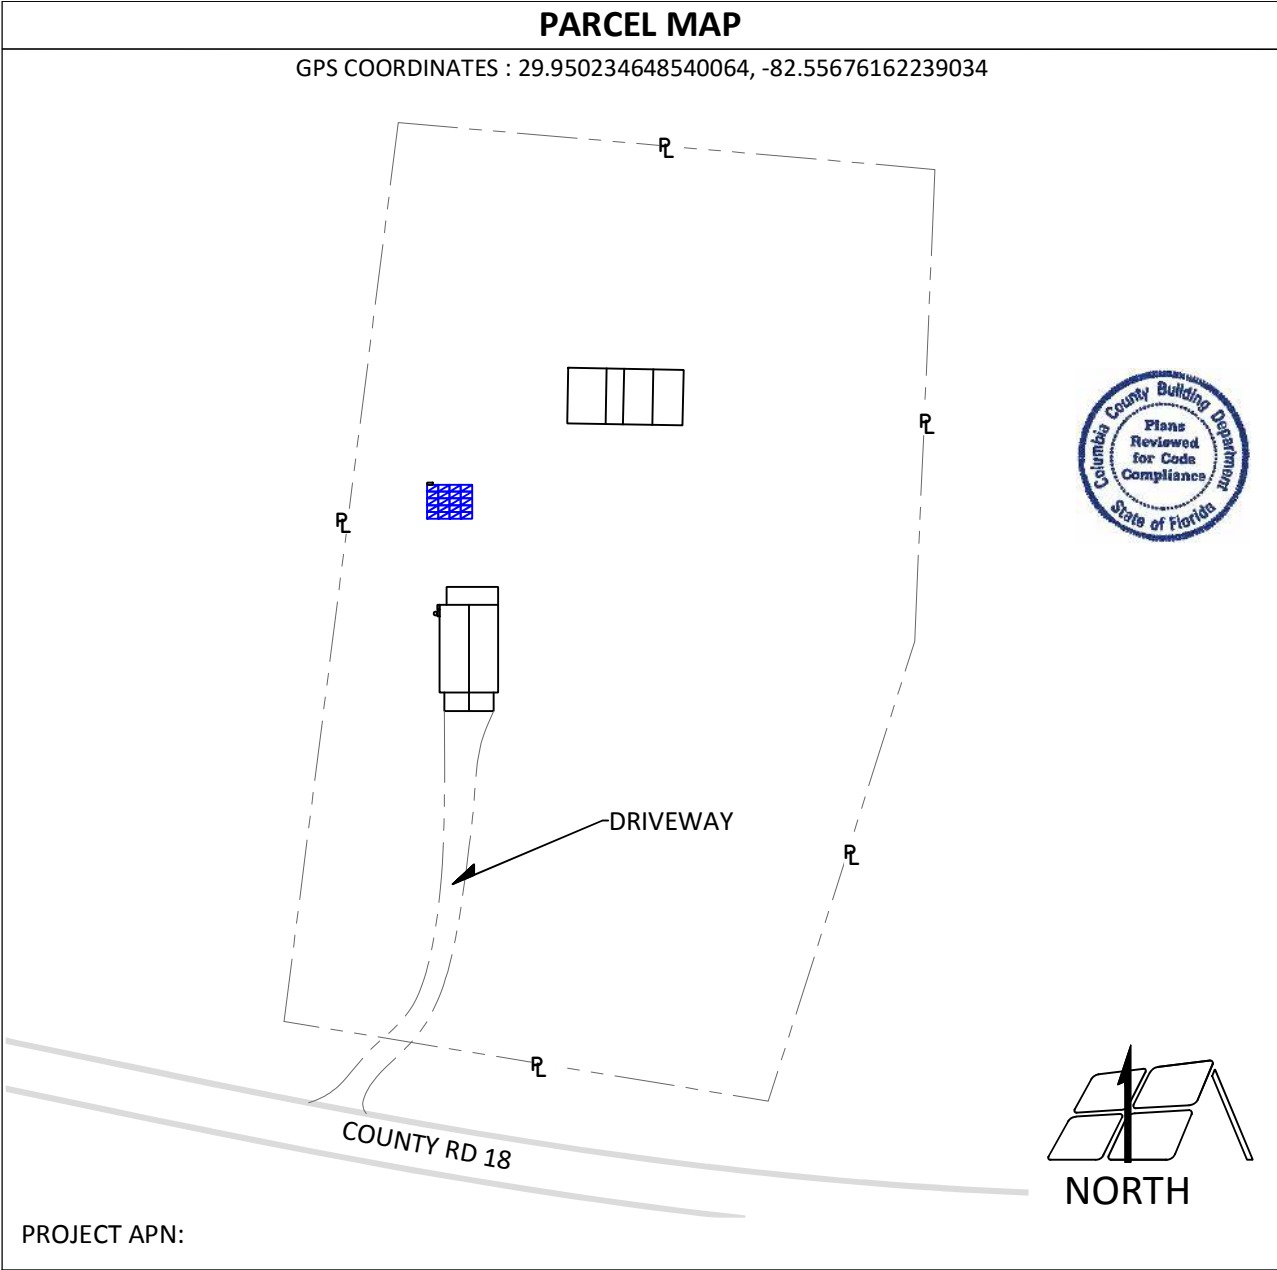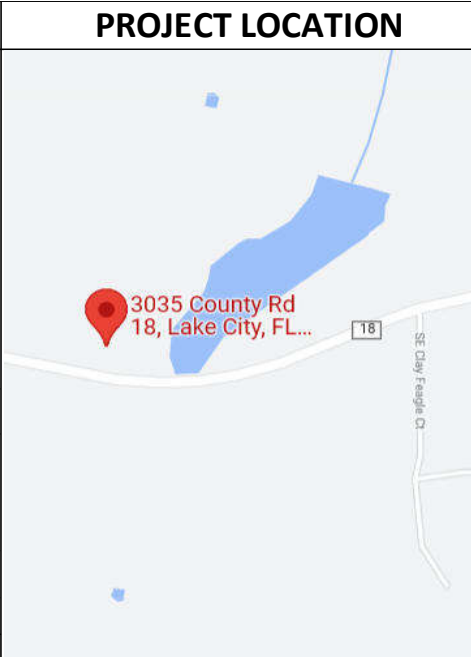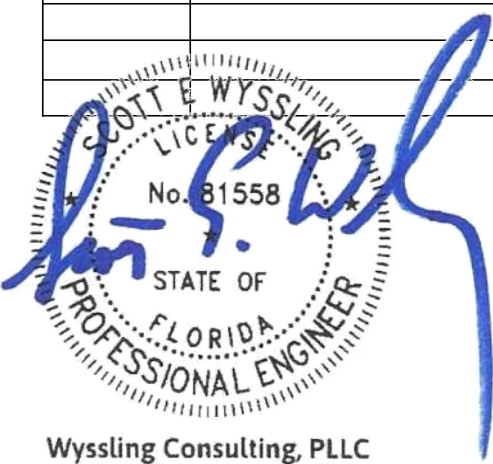

<div>PARCEL MAP</div> <div>GPS COORDINATES : 29.950234648540064, -82.55676162239034</div> <div></div> <div>PROJECT APN:</div>		<div>GOVERNING CODES</div> <div>APPLICABLE BUILDING CODES: 2018 INTERNATIONAL BUILDING CODE 2018 INTERNATIONAL RESIDENTIAL CODE 2018 INTERNATIONAL FIRE CODE 2017 NATIONAL ELECTRIC CODE 2020 FLORIDA BUILDING CODE 2020 FLORIDA RESIDENTIAL CODE</div>		<div>DESIGN CRITERIA</div> <div>BUILDING OCCUPANCY: U RISK CATEGORY: II ASCE 7-16 WIND SPEED: 120 EXPOSURE CATEGORY: Exposure C SNOW LOAD: 0 SNOW EXPOSURE: N/A CONSTRUCTION TYPE: N/A</div>		<div>PROJECT LOCATION</div> <div></div>		<div>DATE</div> <div>11/16/2021</div>		<div>RELEASE</div> <div>SUBMIT FOR PERMIT</div>		<div>COVER SHEET</div>																																				
<div>GENERAL PROJECT &amp; JURISDICTIONAL NOTES</div> <div>INSPECTION REQUIREMENTS</div> <div>1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH ALL OSHA REGULATIONS.</div> <div>2. PENDING LOCAL JURISDICTIONAL REQUIREMENTS AND WHEN APPLICABLE ALL ELECTRICAL ENCLOSURE DEAD FRONTS, COVERS, DOORS, ETC. SHALL BE OPEN AND ACCESSIBLE FOR INSPECTIONS. WHEN TRENCH AND ROOF INSPECTIONS ARE REQUIRED WORK SHALL BE OPEN AND ACCESSIBLE FOR INSPECTOR.</div>		<div>JURISDICTIONAL &amp; LISTING REQUIREMENTS</div> <div>1. WHEN APPLICABLE A SMOKE DETECTOR, APPROVED AND LISTED BY THE STATE FIRE MARSHAL OR ANSI/UL 217 CERTIFIED TO NATIONAL FIRE ALARM AND SIGNALING CODE, NFPA 72 SHALL BE VERIFIED FUNCTIONAL OR INSTALLED IN ALL APPLICABLE CODE REQUIRED LOCATIONS.</div> <div>2. ALL APPLICABLE EQUIPMENT TO BE UL LISTED OR LISTED BY OTHER JURISDICTIONAL AND UTILITY APPROVED ASSOCIATION OR NATIONALLY RECOGNIZED ORGANIZATION.</div> <div>3. FULL SCOPE OF WORK SHALL COMPLY WITH ALL APPLICABLE CODES LISTED IN GOVERNING CODES SECTION, ALL MANUFACTURES' LISTINGS, INSTALLATION INSTRUCTIONS AND SPECIFICATIONS AND JURISDICTIONAL REQUIREMENTS.</div> <div>4. REVISED PLANS WILL BE REQUIRED TO BE RESUBMITTED TO THE LOCAL JURISDICTION IF THE INSTALLED ARRAY AND ASSOCIATED EQUIPMENT DOES NOT MATCH THE APPROVED BUILDING PLANS. ADDITIONAL FEES MAY ALSO APPLY.</div> <div>5. THE PLACEMENT OF A UTILITY PV PRODUCTION METER SHALL BE PROVIDED AND PLACED BY THE CONTRACTOR AS PER APPLICABLE UTILITY OR AHJ REQUIREMENTS.</div>		<div>COPYRIGHT NOTICE</div> <div>1. UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT EXPRESSED WRITTEN PERMISSION FROM THE CONTRACTOR AND ADVANCED SOLAR SOLUTIONS IS A VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTION.</div>		<div>SCOPE OF WORK</div> <div>GROUND MOUNTED PV (SOLAR) PROJECT GRID-TIED W/O BATTERY STORAGE</div>		<div>SHEET INDEX</div> <table><thead><tr><th>SHEET NUMBER</th><th>SHEET TITLE</th></tr></thead><tbody><tr><td>PV-001</td><td>COVER SHEET</td></tr><tr><td>N-001</td><td>GENERAL NOTES</td></tr><tr><td>PV-100G</td><td>PV ARRAY LAYOUT</td></tr><tr><td>PV-101G</td><td>DETAILED LAYOUT</td></tr><tr><td>S-300</td><td>GROUND RACKING LAYOUT</td></tr><tr><td>E-001</td><td>EQUIP. CALCULATION</td></tr><tr><td>E-002</td><td>WIRE AND COND. CALCS</td></tr><tr><td>E-003</td><td>THREE LINE DIAGRAM</td></tr><tr><td>E-100</td><td>ELECTRICAL LAYOUT</td></tr><tr><td>P-001</td><td>STANDARD PLACARDS</td></tr><tr><td>P-002</td><td>DYNAMIC PLACARDS</td></tr><tr><td>R-1xx</td><td>EQUIP.CUT SHEETS</td></tr></tbody></table>		SHEET NUMBER	SHEET TITLE	PV-001	COVER SHEET	N-001	GENERAL NOTES	PV-100G	PV ARRAY LAYOUT	PV-101G	DETAILED LAYOUT	S-300	GROUND RACKING LAYOUT	E-001	EQUIP. CALCULATION	E-002	WIRE AND COND. CALCS	E-003	THREE LINE DIAGRAM	E-100	ELECTRICAL LAYOUT	P-001	STANDARD PLACARDS	P-002	DYNAMIC PLACARDS	R-1xx	EQUIP.CUT SHEETS	<div>6.500 kW PHOTOVOLTAIC PLANS</div> <table><thead><tr><th>NAME</th><th>ADDRESS</th><th>ADDRESS</th><th>APN</th></tr></thead><tbody><tr><td>Dodsworth, Janet</td><td>3035 County Rd 18</td><td>Lake City, FL 32025</td><td></td></tr></tbody></table>		NAME	ADDRESS	ADDRESS	APN	Dodsworth, Janet	3035 County Rd 18	Lake City, FL 32025				
						SHEET NUMBER	SHEET TITLE																																									
PV-001	COVER SHEET																																															
N-001	GENERAL NOTES																																															
PV-100G	PV ARRAY LAYOUT																																															
PV-101G	DETAILED LAYOUT																																															
S-300	GROUND RACKING LAYOUT																																															
E-001	EQUIP. CALCULATION																																															
E-002	WIRE AND COND. CALCS																																															
E-003	THREE LINE DIAGRAM																																															
E-100	ELECTRICAL LAYOUT																																															
P-001	STANDARD PLACARDS																																															
P-002	DYNAMIC PLACARDS																																															
R-1xx	EQUIP.CUT SHEETS																																															
NAME	ADDRESS	ADDRESS	APN																																													
Dodsworth, Janet	3035 County Rd 18	Lake City, FL 32025																																														
<div>PROPOSED SOLAR EQUIPMENT</div> <table><thead><tr><th>QTY.</th><th>EQUIPMENT</th><th>DESCRIPTION/MFG/MODEL</th></tr></thead><tbody><tr><td>20</td><td>MODULES</td><td>PEIMAR SM325M (FB)</td></tr><tr><td>1</td><td>INVERTER(S)</td><td>SolarEdge SE5000H-US (240V)</td></tr><tr><td>N/A</td><td>RACKING</td><td>IronRidge Ground Mt W/ XR1000 Rail</td></tr><tr><td>0</td><td>STANCHIONS</td><td></td></tr><tr><td>N/A</td><td>RSD DEVICE</td><td>INTEGRATED IN INV &amp; OPT</td></tr><tr><td>0</td><td>BATTERIES</td><td></td></tr><tr><td>0</td><td>COMBINER(S)</td><td></td></tr><tr><td>(E)</td><td>MSP RATINGS</td><td>200A BUS/200A MAIN BREAKER</td></tr></tbody></table>		QTY.	EQUIPMENT	DESCRIPTION/MFG/MODEL	20	MODULES	PEIMAR SM325M (FB)	1	INVERTER(S)	SolarEdge SE5000H-US (240V)	N/A	RACKING	IronRidge Ground Mt W/ XR1000 Rail	0	STANCHIONS		N/A	RSD DEVICE	INTEGRATED IN INV & OPT	0	BATTERIES		0	COMBINER(S)		(E)	MSP RATINGS	200A BUS/200A MAIN BREAKER	<div>SITE / PROJECT DETAILS</div> <table><thead><tr><th>CONNECTION</th><th>WIRE TAP</th></tr></thead><tbody><tr><td>SYSTEM SIZE DC</td><td>6.500 KW</td></tr><tr><td>SYSTEM SIZE AC</td><td>5.000 KW</td></tr><tr><td>QTY. STRING/CKT.</td><td>2</td></tr><tr><td>ELECT. SERVICE</td><td>120/240V - 1Φ</td></tr><tr><td>ROOF COVERING</td><td>N/A</td></tr><tr><td>MAX ARRAY HGT.</td><td>6.94 FEET</td></tr><tr><td>TILT</td><td>20°</td></tr><tr><td>AZIMUTH</td><td>181°</td></tr></tbody></table>		CONNECTION	WIRE TAP	SYSTEM SIZE DC	6.500 KW	SYSTEM SIZE AC	5.000 KW	QTY. STRING/CKT.	2	ELECT. SERVICE	120/240V - 1Φ	ROOF COVERING	N/A	MAX ARRAY HGT.	6.94 FEET	TILT	20°	AZIMUTH	181°
QTY.	EQUIPMENT	DESCRIPTION/MFG/MODEL																																														
20	MODULES	PEIMAR SM325M (FB)																																														
1	INVERTER(S)	SolarEdge SE5000H-US (240V)																																														
N/A	RACKING	IronRidge Ground Mt W/ XR1000 Rail																																														
0	STANCHIONS																																															
N/A	RSD DEVICE	INTEGRATED IN INV & OPT																																														
0	BATTERIES																																															
0	COMBINER(S)																																															
(E)	MSP RATINGS	200A BUS/200A MAIN BREAKER																																														
CONNECTION	WIRE TAP																																															
SYSTEM SIZE DC	6.500 KW																																															
SYSTEM SIZE AC	5.000 KW																																															
QTY. STRING/CKT.	2																																															
ELECT. SERVICE	120/240V - 1Φ																																															
ROOF COVERING	N/A																																															
MAX ARRAY HGT.	6.94 FEET																																															
TILT	20°																																															
AZIMUTH	181°																																															
<div>PROJECT TEAM LIST</div> <div>CONTRACTOR: Daybreak Install LLC 2100 N Main St Ste. 212 Fort Worth, TX 76164 CONTRACTOR LIC #: CVC56966 PHONE: (817) 995-9572 CONTACT NAME: Sherrie Ledbetter PHONE: (817) 501-4922 EMAIL: sherrie.ledbetter@DaybreakInstall.com</div> <div>ELECTRICAL UTILITY: FPL - Florida Power &amp; Light METER NUMBER: PHONE: AUTHORITY HAVING JURISDICTION: BUILDING: County Of Columbia PHONE: ENGINEERED BY: Scott E. Wyssling 76 North Meadowbrook Dr Alpine, UT 84004 LICENSE #: 81558 LICENSE TYPE: Civil PHONE: (202) 874-3483 EMAIL: swyssling@wysslingconsulting.com</div> <div>DESIGN BY: Sherrie Ledbetter PHONE: (817) 501-4922 EMAIL: sherrie.ledbetter@DaybreakInstall.com</div> <div>PROJECT DRAFTER: Advanced Solar Solutions 2372 Morse Ave #912 Irvine, CA 92614 PHONE: 559-321-7000 EMAIL: info@advpermits.com</div> <div>HOME OWNER PROJECT LOCATION: Dodsworth, Janet 3035 County Rd 18, Lake City, FL 32025</div> <div>CONTACT NAME: Dodsworth, Janet PHONE: EMAIL:</div>		<div>THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES</div> <div></div> <div>Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 COA # RY34912 Signed 11-17-21</div>																																														



GENERAL NOTES:\*

PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION *NEC 110.26*.

PV SYSTEM COMPONENTS; INCLUDING BUT NOT LIMITED TO, MODULES, INVERTERS AND SOURCE CIRCUIT COMBINERS ARE IDENTIFIED AND LISTED FOR USE IN PV SYSTEMS IN COMPLIANCE WITH *NEC 690.4 AND 690.6* AND *ALL UL, IEC, IEEE* CLASSIFICATIONS AS REQUIREMENTS.

RAPID SHUTDOWN NOTES:\*

PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDIDNG SHALL INCLUDE A **RAPID SHUTDOWN FUNCTION** THAT CONTROLS SPECIFIC PV CONDUCTORS IN ACCORDANCE WITH *2017 NEC 690.12(A)-(D)*

EQUIPMENT LOCATIONS & ELECTRICAL NOTES:\*

JUNCTION AND PULL BOXES ARE PERMITTED TO BE INSTALLED UNDER PV MODULES IN COMPLIANCE WITH *NEC 690.34*.

ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT. *2017 NEC 690.15(A)*

ALL EQUIPMENT SHALL BE INSTALLED **ACCESSIBLE TO QUALIFIED PERSONNEL** IN COMPLIANCE WITH *NEC* APPLICABLE CODES.

ALL COMPONENTS ARE **LISTED FOR THEIR INTENDED PURPOSE AND RATED FOR OUTDOOR USAGE** WHEN APPLICABLE.

STRUCTURAL AND INSTALLATION NOTES:\*

RACKING SYSTEM & PV PANELS MOUNTED ON A ROOFTOP SHALL BE LISTED AND LABELED IN ACCORDANCE WITH *UL 1703* AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER INSTALLATION INSTRUCTIONS.

ALL PV RACKING ATTACHMENT POINTS SHALL NOT EXCEED THE PRE-ENGINEERED **MAX SPANS** OUTLINED BY THE RACKING MANUFACTURES ENGINEER OF RECORD.

GROUNDING NOTES:\*

IN **UNGROUND**ED SYSTEMS ONLY THE DC CONDUCTORS ARE UNGROUNDED AND REQUIRE AN EQUIPMENT GROUNDING CONDUCTOR. ALL METAL ELECTRICAL EQUIPMENT AND STRUCTURAL COMPONENTS BONDED TO

GROUND, IN COMPLIANCE WITH *NEC 250.134* AND *NEC 250.136(A)*.

PV EQUIPMENT INCLUDING **MODULE FRAMES AND OTHER METAL PARTS SHALL BE GROUNDED** IN COMPLIANCE WITH *NEC 690.43* AND MINIMUM GROUND CONDUCTORS SIZED IN ACCORDANCE WITH *NEC TABLE 250.122*.

CONDUCTIVE PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES SHALL BE GROUNDED IN COMPLIANCE WITH *NEC 250.134 AND NEC 250.136(A)*.

**UL2703** APPROVED **MODULE AND RACK GROUNDING** SHALL BE USED AND INSTALLED PER MANUFACTURER'S INSTALLATION MANUAL. IF *UL2703* APPROVED GROUNDING IS NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURER'S INSTALLATION REQUIREMENTS.

**THE GROUNDING CONNECTION TO A MODULE** SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.

**THE GROUNDING ELECTRODE SYSTEM** COMPLIES WITH *NEC 690.47* AND *NEC 250.50* THROUGH *NEC 250.106*. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM WILL BE PROVIDED IN COMPLIANCE WITH *NEC 250, NEC 690.47* AND *AHJ*.

PV SYSTEMS SHALL BE PROVIDED WITH **DC GROUND-FAULT PROTECTION** *2017 NEC 690.41(B)*

INTERCONNECTION / POC NOTES:\*

**ALL LOAD-SIDE INTERCONNECTIONS** ARE IN COMPLIANCE WITH *2017 NEC 705.12(B)*

**THE TOTAL RATING OF ALL OCPD IN SOLAR LOAD CENTERS** SHALL NOT EXCEED THE RATED AMPACITY OF THE BUSBAR EXCLUDING THE OCPD PROTECTING THE BUSBAR IN COMPLIANCE WITH *NEC 705.12(B)(2)(3)(c)*

**ALL FEEDER TAP (LOAD SIDE) INTERCONNECTIONS** ARE IN COMPLIANCE WITH *2017 NEC 705.12(B)(2)(1)*

THE PV SYSTEM BACK-FEED BREAKER SHALL BE INSTALLED ON THE OPPOSITE END OF THE BUS BAR AND IT SHALL ALSO BE SIZED APPROPRIATELY AS PER *2017 NEC 705.12(B)(2)(3)(b)*

**SUPPLY SIDE TAP INTERCONNECTIONS** ARE IN COMPLIANCE WITH *NEC 705.12(A)* WITH SERVICE ENTRANCE CONDUCTORS IN COMPLIANCE WITH *NEC 230.42*

**BACKFEEDING BREAKER** FOR INVERTER OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING *2017 NEC 705.12(B)(5)*

**MICROINVERTER BRANCH CIRCUITS** SHALL BE CONNECTED TO A SINGLE OCPD IN ACCORDANCE WITH THEIR INSTALLATION INSTRUCTIONS AND *NEC 690.9*

DISCONNECTS AND OCPD NOTES:\*

**ALL DISCONNECTING SWITCHES** WILL BE CONFIGURED SO THAT ALL ENERGIZED CONDUCTORS WHEN DISCONNECT IS OPEN SHALL BE ON THE TERMINALS MARKED, “LINE SIDE” (TYPICALLY THE UPPER TERMINALS)

**ALL AC DISCONNECTS** SHALL BE LABELED, LOCKABLE, OF VISIBLE BREAK TYPE SWITCH WITH EXTERNAL HANDLE AND ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL.

**AC DISCONNECTS** SHALL BE A “KNIFE BLADE” TYPE DISCONNECT. IF EXTERIOR, RATED TO NEMA 3R OR BETTER PER *NEC 110.28*

**ADDITIONAL AC DISCONNECTS** SHALL BE PROVIDED WHERE THE INVERTER IS NOT ADJACENT TO THE UTILITY AC DISCONNECT, OR NOT WIHTIN SIGHT OF THE UTILITY AC DISCONNECT. *2017 NEC 690.15(A)*

**BOTH POSITIVE AND NEGATIVE PV CONDUCTORS** REMAIN UNGROUNDED. THEREFORE, BOTH SHALL REMAIN OPEN WHERE A DISCONNECT IS REQUIRED IN COMPLIANCE WITH *2017 NEC 690.15(D)*

**ALL OCPD RATINGS AND TYPES SPECIFIED** SHALL BE IN COMPLIANCE WITH *NEC 690.8, 690.9, 705.12* AND *240*.

**BOTH POSITIVE AND NEGATIVE DC PV CONDUCTORS ARE UNGROUND**ED; BOTH REQUIRE OVERCURRENT PROTECTION IN COMPLIANCE WITH *NEC 690.9*

**ARC FAULT (AFCI) DC CIRCUIT PROTECTION** IS REQUIRED FOR ALL PV SYSTEMS ON OR PENETRATING A BUILDING WITH A MAXIMUM SYSTEM VOLTAGE OF 80 VOLTS OR GREATER. ALL DC PV CIRCUITS INSTALLED IN OR ON BUILDINGS WILL BE ARC-FAULT CIRCUIT PROTECTED IN COMPLIANCE WITH *NEC 690.11, UL1699B* AND SHALL BE LISTED AND LABELED IN ACCORDANCE WITH *UL 1699 (B)*.

WIRING & CONDUIT NOTES:\*

**ALL CONDUIT AND CONDUCTORS SHALL BE APPROVED** FOR THEIR INTENDED PURPOSE INCLUDING WET LOCATIONS AND EXPOSED TO SUNLIGHT. CONDUIT AND CONDUCTOR SIZE SPECIFICATIONS ARE BASED ON THE MINIMUM CODE REQUIREMENTS AND ARE NOT LIMITED TO UP SIZING.

**ALL CONDUCTORS SHALL BE SIZED** IN COMPLIANCE WITH *NEC 690.8, NEC 690.7*.

**ALL CONDUCTORS SHALL BE DERATED** AS APPLICABLE TO THEIR RESPECTIVE ENVIRONMENT INCLUDING DIRECT

SUNLIGHT IN ACCORDANCE WITH *2017 NEC 310.15(B)(3)(4)(c)*

**EXPOSED UNGROUND**ED DC PV SOURCE AND OUTPUT **CIRCUITS** SHALL USE CONDUCTORS LISTED AND IDENTIFIED AS PHOTOVOLTAIC (PV) WIRE IN COMPLIANCE *2017 NEC 690.31(C)(1)*. PV MODULES WIRE LEADS SHALL BE LISTED FOR USE WITH UNGROUNDED SYSTEMS IN COMPLIANCE WITH *2017 NEC 690.4(B)*

**PV WIRE BLACK WIRE** MAY BE FIELD-MARKED WHITE IN COMPLIANCE WITH *NEC 200.6 (A)(6)*.


**PV MODULE CONDUCTORS LOCATED UNDER ARRAYS** WILL BE SECURED IN A WORKMANLIKE MANNER IN COMPLIANCE WITH *NEC 110.12*.

WATERPROOFING:\*

ALL NEW **ROOFTOP PENETRATIONS** SHALL BE SEALED AND MADE WEATHER TIGHT WITH APPROVED CHEMICAL SEALANT AND FLASHINGS WHERE REQUIRED PER CODE AND GENERAL BUILDING AND ROOFING WORKMANSHIP STANDARDS BY A LICENSED CONTRACTOR.


**ALL EXTERIOR ELECTRICAL EQUIPMENT, SHALL BE NEMA 3R** OR BETTER RATED. ALL EXTERIOR CONDUIT AND CONNECTORS SHALL BE RATED FOR WET LOCATIONS.

\*ALL NOTES ARE AS APPLICABLE TO THIS PROJECT. DISREGARD ANY NOTES THAT DO NOT APPLY TO THIS PROJECT.



**Wyssling Consulting, PLLC**  
76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21



THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

<div></div> <div>Daybreak Install LLC</div> <div>CVC56966 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922</div>	6.500 kW PHOTOVOLTAIC PLANS			REV	DATE	RELEASE
					11/16/2021	SUBMIT FOR PERMIT
			N-001			GENERAL NOTES




PV AC DISCONNECT LOCATED ON ACCESSIBLE EXTERIOR WALL WITH EXTERNAL HANDLE VISIBLE, LOCKABLE & LABELED WITHIN 10 FEET OF THE METER

NOTE: ALL ELECTRICAL LAYOUT DETAILS ON SHEET E-100

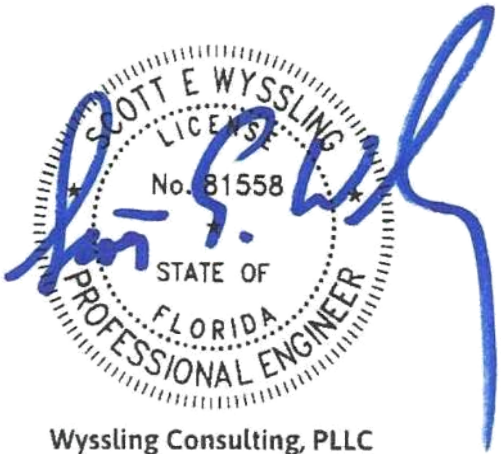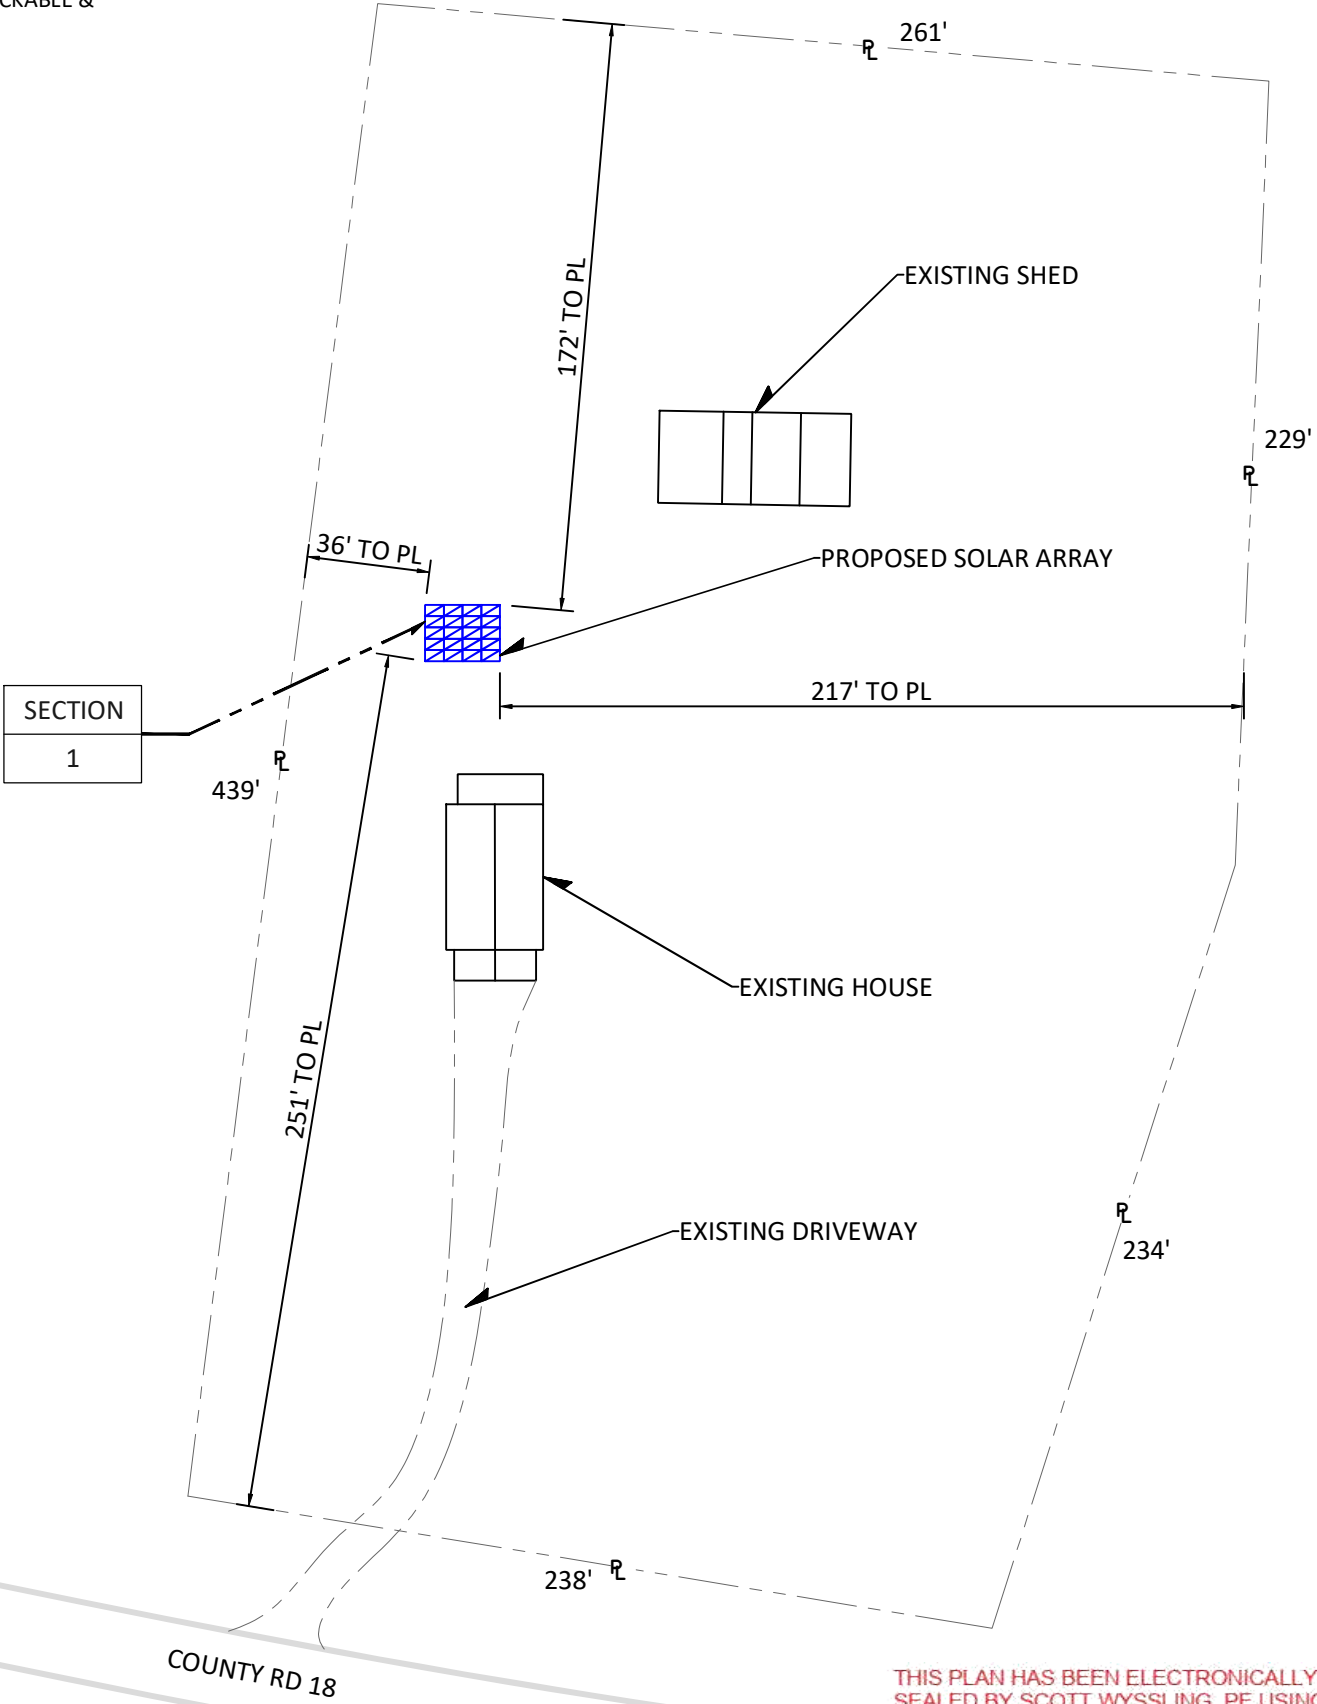

Wyssling Consulting, PLLC  
76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



GROUND MOUNT SETBACKS & AHJ NOTES

ALL GROUND MOUNTED STRUCTURES SHALL COMPLY WITH STATE AND LOCAL AHJ REQUIRED SETBACKS TO SEPTIC OR WASTEWATER SYSTEM COMPONENTS, LEACH FIELDS, PROPERTY LINES, ROADS, HIGHWAYS, RIGHT OF WAYS, SIDEWALKS, DRIVEWAYS, OTHER STRUCTURES, WATER WAYS, EASEMENTS, UTILITIES, TREES, FENCES AND FLOOD ZONES.

PV SITE LAYOUT LEGEND

SECTION	PV ARRAY TAG	SA	SITE ACCESS
1	SECTION # MODULE GROUP	GA	GATE ACCESS

AZIMUTH AND TILT TABLE

SECTION #	AZIMUTH	ARRAY PITCH / TILT
SECTION-1	181	20°

6.500 kW PHOTOVOLTAIC PLANS

NAME	Dodsworth, Janet
ADDRESS	3035 County Rd 18
ADDRESS	Lake City, FL 32025
APN	

CVC56966  
2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

Daybreak Install LLC

DATE  
11/16/2021

RELEASE  
SUBMIT FOR PERMIT

REV

PV ARRAY LAYOUT

PV-100G

\*EXISTING DIMENSIONS ARE APPROX. CONFIRM ALL DIMENSIONS SHOWN


SCALE: 1/56" = 1'0" @ SHEET SIZE A3


QTY 20 PEIMAR SM325M (FB) MODULES QTY 1 SolarEdge SE5000H-US (240V) INVERTER




NOTE: ALL ELECTRICAL LAYOUT DETAILS ON SHEET E-100

A CLEAR, BRUSH-FREE AREA OF 10 FEET (3048 MM) SHALL BE REQUIRED FOR GROUND MOUNTED PHOTOVOLTAIC ARRAYS PER IFC 1204.4

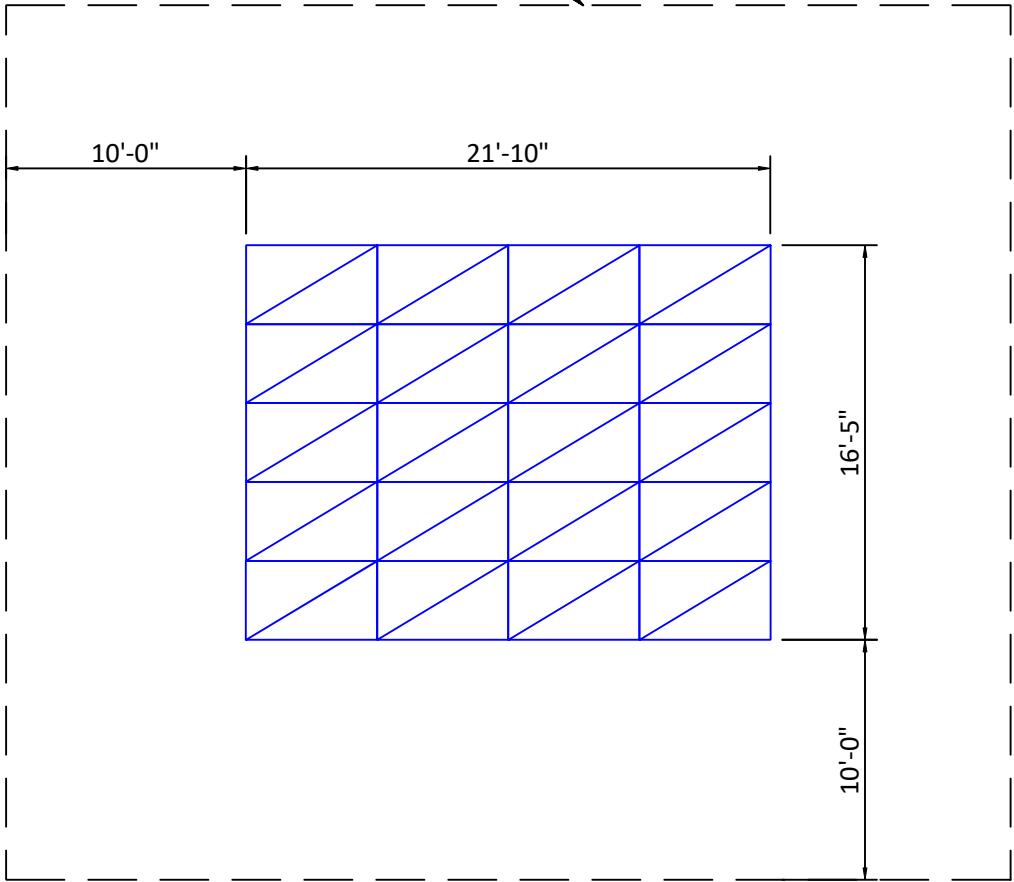

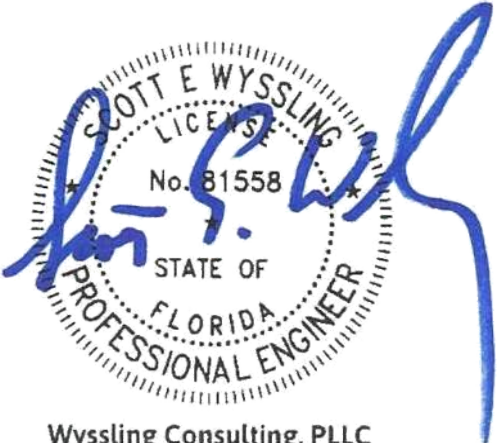  
Wyssling Consulting, PLLC  
76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES




QTY 20 PEIMAR SM325M (FB) MODULES    QTY 1 SolarEdge SE5000H-US (240V) INVERTER

SCALE: 1/8" = 1'0" @ SHEET SIZE A3


Daybreak Install LLC 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922	6.500 kW PHOTOVOLTAIC PLANS		REV	DATE	RELEASE
	NAME	Dodsworth, Janet		11/16/2021	SUBMIT FOR PERMIT
	ADDRESS	3035 County Rd 18			
	ADDRESS	Lake City, FL 32025			
APN					
CVC56966					
PV-101G					
DETAILED LAYOUT					





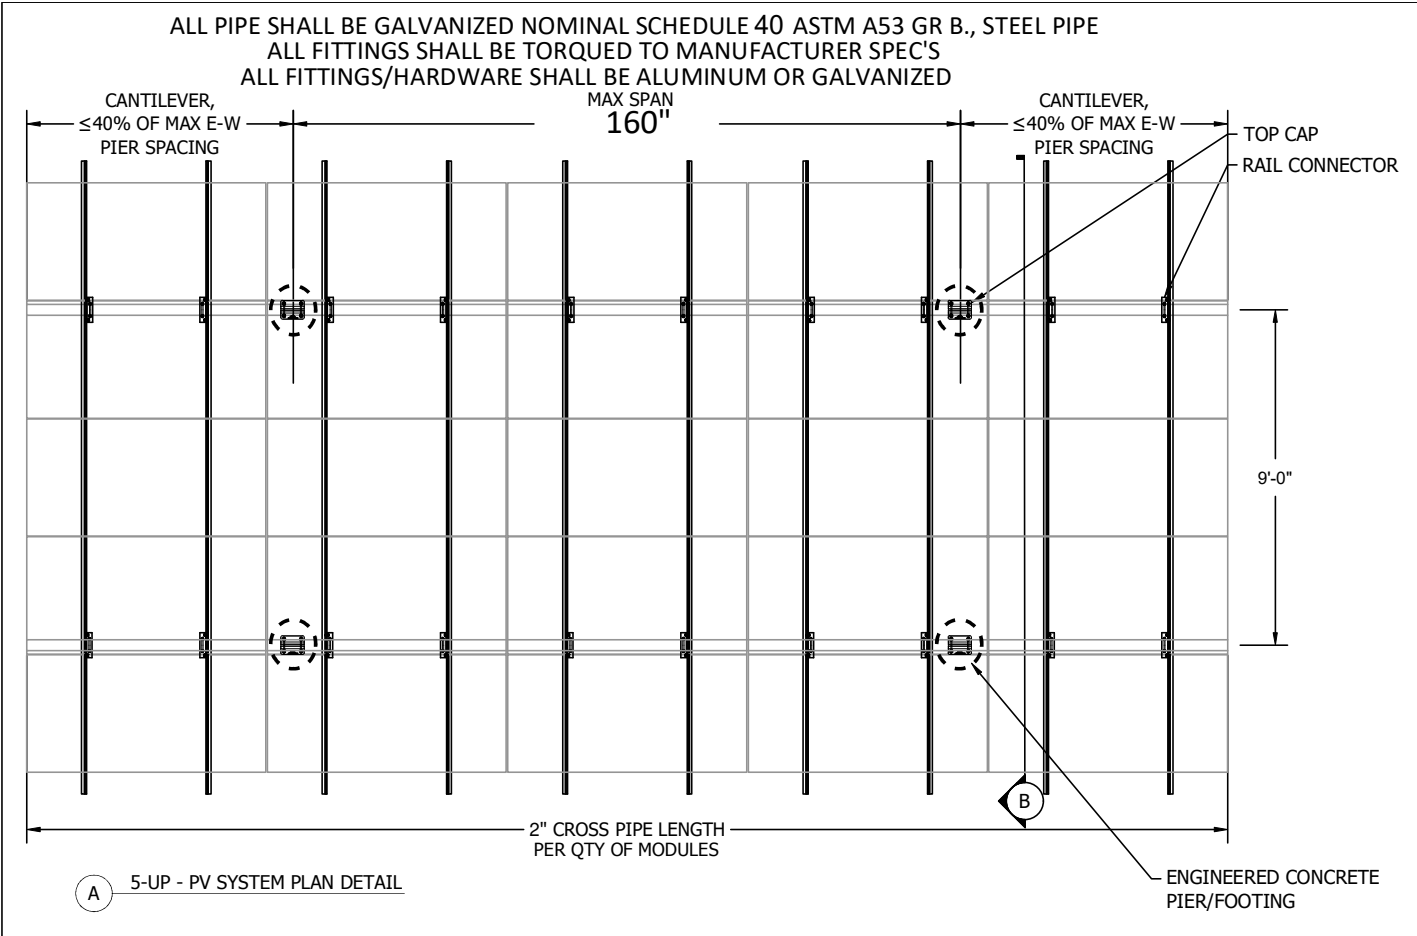

ARRAY AZIMUTH: 181 DEGREES  
ARRAY TILT: 20 DEGREES

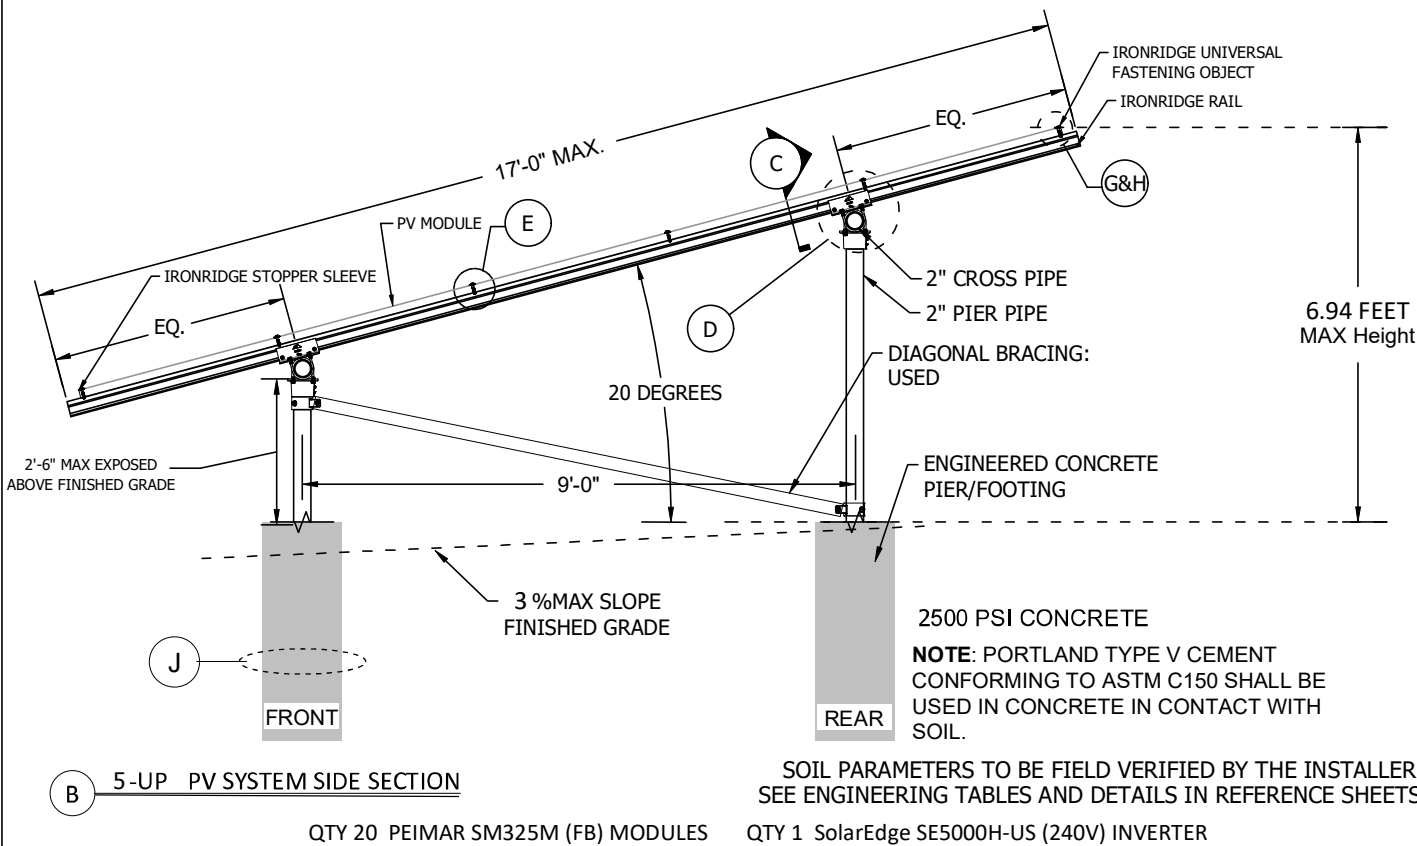

**PV RACKING LEGEND**

	RACKING RAIL
	3" PIPE BEAM
	FOOTING W/ 3" PIPE

SECTION 1  
PV ARRAY TAG SECTION #  
MODULE GROUP

\* DETAILS IN TOP VIEW

**SEE PIER SCHEDULE IN REFERENCE SHEETS**

DRILL/POUR FOUNDATION

**RAIL CONNECTOR**

PIPE FITTINGS DETAIL

**CYLINDRICAL CONCRETE PIER SCHEDULE**

FRONT		REAR	
DIAMETER	DEPTH	DIAMETER	DEPTH
18"	60"	18"	60"

NOTE: ALL FOOTING DEPTHS REPRESENT REQUIRED EMBEDDED DEPTH INTO FIRM, NATIVE SOIL

**DETAIL, END CLAMP PLAN**

DETAIL, MID CLAMP FRONT

DETAIL, END CLAMP FRONT

**ENGINEER'S STAMPS WHEN REQUIRED**

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

**6.500 kW PHOTOVOLTAIC PLANS**

NAME	Dodsworth, Janet
ADDRESS	3035 County Rd 18
ADDRESS	Lake City, FL 32025
APN	

**Daybreak Install LLC**

CVC56966

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

**Wyssling Consulting, PLLC**


76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21

**RACKING LAYOUT**

**S-300**

PV MODULE #1 SPECIFICATIONS		
MANUFACTURER	PEIMAR	
MODEL NUMBER	SM325M (FB)	
WEIGHT	41.01	lbs
DIMENSIONS	65.55 x 39.45 x 1.57	L" x W" x D"/THICK
PEAK POWER @ STC (Pmax)	325	WATTS
Voc (OPEN-CIRCUIT VOLTAGE)	41.67	VOLTS DC
Vmp (MAX-POWER VOLTAGE)	34.15	VOLTS DC
isc (SHORT-CIRCUIT CURRENT)	10.08	AMPS
imp (OPERATING CURRENT)	9.52	AMPS
MFR. Voc TEMP COEFFICIENT	0.28	%/K
MAX SERIES FUSE RATING	20.0	AMPS
TEMP. CORRECTED Voc	37.92	VOLTS DC

DC/DC OPTIMIZER (IF APPL.)		
MANUFACTURER	SolarEdge Technologies	
MODEL NUMBER	P370 Single (240V)	
WEIGHT	1.5	lbs
RATED OUTPUT isc	15	AMPS
MAX OUTPUT VOLTAGE	60	VOLTS
MAX INPUT VOLTAGE Voc	60	VOLTS



**Wyssling Consulting, PLLC**  
76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21

PV SYSTEM MAXIMUM VOLTAGE ( MODULE Voc <sub>MAX</sub> )									
DATA SOURCE		SOLARABCS.ORG/ABOUT/PUBLICATIONS/REPORTS/ EXPEDITED-PERMIT/MAP/							
EXTREME MIN. TEMP. [°C]	STC TEMPERATURE [°C]	CORRECTED TEMPERATURE	MFR. P <sub>MAX</sub> TEMP COEFFICIENT [-0.8%/C] * 100	FORMULA	CORRECTED TEMP. COEFFICIENT	MODULE Voc [VDC]	TEMPERATURE CORRECTED OPEN CIRCUIT VOLTAGE		
-6	-	25	=	-31	*	0.28%	=	-0.09	+ 1
						0.91	*	41.67	=
									37.92

DC COMBINER / DISCONNECT #1		
MANUFACTURER		
MODEL NUMBER		
OCPD (DISCONNECT TYPE)		
WEIGHT		lbs
NEMA RATING		
LOCATION OF COMPONENT		
DC INPUT		
SERIES FUSE RATING FOR PV MODULES		AMPS (OCPD)
QUANTITY OF PV SOURCE CIRCUITS		QTY
MAX PV MODULE V <sub>oc</sub>		VOLTS DC
MAX # OF MODULES IN CIRCUIT		QTY
MAX ALLOWED INPUT VOLTAGE		VOLTS DC
MAX INPUT FUSE/BREAKER RATING		AMPS
DC OUTPUT		
MAX CIRCUIT OUTPUT CURRENT		AMPS
MAX CONT. OUTPUT CURRENT		AMPS

DC COMBINER / DISCONNECT #2 (IF APPL.)		
MANUFACTURER		
MODEL NUMBER		
OCPD (DISCONNECT TYPE)		
WEIGHT		lbs
NEMA RATING		
LOCATION OF COMPONENT		
DC INPUT		
SERIES FUSE RATING FOR PV MODULES		AMPS (OCPD)
QUANTITY OF PV SOURCE CIRCUITS		QTY
MAX PV MODULE $V_{oc}$		VOLTS DC
MAX # OF MODULES IN CIRCUIT		QTY
MAX ALLOWED INPUT VOLTAGE		VOLTS DC
MAX INPUT FUSE/BREAKER RATING		AMPS
DC OUTPUT		
MAX CIRCUIT OUTPUT CURRENT		AMPS
MAX CONT. OUTPUT CURRENT		AMPS

DC COMBINER / DISCONNECT #3 (IF APPL.)		
MANUFACTURER		
MODEL NUMBER		
OCPD (DISCONNECT TYPE)		
WEIGHT		lbs
NEMA RATING		
LOCATION OF COMPONENT		
DC INPUT		
SERIES FUSE RATING FOR PV MODULES		AMPS (OCPD)
QUANTITY OF PV SOURCE CIRCUITS		QTY
MAX PV MODULE $V_{oc}$		VOLTS DC
MAX # OF MODULES IN CIRCUIT		QTY
MAX ALLOWED INPUT VOLTAGE		VOLTS DC
MAX INPUT FUSE/BREAKER RATING		AMPS
DC OUTPUT		
MAX CIRCUIT OUTPUT CURRENT		AMPS
MAX CONT. OUTPUT CURRENT		AMPS

STRING INVERTER #1 SPECIFICATIONS		
MANUFACTURER	SolarEdge	
MODEL NUMBER	SE5000H-US (240V)	
QUANTITY	1	INVERTER(S)
NOMINAL POWER RATING	5000	WATT AC
WEIGHT	25.1	lbs.
DC INPUT		
Max INPUT DC VOLTAGE	480	VOLTS DC
Min. MPPT VOLTAGE RANGE	380	VOLTS DC
Max. MPPT VOLTAGE RANGE	480	VOLTS DC
Max INPUT CURRENT	13.5	AMPS
MPPT QTY	N/A	
INTEGRATED DC DISCONNECT	Yes	COMPLY W/NEC 690.17
INTEGRATED AC DISCONNECT	NO	
AC OUTPUT		
NOMINAL VOLTAGE OUTPUT	240	VOLTS AC
MAX. AC APPARENT POWER	5000	WATTS
MAX OVERCURRENT PROTECTION (OCPD)	30	AMPS
MAX. OUTPUT CURRENT	21	AMPS - MAX

STRING INVERTER #2 SPECIFICATIONS (IF APPL.)		
MANUFACTURER		
MODEL NUMBER		
QUANTITY		INVERTER(S)
NOMINAL POWER RATING		WATT AC
WEIGHT		lbs.
DC INPUT		
Max INPUT DC VOLTAGE		VOLTS DC
Min. MPPT VOLTAGE RANGE		VOLTS DC
Max. MPPT VOLTAGE RANGE		VOLTS DC
Max INPUT CURRENT		AMPS
MPPT QTY		
INTEGRATED DC DISCONNECT		COMPLY W/NEC 690.17
INTEGRATED AC DISCONNECT		
AC OUTPUT		
NOMINAL VOLTAGE OUTPUT		VOLTS AC
MAX. AC APPARENT POWER		WATTS
MAX OVERCURRENT PROTECTION (OCPD)		AMPS
MAX. OUTPUT CURRENT		AMPS - MAX

AC COMBINER #1 (SOLAR LOAD CENTER)		
MANUFACTURER		
MODEL NUMBER		
RATED OPERATIONAL VOLTAGE		VOLTS
RATED CURRENT		AMPS
NUMBER OF POLES		P
NEMA RATING		
MAIN BREAKER SIZE		AMPS
TOTAL INPUT CURRENT		AMPS
NUMBER OF BRANCH CIRCUITS		CIRCUITS

AC COMBINER #2 (SOLAR LOAD CENTER)		
MANUFACTURER		
MODEL NUMBER		
RATED OPERATIONAL VOLTAGE		VOLTS
RATED CURRENT		AMPS
NUMBER OF POLES		P
NEMA RATING		
MAIN BREAKER SIZE		AMPS
TOTAL INPUT CURRENT		AMPS
NUMBER OF BRANCH CIRCUITS		CIRCUITS

AC DISCONNECT #1 (IF APPL.)		
MANUFACTURER	Eaton	
MODEL NUMBER	DG222NRB	
QUANTITY	1	AC DISCO.(S)
DISCONNECT DEVICE TYPE	Fusible	
RATED OPERATIONAL VOLTAGE	240	VOLTS
RATED CURRENT	60	AMPS
NUMBER OF POLES	2	P
NEMA RATING	3R	
FUSE RATING	30	AMPS
TOTAL INPUT CURRENT	21	AMPS

AC DISCONNECT #2 (IF APPL.)		
MANUFACTURER		
MODEL NUMBER		
QUANTITY		AC DISCO.(S)
DISCONNECT DEVICE TYPE		
RATED OPERATIONAL VOLTAGE		VOLTS
RATED CURRENT		AMPS
NUMBER OF POLES		P
NEMA RATING		
FUSE RATING		AMPS
TOTAL INPUT CURRENT		AMPS

AC SUB-PANEL #1 (IF APPL.)		
NEW OR EXISTING		
MAKE / MODEL		
TYPE OF PANEL		
NUMBER OF POLES		P
NEMA RATING		
BUSS BAR RATING		AMPS
SUB-PANEL MAIN BREAKER		AMPS
MAIN SERVICE PANEL P.O.C. BREAKER		AMPS
SUM OF EXISTING CIRCUIT BREAKERS		AMPS
MAX ALLOWABLE SOLAR CURRENT		AMPS
PV BACKFEED BREAKER #1		AMPS (Imax)
PV BACKFEED BREAKER #2		AMPS (Imax)
PV BACKFEED BREAKER #3		AMPS (Imax)
PV BACKFEED BREAKER #4		AMPS (Imax)

MAIN SERVICE PANEL (IF APPL.)		
NEW OR EXISTING	EXISTING	
ELECTRICAL SERVICE	120/240V Single Phase	
BUSS BAR RATED CURRENT	200	AMPS
MAIN BREAKER RATED CURRENT	200	AMPS
SUM OF EXISTING CIRCUIT BREAKERS		AMPS
MAX ALLOWABLE SOLAR CURRENT 100%	0	AMPS
MAX ALLOWABLE SOLAR CURRENT 120%	40	AMPS (Imax)
PV BACKFEED BREAKER #1		AMPS (Imax)
PV BACKFEED BREAKER #2		AMPS (Imax)
PV BACKFEED BREAKER #3		AMPS (Imax)
PV BACKFEED BREAKER #4		AMPS (Imax)
ALT. ENERGY BACKFEED BREAKER (IF APPL.)		AMPS (Imax)

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

6.500 kW PHOTOVOLTAIC PLANS	DATE	11/16/2021	RELEASE		SUBMIT FOR PERMIT	
	REV					
NAME			Dodsworth, Janet			
ADDRESS			3035 County Rd 18			
ADDRESS			Lake City, FL 32025			
APN						
CVC56966			E-001		EQUIP. CALCULATIONS	
2100 N Main St Ste. 212						
Fort Worth, TX 76164						
(817) 501-4922						

Daybreak Install LLC



WIRE AND CONDUCTOR NOTES

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS  
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.  
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS  
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6

PV DC WIRING						AC WIRING					
EQUIPMENT GROUND			GREEN OR BARE, OR GREEN/YELLOW			EQUIPMENT GROUND			GREEN OR BARE, OR GREEN/YELLOW		
GROUNDED CONDUCTOR. TYPICALLY NEGATIVE			WHITE OR GRAY			GROUNDED CONDUCTOR (NEUTRAL)			WHITE OR GRAY		
UNGROUND CONDUCTOR(S). TYPICALLY POSITIVE			ANY COLOR OTHER THAN GREEN OR WHITE/GRAY			UNGROUND CONDUCTOR(S) HOT: L1 AND L2			ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.		
			CONVENTION IS RED FOR GROUNDED SYSTEMS						CONVENTION IS L1 BLACK		
			RED (+) AND BLACK (-) FOR UNGROUNDED SYSTEMS						CONVENTION IS L2 RED		

DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY							CONDUCTOR TEMPERATURE DERATING						CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION						AMPACITY CHECK					
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL STRINGS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	DC/DC CONVERTER	(1) CU	90	#12 AWG	30	10.08	X	1	X	1.25	X	1.25	=	15.75	OPEN AIR	35	N/A	0	35	0.96	2	N/A	30	X	0.96	X	1.0	=	28.8	15.75	≤	28.8
DC2	DC/DC CONVERTER	INVERTER	(1) CU	90	#10 AWG	40	15	X	1	X	1	X	1.25	=	18.75	OPEN AIR	35	N/A	0	35	0.96	4	N/A	40	X	0.96	X	1.0	=	38.4	18.75	≤	38.4
DC3								X		X		X		=										X		X		=			≤		
DC4								X		X		X		=										X		X		=			≤		
DC5										X		X		=										X		X		=			≤		
DC6										X		X		=										X		X		=			≤		
DC7								X		X		X		=										X		X		=			≤		
DC8								X		X		X		=										X		X		=			≤		

SCOTT E WYSSLING

FLORIDA

PROFESSIONAL ENGINEER

No. 81558

Wyssling Consulting, PLLC

76 N Meadowbrook Drive

Alpine UT 84004 COA # RY34912

Signed 11-17-21

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

VOLTAGE DROP CALCULATIONS

%VD = (0.2 x DISTANCE x Imp x DC or AC RESISTANCE) / Vmp

CONDUCTOR RUN	WORST CASE V-DROP	AC/DC
INVERTER TO AC DISCONNECT	1.47%	AC
TOTAL	1.47%	AC

AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY				CONDUCTOR TEMPERATURE DERATING						CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION						AMPACITY CHECK				
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	AC DISCONNECT	(1) CU	75	#10 AWG	35	1.25	X	21.0	=	26.2	UNDERGROUND	35	N/A	0	30	1.00	3	1.0	35	X	1.00	X	1.0	=	35.0	26.2	≤	35.0
AC2	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#6 AWG	65	1.25	X	21.0	=	26.2	EXT WALL	35	N/A	0	30	1.00	3	1.0	65	X	0.94	X	1.0	=	61.1	26.2	≤	61.1
AC3								X		=											X		X		=			≤	
AC4								X		=											X		X		=			≤	
AC5								X		=											X		X		=			≤	
AC6								X		=											X		X		=			≤	
AC7								X		=											X		X		=			≤	
AC8								X		=											X		X		=			≤	
AC9								X		=											X		X		=			≤	
AC10								X		=											X		X		=			≤	

Daybreak Install LLC

CVC56966

2100 N Main St Ste. 212

Fort Worth, TX 76164

(817) 501-4922

6.500 KW PHOTOVOLTAIC PLANS

NAME

Dodsworth, Janet

ADDRESS

3035 County Rd 18

ADDRESS

Lake City, FL 32025


APN

E-002


WIRE AND COND. CALCS.









PROPOSED UNDERGROUND CONDUIT  
TRENCH LENGTH 60FT

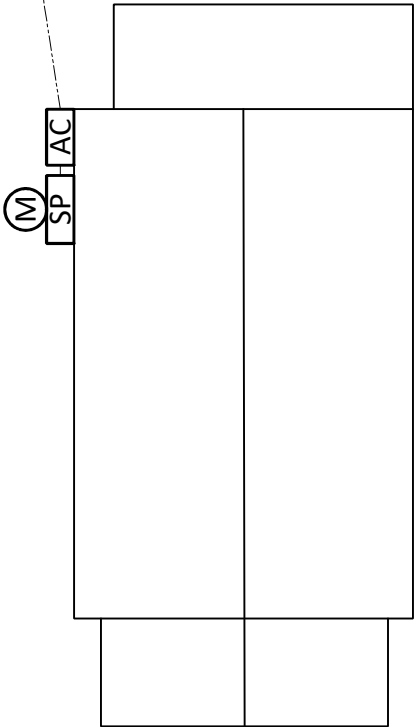

Wyssling Consulting, PLLC  
76 N Meadowbrook Drive  
Alpine UT 84004 COA # RY34912  
Signed 11-17-21



EQUIPMENT GROUNDING		RELEASE		ELECTRICAL LAYOUT																											
1. METAL PV MODULE FRAMES MUST BE CONNECTED TO THE EGC (EQUIPMENT GROUNDING CONDUCTOR).		SUBMIT FOR PERMIT																													
1.1. WEEBS MAY BE USED IN LIEU OF MODULE GROUND CLAMPS OR LUGS, WITH APPROVAL OF AHJ AND RACKING MFG. WEEBS ARE ONE TIME USE ONLY. SEE "we-llc.com" FOR RACKING SPECIFIC WEEB, INSTALL INSTRUCTIONS, AND UL 2703 CERT.																															
1.2. FOR "LAY-IN" LUG MODULE GROUNDING; CORRECT HARDWARE OF PROPER METAL MATERIAL TO AVOID CORROSION MUST BE USED. TYPICALLY DIRECT BURIAL RATED, TINNED, OR STAINLESS STEEL. GROUNDING LUGS MUST BE ATTACHED AT MARKED LOCATION ON EACH MODULE.																															
2. THE EGC (EQUIPMENT GROUNDING CONDUCTOR) IS USED TO BOND ALL NON-CURRENT CARRYING CONDUCTORS AND EXPOSED METAL PARTS THAT MIGHT COME INTO CONTACT WITH CURRENT-CARRYING CONDUCTORS, INCLUDING THE FOLLOWING:		DATE		E-100																											
2.1. PV MODULES FRAMES, ARRAY MOUNTING RACKING; THE METAL CHASSIS OF EQUIPMENT SUCH AS INVERTERS, DISCONNECTS, METERS, JUNCTION BOXES AND COMBINER BOXES; AND METAL CONDUIT HOLDING CIRCUITS > 250 VOLTS TO GROUND PER NEC 250.97		11/16/2021																													
3. THE GEC (GROUNDING ELECTRODE CONDUCTOR) IS THE CONDUCTOR USED TO CONNECT THE GE OR GE SYSTEM TO THE SYSTEM GC, TO THE EGC, OR TO BOTH.		REV																													
4. THE GE (GROUNDING ELECTRODE) IS A CONDUCTING OBJECT, OFTEN A ROD, RING, OR PLATE ESTABLISHING A DIRECT CONNECTION TO EARTH. THE AC SYSTEM GROUND IS EXISTING, USUALLY AT THE EXISTING MAIN PANEL AND/OR UTILITY METER. THE GROUND CAN ONLY OCCUR IN ONE PLACE AND MUST NOT BE DUPLICATED IN SUB-PANELS OR ANYWHERE ELSE ON AC SIDE.																															
ELECTRICAL SYMBOL LEGEND		6.500 kW PHOTOVOLTAIC PLANS																													
<table><tr><td><div>CB</div>DC COMBINER BOX</td><td><div>ATF</div>AUTO TRANSFORMER</td></tr><tr><td><div>DCB</div>DC DISCONNECTING COMBINER BOX</td><td><div>SLC</div>SOLAR LOAD CENTER</td></tr><tr><td><div>DC</div>DC DISCONNECT</td><td><div>ACC</div>AC COMBINER</td></tr><tr><td><div>INV#</div>DC/AC STRING INVERTER</td><td><div>BATT</div>BATTERY</td></tr><tr><td><div>CLP</div>CRITICAL LOADS PANEL</td><td><div>AC</div>AC DISCONNECT</td></tr><tr><td><div>RSD</div>RAPID SHUTDOWN</td><td><div>SP</div>SERVICE PANEL</td></tr><tr><td><div>SUB</div>SUB-PANEL</td><td><div>P</div>PERFORMANCE METER</td></tr><tr><td></td><td><div>M</div>UTILITY METER</td></tr><tr><td><div>SECTION</div></td><td><div>XFMR</div>TRANSFORMER</td></tr><tr><td><div>1</div></td><td><div>JB</div>JUNCTION BOX</td></tr><tr><td><div>PV ARRAY TAG</div></td><td><div>ATS</div>AUTO TRANSFER SWITCH</td></tr><tr><td><div>SECTION #</div></td><td></td></tr><tr><td><div>MODULE GROUP</div></td><td></td></tr></table>		<div>CB</div> DC COMBINER BOX	<div>ATF</div> AUTO TRANSFORMER	<div>DCB</div> DC DISCONNECTING COMBINER BOX	<div>SLC</div> SOLAR LOAD CENTER	<div>DC</div> DC DISCONNECT	<div>ACC</div> AC COMBINER	<div>INV#</div> DC/AC STRING INVERTER	<div>BATT</div> BATTERY	<div>CLP</div> CRITICAL LOADS PANEL	<div>AC</div> AC DISCONNECT	<div>RSD</div> RAPID SHUTDOWN	<div>SP</div> SERVICE PANEL	<div>SUB</div> SUB-PANEL	<div>P</div> PERFORMANCE METER		<div>M</div> UTILITY METER	<div>SECTION</div>	<div>XFMR</div> TRANSFORMER	<div>1</div>	<div>JB</div> JUNCTION BOX	<div>PV ARRAY TAG</div>	<div>ATS</div> AUTO TRANSFER SWITCH	<div>SECTION #</div>		<div>MODULE GROUP</div>		NAME: Dodsworth, Janet			
<div>CB</div> DC COMBINER BOX	<div>ATF</div> AUTO TRANSFORMER																														
<div>DCB</div> DC DISCONNECTING COMBINER BOX	<div>SLC</div> SOLAR LOAD CENTER																														
<div>DC</div> DC DISCONNECT	<div>ACC</div> AC COMBINER																														
<div>INV#</div> DC/AC STRING INVERTER	<div>BATT</div> BATTERY																														
<div>CLP</div> CRITICAL LOADS PANEL	<div>AC</div> AC DISCONNECT																														
<div>RSD</div> RAPID SHUTDOWN	<div>SP</div> SERVICE PANEL																														
<div>SUB</div> SUB-PANEL	<div>P</div> PERFORMANCE METER																														
	<div>M</div> UTILITY METER																														
<div>SECTION</div>	<div>XFMR</div> TRANSFORMER																														
<div>1</div>	<div>JB</div> JUNCTION BOX																														
<div>PV ARRAY TAG</div>	<div>ATS</div> AUTO TRANSFER SWITCH																														
<div>SECTION #</div>																															
<div>MODULE GROUP</div>																															
		ADDRESS: 3035 County Rd 18																													
		ADDRESS: Lake City, FL 32025																													
		APN:																													
PV AC DISCONNECT LOCATED ON ACCESSIBLE EXTERIOR WALL WITH EXTERNAL HANDLE VISIBLE, LOCKABLE & LABELED WITHIN 10 FEET OF THE METER.		CVC56966																													
		2100 N Main St Ste. 212																													
		Fort Worth, TX 76164																													
		(817) 501-4922																													
THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES		Daybreak Install LLC																													
SCALE: 1/16" = 1'0" @ SHEET SIZE A3																															

SECTION

PV ARRAY TAG

1

SECTION #

MODULE GROUP

1		CONDUIT, RACEWAY, J-BOX, AND PULL BOXES		SCALE: 1/2" = 1'-0"		2		DC DISCONNECTS		SCALE: 1/4" = 1'-0"		3		INVERTER(S)		SCALE: 1/4" = 1'-0"		SHEET NOTES																													
<div>WARNING: PHOTOVOLTAIC POWER SOURCE</div> <div><div>1. PLACE ON CONDUIT AND/OR RACEWAYS EVERY 10' (60"), 12" FROM BENDS, 12" ABOVE AND BELOW PENETRATIONS.</div><div>2. CODE REFERENCE: NEC 690.31(G)(3)</div><div>3. MINIMUM OF 1 1/8" x 5 3/4"</div><div>4. FONT: 3/8" AND .8 WIDTH FACTOR.</div><div>5. REFLECTIVE WHITE LETTERS ON A RED BACKGROUND.</div></div>																		<div>WARNING</div> <div>ELECTRICAL SHOCK HAZARD</div> <div>TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENGERGIZED IN THE OPEN POSITION</div> <div><div>1. PLACED ON DC DISCONNECT(S) AND ON ANY EQUIPMENT THAT STAYS ENERGIZED IN THE OFF POSITION FROM THE PV SUPPLY.</div><div>2. CODE REFERENCE: NEC 690.13(B)</div><div>3. MINIMUM OF 3 1/2" x 10"</div><div>4. FONT: 3/8"</div><div>5. WARNING LABEL IS WHITE AND ORANGE</div></div>										<div>WARNING</div> <div>THE DISCONNECTION OF THE GROUNDED CONDUCTOR(S) MAY RESULT IN OVERVOLTAGE ON THE EQUIPMENT</div> <div><div>1. MINIMUM OF 3 1/2" x 10 1/2"</div><div>2. FONT: 3/8"</div><div>3. WARNING LABEL IS WHITE AND ORANGE</div></div>										<div>CODE ABBREVIATIONS: NATIONAL ELECTRICAL CODE (NEC) INTERNATIONAL BUILDING CODE (IBC) INTERNATIONAL RESIDENTIAL CODE (IRC) INTERNATIONAL FIRE CODE (IFC) UNDERWRITERS LABORATORY (UL)</div> <div>1. COMBINATION PLACARDS MAY BE USED IN PLACE OF MULTIPLE PLACARDS FOR THE SAME DEVICE. ALL INFORMATION FROM THE MULTIPLE PLACARDS MUST BE PRESENT.</div> <div>2. BLACK LETTERS WITH YELLOW BACKGROUND MAY BE USED IN PLACE OF THE STANDARD WHITE LETTERS WITH RED BACKGROUND WITH AHJ APPROVAL.</div> <div>3. ALL INTERIOR AND EXTERIOR DC CONDUIT, ENCLOSURES, RACEWAYS, CABLE ASSEMBLIES, JUNCTION BOXES, COMBINER BOXES AND DISCONNECTS ARE MARKED. (NEC 690.31[G], NEC 690.13 &amp; 690.53)</div> <div>4. THE MARKINGS ON THE CONDUITS, RACEWAYS AND CABLE ASSEMBLIES ARE EVERY 10 FEET, WITHIN ONE FOOT OF ALL TURNS OR BENDS AND WITHIN ONE FOOT ABOVE AND BELOW ALL PENETRATIONS OF ROOF/CEILING ASSEMBLIES, WALLS AND BARRIERS. (IFC 605.11.1.4, NEC 690.31[G][3] )</div> <div>5. WHERE PV CIRCUITS ARE EMBEDDED IN BUILT-UP, LAMINATE OR MEMBRANE ROOFING MATERIALS IN ROOF AREAS NOT COVERED BY PV MODULES AND ASSOCIATED EQUIPMENT, THE LOCATION OF CIRCUITS SHALL BE CLEARLY MARKED.</div> <div>6. REQUIRED LABELS SHALL BE PERMANENT AND SUITABLE FOR THE ENVIRONMENT. MATERIALS USED FOR MARKING MUST BE WEATHER RESISTANT. UL STANDARD IS RECOMMENDED TO DETERMINE WEATHER RATING. UL LISTING OF MARKINGS IS NOT REQUIRED. SEE UL LABELING SYSTEM 969 (UL 969)</div> <div>7. MARKING CONTENT AND FORMAT: 7.1. ARIAL OR SIMILAR FONT, NON-BOLD. 7.2. MINIMUM 3/8" LETTER HEIGHT FOR HEADERS. 7.3. MINIMUM 1/16" LETTER HEIGHT FOR DATA 7.4. CONTRASTING BACKGROUND AND LETTERING. 7.5. ALL CAPITAL LETTERS. 7.6. CONTRASTING SPACE BETWEEN ROWS OF TEXT 7.7. DIMENSIONS OF PLACARDS ARE APPROXIMATE. MAY BE REDUCED AND / OR INCREASED TO UL APPROVED MANUFACTURED PRODUCT</div>									
<div>DO NOT OPEN UNDER LOAD</div> <div><div>1. CODE REFERENCE: NEC 690.13(C)</div><div>2. USE ON NON-LOAD BREAK RATED DISCONNECTION.</div><div>3. MINIMUM OF 1" x 6"</div><div>4. FONT: 3/8" AND .8 WIDTH FACTOR</div><div>5. WHITE LETTERS ON A RED BACKGROUND.</div></div>																		<div>DC COMBINER BOX</div> <div>COMBINER # 1</div> <div><div>1. USE PLACARD "COMBINER # 1" WHEN MORE THAN 1 DC COMBINER IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</div><div>2. MINIMUM OF 1" x 4"</div><div>3. FONT: 3/8" AND .75 TO .8 WIDTH FACTOR</div><div>4. WHITE LETTERS ON A RED BACKGROUND.</div></div>										<div>WARNING</div> <div>ARC FLASH HAZARD</div> <div>APPROPRIATE PPE REQUIRED</div> <div>FAILURE TO COMPLY CAN RESULT IN DEATH OR INJURY</div> <div>REFER TO NFPA 70E</div> <div><div>1. VERIFY WHICH PLACARD IS REQUIRED WITH AHJ.</div><div>2. MINIMUM OF 1" x 4"</div><div>3. FONT: 3/8" AND .8 WIDTH FACTOR</div><div>4. WARNING LABEL IS WHITE AND ORANGE</div><div>5. DATA COLLECTED FROM AS-BUILT INFO, PRIOR TO PTO, BY OTHERS.</div></div>																			
																																						7		MAIN SERVICE PANEL		SCALE: 1/4" = 1'-0"		8		AC AND DC DISCONNECTS	
<div>1. LOCATE NO MORE THAN 1 m FROM THE SERVICE DISCONNT MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION.</div> <div>SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN<div><div>TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY.</div><div>SOLAR ELECTRIC PV PANELS</div></div></div> <div><div>2. CODE REFERENCE: NEC 690.56(C)(1)(a)</div><div>3. TITLE: MIN. 3/8" BLACK CHARACTERS ON YELLOW BACKGROUND, REMAINING CHARACTERS MIN. 3/16" IN BLACK ON WHITE BACKGROUND.</div></div>																		<div>AC DISCONNECT # 1</div> <div>DC DISCONNECT # 1</div> <div>USE PLACARD "[AC][DC] DISCONNECT # 1" WHEN MORE THAN ONE DISCONNECT IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</div> <div><div>PHOTOVOLTAIC</div><div>DC DISCONNECT</div><div>PHOTOVOLTAIC</div><div>AC DISCONNECT</div></div> <div><div>1. PLACE ON ALL AC AND DC DISCONNECTS</div><div>2. CODE REFERENCE: NEC 690.13(B)</div><div>3. MINIMUM OF 1" x 10 1/2"</div><div>4. FONT: 3/8"</div><div>5. WHITE LETTERS ON A RED BACKGROUND.</div></div>										<div>WARNING</div> <div>ELECTRICAL SHOCK HAZARD</div> <div>TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENGERGIZED IN THE OPEN POSITION</div> <div>DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT</div> <div><div>1. ONLY FOR UNGROUNDED SYSTEMS.</div><div>2. PLACED ON ALL ENCLOSURES WITH UNGROUNDED CIRCUITS OR DEVICES WHICH ARE ENERGIZED AND MAY BE EXPOSED DURING SERVICE.</div><div>3. MINIMUM OF 3" x 10 1/2"</div><div>4. FONT: 3/8"</div><div>5. WARNING LABEL IS WHITE AND ORANGE</div></div>																			
																																						10		INVERTER(S)		SCALE: 1/2" = 1'-0"		11		RAPID SHUTDOWN SWITCH	
<div>INVERTER # 1</div> <div><div>1. USE PLACARD "INVERTER # 1" WHEN MORE THAN 1 INVERTER IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</div><div>2. MINIMUM OF 1" x 4"</div><div>3. FONT: 3/8"</div><div>4. WHITE LETTERS ON A RED BACKGROUND.</div></div>																		<div>1. A RAPID SHUTDOWN SWITCH SHALL HAVE A LABEL LOCATED ON OR NO MORE THAN 1M (3 FT) FROM THE SWITCH THAT INCLUDES THE FOLLOWING:</div> <div>RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM</div> <div>2. THE LABEL SHALL BE REFLECTIVE WITH ALL LETTERS CAPITALIZED AND HAVING A MINIMUM HEIGHT OF 9.5 MM (3/8 IN.), IN WHITE ON RED BACKGROUND.</div>																													
																												<div>QTY 20 PEIMAR SM325M (FB) MODULES</div> <div>QTY 1 SolarEdge SE5000H-US (240V) INVERTER</div>																			

Daybreak Install LLC

CVC56966

2100 N Main St Ste. 212

Fort Worth, TX 76164

(817) 501-4922

NAME

Dodsworth, Janet

ADDRESS

3035 County Rd 18

ADDRESS

Lake City, FL 32025

APN

6.500 kW PHOTOVOLTAIC PLANS

SCOTT E WYSSLING

PE

No. 81558

STATE OF FLORIDA

PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC


76 N Meadowbrook Drive

Alpine UT 84004 COA # RY34912

Signed 11-17-21

DAYBREAK

ENGINEERS

 <b>Daybreak Install LLC</b> CVC56966 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922	6.500 kW PHOTOVOLTAIC PLANS			REV	DATE	RELEASE
					11/16/2021	SUBMIT FOR PERMIT
	NAME	Dodsworth, Janet				
	ADDRESS	3035 County Rd 18				
	ADDRESS	Lake City, FL 32025				
	APN					
				P-001		STANDARD PLACARDS









## SM325M (FB)


60-CELL LINE

MADE IN ITALY MODULE

Peimar monocrystalline solar panels, produced using a combination of innovative production processes and advanced engineering techniques, provide customers with maximum output and super high performance.

This allows fewer panels to be used to generate more energy, ideal if space is restricted or environmental conditions are challenging. Modern design, using matching black cells and frames and a very long lifespan ensure this monocrystalline are a great option.

### CELLS



60 CELLS  
MONO 5BB / 9BB M3 | **PERC**  
158.75x158.75mm / 6.25x6.25"

### FRAME



COMPACT AND STURDY | **40mm**  
ANCHORABLE ALSO ON THE SHORT SIDE <sup>(5)</sup>

**30** YEAR LINEAR POWER WARRANTY  
 **20** YEAR PRODUCT WARRANTY

**PERC TECHNOLOGY**

**MODULE FIRE PERFORMANCE: CLASS 1**

**ANTI-REFLECTIVE GLASS**

**QBE INSURANCE**  
Product Liability Insurance QBE

www.peimar.com




### ELECTRICAL CHARACTERISTICS (STC) <sup>(1)</sup>

	SM325M (FB)
Nominal Output (Pmax) <sup>(2)</sup>	325 W
Sorting Tolerance	0/+5 W
Voltage at Pmax (Vmp)	34.15 V
Current at Pmax (Imp)	9.52 A
Open Circuit Voltage (Voc) <sup>(3)</sup>	41.67 V
Short Circuit Current (Isc) <sup>(3)</sup>	10.08 A
Maximum System Voltage	1500 V
Maximum Series Fuse Rating	15 A
Module Efficiency	19.48%
Protection class against electric shock	Class II

### MECHANICAL CHARACTERISTICS

Solar Cells	60 (6x10) M3 monocrystalline <b>PERC</b>
Solar Cells Size	158,75x158,75 mm / 6,25x6,25"
Front Cover	3,2 mm / 0,13" thick, low iron tempered glass
Back Cover	TPT (Tedlar-PET-Tedlar)
Encapsulant	EVA (Ethylene vinyl acetate)
Frame	Anodized aluminium alloy, double wall
Frame finishing	Black
Backsheet finishing	Black
Diodes	3 Bypass diodes serviceable
Junction Box	IP67 rated
Connector	MC4 or compatible connector
Cables Length	900 mm / 35.43"
Cables Section	4.0 mm² / 0.006 in²
Dimensions	1665x1002x40 mm / 65.55x39.45x1.57"
Weight	18.6 Kg / 41.01 lbs
Max Load (Test Load) - SF	5400 Pa - 1.5 <sup>(5)</sup>

### DIMENSIONS

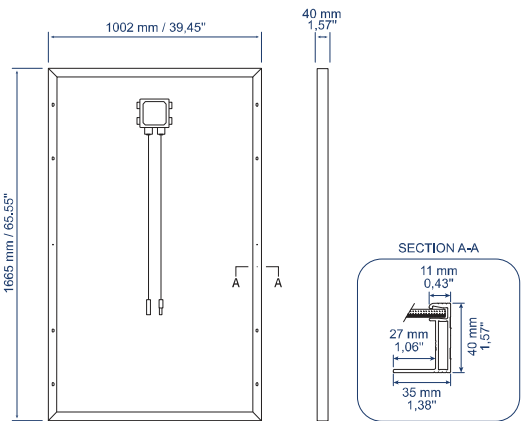

1. STC: (Standard Test Condition) Irradiance 1000W/m²; Module Temperature 25°C; Air Mass 1.5

2. Pmax, Voc, Isc measurement tolerance: ±3%

3. NMOT: Nominal Module Operating Temperature; Irradiance 800W/m²; Air 20°C; Wind speed 1m/s

### TEMPERATURE CHARACTERISTICS

NMOT <sup>(3)</sup>	45±2 °C
Temperature Coefficient of Pmax	-0.37 %/°C
Temperature Coefficient of Voc	-0.28 %/°C
Temperature Coefficient of Isc	0.042 %/°C
Operating Temperature	-40 °C ~ +85°C



### PACKAGING <sup>(4)</sup>

Pallet dimensions	1720x1200x1210 mm / 67.72x47.24x47.64"
Pieces per pallet	27
Weight	535 Kg / 1179 lbs

### CERTIFICATIONS

Fire Resistance Rating	Class of reaction to fire: 1 (UN 9177)
Fire Performance Rating	Type 1 (UL 61730:2017)
Product Certificate	UL 61730:2017

### CURRENT/VOLTAGE CHARACTERISTICS

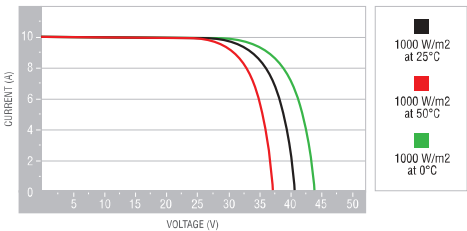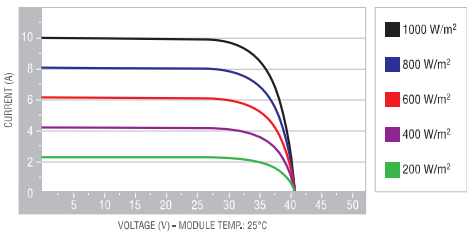

4. Pallets can be stacked up to two

5. Consult the installation manual for the relative mounting configurations

It is important to point out, that all technical specifications, information and figures contained in this datasheet are estimated values. Peimar reserves the right to change the technical specifications, information and figures contained in this document at any time without notice. USA\_2021\_06\_00

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

Daybreak Install LLC

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

NAME Dodsworth, Janet

ADDRESS 3035 County Rd 18

ADDRESS Lake City, FL 32025

APN

REV DATE RELEASE  
11/16/2021 SUBMIT FOR PERMIT

R-100

EQUIP. CUT SHEETS





Certificate of Compliance

Certificate: 80042800 Master Contract: 274817  
Project: 80042800 Date Issued: 2020-11-03  
Issued To: Peimar Inc  
309 Fellowship Road, Suite 115  
East Gate Center  
Mount Laurel, New Jersey, 08054  
United States  
Attention: Stefano Caruso

The products listed below are eligible to bear the CSA Mark shown with adjacent indicators 'C' and 'US' for Canada and US or with adjacent indicator 'US' for US only or without either indicator for Canada only.

Issued by: Michael Hoffnagle  
Michael Hoffnagle



PRODUCTS

CLASS 5311 10 - POWER SUPPLIES - Photovoltaic Modules and Panels  
CLASS 5311 90 - POWER SUPPLIES - Photovoltaic Modules and Panels (Certified to U.S. Standards)



Certificate: 80042800 Master Contract: 274817  
Project: 80042800 Date Issued: 2020-11-03

- Model SMXXXM Series, mono-crystalline silicon, 72 Cell, where xxx is the power output from 405 W to 340 W.

Model	Rated Max @ STC (Watts)	Voltage at Rated @ Max Power (V)	Current at Rated Max Power @ STC (A)	Open Circuit Voltage @ STC (A)	Short Circuit Current @ STC (A)
	(Pmax)	(Vmp)	(Imp)	(Voc)	(Isc)
SM405M	405	41.5	9.76	50.63	10.34
SM400M	400	41.3	9.69	50.39	10.26
SM395M	395	41.1	9.61	50.14	10.18
SM390M	390	40.9	9.54	49.9	10.1
SM385M	385	40.7	9.46	49.66	10.02
SM380M	380	40.5	9.39	49.41	9.94
SM375M	375	40.3	9.31	49.17	9.86
SM370M	370	40.1	9.24	48.92	9.78
SM365M	365	39.9	9.16	48.68	9.7
SM360M	360	39.7	9.09	48.44	9.62
SM355M	355	39.5	9.01	48.19	9.54
SM350M	350	39.3	8.94	47.95	9.46
SM345M	345	39.1	8.86	47.70	9.38
SM340M	340	38.9	8.79	47.46	9.3
Max Series Fuse Rating (A)	15				
Max System Voltage (V)	1500				
Fire Performance Rating	Type 1				

- Model SMXXXM Series, mono-crystalline silicon, 60 Cell, where xxx is the power output from 340 W to 290 W.

Model	Rated Max @ STC (Watts)	Voltage at Rated @ Max Power (V)	Current at Rated Max Power @ STC (A)	Open Circuit Voltage @ STC (A)	Short Circuit Current @ STC (A)
	(Pmax)	(Vmp)	(Imp)	(Voc)	(Isc)
SM340M	340	34.75	9.79	42.39	10.37
SM335M	335	34.55	9.7	42.16	10.27
SM330M	330	34.35	9.61	41.91	10.18
SM325M	325	34.15	9.52	41.67	10.08
SM320M	320	33.95	9.43	41.42	9.98

REV	DATE	RELEASE
	11/16/2021	SUBMIT FOR PERMIT
6.500 kW PHOTOVOLTAIC PLANS		
NAME	Dodsworth, Janet	
ADDRESS	3035 County Rd 18	
ADDRESS	Lake City, FL 32025	
APN		
CVC56966		
2100 N Main St Ste. 212		
Fort Worth, TX 76164		
(817) 501-4922		
Daybreak Install LLC	R-101	EQUIP. CUT SHEETS







Certificate: 80042800  
Project: 80042800

Master Contract: 274817  
Date Issued: 2020-11-03

SM315M	315	33.75	9.34	41.18	9.89
SM305M	305	33.55	9.25	40.94	9.79
SM300M	300	33.35	9.16	40.70	9.69
SM295M	295	33.15	9.07	40.45	9.59
SM290M	290	32.95	8.98	40.21	9.50
Max Series Fuse Rating (A)	15				
Max System Voltage (V)	1500				
Fire Performance Rating	Type 1				

Design Load: 3600 Pa  
Test Load: 5400 Pa

Notes:

- Rated electrical characteristics are within +/-10% of measured values at Standard Test Conditions of 100 mW/cm2 irradiance, AM 1.5 spectrum, and 25°C.
- 1500V maximum system voltage can only be used with 1500V rated components (Junction box, connector and cable)

APPLICABLE REQUIREMENTS

CAN/CSA-C22.2 No. 61730-1:19	Photovoltaic (PV) module safety qualification - Part 1: Requirements for construction
CAN/CSA-C22.2 No. 61730-2:19	Photovoltaic (PV) module safety qualification - Part 2: Requirements for testing
UL 61730-1:2017	Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction
UL 61730-2:2017	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing

MARKINGS

The manufacturer is required to apply the following markings:

- Products shall be marked with the markings specified by the particular product standard.
- Products certified for Canada shall have all Caution and Warning markings in both English and French.



Additional bilingual markings not covered by the product standard(s) may be required by the Authorities Having Jurisdiction. It is the responsibility of the manufacturer to provide and apply these additional markings, where applicable, in accordance with the requirements of those authorities.



Certificate: 80042800  
Project: 80042800

Master Contract: 274817  
Date Issued: 2020-11-03

The products listed are eligible to bear the CSA Mark shown with adjacent indicators 'C' and 'US' for Canada and US (indicating that products have been manufactured to the requirements of both Canadian and U.S. Standards) or with adjacent indicator 'US' for US only or without either indicator for Canada only.

1. The following markings appear on the enclosure by silk-screening, permanent ink stamping, on adhesive labels that appear on the CSA List of Accepted Adhesive Nameplates, or by other permanent method:  
Each PV module shall include the following clear and indelible markings:  
a) Submittor’s name and/or CSA Master Contract number “266494”.  
b) Model designation.  
c) Complete electrical ratings at STC:  
- Open-circuit voltage (include tolerances)  
- Operating voltage  
- Maximum system voltage  
- Short-circuit current (include tolerances)  
- Current at rated operating voltage  
- Maximum power (include tolerances)  
d) date and place of manufacture; alternatively serial number assuring traceability of date and place of manufacture;  
e) PV module classification: Class II, as indicated   
f) PV module application class: Class A  
g) For Class II PV modules, the (IEC 60417-6042: Caution, risk of electric shock) symbol shall be applied, the caution mark:   
h) Maximum over-current protection rating.  
i) The CSA Monogram with the “C/US” indicators;
2. All electrical data shall be shown as relative to standard test conditions (STC) (1 000 W/m², (25 ± 2) °C, AM 1.5 according to IEC 60904-3).
3. Polarity of terminals or leads, PV connectors shall be clearly marked indicating the terminal polarity. A module or panel may be identified with one of the following marking statements:  
“+” and “-” or  
“POS” and “NEG” or  
“POSITIVE” and “NEGATIVE”

6.500 kW PHOTOVOLTAIC PLANS

Daybreak Install LLC

CVC56966

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

NAME	Dodsworth, Janet
ADDRESS	3035 County Rd 18
ADDRESS	Lake City, FL 32025
APN	

REV	DATE	RELEASE
	11/16/2021	SUBMIT FOR PERMIT

R-102

EQUIP. CUT SHEETS





Certificate: 80042800  
Project: 80042800

Master Contract: 274817  
Date Issued: 2020-11-03

4. PV connectors or wiring shall be marked in accordance with IEC 62852 with “Do not disconnect under load”. Symbol or warning notice shall be imprinted or labelled close to connector.

The following symbols may be used to show that a PV connector shall not be disconnected under load. See Figures A.1 and A.2.

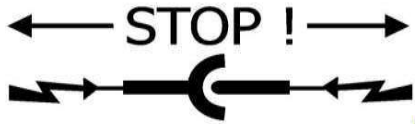


Figure A.1 – Symbol “DO NOT DISCONNECT UNDER LOAD”





Figure A.2 – Symbol “DO NOT DISCONNECT UNDER LOAD” (IEC 60417-6070)

5. A wiring terminal or bonding location of a PV module intended to accommodate a field installed bonding conductor for equipotential bonding shall be identified with the appropriate symbol IEC 60417-5019 . Each grounding point is identified with ground symbol located adjacent to terminal.
6. PV modules provided with terminals for field wiring rated only for use with copper wire shall be marked, at or adjacent to the terminals, with the statement "Use copper wire only", "Cu only", or the equivalent.
7. PV modules provided with terminals for field wiring rated only for use with a different specific wiring material shall be marked with a similar statement referring to the rated material.
8. PV modules provided with terminals for field wiring rated for use with all types of wiring material do not need to be marked.
9. The recommended maximum series/ parallel module configurations shall be applied to either the module or placed into the instruction and installation manual.
10. A module employing a nonmetallic junction box having a threaded or unthreaded opening shall be marked “for use with nonmetallic conduit systems only” or the equivalent.
11. A module employing a nonmetallic junction box having threaded or unthreaded opening shall be marked “For use with nonmetallic conduit systems only” or the equivalent.
12. System Fire Class Rating: See Installation Instructions for Installation Requirements to Achieve a Specified System Fire Class Rating with this Product, this statement should be marked on the label.
13. Module Fire Performance: Class A (CSA 61730:2019) or Type 1 (UL 61730:2017).



*Supplement to Certificate of Compliance*

Certificate: 80042800

Master Contract: 274817

*The products listed, including the latest revision described below, are eligible to be marked in accordance with the referenced Certificate.*

**Product Certification History**

Project	Date	Description
80042800	2020-11-03	New Certification Evaluation of Peimar PV modules to UL61730 and CAN/CSA 61730 Standards from IEC CB Scheme. Additional models and components were added to the project.  - CB Certificates for IEC 61730-1 and -2 are provided along with supporting IEC test reports - Gap testing only for UL ND - Fire testing will be carried over from UL1703 certification report.

REV	DATE	RELEASE
	11/16/2021	SUBMIT FOR PERMIT
EQUIP. CUT SHEETS		
R-103		

6.500 kW PHOTOVOLTAIC PLANS			
NAME	Dodsworth, Janet		
ADDRESS	3035 County Rd 18		
ADDRESS	Lake City, FL 32025		
APN			

Daybreak Install LLC	CVC56966
2100 N Main St Ste. 212	
Fort Worth, TX 76164	
(817) 501-4922	



# Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



12-25  
YEAR  
WARRANTY

INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking efficiency
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Extremely small
- Built-in module-level monitoring
- Outdoor and indoor installation
- Optional: Revenue grade data, ANSI C12.20 Class 0.5 (0.5% accuracy)

[solaredge.com](http://solaredge.com)



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
OUTPUT								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac
AC Frequency (Nominal)	59.3 - 60 - 60.5 <sup>®</sup>							Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A
GFDI Threshold	1							A
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes							
INPUT								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded	Yes							
Maximum Input Voltage	480							Vdc
Nominal DC Input Voltage	380				400			Vdc
Maximum Input Current @240V <sup>(2)</sup>	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V <sup>(2)</sup>	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current	45							Adc
Reverse-Polarity Protection	Yes							
Ground-Fault Isolation Detection	600k $\Omega$ Sensitivity							
Maximum Inverter Efficiency	99	99.2						%
CEC Weighted Efficiency	99						99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption	< 2.5							W
ADDITIONAL FEATURES								
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)							
Revenue Grade Data, ANSI C12.20	Optional <sup>®</sup>							
Rapid Shutdown - NEC 2014 and 2017 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect							
STANDARD COMPLIANCE								
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07							
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (HI)							
Emissions	FCC Part 15 Class B							
INSTALLATION SPECIFICATIONS								
AC Output Conduit Size / AWG Range	3/4" minimum / 14-6 AWG					3/4" minimum /14-4 AWG		
DC Input Conduit Size / # of Strings / AWG Range	3/4" minimum / 1-2 strings / 14-6 AWG					3/4" minimum / 1-3 strings / 14-6 AWG		
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174					21.3 x 14.6 x 7.3 / 540 x 370 x 185		in / mm
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9		38.8 / 17.6		lb / kg	
Noise	< 25				<50			dBA
Cooling	Natural Convection							
Operating Temperature Range	-40 to +140 / -25 to +60 <sup>®</sup> (-40°F / -40°C option) <sup>(5)</sup>							°F / °C
Protection Rating	NEMA 4X (Inverter with Safety Switch)							

<sup>(1)</sup> For other regional settings please contact SolarEdge support  
<sup>(2)</sup> A higher current source may be used; the inverter will limit its input current to the values stated  
<sup>(3)</sup> Revenue grade inverter P/N: SExxxxH-US000NNC2  
<sup>(4)</sup> For power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>  
<sup>(5)</sup> -40 version P/N: SExxxxH-US000NNU4

© SolarEdge Technologies, Inc. All rights reserved. SOLAREGE, the SolarEdge logo, OPTIMIZED BY SOLAREGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2018/V01/ENG NAM. Subject to change without notice.

RoHS

6.500 kW PHOTOVOLTAIC PLANS

Daybreak Install LLC

REV 11/16/2021

RELEASE

DATE

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

SUBMIT FOR PERMIT

11/16/2021

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

&lt;



Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505



POWER OPTIMIZER

PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

solaredge.com



Power Optimizer  
For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505

Optimizer model (typical module compatibility)	P320 (for 60-cell modules)	P340 (for high-power 60-cell modules)	P370 (for higher-power 60 and 72-cell modules)	P400 (for 72 & 96-cell modules)	P401 (for high power 60 and 72 cell modules)	P405 (for high-voltage modules)	P485 (for high-voltage modules)	P505 (for higher current modules)	
INPUT									
Rated Input DC Power <sup>(1)</sup>	320	340	370	400		405	485	505	W
Absolute Maximum Input Voltage (Voc at lowest temperature)	48		60	80	60	125 <sup>(2)</sup>		83 <sup>(2)</sup>	Vdc
MPPT Operating Range	8 - 48		8 - 60	8 - 80	8-60	12.5 - 105		12.5 - 83	Vdc
Maximum Short Circuit Current (Isc)	11			10.1	11.75	11		14	Adc
Maximum DC Input Current	13.75			12.5	14.65	12.5		17.5	Adc
Maximum Efficiency	99.5								%
Weighted Efficiency	98.8							98.6	%
Overvoltage Category	II								
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)									
Maximum Output Current	15								Adc
Maximum Output Voltage	60					85			Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)									
Safety Output Voltage per Power Optimizer	1 ± 0.1								Vdc
STANDARD COMPLIANCE									
EMC	FCC Part15 Class B, IEC61000-6-2, IEC61000-6-3								
Safety	IEC62109-1 (class II safety), UL1741								
Material	UL94 V-0 , UV Resistant								
RoHS	Yes								
INSTALLATION SPECIFICATIONS									
Maximum Allowed System Voltage	1000								Vdc
Compatible inverters	All SolarEdge Single Phase and Three Phase inverters								
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1			129 x 153 x 33.5 / 5.1 x 6 x 1.3	129 x 153 x 29.5 / 5.1 x 6 x 1.16	129 x 159 x 49.5 / 5.1 x 6.3 x 1.9		129 x 162 x 59 / 5.1 x 6.4 x 2.3	mm / in
Weight (including cables)	630 / 1.4			750 / 1.7	655 / 1.5	845 / 1.9		1064 / 2.3	gr / lb
Input Connector	MC4 <sup>(3)</sup>						Single or dual MC4 <sup>(3)(4)</sup>	MC4 <sup>(3)</sup>	
Input Wire Length	0.16 / 0.52								m / ft
Output Wire Type / Connector	Double Insulated / MC4								
Output Wire Length	0.9 / 2.95		1.2 / 3.9						m / ft
Operating Temperature Range <sup>(5)</sup>	-40 - +85 / -40 - +185								°C / °F
Protection Rating	IP68 / NEMA6P								
Relative Humidity	0 - 100								%

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed  
(2) NEC 2017 requires max input voltage be not more than 80V  
(3) For other connector types please contact SolarEdge  
(4) For dual version for parallel connection of two modules use P485-4NMDMRM. In the case of an odd number of PV modules in one string, installing one P485 dual version power optimizer connected to one PV module. When connecting a single module seal the unused input connectors with the supplied pair of seals.  
(5) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details.

PV System Design Using a SolarEdge Inverter <sup>(6)(7)</sup>	Single Phase HD-Wave	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	P320, P340, P370, P400, P401 P405, P485, P505	8	10	18	
Maximum String Length (Power Optimizers)		6	8	14	
		25	25	50 <sup>(8)</sup>	
Maximum Power per String	5700 (6000 with SE7600-US - SE11400-US)	5250	6000 <sup>(9)</sup>	12750 <sup>(10)</sup>	W
Parallel Strings of Different Lengths or Orientations	Yes				

(6) For detailed string sizing information refer to: [http://www.solaredge.com/sites/default/files/string\\_sizing\\_na.pdf](http://www.solaredge.com/sites/default/files/string_sizing_na.pdf)  
(7) It is not allowed to mix P405/P485/P505 with P320/P340/P370/P400/P401 in one string  
(8) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement  
(9) For 208V grid: it is allowed to install up to 6,500W per string when the maximum power difference between each string is 1,000W  
(10) For 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W



Daybreak Install LLC

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

CVC56966

6.500 kW PHOTOVOLTAIC PLANS

NAME  
ADDRESS  
ADDRESS  
APN

Dodsworth, Janet  
3035 County Rd 18  
Lake City, FL 32025

REV

DATE  
11/16/2021

RELEASE  
SUBMIT FOR PERMIT

R-105

EQUIP. CUT SHEETS





Ground Mount System

Datasheet



Mount on all terrains, in no time.

The IronRidge Ground Mount System combines our XR1000 rails with locally-sourced steel pipes or mechanical tubing, to create a cost-effective structure capable of handling any site or terrain challenge. Installation is simple with only a few structural components and no drilling, welding, or heavy machinery required. In addition, the system works with a variety of foundation options, including concrete piers and driven piles.



**Rugged Construction**  
Engineered steel and aluminum components ensure durability.



**UL 2703 Listed System**  
Meets newest effective UL 2703 standard.



**Flexible Architecture**  
Multiple foundation and array configuration options.



**PE Certified**  
Pre-stamped engineering letters available in most states.



**Design Software**  
Online tool generates engineering values and bill of materials.



**20-Year Warranty**  
Twice the protection offered by competitors.



Substructure

Top Caps



Connect vertical and cross pipes.

Bonded Rail Connectors ☺



Attach and bond Rail Assembly to cross pipes.

Diagonal Braces



Optional Brace provides additional support.

Cross Pipe & Piers



Steel pipes or mechanical tubing for substructure.

Rail Assembly

XR1000 Rails



Curved rails increase spanning capabilities.

UFOs ☺



Universal Fastening Objects bond modules to rails.

Stopper Sleeves ☺



Snap onto the UFO to turn into a bonded end clamp.

Accessories



Wire Clips and End Caps provide a finished look.

Resources



**Design Assistant**  
Go from rough layout to fully engineered system. For free.  
Go to [ironridge.com/design](https://ironridge.com/design)



**NABCEP Certified Training**  
Earn free continuing education credits, while learning more about our systems.  
Go to [ironridge.com/training](https://ironridge.com/training)



360° Product Tour  
Visit [ironridge.com](https://ironridge.com)

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

Daybreak Install LLC

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

REV 11/16/2021

DATE 11/16/2021

RELEASE SUBMIT FOR PERMIT

NAME Dodsworth, Janet

ADDRESS 3035 County Rd 18

ADDRESS Lake City, FL 32025


APN

R-106


EQUIP. CUT SHEETS



RACKING & RAIL CUT SHEET

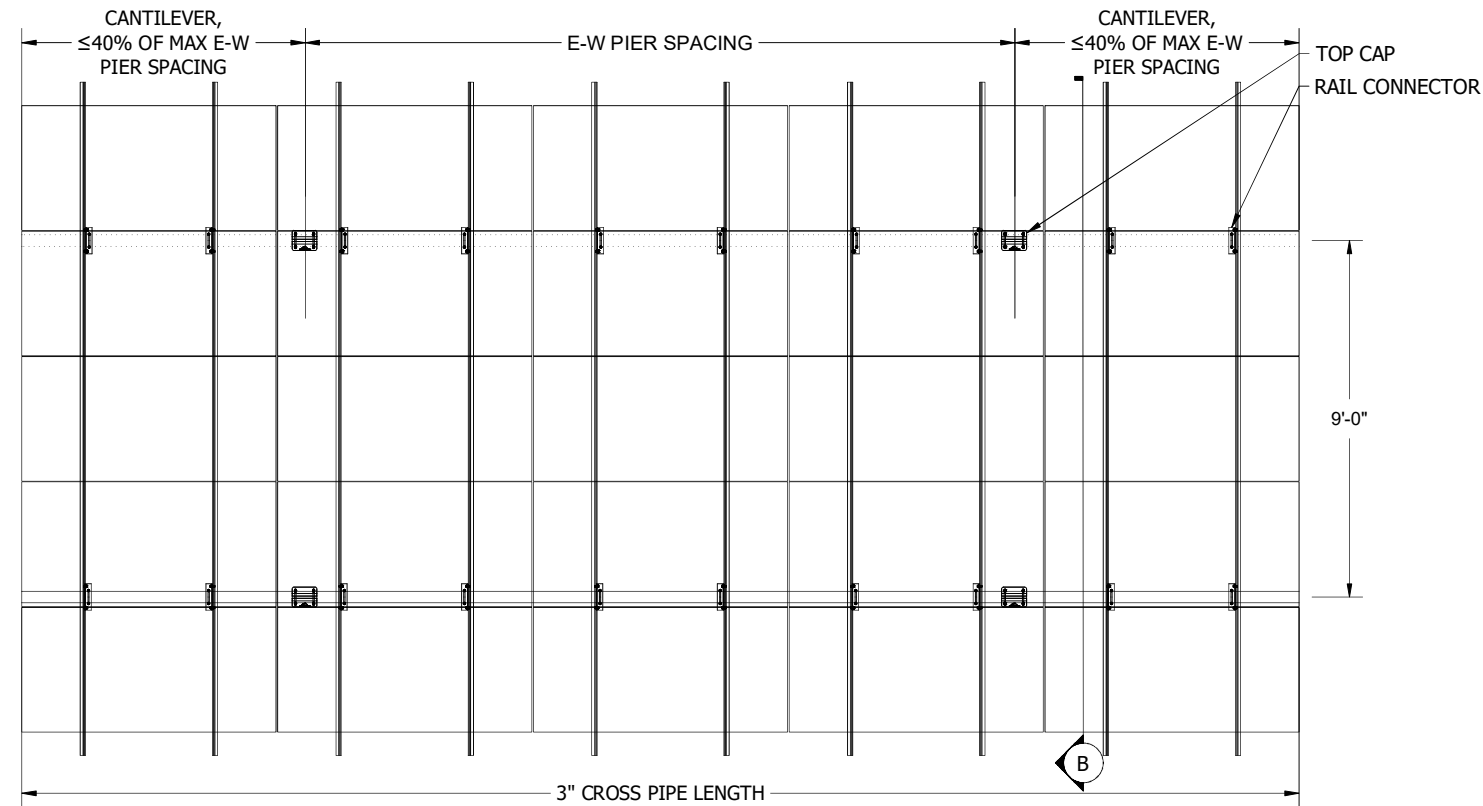


A 5-UP - PV SYSTEM PLAN DETAIL  
Scale: 1/2"=1'-0"

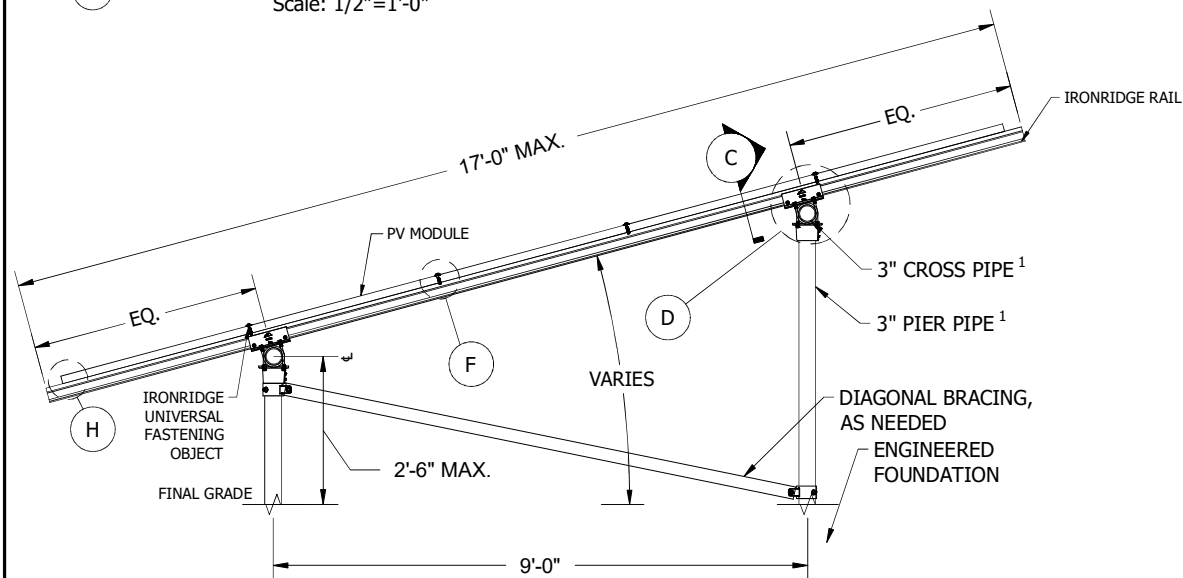


B 5-UP - PV SYSTEM SIDE SECTION  
Scale: 3/4"=1'-0"


- SHEET NOTES
1. SCHEDULE 40 PIPE OR ALLIED MECHANICAL TUBING (8GA WALL THICKNESS)

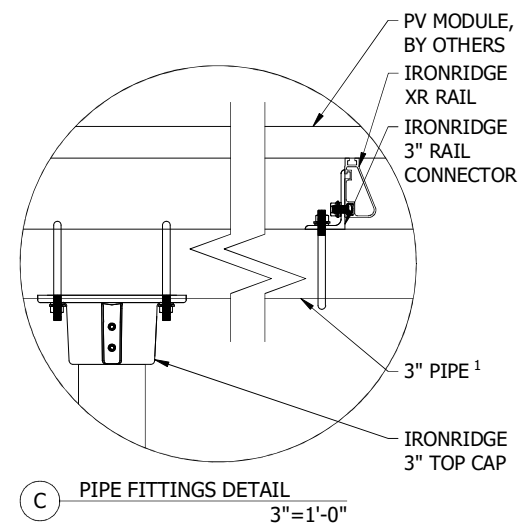


C PIPE FITTINGS DETAIL  
3"=1'-0"

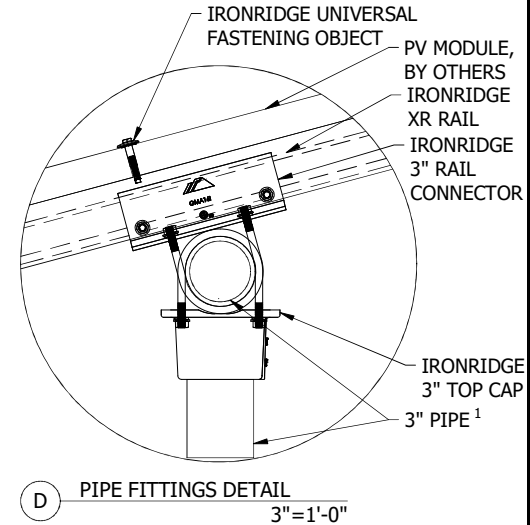


D PIPE FITTINGS DETAIL  
3"=1'-0"

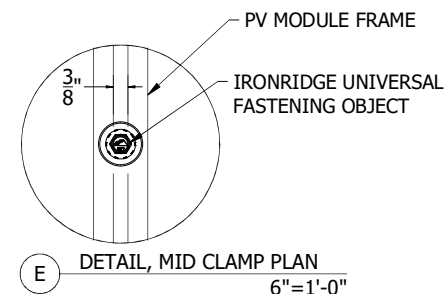


E DETAIL, MID CLAMP PLAN  
6"=1'-0"

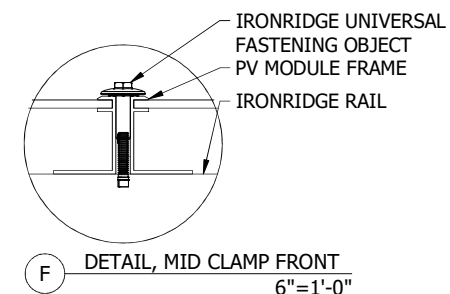


F DETAIL, MID CLAMP FRONT  
6"=1'-0"

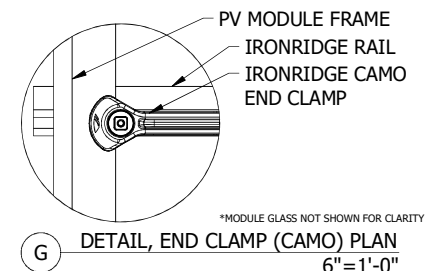


G DETAIL, END CLAMP (CAMO) PLAN  
6"=1'-0"

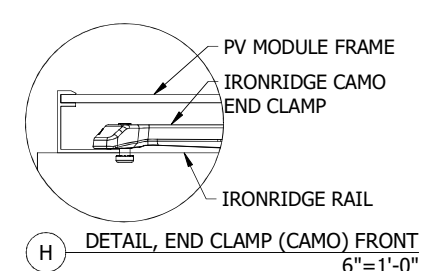

H DETAIL, END CLAMP (CAMO) FRONT  
6"=1'-0"

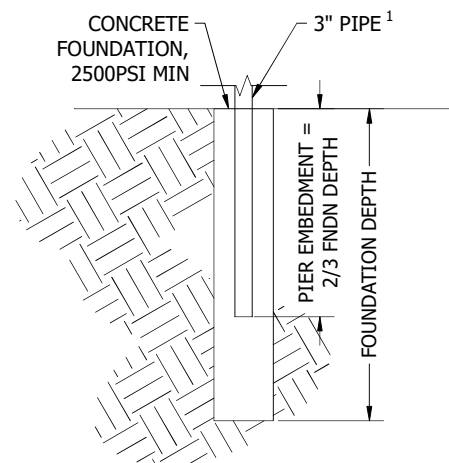


J DRILL/POUR FOUNDATION  
Scale: 3/4"=1'-0"

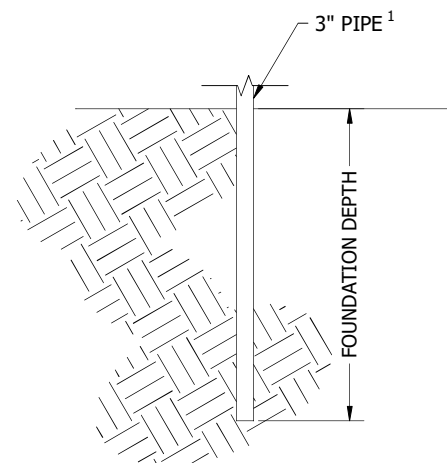

\*ADDITIONAL ENGINEERING REQUIRED

K DRIVEN PIER FOUNDATION  
Scale: 3/4"=1'-0"

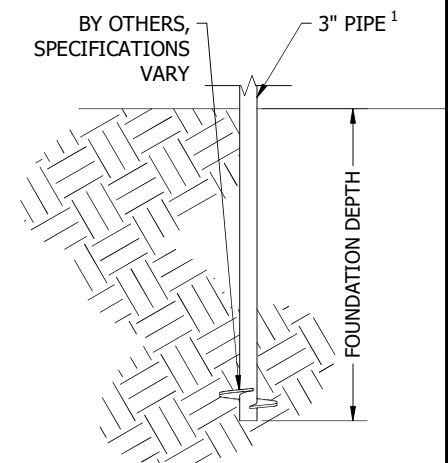

\*ADDITIONAL ENGINEERING REQUIRED

L HELICAL PILE FOUNDATION  
Scale: 3/4"=1'-0"



1495 ZEPHYR AVE, HAYWARD, CA 94544  
800.227.9523 IRONRIDGE.COM

CLIENT NAME	IRONRIDGE
PROJECT NAME	GROUND MOUNT SYSTEM
PROJECT ADDRESS	
SYSTEM KW DC	

WIND SPEED, MPH	
SNOW LOAD, PSF	
EXPOSURE CAT	
RISK CAT	
MODULE TYPE	72 CELL, GENERIC
MODULE W DC	
MODULE QTY	

>	5								
APPROVAL STATUS									

SHEET NAME	PV SYSTEM DETAILS
JOB NO.	2.09 GM
ISSUE DATE	JUNE 2018
SHEET NO.	IR 6.1
SHEET SIZE	24X36

6.500 kW PHOTOVOLTAIC PLANS

CVC56966  
2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

Daybreak Install LLC

REV 11/16/2021  
DATE 11/16/2021  
RELEASE SUBMIT FOR PERMIT

NAME Dodsworth, Janet

ADDRESS 3035 County Rd 18

ADDRESS Lake City, FL 32025

APN

R-107

EQUIP. CUT SHEETS







Starling Madison Lofquist, Inc.  
*Consulting Structural and Forensic Engineers*

5224 South 39<sup>th</sup> Street, Phoenix, Arizona 85040  
tel: (602) 438-2500 fax: (602) 438-2505 ROC#291316 [www.smleng.com](http://www.smleng.com)

IronRidge  
28357 Industrial Boulevard  
Hayward, CA 94545

July 1, 2019  
Page 1 of 52

Attn: Mr. Corey Geiger, VP New Markets, IronRidge Inc.

Subject: Ground Mounting System – Structural Analysis – 5 Module (XR1000)

Dear Sir:

We have analyzed the subject ground mounted structure and determined that it is in compliance with the applicable sections of the following Reference Documents:

Codes: ASCE/SEI 7-16 Min. Design Loads for Buildings & Other Structures  
Florida Building Code, 2020 Edition  
Other: AC428, Acceptance Criteria for Modular Framing Systems Used to Support PV  
Modules, dated Effective November 1, 2012 by ICC-ES  
Aluminum Design Manual, 2015 Edition  
IronRidge Exhibit EX-0002

The structure is a simple column (pier) and beam (cross pipe) system. The piers & cross pipes are ASTM A53 Grade B standard weight (schedule 40) steel pipes or Allied Mechanical Tubing. Please refer to Exhibit EX-0002 for approved pipe geometry and material properties. The tops of the piers are connected in the E-W direction by the cross pipes which cantilever over and extend past the end piers. The cross pipes are connected by proprietary IronRidge XR1000 Rails spanning up and down the slope which cantilever over and extend past the top and bottom cross pipes. There are typically two rails per column of modules. The modules are clamped to the rails by the IronRidge Module Mounting Clamps as shown in the attached Exhibit.

Gravity loads are transferred to the piers and foundations by the rails and cross pipes acting as simple beams. For lateral loads the system is either a cantilever structure or, when diagonal braces are provided, a braced frame. The effect of seismic loads (for all design categories A-F) have been determined to be less than the effect due to wind loads in all load conditions and combinations.

The pier spacing in the N-S direction is 9'-0". The pier spacing in the E-W direction is selected from load tables determined by the structural design for the specified slope, wind load, and snow load. The governing criteria for the pier spacing is either the spanning capacity of the cross pipes or the cantilever capacity of the pier. Simplified Load Tables 1A-F & 2A-F are included herein for reference.

More comprehensive information covering all load combinations is available at the IronRidge website, [IronRidge.com](http://IronRidge.com).

IronRidge  
Mr. Corey Geiger  
Ground Mounting System – Structural Analysis – 5 Module (XR1000)

July 1, 2019  
Page 11 of 52

**Table 2D - MAXIMUM PIER SPACING (in)**



3" Braced Pipe Frame	Snow	Slope (deg)									
Wind Speed & Exposure Category	psf	0	5	10	15	20	25	30	35	40	45
100 mph Exposure B	0	206	206	202	196	187	179	172	172	173	174
	10	182	182	180	178	176	175	172	172	173	174
	20	155	155	155	154	155	157	158	163	170	174
	30	145	146	145	144	146	149	152	158	165	172
	40	133	133	133	132	135	139	142	149	157	166
	50	121	121	122	123	126	130	135	142	150	160
105 mph Exposure B	60	111	111	112	113	119	123	128	135	144	154
	0	206	206	194	189	179	172	165	165	166	166
	10	182	182	176	174	172	170	165	165	166	166
	20	155	155	152	151	152	153	154	159	165	166
	30	145	146	143	142	144	146	148	153	160	166
	40	133	133	131	131	133	136	140	146	153	161
110 mph Exposure B	50	121	121	122	122	125	128	132	139	147	156
	60	111	111	112	113	118	122	126	133	141	151
	0	206	206	187	182	173	165	158	158	159	160
	10	182	182	172	170	167	165	158	158	159	160
	20	155	155	149	148	149	149	150	155	159	160
	30	145	146	141	140	141	143	145	150	156	160
120 mph Exposure B	40	133	133	129	129	131	134	137	142	149	157
	50	121	121	120	120	123	126	130	136	144	152
	0	198	203	174	169	160	153	147	146	147	148
	10	178	180	164	162	158	153	147	146	147	148
	20	153	154	144	143	143	143	143	146	147	148
	30	143	145	136	135	136	137	138	142	147	148
130 mph Exposure B	40	131	132	126	125	127	129	131	136	142	148
	50	121	121	118	117	119	122	125	130	137	144
	0	186	191	163	158	149	143	137	136	137	137
	10	171	174	157	154	149	143	137	136	137	137
	20	148	150	139	138	137	136	135	136	137	137
	30	140	141	132	131	131	131	131	135	137	137
140 mph Exposure B	40	128	130	123	122	123	124	125	130	135	137
	50	119	120	115	114	116	118	120	125	131	137
	0	175	180	153	148	140	133	128	127	128	128
	10	164	167	150	147	140	133	128	127	128	128
	20	144	146	134	133	131	130	128	127	128	128
	30	136	138	128	127	126	126	125	127	128	128
150 mph Exposure B	40	125	127	119	118	119	119	120	124	128	128
	50	117	118	112	111	113	114	115	120	125	128
	0	165	170	144	139	132	125	120	119	120	120
	10	158	161	143	139	132	125	120	119	120	120
	20	140	142	130	128	126	124	120	119	120	120
160 mph Exposure B	30	132	134	124	122	121	120	120	119	120	120
	40	123	124	116	115	115	115	115	118	120	120
	0	157	161	136	131	124	118	113	112	113	113
	10	152	155	136	131	124	118	113	112	113	113
	20	136	138	125	123	121	118	113	112	113	113
160 mph Exposure B	30	129	131	120	118	117	116	113	112	113	113
	40	120	121	113	111	111	111	110	112	113	113

Notes: see page 14

IronRidge  
Mr. Corey Geiger  
Ground Mounting System – Structural Analysis – 5 Module (XR1000)

July 1, 2019  
Page 14 of 52

Notes for Tables 1 & 2:

1.  = Indicated region denotes the requirement for (3) three XR1000 rails.
-  = Indicated region denotes special requirements for XR1000 rails – contact IronRidge.
2. Cross pipe splices not permitted in outer 2/3 of end spans, or the middle 1/3 of interior spans based on the installed attachment spacing ( $L_{install}$ ). See Figure A
3. End cantilever span of pipe rails (max) =  $0.40 \times$  maximum span ( $L_{max}$ ) from above tables. See Figure A
4. When installations occur on a N-S grade, the design slope of the array shall be determined as the slope relative to level ground. Code required topographic effects have not been considered. Topographic (Wind) Factor = 1.0 (no topographic effects)
5. Dead Load (Weight) = 3 psf
6. Maximum PV Module Dimension = 80"

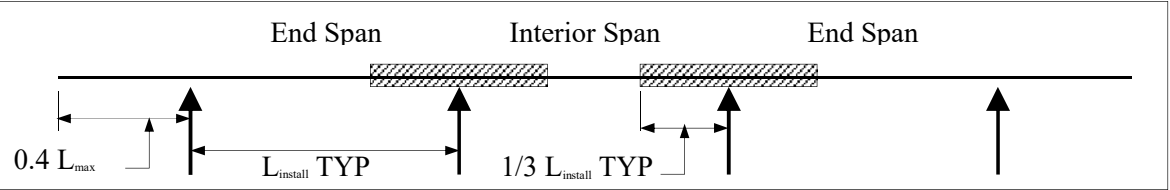



Figure A

$L_{max}$  = Maximum pier spacing provided in the tables above for the project design criteria

$L_{install}$  = Actual installed pier spacing

 = Indicates region of the pipe rail where splice may be installed

To avoid potential problems from the effects of thermal expansion, a maximum total continuous cross pipe length of 100 ft is recommended.

Notes for CAMO module clamp installation:

1. Single module installation (“orphan modules”) shall not be permitted with the ground mount system when CAMO clamp is used. Reference Figure 1 on following page for “Orphan Module” installation.
2. CAMO clamps will function within a module’s design load ratings. Be sure the specific module being used with the CAMO clamp meets the dimensional requirements shown in Figure 2 on the following page, is a module listed in IronRidge’s installation manual, and that the module selected is suitable for the environmental conditions of a particular project.

IronRidge  
Mr. Corey Geiger  
Ground Mounting System – Structural Analysis – 5 Module (XR1000)

July 1, 2019  
Page 25 of 52

Soil Class 2											
Table 4D - MINIMUM FOUNDATION DEPTHS (in)											
3" Pipe Frame Braced	Pier Dia (in)	Slope (deg)									
		0	5	10	15	20	25	30	35	40	45
100 mph Exposure B	12	36	36	36	36	42	48	48	54	60	60
	16	36	36	36	36	36	42	42	48	54	54
	20	36	36	36	36	36	36	42	42	48	48
	24	36	36	36	36	36	36	36	42	42	48
105 mph Exposure B	12	36	36	36	36	42	48	54	54	60	66
	16	36	36	36	36	36	42	48	48	54	54
	20	36	36	36	36	36	36	42	42	48	48
	24	36	36	36	36	36	36	36	42	42	48
110 mph Exposure B	12	36	36	36	42	42	48	54	54	60	66
	16	36	36	36	36	36	42	48	48	54	60
	20	36	36	36	36	36	36	42	48	48	54
	24	36	36	36	36	36	36	42	42	42	48
120 mph Exposure B	12	36	36	36	42	48	48	54	60	66	66
	16	36	36	36	36	36	42	48	54	54	60
	20	36	36	36	36	36	42	42	48	48	54
	24	36	36	36	36	36	36	42	42	48	48
130 mph Exposure B	12	36	36	36	48	48	54	60	60	66	72
	16	36	36	36	36	42	48	48	54	60	60
	20	36	36	36	36	36	42	48	48	54	54
	24	36	36	36	36	36	36	42	48	48	54
140 mph Exposure B	12	36	42	36	48	54	54	60	66	66	72
	16	36	36	36	42	42	48	54	54	60	66
	20	36	36	36	36	36	42	48	48	54	60
	24	36	36	36	36	36	42	42	48	48	54
150 mph Exposure B	12	36	42	48	54	60	60	60	66	72	78
	16	36	36	36	42	48	48	54	60	60	66
	20	36	36	36	36	42	42	48	54	54	60
	24	36	36	36	36	36	42	48	48	54	54
160 mph Exposure B	12	42	48	48	54	60	60	66	66	72	78
	16	36	36	36	42	48	48	54	60	66	72
	20	36	36	36	36	42	48	48	54	60	60
	24	36	36	36	36	36	42	48	48	54	60

Notes: see page 52

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

Daybreak Install LLC

RELEASE

DATE

REV

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

NAME  
ADDRESS  
ADDRESS  
APN

SUBMIT FOR PERMIT

11/16/2021

Dodsworth, Janet  
3035 County Rd 18  
Lake City, FL 32025

R-109

EQUIP. CUT SHEETS

IronRidge  
Mr. Corey Geiger  
Ground Mounting System – Structural Analysis – 5 Module (XR1000)

July 1, 2019  
Page 52 of 52

- Notes for Tables 3 & 4:
- 1. Concrete Weight = 145 pcf / f'c = 2500 psi
  - 2. Provide Air Entraining Admixture for freeze and thaw cycles as required for colder climates.
  - 3. Skin Friction per 2020 FBC 1810.3.3.1.4 & 5
  - 4. Top 1'-0" of soil neglected for Skin Friction
  - 5. Snow Load = 0 psf – tabulated values are conservative for Snow Loads > 0 psf
  - 6. \* indicates special foundation required. Contact IronRidge
  - 7. Resistance to corrosion and/or sulfate attack, along with possible adverse effects due to expansive soils has not been considered in these foundation recommendations. SML Engineers assumes no liability with regard to these items.
  - 8. Soil classification is to be determined and verified by the end user of this certification letter.

The analysis assumes that the array, including the connections and associated hardware, are installed in a workmanlike manner in accordance with the IronRidge Ground Mount Installation Manual and generally accepted standards of construction practice. Verification of PV Module capacity to support the loads associated with the given array shall be the responsibility of the Contractor or Owner and not IronRidge or Starling Madison Lofquist.


Please feel free to contact me at your convenience if you have any questions.

Respectfully yours,

Tres Warner, P.E.  
Design Division Manager

Tres J  
Warner

Digitally signed by Tres  
J Warner  
DN: c=US, o=Starling  
Madison Lofquist Inc,  
ou=A01410C00000174  
6F7B4222000053B6,  
cn=Tres J Warner  
Date: 2021.02.25  
13:15:45 -07'00'

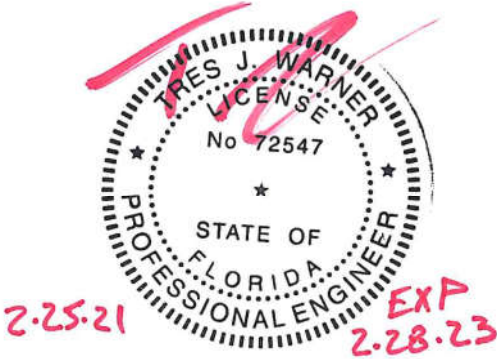

Daybreak Install LLC CVC56966 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922	6.500 kW PHOTOVOLTAIC PLANS		REV	DATE	RELEASE
	NAME	Dodsworth, Janet		11/16/2021	SUBMIT FOR PERMIT
	ADDRESS	3035 County Rd 18			
	ADDRESS	Lake City, FL 32025			
		APN			
				R-110	EQUIP. CUT SHEETS



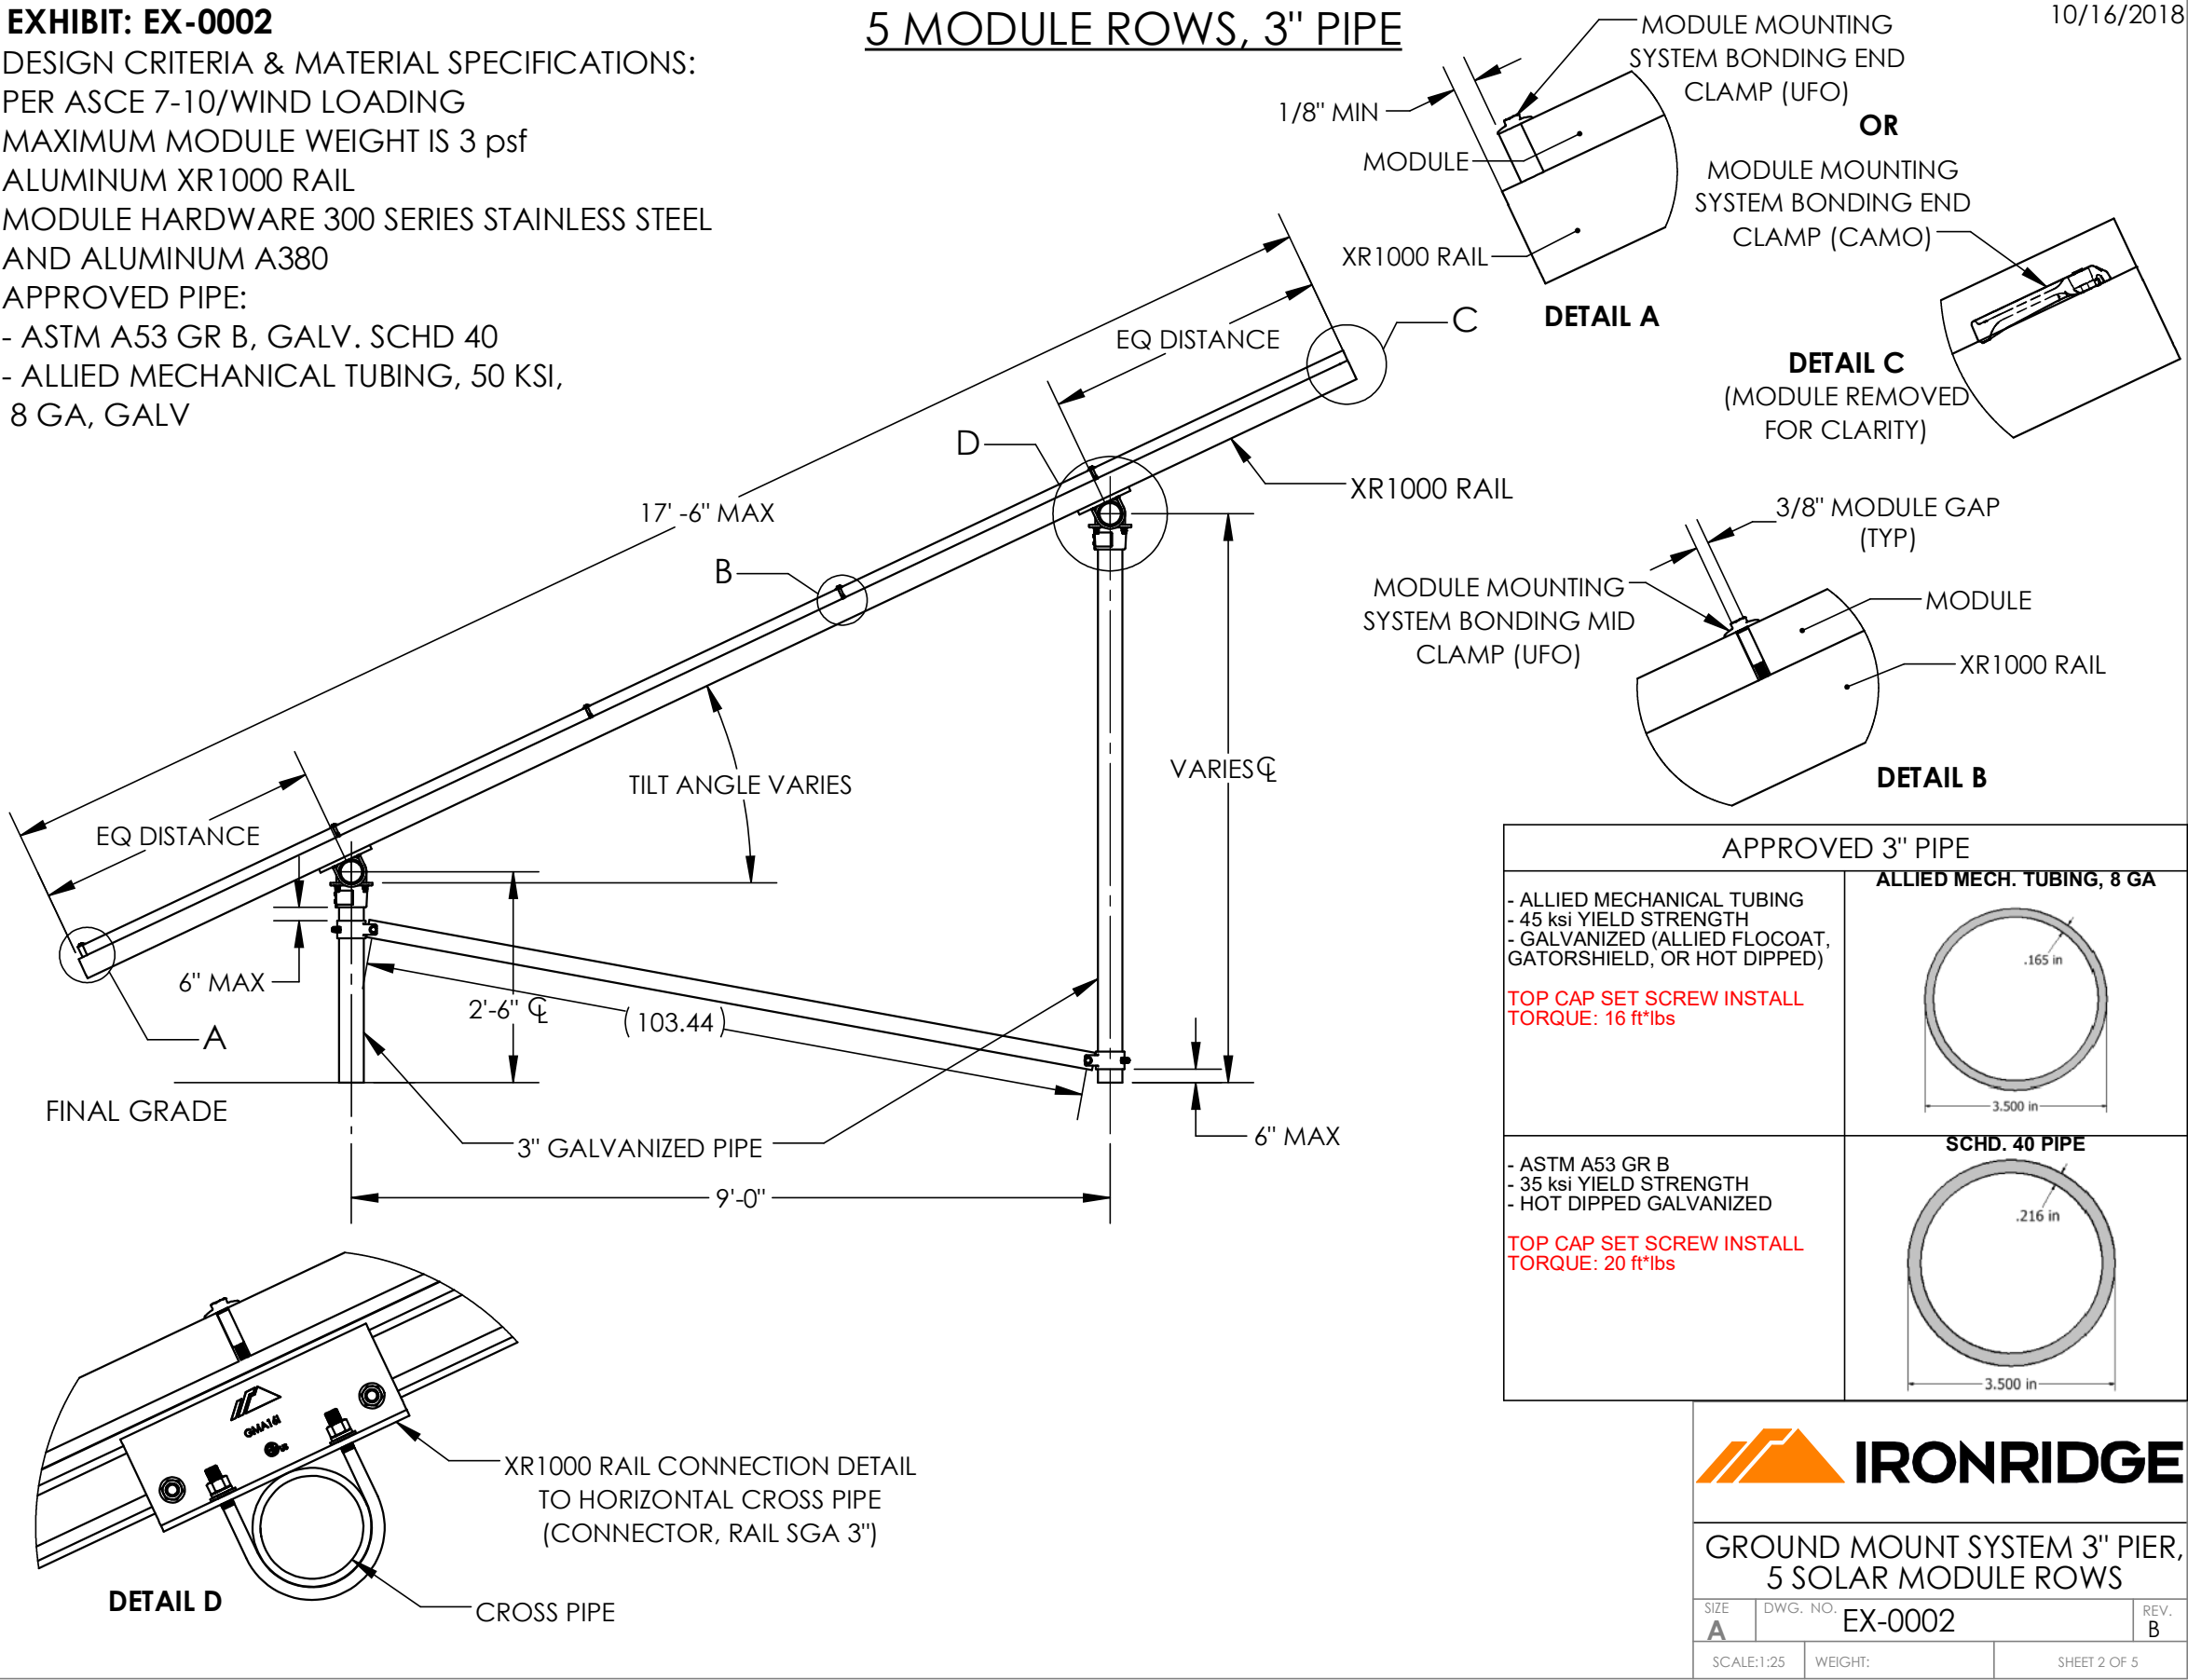


EXHIBIT: EX-0002

DESIGN CRITERIA & MATERIAL SPECIFICATIONS:  
PER ASCE 7-10/WIND LOADING  
MAXIMUM MODULE WEIGHT IS 3 psf  
ALUMINUM XR1000 RAIL  
MODULE HARDWARE 300 SERIES STAINLESS STEEL  
AND ALUMINUM A380  
APPROVED PIPE:  
- ASTM A53 GR B, GALV. SCHD 40  
- ALLIED MECHANICAL TUBING, 50 KSI,  
8 GA, GALV

5 MODULE ROWS, 3" PIPE

10/16/2018



APPROVED 3" PIPE	
<ul style="list-style-type: none"><li>- ALLIED MECHANICAL TUBING</li><li>- 45 ksi YIELD STRENGTH</li><li>- GALVANIZED (ALLIED FLOCOAT, GATORSHIELD, OR HOT DIPPED)</li></ul> <p>TOP CAP SET SCREW INSTALL TORQUE: 16 ft*lbs</p>	<p>ALLIED MECH. TUBING, 8 GA</p>
<ul style="list-style-type: none"><li>- ASTM A53 GR B</li><li>- 35 ksi YIELD STRENGTH</li><li>- HOT DIPPED GALVANIZED</li></ul> <p>TOP CAP SET SCREW INSTALL TORQUE: 20 ft*lbs</p>	<p>SCHD. 40 PIPE</p>



GROUND MOUNT SYSTEM 3" PIER,  
5 SOLAR MODULE ROWS

SIZE <b>A</b>	DWG. NO. EX-0002	REV. B
SCALE: 1:25	WEIGHT:	SHEET 2 OF 5

6.500 kW PHOTOVOLTAIC PLANS

CVC56966

Daybreak Install LLC

2100 N Main St Ste. 212

Fort Worth, TX 76164

(817) 501-4922

NAME  
Dodsworth, Janet

ADDRESS  
3035 County Rd 18

ADDRESS  
Lake City, FL 32025

APN

RELEASE  
11/16/2021  
SUBMIT FOR PERMIT

DATE

REV

EQUIP. CUT SHEETS


R-111




EXHIBIT: EX-0002

NORTH VIEW



10/16/2018

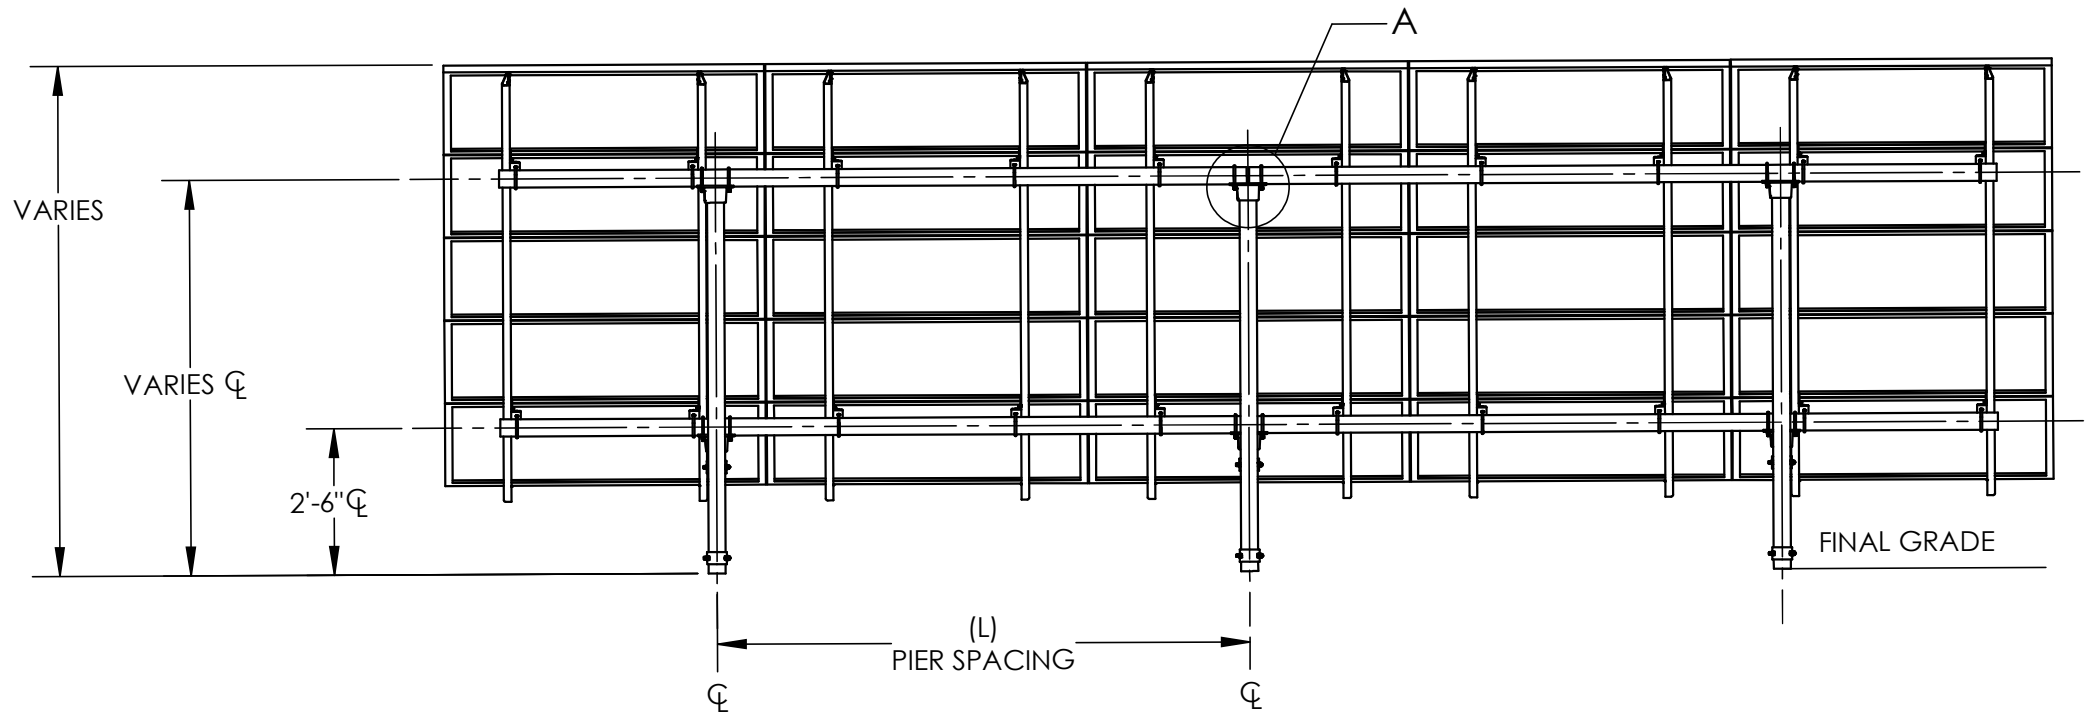

SPLICING CROSS PIPE

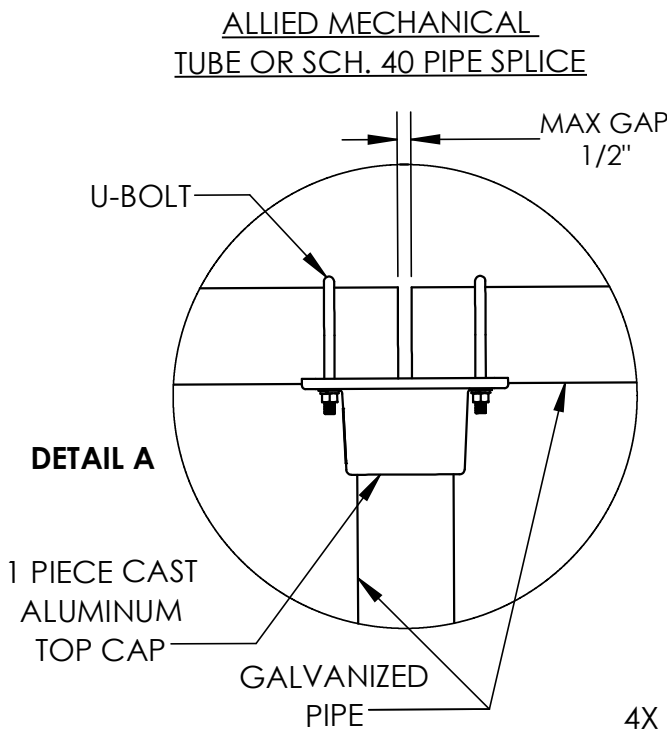

Mechanical Tube Size of the Structure	Splice Tube Size
2.375" OD, 12 Gauge	2.000" OD, 9 Gauge, Minimum 12" Long
3.500" OD, 8 Gauge	3.000" OD, 12 Gauge, Minimum 12" Long

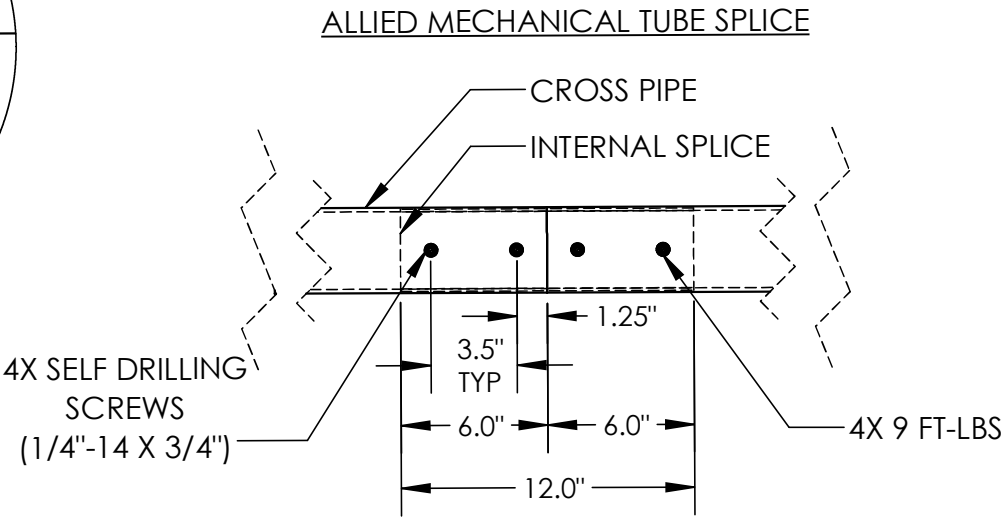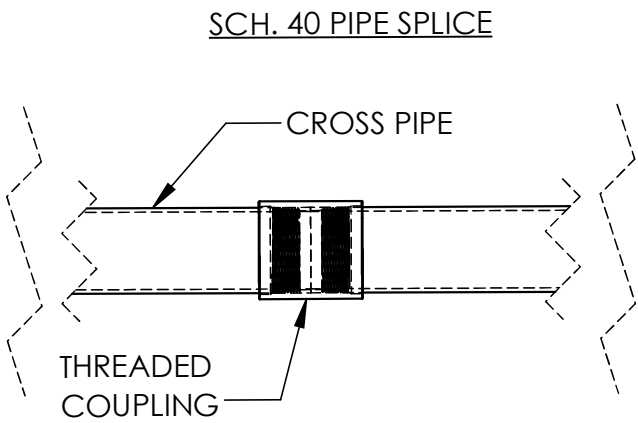

GROUND MOUNT SYSTEM, 5  
SOLAR MODULE ROWS

SIZE <b>A</b>	DWG. NO. <b>EX-0002</b>	REV. <b>B</b>
SCALE: 1:25	WEIGHT:	SHEET 4 OF 5

Daybreak Install LLC

CVC56966  
2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

6.500 kW PHOTOVOLTAIC PLANS

NAME  
Dodsworth, Janet

ADDRESS  
3035 County Rd 18

ADDRESS  
Lake City, FL 32025

APN

REV

DATE  
11/16/2021

RELEASE  
SUBMIT FOR PERMIT


R-112

EQUIP. CUT SHEETS

EXHIBIT: EX-0002

CONCRETE FOUNDATION DETAILS

10/16/2018

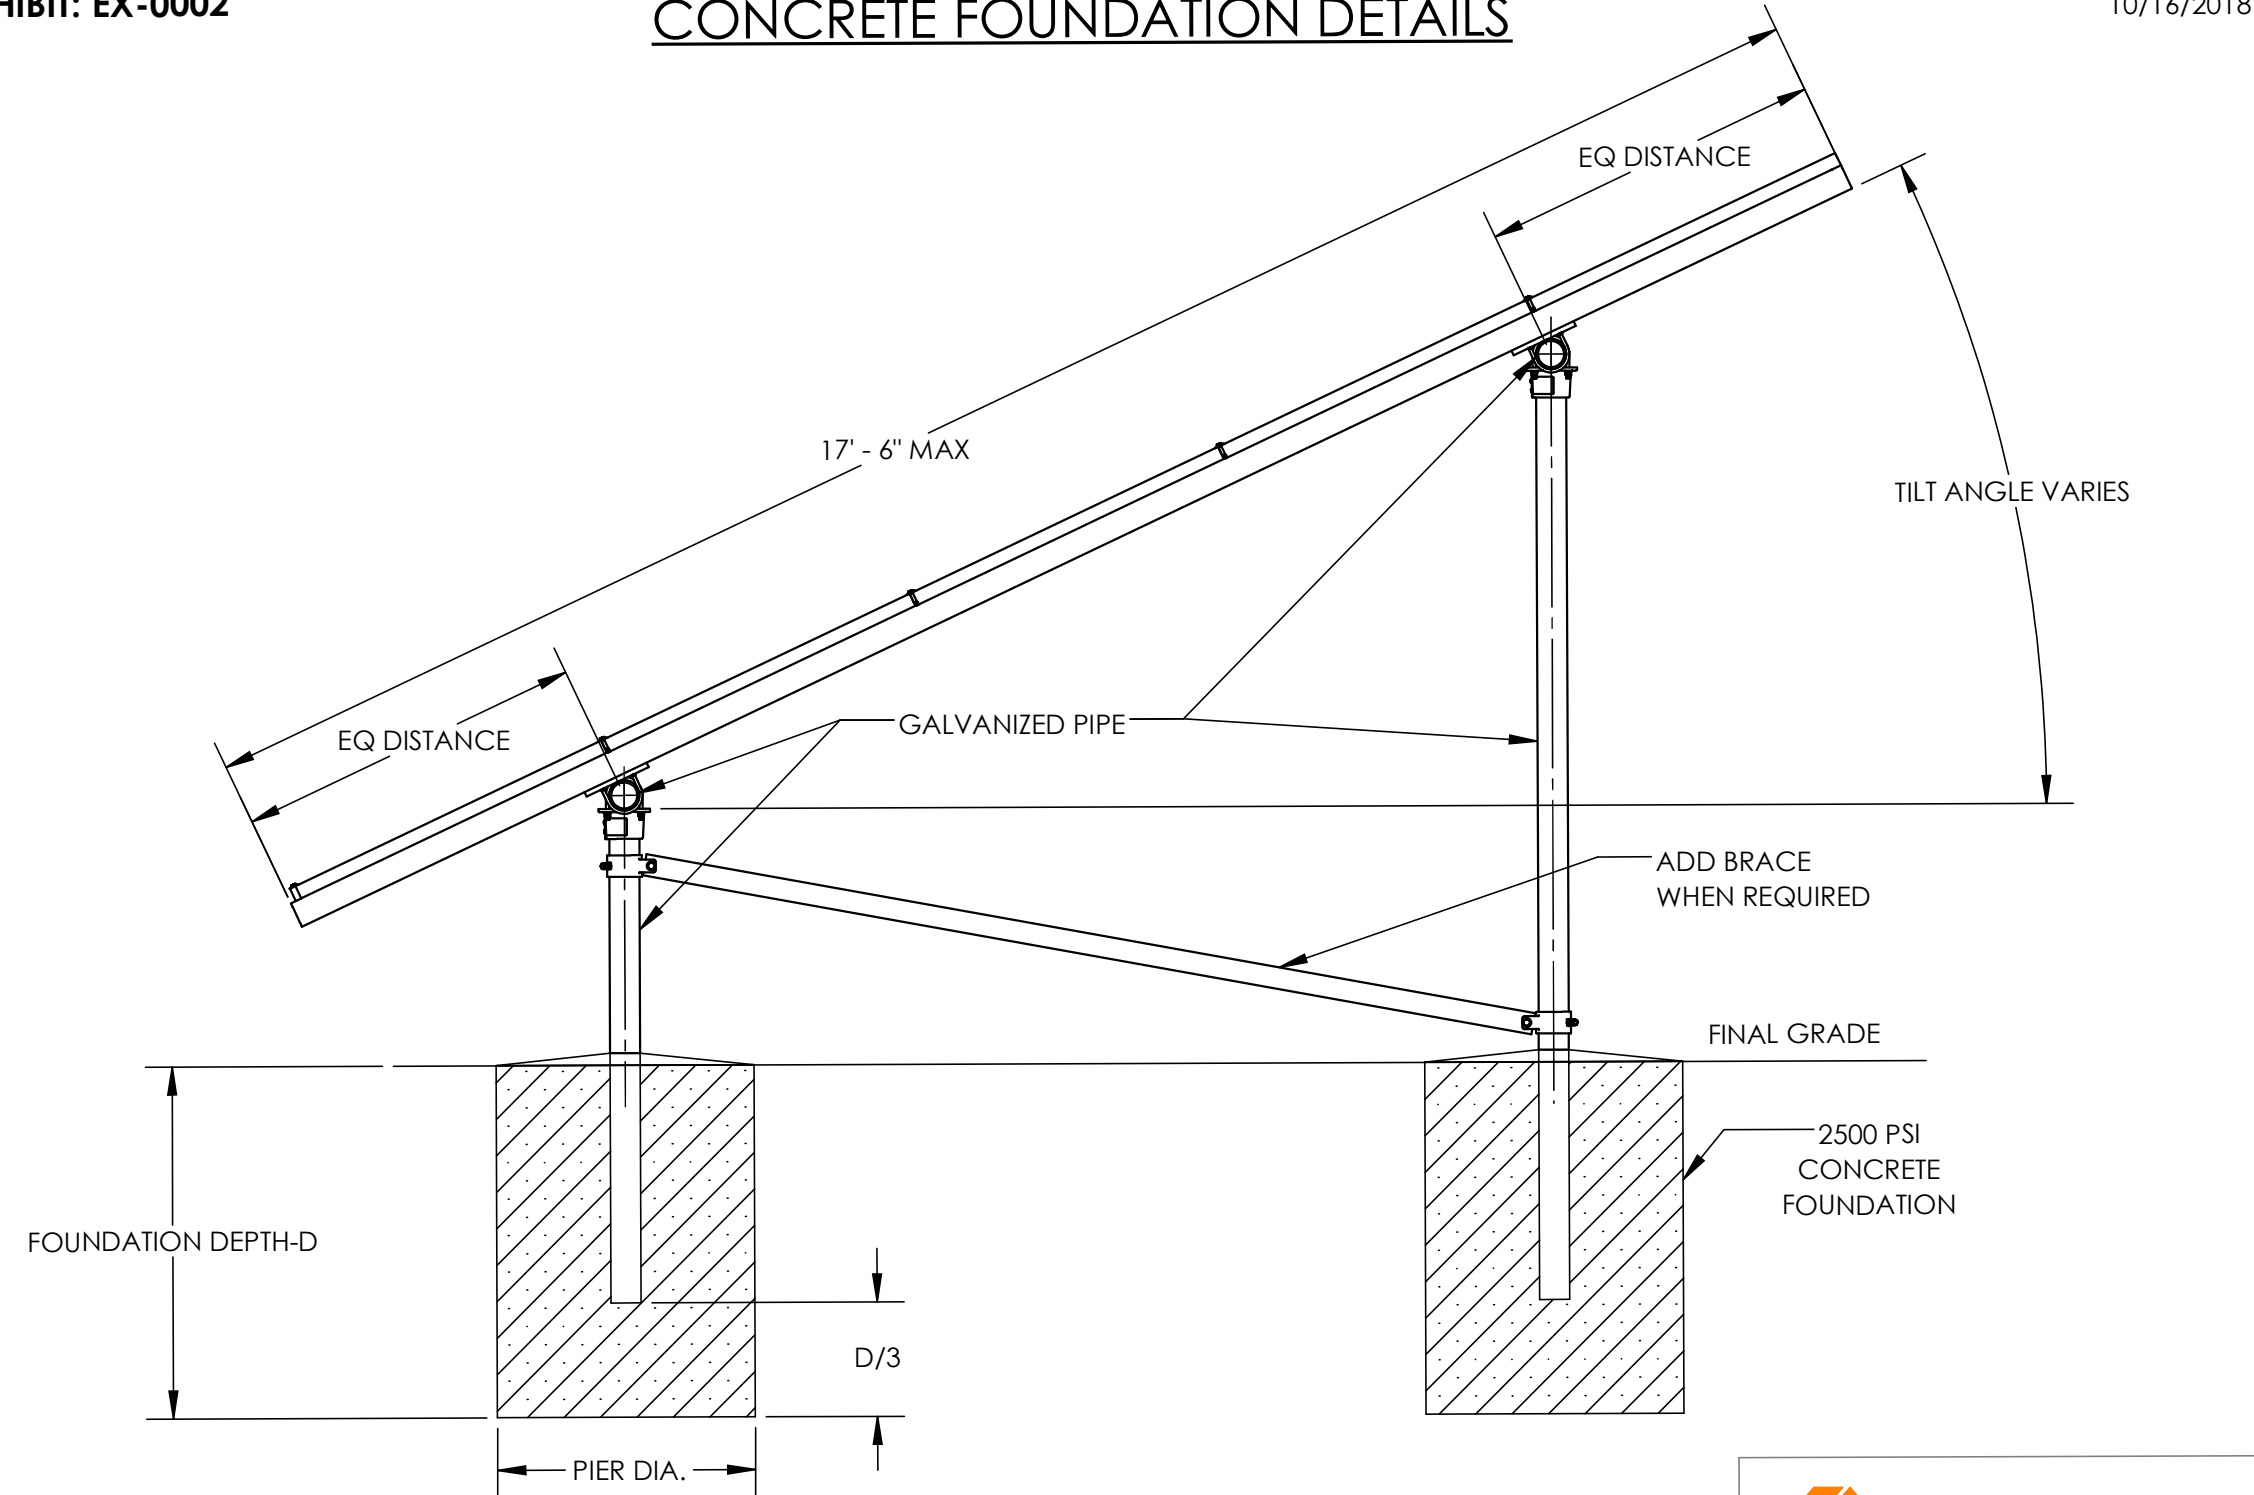

NOTE:  
THE ATTACHED SPAN TABLES ARE BASED ON USING DRILLED CAST-IN-PLACE CONCRETE PIER FOUNDATION SYSTEM. OTHER FOUNDATION SYSTEMS (EG. SCREW ANCHORS, DRIVEN PIERS) ARE PERMISSIBLE BUT MAY REQUIRE ADDITIONAL BRACING AND/OR REDUCED SPAN. PLEASE CONTACT IRONRIDGE FOR MORE INFORMATION.



GROUND MOUNT SYSTEM, 5  
SOLAR MODULE ROWS

SIZE A	DWG. NO. EX-0002	REV. B
SCALE: 1:25	WEIGHT:	SHEET 5 OF 5




Daybreak Install LLC 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922	6.500 kW PHOTOVOLTAIC PLANS		REV	DATE	RELEASE
	NAME	Dodsworth, Janet		11/16/2021	SUBMIT FOR PERMIT
	ADDRESS	3035 County Rd 18			
	ADDRESS	Lake City, FL 32025			
APN					
R-113		EQUIP. CUT SHEETS			





ELECTRICAL DIAGRAM

Cut Sheet

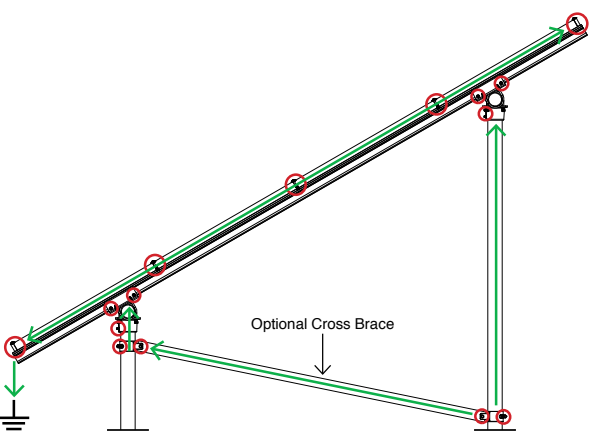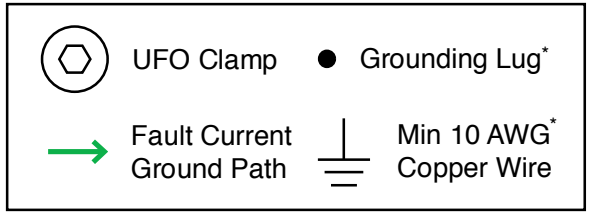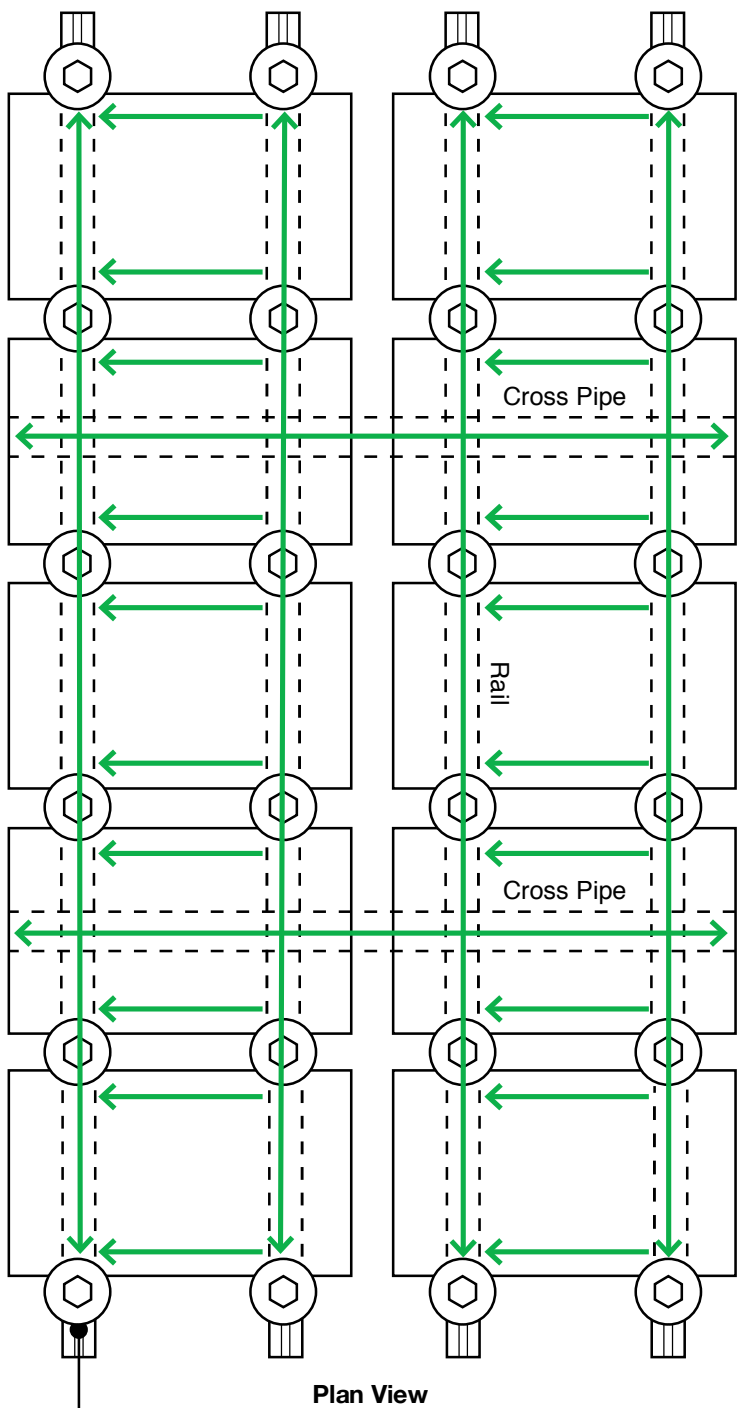

○ Bonding Points    ← Fault Current Ground Path

\*Grounding Lugs and Wire are not required in systems using certain Enphase microinverters.


Section View

Plan View

\*Only one Grounding Lug required per continuous subarray.




Grounding Lug

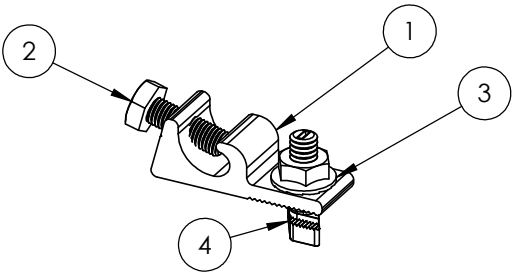

ITEM NO.	DESCRIPTION	QTY. IN KIT
1	LUG, GROUNDING, LAY-IN - LOW PROFILE	2
2	BOLT, 1/4-28 X .750" HEX CS SST	2
3	NUT, FLANGE HEX 1/4-20 SST	2
4	BOLT, T CSTM 1/4-20 X 1.188" LOCK SS	2


Part Number	Description	Wire Size Range (AWG)
GD-LUG-003	KIT, 2PCS, GROUNDING LUG, LOW PROFILE	4-10

1) Lug, Grounding

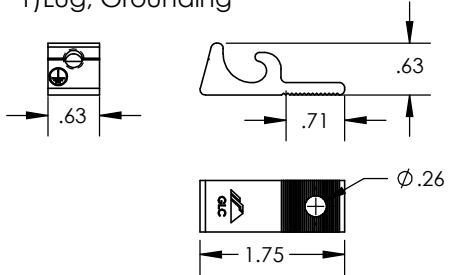


Property	Value
Material	Tin Plated Copper
Finish	Clear Matte

2) Bolt, 1/4-28 x .750 Hex

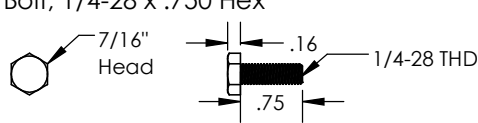


Property	Value
Material	300 Series Stainless Steel
Finish	Clear

3) Nut, Flange Hex 1/4-20

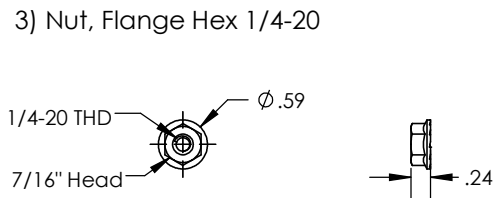

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

4) Bolt, T CSTM 1/4-20 x .750

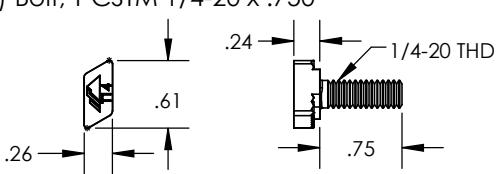

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

v1.0

Daybreak Install LLC

CVC56966

2100 N Main St Ste. 212  
Fort Worth, TX 76164  
(817) 501-4922

6.500 kW PHOTOVOLTAIC PLANS

NAME  
ADDRESS  
ADDRESS  
APN

Dodsworth, Janet  
3035 County Rd 18  
Lake City, FL 32025

REV

DATE

RELEASE

11/16/2021

SUBMIT FOR PERMIT

R-114

EQUIP. CUT SHEETS





General Duty Cartridge Fuse  
Safety Switch

DG222NRB  
UPC:782113144221

- Dimensions:
- Height: 7 IN
  - Length: 6.41 IN
  - Width: 8.4 IN

Weight:9 LB

Notes:Maximum hp ratings apply only when dual element fuses are used. 3-Phase hp rating shown is a grounded B phase rating, UL listed.

- Warranties:
- Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.

- Specifications:
- Type: General Duty/Cartridge Fuse
  - Amperage Rating: 60A
  - Enclosure: NEMA 3R
  - Enclosure Material: Painted galvanized steel
  - Fuse Class Provision: Class H fuses
  - Fuse Configuration: Fusible with neutral
  - Number Of Poles: Two-pole
  - Number Of Wires: Three-wire
  - Product Category: General Duty Safety Switch
  - Voltage Rating: 240V

- Supporting documents:
- Eatons Volume 2-Commercial Distribution
  - Eaton Specification Sheet - DG222NRB

- Certifications:
- UL Listed




pe.eaton.com

1.1 Switching Devices  
1 Safety Switches

All general-duty switches above 100A and all heavy-duty switches incorporate these K-Series switch design features.

- Two points of contact provide a positive open and close, easier operation, and also help prevent contact burning for longer contact life



Visible Double-Break Rotary Blade Mechanism

- Protects against accidental contact with energized parts. Probe holes enable the user to test if the line side is energized without removing the shield. Not provided on general-duty switches, but available as a field kit or factory installed



Clear Line Shield



Clearly Visible Handle

- The position (ON or OFF) can be clearly seen from a distance and the length provides for easy operation



Triple Padlocking Capability

- Personnel safety feature because the large hasp can accommodate up to three 3/8-inch (9.5 mm) shank locks



Additional Locking Capability

- Cabinet door can be further padlocked at the top and bottom as applicable



Interlocking Mechanism

- Door cannot be opened when the handle is in the ON position. Front and side operable defeater mechanism provides for user access when necessary on single-throw switches



Tangential Knockouts

- An ample number are provided on the top, bottom and sides of both NEMA Types 1 and 3R enclosures through 200A



Bolt-On Hub Kits

- For switches in a NEMA Type 3R, 30–200A. Use a Myers type hub for all others

Standards and Certifications


- UL listed File No. E5239
- Meets UL 98 for enclosed switches and NEMA Std. KS-1



Seismic Qualifications

- General-duty switches exceed the requirements of Uniform Building Code (UBC) and California Code Title 24 OSP-0011-10, OSP-0012-10



 Daybreak Install LLC CVC56966 2100 N Main St Ste. 212 Fort Worth, TX 76164 (817) 501-4922	6.500 kW PHOTOVOLTAIC PLANS		REV	DATE	RELEASE
	NAME		11/16/2021		SUBMIT FOR PERMIT
	ADDRESS				
	ADDRESS				
	APN				
	Dodsworth, Janet				
	3035 County Rd 18				
	Lake City, FL 32025		R-115		EQUIP. CUT SHEETS

