




REAR ELEVATION: SCALE: 1/4" = 1'-0"



RIGHT ELEVATION SCALE: 1/4" = 1'-0"

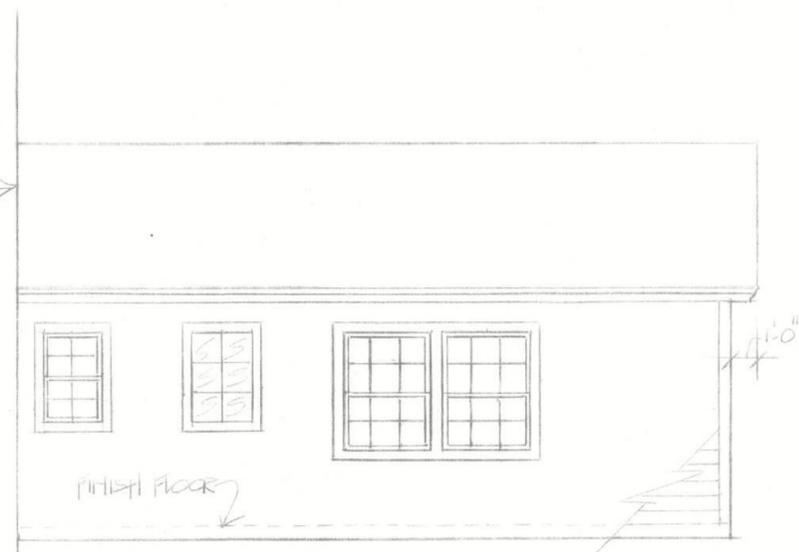


FRONT ELEVATION SCALE: 1/4" = 1'-0"

4'x8'x1/2" CDX PLYWOOD SHEATHING 4 PLY W/CLIPS
 ROOF - ASPHALT SHINGLE - USE MIN 25LB. FIBERGLASS SEAL TAB OVER 15# DRY-IN FELT
 SBCCI APPROVED ANCHORS CAPABLE OF MEETING UPLIFT REQ. AS PROVIDED BY TRUSS MANU. @ @ DRG. POINT OF @ TRUSS (SIMPSON MTS 20 OR EQ.)
 FIRE-ENGINEERED ROOF TRUSSES @ 2'-0" O.C.
 K-30 INSULATION


2'x6" SUB FASCIA W/ ALUM. FASCIA, ALUM. DRIP & VENTED ALUM. SOFFIT
 SIDING TO MATCH EXISTING STRUCTURE ON 15# DRY-IN FELT ON 1/2" CDX PLYWOOD SHEATHING.
 5/8" DRYWALL ON 2(2x4 TOP PLATE)
 2x4 FRAME WALL @ 16" O.C. W/ R-11 INSULATION W/ 1/2" DRYWALL OVER
 2x4 P.T. BOTTOM PLATE W/ A-307 OR EQ. 1/2" @ 10" STEEL ANCHOR BOLTS W/ 2" DIAM 5/16" WASHERS @ 21" O.C. (M.P.)

8'x16'x8" HEADER BLOCK
 MOLDING
 3 1/2" 2,500 PSI CONC. SLAB W/ 6" x 6" W/M. REINF. (OR FIBERMESH) ON 6" MIL V.B. LAPPED & TAPED
 CLEAN, COMPACTED TREATED FILL
 8'x16" CONC. 2,500 PSI 5# SWMP W/ 2 #5 REBAR CONT. ON STEEL CHAIRS 4'-0" O.C. REBAR SPLICES TO BE OVERLAPPED 24" AND WIRED. ALL REBAR TO HAVE MIN 3" CONC. COVERAGE.
 FINISH GRADE
 HEIGHT OF STEEL WALL TO CONFORM TO EXISTING STRUCTURE
 FOOTING

EXTERIOR WALL SECTION & FOOTING SCALE: 1/2" = 1'-0"

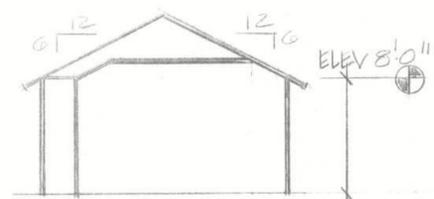




TRUSS PROFILE FOR AREA ABOVE BEDROOM. FLAT BOTTOM CHORD FOR REMAINDER OF ADDITION. SCALE: 1/8" = 1'-0"

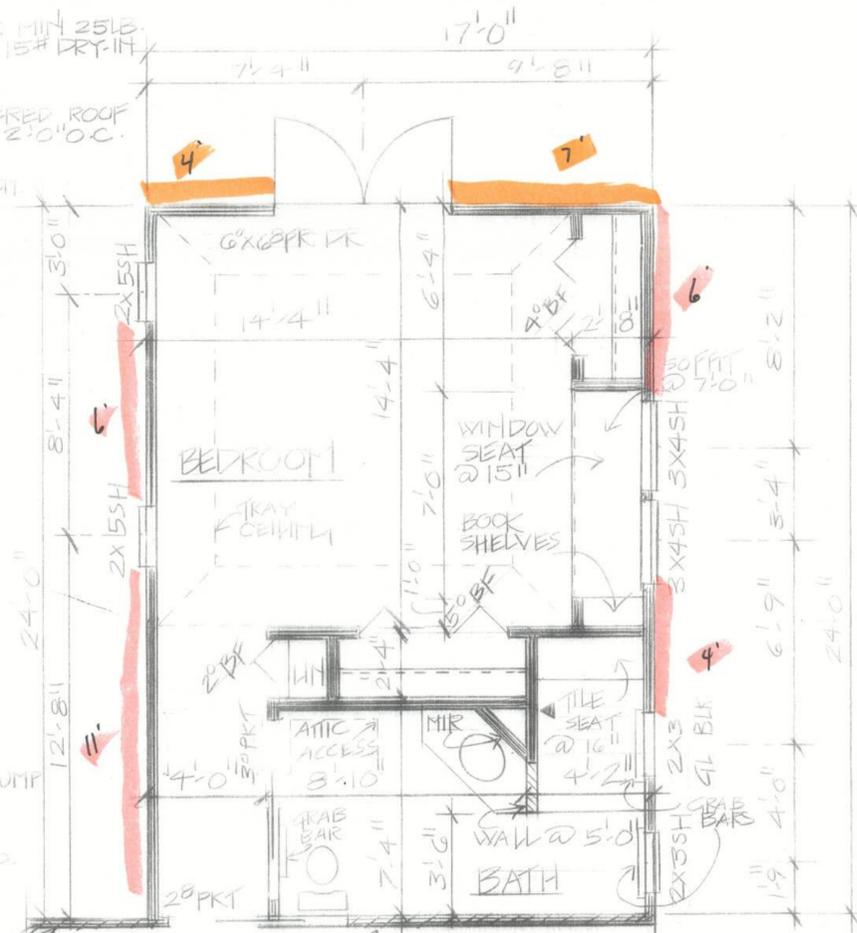

FLOOR PLAN SCALE: 1/4" = 1'-0"

DATE: 2.11.13	REVISION
ADDITION FOR MARK & KATHIE CADELL (386)-984-7781 10497 S.W. WISTERHURST AVE, LAKE CRY 32024	
DRAWN BY: PAT CALHOUN 476 S W 11TH CT, FT WHITE, FL 32038 SEC. 4129.0037	
SHEET 1	OF 2

715 11
6026-27

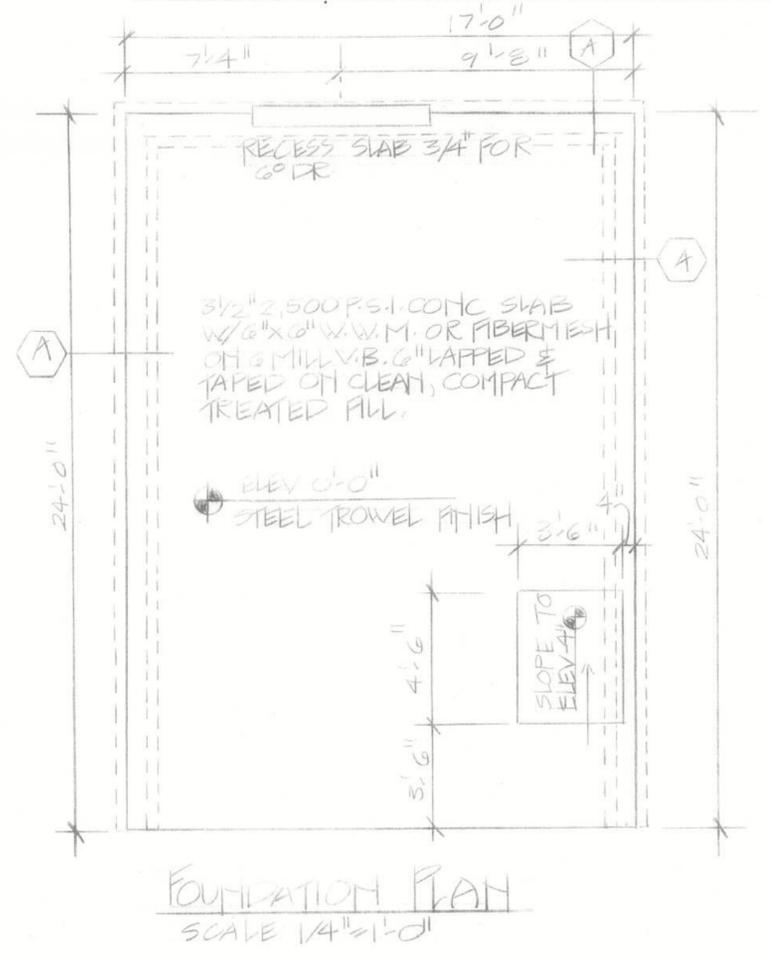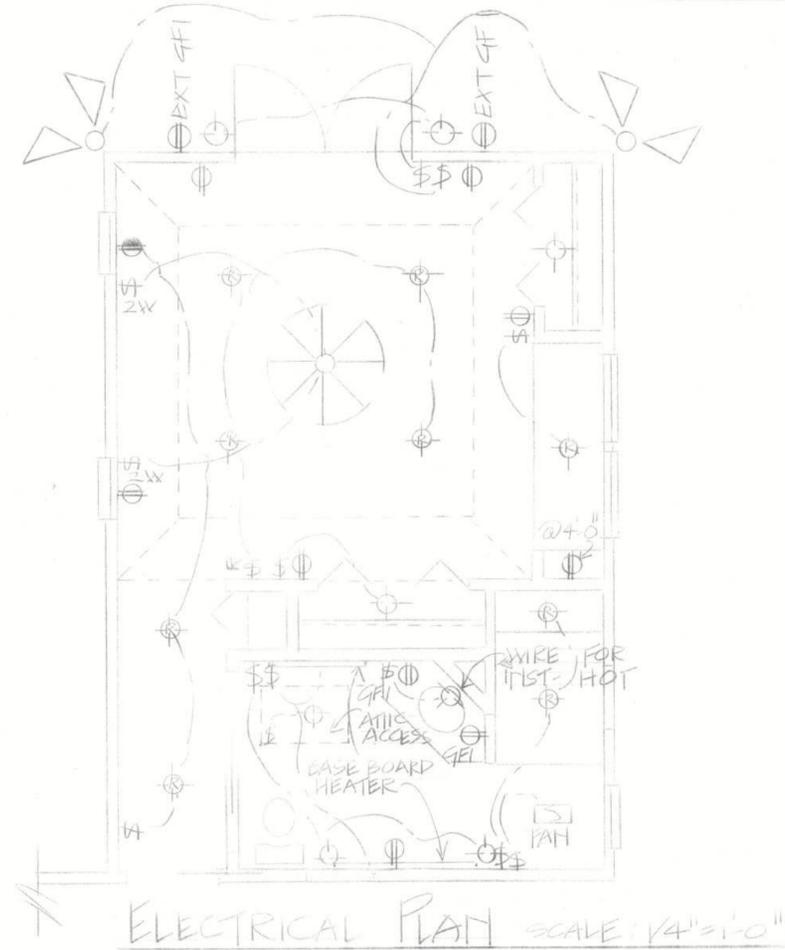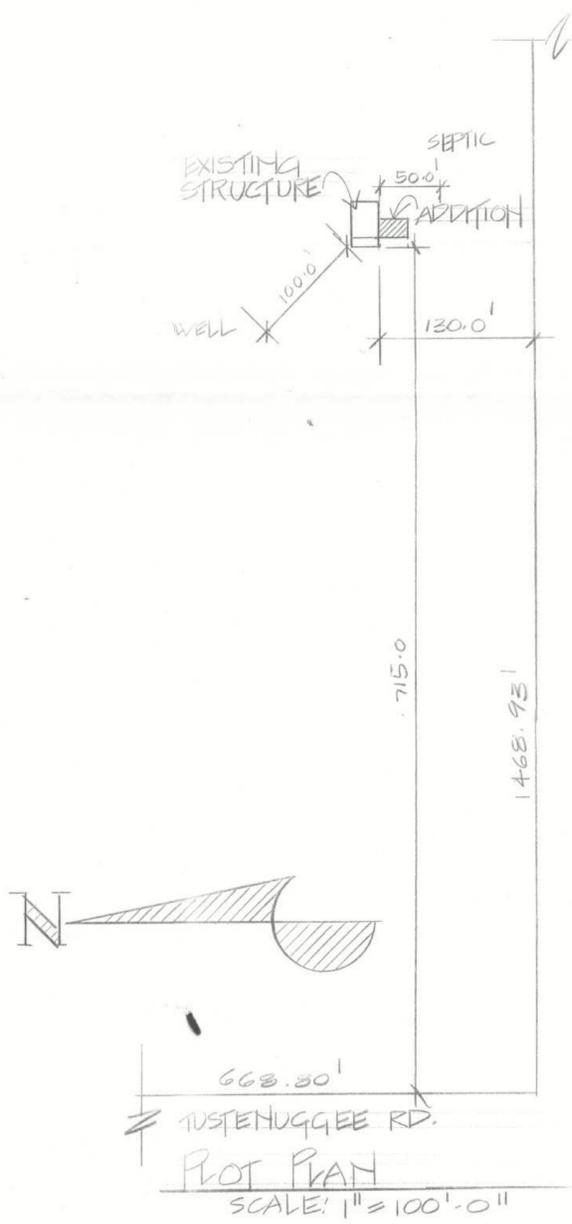

SHEET 2 OF 2	ADDITION FOR: MARK & KATHIE BARDELL 10497 S.W. TUSTENUGGEE AVE., LAKE CITY 32024 DRAWN BY: PAT GALLIGER, 495 S. VILHITY CT., FT. WHITE, FL 32038	DATE 2.11.13 REVISION
-----------------------	--	-----------------------------