

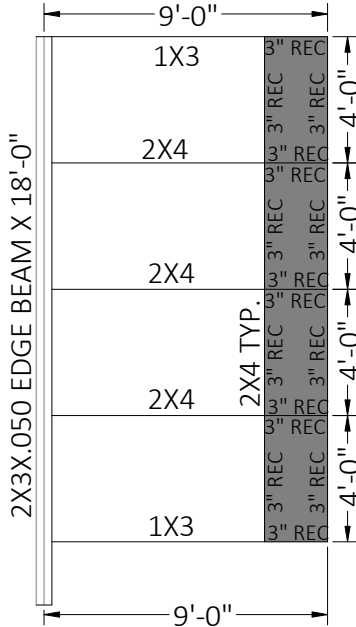
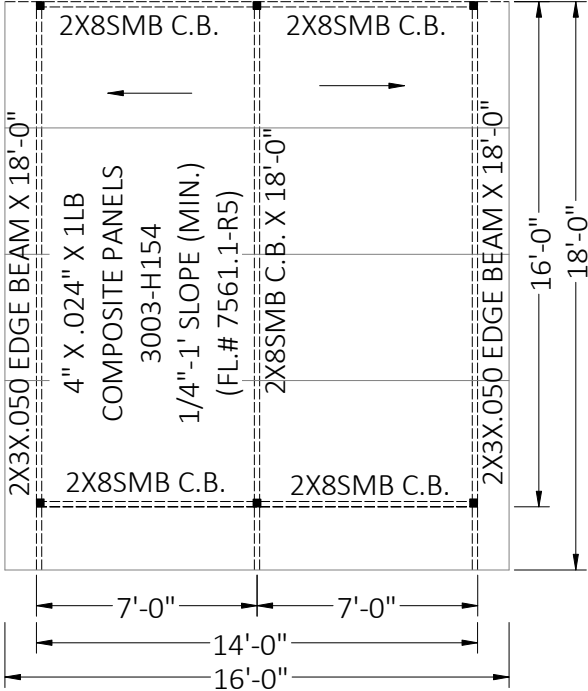
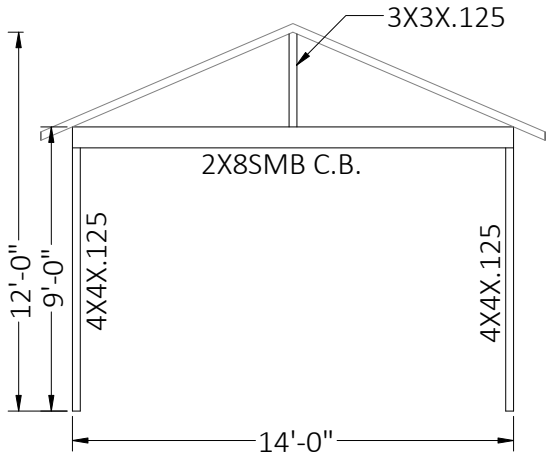
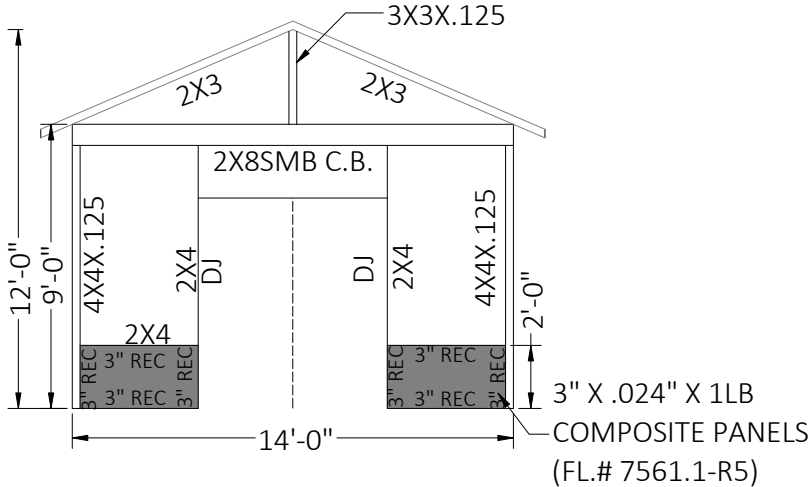


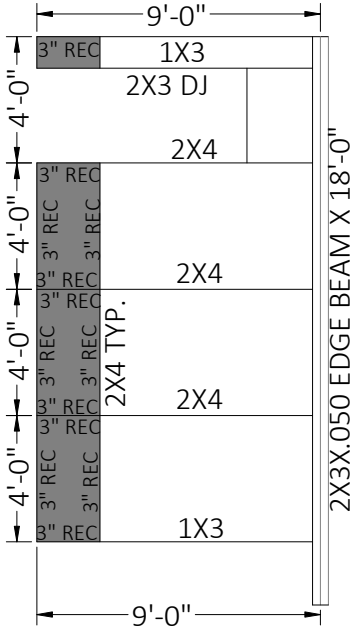


- ALUMINUM SPECIFICATIONS
1. ALUMINUM EXTRUSIONS SHALL BE 6005 T5 ALLOY UNLESS OTHERWISE NOTED.
 2. ALL SELF MATING BEAM SECTIONS ARE TO BE STITCHED WITH #12 SCREWS 6" FROM ENDS & 24" CENTER TO CENTER. #10 SCREW 6" FROM ENDS & 12" CENTER TO CENETER.
 3. THE MINIMUM NORMAL THICKNESS OF PROTECTOR PANELS (KICKPLATES) SHALL BE AN INDUSTRY STANDARD OF 0.024 INCHES.
 4. VINYL AND ACRYLIC PANELS SHALL BE REMOVED WHEN WIND SPEEDS EXCEED 75 MPH PER FBC.
 5. SCREEN MATERIAL SHALL BE 18/14 SCREEN UNLESS APPROVED BY FLORIDA ENGINEERING LLC.
 6. 1"X2" & 1"X3" NON STRUCTURAL MEMBERS MAY BE USED INTERCHANGEABLY.
 7. DOOR LOCATION MAY BE RELOCATED BY CONTRACTOR IN THE FIELD.
 8. INSULATED PANEL OVERHANG PER PRODUCT APPROVAL 36" (MAX.) AT FRONT, 25% OF LAST PANEL WIDTH ALONG SIDES, TYP.

■ = 4X4X.125

This item has been electronically signed and sealed by Craig E. Gunderson, P.E. on date below using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed
by Craig E
Gunderson
Date:
2022.05.24
13:10:21 -04'00'



FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
www.flengineeringllc.com

PROJECT NO. 2211644-2

CA CERT. #30782

CONTRACTOR:
AMERICAN GUTTER

PROJECT ADDRESS:
PRIESTER
515 SW OLD LAKE CITY TER,
HIGH SPRINGS FL 32655

DESIGN DATE: 04/28/2022

REVISION 1: 05/23/2022

REVISION 2: DATE

DRAWN BY: RJ

SCALE: NTS

SHEET:

02