

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.



Custom Residential Design for:

MR. and MRS. J. KASAK

Columbia County, Florida

Drawing Index

CS.1	COVER SHEET, DRAWING INDEX	A.1	ARCHITECTURAL DETAILS
A.1	BUILDING ELEVATIONS	A.2	STRUCTURAL INFORMATION
A.2	BUILDING ELEVATIONS	A.3	WALL FRAMING DETAILS
A.3	FLOOR PLAN / ELECTRICAL PLAN	A.10	FOUNDATION PLAN
A.4	FLOOR PLAN DIMENSIONS	A.11	ROOF FRAMING PLAN
A.5	WALL SECTIONS / ALTERNATE COMPONENTS LIST / DETAILS	A.12	ROOF FRAMING DETAILS
A.6	ARCHITECTURAL TRIM DETAILS	A.13	GENERAL NOTES

REVISION:
29 NOV 2012
21 DEC 2012
08 MAY 2013

Copyright 2012
N.P. Geisler, Architect

DRAWN:
198

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
COVER SHEET

Celebrating
40 Years of Service
1972 - 2012
N.P. Geisler, Architect
ARCHITECT

NICHOLAS PAUL GEISLER
ARCHITECT
N.C. STATE CERTIFIED
1758 NW Brown Rd.
Lake City, FL 32055
386-565-4325

DATE:
15 NOV 2012
COMM:
2K1287

SHEET:
CS.1
1 of 1



mm
10 May 2013
AR0007005

General Roofing NOTES:

DECK REQUIREMENTS:
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12
OR GREATER. FOR ROOF SLOPES FROM 2:12 TO 4:12, DBL. UNDERLAYMENT
IS REQUIRED.

UNDERLAYMENT:
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM W/ ASTM D 226,
TYPE I, OR ASTM D 4863, TYPE I.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:
SELF ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY W/ ASTM D 1910.

ASPHALT SHINGLES:
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING,
AND COMPLY WITH ASTM D 226 OR ASTM D 3462.

FASTENERS:
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS
STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH
A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH
THE ROOFING MATERIAL AND A MINIMUM 3/4" INTO THE ROOF SHEATHING.
WHERE THE SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE
THROUGH THE SHEATHING.

ATTACHMENT:
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN
FOUR FASTENERS PER STRIP SHINGLE OR TWO FASTENERS PER INDIVIDUAL
SHINGLE. WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR
GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS
OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM
WITH ASTM D 3161 OR M-DC PA 101-95.

UNDERLAYMENT APPLICATION:
FOR ROOF SLOPES FROM 2:12 TO 4:12, UNDERLAYMENT SHALL BE A MINIMUM
OF TWO LAYERS APPLIED AS FOLLOWS:

1. STARTING AT THE EAVE, A 19 INCH STRIP OF UNDERLAYMENT SHALL BE
APPLIED PARALLEL WITH THE EAVE AND FASTENED SUFFICIENTLY TO
STAY IN PLACE.

2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT
SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 19 INCHES AND
FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPED 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM
OF ONE LAYER OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:

STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE
FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED
SUFFICIENTLY TO STAY IN PLACE.

BASE AND CAP FLASHINGS:
BASE AND CAP FLASHINGS SHALL BE INSTALLED IN ACCORDANCE W/ MFGR'S
INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE OF EITHER CORROSION
RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL
SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 11 LBS PER 100 SQUARE
FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM
NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE W/ MANUFACTURER'S
INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY
LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED.


1. FOR OPEN VALLEYS LINED WITH METAL, THE VALLEY LINING SHALL BE
AT LEAST 16" WIDE AND OF ANY OF THE CORROSION RESISTANT METALS
IN FBC TABLE 9013.92.
2. FOR OPEN VALLEYS, VALLEY LINING OF TWO PLYS OF MINERAL SURFACE
ROLL ROOFING SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 18
INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.
3. FOR CLOSED VALLEYS VALLEY LINING SHALL BE ONE OF THE FOLLOWING:
 1. BOTH TYPES 1 AND 2 ABOVE, COMBINED.
 2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND
COMPLYING WITH ASTM D 224.
 3. SPECIALTY UNDERLAYMENT AT LEAST 36 INCHES WIDE AND COMPLYING
WITH ASTM D 1910.

ROOFING SHINGLE NOTE !!!

SHINGLES SHALL BE OF THE FOLLOWING MANUFACTURES
AND MODELS:

TAMKO ROOFING PRODUCTS	GAF MATERIALS CORP.	ELK PREMIUM ROOFING
GLASS-SEAL AR	ROYAL SOVEREIGN	RAISED PROFILE #
ELITE GLASS-SEAL AR	MARQUIS	PRESTIQUE HIGH
HERITAGE 30 AR	WEATHER MAX	DEFINITION #
HERITAGE 40 AR	SLATELINE	PRESTIQUE 25 #
HERITAGE 50 AR	GRAND CANYON	PRESTIQUE 30 #
	GRAND SEQUOIA	PRESTIQUE 135 #
	COUNTRY MANOR	PRESTIQUE 1 #
	COUNTRY ESTATES	PRESTIQUE PLUS #
	TIMBERLINE 30	PRESTIQUE GALLERY
	TIMBERLINE SELECT 40	COLLECTION #
	TIMBERLINE ULTRA	CAPSTONE #
	SENTINEL	
		ELK REQUIRED NAILS/SHINGLE = 4
		# = 5 NAILS
		o = 6 NAILS
	GAF REQUIRED NAILS/SHINGLE = 4	

THESE SHINGLES MEET THE REQUIREMENTS OF ASTM D-3161
TYPE I, MODIFIED TO 130 MPH WINDS & FBC TAS 100, USING
THE SPECIFIED NAILS

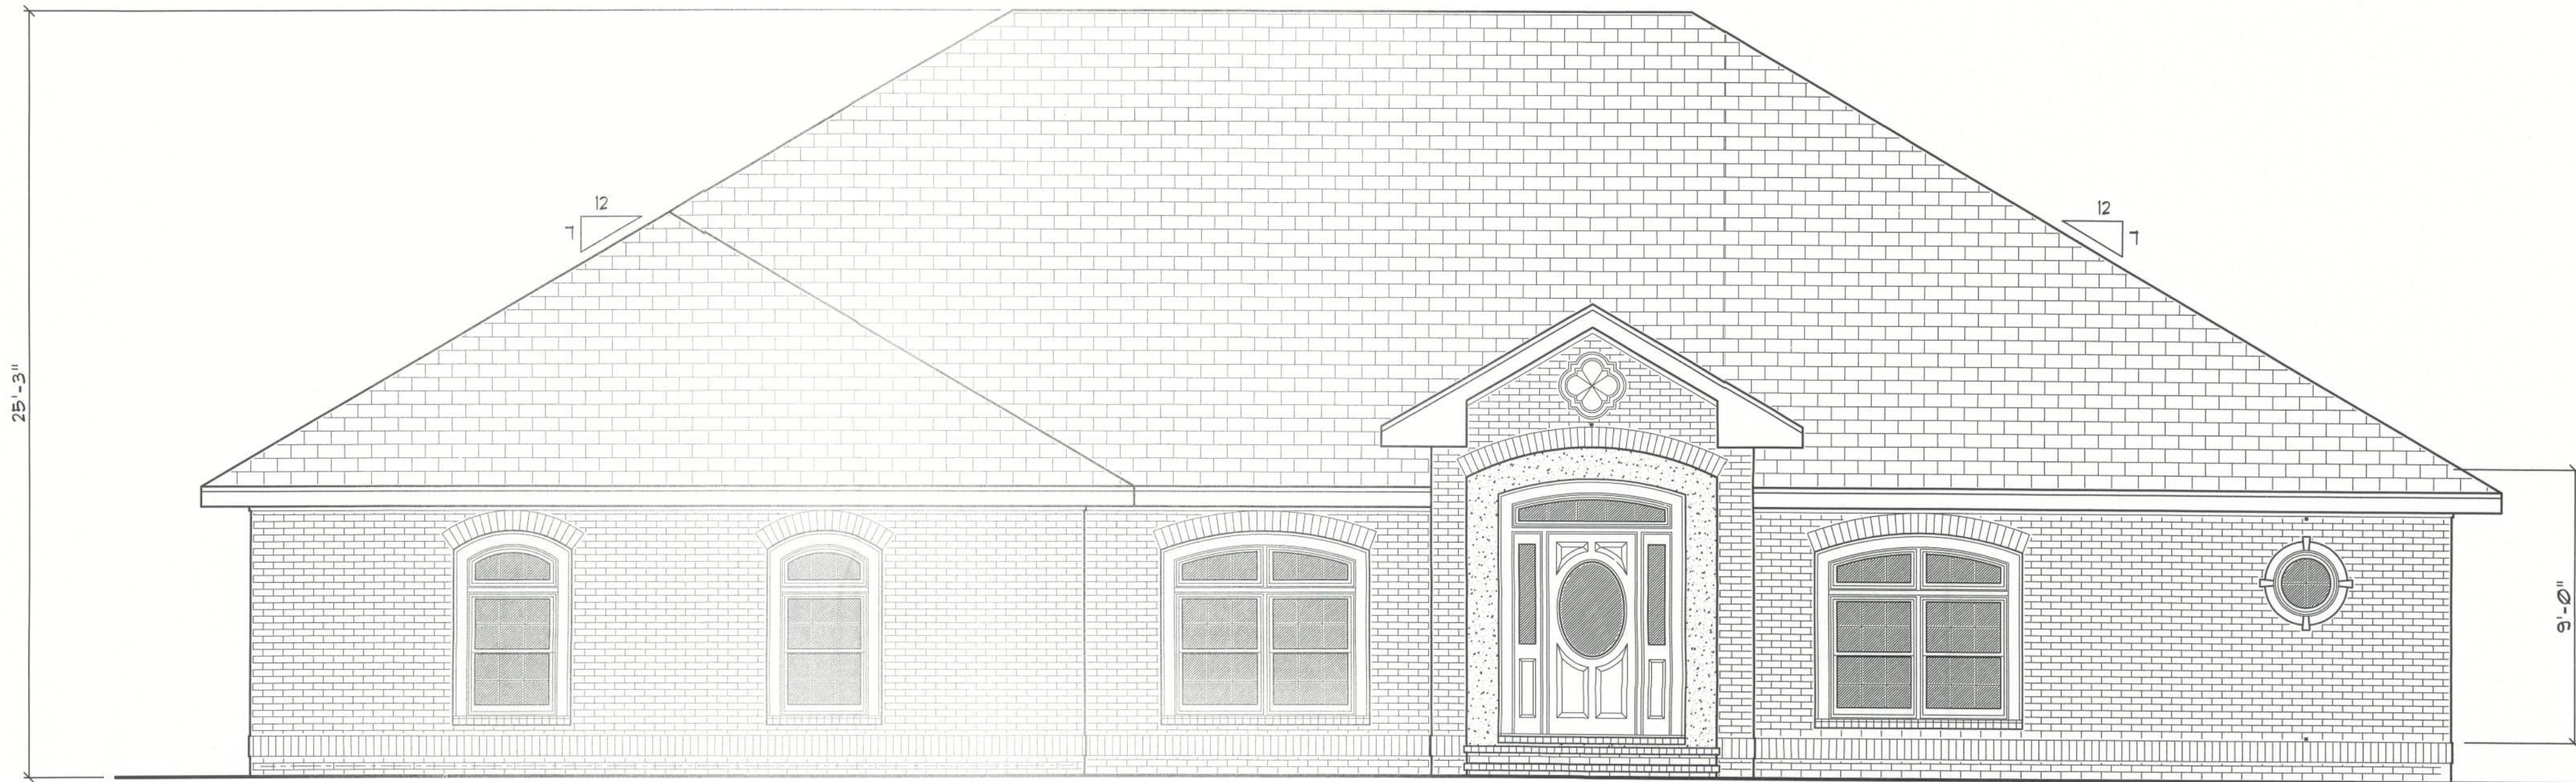


Front Elevation

SCALE: 1/4" = 1'-0"

NOTE!
REFER TO THE MATERIALS LIST FOR THE VARIOUS FINISH MATERIALS
FOR THE EXTERIOR BUILDING COMPONENTS, TYPICAL, T.O.

EXTERIOR FINISH MATERIALS:

1. CONT. RIDGE VENT TO MATCH ROOFING
2. FINISH ROOFING AS SELECTED BY OWNER
3. MTL. FLASHING ON 1X6 CYPRESS FASCIA
4. DBL. GLAZED FRENCH DOORS
5. DBL. GLAZED CROSSBUCK ENTRY DOORS
6. RAISED PANEL WOOD GARAGE DOOR
7. PORCH BEAM - SEE PLANS FOR SIZE
8. PORCH POSTS, STYLE PER OWNER'S CHOICE
9. BRICK VENEER - COLOR, STYLE & PATTERN
AS SELECTED BY THE OWNER
10. DBL. HUNG WOOD OR METAL WINDOWS W/
DBL. GLAZING, AS SELECTED BY OWNER
W/ SHUTTERS AS SELECTED BY OWNER
11. FIXED GLASS TRANSOM UNITS OVER DBL.
HUNG, TILT & SLID WINDOW UNIT - GLASS
DIVISION PATTERN AS SELECTED BY OWNER
12. ENTRY DOOR & SIDELITES AS
SELECTED BY OWNER
13. CONCRETE PORCH DECK, W/ WOOD FLOAT
FINISH & TOOLED EDGES
14. SHAPED 2X4 CYPRESS WATERTABLE &
1X CYP. SKIRT BOARD TRIM
15. MASONRY FOUNDATION - REFER TO
OWNER AS TO FINISH.

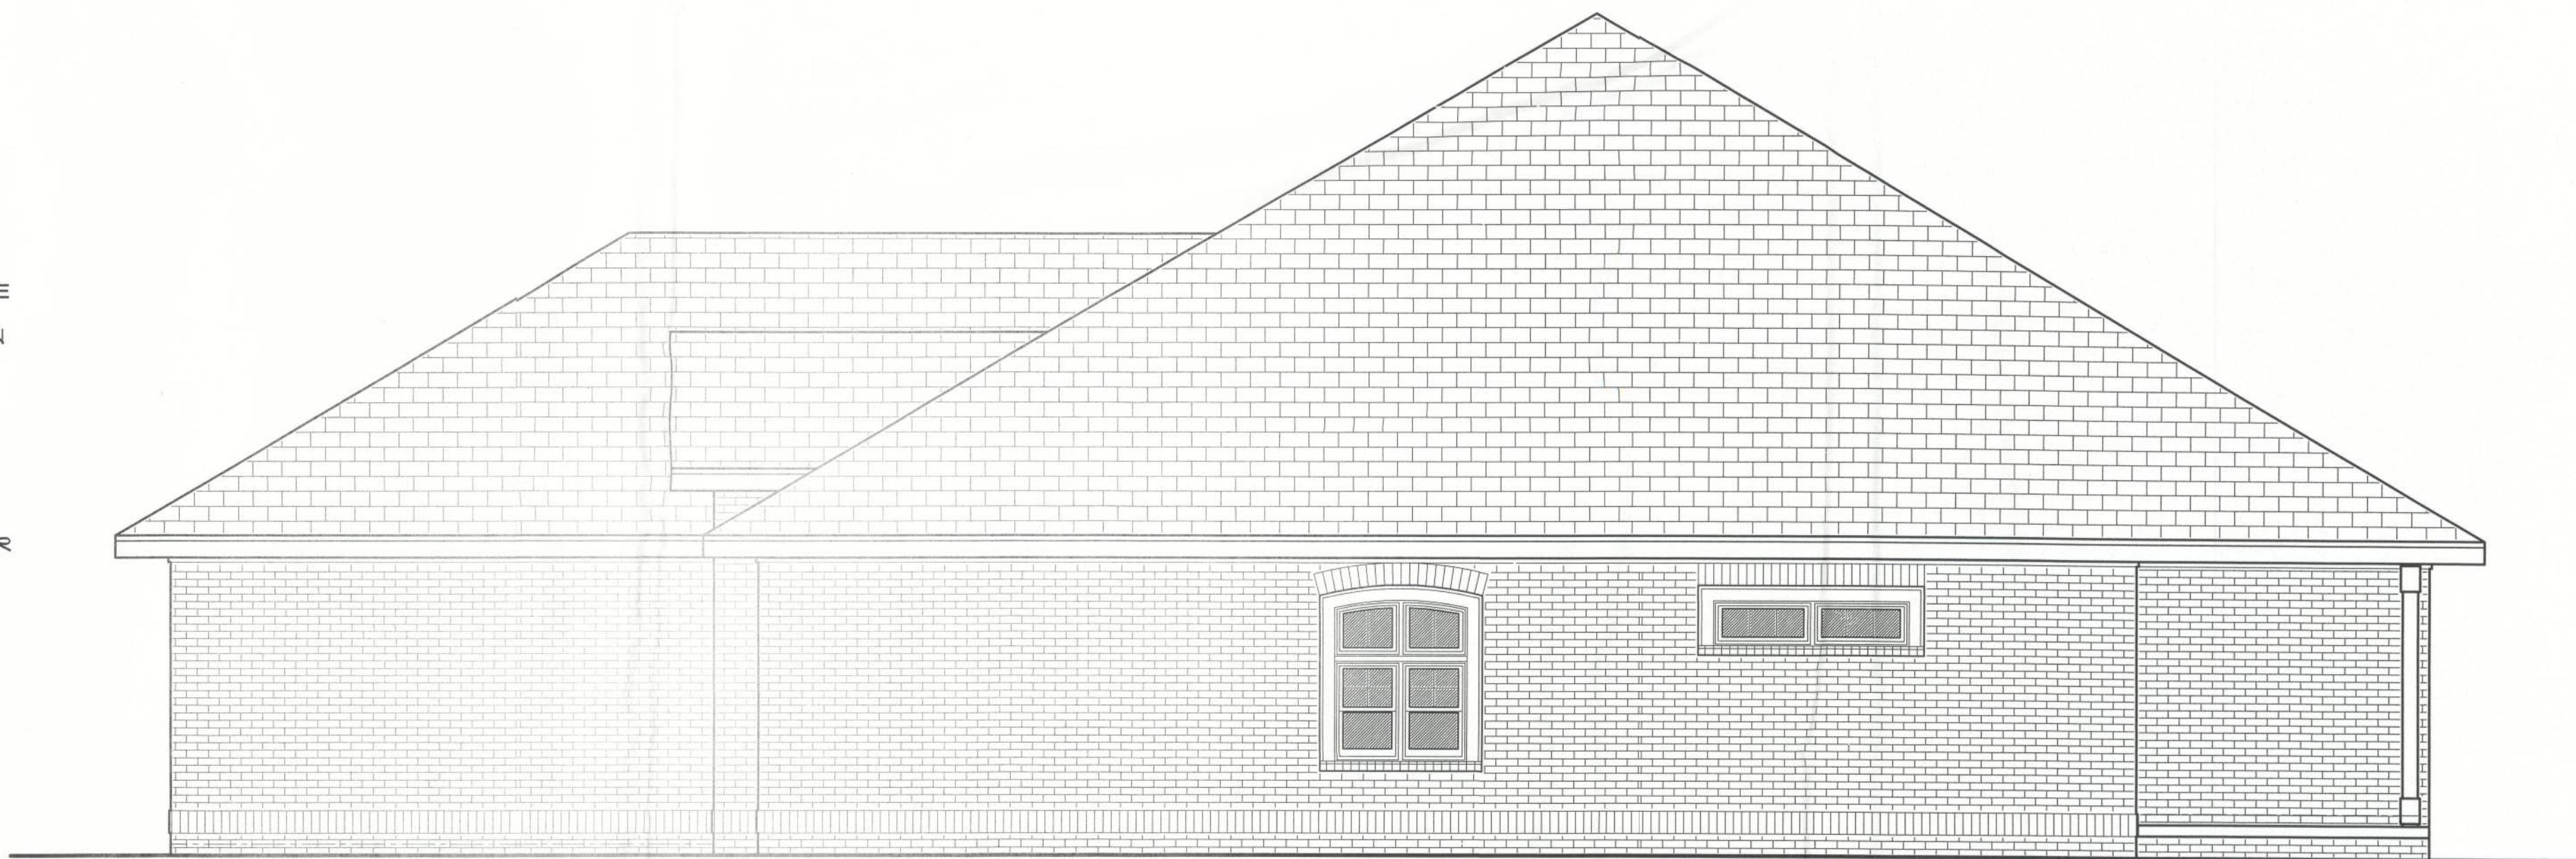

Left Side Elevation

SCALE: 1/4" = 1'-0"

REVISION:

21 DEC 2012
08 MAY 2013

Copyright, 2012 ©
N.P. Gelsler, Architect

DRAWN:

198

CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
ELEVATIONS



NICHOLAS
PAUL
GELSNER
ARCHITECT
1755 NW Brown Rd.
Gainesville, FL 32609
352-389-1325
N.C.A.R.C. CERTIFIED

DATE:

15 NOV 2012

COMM:

2K1287


SHEET:

A.1

1 OF 13

16 May 2013
AR0007005


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use in or incorporated within any other job without specific and individual authorization by the architect.

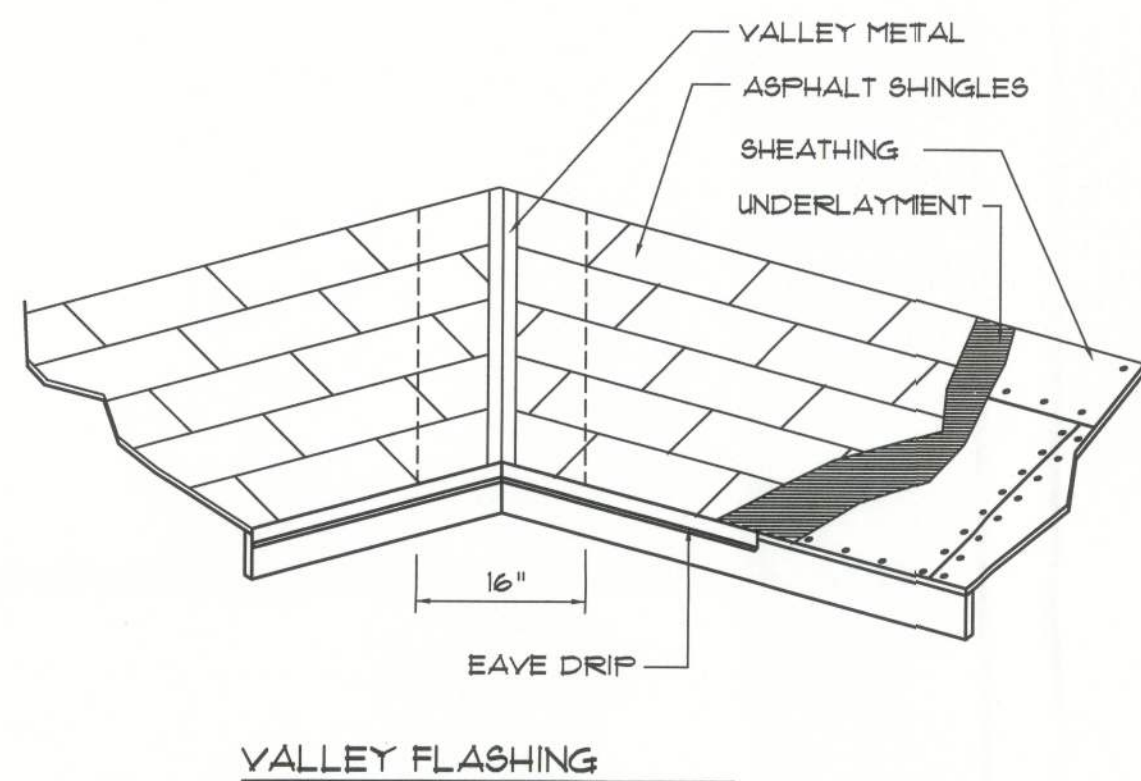

ROOFING METALS for FLASHING/ROOFING MINIMUM THICKNESS REQUIREMENTS			
MATERIAL	MINIMUM THICKNESS (in)	GAGE	WEIGHT (OZ)
COPPER			16
ALUMINUM	0.024		
STAINLESS STEEL		28	
GALVANIZED STEEL	0.0179	26 (ZINC COATED G90)	
ZINC ALLOY LEAD PAINTED TERNE	0.021		40 20

Roofing/Flashing DETS.
SCALE: NONE


C

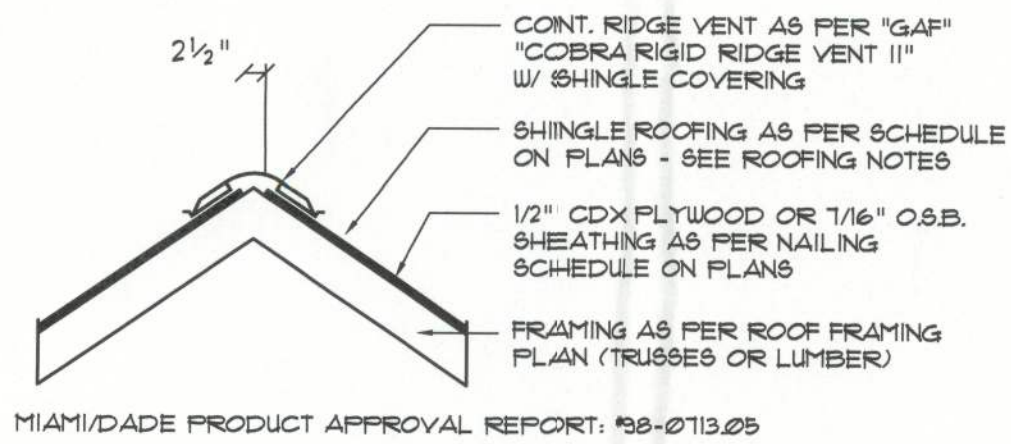

MIAMI/DADE PRODUCT APPROVAL REPORT: 138-0713.05

Ridge Vent DETAIL
SCALE: 3/4" = 1'-0"

B

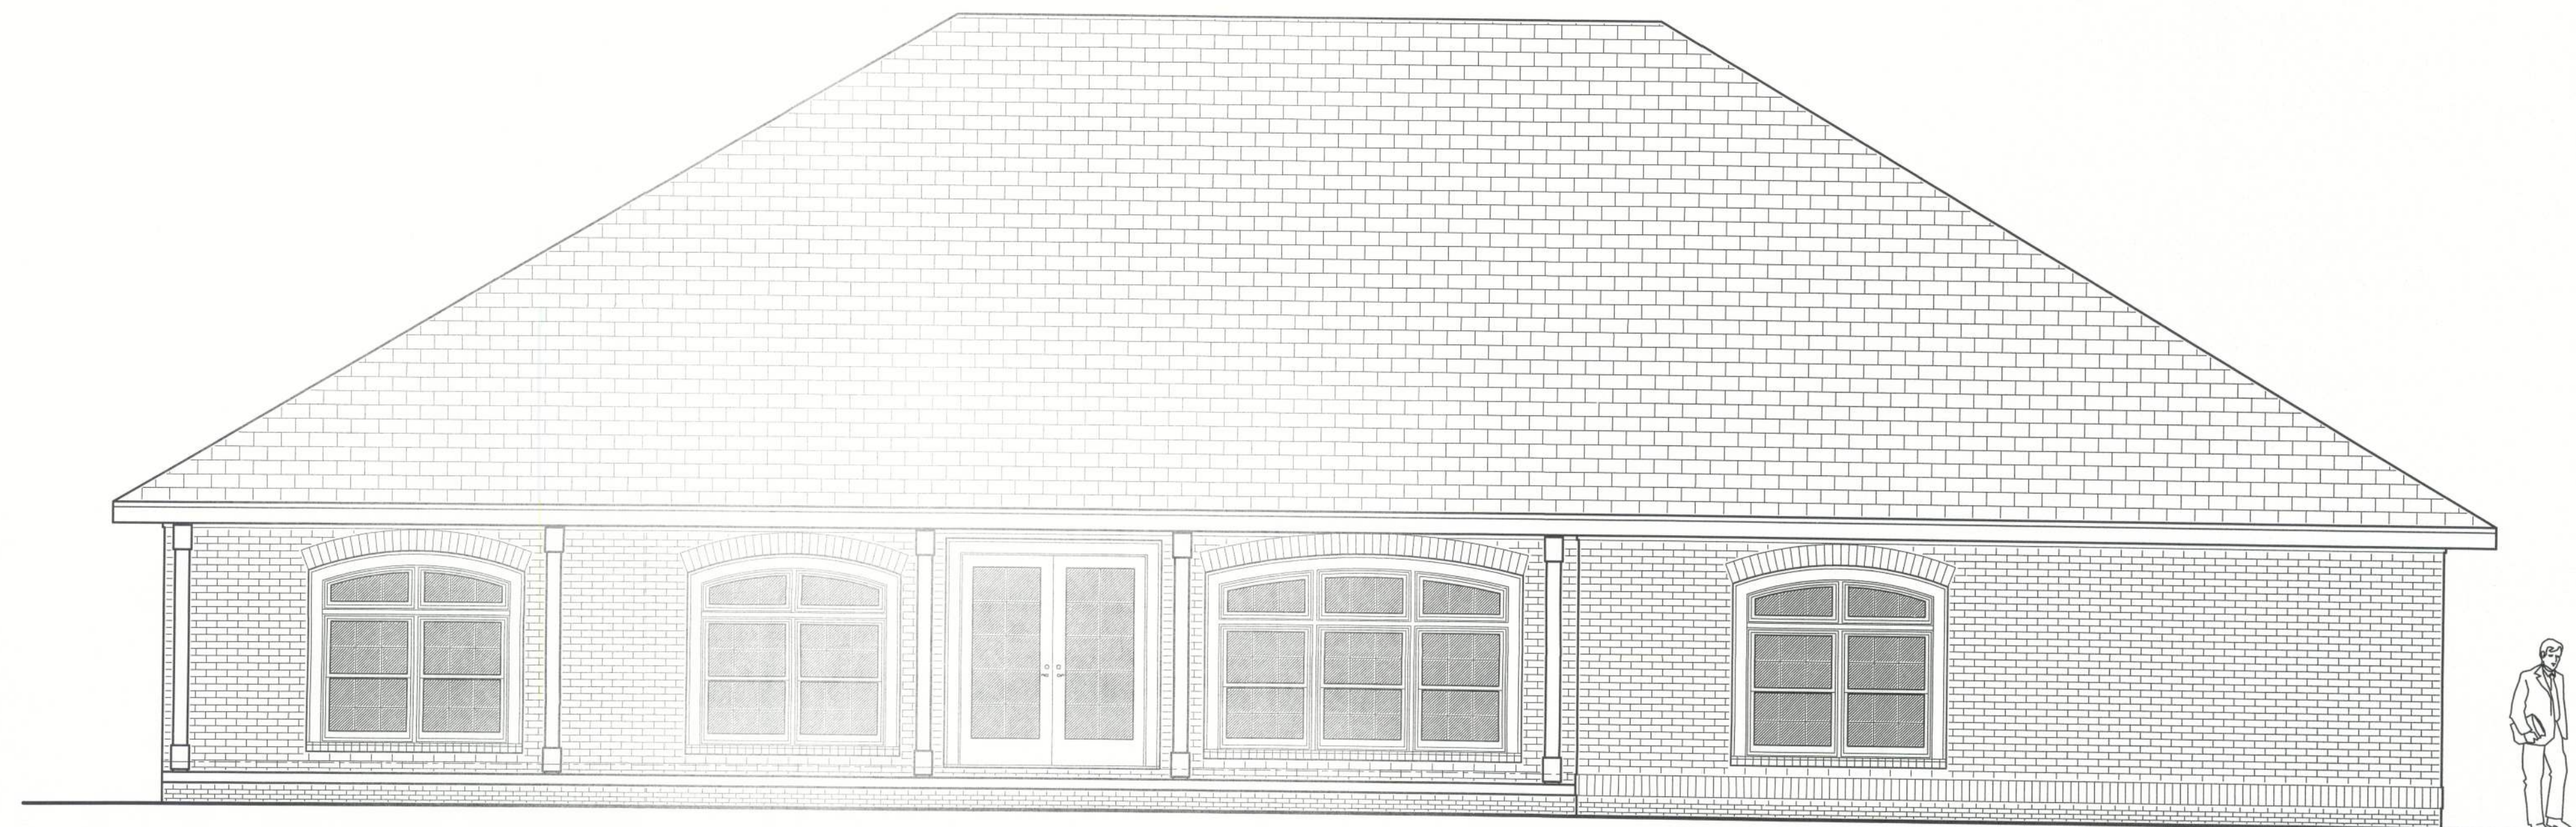

Rear Elevation
SCALE: 1/4" = 1'-0"



Right Side Elevation
SCALE: 1/4" = 1'-0"

REVISION:
27 DEC 2012
08 MAY 2013

Copyright, 2012
N.P. Geisler, Architect

DRAWN:
108

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
ELEVATIONS

40 Years of Service
1972 - 2012
N.P. Geisler, Architect
AR000700

NICHOLAS PAUL GEISLER
ARCHITECT
N.C.A.R.T.B. - Certified
1758 NW 80th St.
Lake City, FL 32055
386-365-4355

DATE:
15 NOV 2012
COMM:
2K1287

SHEET:
A.2
2 OF 13

10 May 2013
AR0007005


Electrical SYMBOLS

POWER

- DUPLEX WALL RECEPTACLE
- DUPLEX WALL RECEPT, BELOW COUNTER
- 240V OUTLET
- GND FAULT INTERRUPTER DUPLEX RECEPT.
- WEATHER PROOF GFI DUPLEX RECEPT.
- QUADRAPLEX WALL RECEPTACLE
- DUPLEX WALL RECEPTACLE, 1/2 SWITCHED
- DUPLEX FLOOR RECEPTACLE
- JUNCTION BOX
- MOTOR (6P - SUBMERSIBLE PUMP)
- ELECTRICAL PANEL
- ELECTRICAL PANEL
- EXHAUST FAN
- SMOKE DETECTOR, 120V
- NON-FUSED DISC SWITCH
- CHIME
- MOMENTARY PUSHBUTTON SWITCH, LIGHTED
- HVAC THERMOSTAT, 60° AFF
- TELEVISION OUTLET
- TELEPHONE
- TELEPHONE, FLOOR OUTLET
- INTERCOM MASTER CONTROL
- INTERCOM STATION
- ALARM ANNUNCIATOR
- PASSIVE IR MOTION DETECTOR
- SECURITY ALARM MASTER CONTROL CABINET
- SECURITY ALARM KEYPAD
- DOOR/WINDOW SWITCH

LIGHTING

- SFSST WALL SWITCH
- DPDT WALL SWITCH (3-WAY)
- SFSST WALL SWITCH, w/ DIMMER
- INC. CHANDELIER, 600W
- CEILING FAN, w/ INC. LIGHT FIXTURE
- 2 LAMP FLU. PRISMATIC WRAP SURFACE FIXTURE
- 2 LAMP FLU. PRISMATIC WRAP SURFACE FIXTURE
- 4 LAMP FLU. PRISMATIC WRAP SURFACE FIXTURE
- INC. LIGHT FIXTURE
- HIGH HAT DOWN LIGHT
- HIGH HAT WALL WASHER
- INC. LIGHT FIXTURE, FULL CHAIN
- VAPOR PROOF INC. LIGHT FIXTURE
- INC. WALL BRACKET
- HEAT LAMP
- DBL. LAMP INC. FLOOD LIGHT
- INC. TRACK LIGHT
- INC. ROPE LIGHT w/ 5W LAMPS @ 4' O.C.
- SWITCH/FIXTURE WIRING
- CONTROL WIRE / LOW VOLTAGE
- TIME CLOCK

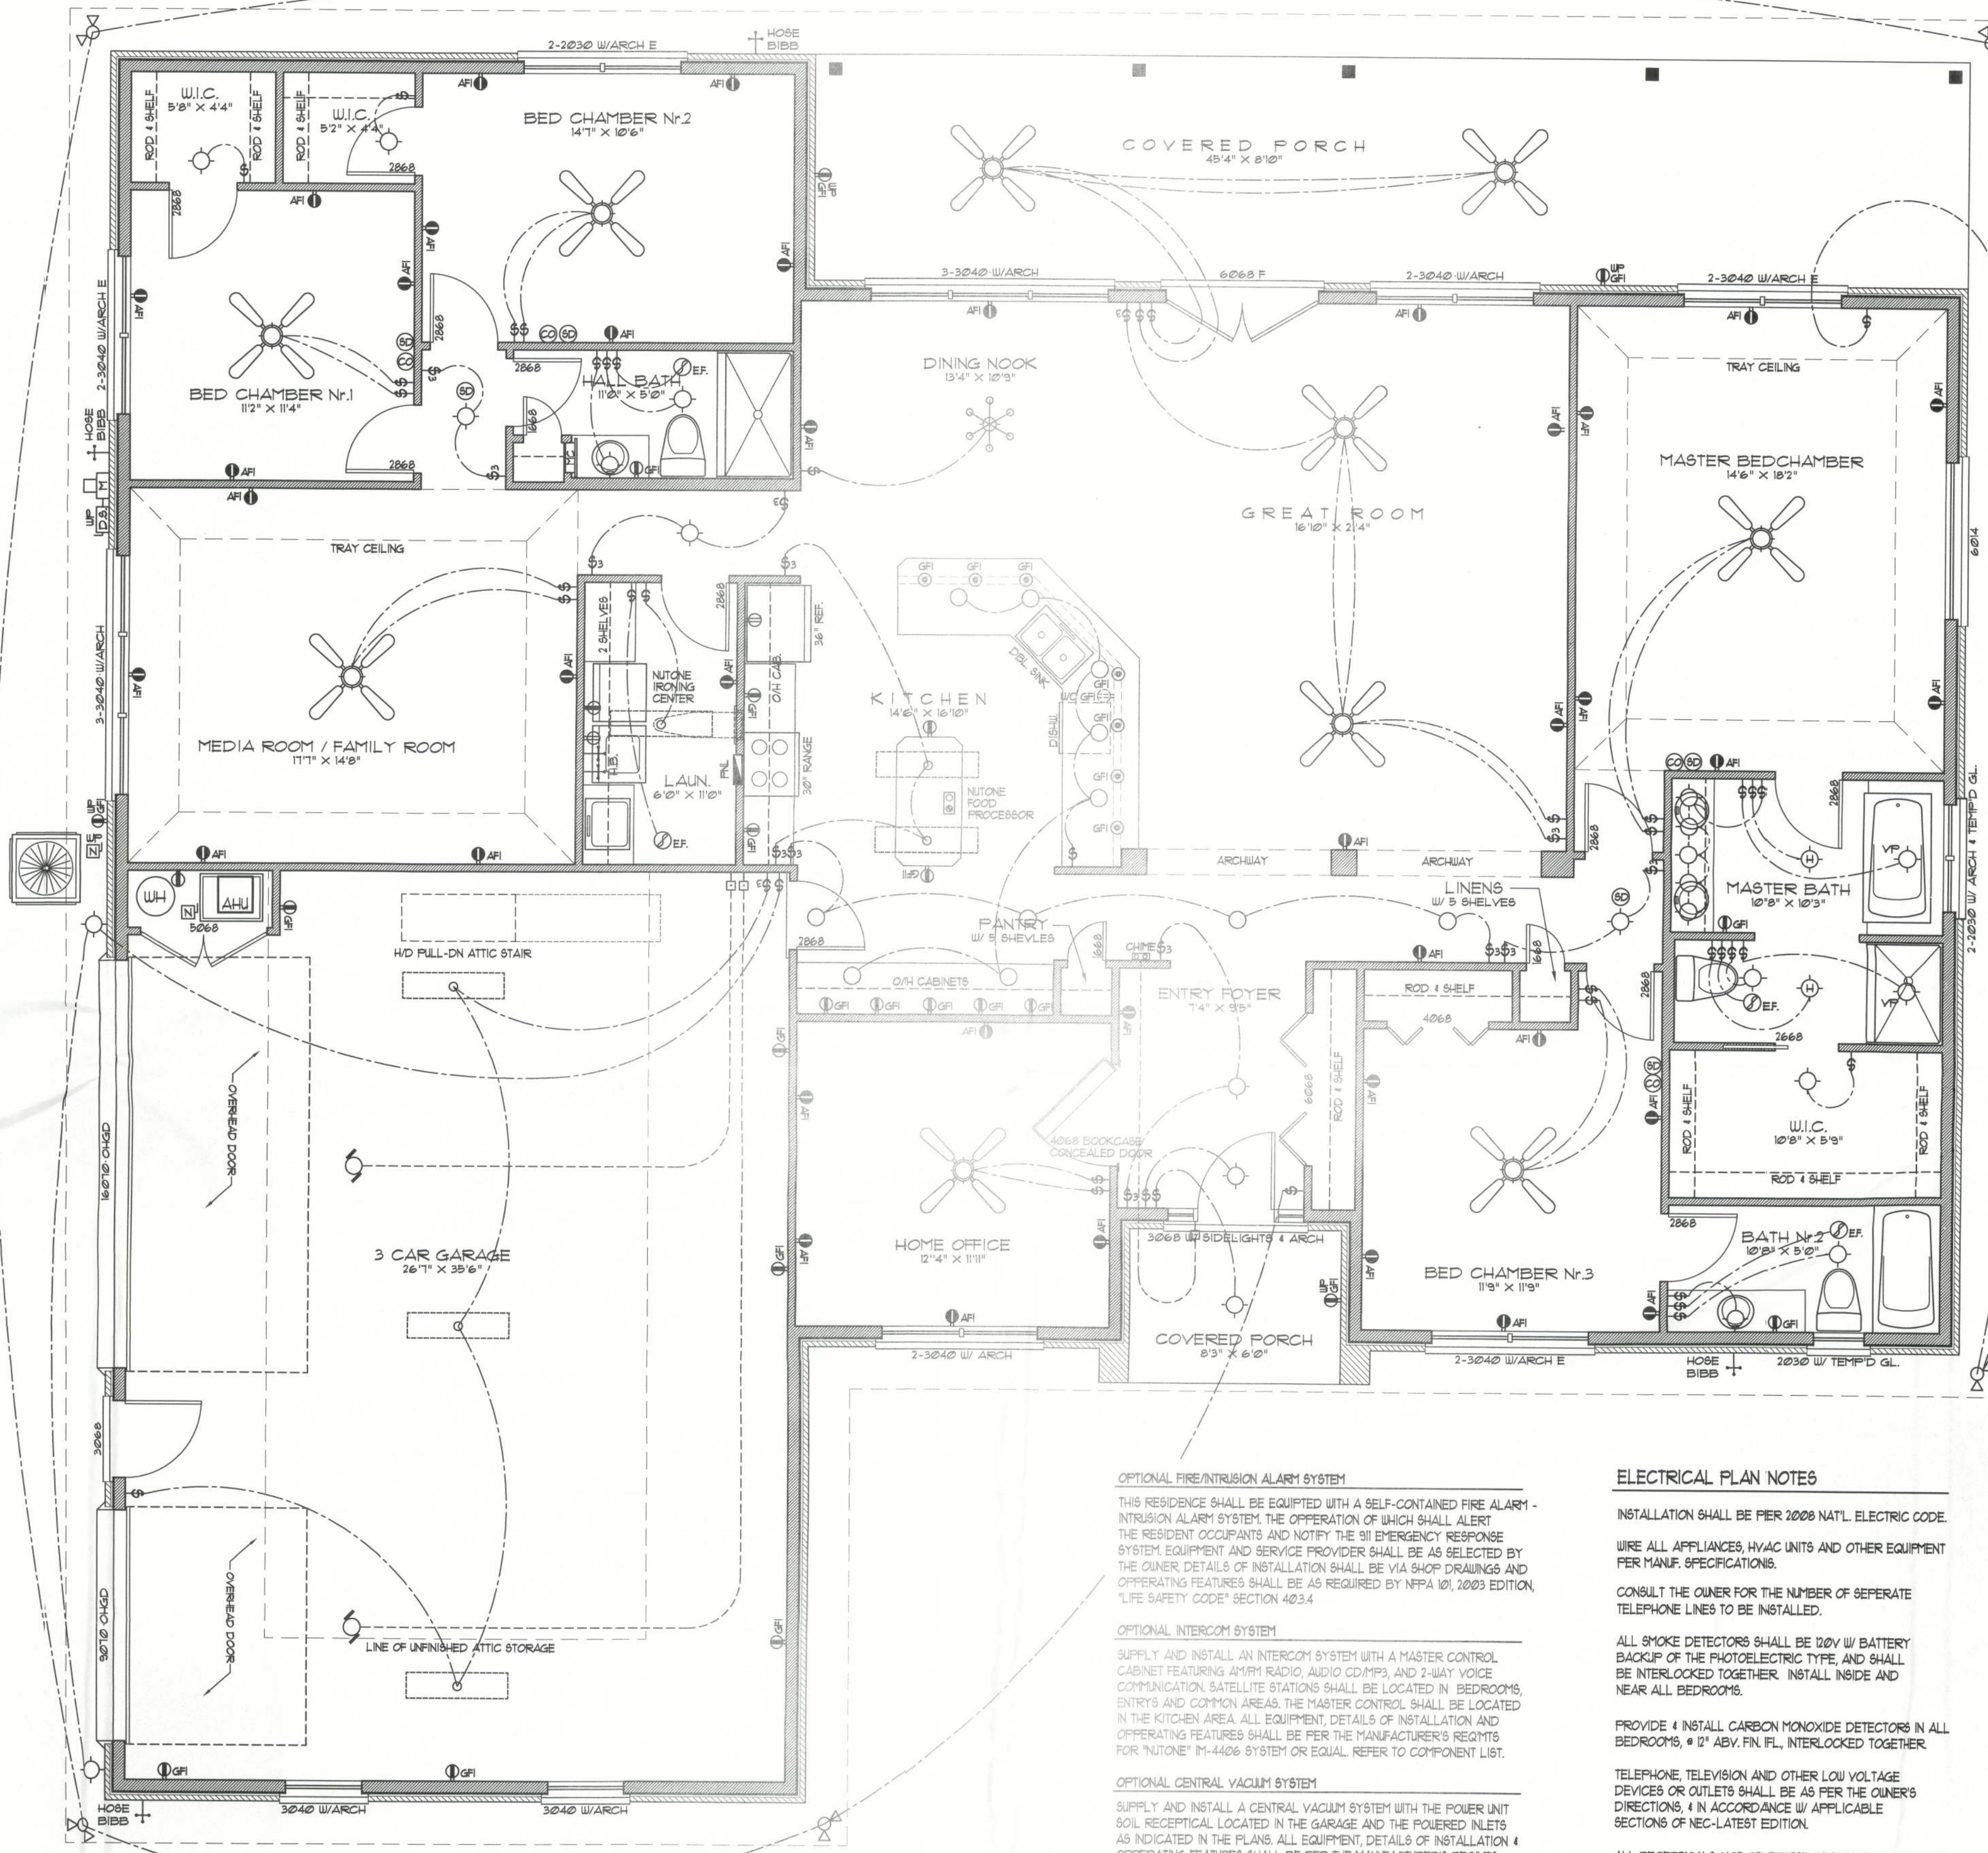

Floor PLAN

SCALE: 1/4" = 1'-0"

NOTE!
REFER TO GENERAL INTERIOR FINISH SCHEDULE ON SHEET A-6

NOTE!
ALL WINDOWS DESIGNATED WITH "E" SHALL BE EGRESS TYPE UNITS

OPTIONAL FIRE/INTRUSION ALARM SYSTEM

THIS RESIDENCE SHALL BE EQUIPPED WITH A SELF-CONTAINED FIRE ALARM - INTRUSION ALARM SYSTEM. THE OPERATION OF WHICH SHALL ALERT THE RESIDENT OCCUPANTS AND NOTIFY THE 911 EMERGENCY RESPONSE SYSTEM. EQUIPMENT AND SERVICE PROVIDER SHALL BE AS SELECTED BY THE OWNER. DETAILS OF INSTALLATION SHALL BE VIA SHOP DRAWINGS AND OPERATING FEATURES SHALL BE AS REQUIRED BY NFPA 101, 2003 EDITION, "LIFE SAFETY CODE" SECTION 403.4.

OPTIONAL INTERCOM SYSTEM

SUPPLY AND INSTALL AN INTERCOM SYSTEM WITH A MASTER CONTROL CABINET FEATURING AM/FM RADIO, AUDIO CD/MP3, AND 2-WAY VOICE COMMUNICATION. SATELLITE STATIONS SHALL BE LOCATED IN: BEDROOMS, ENTRY AND COMMON AREAS. THE MASTER CONTROL SHALL BE LOCATED IN THE KITCHEN AREA. ALL EQUIPMENT, DETAILS OF INSTALLATION AND OPERATING FEATURES SHALL BE PER THE MANUFACTURER'S REGMITS FOR "NUTONE" IM-4406 SYSTEM OR EQUAL. REFER TO COMPONENT LIST.

OPTIONAL CENTRAL VACUUM SYSTEM

SUPPLY AND INSTALL A CENTRAL VACUUM SYSTEM WITH THE POWER UNIT SOIL RECEPTACLE LOCATED IN THE GARAGE AND THE POWERED INLETS AS INDICATED IN THE PLANS. ALL EQUIPMENT, DETAILS OF INSTALLATION AND OPERATING FEATURES SHALL BE PER THE MANUFACTURER'S REGMITS FOR "NUTONE" CV-1500 QUIET SERIES SYSTEM OR EQUAL. REFER TO COMPONENT LIST.

NOTE!
CABINETS, COUNTERS, SHELVES AND THE LIKE, SHOWN ON THIS PLAN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS OF QUALITY AS OUTLINED IN THE NOTES TITLED "GENERAL MILLWORK NOTES", AND SHALL INCLUDE SUCH FEATURES, HARDWARE AND FINISHES AS DIRECTED BY THE OWNER. THE PLAN VIEWS INDICATED ARE FOR GENERAL LOCATION AND EXTENT OF THE WORK - UNLESS DETAILED CABINET PLANS ARE INCLUDED WITH THIS PLANS PACKAGE. ALL OTHER PHYSICAL CHARACTERISTICS SHALL BE AS DIRECTED BY THE OWNER.

NOTE!
PROVIDE 2X6 BACKING AT ALL OVERHEAD CABINET LOCATIONS, FLUSH WITH FACE OF FRAMING - TOP OF BACKING TO BE 1'-0" AFF.

ELECTRICAL PLAN NOTES

INSTALLATION SHALL BE PER 2008 NAT'L. ELECTRIC CODE.

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.

ALL SMOKE DETECTORS SHALL BE 120V w/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.

PROVIDE 4 INSTALL CARBON MONOXIDE DETECTORS IN ALL BEDROOMS, 1 12" ABV. FN. FL, INTERLOCKED TOGETHER.

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, 4 IN ACCORDANCE w/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

ALL RECEPTICALS, NOT OTHERWISE DESIGNATED, SHALL BE ARC FAULT INTERRUPTER TYPE, EXCEPT DEDICATED OUTLETS.

ALL RECEPTICALS IN KITCHEN AND BATHS SHALL BE GROUND FAULT INTERRUPTER TYPE (GFI).

ALL EXTERIOR RECEPTICALS SHALL BE WEATHERPROOF GROUND FAULT INTERRUPTER TYPE (WPGFI).

ELECTRICAL CONTR. SHALL PREPARE "AS-BUILT" SHOP DUGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE w/ ALL QCTS IDENTIFIED w/ QCT N, DESCRIPTION & BRKR. SERVICE ENT. 4 ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPES & EQUIPMENT TYPE w/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.


PANEL SCHEDULE

PANEL 1: 200A - MLO - 120/240V - 1P - 4 WIRE 40 SLOT - FLUSH MOUNT

Cir. Nr.	Location	Trip Poles	Wire Size	Load
1-10	Lighting/Recept.	15A/FP	14NM	12132W
11	Dishwasher	-	-	1500W
12-14	Sm. KIL. Appliances	20A/FP	12NM	4500W
15-17	Ceiling Fans	15A/FP	14NM	3600W
18-20	Fut. Irrigation Pump	20A/FP	12NM	1200W
21	Refrigerator	15A/FP	14NM	1200W
22	Spares	-	-	400W
23	ELH	30A/2P	10NM	4500W
24	Range	50A/2P	6NM	8000W
25	Water Well	20A/2P	12NM	1200W
26	Dryer	30A/2P	10NM	5000W
27	HVAC CU	60A/2P	6NM	(6300W)
28	HVAC AHU	60A/2P	12NM	10000W
29	Fut. Pool Pump	20A/2P	12NM	1200W
30	Spares	-	-	400W
31-40	Spares	-	-	2400W
TOTAL CONNECTED LOAD:				58032W

ELECTRICAL COMPUTATIONS

General Lighting/Receptacles @ 3w/sf		
4544 sf x 3w =	13632.0w	
Washer Circuit	1500.0w	
Dishwasher Circuit	1500.0w	
Sm. Appliance Circuits (3 @ 1500w)	4500.0w	
Sub-Total	21132.0w	
1st 3KW @ 100%	3000.0w	
Bal. of KW @ 35% (18132 x 35)	6346.2w	
Fixed Appliances:		
Refrigerator	1200.0w	
Cig. Fans (10 @ 360w)	3600.0w	
Irrigation Pump (future)	1200.0w	
Water Well Pump	1200.0w	
Pool Pump (future)	1200.0w	
ELH	4500.0w	
Spares (5 @ 640w)	3200.0w	
Sub-Total	15300.0w	
Load @ 75% DF.	11475.0w	
100% Demand Factor Loads:		
Dryer	5000.0w	
Range	8000.0w	
HVAC System (5.0T Heat Pump)	(6300.0w)	
HVAC System (10KW Heat Strip)	10000.0w	
Total Demand Load:	44621.2w	
FEEDER SIZE: 44621.2w / 240v = 185.92 amperes		
USE: 3 #10 THW w/ 1 # Cu GND / 2 1/2" C.		

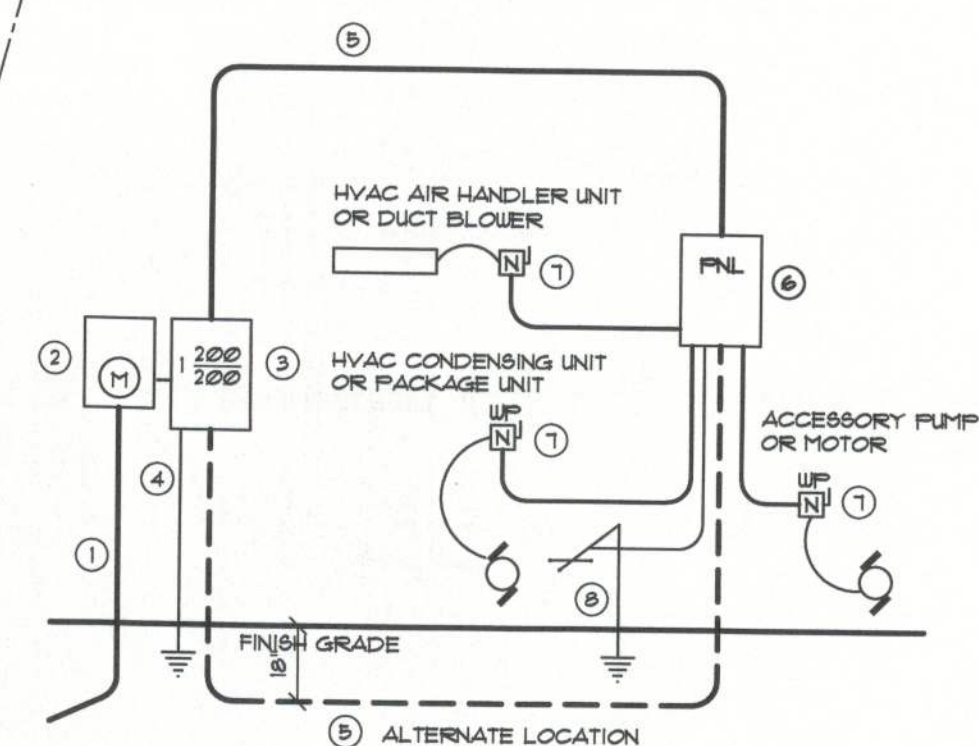

- 1 Service Feeder Entrance Conductors: 2 1/4" rigid conduit, min. 18" deep w/ continuous Ground Bonding Conductor. Service/Entrance Conductors shall not be spliced except that bolted connections at the Meter, Disconnect Devices and Panel shall be allowed.
- 2 Meter Enclosure, weatherproof, UL Listed.
- 3 Main Disconnect Switch: fused or Main BRKR, weatherproof, UL Listed.
- 4 Service entrance Grounds: 4" x 1/4" Inconsteel rod x 8'-0" long and/or concrete encased foundation steel rods x 20'-0" long. Grounding Conductor shall be bonded to each place of Service/Entrance Equipment, and shall be sized per Item 5, below.
- 5 200 AMPERE SERVICE: 3 #10-USE-Cu, 1 #4-Cu-GND, 2" Conduit.
- 6 House Panel (FNL) UL Listed, sized per schedule.
- 7 Equipment Disconnect Switch: non-fused, in weatherproof enclosure, size according to Panel Schedule loads.
- 8 Provide Ground Bond Wire to metal piping size in accordance with the Service Ground Conductor.

NOTE!
THE MINIMUM AIC RATING FOR PANEL BOARDS, BRKRS AND DISCONNECT SWITCHES SHALL BE 21,000 AIC.

ELECTRICAL RISER DIAGRAM: 200A
SCALE: NONE

REVISION:

21 DEC 2012
08 MAY 2013

Copyright, 2012
N.P. Geisler, Architect

DRAWN:

108

CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
FLOOR PLAN / ELECTRICAL PLAN

Celebrating
40 Years of Service
1972-2012
N.P. Geisler, Architect
AR0007005

NICHOLAS PAUL GEISLER
ARCHITECT
N.C.A.R.B. - Certified

DATE:
15 NOV 2012

COMMIT:
2K1287

SHEET:
A.3

3 OF 13

10/11/2012
AR0007005


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.



Int. Wall Trim DETAIL B


SCALE: 1/2" = 1'-0"

B

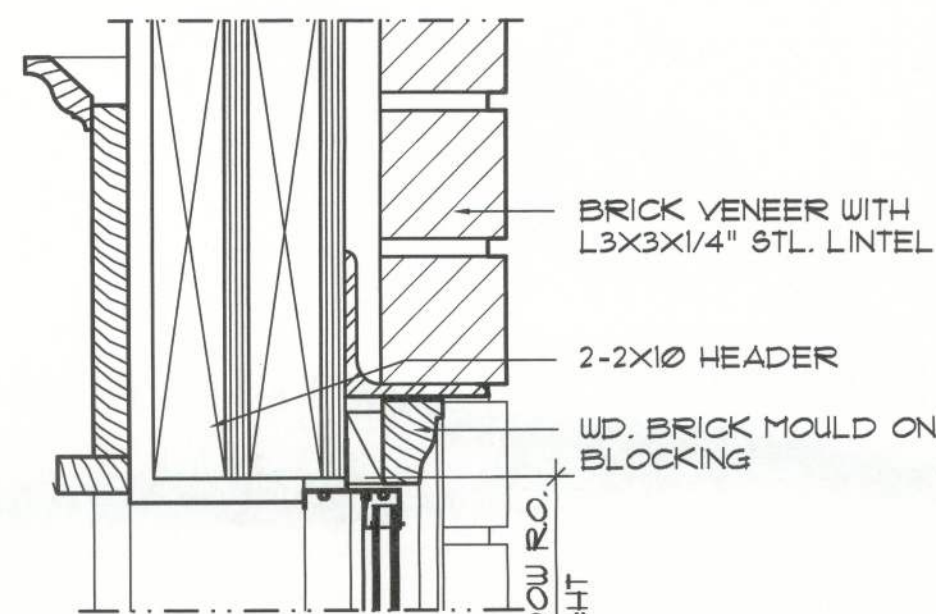


HEAD DETAIL MTL. SASH

1

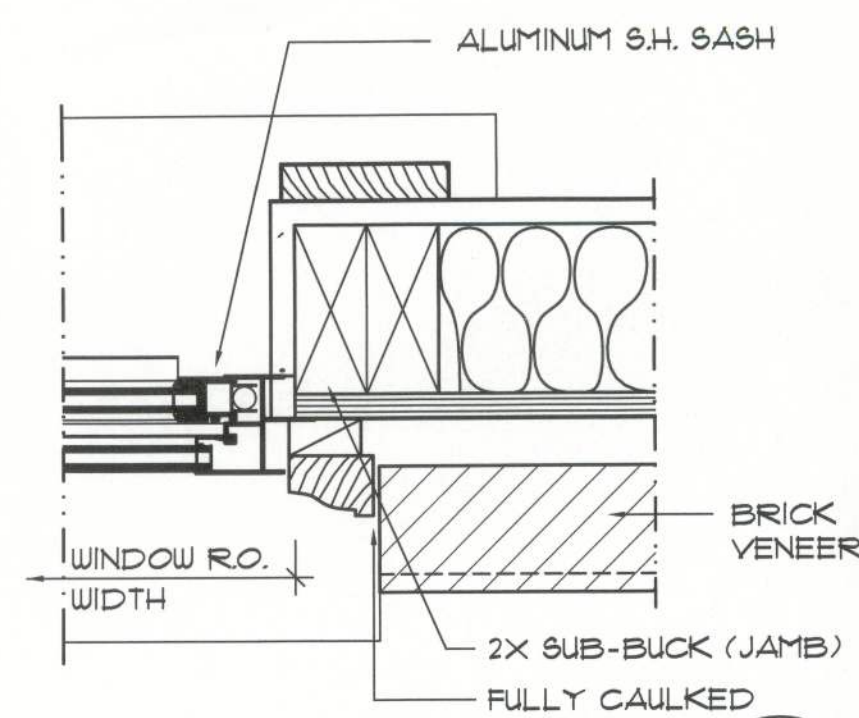

JAMB DETAIL WOOD SASH

2

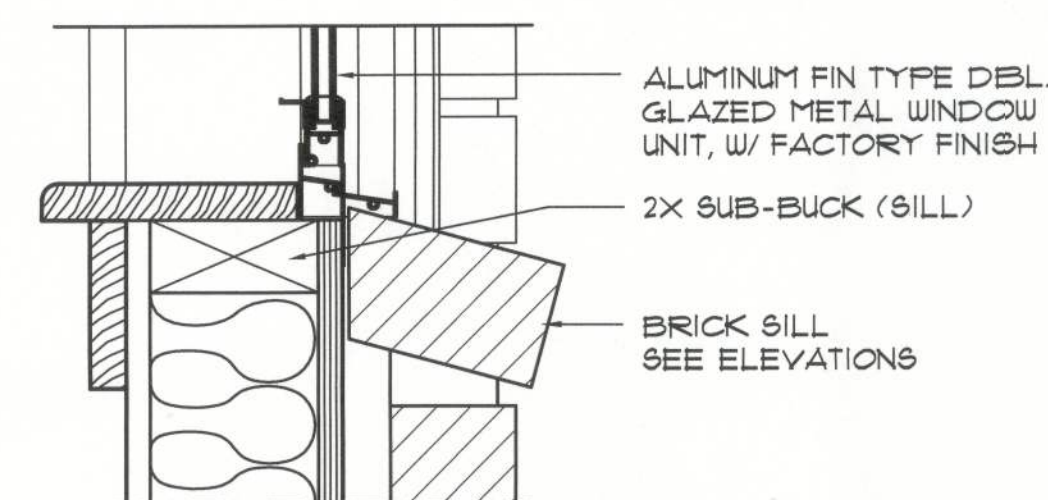


SILL DETAIL WOOD SASH

3

Typical Window DET'S

SCALE: 3" = 1'-0"

A

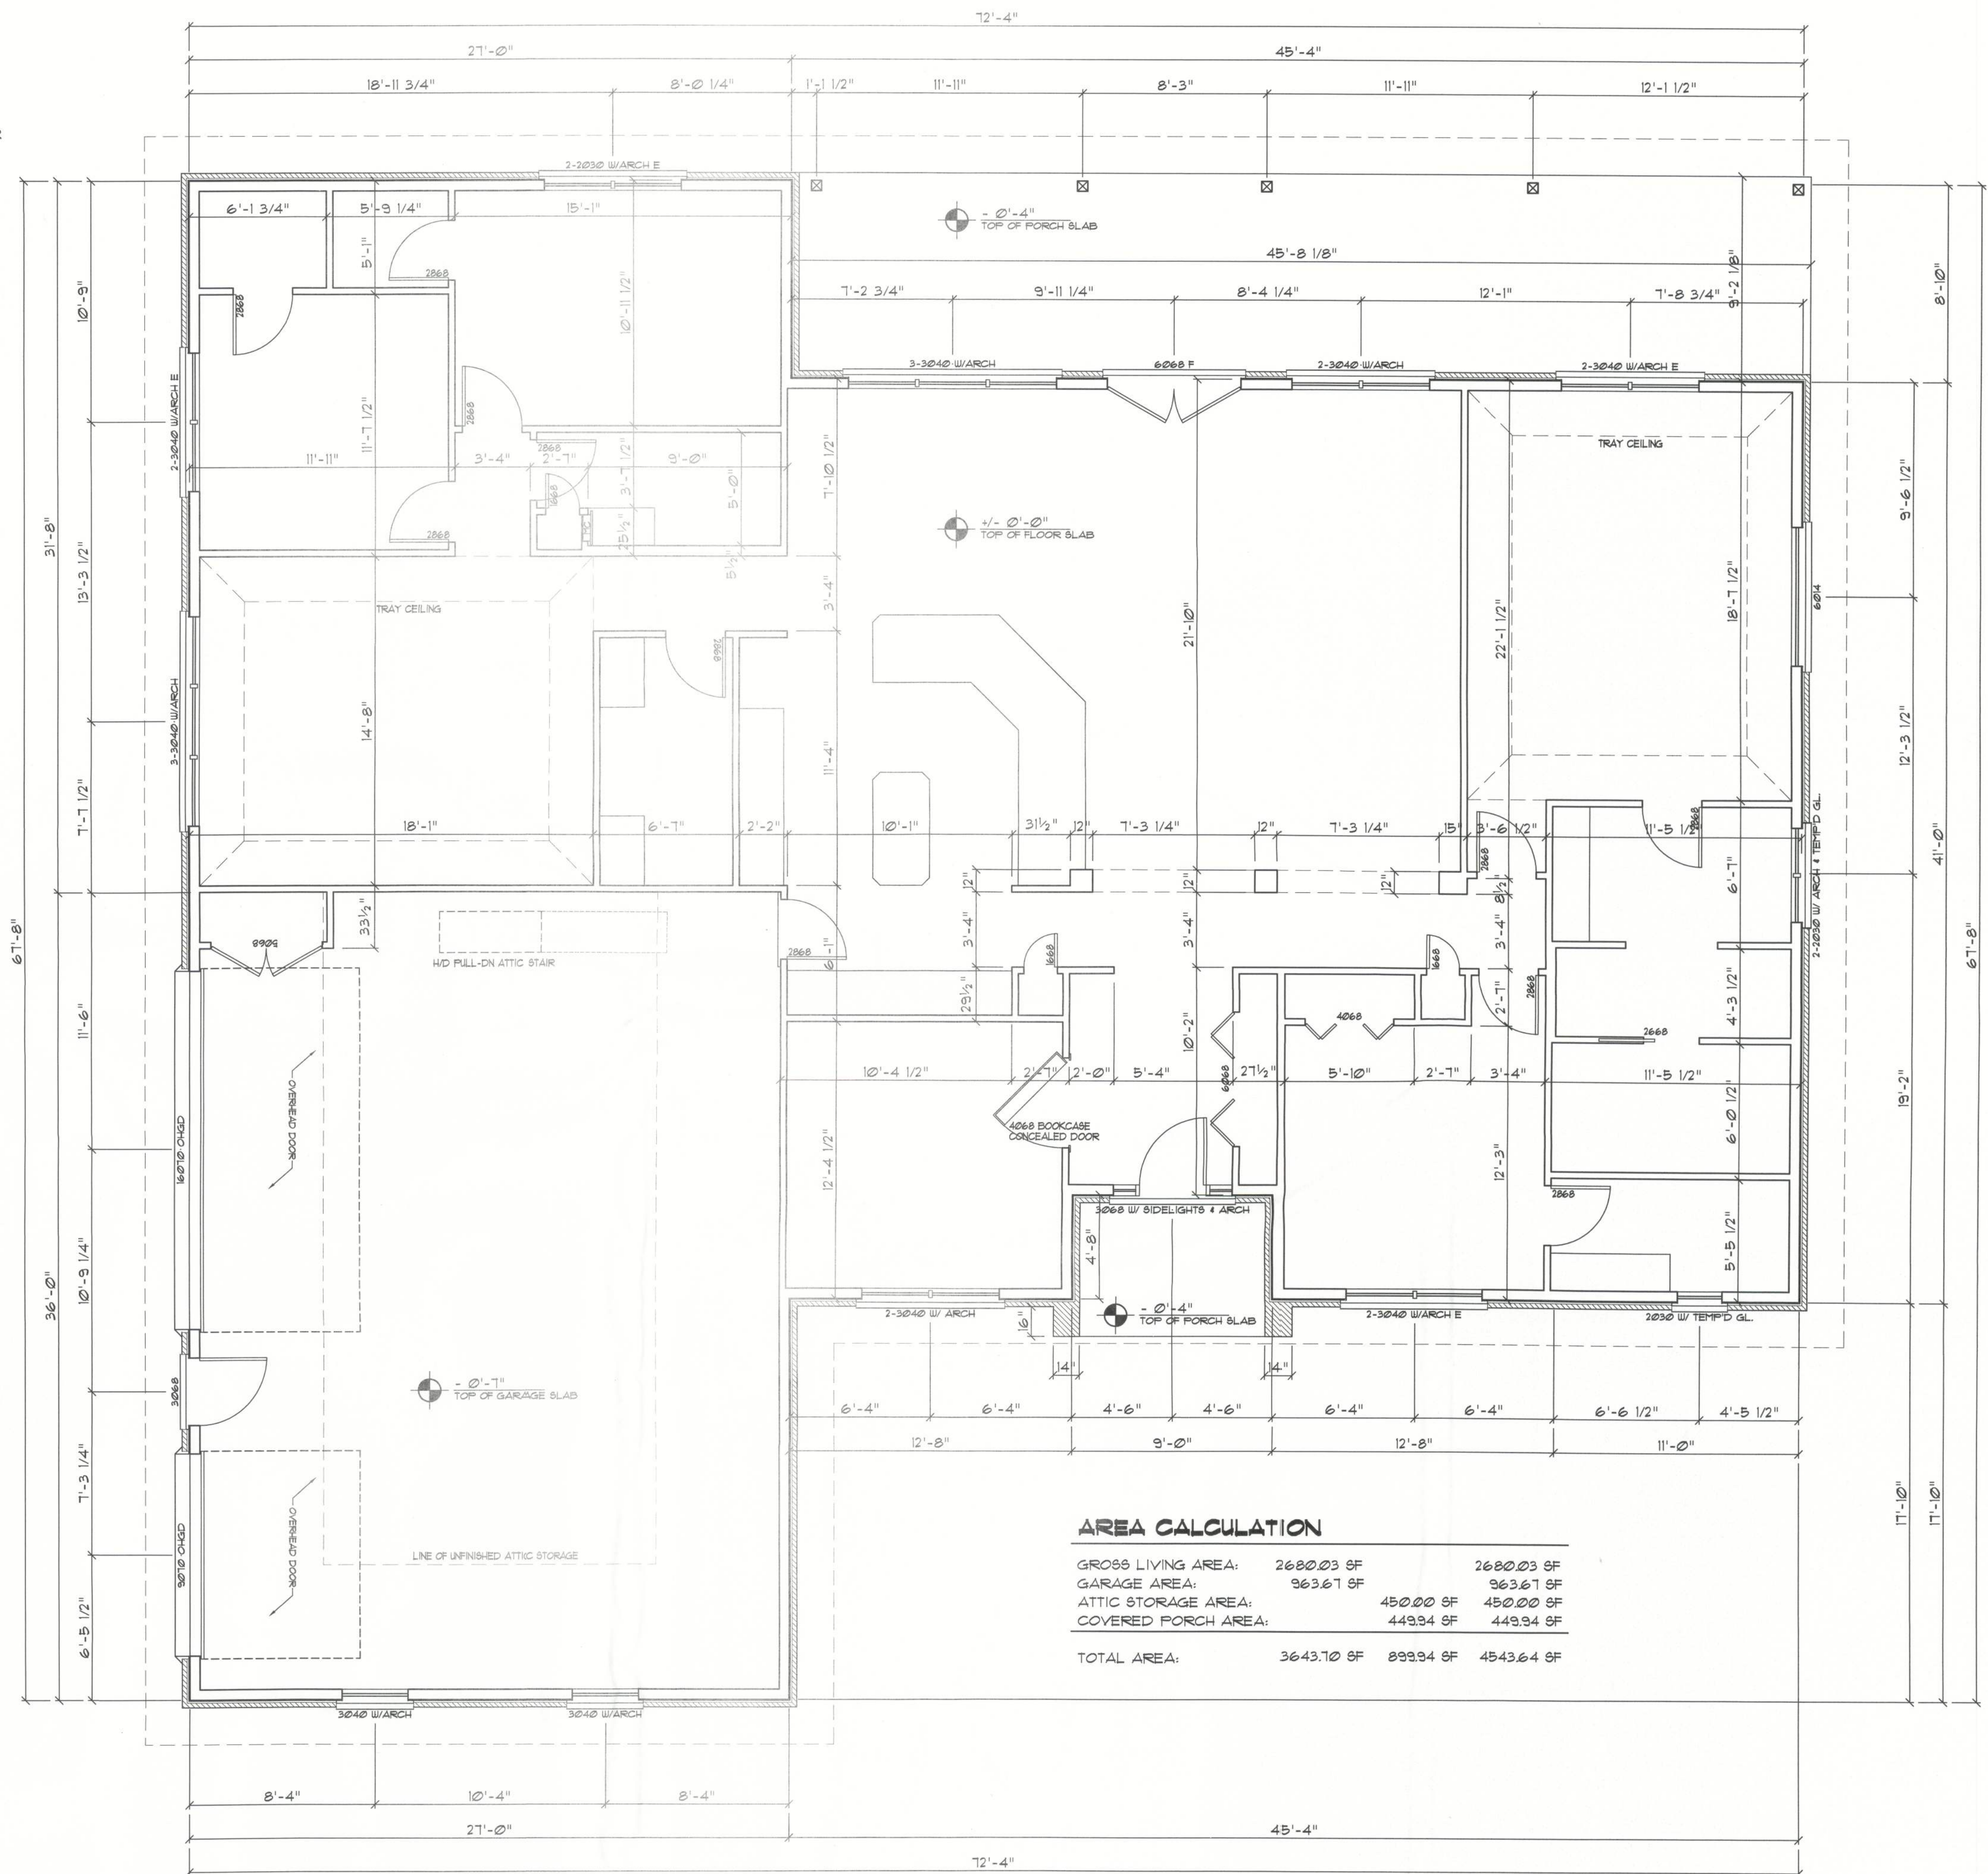

AREA CALCULATION

GROSS LIVING AREA:	2680.03 SF	2680.03 SF
GARAGE AREA:	963.61 SF	963.61 SF
ATTIC STORAGE AREA:	450.00 SF	450.00 SF
COVERED PORCH AREA:	449.94 SF	449.94 SF
TOTAL AREA:	3643.10 SF	4543.64 SF

Dimension PLAN

SCALE: 1/4" = 1'-0"

NOTE:
ALL INTERIOR PARTITION WALLS ARE 3 1/2" THICK, UNLESS NOTED OTHERWISE.
NOTE:
ALL WINDOWS DESIGNATED WITH "E" SHALL BE EGRESS TYPE UNITS

NOTE:
ALL INTERIOR PARTITION WALLS ARE 3 1/2" THICK, UNLESS NOTED OTHERWISE.

NOTE:
ALL EXTERIOR WALLS ARE 2X6 STUDS W/ 1/2" THICK CDX PLYWD. SHEATHING

REVISION:
21 DEC 2012
08 MAY 2013

Copyright, 2012
N.P. Gesler, Architect

DRAWN:
198

CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
DIMENSION PLAN

Celebrating
40 Years of Service
1972 - 2012
N.P. Gesler, Architect
N.C. STATE LICENSE
13585-365-4325

**NICHOLAS PAUL
GESLER
ARCHITECT**
N.C. STATE LICENSE
13585-365-4325

DATE:
15 NOV 2012

COMM:

2K1287


SHEET:

A.4

4 OF 13


AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

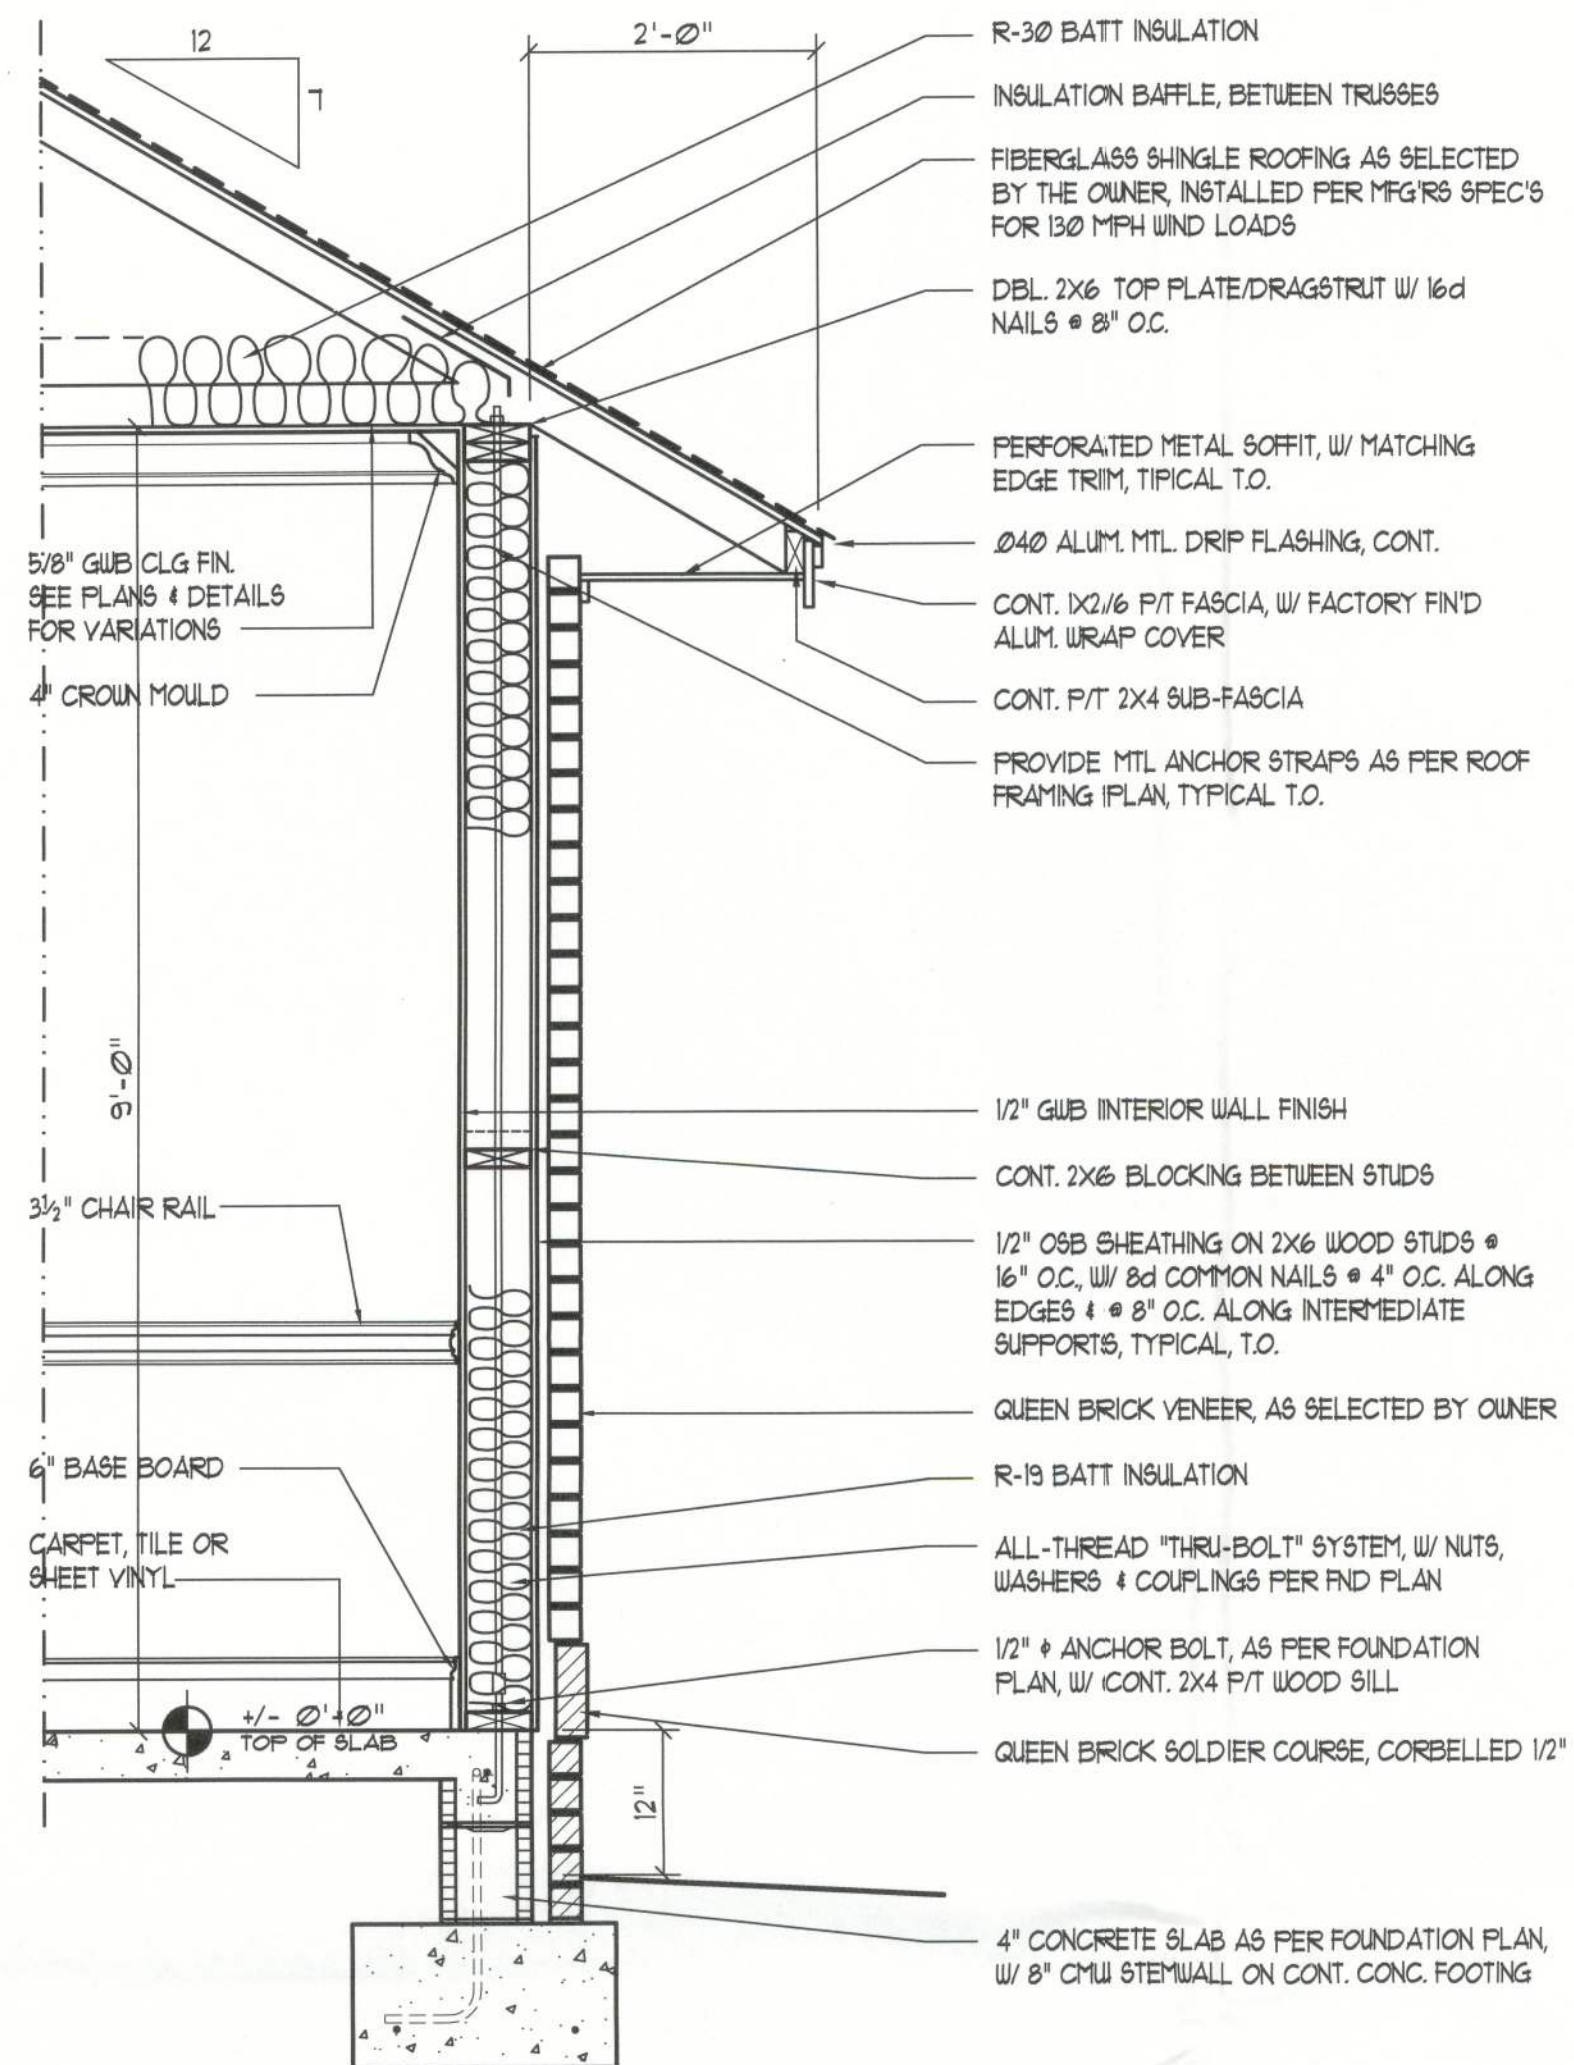

Typical Wall SECTION

SCALE: 3/4" = 1'-0"

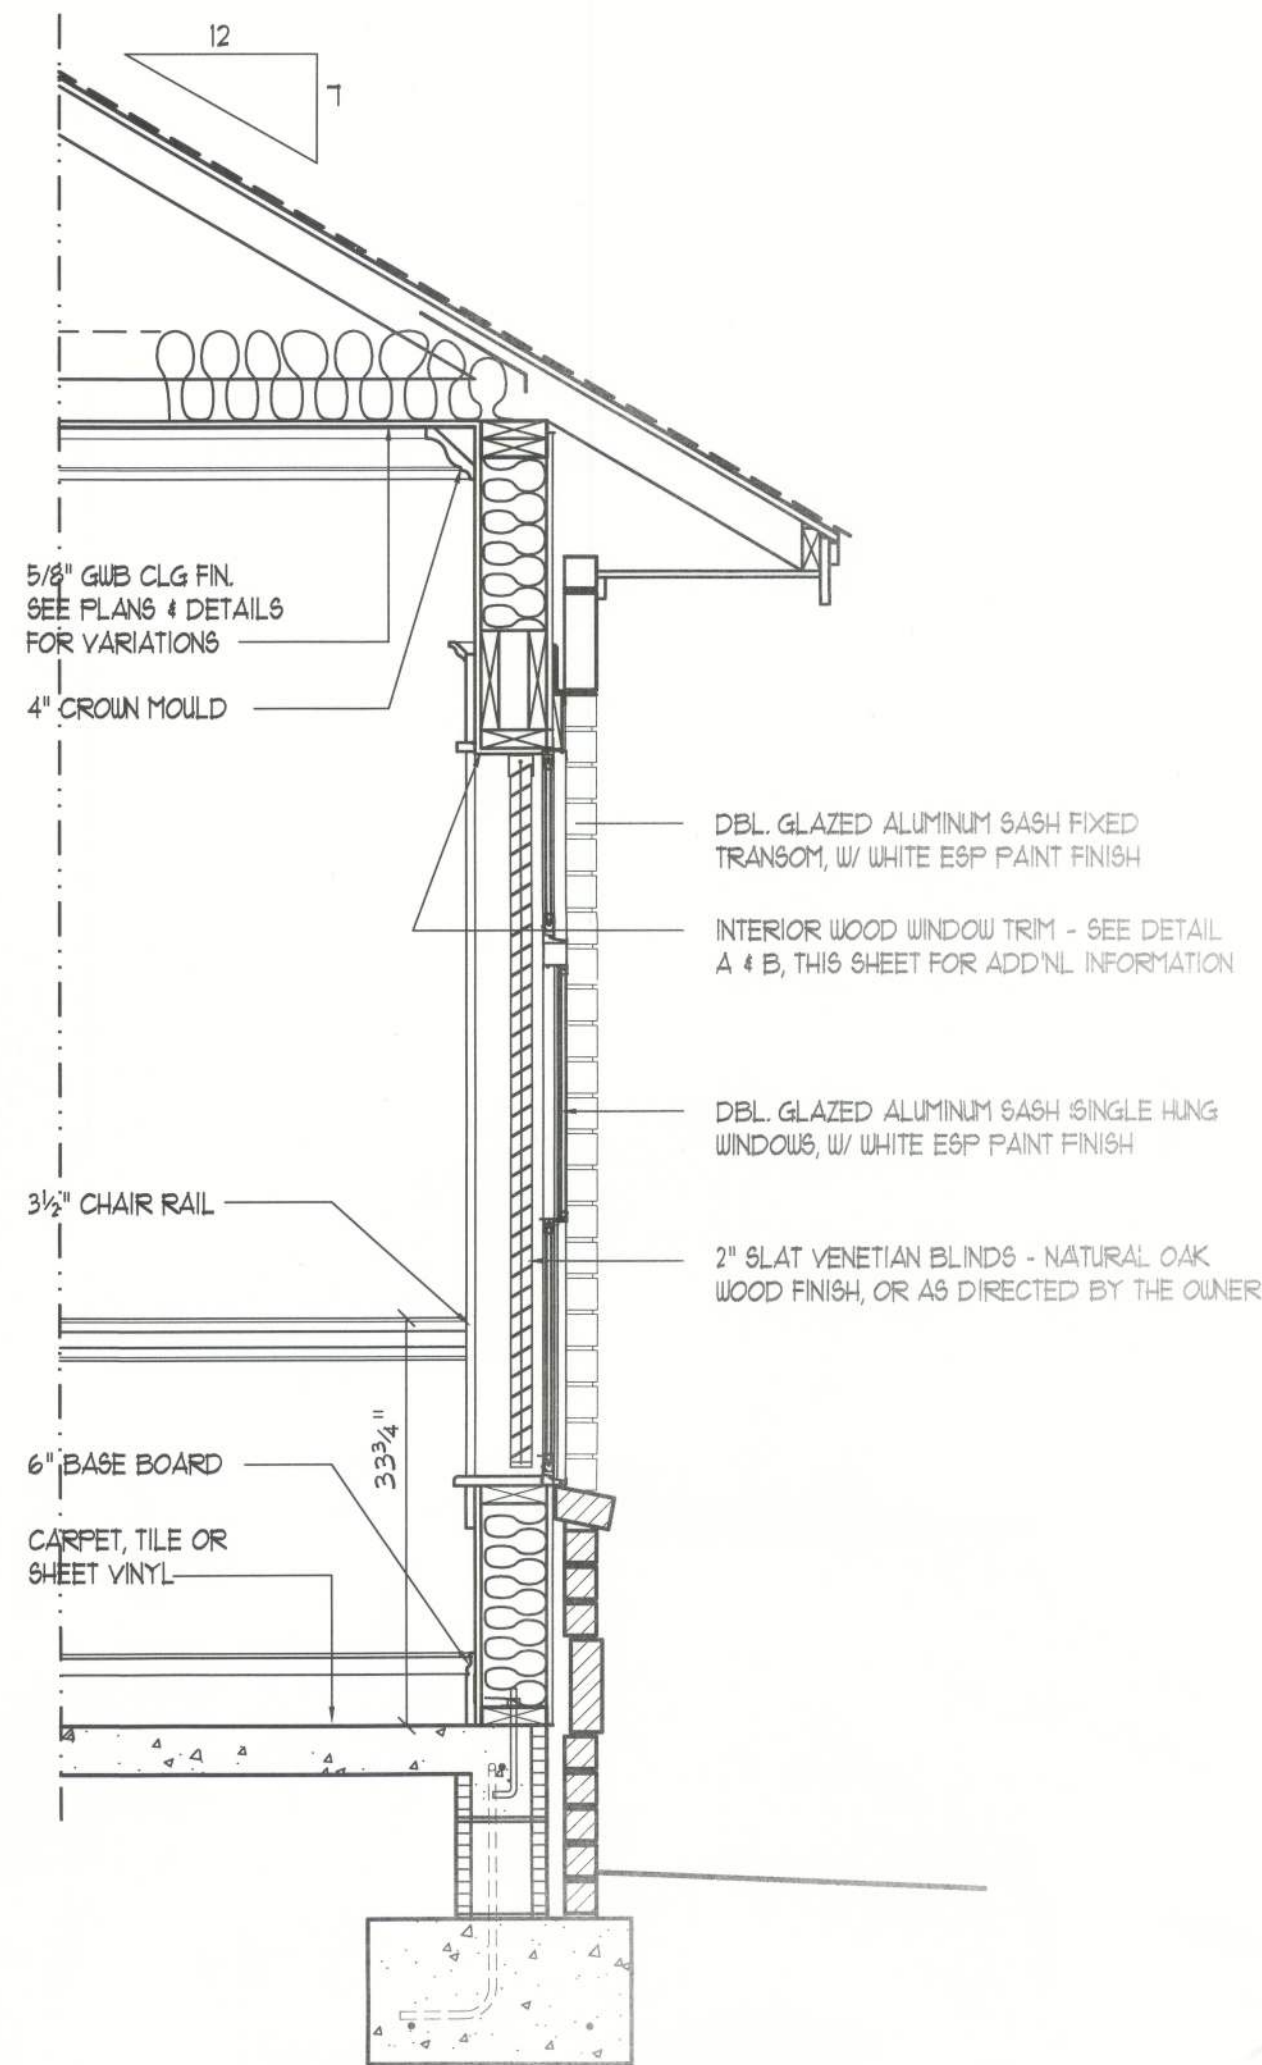

Wall SECTION @ Window

SCALE: 3/4" = 1'-0"



OPTIONAL NUTONE PRODUCTS:

THE FOLLOWING NUTONE PRODUCTS/SYSTEMS ARE OPTIONAL AND SHALL BE VERIFIED WITH THE OWNER PRIOR TO INCLUSION IN THE PROJECT. INSTALLATION SHALL BE VIA APPROVED SHOP DRAWINGS

1) OPTIONAL BUILT-IN FOOD CENTER:

SUPPLY AND INSTALL A BUILT-IN FOOD PROCESSING SYSTEM WITH THE POWER UNIT RECESSED IN THE KITCHEN COUNTER AS INDICATED IN THE PLANS. ALL EQUIPMENT, DETAILS OF INSTALLATION & OPERATING FEATURES SHALL BE PER THE MANUFACTURER'S REQUIREMENTS FOR "NUTONE" "BUILT-IN FOOD CENTER" OR EQUAL. REFER TO COMPONENTS LIST.

BUILT-IN FOOD CENTER COMPONENTS LIST:

PART No.: DESCRIPTION:

25188	POWER UNIT, 1/3 H.P.
173N	FRUIT JUICER
256	FOOD PROCESSOR
271	MIXER
272	BLENDER
276	COFFEE GRINDER

INCLUDE ALL FITTINGS, BRACKETS, ROUGH-INS, WIRING AND OTHER COMPONENTS OF INSTALLATION AS REQUIRED FOR A COMPLETE, OPERATIONAL SYSTEM.

2) OPTIONAL BUILT-IN IRONING CENTER:

SUPPLY AND INSTALL A BUILT-IN IRONING CENTER WITH WORK LIGHT AUTOMATIC SHUT-OFF TIMER AT LOCATION INDICATED IN THE PLANS. ALL EQUIPMENT, DETAILS OF INSTALLATION & OPERATING FEATURES SHALL BE PER THE MANUFACTURER'S SPECIFICATIONS FOR "NUTONE" "BUILT-IN IRONING CENTER" OR EQUAL. REFER TO COMPONENTS LIST.

BUILT-IN IRONING CENTER COMPONENTS LIST:

PART No.: DESCRIPTION:

AVC-40NDR	MAIN CABINET ASSEMBLY
AVC-RP	RAISED PANEL OAK DOOR
AVC-CP	REPLACEMENT IRONING BOARD COVER
AVC-SLI	SLEEVE BOARD

INCLUDE ALL FITTINGS, BRACKETS, ROUGH-INS, WIRING AND OTHER COMPONENTS OF INSTALLATION AS REQUIRED FOR A COMPLETE, OPERATIONAL SYSTEM.

3) OPTIONAL NUTONE CENTRAL VACUUM SYSTEM COMPONENTS LIST:

PART No.: DESCRIPTION:

CV-150	POWER UNIT, 2 MOTOR, 2 1/2 HP., 6 GAL. CAPACITY
593	MOTOR DRIVEN POWER BRUSH
CK-230	DELUXE TOOLKIT
CH-510	DELUXE CURRENT CARRYING HOSE
360W	AUTOMATIC ON/OFF WALL INLET
CI-360W	VAC FAN AUTOMATIC DUSTPAN INLET

INCLUDE ALL FITTINGS, BRACKETS, ROUGH-INS, TUBING, PIPING AND OTHER COMPONENTS OF INSTALLATION AS REQUIRED FOR A COMPLETE, OPERATIONAL SYSTEM.

4) OPTIONAL NUTONE INTERCOM SYSTEM COMPONENTS LIST:

PART No.: DESCRIPTION:

IM-4406	INTERCOM MASTER CONTROL, W/ RADIO & CD PLAYER
IS-445UH	INSIDE 5" SPEAKER, WITH CONTROLS
IS-419UH	OUTSIDE CAST METAL 5" SPEAKER, WITH CONTROLS

INCLUDE ALL WIRING, BRACKETS, ROUGH-INS AND OTHER COMPONENTS OF INSTALLATION AS REQUIRED FOR A COMPLETE OPERATIONAL SYSTEM.

"CRACKED ICE" LENSE, W/ "TEE" BAR DIVIDER @ 1/3 POINTS

R-22 BATT INSULATION, (MIN. R-19) TYPICAL, THRU-OUT

3" CROWN MOULDING, ALL AROUND,

LOCATE CROWN MOULD HERE FOR APPLICATIONS W/ 8'-0" CLG. HGT.

KEYLESS SOCKET W/ 60W INC. LAMPS SPACED @ 16" O.C.

PAINT INTERIOR "PINK"

1/2" GWB, W/ KNOCK-DOWN FINISH, PAINTED

2X4 SOFFIT FRAMING AT 16" O.C.


2 1/2" CASING MOULDING, ALL AROUND

RETURN CASING TO WALL @ OPEN ENDS


BEVELED EDGE MIRROR, OR AS DIRECTED BY THE OWNER

Lighting Soffit DETAIL

SCALE: 3/4" = 1'-0"

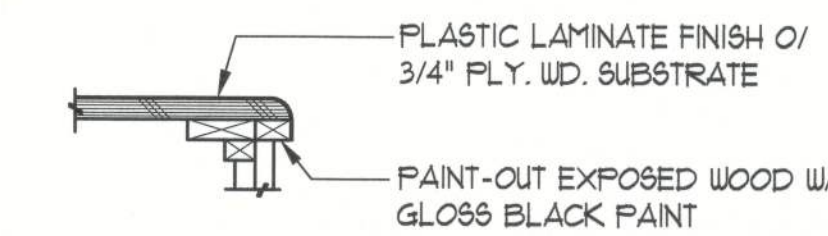


NOTE!
PROVIDE 2X6 BACKING AT ALL OVERHEAD CABINET LOCATIONS, FLUSH WITH FACE OF FRAMING - TOP OF BACKING TO BE 1'-0" AFF.

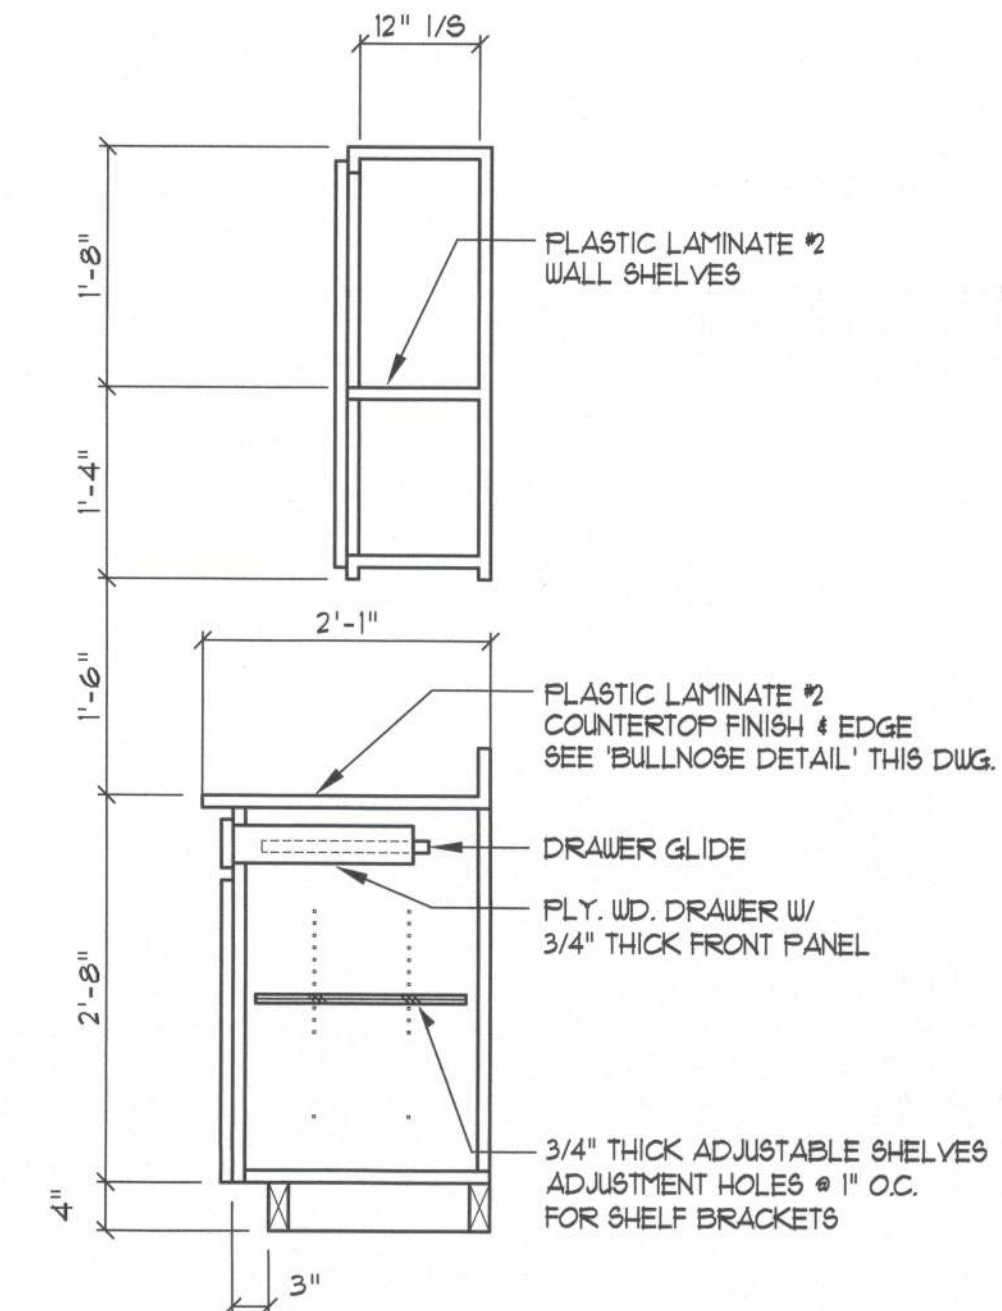

Base & O/H Cab.

SCALE 3/4" = 1'-0"

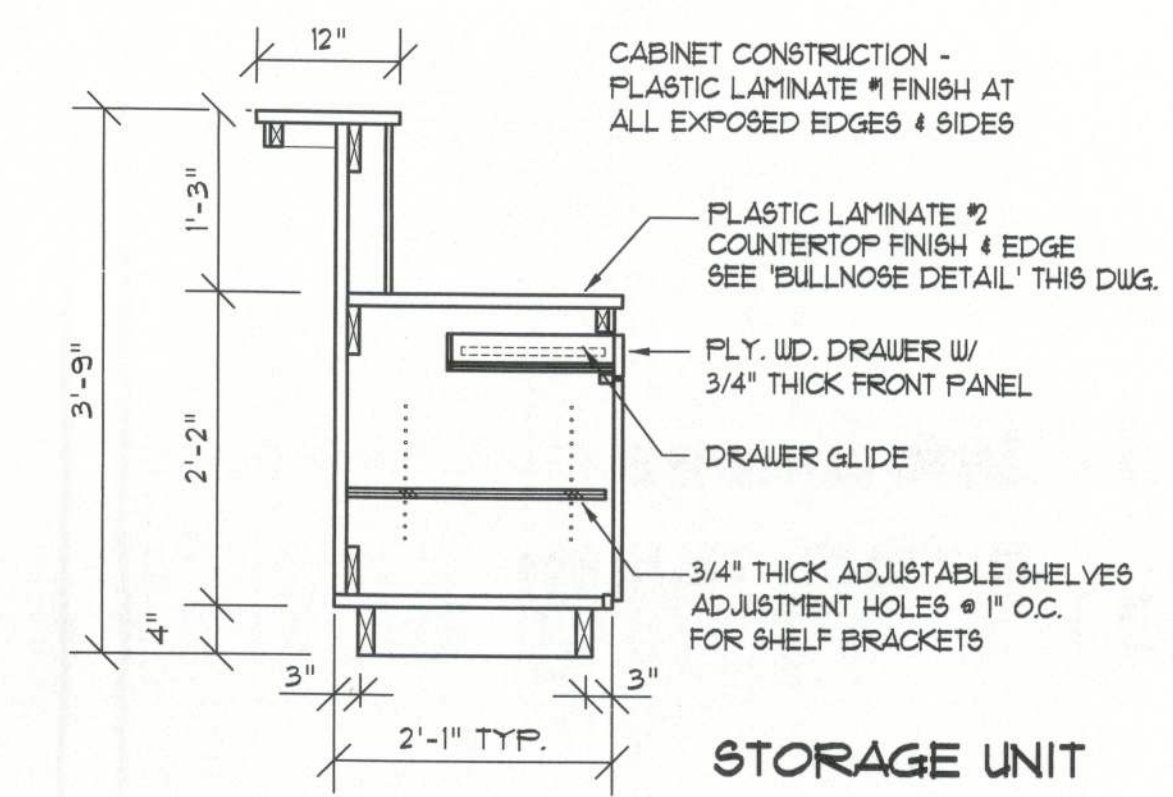

Desk W/ Walk-up Counter

SCALE 3/4" = 1'-0"

NOTE!
CABINETS, COUNTERS, SHELVES AND THE LIKE, SHOWN ON THIS PLAN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS OF QUALITY AS OUTLINED IN THE NOTES TITLED "GENERAL MILLWORK NOTES", AND SHALL INCLUDE SUCH FEATURES, HARDWARE AND FINISHES AS DIRECTED BY THE OWNER. THE PLAN VIEWS INDICATED ARE FOR GENERAL LOCATION AND EXTENT OF THE WORK - UNLESS DETAILED CABINET PLANS ARE INCLUDED WITH THIS PLANS PACKAGE ALL OTHER PHYSICAL CHARACTERISTICS SHALL BE AS DIRECTED BY THE OWNER.

NOTE!
THESE COUNTER DETAILS ARE GENERAL IN NATURE AND PROVIDE A BASIS FOR ACTUAL CABINET CONSTRUCTION.

Typical Cabinet DET'S

SCALE 3/4" = 1'-0"



REVISION:
21 DEC 2012

Copyright, 2012
N.F. Geisler, Architect

DRAWN:
RPG

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
WALL SECTION - ARCHITECTURAL DETAILS

Celebrating
40 Years of Service
1972-2012
N.F. Geisler, Architect
L. GEISLER




**NICHOLAS
GEISLER
PAUL
ARCHITECT**
N.C.A.R.B. Certified
1756 NW Brown Rd.
Lake City, FL 32025
386-365-4355

DATE:
15 NOV 2012
COMM:
2K1287

SHEET:
A.5
5 of 13

Mr. J. Kasak
10/11/2013
AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

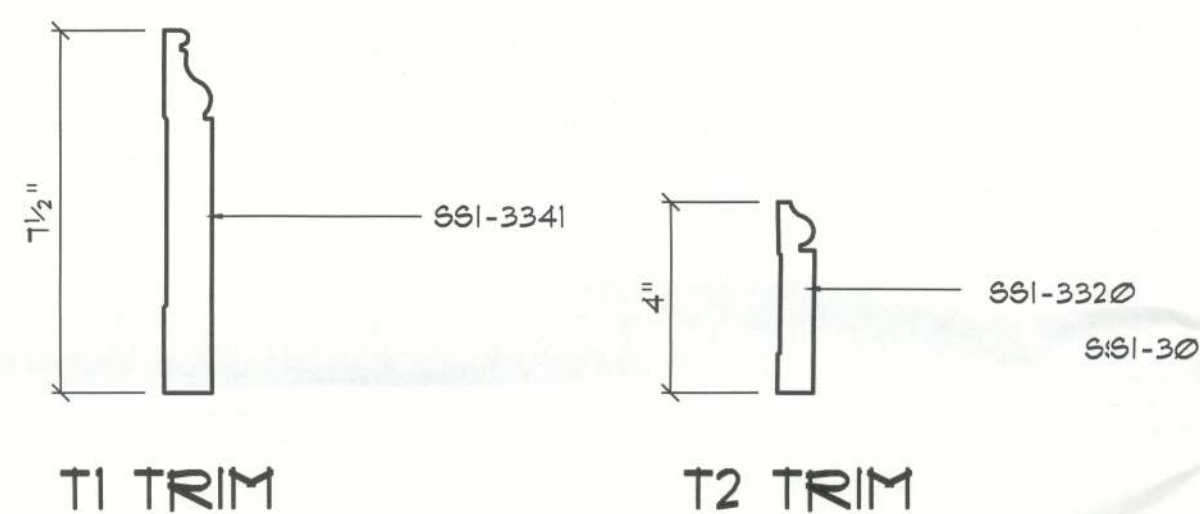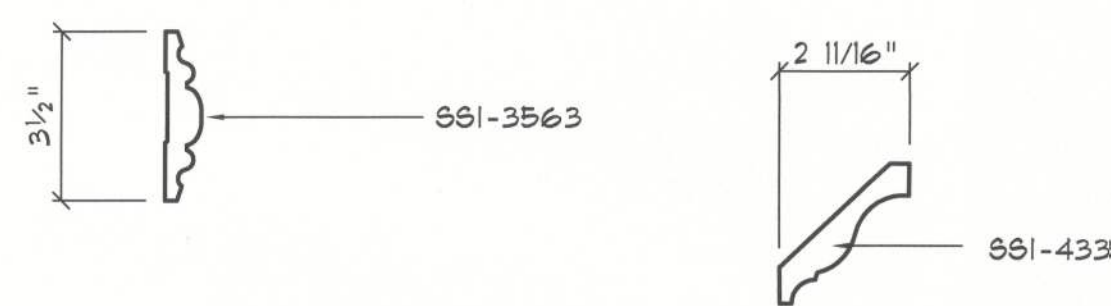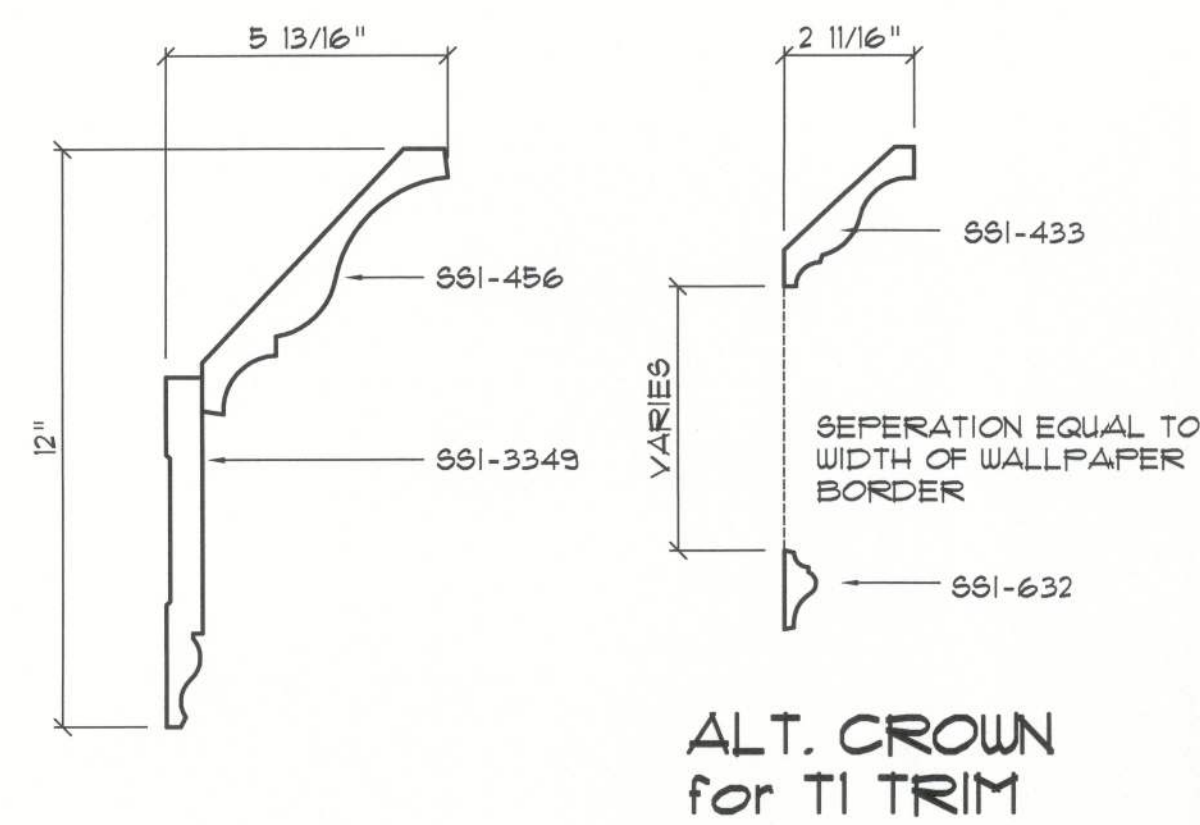


NOTE 1.1.1
ALL PROFILES AS PER 845 CRAFTSMAN, INC., TAMPA FLORIDA
TRIM WOOD SPECIES SHALL BE "POPLAR"

Wall/Ceiling Trim PROFILES

SCALE: 3" = 1'-0"


ALTERNATE No. 2:
FOR TRIM TYPE T1, 2" DENTAL MOULDING MAY BE
INSERTED BETWEEN 861-456 AND 861-3349

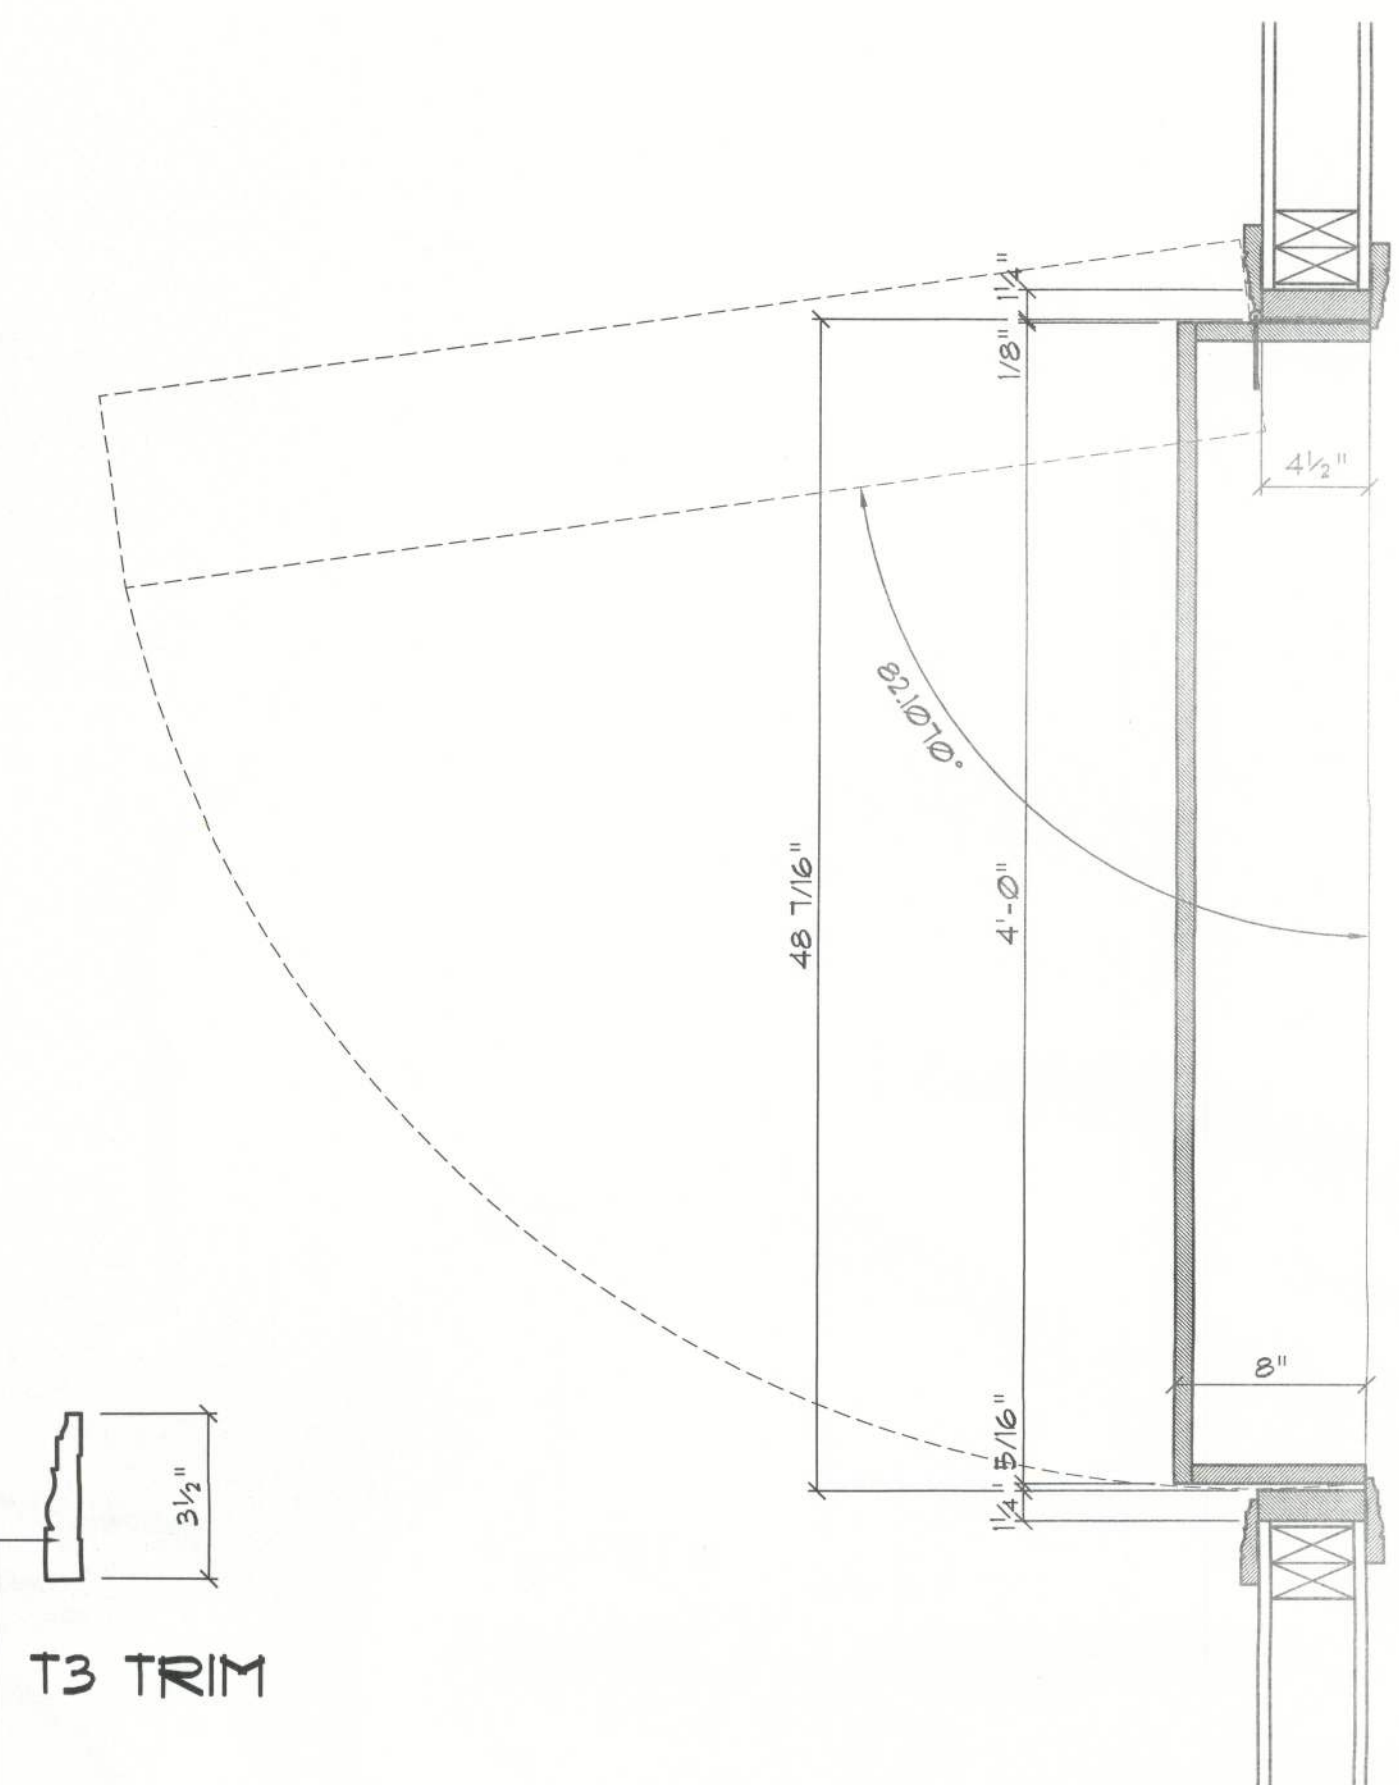


PLAN

Hidden Door DETAIL

SCALE: 1 1/2" = 1'-0"

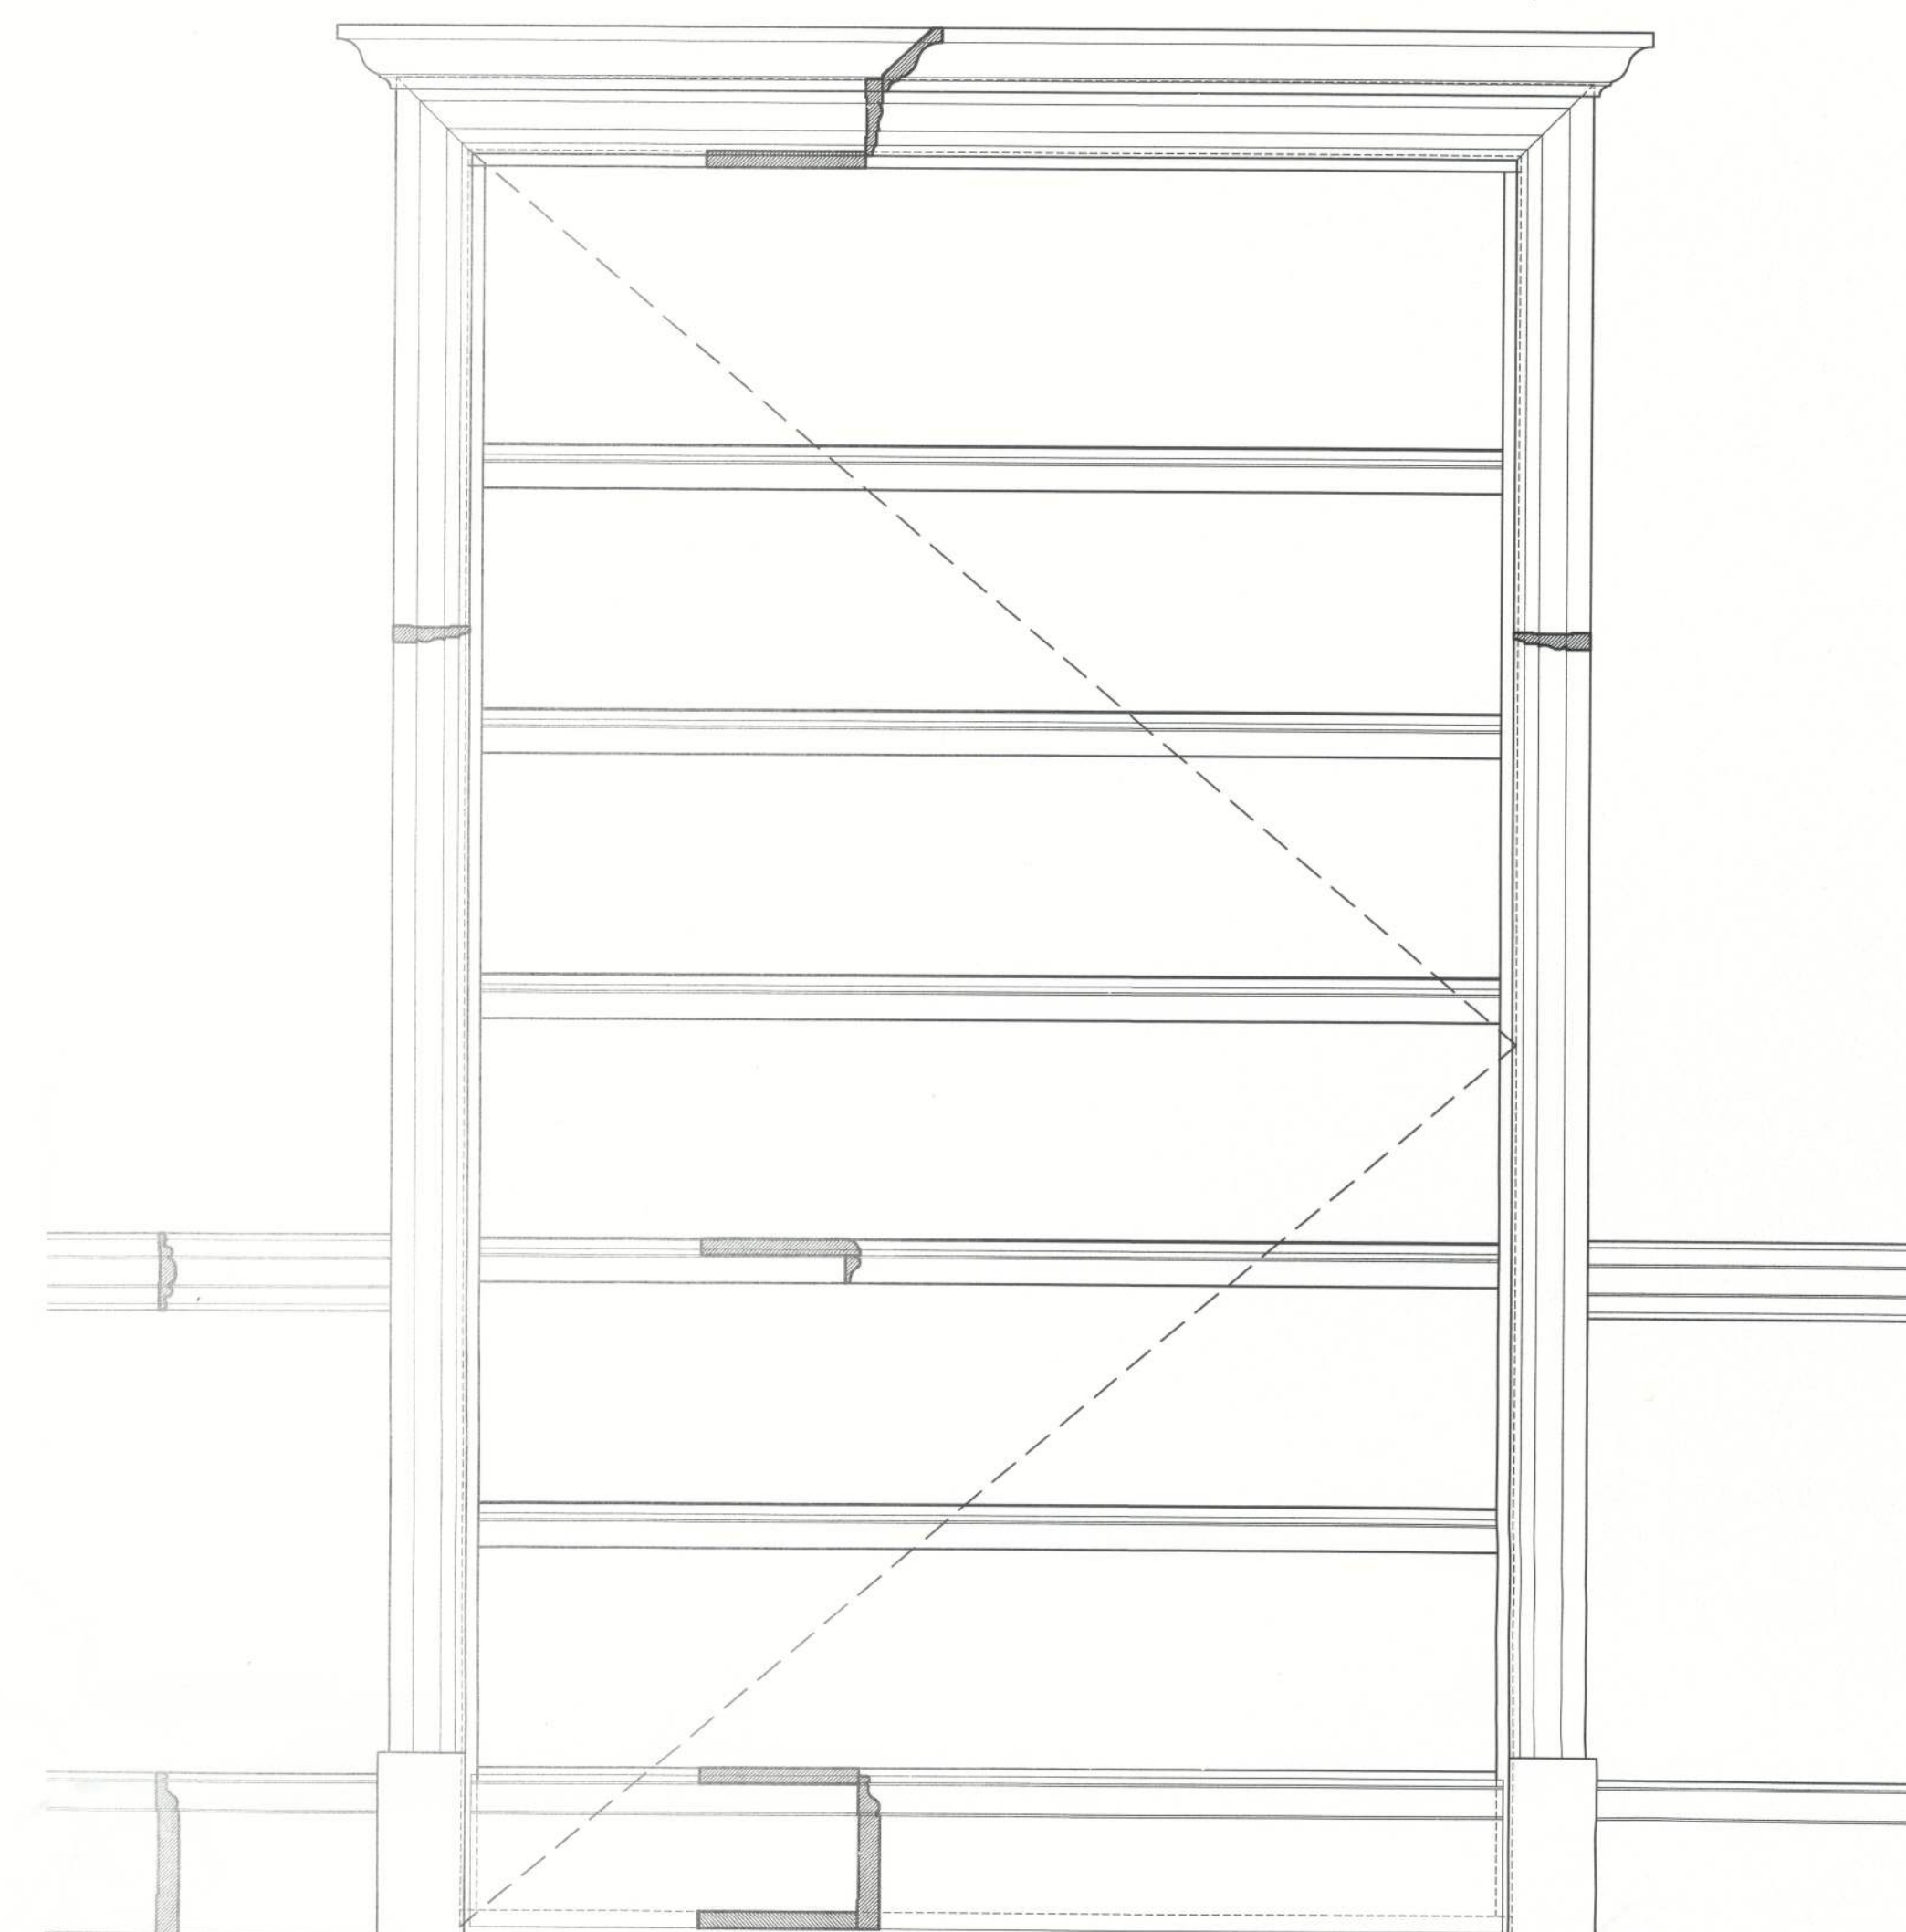

FRONT ELEVATION

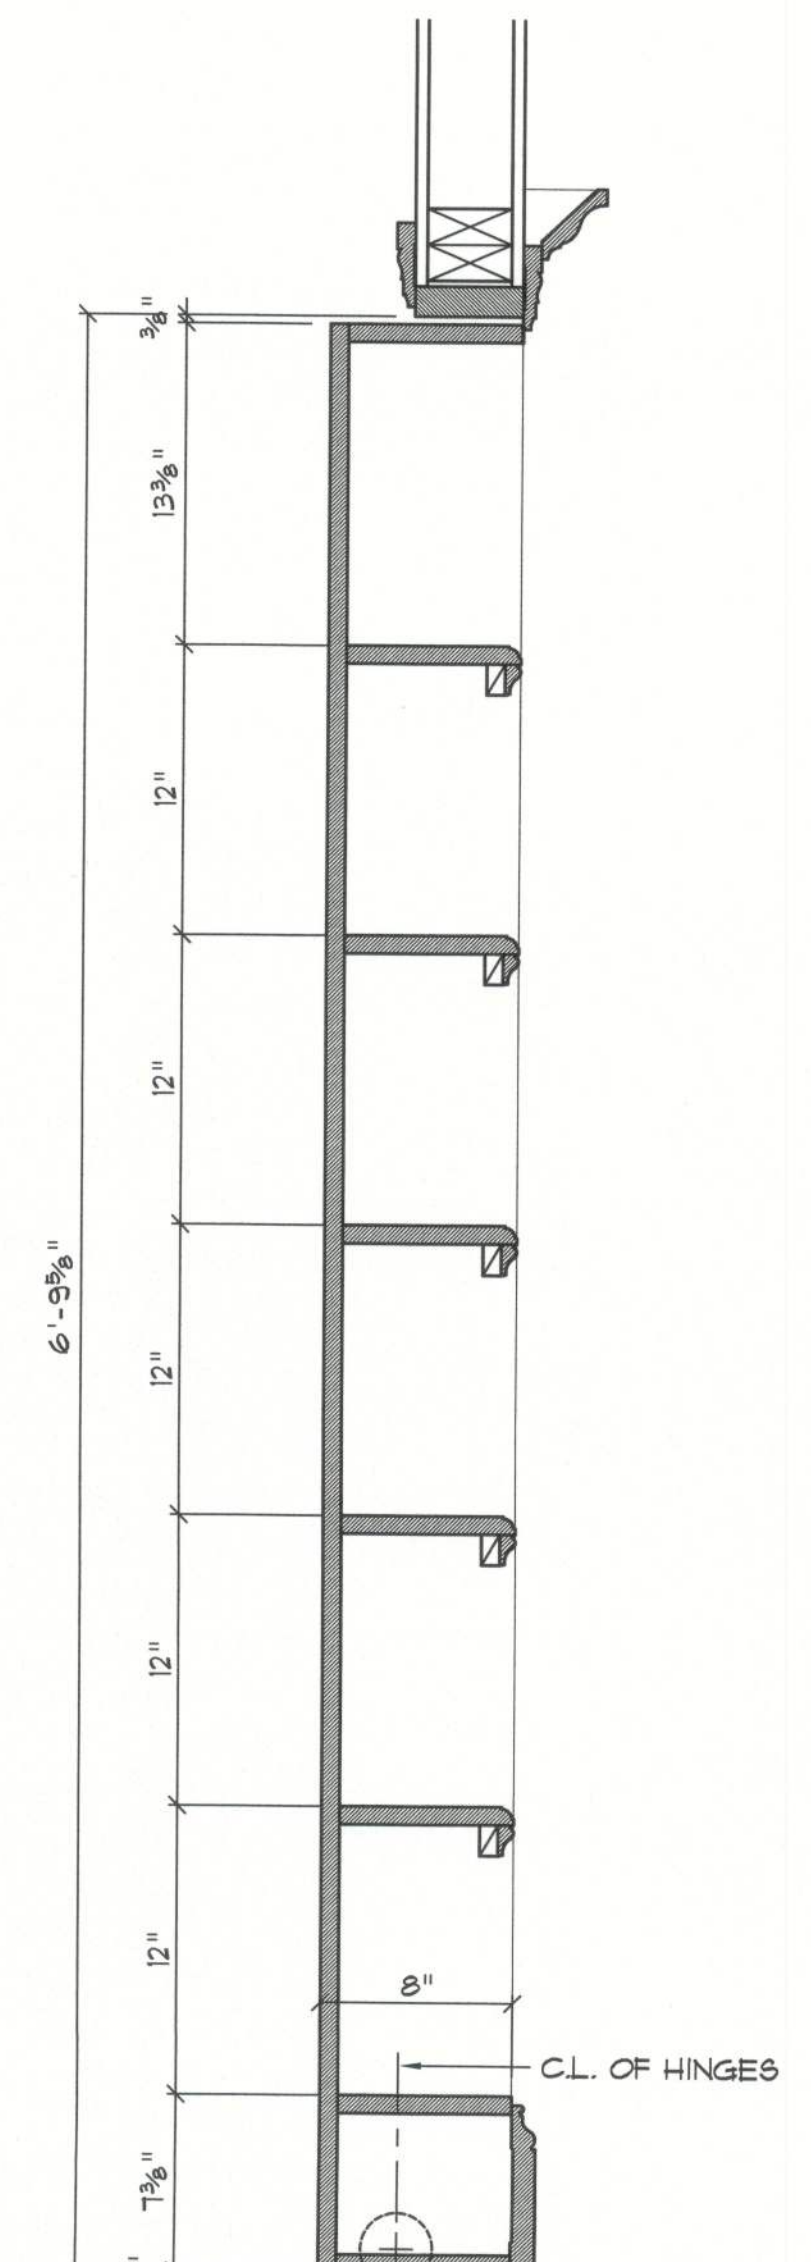

SECTION

CONCEALED DOOR GENERAL NOTES

1. ALL COMPONENTS SHALL BE "POPLAR" WOOD, SMOOTH SANDED, READY FOR FINISH AS DIRECTED BY THE OWNER (STAIN & VARNISH OR ALKYD ENAMEL)
2. SHAPED TRIM COMPONENTS SHALL BE AS PER "861 CRAFTSMAN" OF TAMPA, FLORIDA, MATCHING SIMILAR COMPONENTS INDICATED IN A/A8
3. PROVIDE THE FOLLOWING HARDWARE COMPONENTS:
2 PAIR 4 1/2" SQ. OFFSET HINGES
2 BALL OR MAGNETIC LATCH ASSEMBLIES
1 4" WHEEL, ADJUSTABLE AS TO HEIGHT
4. INSTALL WHEEL IN THE SAME PLANE AS THE CENTERLINE OF THE HINGES AND AT RIGHT ANGLE TO HINGE PLANE.
5. PROVIDE 5/4 HARDWOOD FRAME
6. PROVIDE 3/4" PLYWOOD BACK, W/ POPLAR FACE VENEERS
7. PROVIDE COMPLETE SHOP DRAWINGS INDICATING SIZES, ASSEMBLIES, METHOD OF CONSTRUCTION, METHODS OF ADJUSTMENTS, PROPOSED FINISHES W/ SAMPLES AND HARDWARE LIST
8. ALL PROVISIONS OF THE MILLWORK NOTES ALONG WITH THE REQUIREMENTS OUTLINED IN THE GENERAL NOTES ON SHEET A.13, SHALL APPLY TO THESE MILLWORK COMPONENTS.

REVISION:

Copyright, 2012
N.P. Geisler, Architect

DRAWN:
198

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
ARCHITECTURAL TRIM DETAILS

Celebrating
40 Years of Service
1972-2012
N.P. Geisler, Architect
AR0007005

**NICHOLAS
GEISLER**
ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Tampa, FL 33605
386-325-4358

DATE:
15 NOV 2012


COMM:
2KI287

SHEET:

A6
6 OF 13

mm
10/15/2013
AR0007005


These drawings, in instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

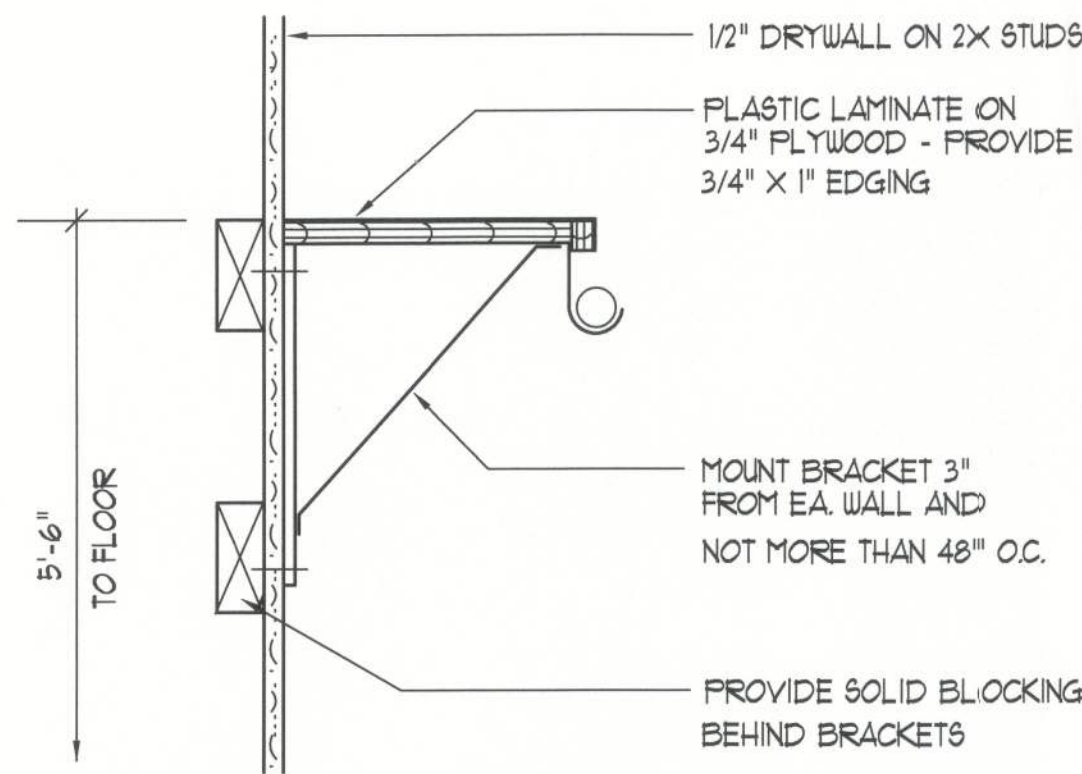

Closet Rod & Shelf Detail

SCALE: NONE

A

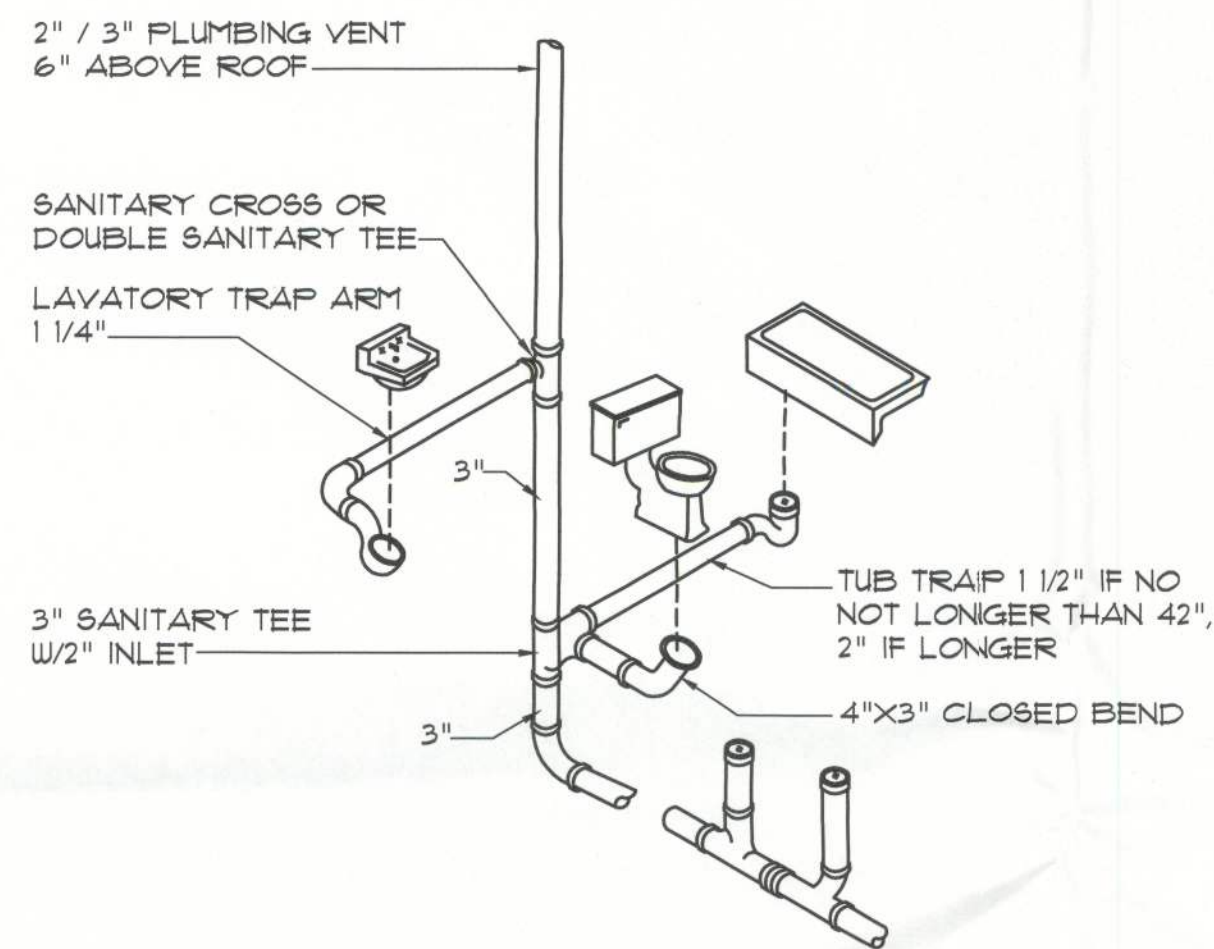


Typ. One Bath Plumbing DET.

N.T.S.
N.T.S. - THIS PLUMBING DIAGRAM IS GENERAL IN NATURE, REFER TO THE 'PLUMBING RISER DIAGRAM' FOR INFORMATION.

C

GENERAL INTERIOR FINISH SCHEDULE:


FLOOR AREA:	CARPET AND PAD, PATTERN & COLOR AS PER THE OWNER OR LAMINATE STRIP WOOD - SEE OWNER FOR CHANGES
BATH/KITCHEN/NOOK/ UTIL. FLOOR AREA:	THINSET CERAMIC TILE OR NATURAL STONE, PAT. & COLOR AS SELECTED BY THE OWNER
BASE:	TRIM AS PER DETAIL ON A6, COLOR AS SELECTED BY THE OWNER OR CERAMIC TILE OR STONE - MATCH WITH FLOORING
TRIM:	COVES, CROWNS, CASINGS CHAIRRAILS AND THE LIKE AS PER DETAIL ON A6, STAIN & VARNISH OR PAINT COLOR AS SELECTED BY THE OWNER
WALLS:	1/2" GWB, PRIMED AND PAINTED 2 COATS LATEX WALL PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER
MAIN CEILING:	5/8" GWB, DIRECT HUNG, TAPED & FINISHED, W/ 1/2 COATS OF LATEX CEILING PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER
APPLIED FINISHES:	APPLIED FINISHED TO GWB, i.e. SPRAY, KNOCK-DOWN, SKIP-TROUWEL AND SIMILAR TREATMENTS AS DIRECTED BY THE OWNER
CABNETS:	AS SELECTED BY THE OWNER, MINIMUM API GRADE: "CUSTOM" - ALL COUNTERTOPS SHALL BE AS SELECTED BY THE OWNER

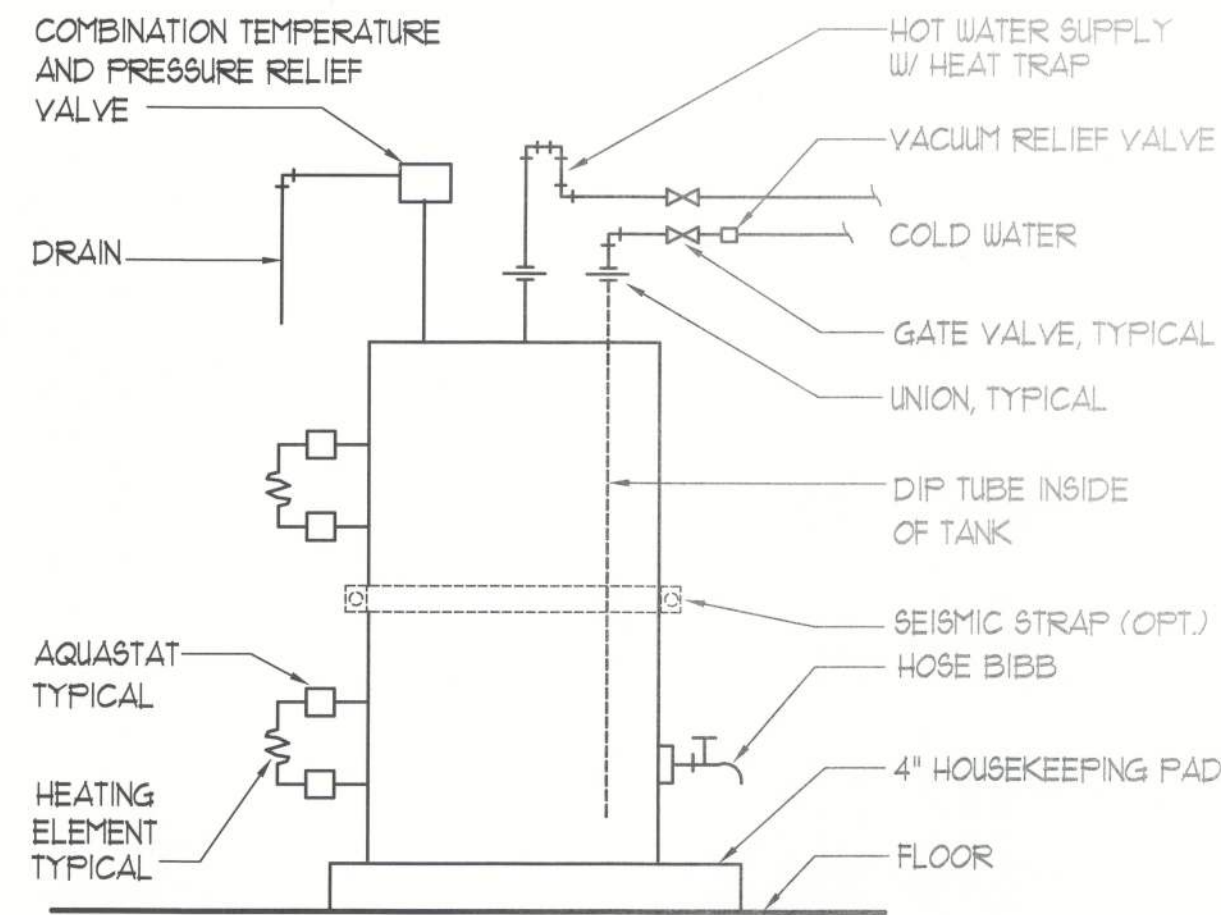

Electric Water Heater DETAIL

SCALE: NONE


B

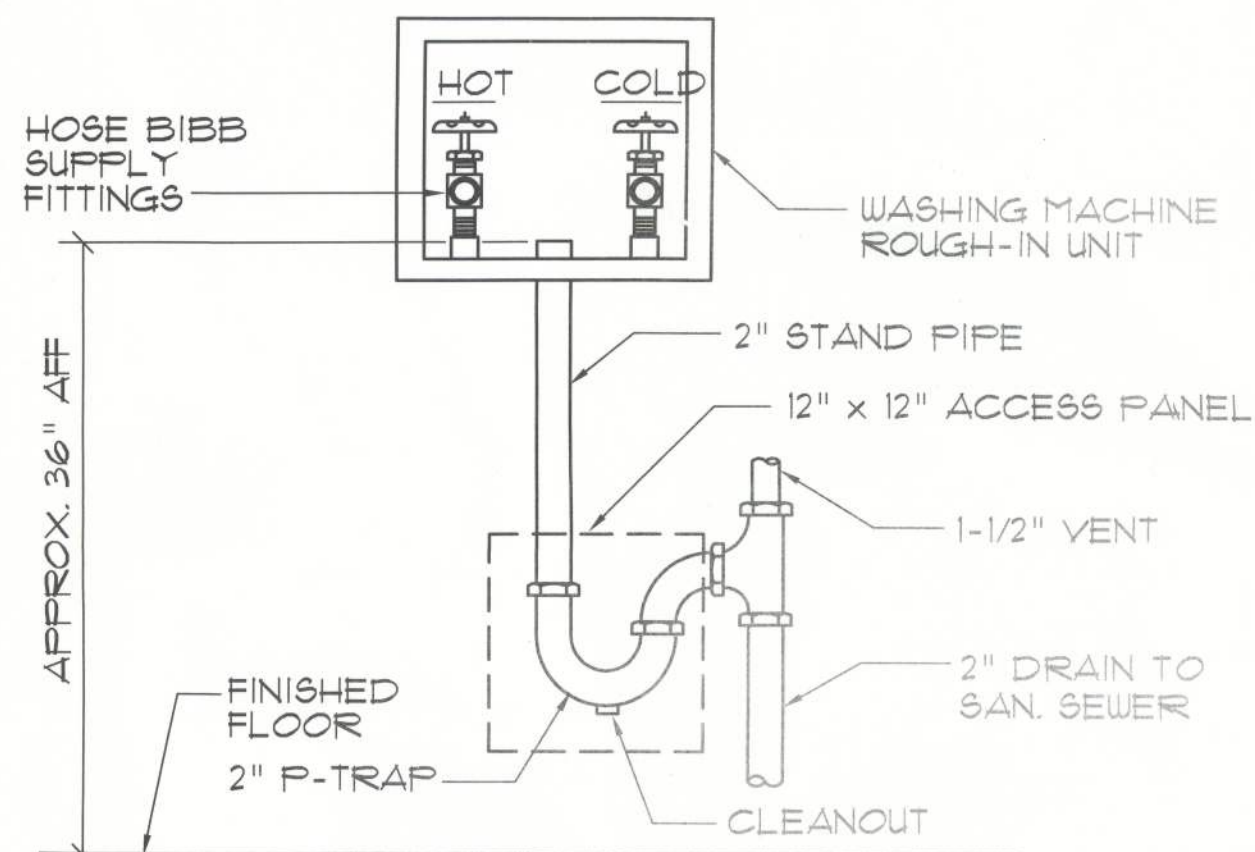

Washing Machine Hook-up DET.

N.T.S.


D

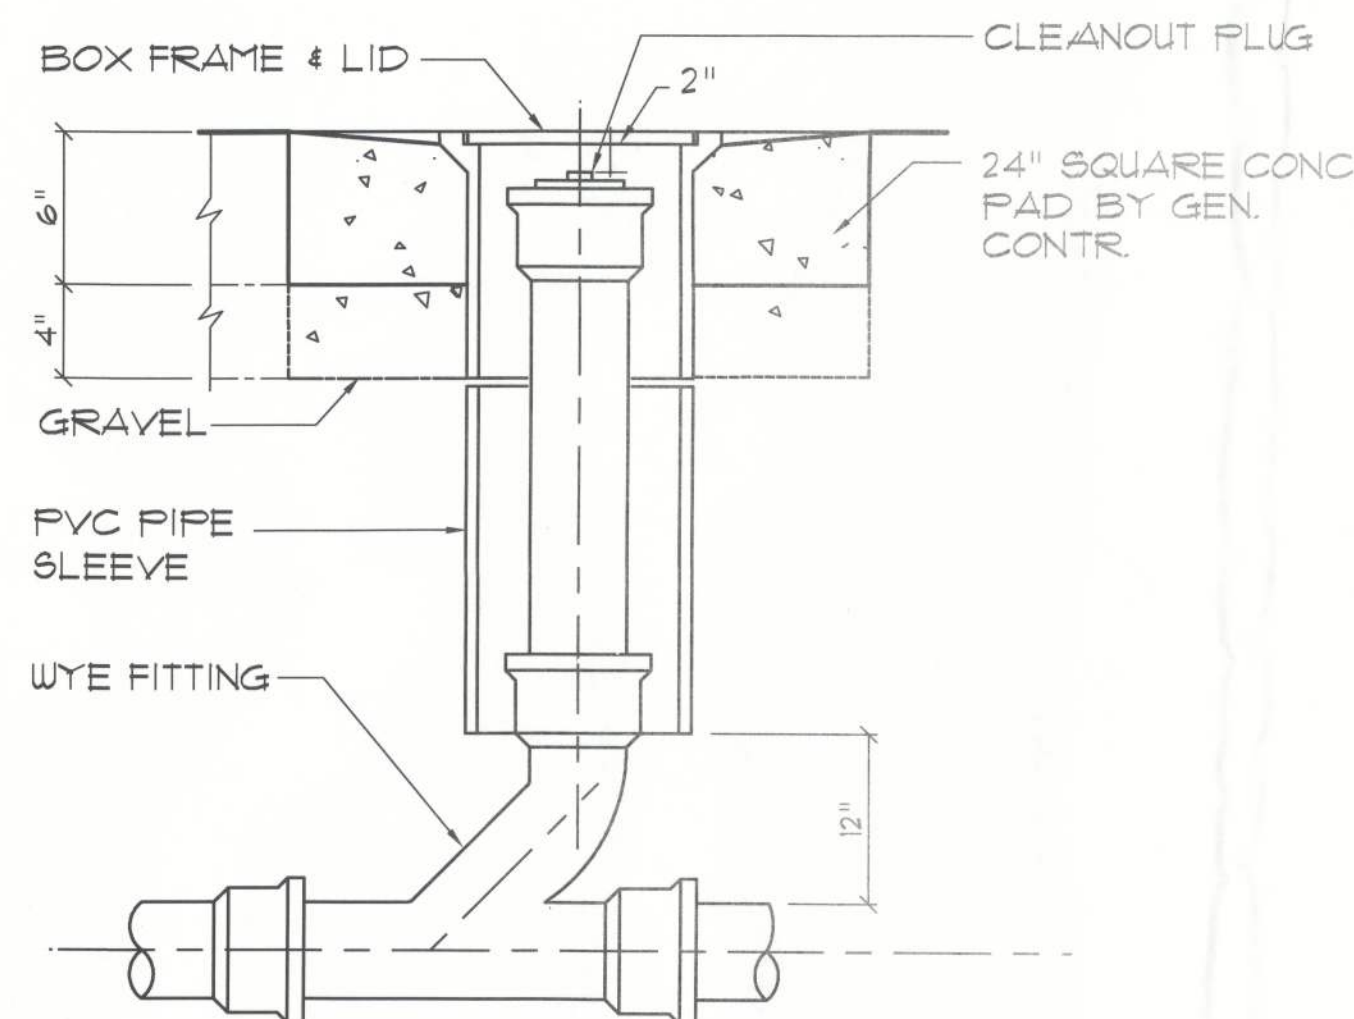

Outdoor Cleanout DETAIL

N.T.S.


F

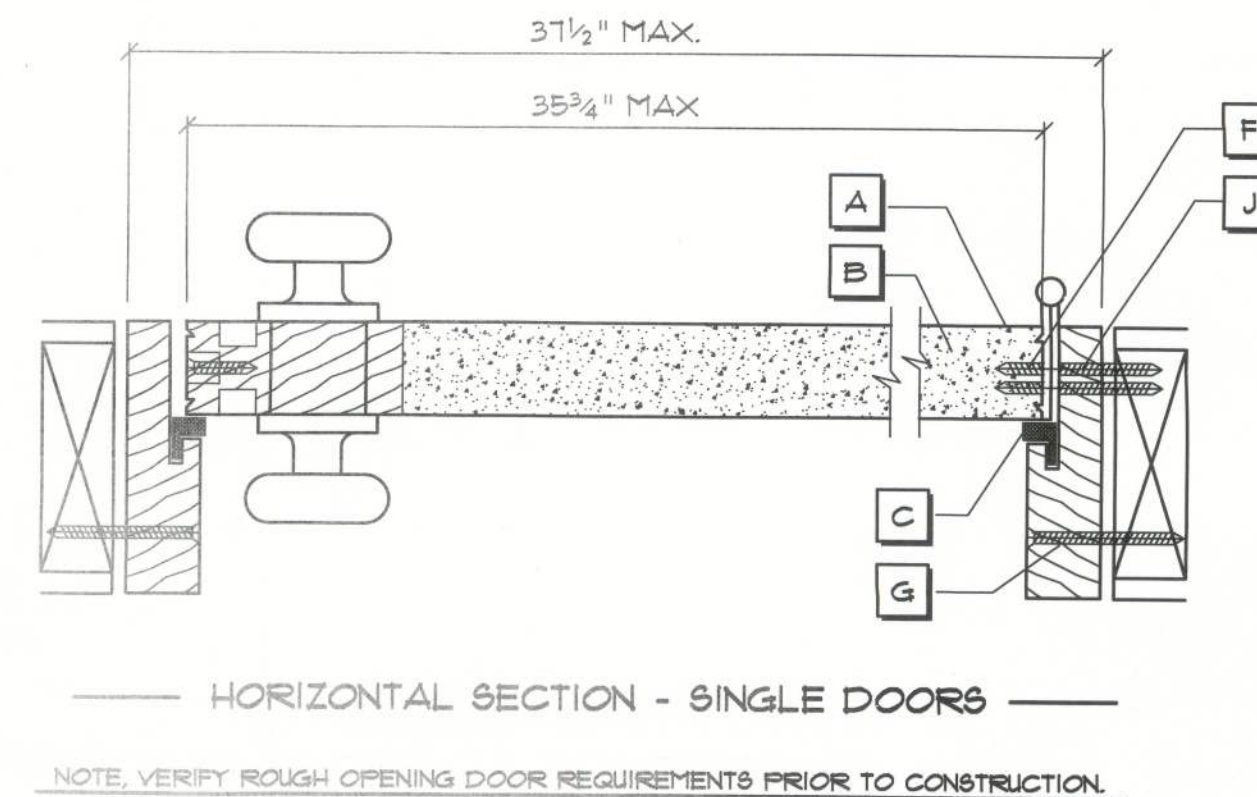

Exterior Door DETAILS

SCALE: NONE


G

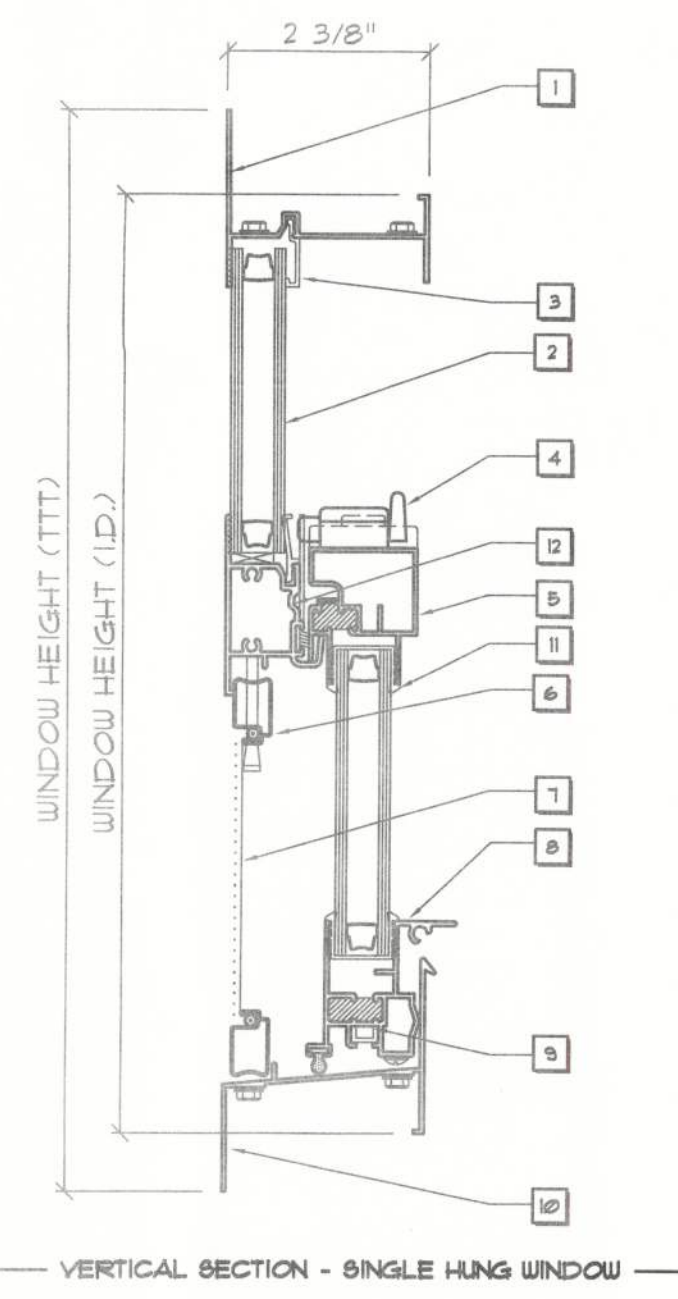

Typ. Window Sash DETAILS

SCALE: NONE

G

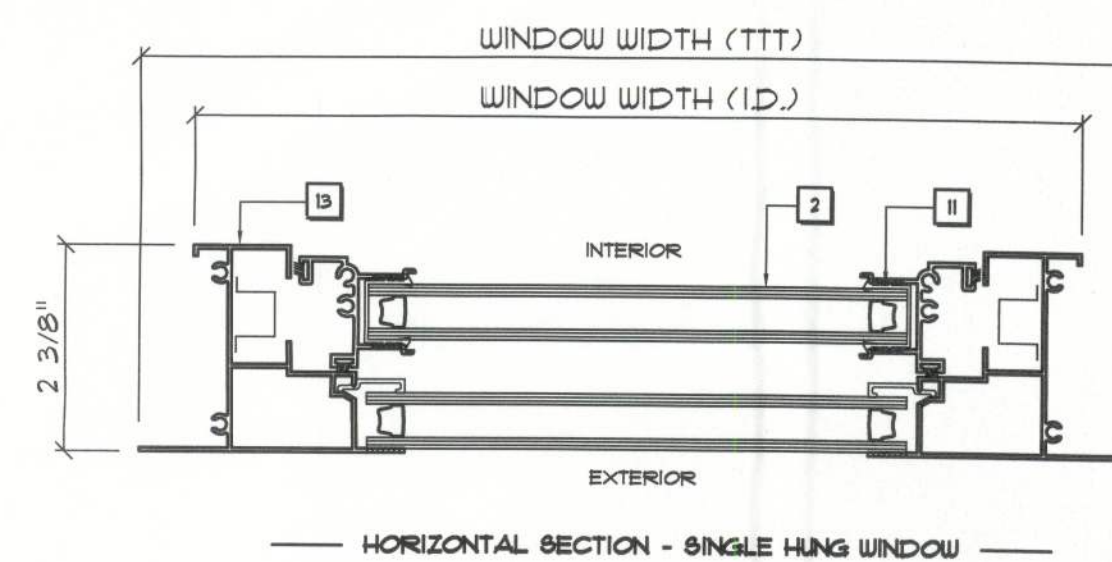


INSTALLATION	MODEL
1" ROOF G. NAILS @ 6" FROM CORNERS, 18" O.C.	SERIES 450
5 - 1" ROOF G. NAILS EA. FLANGE, MAX. 18" O.C.	SERIES 650

NOTE !!!
ALL WINDOWS ARE INSULATED AND WEATHERSTRIPPED AS MANUFACTURED BY THE HOME PRODUCTS, INC. - OTHER MANUFACTURERS/PRODUCTS SHALL BE CONSIDERED AS EQUAL IF THEIR WIND DESIGN PERFORMANCE MEETS OR EXCEEDS THESE UNITS.
NOTE, VERIFY ROUGH OPENING WINDOW REQUIREMENTS PRIOR TO CONSTRUCTION.
N1 - COMPLETE WITH PAN LITE AS PER SERIES 450
N2 - TESTING AS PER ASTM E1320

Door Notes

- A STEEL SKIN - 26 GA.
- B POLYURETHANE FOAM CORE
- C COMPRESSION WEATHER STRIP
- D WOOD HEAD JAMB
- E ALUMINUM BUMPER THRESHOLD
- F #10-24 X 1/2" F.H.W.S. (4) SCREWS PER HINGE INTO DOOR
- G #10 X 3" F.H.W.S. (5) SCREWS THROUGH HINGE JAMB, 8" DOWN FROM TOP, MAX. 18" O.C. THEREAFTER
- H NOT USED
- J #10 X 2" F.H.W.S. (4) SCREWS THROUGH EACH HINGE INTO DOOR JAMB.
- K #10 X 2" F.H.W.S. (2) SCREWS THROUGH HEAD INTO HEADER.

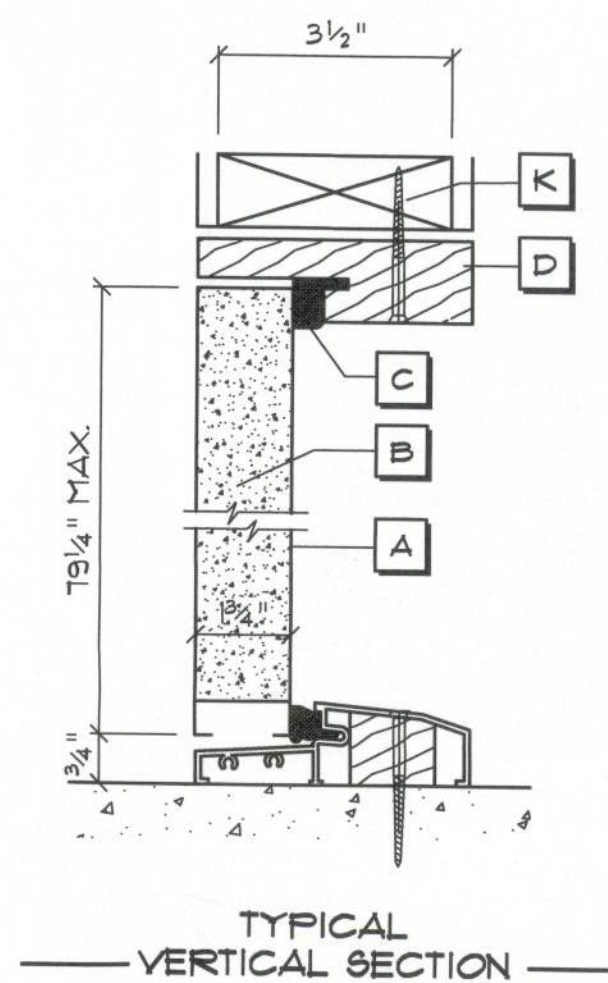

DESIGN PRESSURE RATINGS *	
POSITIVE	+16.0 PSF
NEGATIVE	-16.0 PSF

* WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED

NOTE !!!
EXTERIOR DOORS SHALL MEET OR EXCEED THE WIND RESISTANCE OF THE FOLLOWING PRODUCT:

SERIES ENTERGY 6-8 W/E INSULW OPAQUE RESIDENTIAL INSULATED STEEL DOOR W/ STEEL FRAME AS MFG'D BY "PREMDOR ENTRY SYSTEMS"

Window Notes

- 1 FLANGED HEAD
- 2 INSULATED GLASS
- 3 GLAZING BEAD
- 4 LOCK
- 5 SASH TOP RAIL
- 6 SCREEN FRAME
- 7 FIBERGLASS MESH
- 8 BOTTOM SASH RAIL
- 9 PIVOT BAR
- 10 FLANGED SILL
- 11 MARINE GLAZING
- 12 FIXED MEETING RAIL
- 13 FLANGED JAMB

REVISION:

Copyright 2012
N.P. Geisler, Architect

DRAWN:

11/18

CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
ARCHITECTURAL DETAILS


Celebrating
40 Years of Service
1972-2012
N.P. Geisler, Architect
AR0007005

**NICHOLAS
GEISLER
ARCHITECT**
N.C.A.R.B. Certified
1755 NW Brown Rd.
388-5682-4365


DATE:
15 NOV 2012
COMM:
2K1287

SHEET:
A.7
7 OF 13

AR0007005

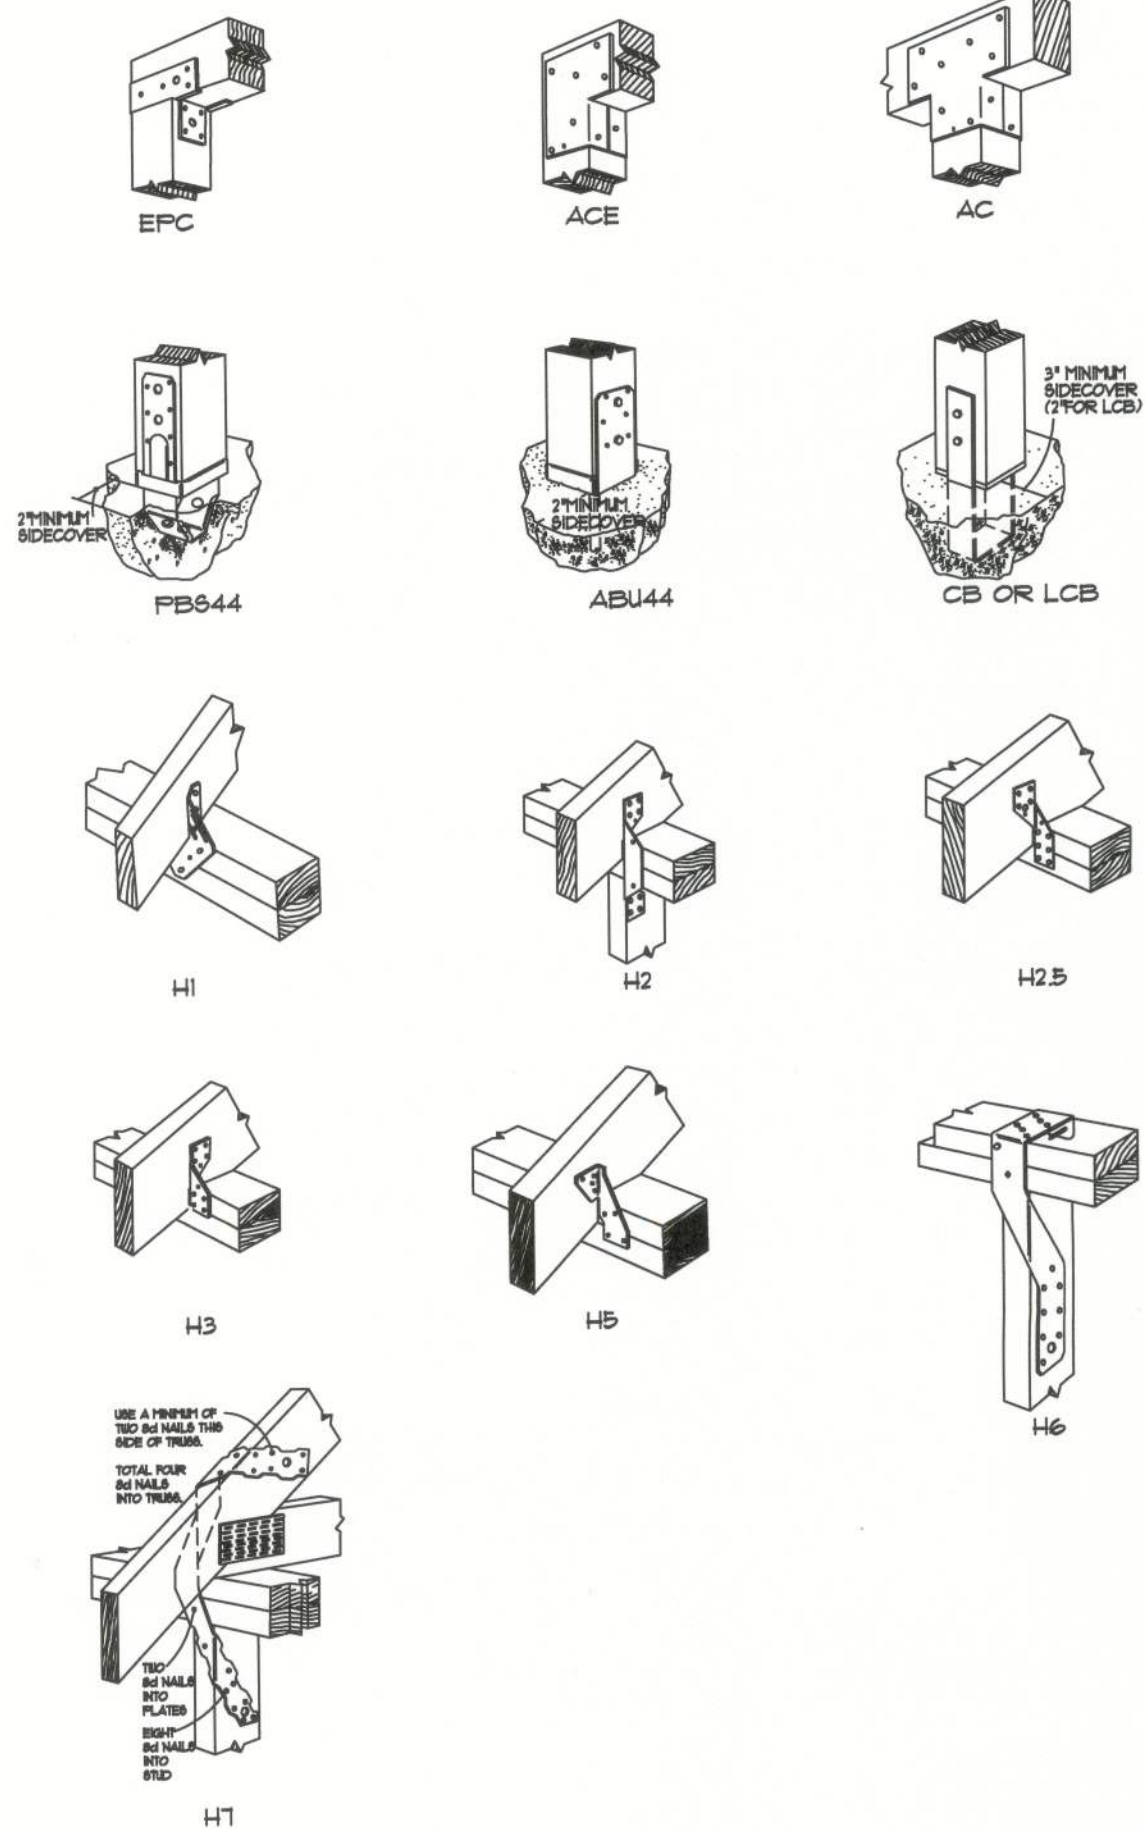

Typical "Simpson" CONNECTORS
SCALE: NONE

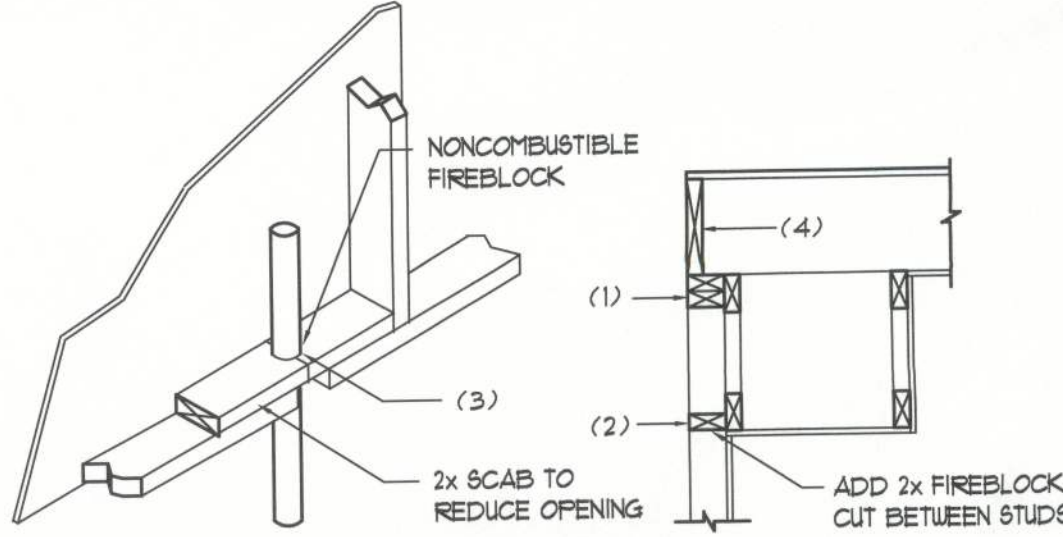

PENETRATIONS **SOFFIT/DROPPED CLG.**

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILING, COVE CEILING, ETC.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH "PYROFANEL MULTIFLEX SEALANT"
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

Fire Stopping DETAILS
SCALE: NONE

GENERAL NOTES:

- THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
- THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. DEFECTS IN MATERIALS, EQUIPMENT, COMPONENTS AND WORKMANSHIP SHALL BE CORRECTED AT NO FURTHER COST TO THE OWNER DURING THE ONE YEAR WARRANTY PERIOD.
- AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD, FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED. THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
- THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
- THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING OF THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNERS" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
- ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
- ALL WORK SHALL BE IN ACCORDANCE W/ APPLICABLE CODES AND LOCAL REGULATIONS, INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
- ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT ON THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
- ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESURE TREATED.
- INTERIOR BEARING WALLS SHALL BE CONSTRUCTED IN COMPLIANCE WITH IUL Design U333. BATT INSULATION SHALL BE INCLUDED WHERE UNCONDITIONED AREA IS BEING SEPARATED FROM HEATED / COOLED AREA.
- INTERIOR STUD WALLS SEPARATING LIVING AREA FROM GARAGE AREAS SHALL BE CONSTRUCTED IN COMPLIANCE WITH IUL Design U333, INCLUDING R-II BATT INSULATION.
- CEILINGS OVER ATTACHED GARAGES OR GARAGES W/ LIVING AREA ABOVE SHALL BE 5/8" FIRECODE "C" GIB ON D3 WOOD FURRING AT 16" O.C. ATTACHED W/ 1/4" BUGLEHEAD SCREWS @ 6" O.C. ALONG EACH POINT OF BEARING.

STANDARD ABBREVIATIONS

AT	GALV.	GALVANIZED
NUMBER or POUNDS	HORZ.	HORIZONTAL
EQUALS	INS.	INSULATION
DIAMETER	INT.	INTERIOR
WITH	LAV.	LAVATORY
WITHOUT	LVL.	LAMINATED VENEER LUMBER
CENTERLINE	MAX.	MAXIMUM
AND	MIN.	MINIMUM
PLUS or MINUS	MISC.	MISCELLANEOUS
ONE FOOT	M.O.	MASONRY OPENING
ONE INCH	No. or N.	NUMBER
1/4" or 1/8"	O.C.	ON CENTER
8 PENNY	O/H	OVERHEAD
BEAM	OHD	OVERHEAD DOOR
BY OTHERS	PLYUD.	PLYWOOD
BOTTOM	P/T	PRESSURE TREATED
CEILING	REINF.	REINFORCING (ED)
CLEANOUT	REQD.	REQUIRED
CONC.	RM.	ROOM
CLEANOUT TO GRADE	R.O.	ROUGH OPENING
DOUBLE	SF	SQUARE FEET
DIM.	SGD	SLIDING GLASS DOOR
DOWN	SHT.	SHEET
ELEV.	SRHL	SUNSHINE RIVER LOG HOMES
EXT.	TYP.	TYPICAL
FRENCH (DOORS)	VERT.	VERTICAL
FOUNDATION	WC	WATERCLOSET (TOILET)

PROJECT INFORMATION / NOTES:

DESIGN VALUES/LOADS & CODES
WIND DESIGN SPEED: 130 MPH, UNLESS NOTED OTHERWISE

SOIL DESIGN STATEMENT:
FOOTING DESIGN IS BASED UPON 1000 PSF SOIL BEARING PRESSURE PROVIDED BY CLEAN SAND, GRAVEL OR STONE. OTHER SOIL CONDITIONS IS: CLAY, HIGH LEVEL OF ORGANICS OR OTHER UNDESIRABLE SOILS SHALL REQUIRE FOUNDATION MODIFICATIONS.

LIVE LOADS: 1st FLOOR: 40PSF, 2nd FLOOR: 40PSF, ROOF: AS DETERMINED BY SHAPE FACTORS APPLIED TO THE WIND FORCE GENERATED BY THE DESIGN WIND SPEED.

BUILDING CODE: 2010 FLORIDA BUILDING CODE

ELECTRICAL CODE: NATIONAL ELECTRICAL CODE - LATEST
LIFE SAFETY: NFPA-101 - LATEST

CONSTRUCTION DOCUMENTS
THE CUSTOMER IS RESPONSIBLE FOR DELIVERING THE REQUIRED SETS OF CONSTRUCTION DOCUMENTS TO THE PERMIT ISSUING AUTHORITIES, FOR THE ISSUANCE OF CONSTRUCTION PERMITS. THE CONTRACTOR SHALL REVIEW THE CONSTRUCTION DOCUMENTS AND VERIFY ALL DIMENSIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT PRIOR TO THE COMMENCEMENT OF ANY WORK OR FABRICATION OF ANY MATERIALS.

DO NOT SCALE OFF THESE PLANS
AMPLE DIMENSIONS ARE SHOWN ON THE PLANS TO LOCATE ALL ITEMS. SIMPLE ARITHMETIC MAY BE USED TO DETERMINE THE LOCATIONS OF THOSE ITEMS NOT DIMENSIONED.

CHANGES TO FINAL PLAN SETS
PLEASE DO NOT MAKE ANY STRUCTURAL CHANGES TO THESE PLANS WITHOUT CONSULTING WITH THE ARCHITECT. THE OWNER SHALL ASSUME ANY AND ALL LIABILITY FOR STRUCTURAL DAMAGE RESULTING FROM CHANGES MADE TO THE PLANS OR BY SUBSTITUTION OF MATERIALS DIFFERENT FROM SPECIFICATION ON THE PLANS.

INORGANIC ARSENICAL PRESURE TREATED WOOD
SOME FRAMING MATERIALS SPECIFIED FOR THE CONSTRUCTION OF YOUR PROJECT SUCH AS SILL OR EXTERIOR FRAMING ARE PRESURE TREATED. EACH PIECE IS CLEARLY MARKED FOR EASY IDENTIFICATION AND IS USUALLY GREENISH IN COLOR.

THIS WOOD HAS BEEN PRESERVED BY PRESURE-TREATMENT WITH AN EPA-REGISTERED PESTICIDE CONTAINING INORGANIC ARSENIC TO PROTECT IT FROM INSECT ATTACK AND DECAY. EXPOSURE TO TREATED WOOD MAY PRESENT CERTAIN HAZARDS, THEREFORE, PRECAUTIONS SHOULD BE TAKEN BOTH WHEN HANDLING THE TREATED WOOD AND IN DETERMINING WHERE TO USE OR DISPOSE OF THE TREATED WOOD.

FOR FURTHER INFORMATION ON THE USE OF AND DISPOSAL OF INORGANIC ARSENIC PRESURE TREATED WOOD, PLEASE REFER TO THE EPA MATERIAL SAFETY SHEET DEALING WITH THIS PRODUCT.

HARDWARE RETIGHTENING REQUIREMENTS
ALL LAG SCREW AND BOLT CONNECTIONS ON COMPOUND BEAMS, POSTS, GIRDERS, TRUSS TRUSSES AND OTHER STRUCTURAL MEMBERS TO BE INSPECTED PERIODICALLY AND RETIGHTENED AS NECESSARY.

SYMBOLS
THESE SYMBOLS ARE MOST OFTEN ENCOUNTERED IN THE FOLLOWING DRAWINGS: ELEVATIONS, DIMENSION PLANS, SECTIONS & STRUCTURAL PLANS

FLORIDA BUILDING CODE

Compliance Summary

TYPE OF CONSTRUCTION

Roof: Hip Construction, Wood Trusses @ 24" O.C.
Walls: 2x6 Wood Studs @ 16" O.C.
Floor: 4" Trk. Concrete Slab W/ Fibermesh Concrete Additive
Foundation: Continuous Footer/Beam Wall

ROOF DECKING

Material: 1/2" CD Plywood or 1/6" OSB.
Sheet Size: 48"x96" Sheets Perpendicular to Roof Framing
Fasteners: 8d Common Nails per schedule on sheet AX

SHEARWALLS

Material: 1/6" OSB "Windstorm", 48" x 96", 120", 120" or 145"
Sheet Size: 48"x96" (120", 120" or 145") Sheets Placed Vertical
Fasteners: 8d Common Nails @ 4" O.C. Edges @ 8" O.C. Interior
Dragstrut: Double Top Plate (3"x8") W/ 6d Nails @ 12" O.C.
Wall Studs: 2x6 9ft Studs @ 16" O.C.

HURRICANE UPLIFT CONNECTORS

Truss Anchors: Simpson H25a @ Ea. Truss End (Typ. U.O.N.)
Wall Tension: Wall Sheathing Nailing is Adequate - 8d @ 4" O.C. Top & Bot.
Anchor Bolts: 1/2" A307 THRU-BOLTS @ 6'4" O.C. - 1st Bolt 8' from corner
Corner Hold-down Device: (1) Anchor THRU-BOLT
Porch Column Base Connector: Simpson ABU44/ABU66 @ each column
Porch Column to Beam Connector: Simpson EPC44/PC44 @ each column

FOOTINGS AND FOUNDATIONS

Footings: 22"x12" Cont. W/ 2-#5 Bars Cont. & Wire Chairs @ 24" O.C.
Stemwall: 8" CMU W/ 1-#5 Vertical Dowel @ 48" O.C.

ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION 1609, FLORIDA BUILDING CODE, 2010 EDITION.

BASIC WIND SPEED:	130 MPH
WIND IMPORTANCE FACTOR (I):	I = 1.00
BUILDING CATEGORY:	CATEGORY II
WIND EXPOSURE:	"B"
INTERVAL PRESSURE COEFFICIENT:	1/- 0.18
MUFRS PER TABLE 1609.2A (FBC 2010)	ROOF: - 32.2 PSF WALLS: +26.8 PSF EAVES: +45.1 PSF
COMPONENTS & CLADDING PER TABLE 1609.2B & 1609.2C (FBC 2010)	OPNGS: +30.4/- 40.7 PSF EAVES: 35.3 PSF ROOF: +21.8/- 35.6 PSF

FRAMING ANCHOR SCHEDULE

APPLICATION	MANUF/MODEL	CAP.
TRUSS TO WALL:	SIMPSON H25a	535#
GIRDER TRUSS TO POST/HEADER:	SIMPSON LGT, W/ 28 - 16d NAILS	1185#
HEADER TO KING STUD(S):	SIMPSON STJ	1310#
PLATE TO FOUNDATION:	5/8" THRU-BOLT	3340#
FORCH BEAM TO POST:	SIMPSON PC44/EPC44	1100#
FORCH POST TO END:	SIMPSON ABU44	2200#
MISC. JOINTS	SIMPSON A34	315#/240#

NOTE:
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.

NOTE:
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.

NOTE:
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.

NOTE:
"SEYCO" PRODUCT APPROVAL:
MIAMI/DADE COUNTY REPORT #5-0818.15

NOTE:
"SIMPSON" PRODUCT APPROVALS:
MIAMI/DADE COUNTY REPORT #1-0107.05, #36-1126.11, #39-0623.04
SECCI NER-443, NER-333

GENERAL NAILING SCHEDULE:

NUMBER OF NAILS FOR CONNECTING WOOD MEMBERS:	COMMON NAILS	Nr. / SPACING
BRIDGING TO JOIST, TOE NAIL	16d	2 EA, END
2" SUBFLOOR TO JOIST:		
BLIND & FACE NAILING	16d	2
SOLE PLATE TO JOIST OR BLOCKING	16d	16" O.C.
FACE NAILED		
TOP OR SOLE PLATE TO STUD	16d	2
END NAILED	16d	3 OR 2 16d
STUD TO SOLE PLATE, TOE NAILED	8d	24" O.C.
DOUBLE STUDS, FACE NAILED	16d	16" O.C.
DOUBLE TOP PLATES, FACE NAILED	16d	
TOP PLATES - LAPs @ INTERSECTIONS	16d	2
FACE NAILED		
1 X 6 SHEATHING TO EACH POINT OF BEARING, FACE NAILED	8d	2
BUILT-UP CORNER STUDS, FACE NAILED	16d	30" O.C.
BUILT-UP GIRDERS & BEAMS	20d	32" O.C. @ TOP & BOTTOM @ STAGGERED - 2 @ EA, END @ SPICES @ 6" O.C. @ EDGES @ 10" O.C. @ INTERMEDIATE @ 6" O.C. @ EDGES @ 10" O.C. @ INTERMEDIATE @ 3" O.C. @ EDGES @ 6" O.C. @ INTERMEDIATE
3/4" PLYWOOD SUBFLOORING	8d	
OSB SHEATHING, 1/6" THICK	8d	
1/8" FIBERBOARD SHEATHING	6d	

- NAILS, BOLTS AND OTHER METAL CONNECTORS WHICH ARE USED IN CONNECTION TO THE WEATHER SHALL BE GALVANIZED OR OTHERWISE CORROSION RESISTANT.
- IN GENERAL, NAILS SHALL PENETRATE THE SECOND MEMBER A DISTANCE EQUAL TO THE THICKNESS OF THE MEMBER BEING NAILED THERETO, OR GREATER.
- THERE SHALL BE NOT LESS THAN 2 NAILS PER CONNECTION.
- GLUING SHALL NOT BE CONSIDERED AN ACCEPTABLE CONNECTOR IN LIEU OF THOSE SPECIFIED HEREIN.
- FORMED METAL CONNECTORS, AS PER THE SCHEDULE HEREIN, SHALL HAVE THE NUMBER OF NAILS INSTALLED AS REQUIRED BY THE MANUFACTURER, OR AS DIRECTED BY THE PLANS.
- NAILS PROJECTING BEYOND THE LAST WOOD MEMBER SHALL BE CLINCHED, WHEREVER POSSIBLE.
- NOTES IN THE "PLANS" PACKAGE OF THE CONSTRUCTION DOCUMENTS SUPERSEDE SIZES & SPACINGS OF NAILS CONTAINED HEREIN.

BUILDING COMPONENTS & CLADDING LOADS
MEAN BUILDING HEIGHT = 30'-0", EXPOSURE "B"
ROOF ANGLE 21° TO 45°

WIND	WIND	WIND	WIND	WIND
DIR	DIR	DIR	DIR	DIR
10	10	10	10	10
1	10	10	10	10
2	10	10	10	10
3	10	10	10	10
4	10	10	10	10
5	10	10	10	10
6	10	10	10	10
7	10	10	10	10
8	10	10	10	10
9	10	10	10	10
10	10	10	10	10

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING

BLDG HEIGHT	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	1.00	1.21	1.41
20	1.00	1.29	1.55
25	1.00	1.35	1.61
30	1.00	1.40	1.66

REVISION:

DRAWN: 198

Copyright 2012
N.P. Geisler, Architect

CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA

STRUCTURAL INFORMATION

40 Years of Service
1972-2012
N.P. Geisler, Architect
AB0007005

728 NW Brown Rd.
Apopka, FL 32830
386-365-4355

NICHOLAS GEISLER ARCHITECT
N.C.A.R.B. Certified

DATE: 15 NOV 2012


COMME: 2K1287

SHEET: A.8
8 of 13

DRW
10 May 2013
AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part, for use on or incorporated within any other job without specific and individual authorization by the architect.

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

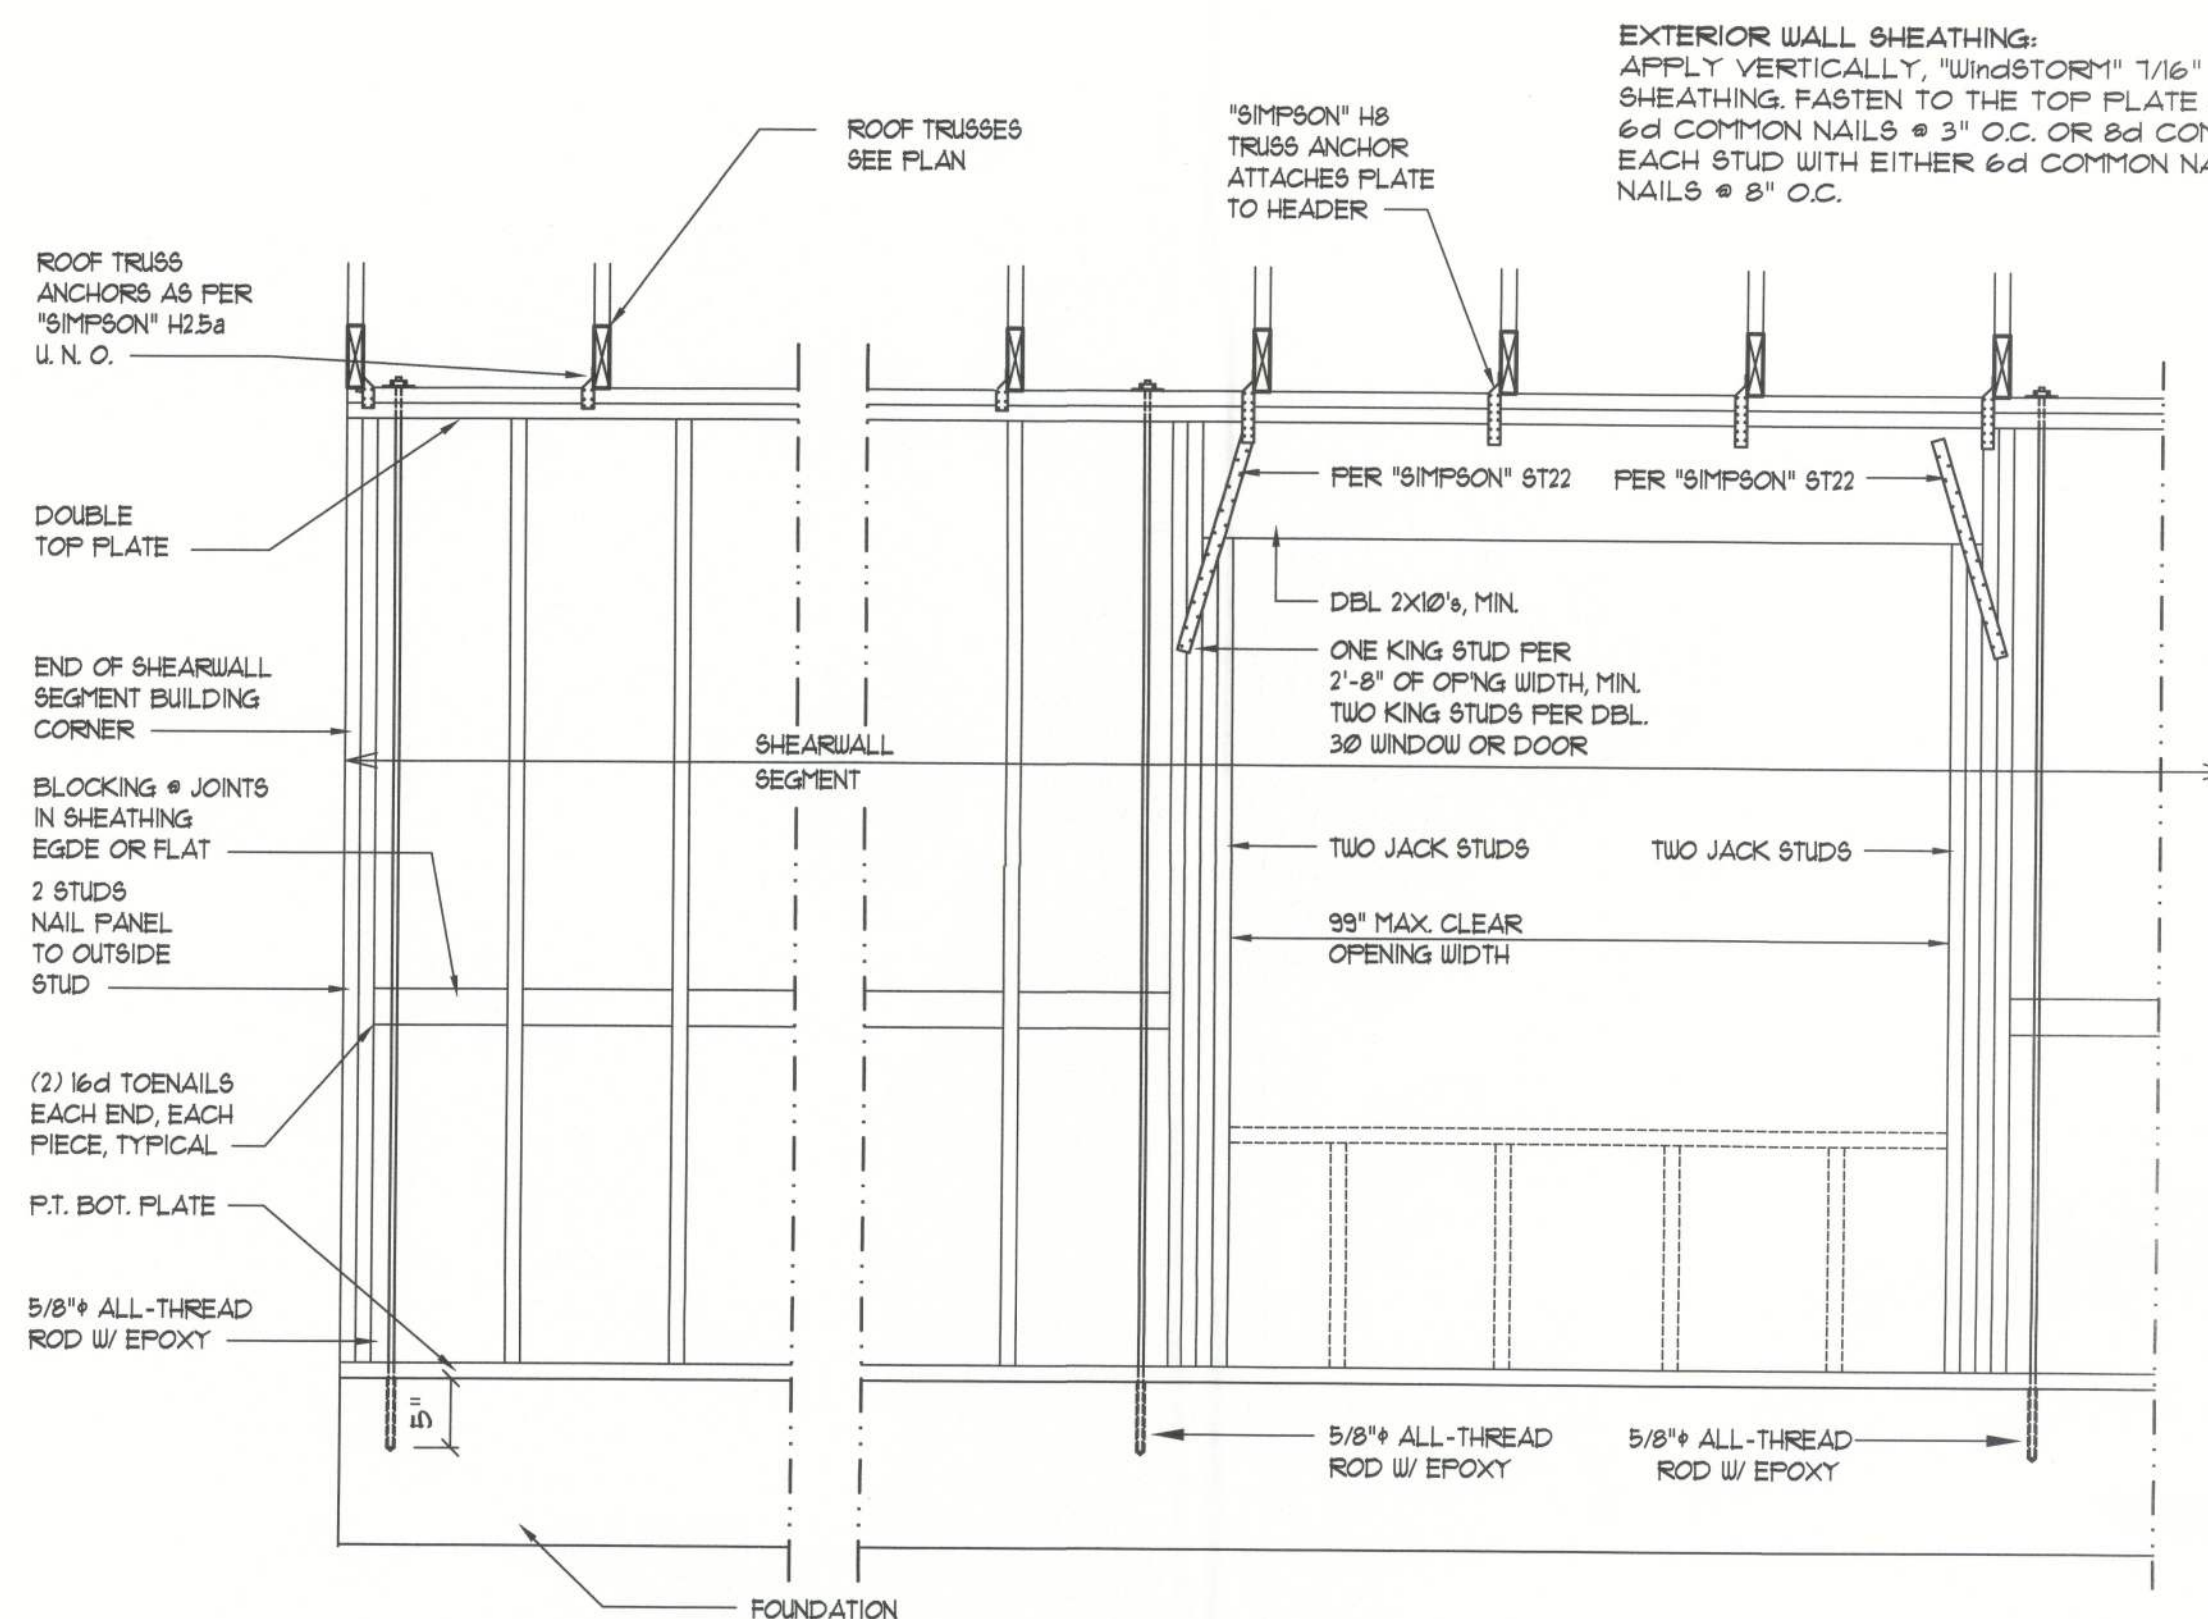

All-Thread Shear Wall DETAILS

SCALE: NONE

C

SHEARWALL NOTES:


1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-91 SBCCI 305.4.3.
2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/4" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
4. NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.
5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
6'-0" TO 9'-0"	(3) 2x4 OR (1) 2x6	2
9'-0" TO 12'-0"	(5) 2x4 OR (2) 2x6	3


All-Thread Wall Tie-Down PLAN

SCALE: NONE


D

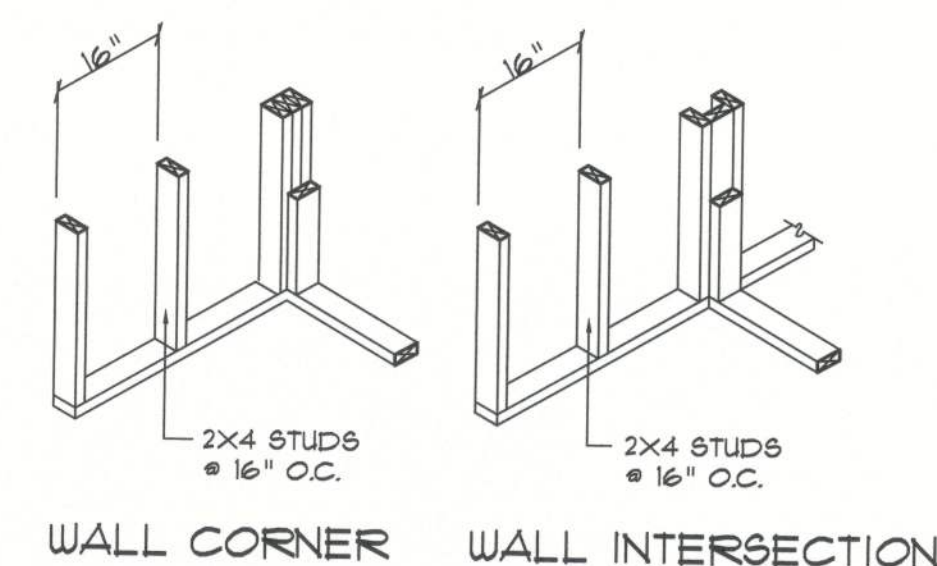


WALL CORNER WALL INTERSECTION

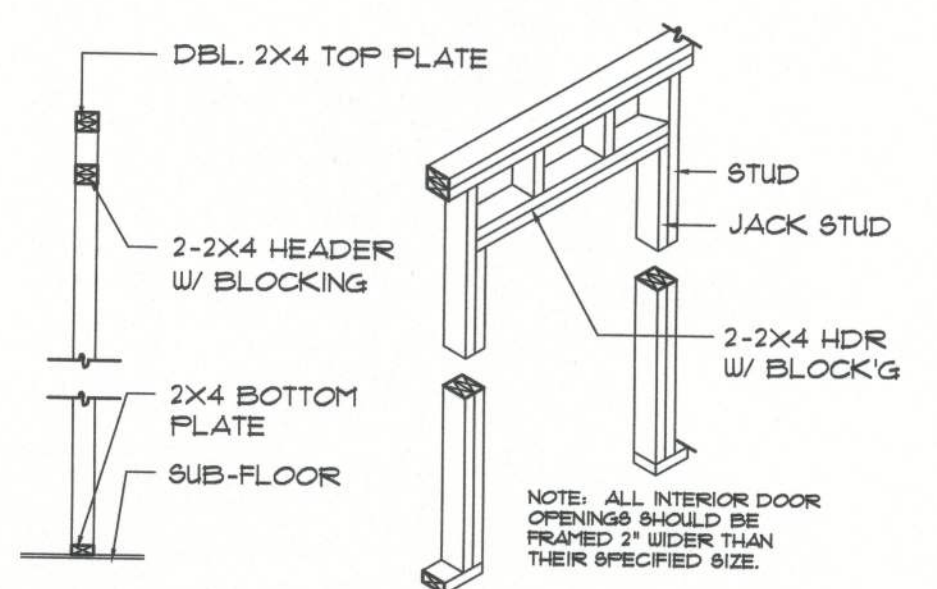

NON-BEARING WALL HEADER

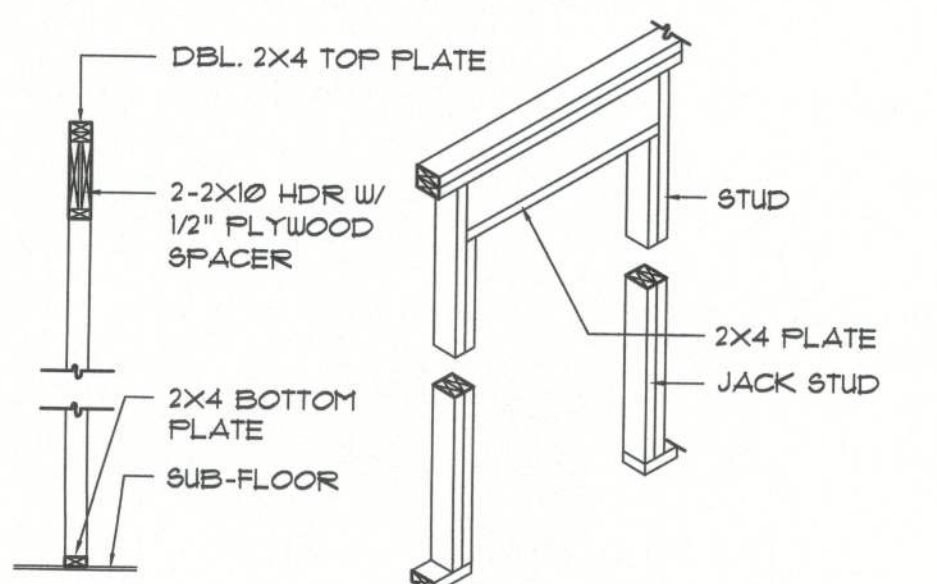

BEARING WALL HEADER

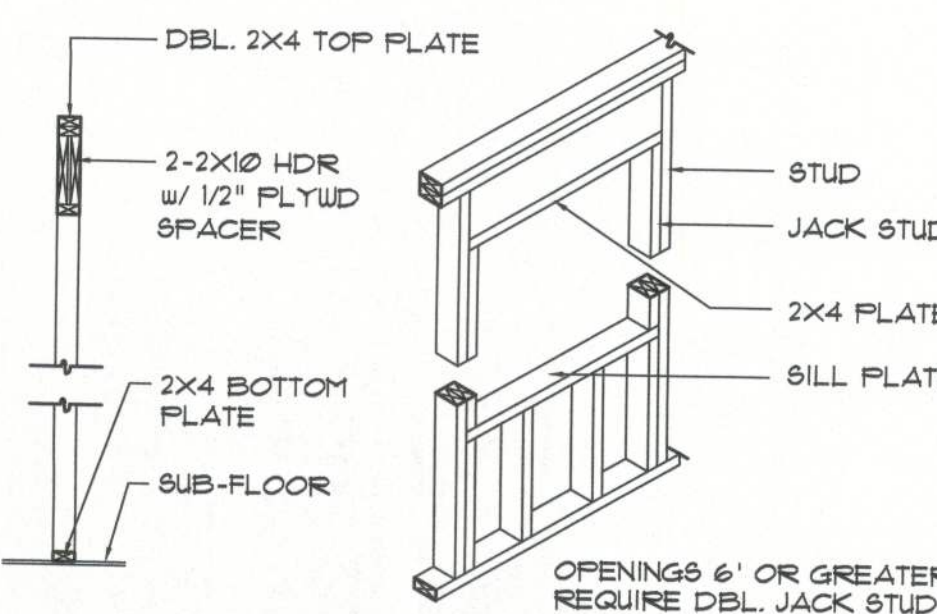


TYPICAL WINDOW HEADER

Framing DETAILS

SCALE: 1/4" = 1'-0"


G

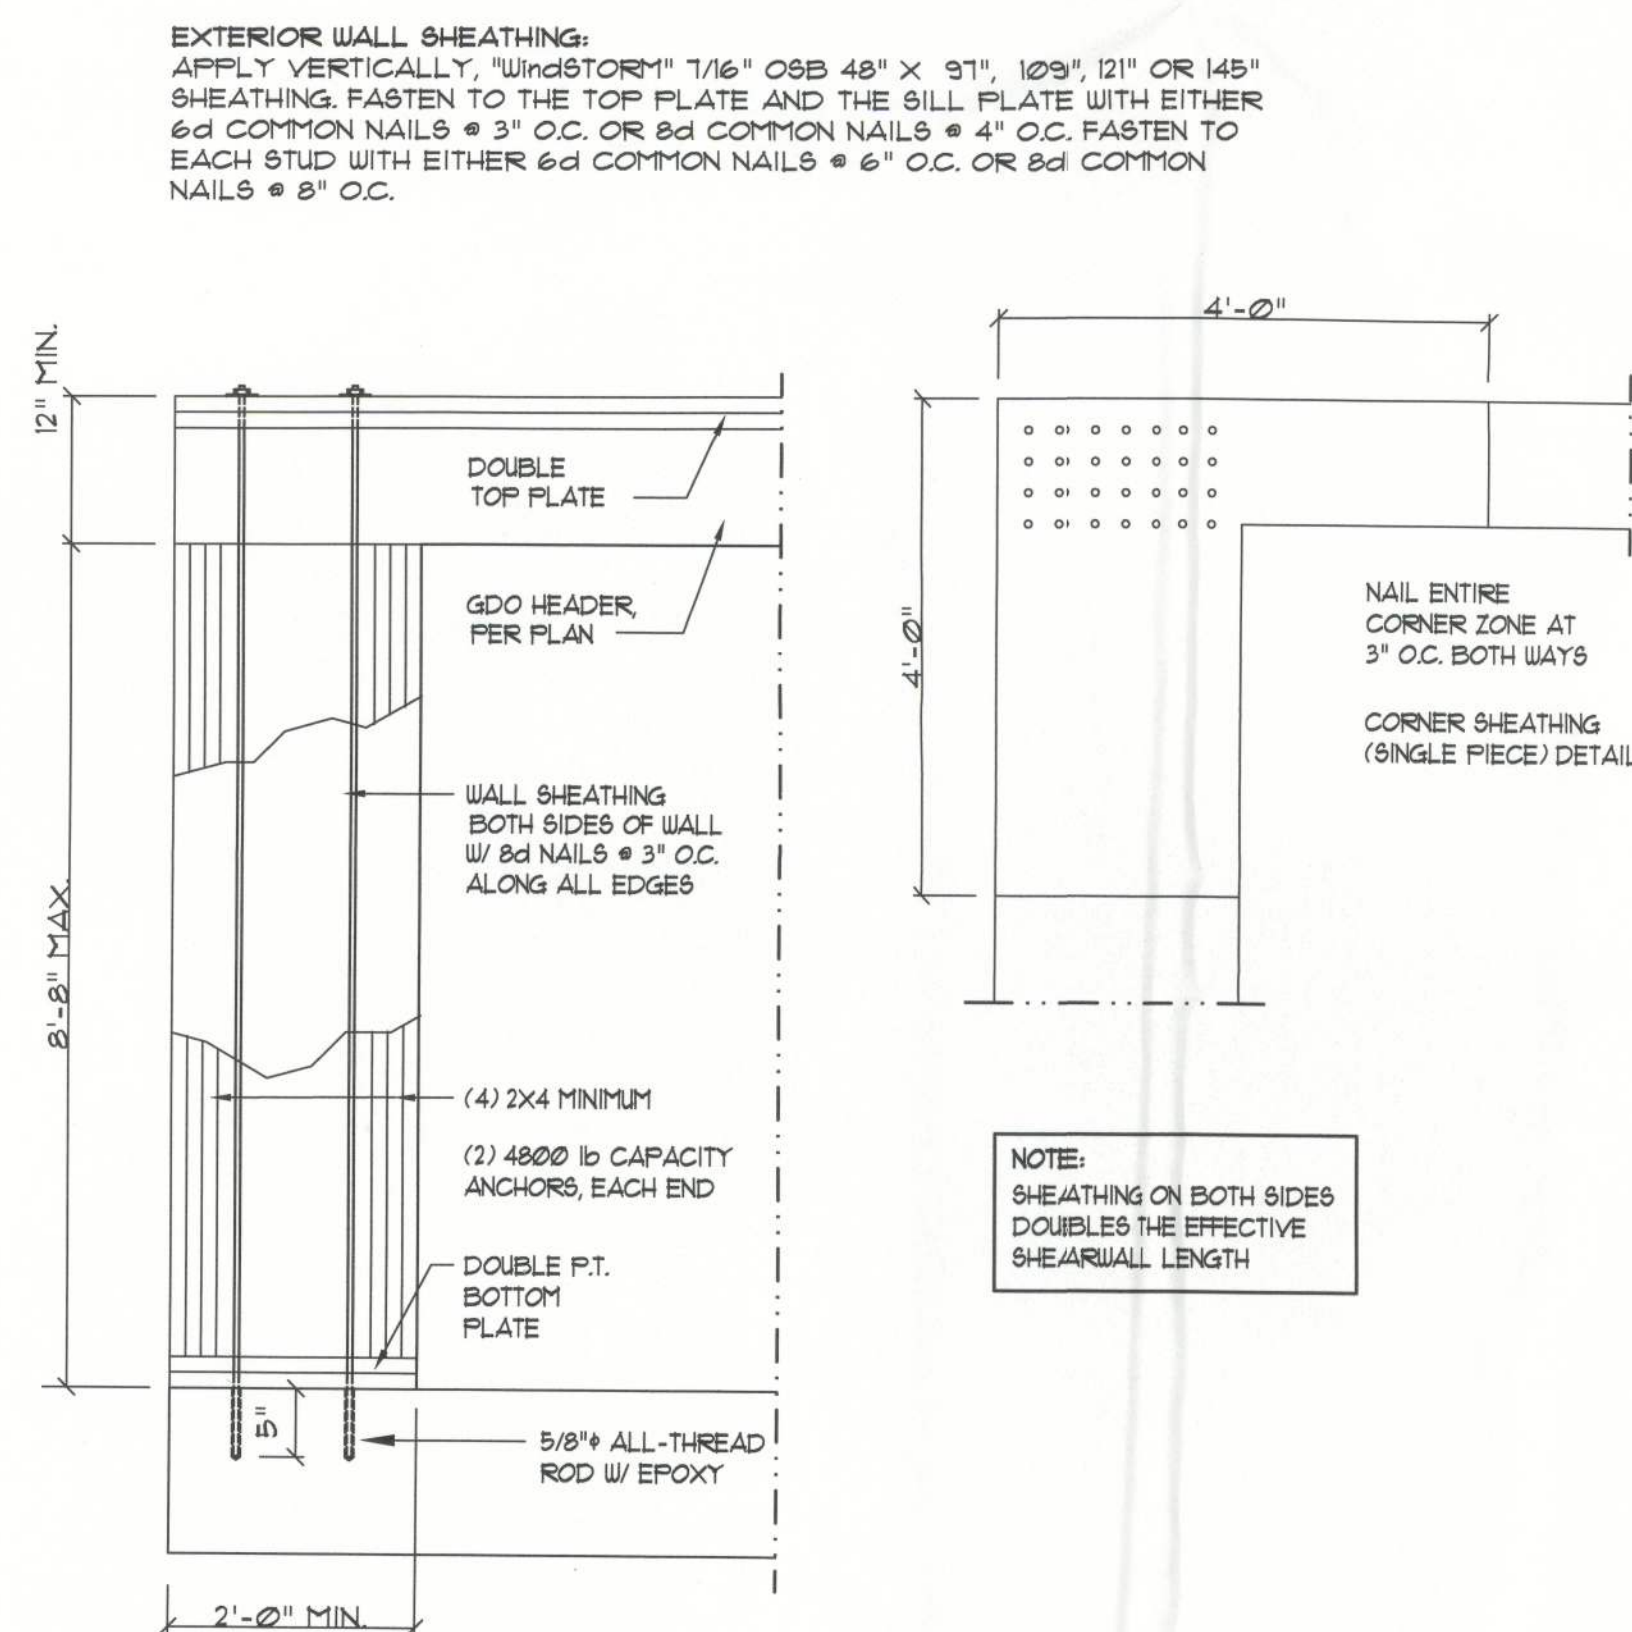

Garage End Wall DETAILS

SCALE: 1/2" = 1'-0"

E

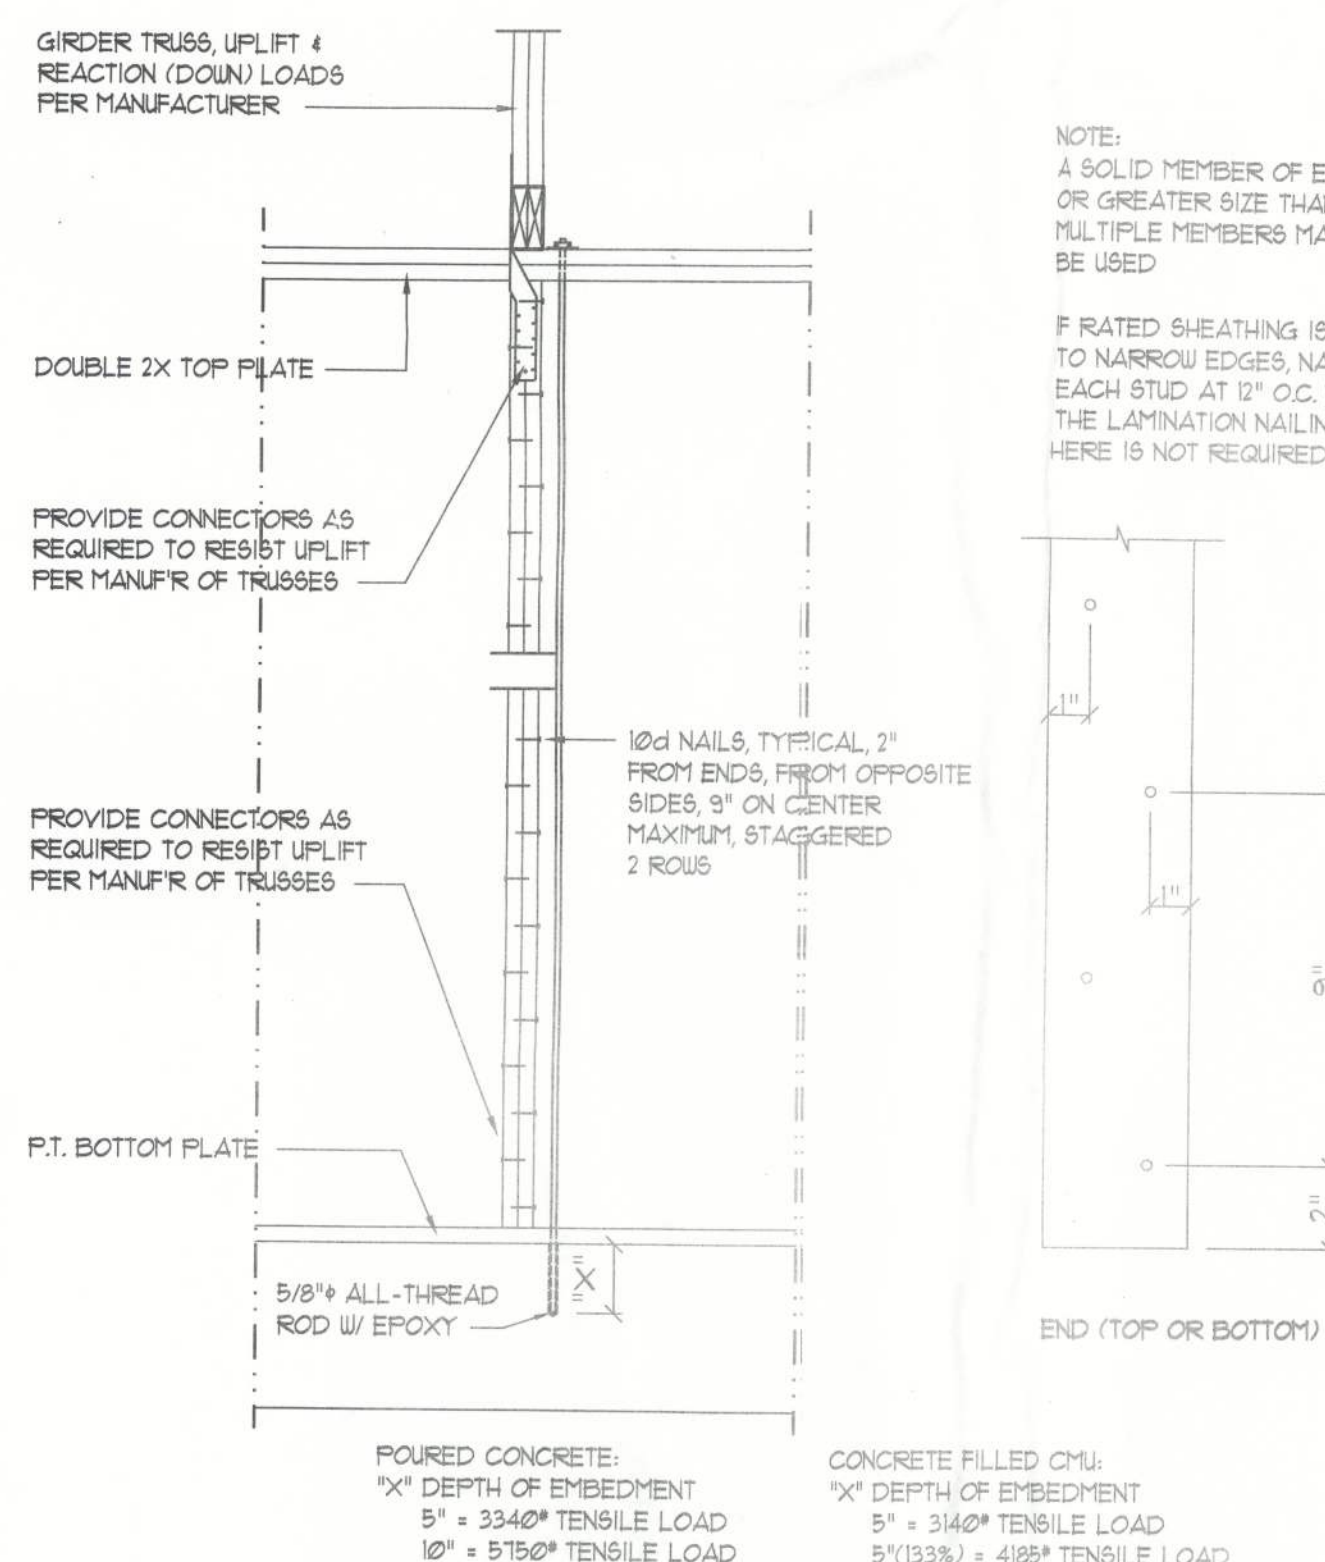

Girder Truss Column DET.

SCALE: 1/2" = 1'-0"

F

CONSTRUCTION NOTES

1. FIELD VERIFY ALL DIMENSIONS AND MATERIALS. ALL OUTSIDE DIMENSIONS ARE TO FACE OF STEMWALL.
2. ALL NAILING CONSTRUCTION MATERIALS SHALL BE AS PER 2004 FBC - SEE 901.
3. PROVIDE EXTERIOR COMBUSTION AIR TO GAS FIRED H.V.A.C. EQUIPMENT, WOOD BURNING STOVES, AND FIREPLACES.
4. VENT CLOTHES DRYER, BATH, AND COOKING FANS TO EXTERIOR AS REQUIRED.
5. CONTRACTOR SHALL CALL ATTENTION TO THE DESIGNER ANY DISCREPANCIES IN DRAWINGS AND/OR SPECIFICATIONS AND SHALL RECEIVE INSTRUCTIONS OR CLARIFICATIONS BEFORE PROCEEDING WITH THE PORTION OF THE WORK IN QUESTION.
6. ROOF & FLOOR TRUSS FRAMING PLANS ARE FOR GENERAL INFORMATION ONLY. THE TRUSS MANUFACTURER SHALL PROVIDE A DETAILED LAYOUT FOR TRUSS AND FRAMING MEMBERS.
7. SHOULD CONDITIONS AT THE SITE BE FOUND MATERIALLY DIFFERENT FROM THOSE INDICATED BY THE DRAWINGS AND/OR SPECIFICATIONS, AND THE CONDITIONS USUALLY INHERENT IN THE WORK OF THE CHARACTER SHOWN AND SPECIFIED BE DIFFERENT FROM THE DESIGNER'S RECOMMENDED BUILDING PROCEDURES, CALL IMMEDIATE ATTENTION TO SUCH CONDITIONS BEFORE PROCEEDING.
8. LP GAS-BURNING APPLIANCES ARE NOT PERMITTED IN BASEMENTS OR CRAWLSPACES.
9. DO NOT SCALE DRAWINGS. USE PRINTED DIMENSIONS ONLY.

NOTE: DETAILS ON THIS SHEET ARE GENERAL IN NATURE AND ARE NOT TO SCALE. REFER TO SHEET A1 FOR GENERAL NAILING NOTES AND ANCHOR STRAPS - SEE PLANS FOR SPECIFIC ANCHORING REQUIREMENTS, IF ANY.

REVISION:

Copyright, 2012
N.P. Geisler, Architect

DRAWN:

108

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
WALL FRAMING DETAILS

Calculating
40 Years of Service
1972-2012
N.P. Geisler, Architect
A000005

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified
1755 NW Brown Rd.
Lake City, FL 32055
386-365-4355

DATE:

15 NOV 2012

COMM:

2K1287

SHEET:

A.9

9 of 13


mmj 2013
A00007005

CONCRETE / MASONRY / METALS GENERAL NOTES:


- DESIGN SOIL BEARING PRESSURE: 1000 PSF.
- EXPANSIVE SOILS: WHERE DIRECTED BY THE SOILS ENGINEER, SOIL AUGMENTATION PER THE SOILS ENGINEER'S SPECIFICATIONS SHALL BE IMPLEMENTED PRIOR TO PLACING ANY FOUNDATIONS - TESTS AS SPECIFIED SHALL BE PERFORMED TO DETERMINE THE SUITABILITY OF THE SUB-GRADE TO SUPPORT THE DESIGN LOADS.
- CLEAN SAND FILL OVER STRIPPED AND COMPACTED EXISTING GD. SHALL BE PLACED IN 12" LIFTS, BOTH SUB-SOIL AND FILL COMPACTION SHALL BE NOT LESS THAN 98% AS MEASURED BY A MODIFIED PROCTOR TEST AT THE RATE OF ONE TEST FOR EACH 1500 SF OF BUILDING PAD AREA, OR FRACTION THEREOF, FOR EACH 12" LIFT.
- REINFORCING STEEL SHALL BE GRADE 60 AND MEET THE REQUIREMENTS OF ASTM A615, ALL BENDS SHALL BE MADE COLD.
- WELDED WIRE MESH SLAB REINFORCING SHALL MEET THE REQUIREMENTS OF ASTM A185 - MIN. YIELD STRESS = 65 KSI.
- CONCRETE SHALL BE STANDARD MIX F_c = 3000 PSI FOR ALL FTGS, SLABS, COLUMNS AND BEAMS OR SHALL BE STANDARD PUMP MIX F_c = 3000 PSI. STRENGTH SHALL BE ATTAINED WITHIN 28 DAYS OF PLACEMENT, MIXING, PLACING AND FINISHING SHALL BE AS PER ACI STANDARDS.
- CONCRETE BLOCK SHALL BE AS PER MANUFACTURER'S PRODUCT GUIDE FOR ASTM C-90 REQUIREMENTS WITH MEDIUM SURFACE FINISH - F_m = 1500 PSI.
- MORTAR SHALL BE TYPE "M" OR "N" FOR ALL MASONRY UNITS.
- STRUCTURAL STEEL SHALL CONFORM TO ASTM A36 STANDARDS FOR STRENGTH, BOLTS SHALL BE ASTM A307 / GRADE 1 OR A325, AS PER PLAN REQUIREMENTS.
- WELDS SHALL BE AS PER "AMERICAN WELDING SOCIETY" STANDARDS FOR STRUCTURAL STEEL APPLICATIONS.

WOOD STRUCTURAL NOTES


- TEMPORARY BRACING OF THE STRUCTURE DURING ERECTION, REQUIRED FOR SAFE AND STABLE CONSTRUCTION, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR SO ENGAGED. TEMPORARY & PERMANENT BRACING OF ROOF TRUSSES SHALL BE AS PER THE STANDARD GUIDELINES OF THE "TRUSS PLATE INSTITUTE".
- ALL TRUSSES SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER & SHALL BE SIGNED AND SEALED BY SAME. TRUSS DESIGN SHALL INCLUDE PLACEMENT PLANS, TRUSS DETAILS, TRUSS TO TRUSS CONNECTIONS & THE STANDARD SPECIFICATIONS & RECOMMENDATIONS OF INSTALLATION OF THE "TRUSS PLATE INSTITUTE".
- WOOD STUDS IN EXTERIOR WALLS & INTERIOR BEARING WALLS SHALL BE NOT LESS THAN N-2 HEM-FIR OR BETTER.
- CONNECTORS FOR WOOD FRAMING SHALL BE GALVANIZED METAL OR BLACK METAL AS MANUFACTURED OR AS CALLED FOR IN THE PLANS AND BE OF A DESIGN SUITABLE FOR THE LOADS AND USE INTENDED. REFER TO THE JOINT REINFORCEMENT SCHEDULE FOR PRINCIPLE CONNECTIONS.

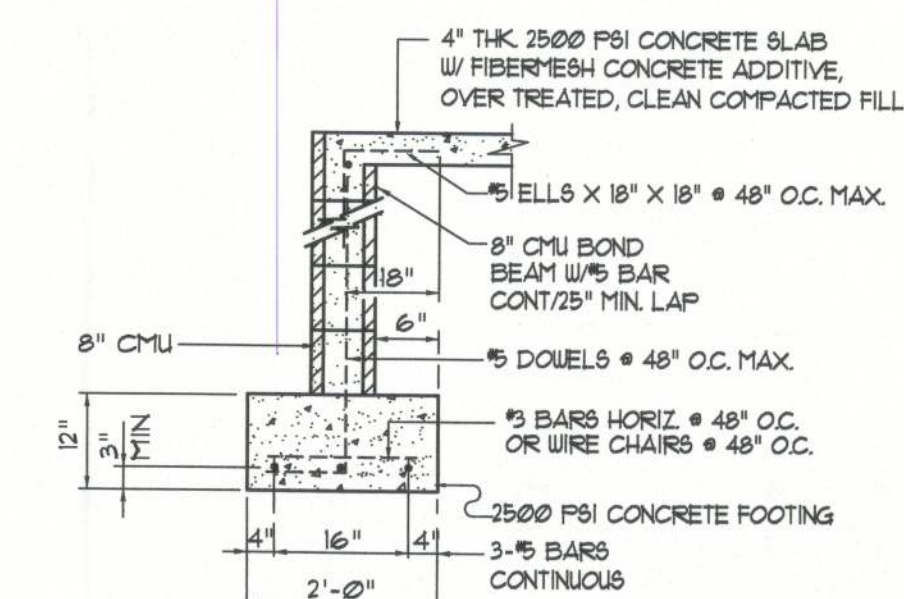

SECTION
SCALE: 1/2" = 1'-0"

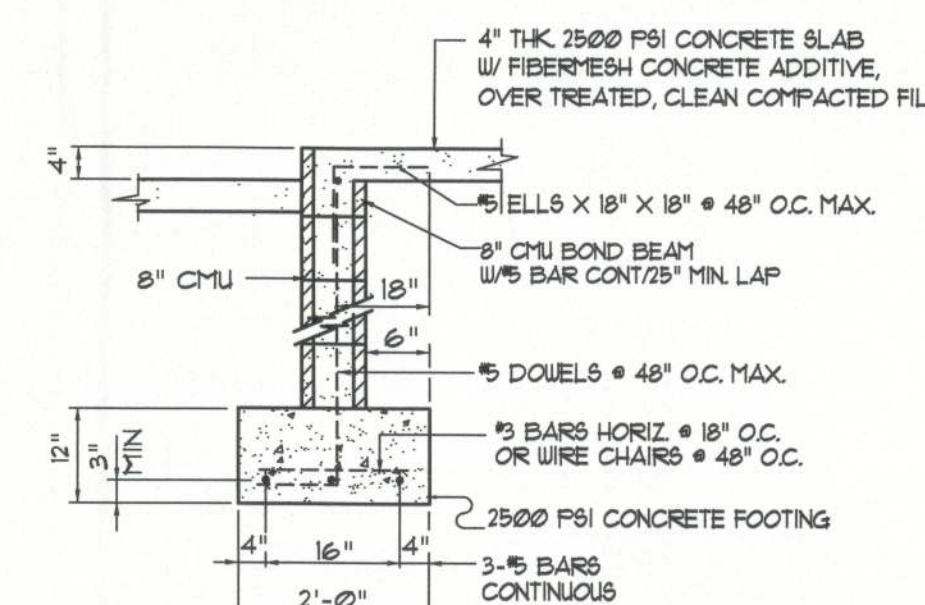

SECTION
SCALE: 1/2" = 1'-0"

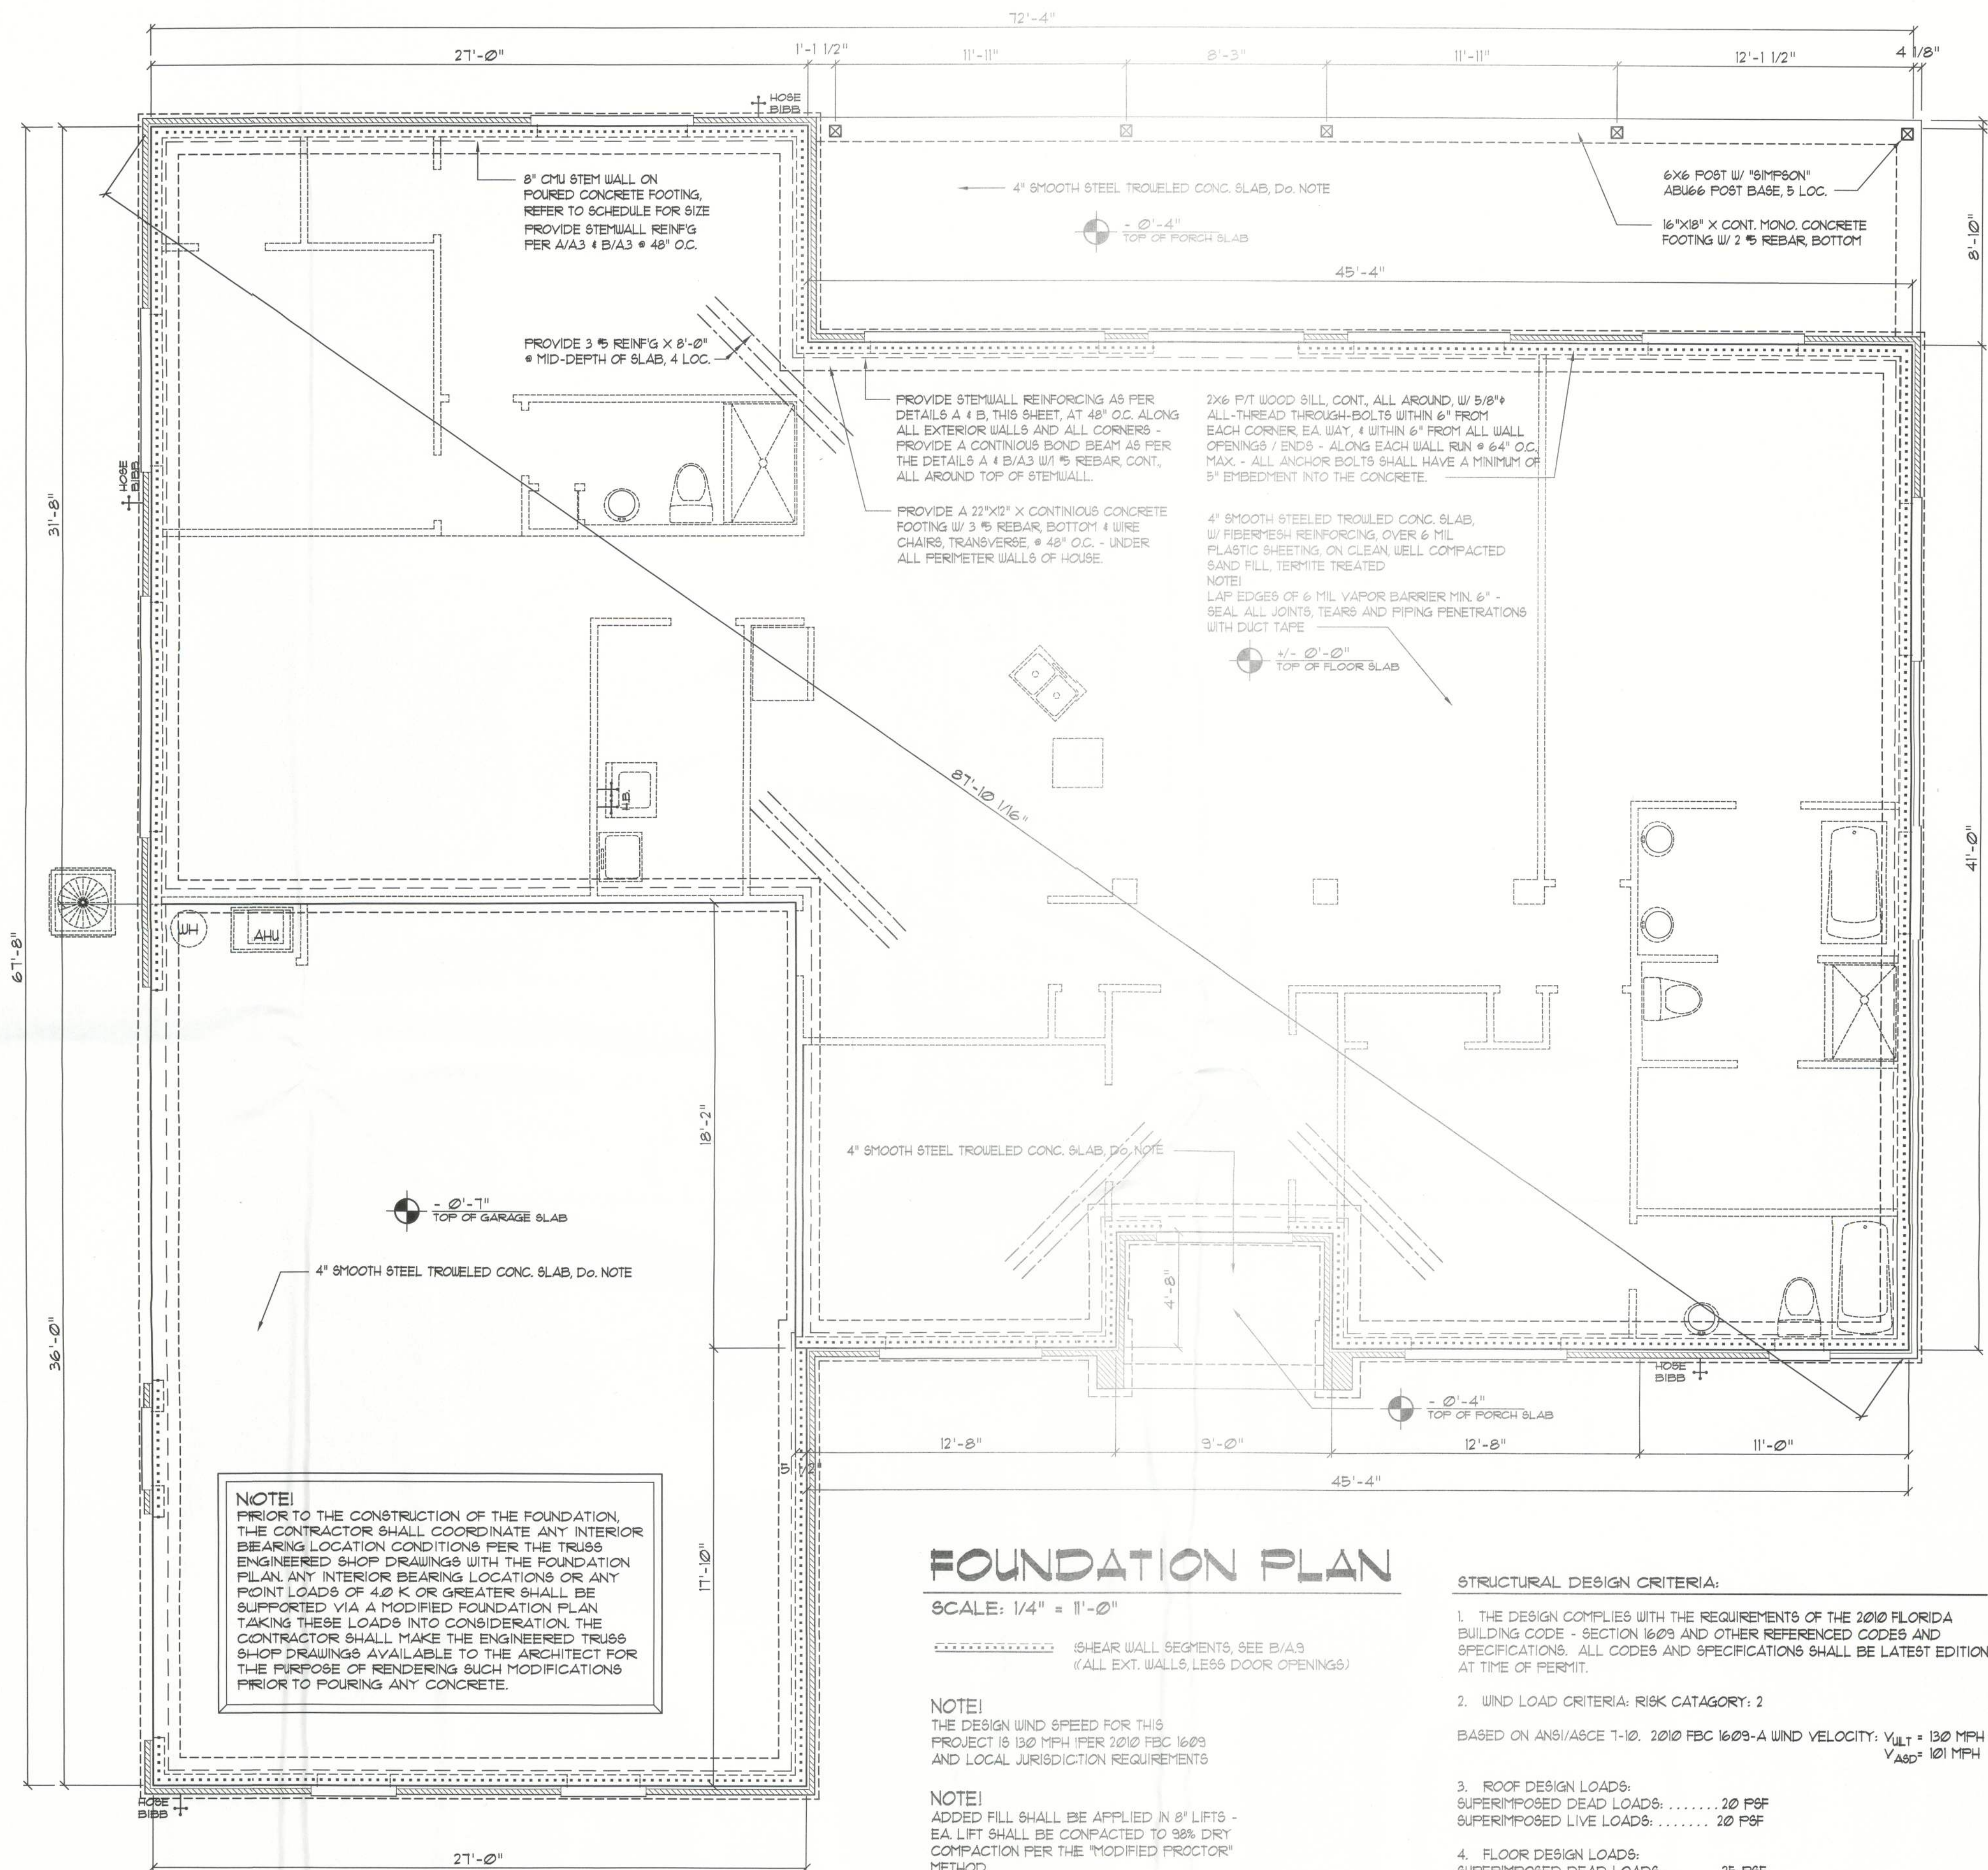

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

..... (SHEAR WALL SEGMENTS, SEE B/A3
(ALL EXT. WALLS, LESS DOOR OPENINGS)

NOTE!

THE DESIGN WIND SPEED FOR THIS PROJECT IS 130 MPH (PER 2010 FBC 1603 AND LOCAL JURISDICTION REQUIREMENTS)

NOTE!

ADDED FILL SHALL BE APPLIED IN 8" LIFTS - EA. LIFT SHALL BE COMPACTED TO 98% DRY COMPACTION PER THE "MODIFIED PROCTOR" METHOD.

NOTE!

PLUMBING CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL PLUMBING WORK, INCLUDING ALL PLUMBING LINE LOCATIONS AND RISER DIAGRAM - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER AND 1 COPY TO THE PERMIT ISSUING AUTHORITY.


NOTE!

HVAC CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL HVAC WORK, INCLUDING ALL DUCTWORK LOC, SIZES, LINES, EQUIPMENT SCH. & BALANCING REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

NOTE!
PRIOR TO THE CONSTRUCTION OF THE FOUNDATION, THE CONTRACTOR SHALL COORDINATE ANY INTERIOR BEARING LOCATION CONDITIONS WITH THE TRUSS ENGINEER'S SHOP DRAWINGS WITH THE FOUNDATION PLAN. ANY INTERIOR BEARING LOCATIONS OR ANY POINT LOADS OF 40 K OR GREATER SHALL BE SUPPORTED VIA A MODIFIED FOUNDATION PLAN TAKING THESE LOADS INTO CONSIDERATION. THE CONTRACTOR SHALL MAKE THE ENGINEERED TRUSS SHOP DRAWINGS AVAILABLE TO THE ARCHITECT FOR THE PURPOSE OF RENDERING SUCH MODIFICATIONS PRIOR TO POURING ANY CONCRETE.

EXTERIOR WALL SHEATHING:
APPLY VERTICALLY, "Windstorm" 1/2" OSB 48" X 96", 109", 12" OR 145" SHEATHING, FASTEN TO THE TOP PLATE AND THE SILL PLATE WITH EITHER 6d COMMON NAILS @ 3" O.C. OR 8d COMMON NAILS @ 4" O.C. FASTEN TO EACH STUD WITH EITHER 6d COMMON NAILS @ 6" O.C. OR 8d COMMON NAILS @ 8" O.C.

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

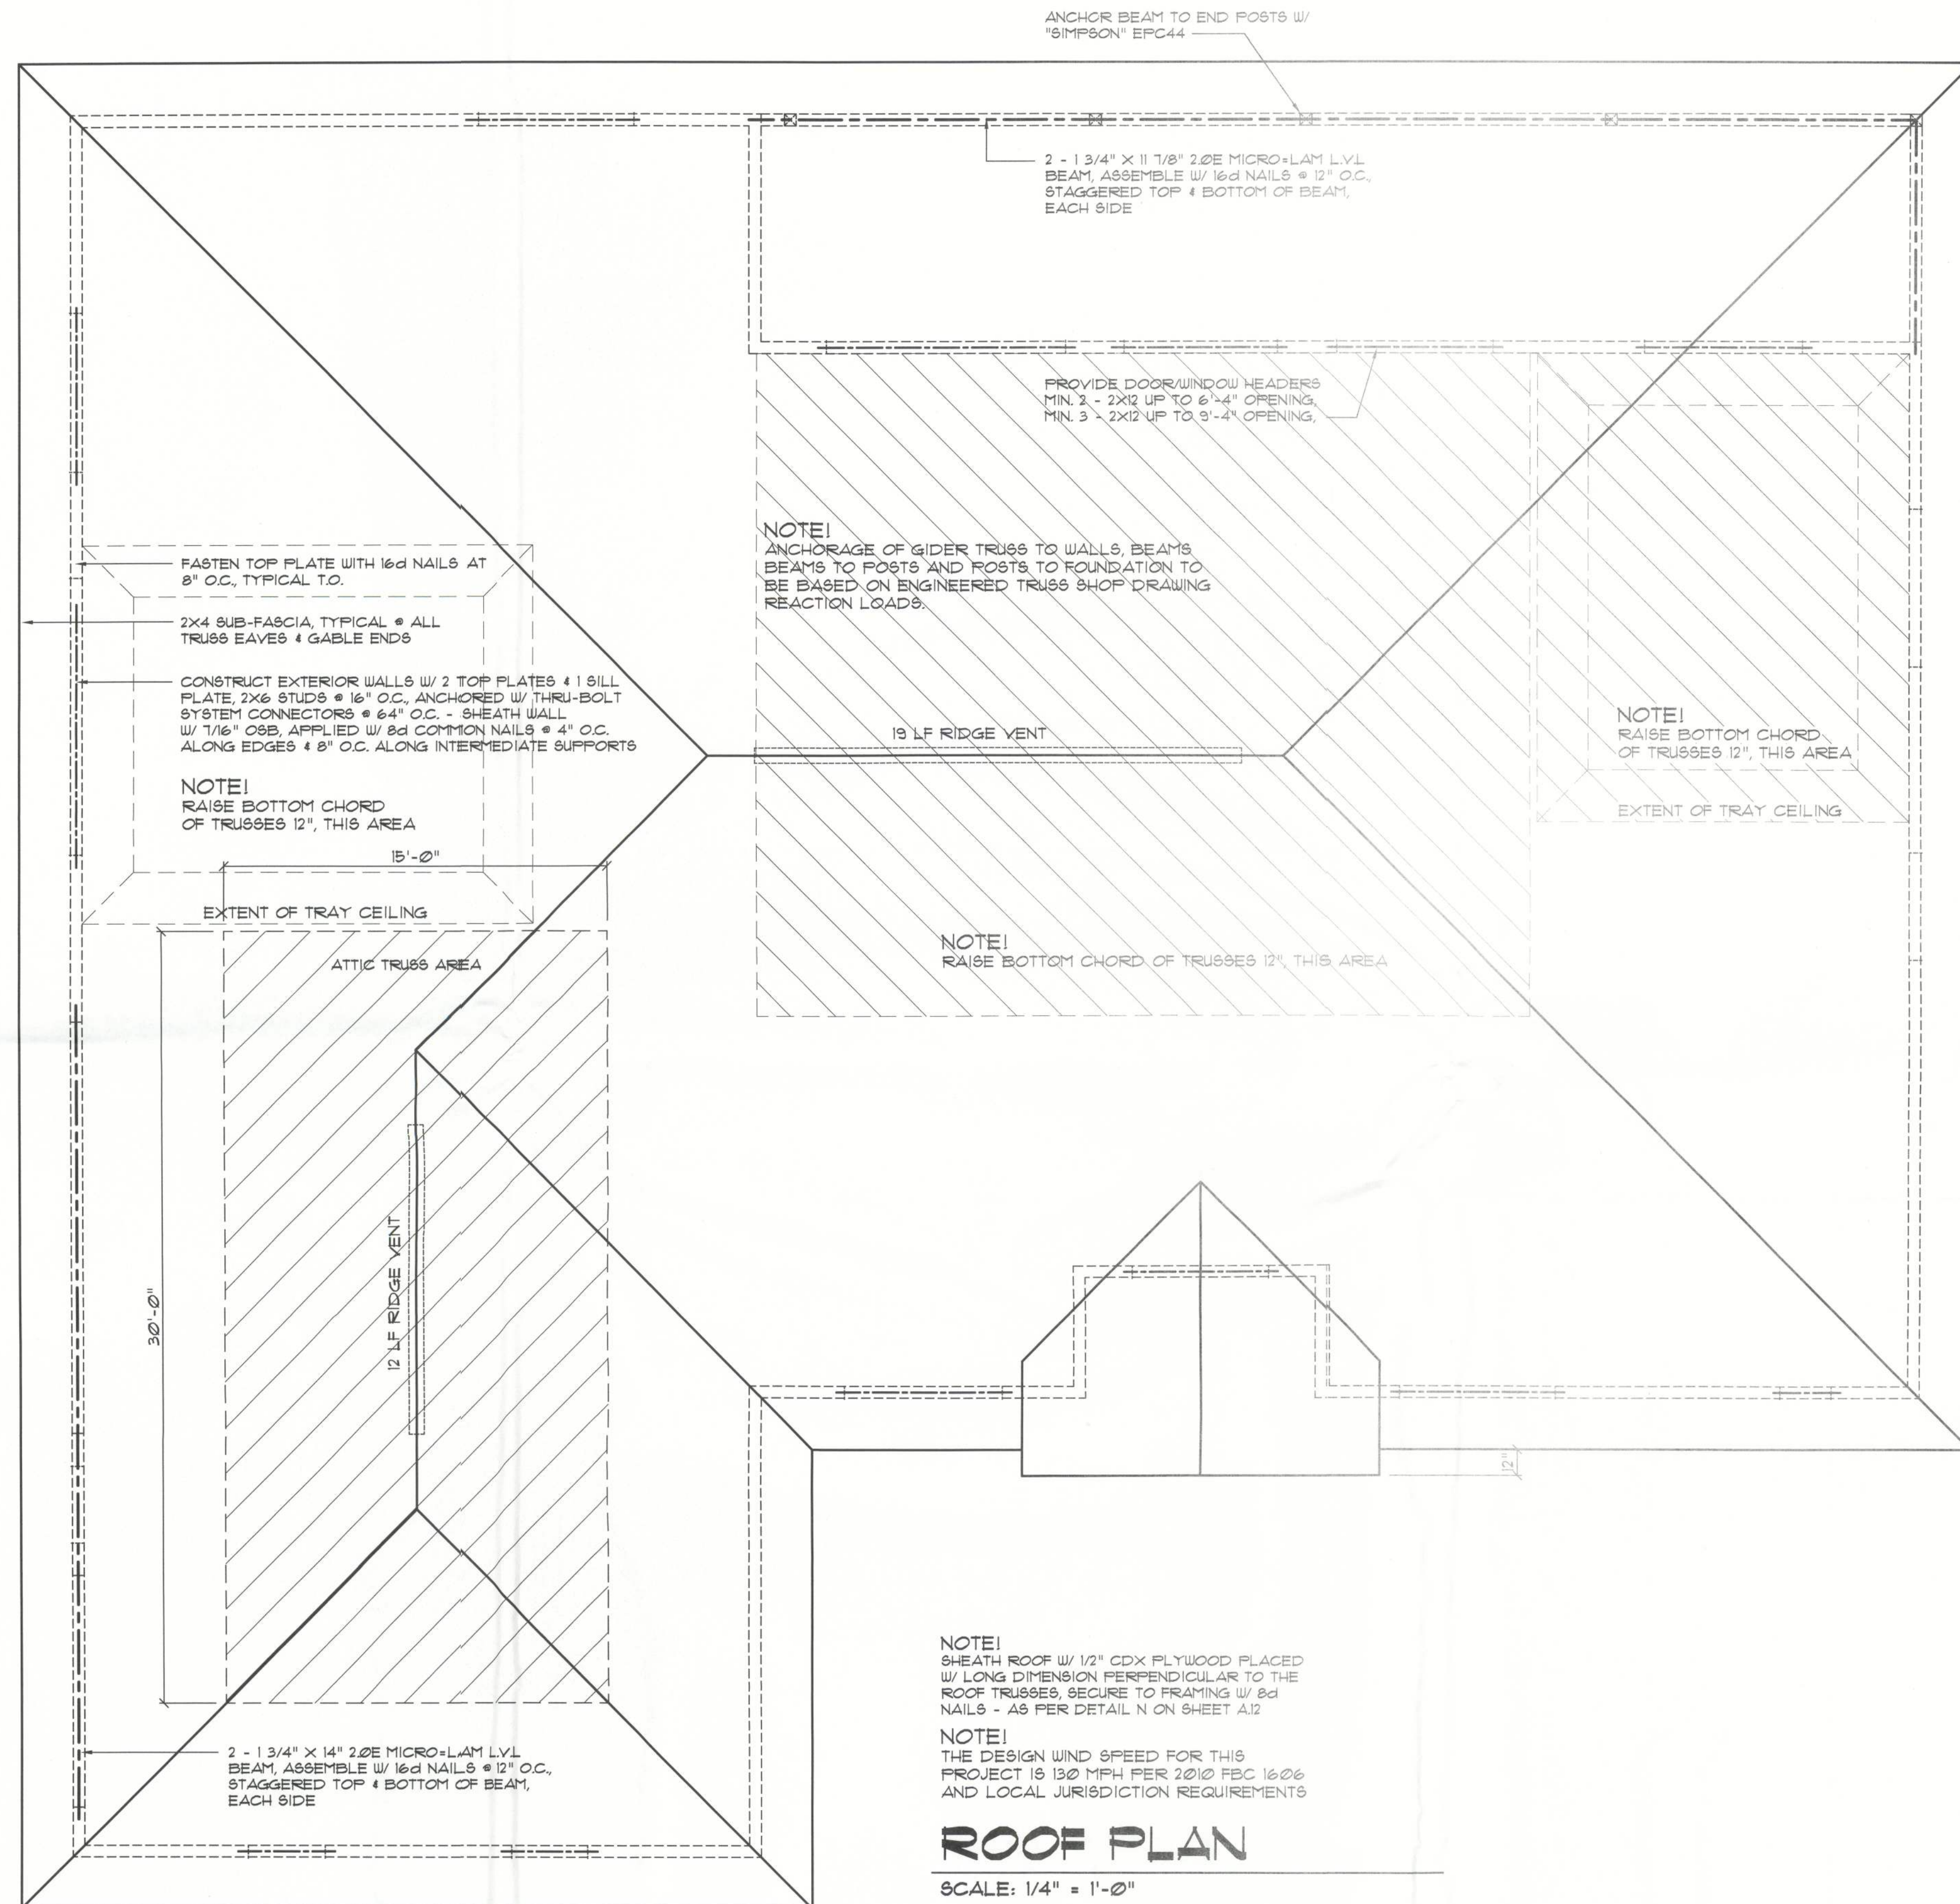

NOTE!
ALL PLATE HEIGHTS AT 9'-0" AFF.
ALL ROOF PITCH AT 1/2, UNO.
ALL EAVES SHALL BE 24", UNO.

NOTE!
ANCHORAGE OF ALL TRUSSES TO PLATES & BEAMS
TO BE BASED ON ENGINEERED TRUSS SHOP DRAWING
REACTION LOADS.

NOTE!
SHEATH ROOF W/ 1/2" CDX PLYWOOD PLACED
W/ LONG DIMENSION PERPENDICULAR TO THE
ROOF TRUSSES, SECURE TO FRAMING W/ 8d
NAILS - AS PER DETAIL N ON SHEET A12

NOTE!
THE DESIGN WIND SPEED FOR THIS
PROJECT IS 130 MPH PER 2010 FBC 1606
AND LOCAL JURISDICTION REQUIREMENTS

ROOF PLAN

SCALE: 1/4" = 1'-0"

NOTE!
ALL PENETRATIONS OF THE TOP PLATE OF ALL LOAD BEARING
WALLS SHALL BE SEALED WITH FIRE RETARDANT CAULKING,
INCLUDING WIRING, PLUMBING OR OTHER SUCH PENETRATIONS.
WALLS OVER 8'-0" TALL SHALL HAVE CONTINUOUS BLOCKING
TO LIMIT CAVITY HEIGHT TO 8'-0". PENETRATIONS THROUGH
SUCH BLOCKING SHALL BE TREATED IN THE SAME MANNER
AS TOP PLATES, NOTED ABOVE

ATTENTION !!!

TRUSS SHOP DRAWING REQUIREMENTS

THIS PROJECT REQUIRES ENGINEERED TRUSS ROOF FRAMING AND/OR
ENGINEERED TRUSS FLOOR FRAMING. BECAUSE OF THIS, PRIOR TO
COMPLETION OF CONSTRUCTION, THE OWNER/BUILDER SHALL PROVIDE
THE ARCHITECT OF RECORD WITH THE SIGNED AND SEALED TRUSS SHOP
DRAWINGS FOR THE AOR'S REVIEW AND COMMENT. THE SUBMISSION SHALL
CONSIST OF 3 PAPER COPIES OF THE SIGNED AND SEALED TRUSS SHOP
DRAWING, AN ELECTRONIC DXF OR DWG (ACAD VERSION 14 OR LOWER) OF
THE PLACEMENT PLAN(S) AND A POSTAGE PAID RETURN MAILER.

FAILURE OF THE OWNER/BUILDER TO PROVIDE THE REQUIRED TRUSS SHOP
DRAWING PACKAGE TO THE AOR SHALL RESULT IN THE FULL ASSUMPTION OF
RESPONSIBILITY BY THE OWNER/BUILDER FOR ALL MATTERS INVOLVING THE
TRUSS FRAMING, INCLUDING, BUT NOT LIMITED TO, THE TRUSS PACKAGE
SUITABILITY FOR INCLUSION IN THE PROJECT, PROFILES, BEARING
REQUIREMENTS, UPLIFT RESTRAINTS OR ANY OTHER ASPECT OF THE
INSTALLATION AND HOW SUCH MAY AFFECT ANY OTHER PORTION OF THE
PROJECT, THE STRUCTURAL STABILITY OR THE CONTINUED SUITABILITY
OF THE TRUSS COMPONENTS FOR THE DURATION OF THE LIFE OF THE
STRUCTURE. USE OF TRUSS DOCUMENTS THAT LACK THE AOR'S "SHOP
DRAWING REVIEW" STAMP WILL RESULT IN AOR BEING RELEASED FROM ALL
LIABILITY INVOLVING ANY TRUSS COMPONENT, FOR ANY REASON.


IF THE 1st SUBMISSION OF THE TRUSS DOCUMENTS FAILS TO MEET THE
REQUIREMENTS OF THE DESIGN CONSTRUCTION DOCUMENTS, ADDITIONAL
SUBMISSIONS SHALL BE REQUIRED UNTIL SUCH TIME THAT THE TRUSS
DOCUMENTS ARE IN CONCURRENCE WITH THE DESIGN CONSTRUCTION
DOCUMENTS. EACH SUBSEQUENT SUBMISSION SHALL INCLUDE A POSTAGE
PAID MAILER FOR THE RETURN OF THE DOCUMENTS. SUCCESSFUL
SUBMISSIONS SHALL BE STAMPED BY THE AOR AND THE DOCUMENTS SHALL
BE MARKED AS "NO EXCEPTIONS TAKEN"

FOLLOWING THE REVIEW AND/OR COMMENTS MADE BY THE AOR, 2 SETS OF
THE STAMPED TRUSS DOCUMENTS SHALL BE RETURNED TO THE OWNER/
BUILDER FOR USE IN THE CONSTRUCTION OF THE PROJECT.

SHOP DXF COORDINATION: THE TRUSS ANCHOR STRAPS AS INDICATED IN
THE CONSTRUCTION DOCUMENTS ARE SUGGESTED STRAPS AND THAT THE
TRUSS ENGINEERED SHOP DRAWING LOADS TAKE PRECEDENCE OVER THAT
INDICATED IN THE CONSTRUCTION DOCUMENTS.
THE UPLIFT LOADS INDICATED FOR EACH TRUSS IN THE ENGINEERED TRUSS
SHOP DRAWINGS MAY BE MATCHED TO STANDARD PRODUCT UPLIFT RATINGS
FOR COMPARABLE UPLIFT CONNECTORS, AND THAT THE PRODUCTS THAT
PROVIDE EQUAL OR GREATER UPLIFT RESISTANCE FOR THE LISTED LOADS
MAY BE USED IN LIEU OF THOSE INDICATED IN THE CONSTRUCTION DOCUMENTS
OR AS APPROVED BY THE BUILDING OFFICIAL.

THE CONTRACTOR SHALL COORDINATE THE TRUSS TO TRUSS ANCHOR
REQUIREMENTS WITH THE TRUSS ENGINEERING SHOP DRAWINGS. SOME OF
THE TRUSS TO TRUSS CONNECTIONS WILL REQUIRE ANCHOR STRAPS IN
ADDITION TO TYPICAL NAILING. ANCHOR DEVICES SHALL BE REQUIRED FOR
ALL JOINTS WITH AN UPLIFT OR GRAVITY LOAD OF 100 LBS OR GREATER.

TRUSSES BEARING ON INTERIOR PARTITIONS WHERE UPLIFT LOADS ARE
PRESENT SHALL REQUIRE ANCHORS OF EQUAL OR GREATER LOAD CAPACITY
THAN THAT INDICATED BY THE TRUSS SHOP DRAWINGS. THE UPLIFT ANCHOR
SYSTEM SHALL BE CONTINUOUS TO THE FOUNDATION.

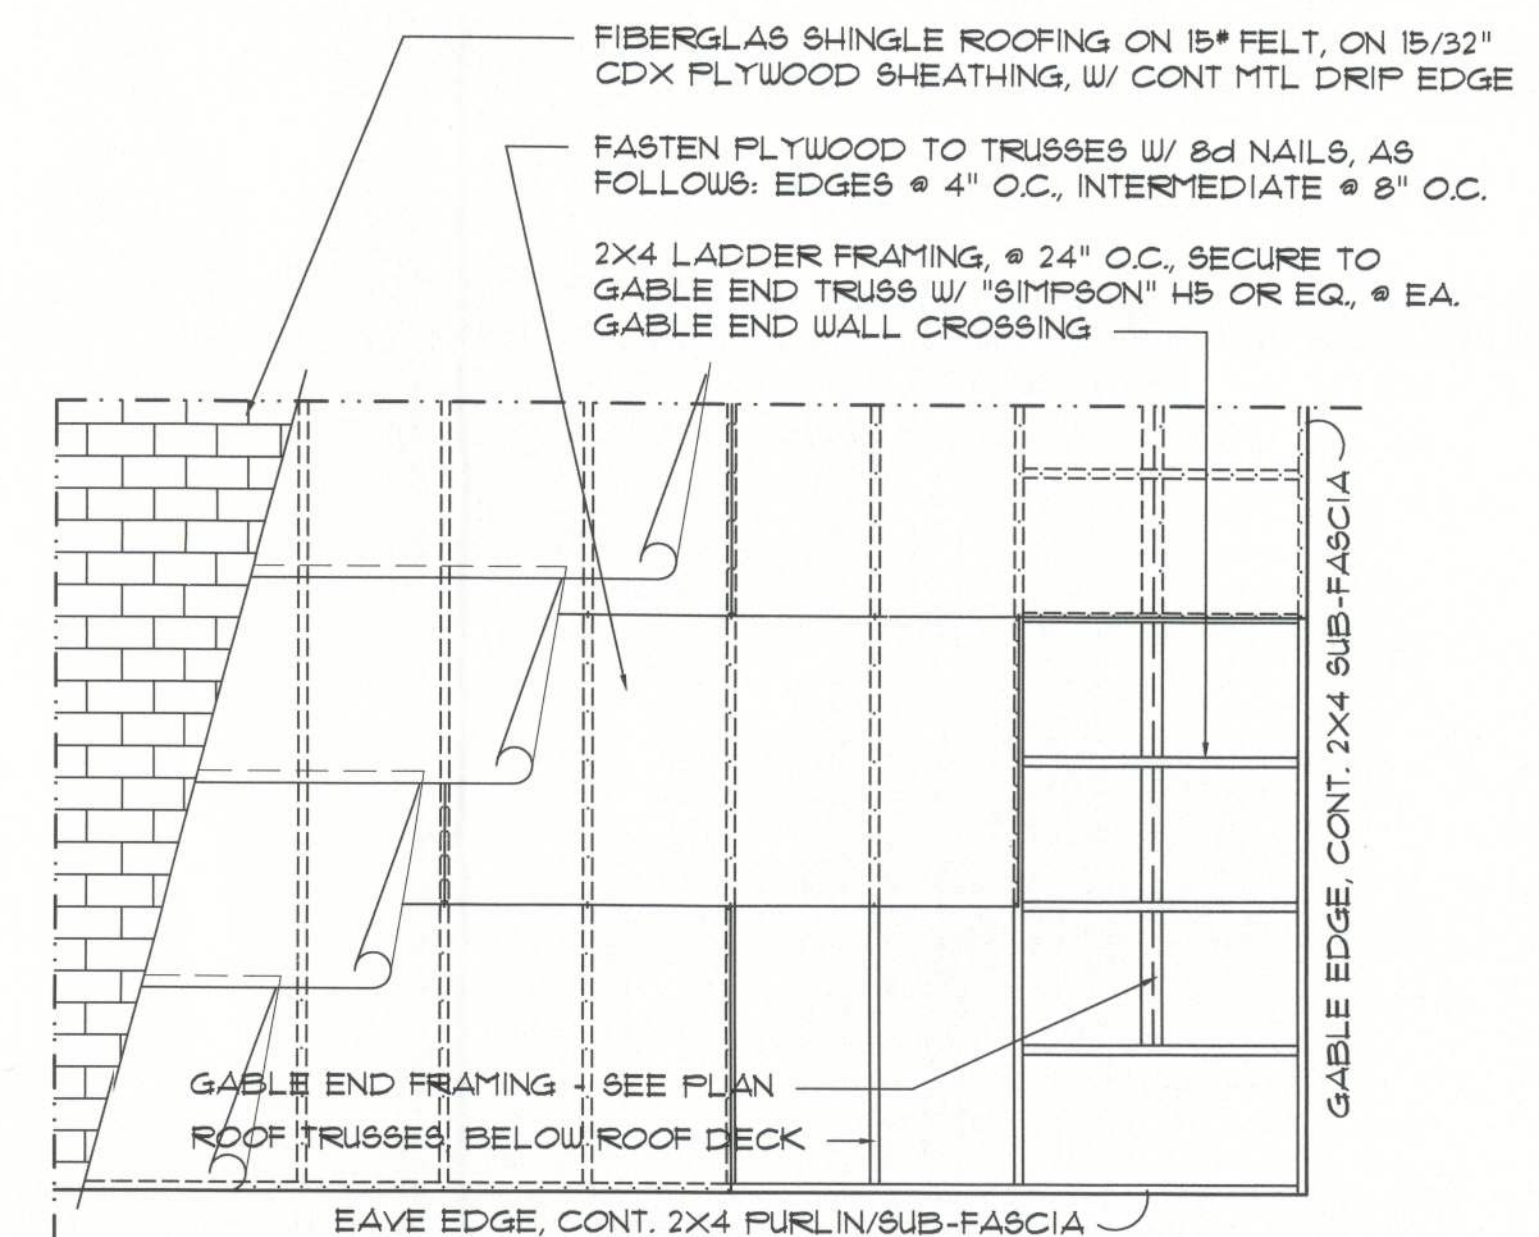

Roof Deck DETAIL

SCALE: 3/8" = 1'-0"

A

REVISION:

27 DEC 2012
08 MAY 2013

Copyright, 2012 ©
N.P. Geisler, Architect

DRAWN:

ppg

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
ROOF PLAN

Celebrating
40 Years of Service
1972 - 2012
N.P. Geisler, Architect
NCA/ARB Certified

**NICHOLAS
PAUL
GEISLER
ARCHITECT**
NCA/ARB Certified
1758 NW Brown Rd.
Lake City, FL 32055
386-365-4355

DATE:

15 NOV 2012

COMM:


2K1287

SHEET:

A.11

11 of 13


ppg
10 May 2013
AR0007005

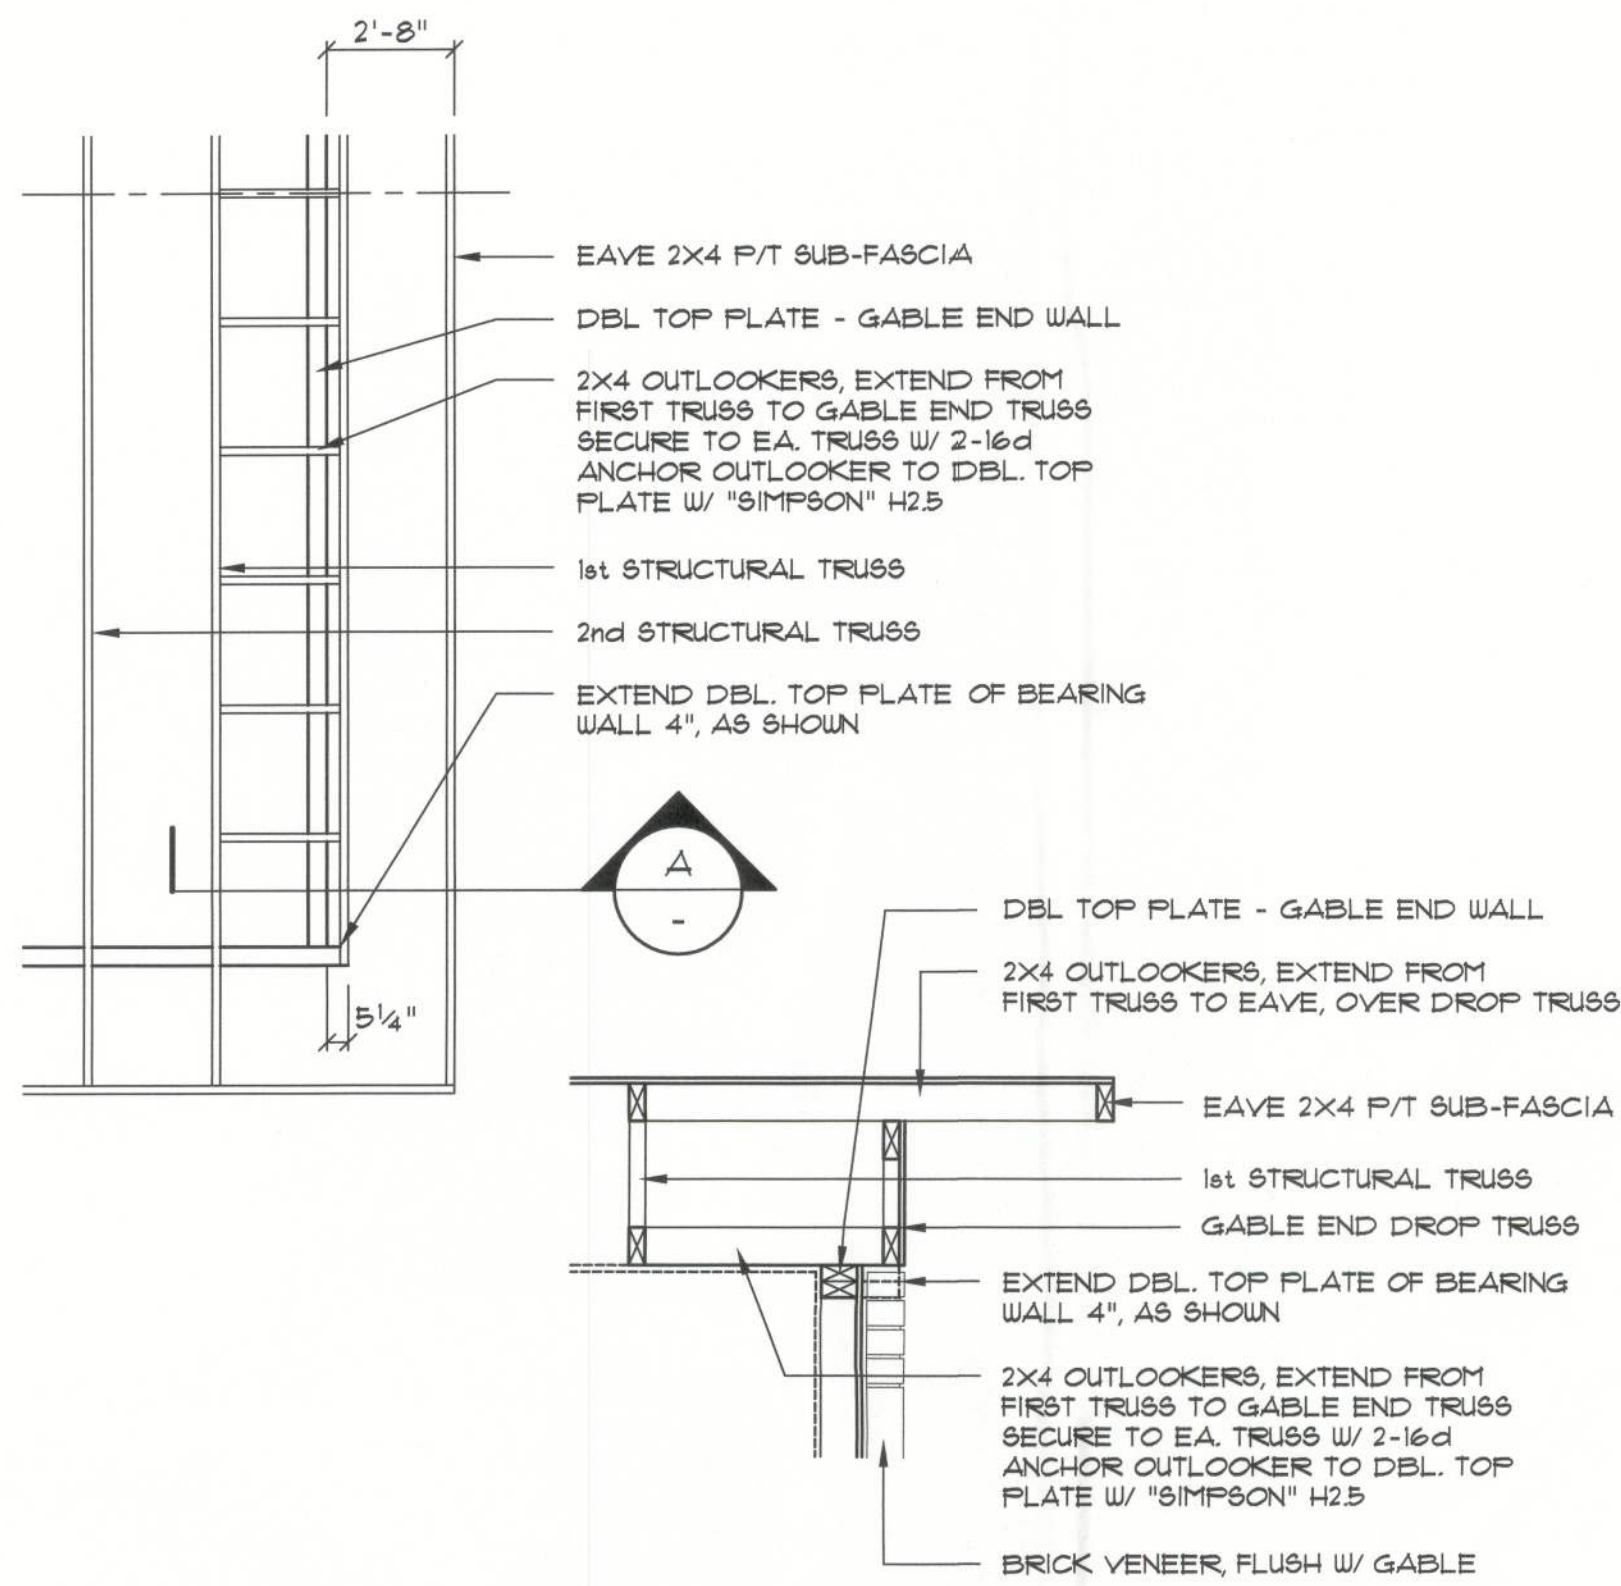

Gable End Wall Extension DETAIL

SCALE: 1/4" = 1'-0"


H

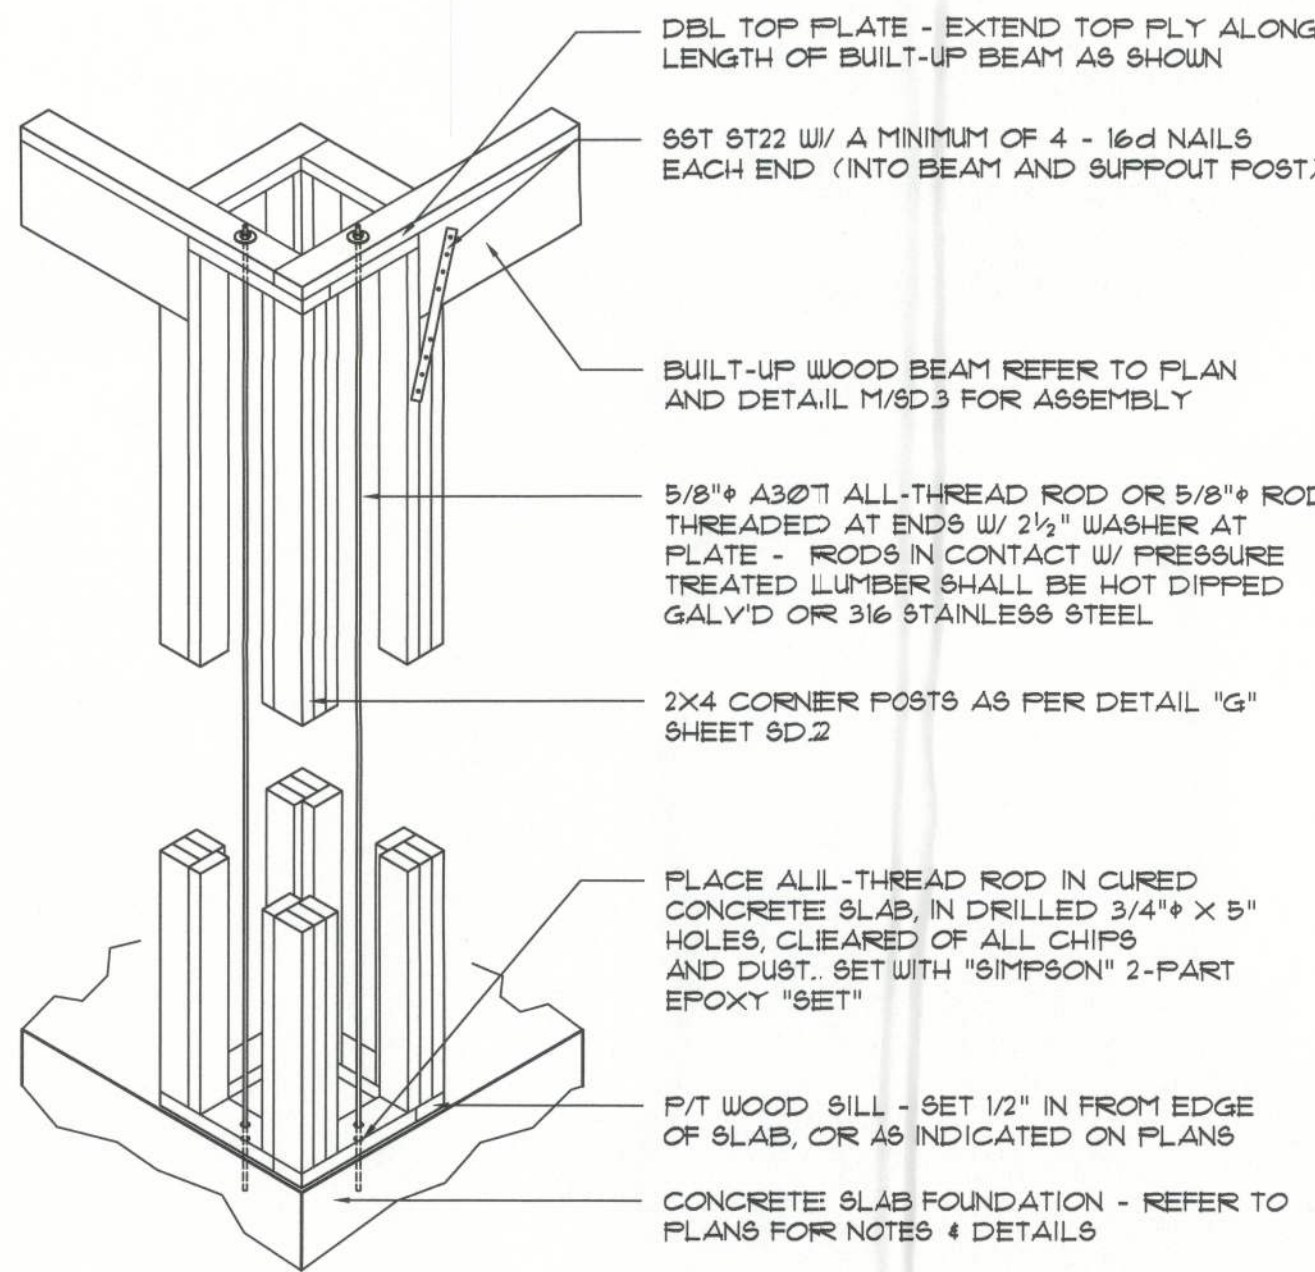

Built-Up Column Thru-Bolt DETAIL

SCALE: 1/2" = 1'-0"


L

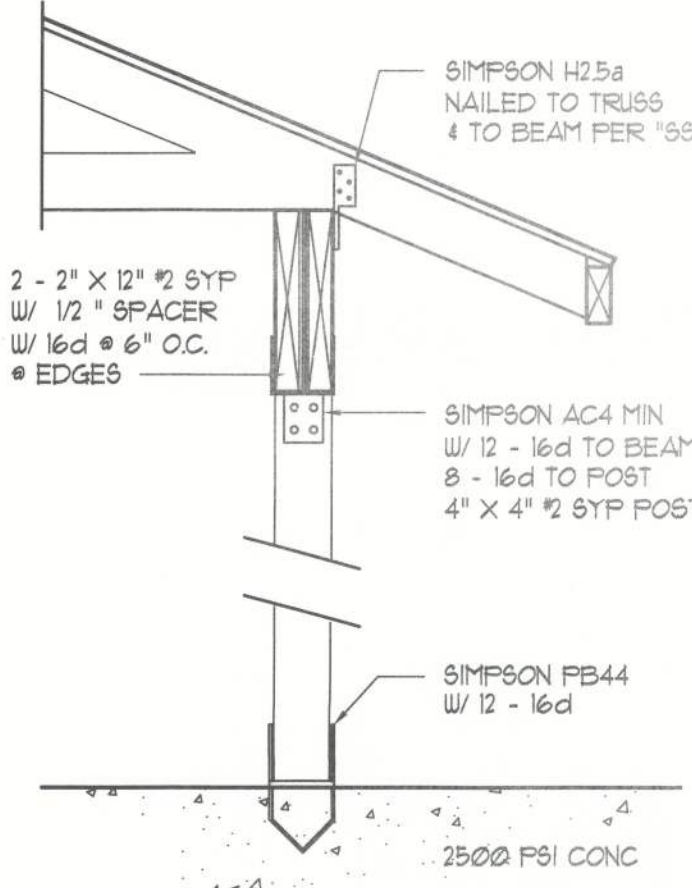

Post/Beam DETAIL


SCALE: 1" = 1'-0"

I

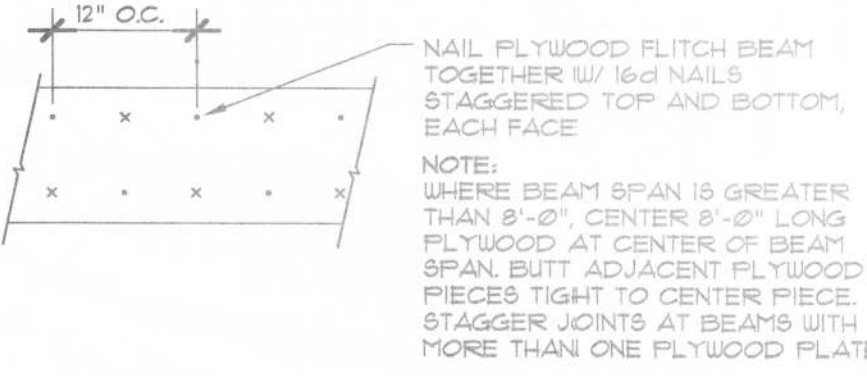


PLYWOOD FLITCH BEAM DETAIL

NOT TO SCALE

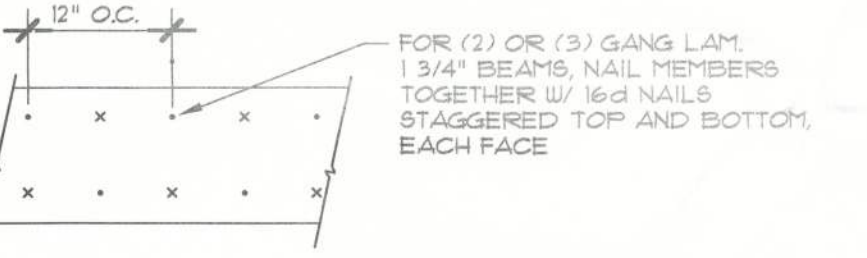

MULTIPLE GANG LAM. DETAIL


NOT TO SCALE

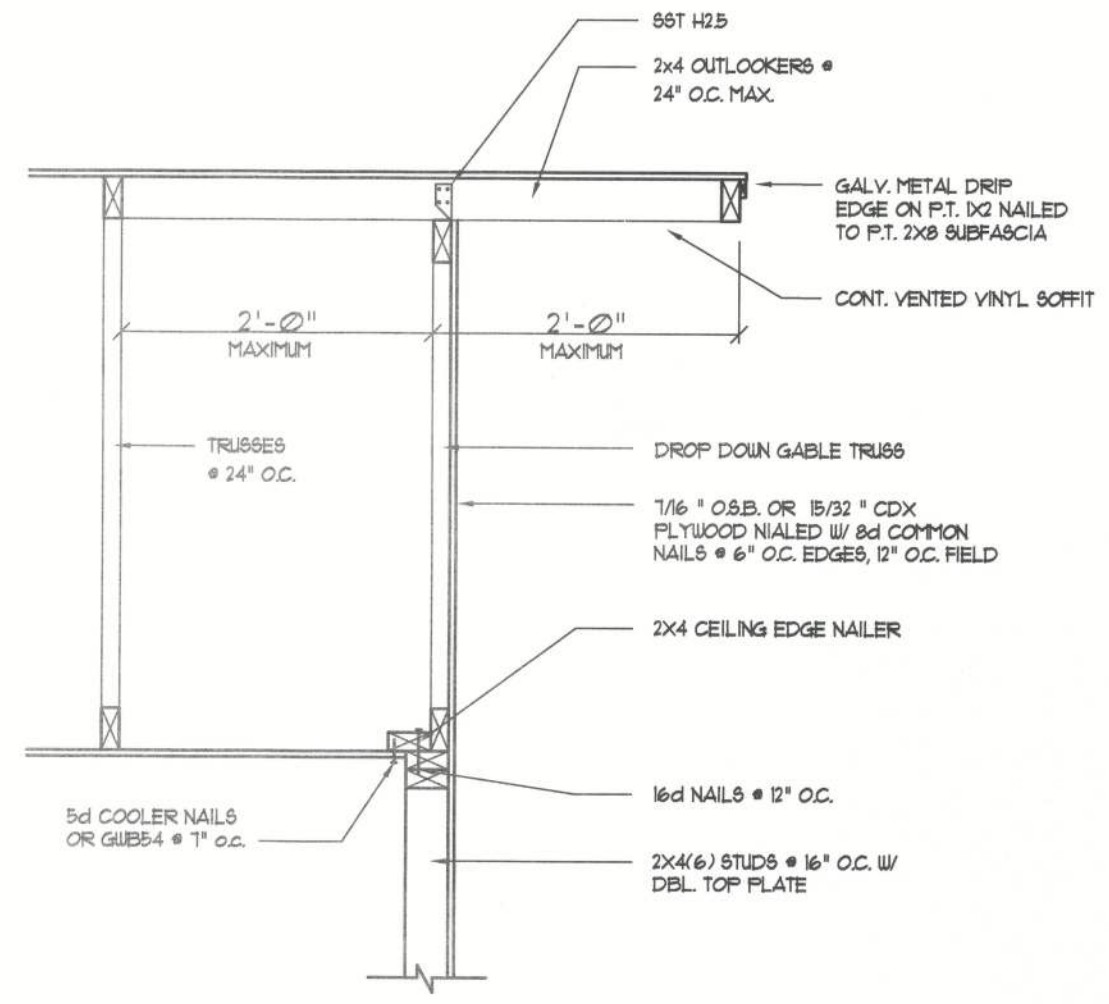

Gable End DETAILS

SCALE: NONE


J

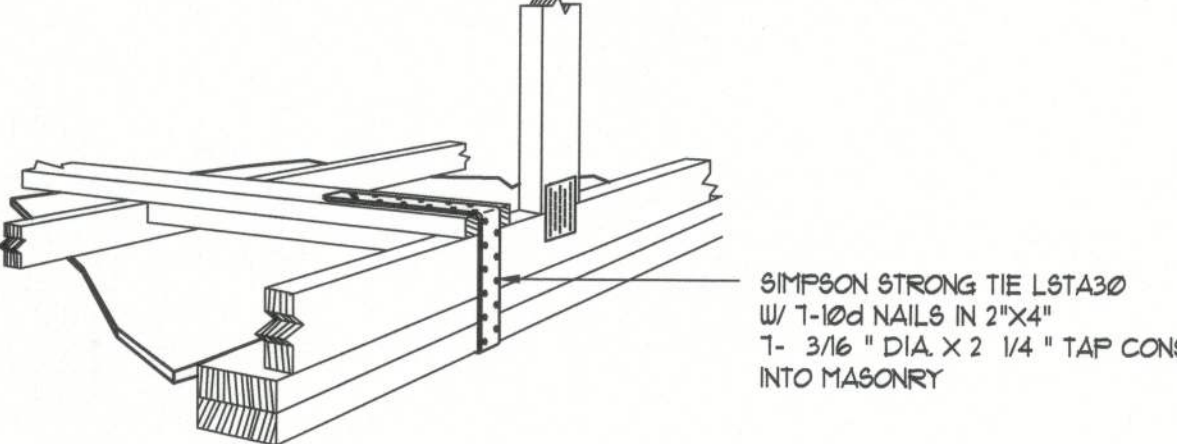

GABLE END GYPSUM DIAPHRAGM HOLDOWN CONNECTOR


SCALE: NONE

K

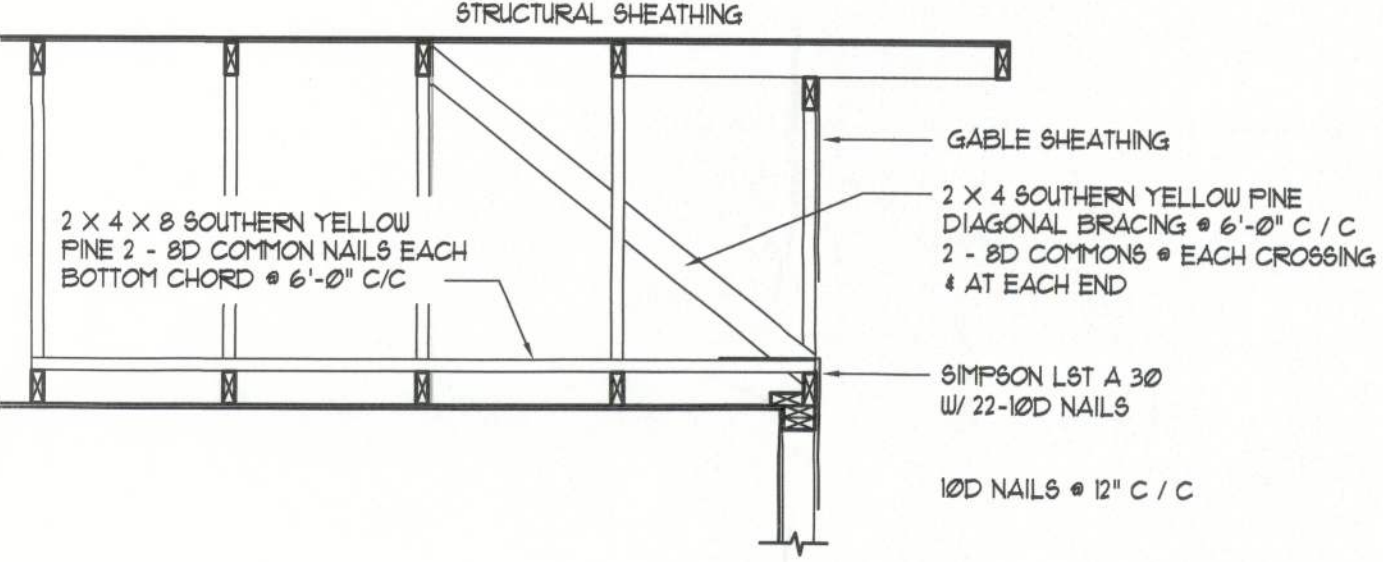

END WALL BRACING FOR CEILING DIAPHRAGM

NTS (ALTERNATIVE TO BALLOON FRAMING)
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW FINE

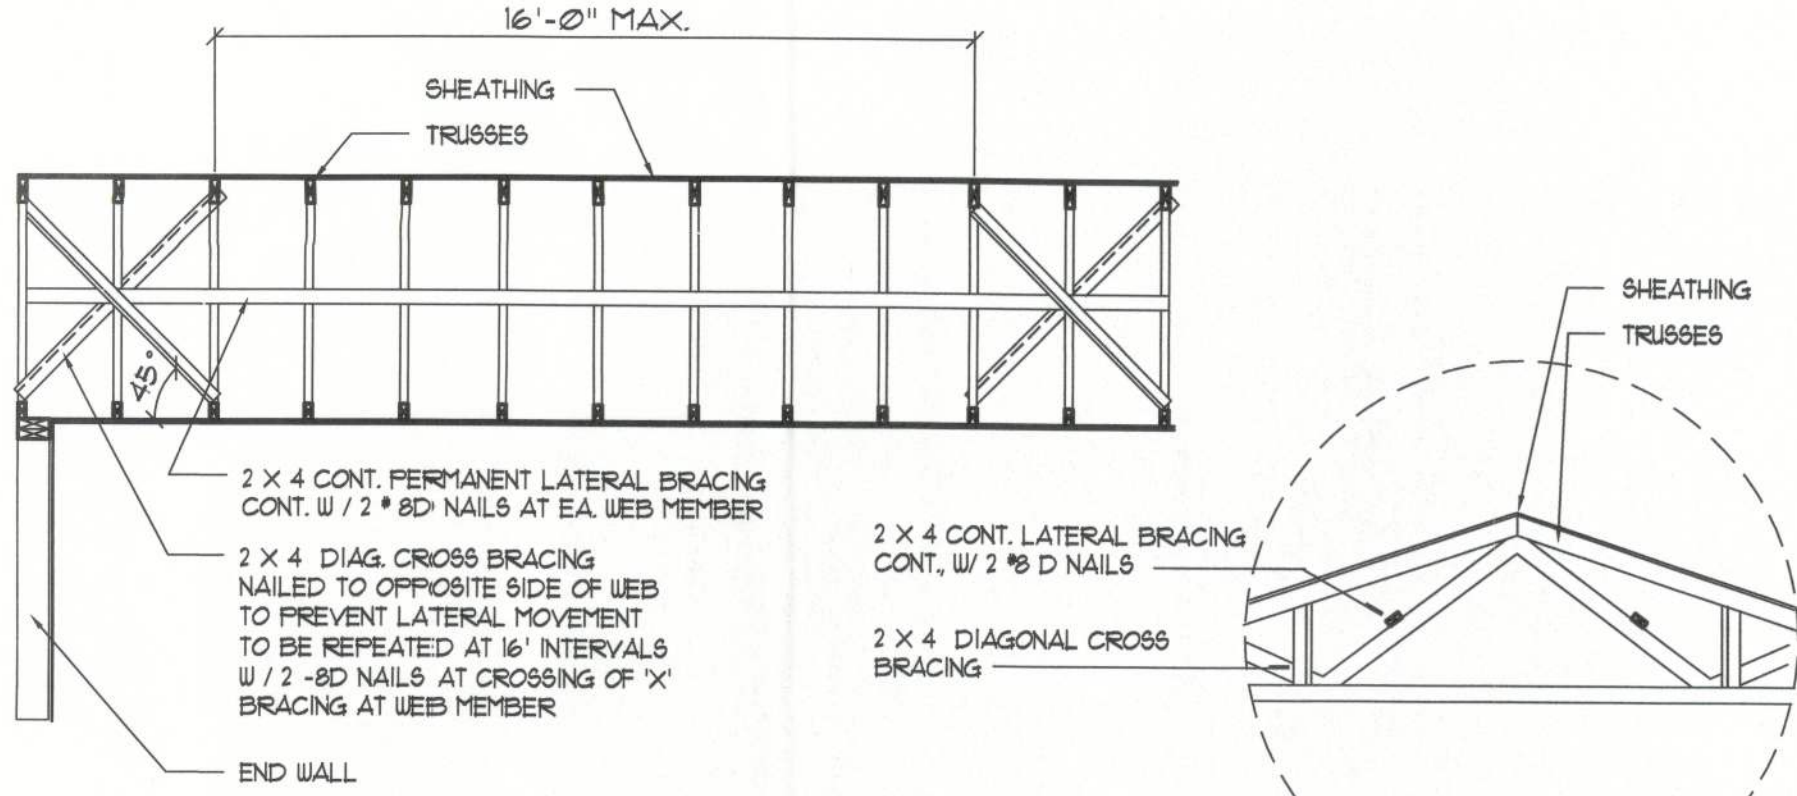

TYP. PERMANENT TRUSS BRACING DIA.


NTS
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW FINE

Truss Bracing DETAILS

SCALE: AS NOTED

O

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1	7/16" O.S.B. OR 15/32 CDX	8d COMMON OR 8d HOT DIPPED GALVANIZED BOX NAILS	6 h.o.c. EDGE 12 h.o.c. FIELD
2			8 h.o.c. FIELD
3			4 h.o.c. GABLE ENDWALL OR GABLE TRUSS 6 h.o.c. EDGE 6 h.o.c. FIELD

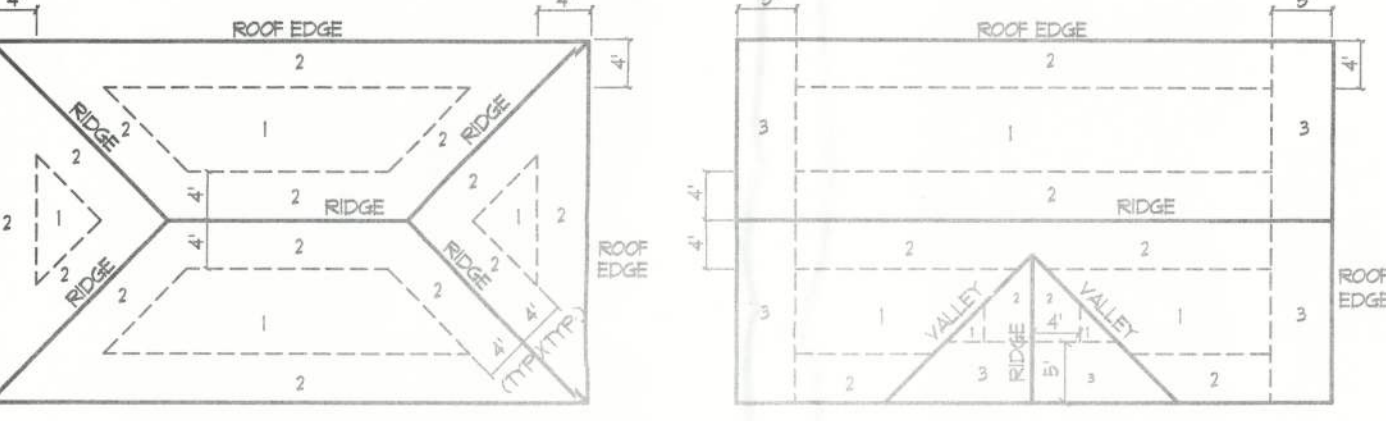

ROOF SHEATHING NAILING ZONES (HIP ROOF) ROOF SHEATHING NAILING ZONES (GABLE ROOF)

Roof Nail Pattern DET.

SCALE: NONE

N

NOTE: DETAILS ON THIS SHEET ARE GENERAL IN NATURE AND ARE NOT TO SCALE. REFER TO SHEET A.1 FOR GENERAL NAILING NOTES AND ANCHOR STRAPS - SEE PLANS FOR SPECIFIC ANCHORING REQUIREMENTS, IF ANY.

REVISION:
Copyright, 2012
N.P. Geisler, Architect
DRAWN:
198
CUSTOM RESIDENTIAL DESIGN FOR:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
WALL & ROOF FRAMING DETAILS

Celebrating
40 Years of Service
1972 - 2012
N.P. Geisler, Architect
1586-7500-7005

NICHOLAS
PAUL
GEISLER
ARCHITECT
1758 NW Brown Rd.
Gainesville, FL 32605
352-350-7500
N. CARB. CERTIFIED

DATE:
15 NOV 2012
COMB:
2K1287

SHEET:
A.12
12 OF 13

10/11/2012
AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

FIELD "AS-BUILT" NOTES

GENERAL NOTES:

1. THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
2. THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. DEFECTS IN MATERIALS, EQUIPMENT, COMPONENTS AND WORKMANSHIP SHALL BE CORRECTED AT NO FURTHER COST TO THE OWNER DURING THE ONE YEAR WARRANTY PERIOD.
3. AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD, FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED. THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
4. THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
5. THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING OF THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNER" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
6. ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
7. ALL WORK SHALL BE IN ACCORDANCE W/ APPLICABLE CODES AND LOCAL REGULATIONS, INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
8. ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT ON THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
9. ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED.
10. INTERIOR BEARING WALLS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333" BATT INSULATION SHALL BE INCLUDED WHERE UNCONDITIONED AREA IS BEING SEPARATED FROM HEATED / COOLED AREA.
11. INTERIOR STUD WALLS SEPARATING LIVING AREA FROM GARAGE AREAS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333", INCLUDING R-II BATT INSULATION.
12. CEILING'S OVER ATTACHED GARAGES OR GARAGES W/ LIVING AREA ABOVE SHALL BE 5/8" FIRECODE "C" GWS ON 1X3 WOOD FURRING AT 16" O.C. ATTACHED W/ 1 1/4" BUGLEHEAD SCREWS @ 6" O.C. ALONG EACH POINT OF BEARING.

AS - BUILT DRAWING REQUIREMENTS:

- A. ELECTRICAL "AS-BUILT" DRAWINGS
ELECTRICAL CONTR SHALL PREPARE "AS-BUILT" SHOP DWGS INDICATING ALL ELECTRICAL WORK INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADD'NG TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT N^o, DESCRIPTION & BRKR. SERVICE ENT. & ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH. RISER DIA SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.
- B. HVAC "AS-BUILT" DRAWINGS
HVAC CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL HVAC WORK, INCLUDING ALL DUCTWORK LOC, SIZES, LINES, EQUIPMENT SCH. & BALANCING REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BLT. DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.
- C. PLUMBING "AS-BUILT" DRAWINGS
PLUMBING CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL PLUMBING WORK, INCLUDING ALL PLUMBING LINE LOCATIONS AND RISER DIAGRAM - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER AND 1 COPY TO THE PERMIT ISSUING AUTHORITY.

TEMPERED GLASS NOTES:

THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING:

1. GLAZING IN SLIDING DOORS AND FIXED AND SLIDING PANELS OF SLIDING (PATIO) DOOR ASSEMBLIES.
2. GLAZING IN DOORS AND WALLS OF ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS AND OTHER SUCH FACILITIES WHERE SUCH GLAZING IS LOCATED 36 INCHES (914 MM) OR LESS, MEASURED HORIZONTALLY, FROM A STANDING OR WALKING SURFACE WITHIN THE ENCLOSURE AND WHERE THE BOTTOM EDGE OF THE EXPOSED GLAZING IS LESS THAN 60 INCHES (1524 MM) MEASURED VERTICALLY, ABOVE SUCH STANDING OR WALKING SURFACES.
3. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24-INCH (610 MM) RADIUS OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES (1524 MM) ABOVE THE FLOOR OR WALKING SURFACE.

EXCEPTION: GLAZING IN WALLS PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION IN GROUP R2 OR WITHIN DWELLING UNITS IN GROUP R2 SHALL BE SUBJECT TO 20204 FBC 2405.2(1)(4).

4. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL, OTHER THAN THOSE LOCATIONS DESCRIBED IN ITEMS 2 AND 3 ABOVE, THAT MEETS ALL OF THE FOLLOWING CONDITIONS:
 41. EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQ FT (824 M²).
 42. BOTTOM EDGE LESS THAN 18 INCHES (457 MM) ABOVE THE FLOOR.
 43. TOP EDGE GREATER THAN 36 INCHES (914 MM) ABOVE THE FLOOR.
 44. ONE OR MORE WALKING SURFACES WITHIN 36 INCHES (914 MM) HORIZONTALLY OF THE PLANE OF THE GLAZING.

GENERAL MILLWORK NOTES:

1. MILLWORK SUB-CONTRACTOR PROVIDING CASEWORK, MILLWORK OR THE LIKE FOR THIS PROJECT SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6 OF THE GENERAL NOTES, THIS SHEET.
2. SCOPE OF WORK INCLUDES, BUT IS NOT LIMITED TO THE FOLLOWING: FABRICATION AND DELIVERY OF MILLWORK SHOWN IN THE DRAWINGS, TO THE JOB SITE, INSTALLATION OF CABINET HINGES, CATCHES, DRAWER & TRAY GUIDES, ADJUSTABLE SHELF STANDARDS & SURFACE BOLTS.
3. ALL APPLICABLE STANDARDS OF "AWI QUALITY STANDARDS & GUIDE SPECIFICATIONS" APPLY TO THIS PROJECT, UNLESS NOTED OTHERWISE.
4. AWI "CUSTOM" GRADE EXCEPT AS OTHERWISE NOTED OR DIRECTED BY THE OWNER, SHALL BE THE BASE STANDARD OF QUALITY REQ'D FOR THIS WORK.
5. MILLWORK SUB-CONTRACTOR SHALL SUBMIT FOR APPROVAL BY THE OWNER, THE FOLLOWING ITEMS, PRIOR TO FABRICATING ANY MAT'L OR MILLWORK: COMPLETE SET OF SHOP DRAWINGS, SAMPLES OF W.D. SPECIES RECEIVING TRANSPARENT FINISH, MFR'S LITERATURE FOR ALL SPECIALTY ITEMS NOT MFD. BY THE ARCHITECTURAL WOODWORK FIRM AND HARDWARE SCHEDULE, SHOWING HARDWARE USED AT EA. LOCATION & CONFORMANCE W/ THE DESIGN INTENT OF THE DRAWINGS OR DIRECTIVES ISSUED BY THE OWNER.
6. PRODUCTS SHALL INCLUDE THE FOLLOWING:
SOFTWOOD - SOLID STOCK PINE, C OR BETTER
HARDWOOD - SPECIES AS SELECTED BY OWNER
PLYWOOD, OPAQUE FINISH - FIR, GRADE A/B
PLYWOOD, TRANSPARENT FINISH - SPECIES AS SELECTED BY OWNER
PARTICLE BOARD - HIGH DENSITY, W/ RESIN BINDER
LAM. PLASTIC - MFG. COLORS, PATTERNS & TEXTURES AS SELECTED BY OWNER
LAMINATING ADHESIVES - POLYVINYL ACETATE, UREA-FORMALDEHYDE, CASEIN
7. ASSEMBLE WORK AT MILL & DELIVER TO JOB SITE READY TO INSTALL INSOFAR AS POSSIBLE.
8. PROTECT MILLWORK FROM MOISTURE & DAMAGE WHILE IN TRANSIT TO THE JOB SITE, UNLOAD AND STORE IN A PLACE WHERE IT WILL BE PROTECTED FROM MOISTURE AND DAMAGE AND BE CONVENIENT FOR INSTALLATION.
9. FABRICATE WORK IN ACCORDANCE WITH MEASUREMENTS TAKEN AT THE JOB SITE.
10. INSTALL HARDWARE IN ACCORDANCE WITH MANUF'R'S DIRECTIONS. LEAVE OPERATING HARDWARE OPERATING SMOOTHLY & QUIETLY.
11. DAMAGED SURFACES SHALL BE REPAIRED TO MATCH UNDAMAGED ADJACENT PORTION OF THE WORK.

GENERAL H.V.A.C. NOTES:

1. SUB-CONTRACTORS PROVIDING HVAC INSTALLATION SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6, GENERAL NOTES & D.I.s.
2. HVAC SUB-CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS, TOOLS AND EQUIPMENT TO INSTALL A COMPLETE & OPERATING HVAC SYSTEM.
3. HVAC SYSTEM SHALL BE AS DETAILED IN THE PLANS (IF INCLUDED), OR SHALL BE AS DIRECTED BY THE OWNER IN CONSULTATION WITH THE HVAC SUB-CONTRACTOR.
4. HVAC SUB-CONTRACTOR SHALL FURNISH SHOP DWGS FOR DUCTWORK, CONDENSING UNIT & AIR HANDLER, EXHAUST FANS AND AIR DEVICES.
5. IT IS THE HVAC SUB-CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH NFPA-90A AND ALL APPLICABLE CODES.
6. FLEXIBLE DUCT SHALL BE FULLY ANNEALED, CORRUGATED ALUMINUM W/ 1 3/4 LB. DENSITY FIBERGLASS INSULATION AND SHALL BE UL LISTED. SHEET METAL DUCT SHALL BE LINED W/ 1" MATFACED DUCT LINER & WRAPPED W/ 1 3/4 LB. FOILFACED FIBERGLASS INSULATION. ALL FIBERGLASS DUCT SHALL BE FOILFACED, R42/R6 @ DUCTBOARD.
7. ALL EXHAUST AND OUTSIDE AIR DUCT SHALL BE GALVANIZED SHEET METAL CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH ASHREA AND SMACNA STANDARDS.
8. ALL AIR DEVICES SHALL BE OF ALUMINUM CONSTRUCTION FOR WALL AND CEILING APPLICATIONS AND STEEL CONSTRUCTION IN FLOOR APPLICATIONS. ACCEPTABLE MANUFACTURER'S SHALL BE TITUS, METALAIR, NAILORHART, HART & COOLIE OR AS DIRECTED BY THE OWNER.
9. IF REQUIRED BY THE OWNER, THE HVAC SUB-CONTRACTOR SHALL SUPPLY & TEST AND BALANCE REPORT IN ACCORDANCE WITH AIR BALANCE COUNCIL STANDARDS, SIGN AND SEALED BY A REGISTERED ENGINEER.
10. HVAC SUB-CONTRACTOR SHALL SUPPLY ALL CONTRACTORS, RELAYS, AND THERMOSTATS. THE ELECTRICAL SUB-CONTRACTOR SHALL PROVIDE ALL SWITCHES, DISCONNECTS & CONTROL WIRING. THERMOSTATS SHALL BE APPROVED BY THE EQUIPMENT MFR.
11. ALL DUCT SIZES INDICATED IN THE PLANS (IF INCLUDED) ARE NET INSIDE DIMENSIONS.
12. ALL EQUIPMENT SHALL BE FULLY WARRANTED FOR 1 YEAR AND THE COMPRESSOR(S) SHALL BE WARRANTED 5 YEARS FROM DATE OF FINAL ACCEPTANCE, BY THE OWNER.
13. ALL WORK IN THIS TRADE SHALL BE COORDINATED WITH ALL OTHER TRADES SO AS TO AVOID CONFLICTS OR HINDERANCE TO COMPLETION OF THE JOB.
14. CONDENSATE DRAIN PIPING SHALL BE INSULATED WITH 1/2" THICK ARMAFLEX INSULATION.
15. FILTERS SHALL BE DISPOSABLE TYPE AND HAVE INITIAL SHARE WEIGHT RESISTANCE OF 10% AND A CLEAN PRESSURE DROP OF 0.15. PROVIDE 2 SETS, ONE DURING CONSTRUCTION AND ONE FOR USE AT FINAL ACCEPTANCE.
16. HVAC SUB-CONTRACTOR SHALL PROVIDE & INSTALL ALL NECESSARY OFFSETS, TRANSITIONS & BENDS REQUIRED TO PROVIDE A COMPLETE SYSTEM AT NO ADDITIONAL COST TO THE OWNER.
17. IT IS THE RESPONSIBILITY OF THE HVAC SUB-CONTRACTOR TO COORDINATE LOCATION OF CEILING DIFFUSERS, GRILLES AND REGISTERS IN THE FIELD WITH THE ELECTRICIAN, LIGHTS AND ARCHITECTURAL ELEMENTS.
18. COORDINATE W/ THE ELECTRICIAN, PARTICULARLY ELECTRICAL NOTE N^o 29, TO ASSURE SUITABLE SIZES OF BREAKERS, SWITCHES AND WIRING.

GENERAL PLUMBING NOTES:

1. SUB-CONTRACTORS PROVIDING PLUMBING MATERIALS AND INSTALLATION SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6.
2. ALL WORKMANSHIP AND MATERIALS SHALL BE IN STRICT ACCORDANCE WITH APPLICABLE LOCAL CODES, RULES AND ORDINANCES.
3. ALL MATERIALS SHALL BE NEW.
4. ALL WORK SHALL BE PERFORMED BY A LICENSED PLUMBING CONTRACTOR IN A FIRST CLASS WORKMANLIKE MANNER. THE COMPLETED SYSTEM SHALL BE FULLY OPERATIONAL.
5. ALL EXCAVATION & BACKFILL AS REQUIRED FOR THIS PHASE OF THE CONSTRUCTION SHALL BE PART OF THE PLUMBING SUB-CONTRACTOR'S RESPONSIBILITIES.
6. PLUMBING FLAT PLANS AND RISER DIAGRAMS (IF INCLUDED) ARE DIAGRAMATIC. DO NOT SCALE THE DRAWINGS FOR EXACT LOCATIONS OF THE PLUMBING FIXTURES.
7. ALL WORK SHALL BE COORDINATED WITH OTHER TRADES TO AVOID INTERFERENCE WITH THE PROGRESS OF THE CONSTRUCTION.
8. WATER PIPING SHALL BE TYPE L COPPER UP TO 1", & TYPE K FOR ALL LARGER SIZES. ALL UNDERGROUND PIPING SHALL BE TYPE K COPPER. AT THE OWNERS OPTION SUPPLY PIPING MAY BE C.P.V.C., SCHEDULE 40 OR SCHEDULE 80.
9. DO NOT USE LEAD BASED SOLDER FOR JOINING SUPPLY PIPING.
10. SOIL, WASTE, VENT & RAINWATER PIPING SHALL BE CAST IRON NO-HUB 301-72 ABOVE GRADE WITH NEOPRENE GASKETS AND STAINLESS STEEL BANDS & BELL & SPIGOT CAST IRON BELOW GRADE W/ LEAD & OAKUM JOINTS OR AT THE OWNERS OPTION, P.V.C., SCHEDULE 40, SEE NOTE 12.
11. AIR CONDITIONING CONDENSATE DRAIN PIPING SHALL BE THREADED STEEL PIPE, COPPER DRAIN, WASTE OR VENT PIPE AND FITTINGS, OR P.V.C., SEE NOTE 12, BELOW. INSULATE ALL CONDENSATE PIPING EXCEPT WHERE UNDERGROUND, AND ELECTRIC HEAT WRAP WHERE EXPOSED TO FREEZING CONDITIONS.
12. P.V.C. SCHEDULE 40 PIPE AND FITTINGS MAY BE USED FOR SOIL, WASTE, VENT, RAINWATER OR CONDENSATE PIPING AS APPROPRIATE, WHERE APPROVED BY LOCAL BUILDING CODES & OFFICIALS. P.V.C. MAY NOT BE USED TO PENETRATE CHASES OR FIRE RATED WALLS / CEILING'S.
13. ALL FIXTURES MUST BE PROVIDED WITH READILY ACCESSIBLE STOPS AND WHERE PROVIDED, MARKED ACCESS PANELS.
14. FURNISH AND INSTALL APPROVED AIR CHAMBERS AT EACH PLUMBING FIXTURE AND APPROVED SHOCK ARRESTERS ON MAIN LINE OR RISERS.
15. DIELECTRIC COUPLINGS ARE REQUIRED BETWEEN ALL DISSIMILAR METALS IN PIPING AND EQUIPMENT CONNECTIONS.
16. ISOLATE COPPER PIPING FROM HANGERS OR SUPPORTS W/ HAIR FELT INSULATOR PADS.
17. PROVIDE 1/2" TRAP PRIMER LINE FOR ALL FLOOR DRAINS FROM NEAREST PLUMBING FIXTURE, DO NOT MANIFOLD.
18. PROVIDE ACCESS PANELS FOR ALL CONCEALED VALVES.
19. PROVIDE COMBINATION COVERPLATE / CLEANOUT PLUG FOR ALL WALL CLEANOUTS, FINISH AS DIRECTED BY THE OWNER.
20. FIXTURES, HARDWARE, EQUIPMENT, COLORS AND FINISHES SHALL BE AS SELECTED BY THE OWNER.

GENERAL WELL & SEPTIC NOTES:

1. SUB-CONTRACTORS PROVIDING WATER WELLS AND/OR SEPTIC TANKS AND DRAINFIELDS SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6, THIS SHEET.
2. LOCATION OF POTABLE WATER WELLS SHALL BE DETERMINED BY THE OWNER IN CONSULTATION WITH THE WELL DRILLING CONTRACTOR. WELLS SHALL NOT BE LOCATED CLOSER THAN 15'-0" TO ANY PROPOSED OR EXISTING SEPTIC TANK OR DRAINFIELD, EITHER ON SUBJECT PROPERTY OR ADJACENT/ADJOINING PROPERTY.
3. POTABLE WATER WELLS SHALL BE A MINIMUM 4" WITH BLACK IRON CASING TO A DEPTH OF 80'-0". PUMPS SHALL BE OF THE SUBMERSIBLE TYPE, THREE WIRE SYSTEM, MINIMUM HORSEPOWER SHALL BE 1/2 H/P OR AS DIRECTED BY THE OWNER. MOTOR STARTER SHALL BE ENCLOSED IN A WEATHERPROOF HOUSING, MOUNTED ON A P/T 4X4 POST AT THE WELL HEAD.
4. WELL HEAD SHALL PROJECT 12" ABOVE GRADE.
5. ALL REQUIRED COMPONENTS FOR A COMPLETE OPERATING SYSTEM SHALL BE PROVIDED, INCLUDING ANTI-FREEZE BLEEDER FITTING, CHECKVALVE, AIR BLEEDERS, SHUTOFF VALVE, HOSE BIBB, PRESSURE REGULATOR/CONTACTOR, UNIONS AND PRESSURE GAUGE.
6. PRESSURE TANK SHALL BE GALVANIZED 82 GALLON CAPACITY, UNLESS DIRECTED OTHERWISE BY THE OWNER.
7. SEPTIC TANK LOCATION & DRAINFIELD INVERT SHALL BE DETERMINED BY THE LOCAL HEALTH DEPARTMENT, IN CONSULTATION W/ THE OWNER.
8. SEPTIC TANKS SHALL BE OF A SIZE & CONSTRUCTION AS DETERMINED BY THE LOCAL HEALTH DEPARTMENT. TANK MAT'L SHALL BE POURED CONCRETE OR FIBERGLASS AS ALLOWED BY THE SEPTIC TANK PERMIT.
9. SEPTIC DRAINFIELDS SHALL BE CONSTRUCTED TO THE STANDARDS OF THE LOCAL HEALTH DEPARTMENT. DRAINFIELD PIPING SHALL BE CLAY TILE OR P.V.C. OR POLY AS ALLOWED BY THE SEPTIC TANK PERMIT. DRAINFIELD BEDS SHALL BE 3/4" WASHED ROCK, INSTALLED THICKNESS SHALL BE AS PER SEPTIC TANK PERMIT.
10. SAND FILTER BEADS, MOUND SYSTEMS, DOSING TANKS, GREASE TRAPS, DISTRIBUTION BOXES, GRINDER PUMPS, BUMP PUMPS AND OTHER SUCH RELATED ITEMS (IF REQUIRED OR REQUESTED) SHALL BE AS PER THE DESIGN STANDARDS OF THE LOCAL HEALTH DEPARTMENT.

ELECTRICAL NOTES: General

1. DO NOT SCALE THE ELECTRICAL DRAWINGS. REFER TO ARCHITECTURAL PLANS AND ELEVATIONS FOR EXACT LOCATION OF ALL EQUIPMENT. CONFIRM WITH OWNER.
2. INSTALL ALL ELECTRICAL WORK IN CONFORMANCE WITH THE NEC 1991 EDITION, AND IT'S AMENDMENTS AS ADOPTED BY THE PERMIT ISSUING AUTHORITY AT THE TIME OF CONSTRUCTION.
3. GROUNDING: GROUND ALL MAIN DISCONNECTS TO STANDARD GROUND ROD(S) AND TO COLD WATER SUPPLY AS PER ARTICLE 250 OF NEC-1994.
4. INSTALL ONLY COPPER WIRING ON THIS PROJECT: THW, TW, THHN, THHN OR NM CABLE, UNLESS NOTED OTHERWISE. ALL CONDUCTORS #10 & SMALLER MAY BE SOLID. ALL CONDUCTORS #8 AND LARGER SHALL BE STRANDED TYPE.
5. PROVIDE CONTINUITY OF NEUTRAL ON MULTI-BRANCH CIRCUITS BY SPLICING AND BRINGING OUT A TAP, ASSURING NO OPENINGS OF NEUTRAL IN REPLACEMENT OF A DEVICE.
6. COLOR CODE MULTI-CIRCUIT WIRING AS FOLLOWS: NEUTRAL - WHITE, GROUND - GREEN, LINE - ALL OTHER COLORS.
7. INSTALL ONLY HIGH POWER FACTOR BALLASTS AT FLUORESCENT FIXTURES.
8. INSTALL GFI BREAKERS OF DEVICES AT ALL BATHROOM, RESTROOM, KITCHEN, GARAGE AND EXTERIOR RECEPTACLES AND AS NOTED ON THE DRAWINGS.
9. INSTALL ONLY THOSE ELECTRICAL DEVICES THAT BEAR A "UL" OR OTHER RECOGNIZED TESTING LAB LABEL. ALL MATERIALS SHALL BE NEW.
10. INSTALL NON-FUSED DISCONNECT SWITCHES AT ALL PIECES OF ELECTRICAL EQUIPMENT LOCATED WHERE SAID EQUIPMENT IS NOT VISIBLE FROM THE CIRCUIT BREAKER THAT PROTECTS IT: SIZE IN ACCORD WITH THE LOAD. ALL DISCONNECT SWITCHES SHALL BE H.P. RATED, HEAVY DUTY, QUICK-HAKE - QUICK-BREAK TYPE - ENCLOSURES SHALL BE AS REQ'D FOR EXPOSURE.
11. MOTOR STARTERS SHALL BE MANUAL OR MAGNETIC WITH OVERLOAD RELAYS IN EACH HOT LEG.
12. ISOLATE DISSIMILAR CONDUIT AND TUBING METALS FROM SOIL, WATER AND GAS PIPING AND OTHER BUILDING MATERIALS WHERE DAMAGE BY FRICTION OR ELECTROLYSIS MAY OCCUR, EXCEPT WHERE ELECTRICAL GROUND IS PROVIDED.
13. FURNISH AND INSTALL ALL ELECTRICAL DEVICES AND ITEMS REQUIRES FOR A COMPLETE, OPERATING SYSTEM, PROVIDING THE FUNCTIONS AS DETAILED IN THE PLANS (AND SPECS).
14. OUTLET BOXES SHALL BE PRESSED STEEL OR PLASTIC OR ALL DRY LOCATIONS. FOR WET LOCATIONS, CAST ALLOY WITH THREADED HUB OUTLET BOXES SHALL BE INSTALLED.
15. HOT CHECK ALL SYSTEMS WITH THE OWNER'S REPRESENTATIVE PRESENT TO VERIFY PROPER FUNCTION PRIOR TO C.O.
16. COORDINATE ALL WORK THROUGH GC TO AVOID CONFLICTS. COORDINATE WITH HVAC CONTRACTOR AND ELECTRONICS SYSTEMS CONTRACTORS SO THAT A COMPLETE, FUNCTIONING SYSTEM IS INSTALLED, IN EACH CASE, WITH NO EXTRA COST TO THE OWNER.
17. EMERGENCY LIGHTING AND EXIT SIGNS, IF INDICATED ON THE PLANS, SHALL BE WIRED PER NEC 100-12F.
18. ALL PANEL SCHEDULES SHALL BE FULLY FILLED OUT AND SHALL BE TYPEWRITTEN. EA. CIRCUIT SHALL BE CLEARLY IDENTIFIED A TO WHAT IS INCLUDED ON SAID CIRCUIT.
19. IT IS NOT THE INTENT OF THESE DRAWINGS TO SHOW EVERY MINOR DETAIL OF THE CONSTRUCTION.
20. THE ELECTRICAL INSTALLATION SHALL MEET ALL STANDARD REQUIREMENTS OF THE POWER COMPANY & TELEPHONE COMPANY.
21. FURNISH AND INSTALL DISCONNECT SWITCHES AND WIRING FOR HVAC SYSTEM AS PER MANUFACTURER'S RECOMMENDATIONS. CONTROLS ARE TO BE SUPPLIED BY THE HVAC CONTRACTOR, AND CONNECTED BY THE ELECTRICAL CONTRACTOR.
22. ALL RACEWAYS BELOW GROUND SHALL BE A MINIMUM OD 3/4".
23. ALL CIRCUIT BREAKERS, TWO AND THREE POLE, SHALL BE COMMON TRIP, NO TIE HANDLES OR TANDEMS SHALL BE ACCEPTABLE.
24. ALL FUSES, UNLESS NOTED OTHERWISE ON THE DRAWINGS, SHALL BE CURRENT LIMITED TYPE (CL) RATED 20000 AIC.
25. ELECTRICAL CONTRACTOR SHALL VERIFY ALL COMPONENTS FOR ALL ELECTRICAL APPLICATIONS & DETERMINE THE CORRECTNESS OF SAME. ANY DISCREPANCY SHALL BE REPORTED TO THE OWNER PRIOR TO FABRICATING ANY MATERIALS, ORDERING COMPONENTS OR DOING ANY WORK.
26. CIRCUITS ON PANEL SCHEDULE (AND PLANS) ARE TO DETERMINE LOAD DATA AND SIZE. THE CONTRACTOR SHALL PROVIDE CIRCUITS AND ROUTING OF CONDUITS AND WIRING TO SUIT JOB CONDITIONS, AND BALANCE THE JOB, THROUGHOUT.
27. CHECK EQUIPMENT FOR PROPER VOLTAGE, PHASE AND AMPERAGE RATING PRIOR TO CONNECTION TO CIRCUITS.
28. PANEL BOARDS SHALL BE CIRCUIT BREAKER TYPE. VERIFY NUMBER AND SIZES OF CIRCUITS.
29. WHEN CONDUIT RUNS EXCEED 200 FEET, FULL BOXES SHALL BE INSTALLED SO THAT NO FULL EXCEEDS THIS DISTANCE.
30. ELECTRICAL EQUIPMENT AIC RATING AND FEEDER SIZE SHOWN ON THE PLANS ARE DESIGNED FOR MAX. AVAILABLE FAULT CURRENT AND MAX. ALLOWABLE VOLTAGE DROP, RESPECTIVELY.

REVISION:

Copyright, 2012
N.P. Geisler, Architect

DRAWN:

198

CUSTOM RESIDENTIAL DESIGN for:
MR. & MRS. J. KASAK
COLUMBIA COUNTY, FLORIDA
GENERAL NOTES

Calculating
40 Years of Service
N.P. Geisler, Architect
1972 - 2012
N.P. Geisler, Architect
Architect
1758 NW Brown Rd.
Lafayette, LA 70505
336-365-4395

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified

DATE:

15 NOV 2012

COMM:

2K1287

SHEET:

A.13

13 OF 13

AR0007005