

(24" WIDE x 12" DEEP FOOTING WITH 3-#5 CONT. REBAR
(20" WIDE x 12" DEEP THICKENED SLAB WITH 3-#5 CONT. REBAR
(VERIFY ALL WITH ENGINEERING)

0000 ELEVATION

ICYNENE INSULATION

SHINGLE ROOFING OVER 30 #1 FELTS FLOORING OVER PER FLOOR. RECOMMENDATIONS OVER 1/2" G.P.B. ROOF SHEATHING INSTALLED PERPENDICULAR TO ROOF TRUSSES WITH STAGGERED END JOINTS. NAILED PER WIND LOAD ENGINEERING

TRUSS TIE DOWN H-10 HURRICANE CLIP TO 200 LBS OR PER TRUSS ENG.

(2) 2x6 TOP PLATES

ALUM DRAIN EDGE 2x6 SUB FASCIA ALUM FASCIA

2x4 BLOCKING • SHEATHING JOINTS

NOTE: ALL PENETRATION THROUGH TOP PLATES TO BE SEALED W/ FIRE CAULK

5/8" GYP. BD. CEILING W/ PLASTER FINISH HEADERS 2x2x8 R. & Y. PINE

2x2" FLAT STRAP TO 100 LBS OF UPLIFT

1/2" GYP. BD. CEILING W/ PLASTER FINISH R-19 BATT OR FOAM INSULATION

HORIZONTAL SIDING APPLIED TO 1/2" OSB WALL SHEATHING W/ HOUSE WRAP FASTEN PER WIND LOAD ENG.

2x6 #2 SPRUCE CONST GRADE OR STR. STUDS • 16" O.C.

VAPOR BARRIER W/ SEALED 6" LAPS OVER TERMITES TREATED, CLEAN, COMPACTED FILL

4" 3000 PSI CONCRETE MIX W/ 6" WELDED WIRE MESH W/ SUPPORTS OR 3000 PSI FIBER MESH CONCRETE MIX

WOOD BASE

P.T. 2x6 BOTTOM PLATE

12"x8" ANCHOR BOLT W/ 2" WASHER SPACED PER ENGINEERING OR 48" O.C. 1/4" FROM CORNERS

8x4 AT EACH SIDE OF ALL OPENINGS

6"x12" STEEL WALL FOUNDATION W/ FILLED CELLS AND 1/2" VERT. REBAR PER WIND LOAD WITH CRUTED JOINTS


GRADE

FT. SIZES AND BAR AS REQ'D

12" MIN DISTANCE BELOW GRADE

TYPICAL WALL SECTION

N.T.S.

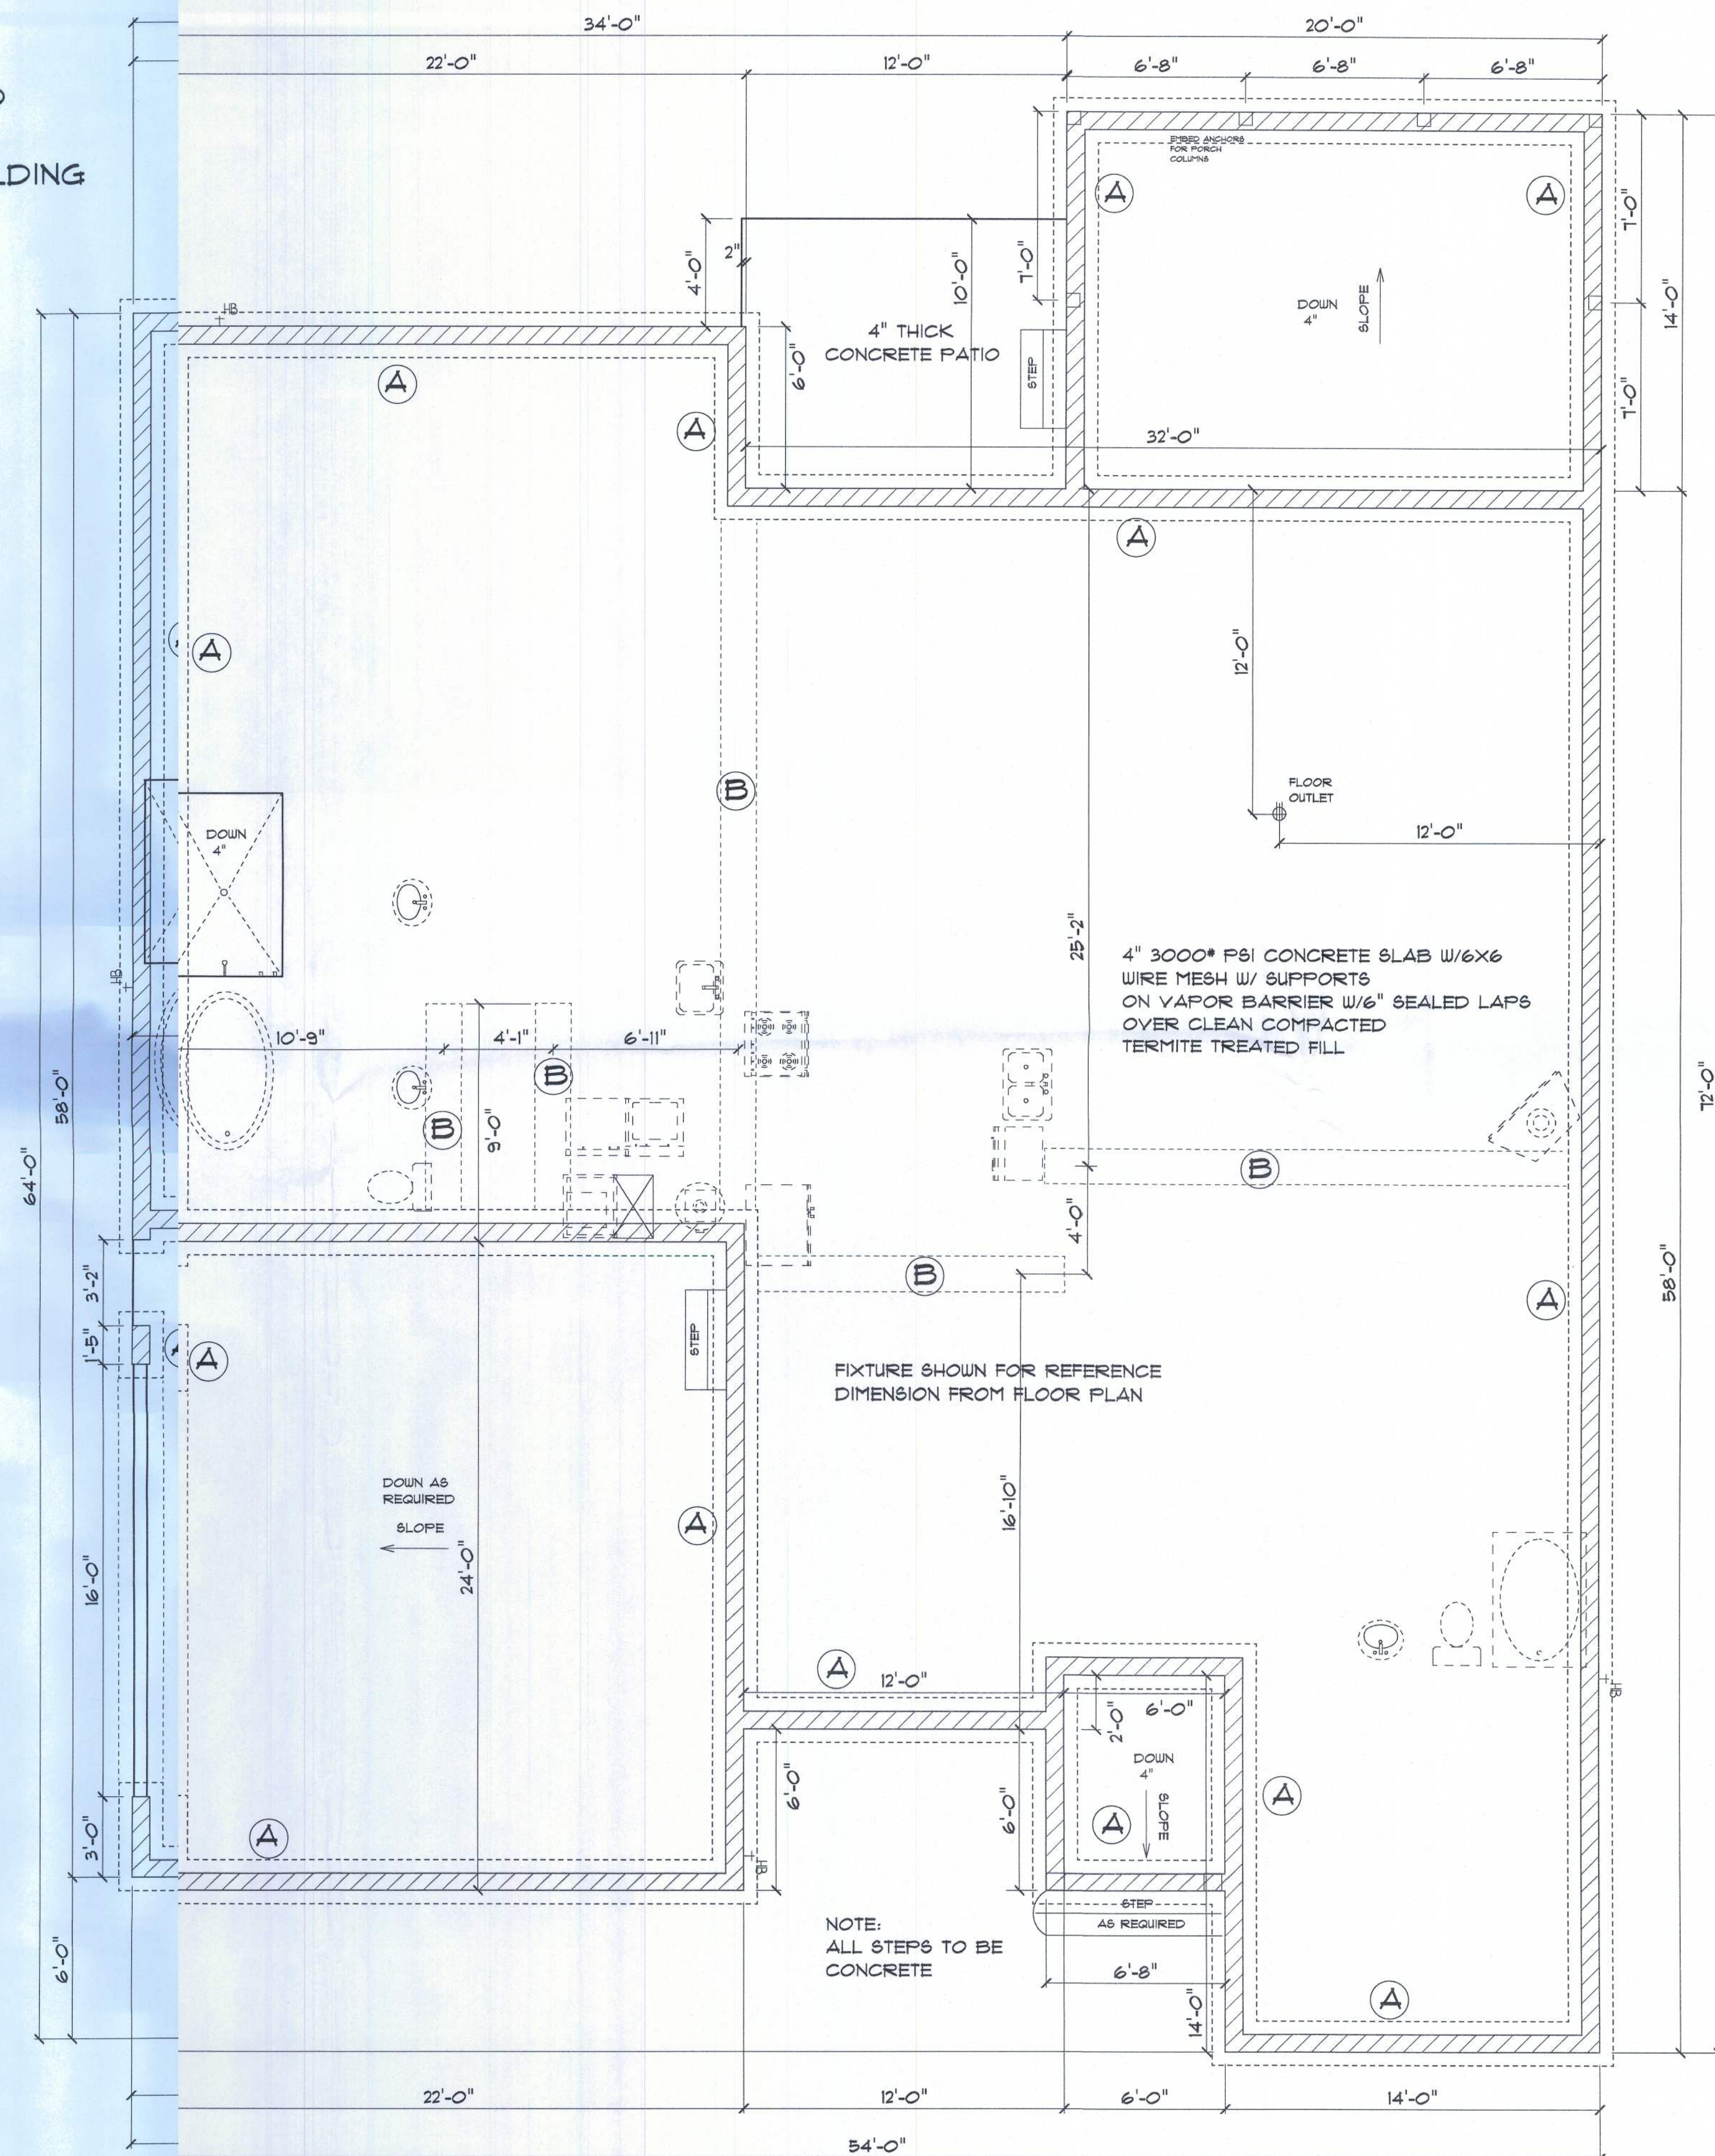

FOUNDATION PLAN