


5/12 PITCH - 24" O/H

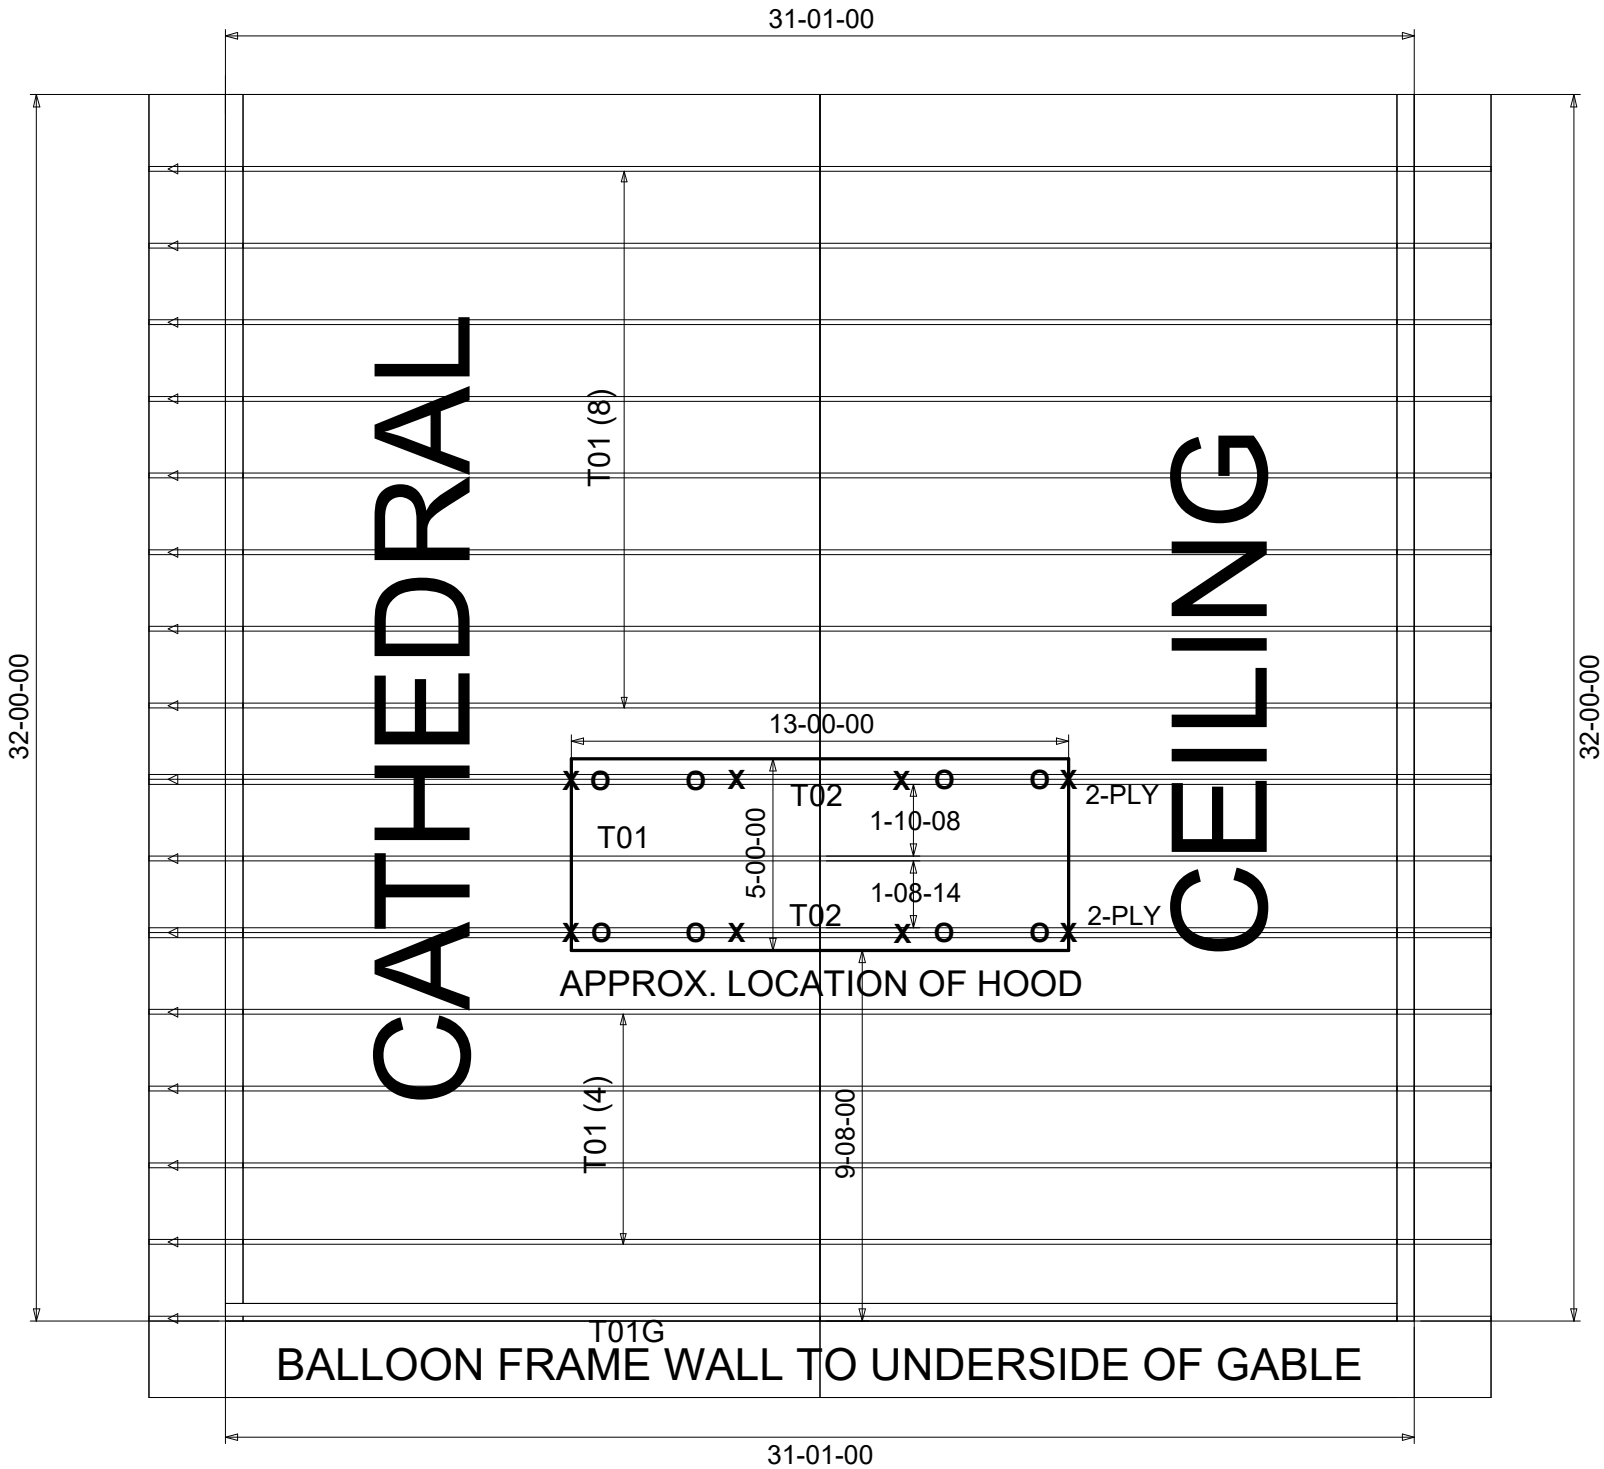

X = HOOD PT LOADS
O = FAN PT LOADS

BEARING HEIGHT SCHEDULE

PER PLAN

NOTES:

1) REFER TO HIB 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING.) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.

2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V105 FOR ALTERNATE BRACING REQUIREMENTS.

3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.

4) ALL TRUSSES ARE DESIGNED FOR 2' o.c. MAXIMUM SPACING, UNLESS OTHERWISE NOTED.

5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.

6) SY42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP.

7) BEAM/HEADER/LINTEL (HDR) TO BE FURNISHED BY BUILDER.

FirstSource

Jacksonville

PHONE: 904-772-6100 FAX: 904-772-1973

Tampa

PHONE: 813-621-9831 FAX: 813-628-8956

Lake City

PHONE: 386-755-6894 FAX: 386-755-7973

BUILDER:

HMI, INC.

LEGAL ADDRESS:

TABERNACLE ADDITION

MODEL:

Revision:

DATE:

DRAWN BY:

Original Reference #:

1st Level Job #:

2nd Level Job #:

3rd Level Job #:

10-15-19

KLH

2135435

1st Level Job #:

2nd Level Job #:

3rd Level Job #:

2135435

FL Approval Codes - Mitek Plates #'s 2197.2 - 2197.4, Versa-Lam #1644-R4 & BCI Joists #1392-R4