



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 4859605 - BIXLER RES.

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: RJH CONSTRUCTION Project Name: Bixler Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: 266 SW Challenger Ave., N/A
City: Lake City State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.


Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8
Wind Code: ASCE 7-22 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 7 individual, Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.


No.	Seal#	Truss Name	Date
1	T38543833	T01	9/16/25
2	T38543834	T01G	9/16/25
3	T38543835	T02	9/16/25
4	T38543836	T03	9/16/25
5	T38543837	T03G	9/16/25
6	T38543838	T04	9/16/25
7	T38543839	T04G	9/16/25



This item has been digitally signed and sealed by Velez, Joaquin, PE on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: Velez, Joaquin
My license renewal date for the state of Florida is February 28, 2027.

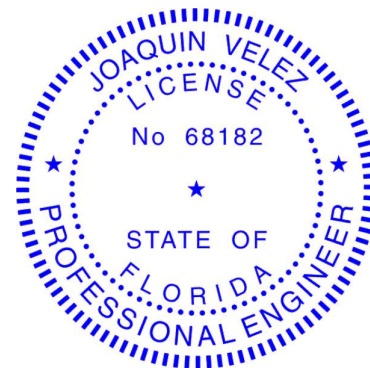

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


September 16,2025

Velez, Joaquin

1 of 1

Job	Truss	Truss Type	Qty	Ply	BIXLER RES.	T38543833
4859605	T01	Common	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:03 2025 Page 1
ID:AK8etWqvJ IEv7bh5_1d3Ryd88S-AHdZ__xSTHv98dDuB_dXTdXvQSZi9TYItuK7gNyd8_2
1-6-0 8-0-0 16-0-0 24-0-0 32-0-0 33-6-0
1-6-0 8-0-0 8-0-0 8-0-0 8-0-0 1-6-0
4x6 == Scale: 3/16"=1'

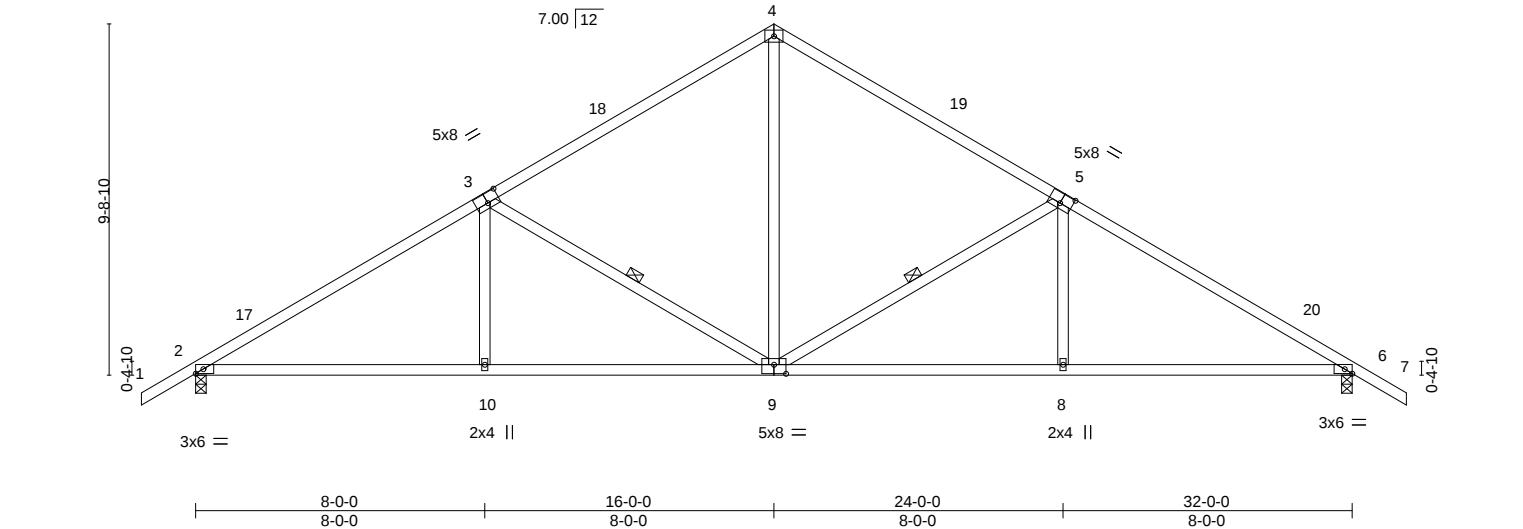

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.80	Vert(LL)	0.11 10-13 >999 240	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.74	Vert(CT)	-0.24 10-13 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.33	Horz(CT)	0.08 6 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 162 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 8-7-1 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 5-9, 3-9

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=-252(LC 10)
Max Uplift 2=-335(LC 12), 6=-335(LC 13)
Max Grav 2=1370(LC 1), 6=1370(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2081/461, 3-4=-1418/377, 4-5=-1418/377, 5-6=-2081/461
BOT CHORD 2-10=-440/1723, 9-10=-440/1722, 8-9=-270/1712, 6-8=-270/1712
WEBS 4-9=-191/866, 5-9=-747/347, 5-8=0/338, 3-9=-747/347, 3-10=0/338

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-8-6, Zone1 1-8-6 to 16-0-0, Zone2 16-0-0 to 20-6-5, Zone1 20-6-5 to 33-6-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=335, 6=335.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:
September 16,2025

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:04 2025 Page 1
 ID:AK8etWqvJ_Ev7bh5_1d3Ryd88S-eUBxKBy4Ea10mno4li8m0r3EHs4YuzNR5Y3gCpyd8_1
 -1-6-0 16-0-0 32-0-0 33-6-0
 1-6-0 16-0-0 16-0-0 1-6-0




LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (6-0-0 max.).
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3	WEBS	1 Row at midpt 12-31

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; C-C for members and forces & MWFRS for reactions shown: Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 2'-0" oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 32, 33, 34, 35, 36, 37, 38, 30, 29, 28, 27, 26, 25, 24, 22.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Date: September 16, 2025



16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	BIXLER RES.	T38543835
4859605	T02	Common	6	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:05 2025 Page 1
ID:AK8etWqvJ_IEv7bh5_1d3Ryd88S-7glJPgzI?u9tOxNHJPf?Z2cElGEcdNyaKCpDIFyd8_0
1-6-0 8-0-0 16-0-0 24-0-0 32-0-0
1-6-0 8-0-0 8-0-0 8-0-0 8-0-0
4x6 = Scale = 1:62.9

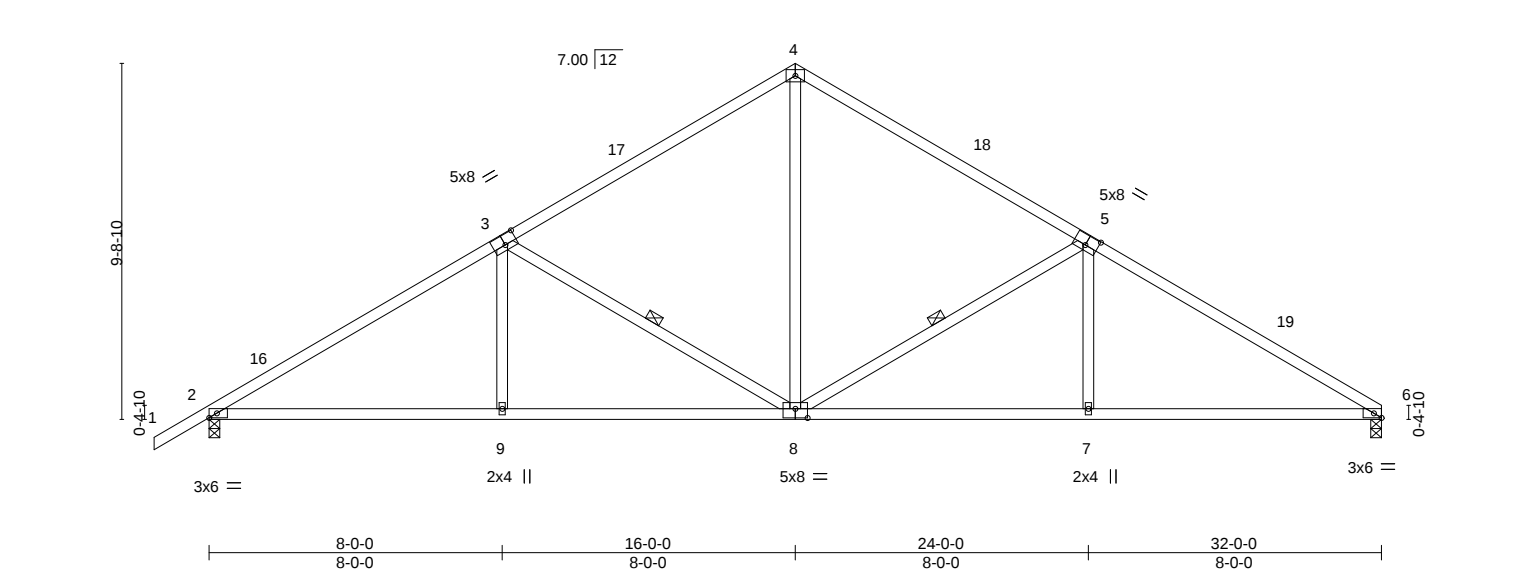


Plate Offsets (X,Y)--		[3:0-4-0,0-3-4], [5:0-4-0,0-3-4], [6:0-2-8,Edge], [8:0-4-0,0-3-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.81
TCDL 10.0	Lumber DOL	1.25	BC 0.75
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.33
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
DEFL.	in (loc)	I/defl	L/d
Vert(LL)	0.13 7-15	>999	240
Vert(CT)	-0.26 7-15	>999	180
Horz(CT)	0.08 6	n/a	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 159 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 8-5-5 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-8, 3-8

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=245(LC 11)
Max Uplift 2=-336(LC 12), 6=-297(LC 13)
Max Grav 2=1372(LC 1), 6=1278(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2085/462, 3-4=-1422/380, 4-5=-1422/378, 5-6=-2095/469
BOT CHORD 2-9=-455/1716, 8-9=-455/1715, 7-8=-307/1726, 6-7=-307/1726
WEBS 4-8=-194/871, 5-8=-760/355, 5-7=0/340, 3-8=-747/347, 3-9=0/338

- NOTES-
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-8-6, Zone1 1-8-6 to 16-0-0, Zone2 16-0-0 to 20-6-5, Zone1 20-6-5 to 32-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=336, 6=297.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017

Date: September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	BIXLER RES.	T38543836
4859605	T03	Common	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:05 2025 Page 1
ID:AK8etWqvJ_IEv7bh5_1d3Ryd88S-7gJPgzi?u9tOxNHJPf?Z2cERGGbdEUaKCpDIFyd8_0

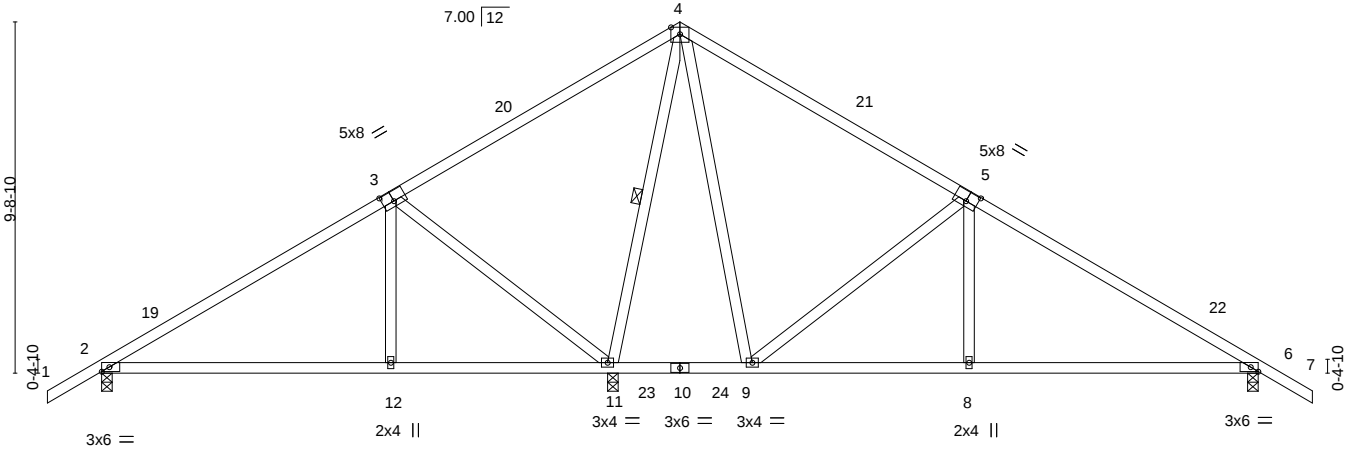



Plate Offsets (X,Y)--	[3:0-3-12,0-3-4], [5:0-3-12,0-3-4], [6:0-2-8,Edge]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.83	Vert(LL) 0.14	12-15	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.62	Vert(CT) -0.25	8-18	>848	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.94	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 171 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-4-13 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3	6-0-0 oc bracing: 9-11.
	WEBS 1 Row at midpt 4-11

REACTIONS. (size) 2=0-3-8, 11=0-3-8, 6=0-3-8
Max Horz 2=-252(LC 10)
Max Uplift 2=-151(LC 12), 11=-330(LC 12), 6=-229(LC 13)
Max Grav 2=573(LC 27), 11=1615(LC 2), 6=836(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-525/231, 3-4=-69/399, 4-5=-284/177, 5-6=-921/257
BOT CHORD 2-12=-246/417, 11-12=-246/417, 8-9=-94/719, 6-8=-94/720
WEBS 4-9=-173/679, 5-9=-831/336, 5-8=0/326, 4-11=-1049/190, 3-11=-724/388, 3-12=-153/323

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-8-6, Zone1 1-8-6 to 16-0-0, Zone2 16-0-0 to 20-6-5, Zone1 20-6-5 to 33-6-0 zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=151, 11=330, 6=229.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:
September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	BIXLER RES.	T38543837
4859605	T03G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:06 2025 Page 1
ID:AK8etWqvJ_IEv7bh5_1d3Ryd88S-bsJic0zKmCHk?5yTs7AE5G9OAFe1MjGkZsYnHyd8_?



		8-0-0		14-0-0		14-1-12 17-10-4		24-0-0		32-0-0	
		8-0-0		6-0-0		0-1-12 3-8-8		6-1-12		8-0-0	
Plate Offsets (X,Y)--		[2:0-4-1,0-1-12], [4:0-4-0,Edge], [5:0-4-0-0-2-11], [6:0-4-0,Edge], [8:0-4-1,0-1-12], [15:0-1-12,0-0-4], [16:0-3-0,0-3-0], [17:0-1-12,0-0-4]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.89		Vert(LL)	-0.11 18-39	>999	240	MT20	244/190
TCDL 10.0		Lumber DOL	1.25	BC 0.48		Vert(CT)	-0.22 18-39	>779	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.78		Horz(CT)	0.01 2	n/a	n/a		
BCDL 10.0		Code	FBC2023/TPI2014	Matrix-MS						Weight: 261 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (2-2-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except:
WEBS 2x4 SP No.3	10-0-0 oc bracing: 2-18,17-18.
OTHERS 2x4 SP No.3	WEBS 1 Row at midpt 5-15, 5-17

REACTIONS. All bearings 0-3-8 except (jt=length) 12=18-0-0, 15=18-0-0, 14=18-0-0, 13=18-0-0, 11=18-0-0, 10=18-0-0.
(lb) - Max Horz 2=-244(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 11, 10, 8 except 2=-107(LC 12), 12=-222(LC 13), 17=-317(LC 12), 15=-120(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 14, 13, 11, 10, 8, 8 except 2=490(LC 27), 12=475(LC 26), 17=1093(LC 2), 17=1006(LC 1), 15=467(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-317/124, 4-5=-175/539, 5-6=-100/447, 6-8=-112/299
BOT CHORD 2-18=-155/311, 17-18=-155/311, 15-17=-258/320
WEBS 5-15=-285/73, 6-12=-417/224, 5-17=-531/208, 4-17=-725/441, 4-18=-150/307

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 10, 8 except (jt=lb) 2=107, 12=222, 17=317, 15=120.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:
September 16,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	BIXLER RES.	T38543838
4859605	T04	Common	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:07 2025 Page 1
ID:AK8etWqvJ_IEv7bh5_1d3Ryd88S-33t4qM_yXVPbDFxQqhTeThku32S5LutoWIKp8yd8__

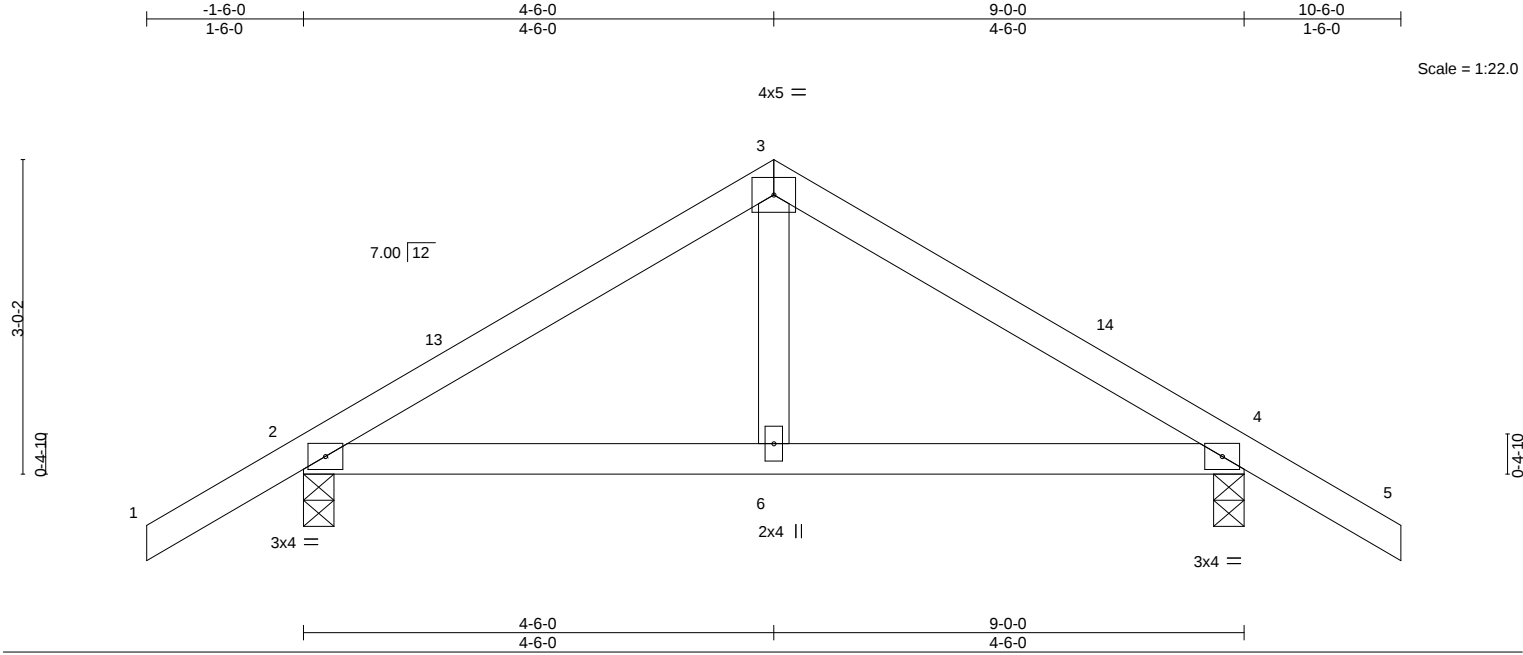

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.19	Vert(LL) 0.02	6-12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.21	Vert(CT) -0.02	6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.08	Horz(CT) 0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 38 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 4=0-3-8
Max Horz 2=-86(LC 10)
Max Uplift 2=-123(LC 12), 4=-123(LC 13)
Max Grav 2=450(LC 1), 4=450(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-428/290, 3-4=-428/290
BOT CHORD 2-6=-131/317, 4-6=-131/317

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-6-0, Zone2 4-6-0 to 8-6-15, Zone1 8-6-15 to 10-6-0 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=123, 4=123.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
Date:

September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.830 s Sep 3 2025 MiTek Industries, Inc. Tue Sep 16 06:46:07 2025 Page 1
ID:AK8etWqvJ_Iev7bh5_1d3Ryd88S-33t4qM_yXVPbdFXfQqhTeThj32j5LYtoWIKp8yd8_

The diagram illustrates a roof truss system with the following components and dimensions:

- Roof Slopes:** The roof slopes are labeled with a vertical dimension of 2-8-1 and a horizontal dimension of 0-4-10.
- Truss Members:**
 - 1:** Left roof slope.
 - 2:** Small roof slope segment.
 - 3:** Roof slope segment with a vertical dimension of 7.00 and a horizontal dimension of 12.
 - 4:** Central vertical post.
 - 5:** Roof slope segment.
 - 6:** Small roof slope segment.
 - 7:** Right roof slope.
- Supports:**
 - 4x6 =** and **4x6 =** at the base corners.
 - 4x5 =** at the top center.
- Internal Bracing/Supports:**
 - 2x4 ||** and **2x4 ||** at the base.
 - 2x4 ||** and **2x4 ||** at the top.
 - 3x4 =** and **3x4 =** on the roof slopes.
- Dimensions:**
 - Horizontal dimensions: 4-6-0, 4-6-0, 9-0-0, 4-6-0.
 - Vertical dimensions: 2-8-1, 0-4-10, 7.00, 12.

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (6-0-0 max.).
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS. (size) 2=0-3-8, 6=0-3-8
 Max Horz 2=-78(LC 10)
 Max Uplift 2=-126(LC 12), 6=-126(LC 13)
 Max Gray 2=447(LC 1), 6=447(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-406/345, 4-6=-406/345
BOT CHORD 2-8=-177/334 6-8=-177/334

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDD=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TP1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=126, 6=126.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd.
Chesterfield, MO 63017

Date: September 16, 2025




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DS-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-USA.com

Symbols

PLATE LOCATION AND ORIENTATION

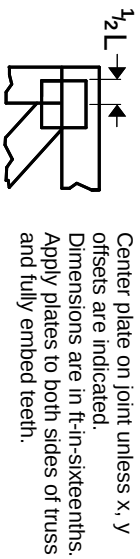

0- $\frac{1}{16}$ "

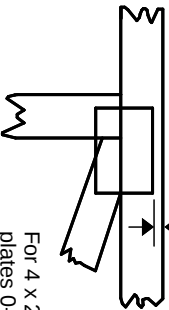

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—
This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

1 2 3 Joint ID typ.

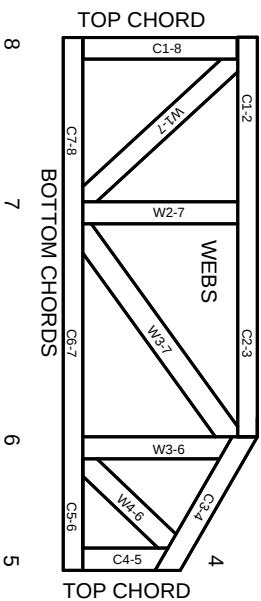

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.