

HUDSON RESIDENCE  
11.63 kW PV SYSTEM  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

Castillo

Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250,

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

| REVISIONS   |      |     |
|-------------|------|-----|
| DESCRIPTION | DATE | REV |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

SUNPRO

ERMOCRATES E. CASTILLO

FLORIDA PROFESSIONAL ENGINEER

NO. 52590

Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.09.15 16:33:52

PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

G-01

PROJECT DESCRIPTION:

31x375 LG NEON2: LG375N1C-A6 (375) MODULES  
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES  
SYSTEM SIZE: 11.625 kW DC STC  
ARRAY AREA #1: 39.03 SQ FT.  
ARRAY AREA #2: 253.67 SQ FT.  
ARRAY AREA #3: 312.21 SQ FT.

EQUIPMENT SUMMARY

31 LG NEON2: LG375N1C-A6 (375) MODULES  
31 ENPHASE: IQ7PLUS-72-2-US MICROINVERTERS  
01 ENPHASE ENCHARGE 10 BATTERY  
01 ENPHASE ENPOWER SWITCH


RACKING: UNIRAC LIGHT RAIL  
ATTACHMENT: UNIRAC FLASHLOC

DESIGN CRITERIA:

WIND SPEED (ULT): 120 MPH  
WIND SPEED (ASD): 93 MPH  
RISK CATEGORY: II  
EXPOSURE: B

CODES AND STANDARDS

GOVERNING CODES :  
FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 (FRC)  
FLORIDA PLUMBING CODE, 7TH EDITION 2020 (FPC)  
FLORIDA BUILDING CODE, 7TH EDITION 2020 (FBC)  
FLORIDA MECHANICAL CODE, 7TH EDITION 2020 (FMC)  
NATIONAL ELECTRICAL CODE 2017 (NEC)  
ASCE 7-16

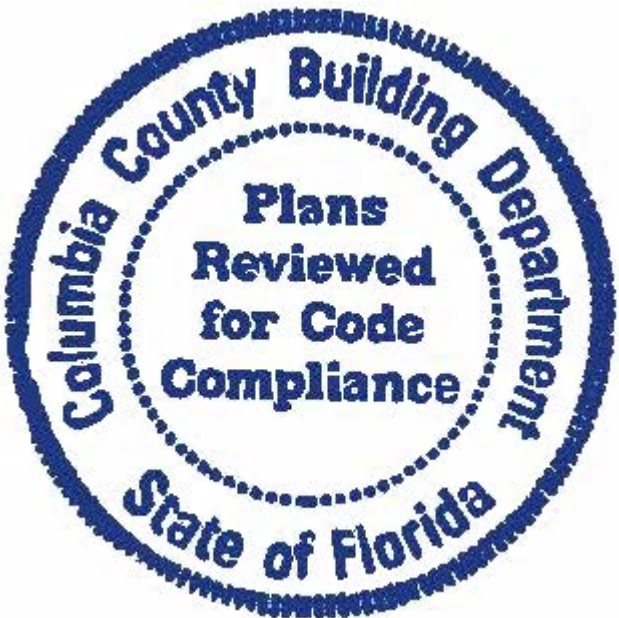

OWNER

HUDSON, RYAN

INSTALLER

SUNPRO SOLAR  
4492 Eagle Falls Place,  
Tampa, FL 33619  
PH: (866) 450-1012

ENGINEER

Castillo Engineering Services LLC  
620 N. Wymore Road, Suite 250, Maitland, FL 32751  
TEL: (407) 289-2575  
Ermocrates E. Castillo  
License#: FL PE 52590

SHEET INDEX

| SHEET #  | SHEET DESCRIPTION                     |
|----------|---------------------------------------|
| G-01     | COVER SHEET                           |
| A-00     | NOTES AND DESCRIPTION                 |
| A-01     | ROOF PLAN                             |
| S-01     | MODULE LAYOUT                         |
| S-01.1   | PARTIAL PRESSURE AND MODULES EXPOSURE |
| S-02     | ATTACHMENT DETAIL                     |
| S-02.1   | STRUCTURE CALCULATION                 |
| E-01     | ELECTRICAL LINE DIAGRAM               |
| E-02     | WIRING CALCULATIONS                   |
| E-03     | SYSTEM LABELING                       |
| DS-01-09 | DATA SHEETS                           |
|          |                                       |
|          |                                       |

HOUSE PHOTO



VICINITY MAP



STRUCTURAL CERTIFICATION:

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7th ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES, AND EQUIPMENT DEAD LOADS.

ELECTRICAL CERTIFICATION:

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.

Symbols:

Section.....

Sheet where section is located

Elevation .....

Detail ID Letter  
Sheet where section is located

Detail .....

Detail ID Letter  
Sheet where section is located

Detail .....

Detail ID Letter  
Area to be enlarged  
Sheet where section is located

Keyed Notes .....

1

Keyed note designation on applicable sheet

Ground Terminal .....

Grounding Point/rod....

Solar Panel .....

or 00

Module with Source Circuit number

Combiner Box .....

CB

AC Disconnect .....

ACD

Main Distribution Panel .....

MDP

Fuse .....

Overcurrent Breaker ..

Inverter .....

Transformer .....

Automatic .....

ATS

Transfer Switch

Vent, Attic fan (Roof obstruction)

PV Roof Attachment

Trusses

Conduit

Fire Access

Abbreviations:

|        |                               |
|--------|-------------------------------|
| AC     | Alternating Current           |
| ACD    | AC Disconnect                 |
| APPROX | Approximate                   |
| AWG    | American Wire Gauge           |
| BAT    | Battery                       |
| CB     | Combiner Box                  |
| DC     | Direct Current                |
| DISC   | Disconnect                    |
| (E)    | Existing                      |
| EL     | Elevation                     |
| EQ     | Equal                         |
| GP     | Generation Panel              |
| JB     | Junction Box                  |
| MCB    | Main Combiner Box             |
| MFR    | Manufacturer                  |
| MID    | Microgrid Interconnect Device |
| MIN    | Minimum                       |
| MISC   | Miscellaneous                 |
| MDP    | Main Distribution Panel       |
| (N)    | New                           |
| NAVD   | North American Vertical datum |
| OCPD   | OverCurrent Protection Device |
| POCC   | Point Of Common Coupling      |
| PV     | Photovoltaic                  |
| SF     | Squarefoot/feet               |
| STC    | Standard Test Conditions      |
| SD     | Soladeck                      |
| TBD    | To Be Determined              |
| TYP    | Typical                       |
| UNO    | Unless Noted Otherwise        |
| UM     | Utility meter                 |
| VIF    | Verify In Field               |
| WP     | Weather Proof                 |

System Description

This system is a grid-tied, PV system, with PV generation consisting of 31x375 LG NEON2: LG375N1C-A6 (375W) Modules with a combined STC rated dc output power of 11,625W. The modules are connected into 31 Enphase: IQ7PLUS-72-2-US microinverters. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electrical Code*.

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

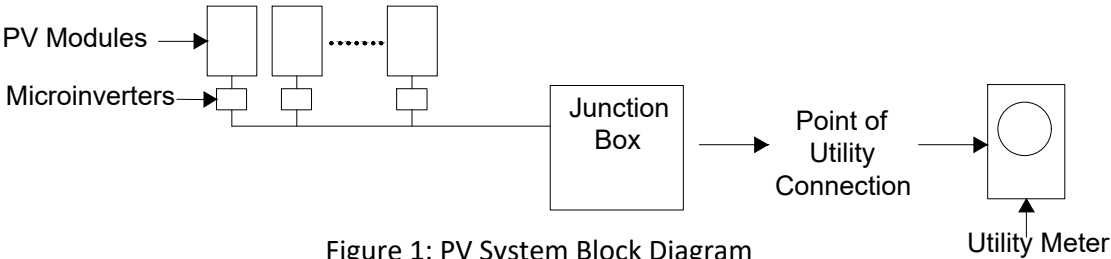


Figure 1: PV System Block Diagram


The inverter meets the requirements of IEEE 1547 and UL 1741.

**FALL PROTECTION:**  
ANCHORAGES USED FOR ATTACHMENT OF PERSONAL FALL ARREST EQUIPMENT MUST BE INDEPENDENT OF ANY ANCHORAGE BEING USED TO SUPPORT OR SUSPEND PLATFORMS, AND CAPABLE OF SUPPORTING AT LEAST 5,000 POUNDS PER EMPLOYEE ATTACHED, OR MUST BE DESIGNED AND USED AS FOLLOWS:

- AS PART OF A COMPLETE PERSONAL FALL ARREST SYSTEM WHICH MAINTAINS A SAFETY FACTOR OF AT LEAST TWO.
- UNDER THE SUPERVISION OF A QUALIFIED PERSON

**ADDITIONAL INFORMATION**

- 29 CFR 1926 SUBPART M, FALL PROTECTION. OSHA STANDARD.
- 1926.502, FALL PROTECTION SYSTEMS CRITERIA AND PRACTICES
- ... 1926.502(D)(15)

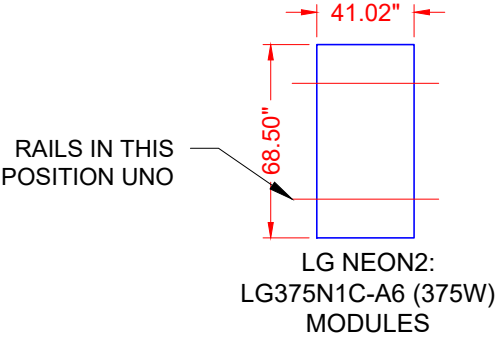

| ALLOWABLE/DESIGN PRESSURE | PSF |
|---------------------------|-----|
| DOWN PRESSURE             | 125 |
| UPLIFT PRESSURE, 2 RAILS  | 88  |

**Castillo Engineering**  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

**SUNPRO**

Digitally Signed by: Ermocrates E Castillo  
Date: 2021.09.15 16:33:52

PROJECT NAME



HUDSON RESIDENCE

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME  
NOTES AND DESCRIPTION

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
A-00

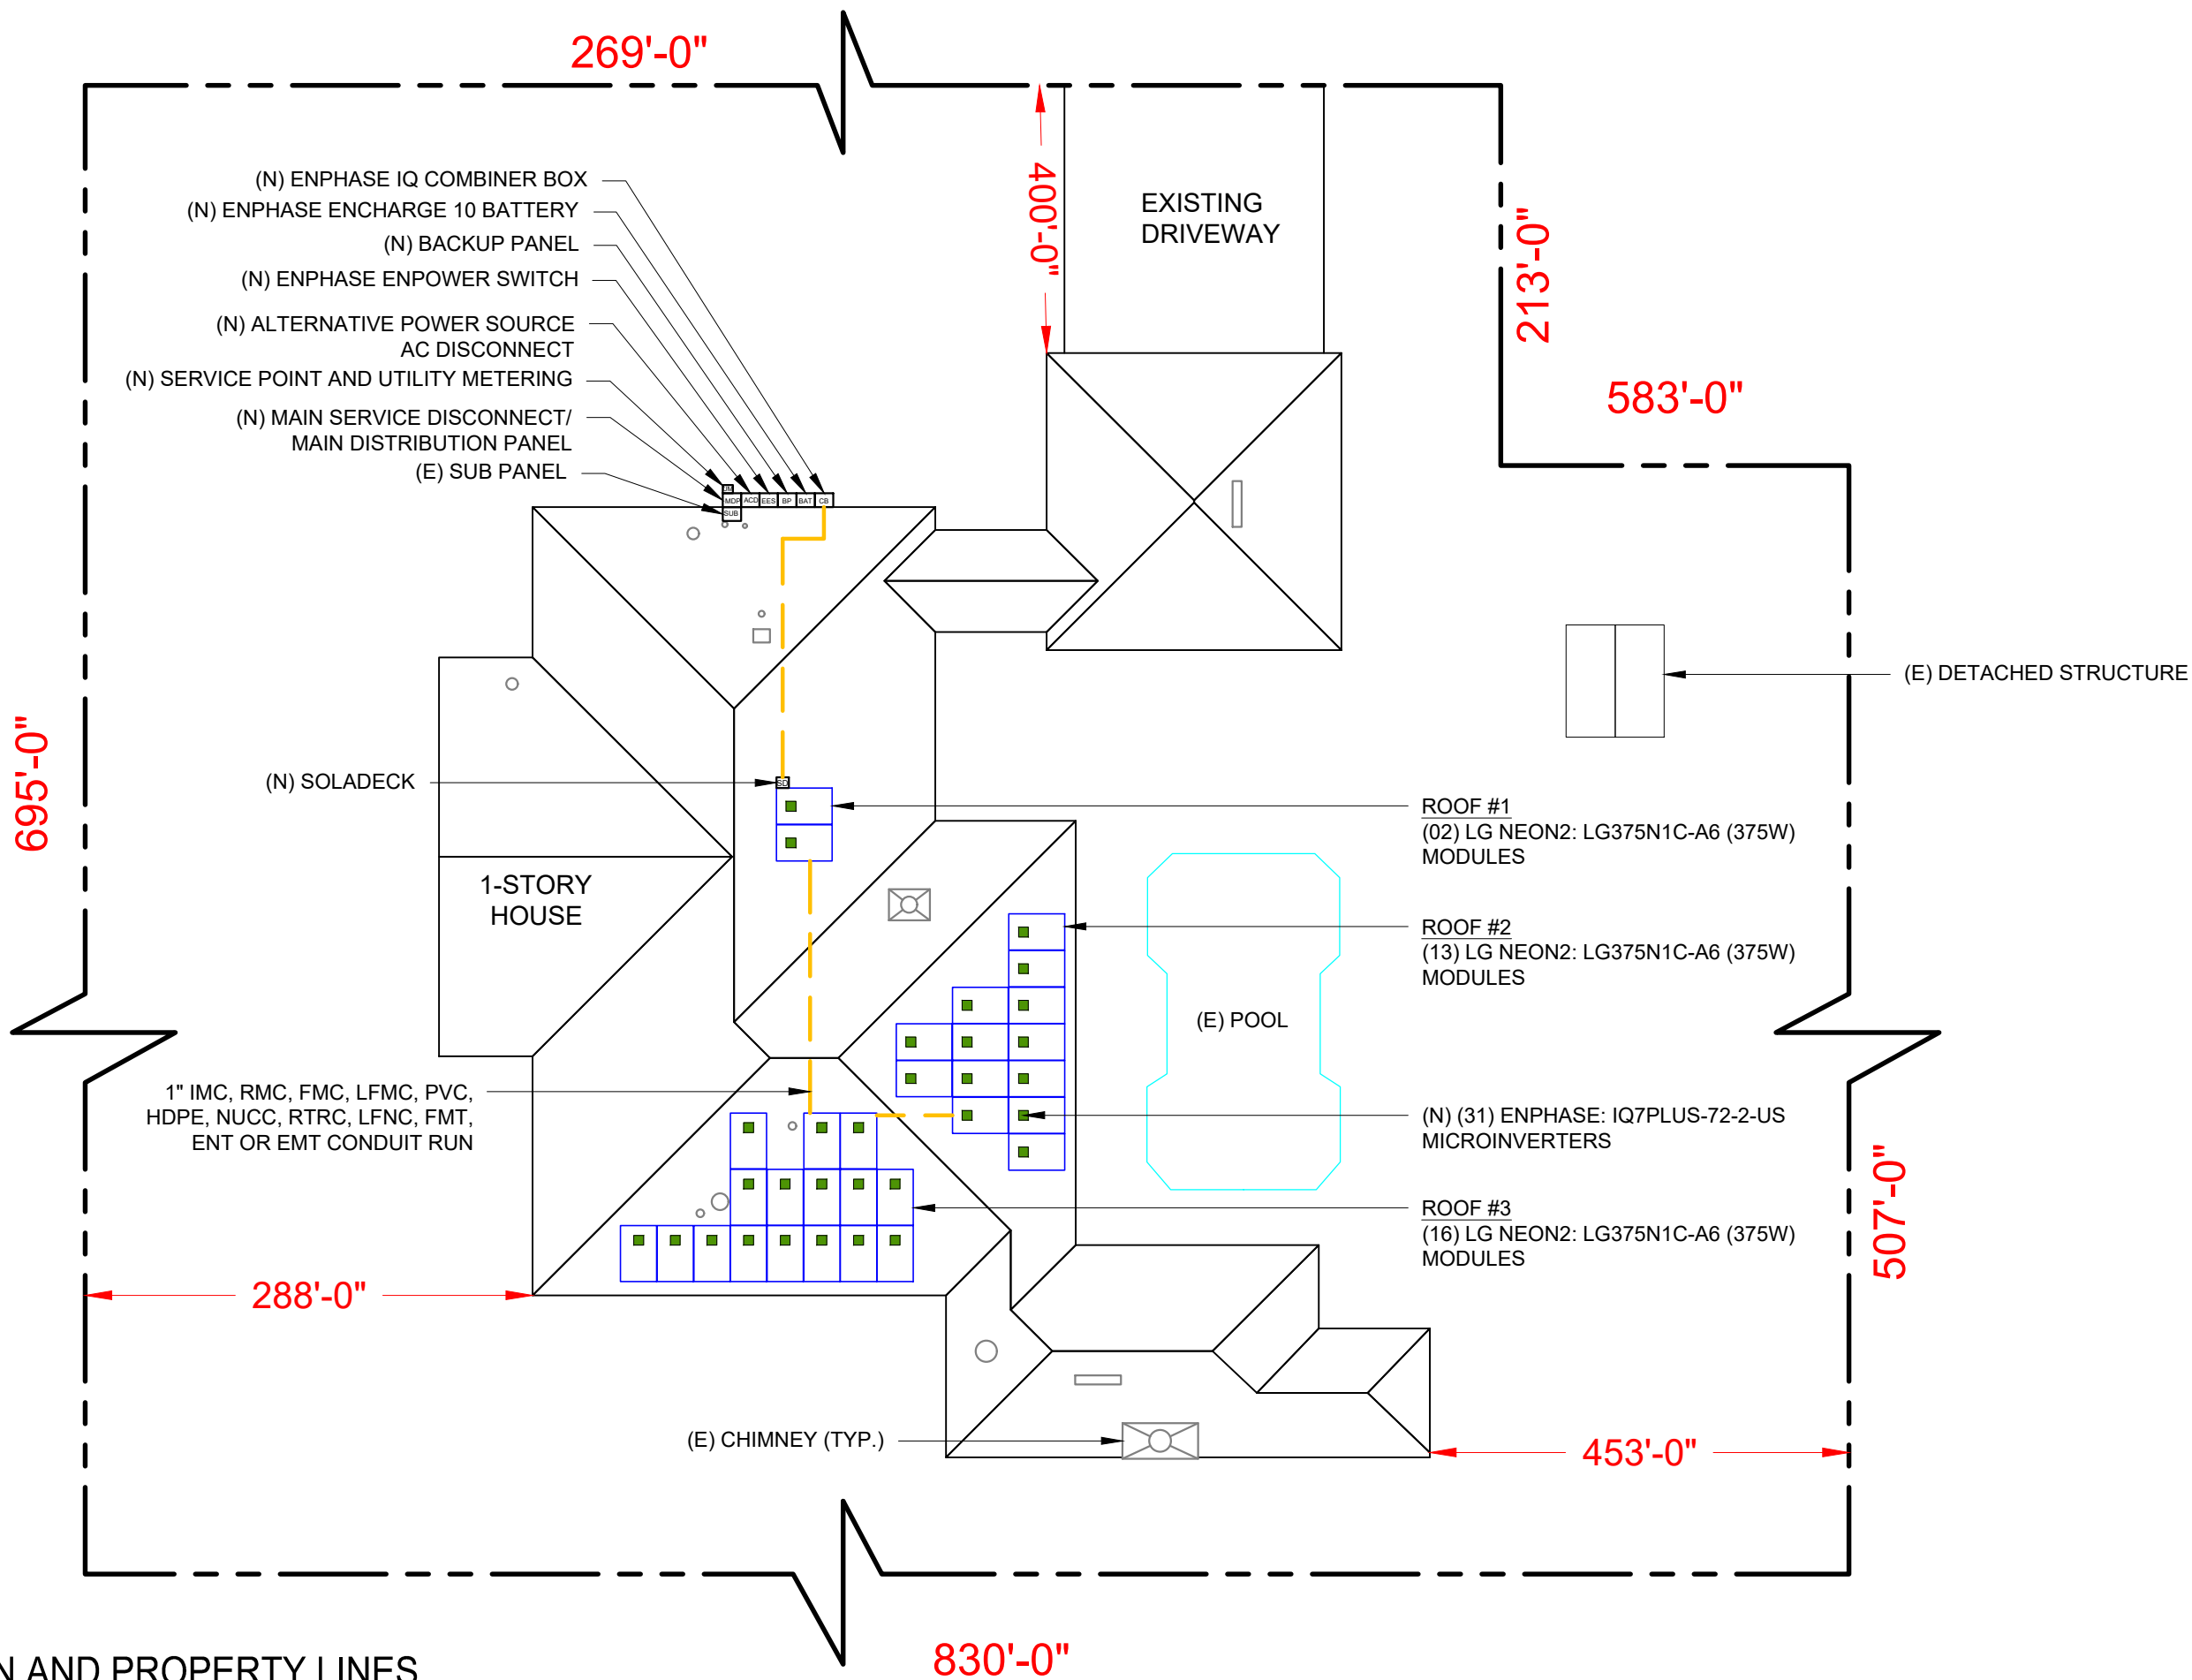

**Castillo Engineering**  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

| REVISIONS   |      |     |
|-------------|------|-----|
| DESCRIPTION | DATE | REV |
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

(E) DETACHED STRUCTURE

Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.09.15 16:33:53

PROJECT NAME

**HUDSON RESIDENCE**

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

ROOF PLAN

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

A-01


MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 31 MODULES  
MODULE TYPE = LG NEON2: LG375N1C-A6 (375W) MODULES  
MODULE WEIGHT = 41.01 LBS / 18.6 KG.  
MODULE DIMENSIONS = 68.50"x 41.02" = 19.51 SF  
UNIT WEIGHT OF ARRAY = 2.10 PSF



| ARRAY AREA & ROOF AREA CALC'S |                 |                     |                     |                                |       |         |            |               |
|-------------------------------|-----------------|---------------------|---------------------|--------------------------------|-------|---------|------------|---------------|
| ROOF                          | ROOF TYPE       | ARRAY AREA (sq.Ft.) | ROOF AREA (Sq. Ft.) | ROOF AREA COVERED BY ARRAY (%) | TILT  | AZIMUTH | TRUSS SIZE | TRUSS SPACING |
| #1                            | ASPHALT SHINGLE | 39.03               | 539.13              | 7.24                           | 22.6° | 90°     | 2"X4"      | 24" O.C.      |
| #2                            | ASPHALT SHINGLE | 253.67              | 509.66              | 49.77                          | 22.6° | 90°     | 2"X4"      | 24" O.C.      |
| #3                            | ASPHALT SHINGLE | 312.21              | 608.57              | 51.30                          | 22.6° | 180°    | 2"X4"      | 24" O.C.      |

(E) FRONT YARD

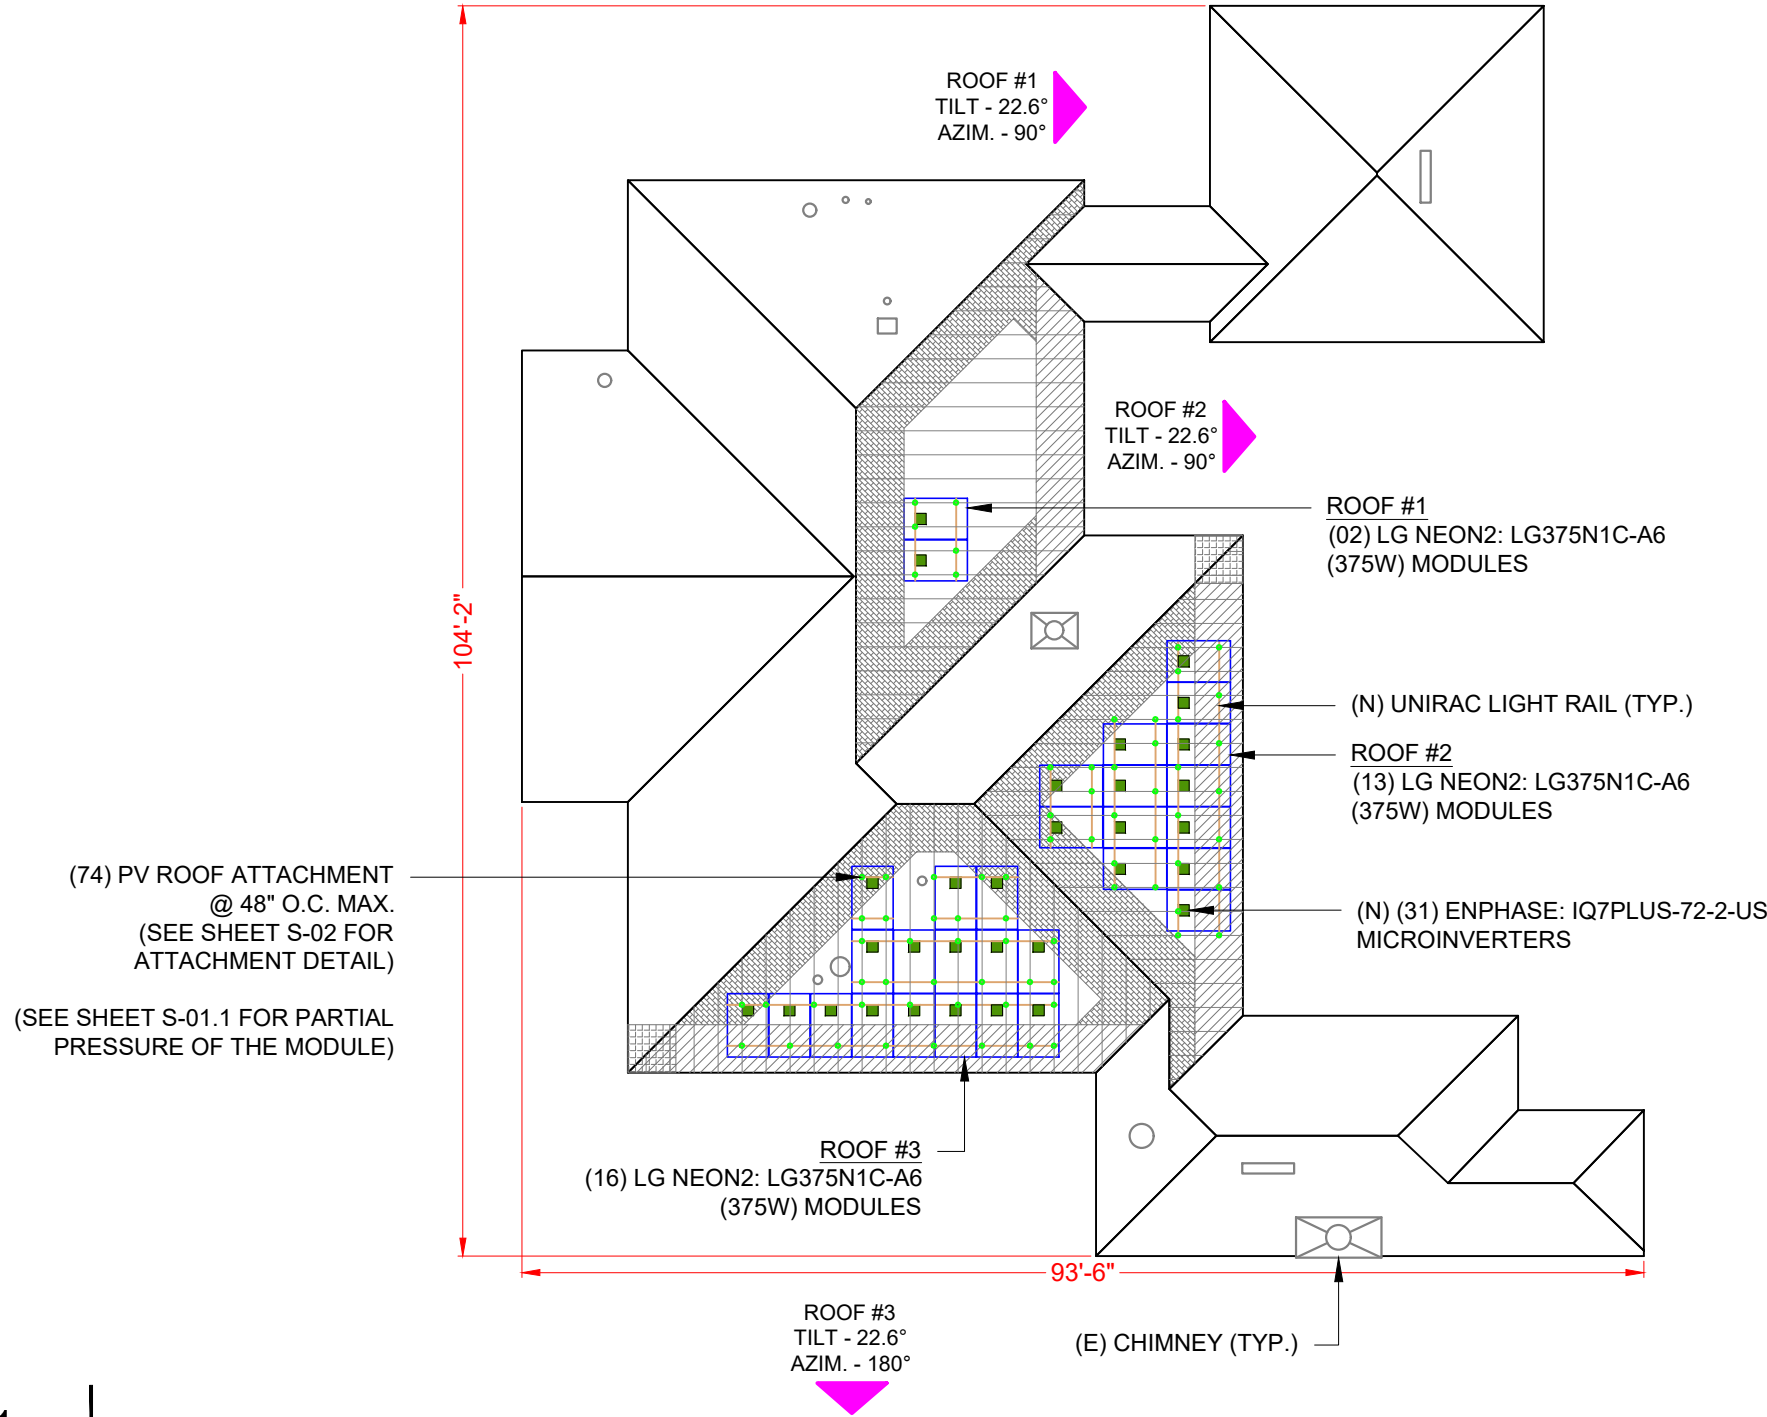

(74) PV ROOF ATTACHMENT @ 48" O.C. MAX.  
(SEE SHEET S-02 FOR ATTACHMENT DETAIL)  
(SEE SHEET S-01.1 FOR PARTIAL PRESSURE OF THE MODULE)

(E) BACK YARD

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO SYP TRUSSES SHALL BE INSTALLED AS SHOWN IN SHEET S-02 AND AS FOLLOWS FOR EACH WIND ZONE:

| WIND ZONES | NON - EXPOSED MODULES |            | EDGE / EXPOSED MODULES |            |
|------------|-----------------------|------------|------------------------|------------|
|            | SPAN                  | CANTILEVER | SPAN                   | CANTILEVER |
| ZONE 1     | 4' - 0"               | 1' - 4"    | 4' - 0"                | 1' - 4"    |
| ZONE 1'    | X                     | X          | X                      | X          |
| ZONE 2e    | 4' - 0"               | 1' - 4"    | 4' - 0"                | 1' - 4"    |
| ZONE 2n    | X                     | X          | X                      | X          |
| ZONE 2r    | 4' - 0"               | 1' - 4"    | 4' - 0"                | 1' - 4"    |
| ZONE 3e    | 4' - 0"               | 1' - 4"    | 4' - 0"                | 1' - 4"    |
| ZONE 3r    | X                     | X          | X                      | X          |

SEE SHEET S-02.1 FOR SUPPORTING CALCULATIONS.

2) EXISTING RESIDENTIAL BUILDING IS AN ASPHALT SHINGLE ROOF WITH MEAN ROOF HEIGHT IS 15 FT AND SYP 2"X4" ROOF TRUSSES SPACED 24" O.C. EXISTING ROOF SLOPE FOR SOLAR SYSTEM RETROFIT IS 22.6 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS.

\* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7th ED. CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES AND EQUIPMENT DEAD LOADS. \*

LEGEND

- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

| REVISIONS   |      |     |
|-------------|------|-----|
| DESCRIPTION | DATE | REV |
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER



Digitally Signed by:  
Ermocrates E Castillo  
Date: 2021.09.15 16:33:53


PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025


SHEET NAME  
MODULE LAYOUT

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
S-01



(E) FRONT YARD

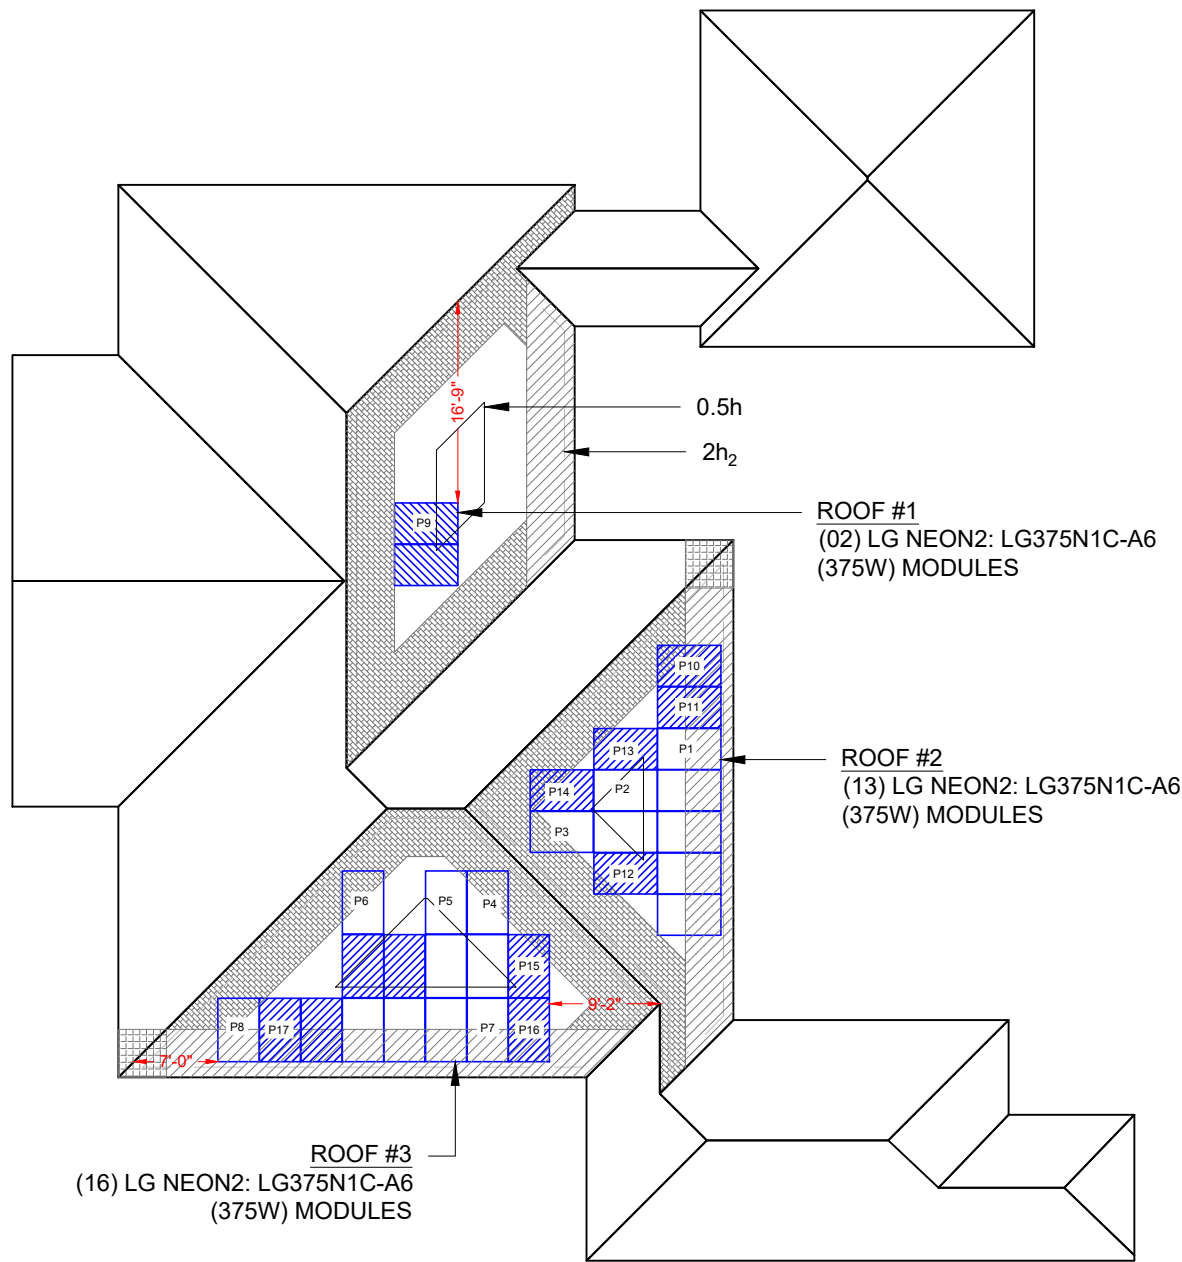

(E) BACK YARD

2h<sub>2</sub> DISTANCE : 0' - 10"  
0.5h DISTANCE : 7' - 6"

NOTE : PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

FOR NON- EXPOSED MODULES

| 1  | 1' | 2e | 2n | 2r | 3e | 3r |
|----|----|----|----|----|----|----|
| 16 | 0  | 16 | 0  | 16 | 16 | 0  |

Module Size 19.51 Sq. ft.

| Non-Exposed modules |       |    |       |    |      |    |    | Partial Pressure |
|---------------------|-------|----|-------|----|------|----|----|------------------|
|                     | 1     | 1' | 2e    | 2n | 2r   | 3e | 3r |                  |
| P1                  | 8.58  | 0  | 10.93 | 0  | 0    | 0  | 0  | 16.00            |
| P2                  | 19.51 | 0  | 0     | 0  | 0    | 0  | 0  | 16.00            |
| P3                  | 11.53 | 0  | 0     | 0  | 7.98 | 0  | 0  | 16.00            |
| P4                  | 10.75 | 0  | 0     | 0  | 8.76 | 0  | 0  | 16.00            |
| P5                  | 19.30 | 0  | 0     | 0  | 0.21 | 0  | 0  | 16.00            |
| P6                  | 10.34 | 0  | 0     | 0  | 9.17 | 0  | 0  | 16.00            |
| P7                  | 9.54  | 0  | 9.97  | 0  | 0    | 0  | 0  | 16.00            |
| P8                  | 2.29  | 0  | 9.97  | 0  | 7.25 | 0  | 0  | 16.00            |

FOR EXPOSED MODULES

| 1  | 1' | 2e   | 2n | 2r   | 3e   | 3r |
|----|----|------|----|------|------|----|
| 16 | 0  | 21.6 | 0  | 21.6 | 21.6 | 0  |

Module Size 19.51 Sq. ft.

| Exposed modules |       |    |       |    |      |    |    | Partial Pressure |
|-----------------|-------|----|-------|----|------|----|----|------------------|
|                 | 1     | 1' | 2e    | 2n | 2r   | 3e | 3r |                  |
| P9              | 19.51 | 0  | 0     | 0  | 0    | 0  | 0  | 16.00            |
| P10             | 3.50  | 0  | 10.94 | 0  | 5.07 | 0  | 0  | 20.60            |
| P11             | 8.57  | 0  | 10.94 | 0  | 0    | 0  | 0  | 19.14            |
| P12             | 17.32 | 0  | 0     | 0  | 2.19 | 0  | 0  | 16.63            |
| P13             | 18.17 | 0  | 0     | 0  | 1.34 | 0  | 0  | 16.39            |
| P14             | 13.09 | 0  | 0     | 0  | 6.42 | 0  | 0  | 17.84            |
| P15             | 16.84 | 0  | 0     | 0  | 2.67 | 0  | 0  | 16.77            |
| P16             | 9.54  | 0  | 0     | 0  | 9.97 | 0  | 0  | 18.86            |
| P17             | 9.41  | 0  | 9.97  | 0  | 0.13 | 0  | 0  | 18.90            |

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS : 88 PSF

LEGEND

- EXPOSED MODULE
- EDGE MODULE
- NON- EXPOSED MODULE
- MISSING MODULE
- MIN. MODULE EDGE DISTANCE LINE
- MODULE EXPOSURE LINE
- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER



Digitally Signed by:  
Ermocrates E Castillo  
Date: 2021.09.15 16:33:54

PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME


PARTIAL PRESSURE AND  
MODULES EXPOSURE

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

S-01.1

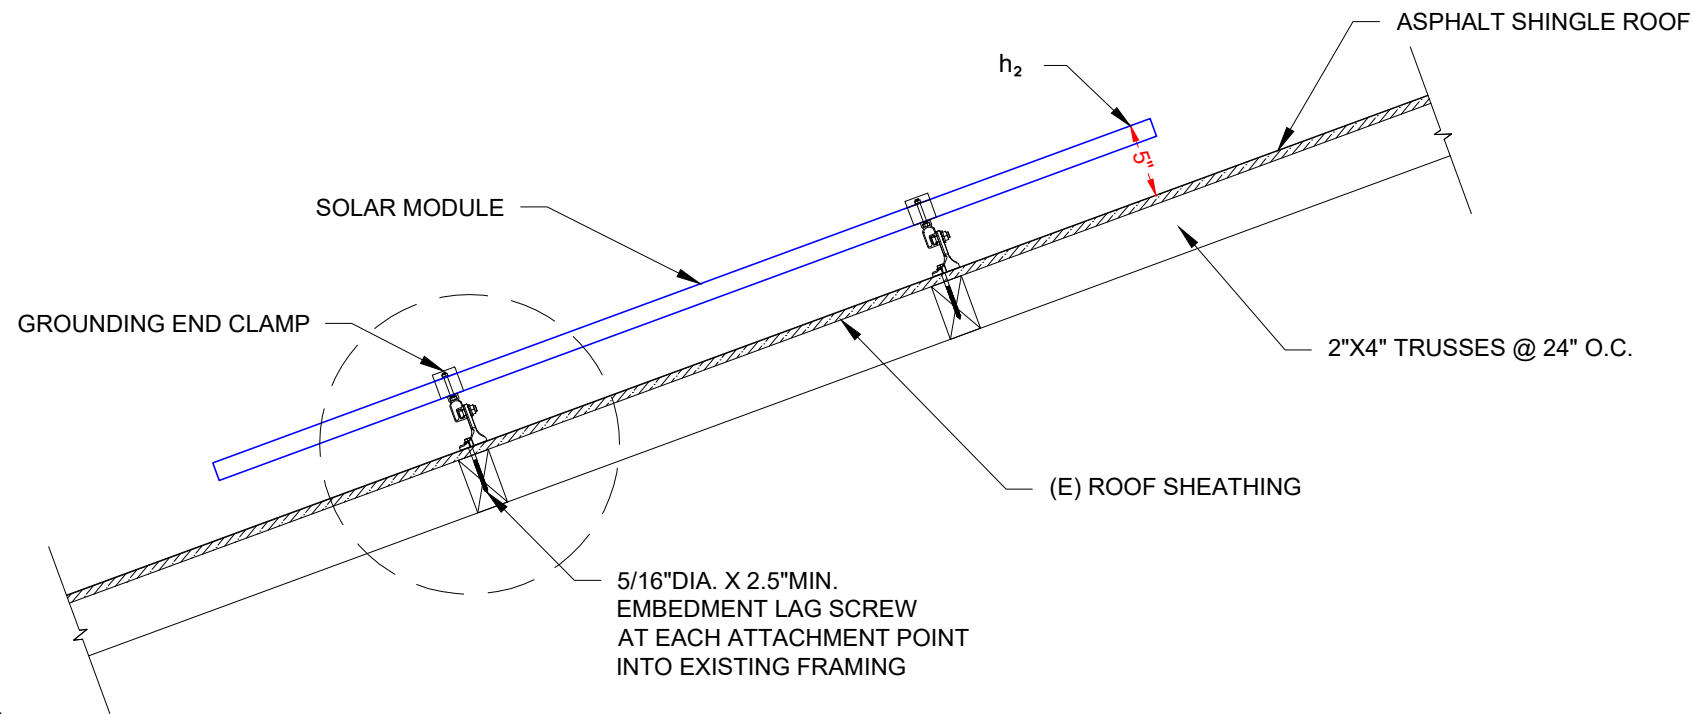

1 ATTACHMENT DETAIL  
S-02 SCALE: 1" = 1'-0"

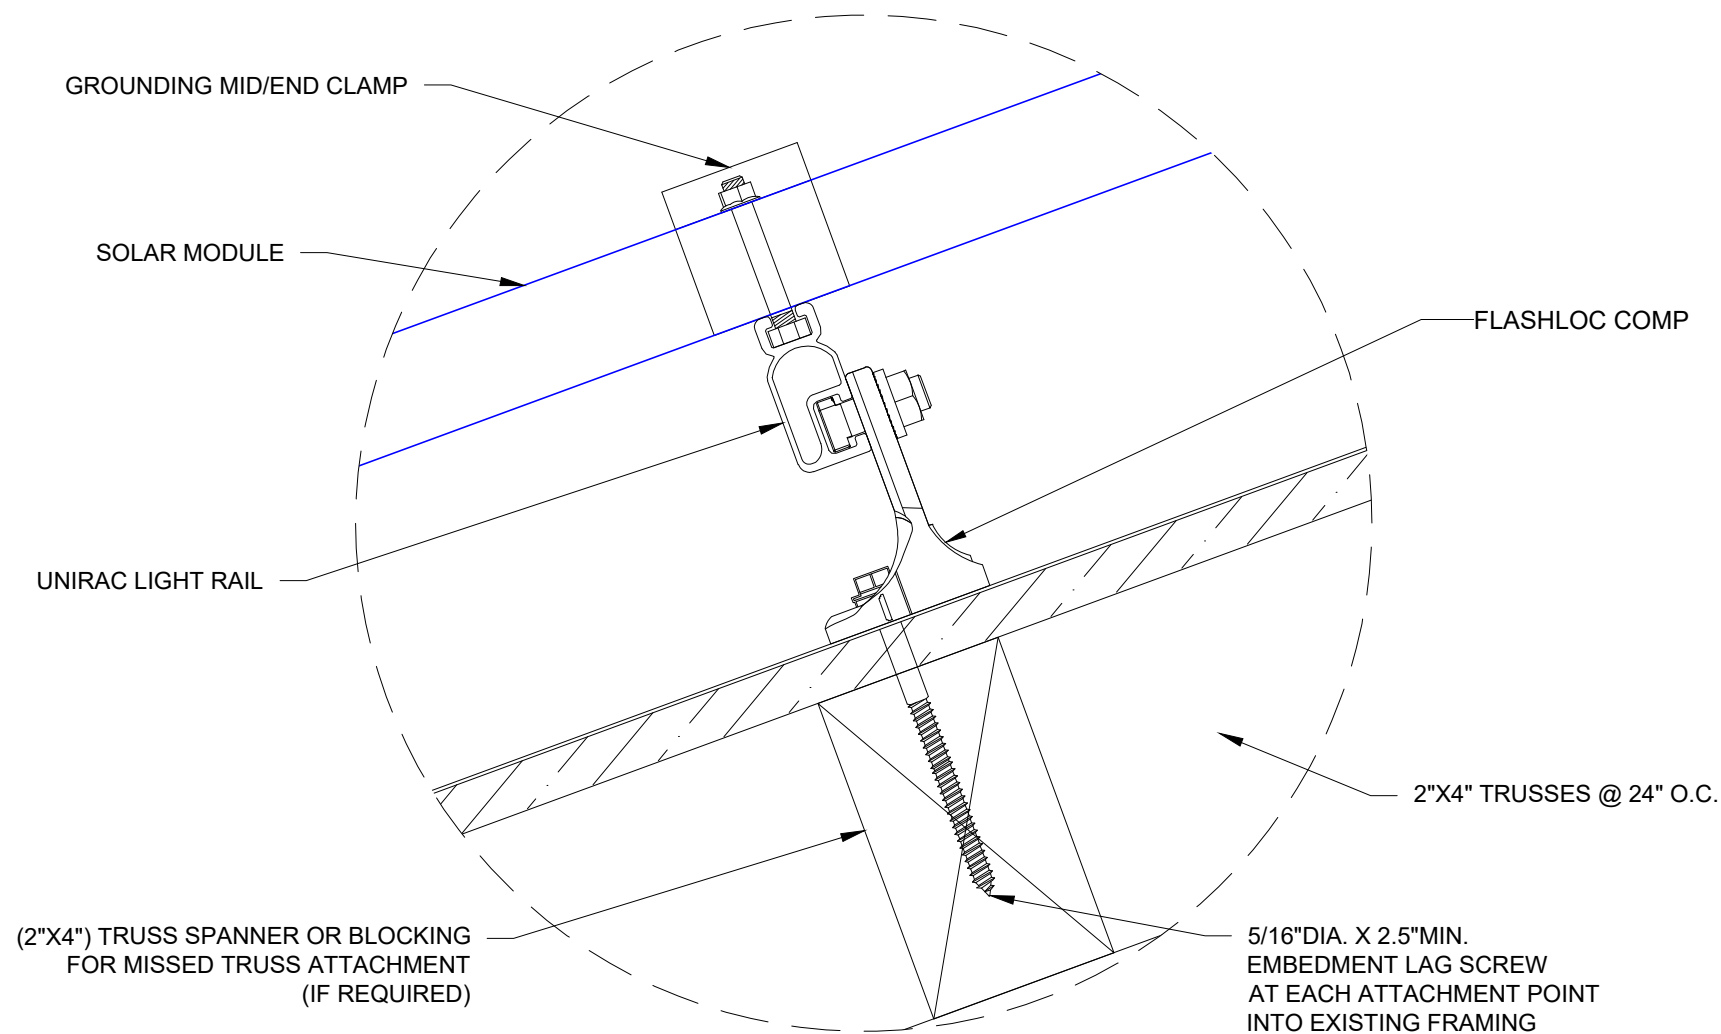

2 ATTACHMENT DETAIL (ENLARGED VIEW)  
S-02 SCALE: 1"=2"

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

SUNPRO



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:33:55

PROJECT NAME

HUDSON RESIDENCE

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

ATTACHMENT DETAIL

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

SUNPRO

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:33:55

PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

STRUCTURE  
CALCULATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02.1

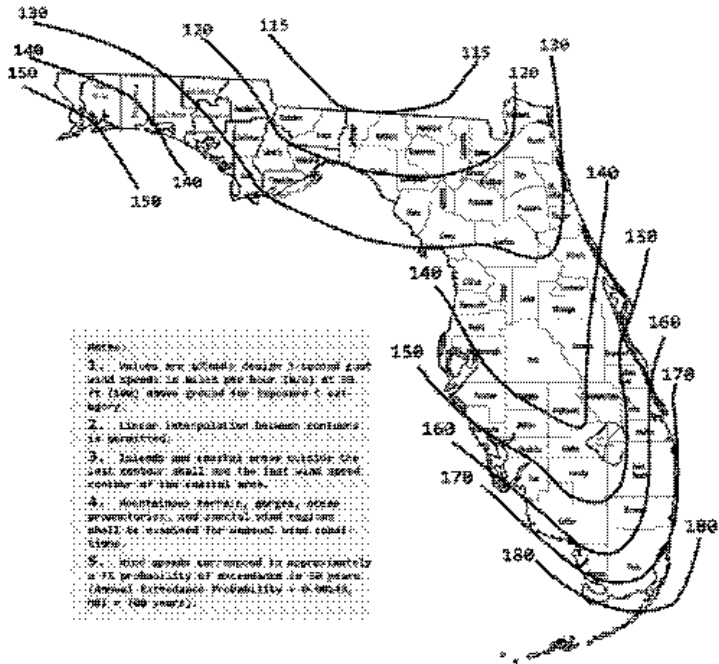


FIGURE 1609.5(1)  
ULTIMATE DESIGN WIND SPEEDS,  $V_{ULT}$ , FOR RISK CATEGORY II BUILDINGS AND OTHER STRUCTURES

WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

| SITE INFORMATION                       |          |                              |         |
|--|----------|------------------------------|---------|
| FBC VERSION                            | 2020     | RISK CATEGORY                | II      |
| MEAN ROOF HEIGHT (ft)                  | 15.0     | EXPOSURE CATEGORY            | B       |
| ROOF LENGTH (ft)                       | 104.0    | ROOF SLOPE                   | 5 / 12  |
| ROOF WIDTH (ft)                        | 94.0     | ROOF SLOPE (°)               | 22.6    |
| PARAPET HEIGHT (ft)                    | 0.0      | ROOF TYPE                    | HIP     |
| MODULE LENGTH (in)                     | 68.5     | ULTIMATE WIND SPEED          | 120 mph |
| MODULE WIDTH (in)                      | 41.02    | NOMINAL WIND SPEED           | 93 mph  |
| MODULE ORIENTATION                     | PORTRAIT | EXPOSURE FACTOR ( $C_e$ )    | 1.000   |
| MODULE AREA (sq. ft.)                  | 19.51    | TEMPERATURE FACTOR ( $C_t$ ) | 1.000   |
| GROUND SNOW LOAD (psf)                 | 0.0      | IMPORTANCE FACTOR ( $I_s$ )  | 1.000   |
| DEAD LOAD (psf)                        | 3.0      | SLOPE FACTOR ( $C_s$ )       | 0.910   |
| SLOPED ROOF SNOW LOAD (psf)            | 0.0      | $K_D$                        | 0.850   |
| EFFECTIVE WIND AREA (ft <sup>2</sup> ) | 19.5     | $K_{ZT}$                     | 1.000   |
| GROUND ELEVATION (ft)                  | 121.0    | $K_e$                        | 0.996   |
| HVHZ                                   | NO       | $K_z$                        | 0.575   |

DESIGN CALCULATIONS

|   |           |       |        |
|---|-----------|-------|--------|
| VELOCITY PRESSURE ( $q$ ) = $.00256 \cdot K_e \cdot K_z \cdot K_{zt} \cdot K_D \cdot V^2$ |           |       |        |
| VELOCITY PRESSURE(ASD) 10.8 psf   |           |       |        |
| WIDTH OF PRESSURE COEFFICIENT   | 94' * 10% | =     | 9.4'   |
|   | 15' * 40% | =     | 6'     |
|   |           |       |        |
| EXTERNAL PRESSURE COEFFICIENT   | ZONE 1    | 0.584 | -1.226 |
|   | ZONE 1'   | 0.584 | X      |
|   | ZONE 2e   | 0.584 | -1.777 |
|   | ZONE 2n   | 0.584 | X      |
|   | ZONE 2r   | 0.584 | -1.777 |
|   | ZONE 3e   | 0.584 | -1.777 |
|   | ZONE 3r   | 0.584 | X      |
| INTERNAL PRESSURE COEFFICIENT (+/-) 0.18  |           |       |        |


| DESIGN PRESSURES |      |                                  |         |
|------------------|------|----------------------------------|---------|
| ROOF ZONE        | DOWN | UP                               |         |
| 1                | 16.0 | -15.1                            | psf     |
| 1'               | 16.0 | X                                | psf     |
| 2e               | 16.0 | -21.1                            | psf     |
| 2n               | 16.0 | X                                | psf     |
| 2r               | 16.0 | -21.1                            | psf     |
| 3e               | 16.0 | -21.1                            | psf     |
| 3r               | 16.0 | X                                | psf     |
|                  |      | Module allowable uplift pressure | 88 psf  |
|                  |      | Module allowable down pressure   | 125 psf |

| ARRAY FACTORS                   |  |                      |         |
|---------------------------------|--|----------------------|---------|
| ARRAY EDGE FACTOR (EXPOSED)     |  | 1.5                  |         |
| ARRAY EDGE FACTOR (NON-EXPOSED) |  | 1                    |         |
|                                 |  | SOLAR PANEL PRESSURE | 0.68387 |
|                                 |  | EQUALIZATION FACTOR  |         |

| ADJUSTED DESIGN PRESSURES |      |              |                 |     |
|---------------------------|------|--------------|-----------------|-----|
| ROOF ZONE                 | DOWN | UP (Exposed) | UP (N. Exposed) |     |
| 1                         | 16.0 | -16.0        | -16.0           | psf |
| 1'                        | 16.0 | X            | X               | psf |
| 2e                        | 16.0 | -21.6        | -16.0           | psf |
| 2n                        | 16.0 | X            | X               | psf |
| 2r                        | 16.0 | -21.6        | -16.0           | psf |
| 3e                        | 16.0 | -21.6        | -16.0           | psf |
| 3r                        | 16.0 | X            | X               | psf |

| ATTACHMENTS USED    |                    |     |
|---------------------|--------------------|-----|
| ATTACHMENT MODEL    | Lag Bolts- Shingle |     |
| ATTACHMENT STRENGTH | 476                | lbs |

| MAX DESIGN LOADS ALLOWABLE |       |              |                 |              |            |             |
|----------------------------|-------|--------------|-----------------|--------------|------------|-------------|
| LIMIT MAX SPAN TO          |       | 48           | in              |              |            |             |
| RAFTER/SEAM SPACING        |       | 24           | in              | NO. OF RAILS | Exposed: 2 | Non. Exp: 2 |
| ROOF ZONE                  | DOWN  | UP (Exposed) | UP (N. Exposed) | SPANS (E)    |            | SPANS (N.E) |
| 1                          | 182.7 | 182.7        | 182.7           | 48 in        |            | 48 in       |
| 1'                         | 0.0   | X            | X               | X in         |            | X in        |
| 2e                         | 182.7 | 246.5        | 182.7           | 48 in        |            | 48 in       |
| 2n                         | 0.0   | X            | X               | X in         |            | X in        |
| 2r                         | 182.7 | 246.5        | 182.7           | 48 in        |            | 48 in       |
| 3e                         | 182.7 | 246.5        | 182.7           | 48 in        |            | 48 in       |
| 3r                         | 0.0   | X            | X               | X in         |            | X in        |

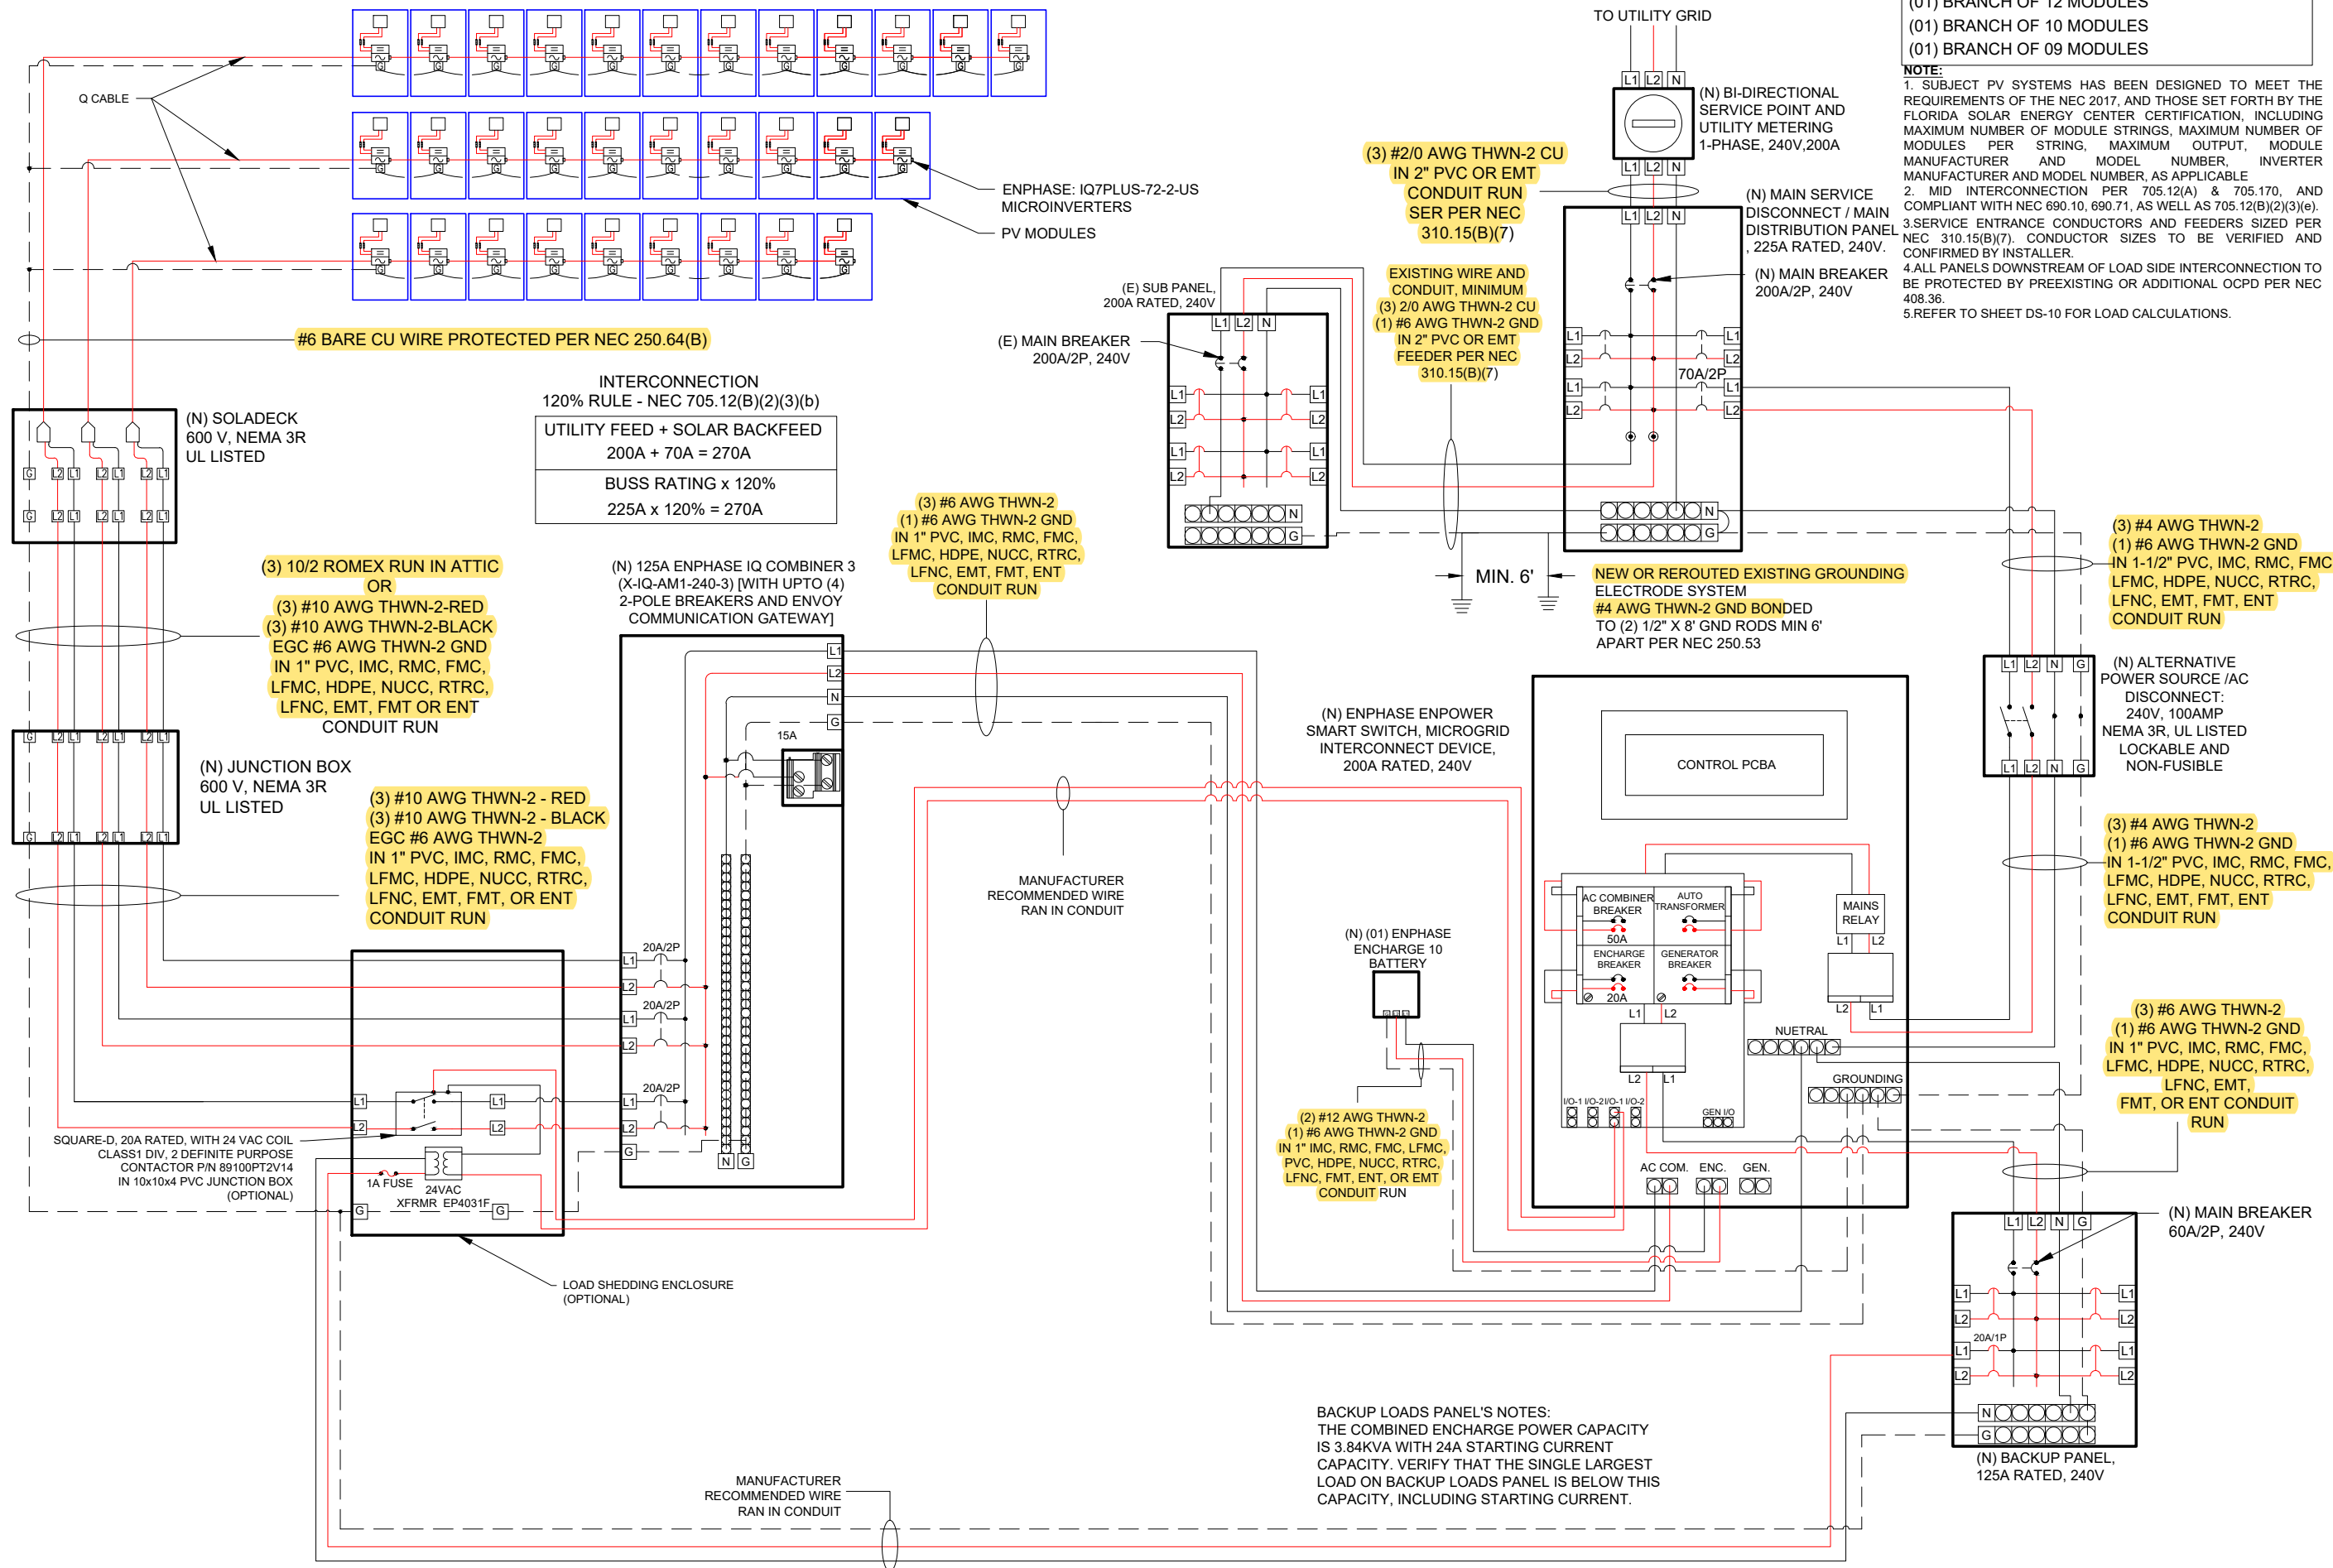

**Castillo Engineering**  
SOLAR DONE RIGHT®


**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC


REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

**SUNPRO**

Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.09.15 16:33:56



PROJECT NAME

**HUDSON RESIDENCE**  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

**ELECTRICAL LINE DIAGRAM**

SHEET SIZE

**ANSI B  
11" X 17"**

SHEET NUMBER

**E-01**

ELECTRICAL CALCULATION

|                          |                   |
|--------------------------|-------------------|
| MODULE MANUFACTURER      | LG                |
| MODULE MODEL             | LG375N10-A6       |
| INVERTER MANUFACTURER    | ENPHASE           |
| INVERTER MODEL           | ENPHASE IQ 7 PLUS |
| MODULES/BRANCH CIRCUIT 1 | 12                |
| MODULES/BRANCH CIRCUIT 2 | 10                |
| MODULES/BRANCH CIRCUIT 3 | 9                 |
| TOTAL ARRAY POWER (KW)   | 11.63             |
| SYSTEM AC VOLTAGE        | 240V 1-PHASE      |

| DESIGN TEMPERATURE    |     |
|-----------------------|-----|
| MIN. AMBIENT TEMP. °F | 32  |
| MAX. AMBIENT TEMP. °F | 117 |
| CALCULATED MAX. VOC   | 45  |
| CALCULATED MIN VMP    | 38  |
| CONDUIT FILL          |     |
| NUMBER OF CONDUITS    | 1   |

| AMPACITY CALCULATIONS      |          |                    |     |                   |                    |                |                 |                |                     |                            |
|----------------------------|----------|--------------------|-----|-------------------|--------------------|----------------|-----------------|----------------|---------------------|----------------------------|
| CIRCUIT                    | MAX AMPS | 1.25 X<br>MAX AMPS | AWG | 90 °C<br>AMPACITY | AMBIENT<br>TEMP °F | TEMP<br>DERATE | CONDUIT<br>FILL | FILL<br>DERATE | DERATED<br>AMPACITY | MAXIMUM CIRCUIT<br>BREAKER |
| CIRCUIT 1                  | 14.5     | 18.1               | #10 | 40                | 130                | 0.76           | 6               | 0.8            | 24.32               | 20 A                       |
| CIRCUIT 2                  | 12.1     | 15.1               | #10 | 40                | 130                | 0.76           | 6               | 0.8            | 24.32               | 20 A                       |
| CIRCUIT 3                  | 10.9     | 13.6               | #10 | 40                | 130                | 0.76           | 6               | 0.8            | 24.32               | 20 A                       |
| ENPHASE COMBINER<br>OUTPUT | 37.5     | 46.8               | #6  | 75                | 95                 | 0.96           | 3               | 1              | 72                  | 50 A                       |
| ENPOWER TO<br>BACKUP PANEL | 48.0     | 60.0               | #6  | 75                | 95                 | 0.96           | 3               | 1              | 72                  | 60 A                       |
| ENPOWER TO<br>ENCHARGE     | 16.0     | 20.0               | #12 | 30                | 95                 | 0.96           | 3               | 1              | 28.8                | 20 A                       |
| ENPOWER TO MAIN<br>PANEL   | 53.5     | 66.8               | #4  | 95                | 95                 | 0.96           | 3               | 1              | 91.2                | 70 A                       |

|                              |    |
|------------------------------|----|
| MAXIMUM CIRCUIT VOLTAGE DROP | 2% |
|------------------------------|----|

| VOLTAGE DROP CALCULATIONS |     |                  |      |     |               |
|---------------------------|-----|------------------|------|-----|---------------|
| CIRCUIT                   | AWG | CIRCULAR<br>MILS | I    | V   | MAX<br>LENGTH |
| CIRCUIT 1                 | #10 | 10380            | 14.5 | 240 | 133 FEET      |
| CIRCUIT 2                 | #10 | 10380            | 12.1 | 240 | 160 FEET      |
| CIRCUIT 3                 | #10 | 10380            | 10.9 | 240 | 178 FEET      |
| ENPHASE COMBINER OUTPUT   | #6  | 26240            | 37.5 | 240 | 130 FEET      |
| ENPOWER TO BACKUP PANEL   | #6  | 26240            | 48.0 | 240 | 102 FEET      |
| ENPOWER TO ENCHARGE       | #12 | 6530             | 16.0 | 240 | 76 FEET       |
| ENPOWER TO MAIN PANEL     | #4  | 41740            | 53.5 | 240 | 145 FEET      |

| NOTES   |  |
|---|--|
| TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)  |  |
| CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)                                    |  |
| MAXIMUM VOC CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A) |  |
| UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER                      |  |
| ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE   |  |
|   | IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS |
|   | IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION                             |
|   | INFORMATION INPUT BY SYSTEM DESIGNER   |
|   | INFORMATON OBTAINED FROM MANUFACTURER DATASHEETS                                 |

ELECTRICAL NOTES

1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
3. THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
4. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
5. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
6. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
7. WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
8. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
9. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
10. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
11. THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
12. UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
13. MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
14. RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
15. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
16. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).
17. THIS SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN OF PV CONDUCTORS IN COMPLIANCE WITH NEC 690.12.
18. LABELING IN COMPLIANCE WITH NEC 690.12 AND 690.56(C) IS SHOWN ON SHEET E-03.
19. ALL CONDUITS TO BE INSTALLED A MIN OF 7/8" ABOVE THE ROOF SURFACE.

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER



Digitally signed by: Ermocrates E Castillo  
Date: 2021.09.15 16:33:56

PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

E-02



# LG NeON<sup>®</sup>2

LG375N1C-A6

375W

The LG NeON<sup>®</sup> 2 is LG's best selling solar module and one of the most powerful and versatile modules on the market today. The cells are designed to appear all-black at a distance, and the performance warranty guarantees 90.6% of labeled power output at 25 years.



## Features



### Enhanced Performance Warranty

LG NeON<sup>®</sup> 2 has an enhanced performance warranty. After 25 years, LG NeON<sup>®</sup> 2 is guaranteed at least 90.6% of initial performance.



### 25-Year Limited Product Warranty

The NeON<sup>®</sup> 2 is covered by a 25-year limited product warranty. In addition, up to \$450 of labor costs will be covered in the rare case that a module needs to be repaired or replaced.



### Solid Performance on Hot Days

LG NeON<sup>®</sup> 2 performs well on hot days due to its low temperature coefficient.



### Roof Aesthetics

LG NeON<sup>®</sup> 2 has been designed with aesthetics in mind using thinner wires that appear all black at a distance.

When you go solar, ask for the brand you can trust: LG Solar

## About LG Electronics USA, Inc.

LG Electronics is a global leader in electronic products in the clean energy markets by offering solar PV panels and energy storage systems. The company first embarked on a solar energy source research program in 1985, supported by LG Group's vast experience in the semi-conductor, LCD, chemistry and materials industries. In 2010, LG Solar successfully released its first MonoX<sup>®</sup> series to the market, which is now available in 32 countries. The NeON<sup>®</sup> (previous MonoX<sup>®</sup> NeON), NeON<sup>®</sup>2, NeON<sup>®</sup>2 BiFacial won the "Intersolar AWARD" in 2013, 2015 and 2016, which demonstrates LG's leadership and innovation in the solar industry.



# LG NeON<sup>®</sup>2

LG375N1C-A6

## General Data

|                                  |                                |
|----------------------------------|--------------------------------|
| Cell Properties (Material/Type)  | Monocrystalline/N-type         |
| Cell Maker                       | LG                             |
| Cell Configuration               | 60 Cells (6 × 10)              |
| Module Dimensions (L × W × H)    | 1,740mm × 1,042mm × 40mm       |
| Weight                           | 18.6 kg                        |
| Glass (Material)                 | Tempered Glass with AR Coating |
| Backsheet (Color)                | White                          |
| Frame (Material)                 | Anodized Aluminium             |
| Junction Box (Protection Degree) | IP 68 with 3 Bypass Diodes     |
| Cables (Length)                  | 1,100mm × 2EA                  |
| Connector (Type/Maker)           | MC 4/MC                        |

## Certifications and Warranty

|                               |  |
|-------------------------------|--|
| Certifications*               | IEC 61215-1/-1-1/2: 2016, IEC 61730-1/2: 2016, UL 61730-1: 2017, UL 61730-2: 2017, ISO 9001, ISO 14001, ISO 50001, OHSAS 18001 |
| Salt Mist Corrosion Test      | IEC 61701:2012 Severity 6  |
| Ammonia Corrosion Test        | IEC 62716: 2013  |
| Module Fire Performance       | Type 1 (UL 61730)  |
| Fire Rating                   | Class C (UL 790, ULC/ORD C 1703)   |
| Solar Module Product Warranty | 25 Year Limited  |
| Solar Module Output Warranty  | Linear Warranty*   |

\*Improved: 1<sup>st</sup> year 98.5%, from 2-24th year: 0.33%/year down, 90.6% at year 25

## Temperature Characteristics


|       |        |        |
|-------|--------|--------|
| NMOT* | [°C]   | 42 ± 3 |
| Pmax  | [%/°C] | -0.34  |
| Voc   | [%/°C] | -0.26  |
| Isc   | [%/°C] | 0.03   |

\*NMOT (Nominal Module Operating Temperature): Irradiance 800 W/m<sup>2</sup>, Ambient temperature 20°C, Wind speed 1 m/s, Spectrum AM 1.5

## Electrical Properties (NMOT)

| Model                       |     | LG375N1C-A6 |
|-----------------------------|-----|-------------|
| Maximum Power (Pmax)        | [W] | 281         |
| MPP Voltage (Vmpp)          | [V] | 33.2        |
| MPP Current (Impp)          | [A] | 8.46        |
| Open Circuit Voltage (Voc)  | [V] | 39.4        |
| Short Circuit Current (Isc) | [A] | 9.13        |

## I-V Curves

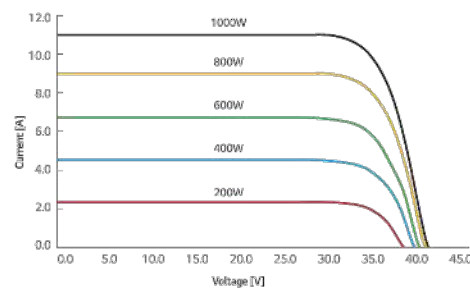

## Electrical Properties (STC\*)

| Model                             |     | LG375N1C-A6 |
|-----------------------------------|-----|-------------|
| Maximum Power (Pmax)              | [W] | 375         |
| MPP Voltage (Vmpp)                | [V] | 35.3        |
| MPP Current (Impp)                | [A] | 10.63       |
| Open Circuit Voltage (Voc, ± 5%)  | [V] | 41.8        |
| Short Circuit Current (Isc, ± 5%) | [A] | 11.35       |
| Module Efficiency                 | [%] | 20.7        |
| Bifaciality Coefficient of Power  | [%] | 10          |
| Power Tolerance                   | [%] | 0 ~ +3      |

\*STC (Standard Test Condition): Irradiance 1000 W/m<sup>2</sup>, cell temperature 25°C, AM 1.5

## Operating Conditions


|                               |          |          |
|-------------------------------|----------|----------|
| Operating Temperature         | [°C]     | 40 ~ +85 |
| Maximum System Voltage        | [V]      | 1,000    |
| Maximum Series Fuse Rating    | [A]      | 20       |
| Mechanical Test Load* (Front) | [Pa/psf] | 5,400    |
| Mechanical Test Load* (Rear)  | [Pa/psf] | 4,000    |

\*Based on IEC 61215-2: 2016 (Test Load = Design Load × Safety Factor (1.5))  
Mechanical Test Loads 6,000Pa / 5,400Pa based on IEC 61215:2005

## Packaging Configuration

|                                      |      |                       |
|--------------------------------------|------|-----------------------|
| Number of Modules per Pallet         | [EA] | 25                    |
| Number of Modules per 40' Container  | [EA] | 650                   |
| Number of Modules per 53' Container  | [EA] | 850                   |
| Packaging Box Dimensions (L × W × H) | [mm] | 1,790 × 1,120 × 1,213 |
| Packaging Box Dimensions (L × W × H) | [in] | 70.5 × 44.1 × 47.8    |
| Packaging Box Gross Weight           | [kg] | 500                   |
| Packaging Box Gross Weight           | [lb] | 1,102                 |

## Dimensions (mm/inch)

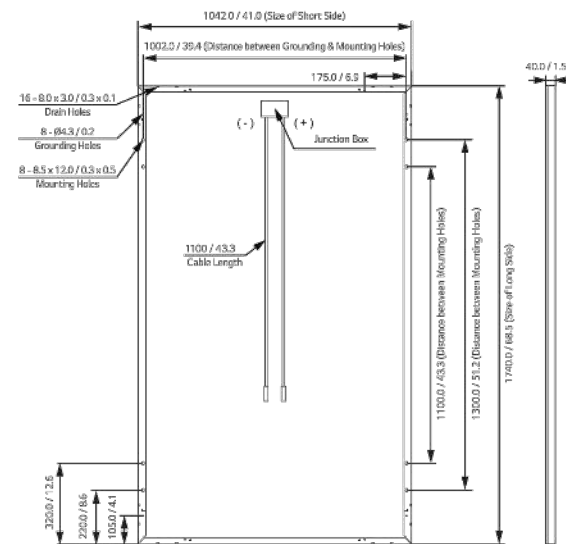

LG Electronics USA, Inc.  
Solar Business Division  
2000 Millbrook Drive  
Lincolnshire, IL 60069  
www.lg-solar.com

Product specifications are subject to change without notice.  
LG375N1C-A6\_AUS.pdf  
012221

© 2021 LG Electronics USA, Inc. All rights reserved.



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

## REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

## PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:33:57

## PROJECT NAME

HUDSON RESIDENCE

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-01



LG Electronics U.S.A., Inc.  
111 Sylvan Avenue  
Englewood Cliffs, NJ 07632  
201.816.2000

Friday, February 5, 2021

RE: Mechanical Load Testing to Determine Structural Performance under Uniform Static Pressure

To: CastilloEngineering,


Upon your request we have conducted in house tests to determine the structural performance of the LG Module frames listed below. Our test results meet the requirements you presented in our conference call on January 29<sup>th</sup>. We will present the test criteria, results, and product limitations that may result from these test conditions in this letter.

The specifications and conditions presented in this letter apply retroactively to the following LG module(s);

|       | 2 Rails  | 3 Rails |
|-------|--|---------|
| Front | 9,000Pa  | 9,000Pa |
| Rear  | 6,350Pa  | 9,000Pa |
| Model | LGxxxN1C(K)-N5(L5), LGxxxN1C(K)-A6(B6)<br>LGxxxQ1C(K)-V5, LGxxxQ1C(K)-A6 |         |

\*The result is based on test load.

Our R&D department has tested these modules to determine the structural performance of under uniform static loading to represent the effects of a wind load on the module. This test was designed only to determine structural performance; the revised specifications apply only to the mechanical performance of the module. *A safety factor of 1.5 should be applied to these test loads for obtaining design loads. It is not recommend designing any system to the full test load.*

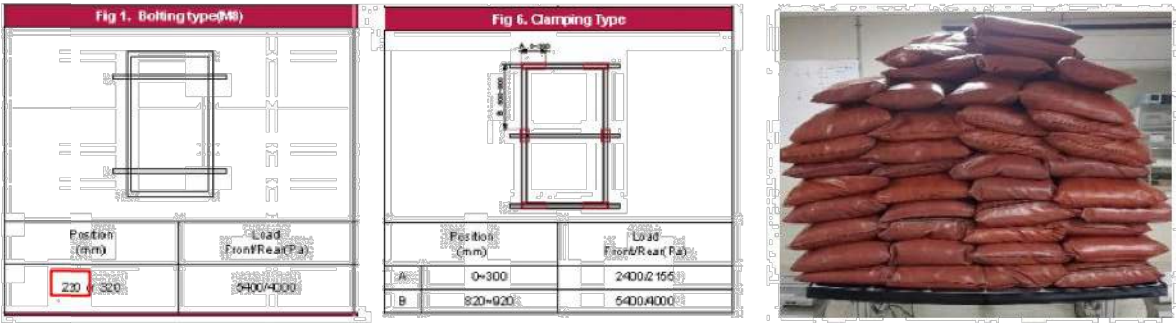

The scope of this test does not include electrical functionality or performance testing. Subjecting the module to these pressures may result in power degradation or total power loss. The electrical function and power generation warranties and specifications of these products are not altered by this document.

If you have any additional questions or concerns about this letter or the test protocol, contact your LG Solar Sales Representative.



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.09.15 16:33:58

PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-02

# Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate seamlessly with the Enphase IQ Envoy™, Enphase Q Aggregator™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.

## Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

## Productive and Reliable

- Optimized for high powered 60-cell and 72-cell\* modules
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

## Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

\* The IQ 7+ Micro is required to support 72-cell modules.



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



# Enphase IQ 7 and IQ 7+ Microinverters

| INPUT DATA (DC)  | IQ7-60-2-US   |                      | IQ7PLUS-72-2-US                |                      |
|--|---|----------------------|--------------------------------|----------------------|
| Commonly used module pairings <sup>1</sup>               | 235 W - 350 W +   |                      | 235 W - 440 W +                |                      |
| Module compatibility                                     | 60-cell PV modules only   |                      | 60-cell and 72-cell PV modules |                      |
| Maximum input DC voltage                                 | 48 V  |                      | 60 V                           |                      |
| Peak power tracking voltage                              | 27 V - 37 V   |                      | 27 V - 45 V                    |                      |
| Operating range  | 16 V - 48 V   |                      | 16 V - 60 V                    |                      |
| Min/Max start voltage                                    | 22 V / 48 V   |                      | 22 V / 60 V                    |                      |
| Max DC short circuit current (module Isc)                | 15 A  |                      | 15 A                           |                      |
| Overvoltage class DC port                                | II  |                      | II                             |                      |
| DC port backfeed current                                 | 0 A   |                      | 0 A                            |                      |
| PV array configuration                                   | 1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit   |                      |                                |                      |
| OUTPUT DATA (AC)   | IQ 7 Microinverter  |                      | IQ 7+ Microinverter            |                      |
| Peak output power  | 250 VA  |                      | 295 VA                         |                      |
| Maximum continuous output power                          | 240 VA  |                      | 290 VA                         |                      |
| Nominal (L-L) voltage/range <sup>2</sup>                 | 240 V /<br>211-264 V  | 208 V /<br>183-229 V | 240 V /<br>211-264 V           | 208 V /<br>183-229 V |
| Maximum continuous output current                        | 1.0 A   | 1.15 A               | 1.21 A                         | 1.39 A               |
| Nominal frequency  | 60 Hz   |                      | 60 Hz                          |                      |
| Extended frequency range                                 | 47 - 68 Hz  |                      | 47 - 68 Hz                     |                      |
| AC short circuit fault current over 3 cycles             | 5.8 Arms  |                      | 5.8 Arms                       |                      |
| Maximum units per 20 A (L-L) branch circuit <sup>3</sup> | 16 (240 VAC)<br>13 (208 VAC)  |                      | 13 (240 VAC)<br>11 (208 VAC)   |                      |
| Overvoltage class AC port                                | III   |                      | III                            |                      |
| AC port backfeed current                                 | 0 A   |                      | 0 A                            |                      |
| Power factor setting                                     | 1.0   |                      | 1.0                            |                      |
| Power factor (adjustable)                                | 0.7 leading ... 0.7 lagging   |                      | 0.7 leading ... 0.7 lagging    |                      |
| EFFICIENCY   | @240 V  | @208 V               | @240 V                         | @208 V               |
| Peak CEC efficiency                                      | 97.6 %  | 97.6 %               | 97.5 %                         | 97.3 %               |
| CEC weighted efficiency                                  | 97.0 %  | 97.0 %               | 97.0 %                         | 97.0 %               |
| MECHANICAL DATA  | IQ 7 Microinverter  |                      |                                |                      |
| Ambient temperature range                                | -40°C to +65°C  |                      |                                |                      |
| Relative humidity range                                  | 4% to 100% (condensing)   |                      |                                |                      |
| Connector type   | MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter)  |                      |                                |                      |
| Dimensions (WxHxD)                                       | 212 mm x 175 mm x 30.2 mm (without bracket)   |                      |                                |                      |
| Weight   | 1.08 kg (2.38 lbs)  |                      |                                |                      |
| Cooling  | Natural convection - No fans  |                      |                                |                      |
| Approved for wet locations                               | Yes   |                      |                                |                      |
| Pollution degree   | PD3   |                      |                                |                      |
| Enclosure  | Class II double-insulated, corrosion resistant polymeric enclosure  |                      |                                |                      |
| Environmental category / UV exposure rating              | NEMA Type 6 / outdoor   |                      |                                |                      |
| FEATURES   |   |                      |                                |                      |
| Communication  | Power Line Communication (PLC)  |                      |                                |                      |
| Monitoring   | Enlighten Manager and MyEnlighten monitoring options.<br>Both options require installation of an Enphase IQ Envoy.  |                      |                                |                      |
| Disconnecting means                                      | The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.   |                      |                                |                      |
| Compliance   | CA Rule 21 (UL 1741-SA)<br>UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01<br>This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions. |                      |                                |                      |

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.  
2. Nominal voltage range can be extended beyond nominal if required by the utility.  
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2018 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.  
2018-02-08




CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

## REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

## PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:33:58

## PROJECT NAME

HUDSON RESIDENCE  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

## SHEET NAME

DATA SHEET

## SHEET SIZE


ANSI B  
11" X 17"

## SHEET NUMBER

DS-03

# Enphase IQ Combiner 3 (X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

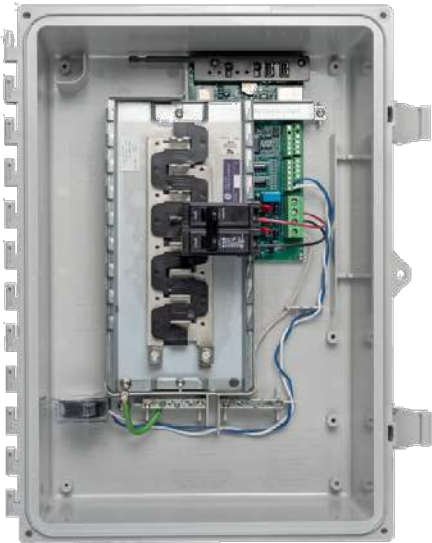

## Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring
- Supports Ensemble Communications Kit for communication with Enphase Encharge™ storage and Enphase Enpower™ smart switch

## Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

## Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- UL listed



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ Combiner 3

| MODEL NUMBER   |  |
|--|--|
| IQ Combiner 3<br>X-IQ-AM1-240-3  | IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).   |
| ACCESSORIES and REPLACEMENT PARTS (not included, order separately)   |  |
| Enphase Mobile Connect™<br>CELLMODEM-03 (4G/12-year data plan)<br>CELLMODEM-01 (3G/5-year data plan)<br>CELLMODEM-M1 (4G based LTE-M/5-year data plan) | Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)  |
| Consumption Monitoring* CT<br>CT-200-SPLIT   | Split core current transformers enable whole home consumption metering (+/- 2.5%).   |
| * Consumption monitoring is required for Enphase Storage Systems   |  |
| Ensemble Communications Kit<br>COMMS-KIT-01  | Installed at the IQ Envoy. For communications with Enphase Encharge™ storage and Enphase Enpower™ smart switch. Includes USB cable for connection to IQ Envoy or Enphase IQ Combiner™ and allows wireless communication with Encharge and Enpower.   |
| Circuit Breakers<br>BRK-10A-2-240<br>BRK-15A-2-240<br>BRK-20A-2P-240   | Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers.<br>Circuit breaker, 2 pole, 10A, Eaton BR210<br>Circuit breaker, 2 pole, 15A, Eaton BR215<br>Circuit breaker, 2 pole, 20A, Eaton BR220  |
| EPLC-01  | Power line carrier (communication bridge pair), quantity - one pair  |
| XA-SOLARSHIELD-ES  | Replace the default solar shield with this Ensemble Combiner Solar Shield to match the look and feel of the Enphase Enpower™ smart switch and the Enphase Encharge™ storage system   |
| XA-PLUG-120-3  | Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)  |
| XA-ENV-PCBA-3  | Replacement IQ Envoy printed circuit board (PCB) for Combiner 3  |
| ELECTRICAL SPECIFICATIONS  |  |
| Rating   | Continuous duty  |
| System voltage   | 120/240 VAC, 60 Hz   |
| Eaton BR series busbar rating  | 125 A  |
| Max. continuous current rating (output to grid)  | 65 A   |
| Max. fuse/circuit rating (output)  | 90 A   |
| Branch circuits (solar and/or storage)   | Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)   |
| Max. continuous current rating (input from PV)   | 64 A   |
| Max. total branch circuit breaker rating (input)   | 80 A of distributed generation / 95 A with IQ Envoy breaker included   |
| Envoy breaker  | 10A or 15A rating GE Q-line/Siemens Type QP / Eaton BR series included   |
| Production Metering CT   | 200 A solid core pre-installed and wired to IQ Envoy   |
| MECHANICAL DATA  |  |
| Dimensions (WxHxD)   | 49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).   |
| Weight   | 7.5 kg (16.5 lbs)  |
| Ambient temperature range  | -40° C to +46° C (-40° to 115° F)  |
| Cooling  | Natural convection, plus heat shield   |
| Enclosure environmental rating   | Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction  |
| Wire sizes   | • 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors<br>• 60 A breaker branch input: 4 to 1/0 AWG copper conductors<br>• Main lug combined output: 10 to 2/0 AWG copper conductors<br>• Neutral and ground: 14 to 1/0 copper conductors<br>Always follow local code requirements for conductor sizing. |
| Altitude   | To 2000 meters (6,560 feet)  |
| INTERNET CONNECTION OPTIONS  |  |
| Integrated Wi-Fi   | 802.11b/g/n  |
| Ethernet   | Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)  |
| Cellular   | CELLMODEM-M1 4G based LTE-M cellular modem (not included). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.  |
| COMPLIANCE   |  |
| Compliance, Combiner   | UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003<br>Production metering: ANSI C12.20 accuracy class 0.5 (PV production)  |
| Compliance, IQ Envoy   | UL 60601-1/CANCSA 22.2 No. 61010-1   |

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 3, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2021-05-20



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

### PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:33:59

### PROJECT NAME

HUDSON RESIDENCE

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-04

## Enphase Enpower

The **Enphase Enpower™** smart switch connects the home to grid power, the Encharge storage system, and solar PV. It provides microgrid interconnection device (MID) functionality by automatically detecting and seamlessly transitioning the home energy system from grid power to backup power in the event of a grid failure. It consolidates interconnection equipment into a single enclosure and streamlines grid independent capabilities of PV and storage installations by providing a consistent, pre-wired solution for residential applications.



### Reliable

- Durable NEMA type 3R enclosure
- Ten-year limited warranty

### Smart

- Controls safe connectivity to the grid
- Automatically detects grid outages
- Provides seamless transition to backup

### Simple

- Connects to the load or service equipment<sup>1</sup> side of the main load panel
- Centered mounting brackets support single stud mounting
- Supports conduit entry from the bottom, bottom left side, and bottom right side
- Supports whole home and partial home backup and subpanel backup
- Up to 200A main breaker support
- Includes neutral-forming transformer for split phase 120/240V backup operation

1. Enpower is not suitable for use as service equipment in Canada.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase Enpower

| MODEL NUMBER   |   |   |
|--|---|---|
| EP200G101-M240US00   | Enphase Enpower smart switch with neutral-forming transformer (NFT), Microgrid Interconnect Device (MID), breakers, and screws. Streamlines grid-independent capabilities of PV and storage installations.  |   |
| ACCESSORIES and REPLACEMENT PARTS  |   |   |
| XA-E3-PCBA-ENS   | Replacement Enpower controller printed circuit board  |   |
| Circuit breakers (as needed) <sup>2,3</sup>  | Not included, must order separately:  |   |
| BRK-100A-2P-240V   | • Main breaker, 2 pole, 100A, 25kAIC, CSR2100N or CSR2100   |   |
| BRK-125A-2P-240V   | • Main breaker, 2 pole, 125A, 25kAIC, CSR2125N  |   |
| BRK-150A-2P-240V   | • Main breaker, 2 pole, 150A, 25kAIC, CSR2150N  |   |
| BRK-175A-2P-240V   | • Main breaker, 2 pole, 175A, 25kAIC, CSR2175N  |   |
| BRK-200A-2P-240V   | • Main breaker, 2 pole, 200A, 25kAIC, CSR2200N  |   |
| BRK-20A-2P-240V-B  | • Circuit breaker, 2 pole, 20A, 10kAIC, BR220B  |   |
| BRK-30A-2P-240V  | • Circuit breaker, 2 pole, 30A, 10kAIC, BR230B  |   |
| BRK-40A-2P-240V  | • Circuit breaker, 2 pole, 40A, 10kAIC, BR240B  |   |
| BRK-60A-2P-240V  | • Circuit breaker, 2 pole, 60A, 10kAIC, BR260   |   |
| BRK-80A-2P-240V  | • Circuit breaker, 2 pole, 80A, 10kAIC, BR280   |   |
| EP200G-HNDL-R1   | Enpower installation handle kit (order separately)  |   |
| ELECTRICAL SPECIFICATIONS  |   |   |
| Assembly rating  | Continuous operation at 100% of its rating  |   |
| Nominal voltage / range (L-L)  | 240 VAC / 100 - 310 VAC   |   |
| Voltage measurement accuracy   | ±1% V nominal (±1.2V L-N and ±2.4V L-L)   |   |
| Nominal frequency / range  | 60 Hz / 56 - 63 Hz  |   |
| Frequency measurement accuracy   | ±0.1 Hz   |   |
| Maximum continuous current rating  | 160A  |   |
| Maximum output overcurrent protection device   | 200A  |   |
| Maximum input overcurrent protection device  | 200A  |   |
| Maximum overcurrent protection device rating for storage branch circuit <sup>4</sup>     | 80A   |   |
| Maximum overcurrent protection device rating for PV combiner branch circuit <sup>4</sup> | 80A   |   |
| Neutral Forming Transformer (NFT)  | • Breaker rating (pre-installed): 40A between L1 and Neutral; 40A between L2 and Neutral<br>• Continuous rated power: 3600VA<br>• Maximum continuous unbalance current: 30A @ 120V<br>• Peak rated power: 8800VA for 30 seconds<br>• Peak unbalanced current: 80A @ 120V for 30 seconds |   |
| MECHANICAL DATA  |   |   |
| Dimensions (WxHxD)   | 50cm x 91.6cm x 24.6cm (19.7 in x 36 in x 9.7 in)   |   |
| Weight   | 38.5 kg (85 lbs)  |   |
| Ambient temperature range  | -40° C to +50° C (-40° F to 122° F)   |   |
| Cooling  | Natural convection, plus heat shield  |   |
| Enclosure environmental rating   | Outdoor, NEMA type 3R, polycarbonate construction   |   |
| Altitude   | To 2500 meters (8200 feet)  |   |
| WIRE SIZES   |   |   |
| Connections  | • Main lugs, backup load lugs, and CSR breakers<br>• BR breakers (wire provided)<br>• AC combiner lugs, Encharge lugs, and generator (reserved for future use) lugs<br>• Neutral (large lugs)   | Cu/AL: 2 AWG - 300 KCMIL<br>6 AWG<br>14 AWG – 2 AWG<br><br>Cu/AL: 6 AWG - 300 KCMIL |
| Neutral and ground bars  | Large holes (5/16-24 UNF)<br>Small holes (10-32 UNF)  | 14 AWG – 1/0 AWG<br>14 AWG – 6 AWG  |
| COMPLIANCE   |   |   |
| Compliance   | UL 1741, UL 1741 SA, UL1998, UL869A <sup>5</sup> , UL67 <sup>5</sup> , UL508 <sup>5</sup> , UL50E <sup>5</sup> , CSA 22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003, AC156.   |   |

2. Compatible with BRHDK125 Hold-Down Kit to comply with 2017 NEC 710.15E for back-fed circuit breakers.  
3. The kAIC of Enpower is the same as the kAIC of the main breaker being installed as listed.  
4. Not included. Installer must provide properly rated breaker per circuit breaker list above.  
5. Sections from these standards were used during the safety evaluation and included in the UL 1741 listing.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enpower, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-06-16



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

### PROJECT INSTALLER

**SUNPRO**

Digitally  
signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:34:00

### PROJECT NAME

**HUDSON RESIDENCE**  
  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-05

# Enphase Encharge 10



The **Enphase Encharge 10™** all-in-one AC-coupled storage system is **reliable, smart, simple, and safe**. It is comprised of three base Encharge 3™ storage units, has a total usable energy capacity of 10.08 kWh and twelve embedded grid-forming microinverters with 3.84 kW power rating. It provides backup capability and installers can quickly design the right system size to meet the needs of both new and retrofit solar customers.

### Reliable

- Proven high reliability IQ Series Microinverters
- Ten-year limited warranty
- Three independent Encharge storage base units
- Twelve embedded IQ 8X-BAT Microinverters
- Passive cooling (no moving parts/fans)

### Smart

- Grid-forming capability for backup operation
- Remote software and firmware upgrade
- Mobile app-based monitoring and control
- Support for self consumption
- Utility time of use (TOU) optimization

### Simple

- Fully integrated AC battery system
- Quick and easy plug-and-play installation
- Interconnects with standard household AC wiring

### Safe

- Cells safety tested
- Lithium iron phosphate (LFP) chemistry for maximum safety and longevity

## Enphase Encharge 10

| MODEL NUMBER   |   |
|--|---|
| ENCHARGE-10-1P-NA                                    | Encharge 10 battery storage system with integrated Enphase Microinverters and battery management unit (BMU). Includes:<br>- Three Encharge 3.36 kWh base units (B03-A01-US00-1-3)<br>- One Encharge 10 cover kit with cover, wall mounting bracket, watertight conduit hubs, and interconnect kit for wiring between batteries (B10-C-1050-0) |
| ACCESSORIES  |   |
| ENCHARGE-HNDL-R1                                     | One set of Encharge base unit installation handles  |
| OUTPUT (AC)  |   |
| @ 240 VAC¹   |   |
| Rated (continuous) output power                      | 3.84 kVA  |
| Peak output power                                    | 5.7 kVA (10 seconds)  |
| Nominal voltage / range                              | 240 / 211 — 264 VAC   |
| Nominal frequency / range                            | 60 / 57 — 61 Hz   |
| Rated output current                                 | 16 A  |
| Peak output current                                  | 24.6A (10 seconds)  |
| Power factor (adjustable)                            | 0.85 leading ... 0.85 lagging   |
| Maximum units per 20 A branch circuit                | 1 unit (single phase)   |
| Interconnection                                      | Single-phase  |
| Maximum AC short circuit fault current over 3 cycles | 69.6 Arms   |
| Round trip efficiency²                               | 89%   |
| BATTERY  |   |
| Total capacity                                       | 10.5 kWh  |
| Usable capacity                                      | 10.08 kWh   |
| Round trip efficiency                                | 96%   |
| Nominal DC voltage                                   | 67.2 V  |
| Maximum DC voltage                                   | 73.5 V  |
| Ambient operating temperature range                  | -15° C to 55° C (5° F to 131° F) non-condensing   |
| Optimum operating temperature range                  | 0° C to 30° C (32° F to 86° F)  |
| Chemistry  | Lithium iron phosphate (LFP)  |
| MECHANICAL DATA                                      |   |
| Dimensions (WxHxD)                                   | 1070 mm x 664 mm x 319 mm (42.13 in x 26.14 in x 12.56 in)  |
| Weight   | Three individual 44.2 kg (97.4 lbs) base units plus 21.1 kg (48.7 lbs) cover and mounting bracket; total 154.7 kg (341 lbs)   |
| Enclosure  | Outdoor – NEMA type 3R  |
| IQ 8X-BAT microinverter enclosure                    | NEMA type 6   |
| Cooling  | Natural convection – No fans  |
| Altitude   | Up to 2500 meters (8200 feet)   |
| Mounting   | Wall mount  |
| FEATURES AND COMPLIANCE                              |   |
| Compatibility  | Compatible with grid-tied PV systems. Compatible with Enphase M215/M250 and IQ Series Micros, Enphase Enpower, and Enphase IQ Envoy for backup operation.   |
| Communication  | Wireless 2.4 GHz  |
| Services   | Backup, self-consumption, TOU, Demand Charge, NEM Integrity   |
| Monitoring   | Enlighten Manager and MyEnlighten monitoring options; API integration   |
| Compliance   | UL 9540, UN 38.3, UL 9540A, UL 1998, UL 991, NEMA Type 3R, AC156<br>EMI: 47 CFR, Part 15, Class B, ICES 003<br>Cell Module: UL 1973, UN 38.3<br>Inverters: UL 62109-1, IEC 62109-2, UL 1741SA, CAN/CSA C22.2 No. 107.1-16, and IEEE 1547  |
| LIMITED WARRANTY                                     |   |
| Limited Warranty³                                    | >70% capacity, up to 10 years or 4000 cycles  |

1. Supported in backup/off grid operations  
2. AC to Battery to AC at 50% power rating.  
3. Whichever occurs first. Restrictions apply.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Encharge 10, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2021-03-01



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

### PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:34:00

### PROJECT NAME

HUDSON RESIDENCE

444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"


### SHEET NUMBER

DS-06

# SOLARMOUNT



**SOLARMOUNT** defined the standard in solar racking. Features are designed to get installers off the roof faster. Our grounding & bonding process eliminates copper wire and grounding straps to reduce costs. Systems can be configured with standard or light rail to meet your design requirements at the lowest cost possible. The superior aesthetics package provides a streamlined clean edge for enhanced curb appeal, with no special brackets required for installation.

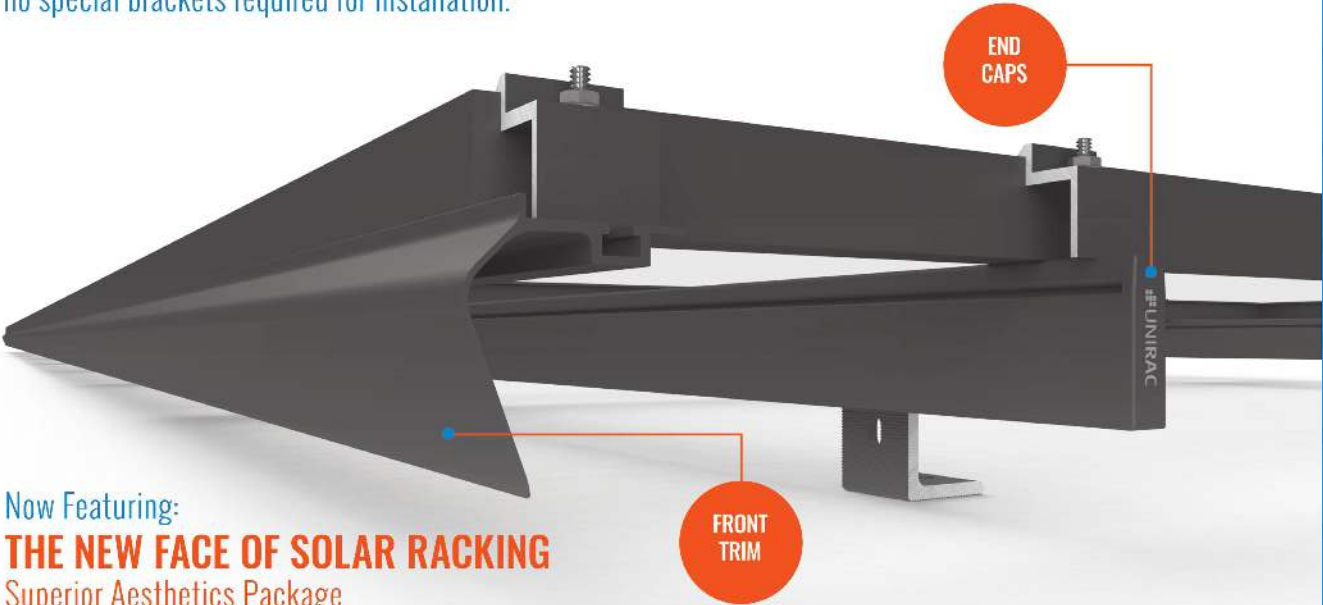

Now Featuring:  
**THE NEW FACE OF SOLAR RACKING**  
Superior Aesthetics Package



**LOSE ALL OF THE COPPER & LUGS**  
System grounding through Enphase microinverters and trunk cables



**SMALL IS THE NEXT NEW BIG THING**  
Light Rail is Fully Compatible with all SM Components



**ENHANCED DESIGN & LAYOUT TOOLS**  
Featuring Google Map Capabilities within U-Builder

**FAST INSTALLATION. SUPERIOR AESTHETICS**  
OPTIMIZED COMPONENTS • VERSATILITY • DESIGN TOOLS • QUALITY PROVIDER

# SOLARMOUNT



## OPTIMIZED COMPONENTS

### INTEGRATED BONDING & PRE-ASSEMBLED PARTS

Components are pre-assembled and optimized to reduce installation steps and save labor time. Our new grounding & bonding process eliminates copper wire and grounding straps or bonding jumpers to reduce costs. Utilize the microinverter mount with a wire management clip for an easier installation.


## VERSATILITY

### ONE PRODUCT - MANY APPLICATIONS


Quickly set modules flush to the roof or at a desired tilt angle. Change module orientation to portrait or landscape while securing a large variety of framed modules on flat, low slope or steep pitched roofs. Available in mill, clear and dark anodized finishes to outperform your projects financial and aesthetic aspirations.

## AUTOMATED DESIGN TOOL DESIGN PLATFORM AT YOUR SERVICE


Creating a bill of materials is just a few clicks away with U-Builder, a powerful online tool that streamlines the process of designing a code compliant solar mounting system. Save time by creating a user profile, and recall preferences and projects automatically when you log in. You will enjoy the ability to share projects with customers: there's no need to print results and send to a distributor, just click and share.




INTEGRATED BONDING  
MIDCLAMP



INTEGRATED BONDING  
SPLICE BAR



INTEGRATED BONDING  
L-FOOT w/ T-BOLT



INTEGRATED BONDING  
MICROINVERTER MOUNT w/  
WIRE MANAGEMENT



## UNIRAC CUSTOMER SERVICE MEANS THE HIGHEST LEVEL OF PRODUCT SUPPORT



UNMATCHED  
EXPERIENCE



CERTIFIED  
QUALITY



ENGINEERING  
EXCELLENCE



BANKABLE  
WARRANTY



DESIGN  
TOOLS



PERMIT  
DOCUMENTATION

### TECHNICAL SUPPORT

Unirac's technical support team is dedicated to answering questions & addressing issues in real time. An online library of documents including engineering reports, stamped letters and technical data sheets greatly simplifies your permitting and project planning process.

### CERTIFIED QUALITY PROVIDER

Unirac is the only PV mounting vendor with ISO certifications for 9001:2015, 14001:2015 and OHSAS 18001:2007, which means we deliver the highest standards for fit, form, and function. These certifications demonstrate our excellence and commitment to first class business practices.

### BANKABLE WARRANTY

Don't leave your project to chance. Unirac has the financial strength to back our products and reduce your risk. Have peace of mind knowing you are receiving products of exceptional quality. SOLARMOUNT is covered by a twenty five (25) year limited product warranty and a five (5) year limited finish warranty.

PROTECT YOUR REPUTATION WITH QUALITY RACKING SOLUTIONS BACKED BY ENGINEERING EXCELLENCE AND A SUPERIOR SUPPLY CHAIN

PUB201711028 PRINTED



**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

| REVISIONS   |      |     |
|-------------|------|-----|
| DESCRIPTION | DATE | REV |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.09.15  
16:34:01

PROJECT NAME

**HUDSON RESIDENCE**  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-07

# FLASH LOC



**FLASHLOC** is the ultimate attachment for composition shingle and rolled comp roofs. The all-in-one mount installs fast — no kneeling on hot roofs to install flashing, no prying or cutting shingles, no pulling nails. Simply drive the lag bolt and inject sealant into the base. **FLASHLOC's** patented TRIPLE SEAL technology preserves the roof and protects the penetration with a permanent pressure seal. Kitted with lag bolts, sealant, and hardware for maximum convenience. Don't just divert water, **LOC it out!**



### PROTECT THE ROOF

Install a high-strength waterproof attachment without lifting, prying or damaging shingles.



### LOC OUT WATER

With an outer shield **1** contour-conforming gasket **2** and pressurized sealant chamber **3** the Triple Seal technology delivers a 100% waterproof connection.



### HIGH-SPEED INSTALL

Simply drive lag bolt and inject sealant into the port **4** to create a permanent pressure seal.

**FASTER INSTALLATION. 25-YEAR WARRANTY.**

FOR QUESTIONS OR CUSTOMER SERVICE VISIT [UNIRAC.COM](http://UNIRAC.COM) OR CALL (505) 248-2702

# FLASH LOC

## INSTALLATION GUIDE



### PRE-INSTALL

Snap chalk lines for attachment rows. On shingle roofs, snap lines 1-3/4" below upslope edge of shingle course. Locate rafters and mark attachment locations.

At each location, drill a 7/32" pilot hole. Clean roof surface of dirt, debris, snow, and ice. Next, BACKFILL ALL PILOT HOLES WITH SEALANT.

NOTE: Space mounts per racking system install specifications.



### STEP 1: SECURE

Place **FLASHLOC** over pilot hole with lag on down-slope side. Align indicator marks on sides of mount with chalk line. Pass included lag bolt and sealing washer through **FLASHLOC** into pilot hole. Drive lag bolt until mount is held firmly in place.

NOTE: The EPDM in the sealing washer will expand beyond the edge of the metal washer when proper torque is applied.



### STEP 2: SEAL

Insert tip of UNIRAC provided sealant into port. Inject until sealant exits both vents.

Continue array installation, attaching rails to mounts with provided T-bolts.



NOTE: When **FLASHLOC** is installed over gap between shingle tabs or vertical joints, fill gap/joint with sealant between mount and upslope edge of shingle course.

NOTE: When installing included rail attachment hardware, torque nut to 30 ft/lbs.

USE ONLY UNIRAC APPROVED SEALANTS: Chemlink Duralink 50 (included in kit) or Chemlink M-1

**FASTER INSTALLATION. 25-YEAR WARRANTY.**

FOR QUESTIONS OR CUSTOMER SERVICE VISIT [UNIRAC.COM](http://UNIRAC.COM) OR CALL (505) 248-2702



**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

| DESCRIPTION | DATE | REV |
|-------------|------|-----|
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

### PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.09.15 16:34:02

### PROJECT NAME

**HUDSON RESIDENCE**  
444 SE HORIZON GLEN,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-08

Residential Optional Calculation

9/25/1997

Job Name

by: John Solis

Version 2011 L

STEP 1 Article 220.82 (B) (1),(2)

sq. ft

2500

General Lighting load

7,500 VA

4

Small Appliance

6,000 VA

1

Laundry circuit

1,500 VA

Gen.Lgt, Sm App.& Laun. Load

15,000 VA

Marc Jones Construction, LLC Sunpro Solar

0

0

0

9/15/2021 10:25

STEP 2 Article 220.82 (C)

General lighting, Sm. Appl. & Laundry

15,000 VA

A/C Condenser & Fixed Electric Space Heating

5 ton

7,130 VA

AHU 1

9.6kW

10,800 VA

1

Heating Load

7,440 VA

A/C #2

VA

AHU 2

Select

VA

Qty

CU Load

8,330 VA

A/C #3

VA

AHU 3

Select

VA

Qty

A/C #4

VA

AHU 4

Select

VA

Qty

A/C #5

VA

AHU 5

Select

VA

Qty

Electric Space Heat @ 65% <4, 40% >3, vs. A/C @ 100%

8,330 VA

STEP 3 Article 220.82 (B) (3)

4,500 VA

Water Heater

4,500 VA

1,400 VA

Refrigerator

2,800 VA

600 VA

Freezer

VA

1,030 VA

Dishwasher

1,030 VA

690 VA

Disposal

VA

400 VA

R / Hood

400 VA

1,630 VA

Microwave

VA

4,000 VA

Microwave

VA

170 VA

Mini Refrig

VA

400 VA

Wine Clr

400 VA

5,000 VA

Insta Hot

VA

1,500 VA

Ironing Center

VA

select

Jacuzzi Tub

VA

select

Sprinkler Pump

VA

1 hp

Well Pump

1,840 VA

select

Fountain Pump

VA

select

Elevator

VA

Pool Equip. Panel

1,840 VA

Apply Demand

GATES

VA

No Demand

Other load

VA

No Demand

Appliance Demand Load

12,810 VA

Dryer Demand Load

5,000 VA

Range Demand Load

10,000 VA

Service Demand

31,454 VA

Demand Load

131 A

Neutral Demand

81 A

Min.Service Req.

150 A

Min. Feeder size

1

Min. Neutral size

4

Eq. Grding Cond.

6

Copper

Total Appliance Load

12,810 VA

STEP 4 Article 220.82 (B) (3)

Electric Clothes Dryers

5,000 VA

STEP 5 Article 220.82 (B) (3)

Electric Ranges

10,000 W

Col C demand

8000

or Number of appliances

Check Box for Gas Range

Cooktop

Col B demand

Cooktop

Col B demand

Oven(s)

Col B demand

Oven(s)

Col B demand

Number of appliances

0

Dem. Factor

Cooktop & Oven Demand Load

jmp1jds@comcast.net

Pool Panel Feeder Calculation (See Note)

Continuous Motors

0

.....

Non-continuous

1,840

.....

Spa heater 11 kVA

.....

Pool heater 3.5 ton

.....

Pool heater 5 ton

.....

Pool Light

select

0

.....

Blower

select

0

240v

other load

0

240v

other load

0

240v

Min.Copper Pool Feeder

AWG

8 A

8 A

A

Minimum Panel Rating

30A

Phase Amperes

Neut. load

Continuous Motors

select

240v

select

240v

select

240v

select

240v

select

240v

Non-continuous Motors

1 hp

240v

select

240v

select

240v

select

240v

select

240v

0.0

Motor Neutral Load

Max.Unbalanced Neutral Load

Castillo Engineering

SOLAR DONE RIGHT

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

| REVISIONS   |      |     |
|-------------|------|-----|
| DESCRIPTION | DATE | REV |
|             |      |     |
|             |      |     |
|             |      |     |
|             |      |     |

PROJECT INSTALLER

SUNPRO

Digitally signed by: Ermocrates E Castillo

Date: 2021.09.15 16:34:02

PROJECT NAME

HUDSON RESIDENCE

444 SE HORIZON GLEN, LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

DS-09