



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 2281691 - BLAKE - ABBATE RES.

MiTek USA, Inc.

6904 Parke East Blvd.
Tampa, FL 33610-4115

Site Information:

Customer Info: Blake Const. Project Name: Abbate Res. Model: Custom
Lot/Block: 9 Subdivision: Southern Approaches
Address: 249 SW Bonanza Glen, N/A
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2017/TPI2014 Design Program: MiTek 20/20 8.2
Wind Code: ASCE 7-10 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 24 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T19604471	CJ01	3/5/20	23	T19604493	T14	3/5/20
2	T19604472	CJ03	3/5/20	24	T19604494	T15	3/5/20
3	T19604473	CJ05	3/5/20				
4	T19604474	EJ01	3/5/20				
5	T19604475	EJ02	3/5/20				
6	T19604476	EJ03	3/5/20				
7	T19604477	EJ04	3/5/20				
8	T19604478	HJ04	3/5/20				
9	T19604479	HJ10	3/5/20				
10	T19604480	T01	3/5/20				
11	T19604481	T02	3/5/20				
12	T19604482	T03	3/5/20				
13	T19604483	T04	3/5/20				
14	T19604484	T05	3/5/20				
15	T19604485	T06	3/5/20				
16	T19604486	T07	3/5/20				
17	T19604487	T08	3/5/20				
18	T19604488	T09	3/5/20				
19	T19604489	T10	3/5/20				
20	T19604490	T11	3/5/20				
21	T19604491	T12	3/5/20				
22	T19604492	T13	3/5/20				




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource-Jacksonville.

Truss Design Engineer's Name: Finn, Walter

My license renewal date for the state of Florida is February 28, 2021.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

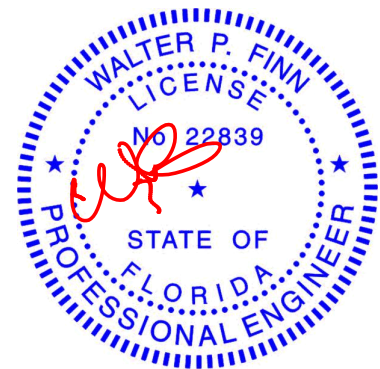

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


March 5, 2020

Job 2281691	Truss CJ01	Truss Type Jack-Open	Qty 14	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604471
----------------	---------------	-------------------------	-----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:06 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-TeJn4KZwe7_F5e3ZI61O9JBYYloXcXjtq2hHQTze0aF

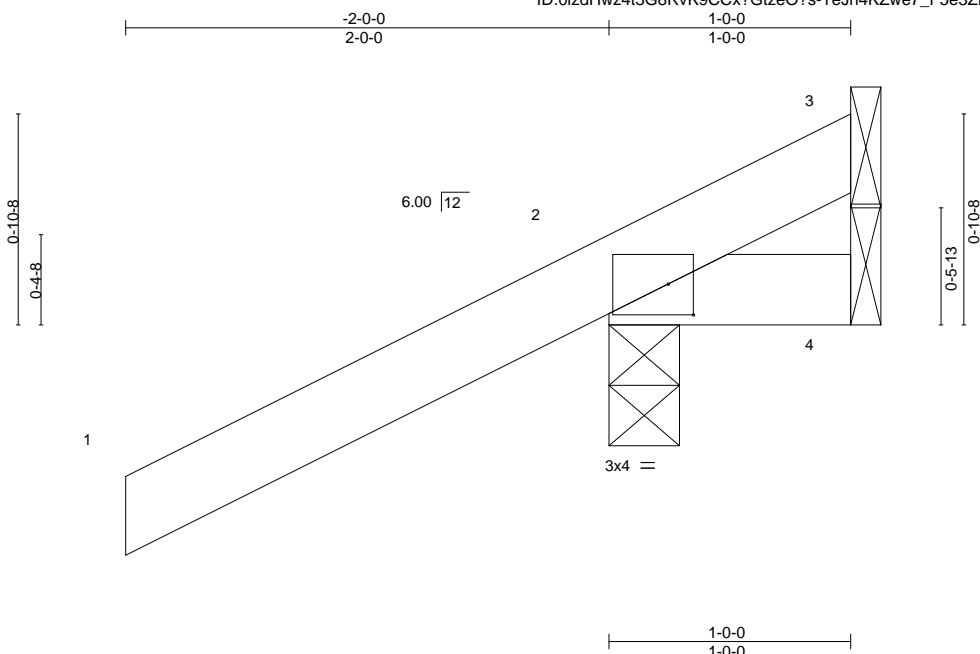

Scale = 1:9.5

Plate Offsets (X,Y)--	[2:0-1-4,0-1-9]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	0.00 7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.07	Vert(CT)	0.00 7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP					Weight: 7 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=66(LC 12)
Max Uplift 3=27(LC 1), 2=-162(LC 12), 4=-46(LC 1)
Max Grav 3=25(LC 16), 2=254(LC 1), 4=44(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 3, 162 lb uplift at joint 2 and 46 lb uplift at joint 4.

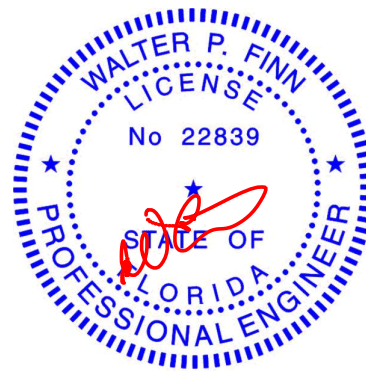

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss CJ03	Truss Type Jack-Open	Qty 10	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604472
----------------	---------------	-------------------------	-----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:06 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-TeJn4KZwe7_F5e3Zl61O9JBlyloScXjtq2hHQTze0aF

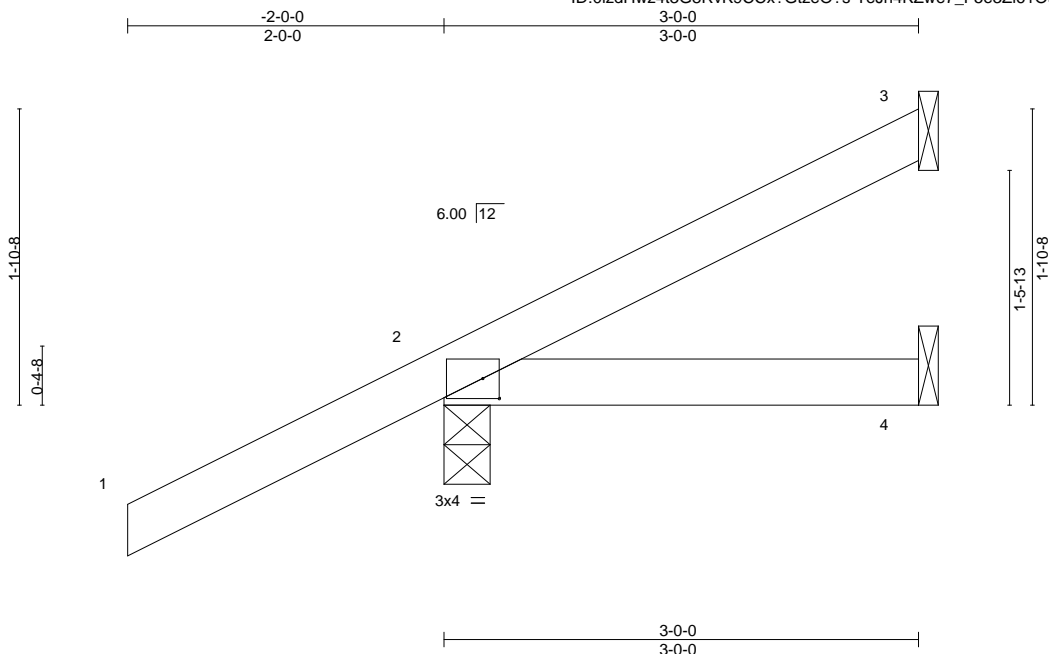

Scale = 1:14.6

Plate Offsets (X,Y)--	[2:0-1-4,0-1-9]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	0.01 4-7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.07	Vert(CT)	-0.01 4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP					Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=113(LC 12)
Max Uplift 3=48(LC 12), 2=-126(LC 12), 4=-22(LC 9)
Max Grav 3=52(LC 1), 2=253(LC 1), 4=48(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 3, 126 lb uplift at joint 2 and 22 lb uplift at joint 4.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

6904 Parke East Blvd.
Tampa, FL 36610

Job 2281691	Truss EJ02	Truss Type Jack-Partial	Qty 5	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604475
----------------	---------------	----------------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:08 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-Q1RXV?aAAIEzKyCxtX3sFkHuB6Ql4QQ9HMAOVLze0aD

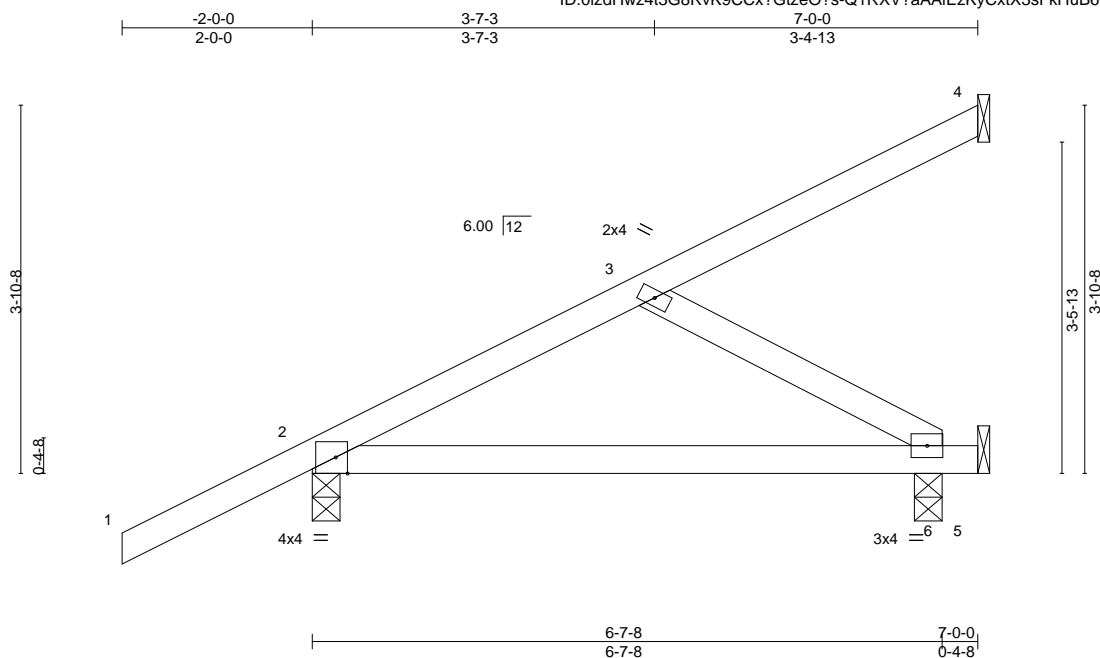


Plate Offsets (X,Y)-- [2:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	0.06	6-9	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.34	Vert(CT)	-0.06	6-9	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	-0.00	5	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS						
								Weight: 31 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 9-6-8 oc bracing.

REACTIONS.

All bearings Mechanical except (jt=length) 2=0-3-8, 6=0-3-8.

(lb) - Max Horz 2=144(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 4 except 2=-100(LC 9), 5=-470(LC 3), 6=-323(LC 9)

Max Grav All reactions 250 lb or less at joint(s) 4, 5 except 2=362(LC 1), 6=671(LC 3)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 2-6=-338/202

WEBS 3-6=-231/388

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=100, 5=470, 6=323.

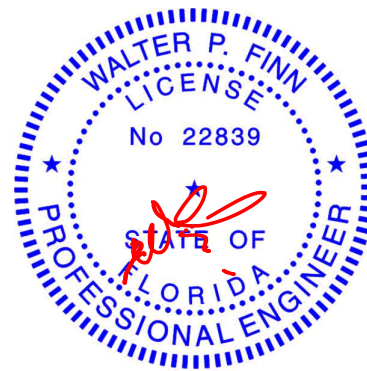

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss EJ04	Truss Type Jack-Partial	Qty 2	Ply 1	BLAKE - ABBATE RES. T19604477
Builders FirstSource, Jacksonville, FL - 32244,					

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:10 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-MPYIwhcQhMUhZGMK_y5KK9MDhv9OYLjSkgfUZEze0aB

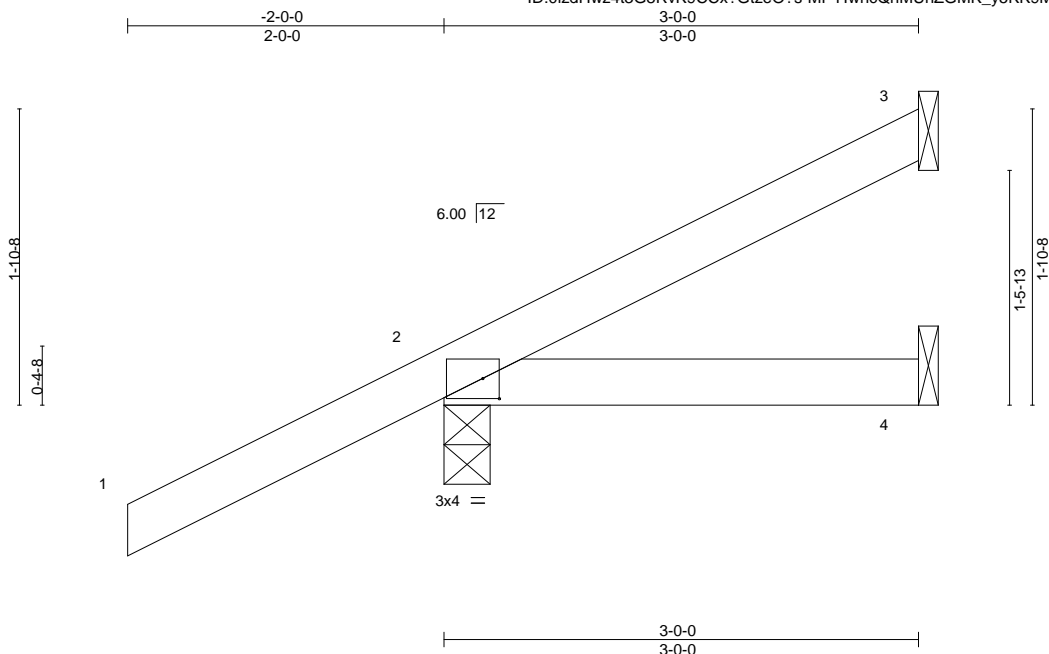

Scale = 1:14.6

Plate Offsets (X,Y)--		[2:0-1-4,0-1-9]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.32		Vert(LL)	0.01 4-7	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.07		Vert(CT)	-0.01 4-7	>999	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0		Code FBC2017/TPI2014		Matrix-MP						Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=113(LC 12)
Max Uplift 3=48(LC 12), 2=126(LC 12), 4=22(LC 9)
Max Grav 3=52(LC 1), 2=253(LC 1), 4=48(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Endl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=126.

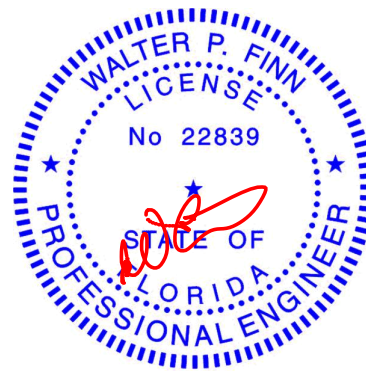

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss HJ04	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	BLAKE - ABBATE RES. T19604478
Job Reference (optional)					

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:11 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-qc6g81c3SgcYBQxWYfcZsNvLoJQCCHoyczJP25gze0aA

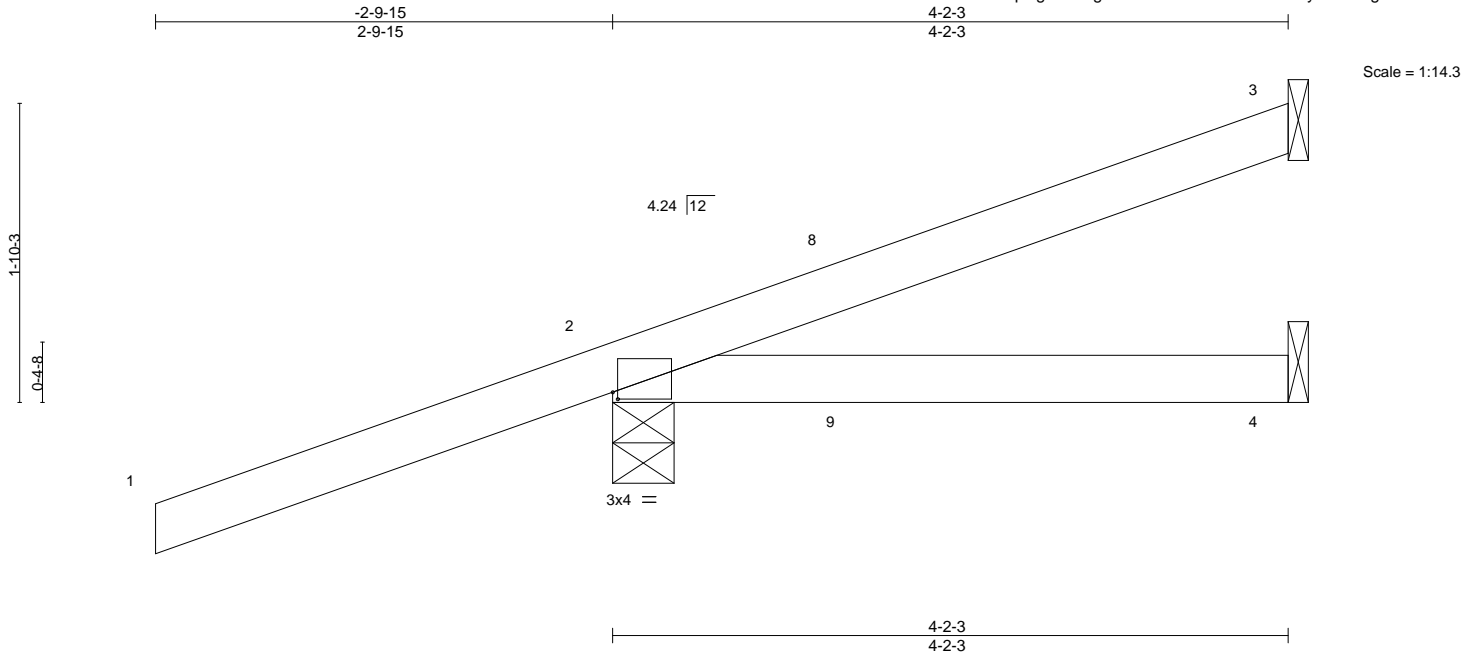


Plate Offsets (X,Y)-- [2:0-0-6,0-0-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	-0.06 4-7 >854	240	MT20 244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.42	Vert(CT)	-0.05 4-7 >977	180	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00 2 n/a	n/a	
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MP					Weight: 17 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=136(LC 4)
Max Uplift 3=37(LC 8), 2=231(LC 4), 4=36(LC 19)
Max Grav 3=52(LC 1), 2=282(LC 1), 4=65(LC 30)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=231.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 103 lb up at 1-6-1, and 83 lb down and 103 lb up at 1-6-1 on top chord, and 69 lb down and 74 lb up at 1-6-1, and 69 lb down and 74 lb up at 1-6-1 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
Vert: 1-3=-54, 4-5=-20
- Concentrated Loads (lb)
Vert: 8=50(F=25, B=25) 9=70(F=35, B=35)

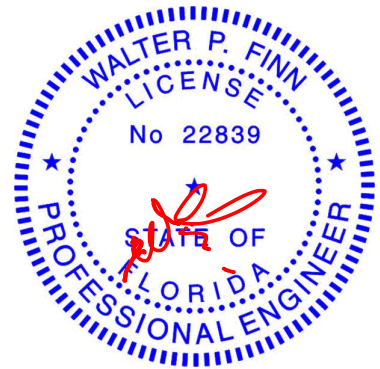

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - ABBATE RES.	T19604479
2281691	HJ10	Diagonal Hip Girder	5	1		
Job Reference (optional)						

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:12 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-log2LNdhDzkPpZWj6N8oPaRV3jjY0AplCz8be6ze0a9

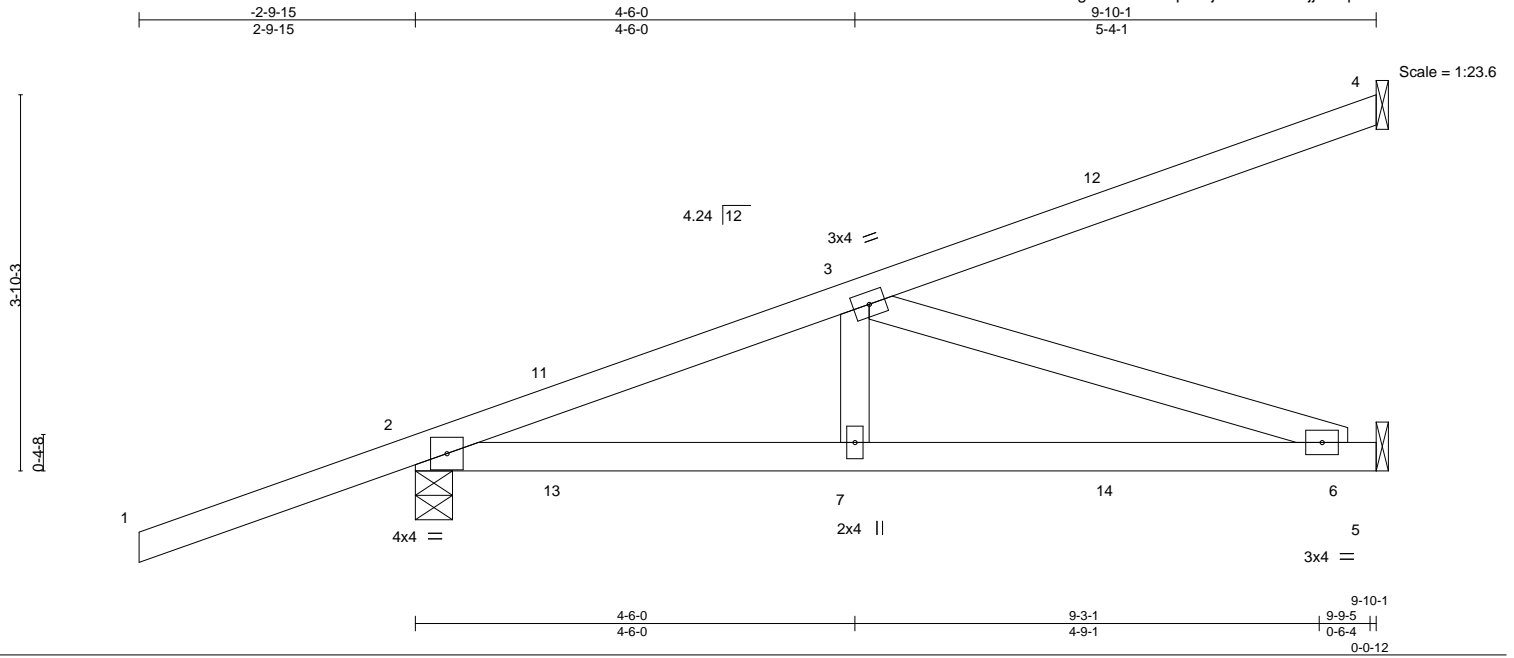

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.59	Vert(LL)	0.12 6-7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.61	Vert(CT)	-0.12 6-7	>967	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.35	Horz(CT)	-0.01 5	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 44 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 7-7-1 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-4-9, 5=Mechanical
Max Horz 2=233(LC 22)
Max Uplift 4=-143(LC 4), 2=-345(LC 4), 5=-216(LC 5)
Max Grav 4=150(LC 1), 2=463(LC 1), 5=266(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-628/448
BOT CHORD 2-7=-510/573, 6-7=-510/573
WEBS 3-6=-603/537

NOTES-

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=143, 2=345, 5=216.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 103 lb up at 1-6-1, 83 lb down and 103 lb up at 1-6-1, 26 lb down and 38 lb up at 4-4-0, 26 lb down and 38 lb up at 4-4-0, and 50 lb down and 97 lb up at 7-1-15, and 50 lb down and 97 lb up at 7-1-15 on top chord, and 69 lb down and 74 lb up at 1-6-1, 69 lb down and 74 lb up at 1-6-1, 53 lb down and 30 lb up at 4-4-0, 53 lb down and 30 lb up at 4-4-0, and 40 lb down and 59 lb up at 7-1-15, and 40 lb down and 59 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 5-8=-20
Concentrated Loads (lb)
Vert: 7=5(F=2, B=25) 11=50(F=25, B=25) 12=-64(F=-32, B=-32) 13=70(F=35, B=35) 14=-49(F=-24, B=-24)

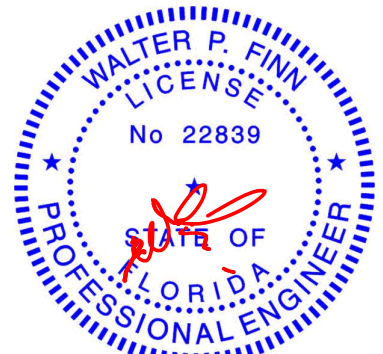

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T01	Truss Type Hip Girder	Qty 1	Ply 2	BLAKE - ABBATE RES. T19604480
----------------	--------------	--------------------------	----------	----------	----------------------------------


Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:16 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-BZwZBkgBHCfRHBPULDCkZQcCgK3syzeL7b7pnuze0a5

-2-0-0	7-0-0	12-0-14	17-0-0	21-11-2	27-0-0	34-0-0	36-0-0
2-0-0	7-0-0	5-0-14	4-11-2	4-11-2	5-0-14	7-0-0	2-0-0

Scale = 1:61.9

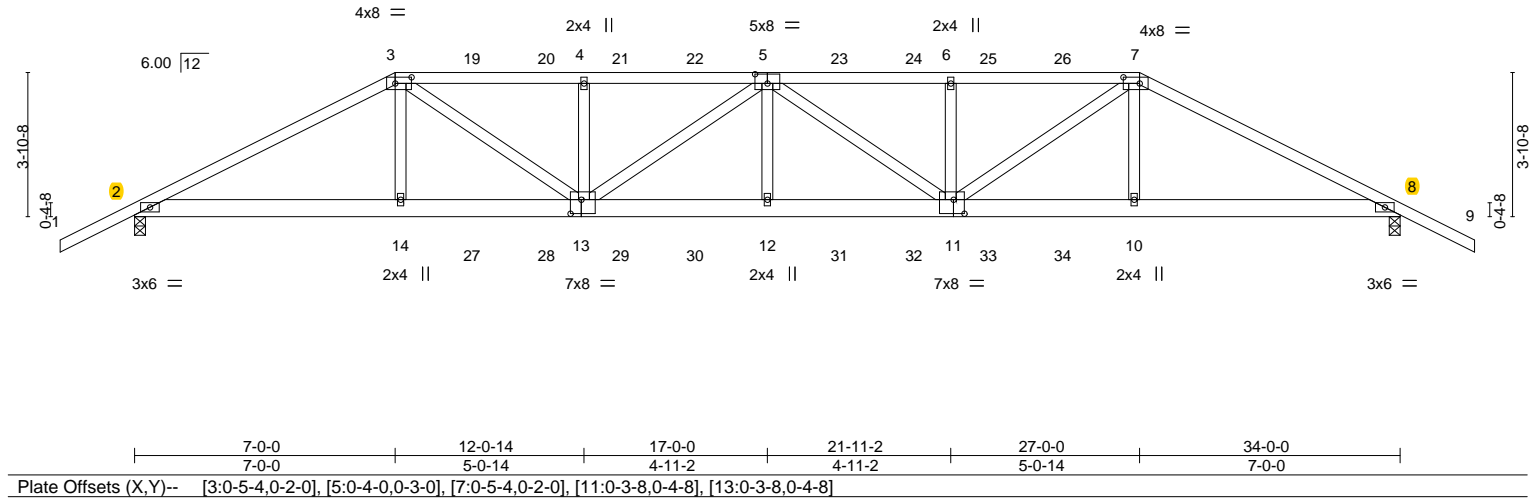

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.55	Vert(LL)	0.28	12	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.65	Vert(CT)	-0.42	12	>981	180	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.42	Horz(CT)	0.09	8	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS						
								Weight: 392 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-5-15 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-1-6 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 8=0-3-8
Max Horz 2=61(LC 7)
Max Uplift 2=1160(LC 8), 8=1226(LC 9)
Max Grav 2=2562(LC 1), 8=2606(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-5017/2452, 3-4=-6179/2990, 4-5=-6191/2997, 5-6=-6234/3057, 6-7=-6222/3050,
7-8=-5113/2596
BOT CHORD 2-14=-2153/4415, 13-14=-2167/4437, 12-13=-3152/6833, 11-12=-3152/6833,
10-11=-2257/4523, 8-10=-2243/4501
WEBS 3-14=-356/654, 3-13=-986/2205, 4-13=-579/323, 5-13=-812/301, 5-12=0/453,
5-11=-749/216, 6-11=-579/323, 7-11=-903/2144, 7-10=-354/653

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=1160, 8=1226.

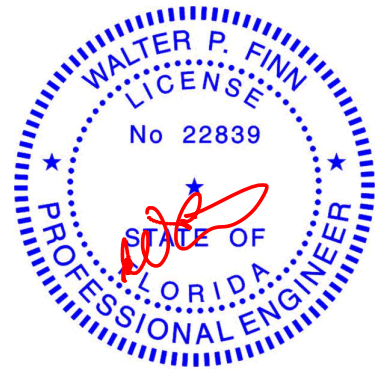

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - ABBATE RES.	T19604480
2281691	T01	Hip Girder	1	2	Job Reference (optional)	

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:17 2020 Page 2
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-flUxO4hp2WNivLOguwjz6e8NQkP5hQtULFsMJKze0a4

NOTES-

9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 125 lb down and 100 lb up at 7-0-0, 106 lb down and 100 lb up at 9-0-12, 106 lb down and 100 lb up at 11-0-12, 114 lb down and 103 lb up at 13-0-12, 114 lb down and 103 lb up at 15-0-12, 114 lb down and 103 lb up at 17-0-0, 114 lb down and 103 lb up at 18-11-4, 114 lb down and 103 lb up at 20-11-4, 106 lb down and 100 lb up at 22-11-4, and 106 lb down and 100 lb up at 24-11-4, and 227 lb down and 252 lb up at 27-0-0 on top chord, and 294 lb down and 335 lb up at 7-0-0, 85 lb down and 82 lb up at 9-0-12, 85 lb down and 82 lb up at 11-0-12, 87 lb down and 21 lb up at 13-0-12, 87 lb down and 21 lb up at 15-0-12, 87 lb down and 21 lb up at 17-0-0, 87 lb down and 21 lb up at 18-11-4, 87 lb down and 21 lb up at 20-11-4, 85 lb down and 82 lb up at 22-11-4, and 85 lb down and 82 lb up at 24-11-4, and 294 lb down and 335 lb up at 26-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-54, 3-7=-54, 7-9=-54, 2-8=-20

Concentrated Loads (lb)

Vert: 3=-106(F) 7=-180(F) 14=-284(F) 5=-114(F) 12=-69(F) 10=-284(F) 19=-106(F) 20=-106(F) 21=-114(F) 22=-114(F) 23=-114(F) 24=-114(F) 25=-106(F) 26=-106(F) 27=-61(F) 28=-61(F) 29=-69(F) 30=-69(F) 31=-69(F) 32=-69(F) 33=-61(F) 34=-61(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 36610

Job 2281691	Truss T02	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604481
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:18 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-7y1JcQiSpVZXUzsSdECerhVj8izQvjeavcwmze0a3

-2-0-0	4-9-8	9-0-0	17-0-0	25-0-0	29-2-8	34-0-0	36-0-0
2-0-0	4-9-8	4-2-8	8-0-0	8-0-0	4-2-8	4-9-8	2-0-0

Scale = 1:61.9

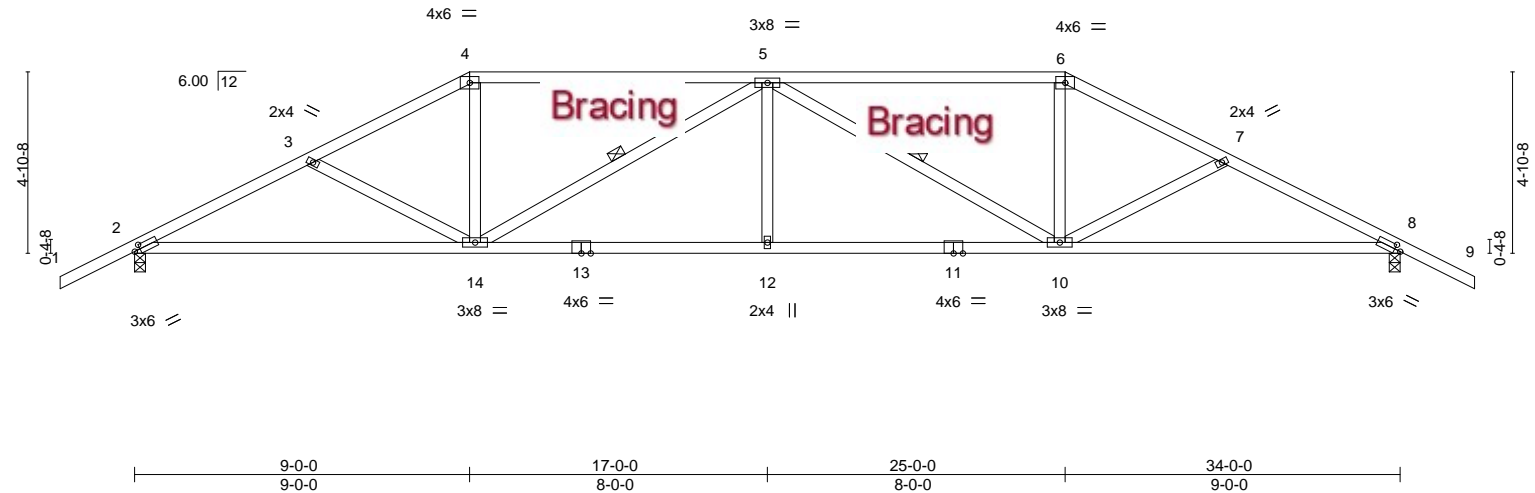


Plate Offsets (X,Y)-- [2:0-1-15,0-1-8], [8:0-1-15,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.77	Vert(LL)	-0.17 12 >999 240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.86	Vert(CT)	-0.34 10-12 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.32	Horz(CT)	0.12 8 n/a n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS				Weight: 171 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 5-10-2 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-14, 5-10

REACTIONS. (size) 2=0-3-8, 8=0-3-8
Max Horz 2=75(LC 11)
Max Uplift 2=250(LC 12), 8=250(LC 13)
Max Grav 2=1366(LC 1), 8=1366(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2349/1200, 3-4=-2104/1067, 4-5=-1856/1015, 5-6=-1856/1015, 6-7=-2104/1067, 7-8=-2349/1200
BOT CHORD 2-14=-914/2058, 12-14=-1009/2407, 10-12=-1009/2407, 8-10=-945/2058
WEBS 3-14=-253/257, 4-14=-230/617, 5-14=-732/340, 5-12=0/294, 5-10=-732/340, 6-10=-230/617, 7-10=-253/256

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=250, 8=250.

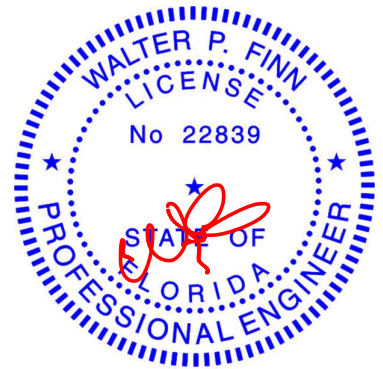

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T03	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604482
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:19 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-b8bipmj4a7dP8eY30LmRB3EI4Y7F9LwnpZLTNCze0a2

-2-0-0	5-7-15	11-0-0	17-0-0	23-0-0	28-4-1	34-0-0	36-0-0
2-0-0	5-7-15	5-4-1	6-0-0	6-0-0	5-4-1	5-7-15	2-0-0

Scale = 1:61.9

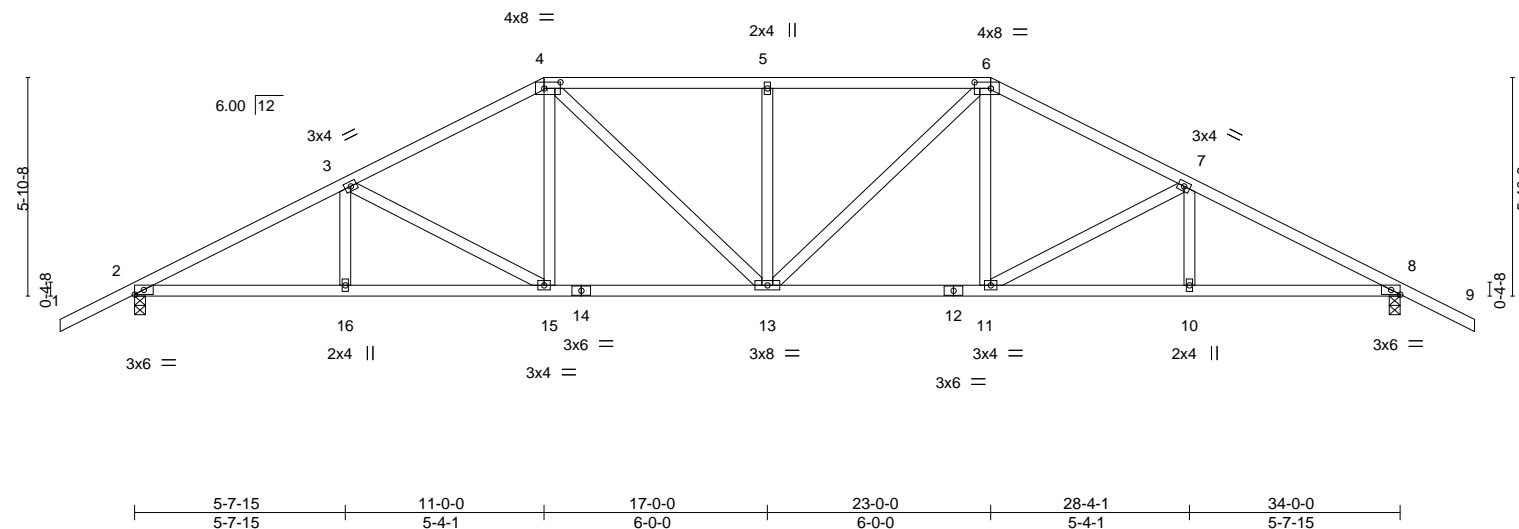


Plate Offsets (X,Y)--		[4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [8:0-2-15,Edge]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.41	Vert(LL)	-0.14 13	>999	240
TCDL 7.0	Lumber DOL	1.25	BC 0.54	Vert(CT)	-0.26 13-15	>999	180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.32	Horz(CT)	0.10 8	n/a	n/a
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 184 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-7-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-1-15 oc bracing.

REACTIONS.

(size) 2=0-3-8, 8=0-3-8
Max Horz 2=88(LC 11)
Max Uplift 2=266(LC 12), 8=266(LC 13)
Max Grav 2=1366(LC 1), 8=1366(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2365/1186, 3-4=-1944/1031, 4-5=-1940/1105, 5-6=-1940/1105, 6-7=-1944/1031,
7-8=-2365/1186
BOT CHORD 2-16=-895/2061, 15-16=-895/2061, 13-15=-634/1684, 11-13=-639/1684, 10-11=-925/2061,
8-10=-925/2061
WEBS 3-15=-440/328, 4-15=-123/384, 4-13=-175/459, 5-13=-369/272, 6-13=-175/459,
6-11=-123/384, 7-11=-440/328

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=266, 8=266.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T04	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604483
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:20 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-3K9406jilRIGmo7Fa2HkgGmvJxRgulyw2D50wfe0a1



Scale = 1:62.9


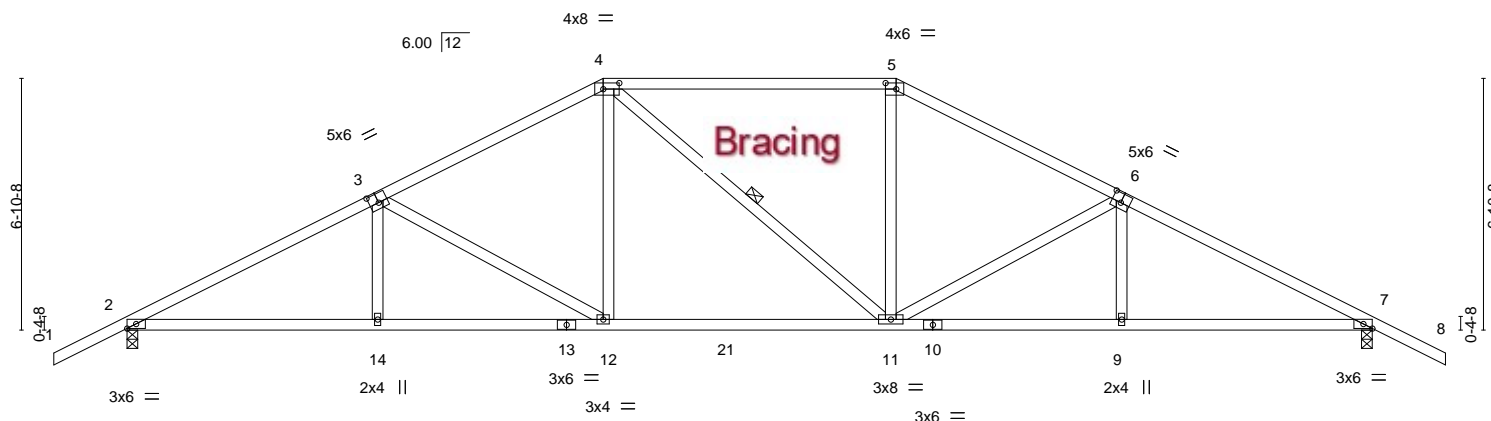


Plate Offsets (X,Y)-- [3:0-3-0,0-3-0], [4:0-5-4,0-2-0], [5:0-3-8,0-2-0], [6:0-3-0,0-3-0], [7:0-2-15,Edge]															
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL		1.25		TC 0.51		Vert(LL)		-0.16 11-12 >999 240		MT20		244/190	
TCDL	7.0	Lumber DOL		1.25		BC 0.65		Vert(CT)		-0.32 11-12 >999 180					
BCLL	0.0 *	Rep Stress Incr		YES		WB 0.53		Horz(CT)		0.10 7 n/a n/a					
BCDL	10.0	Code FBC2017/TPI2014				Matrix-MS						Weight: 176 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
4-5: 2x4 SP M 31
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-1-9 oc bracing.
WEBS 1 Row at midpt 4-11

REACTIONS.


(size) 2=0-3-8, 7=0-3-8
Max Horz 2=-102(LC 10)
Max Uplift 2=-280(LC 12), 7=-280(LC 13)
Max Grav 2=1366(LC 1), 7=1366(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2321/1181, 3-4=-1808/990, 4-5=-1555/955, 5-6=-1809/990, 6-7=-2321/1181
BOT CHORD 2-14=-882/2012, 12-14=-882/2013, 11-12=-556/1555, 9-11=-905/2013, 7-9=-906/2012
WEBS 3-14=0/256, 3-12=-535/399, 4-12=-147/476, 5-11=-145/477, 6-11=-535/399, 6-9=0/255

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 2=280, 7=280.

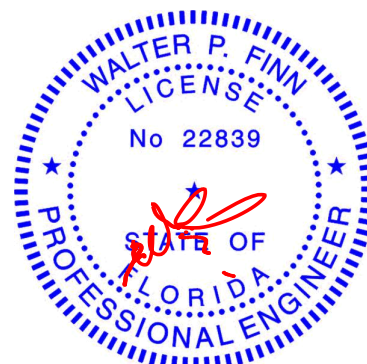

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T05	Truss Type Hip	Qty 2	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604484
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:21 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-XXjSESskK6kt7OyiR7movGUJ1BLmMdGN4GtqaS5ze0a0

-2-0-0	7-10-12	15-0-0	19-0-0	26-1-4	34-0-0
2-0-0	7-10-12	7-1-4	4-0-0	7-1-4	7-10-12

Scale = 1:60.5

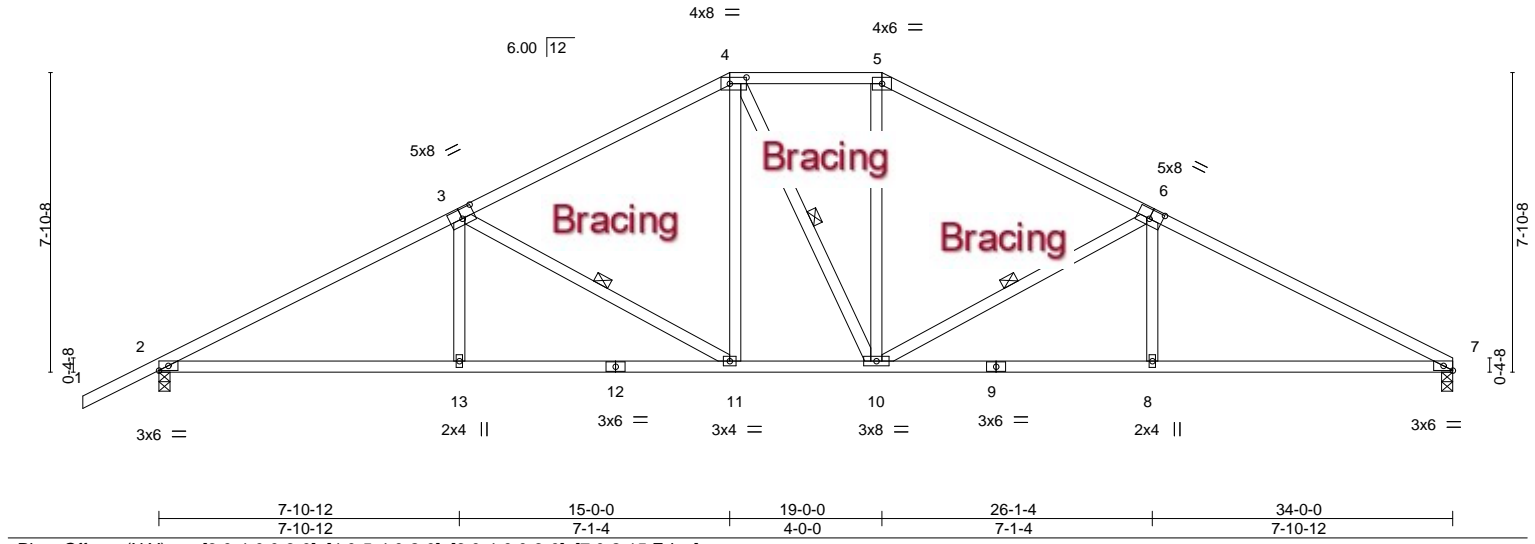


Plate Offsets (X, Y)--		[3:0-4-0,0-3-0], [4:0-5-4,0-2-0], [6:0-4-0,0-3-0], [7:0-2-15,Edge]
LOADING (psf)	SPACING-	2-0-0
TCLL 20.0	Plate Grip DOL	1.25
TCDL 7.0	Lumber DOL	1.25
BCLL 0.0 *	Rep Stress Incr	YES
BCDL 10.0	Code FBC2017/TPI2014	
	CSI.	
	TC 0.69	
	BC 0.75	
	WB 0.26	
	Matrix-MS	
	DEFL.	
	Vert(LL) 0.13	in (loc) 8-19
	Vert(CT) -0.26	8-19
	Horz(CT) 0.10	7 n/a
	L/d	240
	PLATES	MT20
	GRIP	244/190
	Weight: 179 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-8-0 oc bracing.
WEBS 1 Row at midpt 3-11, 4-10, 6-10

REACTIONS.


(size) 2=0-3-8, 7=0-3-8
Max Horz 2=120(LC 16)
Max Uplift 2=293(LC 12), 7=254(LC 13)
Max Grav 2=1369(LC 1), 7=1255(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2292/1188, 3-4=-1658/955, 4-5=-1403/929, 5-6=-1660/957, 6-7=-2313/1207
BOT CHORD 2-13=-945/1978, 11-13=-945/1978, 10-11=-525/1401, 8-10=-965/1999, 7-8=-965/2000
WEBS 3-13=0/328, 3-11=-672/486, 4-11=-203/444, 5-10=-208/446, 6-10=-696/507, 6-8=0/330

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=293, 7=254.

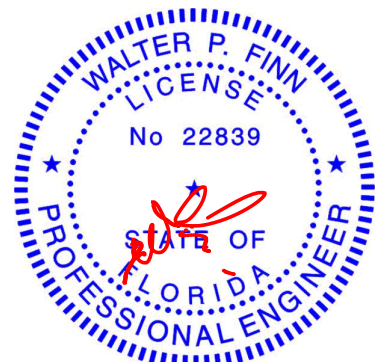

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:24 2020 Page 1
ID:0jzdHwz4t3G8RvK9CCx?GtzeO?s-v6PasTnCoFiFPR0puLcu6xVQZmNgRgWvr3E2Qze0Zz

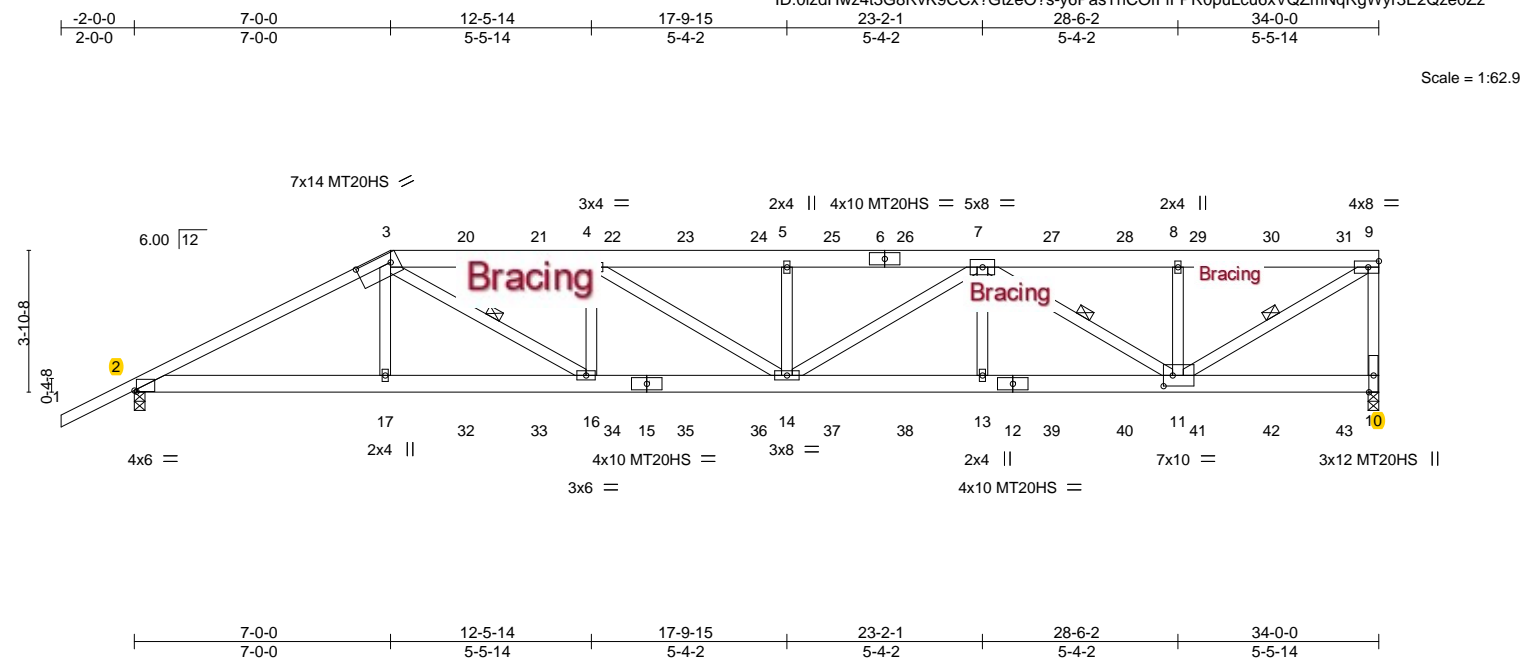


Plate Offsets (X,Y)-- [2:0-0-11,0-0-6], [3:0-11-4,0-3-0], [11:0-3-0,0-3-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.88	Vert(LL)	0.40	14	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.80	Vert(CT)	0.55	14-16	>742	180	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.99	Horz(CT)	-0.12	10	n/a	n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS							Weight: 228 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.2 *Except*
1-3: 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-	
TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 3-0-14 oc bracing.
WEBS	1 Row at midpt 3-16, 7-11, 9-11

REACTIONS. (size) 10=0-3-8, 2=0-3-8
 Max Horz 2=144(LC 34)
 Max Uplift 10=1824(LC 5), 2=1657(LC 8)
 Max Grav 10=2125(LC 43), 2=1948(LC 43)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD
2-3=-3868/3611, 3-4=-4904/4941, 4-5=-5247/5204, 5-7=-5247/5204, 7-8=-2845/2508,
8-9=-2845/2508, 9-10=-1996/1739

BOT CHORD
2-17=-3254/3398, 16-17=-3239/3379, 14-16=-4939/4902, 13-14=-4228/4560,
11-13=-4228/4560

WEBS
3-17=-362/617, 7-16=-2059/1829, 4-16=-650/466, 4-14=-330/419, 5-14=-364/203,
7-14=-1158/922, 7-13=-161/406, 7-11=-2035/2042, 8-11=-620/339, 9-11=-2943/3335

NOTES-


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=1824, 2=1657.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 125 lb down and 100 lb up at 7-0-0, 106 lb down and 100 lb up at 9-0-12, 27 lb down and 54 lb up at 11-0-12, 27 lb down and 54 lb up at 13-0-12, 27 lb down and 54 lb up at 15-0-12, 27 lb down and 54 lb up at 17-0-12, 27 lb down and 54 lb up at 19-0-12, 106 lb down and 100 lb up at 21-0-12, 106 lb down and 100 lb up at 23-0-12, 106 lb down and 100 lb up at 25-0-12, 106 lb down and 100 lb up at 27-0-12, 106 lb down and 100 lb up at 29-0-12, and 106 lb down and 100 lb up at 31-0-12, and 112 lb down and 99 lb up at 33-0-12 on top chord, and 294 lb down and 335 lb up at 7-0-0, 85 lb down and 82 lb up at 9-0-12, 210 lb down and 270 lb up at 11-0-12, 210 lb down and 270 lb up at 13-0-12, 210 lb down and 270 lb up at 15-0-12, 210 lb down and 270 lb up at 17-0-12, 210 lb down and 270 lb up at 19-0-12, 85 lb down and 82 lb up at 21-0-12, 85 lb down and 82 lb up at 23-0-12, 85 lb down and 82 lb up at 25-0-12, 85 lb down and 82 lb up at 27-0-12, 85 lb down and 82 lb up at 29-0-12, and 85 lb down and 82 lb up at 31-0-12, and 89 lb down and 80 lb up at 33-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Continued on page 2

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

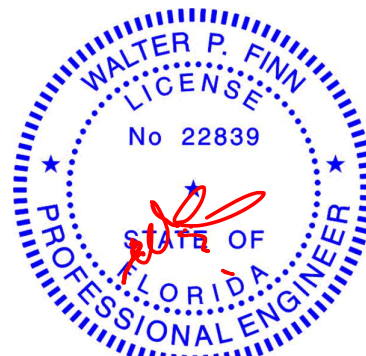

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - ABBATE RES.	T19604485
2281691	T06	Half Hip Girder	1	1	Job Reference (optional)	

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-3=-54, 3-9=-54, 2-10=-20
- Concentrated Loads (lb)
- Vert: 3=-106(B) 17=-284(B) 13=-61(B) 7=-106(B) 20=-106(B) 21=-21(B) 22=-21(B) 23=-21(B) 24=-21(B) 25=-21(B) 26=-106(B) 27=-106(B) 28=-106(B) 29=-106(B) 30=-106(B) 31=-112(B) 32=-61(B) 33=252(B) 34=252(B) 35=252(B) 36=252(B) 37=252(B) 38=-61(B) 39=-61(B) 40=-61(B) 41=-61(B) 42=-61(B) 43=-63(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 36610

Job 2281691	Truss T07	Truss Type Half Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604486
----------------	--------------	------------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:25 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-Qlyz4pnr9zNZsZ?CMbsrRKUm3y5SZzzgBVonasze0Zy

-2-0-0	4-9-8	9-0-0	14-8-9	21-6-0	28-3-6	34-0-0
2-0-0	4-9-8	4-2-8	5-8-9	6-9-6	6-9-6	5-8-10

Scale = 1:60.6

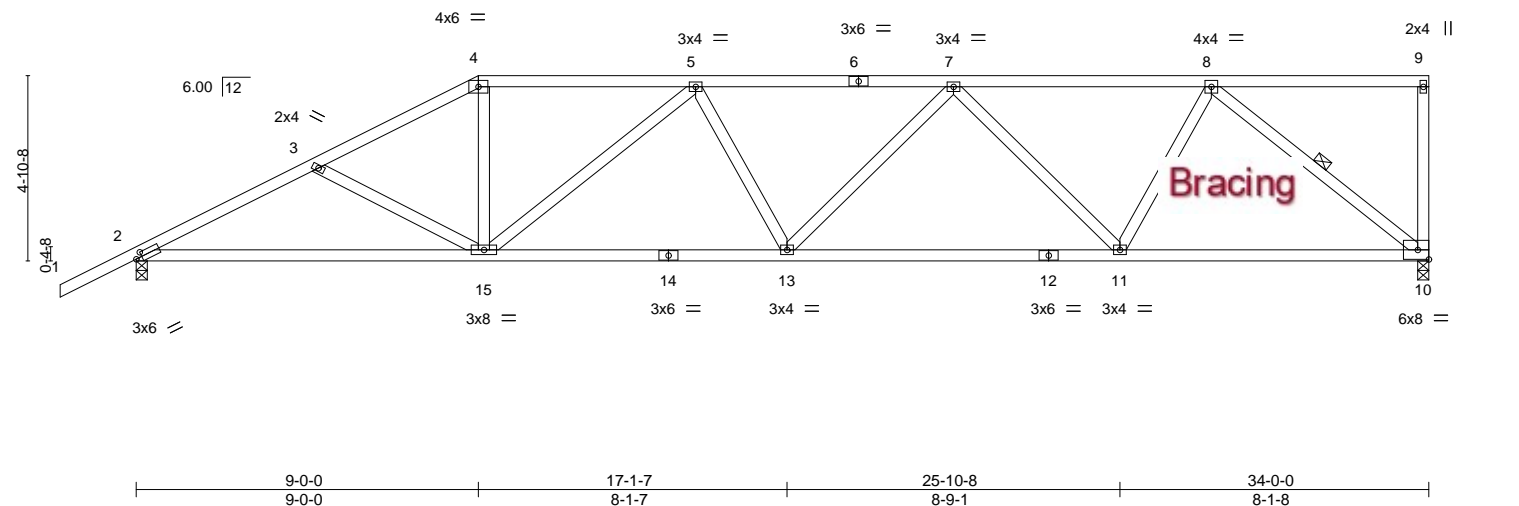


Plate Offsets (X,Y)-- [2-0-1-15,0-1-8]		9-0-0 9-0-0		17-1-7 8-1-7		25-10-8 8-9-1		34-0-0 8-1-8	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.44	Vert(LL)	-0.15 13-15	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.87	Vert(CT)	-0.34 11-13	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.11 10	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 180 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 5-4-10 oc bracing.
WEBS 1 Row at midpt 8-10

REACTIONS.


(size) 10=0-3-8, 2=0-3-8
Max Horz 2=180(LC 12)
Max Uplift 10=-325(LC 9), 2=-267(LC 9)
Max Grav 10=1249(LC 1), 2=1364(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2348/1163, 3-4=-2092/1023, 4-5=-1842/973, 5-7=-2305/1152, 7-8=-1670/806
BOT CHORD 2-15=-1202/2058, 13-15=-1197/2295, 11-13=-1115/2165, 10-11=-666/1304
WEBS 3-15=-269/268, 4-15=-257/668, 5-15=-665/297, 7-13=-54/264, 7-11=-716/448, 8-11=-301/789, 8-10=-1663/855

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=325, 2=267.

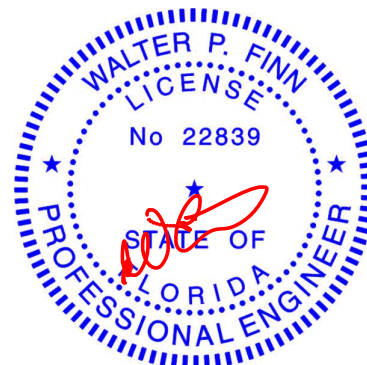

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T08	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604487
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:26 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-uUWLH9oTwHVQUjaPwJO4zX0xyMWJIVHpQ9YL6Ize0Zx

-2-0-0 2-0-0	5-7-15 5-7-15	11-0-0 5-4-1	17-0-0 6-0-0	23-0-0 6-0-0	28-4-1 5-4-1	34-0-0 5-7-15
-----------------	------------------	-----------------	-----------------	-----------------	-----------------	------------------

Scale = 1:60.4

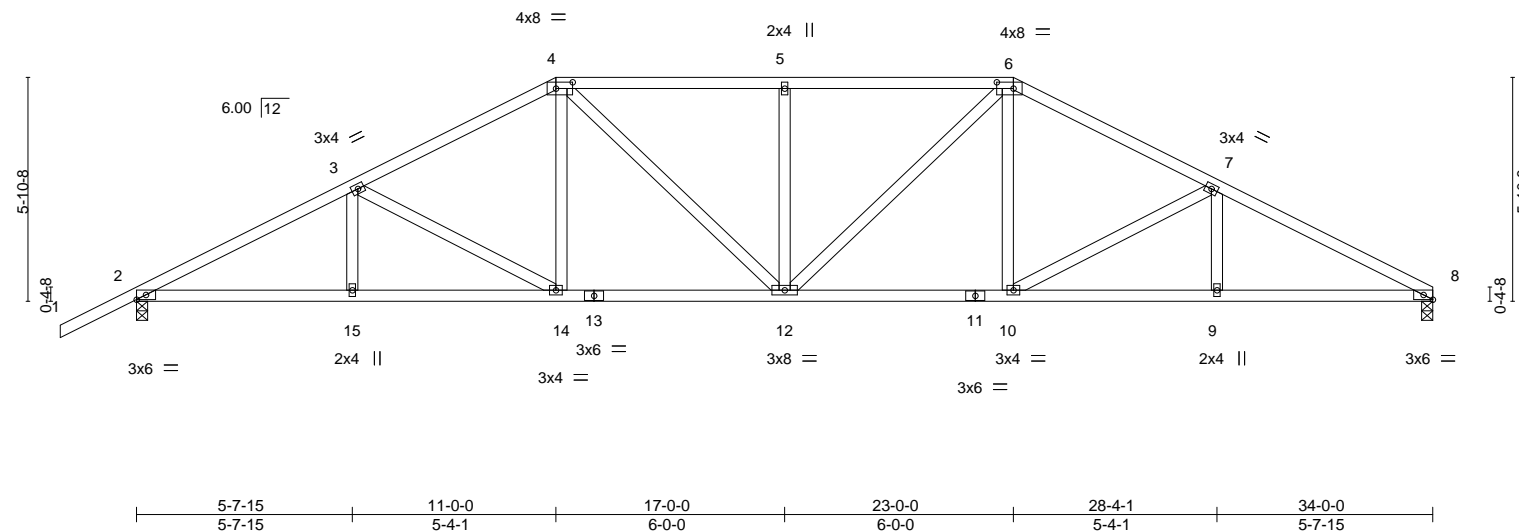


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [8:0-2-15,Edge]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.43	Vert(LL)	-0.14 12 >999 240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.57	Vert(CT)	-0.27 10-12 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.10 8 n/a n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS				Weight: 180 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-9-8 oc bracing.

REACTIONS.

(size) 8=0-3-8, 2=0-3-8
Max Horz 2=96(LC 16)
Max Uplift 8=228(LC 13), 2=267(LC 12)
Max Grav 8=1255(LC 1), 2=1369(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2372/1198, 3-4=-1951/1044, 4-5=-1949/1122, 5-6=-1949/1122, 6-7=-1958/1050,
7-8=-2405/1228
BOT CHORD 2-15=-983/2067, 14-15=-983/2067, 12-14=-697/1690, 10-12=-702/1696, 9-10=-1014/2101,
8-9=-1014/2101
WEBS 3-14=-440/327, 4-14=-123/383, 4-12=-179/464, 5-12=-369/273, 6-12=-169/458,
6-10=-133/386, 7-10=-472/357

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=228, 2=267.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T09	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. T19604488
Builders FirstSource, Jacksonville, FL - 32244,					

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:27 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-Mh4jUVp5hadH6t9bU0vJWIZ48mq41vJyfpHufze0Zw

-2-0-0	6-10-2	13-0-0	21-0-0	27-1-14	34-0-0
2-0-0	6-10-2	6-1-14	8-0-0	6-1-14	6-10-2

Scale = 1:60.5

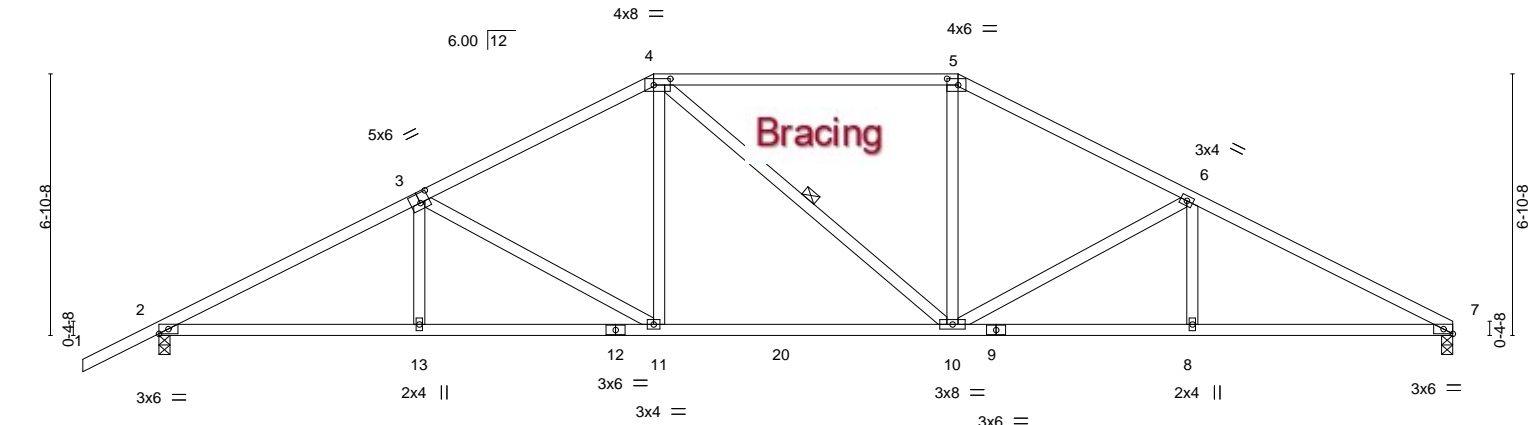


Plate Offsets (X,Y)--	[3:0-3-0,0-3-0], [4:0-5-4,0-2-0], [5:0-3-8,0-2-0], [7:0-2-15,Edge]
-----------------------	--


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53	Vert(LL)	-0.16 10-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.67	Vert(CT)	-0.32 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.55	Horz(CT)	0.10 7	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS						
									Weight: 173 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except*	TOP CHORD Structural wood sheathing directly applied or 3-3-7 oc purlins.
4-5: 2x4 SP M 31	BOT CHORD Rigid ceiling directly applied or 5-8-15 oc bracing.
BOT CHORD 2x4 SP No.2	WEBS 1 Row at midpt 4-10
WEBS 2x4 SP No.3	

REACTIONS.	(size) 7=0-3-8, 2=0-3-8
Max Horz	2=108(LC 12)
Max Uplift	7=-242(LC 13), 2=-281(LC 12)
Max Grav	7=1255(LC 1), 2=1369(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2328/1193, 3-4=-1815/1003, 4-5=-1564/969, 5-6=-1819/1007, 6-7=-2352/1215
BOT CHORD	2-13=-963/2018, 11-13=-963/2019, 10-11=-617/1561, 8-10=-985/2043, 7-8=-985/2043
WEBS	3-13=0/255, 3-11=-535/398, 4-11=-148/477, 5-10=-155/479, 6-10=-560/423, 6-8=0/259

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 7=242, 2=281.

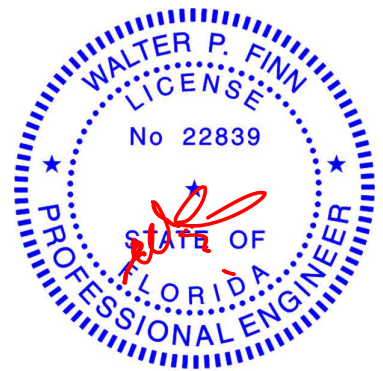

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T10	Truss Type Common	Qty 2	Ply 1	BLAKE - ABBATE RES. T19604489
Job Reference (optional)					

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:29 2020 Page 1
ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-I3CTvBqLDCt?LBj_bRxnbaeRjaTTVipF67m?jdz0Zu

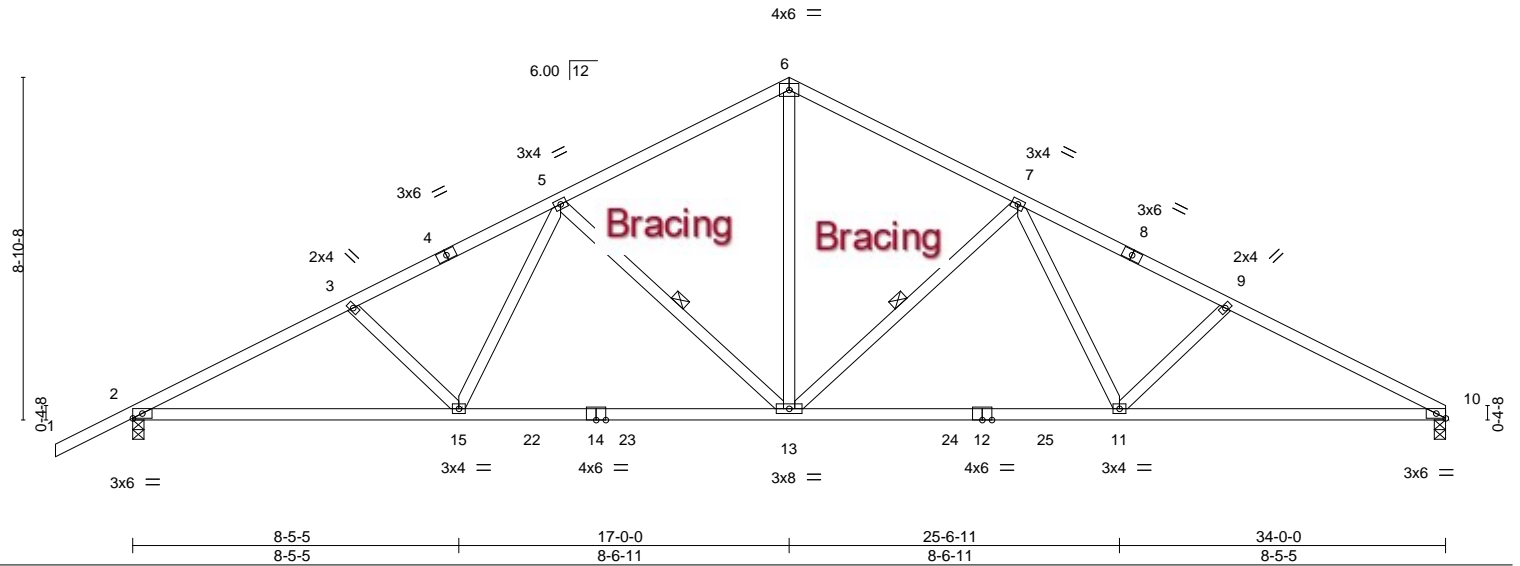


Plate Offsets (X,Y)-- [10:0-2-15,Edge]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46	Vert(LL)	-0.19 13-15	>999	240
TCDL 7.0	Lumber DOL	1.25	BC 0.80	Vert(CT)	-0.36 13-15	>999	180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.81	Horz(CT)	0.10 10	n/a	n/a
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 175 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-8-0 oc bracing.
WEBS 1 Row at midpt 7-13, 5-13

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
Max Horz 2=133(LC 16)
Max Uplift 2=303(LC 12), 10=264(LC 13)
Max Grav 2=1369(LC 1), 10=1255(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2342/1256, 3-5=-2134/1188, 5-6=-1493/929, 6-7=-1493/929, 7-9=-2155/1207,
9-10=-2355/1279
BOT CHORD 2-15=-1032/2043, 13-15=-765/1684, 11-13=-772/1692, 10-11=-1058/2072
WEBS 6-13=-574/970, 7-13=-595/460, 7-11=-182/462, 9-11=-287/296, 5-13=-585/451,
5-15=-163/457, 3-15=-270/280

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 2=303, 10=264.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T11	Truss Type Hip Girder	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604490
----------------	--------------	--------------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:30 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-nFms7Xrz_V?szKuA99S08NBclzpWEKfPLnWYF4ze0Zt



Scale = 1:39.1

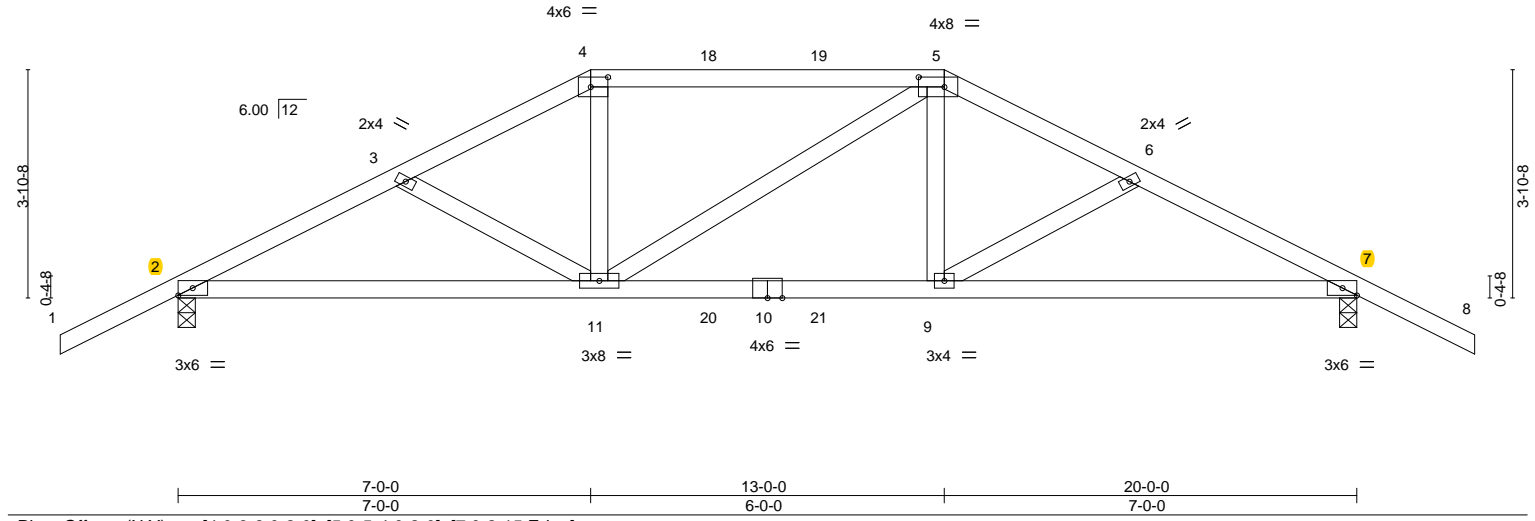


Plate Offsets (X,Y)-- [4:0-3-8,0-2-0], [5:0-5-4,0-2-0], [7:0-2-15,Edge]							
LOADING (psf)	SPACING	2-0-0	CSI	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.51	Vert(LL)	0.20 9-11	>999	240
TCDL 7.0	Lumber DOL	1.25	BC 0.81	Vert(CT)	-0.22 9-11	>999	180
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.26	Horz(CT)	0.07 7	n/a	n/a
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 99 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
4-5: 2x4 SP M 31
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 4-9-4 oc bracing.

REACTIONS.

(size) 2=0-3-8, 7=0-3-8
Max Horz 2=-61(LC 6)
Max Uplift 2=-832(LC 5), 7=-862(LC 4)
Max Grav 2=1431(LC 1), 7=1453(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2517/1593, 3-4=-2373/1585, 4-5=-2133/1459, 5-6=-2419/1650, 6-7=-2564/1659
BOT CHORD 2-11=-1409/2201, 9-11=-1428/2172, 7-9=-1430/2243
WEBS 4-11=-445/674, 5-9=-422/662

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope); porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=832, 7=862.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 125 lb down and 100 lb up at 7-0-0, 106 lb down and 100 lb up at 9-0-12, and 106 lb down and 100 lb up at 10-11-4, and 227 lb down and 252 lb up at 13-0-0 on top chord, and 294 lb down and 335 lb up at 7-0-0, 85 lb down and 82 lb up at 9-0-12, and 85 lb down and 82 lb up at 10-11-4, and 294 lb down and 335 lb up at 12-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-5=-54, 5-8=-54, 12-15=-20
Concentrated Loads (lb)
Vert: 4=-106(B) 5=-180(B) 11=-284(B) 9=-284(B) 18=-106(B) 19=-106(B) 20=-61(B) 21=-61(B)



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 36610

Job 2281691	Truss T12	Truss Type Hip	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604491
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:31 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-FSKEKtsblp7ibUTMjszFgbkl8NB4zosYZRF6oWze0Zs

-2-0-0	4-9-8	9-0-0	11-0-0	15-2-8	20-0-0	22-0-0
2-0-0	4-9-8	4-2-8	2-0-0	4-2-8	4-9-8	2-0-0

Scale = 1:39.1

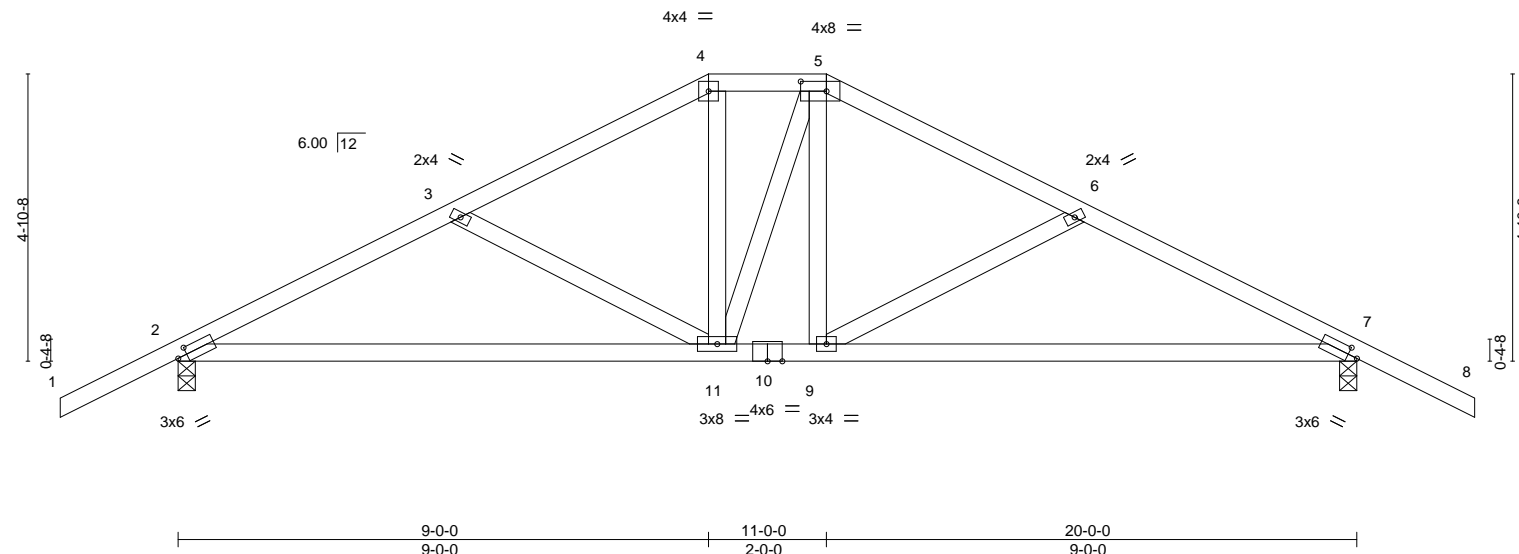


Plate Offsets (X,Y)--		[2:0-1-15,0-1-8], [5:0-5-4,0-2-0], [7:0-1-15,0-1-8]
LOADING (psf)	SPACING-	2-0-0
TCLL 20.0	Plate Grip DOL	1.25
TCDL 7.0	Lumber DOL	1.25
BCLL 0.0 *	Rep Stress Incr	YES
BCDL 10.0	Code	FBC2017/TPI2014
	CSI.	
	TC 0.59	
	BC 0.66	
	WB 0.20	
	Matrix-MS	
	DEFL.	
	in (loc)	l/defl
	Vert(LL) 0.31 9-17	>763
	Vert(CT) -0.29 9-17	>829
	Horz(CT) 0.03 7	n/a
	PLATES	GRIP
	MT20	244/190
	Weight: 104 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-1-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 4-2-1 oc bracing.

REACTIONS.


(size) 2=0-3-8, 7=0-3-8
Max Horz 2=-75(LC 10)
Max Uplift 2=-324(LC 9), 7=-324(LC 8)
Max Grav 2=848(LC 1), 7=848(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1221/1523, 3-4=-955/1303, 4-5=-807/1218, 5-6=-954/1301, 6-7=-1221/1522
BOT CHORD 2-11=-1248/1067, 9-11=-926/806, 7-9=-1272/1067
WEBS 3-11=-306/405, 4-11=-467/282, 5-9=-477/281, 6-9=-307/408

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=324, 7=324.

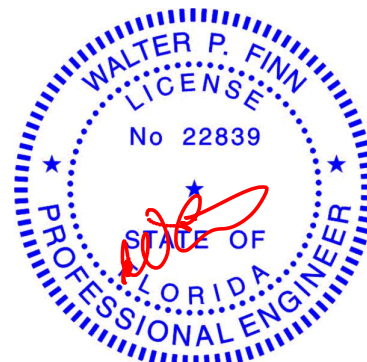

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T13	Truss Type Common	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604492
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:32 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-jeucYDtEW7GZCe2ZHaVUDoGvvnTOiBPho5?fkKye0Zr

-2-0-0	5-9-14	10-0-0	14-2-2	20-0-0	22-0-0
2-0-0	5-9-14	4-2-2	4-2-2	5-9-14	2-0-0

Scale = 1:38.5

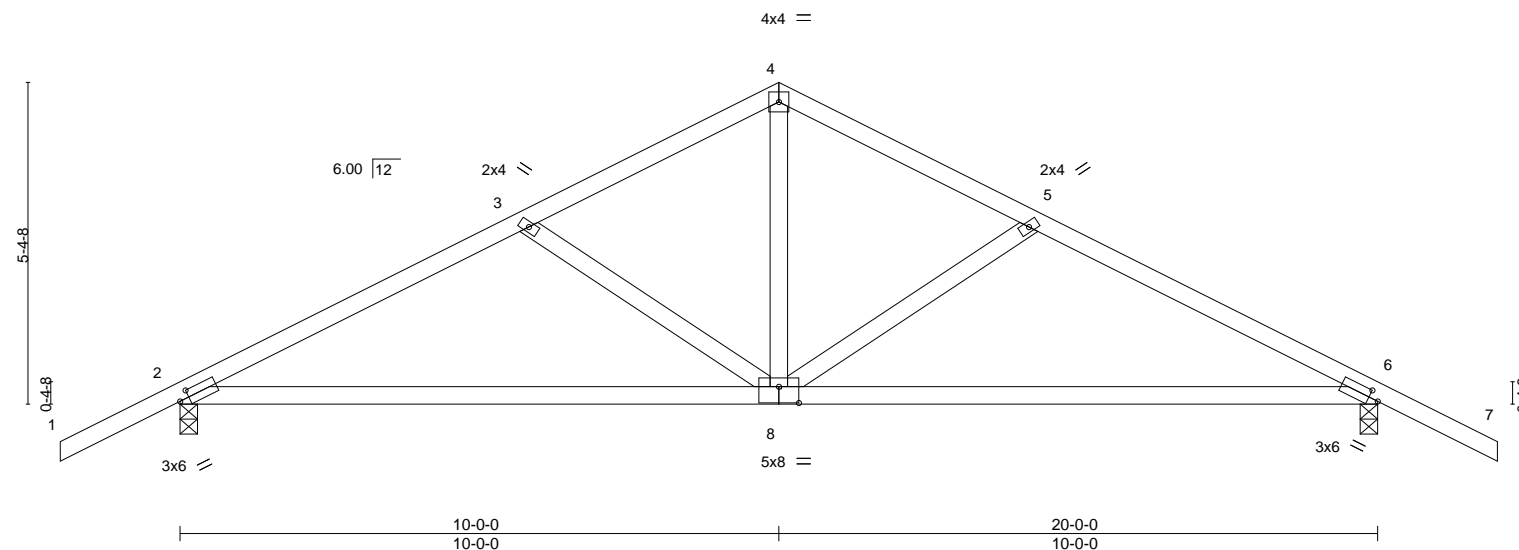


Plate Offsets (X,Y)--		[2:0-1-15,0-1-8], [6:0-1-15,0-1-8], [8:0-4-0,0-3-4]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 20.0	2-0-0	TC 0.66	in (loc) l/defl L/d
TCDL 7.0	Plate Grip DOL 1.25	BC 0.91	Vert(LL) 0.38 8-14 >626 240
BCLL 0.0 *	Lumber DOL 1.25	WB 0.50	Vert(CT) -0.34 8-14 >710 180
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.03 6 n/a n/a
	Code FBC2017/TPI2014		
			PLATES MT20
			GRIP 244/190
			Weight: 92 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=81(LC 11)
Max Uplift 2=-306(LC 9), 6=-306(LC 8)
Max Grav 2=848(LC 1), 6=848(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1173/1464, 3-4=-905/1280, 4-5=-905/1280, 5-6=-1173/1463
BOT CHORD 2-8=-1184/1015, 6-8=-1200/1015
WEBS 4-8=-1007/583, 5-8=-325/405, 3-8=-325/406

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=306, 6=306.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T14	Truss Type Hip Girder	Qty 1	Ply 1	BLAKE - ABBATE RES. T19604493
Job Reference (optional)					

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:34 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-f1?MyuuU2kWHsyBxO_XylDMLsbMHAC3_GOUmOrze0Zp



Scale = 1:22.5

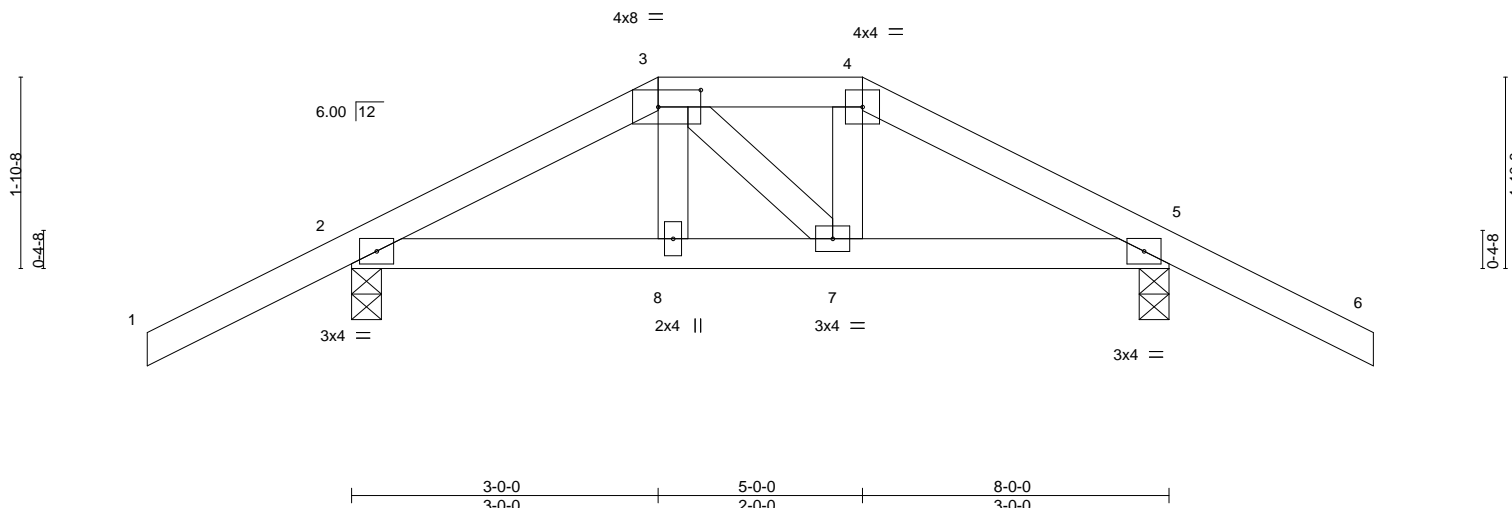


Plate Offsets (X,Y)-- [3:0-5-0,0-2-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	0.01 8	>999	240
TCDL 7.0	Lumber DOL	1.25	BC 0.12	Vert(CT)	-0.01 8-11	>999	180
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.00 5	n/a	n/a
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS				
						Weight: 39 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=-34(LC 6)
Max Uplift 2=-199(LC 4), 5=-205(LC 5)
Max Grav 2=404(LC 19), 5=404(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-380/271, 3-4=-326/251, 4-5=-396/265
BOT CHORD 2-8=-210/354, 7-8=-215/359, 5-7=-193/363

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope); porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=199, 5=205.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 26 lb down and 49 lb up at 3-0-0, and 91 lb down and 77 lb up at 5-0-0 on top chord, and 136 lb down and 82 lb up at 3-0-0, and 136 lb down and 82 lb up at 4-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-4=-54, 4-6=-54, 9-12=-20
Concentrated Loads (lb)
Vert: 3=-3(F) 4=-3(F) 8=3(F) 7=3(F)

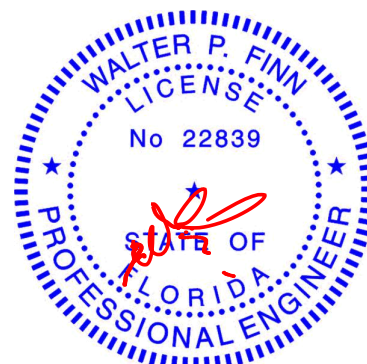

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




6904 Parke East Blvd.
Tampa, FL 33610

Job 2281691	Truss T15	Truss Type Common	Qty 1	Ply 1	BLAKE - ABBATE RES. Job Reference (optional)	T19604494
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource, Jacksonville, FL - 32244,

8.240 s Feb 7 2020 MiTek Industries, Inc. Thu Mar 5 09:02:35 2020 Page 1

ID:0izdHwz4t3G8RvK9CCx?GtzeO?s-7DZIAEv6p2e836m7yi2BrRuVN_gxvfw8U2DJxHze0Zo



Scale = 1:22.2

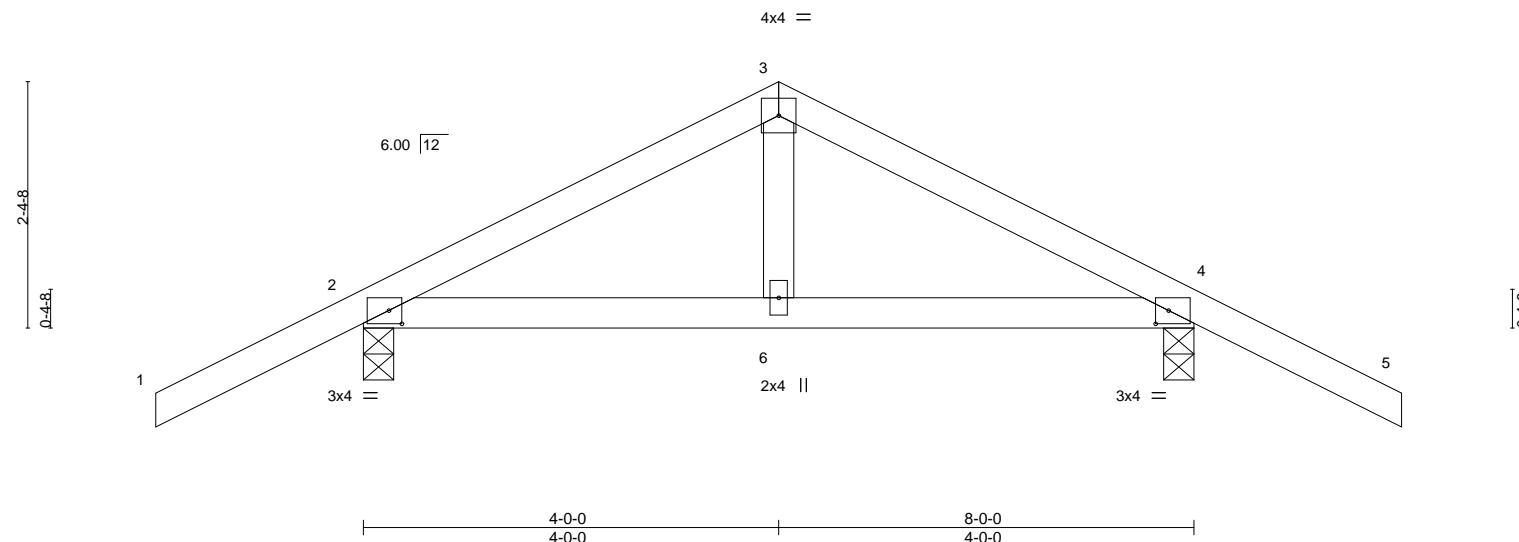


Plate Offsets (X,Y)--		[2:0-1-8,0-1-9], [4:0-1-8,0-1-9]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 20.0	Plate Grip DOL 1.25	TC 0.32	in (loc) l/defl L/d
TCDL 7.0	Lumber DOL 1.25	BC 0.16	Vert(LL) 0.02 6-12 >999 240
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Vert(CT) -0.01 6-9 >999 180
BCDL 10.0	Code FBC2017/TPI2014	Matrix-MS	Horz(CT) 0.00 4 n/a n/a
			PLATES MT20
			GRIP 244/190
			Weight: 35 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-41(LC 10)
Max Uplift 2=-136(LC 8), 4=-136(LC 9)
Max Grav 2=404(LC 1), 4=404(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-337/512, 3-4=-337/512
BOT CHORD 2-6=-316/262, 4-6=-316/262

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=136, 4=136.

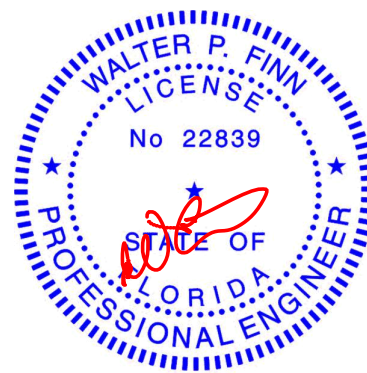

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

March 5, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



6904 Parke East Blvd.
Tampa, FL 36610

Symbols


PLATE LOCATION AND ORIENTATION

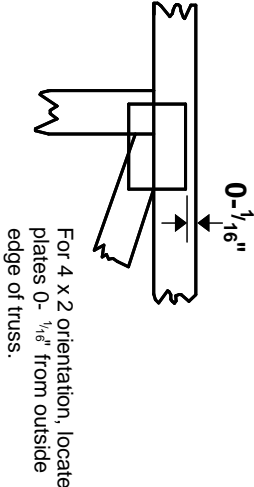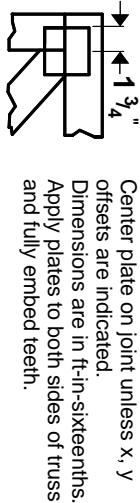


This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MiTek 20/20** software or upon request.


PLATE SIZE



LATERAL BRACING LOCATION




BEARING

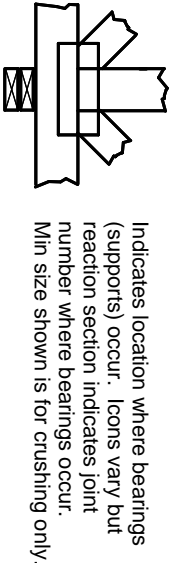

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

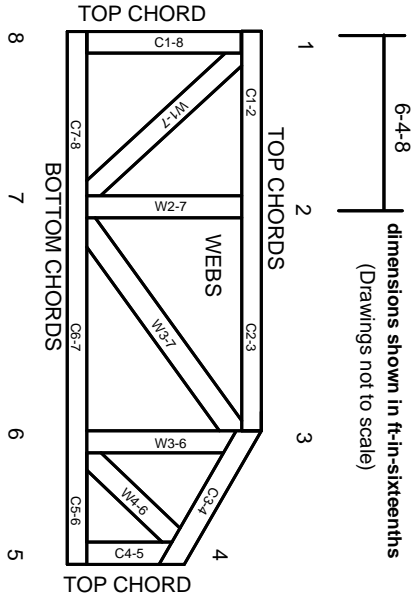

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.
CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 10/03/2015

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and ware at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.