



GENERAL INTERIOR FINISH SCHEDULE:

- FLOOR AREA:** CARPET AND PAD, PATTERN & COLOR AS PER THE OWNER OR LAMINATE STRIP WOOD - SEE OWNER FOR CHANGES
- RESTROOM FLOOR:** THINSET CERAMIC TILE OR NATURAL STONE, PAT. & COLOR AS SELECTED BY THE OWNER
- BASE:** TRIM AS PER DETAIL ON A2, COLOR AS SELECTED BY THE OWNER OR CERAMIC TILE OR STONE - MATCH WITH FLOORING
- TRIM:** COVERS, CROWN, CASINGS, CHAIRRAILS AND THE LIKE AS PER DETAIL ON A2, STAIN & VARNISH OR PAINT COLOR AS SELECTED BY THE OWNER
- WALLS:** 1/2" GIBB PRIMED AND PAINTED 2 COATS, LATEX WALL PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER
- MAIN CEILING:** 5/8" GIBB DIRECT HUNG, TAPED & FINISHED, W/ 2 COATS OF LATEX CEILING PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER
- APPLIED FINISHES:** APPLIED FINISHED TO GIBB, (e.g. SPRAY, KNOCK-DOWN, SKIP-TROUPEL AND SIMILAR TREATMENTS) AS DIRECTED BY THE OWNER
- CABINETS:** AS SELECTED BY THE OWNER MINIMUM 48" GRADE, (CUSTOM) - ALL COUNTERTOPS SHALL BE AS SELECTED BY THE OWNER

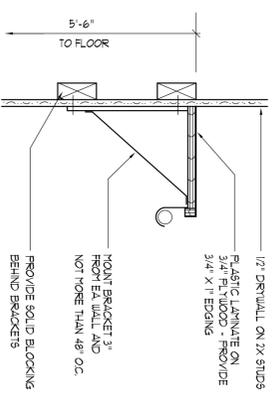


Closet Rod & Shelf Detail

SCALE: NONE

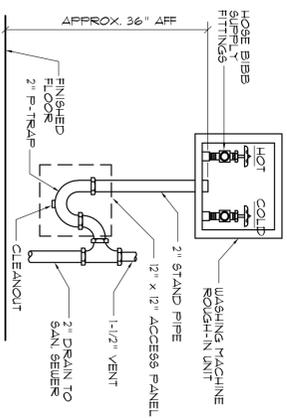


Washing Machine Det.

NT 5.

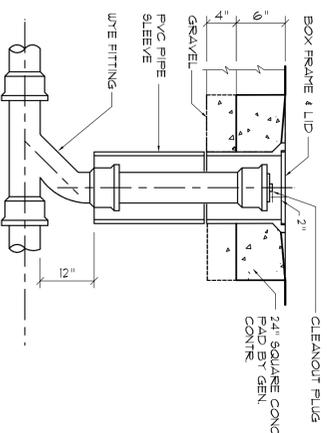


Outdoor Cleanout Detail

NT 5.

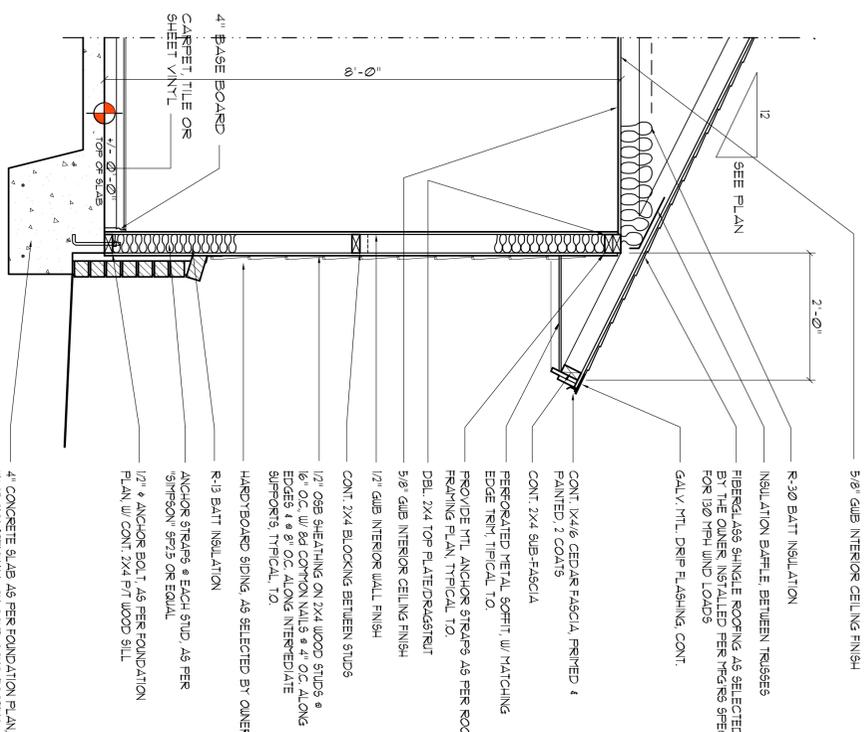

Typical 8'-11" Wall Section

SCALE: 3/4" = 1'-0"

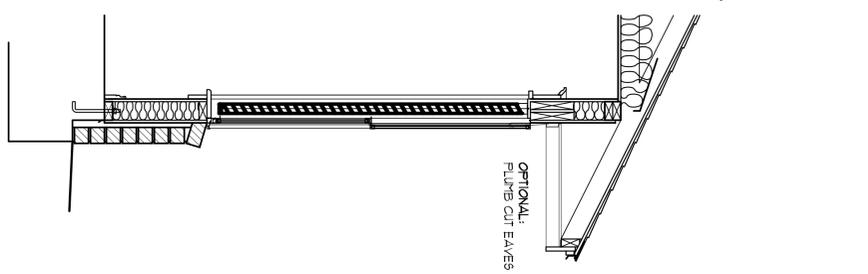


Ridge Vent Detail

SCALE: 3/4" = 1'-0"




| AREA OF ATTIC | REQD LF OF VENT | NET FREE AREA OF VENT | AREA OF ROOFING |
|---------------|-----------------|-----------------------|-----------------|
| 1400 SF | 101 LF | 450 SQ IN | 1400 SQ IN |
| 1900 SF | 141 LF | 630 SQ IN | 1900 SQ IN |
| 2400 SF | 181 LF | 810 SQ IN | 2400 SQ IN |
| 2900 SF | 221 LF | 990 SQ IN | 2900 SQ IN |
| 3400 SF | 261 LF | 1170 SQ IN | 3400 SQ IN |
| 3900 SF | 301 LF | 1350 SQ IN | 3900 SQ IN |
| 4400 SF | 341 LF | 1530 SQ IN | 4400 SQ IN |
| 4900 SF | 381 LF | 1710 SQ IN | 4900 SQ IN |
| 5400 SF | 421 LF | 1890 SQ IN | 5400 SQ IN |
| 5900 SF | 461 LF | 2070 SQ IN | 5900 SQ IN |
| 6400 SF | 501 LF | 2250 SQ IN | 6400 SQ IN |
| 6900 SF | 541 LF | 2430 SQ IN | 6900 SQ IN |
| 7400 SF | 581 LF | 2610 SQ IN | 7400 SQ IN |
| 7900 SF | 621 LF | 2790 SQ IN | 7900 SQ IN |
| 8400 SF | 661 LF | 2970 SQ IN | 8400 SQ IN |
| 8900 SF | 701 LF | 3150 SQ IN | 8900 SQ IN |
| 9400 SF | 741 LF | 3330 SQ IN | 9400 SQ IN |

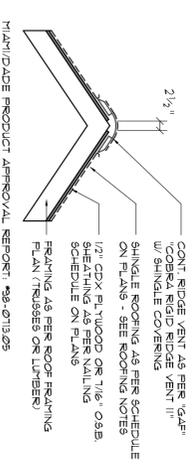


Roofing/Flashing Dets.

SCALE: NONE

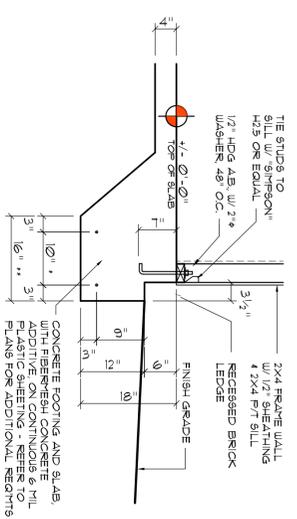


Typ. Mono. Fig. Det.

SCALE: 3/4" = 1'-0"

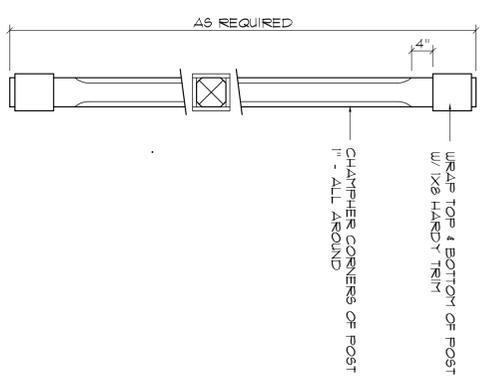

POST DETAIL

SCALE: 1" = 1'-0"

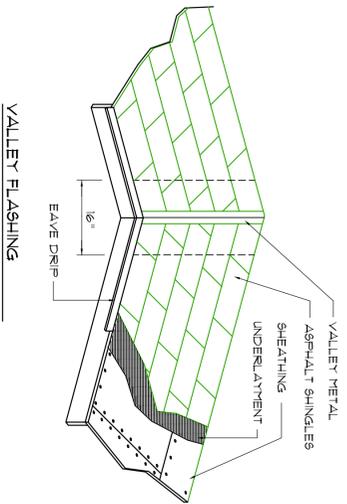

ROOFING METALS FOR FLASHING/ROOFING

MINIMUM THICKNESS REQUIREMENTS

| MATERIAL | MINIMUM THICKNESS (in.) | GAGE | WEIGHT (oz) |
|------------------|-------------------------|----------------------|-------------|
| COPPER | | | 16 |
| ALUMINUM | 0.074 | | |
| GALVANIZED STEEL | 0.0719 | 26 (ZINC COATED 950) | |

DATE: 23SEP 2025
 COM: 2K2549
 SHEET: A.4
 4 OF 9

1728 NW BROWNS RD
 SUITE 300
 386-365-4355
 DATE: 23SEP 2025
 COM: 2K2549

NOHOLAS GIBLER ARCHITECT
 ARCHITECTURAL DESIGN

1972 - 2025
 N.P. Gibler, Architect
 ARCHITECT

TOUCHSTONE CONSTRUCTION INC.
 LAKE CITY, FLORIDA
 WALL SECTION & DETAILS

REVISION:
 DRAWN: 1P8
 8/20/2025

AR0007005