

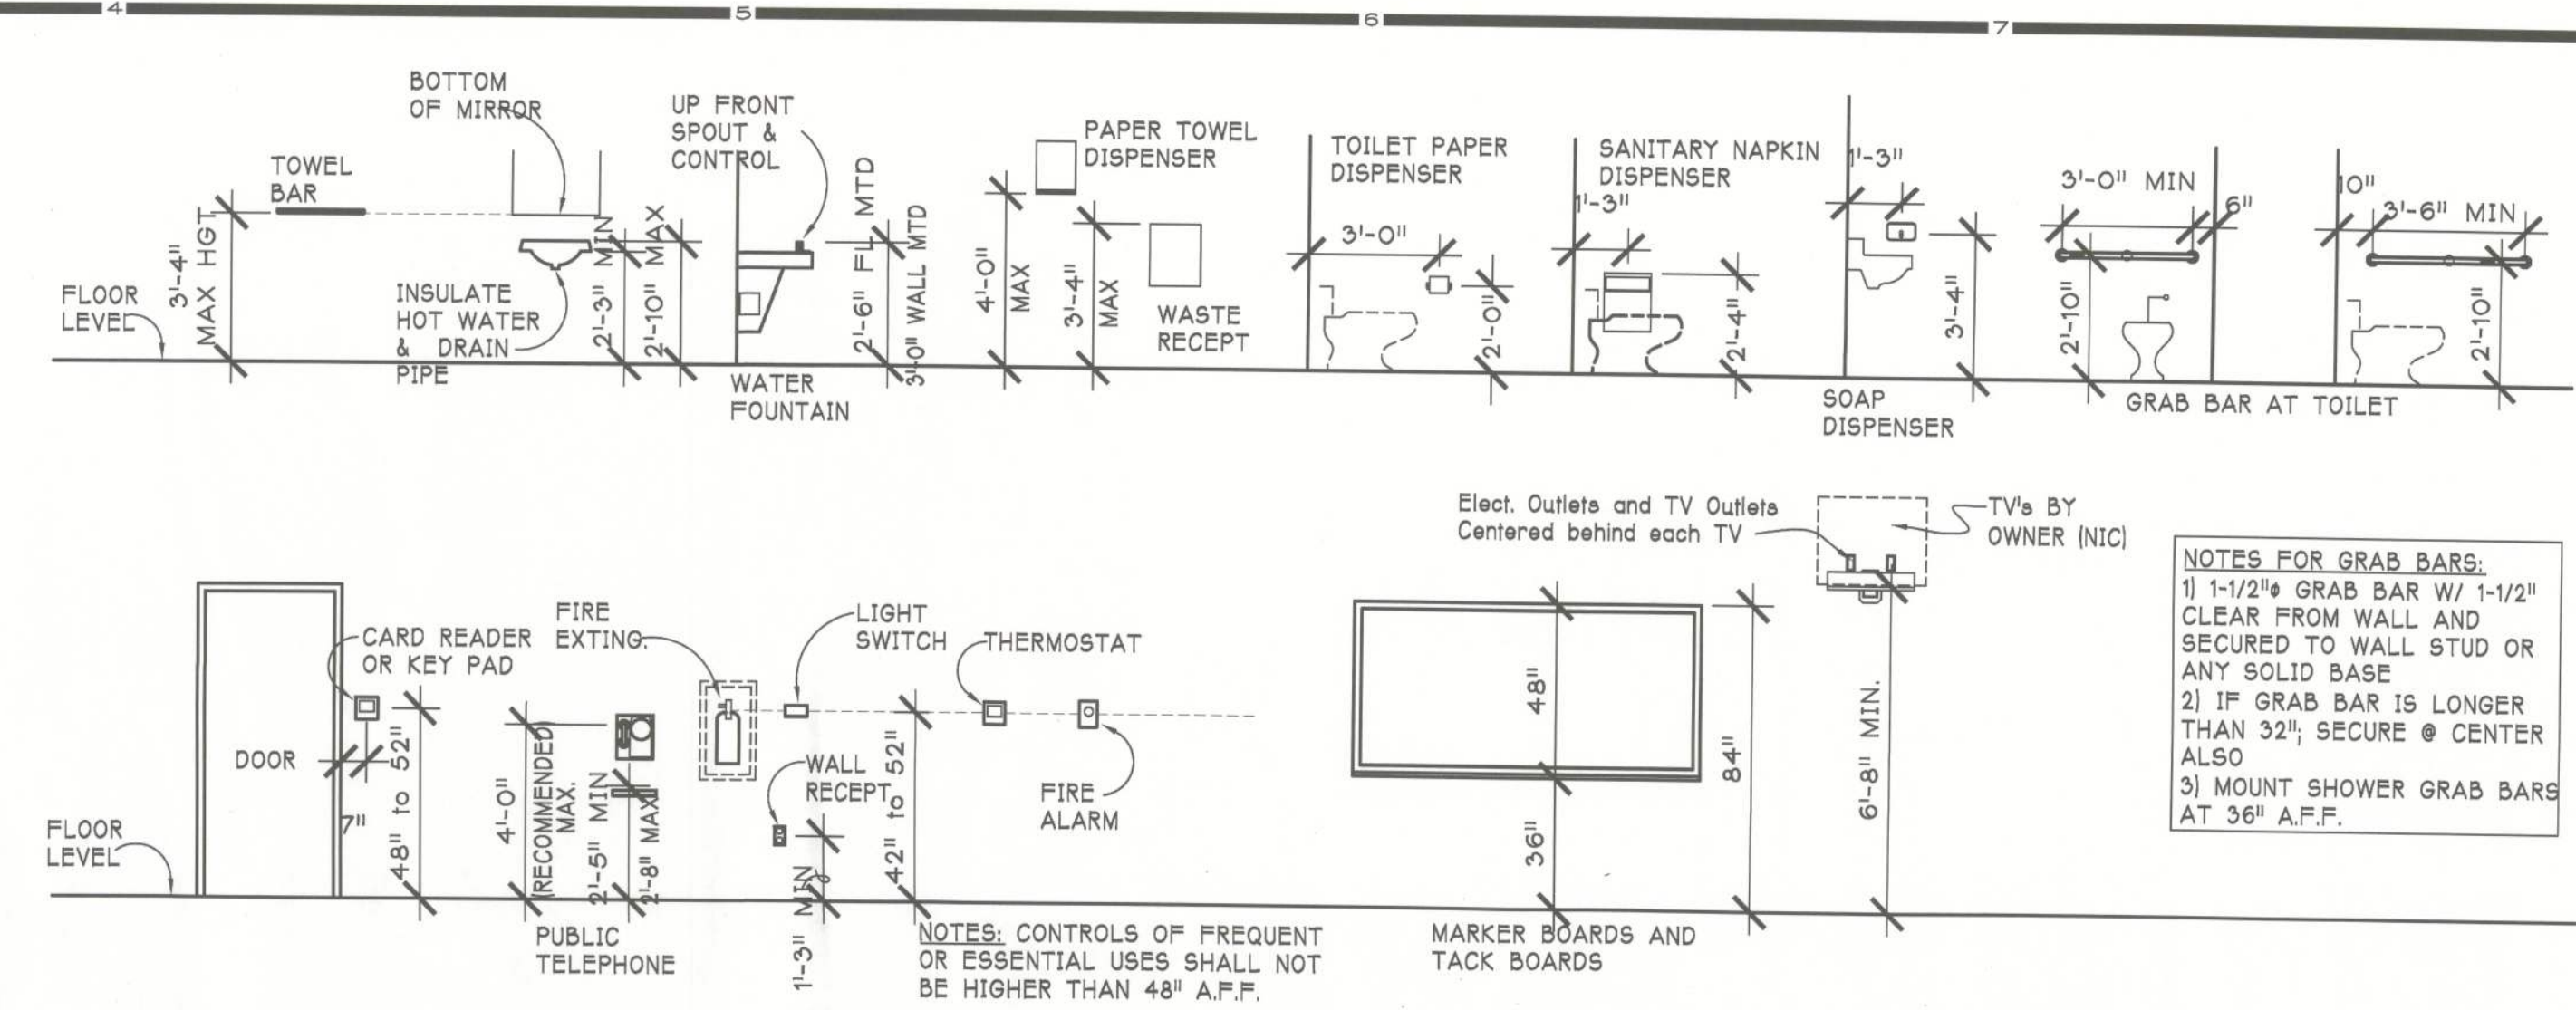
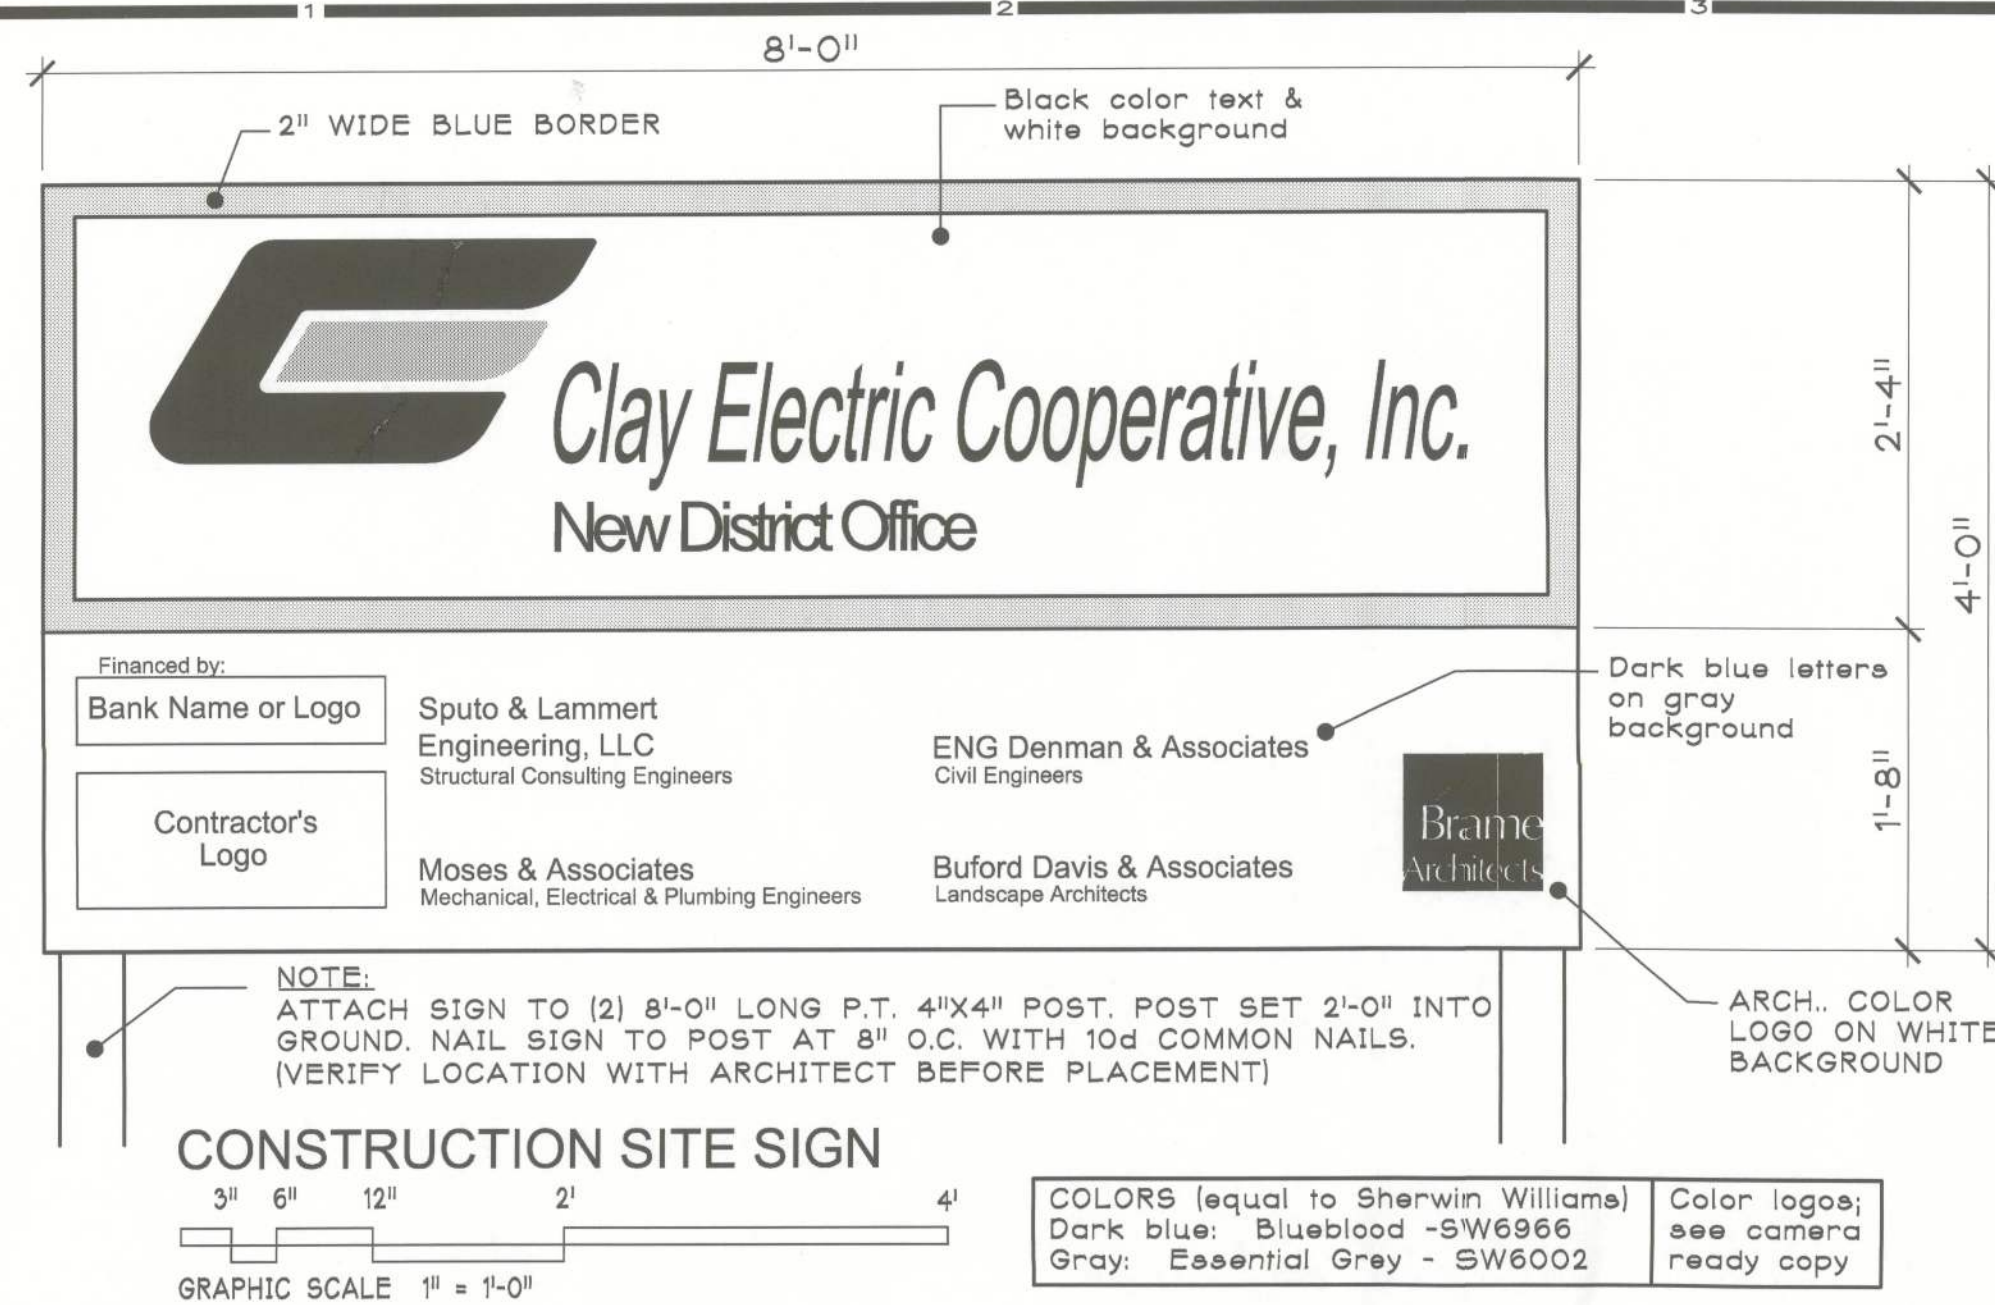


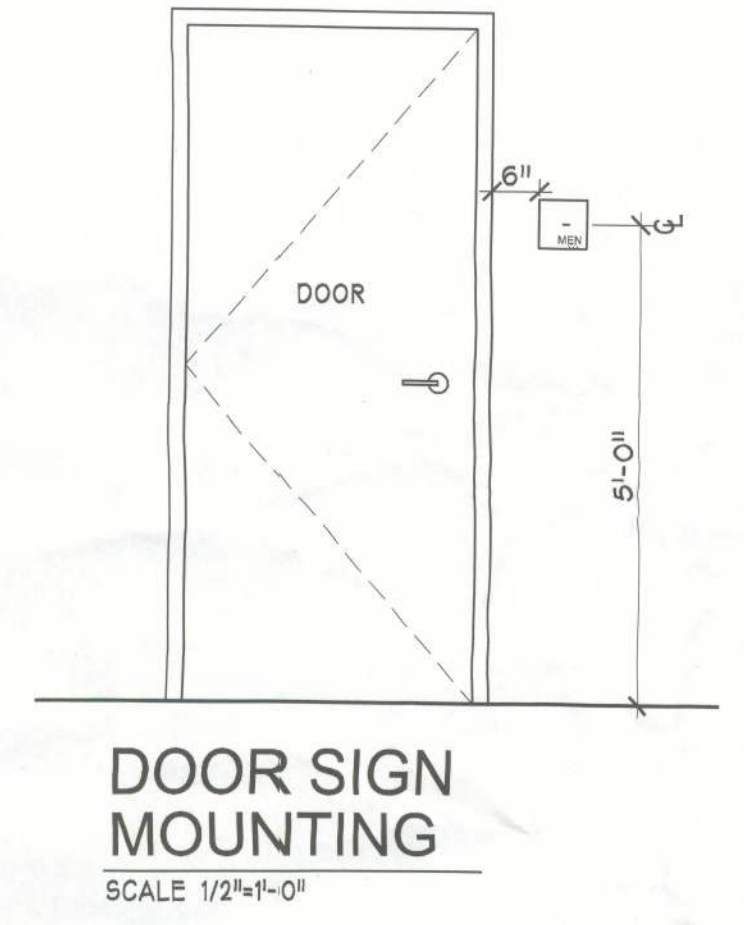

LIST OF ABBREVIATIONS:

A.F.F.	ABOVE FINISHED FLOOR	EQ	EQUAL	NOM	NOMINAL
ALUM	ALUMINUM	EQUIP	EQUIPMENT	O.A.	OVER ALL
ALT	ALTERNATE	ETC	ETCETERA	O.C.	ON CENTER
AP	ACOUSTICAL PANEL	E.W.	EACH WAY	OPNG	OPENING
APC	ACOUSTICAL PANEL CEILING	EXIST	EXISTING	P.C.	PRECAST
APP	APPLIANCE(S)	EXP.JT	EXPANSION JOINT	PERIM	PERIMETER
BD	BOARD	FL'SHG	FLASHING	PREFAB	PREFABRICATED
BLK	BLOCK	FT	FOOT/FEET	PLYWD	PLYWOOD
BOT	BOTTOM	FTG	FOOTING	P.S.	PROJECTOR SCREEN
BRG	BEARING	FURR	FURRING	P.T.	PRESSURE TREATED
B.U.R.	BUILT UP ROOF	F.W.	FRAME WIDTH	Q.T.	QUARRY TILE
C.J.	CONTROL JOINT	GA	GAUGE	RAD	RADIUS
C.L.	CHAIN LINK	GALV	GALVANIZED	REFRIG	REFRIGERATOR
CLG	CEILING	H.C.	HANDICAPPED	REINF	REINFORCED
CMU	CONCRETE MASONRY UNIT	HGT	HEIGHT	REQ'D	REQUIRED
COL	COLUMN	HORIZ	HORIZONTAL	SHT	SHEET
COMP	COMPOSITION	HW	HOT WATER	SIM	SIMILAR
CONC	CONCRETE	INSUL	INSULATION	SQ	SQUARE
CONT	CONTINUOUS	INT	INTERIOR	STL	STEEL
CTG	COATING	JST	JOIST	STRUC	STRUCTURE/STRUCTURAL
CV	CENTRAL VACUUM	JTS	JOINTS	ST STL	STAINLESS STEEL
DBL	DOUBLE	L	ANGLE	SUPP	SUPPORT
DISP	DISPENSER	MFR	MANUFACTURER	T.S.	TUBULAR STEEL
D.S.	DOWNSPOUT	MAX	MAXIMUM	TYP	TYPICAL
DWGS	DRAWINGS	MECH	MECHANICAL	U.O.N.	UNLESS OTHERWISE NOTED
EA	EACH	MIN	MINIMUM	VERT	VERTICAL
E.J.	EXPANSION JOINT	MTD	MOUNTED	W/	WITH
ELEC	ELECTRICAL	MTL	METAL	WD	WOOD
				W.W.F.	WELDED WIRE FABRIC

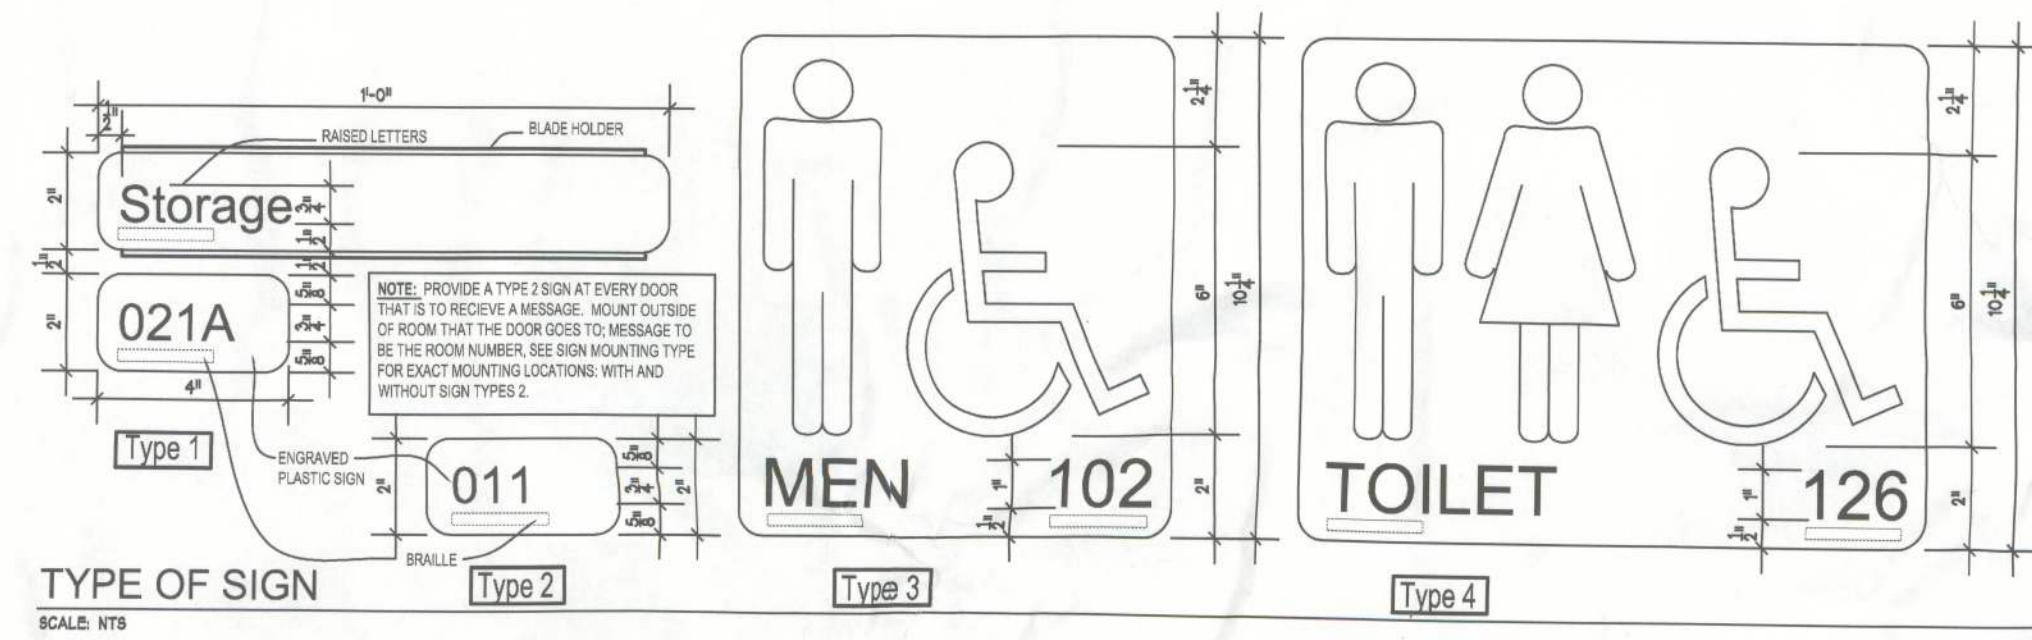

Bearing the UL Classification Mark

Design No. U905

Bearing Wall Rating — 2 HR.

Nonbearing Wall Rating — 2 HR

Load Restricted for Canadian Applications — See Guide BXUV7

Horizontal Section

1. Concrete Blocks — Various designs. Classification-D-2 (2 hr). See Concrete Blocks category for list of eligible manufacturers.

2. Mortar — Blocks laid in full bed of mortar, nom. 3/8 in. thick, of not less than 2-1/4 and not more than 3-1/2 parts of clean sharp sand to 1 part Portland cement (proportioned by volume) and not more than 50 percent hydrated lime (by cement volume). Vertical joints staggered.




3. Portland Cement Stucco or Gypsum Plaster — Add 1/2 hr to classification if used. Where combustible members are framed in wall, plaster of stucco must be applied on the face opposite framing to achieve a 3 hr max. Classification of 1-1/2 hr. Attached to concrete blocks (Item 1).

4. Loose Masonry Fill — If all core spaces are filled with loose dry expanded slag, expanded clay or shale (Rotary Kiln Process), water repellent vermiculite masonry fill insulation, or silicone treated perlite loose fill insulation add 2 hr to classification.

5. Foamed Plastic — (Optional-Not Shown) — 1-1/2 in. thick max, 4 ft wide sheathing attached to concrete blocks (Item 1).

THE DOW CHEMICAL CO — Type Thermax

Bearing the UL Classification Mark

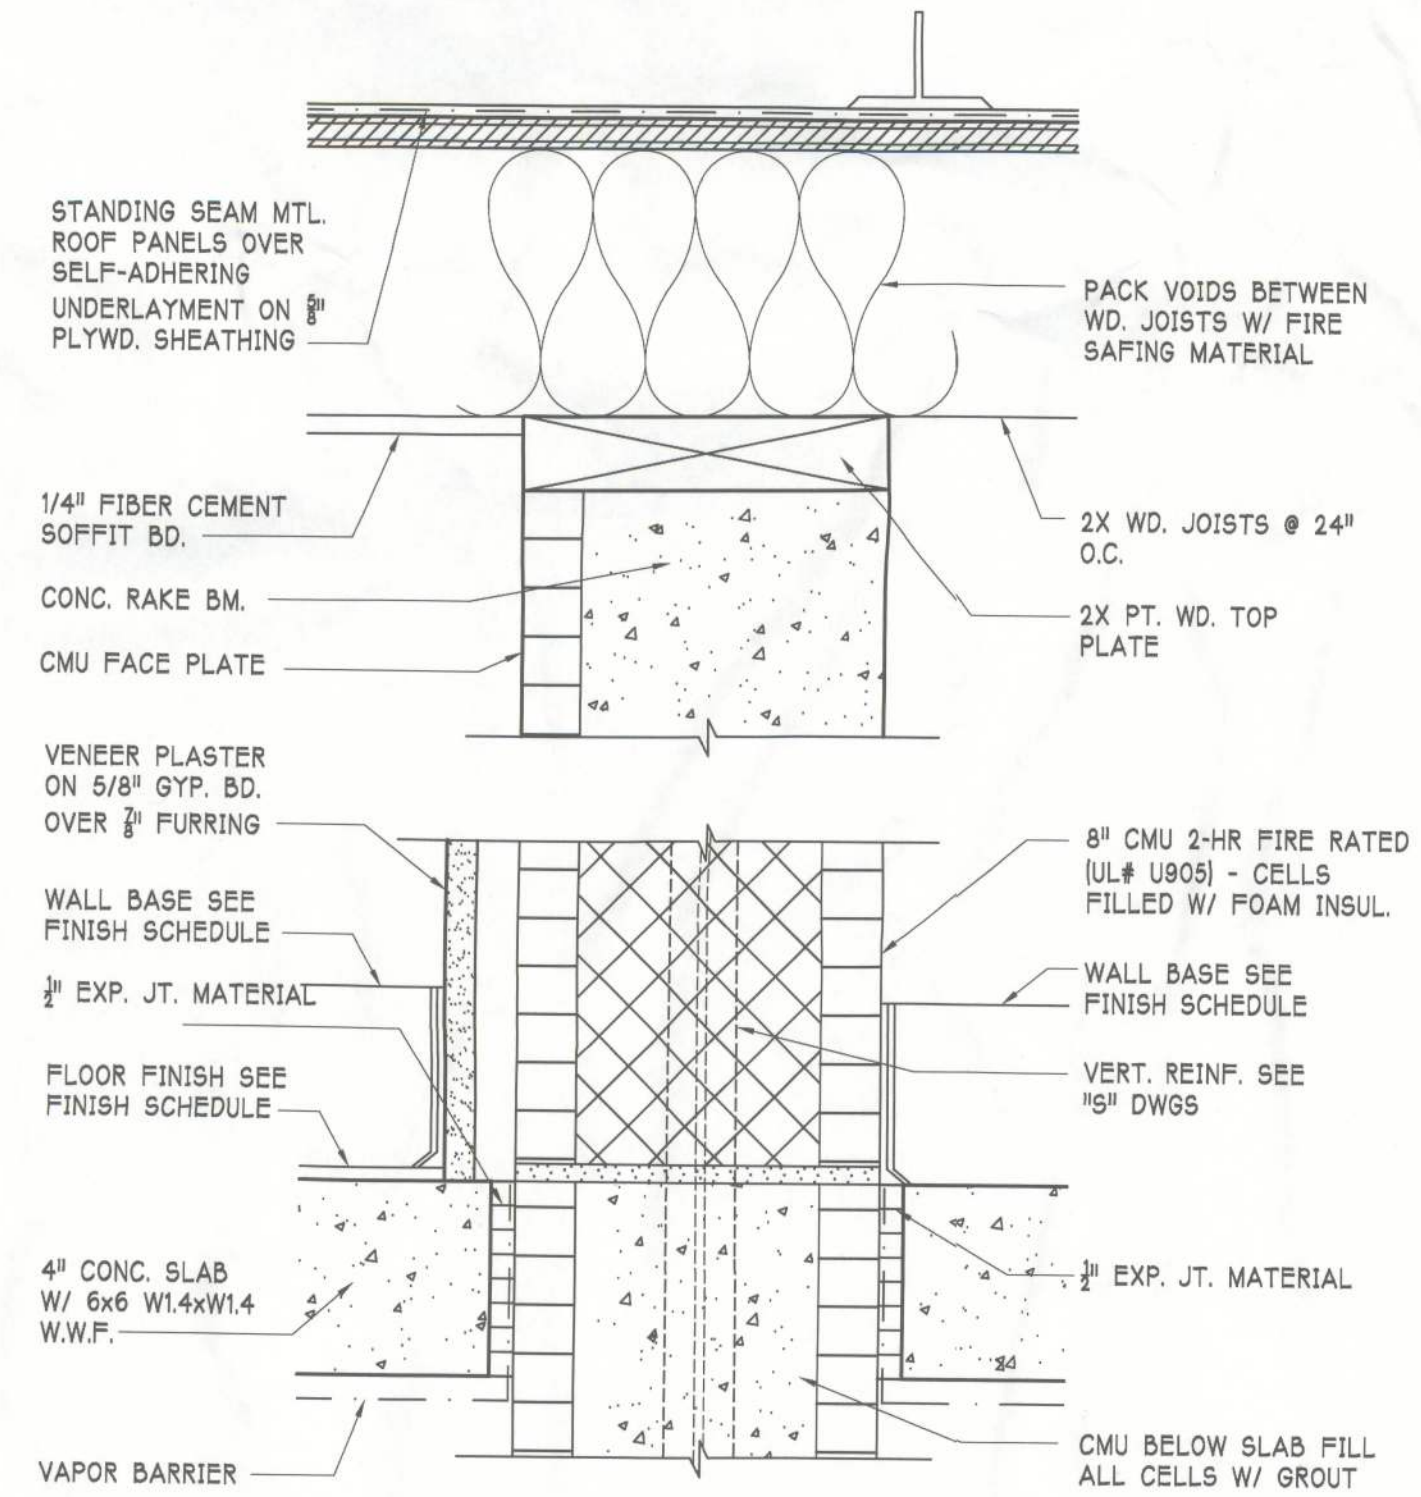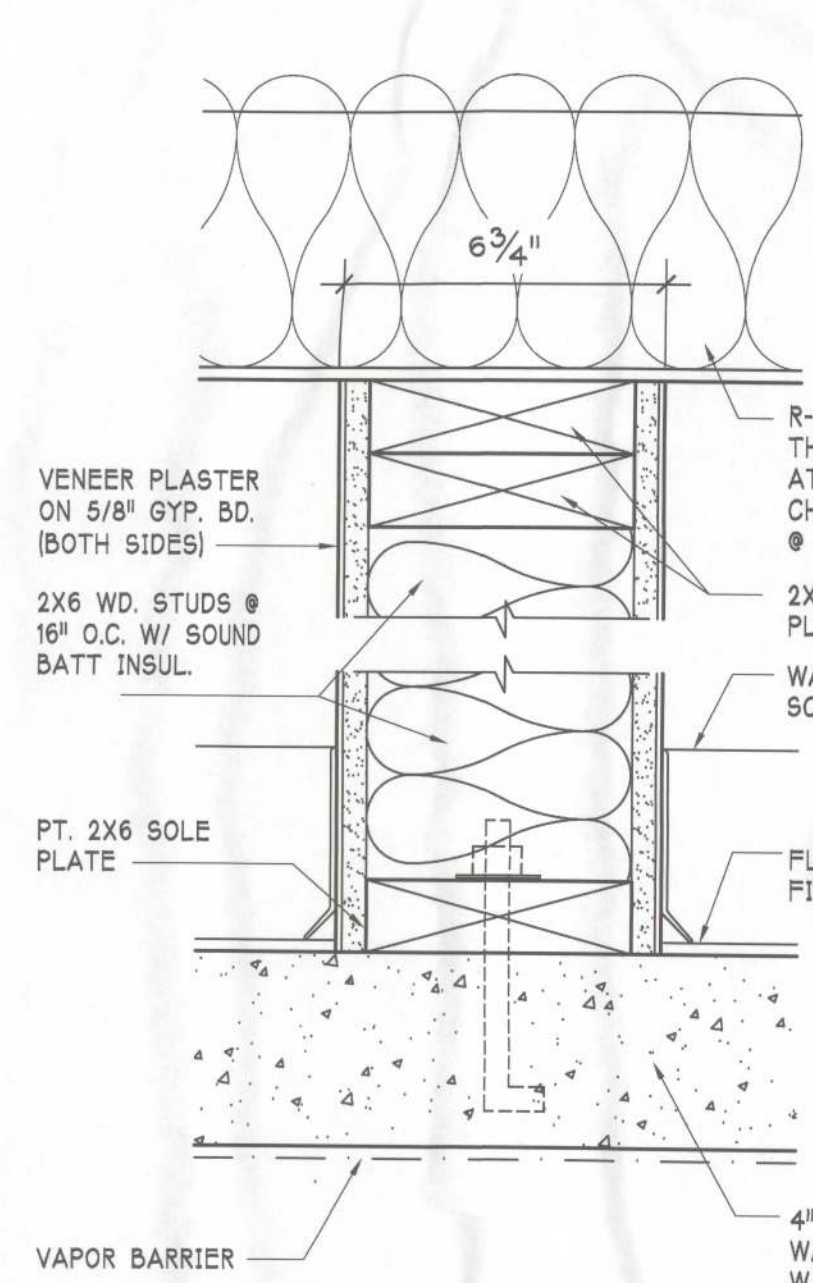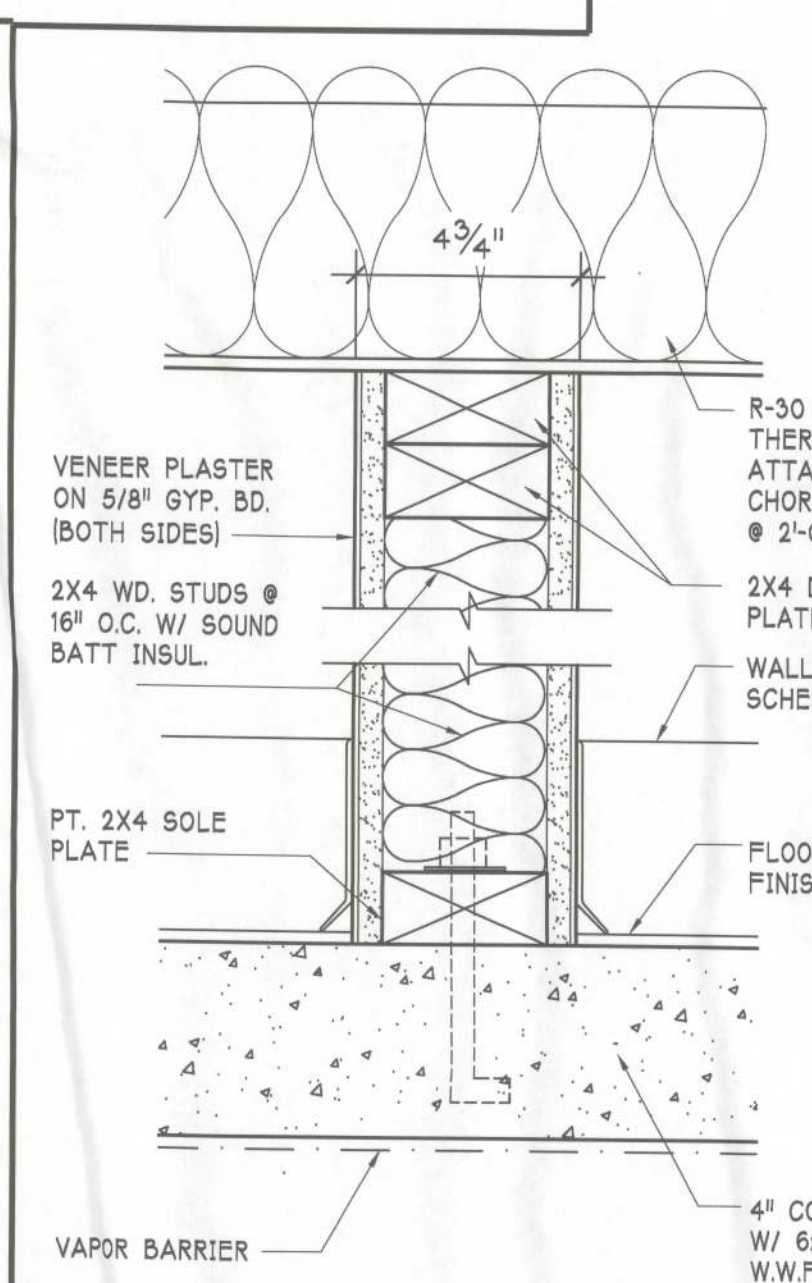


SIGN SCHEDULE

DOOR NO.	SIGN TYPE	MESSAGE	NOTES
100	-	-----	
102	3	MEN	
103	3	WOMEN	
104	1	OFFICE COORDINATOR	
105	-	-----	
106	1	MEMBER REPRESENTATIVE	
107	1	CONFERENCE	
108	1	DISTRICT MANAGER	
109	1	MULTI-PURPOSE	
109B	1	MULTI-PURPOSE	
110	2	-----	
111	2	-----	
112	2	-----	
113	1	ENGINEER	
114	1	ENGINEER	
115	-	-----	
117	1	OPERATION	
117A	1	OPERATION	
118	2	-----	
119	1	LINE SUPERVISOR	
120	2	-----	
121	-	-----	
122	1	JANITOR	
123	3	WOMEN	
124	3	MEN	
125	3	MEN	
126	4	UNISEX	
127	1	STORE KEEPER	
128	1	METER READER	
128A	1	METER READER COORDINATOR	
129	-	-----	
131	1	DISTRICT ENGINEER	
133	-	-----	
135	1	MECH/ELEC	
136	1	COMM. & DATA	
137	1	STRESS RELIEF	
138	2	-----	
139	1	DISPATCH	
140	2	-----	

NOTES:
ALL MESSAGES TO BE VERIFIED DURING SHOP DRAWING STAGE & BEFORE FABRICATION.

KEY TO DETAIL NUMBERS

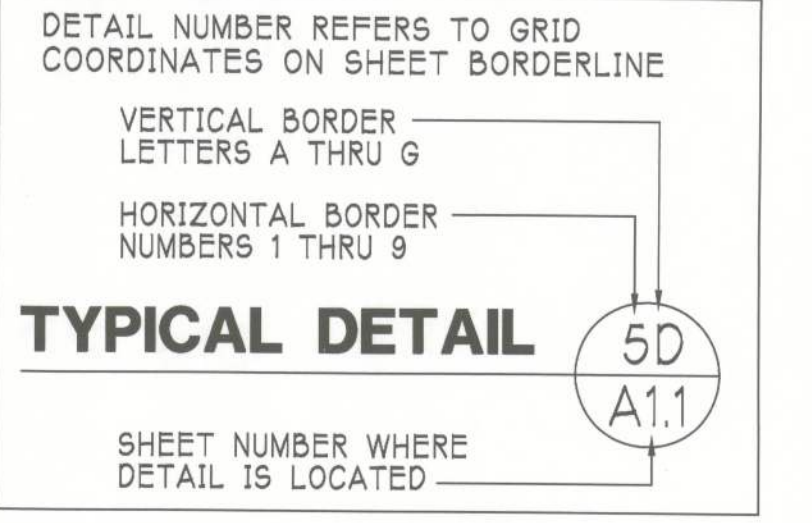

606 N.E. First Street
Gainesville, Florida 32601
352 / 372-0425
FAX 352 / 372-0427

Clay Electric Cooperative, Inc.
A Touchstone Energy Cooperative

NEW DISTRICT OFFICE
1659 SW State Road 47 Lake City, Florida

WILLIAM W. BRAME
REGISTRATION # AB-0007024
CORP. LIC. NO. AA 0000071

ABBREVIATION, INTERIOR SIGNAGE & TYP. MOUNTING HEIGHTS

DRAWN GBV
CHECKED BB
DATE 02/07/2012
CAD 3702060/CD

REVISIONS

FILE NO. 3702.060
SHEET

A0.1