



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 2455456 - BLAKE - APTS.

MiTek USA, Inc.

6904 Parke East Blvd.
Tampa, FL 33610-4115

Site Information:

Customer Info: Blake Const. Project Name: Apts. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: 217 SW Tigerview Glen, N/A
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2017/TPI2014 Design Program: MiTek 20/20 8.2
Wind Code: ASCE 7-10 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 31 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T21501950	CJ01	10/6/20	23	T21501972	V03	10/6/20
2	T21501951	CJ03	10/6/20	24	T21501973	V04	10/6/20
3	T21501952	CJ05	10/6/20	25	T21501974	V05	10/6/20
4	T21501953	EJ01	10/6/20	26	T21501975	V06	10/6/20
5	T21501954	EJ01G	10/6/20	27	T21501976	V07	10/6/20
6	T21501955	HJ10	10/6/20	28	T21501977	V08	10/6/20
7	T21501956	T01	10/6/20	29	T21501978	V09	10/6/20
8	T21501957	T02	10/6/20	30	T21501979	V10	10/6/20
9	T21501958	T03	10/6/20	31	T21501980	V11	10/6/20
10	T21501959	T04	10/6/20				
11	T21501960	T05	10/6/20				
12	T21501961	T06	10/6/20				
13	T21501962	T07	10/6/20				
14	T21501963	T08	10/6/20				
15	T21501964	T09	10/6/20				
16	T21501965	T10	10/6/20				
17	T21501966	T11	10/6/20				
18	T21501967	T12	10/6/20				
19	T21501968	T13	10/6/20				
20	T21501969	T13G	10/6/20				
21	T21501970	V01	10/6/20				
22	T21501971	V02	10/6/20				




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource-Jacksonville.

Truss Design Engineer's Name: Finn, Walter

My license renewal date for the state of Florida is February 28, 2021.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

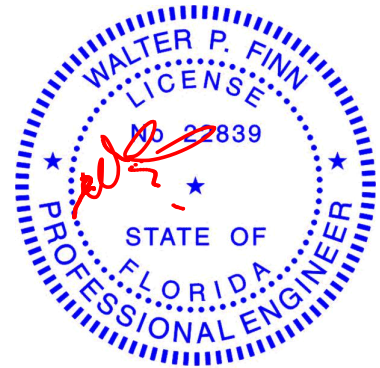

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:13 2020 Page 1
ID: 6gT8DbE5xKhvZCk42Ni6wysZ?g-sym?ovnRP4GXVO?Bsq8H7K7jV_2JovSU6tVojwW9Wm



NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCPl=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=162.



October 6, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501951
2455456	CJ03	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:14 2020 Page 1
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-K8G8C8wPCjC68fzBkZLNpLtiSvkC2F9cjd3KAyW9WI

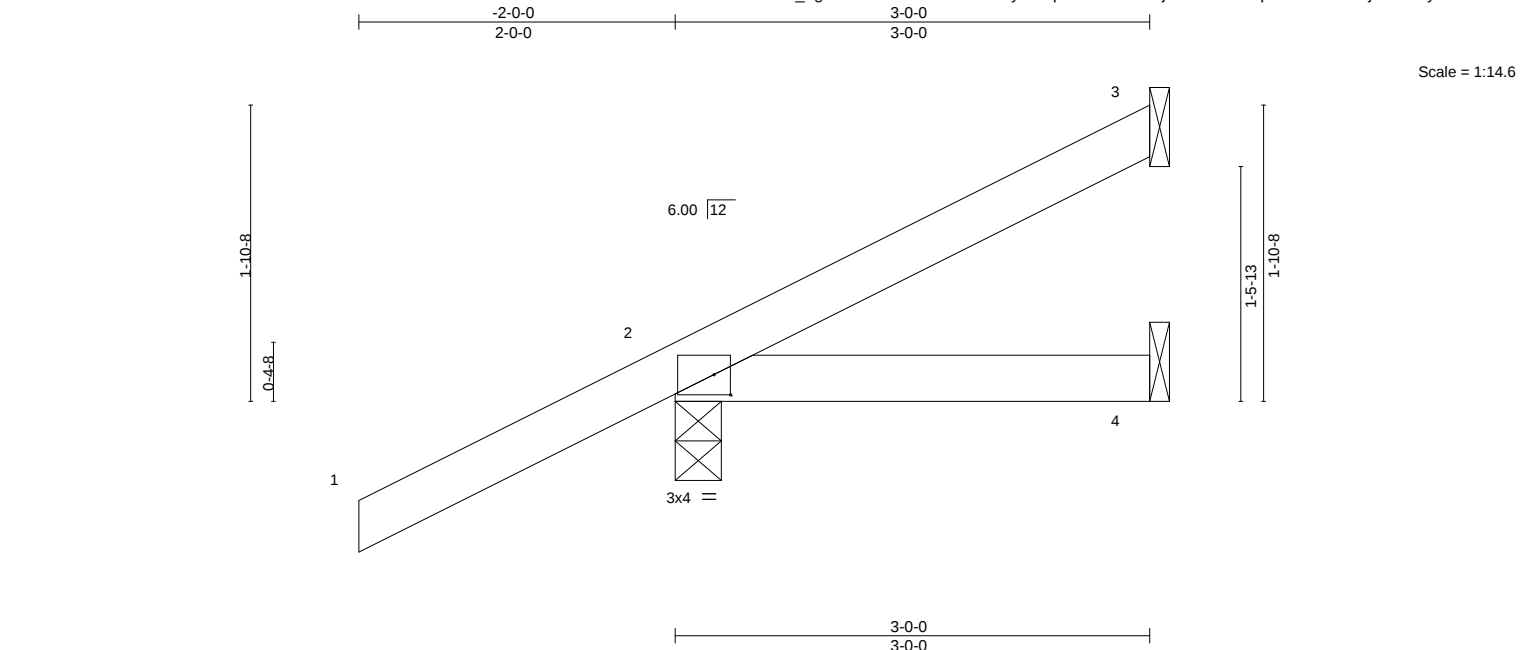


Plate Offsets (X,Y)--		[2:0-1-4,0-1-9]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32
TCDL 7.0	Lumber DOL	1.25	BC 0.07
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-MP
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.01 4-7 >999 240
			Vert(CT) -0.01 4-7 >999 180
			Horz(CT) -0.00 3 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 13 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=113(LC 12)
Max Uplift 3=-48(LC 12), 2=-126(LC 12), 4=-22(LC 9)
Max Grav 3=52(LC 1), 2=253(LC 1), 4=48(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
4) Refer to girder(s) for truss to truss connections.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=126.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501952
2455456	CJ05	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:14 2020 Page 1
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-K8G8C8wPCjC68fzBkZLNpLtlZvG22F9cjd3KAYW9WI

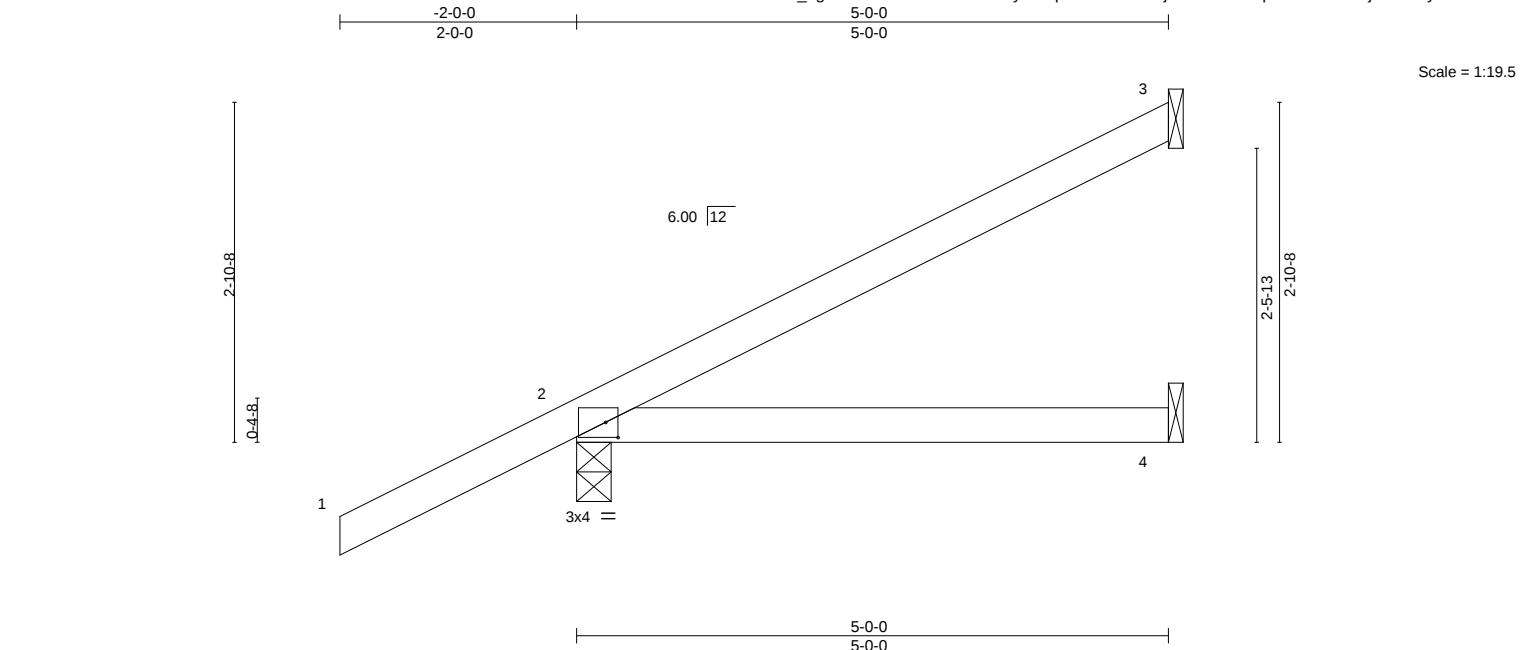


Plate Offsets (X,Y)--		[2:0-1-4,0-1-9]									
LOADING	(psf)	SPACING-		CSL		DEFL.	in	(loc)	l/defl	L/d	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	0.08	4-7	>750	240	MT20
TCDL	7.0	Lumber DOL	1.25	BC	0.34	Vert(CT)	0.07	4-7	>856	180	GRIP
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a	n/a	244/190
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MP							Weight: 19 lb
											FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=162(LC 12)
Max Uplift 3=-98(LC 12), 2=-137(LC 12), 4=-44(LC 9)
Max Grav 3=108(LC 1), 2=313(LC 1), 4=87(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
4) Refer to girder(s) for truss to truss connections.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=137.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501953
2455456	EJ01	Jack-Partial	30	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:15 2020 Page 1

ID:_6gT8DbE5xKhVZCk42Ni6wysZ?q-oKqWQUw1z0KzmpXNIHscMYQOoJahniOlyQMcsCyW9Wk

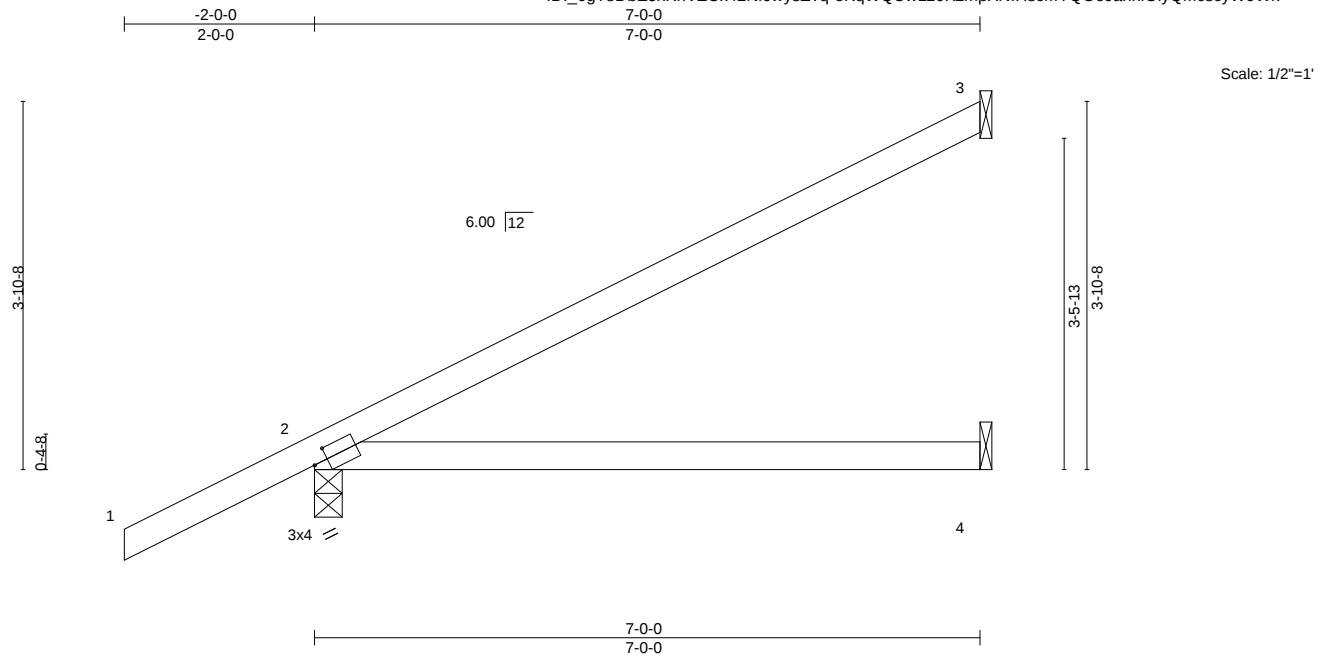


Plate Offsets (X,Y)-- [2:0-1-13,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.67	Vert(LL)	0.13 4-7 >656 240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.21 4-7 >393 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01 3 n/a n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS				Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
 Max Horz 2=210(LC 12)
 Max Uplift 3=-145(LC 12), 2=-154(LC 12), 4=-5(LC 12)
 Max Grav 3=160(LC 1), 2=380(LC 1), 4=125(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpI=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 3=145, 2=154.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6, 2020



WARNING: Velly design parameters are listed on this and included with reference page MP147316v, 3/19/2020 before use. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2672 Crain Highway, Suite 203 Waldorf, MD 20601.




6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501954
2455456	EJ01G	Monopitch Supported Gable	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:15 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-oKqWQUw1z0KzmpXNIHscMYQULJhjinimlyQMcsyW9Wk

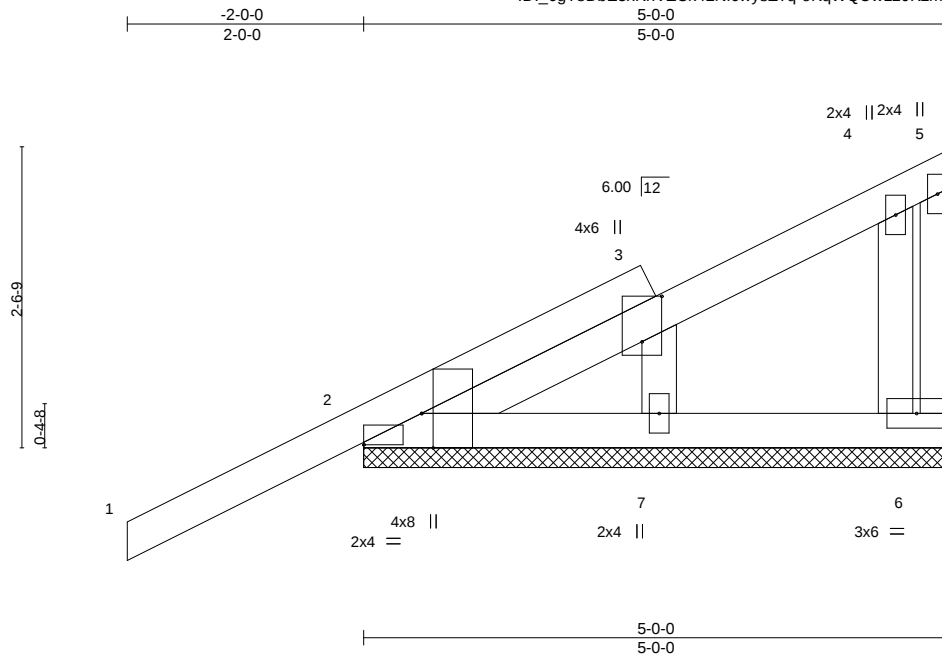

Scale = 1:19.5

Plate Offsets (X,Y)--		[2:0-3-8,Edge], [2:Edge,0-3-3], [3:0-4-10,0-2-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES
TCLL 20.0		Plate Grip DOL	1.25	TC 0.31		Vert(LL)	0.01	1	n/r	120	GRIP
TCDL 7.0		Lumber DOL	1.25	BC 0.06		Vert(CT)	0.00	1	n/r	120	MT20
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.04		Horz(CT)	-0.00	6	n/a	n/a	244/190
BCDL 10.0		Code	FBC2017/TPI2014	Matrix-P							Weight: 29 lb
											FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=5-0-0, 6=5-0-0, 7=5-0-0
Max Horz 2=144(LC 12)
Max Uplift 2=-107(LC 12), 6=-56(LC 12), 7=-71(LC 12)
Max Grav 2=237(LC 1), 6=82(LC 1), 7=145(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7 except (jt=lb) 2=107.
 - 8) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501955
2455456	HJ10	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:17 2020 Page 1
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?l-jyHrAyHVeah?7hmQiv4RzVm36H6FZE2PkrjxVyW9Wi

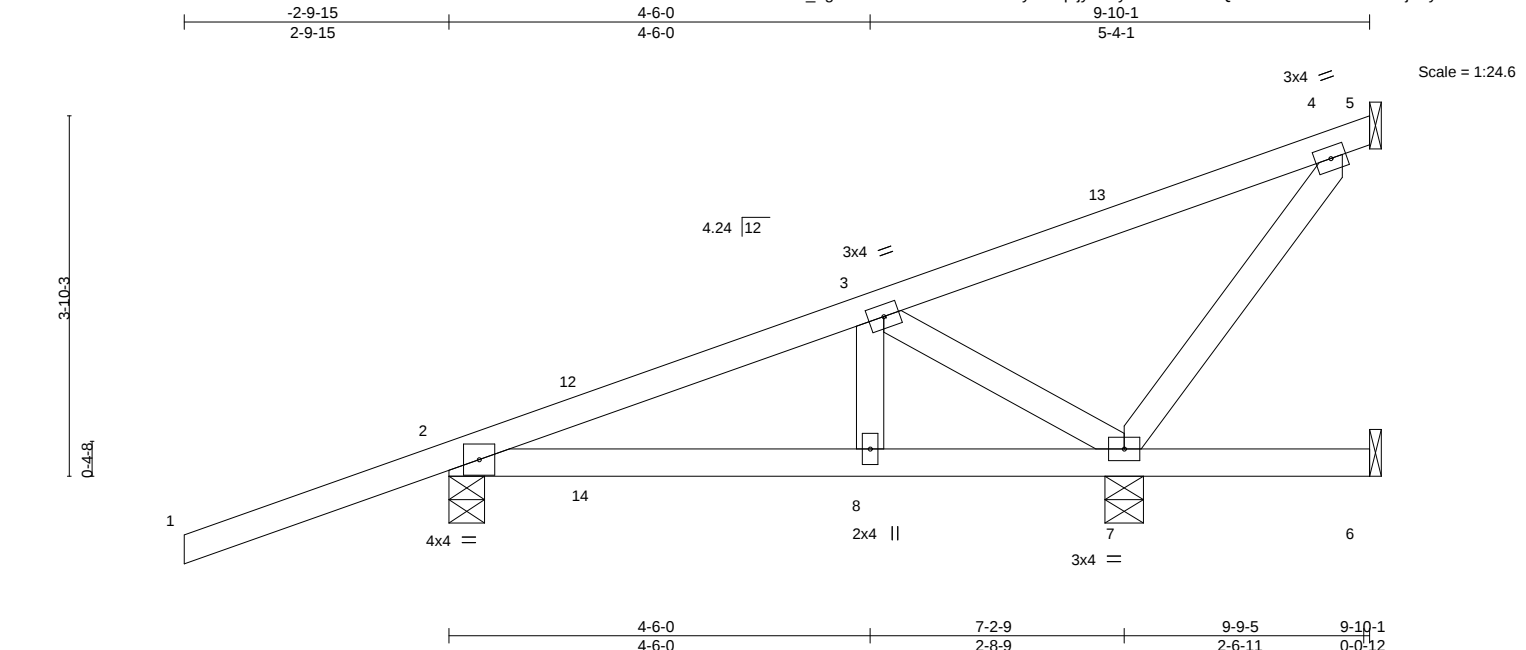

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.56	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.44	Vert(LL) -0.06 8-11 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.23	Vert(CT) 0.05 8-11 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) -0.00 5 n/a n/a		
	Code FBC2017/TPI2014			Weight: 47 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. All bearings Mechanical except (jt=length) 2=0-4-9, 7=0-4-15.
(lb) - Max Horz 2=233(LC 22)
Max Uplift All uplift 100 lb or less at joint(s) except 5=-233(LC 1), 2=-147(LC 4), 7=-724(LC 4)
Max Grav All reactions 250 lb or less at joint(s) 5, 2, 6 except 7=814(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-368/221, 3-4=-416/426
WEBS 3-7=-342/312, 4-7=-636/602

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 233 lb uplift at joint 5, 147 lb uplift at joint 2 and 724 lb uplift at joint 7.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 103 lb up at 1-6-1, 83 lb down and 103 lb up at 1-6-1, 26 lb down and 46 lb up at 4-4-0, 26 lb down and 46 lb up at 4-4-0, and 50 lb down and 106 lb up at 7-1-15, and 50 lb down and 106 lb up at 7-1-15 on top chord, and 69 lb down and 74 lb up at 1-6-1, 69 lb down and 74 lb up at 1-6-1, 53 lb down and 30 lb up at 4-4-0, and 53 lb down and 30 lb up at 4-4-0, and 40 lb down and 59 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-54, 6-9=-20
Concentrated Loads (lb)
Vert: 8=5(F=2, B=2) 7=-24(F) 12=50(F=25, B=25) 13=-64(F=-32, B=-32) 14=70(F=35, B=35)

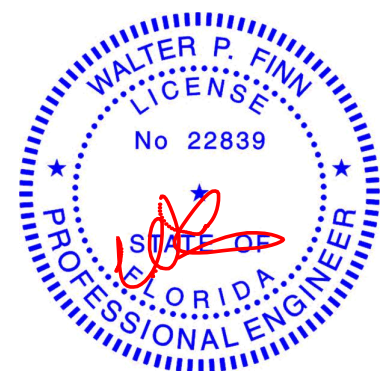

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501956
2455456	T01	Half Hip Girder	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,			8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:19 2020 Page 1			
			ID: _6gT8DbE5xKhVZCk42Ni6wysZ?g-h531GszX0FqPFQr8X7xYWOa07ws6jKILt2Kq?NyW9Wg			
-2-0-0	3-10-15	7-0-0	12-7-1	18-0-6	23-5-10	28-10-15
2-0-0	3-10-15	3-1-1	5-7-1	5-5-5	5-5-5	5-5-5
						34-6-0
						5-7-1

Scale: 3/16"=1'

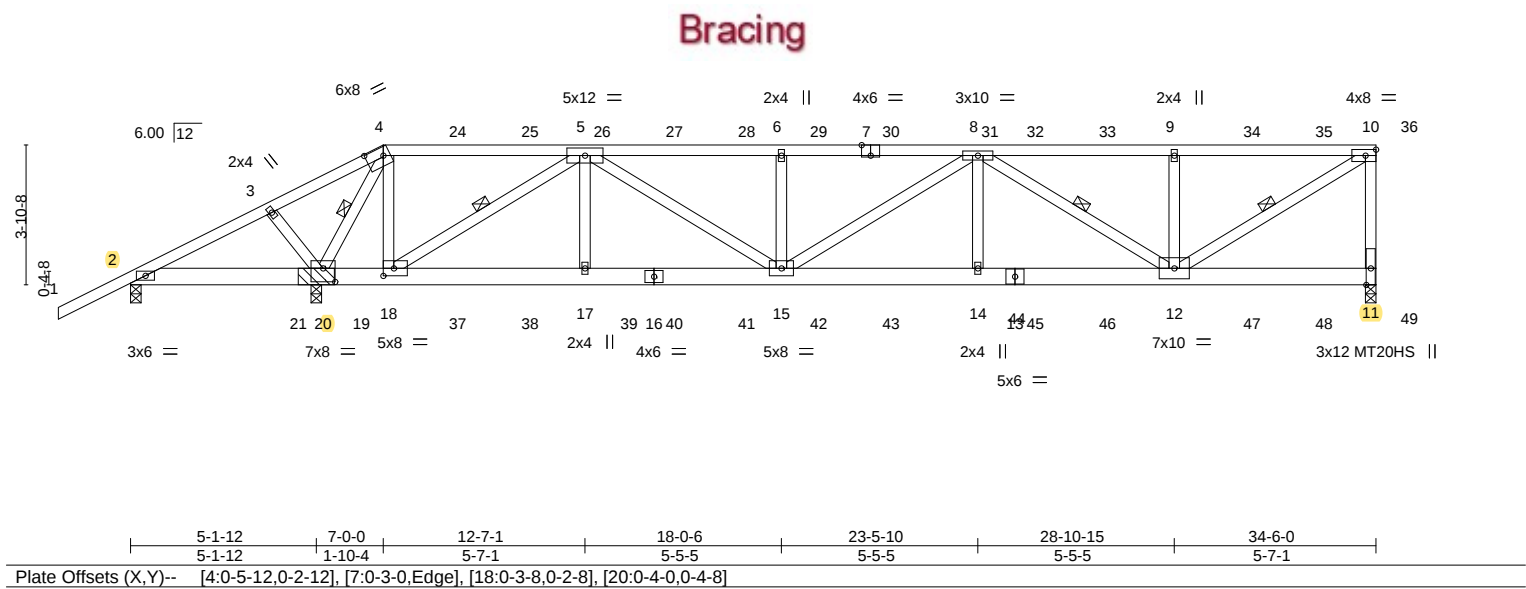


LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.90	Vert(LL)	0.31 14-15 >999	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.79	Vert(CT)	-0.40 14-15 >876	MT20HS		187/143	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.71	Horz(CT)	0.06 11 n/a n/a				
BCDL	10.0	Code FBC2017/TP12014		Matrix-MS							
								Weight: 220 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-4-6 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 4-10-3 oc bracing.
WEBS	2x4 SP No.3 *Except*	WEBS	1 Row at midpt 4-20, 5-18, 8-12, 10-12
	5-18,5-15,8-15,8-12,10-12: 2x4 SP No.2		

REACTIONS.	(size) 11=0-3-8, 2=0-3-8, 20=(0-3-8 + bearing block) (req. 0-4-6)
	Max Horz 2=213(LC 23)
	Max Uplift 11=-1330(LC 4), 2=-768(LC 1), 20=-2156(LC 5)
	Max Grav 11=2246(LC 1), 2=554(LC 6), 20=3700(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1359/2240, 3-4=-1362/2347, 4-5=-250/424, 5-6=-3818/2242, 6-8=-3818/2242, 8-9=-2700/1584, 9-10=-2700/1584, 10-11=-2054/1306
BOT CHORD	2-20=-1967/1174, 18-20=-499/289, 17-18=-1437/2432, 15-17=-1437/2432, 14-15=-2312/3934, 12-14=-2312/3934
WEBS	4-20=-3615/2070, 4-18=-935/1813, 5-18=-3394/2004, 5-17=-13/481, 5-15=-958/1648, 6-15=-566/491, 8-14=-13/448, 8-12=-1467/865, 9-12=-635/555, 10-12=-1838/3146

- NOTES-**
- 2x6 SP No.2 bearing block 12" long at jt. 20 attached to front face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners. Bearing is assumed to be SP No.2.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1330 lb uplift at joint 11, 768 lb uplift at joint 2 and 2156 lb uplift at joint 20.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 106 lb down and 146 lb up at 7-0-0, 106 lb down and 146 lb up at 9-0-12, 106 lb down and 146 lb up at 11-0-12, 106 lb down and 146 lb up at 13-0-12, 106 lb down and 146 lb up at 15-0-12, 106 lb down and 146 lb up at 17-0-12, 106 lb down and 146 lb up at 19-0-12, 106 lb down and 139 lb up at 21-0-12, 106 lb down and 146 lb up at 23-0-12, 106 lb down and 146 lb up at 25-0-12, 106 lb down and 146 lb up at 27-0-12, 106 lb down and 146 lb up at 29-0-12, 106 lb down and 146 lb up at 31-0-12, and 106 lb down and 146 lb up at 33-0-12, and 122 lb down and 146 lb up at 33-11-4 on top chord, and 85 lb down and 25 lb up at 7-0-0, 85 lb down and 25 lb up at 9-0-12, 85 lb down and 25 lb up at 11-0-12, 85 lb down and 25 lb up at 13-0-12, 85 lb down and 25 lb up at 15-0-12, 85 lb down and 25 lb up at 17-0-12, 85 lb down and 25 lb up at 19-0-12, 85 lb down and 25 lb up at 21-0-12, 85 lb down and 25 lb up at 23-0-12, 85 lb down and 25 lb up at 25-0-12, 85 lb down and 25 lb up at 27-0-12, 85 lb down and 25 lb up at 29-0-12, 85 lb down and 25 lb up at 31-0-12, and 85 lb down and 25 lb up at 33-0-12, and 96 lb down and 19 lb up at 33-11-4 on bottom chord. The design/selection of structural connection device(s) is the responsibility of others.

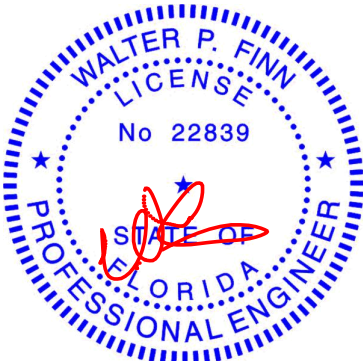

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501956
2455456	T01	Half Hip Girder	2	1	Job Reference (optional)	


NOTES-
9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-10=-54, 2-11=-20
Concentrated Loads (lb)
Vert: 4=-106(B) 18=-59(B) 9=-106(B) 12=-61(B) 24=-106(B) 25=-106(B) 26=-106(B) 27=-106(B) 28=-106(B) 29=-106(B) 30=-106(B) 31=-106(B) 32=-106(B) 33=-106(B) 34=-106(B) 35=-106(B) 36=-122(B) 37=-61(B) 38=-61(B) 39=-61(B) 40=-61(B) 41=-61(B) 42=-61(B) 43=-61(B) 44=-61(B) 45=-61(B) 46=-61(B) 47=-61(B) 48=-61(B) 49=-67(B)

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501957
2455456	T02	Hip	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:23 2020 Page 1

ID: 6gT8DbE5xKhVZCk42Ni6wysZ?z-ZtJY5D124TLrj29wmy0UgEloAXEnf8rxogI188yW9Wc



Scale = 1:61.4

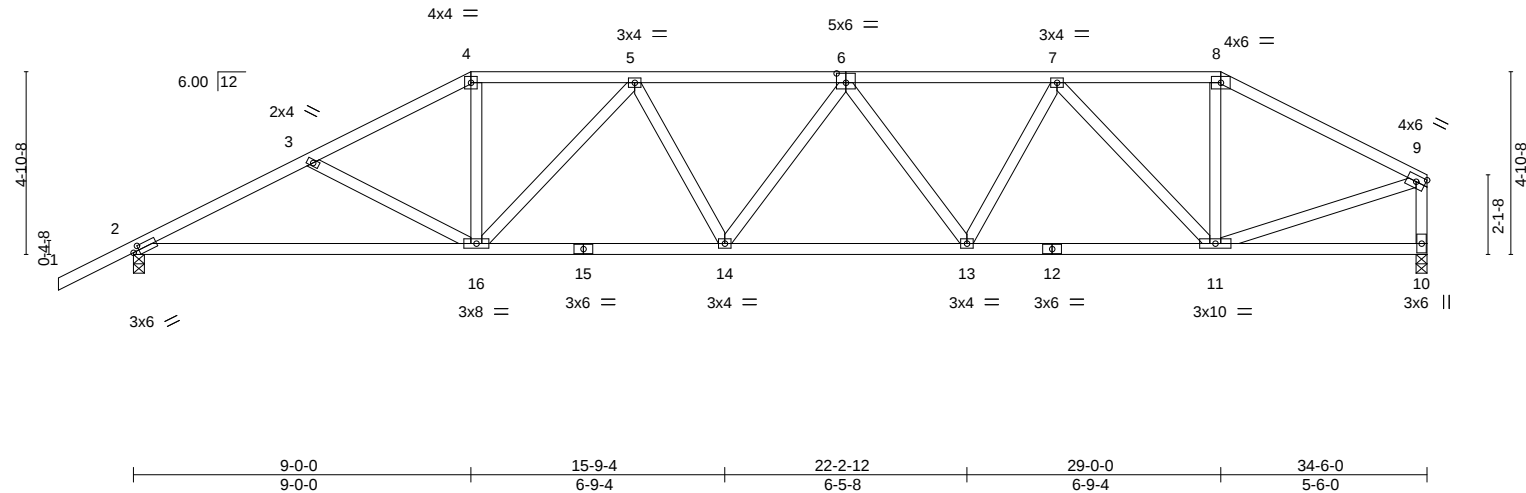


Plate Offsets (X,Y)--		[2:0-1-15,0-1-8], [6:0-3-0,0-3-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.45	Vert(LL)	0.18 14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.81	Vert(CT)	-0.35 16-19	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.74	Horz(CT)	0.10 10	n/a	n/a		
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-MS						
				Weight: 188 lb				FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-7-6 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 5-6-15 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 2=0-3-8, 10=0-3-8
Max Horz 2=187(LC 12)
Max Uplift 2=-577(LC 12), 10=-473(LC 13)
Max Grav 2=1382(LC 1), 10=1268(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2388/1218, 3-4=-2128/1076, 4-5=-1874/1020, 5-6=-2347/1241, 6-7=-2165/1144,
7-8=-1302/738, 8-9=-1509/752, 9-10=-1218/643
BOT CHORD 2-16=-1106/2095, 14-16=-1087/2269, 13-14=-1134/2368, 11-13=-920/1943
WEBS 3-16=-277/272, 4-16=-305/717, 5-16=-651/366, 6-13=-371/250, 7-13=-185/493,
7-11=-983/483, 8-11=-153/456, 9-11=-576/1303

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 577 lb uplift at joint 2 and 473 lb uplift at joint 10.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501958
2455456	T03	Hip	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:25 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-WFQIWv2lc5bZzLIluN2ymfq1XLx733DF_n8D1yW9Wa



Scale = 1:61.4

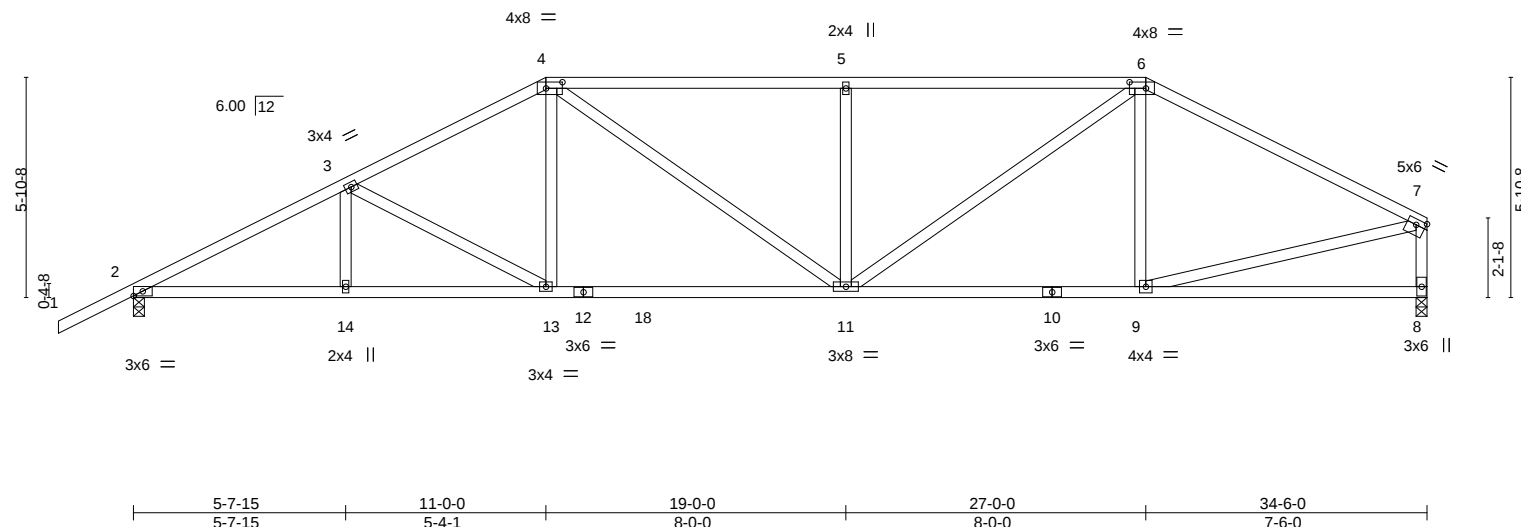


Plate Offsets (X,Y)--		[4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [7:Edge,0-1-12]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.91	Vert(LL)	0.14 11-13	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.68	Vert(CT)	-0.30 11-13	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.08 8	n/a	n/a		
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS						Weight: 187 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 5-8-10 oc bracing.

REACTIONS. (size) 2=0-3-8, 8=0-3-8
Max Horz 2=208(LC 12)
Max Uplift 2=-574(LC 12), 8=-470(LC 13)
Max Grav 2=1382(LC 1), 8=1268(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2395/1196, 3-4=-1989/1044, 4-5=-2006/1128, 5-6=-2006/1128, 6-7=-1615/810,
7-8=-1199/658
BOT CHORD 2-14=-1078/2087, 13-14=-1078/2087, 11-13=-797/1728, 9-11=-607/1360
WEBS 3-13=-418/321, 4-13=-112/423, 4-11=-264/464, 5-11=-499/374, 6-11=-396/859,
7-9=-548/1299

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCPi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 574 lb uplift at joint 2 and 470 lb uplift at joint 8.

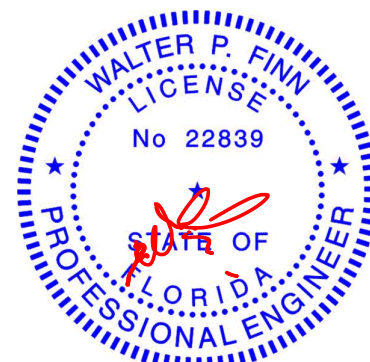

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501959
2455456	T04	Hip	2	1	Job Reference (optional)	

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:27 2020 Page 1

Scale = 1:62.5




LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.54	Vert(LL) -0.23 9-10 >999 240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.82	Vert(CT) -0.47 9-10 >877 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.71	Horz(CT) 0.09 9 n/a n/a		
BCDL 10.0	Code FBC2017/TPJ2014	Matrix-MS		Weight: 198 lb	FT = 20%

TOP CHORD	Structural wood sheathing directly applied or 3-5-6 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 5-8-1 oc bracing.

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 571 lb uplift at joint 2 and 466 lb uplift at joint 9.



WARNING: Verify design parameters and READ NOTES ON THIS AND INCLUDED WITH REFERENCE PAGE MP17475167, 3/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501961
2455456	T06	Hip	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:31 2020 Page 1
 ID: 6gT8DbE5xKhVZCk42Ni6wysZ?KPoZny73CxLihGmSEe9M?w4AYxYXrF6dwESRhyW9WU
 -2-0-0 5-11-7 11-1-12 17-0-0 21-0-0 26-10-4 32-0-9 38-0-0 40-0-0
 2-0-0 5-11-7 5-2-5 5-10-4 4-0-0 5-10-4 5-2-5 5-11-7 2-0-0
 Scale = 1:69.5

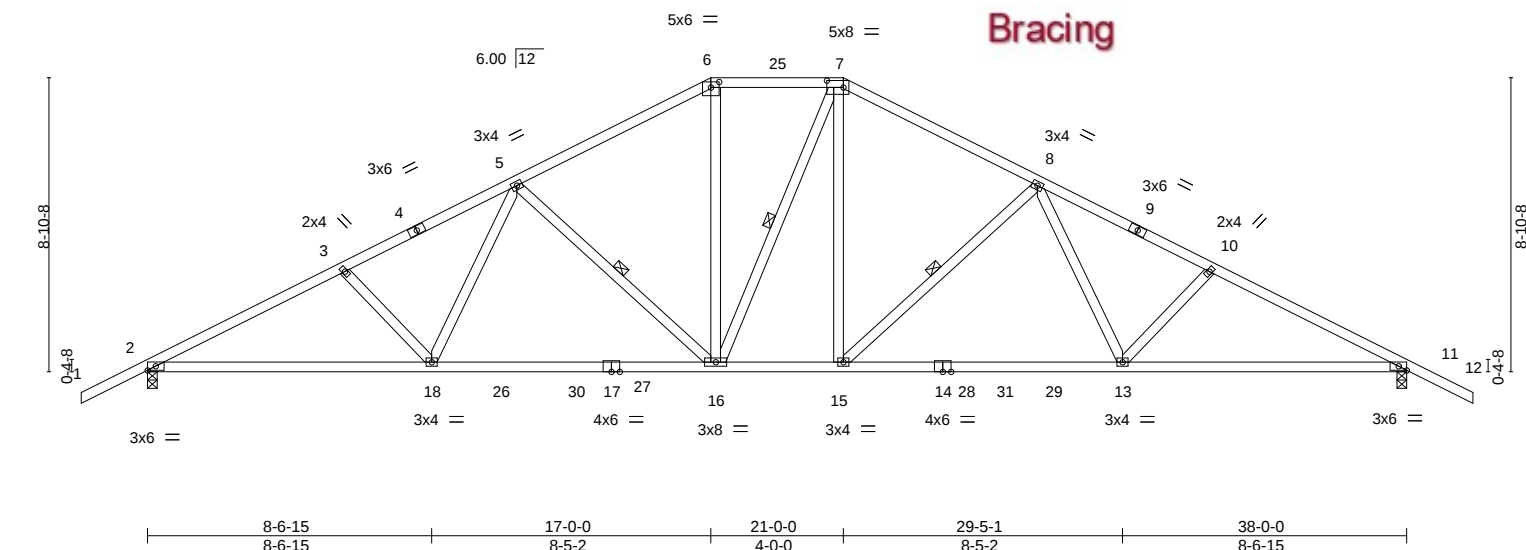


Plate Offsets (X,Y)--		[6:0-3-0,0-2-0], [7:0-6-0,0-2-8], [11:0-2-15,Edge]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 20.0	Plate Grip DOL 1.25	TC 0.49	in (loc) l/defl L/d
TCDL 7.0	Lumber DOL 1.25	BC 0.88	Vert(LL) -0.23 13-15 >999 240
BCLL 0.0 *	Rep Stress Incr YES	WB 0.39	Vert(CT) -0.46 13-15 >999 180
BCDL 10.0	Code FBC2017/TPI2014	Matrix-MS	Horz(CT) 0.12 11 n/a n/a
		PLATES MT20	
		GRIP 244/190	
		Weight: 217 lb FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-6 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 5-7-7 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-16, 7-16, 8-15

REACTIONS. (size) 2=0-3-8, 11=0-3-8
 Max Horz 2=-200(LC 13)
 Max Uplift 2=-599(LC 12), 11=-599(LC 13)
 Max Grav 2=1514(LC 1), 11=1514(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2648/1389, 3-5=-2447/1333, 5-6=-1797/1069, 6-7=-1545/1022, 7-8=-1797/1069,
 8-10=-2447/1333, 10-11=-2648/1389
 BOT CHORD 2-18=-1075/2312, 16-18=-837/1965, 15-16=-517/1544, 13-15=-845/1965,
 11-13=-1100/2312
 WEBS 3-18=-266/277, 5-18=-166/473, 5-16=-590/455, 6-16=-275/521, 7-15=-276/520,
 8-15=-591/456, 8-13=-166/474, 10-13=-266/277

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 599 lb uplift at joint 2 and 599 lb uplift at joint 11.



Walter P. Finn PE No.22839
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:


October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501962
2455456	T07	Common	16	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),		Jacksonville, FL - 32244,		8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:33 2020 Page 1			
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-HovKCe8JYbQwawrM3Bq4L9U7Zgt?k7P5EjZVzyW9WS							
-2-0-0	5-1-12	12-0-0	19-0-0	26-0-0	32-10-4	38-0-0	40-0-0
2-0-0	5-1-12	6-10-4	7-0-0	7-0-0	6-10-4	5-1-12	2-0-0
Scale = 1:67.3							

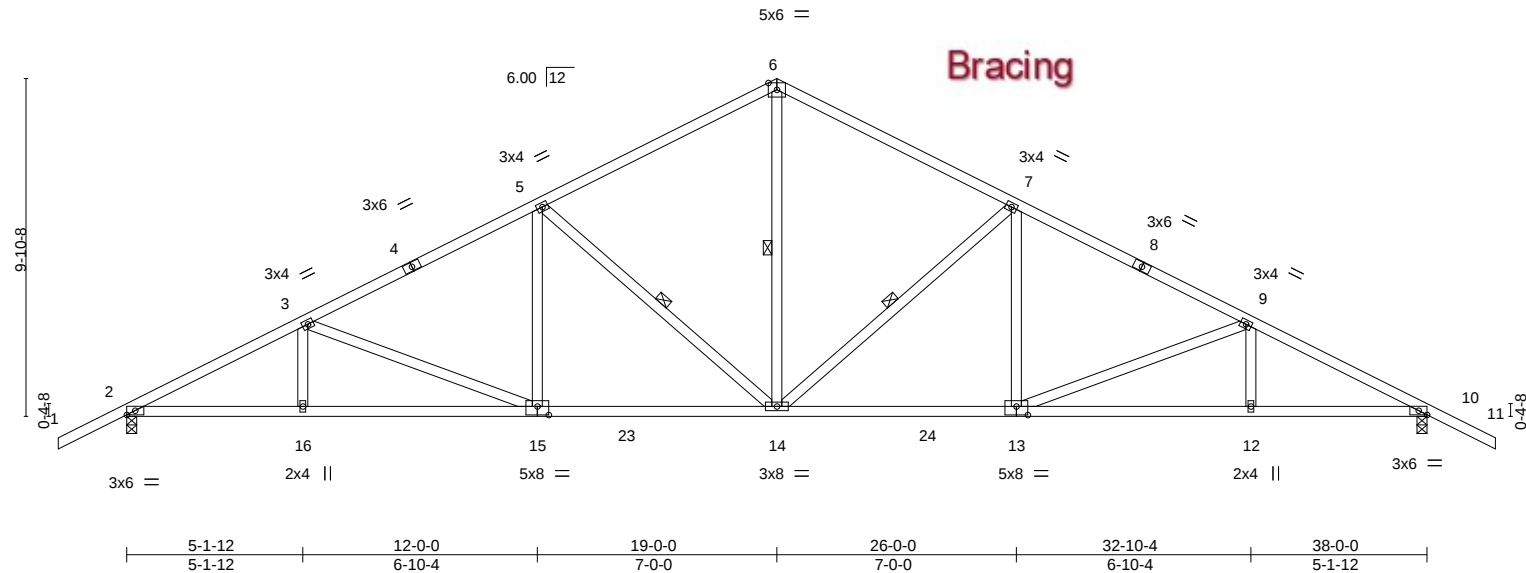


LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.61	Vert(LL)	-0.17 13-14 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.70	Vert(CT)	-0.34 13-14 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.50	Horz(CT)	0.13 10 n/a n/a				
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS							
								Weight: 212 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-4-14 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 5-5-12 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 6-14, 7-14, 5-14

REACTIONS.	
(size)	2=0-3-8, 10=0-3-8
Max Horz	2=-221(LC 13)
Max Uplift	2=-594(LC 12), 10=-594(LC 13)
Max Grav	2=1514(LC 1), 10=1514(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2720/1422, 3-5=-2245/1238, 5-6=-1665/1029, 6-7=-1665/1029, 7-9=-2245/1238, 9-10=-2720/1422
BOT CHORD	2-16=-1113/2384, 15-16=-1113/2384, 14-15=-821/1942, 13-14=-826/1942, 12-13=-1147/2384, 10-12=-1147/2384
WEBS	6-14=-626/1066, 7-14=-720/514, 7-13=-85/420, 9-13=-482/344, 5-14=-720/514, 5-15=-85/420, 3-15=-482/344

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 594 lb uplift at joint 2 and 594 lb uplift at joint 10.

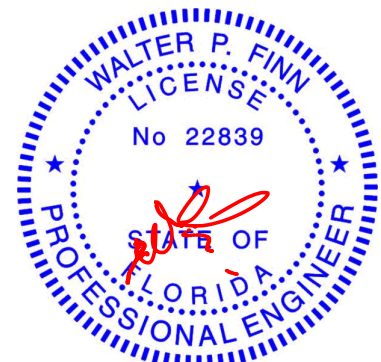


Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

Job 2455456	Truss T08	Truss Type Common	Qty 18	Ply 1	BLAKE - APTS. T21501963
----------------	--------------	----------------------	-----------	----------	----------------------------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:35 2020 Page 1
ID: 6gT8DbE5xKhVZCk42Ni6wysZ?q-DA14cKAaF9r89u3DTUDIAmFrQNNQTc9iYYCgaSyW9WQ
-2-0-0 5-1-12 12-0-0 19-0-0 26-0-0 32-10-4 38-0-0 40-0-0
2-0-0 5-1-12 6-10-4 7-0-0 7-0-0 6-10-4 5-1-12 2-0-0

Scale = 1:67.3

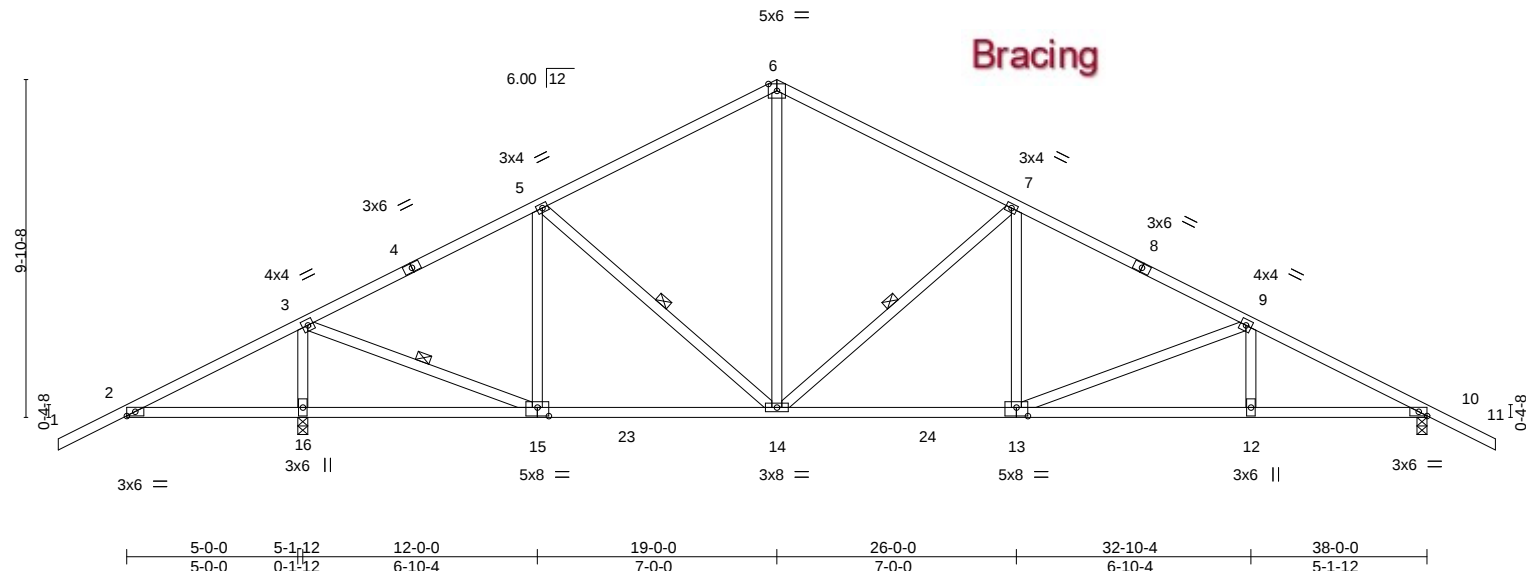

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	-0.11 13-14 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.63	Vert(CT)	-0.22 12-13 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.59	Horz(CT)	0.06 10 n/a n/a				
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS							
								Weight: 212 lb FT = 20%			

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-9-9 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 7-14, 5-14, 3-15

REACTIONS. (size) 16=0-3-8, 10=0-3-8
Max Horz 16=221(LC 12)
Max Uplift 16=687(LC 12), 10=531(LC 13)
Max Grav 16=1751(LC 1), 10=1277(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-791/651, 3-5=-1108/536, 5-6=-1138/705, 6-7=-1139/706, 7-9=-1721/909, 9-10=-2208/1079
BOT CHORD 2-16=-520/847, 15-16=-520/808, 14-15=-294/982, 13-14=-511/1472, 12-13=-841/1928, 10-12=-841/1928
WEBS 6-14=-335/621, 7-14=-721/514, 7-13=-86/422, 9-13=-490/354, 5-15=-420/421, 3-15=-1008/1540, 3-16=-1607/1201

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 687 lb uplift at joint 16 and 531 lb uplift at joint 10.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501964
2455456	T09	Common	8	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:36 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-hNbSggBC0Tz?n2eQ1BIXi_n?smiOC0GrnByD6uyW9WP

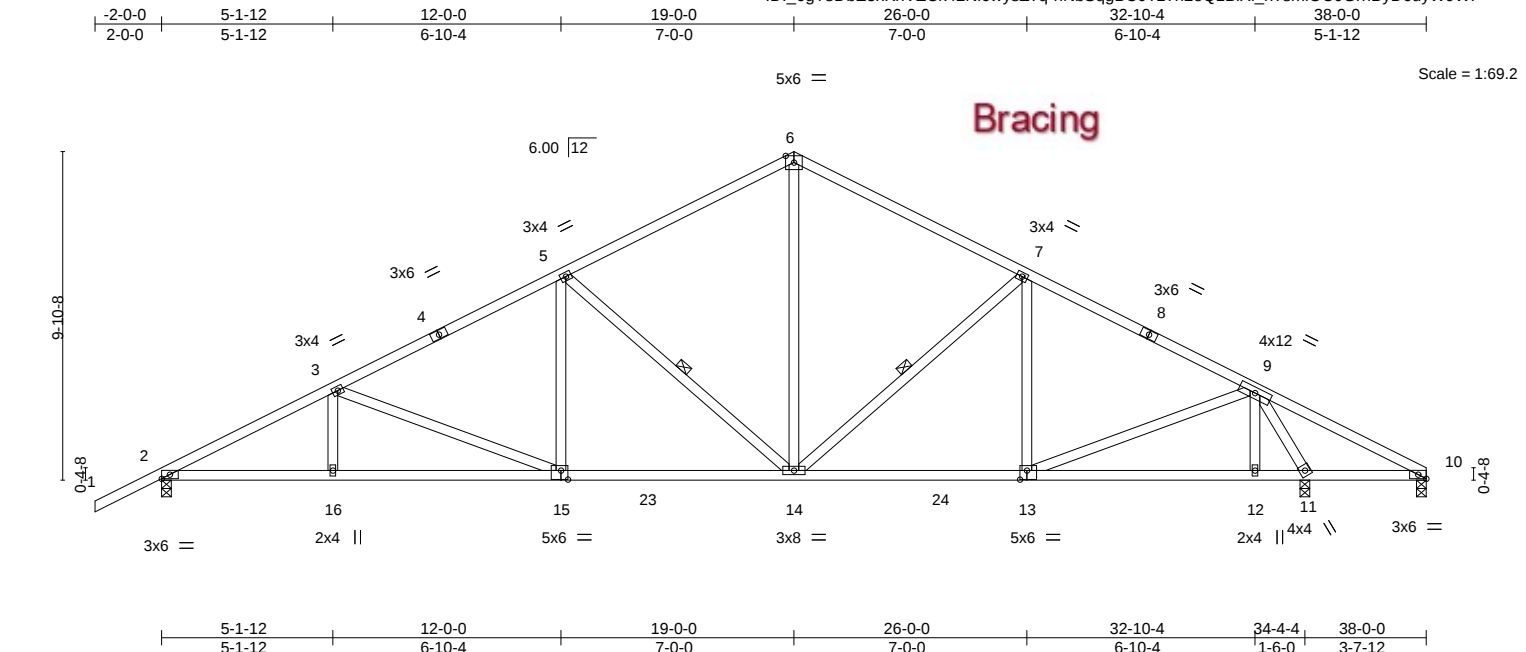


Plate Offsets (X,Y)-- [10:0-2-15,Edge], [13:0-2-8,0-3-4], [15:0-2-8,0-3-4]													
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.58	Vert(LL)	-0.12	14-15	>999	240	MT20	244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.65	Vert(CT)	-0.24	15-16	>999	180			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.79	Horz(CT)	0.08	11	n/a	n/a			
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS							Weight: 213 lb	FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-8-2 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 5-10-1 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 5-14, 7-14

REACTIONS.	(size) 2=0-3-8, 11=0-3-8, 10=0-3-8
	Max Horz 2=241(LC 12)
	Max Uplift 2=-543(LC 12), 11=-655(LC 13), 10=-301(LC 19)
	Max Grav 2=1343(LC 1), 11=1859(LC 1), 10=127(LC 12)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2350/1231, 3-5=-1867/1043, 5-6=-1285/833, 6-7=-1284/833, 7-9=-1426/809, 9-10=-431/902
BOT CHORD	2-16=-1023/2055, 15-16=-1023/2055, 14-15=-698/1603, 13-14=-486/1205, 12-13=-86/310, 11-12=-86/310, 10-11=-744/440
WEBS	3-15=-488/349, 5-15=-86/422, 5-14=-721/515, 6-14=-449/733, 7-14=-292/278, 9-13=-430/987, 9-11=-1992/1019

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 543 lb uplift at joint 2, 655 lb uplift at joint 11 and 301 lb uplift at joint 10.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


MiTek
6904 Parke East Blvd.
Tampa, FL 33610



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501966
2455456	T11	Common	8	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:38 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-dljDFLCSY4Ej0Loo8cn?nPtKFaNgguh8EVRKAnyW9WN



Scale = 1:66.4

Plate Offsets (X,Y)--		[13:0-2-8,0-3-4], [15:0-4-0,0-3-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.59	in (loc)	l/defl	L/d		MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.66	Vert(LL)	0.13 15-16	>999	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.86	Vert(CT)	-0.25 15-16	>999	180		
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS		Horz(CT)	0.08 11	n/a	n/a		
										Weight: 203 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-7-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 5-5-12 oc bracing.
WEBS 1 Row at midpt 5-14, 7-14

REACTIONS. (size) 2=0-3-8, 11=0-3-8
Max Horz 2=292(LC 12)
Max Uplift 2=-556(LC 12), 11=-452(LC 13)
Max Grav 2=1382(LC 1), 11=1268(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2435/1272, 3-5=-1954/1085, 5-6=-1373/876, 6-7=-1372/876, 7-9=-1613/900, 9-10=-828/439, 10-11=-1284/658
BOT CHORD 2-16=-1158/2131, 15-16=-1158/2131, 14-15=-834/1681, 13-14=-667/1375, 12-13=-417/769
WEBS 3-15=-486/347, 5-15=-85/421, 5-14=-720/515, 6-14=-488/808, 7-14=-376/308, 9-13=-268/649, 9-12=-850/570, 10-12=-670/1229

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 556 lb uplift at joint 2 and 452 lb uplift at joint 11.

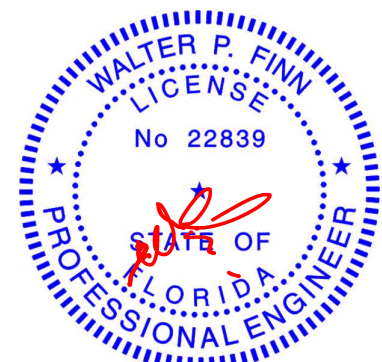

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501967
2455456	T12	Common	8	1		

Builders FirstSource (Jacksonville, FL),		Jacksonville, FL - 32244,		8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:40 2020 Page 1			
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-a8qzg1Ei4iUQGfyBG1pTtqyhkO6p8tFRipwRFfyW9WL							
-2-0-0	5-1-12	12-0-0	19-0-0	26-0-0	32-10-4	34-6-0	
2-0-0	5-1-12	6-10-4	7-0-0	7-0-0	6-10-4	1-7-12	


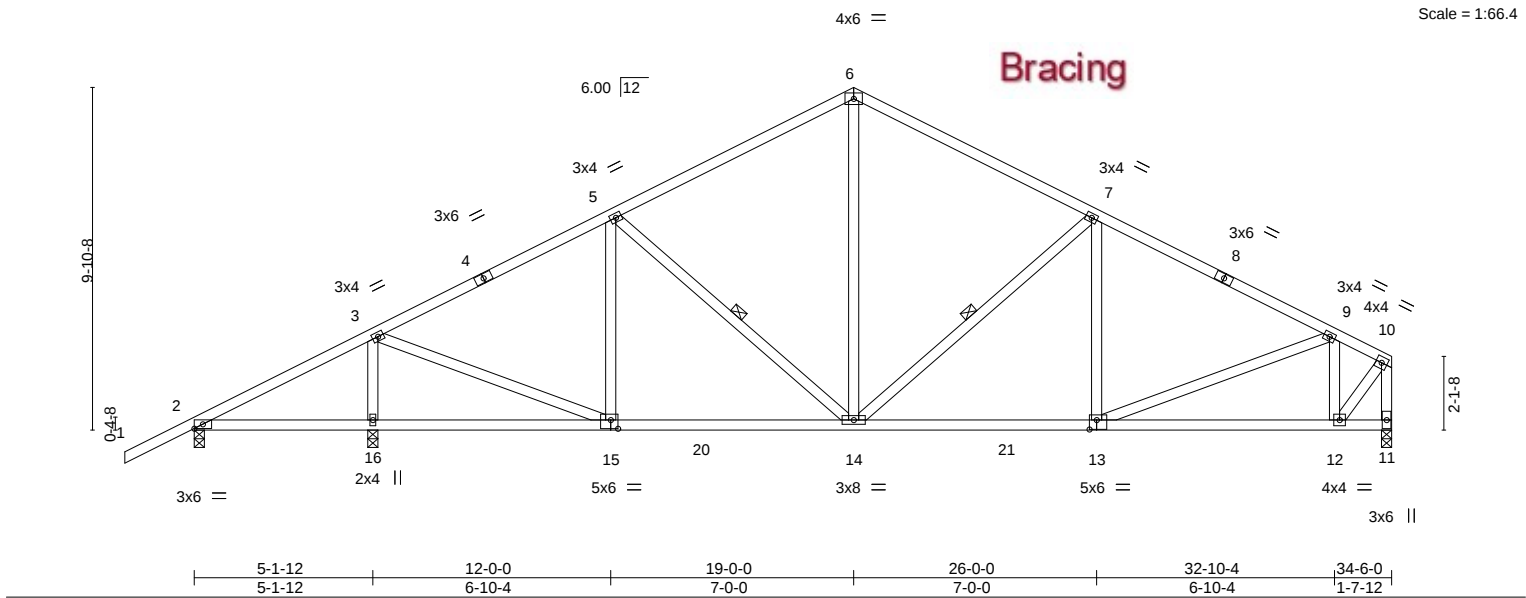


Plate Offsets (X,Y)--		[13:0-2-8,0-3-4], [15:0-2-8,0-3-0]
LOADING (psf)	SPACING-	2-0-0
TCLL 20.0	Plate Grip DOL	1.25
TCDL 7.0	Lumber DOL	1.25
BCLL 0.0 *	Rep Stress Incr	YES
BCDL 10.0	Code	FBC2017/TPI2014
	CSI.	
	TC	0.52
	BC	0.49
	WB	0.53
	Matrix-MS	
	DEFL.	
	in (loc)	l/defl
	Vert(LL)	-0.06 13-14 >999 240
	Vert(CT)	-0.13 13-14 >999 180
	Horz(CT)	0.03 11 n/a n/a
	PLATES	GRIP
	MT20	244/190
	Weight: 203 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-9-3 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-14, 7-14
REACTIONS.	
(size) 2=0-3-8, 16=0-3-8, 11=0-3-8	
Max Horz 2=292(LC 12)	
Max Uplift 2=-128(LC 8), 16=-590(LC 12), 11=-400(LC 13)	
Max Grav 2=231(LC 23), 16=1388(LC 1), 11=1060(LC 1)	

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-201/252, 3-5=-1097/612, 5-6=-999/671, 6-7=-999/671, 7-9=-1293/724, 9-10=-696/366, 10-11=-1078/546
BOT CHORD 14-15=-407/911, 13-14=-510/1089, 12-13=-352/651
WEBS 3-16=-1251/788, 3-15=-516/1115, 5-15=-265/241, 6-14=-303/503, 7-14=-415/328, 9-13=-169/477, 9-12=-703/489, 10-12=-568/1044

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 128 lb uplift at joint 2, 590 lb uplift at joint 16 and 400 lb uplift at joint 11.

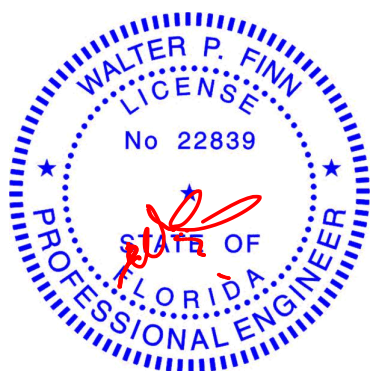

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501968
2455456	T13	Common	4	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:40 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ? q-a8qzg1Ei4iUQGfyBG1pTtqye2O2F8zpRipwRFfyW9WL



Scale = 1:29.2

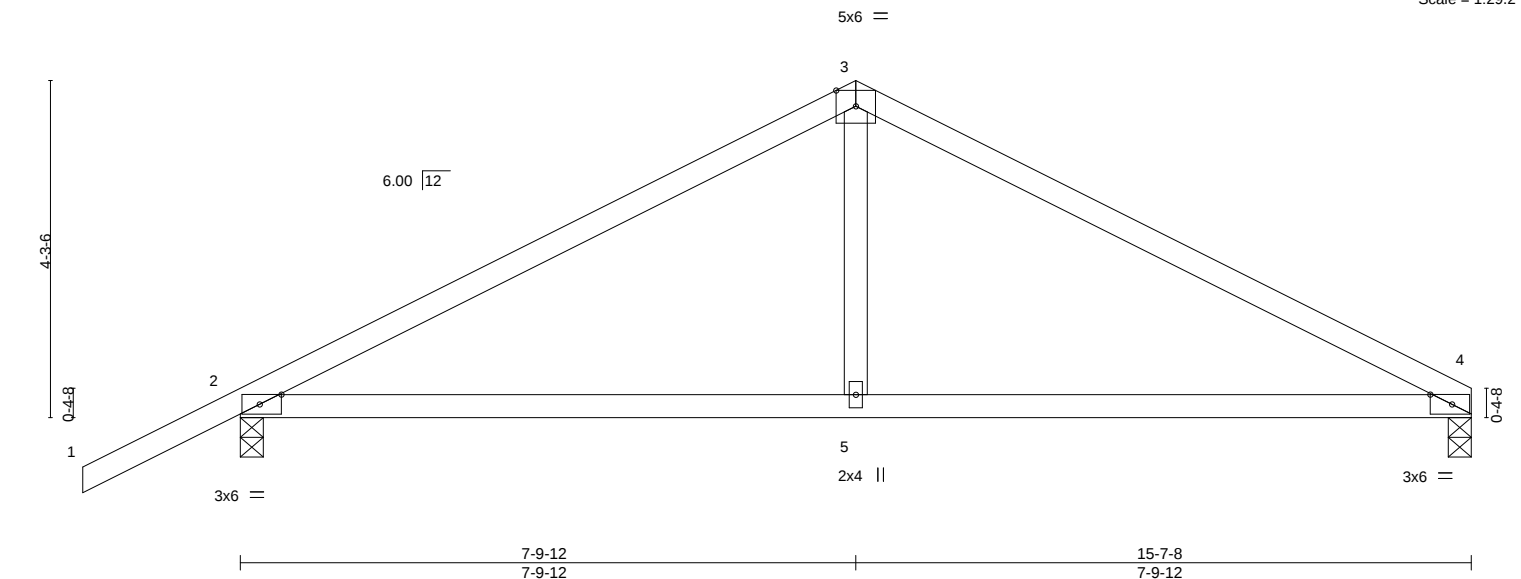


Plate Offsets (X,Y)--		[2:0-3-5,Edge], [4:0-3-5,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.76	Vert(LL)	0.27 5-8	>703	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.72	Vert(CT)	-0.23 5-8	>826	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01 4	n/a	n/a		
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS						Weight: 58 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-1-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-2-14 oc bracing.

REACTIONS. (size) 4=0-3-8, 2=0-3-8
Max Horz 2=124(LC 16)
Max Uplift 4=260(LC 8), 2=295(LC 9)
Max Grav 4=571(LC 1), 2=693(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-815/1080, 3-4=-812/1077
BOT CHORD 2-5=-847/652, 4-5=-847/652
WEBS 3-5=-568/360

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 260 lb uplift at joint 4 and 295 lb uplift at joint 2.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501969
2455456	T13G	COMMON SUPPORTED GAB	4	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:41 2020 Page 1
 ID: 6gT8DbE5xKhVZCk42Ni6wysZ?g-2KOLtNELr?cHupXNqkKIP1VwnnYEtS3awTf_n5yW9WK
 -2-0-0 7-9-12 15-7-8 17-7-8
 2-0-0 7-9-12 2-0-0
 Scale = 1:32.5

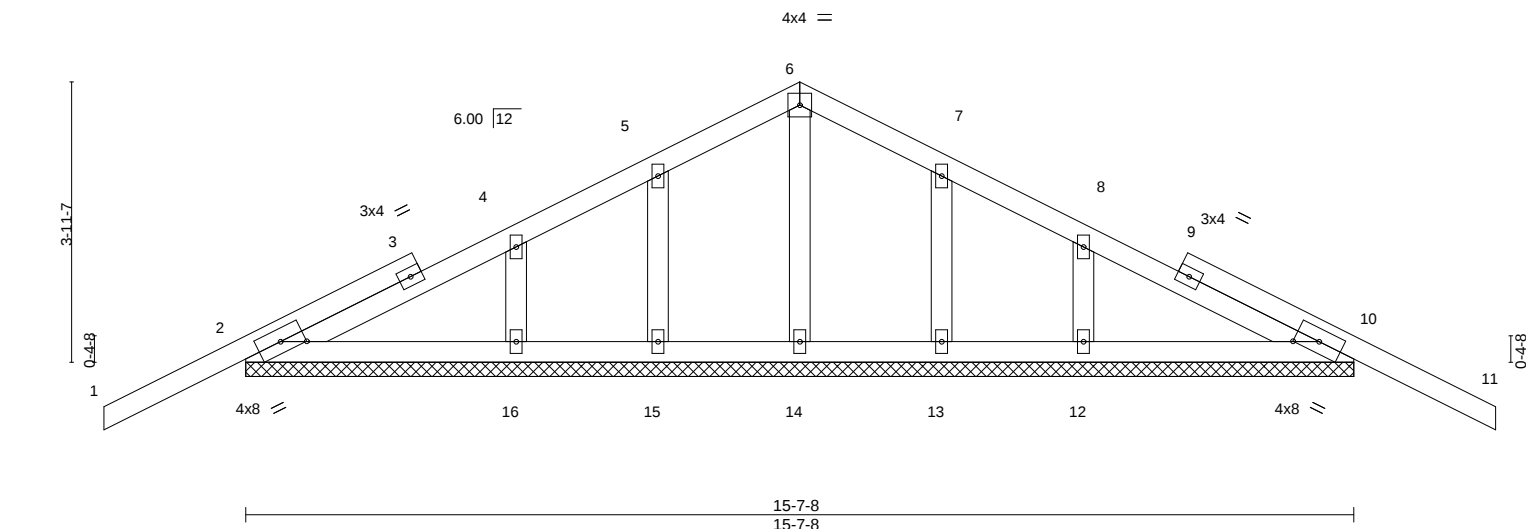


Plate Offsets (X,Y)--		[2:0-4-0,0-1-15], [10:0-4-0,0-1-15]	
LOADING (psf)	SPACING-	2-0-0	CSL
TCLL 20.0	Plate Grip DOL	1.25	TC 0.31
TCDL 7.0	Lumber DOL	1.25	BC 0.09
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.02 11 n/r 120
			Vert(CT) -0.02 11 n/r 120
			Horz(CT) 0.00 10 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 79 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 15-7-8.
 (lb) - Max Horz 2=96(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 15, 13 except 2=-123(LC 12), 10=-140(LC 13), 16=-114(LC 12), 12=-119(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 14, 15, 16, 13, 12 except 2=262(LC 23), 10=262(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 13 except (jt=lb) 2=123, 10=140, 16=114, 12=119.



Walter P. Finn PE No.22839
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501970
2455456	V01	GABLE	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:42 2020 Page 1

ID: 6gT8DbE5xKhVZCk42Ni6wysZ?q-WXyk5jFzcJk8Vz6ZNSryF18HBv4cu0j97PYJYyW9WJ

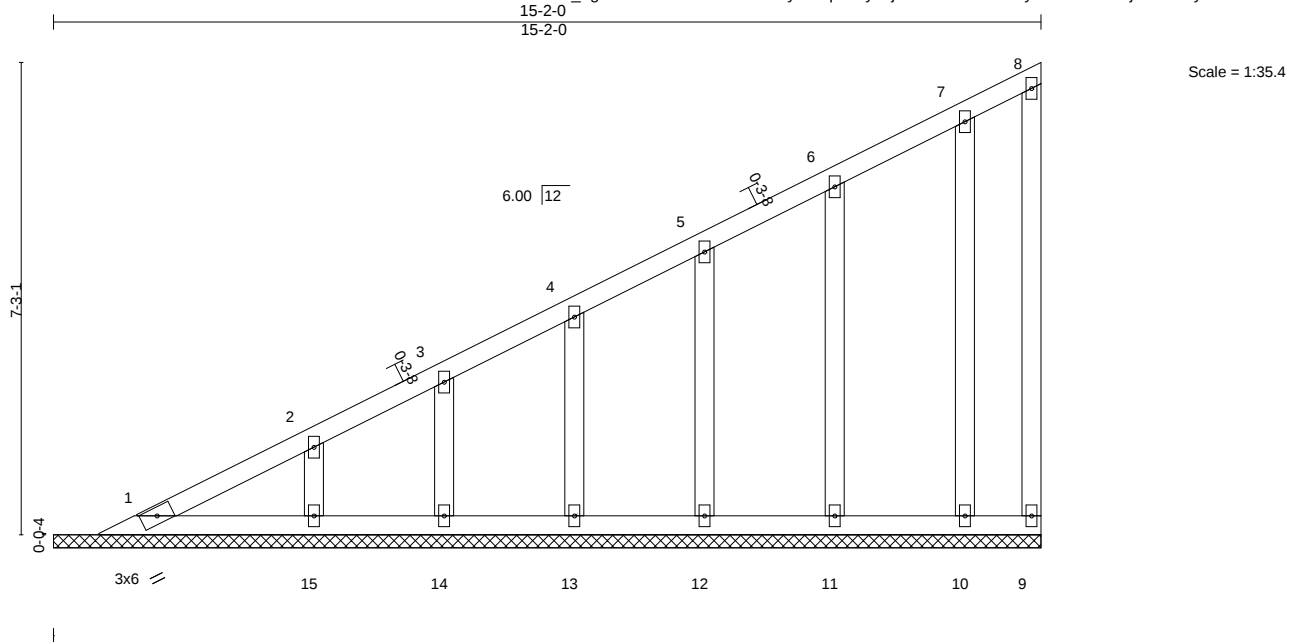

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S					Weight: 87 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-2-0.
(lb) - Max Horz 1=334(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 9, 14, 13, 12, 11, 10 except 15=-132(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 15, 14, 13, 12, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-402/150, 2-3=-316/114, 3-4=-259/96

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) All plates are 2x4 MT20 unless otherwise indicated.
3) Gable requires continuous bottom chord bearing.
4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 14, 13, 12, 11, 10 except (jt=lb) 15=132.

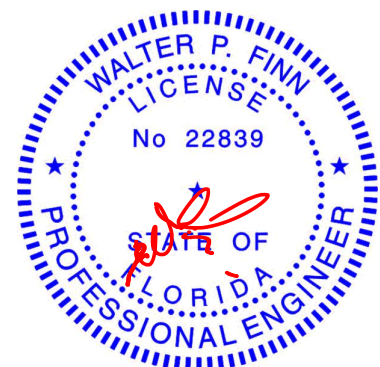

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501971
2455456	V02	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:43 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-_jW6I3GbNds?76gmx9NAUSaHpbDRLLxtOn85s_yW9WI

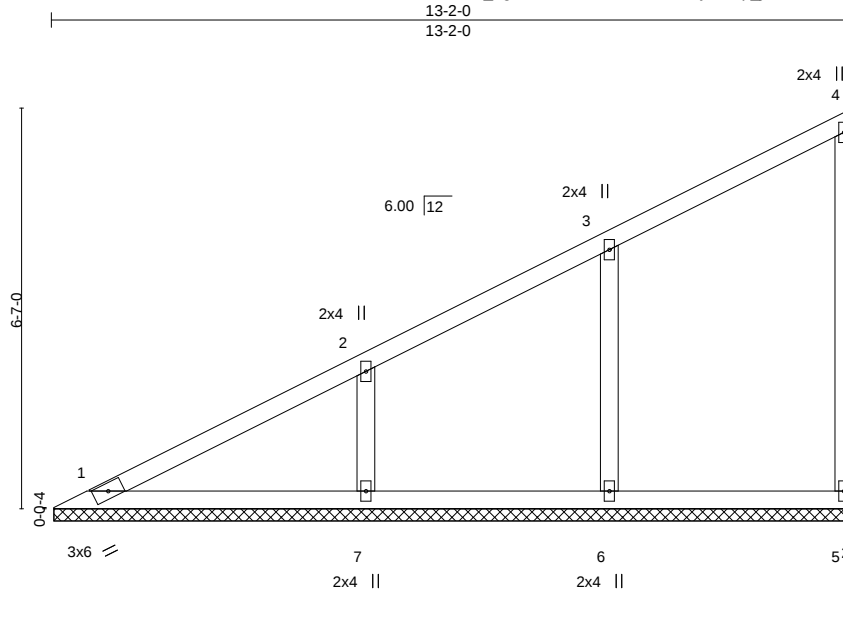

Scale = 1:37.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.22	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S					Weight: 58 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-1-8.
(lb) - Max Horz 1=302(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 5 except 6=-186(LC 12), 7=-227(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=328(LC 2), 7=360(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-344/134
WEBS 3-6=-220/265, 2-7=-256/301

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 6=186, 7=227.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501972
2455456	V03	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:43 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-_jW6l3GbNds?76gmX9NAUSalebDkLLxtOn85s_yW9WI

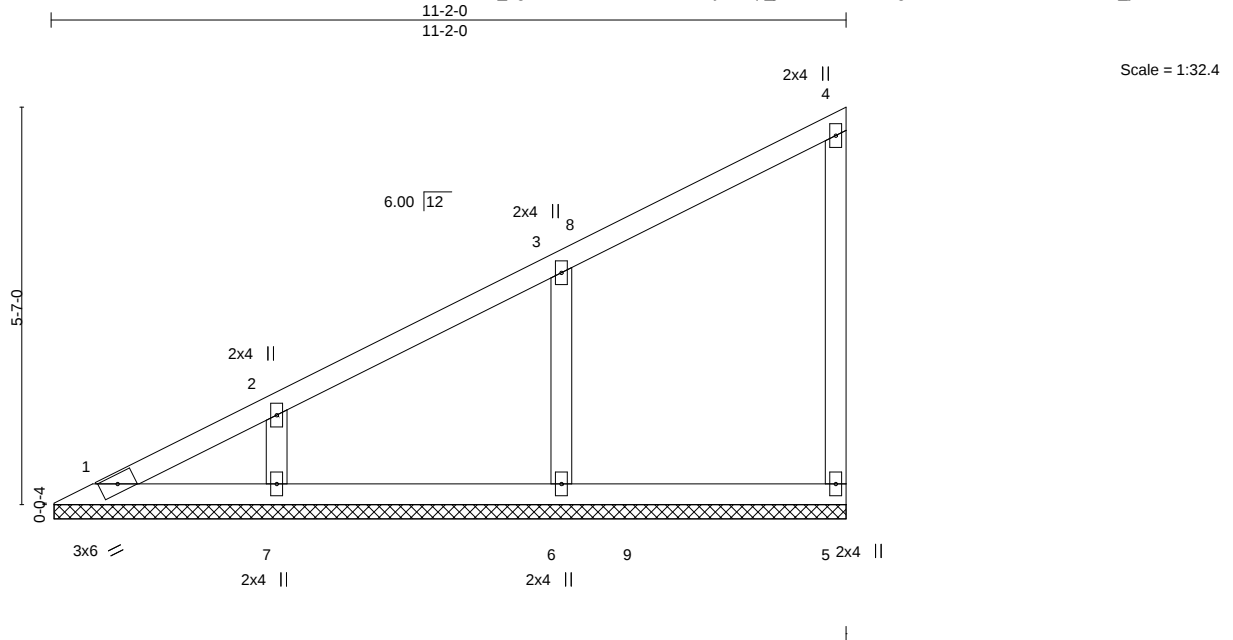

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.15	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						Weight: 48 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 11-1-8.
(lb) - Max Horz 1=228(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 5 except 6=-168(LC 12), 7=-173(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=324(LC 1), 7=263(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-324/122
WEBS 3-6=-237/300

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 6=168, 7=173.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501973
2455456	V04	Valley	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:44 2020 Page 1

ID: 6gT8DbE5xKhVZCk42Ni6wysZ?q-Sv4UVPHD8w_slGFyVtuP1g7SN?Yj4ov0dRueOQyW9WH

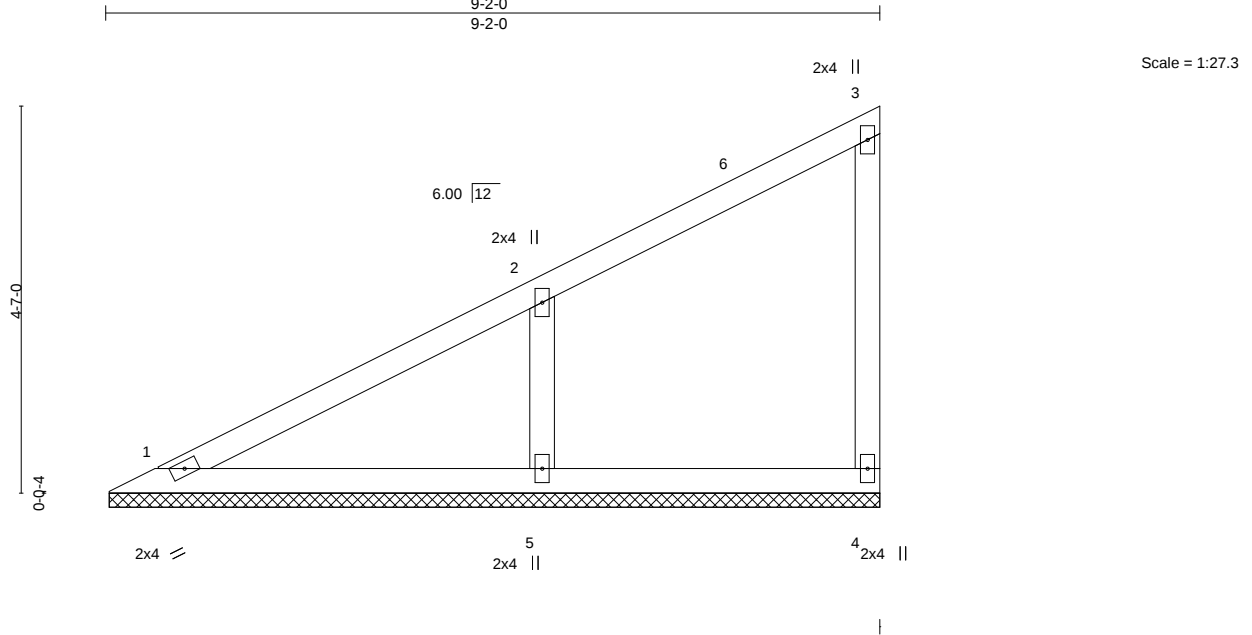


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.23	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						Weight: 37 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS.	(size)
1=9-1-8, 4=9-1-8, 5=9-1-8	
Max Horz 1=194(LC 12)	
Max Uplift 4=-45(LC 12), 5=-235(LC 12)	
Max Grav 1=135(LC 1), 4=103(LC 1), 5=383(LC 1)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS	2-5=-273/361

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Gable requires continuous bottom chord bearing.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=235.

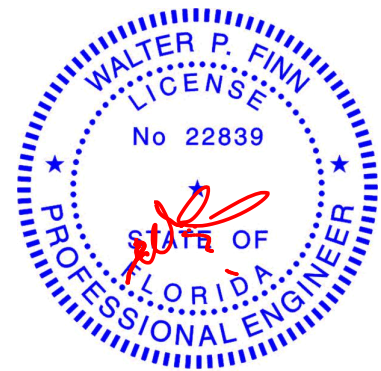

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501974
2455456	V05	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:44 2020 Page 1

ID: 6gT8DbE5xKhVZCk42Ni6wysZ?q-Sv4UVPHD8w_slGFyVtuP1g7TY?Zi4oA0dRueOQyW9WH

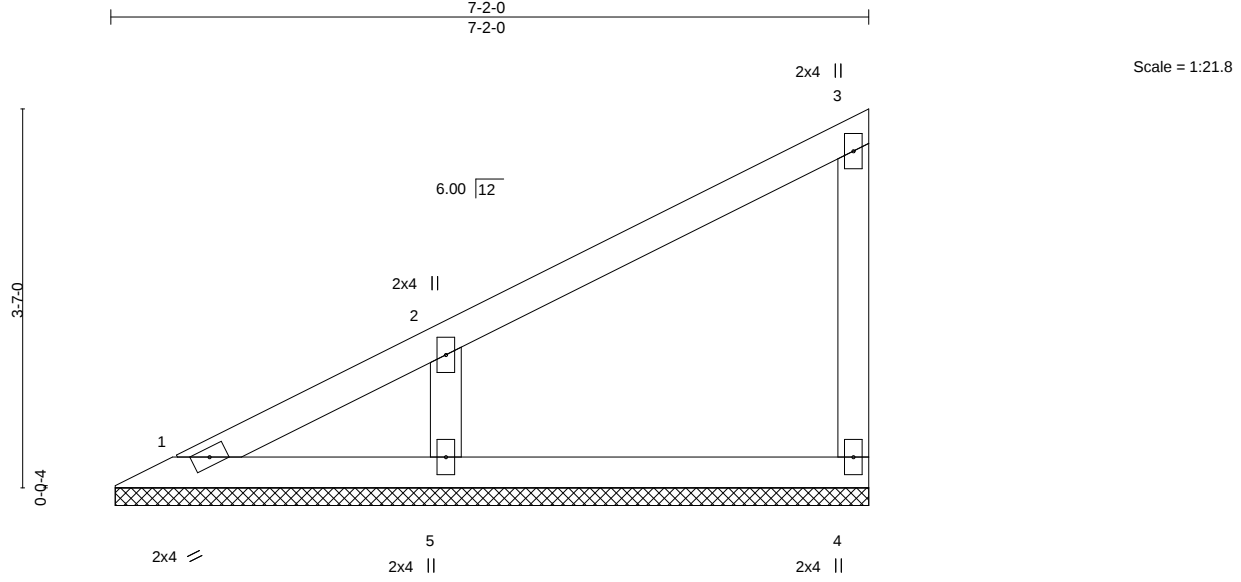

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.11	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						Weight: 27 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 1=7-1-8, 4=7-1-8, 5=7-1-8
Max Horz 1=156(LC 12)
Max Uplift 4=-76(LC 12), 5=-182(LC 12)
Max Grav 1=67(LC 21), 4=121(LC 1), 5=291(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-212/305

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=182.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501975
2455456	V06	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:45 2020 Page 1
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-w6esjIrvE6jMQq83aPeatfbsPtwpGqAr5dCwtyW9WG

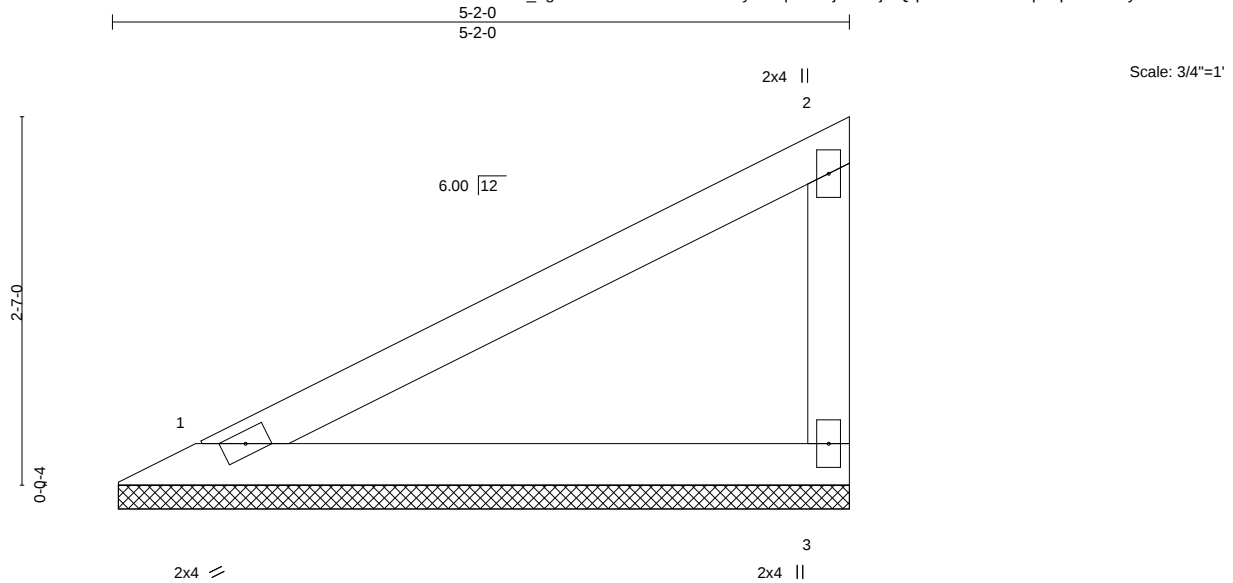


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.37	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.24	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00		n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-P						Weight: 18 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 1=5-1-8, 3=5-1-8
Max Horz 1=107(LC 12)
Max Uplift 1=-48(LC 12), 3=-102(LC 12)
Max Grav 1=163(LC 1), 3=163(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 3=102.

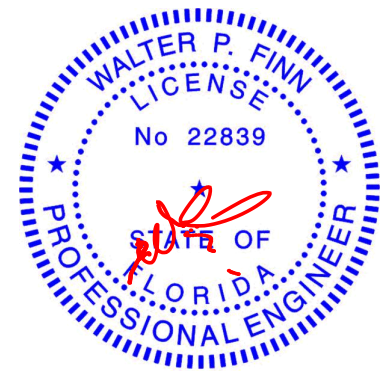

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


MiTek
6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501976
2455456	V07	GABLE	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:45 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-w6esjllrvE6jMQq83aPeatffXPwnpG_Ar5dCwtyW9WG

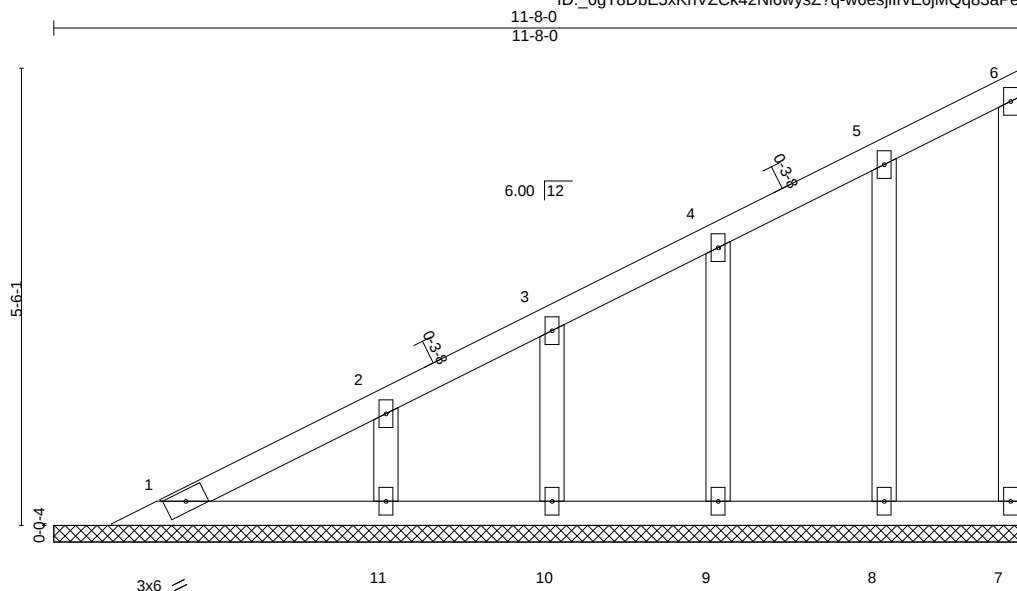

Scale = 1:27.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	7	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S					Weight: 56 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 11-8-0.
(lb) - Max Horz 1=223(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 7, 10, 9, 8 except 11=131(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 11, 10, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-314/120

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) All plates are 2x4 MT20 unless otherwise indicated.
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 10, 9, 8 except (jt=lb) 11=131.

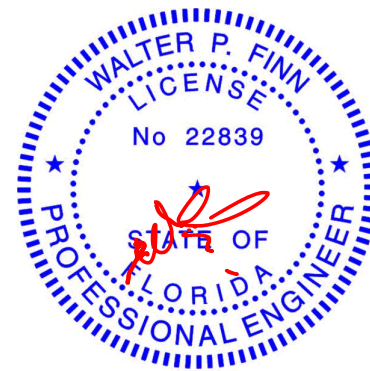

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501977
2455456	V08	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:46 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-OICEw5ITfYEa_aPLclwt65CnAoDiYiJJ4lNITJyW9WF

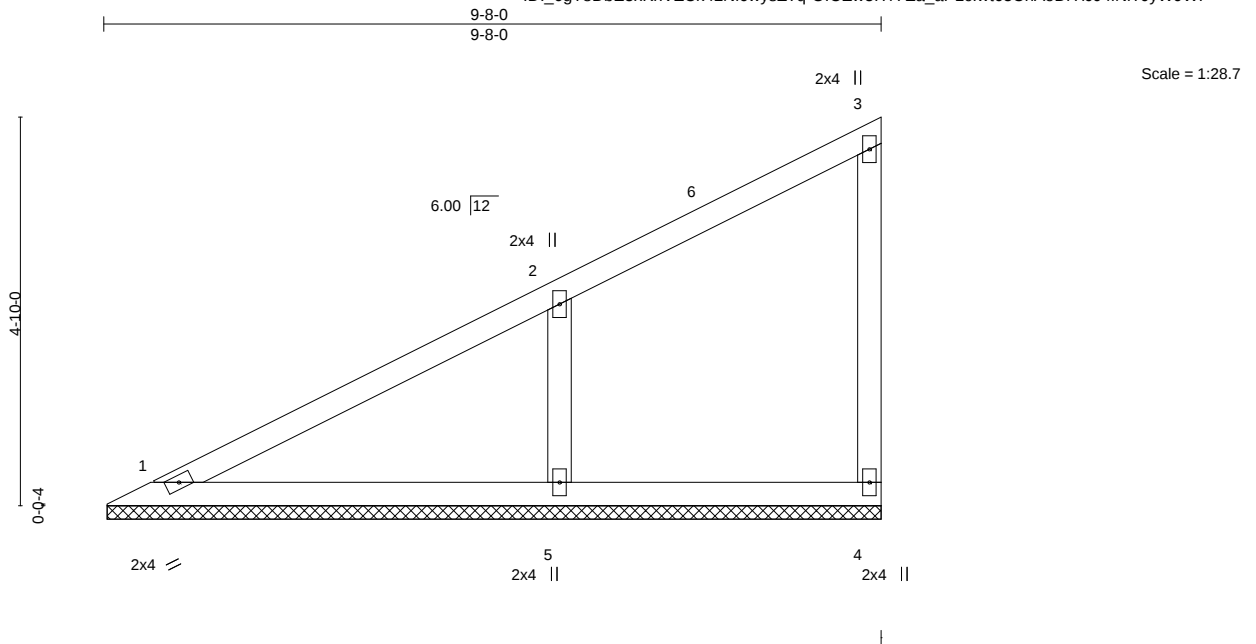

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.20	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						Weight: 39 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=9-7-8, 4=9-7-8, 5=9-7-8
Max Horz 1=203(LC 12)
Max Uplift 4=-36(LC 14), 5=-249(LC 12)
Max Grav 1=150(LC 1), 4=96(LC 1), 5=412(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-293/380

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=249.

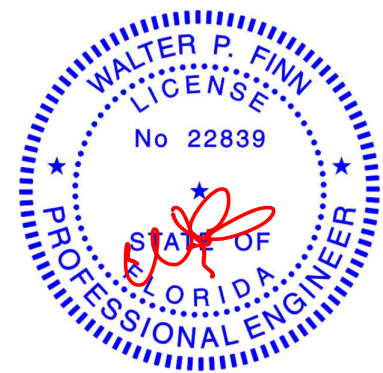

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501978
2455456	V09	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:47 2020 Page 1

ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-sUmd8QJ5QrMRck_XA?R6flk_gCbGH9sTJP6i?lyW9WE

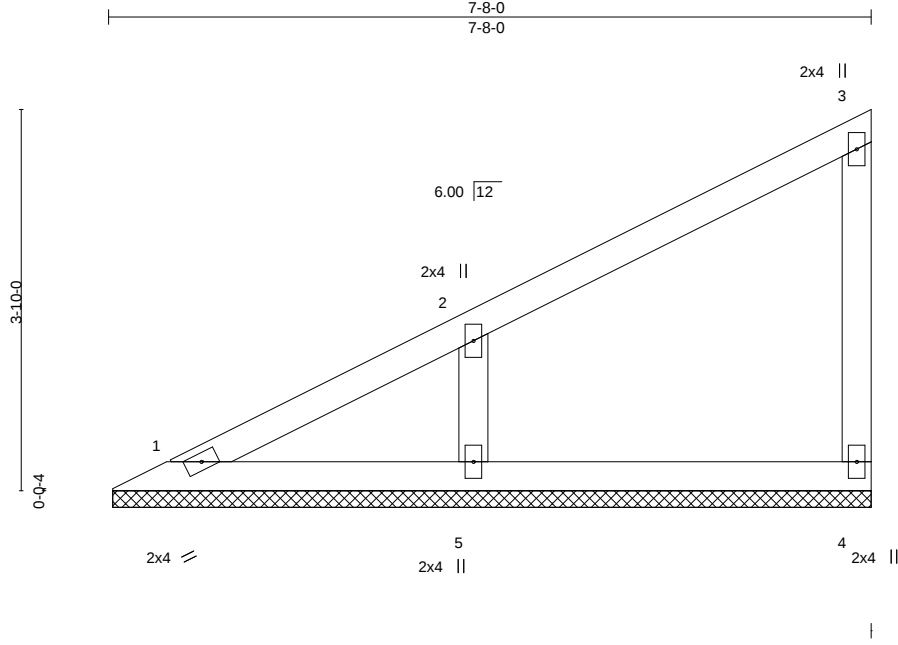

Scale = 1:23.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.12	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						Weight: 30 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 1=7-7-8, 4=7-7-8, 5=7-7-8
Max Horz 1=168(LC 12)
Max Uplift 4=-75(LC 12), 5=-194(LC 12)
Max Grav 1=82(LC 1), 4=119(LC 1), 5=310(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-224/314

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=194.



Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

October 6,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE - APTS.	T21501979
2455456	V10	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:47 2020 Page 1

ID: 6gT8DbE5xKhVZCk42Ni6wysZ?q-sUmd8QJ5QrMRck_XA?R6flkvuCYQHAJJP6I?lyW9WE

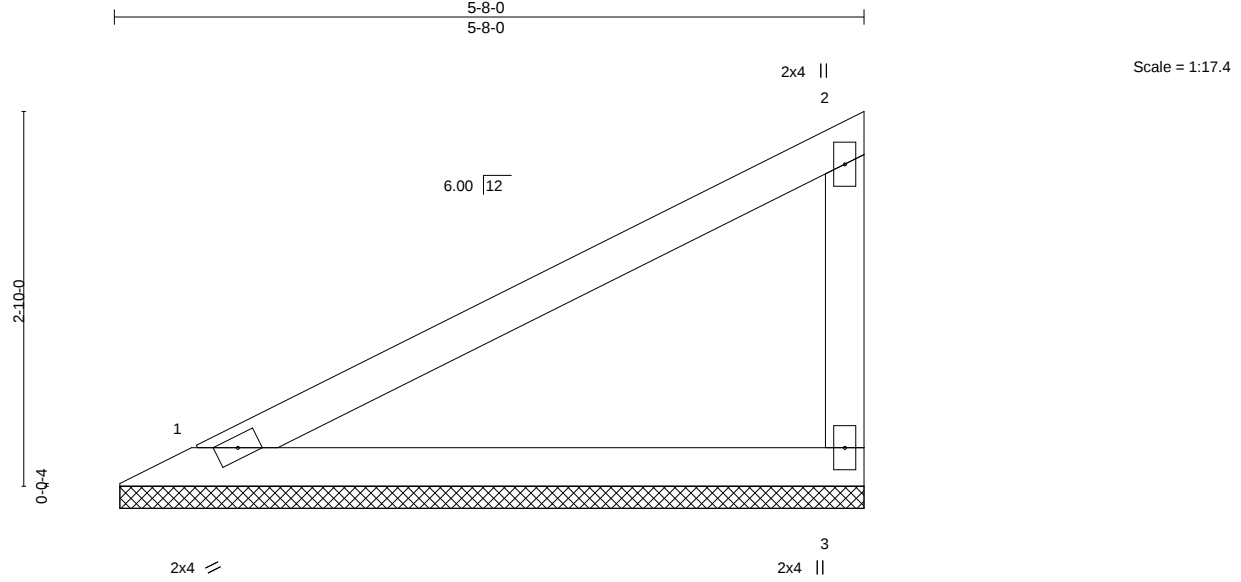


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.47	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.30	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00		n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-P						Weight: 20 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-8-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 1=5-7-8, 3=5-7-8
Max Horz 1=119(LC 12)
Max Uplift 1=-54(LC 12), 3=-114(LC 12)
Max Grav 1=181(LC 1), 3=181(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) Gable requires continuous bottom chord bearing.
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 3=114.

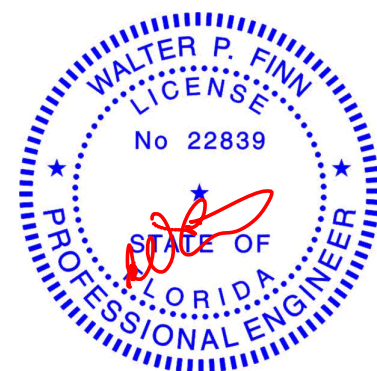

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2455456	Truss V11	Truss Type Valley	Qty 2	Ply 1	BLAKE - APTS. T21501980
----------------	--------------	----------------------	----------	----------	----------------------------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 6 10:44:48 2020 Page 1
ID: _6gT8DbE5xKhVZCk42Ni6wysZ?q-LhJ?LmKkB9UIDuZjkiyLBWH9Zcxp0dZcX3ssXCyW9WD

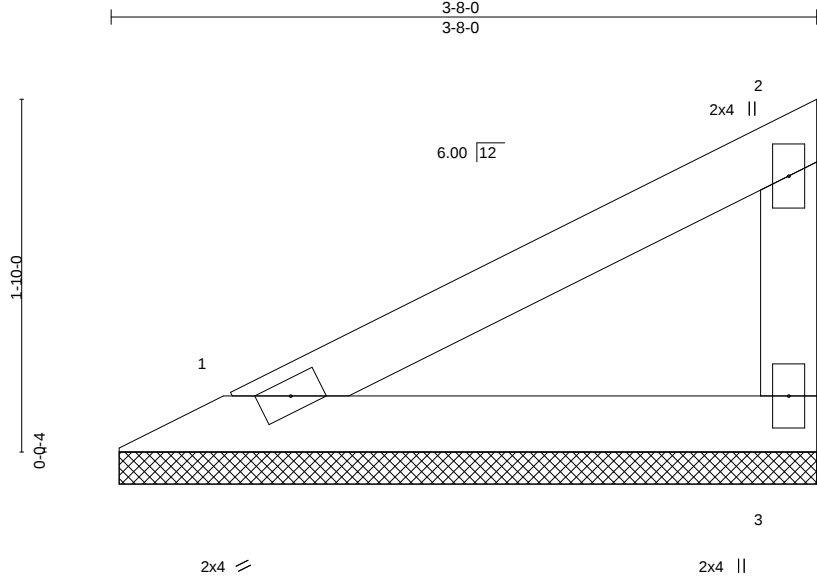

Scale: 1"=1'


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00		n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-P					Weight: 12 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 1=3-7-8, 3=3-7-8
Max Horz 1=71(LC 12)
Max Uplift 1=-32(LC 12), 3=-67(LC 12)
Max Grav 1=107(LC 1), 3=107(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Gable requires continuous bottom chord bearing.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

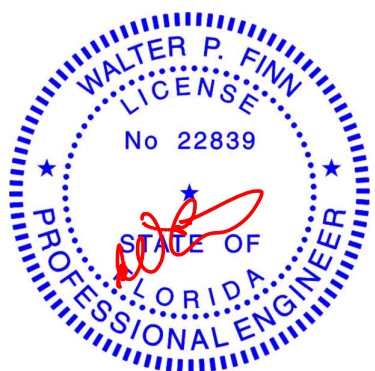

Walter P. Finn PE No.22839
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


October 6,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless X, Y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

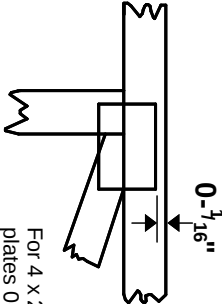

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—
—
This symbol indicates the required direction of slots in connector plates.

*** Plate location details available in MITek 20120 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

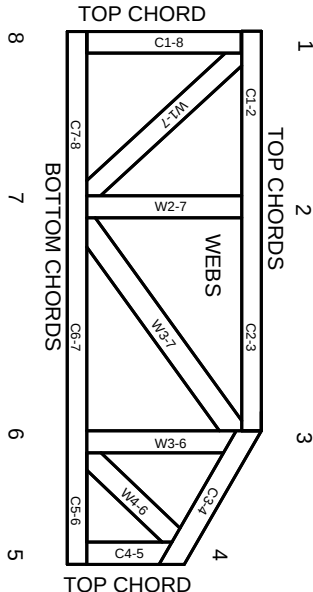

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.