

CR # 10-7648



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 20-0480
DATE PAID: 2/11/20
FEE PAID: 370.00
RECEIPT #: 1510548

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: BLUE SKY TIMBER / RACHEL SHELDONAGENT: PELONI'S SEPTICTELEPHONE: (386) 344-4205MAILING ADDRESS: 330 W RAILROAD ST.

LAKE CITY

FL 32055

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: N/A BLOCK: N/A SUBDIVISION: METES AND BOUNDS PLATTED: _____PROPERTY ID #: 13-4S-15-00358-001 ZONING: AG I/M OR EQUIVALENT: ☐ NO ☐PROPERTY SIZE: 10.070 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ≤ 2000 GPD ☐ > 2000 GPDIS SEWER AVAILABLE AS PER 381.0065, FS? ☐ NO ☐ DISTANCE TO SEWER: N/A FTPROPERTY ADDRESS: 233 SE BALLARD CT. LAKE CITYDIRECTIONS TO PROPERTY: 90 WEST TURN LEFT ON PINE MT. TURN LEFT ON JAFUS, TO END. TURN RIGHT ON BALLARD AND FOLLOW AROUND CURVE. SITE ON LEFT.BUILDING INFORMATION ☒ RESIDENTIAL ☐ COMMERCIAL


Unit No.	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	MOBILE HOME	3	1,795	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify) _____SIGNATURE: [Signature]DATE: 6-17-2020

Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan

Permit Application Number: 20-0480

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

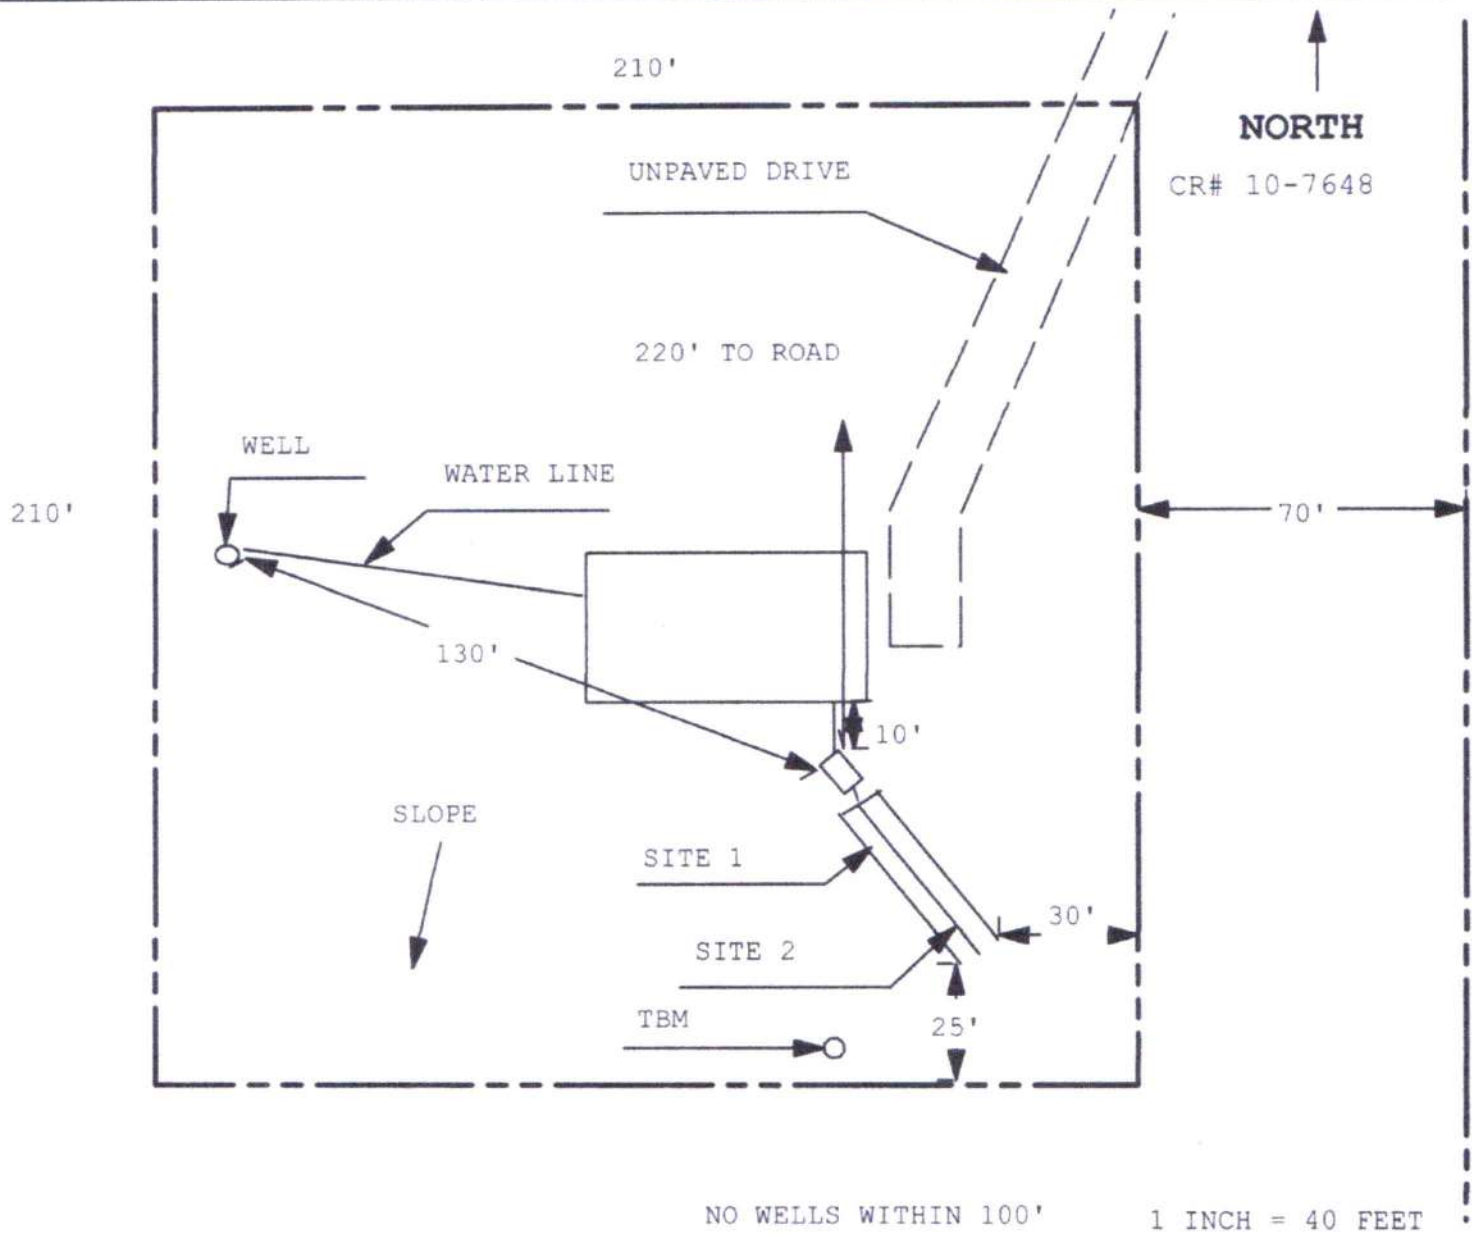

Site Plan Submitted By Paul R. Rags Date 6/17/20
Plan Approved ✓ Not Approved _____ Date 6/18/2020

By Kell Rags Columbia CPHU

Notes: _____



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-2092163
APPLICATION #: AP1510548
DATE PAID: 6/17/2020
FEE PAID: 31000
RECEIPT #: 12-P10-4457311
DOCUMENT #: PR1353832

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: BLUE**20-0480 SKY TIMBER

PROPERTY ADDRESS: 233 SE BALLARD Ct Lake City, FL 32024

LOT: _____ BLOCK: _____ SUBDIVISION: _____

PROPERTY ID #: 00358-001

[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD New Septic CAPACITY
A [] GALLONS / GPD N/A CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []

D [375] SQUARE FEET Drainfield SYSTEM
R [] SQUARE FEET N/A SYSTEM

A TYPE SYSTEM: [X] STANDARD [] FILLED [] MOUND []

I CONFIGURATION: [X] TRENCH [] BED []

N

F LOCATION OF BENCHMARK: Nail in 6" oak tree S of system site

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES] FT [] ABOVE / BELOW BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [44.00] [INCHES] FT [] ABOVE / BELOW BENCHMARK/REFERENCE POINT

L

D FILL REQUIRED: [0.00] INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 3 bedrooms with a maximum occupancy of 6 persons (2 per bedroom), for a total estimated flow of 300 gpd.

T

H

E

R

SPECIFICATIONS BY: Paul Lloyd

TITLE: _____

APPROVED BY: Kelli Rogers
Kelli C Rogers

TITLE: Environmental Specialist II

Columbia CHD

DATE ISSUED: 06/18/2020

EXPIRATION DATE: 12/18/2021

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

Page 1 of 3

0114

AP1510548

PR1353832

SP