



REVISIONS	22 / Sept. / 2008
	28 / Sept. / 2008
	30 / Sept. / 2008
	17 / Nov / 2008 (Finals)
	26 / Nov / 2008 (Finals)
	28 / Nov / 2008 (Finals)
	14 / Jan / 2008 (Finals)

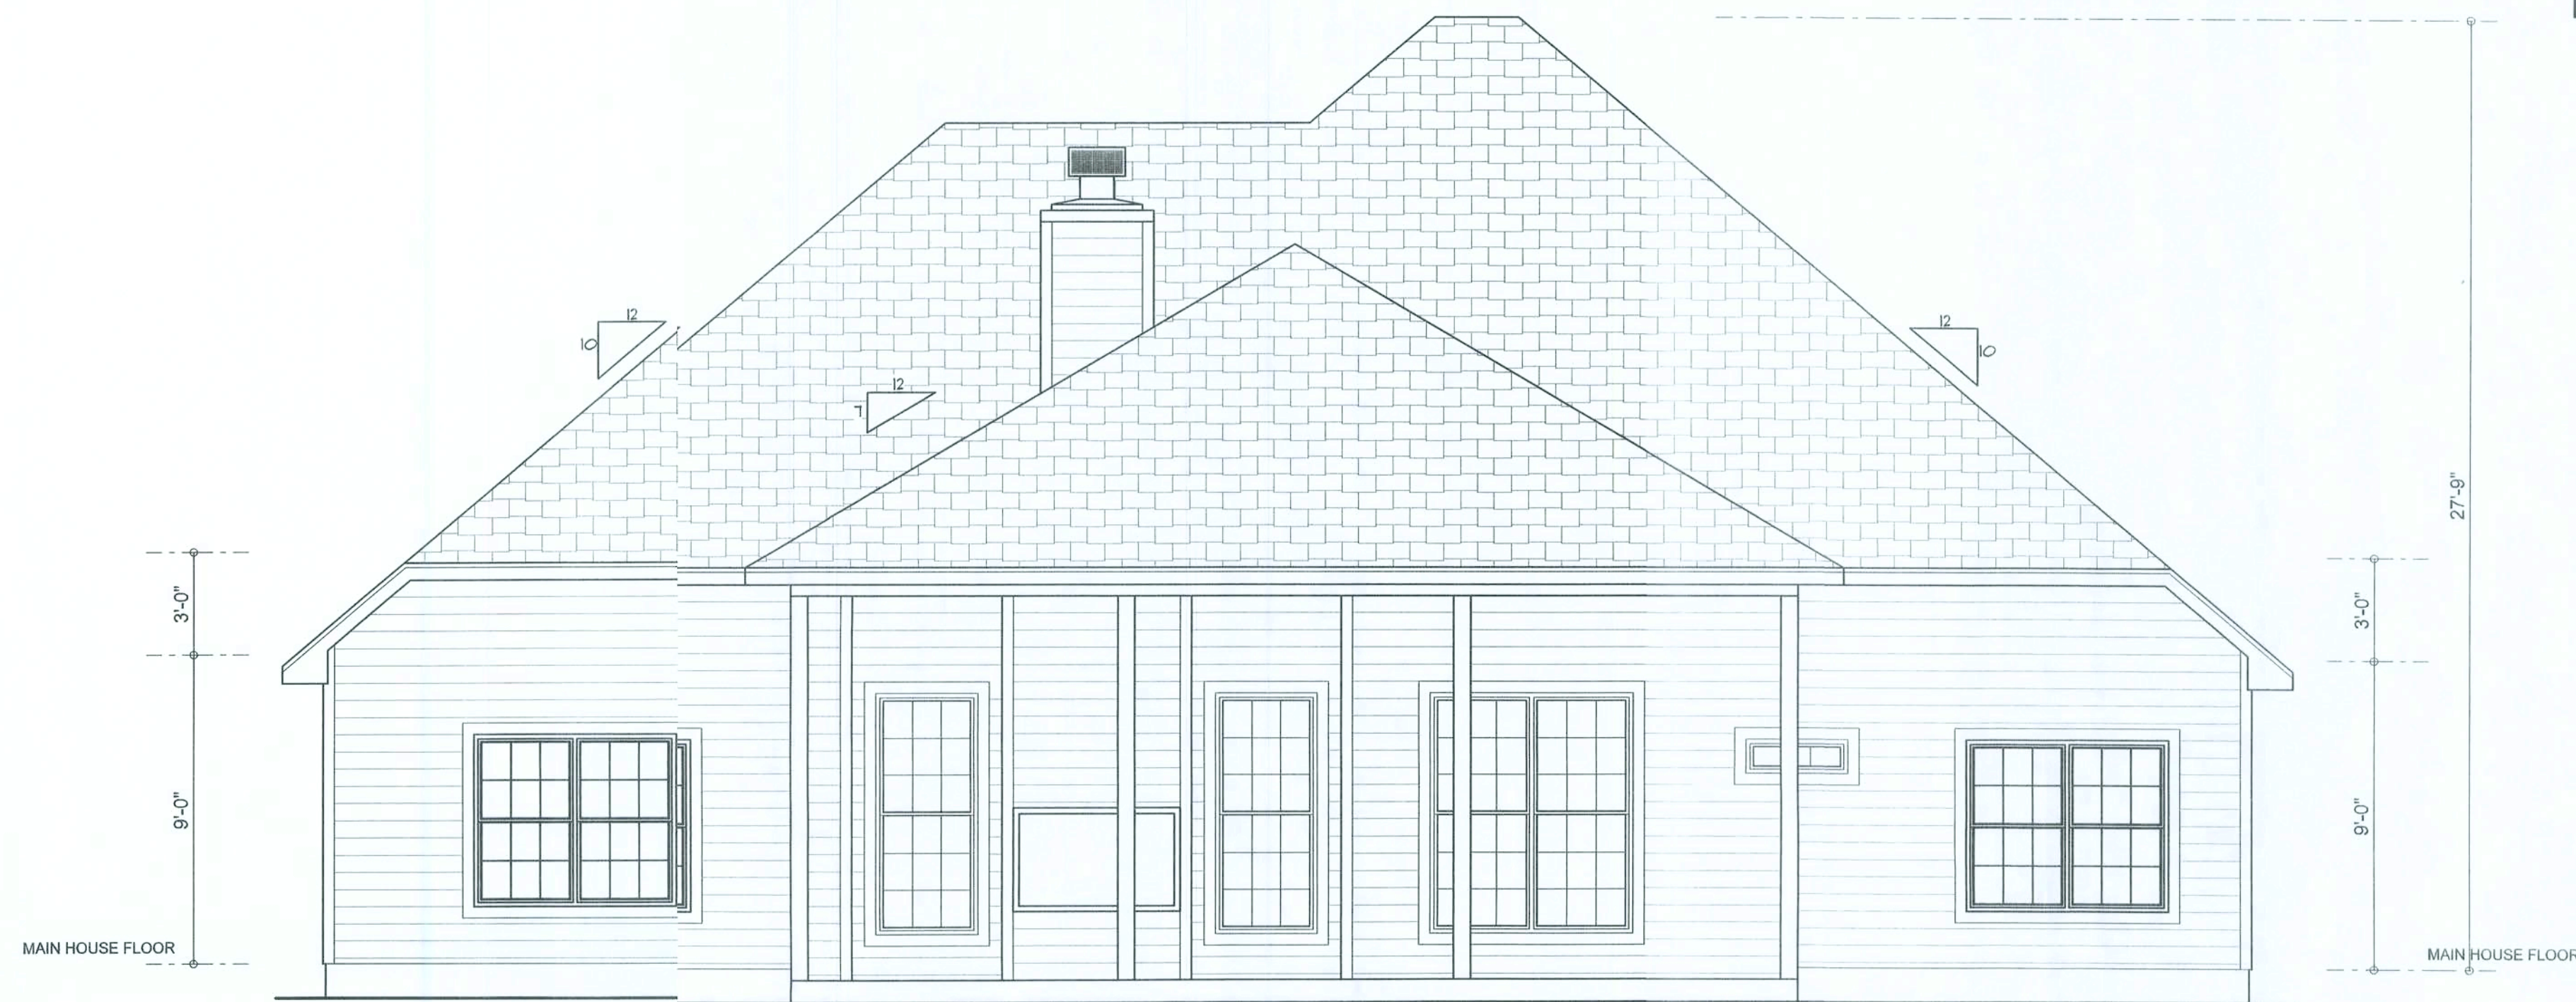

REAR ELEVATION

SCALE: 1/4" = 1'-0"

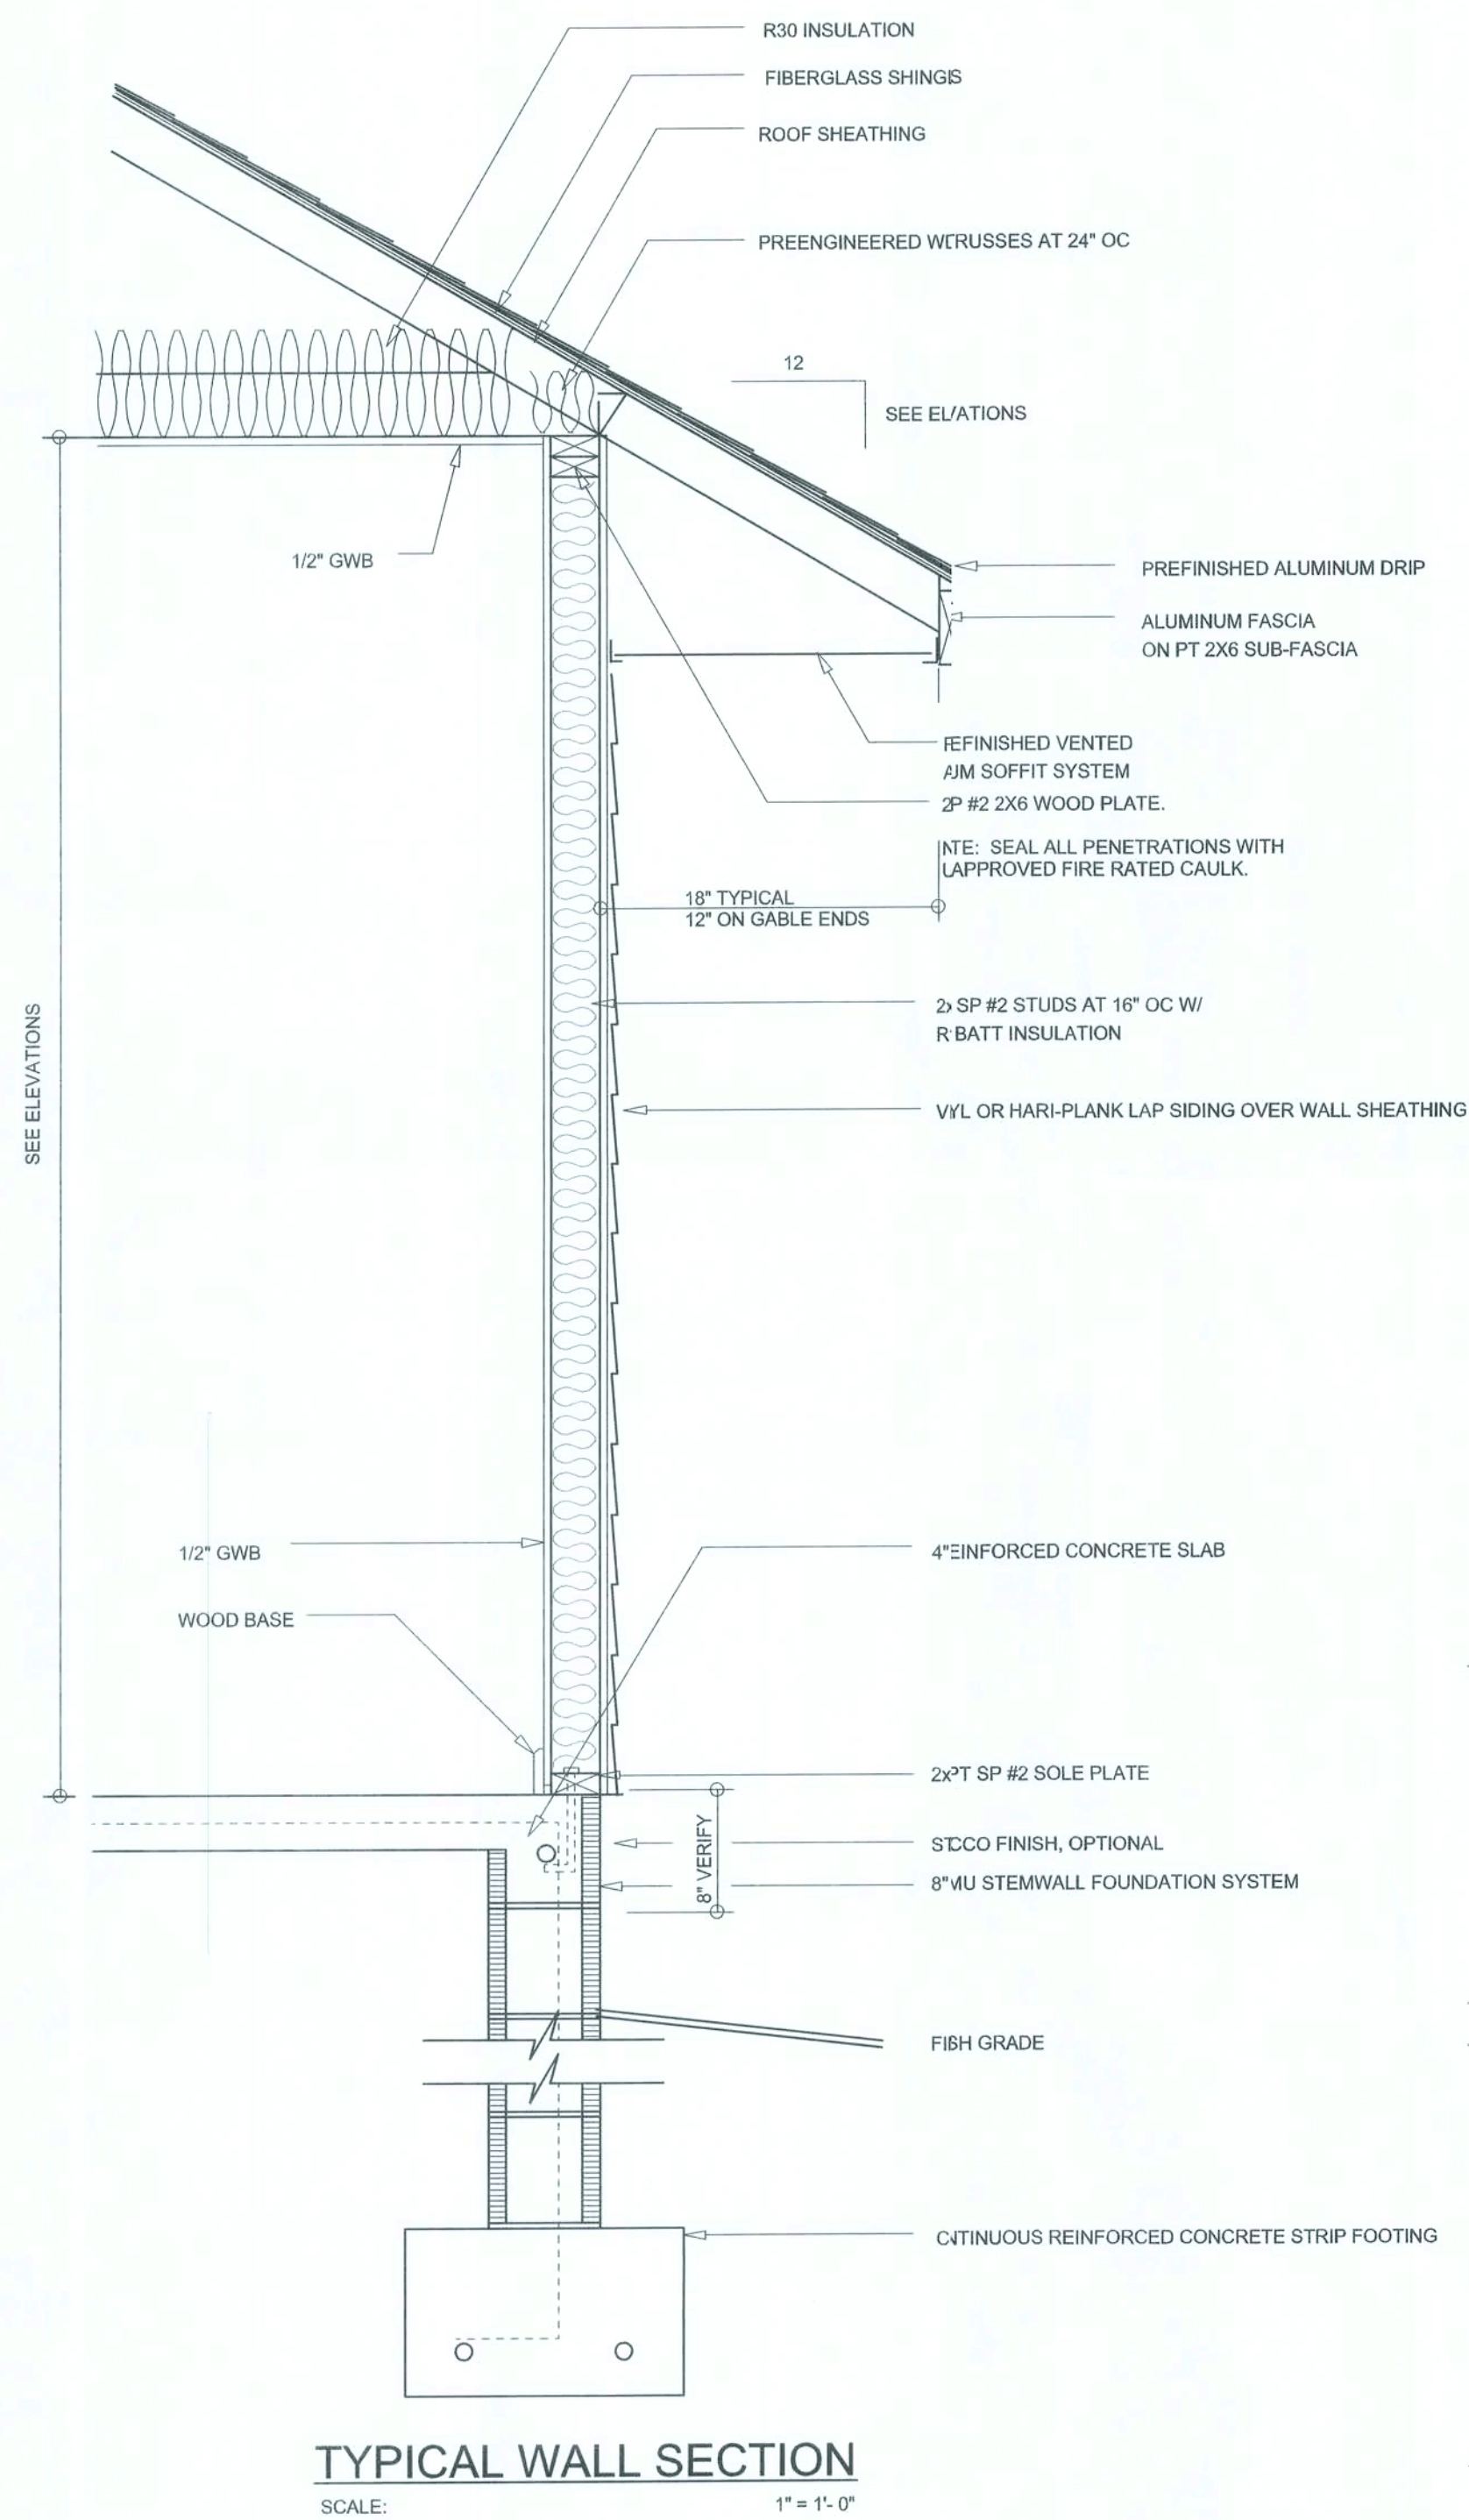

FRONT ELEVATION

SCALE: 1/4" = 1'-0"

NOTE: GARAGE FLOOR TO BE 1'-0" MIN. BELOW MAIN HOUSE FLOOR

PERMIT #090221

A CUSTOM RESIDENCE FOR:

PAUL & EMMY PHINNEY

PROJECT ADDRESS

BLAYLOCK ROAD
COLUMBIA COUNTY
FLORIDA 32024

DRAWN BY:

(386) 466 - 7338

DRAWING DATE:



February 23, 2009

SHEET NUMBER

A1

OF 4 SHEETS

REVISIONS	22 / Sept. / 2008
	28 / Sept. / 2008
	30 / Sept. / 2008
	17 / Nov /2008 (Finals)
	26 / Nov /2008 (Finals)
	28 / Nov /2008 (Finals)
	14 / Jan /2008 (Finals)

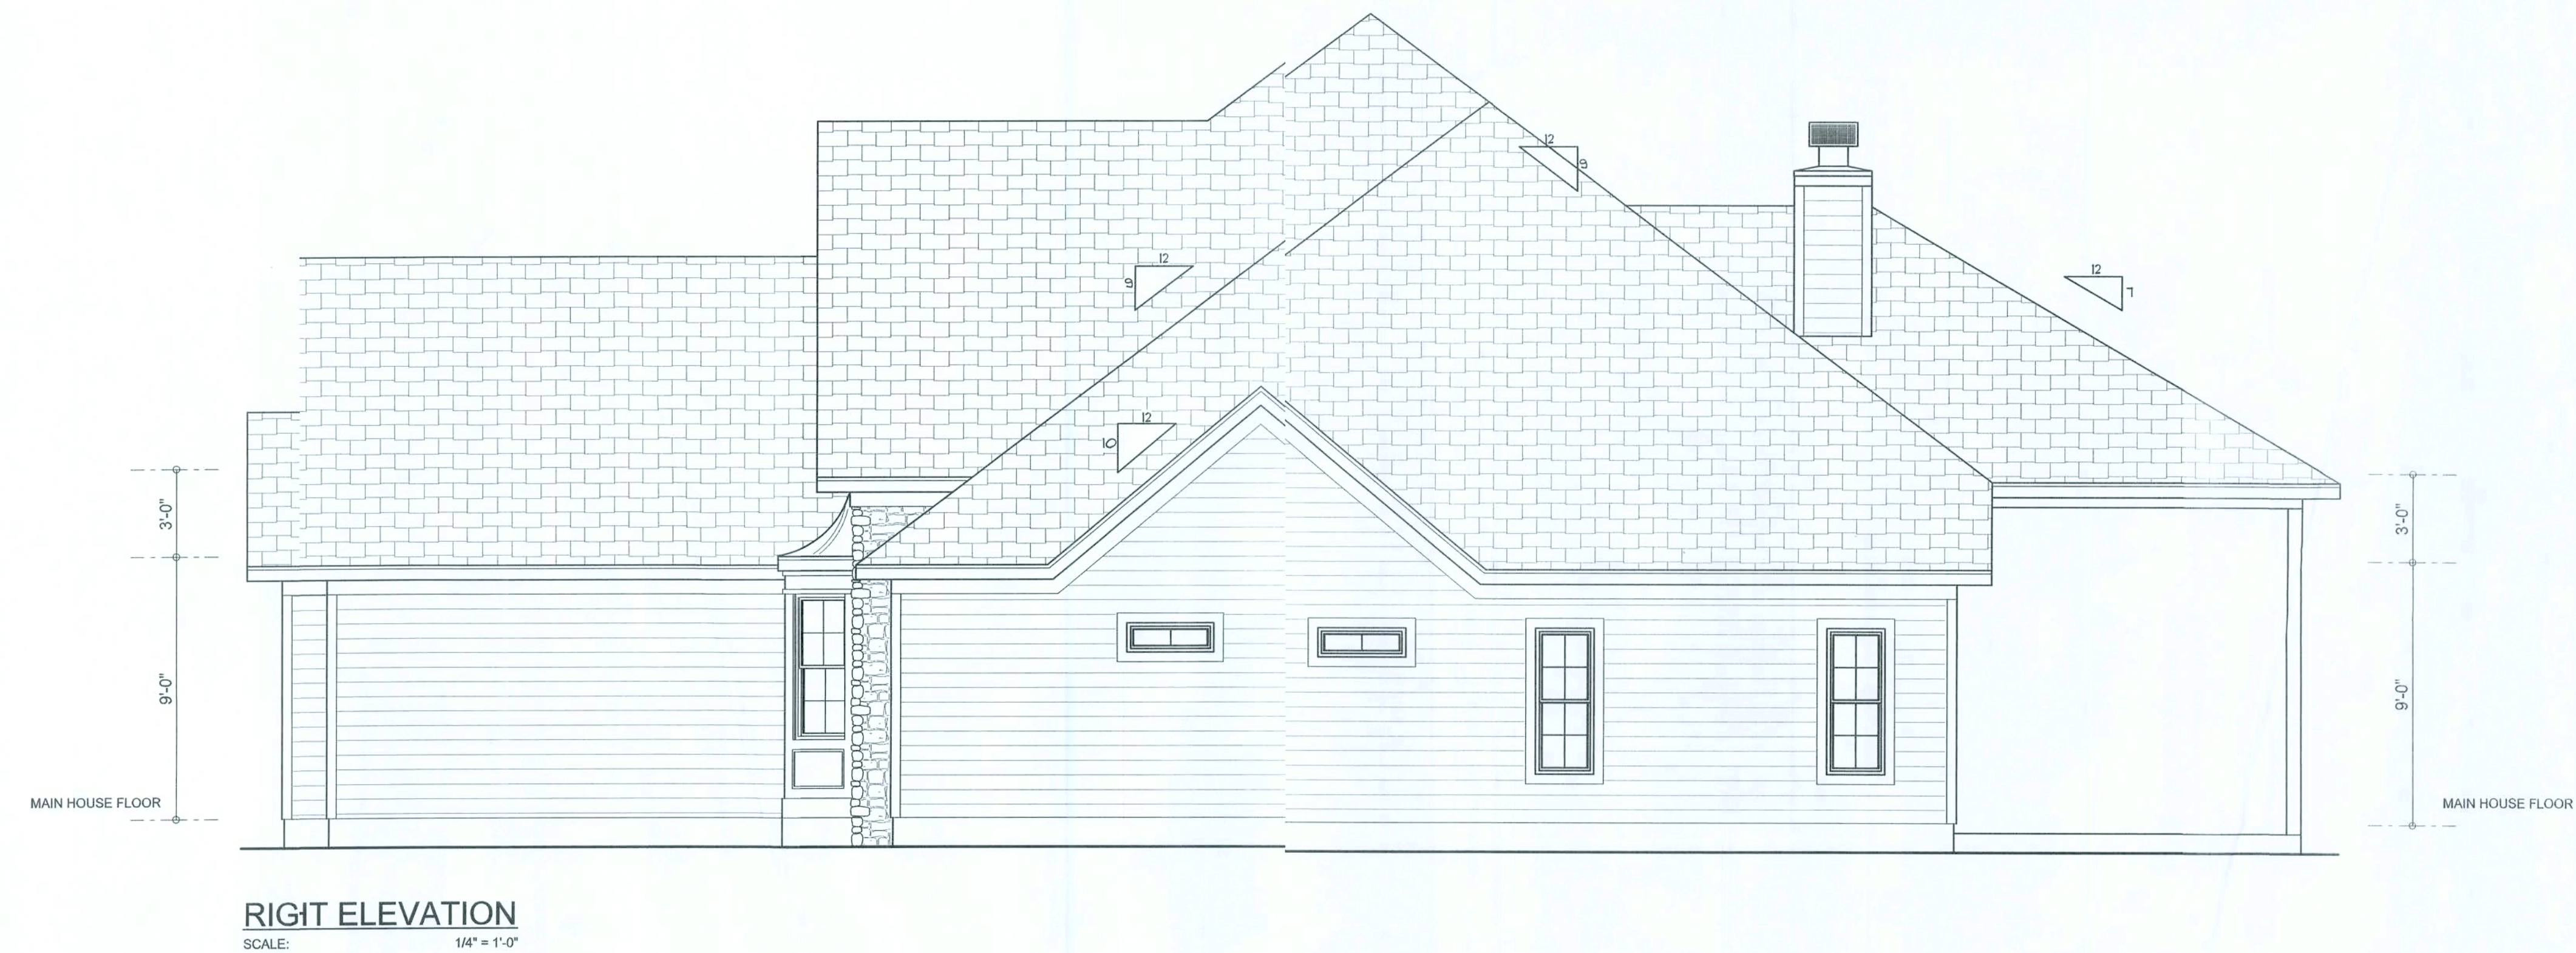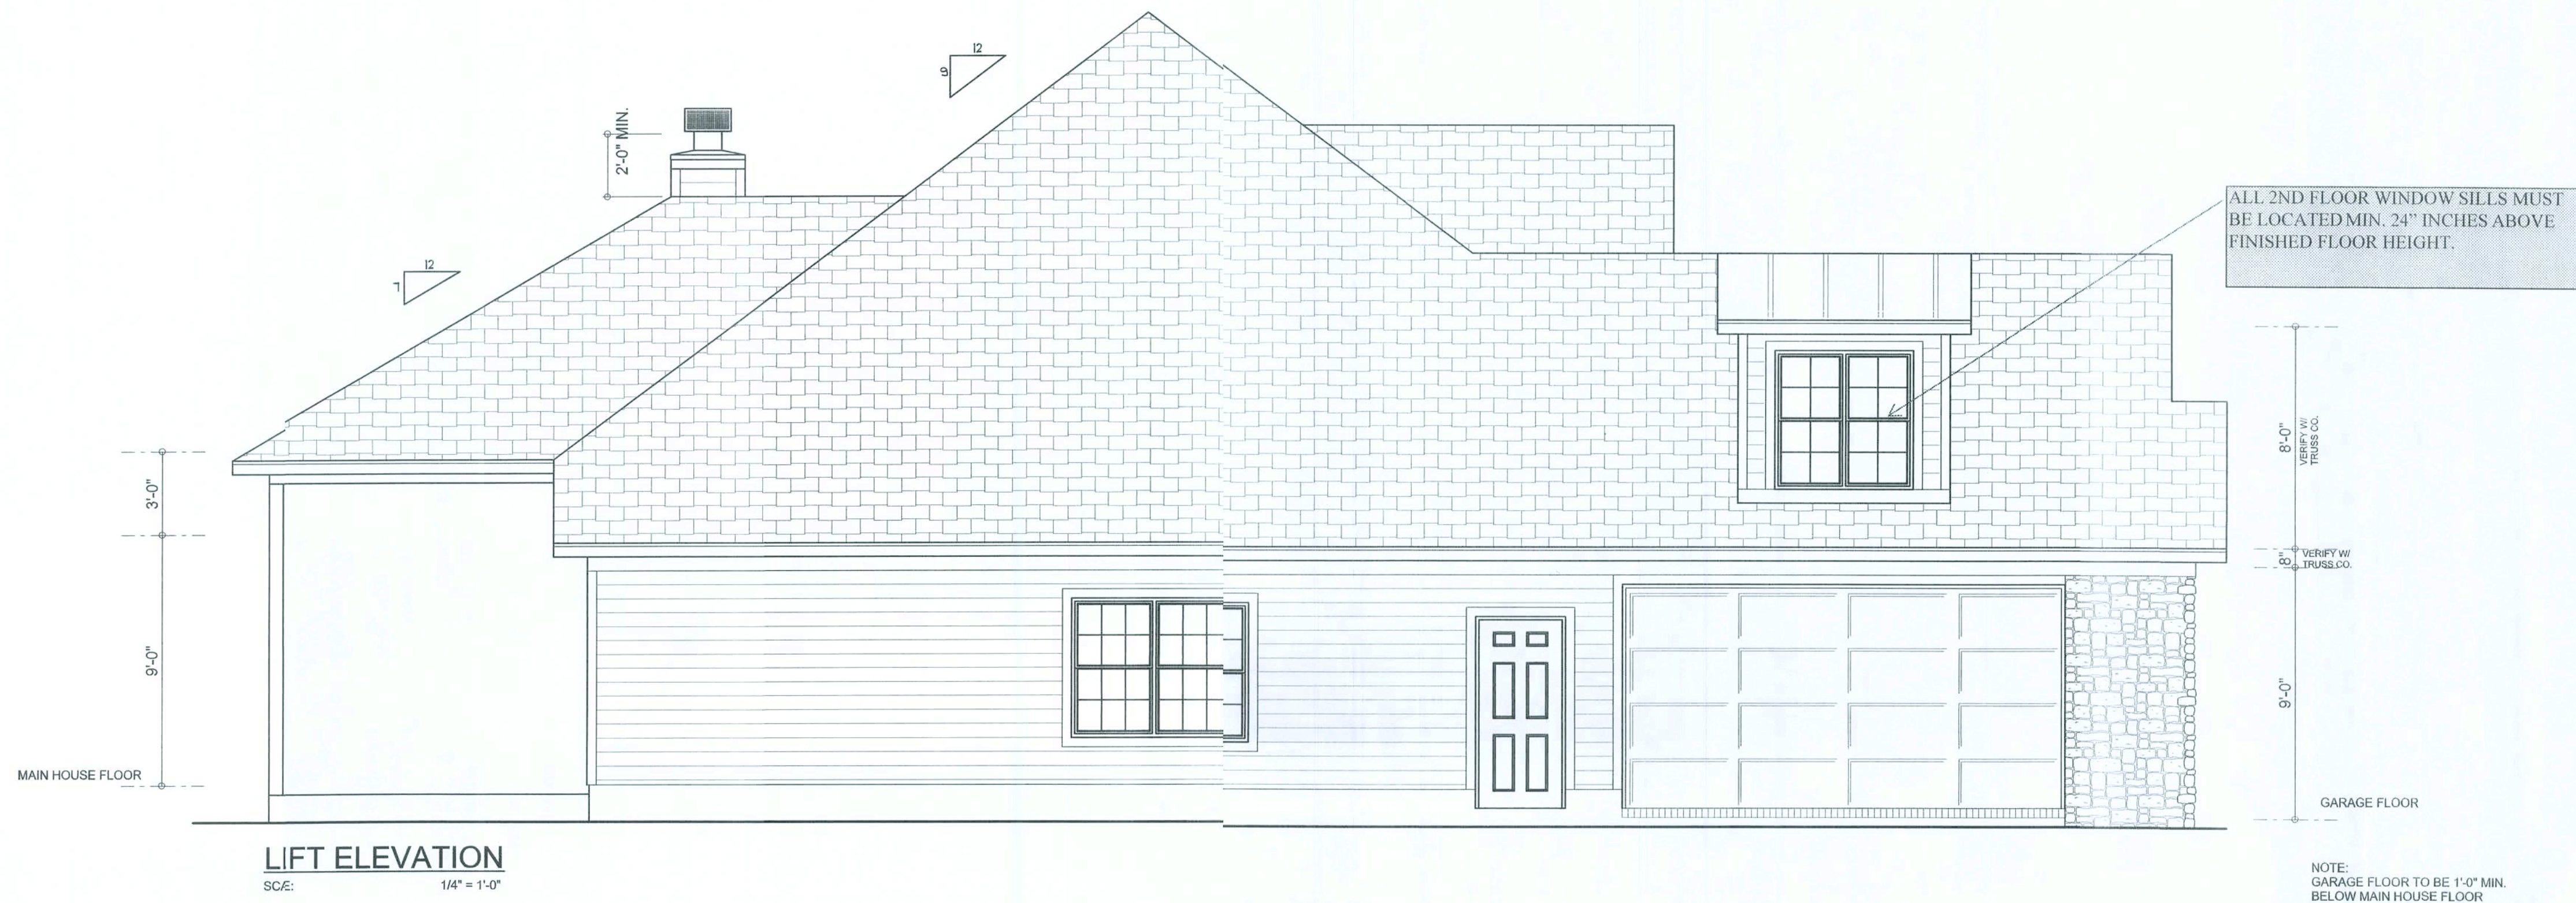

PERMIT #090221



A CUSTOM RESIDENCE FOR:
**PAUL & EMMY
PHINNEY**
PROJECT ADDRESS:
BLAYLOCK ROAD
COLUMBIA COUNTY
FLORIDA 32024

DRAWN BY:

(386) 466 - 7138

DRAWING DATE:
February 23, 2009

SHEET NUMBER
A2
OF 4 SHEETS

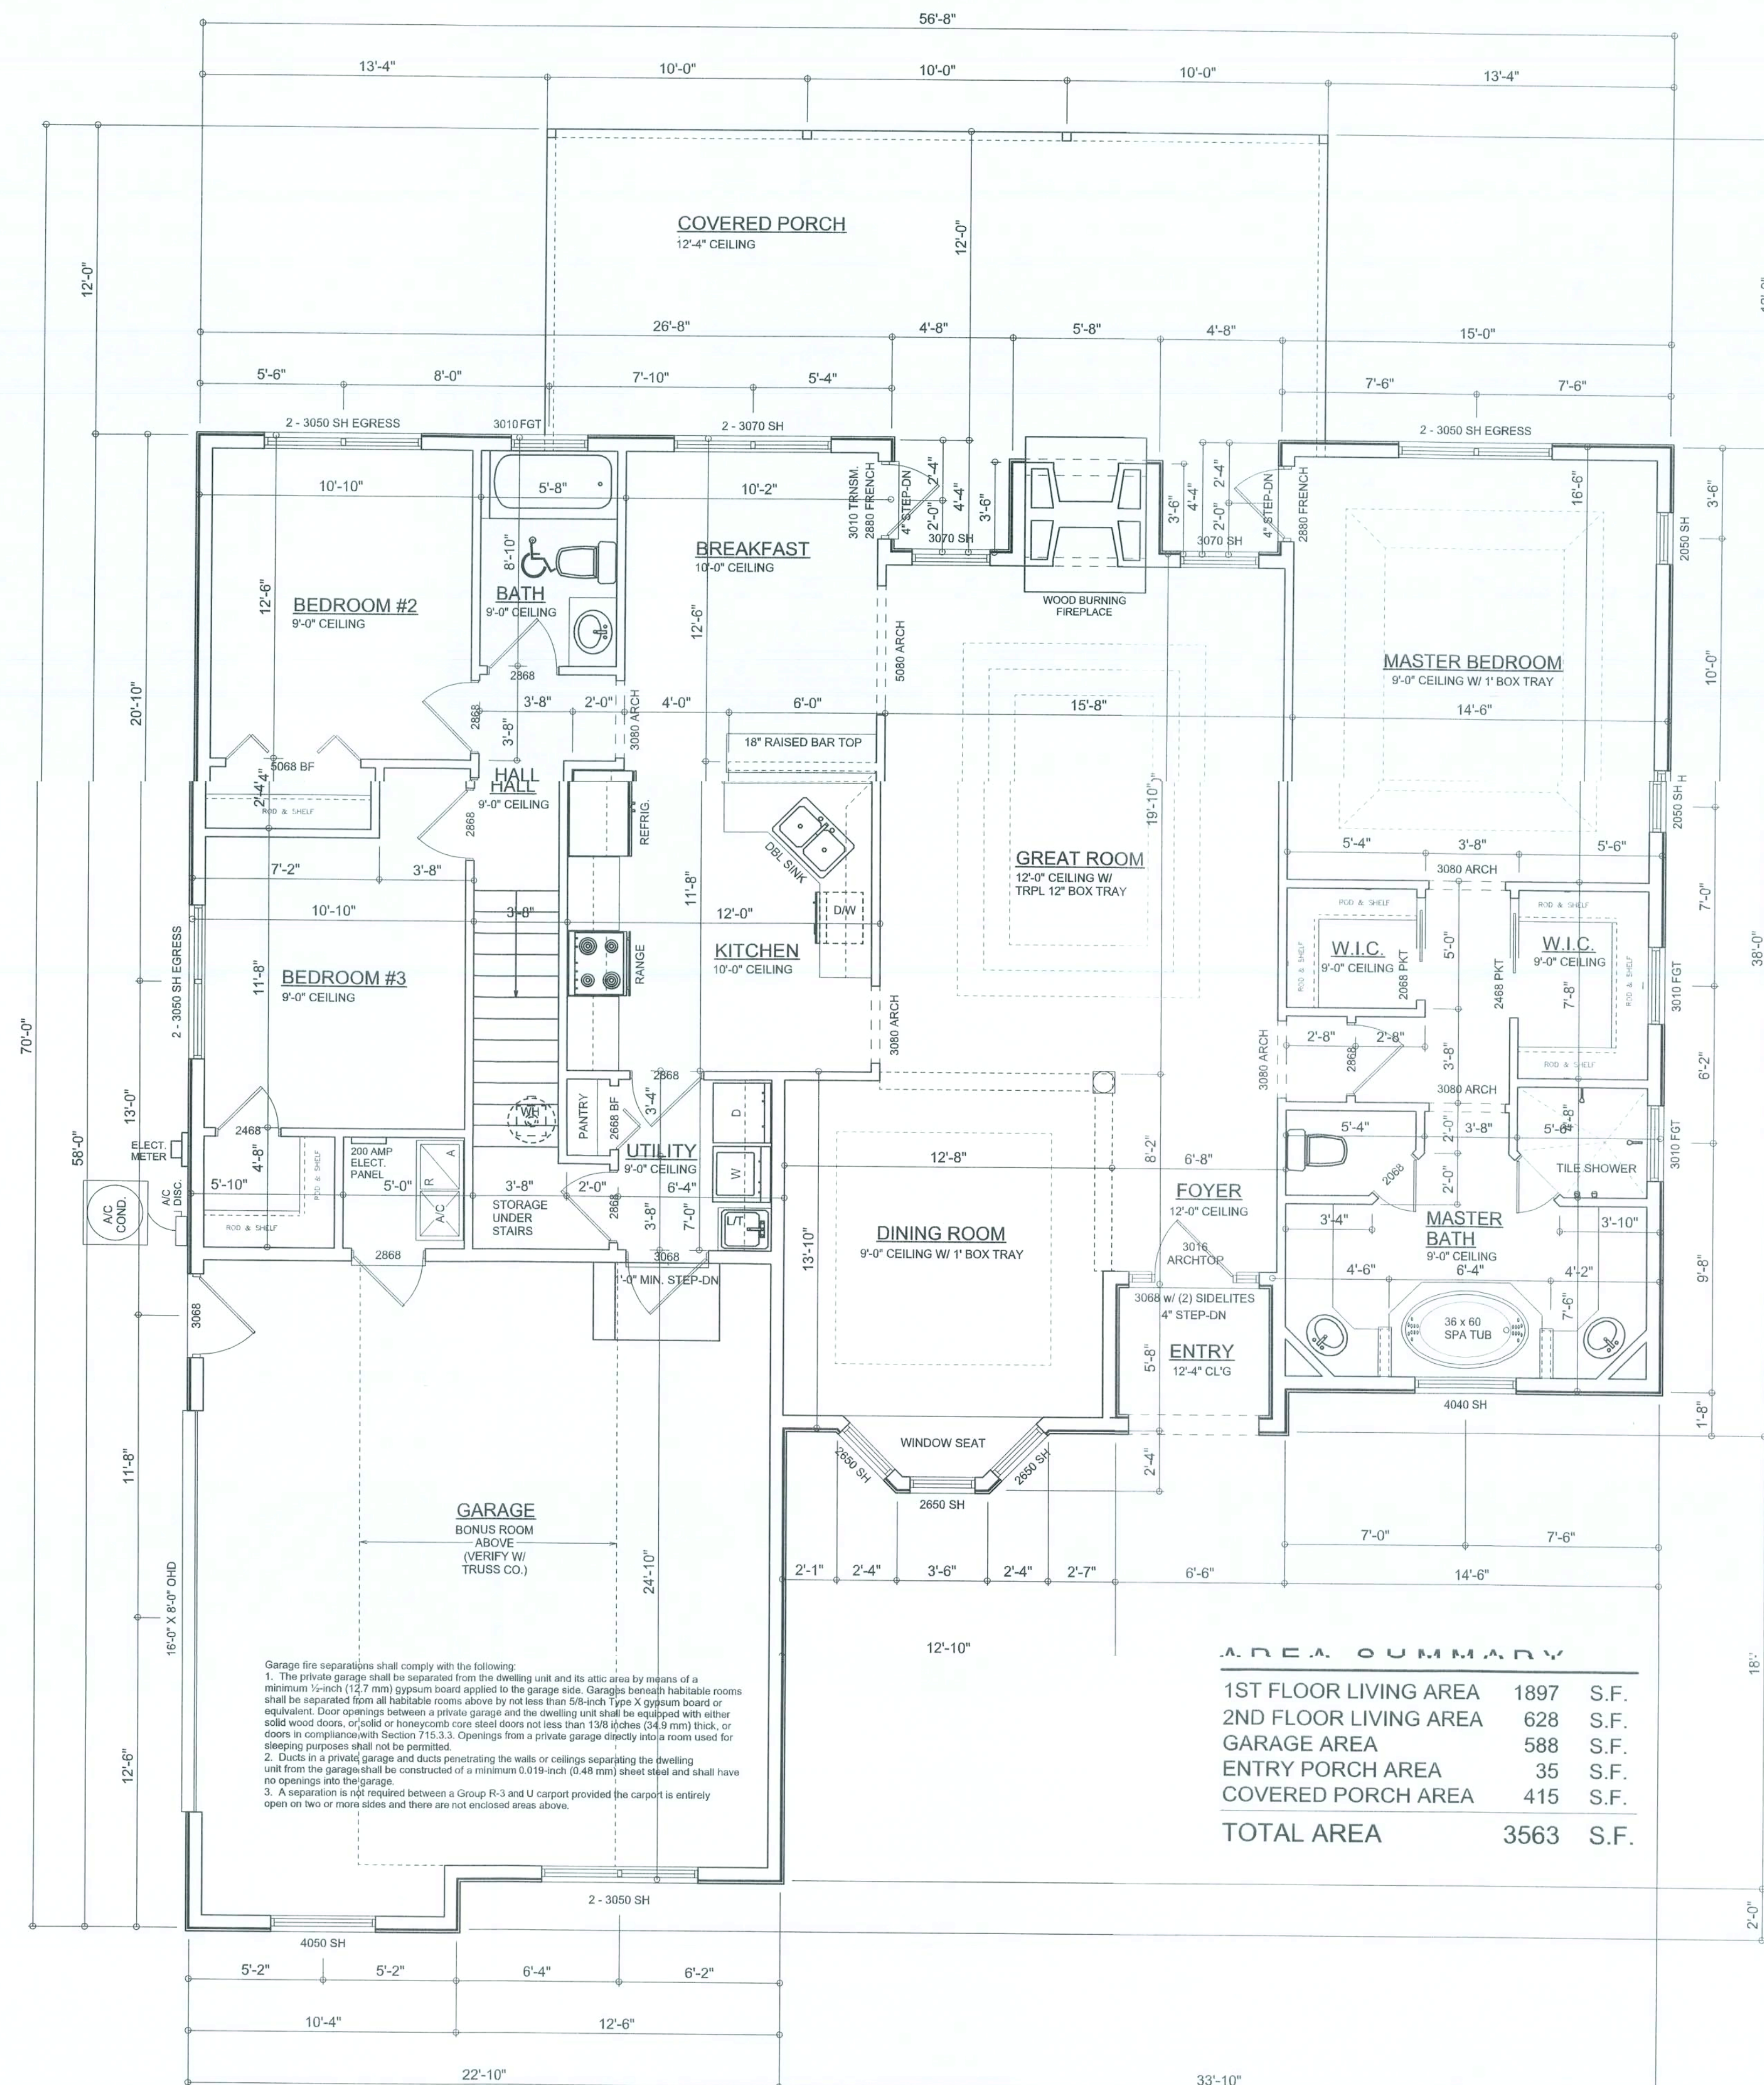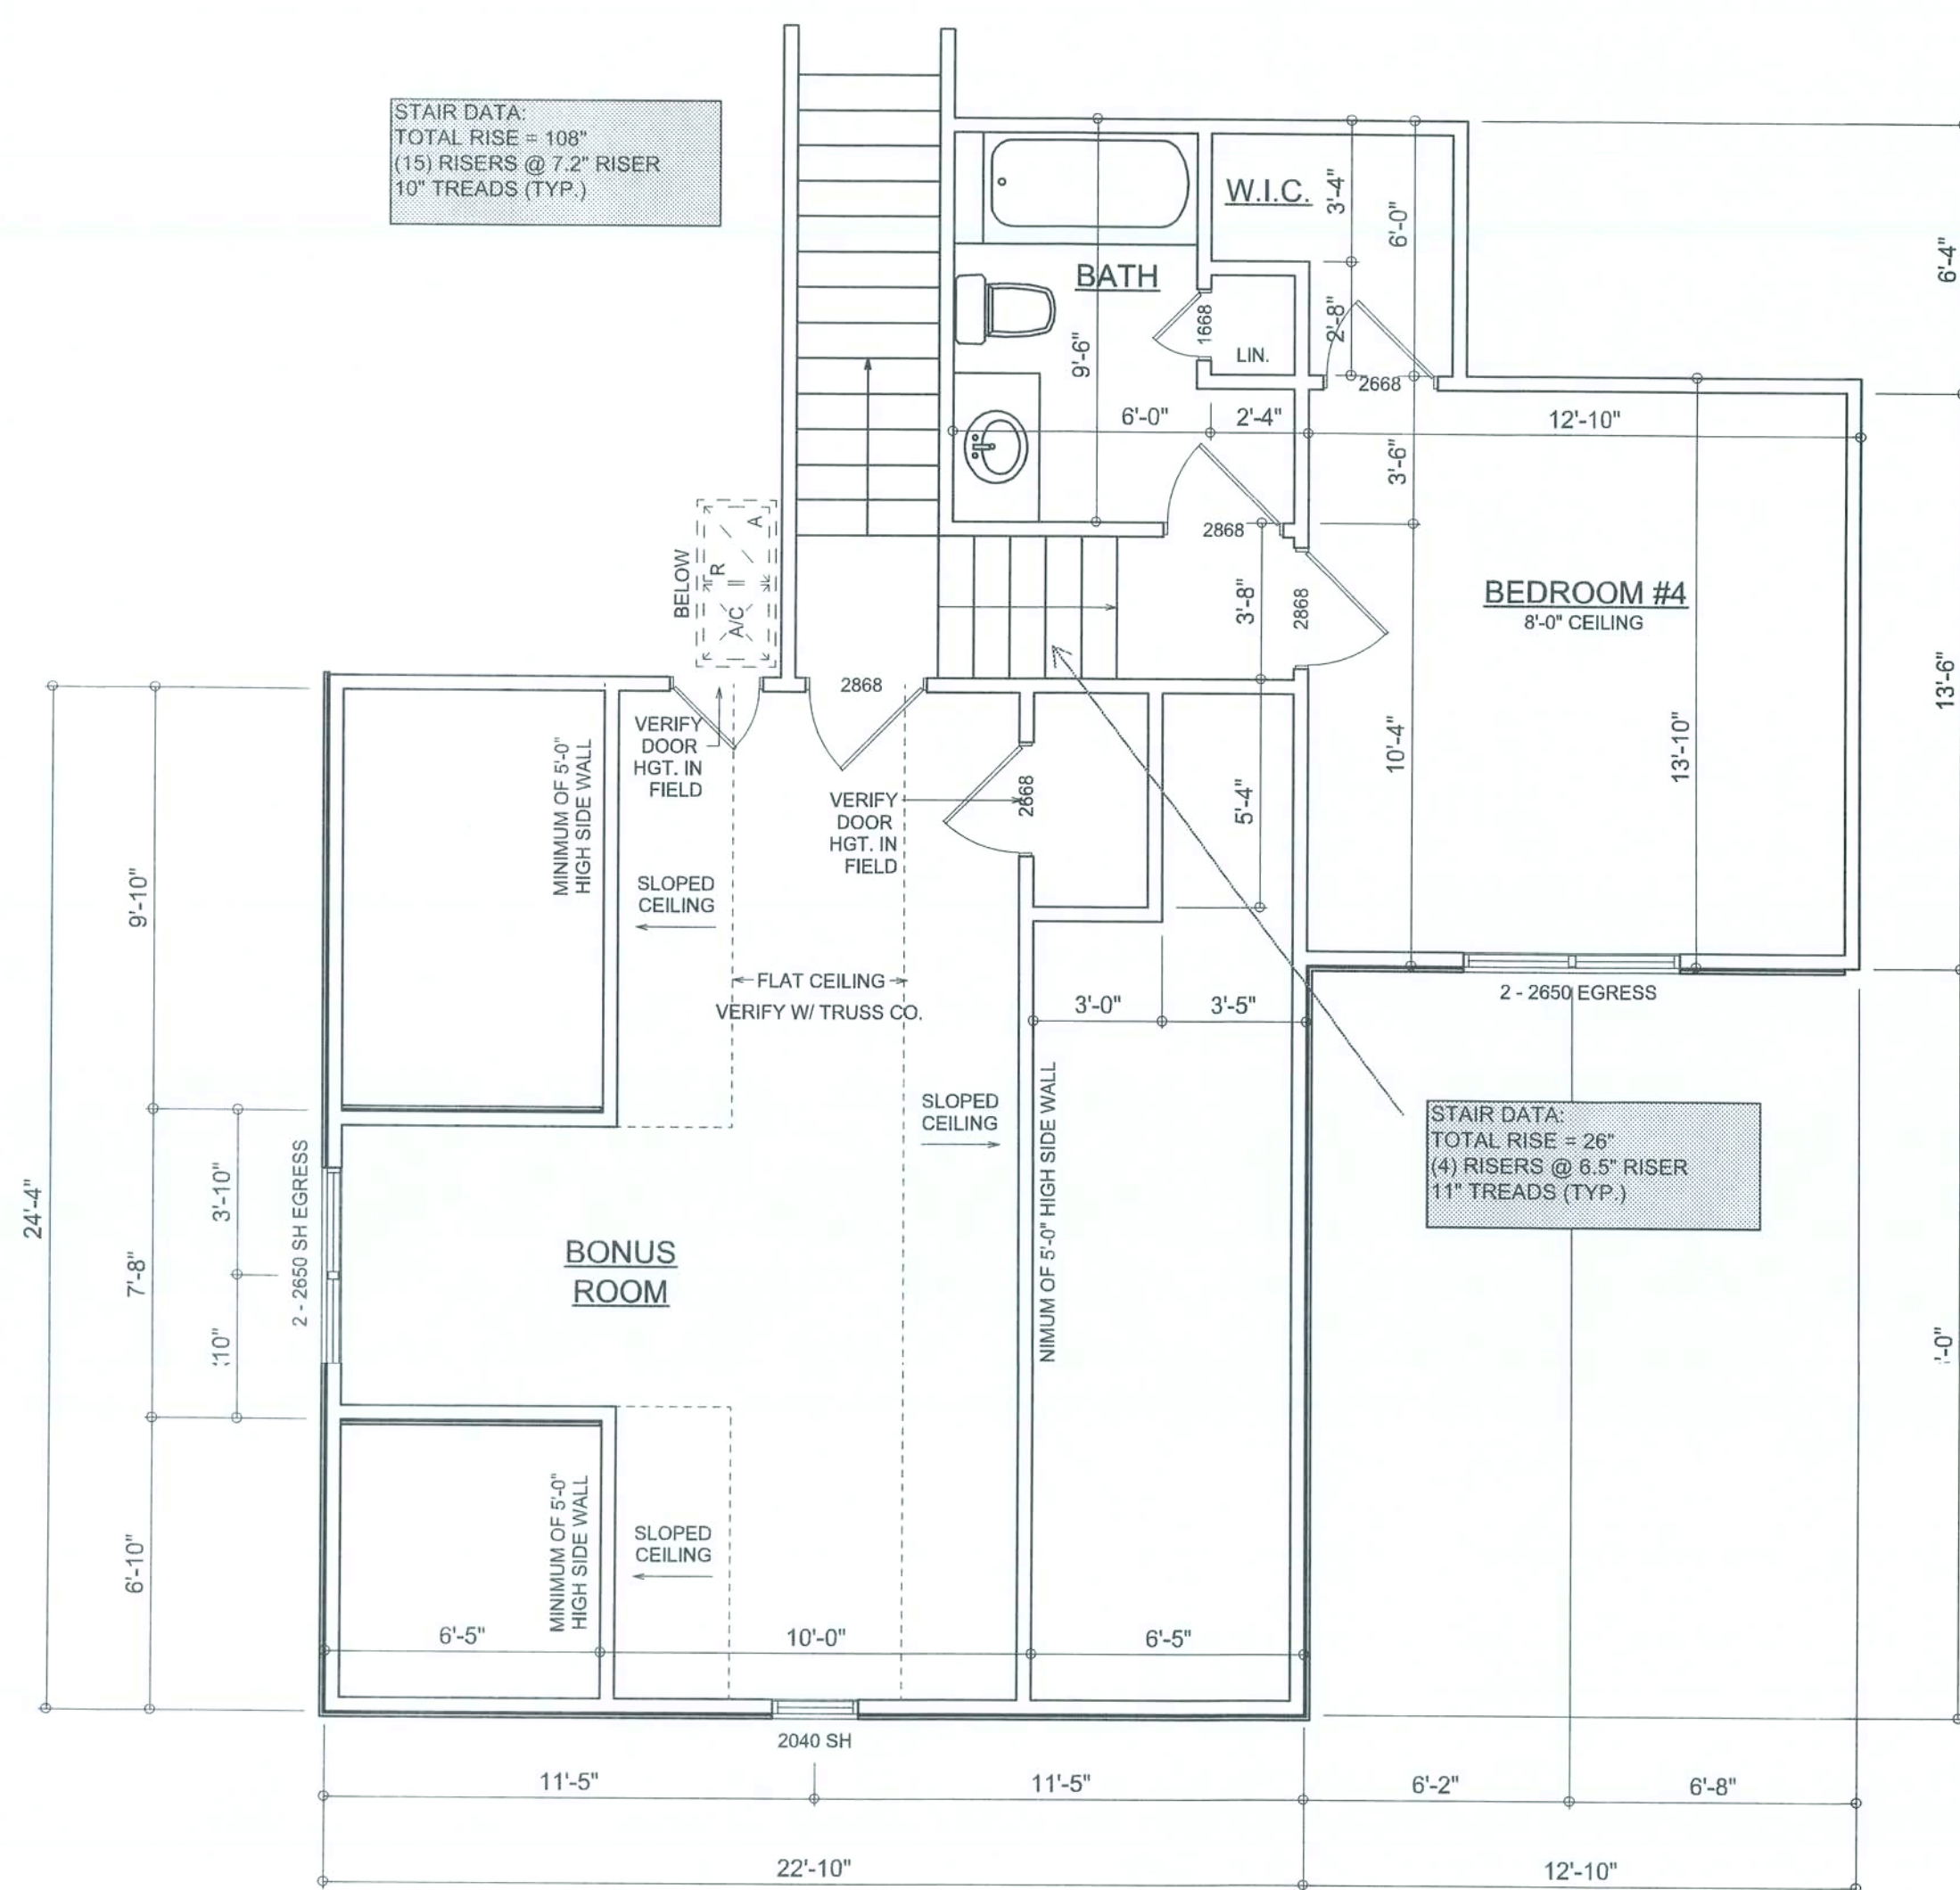

REVISIONS	22 / Sept. / 2008
	28 / Sept. / 2008
	30 / Sept. / 2008
	17 / Nov / 2008 (Finals)
	26 / Nov / 2008 (Finals)
	28 / Nov / 2008 (Finals)
	14 / Jan / 2008 (Finals)

PERMIT #090221

A CUSTOM RESIDENCE FOR:

PAUL & EMMY
PHINNEY

PROJECT ADDRESS:

BLAYLOCK ROAD
COLUMBIA COUNTY
FLORIDA 32024

DRAWN BY:

(386) 466 - 7338

DRAWING DATE:

February 23, 2009


















SHEET NUMBER


A3

OF 4 SHEETS

ELECTRICAL PLAN NOTES


- E -1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
- E -2 CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
- E -3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
- E -4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
- E -5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.
- E -6 ELECTRICAL CON'TR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E -7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
- E -8 ALL BEDROOM RECEPTACLES SHALL BE AFCI (ARC FAULT CIRCUIT INTERRUPT)
- E -9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION
- E -10 A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL.
- E -11 CARBON MONOXIDE ALARMS SHALL BE REQUIRED WITHIN 10' OF ALL ROOMS FOR SLEEPING PURPOSES IN BUILDINGS HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR ATTACHED GARAGE.

EECTRICAL LEGEND	
	CEILING FAN (P2-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	2xFLUORESCENT LIGHT FIXTURE
	RECESSED CAN LIGHT
	8 1/2\"/>
	8 1/2\"/>
	LIGHT FIXTURE
	DUPLEX OUTLET
	20\"/>
	GIDUPLEX OUTLET
	SDKE DETECTOR
	W.L SWITCH
	3 AY WALL SWITCH
	4 AY WALL SWITCH
	WFER PROOF GFI OUTLET
	PDNE JACK
	TEIVISION JACK
	GAGE DOOR OPENER
	CIBON MONOXIDE ALARM

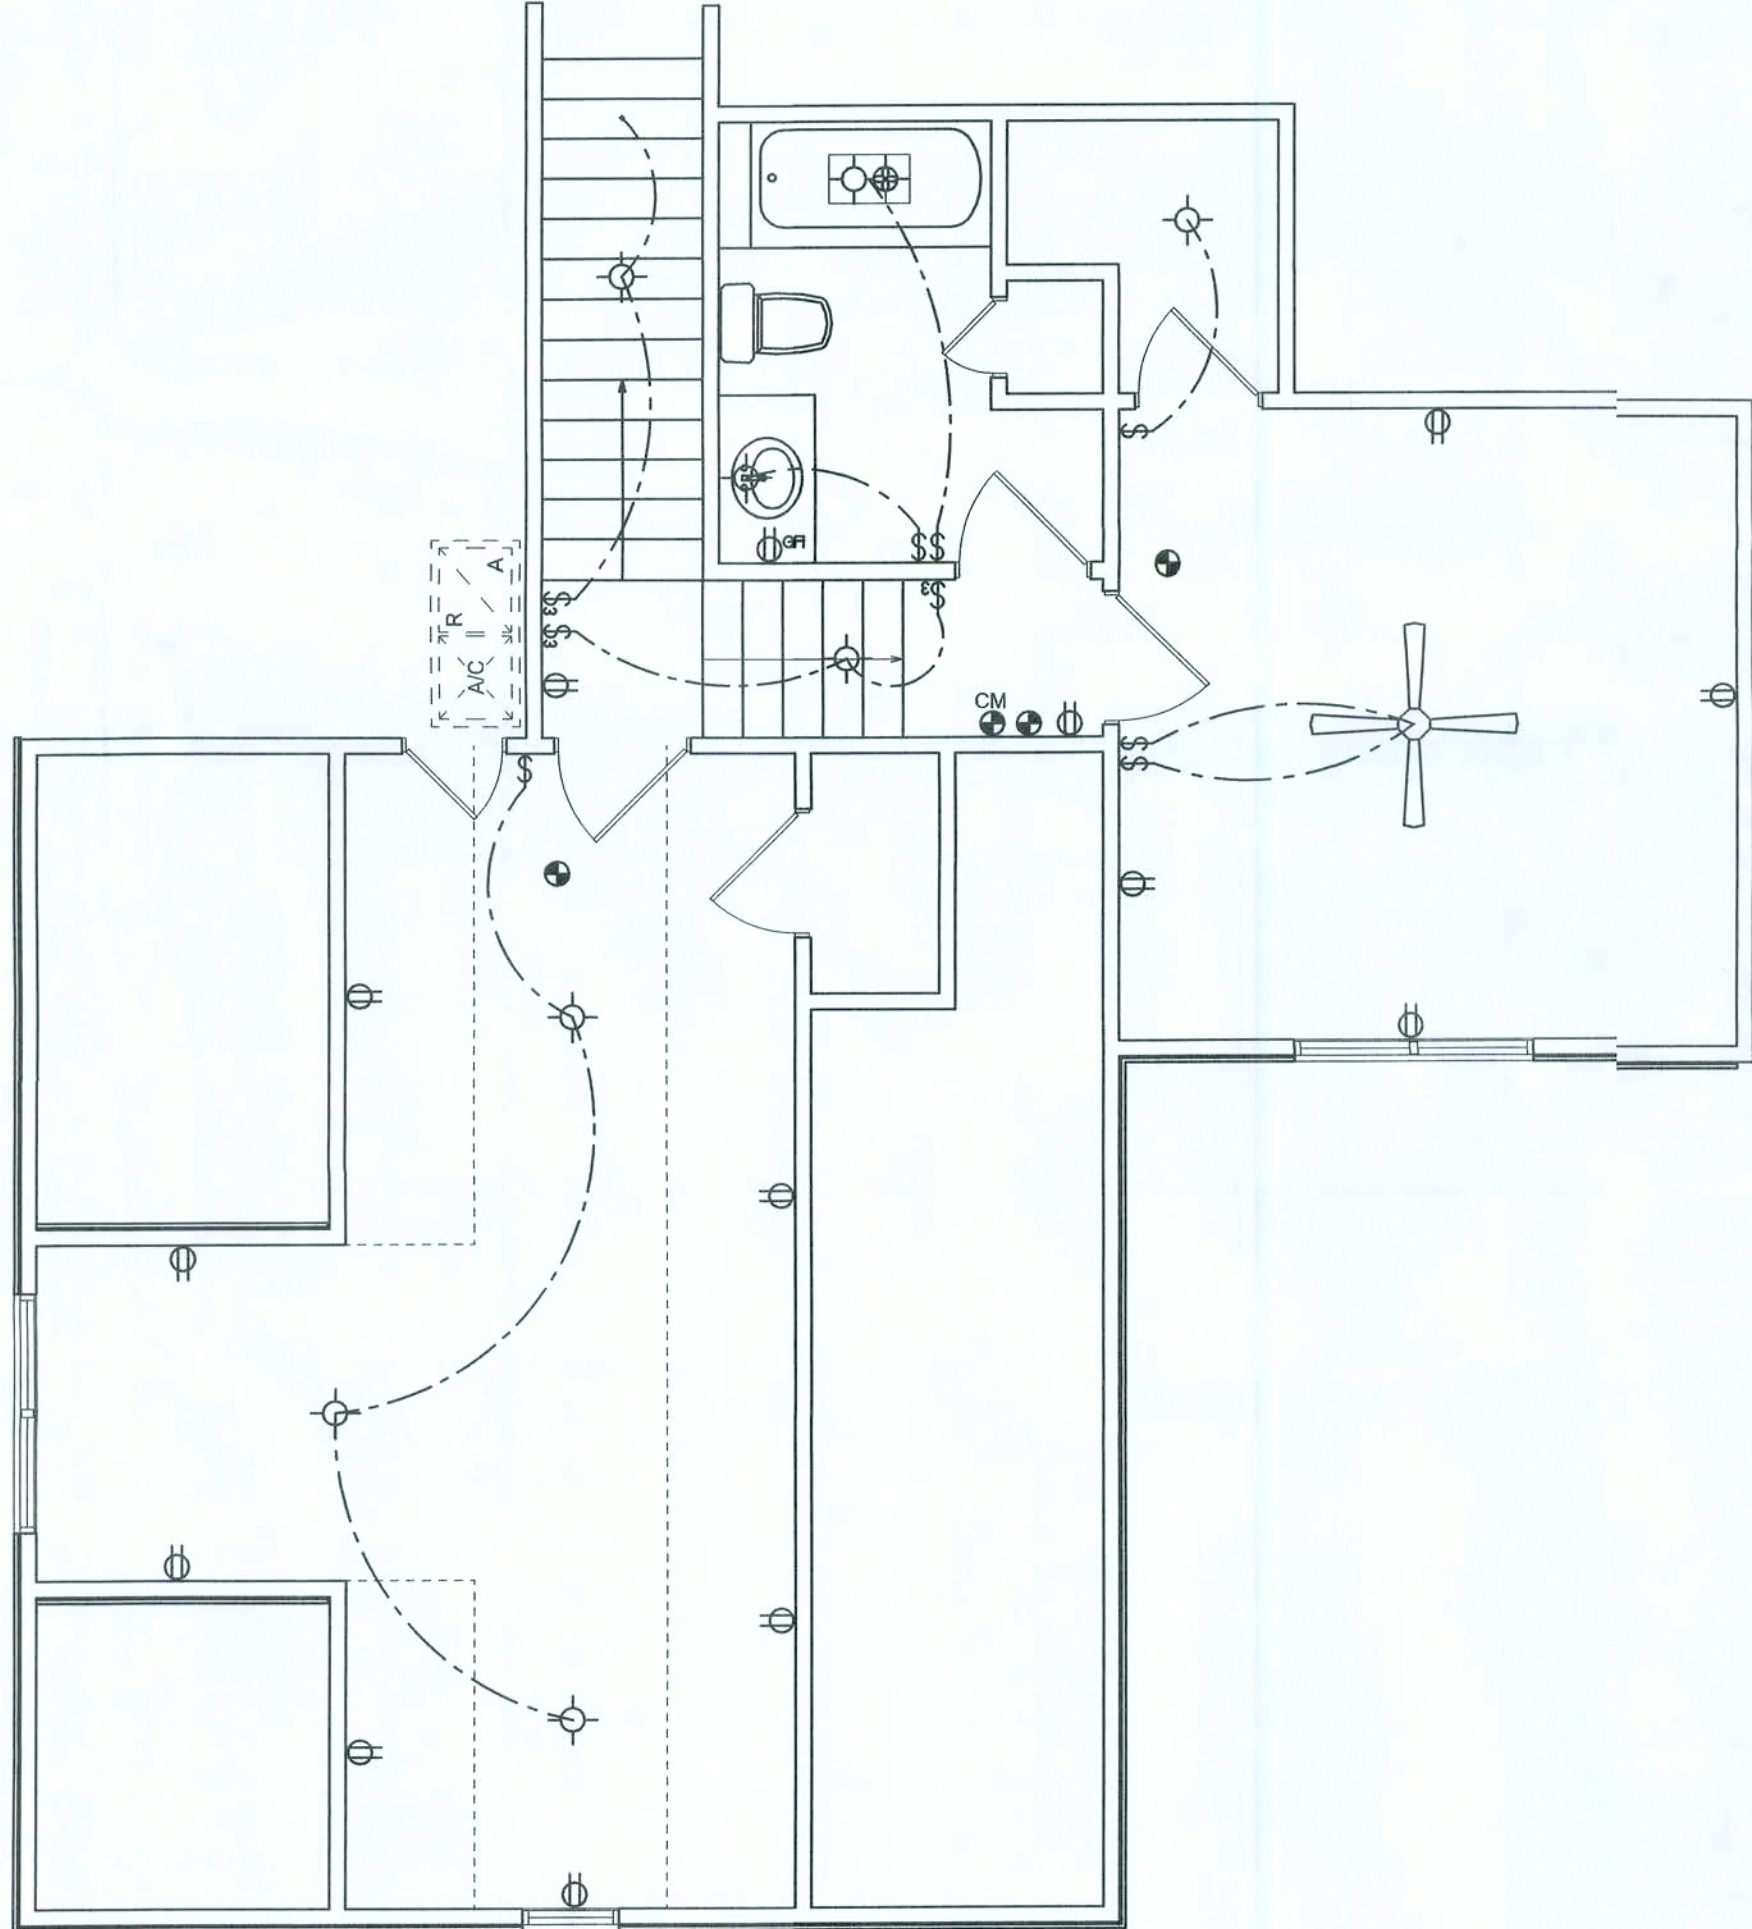

2ND FLOOR ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

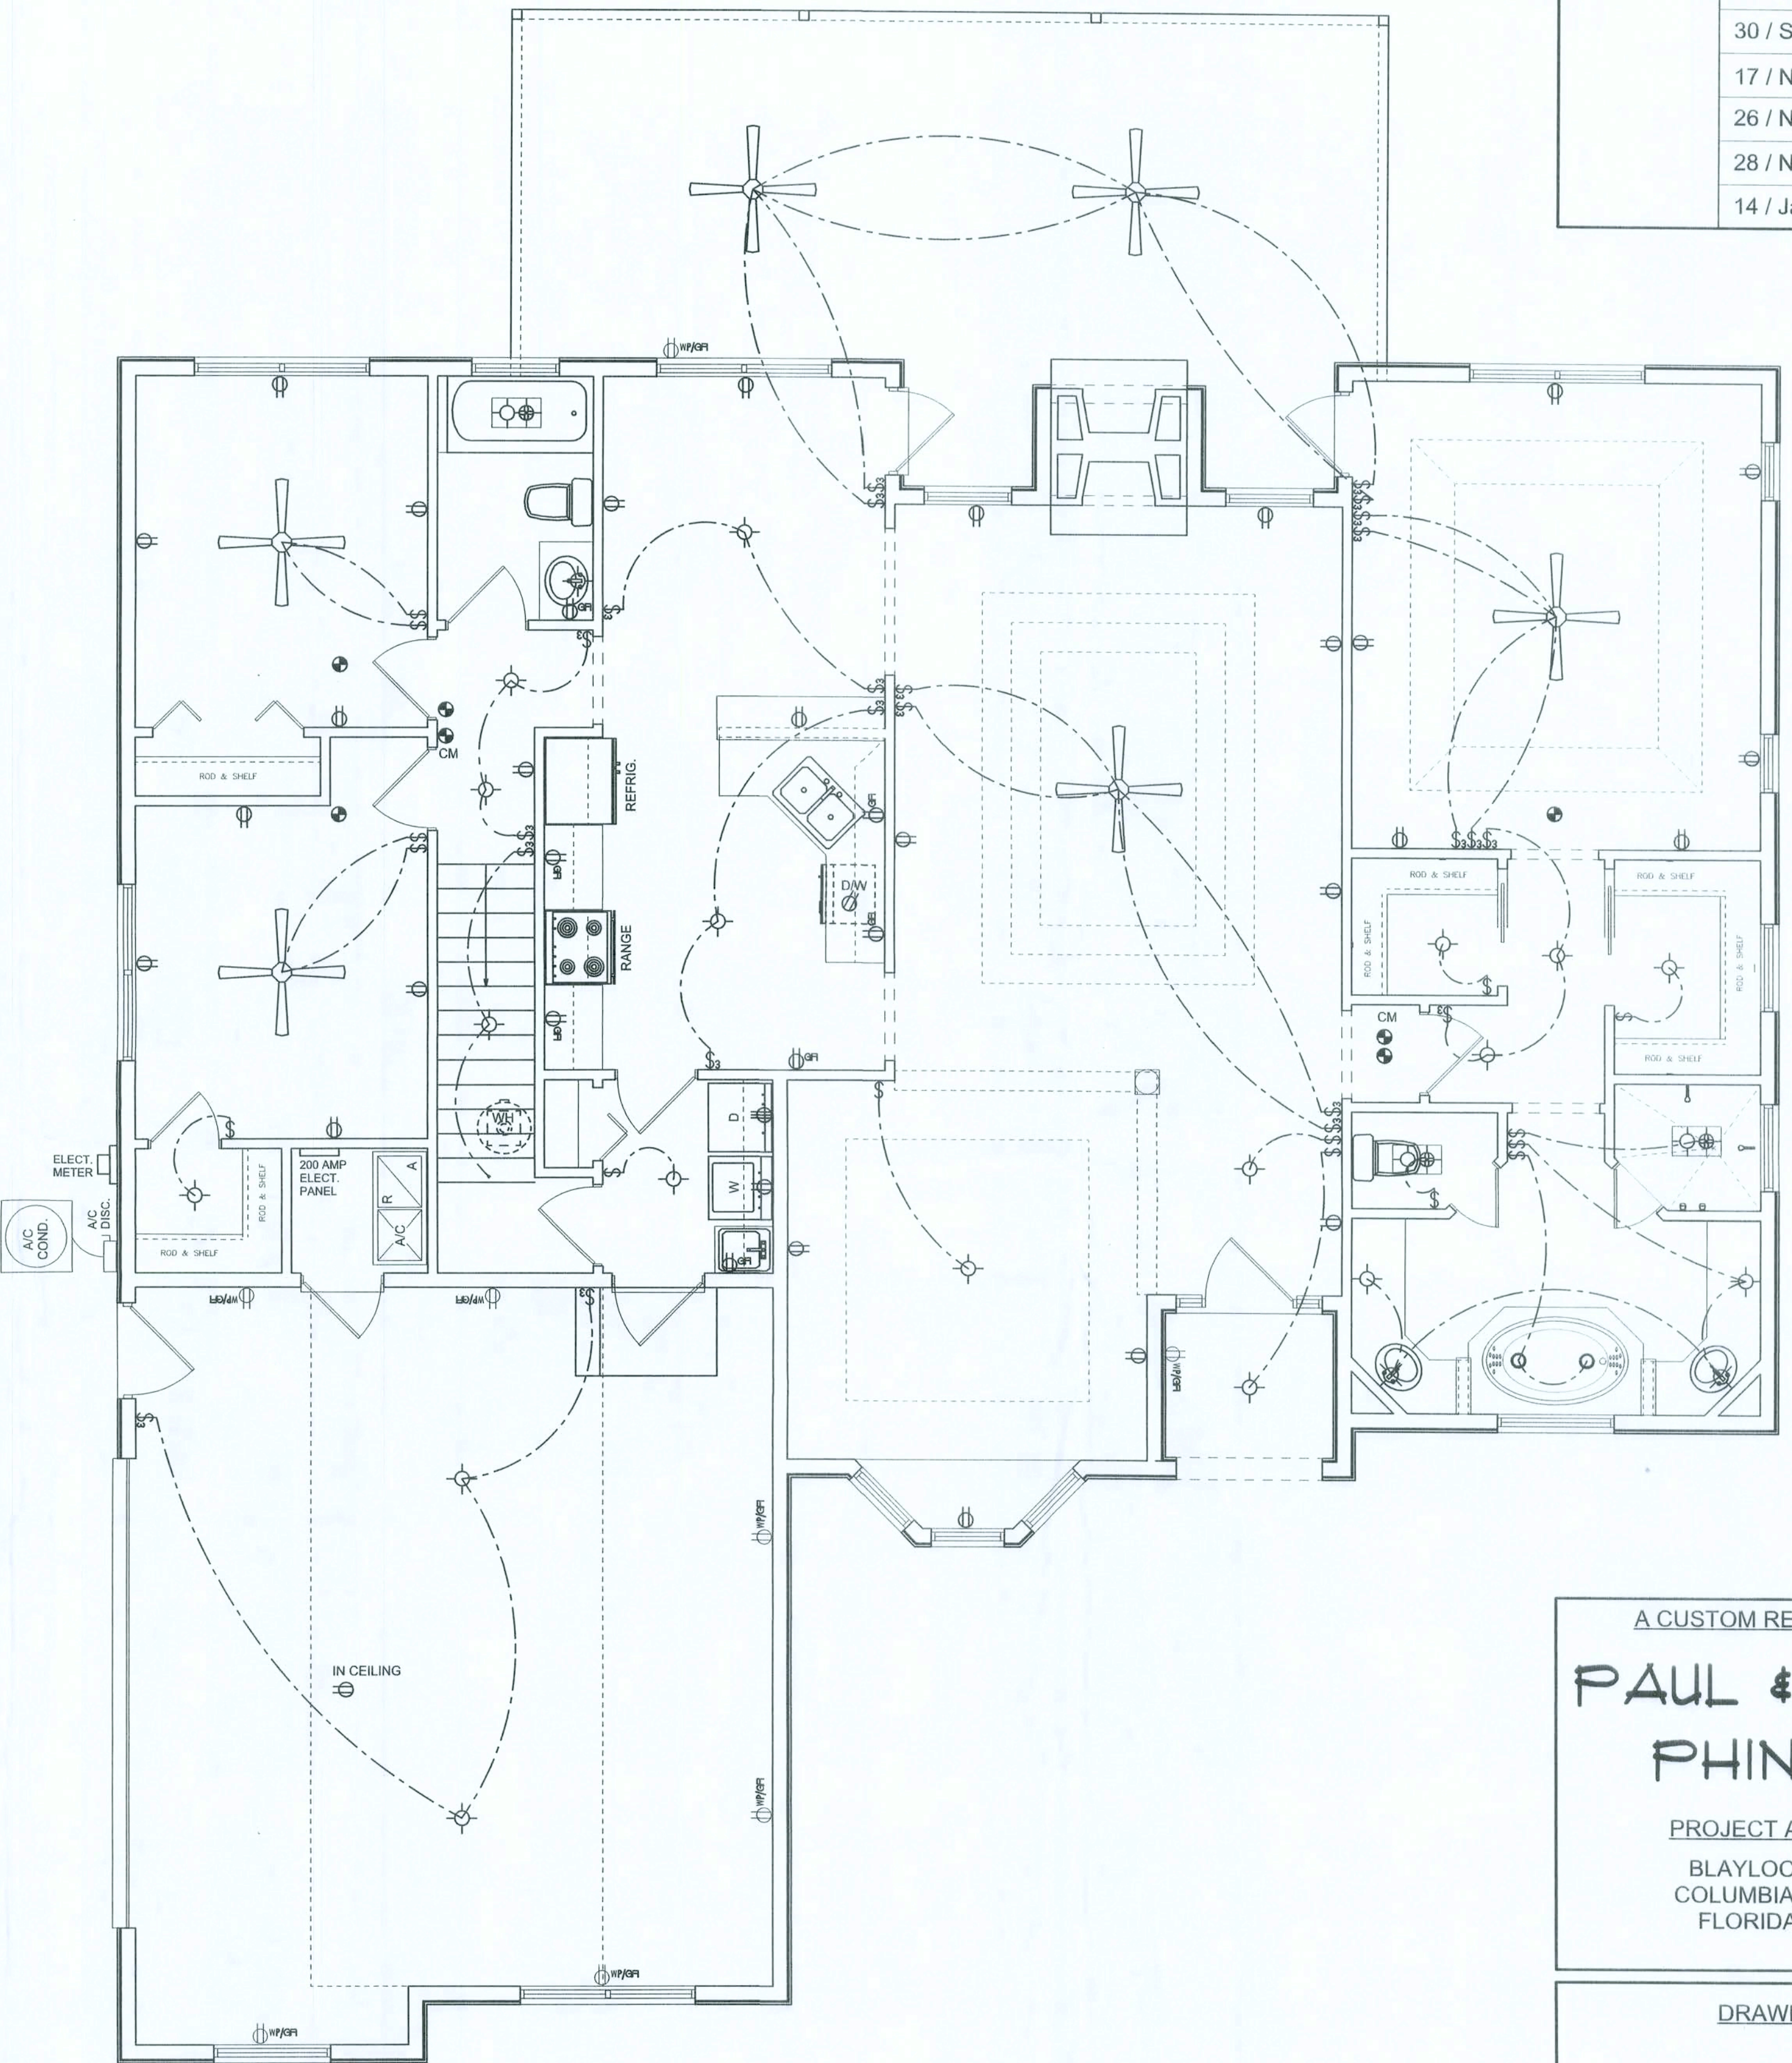

1ST FLOOR ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

REVISIONS	
	22 / Sept. / 2008
	28 / Sept. / 2008
	30 / Sept. / 2008
	17 / Nov / 2008 (Finals)
	26 / Nov / 2008 (Finals)
	28 / Nov / 2008 (Finals)
	14 / Jan / 2008 (Finals)

A CUSTOM RESIDENCE FOR:

PAUL & EMMY PHINNEY

PROJECT ADDRESS:

BLAYLOCK ROAD
COLUMBIA COUNTY
FLORIDA 32024

DRAWN BY:

(386) 466 - 7338





DRAWING DATE

February 11, 2009

SHEET NUMBER

A4

OF 4 SHEETS

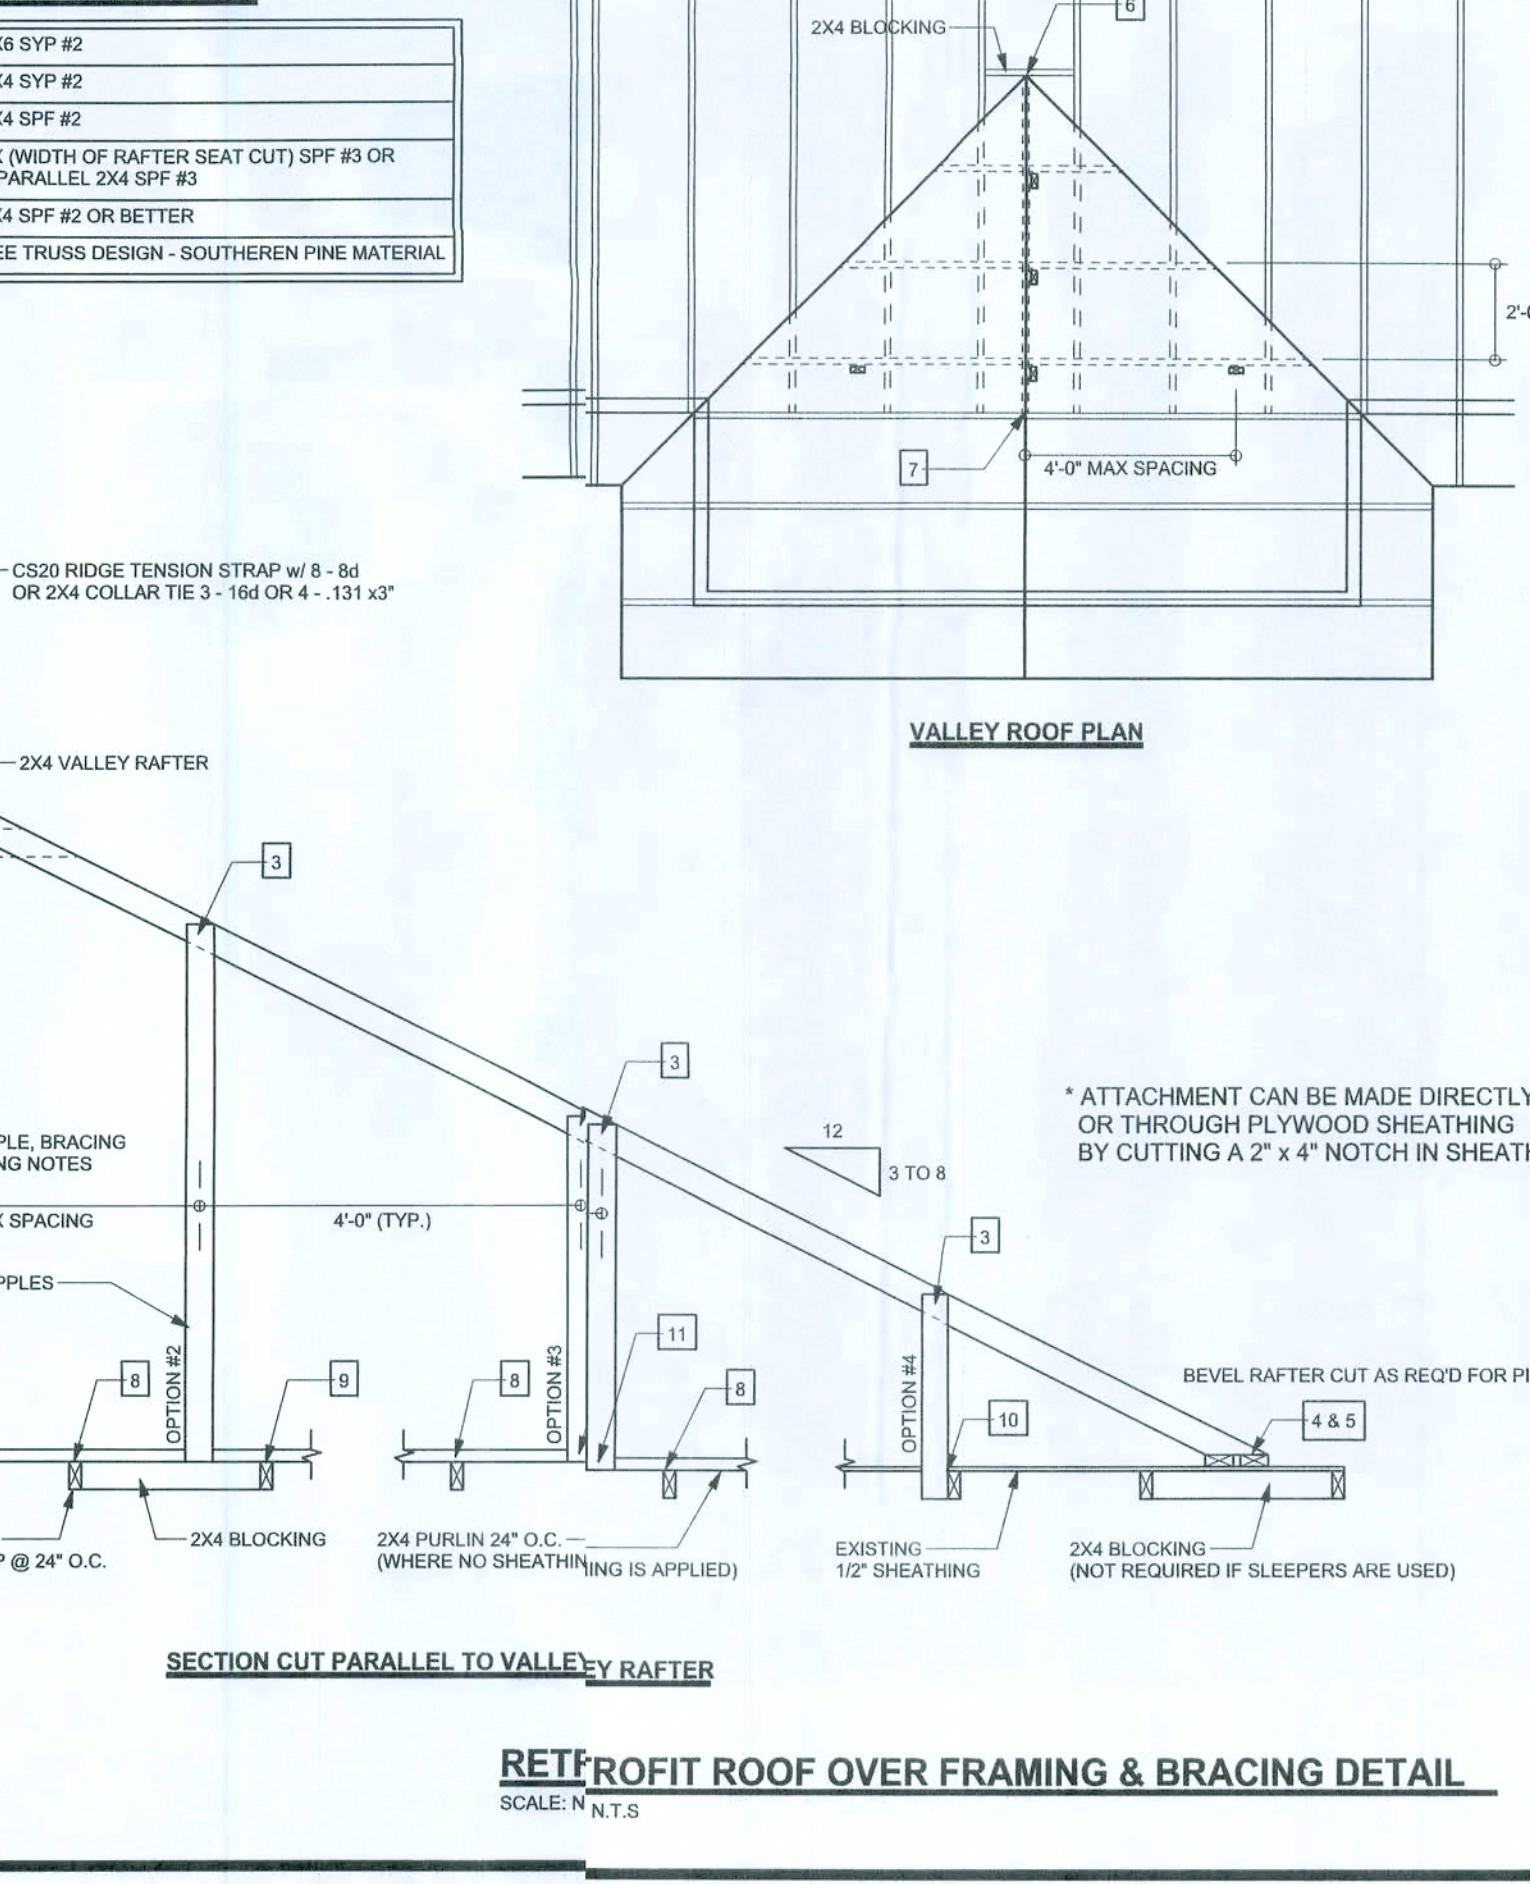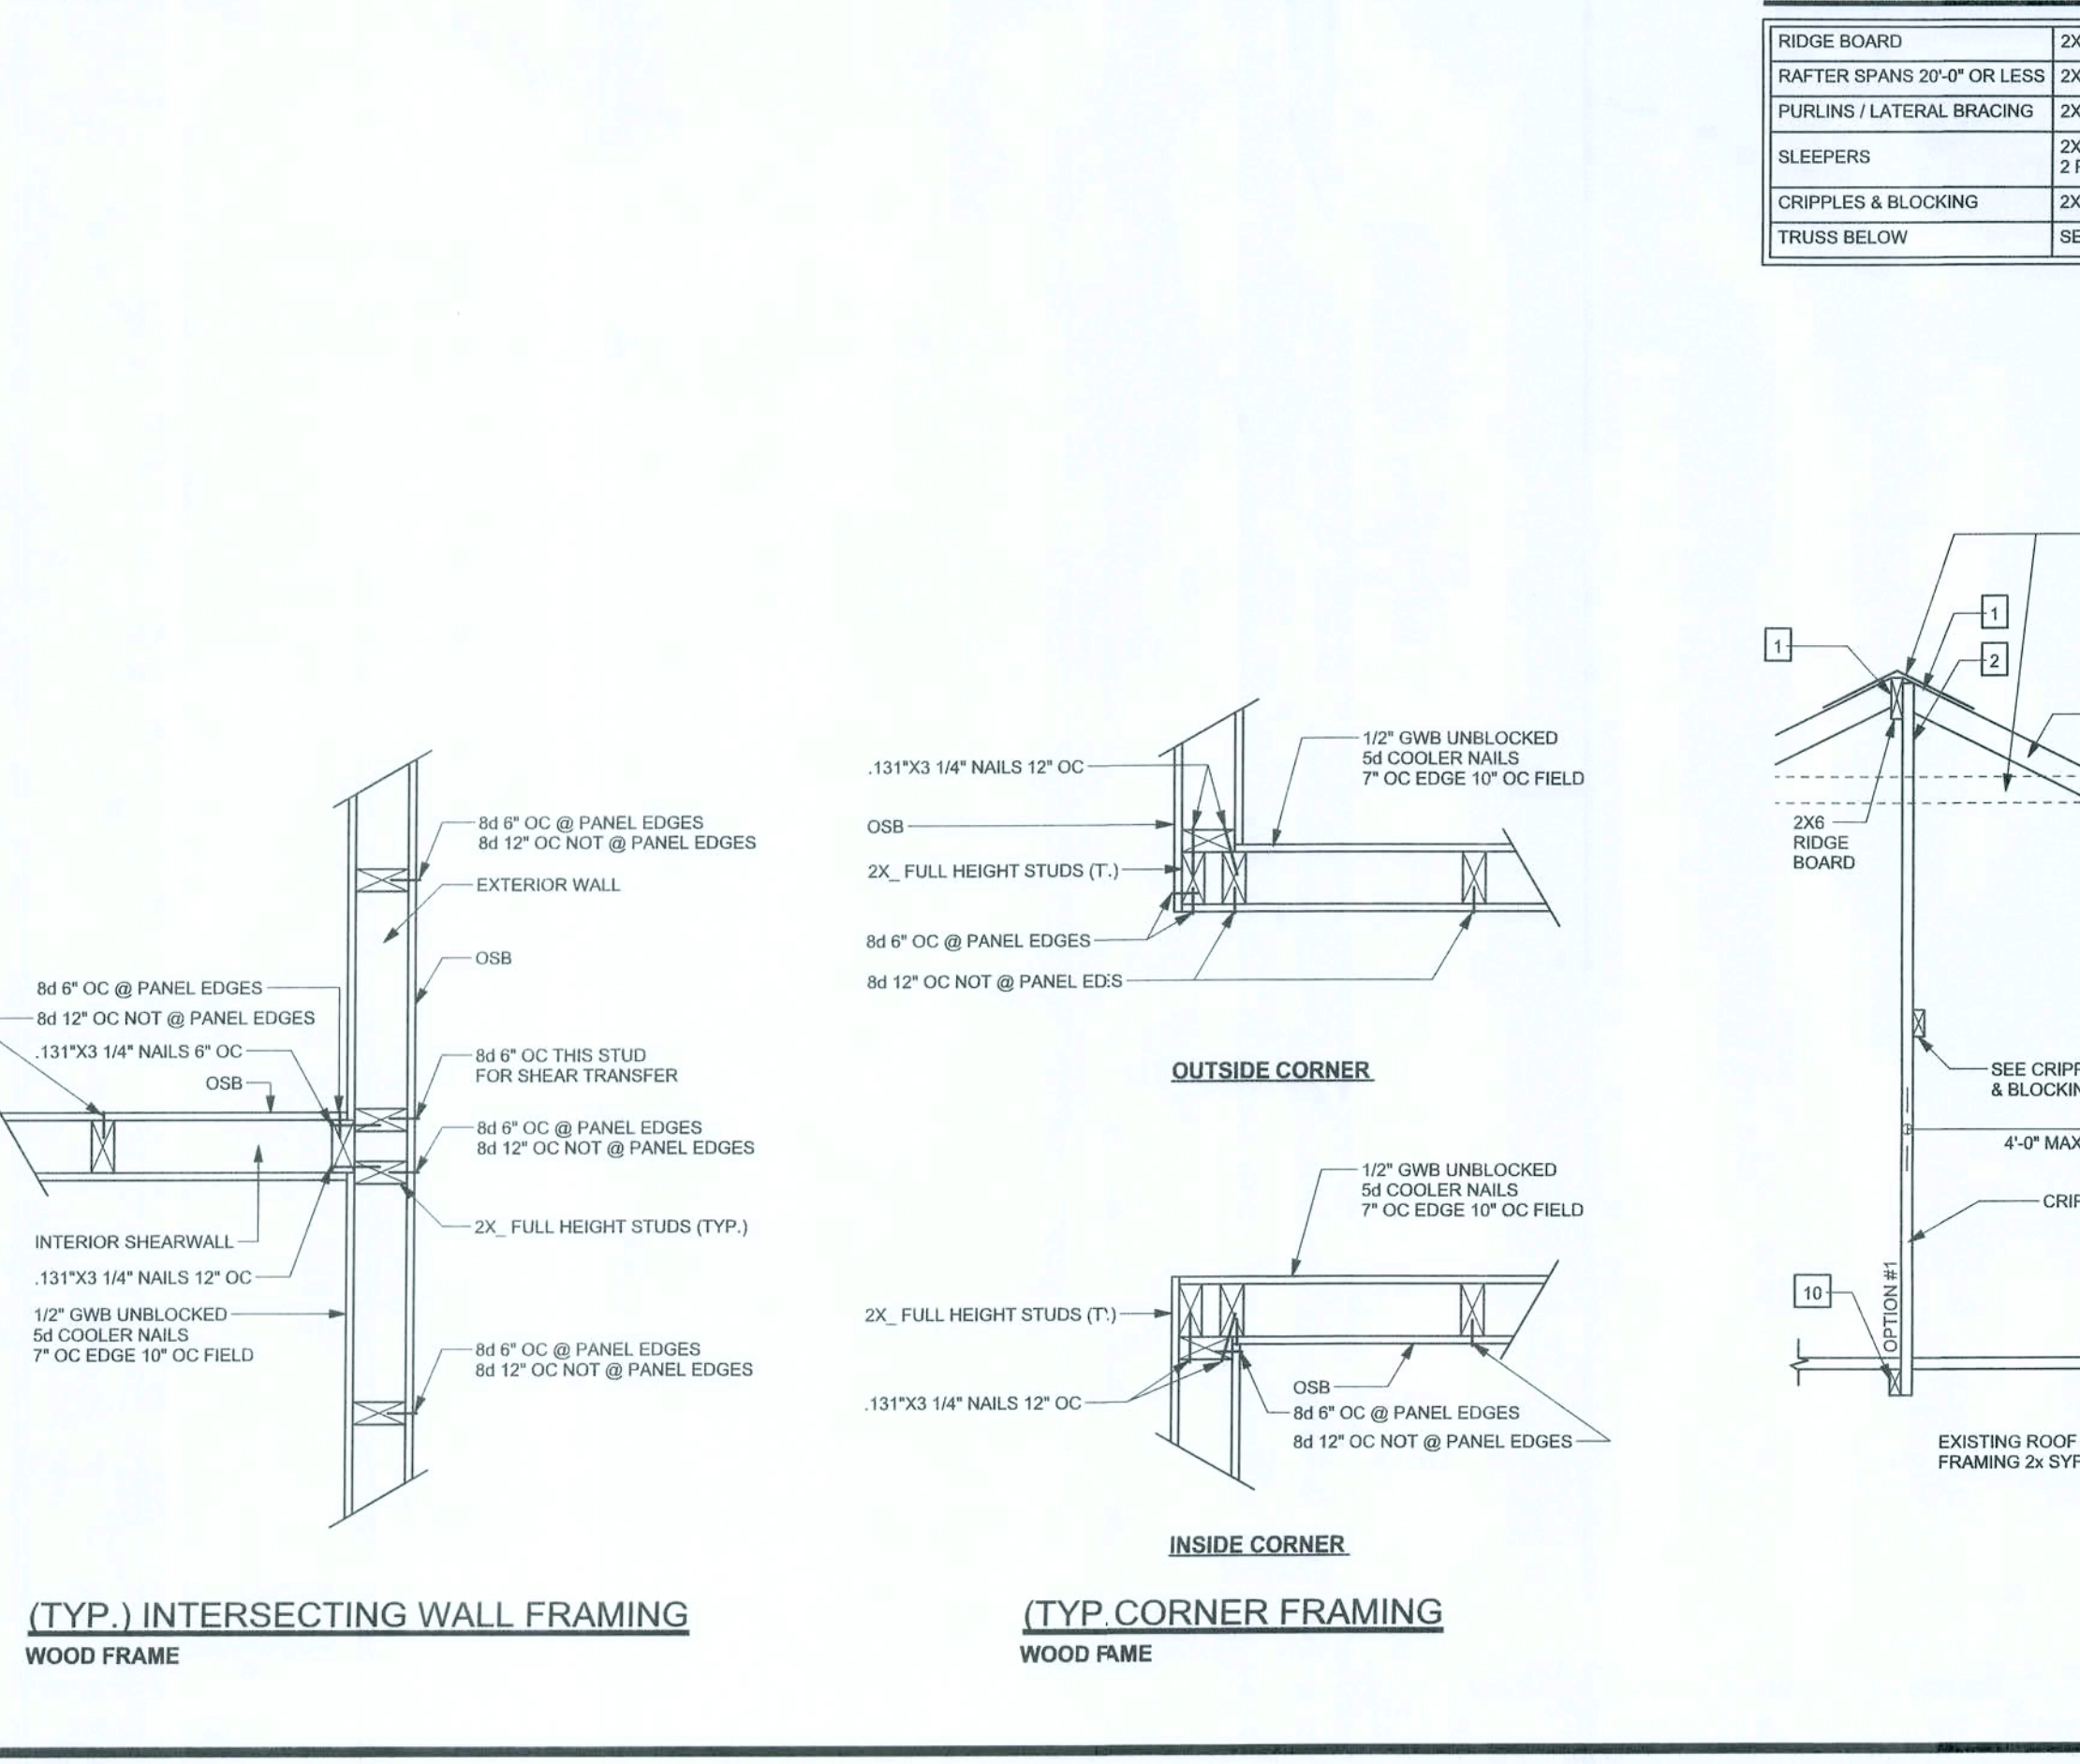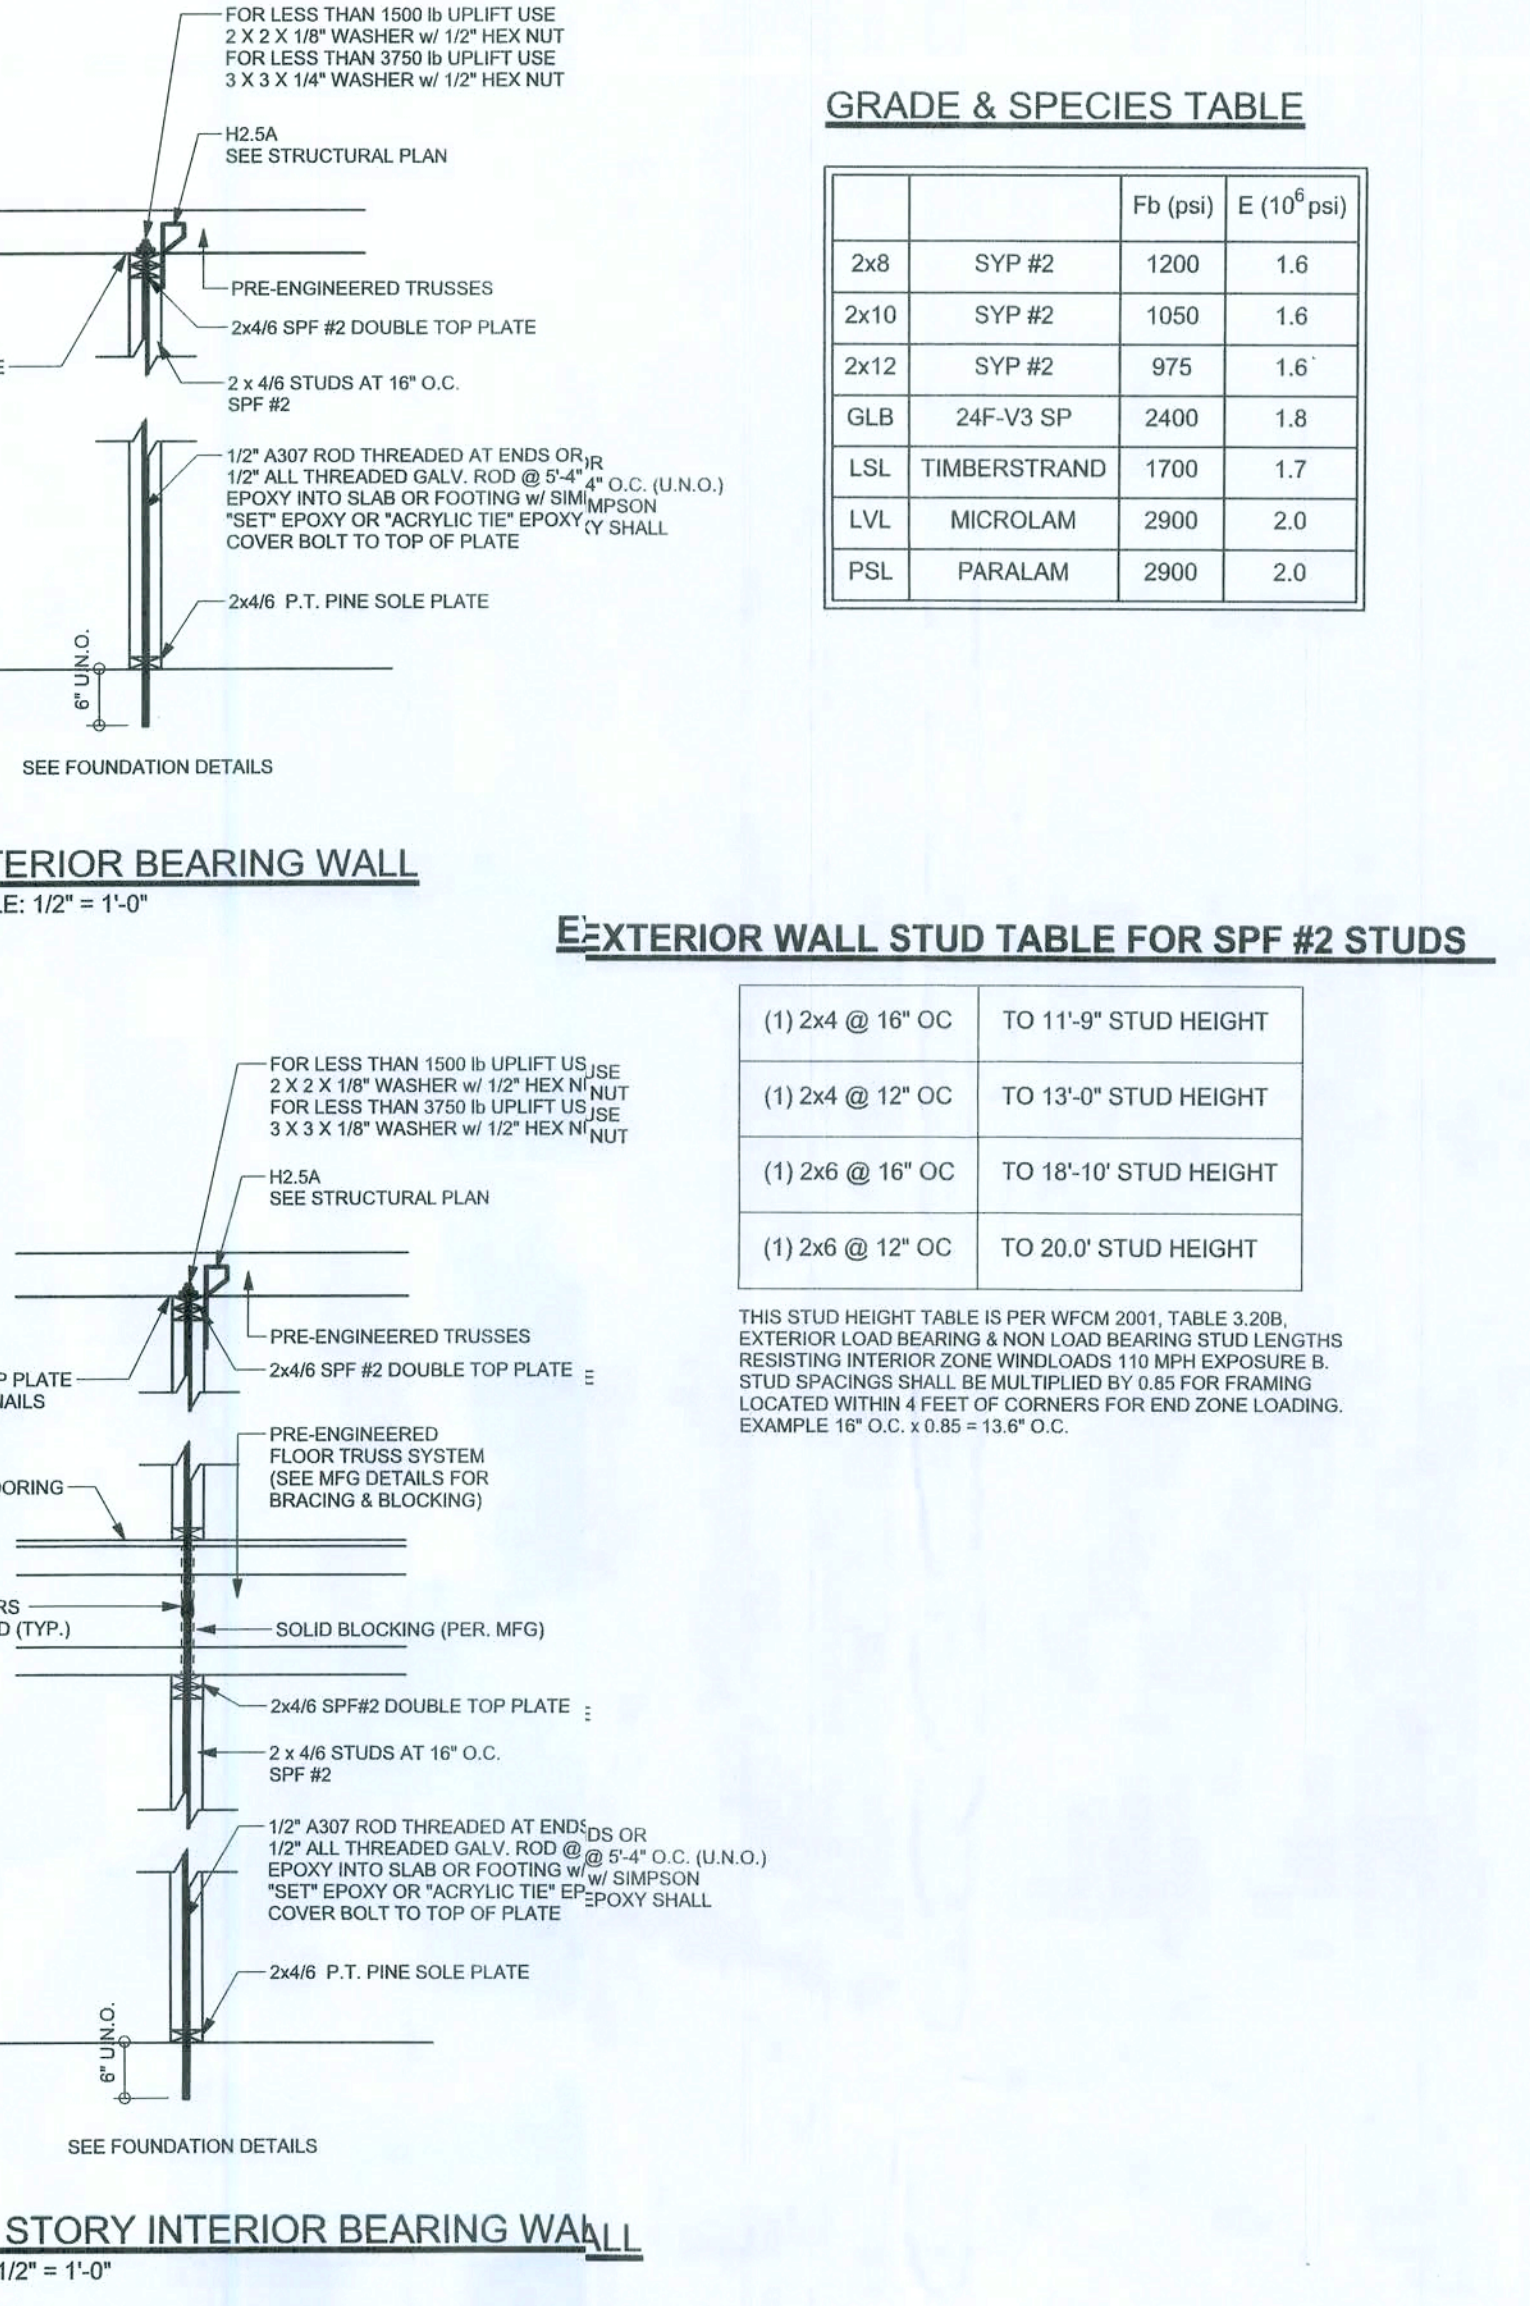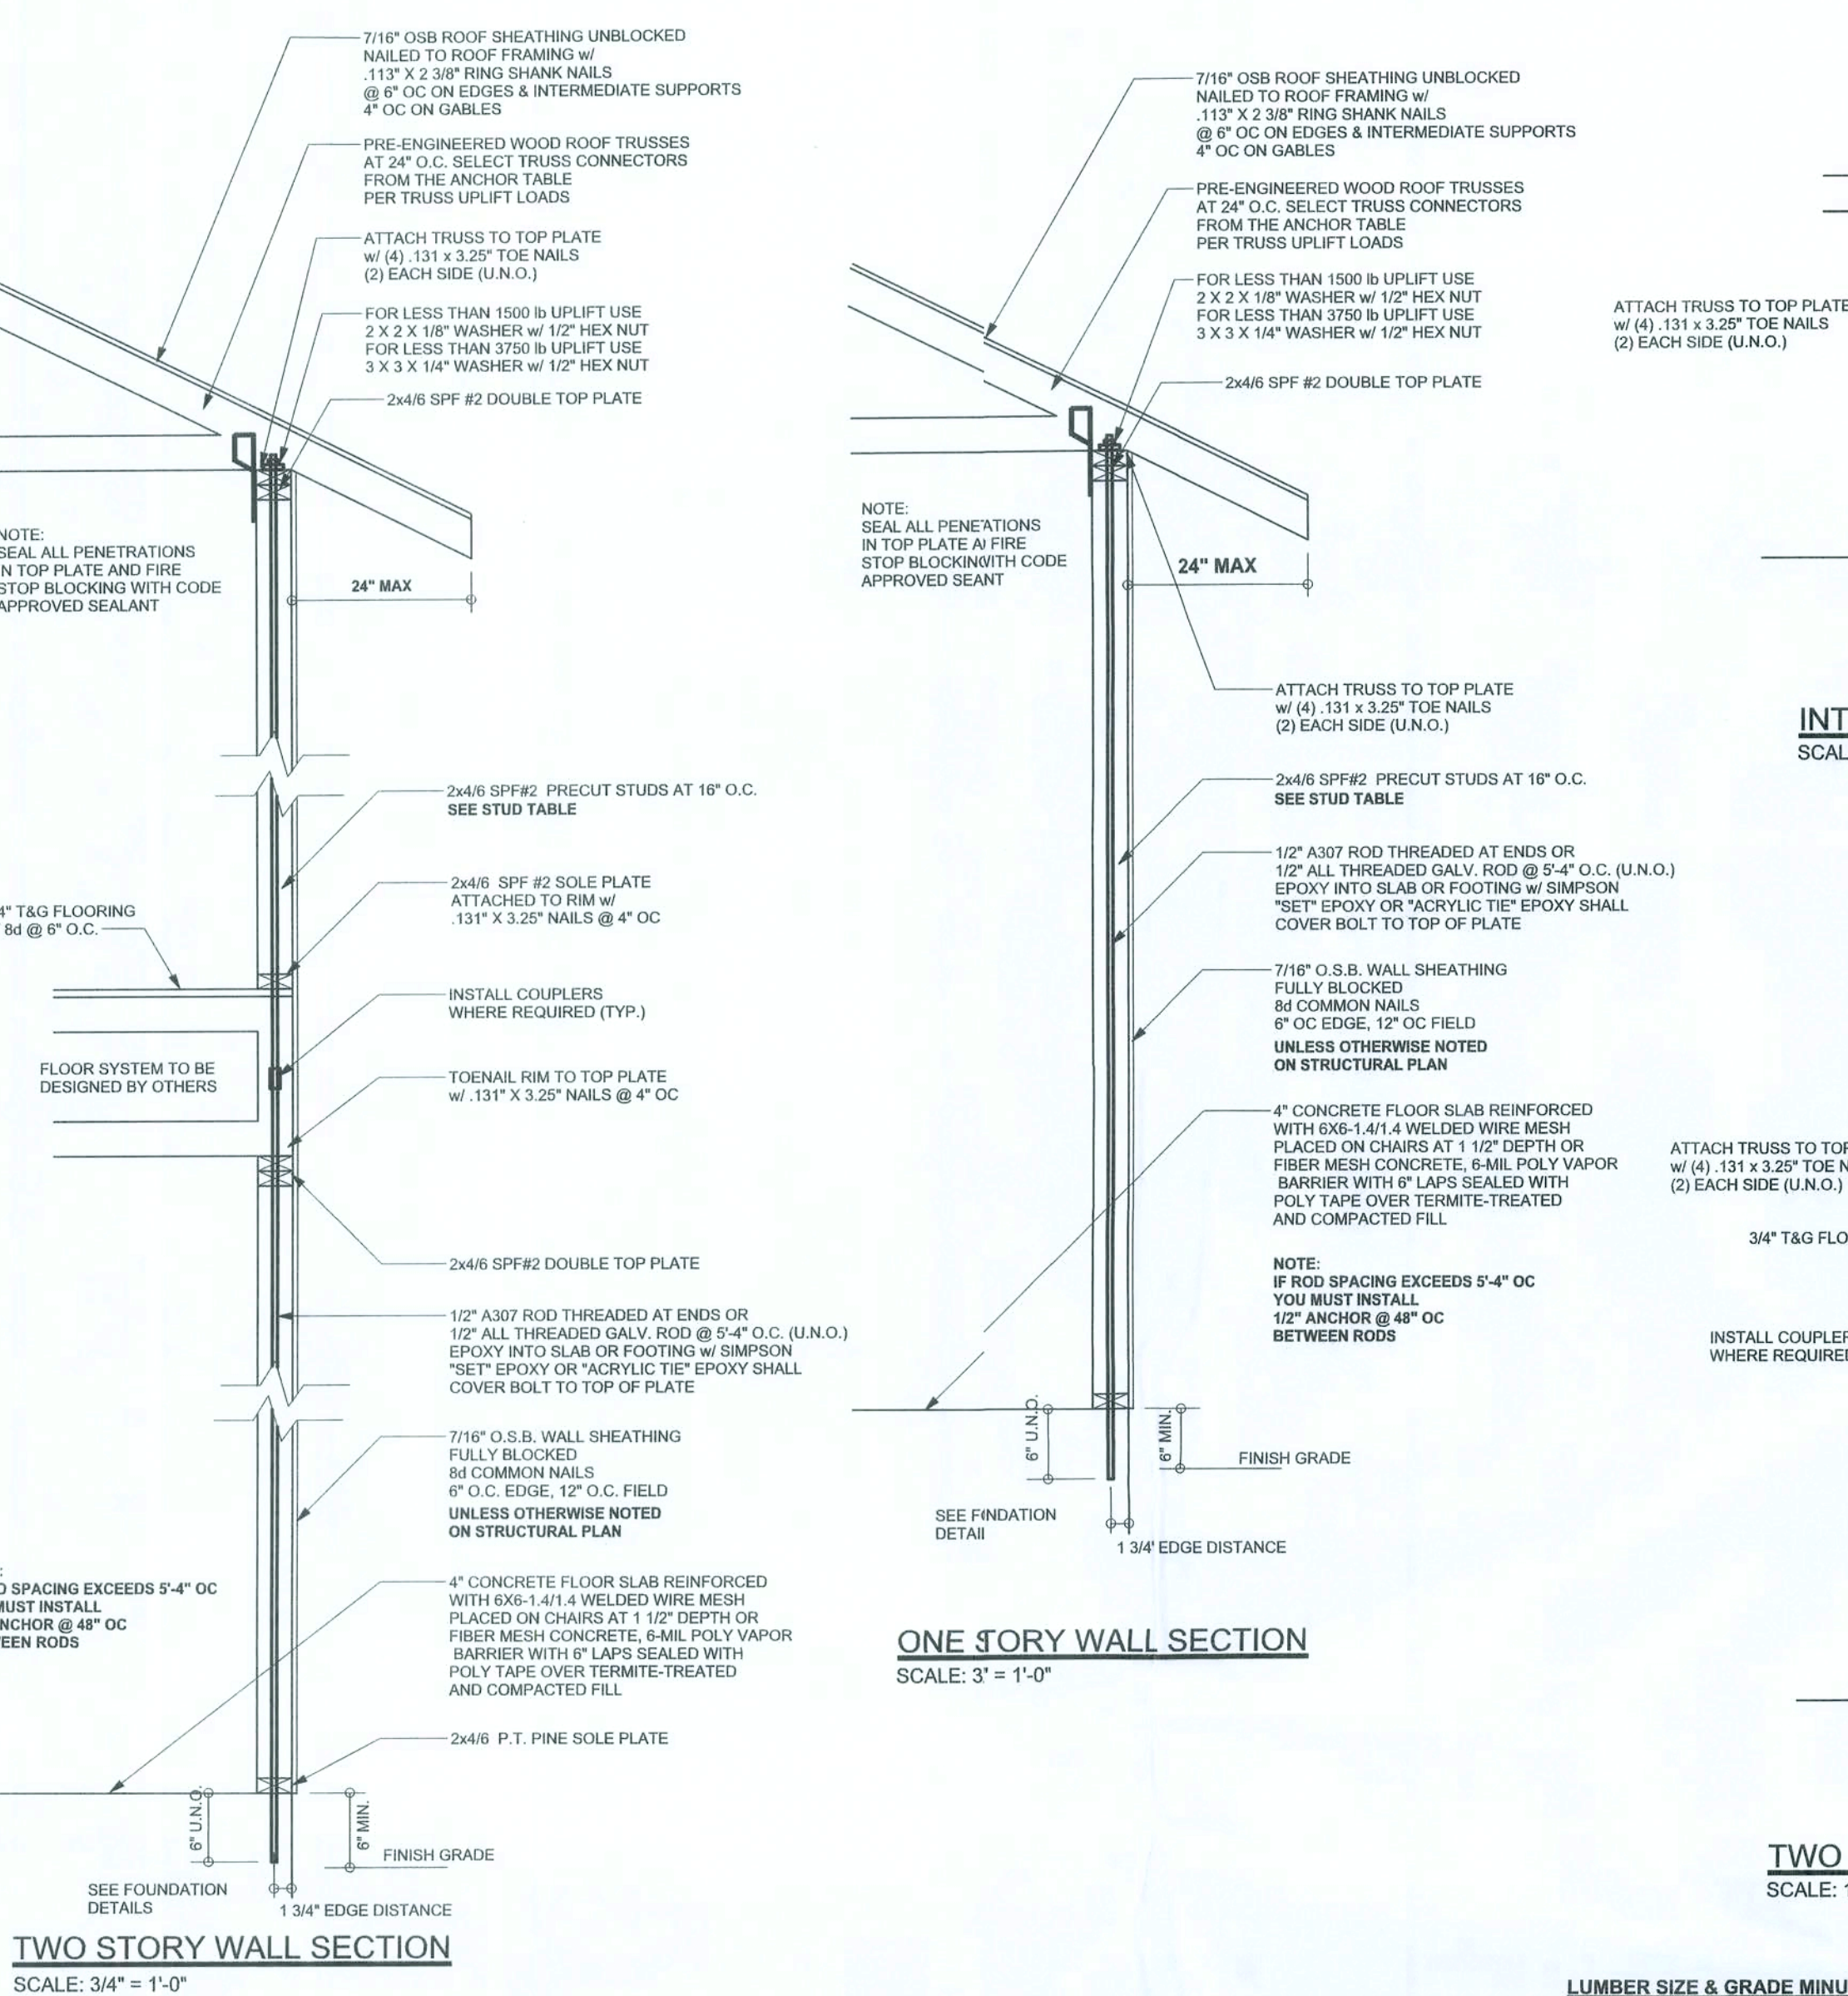


ANCHOR TABLE

UPLIFT LBS. SYP	UPLIFT LBS. SPF	TRUSS CONNECTOR*	TO PLATES	TO RAFTER/TRUSS	TO STUDS
< 420	< 245	H5A	3-8d	3-8d	
< 455	< 265	H5	4-8d	4-8d	
< 380	< 235	H4	4-8d	4-8d	
< 455	< 320	H3	4-8d	4-8d	
< 415	< 355	H2.5	5-8d	5-8d	
< 600	< 535	H2.5A	5-8d	5-8d	
< 950	< 820	H6	8-8d	8-8d	
< 745	< 565	H8	5-10d, 1 1/2"	5-10d, 1 1/2"	
< 1465	< 1050	H14-1	13-8d	12-8d, 1 1/2"	
< 1465	< 1050	H14-2	15-8d	12-8d, 1 1/2"	
< 980	< 650	H10-1	8-8d, 1 1/2"	8-8d, 1 1/2"	
< 745	< 550	H10-2	6-10d	6-10d	
< 1470	< 1265	H16-1	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1470	< 1265	H16-2	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1000	< 860	MTS24C	7-10d 1 1/2"	7-10d 1 1/2"	
< 1450	< 1245	HTS24	12-10d 1 1/2"	12-10d 1 1/2"	
< 2900	< 2400	2-HTS24			
< 2050	< 1785	LG2	14-16d	14-16d	
HEAVY GIRDER TIEDOWNS*					
< 3965	< 3330	MG1		22-10d	1-5/8" THREADED ROD 12" EMBEDMENT
< 10980	< 6485	HGT-2		16-10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 10530	< 8035	HGT-3		16-10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 8250	< 8250	HGT-4		16-10d	2-5/8" THREADED ROD 12" EMBEDMENT
STUD STRAP CONNECTOR*					
< 435	< 435	SSP DOUBLE TOP PLATE	3-10d		TO STUDS
< 455	< 420	SSP SINGLE SILL PLATE	1-10d		4-10d
< 825	< 825	DSP DOUBLE TOP PLATE	6-10d		4-10d
< 825	< 600	DSP SINGLE SILL PLATE	2-10d		8-10d
< 885	< 760	SP4		6-10d, 1 1/2"	8-10d
< 1240	< 1065	SP4H		10-10d, 1 1/2"	10-10d, 1 1/2"
< 885	< 760	SP6		6-10d	10-10d, 1 1/2"
< 1240	< 1065	SP6H		10-10d	10-10d, 1 1/2"
< 1235	< 1165	LSTA18	14-10d		
< 1235	< 1235	LSTA21	16-10d		
< 1030	< 1030	CS20	18-8d		
< 1705	< 1705	CS16	28-8d		
STUD ANCHORS*					
< 1350	< 1305	LTT19	8-16d		1/2" AB
< 2310	< 2310	LTT31	10-16d, 1 1/2"		1/2" AB
< 2775	< 2570	HD2A	2-5/8" BOLTS		5/8" AB
< 4175	< 3695	HTT16	18-16d		5/8" AB
< 1400	< 1400	PAHD42	16-16d		
< 3335	< 3335	HPAH222	16-16d		
< 2200	< 2200	ABU44	12-16d		1/2" AB
< 2300	< 2300	ABU66	12-16d		1/2" AB
< 2320	< 2320	ABU88	18-16d		2-5/8" AB



CONNECTION REQUIREMENT NOTES
1 2X4 RAFTERS TO RIDGE
2 CRIPPLE TO RIDGE
3 CRIPPLE TO RAFTERS
4 RAFTER TO SLEEPER OR BLOCKING
5 SLEEPER TO TRUSS
6 RIDGE BOARD TO ROOF BLOCK
7 RIDGE BOARD TO TRUSS
8 PURLIN TO TRUSS (TYP.)
9 TRUSS TO TRUSS (IF CRIPPLE IS ATTACHED TO PURLIN)
10 CRIPPLE TO BLOCKING
11 CRIPPLE TO TRUSS
12 CRIPPLE TO PURLIN

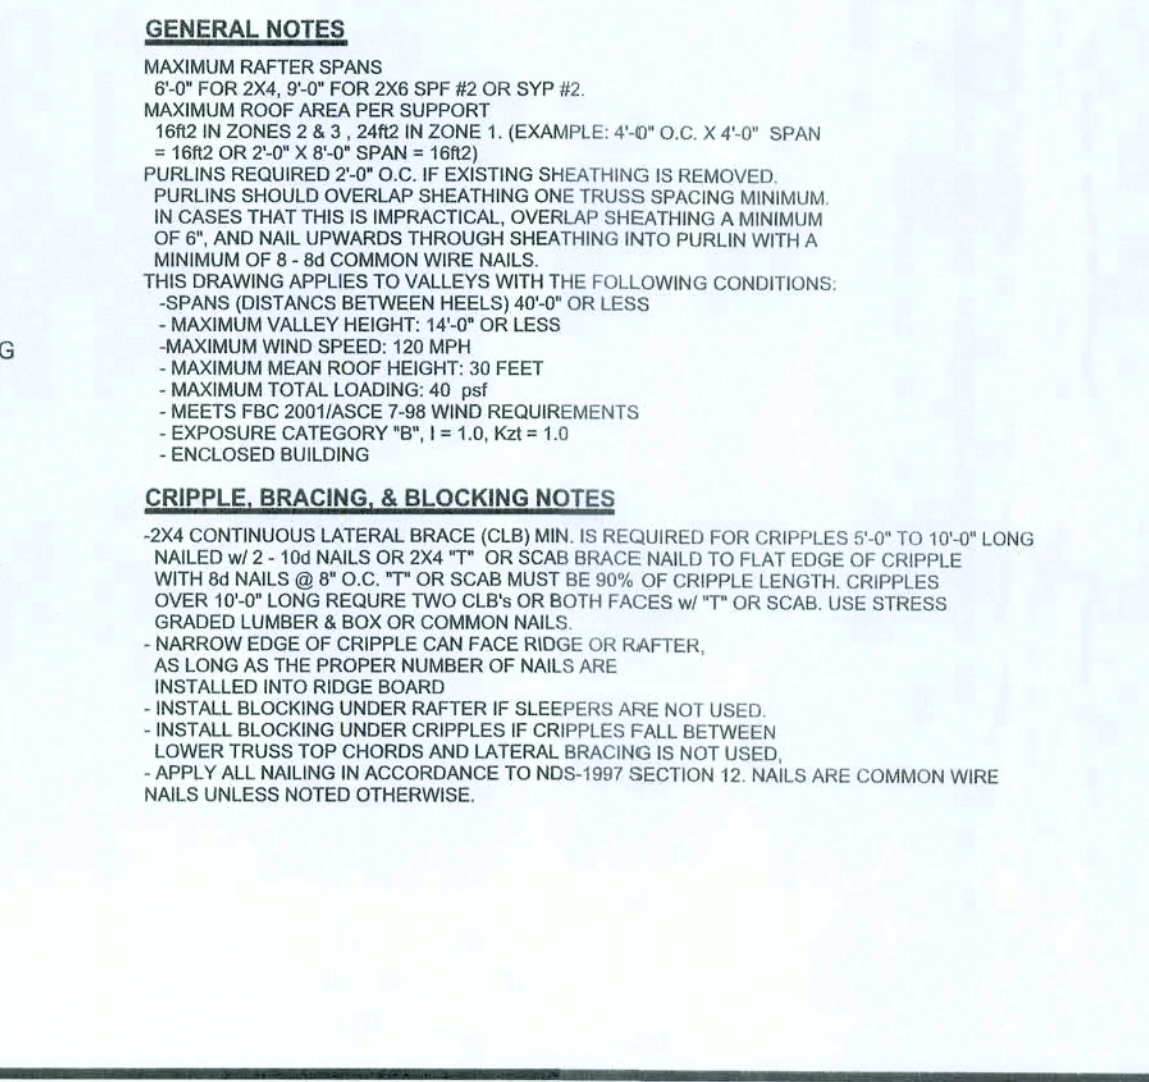

GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN UPLIFT CONNECTION 415LB EACH END, 2X6 RAFTERS 700 LB EACH END.


FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 2000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OF SOILS PROVIDES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F_c = 3000 PSI.

WELDED WIRE REINFORCED SLAB: 5" x 6" W1.4 x W1.4, F_y = 80ksi, WELDED WIRE REINFORCEMENT FABRIC (W.W.R.) CONFORMING TO ASTM A188, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'-0".

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT PRIOR LENGTH 1/8 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH/ WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1:5 AND TYPICAL SPACING OF CUTS TO BE 12\"/>

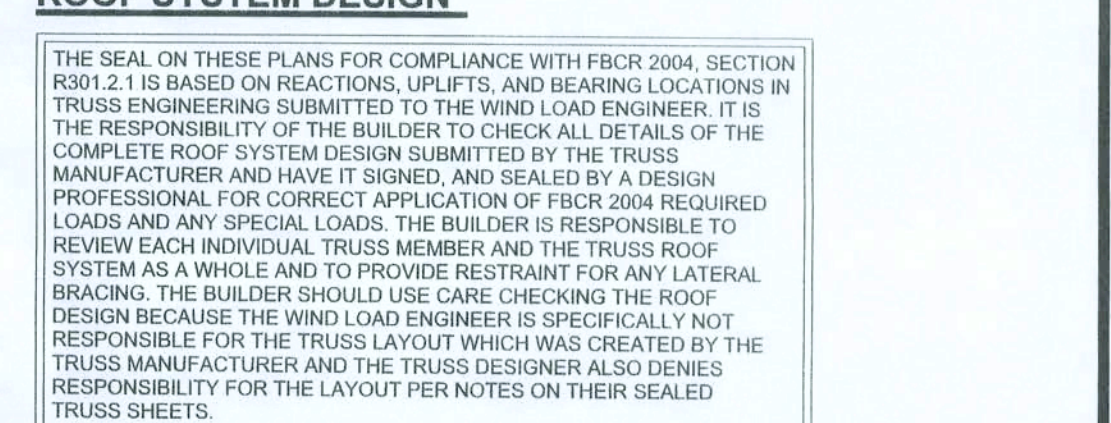

DESIGN DATA

WIND LOADS PER FLORIDA BUILDING CODE 2004 RESIDENTIAL, SECTION R301.2.1
(ENCLOSED SIMPLE DIAPHRAGM BUILDINGS WITH FLAT, HIPPED, OR GABLE ROOFS; MEAN ROOF HEIGHT NOT EXCEEDING LEAST HORIZONTAL DIMENSION OR 60 FT; NOT ON UPPER HALF OF HILL OR ESCARPMENT SOFT IN EXP. B, SOFT IN EXP. C AND <10% SLOPE AND UNOBSTRUCTED UPWIND FOR 50x HEIGHT OR 1 MILE WHICHEVER IS LESS.)
BUILDING IS NOT IN THE HIGH VELOCITY HURRICANE ZONE
BUILDING IS NOT IN THE WIND-BORNE DEBRIS REGION
1) BASIC WIND SPEED = 110 MPH
2) WIND EXPOSURE = B
3) WIND IMPORTANCE FACTOR = 1.0
4) BUILDING CATEGORY = II
5) ROOF ANGLE = 10-45 DEGREES
6) MEAN ROOF HEIGHT = <30 FT
7) INTERNAL PRESSURE COEFFICIENT = N/A (ENCLOSED BUILDING)
8) COMPONENTS AND CLADDING DESIGN WIND PRESSURES (TABLE R301.2(2))

Zone	Effective Wind Area (ft ²)	10	100
1	19.9 - 21.8	18.1	-18.1
2	19.9 - 25.5	18.1	-21.8
2 Other		40.2	-40.8
3	19.9 - 25.5	18.1	-21.8
3 Other		68.3	-42.4
4	21.8 - 23.6	18.5	-20.4
5	21.8 - 29.1	18.5	-22.6
Worst Case (Zone 5, 10 ft RZ)		21.8	-29.1
18x7 Garage Door		19.5	-22.9
18x7 Garage Door		18.5	-21.0

DESIGN LOADS
FLOOR 40 PSF (ALL OTHER DWELLING ROOMS)
30 PSF (SLEEPING ROOMS)
30 PSF (ATTICS WITH STORAGE)
10 PSF (ATTICS WITHOUT STORAGE, <3:12)
ROOF 20 PSF (FLAT OR <4:12)
16 PSF (4:12 TO <12:12)
12 PSF (12:12 AND GREATER)
STAIRS 40 PSF (ONE & TWO FAMILY DWELLINGS)
SOIL BEARING CAPACITY 1000PSF
NOT IN FLOOD ZONE (BUILDER TO VERIFY)

REVISIONS

--	--

Paul & Emmy Phinnney Residence

ADDRESS: Columbia County, Florida

Mark Disoway P.E., Box 868 Lake City, Florida 32056 Phone: (386) 754 - 5419 Fax: (386) 269 - 4871

PRINTED DATE: February 11, 2009

DRAWN BY: David Disoway


STRUCTURAL BY: David Disoway

FINALS DATE: 11Feb09

JOB NUMBER: 810071


DRAWING NUMBER: S-1

OF 4 SHEETS

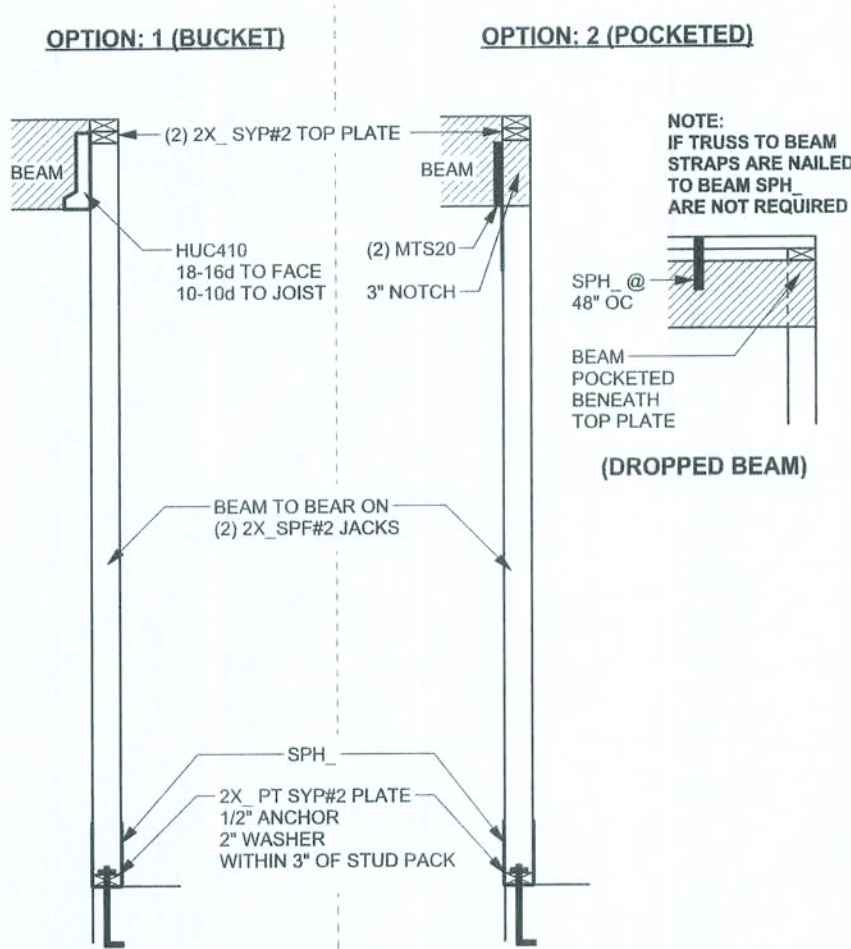


(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

ALLOWABLE UPLIFT:
1265 LB

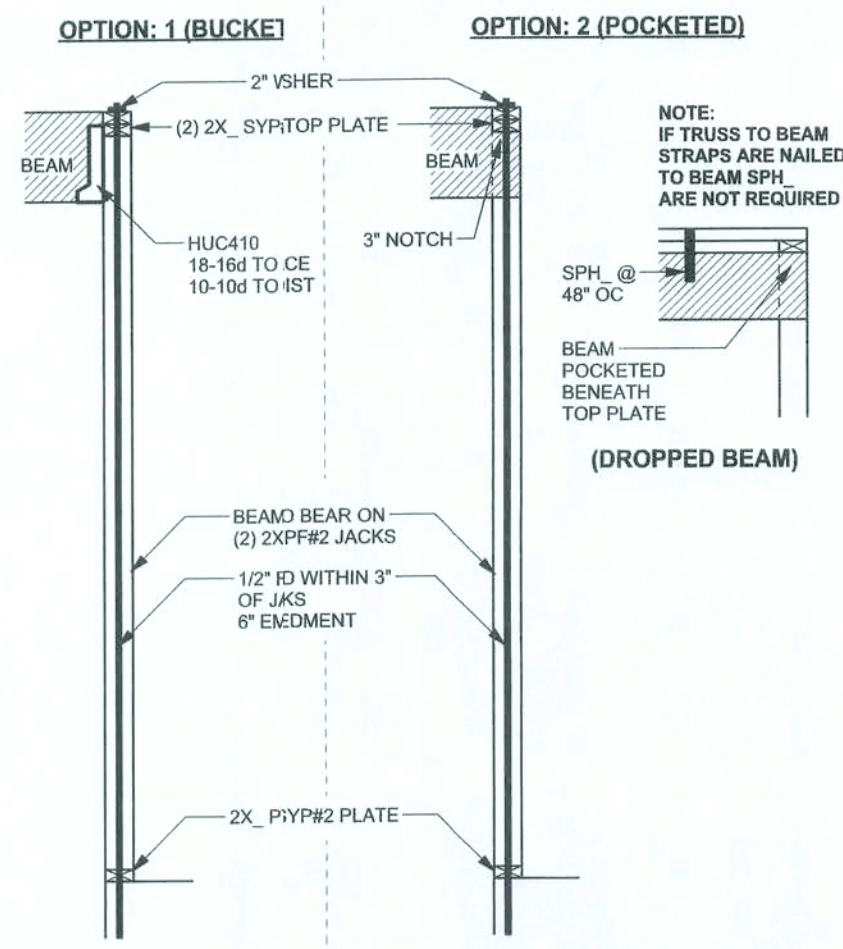

(TYP.) BEAM O WALL
WOOD FRAME w/ RGS

ALLOWABLE UPLIFT:
1776 LB

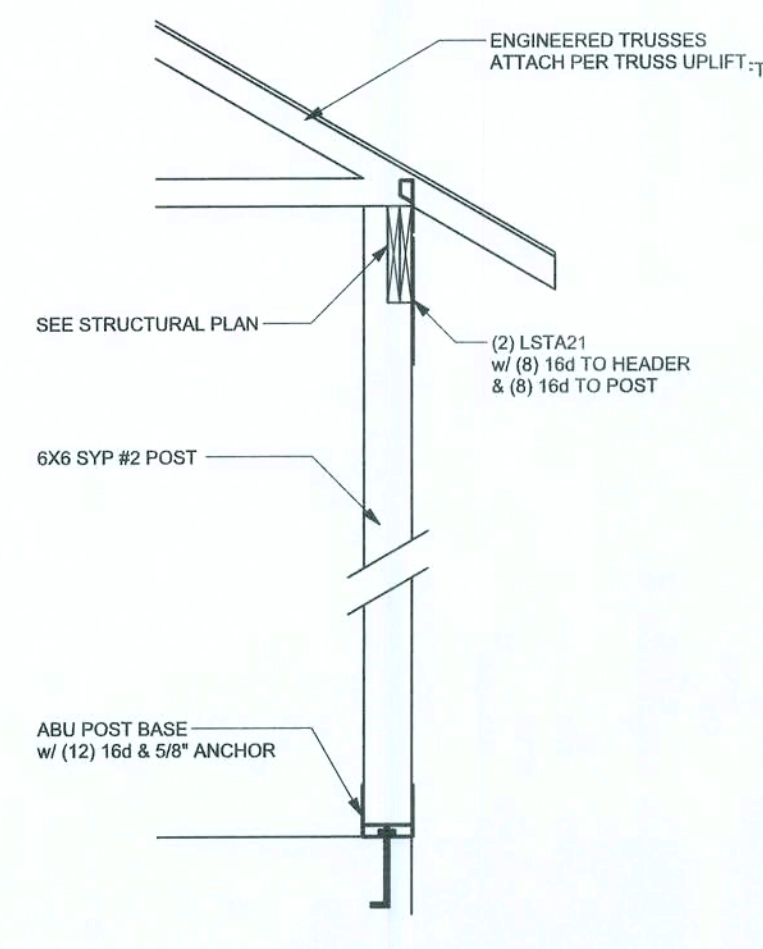

(TYP.) PORCH POST
ONE STORY WOOD


ALTERNATE CONNECTION WHERE
ROD CANNOT BE PLACED IN WALL
ONE STORY WOOD FRAME w/ RODS

ALLOWABLE UPLIFT:
1900 LB


2X6 SYP#2 GARAGE DOOR BUCK ATTACHMENT

ATTACH GARAGE DOOR BUCK TO STUD PACK AT EACH SIDE OF DOOR OPENING WITH 3/8\"/>


DOOR WIDTH	3/8\"/>
------------	---------

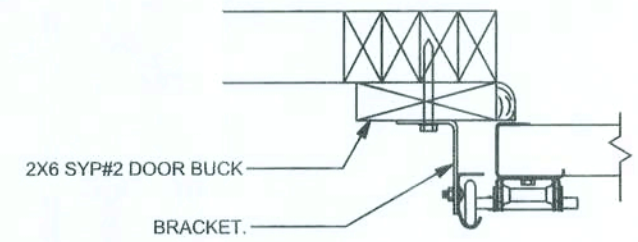



(TYP.) GARAGE DOOR BUCK INSTALLATION
WOOD FRAME

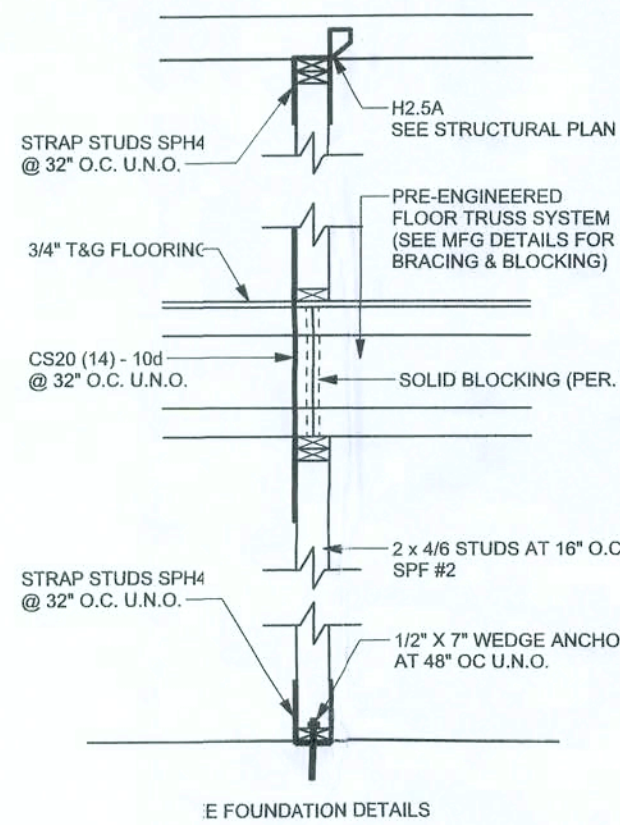


(ALT.) 2 STORY INTERIOR BEARING WALL
SCALE: 1/2\"/>

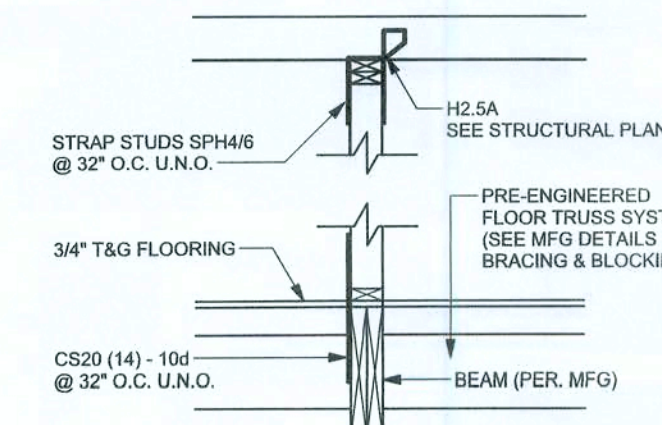

(ALT.) INTERIOR BEARING WALL TO BEAM
SCALE: 1/2\"/>

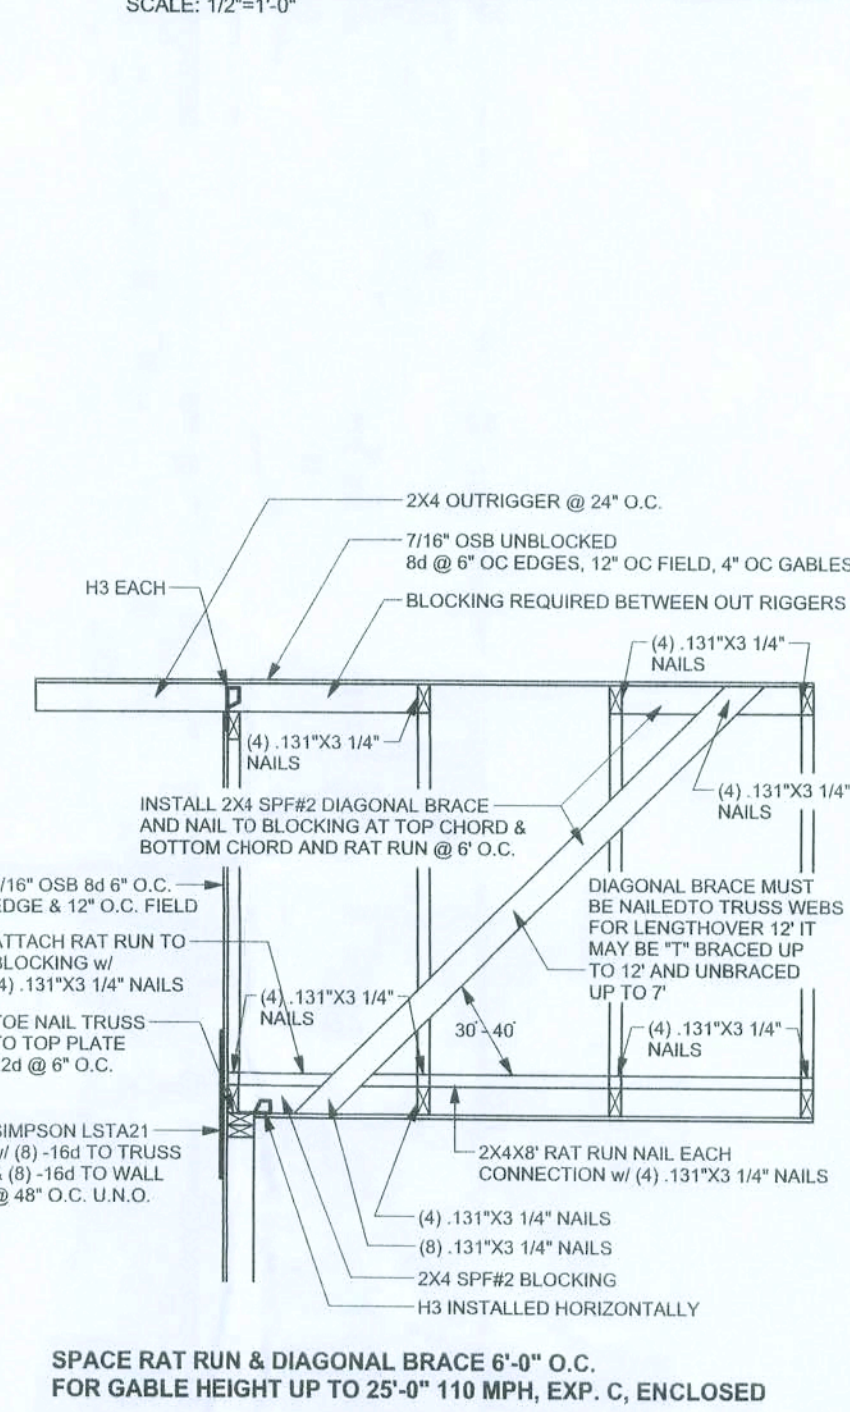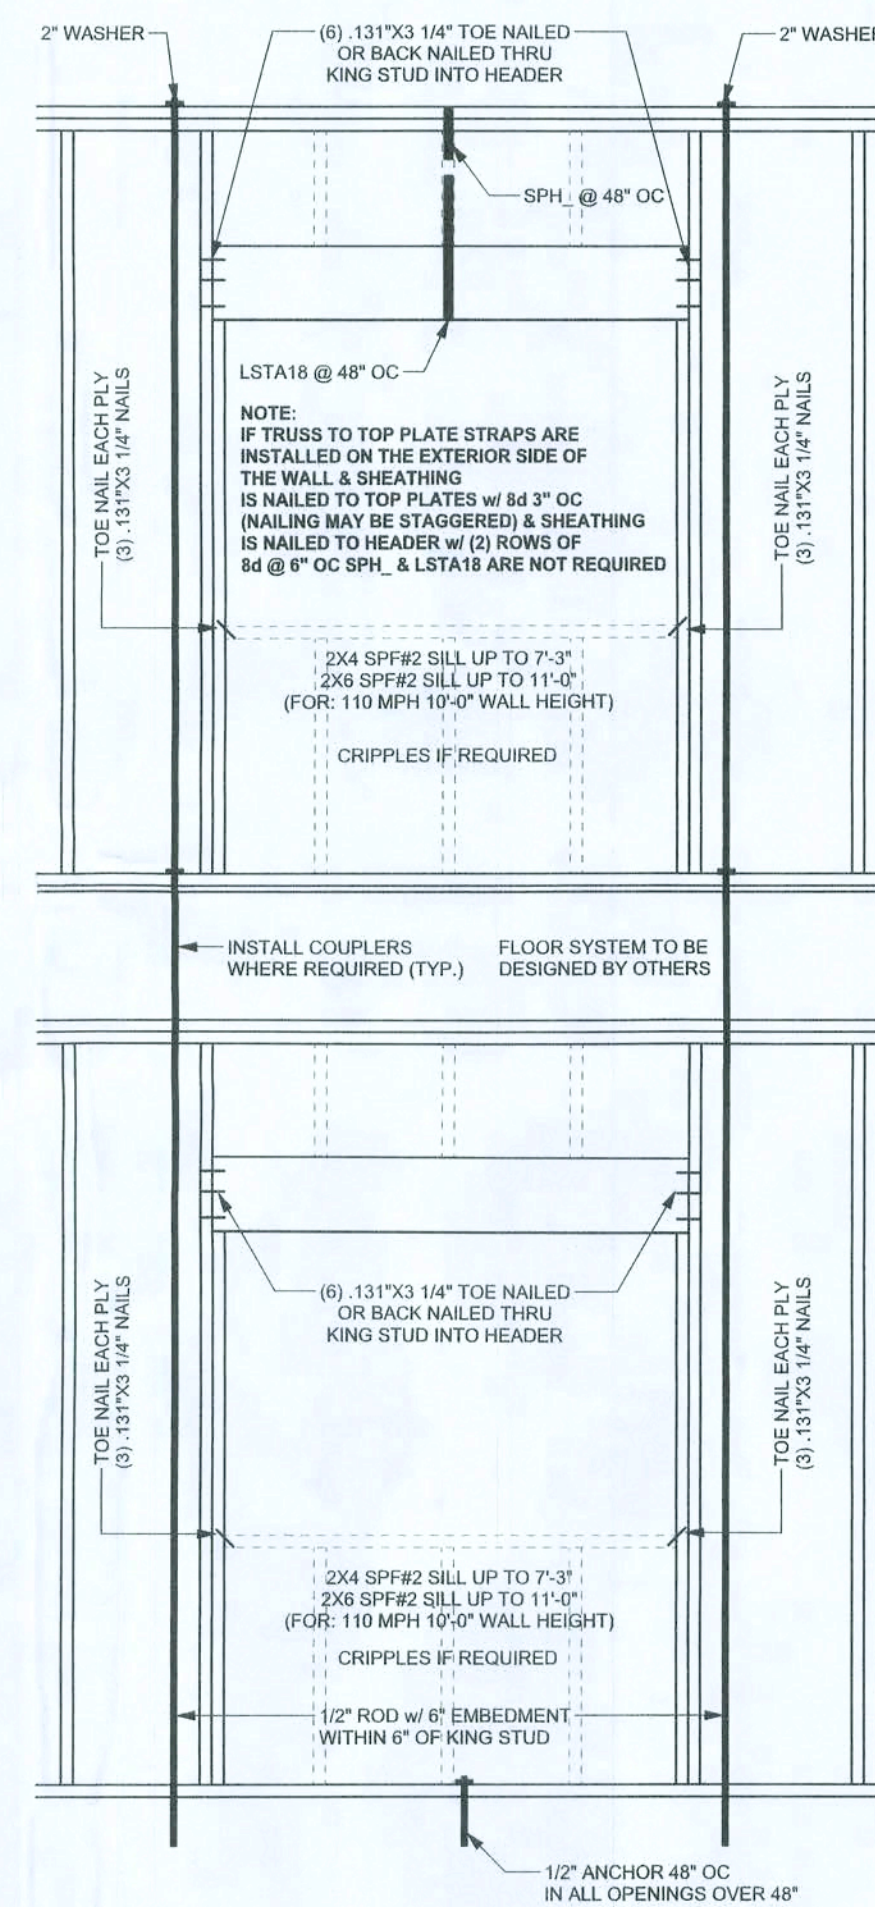


(TYP.) GABLE BRACING DETAIL
WOOD FRAME

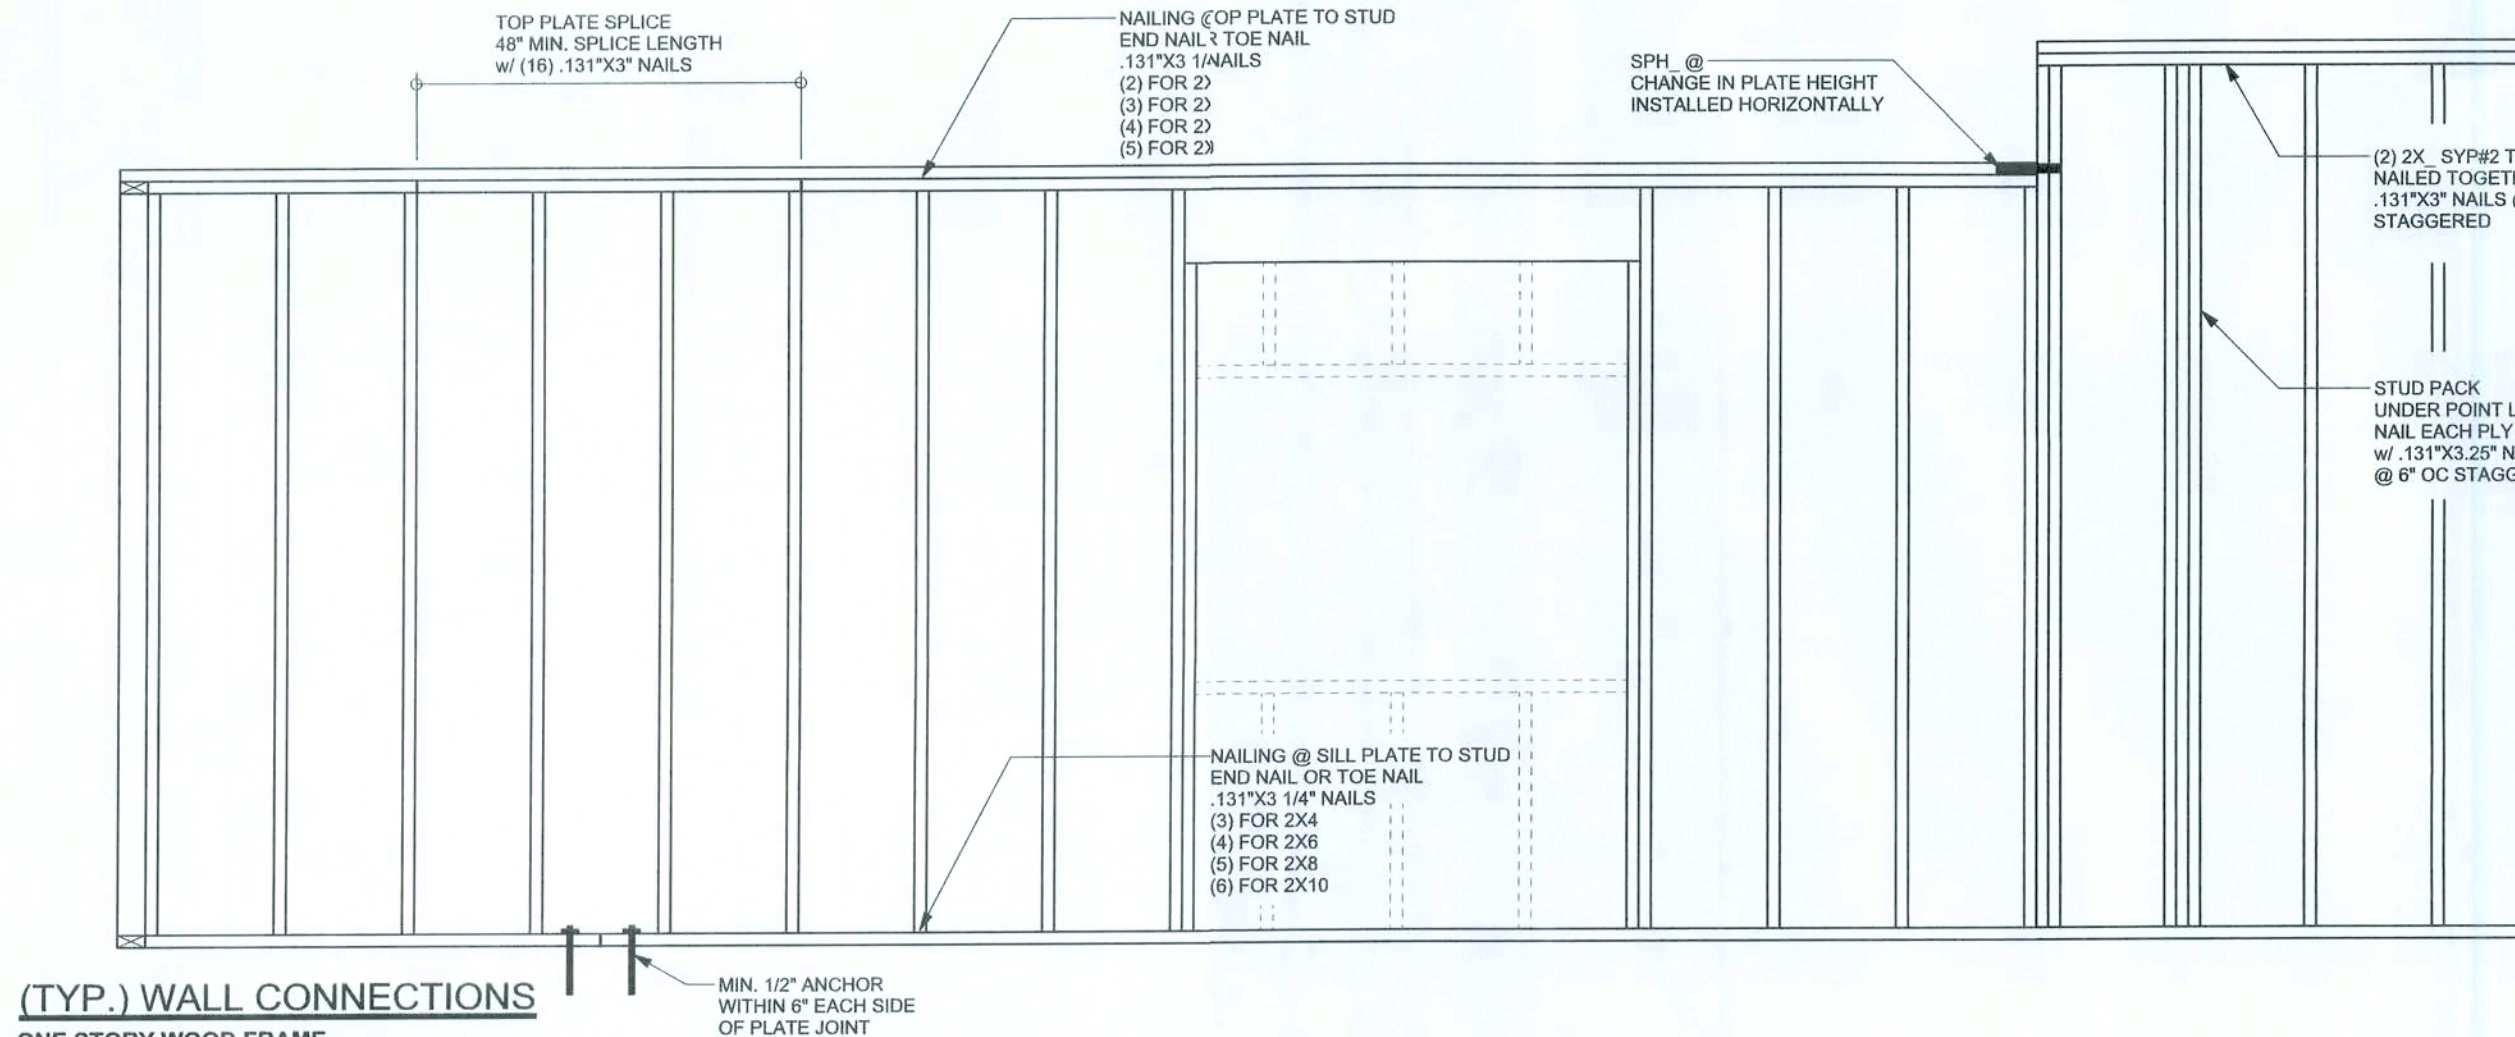


(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

OPTION 2 (DROPPED HEADER)


(TYP.) HEADER
TWO STORY WOOD FRAME w/ RODS

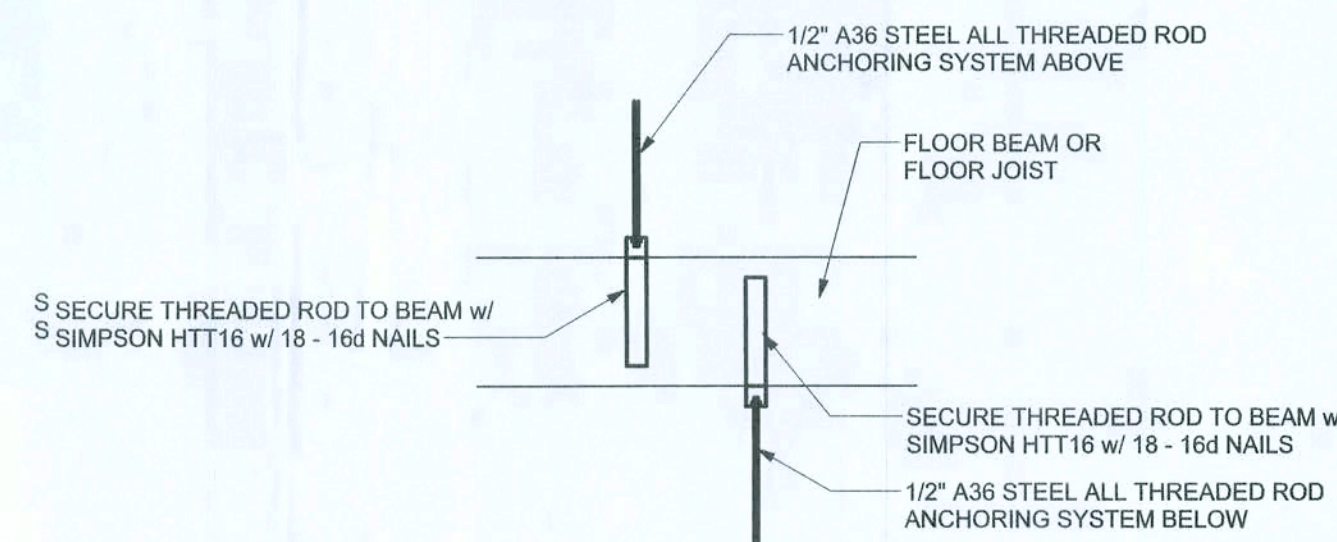

OPTIONAL THREADED ROD TO
FLOOR BEAM OR FLOOR JOIST
SCALE: 1/2\"/>

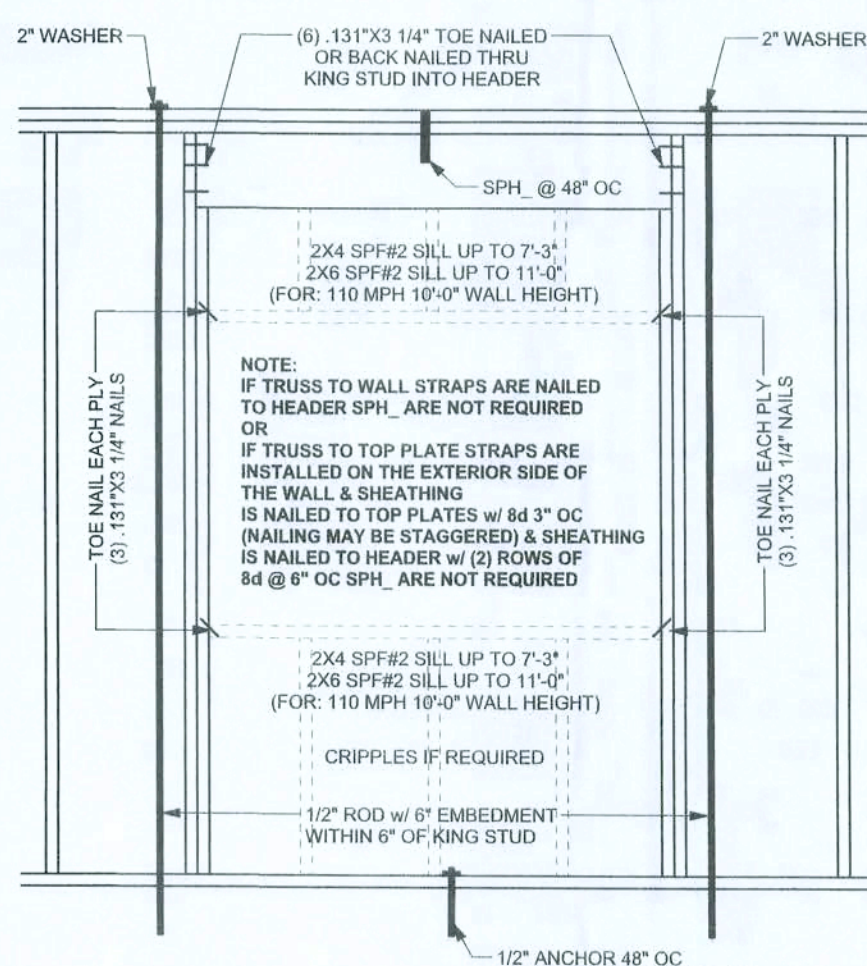

(TYP.) HEADER
ONE STORY WOOD FRAME w/ RODS

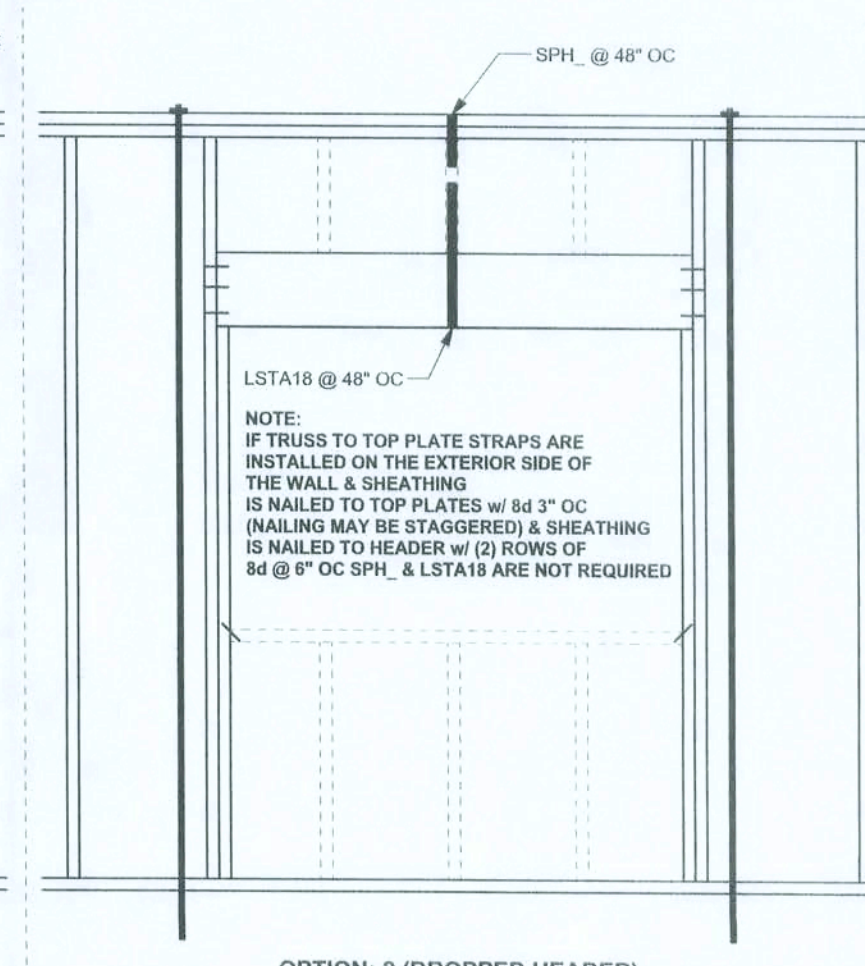

OPTION 2 (DROPPED HEADER)

REVISIONS	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

WINDLOAD ENGINEER:
Mark Discosway, P.E.
No. 53915, P.O. Box 868, Lake City, FL 32056,
386-754-5419

DIMENSIONS:
Stated dimensions supersede scaled
dimensions. Refer all questions to
Mark Discosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Discosway, P.E. hereby expressly
reserves to common law copyrights and
property right in these instruments of service.
This document is not to be reproduced, altered
or copied in any form or manner without first
the express written permission and consent
of Mark Discosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
ordances of the plan, relating to
wind engineering comply with section
5301.2, Florida building code
residential 2004,
to the best of my knowledge.

LIMITATION: This design is valid for one
building, at specified location.

MARK DISCOSWAY
P.E. 53915

Mark Discosway
11FEB09
SEAL

Paul & Emmy
Phinney Residence

ADDRESS:
Columbia County, Florida

Mark Discosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871


PRINTED DATE:
February 11, 2009

DRAWN BY: STRUCTURAL BY:
David Discosway


FINALS DATE:
11Feb09

JOB NUMBER:
810071

DRAWING NUMBER
S-1.1
OF 4 SHEETS



STEWALL WALL (FEET)	UNBALANCE BACCEL HEIGHT	VERTICAL REINFORCEMENT FOR 1" CMU STEWWALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 1" CMU STEWWALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

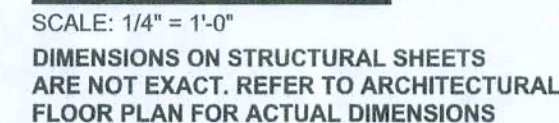

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

11 FEB 09

OF 4 SHEETS

REVISIONS	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

USE H2.5A (480lb) TO ATTACH ALL TRUSSES w/ UPLIFT
TO WALLS AND PORCH BEAMS UNLESS NOTED OTHERWISE

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X12 SYP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-4 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI-103. BCSI-81, BCSI-82, & BCSI-83. BCSI-81, BCSI-82, & BCSI-83 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

WALL LEGEND

	EXTERIOR WALL
	INTERIOR NON-LOAD BEARING WALL
	INTERIOR LOAD BEARING WALL w/ NO UPLIFT
	INTERIOR LOAD BEARING WALL w/ UPLIFT

HEADER LEGEND


- (2) 2X12X0', 1J 1K → HEADER/BEAM CALL-OUT (U.N.O.)
- ↑ → NUMBER OF KING STUDS (FULL LENGTH)
- ↑ → NUMBER OF JACK STUDS (UNDER HEADER)
- ↑ → SPAN OF HEADER
- ↑ → SIZE OF HEADER MATERIAL
- ↑ → NUMBER OF PLIES IN HEADER

THREADED ROD LEGEND

- ⊙ → INDICATES LOCATION OF:
1ST FLOOR 1/2" A307 ALL THREADED ROD
- ⊗ → INDICATES LOCATION OF:
2ND FLOOR 1/2" A307 ALL THREADED ROD


TOTAL SHEAR WALL SEGMENTS

	REQUIRED	ACTUAL
TRANSVERSE	46.5'	95.1'
LONGITUDINAL	38.9'	45.2'

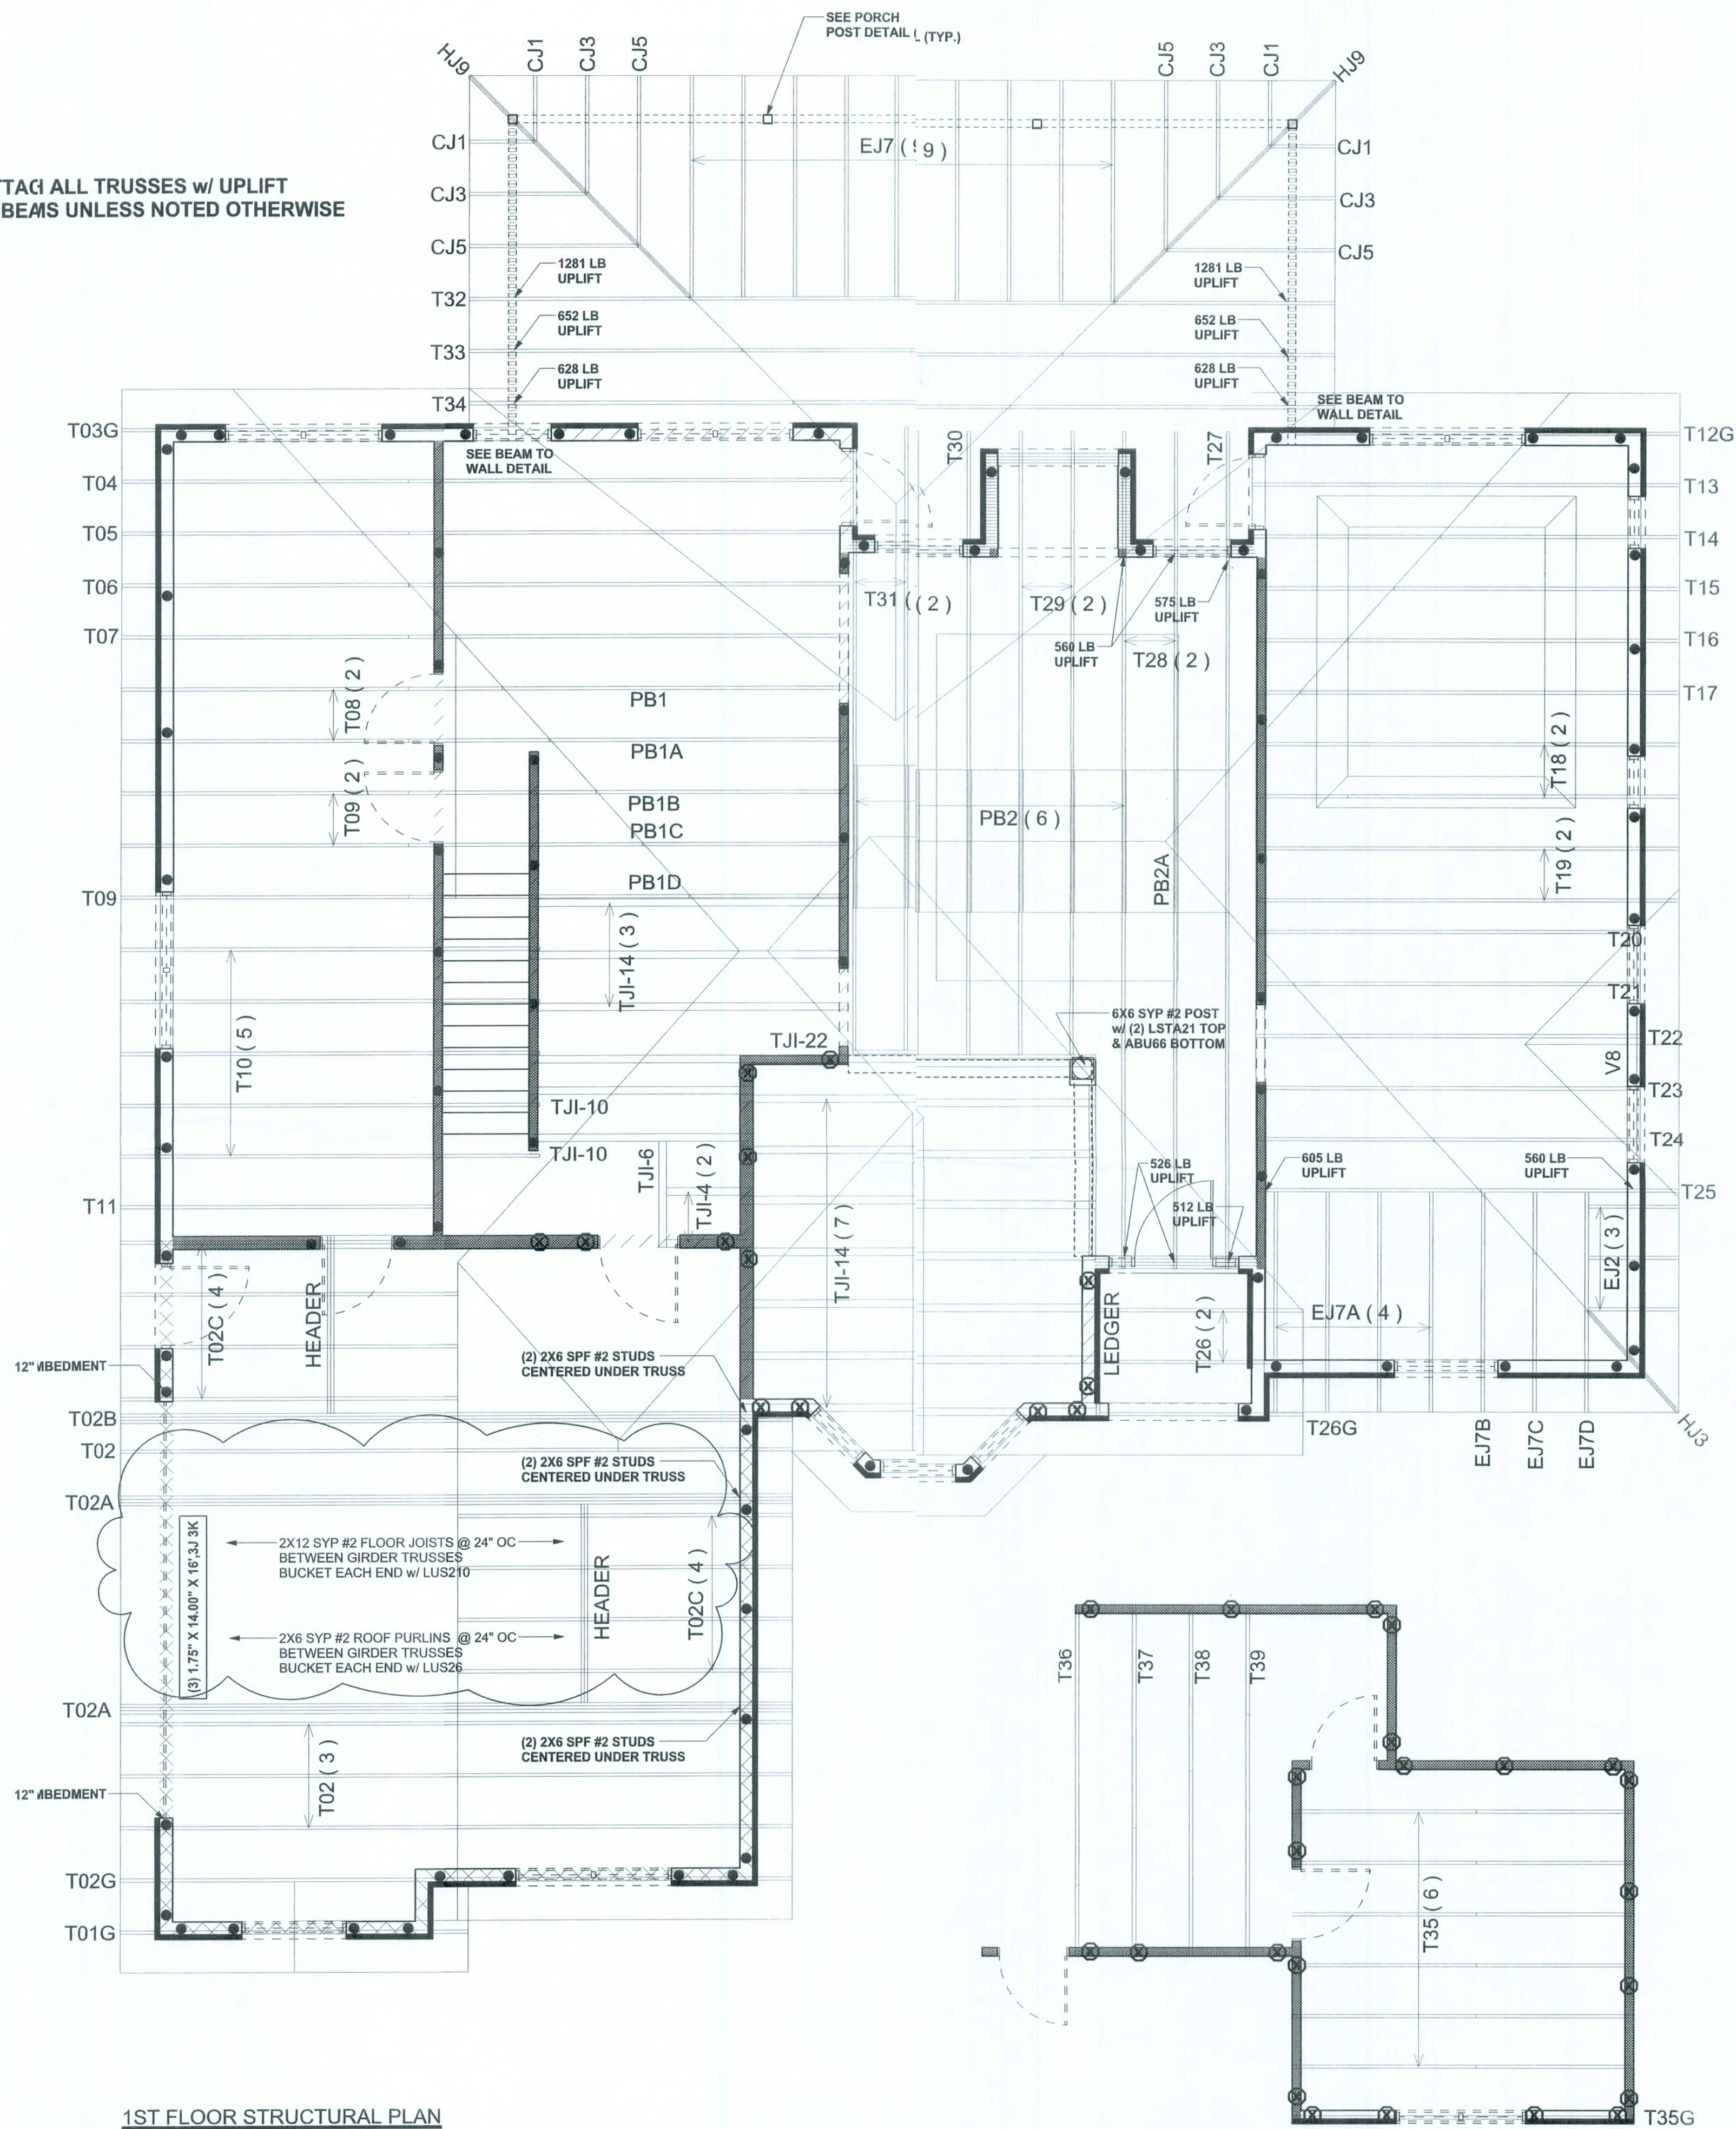


1ST FLOOR STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

2ND FLOOR STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

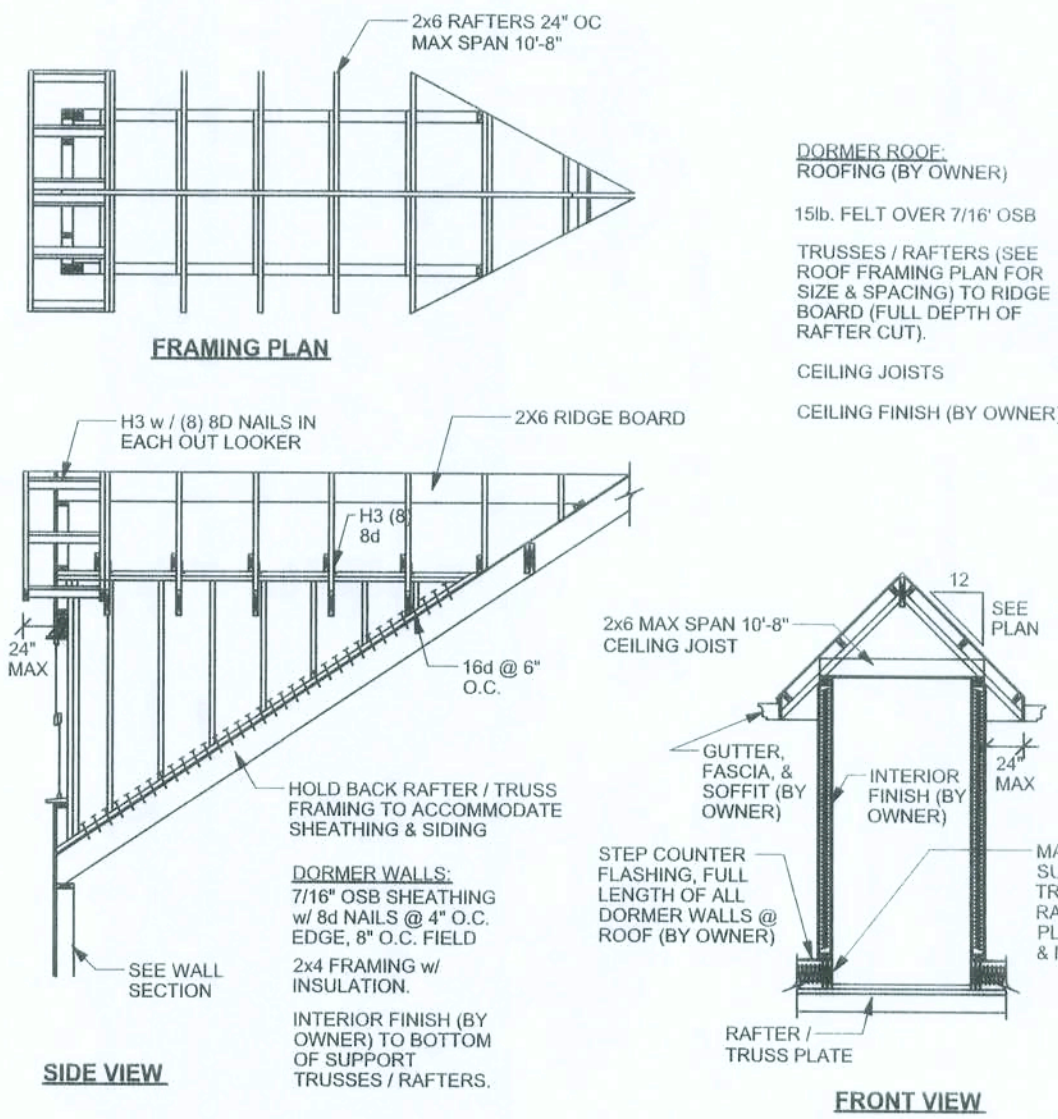

DORMER ANCHORING DETAIL (ON ROOF)
SCALE: N.T.S.

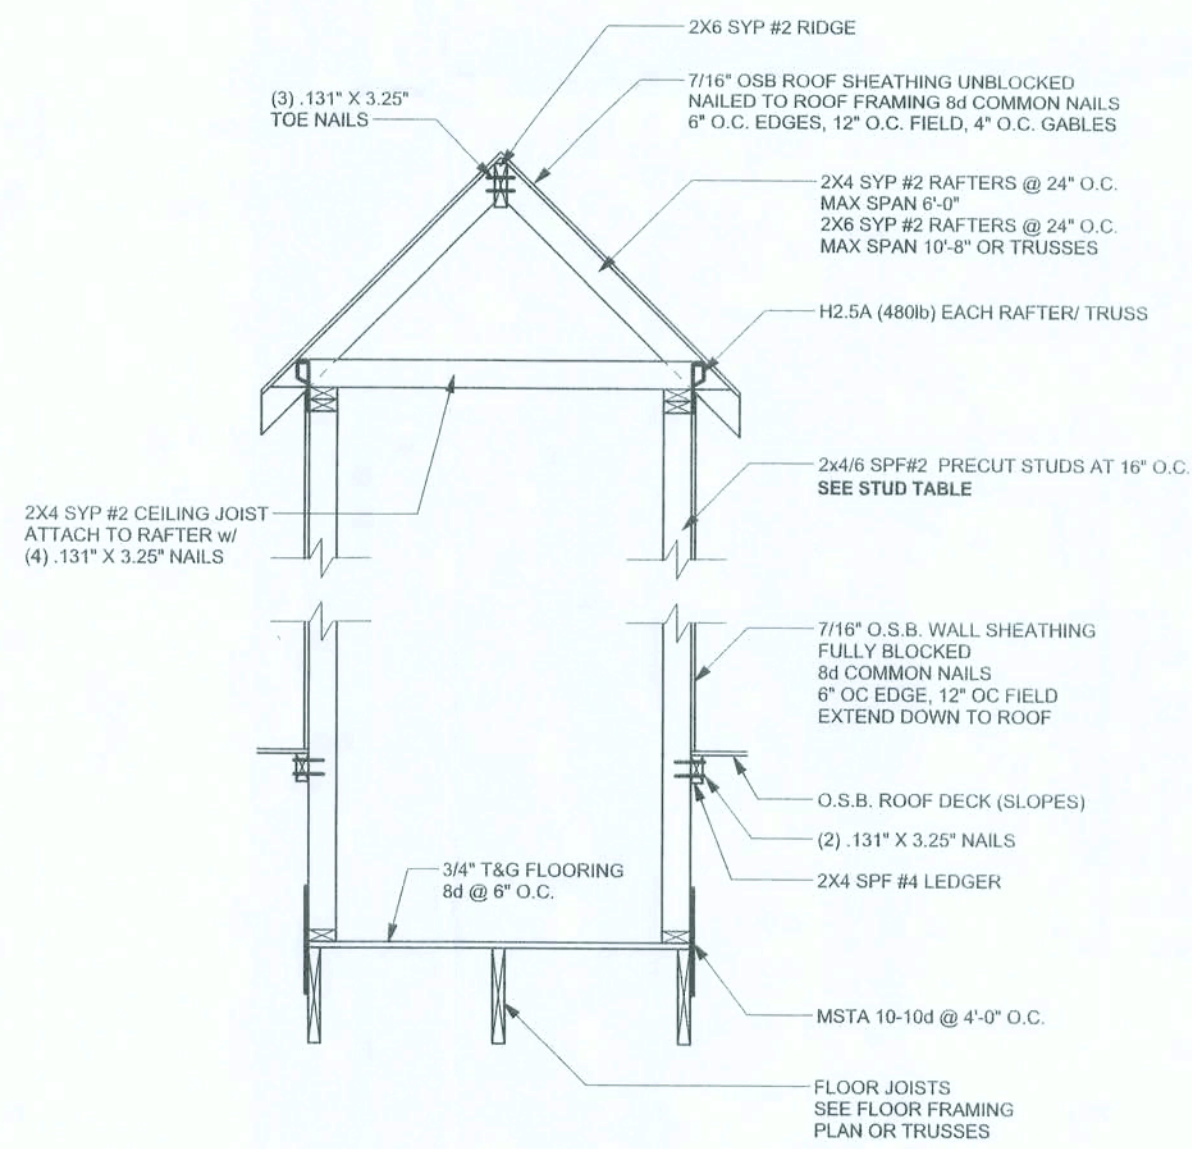

DORMER ANCHORING DETAIL (ON FLOOR)
SCALE: N.T.S.

PERMIT #090221

WINDLOAD ENGINEER:
Mark Disosway, P.E.
No. 3385, PCB 868, Lake City, FL 32056,
386-79-5419

DIMENSIONS:
Stated dimensions supersede scaled
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not exceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly
reserves all common law copyrights and
property rights in these instruments of service.
This document is not to be reproduced, altered
or copied in any form or manner without first
the express written permission and consent
of Mark Disosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
portion of the plan, relating to
wind engineering comply with section
R301.21, Florida building code
residential 2004,
to the best of my knowledge.

LIMITATION: This design is valid for one
building, at specified location.

MARK DISOSWAY
P.E. 53915

Paul & Emmy
Hinney Residence

ADDRESS:
Columbia County, Florida

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
February 27, 2009

DRAWN BY: STRUCTURAL BY:
David Disosway

FINALS DATE:
11Feb09

JOB NUMBER:
810071

DRAWING NUMBER
S-3

OF 4 SHEETS

CONNECTIONS, WALL, & HEADER DESIGN IS BASED
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING
FURNISHED BY BUILDER. BUILDERS FIRST SOURCE
JOB # 294475