

PROJECT DESCRIPTION:

32x365 REC SOLAR : REC365AA (365W) MODULES  
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES  
SYSTEM SIZE: 11.680 kW DC STC  
ARRAY AREA #1: 188.33 SQ FT.  
ARRAY AREA #2: 226.00 SQ FT.  
ARRAY AREA #3: 188.33 SQ FT.

EQUIPMENT SUMMARY


- 32 REC SOLAR : REC365AA (365W) MODULES
- 32 ENPHASE: IQ7PLUS-72-2-US MICROINVERTERS
- 01 TESLA BACKUP GATEWAY 2
- 02 TESLA POWERWALL 2

GOVERNING CODES:  
FLORIDA RESIDENTIAL CODE, 7th EDITION 2020 (FRC)  
FLORIDA PLUMBING CODE, 7th EDITION 2020 (FPC)  
FLORIDA BUILDING CODE, 7th EDITION 2020 (FBC)  
FLORIDA MECHANICAL CODE, 7th EDITION 2020 (FMC)  
NEC 2017 CODE BOOK  
ASCE 7-16

SHEET INDEX

- A-00 PLOT PLAN & VICINITY MAP
- A-01 SYMBOLS & SYSTEM DESCRIPTION
- S-01 ROOF PLAN & MODULES
- S-01.1 PARTIAL PRESSURE AND MODULES EXPOSURE
- S-02 STRUCTURAL ATTACHMENT DETAILS
- S-02.1 STRUCTURAL CALCULATIONS
- E-01 ELECTRICAL LINE DIAGRAM
- E-02 WIRING CALCULATIONS
- E-03 SYSTEM LABELING

DS-01-08 DATA SHEETS

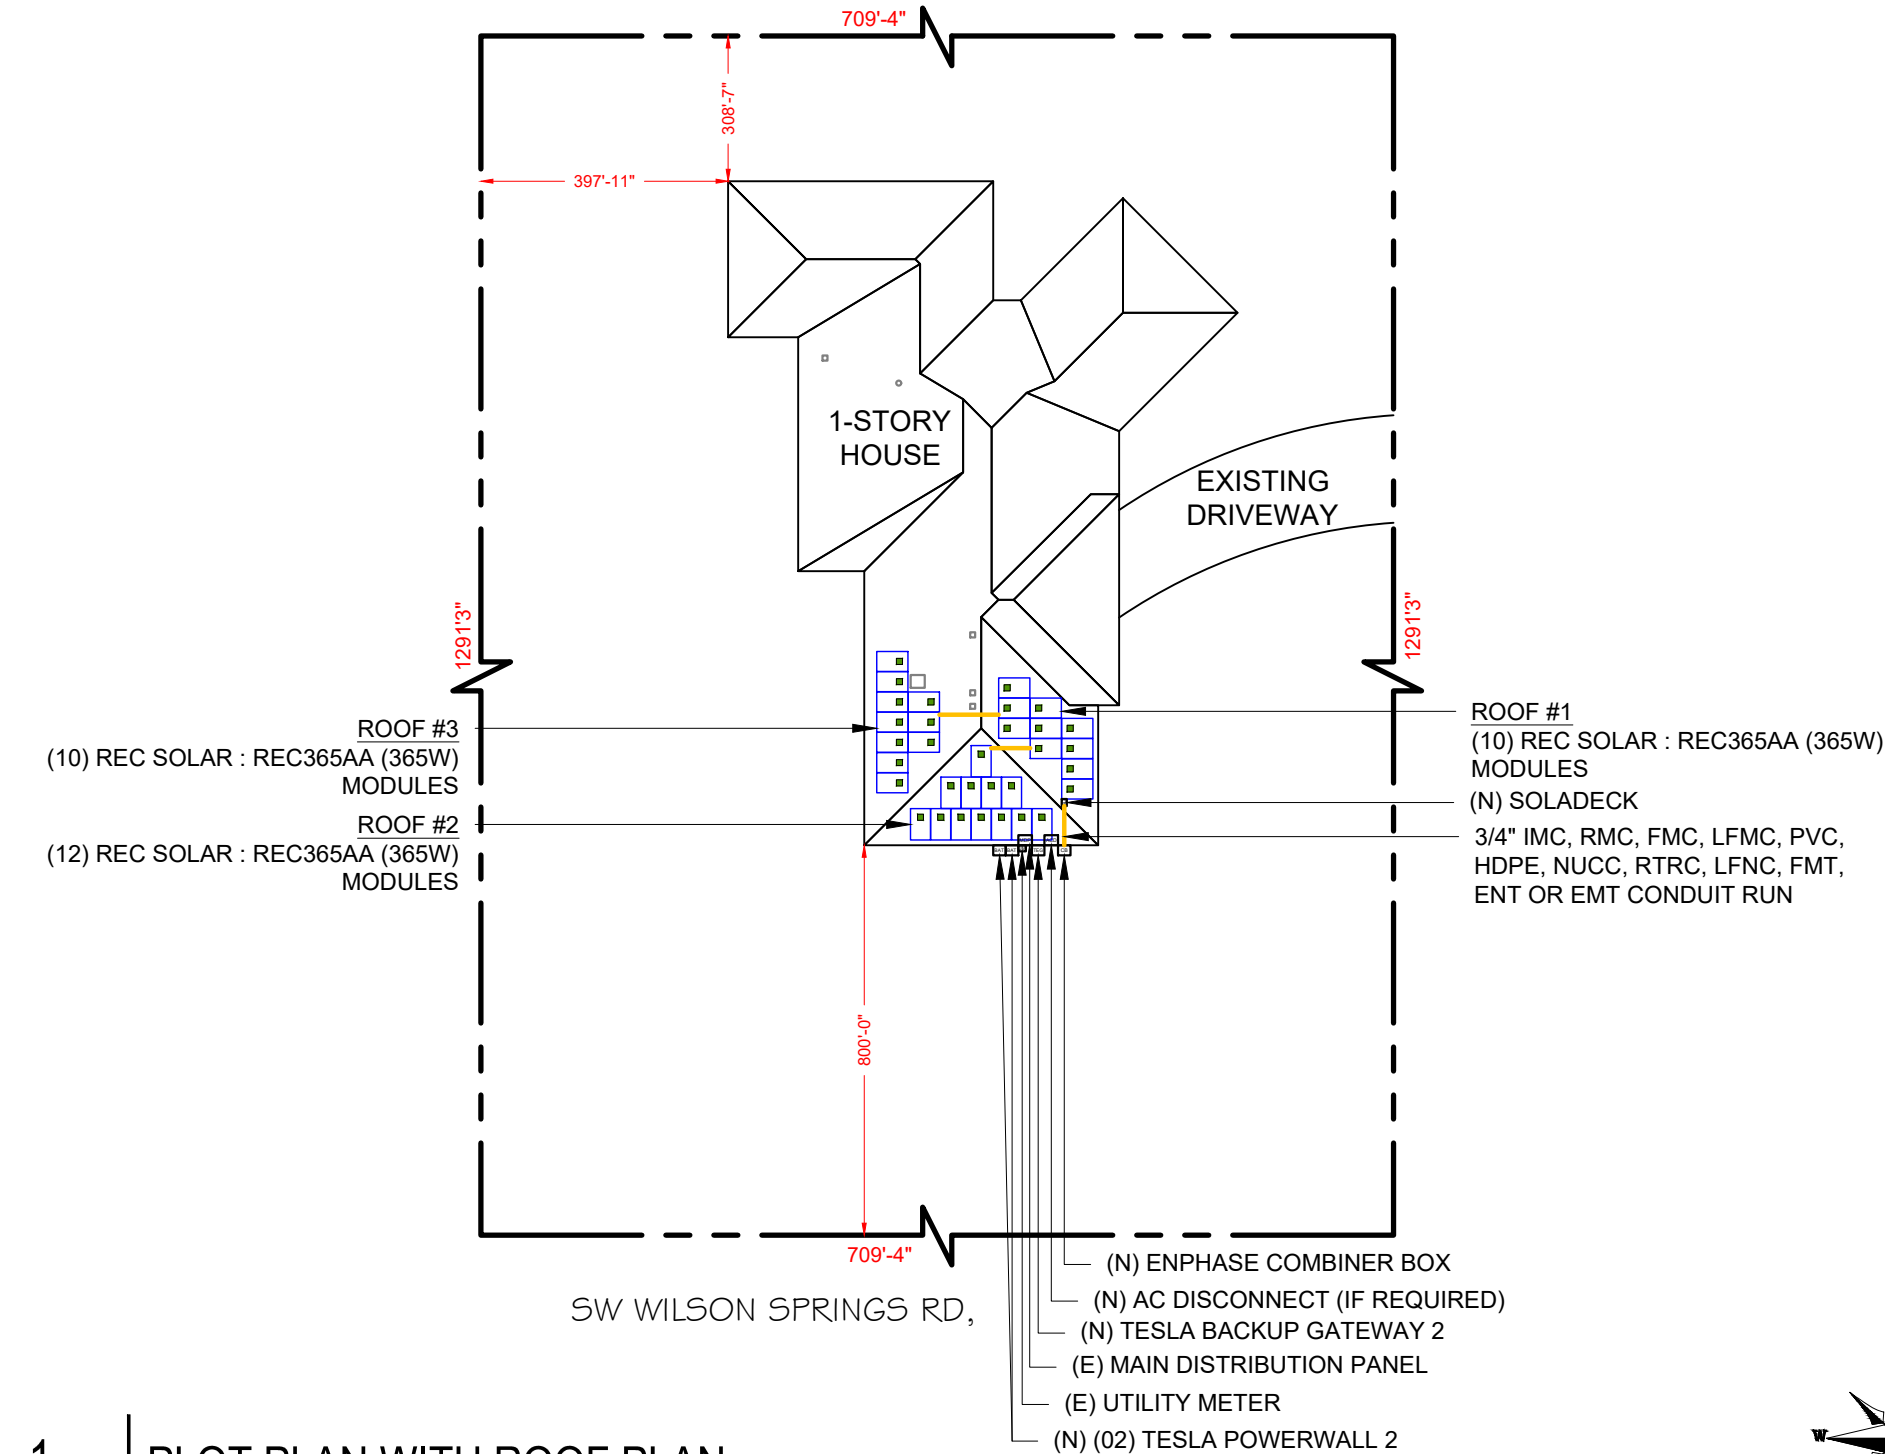

1 PLOT PLAN WITH ROOF PLAN

A-00


SCALE: 1/32" = 1'-0"



2 HOUSE PHOTO

A-00

SCALE: NTS

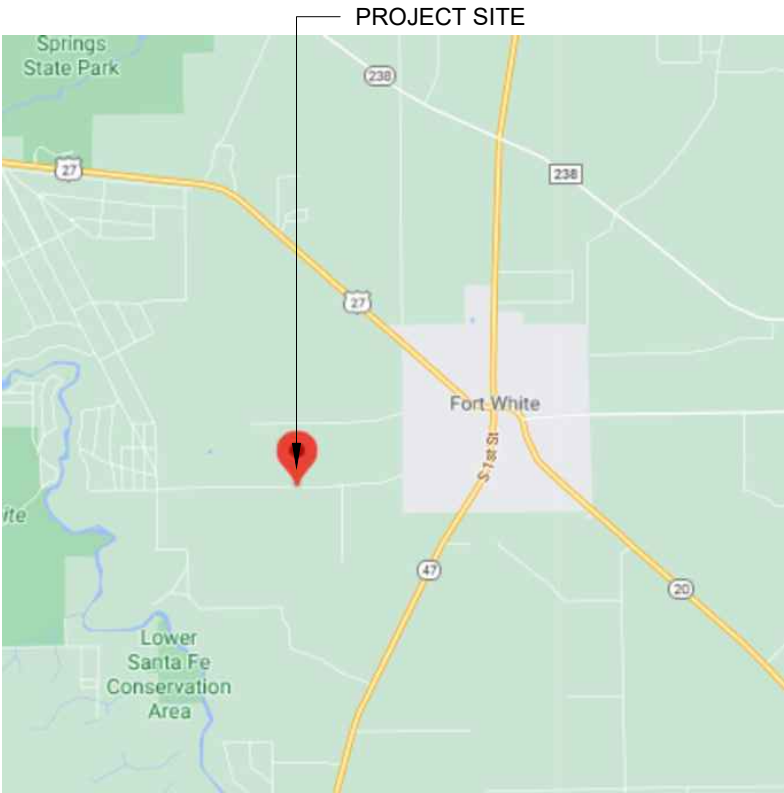

3 VICINITY MAP

A-00

SCALE: NTS



DESIGNED TO PERMIT:

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.03.29 17:54:15

PROJECT NAME

NICEWONGER RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

PLOT PLAN & VICINITY MAP

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

A-00


Symbols:

Section.....



Sheet where section is located


Elevation .....



Detail ID Letter

Sheet where section is located


Detail .....



Detail ID Letter

Sheet where section is located

Detail .....



Detail ID Letter

Area to be enlarged


Sheet where section is located

Keyed Notes .....


1

Keyed note designation on applicable sheet


Ground Terminal .....



Grounding Point/rod....



Solar Panel .....



or 00

Module with Source Circuit number

Combiner Box .....

CB


DC Disconnect .....

DCD


Main Distribution Panel .....

MDP


Fuse .....




Overcurrent Breaker ..



Inverter .....



Transformer .....



Automatic .....

ATS


Transfer Switch

Abbreviations:

AC	Alternating Current
APPROX	Approximate
AWG	American Wire Gauge
CB	Combiner Box
DC	Direct Current
DCD	Direct Current Disconnect
DISC	Disconnect
(E)	Existing
EL	Elevation
EQ	Equal
JB	Junction Box
MCB	Main Combiner Box
MFR	Manufacturer
MIN	Minimum
MISC	Miscellaneous
(N)	New
OCPD	OverCurrent Protection Device
POCC	Point Of Common Coupling
PV	Photovoltaic
SF	Squarefoot/feet
STC	Standard Test Conditions
TBD	To Be Determined
TYP	Typical
VIF	Verify In Field
WP	Weather Proof

System Description

This system is a grid-tied, PV system, with PV generation consisting of 32 REC SOLAR REC365AA (365W) MODULES with a combined STC rated dc output power of 11680W. The modules are connected into 32 ENPHASE IQ7PLUS-72-2-US MICROINVERTERS. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electric Code*

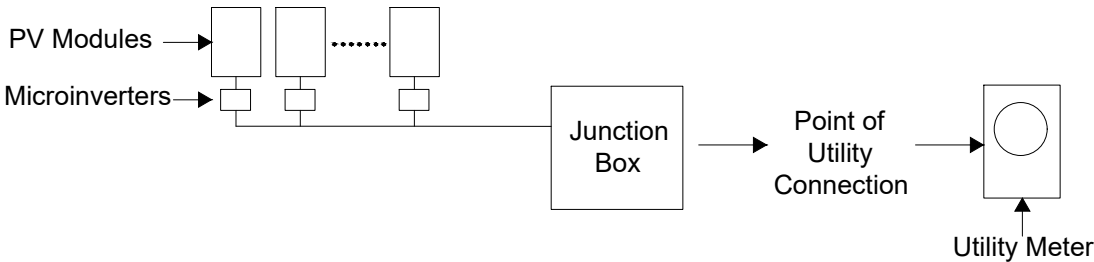

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

The inverter meets the requirements of IEEE 1547 and UL 1741. This means that if it detects a loss of utility power, it will automatically disconnect from the utility. When utility voltage is restored, the inverter automatically reconnects to the utility grid after verifying utility voltage and frequency stability.

On a day with average Florida sunshine, this system outputs 46.72 kWh per day on site.

REVISIONS

DESCRIPTION	DATE	REV


PROJECT INSTALLER

PROJECT NAME



MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 32 MODULES  
MODULE TYPE = REC SOLAR : REC365AA (365W) MODULES  
MODULE WEIGHT = 58.64 LBS / 26.6 KG.  
MODULE DIMENSIONS = 67.8"x 40" = 18.83 SF  
UNIT WEIGHT OF ARRAY = 3.11 PSF



ARRAY AREA & ROOF AREA CALC'S								
ROOF	ROOF TYPE	ARRAY AREA (sq.Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)	TILT	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	ASPHALT SHINGLE	188.33	372.83	50.51	22.6°	90°	2"x4"	24" o.c.
#2	ASPHALT SHINGLE	226.00	380.33	59.42	22.6°	180°	2"x4"	24" o.c.
#2	ASPHALT SHINGLE	188.33	974.47	19.33	22.6°	270°	2"x4"	24" o.c.

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO TRUSSES SHALL BE INSTALLED AS SHOWN IN SHEET S-02 AND AS FOLLOWS FOR EACH WIND ZONE:

WIND ZONES	NON - EXPOSED MODULES		EDGE / EXPOSED MODULES	
	SPAN	CANTILEVER	SPAN	CANTILEVER
ZONE 1	6' - 0"	1' - 4"	6' - 0"	1' - 4"
ZONE 1'	X	X	X	X
ZONE 2e	4' - 0"	1' - 4"	6' - 0"	1' - 4"
ZONE 2n	X	X	X	X
ZONE 2r	4' - 0"	1' - 4"	6' - 0"	1' - 4"
ZONE 3e	4' - 0"	1' - 4"	6' - 0"	1' - 4"
ZONE 3r	X	X	X	X

SEE SHEET S-02.1 FOR SUPPORTING CALCULATIONS.

2) EXISTING RESIDENTIAL BUILDING IS AN ASPHALT SHINGLE ROOF WITH MEAN ROOF HEIGHT IS 15 FT AND SYP 2"x4" ROOF TRUSSES SPACED 24" O.C. EXISTING ROOF SLOPE FOR SOLAR SYSTEM RETROFIT IS 22.6 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS.

\* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE LATERAL AND UPLIFT WIND LOADS AND EQUIPMENT DEAD LOADS. \*



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.03.29 17:54:16

PROJECT NAME

NICEWONGER RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

ROOF PLAN & MODULES

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER


S-01

1

ROOF PLAN & MODULES


S-01

SCALE: 1/16" = 1'-0"

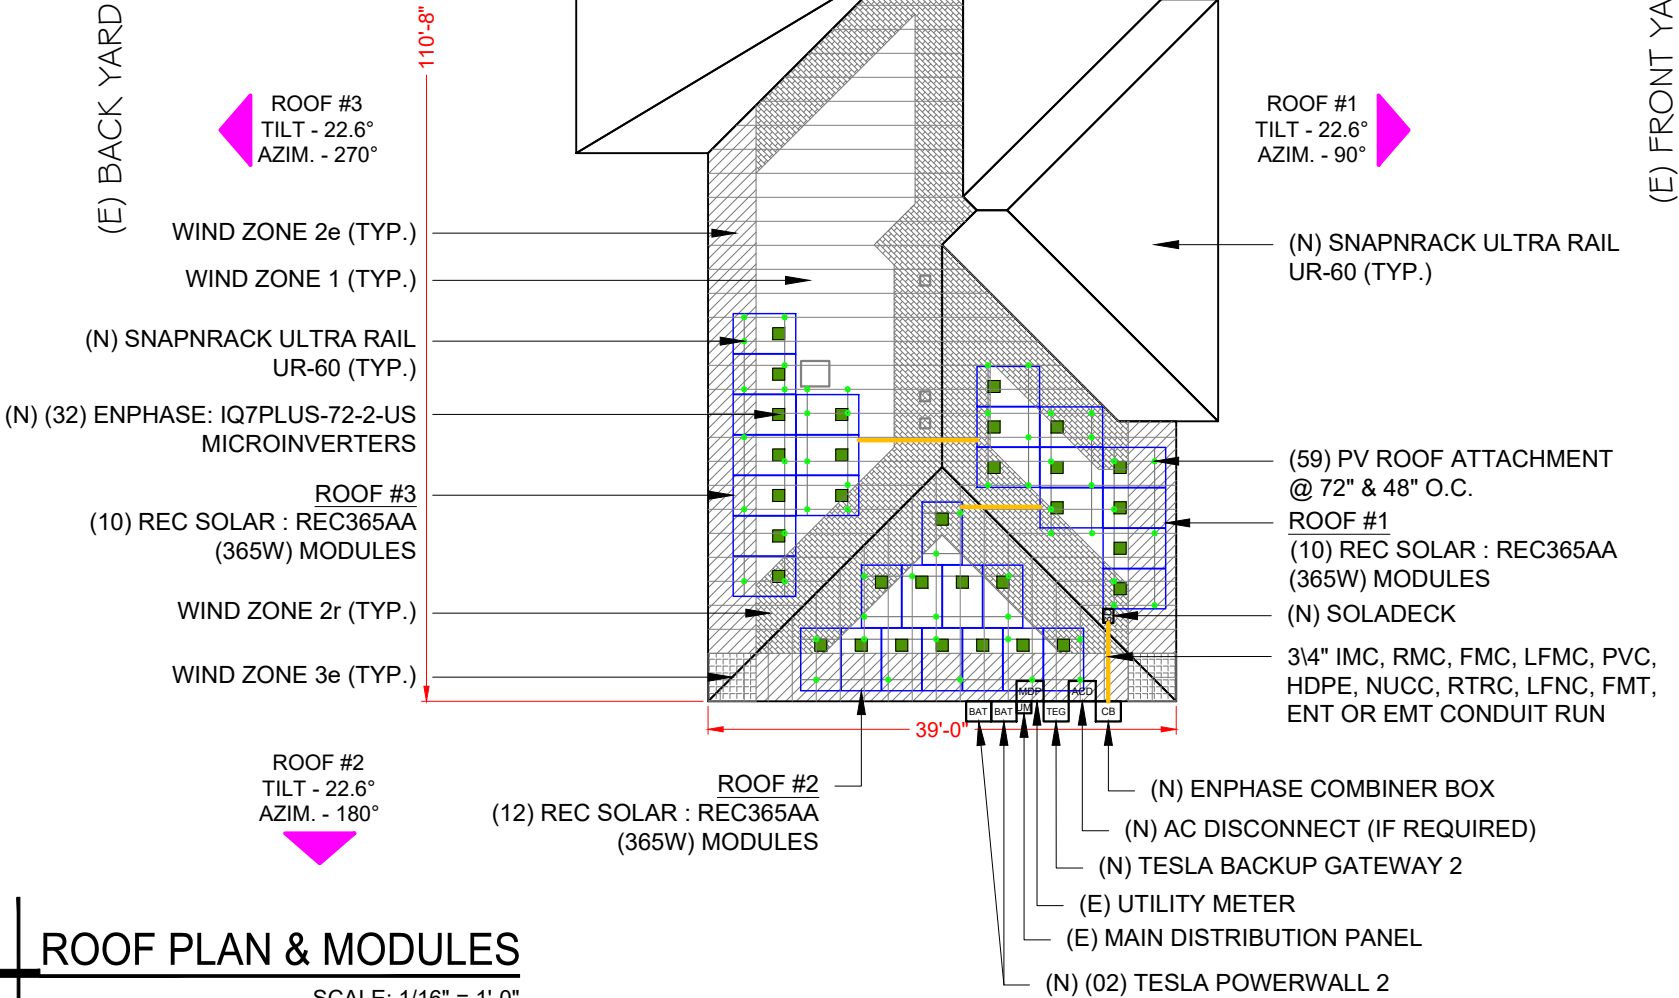


LEGEND

- TEG - TESLA BACKUP GATEWAY 2
- BAT - TESLA POWERWALL 2
- UM - UTILITY METER
- SD - SOLADECK
- ACD - AC DISCONNECT (IF REQUIRED)
- MDP - MAIN DISTRIBUTION PANEL
- □ - VENT, ATTIC FAN (ROOF OBSTRUCTION)
- - PV ROOF ATTACHMENT
- TRUSS
- CONDUIT
- CB - COMBINER BOX



(E) BACK YARD

(E) FRONT YARD

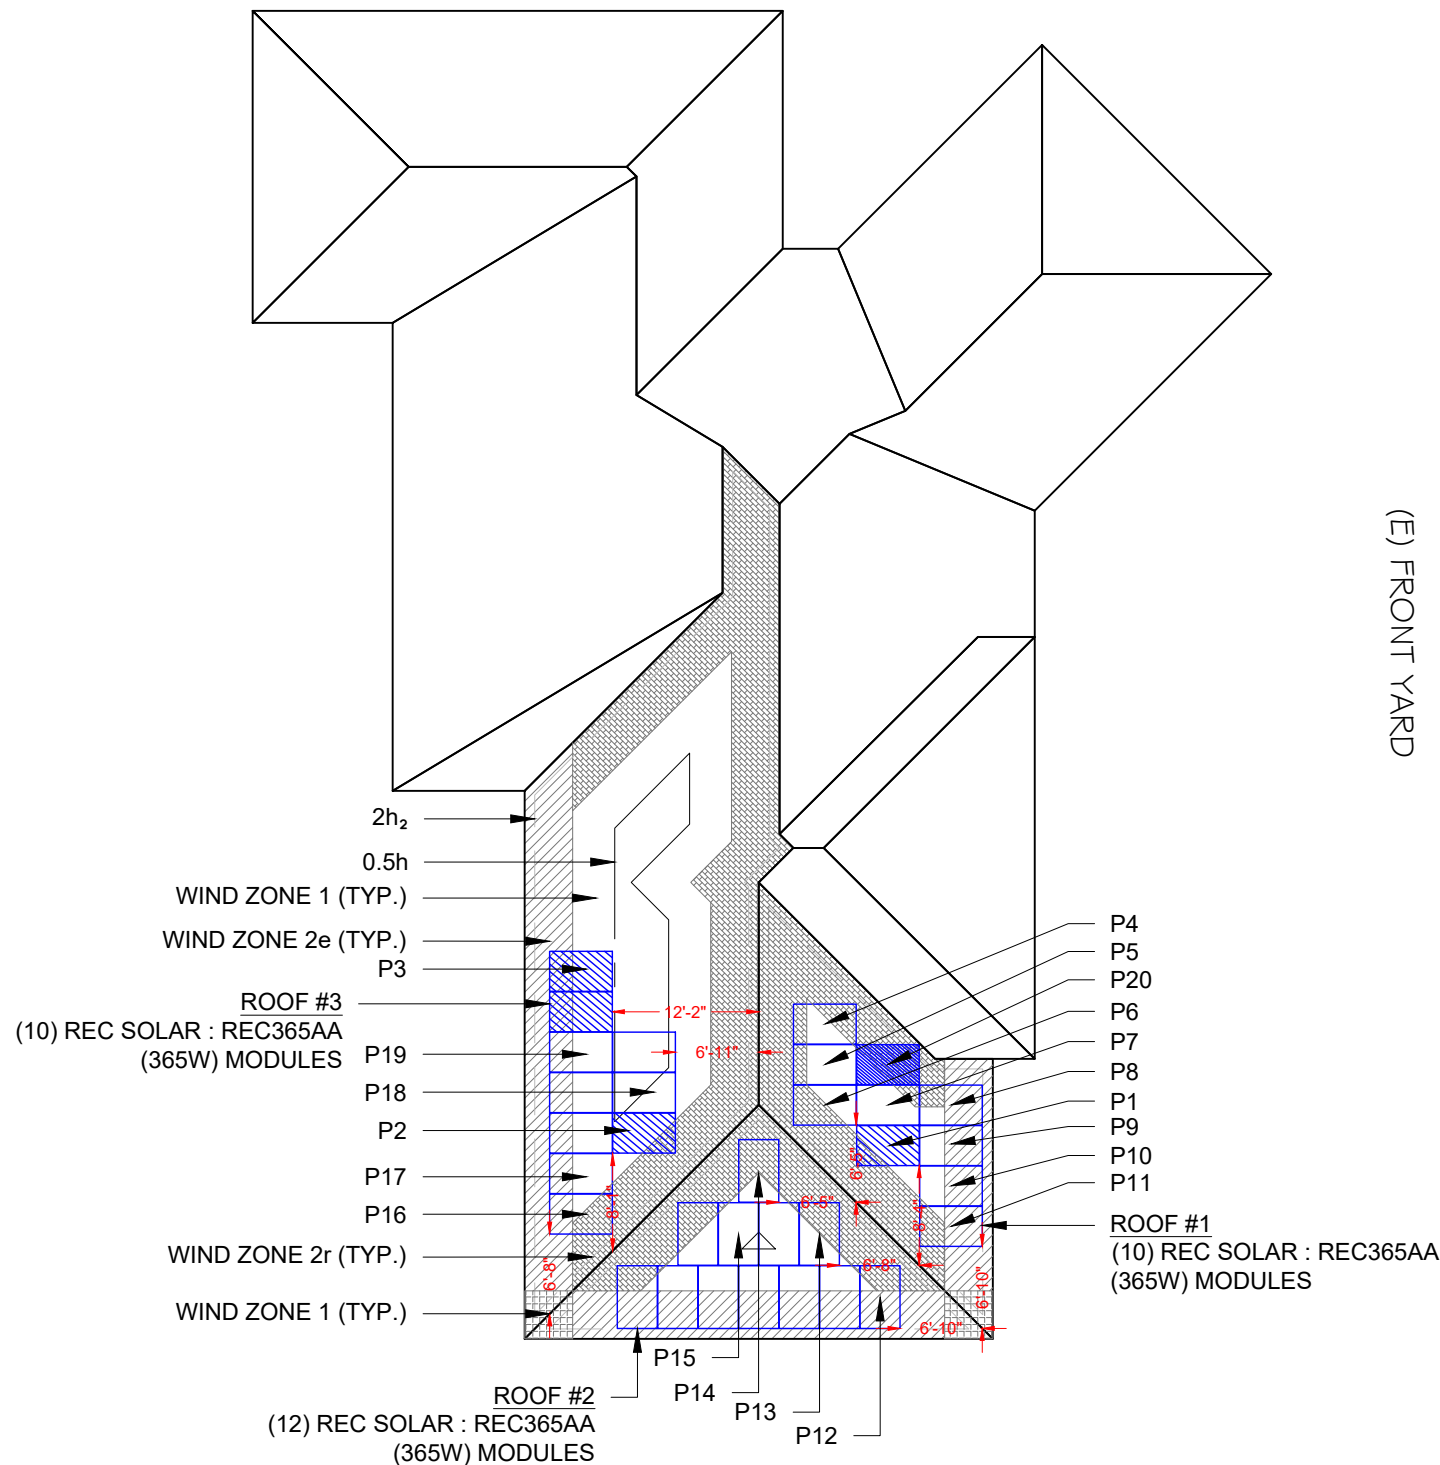

FOR EXPOSED MODULES						
1	1'	2e	2n	2r	3e	3r
26.9	0	37.4	0	37.4	37.4	0

Module Size 18.83 Sq. ft.

Exposed modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P1	15.30	0	0	0	3.53	0	0	28.87
P2	14.79	0	0	0	4.04	0	0	29.15
P3	11.92	0	6.91	0	0	0	0	30.75

FOR NON-EXPOSED MODULES						
1	1'	2e	2n	2r	3e	3r
17.9	0	24.9	0	24.9	24.9	0

Module Size 18.83 Sq. ft.

Non-Exposed modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P4	7.72	0	0	0	11.11	0	0	22.03
P5	14.83	0	0	0	4.00	0	0	19.39
P6	8.83	0	0	0	10.00	0	0	21.62
P7	16.38	0	0	0	2.45	0	0	18.81
P8	3.42	0	11.28	0	4.13	0	0	23.63
P9	7.55	0	11.28	0	0	0	0	22.09
P10	7.31	0	11.28	0	0.24	0	0	22.18
P11	1.03	0	11.28	0	6.52	0	0	24.52
P12	1.05	0	11.28	0	6.50	0	0	24.51
P13	9.60	0	0	0	9.23	0	0	21.33
P14	5.87	0	0	0	12.96	0	0	22.72
P15	18.44	0	0	0	0.39	0	0	18.04
P16	3.15	0	6.91	0	8.76	0	0	23.73
P17	11.53	0	6.91	0	0.39	0	0	20.61
P18	18.83	0	0	0	0	0	0	17.90
P19	11.92	0	6.91	0	0	0	0	20.47

FOR EDGE MODULES						
1	1'	2e	2n	2r	3e	3r
26.9	0	37.4	0	37.4	37.4	0

Module Size 18.83 Sq. ft.

Edge Modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P20	4.94	0	0	0	13.89	0	0	34.65

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAIL: 75 PSF

NOTE : PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

2h<sub>2</sub> DISTANCE : 0' - 10"  
0.5h DISTANCE : 7' - 6"

LEGEND	
	- EXPOSED MODULE
	- NON- EXPOSED MODULE
	- EDGE MODULE
	- MIN. MODULE EDGE DISTANCE LINE
	- MODULE EXPOSURE LINE

Castillo Engineering

DESIGNED TO PERMIT  
CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV


PROJECT INSTALLER  
**POWER**  
PRODUCTION MANAGEMENT, INC.  
Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.03.29 17:54:17

PROJECT NAME  
**NICEWONGER RESIDENCE**  
1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME  
PARTIAL PRESSURE AND  
MODULES EXPOSURE

SHEET SIZE  
**ANSI B**  
11" X 17"

SHEET NUMBER  
**S-01.1**

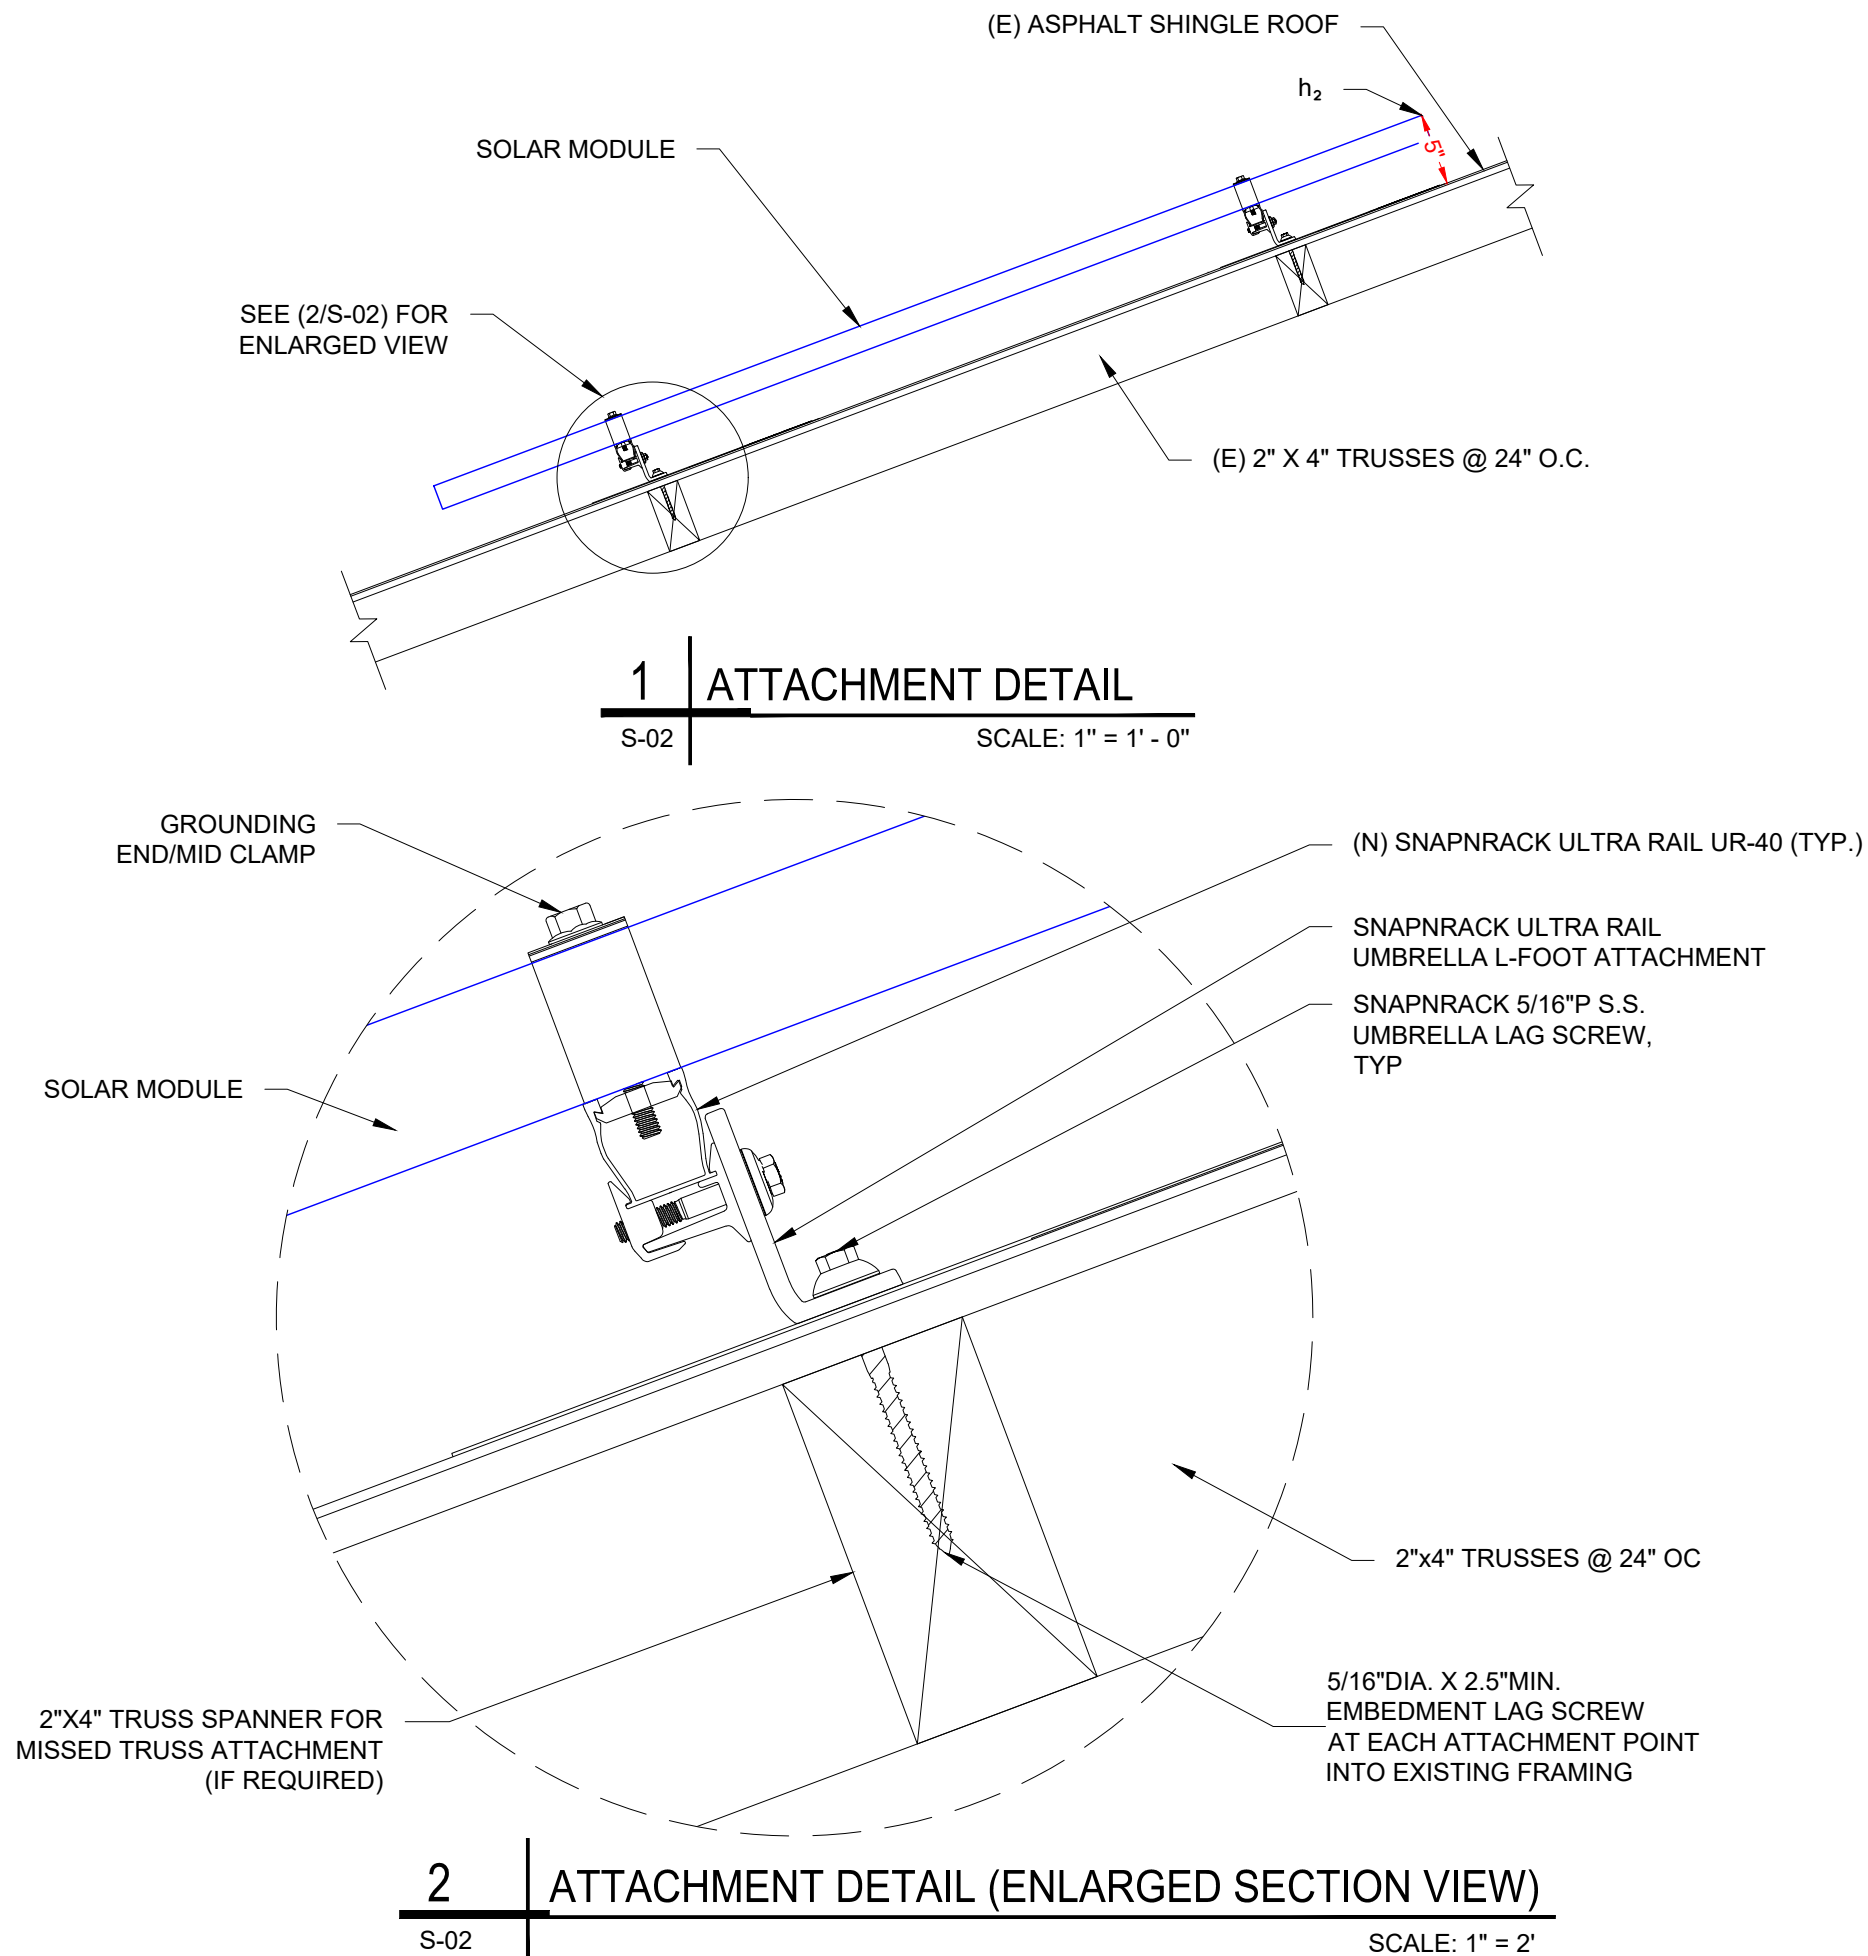

Castillo

Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250,

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER

PRODUCTION MANAGEMENT, INC.

Digitally signed by: Ermocrates E Castillo

Date: 2021.03.29 17:54:17

PROJECT NAME

NICEWONGER RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

STRUCTURAL ATTACHMENT DETAILS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02



REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:18

PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME  
STRUCTURAL  
ATTACHMENT  
DETAILS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02.1

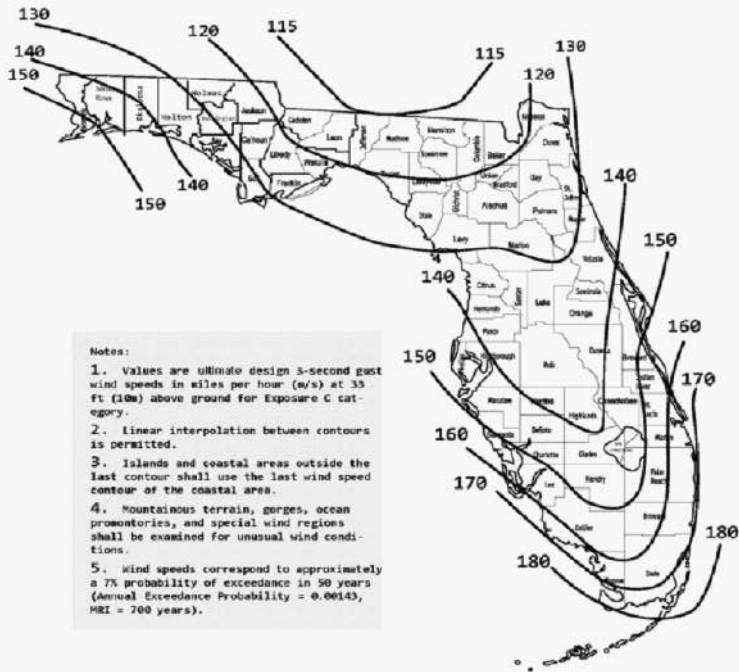



FIGURE 1609.3(1)  
ULTIMATE DESIGN WIND SPEEDS,  $V_{ULT}$ , FOR RISK CATEGORY II BUILDINGS AND OTHER STRUCTURES

WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	15.0	EXPOSURE CATEGORY	B
ROOF LENGTH (ft)	110.8	ROOF SLOPE	5 /12
ROOF WIDTH (ft)	39.0	ROOF SLOPE (°)	22.6
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	HIP
MODULE LENGTH (in)	67.8	ULTIMATE WIND SPEED	130 mph
MODULE WIDTH (in)	40.00	NOMINAL WIND SPEED	101 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR ( $C_e$ )	1.000
MODULE AREA (sq. ft)	18.83	TEMPERATURE FACTOR ( $C_t$ )	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR ( $I_s$ )	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR ( $C_s$ )	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	$K_D$	0.850
EFFECTIVE WIND AREA (ft <sup>2</sup> )	18.8	$K_{ZT}$	1.000
GROUND ELEVATION (ft)	51.0	$K_e$	0.998
HVHZ	NO	$K_z$	0.575


DESIGN CALCULATIONS			
VELOCITY PRESSURE ( $q$ ) = $.00256 \cdot K_e K_{ZT} K_D V^2$			
VELOCITY PRESSURE(ASD) 12.7 psf			
WIDTH OF PRESSURE COEFFICIENT	39' * 10%	=	3.9'
	15' * 40%	=	6'
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	0.590	-1.235
	ZONE 1'	0.590	X
	ZONE 2e	0.590	-1.789
	ZONE 2n	0.590	X
	ZONE 2r	0.590	-1.789
	ZONE 3e	0.590	-1.789
	ZONE 3r	0.590	X
INTERNAL PRESSURE COEFFICIENT (+/-) 0.18			

DESIGN PRESSURES						
ROOF ZONE	DOWN	UP				
1	16.0	-17.9	psf			
1'	16.0	X	psf			
2e	16.0	-24.9	psf	Module allowable uplift pressure	75	psf
2n	16.0	X	psf	Module allowable down pressure	76	psf
2r	16.0	-24.9	psf			
3e	16.0	-24.9	psf			
3r	16.0	X	psf			
ARRAY FACTORS						
ARRAY EDGE FACTOR (EXPOSED)		1.5	SOLAR PANEL PRESSURE		0.69003	
ARRAY EDGE FACTOR (NON-EXPOSED)		1	EQUALIZATION FACTOR			
ADJUSTED DESIGN PRESSURES						
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)			
1	16.0	-28.9	-17.9	psf		
1'	16.0	X	X	psf		
2e	16.0	-37.4	-24.9	psf		
2n	16.0	X	X	psf		
2r	16.0	-37.4	-24.9	psf		
3e	16.0	-37.4	-24.9	psf		
3r	16.0	X	X	psf		
ATTACHMENTS USED						
ATTACHMENT MODEL		Lag Bolts- Shingle				
ATTACHMENT STRENGTH		476 lbs				
MAX DESIGN LOADS ALLOWABLE						
LIMIT MAX SPAN TO		N/A	in			
RAFTER/SEAM SPACING		24	in	NUMBER OF RAILS		2
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)	SPANS (E)		SPANS (N.E)
1	271.2	455.4	303.6	lbs	72 in	72 in
1'	0.0	X	X	lbs	X in	X in
2e	271.2	422.4	422.4	lbs	48 in	72 in
2n	0.0	X	X	lbs	X in	X in
2r	271.2	422.4	422.4	lbs	48 in	72 in
3e	271.2	422.4	422.4	lbs	48 in	72 in
3r	0.0	X	X	lbs	X in	X in

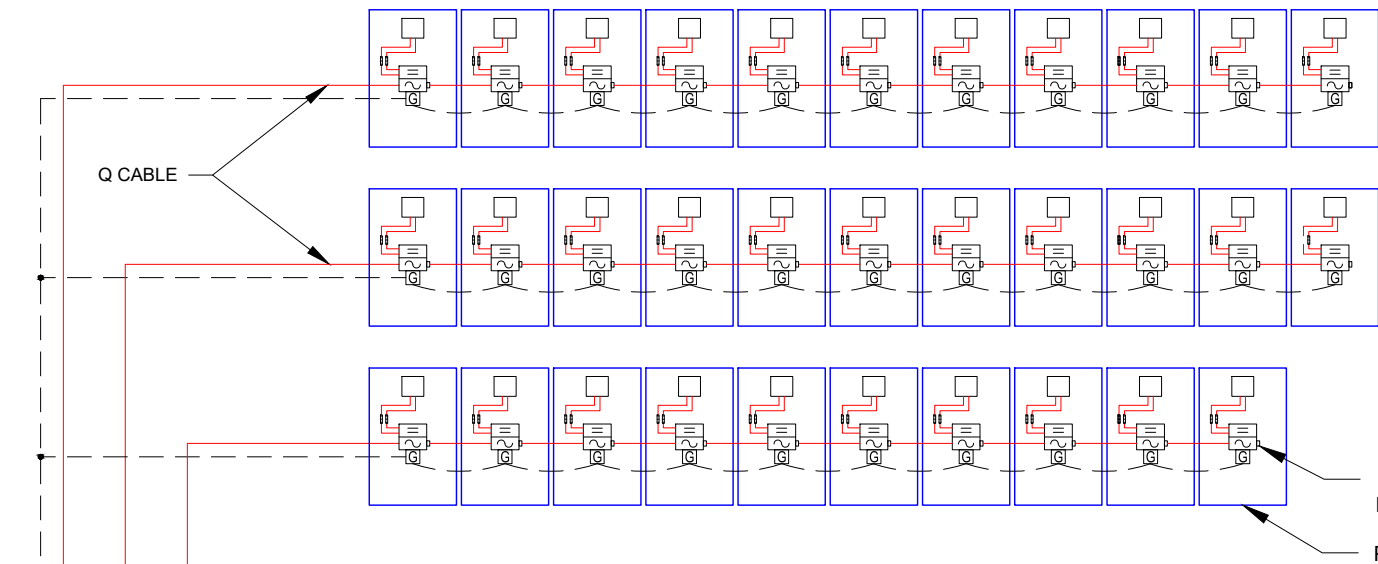

ENPHASE: IQ7PLUS-72-2-US  
MICROINVERTERS


PV MODULES

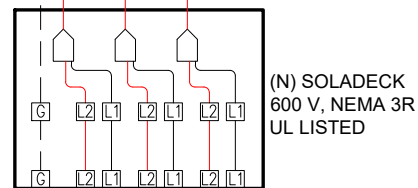


(N) SOLADECK  
600 V, NEMA 3R  
UL LISTED

(3) 10/2 NM-C RUN IN DRY  
INTERIOR LOCATION  
OR  
(3) #10 AWG THWN-2 - RED  
(3) #10 AWG THWN-2 - BLACK  
EGC #10 AWG THWN-2  
IN 3/4" PVC, IMC, RMC, FMC,  
LFMC, HDPE, NUCC, RTRC,  
LFNC, EMT, FMT, OR ENT  
CONDUIT RUN

(N) 125A ENPHASE IQ COMBINER 3  
(X-IQ-AM1-240-3) [WITH UPTO (4)  
2-POLE BREAKERS AND ENVOY  
COMMUNICATION GATEWAY]

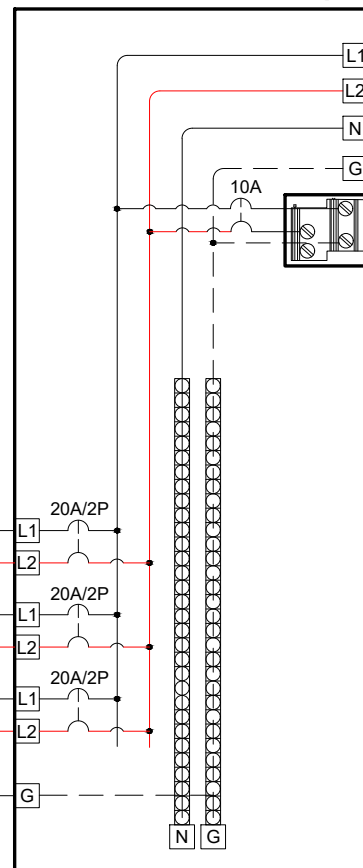

(N) AC DISCONNECT:  
240V, 60AMP, RATE  
NEMA 3R, UL LISTED  
LOCKABLE & NON-FUSIBLE  
(IF REQUIRED)




(3) #8 AWG THWN-2  
(1) #10 AWG THWN-2 GND  
IN 3/4" PVC, IMC, RMC, FMC,  
LFMC, HDPE, NUCC, RTRC,  
LFNC, EMT, FMT, OR ENT  
CONDUIT RUN

(N) (02) TESLA POWERWALL 2  
5kW CONTINUOUS POWER  
13.5kWh STORAGE

(3) #10 AWG THWN  
(1) #10 AWG THWN-2 GND  
IN 3/4" IMC, RMC, FMC, LFMC,  
PVC, HDPE, NUCC, RTRC,  
LFNC, FMT, ENT, OR EMT  
CONDUIT RUN

TO UTILITY GRID



(2) #2/0 AWG THWN-2 CU  
(1) #2/0 AWG THWN-2 CU NEUTRAL  
IN 1-1/2" IMC, RMC, FMC, LFMC,  
PVC, HDPE, NUCC, RTRC,  
LFNC, FMT, ENT OR EMT CONDUIT  
RUN

(N) MAIN SERVICE  
DISCONNECT, 200A/2P, 240V.

(N) 200A TESLA POWERWALL  
BACKUP GATEWAY 2 AUTOMATIC  
TRANSFER SWITCH  
MICROGRID INTERCONNECT DEVICE  
UL LISTED, SER RATED

NEW OR REROUTED  
EXISTING GROUNDING  
ELECTRODE SYSTEM

(2) #2/0 AWG THWN-2 CU  
(1) #2/0 AWG THWN-2 CU NEUTRAL  
(1) #4 AWG THWN-2 CU GND  
IN 2" IMC, RMC, FMC, LFMC,  
PVC, HDPE, NUCC, RTRC,  
LFNC, FMT, ENT OR EMT CONDUIT  
RUN

(N) MAIN BREAKER,  
200A/2P, 240V.

(E) MAIN DISTRIBUTION PANEL,  
225A RATED, 240V

SOLAR ARRAY (11.680 kW-DC STC)

(32) REC SOLAR : REC365AA (365W) MODULES

(02) BRANCH OF 11 MODULES

(01) BRANCH OF 10 MODULES

**NOTE:**

1. SUBJECT PV SYSTEMS HAS BEEN DESIGNED TO MEET THE REQUIREMENTS OF THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION, INCLUDING MAXIMUM NUMBER OF MODULE STRINGS, MAXIMUM NUMBER OF MODULES PER STRING, MAXIMUM OUTPUT, MODULE MANUFACTURER AND MODEL NUMBER, INVERTER MANUFACTURER AND MODEL NUMBER, AS APPLICABLE.  
2. MID INTERCONNECTION PER 705.12(A) & 705.170, AND COMPLIANT WITH NEC 690.10 AND 690.71.

**Castillo**  
Engineering

DESIGNED TO PERMIT

**CASTILLO ENGINEERING  
SERVICES, LLC**

COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751

TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

**REVISIONS**

DESCRIPTION	DATE	REV

**PROJECT INSTALLER**

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:18

**PROJECT NAME**

**NICEWONGER  
RESIDENCE**

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

**SHEET NAME**

**ELECTRICAL  
LINE DIAGRAM**

**SHEET SIZE**

**ANSI B  
11" X 17"**

**SHEET NUMBER**

**E-01**



AC CONDUCTOR AMPACITY CALCULATIONS:  
FROM ROOF TOP SOLADECK TO LOAD CENTER

MODULE MANUFACTURER	REC SOLAR
MODULE MODEL	REC365AA BLACK
INVERTER MANUFACTURER	ENPHASE
INVERTER MODEL	ENPHASE IQ 7 PLUS
MODULES/BRANCH CIRCUIT 1	10
MODULES/BRANCH CIRCUIT 2	11
MODULES/BRANCH CIRCUIT 3	11
TOTAL ARRAY POWER (KW)	11.68
SYSTEM AC VOLTAGE	240V 1-PHASE

DESIGN TEMPERATURE	
MIN. AMBIENT TEMP. °F	32
MAX. AMBIENT TEMP. °F	117
CALCULATED MAX. VOC	48
CALCULATED MIN VMP	29
CONDUIT FILL	
NUMBER OF CONDUITS	1

AMPACITY CALCULATIONS										
CIRCUIT	MAX AMP'S	1.25 x MAX AMP'S	AWG	90 °C AMPACITY	AMBIENT TEMP °F	TEMP DERATE	CONDUIT FILL	FILL DERATE	DERATED AMPACITY	MAXIMUM CIRCUIT BREAKER
CIRCUIT 1	12.1	15.1	#10	40	130	0.76	6	0.8	24.32	20 A
CIRCUIT 2	13.3	16.6	#10	40	130	0.76	6	0.8	24.32	20 A
CIRCUIT 3	13.3	16.6	#10	40	130	0.76	6	0.8	24.32	20 A
TESLA POWERWALL 1	22.0	27.5	#10	40	95	0.96	3	1	38.4	30 A
TESLA POWERWALL 2	22.0	27.5	#10	40	95	0.96	3	1	38.4	30 A
AC COMBINER PANEL OUTPUT	38.7	48.3	#8	55	95	0.96	3	1	52.8	50 A
TESLA GATEWAY OUTPUT	82.7	103.3	2/0	PER 2017 NEC 310.15.(B).(7)						110 A

MAXIMUM CIRCUIT VOLTAGE DROP	2%
------------------------------	----

VOLTAGE DROP CALCULATIONS					
CIRCUIT	AWG	CIRCULAR MILLS	I	V	MAX LENGTH
CIRCUIT 1	#10	10380	12.1	240	160 FEET
CIRCUIT 2	#10	10380	13.3	240	145 FEET
TESLA POWERWALL 1	#10	10380	22.0	240	88 FEET
TESLA POWERWALL 2	#10	10380	22.0	240	88 FEET
COMBINER PANEL OUTPUT	#8	16510	38.7	240	79 FEET
TESLA GATEWAY OUTPUT	2/0	133100	82.7	240	300 FEET

NOTES	
	TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)
	CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)
	MAXIMUM VOC CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A)
	UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER
	ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE
	IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS
	IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION
	INFORMATION INPUT BY SYSTEM DESIGNER
	INFORMATION OBTAINED FROM MANUFACTURER DATASHEETS

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107.

AC CONDUCTOR AMPACITY CALCULATIONS:  
FROM AC COMBINER BOX TO MSP

MODULE PROPERTIES			
VOC	44	ISC	10.52
VMPP	37.1	IMP	9.85
TC VOC	-0.24%/°C	TC VMP	-0.26%/°C
PMP	365.0	NOCT	45 °C

INVERTER PROPERTIES	
OUTPUT VOLTAGE	240 L-L 1-PH
MAX INPUT DC VOLTAGE	60 VDC
OPERATING RANGE	16 - 60 VDC
MPPT VOLTAGE RANGE	27 - 45 VDC
START VOLTAGE	22 VDC
MAX INPUT POWER	440 WDC
CONTINUOUS AC POWER	290 VA

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
- THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEBB LUG OR ILSKO GBL-4DBT LAY-IN LUG.
- THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
- UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
- MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
- RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
- CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
- CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).

ENPHASE IQ7PLUS-72-2-US MICROINVERTER		
Input Data (DC)		
	Recommended Input Power (STC)	235-440W +
	Maximum Input DC Voltage	60V
	Peak Power Tracking Voltage	27V-45V
	Operating Range	16V-60V
	Min. / Max. Start Voltage	22V / 60V
	Max DC Short Circuit Current	15A
Output Data (AC)		
	Maximum Output Power	290W
	Nominal Output Current	1.21A
	Nominal Voltage / Range	240V/211-264V
	Nominal Frequency / Range	60 Hz
	Extended Frequency / Range	47-68 Hz
	Power Factor at rated power	1.0
	Maximum unit per 20A Branch Circuit	13 (240 VAC)

ELECTRICAL NOTES



DESIGNED TO PERMIT\*

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.03.29 17:54:19

PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

WIRING  
CALCULATIONS


SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

E-02





**WARNING**

**ELECTRIC SHOCK HAZARD**  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.13(B))



**WARNING DUAL POWER SOURCE**

**SECOND SOURCE IS PHOTOVOLTAIC SYSTEM**

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

**RAPID SHUTDOWN  
SWITCH FOR  
SOLAR PV SYTEM**

LABEL LOCATION:  
AC DISCONNECT  
(PER CODE: NEC690.56(C)(3))

- ADHESIVE FASTENED SIGNS:
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
  - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].
    - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

**PHOTOVOLTAIC SYSTEM AC DISCONNECT**  
RATED AC OPERATING CURRENT **82.7 AMPS**  
AC NOMINAL OPERATING VOLTAGE **240 VOLTS**

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC690.54)

**WARNING**

**INVERTER OUTPUT CONNECTION DO NOT  
RELOCATE THIS OVERCURRENT DEVICE**

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))


DATA PER PANEL

NOMINAL OPERATING AC VOLTAGE -	240	V
NOMINAL OPERATING AC FREQUENCY-	60	Hz
MAXIMUM AC POWER-	290	VA
MAXIMUM AC CURRENT-	1.21	A
MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION PER CIRCUIT-	20	A

LABEL LOCATION:  
COMBINER BOX  
(PER CODE: NEC690.52)

**SOLAR PV SYSTEM EQUIPPED  
WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN  
SWITCH TO THE  
"OFF" POSITION TO  
SHUT DOWN PV SYSTEM  
AND REDUCE  
SHOCK HAZARD  
IN THE ARRAY



LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.56(C)(1)(a), IFC 605.11.3.1(1))

**WARNING:**

**THIS EQUIPMENT FED BY MULTIPLE  
SOURCES. TOTAL RATING OF ALL  
OVERCURRENT DEVICES, EXCLUDING  
MAIN SUPPLY OVERCURRENT DEVICE,  
SHALL NOT EXCEED AMPACITY OF BUSBAR**

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(e))

**Castillo**  
Engineering

DESIGNED TO PERMIT:


**CASTILLO ENGINEERING  
SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:19

PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

SYSTEM  
LABELING

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

E-03




# REC ALPHA SERIES


380 W<sub>P</sub> POWER  
20 YEAR PRODUCT WARRANTY  
25 YEAR POWER OUTPUT WARRANTY

**α**  
recgroup.com/alpha

SOLAR'S MOST TRUSTED

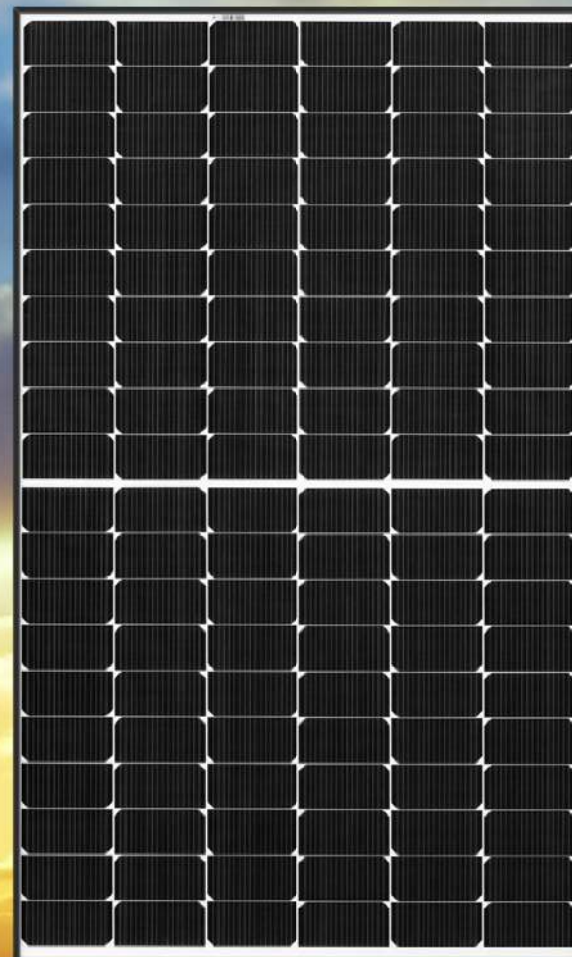

## REC ALPHA SERIES PRODUCT DATASHEET

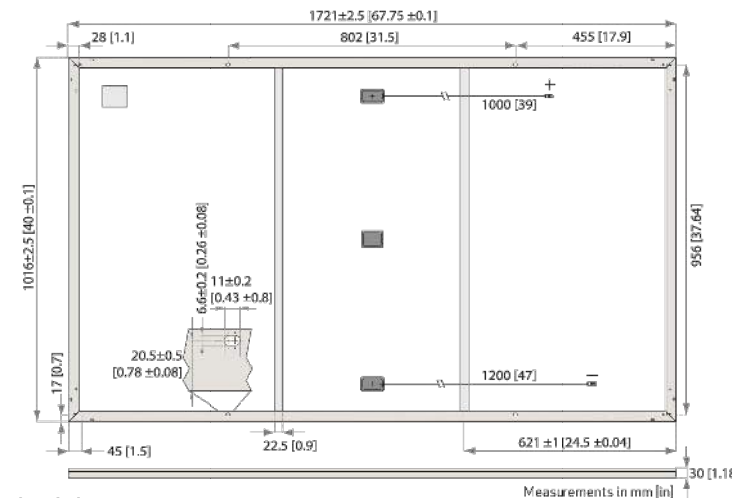

### GENERAL DATA

Cell type:	120 half-cut cells with REC heterojunction cell technology 6 strings of 20 cells in series	Junction box:	3-part 3 bypass diodes, IP67 rated in accordance with IEC 62790
Glass:	0.13 in (3.2 mm) solar glass with anti-reflection surface treatment	Cable:	12 AWG (4 mm <sup>2</sup> ) PV wire, 39 + 47 in (1 + 1.2 m) in accordance with EN 50618
Backsheet:	Highly resistant polymeric construction	Connectors:	Stäubli MC4 PV-KBT4/KST4, 12 AWG (4 mm <sup>2</sup> ) in accordance with IEC 62852 IP68 only when connected
Frame:	Anodized aluminum (black)	Origin:	Made in Singapore

### ELECTRICAL DATA @ STC

	360	365	370	375	380
Nominal Power - P <sub>MPP</sub> (Wp)	360	365	370	375	380
Watt Class Sorting - (W)	-0/+5	-0/+5	-0/+5	-0/+5	-0/+5
Nominal Power Voltage - V <sub>MPP</sub> (V)	37.7	38.0	38.3	38.7	39.0
Nominal Power Current - I <sub>MPP</sub> (A)	9.55	9.60	9.66	9.72	9.76
Open Circuit Voltage - V <sub>OC</sub> (V)	44.1	44.3	44.5	44.6	44.7
Short Circuit Current - I <sub>SC</sub> (A)	10.23	10.26	10.30	10.40	10.46
Panel Efficiency (%)	20.6	20.9	21.2	21.4	21.7

Values at standard test conditions (STC): air mass AM 1.5, irradiance 1075 W/sq ft (1000 W/m<sup>2</sup>), temperature 77°F (25°C), based on a production spread with a tolerance of V<sub>OC</sub> & I<sub>SC</sub> ±3% within one watt class. \* Where xxx indicates the nominal power class (P<sub>MPP</sub>) at STC above.

### ELECTRICAL DATA @ NMOT

	274	278	282	286	290
Nominal Power - P <sub>MPP</sub> (Wp)	274	278	282	286	290
Nominal Power Voltage - V <sub>MPP</sub> (V)	35.5	35.8	36.1	36.4	36.7
Nominal Power Current - I <sub>MPP</sub> (A)	7.71	7.76	7.80	7.85	7.88
Open Circuit Voltage - V <sub>OC</sub> (V)	41.6	41.7	41.9	42.0	42.1
Short Circuit Current - I <sub>SC</sub> (A)	8.26	8.29	8.32	8.40	8.45

Nominal module operating temperature (NMOT): air mass AM 1.5, irradiance 800 W/m<sup>2</sup>, temperature 68°F (20°C), windspeed 3.3 ft/s (1 m/s). \* Where xxx indicates the nominal power class (P<sub>MPP</sub>) at STC above.

### CERTIFICATIONS

IEC 61215:2016, IEC 61730:2016, UL 1703, UL 61730	
IEC 62804	PID
IEC 61701	Salt Mist
IEC 62716	Ammonia Resistance
UL 1703	Fire Type Class 2
IEC 62782	Dynamic Mechanical Load
IEC 61215-2:2016	Hailstone (35mm)
AS4040.2 NCC 2016	Cyclic Wind Load
ISO 14001:2004, ISO 9001:2015, OHSA 18001:2007	



### WARRANTY

20 year product warranty  
25 year linear power output warranty  
Maximum annual power degradation of 0.25% p.a.  
Guarantees 92% of power after 25 years  
See warranty conditions for further details.

### MECHANICAL DATA

Dimensions:	67.9 x 40 x 1.2 in (1721 x 1016 x 30 mm)
Area:	18.8 sq ft (1.75 m <sup>2</sup> )
Weight:	43 lbs (19.5 kg)

### MAXIMUM RATINGS

Operational temperature:	-40 ... +85°C
Maximum system voltage:	1000 V
Design load (+): snow	4666 Pa (97.5 lbs/sq ft)*
Maximum test load (+):	7000 Pa (146 lbs/sq ft)*
Design load (-): wind	2666 Pa (55.6 lbs/sq ft)*
Maximum test load (-):	4000 Pa (83.5 lbs/sq ft)*
Max series fuse rating:	25 A
Max reverse current:	25 A

\* Calculated using a safety factor of 1.5  
\* See installation manual for mounting instructions


### TEMPERATURE RATINGS\*

Nominal Module Operating Temperature:	44°C (±2°C)
Temperature coefficient of P <sub>MPP</sub> :	-0.26 %/°C
Temperature coefficient of V <sub>OC</sub> :	-0.24 %/°C
Temperature coefficient of I <sub>SC</sub> :	0.04 %/°C

\* The temperature coefficients stated are linear values

### LOW LIGHT BEHAVIOUR

Typical low irradiance performance of module at STC:

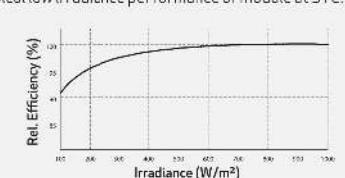

Specifications subject to change without notice.

Ref: PM-DS-12-01-Rev-B-08.19

Castillo  
Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER

POWER  
PRODUCTION MANAGEMENT, INC.

Digitally  
Signed by:  
Ermocrates  
Castillo  
Date:  
2021.03.29  
17:54:20

### PROJECT NAME

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

NICEWONGER  
RESIDENCE

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-01

Founded in Norway in 1996, REC is a leading vertically integrated solar energy company. Through integrated manufacturing from silicon to wafers, cells, high-quality panels and extending to solar solutions, REC provides the world with a reliable source of clean energy. REC's renowned product quality is supported by the lowest warranty claims rate in the industry. REC is a Bluestar Elkem company with headquarters in Norway and operational headquarters in Singapore. REC employs around 2,000 people worldwide, producing 1.5 GW of solar panels annually.

REC  
www.recgroup.com







Castillo Engineering Services, LLC  
2925 W. State Road 434, Suite 111,  
Longwood, FL 32779

RE: REC Modules Max Wind Load

San Luis Obispo, 18 February 2021

To Whom it May Concern;

REC Americas LLC confirms that the REC Twin Peak 3M series (RECXXTP3M) and REC Alpha Series (RECXXAA) modules have passed UL2703 Mechanical Load testing at a test load of +/-113 PSF utilizing four-point attachments on the long side of the module.

Please be in touch with the REC Technical Department if you have any questions.

Sincerely,

George McClellan  
REC Americas LLC  
Senior Technical Sales Manager

REC Americas LLC  
1420 Gateway Dr, Suite 170  
San Mateo, CA 94404  
Dir 805 704 3226  
Fax 805 457 6104  
[www.recgroup.com](http://www.recgroup.com)



DESIGNED TO PERMIT

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:20

PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-02

# Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate seamlessly with the Enphase IQ Envoy™, Enphase Q Aggregator™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.

### Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

### Productive and Reliable

- Optimized for high powered 60-cell and 72-cell\* modules
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

### Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

\* The IQ 7+ Micro is required to support 72-cell modules.



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2-US	
Commonly used module pairings <sup>1</sup>	235 W - 350 W +		235 W - 440 W +	
Module compatibility	60-cell PV modules only		60-cell and 72-cell PV modules	
Maximum input DC voltage	48 V		60 V	
Peak power tracking voltage	27 V - 37 V		27 V - 45 V	
Operating range	16 V - 48 V		16 V - 60 V	
Min/Max start voltage	22 V / 48 V		22 V / 60 V	
Max DC short circuit current (module Isc)	15 A		15 A	
Overvoltage class DC port	II		II	
DC port backfeed current	0 A		0 A	
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit			
OUTPUT DATA (AC)	IQ 7 Microinverter		IQ 7+ Microinverter	
Peak output power	250 VA		295 VA	
Maximum continuous output power	240 VA		290 VA	
Nominal (L-L) voltage/range <sup>2</sup>	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V
Maximum continuous output current	1.0 A	1.15 A	1.21 A	1.39 A
Nominal frequency	60 Hz		60 Hz	
Extended frequency range	47 - 68 Hz		47 - 68 Hz	
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms	
Maximum units per 20 A (L-L) branch circuit <sup>3</sup>	16 (240 VAC) 13 (208 VAC)		13 (240 VAC) 11 (208 VAC)	
Overvoltage class AC port	III		III	
AC port backfeed current	0 A		0 A	
Power factor setting	1.0		1.0	
Power factor (adjustable)	0.7 leading ... 0.7 lagging		0.7 leading ... 0.7 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V
Peak CEC efficiency	97.6 %	97.6 %	97.5 %	97.3 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %
MECHANICAL DATA	IQ 7 Microinverter			
Ambient temperature range	-40°C to +65°C			
Relative humidity range	4% to 100% (condensing)			
Connector type	MC4 (or Amphenol F-4 UTX with additional Q-DCC-5 adapter)			
Dimensions (WxHxD)	212 mm x 175 mm x 30.2 mm (without bracket)			
Weight	1.08 kg (2.38 lbs)			
Cooling	Natural convection - No fans			
Approved for wet locations	Yes			
Pollution degree	PD3			
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure			
Environmental category / UV exposure rating	NEMA Type 6 / outdoor			
FEATURES				
Communication	Power Line Communication (PLC)			
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.			
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.			

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.  
2. Nominal voltage range can be extended beyond nominal if required by the utility.  
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2018 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.  
2018-02-08



### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:21

### PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"


### SHEET NUMBER

DS-03



# Enphase IQ Combiner 3 (X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

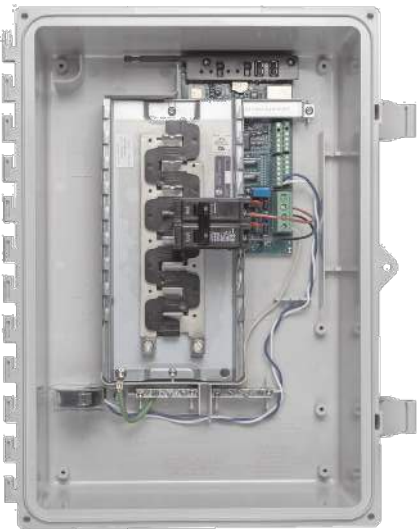

## Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

## Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

## Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year warranty
- UL listed



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ Combiner 3

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (not included, order separately)	
Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (5,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)
COMPLIANCE	
Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1
* Consumption monitoring is required for Enphase Storage Systems.	

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner.  
2018-09-13



## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:21

## PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

## SHEET NAME

DATA SHEET

## SHEET SIZE

ANSI B  
11" X 17"

## SHEET NUMBER

DS-04

## POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.



### PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy <sup>1</sup>	14 kWh
Usable Energy <sup>1</sup>	13.5 kWh
Real Power, max continuous <sup>2</sup>	5 kW (charge and discharge)
Real Power, peak (10s, off-grid/backup) <sup>2</sup>	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	+/- 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency <sup>1,3</sup>	90%
Warranty	10 years

<sup>1</sup>Values provided for 25°C (77°F), 33 kW charge/discharge power.

<sup>2</sup>In Backup mode, grid charge power is limited to 1.67 kW.


<sup>3</sup>AC to battery to AC, at beginning of life.

### COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973, UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)

### MECHANICAL SPECIFICATIONS

Dimensions	1150 mm x 755 mm x 155 mm (45.3 in x 29.7 in x 6.1 in)
Weight	125 kg (276 lbs)
Mounting options	Floor or wall mount

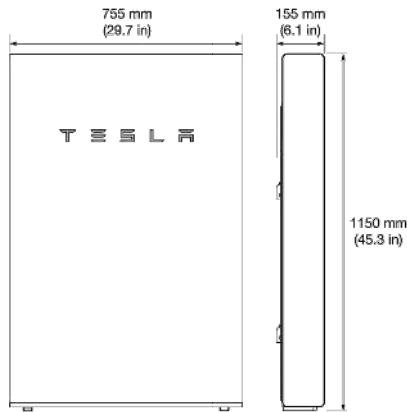


### ENVIRONMENTAL SPECIFICATIONS


Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Optimum Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F) Up to 95% RH, non-condensing State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)

## TYPICAL SYSTEM LAYOUTS

### WHOLE HOME BACKUP

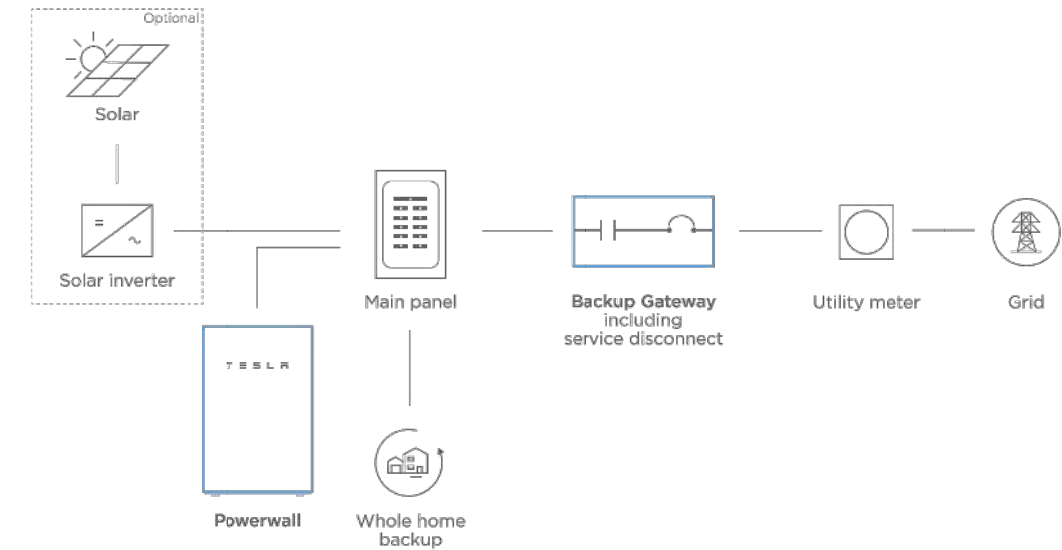

### PARTIAL HOME BACKUP

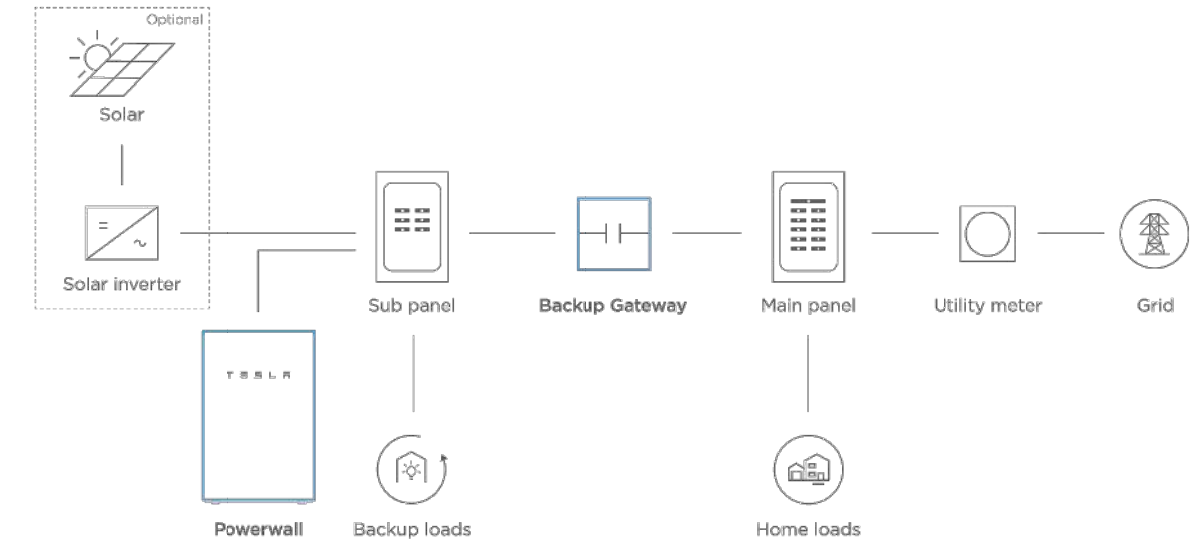

TESLA

TESLA.COM/ENERGY

TESLA

NA - BACKUP - 2018-04-18

TESLA.COM/ENERGY

Castillo  
Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING  
SERVICES, LLC

COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

#### REVISIONS

DESCRIPTION	DATE	REV

#### PROJECT INSTALLER

POWER  
PRODUCTION MANAGEMENT, INC.

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:22

#### PROJECT NAME

NICEWONGER  
RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

#### SHEET NAME

DATA SHEET

#### SHEET SIZE

ANSI B  
11" X 17"

#### SHEET NUMBER

DS-05



POWERWALL

Backup Gateway 2

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA <sup>1</sup>
Overcurrent Protection Device	100-200A; Service Entrance Rated <sup>1</sup>
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) <sup>2</sup>
User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, and backup
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years


<sup>1</sup> When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.  
<sup>2</sup> The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount, Semi-flush mount

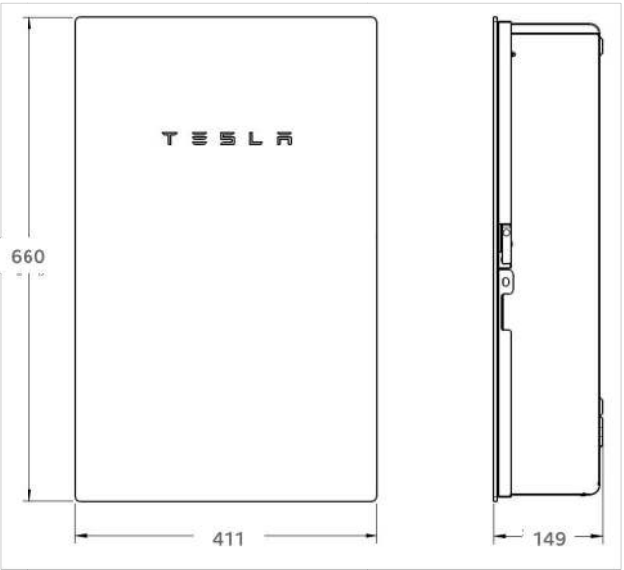

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.03.29 17:54:22

PROJECT NAME

NICEWONGER RESIDENCE

1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-06

# Ultra Rail


UR-40  
UR-60

## SnapNrack Ultra Rail System

A sleek, straightforward rail solution for mounting solar modules on all roof types. Ultra Rail features two rail profiles; UR-40 is a lightweight rail profile that is suitable for most geographic regions and maintains all the great features of SnapNrack rail, while UR-60 is a heavier duty rail profile that provides a larger rail channel and increased span capabilities. Both are compatible with all existing mounts, module clamps, and accessories for ease of install.


### The Entire System is a Snap to Install

- New Ultra Rail Mounts include snap-in brackets for attaching rail
- Compatible with all the SnapNrack Mid Clamps and End Clamps customers love
- Universal End Clamps and snap-in End Caps provide a clean look to the array edge

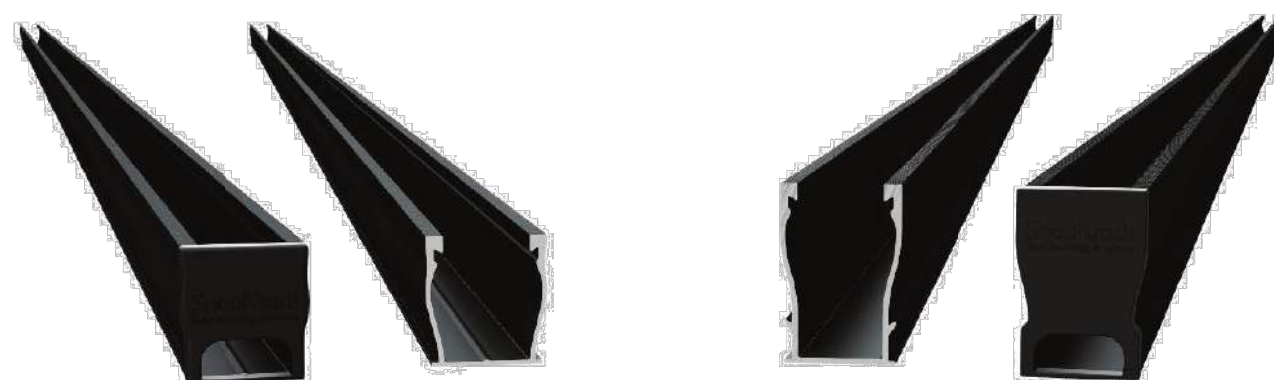

### Unparalleled Wire Management

- Open rail channel provides room for running wires resulting in a long-lasting quality install
- Industry best wire management offering includes Junction Boxes, Universal Wire Clamps, MLPE Attachment Kits, and Conduit Clamps
- System is fully bonded and listed to UL 2703 Standard

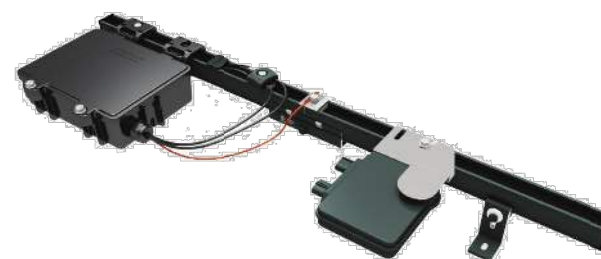

### Heavy Duty UR-60 Rail

- UR-60 rail profile provides increased span capabilities for high wind speeds and snow loads
- Taller, stronger rail profile includes profile-specific rail splice and end cap
- All existing mounts, module clamps, and accessories are retained for the same great install experience



## The Ultimate Value in Rooftop Solar



Industry leading Wire Management Solutions



Mounts available for all roof types



Single Tool Installation



All SnapNrack Module Clamps & Accessories are compatible with both rail profiles

**Start Installing Ultra Rail Today**

**RESOURCES**  
**DESIGN**  
**WHERE TO BUY**

[snapnrack.com/resources](http://snapnrack.com/resources)  
[snapnrack.com/configurator](http://snapnrack.com/configurator)  
[snapnrack.com/where-to-buy](http://snapnrack.com/where-to-buy)

# Quality. Innovative. Superior.

SnapNrack Solar Mounting Solutions are engineered to optimize material use and labor resources and improve overall installation quality and safety.

877-732-2860

[www.snapnrack.com](http://www.snapnrack.com)

[contact@snapnrack.com](mailto:contact@snapnrack.com)

© 2019 by SnapNrack Solar Mounting Solutions. All rights reserved.

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER

### PROJECT NAME

**NICEWONGER  
RESIDENCE**  
1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

### SHEET NAME

**DATA SHEET**

### SHEET SIZE


**ANSI B  
11" X 17"**

### SHEET NUMBER

**DS-07**




# SnapNrack Umbrella Sealing Technology

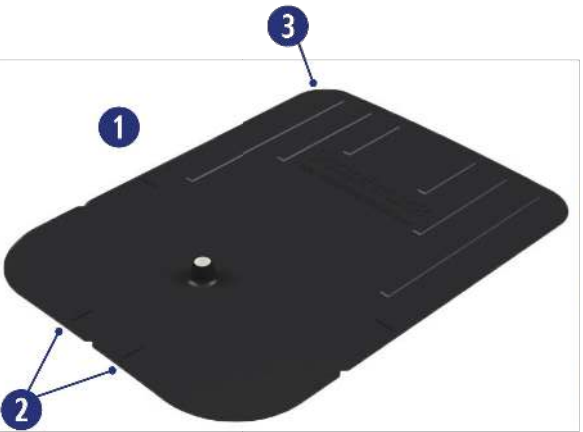

## Featuring New Innovative Flashing

- 1 Smaller 9"x12" size allows for easier insertion under shingles
- 2 Alignment markers make it easy to locate pilot holes
- 3 Rounded corners make for easier insertion & eliminate corner points from folding up

- **Innovative Flashing Elevates Protection.** New flashing uses a fully formed raised cone to prevent any potential water from getting into penetration. Feel secure as the flashing is one piece and doesn't rely on multiple parts sealing together.
- **Mechanical Design Creates a Lifelong Seal.** Patented Umbrella technology utilizes unique Umbrella Washer to seal lag bolt, L Foot, and flashing and prevent any potential roof leaks. Technology passes UL 2582 Wind Driven Rain Test without a rubber seal, however rubber gasket is included for extra peace of mind.
- **Single Fastener Eliminates Extra Steps.** Utilize one lag bolt with Umbrella Washer to secure the entire mount assembly and flashing. No longer necessary to attach a base, then a flashing, then a mount as all are secured in one step.
- **Single Tool Installation.** SnapNrack was the first in the industry to develop a complete system that only requires a single tool. That tradition is continued as a ½" socket is still the only tool necessary to secure the mount as well as all other parts of the system.

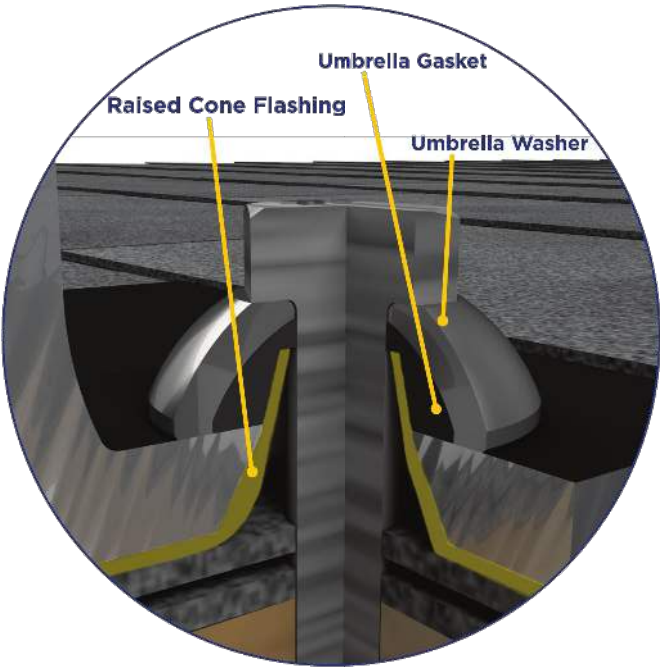

Note: Flashing shown in yellow for illustration purposes only.

## Industry Leading Spans for a Light Rail Solution


This table was prepared in compliance with applicable engineering codes and standards. Values are based on the following:

- ASCE 7-10
- Chapter 30 Wind Loads & Chapter 7 Snow Loads
- Roof Slope: 7 - 27 deg
- Roof Height: 0 - 30 ft
- Exposure: B
- Roof Zone: 1
- Module Orientation: Portrait
- Module Type: 60 Cell Modules
- Roof Type: Comp

System Span Key	
6 ft Spans	
4 ft Spans	
2 ft Spans	

		Ultra Rail, UR-40 Rail System Spans																
		Wind (mph)																
Snow (psf)		110	115	120	125	130	135	140	145	150	155	160	165	170	175	180	190	
	0																	
	5																	
	10																	
	15																	
	20																	
	25																	
	30																	
	35																	
	40																	
	45																	
	50																	
	60																	
	70																	
	80																	
	90																	
	100																	
	110																	
	120																	

Visit SnapNrack.com for detailed span tables and certifications.

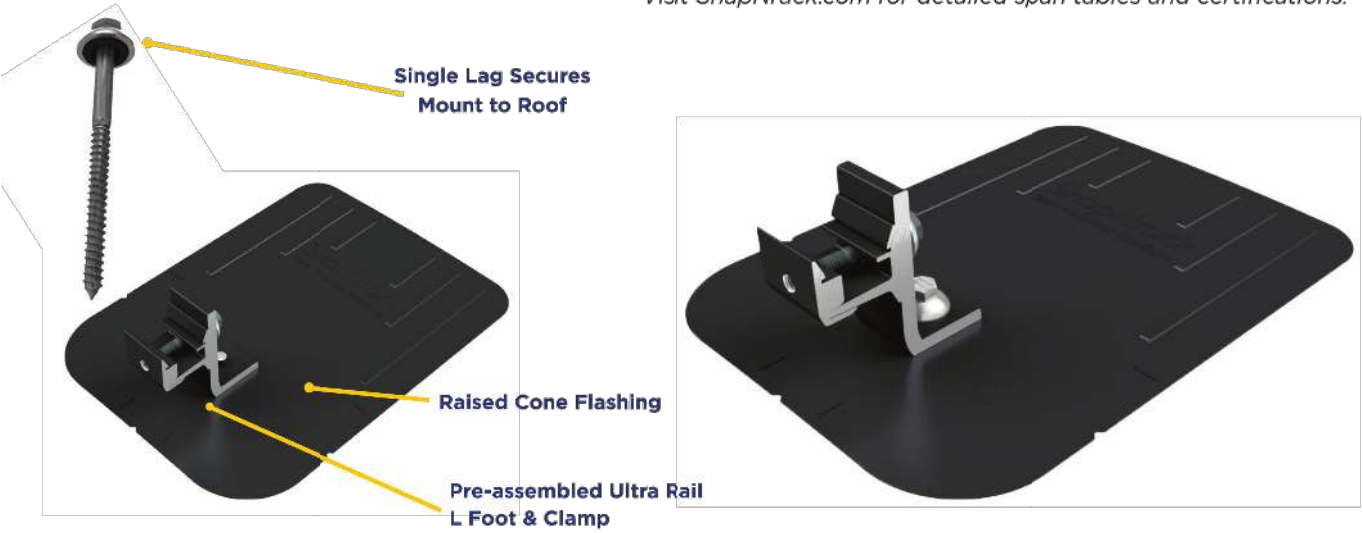

## Certifications

SnapNrack Ultra Rail system has been evaluated by Underwriters Laboratories (UL) and Listed to UL/ANSI Standard 2703 for Mechanical Loading and Fire. Additionally it is listed to UL 2582 for wind-driven rain.



877-732-2860

www.snapnrack.com

contact@snapnrack.com

© 2018 by SnapNrack Solar Mounting Solutions. All rights reserved

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER

POWER  
PRODUCTION MANAGEMENT, INC.

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.03.29  
17:54:24

## PROJECT NAME

NICEWONGER  
RESIDENCE  
1845 SW WILSON SPRINGS RD,  
FORT WHITE, FL 32038

## SHEET NAME

DATA SHEET

## SHEET SIZE

ANSI B  
11" X 17"

## SHEET NUMBER

DS-08