



STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM (OSTDS)

PERMIT NO. 24-0349
DATE PAID: 7/26/24
FEE PAID: 2251.00
RECEIPT #: 2067013

APPLICATION FOR CONSTRUCTION PERMIT

APPLICATION FOR:
☒ New System ☒ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Robbins Real Estate EMAIL: provisionpermitting@gmail.com
AGENT: Soupe North TELEPHONE: 863-517-5701
MAILING ADDRESS: 702 NE Okinawa St Lake City FL

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

OSTDS REMEDIATION PLAN? [Y / N]

LOT: _____ BLOCK: _____ SUBDIVISION: _____ PLATTED: _____

PROPERTY ID #: 35-35-17-07253-000 ZONING: _____ I/M OR EQUIVALENT: [Y / N]

PROPERTY SIZE: 35.13 ACRES WATER SUPPLY: [] PRIVATE PUBLIC [] ≤ 2000 GPD [] > 2000 GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? [Y / N] DISTANCE TO SEWER: _____ FT

PROPERTY ADDRESS: 702 NE Okinawa St Lake City FL

DIRECTIONS TO PROPERTY: R on NE Lake Desoto Cir, R on NE Vickers Ter, L on E Duval, continue on E US Hwy 90, L on Cortez, L on Okinawa, property on L

BUILDING INFORMATION

[] RESIDENTIAL

☒ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table I, Chapter 62-6, FAC
1	OFFICE	<u>0</u>	2100	<u>Build 1970</u>
2	Existing office	<u>—</u>	1425 HIC office	<u>Repair attached NOT Final</u>
3				
4				

[] Floor/Equipment Drains [] Other (Specify) _____


SIGNATURE: Soupe North DATE: _____

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)

Incorporated 62-6.004, FAC

Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan
Permit Application Number: 24-0349

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

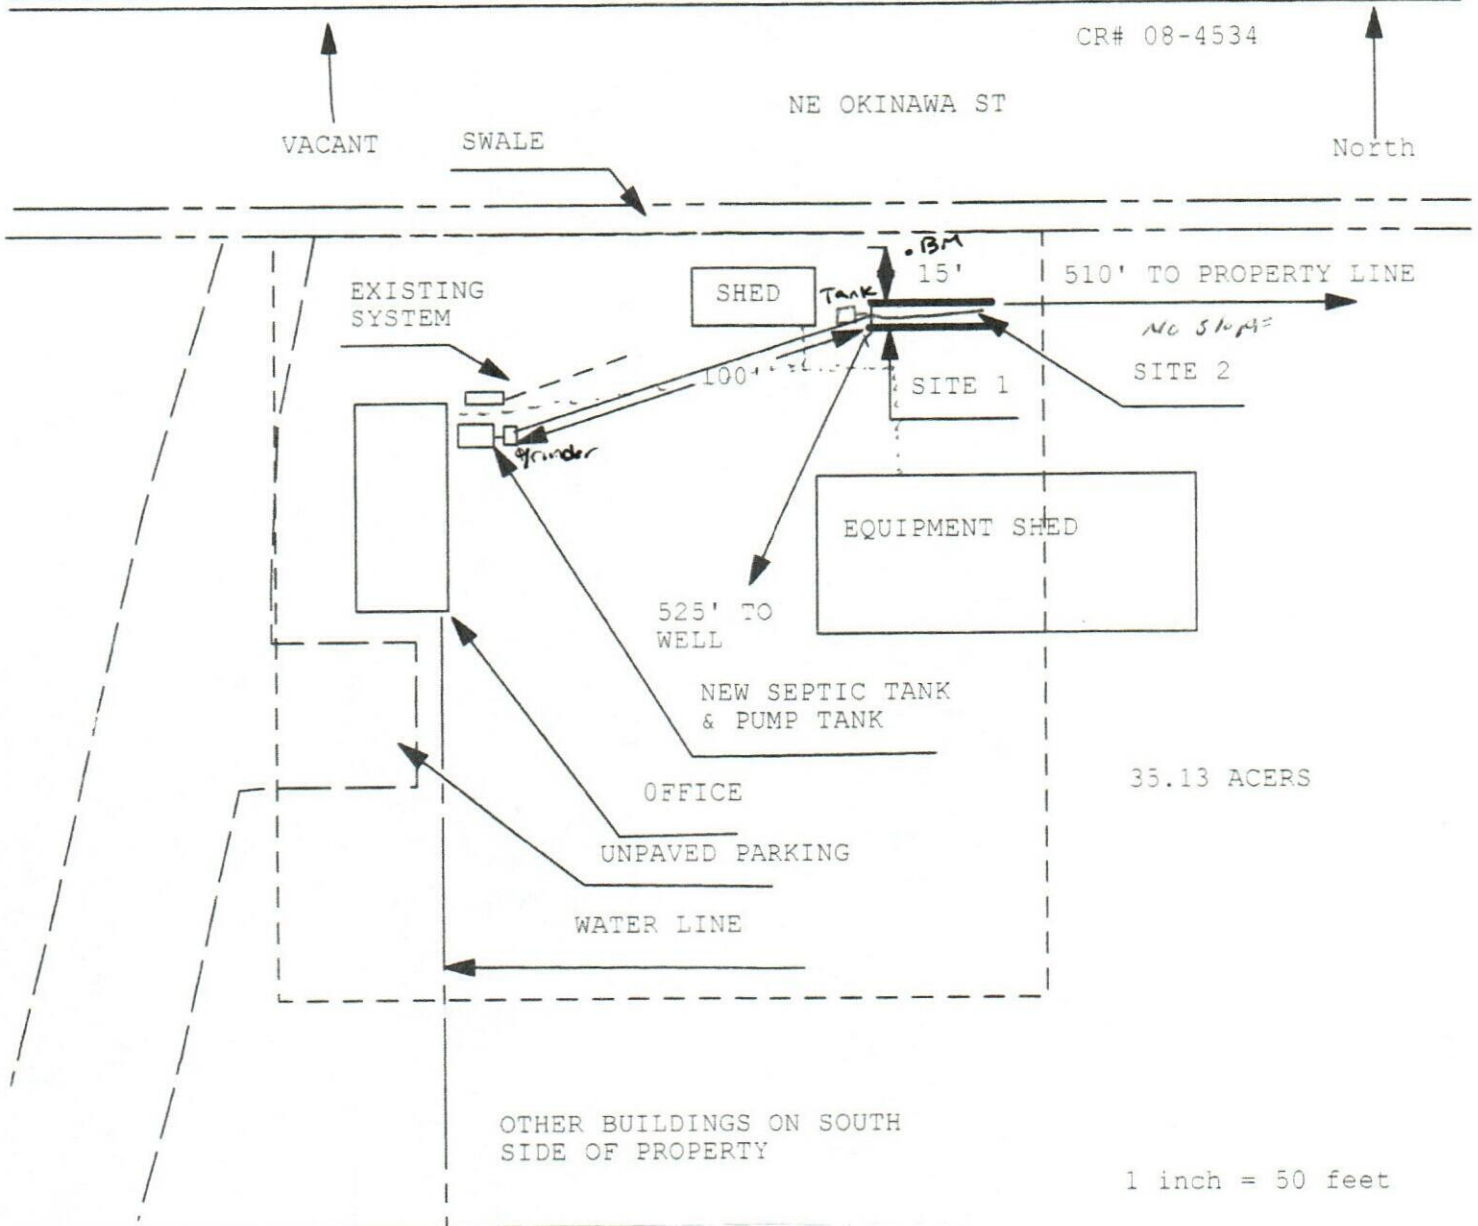

Site Plan submitted by: Sonja North
Plan Approved ☒ Not Approved ☐
By [Signature] ET2 Columbia Date 5/29/24
County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-2894981
APPLICATION #: AP2067013
DATE PAID: 4/26/24
FEE PAID: 225.00
RECEIPT #:
DOCUMENT #: PR2085958

CONSTRUCTION PERMIT FOR: OSTDS Existing Modification

APPLICANT: ROBBINS**24-0349 REAL ESTATE

PROPERTY ADDRESS: 702 NE OKINAWA Lake City, FL 32055

LOT: BLOCK: SUBDIVISION:

PROPERTY ID #: 07253-000 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [1,050] GALLONS / GPD Existing Septic Tank CAPACITY
A [] GALLONS / GPD CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []

D [394] SQUARE FEET Drainfield SYSTEM
R [] SQUARE FEET SYSTEM
A TYPE SYSTEM: [] STANDARD [] FILLED [x] MOUND []
I CONFIGURATION: [x] TRENCH [] BED []

F LOCATION OF BENCHMARK: Nail in tree near site

I ELEVATION OF PROPOSED SYSTEM SITE [13.00] [INCHES] FT [] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [13.00] [INCHES] FT [] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT

L
D FILL REQUIRED: [18.00] INCHES EXCAVATION REQUIRED: [28.00] INCHES

O Add 154sqft to existing 240sqft for a total of 394sqft of drainfield for new 2100sqft office with 6 employees. Install D/F at same elevation as original.
T
H
E
R

SPECIFICATIONS BY: Sean P Havens TITLE: Environmental Specialist I

APPROVED BY: Sean P Havens TITLE: Environmental Specialist I Columbia CHD

DATE ISSUED: 05/29/2024 EXPIRATION DATE: 11/29/2025

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)
Incorporated 62-6.004, FAC