

76 North Meadowbrook Drive Alpine, UT 84004 office (201) 874-3483 swyssling@wysslingconsulting.com

Lumio Solar 12600 Challenger Parkway, Suite 200 Orlando, FL 32826 June 30, 2022

Scott

Digitally signed by Scott E Wyssling
DN: C=US, S=Utah, L=Alpine,
O=Wyssling Consulting, CN=Scott E
Wyssling +
E=swyssling@wysslingconsulting.com
Reason: I am the author of this
document
Location: your signing location here
Date: 2022.06.30 23:55:16-06'00'
Foxit PDF Editor Version: 11.1.0

Re: Engineering Services Solomon Residence 233 North West Scott Glen, Lake City FL 3.200 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

A. Site Assessment Information

- 1. Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
- Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

B. Description of Structure:

Roof Framing: Prefabricated wood trusses at 24" on center. All truss members are

constructed of 2 x 4 dimensional lumber.

Roof Material: Metal Roofing Roof Slopes: 27 +/- degrees Attic Access: Accessible Permanent

C. Loading Criteria Used

- Dead Load
 - Existing Roofing and framing = 7 psf
 - New Solar Panels and Racking = 3 psf
 - TOTAL = 10 PSF
- Live Load = 20 psf (reducible) 0 psf at locations of solar panels
- Ground Snow Load = 0 psf
- Wind Load based on ASCE 7-16
 - Ultimate Wind Speed = 120 mph (based on Risk Category II)
 - Exposure Category B

Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the FBC 2020 7th Edition, including provisions allowing existing structures to not require strengthening if the new loads do not exceed existing design loads by 105% for gravity elements and 110% for seismic elements. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.

D. Solar Panel Anchorage

- 1. The solar panels shall be mounted in accordance with the most recent "S-5 Installation Manual". If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
- 2. System will be attached to the metal roofing material utilizing the patented S-5 connection. Installation of the connections shall be in accordance with the manufacturer's recommendations., and condition of the roof, the panel supports shall be placed no greater than 48" on center.
- 3. Panel supports connections shall be staggered to distribute load to adjacent framing members.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the FBC 2020 7th Edition, current industry standards and practice, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Scott E Wysslip PE

Florida License No. 815

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

No. 8155

STATE OF

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004

Florida License # RY34712

Date Signed 6/30/2022



	ARRAY DESCRIPTION						
ROOF	# OF MODULES	AZIMUTH	TRUSS SIZE	TRUSS SPACING	ROOF MATERIAL		
#1	8	270°	2X4	24" O.C.	ASPHALT SHINGLE		

LEGEND

(E) - EXISTING (N) - NEW

	DESIGN SPECIFICATION				
	RISK CATEGORY	II			
	CONSTRUCTION	SFD			
	ZONING	RESIDENTIAL			
۷	SNOW LOAD (ASCE 7-16)	0 PSF			
	EXPOSURE CATEGORY	В			
	WIND SPEED (ASCE 7-16)	120 MPH			





ATLANTIC KEY ENERGY LLC
7006 STAPOINT CT
STE B
WINTER PARK, FL 32792
+1 (407) 988-0273

PROJECT NAME & ADDRESS

SUSAN SOLOMON RESIDENCE 233 NW SCOTT GLEN LAKE CITY, FL 32055

ENGINEER CONTACT INFORMATION

SCOTT WYSSLING LICENSE# 81558 76 N MEADOWBROOK DR., ALPINE, UT 84004

SIGNATURE WITH SEAL

REVISIONS						
DESCRIPTION	DATE	REV				
			l			
			ĺ			
Orawn bv:		D.O.	1			

S.W.

6/27/22

Drawn by:


Checked by:

SHEET NAME

ROOF PLAN AND MODULES
SHEET NUMBER

S-0

BACK OF RESIDENCE

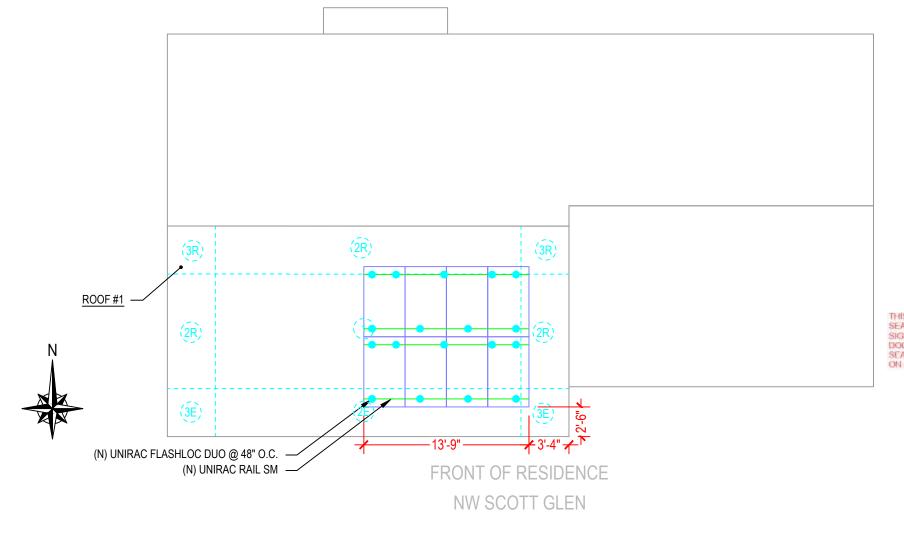

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MIST BE VERIFIED ON ANY ELECTRONIC COPIES.

NO. 8155

Wyssling Consulting, PLLC 76 N Meadowbrook Brive Alpine UT 84004 Florida License # RY34912

Date Signed 6/30/2022

ROOF PLAN AND MODULES

S-0

SCALE: NTS

FLASHLOC™ DUO

THE MOST VERSATILE DIRECT TO DECK ATTACHMENT



FLASHLOC™ DUO is the most versatile direct to deck and rafter attachment for composition shingle and rolled comp roofs. The all-in-one mount installs fast — no kneeling on hot roofs to install flashing, no prying or cutting shingles, no pulling nails. Simply drive the required number of screws to secure the mount and inject sealant into the base. FLASHLOC's patented TRIPLE SEAL technology preserves the roof and protects the penetration with a permanent pressure seal. Kitted with two rafter screws, sealant and hardware for maximum convenience (deck screws sold separately). Don't just divert water, LOC it out!







PROTECT THE ROOF

Install a high-strength waterproof attachment without lifting, prying or damaging shingles.

APRIL2021_FLASHLOCDUO_V1



LOC OUT WATER

technology delivers a 100% waterproof connection.




With an outer shield 1 contour-conforming gasket
2 and pressurized sealant chamber 3 the Triple Seal
sealant into the port 4 to create a permanent pressure

HIGH-SPEED INSTALL

FASTER INSTALLATION. 25-YEAR WARRANTY.

FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR CALL (505) 248-2702

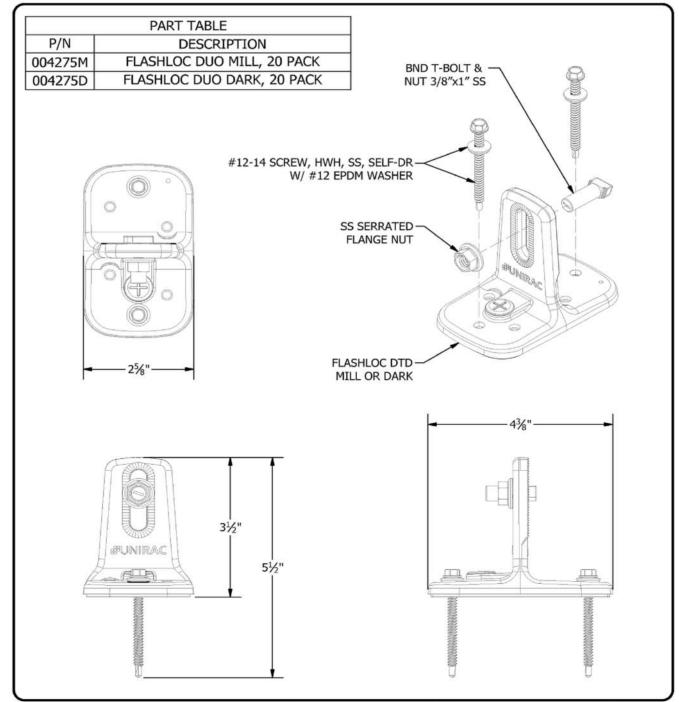



1411 BROADWAY BLVD. NE ALBUQUERQUE, NM 87102 USA PHONE: 505.242.6411 WWW.UNIRAC.COM

PRODUCT LINE: **SOLARMOUNT** DRAWING TYPE: ASSEMBLY DETAIL FLASHLOC DUO KI DESCRIPTION: 4/29/2021 REVISION DATE:

DRAWING NOT TO SCALE ALL DIMENSIONS ARE NOMINAL

PRODUCT PROTECTED BY ONE OR MORE US PATENTS LEGAL NOTICE

FL-A04 SHEET ATLANTIC KEY ENERGY LLC 7006 STAPOINT CT WINTER PARK, FL 32792 +1 (407) 988-0273

PROJECT NAME & ADDRESS

SUSAN SOLOMON RESIDENCE 233 NW SCOTT GLEN LAKE CITY, FL 32055

ENGINEER CONTACT INFORMATION

SCOTT WYSSLING LICENSE# 81558 76 N MEADOWBROOK DR. ALPINE, UT 84004

SIGNATURE WITH SEAL

REVISIONS					
DESCRIPTION	DATE	REV			
Drawn by:	D.O.				
Checked by:	S.W.				
Date: 6/27/					

SHEET NAME **EQUIPMENT SPECIFICATIONS**

SHEET NUMBER

S-1

SOLARMOUNT



SOLARMOUNT defined the standard in solar racking. Features are designed to get installers off the roof faster. Our grounding & bonding process eliminates copper wire and grounding straps to reduce costs. Systems can be configured with standard or light rail to meet your design requirements at the lowest cost possible. The superior aesthetics package provides a streamlined clean edge for enhanced curb appeal, with no special brackets required for installation.









System grounding through Enphase microinverters and trunk cables Light Rail is Fully Compatible with all SM Components



LOSE ALL OF THE COPPER & LUGS SMALL IS THE NEXT NEW BIG THING ENHANCED DESIGN & LAYOUT TOOLS

FAST INSTALLATION. SUPERIOR AESTHETICS

OPTIMIZED COMPONENTS . VERSATILITY . DESIGN TOOLS . QUALITY PROVIDER

SOLARMOUNT

#UNIRAC

OPTIMIZED COMPONENTS


INTEGRATED BONDING & PRE-ASSEMBLED PARTS

Components are pre-assembled and optimized to reduce installation steps and save straps or bonding jumpers to reduce costs. Utilize the microinverter mount with a wire

ONE PRODUCT - MANY APPLICATIONS

Quickly set modules flush to the roof or at a desired tilt angle. Change module

when you log in. You will enjoy the ability to share projects with customers; there's no

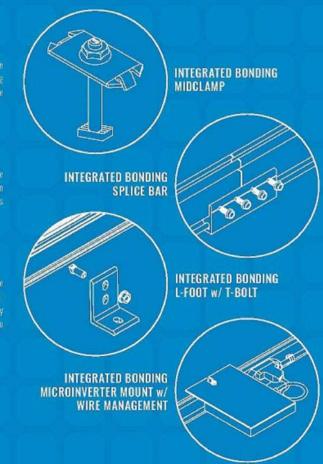



UNIRAC CUSTOMER SERVICE MEANS THE HIGHEST LEVEL OF PRODUCT SUPPORT













TECHNICAL SUPPORT

CERTIFIED QUALITY PROVIDER

BANKABLE WARRANTY

Don't leave your project to chance Unitac has the financial quality. SOLARMOUNT is covered by a twenty five (25) year

PROTECT YOUR REPUTATION WITH QUALITY RACKING SOLUTIONS BACKED BY ENGINEERING EXCELLENCE AND A SUPERIOR SUPPLY CHAIN

ATLANTIC KEY ENERGY LLC 7006 STAPOINT CT WINTER PARK, FL 32792

+1 (407) 988-0273 PROJECT NAME & ADDRESS

SUSAN SOLOMON RESIDENCE 233 NW SCOTT GLEN LAKE CITY, FL 32055

ENGINEER CONTACT INFORMATION

SCOTT WYSSLING LICENSE# 81558 76 N MEADOWBROOK DR. ALPINE, UT 84004

SIGNATURE WITH SEAL

REVISIONS DESCRIPTION DATE REV Checked by:

> SHEET NAME **EQUIPMENT**

6/27/22

SPECIFICATIONS SHEET NUMBER

S-2