



STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM (OSTDS)

APPLICATION FOR CONSTRUCTION PERMIT

CR # 20-00084

PERMIT NO. 22-0991
DATE PAID: 12/12/22
FEE PAID: 318.00
RECEIPT #: 1925747

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: ALEX TALMADGE BULLARD

AGENT: BLAKE CONSTRUCTION CO

TELEPHONE: (386) 754-5810

MAILING ADDRESS: 618 SW FLORIDA GATEWAY DRIVE LAKE CITY FL 32024

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: N/A BLOCK: N/A SUBDIVISION: _____ PLATTED: _____

PROPERTY ID #: 21-4S-16-03081-015 ZONING: RES I/M OR EQUIVALENT: ☐ NO ☐

PROPERTY SIZE: 6.210 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ≤ 2000 GPD ☐ > 2000 GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☐ NO ☐ DISTANCE TO SEWER: N/A FT

PROPERTY ADDRESS: 4207 SW COUNTY ROAD 242

DIRECTIONS TO PROPERTY: TAKE 90 EAST. TURN LEFT ON COUNTY ROAD 247. TURN LEFT ON COUNTY ROAD 242. SITE ON RIGHT.

BUILDING INFORMATION ☒ RESIDENTIAL ☐ COMMERCIAL


Unit No.	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 62-6, FAC
1	<u>HOUSE</u>	<u>2</u>	<u>698</u>	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify) _____

SIGNATURE: Blake N Lunde II, President DATE: 12/12/2022

Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan
Permit Application Number: 22-0991

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

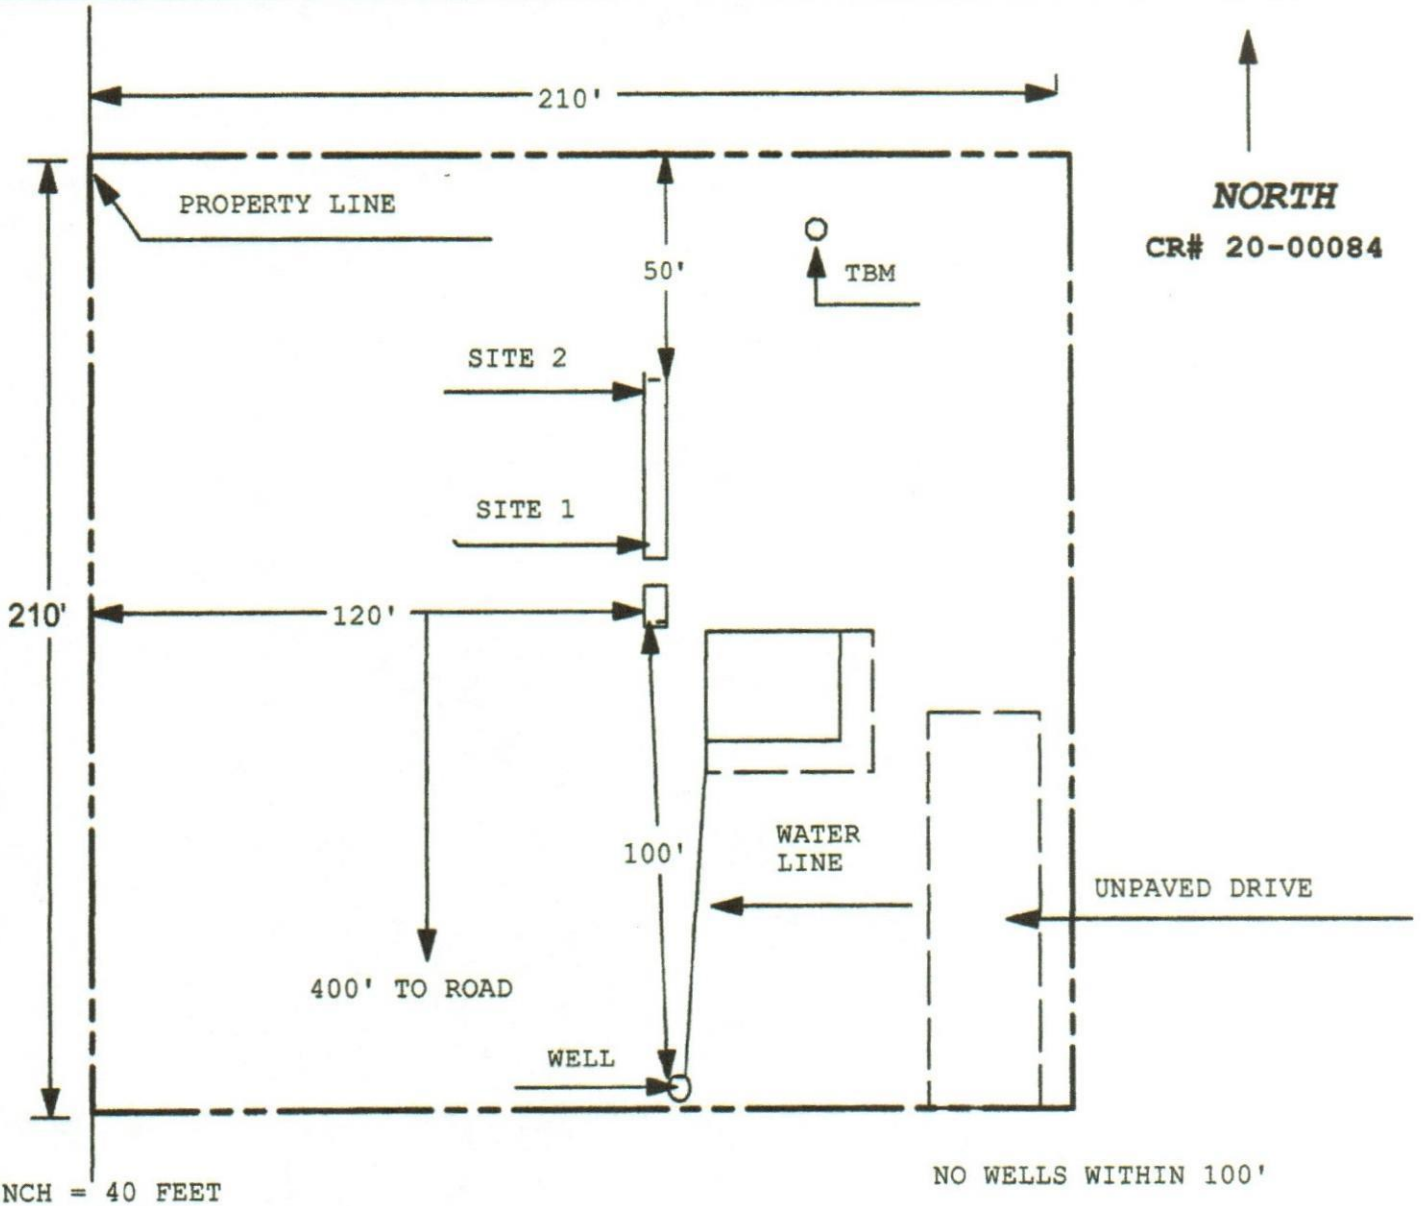

Site Plan Submitted By Paul Lay Date 12/7/22
Plan Approved ✓ Not Approved Date 12/12/22
By ESA ESC Columbia CPHU
Notes: Blake N Lunde II, President

Verified by pdfFilter
12/13/2022



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-2621521
APPLICATION #: AP1925747
DATE PAID: 12/12/22
FEE PAID: 310.00
RECEIPT #: _____
DOCUMENT #: PR1881506

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: ALEX**22-0991 BULLARD

PROPERTY ADDRESS: 4207 SW CR 242 Lake City, FL 32024

LOT: _____ BLOCK: _____ SUBDIVISION: Saddle Ridge

PROPERTY ID #: 03081-015

[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD _____ Septic _____ CAPACITY
A [] GALLONS / GPD _____ N/A _____ CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []

D [250] SQUARE FEET _____ SYSTEM
R [] SQUARE FEET _____ N/A _____ SYSTEM

A TYPE SYSTEM: [x] STANDARD [] FILLED [] MOUND [] _____

I CONFIGURATION: [x] TRENCH [] BED [] _____

N
F LOCATION OF BENCHMARK: Nail in 4" oak north of system site

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [38.00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT

L

D FILL REQUIRED: [4.00] INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 2 bedrooms with a maximum occupancy of 4 persons (2 per bedroom), for a total estimated flow of 200 gpd.

T
H
E
R

SPECIFICATIONS BY: Paul Lloyd TITLE: PSE

APPROVED BY: Sean P Havens TITLE: Environmental Specialist I Columbia CHD

DATE ISSUED: 12/12/2022 EXPIRATION DATE: 06/12/2024

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

SK