

FRONT OF HOUSE

Inverter Type: (31)Enphase IQ8PLUS-72-2-US
PV Panel: (31) SIL 370 HC
Racking: Iron Ridge XR-100
Total Wattage: 11,470W DC
Roof Type: Metal
Wind Load: 27 to 45 Deg
Fastener Type: Use S-5! Proteas

Sheet Index

S-1 Cover Sheet / Site Plan
S-2 Detail
E-1 One - Line
E-2 Electrical Code
S-1A Mounting Plan

General Notes:

-Enphase IQ8PLUS-72-2-US Micro Inverters are located on roof behind each module.
-First responder access maintained and from adjacent roof.
-Wire run from array to connection is 40 feet.



6101 Johns Rd, Ste 8
Tampa, FL 33634
727-471-7442

Legend



First responder access



Ground Access



Chimney



Satellite



Vent Pipe



Utility Meter



PV Disconnect

Meets the requirements of the following- (2020 FL Residential Code & FBC, 7th Edition (2020 International Residential Code) - 2nd Printing modified by the FL Building Standards, 2020 Florida Building Energy Conservation Code 7th edition, County of Columbia Code, 2017 National Electric Code.)

System meets the requirements of NFPA 70th Edition, Chapter 11.12

Meets All Editions of Florida Fire Prevention Code 2020 7th Edition
Meets all requirements of NFPA-1 7th Edition and NFPA-101



3' Access Pathway

Represents all Fire Clearance
including Alternative methods

1st Responder Access

minimum of 36" unobstructed as per
Section R324 of the 2020 IRC


Customer Info:

Lee Caudill
634 SW Manatee Ter
Fort White, FL
32038

Utility Meter

-COGEN Disconnect
Located adjacent to
Utility meter

R-1
Modules (31)
Pitch: 33°
Azimuth: 102°



Layout Subject to Change Based on Site Conditions

Godwin Engineering and
Design, LLC
8378 Foxtail Loop
Pensacola, FL 32526
D. Chad Godwin, PE
Chad@godwineng.com

Donnie C
Godwin

2022.05.1
17:42:32 Z
'00'05-



Date: 5/12/2022

Drawn by: KT


Revised by: .

Rev #: 00

Rev Date: .

Page: 11"x17" S-1



N



Compass for Aerial



Ironridge XR-100

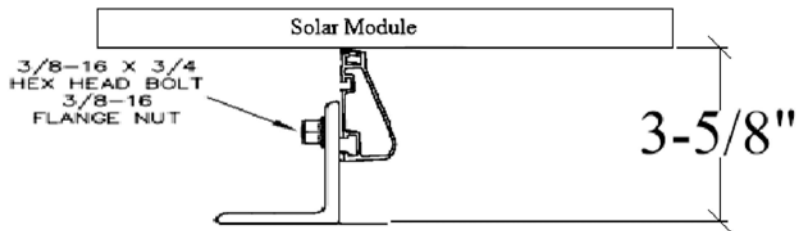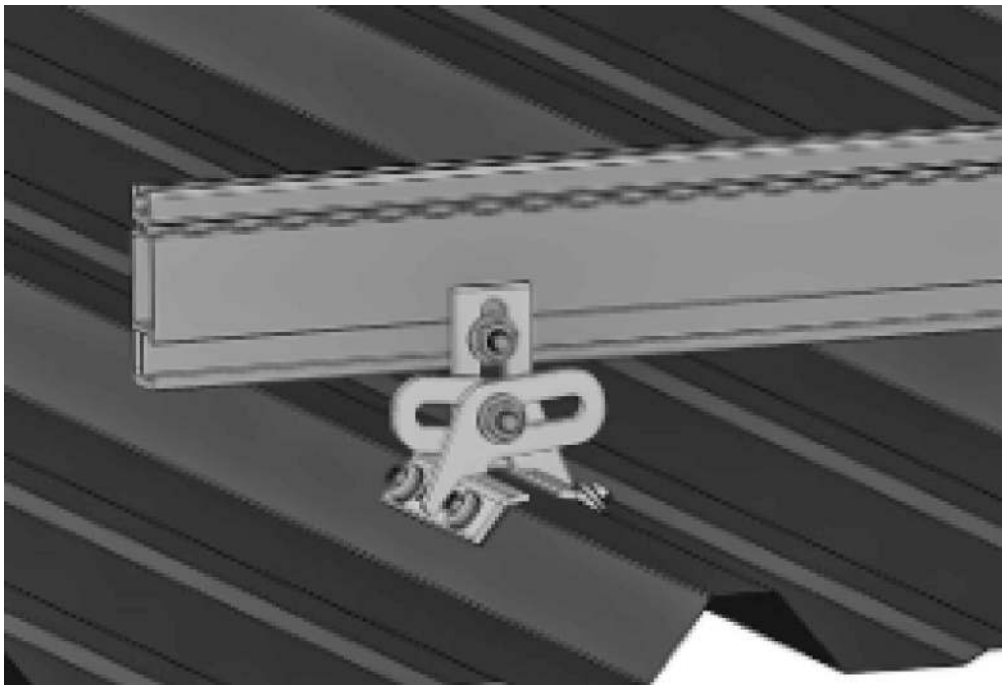

General Notes:

- S-5 Brackets are secured to Roof
- @ 48" O.C. in Zone 1, @ 48" O.C in Zone 2e, @ 48" O.C. in Zone 2n,
- @ 48" O.C. in Zone 2r, @ 48" O.C in Zone 3e, & @ 48" O.C. in Zone 3r
- using (4) 6mm x 25mm BI-Metal Self-Piercing
- Subject roof has One layer.
- All penetrations are sealed.

Install will be done to Manufacturer Spec

Godwin Engineering and
Design, LLC
8378 Foxtail Loop
Pensacola, FL 32526
D. Chad Godwin, PE
Chad@godwineng.com



Donnie C Godwin
2022.05.12
'00'05- 17:42:49

Roof Section	Pitch	Roof Rafter and Spacing	Overhang	Notes:
R1	8/12	2"x4" @ 24 O.C.	12"	Truss
-Roof Height 15' -Per 2020 FBC, the Roof Mounted PV System will be subject to the following design criteria: Design Wind Speed(Vult) - 120mph 3 sec gust, Exposure Category - B -Designed as per ASCE7-16		Inverter Type: (31)Enphase IQ8PLUS-72-2-US PV Panel: (31) SIL 370 HC Racking: Iron Ridge XR-100 Total Wattage: 11,470W DC Roof Type: Metal Wind Load: 27 to 45 Deg Fastener Type: Use S-5! Proteas		Customer Info: Lee Caudill 634 SW Manatee Ter Fort White, FL 32038



6101 Johns Rd, Ste 8
Tampa, FL 33634
727-471-7442

Date:	5/12/2022
Drawn by:	KT
Revised by:	.
Rev #: 00	
Rev Date:	.
Page:	11"X17" S-2

- NEC LABEL NOTES:
1. THE WARNING SIGN(S) OR LABEL(S) SHALL COMPLY WITH NEC 110.21(B)
 2. LABELS SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE THEY ARE INSTALLED.
 3. LABELS TO BE A MIN LETTER HEIGHT OF 3/8" AND PERMANENTLY AFFIXED.
 4. LABELS SHALL ALSO COMPLY WITH THE SPECIFIC REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.

Warning

THREE POWER SOURCES
SOURCES: UTILITY GRID,BATTERY
AND PV SOLAR ELECTRIC SYSTEM

! WARNING !

POWER SOURCE OUTPUT CONNECTION:
DO NOT RELOCATE THIS OVERCURRENT
DEVICE


Photovoltaics:
(31) SIL 370 HC

Inverters:
(31) Enphase IQ8PLUS-72-2-US Micro Inverters

Circuits:
(1) circuit of (11) Modules
(2) circuits of (10) Modules
Maximum Inverters Per 20A Circuit (13)

		Conduit (in)	L1,L2, N (awg)	Ground (awg)	OCPD
After Combiner	A	0.75	6	8	50
After ATS	B	1	4	8	50
To Line Side Tap	C	1	4	N/A	50

Enphase Output Ckt Per String	
To Overcurrent Protection Device	
AC Max Output Current	13.31
AC Max Output Current * 1.25%	16.6
Overcurrent Protection (A)	20
No. of Current Carrying Cond	<4
Conductor Gauge (AWG)	10
Enphase Total Output Ckt	
AC Max Output Current	37.51
AC Max Output Current * 1.25%	46.9
Overcurrent Protection (A)	50
No. of Current Carrying Cond	<4
Conductor Gauge (AWG)	6

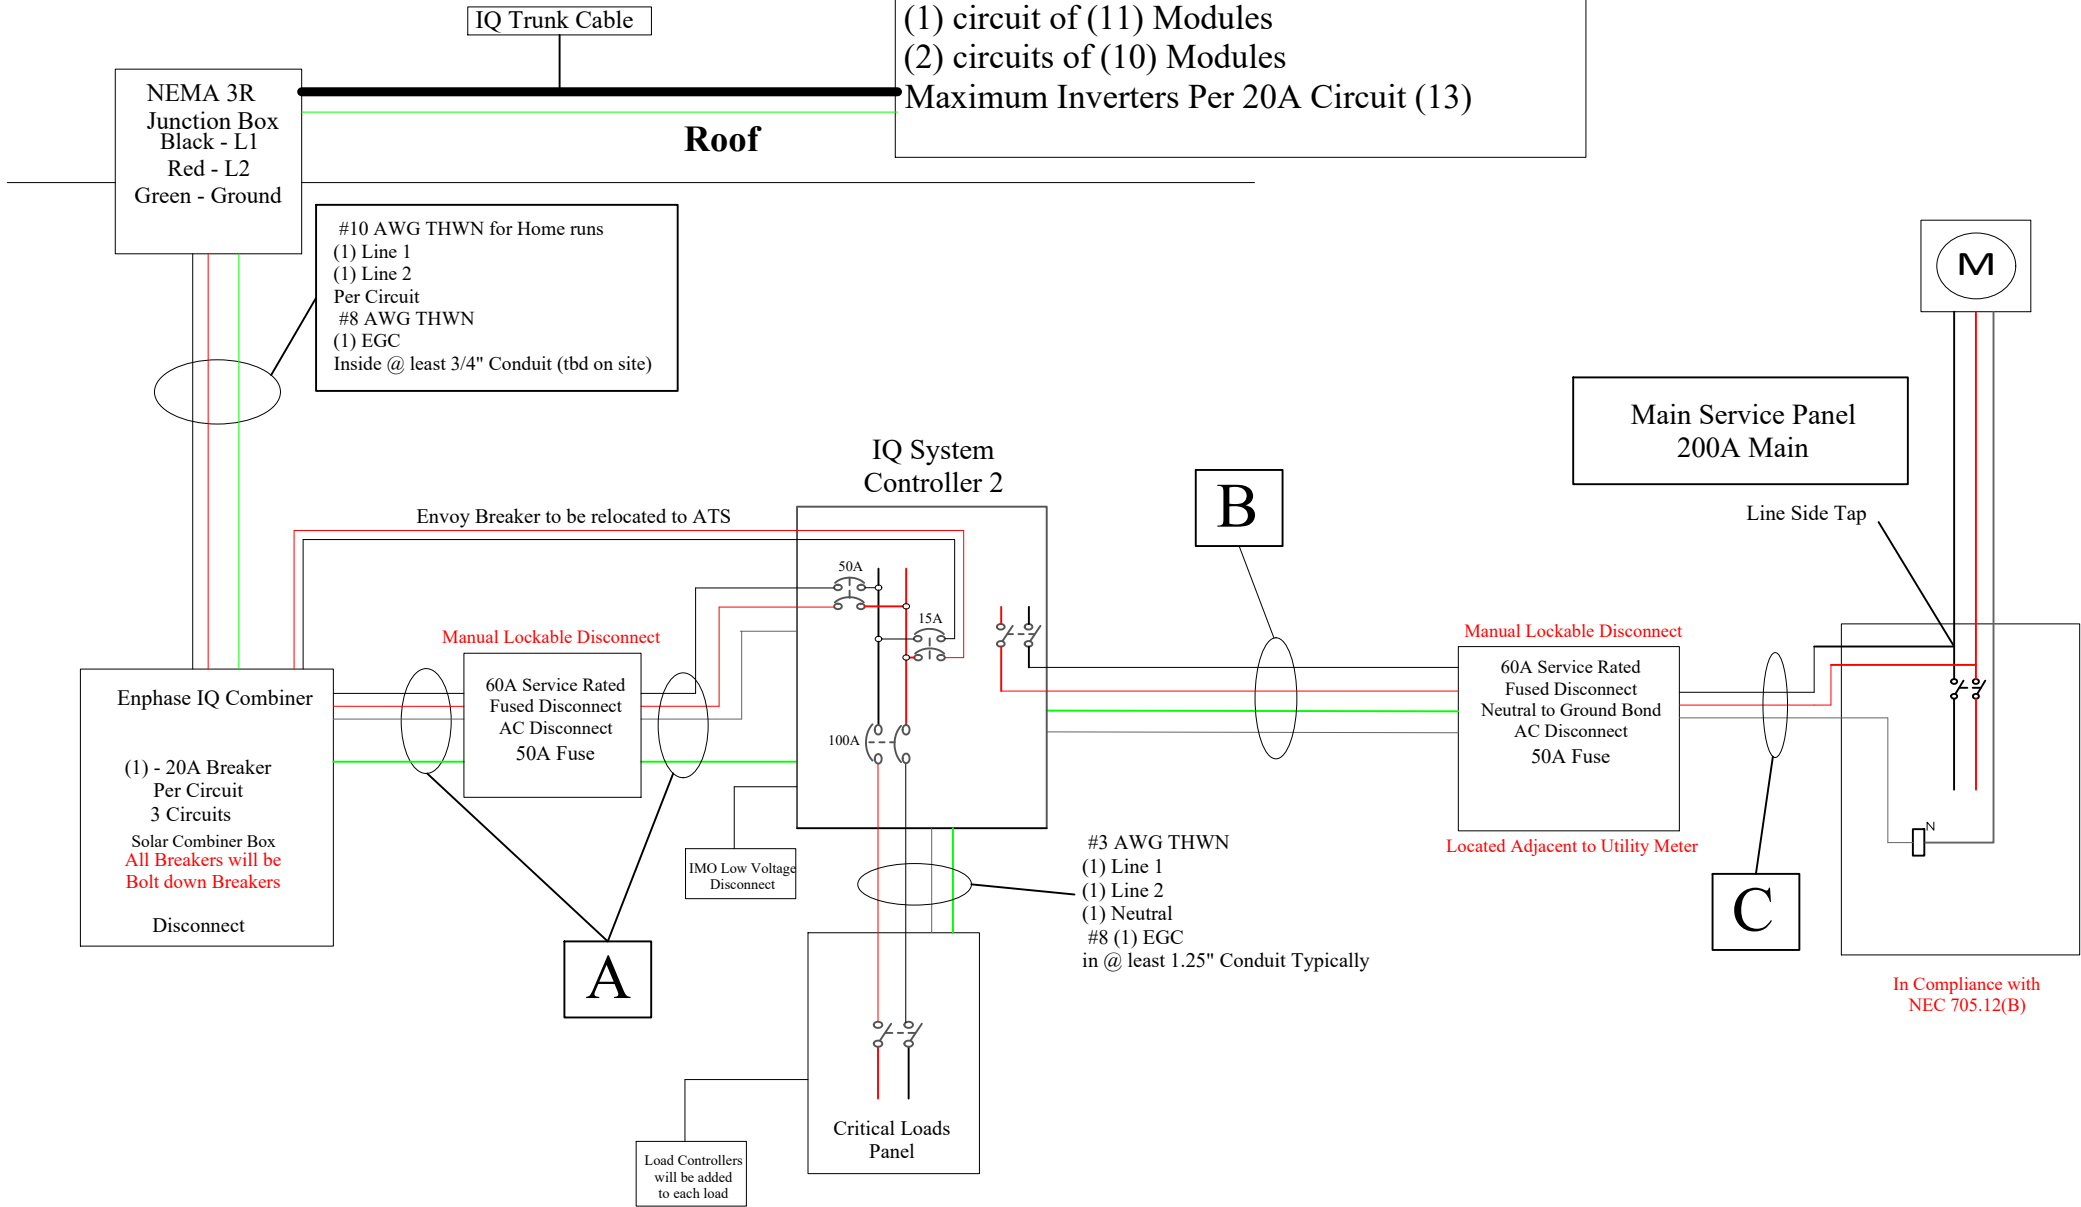

PHOTOVOLTAIC SYSTEM
! AC DISCONNECT !

RATED AC OUTPUT CURRENT: 37.51A
NOMINAL OPERATING VOLTAGE: 240VAC

Refer to NEC 312.8 for
Conditions on taps in switch
and over current devices
Enclosures.
If the conditions are not
met a tap box will
need to be installed
and revision completed.

Godwin Engineering and
Design, LLC
8378 Foxtail Loop
Pensacola, FL 32526
D. Chad Godwin, PE
Chad@godwineng.com



Donnie C Godwin
2022.05.12
'00'05- 17:43:03



6101 Johns Rd, Ste 8
Tampa, FL 33634
727-471-7442

Date: 5/12/2022

Drawn by: KT

Revised by: .

Rev #: 00

Rev Date: .

Page: 11"x17" E-1

Inverter Type:
Enphase IQ8PLUS-72-2-US
PV Panel:
(31)
SIL 370 HC
Total Wattage:
11,470W DC

Including the label below

In Case of Emergency Call
Solar Bear
at 727-471-7442
EC #: EC13006630

Meets 11.12.2.1.5

Note:

-All wiring to meet the 2017 NEC and
Florida electric codes.
60A Disconnect
-Type of conduit to be determined
on site by contractor.

Install will be done to Manufacturer Spec

GEC NOTES

- Ungrounded system per 690.41(A)(4)
- GEC must be installed per 250.64
- GEC must be continuous un-spliced or irreversibly spliced from inverter to existing service ground system or continuous from the arrays to the existing service ground system.
- GEC must be min #8 AWG and installed in conduit
- If GEC is not in conduit, it must be #6 min
- Disconnects will be Visible, lockable, adjacent to and within 10' of utility meter
- All Labels & Markings for photovoltaic system will be reflective and meet all requirements for NFPA 11.12

Customer Info:

Lee Caudill
634 SW Manatee Ter
Fort White, FL
32038

The Placard shall be permanently riveted..., and shall be made of red, weatherproof, hard plastic, with engraved white block lettering.

Rapid Shutdown Built in Per Code NEC 690.12

PV AC disconnect is lockable in the open position per code NEC 705.22(7)

-A placard will be added with instructions and locations to be in compliance with 690.12, 690.56(B) and NEC 705.10

In compliance with NEC 250.58, NEC 690.8, NEC 250.24, NEC250.24(D)

Conductors have a min ampacity of 60 amperes Per Code NEC 230.79(D)

Everything will be built to Code without all Specifics labeled on plan

System is in compliance with FFPC 1:11.12 7th Edition.

Smoke Detectors will be added as per FBC 553.883

Markings shall be placed on all DC Conduits, DC Combiners, Raceways, Enclosures, Junction Boxes, and Cable Assemblies at every 10', turns, and above and below penetrations in compliance with NFPA

Disconnect means shall be provided for all disconnecting all ungrounded conductors that supply or pass through the building or structure Per Code 2017 NEC Section 225.31 & Section 225.32

E04. Construction documents specify PV system circuits installed on or in buildings include a rapid shutdown function that controls specific conductors in accordance with NEC article 690.12.

E05. These construction documents specify that a label is provided with the method to initiate rapid shut down per 690.12(4).

E06. Construction drawings specify buildings or structures with both utility service and a PV system, complying with NEC article 690.12 shall have a permanent plaque or directory including the following wording: "PHOTO VOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN" as per NEC article 690.56 (C).

E07. Construction documents specify PV power circuit labels shall appear on every section of the wiring system that is separated by enclosures, walls, partitions, ceilings, or floors.

E08. Construction documents specify all warning sign(s) or label(s) shall comply with NEC article 110.21 (B). Label warnings shall adequately warn of the hazard. Labels shall be permanently affixed to the equipment, and Labels required shall be suitable for the environment.

System meets the grounding requirements of NEC 690.43

Inverter Output Ckt To Overcurrent Protection Device		
Design Temperature(F)	94°F	
Max Amb Temp Range(F)	87-95	310.15(B)(2)(a)
Temp Rating of Conductors (C)	75°C	
Current Carrying	<4	310.15(B)(3)(a)
AC Max Output Current	38A	690.8(A)(3)
AC Max Output Current * 1.25%	47A	690.8(B)
Overcurrent Protection(A)	50A	
Amp Temp Correction Factor	0.94	310.15(B)(2)(a)
Raceway Fill adjustment Factor	100%	310.15(B)(3)(a)
Wire Size(Awg)	6	310.15(B)(16)
Cond. Allowable Ampacity(A)	65A	
Cond Adjusted Ampacity(A)	61A	65A*1*0.94=61.1A
Ampacity Check 1 Per 690.8(B)(1)	Pass	37.51A*1.25=50A<65A Pass
Ampacity Check 2 Per 690.8(B)(2)	Pass	65A*0.94A*1=61.1A>37.51A Pass

All Exterior equipment is A minimum of Nema-R3 Rated

All Interactive System(S) Points of interconnection with other sources shall be marked at an accesible location at the disconnecting means as a power source and with the rated ac output current and the nominal operating AC voltage. Per NEC 690.54

Disconnect is in compliance 230.72

Supply side disconnect adjacent to Msp

Over Current Protection Device is "Next size up" Based on Inverter Maximum Continuous Output Current Rating 2017 NEC 240.4(B)

-All new equipment located adjacent to Meter on exterior wall

Labels will be placed in the correct location Per Code NEC 690.56(B), 690.56(C), & 690.53

Smoke Alarms per F.S. 553.883
Include required label for metallic raceways and conduits to sheet E-1 per NEC article 690.31(G)(3).

Add required label to sheet E-1 per NEC article 705.10.
Include required label to sheet E-1 per NEC article 705.12(B)
Photovoltaic AC disconnect shall be capable of being locked in the open position per NEC article 705.22(6).

Photovoltaic AC Overcurrent protection shall be located within 10 feet of the point where conductors are connected to the service per NEC 705.31.

-All Electrical Service Equipment shall be located at or above BFE+1' or 8.00' NAVD

Line Side Tap will be done in Main Service Panel in house.

-Markings Shall Be reflective, Weather Resistant and suitable for the environment.
-Markings Shall be red with white lettering with minimum 3/8" Capital Letters

Note:
-Subject PV Systems has been designed to meet the requirments of the NEC 2017, and those set forth by the Florida Solar Energy Center Certification, Including Maximum Number of Module Strings, Maximum number of modules per string, Maximum Output, Module Manufacturer and model number, inverter manufacturer and model number, as applicable.

NEC 705.10 A permanent plaque or directory, denoting the location of all electric power source disconnecting means on or in the premises, shall be installed at each service equipment location and at the location(s) of the system disconnect(s) for all electric power production sources capable of being interconnected. One sign required for each PV system.

Apply to Main Disconnect

Permanent sticker added to disconnect

In Case of Emergency Call Solar Bear at 727-471-7442 EC #: EC13006630

J-Box not penetrating roof

WARNING:PHOTOVOLTAIC POWER SOURCE

DO NOT OPEN UNDER LOAD

WARNING THIS SERVICE METER IS ALSO SERVED BY A PHOTOVOLTAIC SYSTEM 705.12(B)(3)

WARNING POWER SOURCE OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE 705.12(B)(2)(3)(b)

WARNING PHOTOVOLTAIC POWER SOURCE NEC 690.31 (G)(3)

3/8 IN MIN. TEXT

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY.

3/16 IN MIN. TEXT

WARNING: DUAL POWER SUPPLY SOURCES: UTILITY GRID AND PV SOLAR ELECTRIC SYSTEM

WARNING: INVERTER OUTPUT CONNECTION: DO NOT RELOCATE THIS OVERCURRENT DEVICE

! WARNING ! POWER SOURCE OUTPUT CONNECTION: DO NOT RELOCATE THIS OVERCURRENT DEVICE

WARNING: DEDICATED SOLAR PANEL DO NOT CONNECT ANY OTHER LOADS


PHOTOVOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN

Figure 690.56(C)(1)(a) Label for PV Systems that Shut down the array and the conductors leaving the array

Godwin Engineering and Design, LLC
8378 Foxtail Loop
Pensacola, FL 32526
D. Chad Godwin, PE
Chad@godwineng.com

D. CHAD GODWIN
LICENSE
No. 81358
STATE OF FLORIDA
PROFESSIONAL ELECTRICAL ENGINEER

Donnie C Godwin
2022.05.12
'00'05- 17:43:20



SOLAR BEAR
RESIDENTIAL & COMMERCIAL EFFICIENCIES

6101 Johns Rd, Ste 8
Tampa, FL 33634
727-471-7442

Date: 5/12/2022

Drawn by: KT

Revised by: .

Rev #: 00


Rev Date: .

Page: 11"x17" E-2

Inverter Type: Enphase IQ8PLUS-72-2-US
PV Panel: (31)
SIL 370 HC
Total Wattage: 11,470W DC

EMERGENCY RESPONDER
THIS SOLAR PV SYSTEM IS
EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE 'OFF' POSITION TO SHUT DOWN THE ENTIRE PV SYSTEM.



NEC690.56(C)(1) AND NFPA 111.12.2.1.1.1.1,11.12.2.1.4

WARNING

ELECTRIC SHOCK HAZARD
DO NOT TOUCH TERMINALS.
TERMINALS ON BOTH THE LINE
AND LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION. 690.17E

NEC 690.35

Install will be done to Manufacturer Spec

Including the label below


In Case of Emergency Call Solar Bear at 727-471-7442 EC #: EC13006630

Customer Info:

Lee Caudill
634 SW Manatee Ter
Fort White, FL 32038

Ⓛ ← Proposed Mounting locations

- Iron Ridge XR-100 Rail
- 14' 17
- 7'
- 4'
- 14 ■ Splice Bar
- 63 Use S-5! Proteas
- 68 Iron Ridge UFO's
- 12 Iron Ridge Sleeves/End Caps
- 1 6x6 J-Box
- 3 Iron Ridge Ground Lugs
- 31 SIL 370 HC
- 31 Enphase IQ8PLUS-72-2-US
- 2 60A Fused Disconnect
- 4 50A Fuses
- 1 IQ Combiner
- 1 50A Breaker for Solar
- 3 20A 2P Breakers
- 1 IQ System Controller 2
- 1 100A Breaker for ATS
- 1 1-Pole 15A Breaker
- 2 Enphase Load Controllers
- 1 Critical loads panel
- 1 IMO Disco

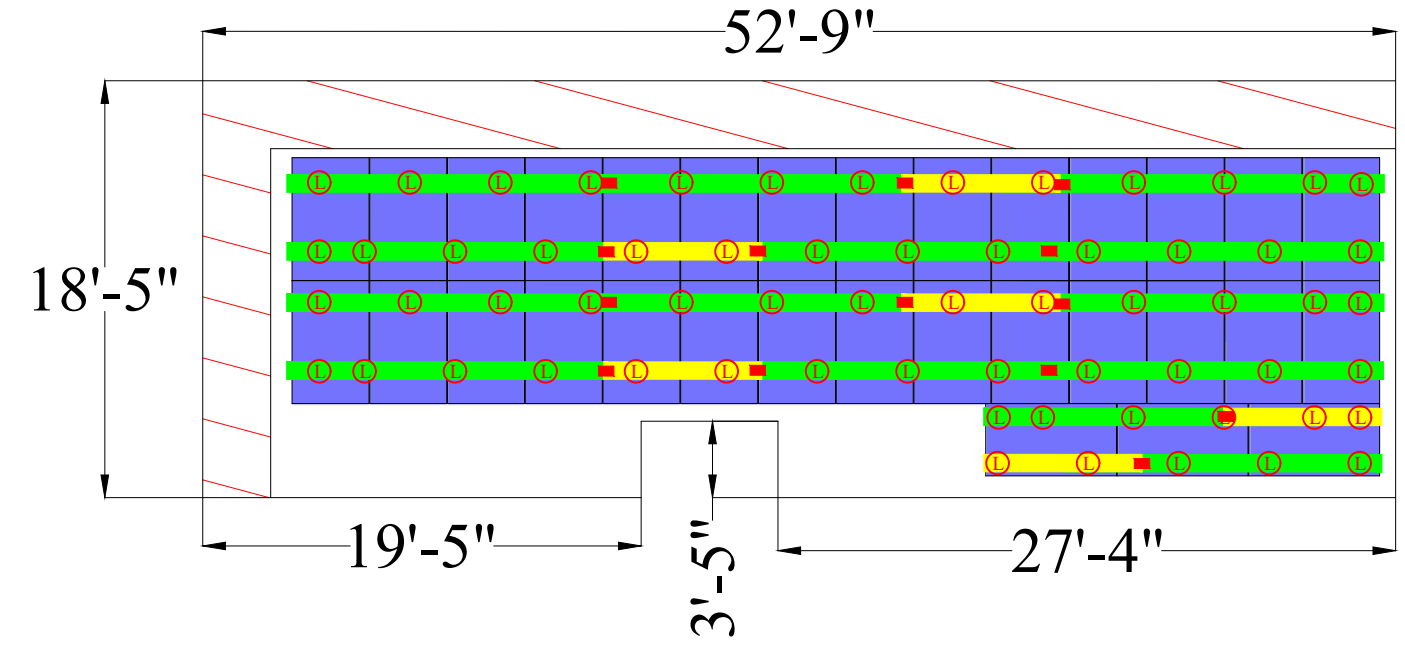

R-1
Modules (31)
Pitch: 33°
Azimuth: 102°

Plans satisfy zones FBC-1510.7.1
Install will be done to Manufacturer Spec


Zone 1, 2e, 2r,2n, 3e, & 3r: Max cantilever is 16" as per manufacturer spec.
Max Cantilever = Max Span * (1/3)=48"*(1/3)=16"

Inverter Type: (31)Enphase IQ8PLUS-72-2-US	Customer Info: Lee Caudill 634 SW Manatee Ter Fort White, FL 32038
PV Panel: (31) SIL 370 HC	
Racking: Iron Ridge XR-100	
Total Wattage: 11,470W DC	
Roof Type: Metal	
Wind Load: 27 to 45 Deg	
Fastener Type: Use S-5! Proteas	

Godwin Engineering and Design, LLC 8378 Foxtail Loop Pensacola, FL 32526 D. Chad Godwin, PE Chad@godwineng.com		 Donnie C Godwin 2022.05.12 '00'05- 17:43:43	
 6101 Johns Rd, Ste 8 Tampa, FL 33634 727-471-7442			
Date: 5/12/2022			
Drawn by: KT			
Revised by: .			
Rev #: 00			
Rev Date: .			
Page: 11"x17" S-1A			

SILFAB PRIME

SIL-370 HC

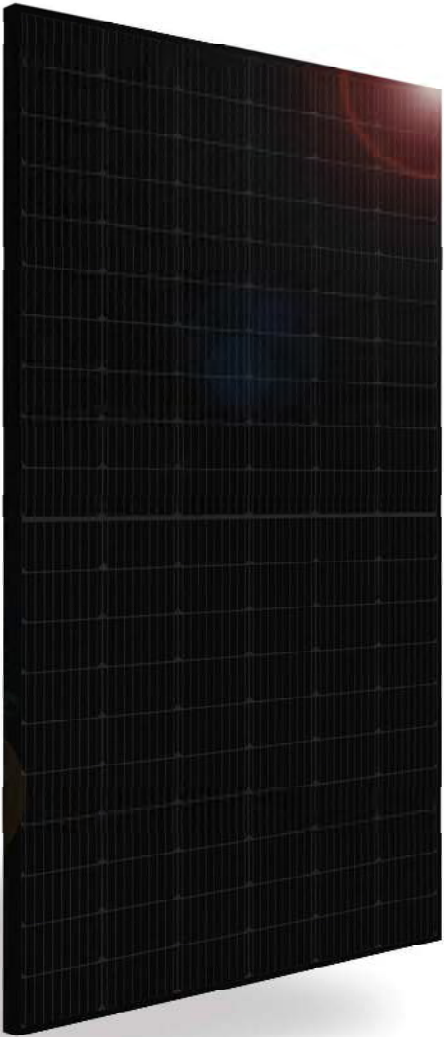

RELIABLE ENERGY.
DIRECT FROM THE SOURCE.

Introducing Silfab Prime.

Designed to outperform.

Dependable, durable, high-performance solar panels
engineered for North American homeowners.

SILFABSOLAR.COM



CHUBB
* Chubb provides error and omission insurance to Silfab Solar Inc.

ELECTRICAL SPECIFICATIONS		370	
Test Conditions		STC	NOCT
Module Power (Pmax)	Wp	370	276
Maximum power voltage (Vpmax)	V	34.95	32.48
Maximum power current (Ipmax)	A	10.60	8.50
Open circuit voltage (Voc)	V	41.75	39.16
Short circuit current (Isc)	A	11.25	9.07
Module efficiency	%	20.2%	18.9%
Maximum system voltage (VDC)	V	1000	
Series fuse rating	A	20	
Power Tolerance	Wp	0 to +10	


Measurement conditions: STC 1000 W/m² • AM 1.5 • Temperature 25 °C • NOCT 800 W/m² • AM 1.5 • Measurement uncertainty ≤ 3%
Sun simulator calibration reference modules from Fraunhofer Institute. Electrical characteristics may vary by ±5% and power by 0 to +10W.

MECHANICAL PROPERTIES / COMPONENTS	METRIC	IMPERIAL
Module weight	19.5kg ±0.2kg	43lbs ±0.4lbs
Dimensions (H x L x D)	1762 mm x 1037 mm x 35 mm	69.4 in x 40.8 in x 1.37 in
Maximum surface load (wind/snow)*	5400 Pa rear load / 5400 Pa front load	112.8 lb/ft² rear load / 112.8 lb/ft² front load
Hail impact resistance	ø 25 mm at 83 km/h	ø 1 in at 51.6 mph
Cells	120 Half cells - Si mono PERC 9 busbar - 83 x 166 mm	120 Half cells- Si mono PERC 9 busbar - 3.26 x 6.53 in
Glass	3.2 mm high transmittance, tempered, DSM antireflective coating	0.126 in high transmittance, tempered, DSM antireflective coating
Cables and connectors (refer to installation manual)	1350 mm, ø 5.7 mm, MC4 from Staubli	53.15 in, ø 0.22 in (12AWG), MC4 from Staubli
Backsheet	High durability, superior hydrolysis and UV resistance, multi-layer dielectric film, fluorine-free PV backsheet	
Frame	Anodized Aluminum (Black)	
Bypass diodes	3 diodes-30SQ045T (45V max DC blocking voltage, 30A max forward rectified current)	
Junction Box	UL 3730 Certified, IEC 62790 Certified, IP68 rated	

TEMPERATURE RATINGS		WARRANTIES	
Temperature Coefficient Isc	+0.064 %/°C	Module product workmanship warranty	25 years**
Temperature Coefficient Voc	-0.28 %/°C	Linear power performance guarantee	30 years
Temperature Coefficient Pmax	-0.36 %/°C		≥ 97.1% end 1st yr ≥ 91.6% end 12th yr ≥ 85.1% end 25th yr ≥ 82.6% end 30th yr
NOCT (± 2°C)	45 °C		
Operating temperature	-40/+85 °C		

CERTIFICATIONS		SHIPPING SPECS	
Product	ULC ORD C1703, UL1703, CEC listed, UL 61215-1/-1-1/-2, UL 61730-1/-2, IEC 61215-1/-1-1/-2***. IEC 61730-1/-2***, CSA C22.2#61730-1/-2, IEC 62716 Ammonia Corrosion; IEC61701:2011 Salt Mist Corrosion Certified, UL Fire Rating: Type 2	Modules Per Pallet:	26 or 26 (California)
Factory	ISO9001:2015	Pallets Per Truck	34 or 32 (California)
		Modules Per Truck	884 or 832 (California)

* ⚠ Warning. Read the Safety and Installation Manual for mounting specifications and before handling, installing and operating modules.
** 12 year extendable to 25 years subject to registration and conditions outlined under “Warranty” at [silfabsolar.com](#)
*** Certification in progress.
PAN files generated from 3rd party performance data are available for download at: [silfabsolar.com/downloads](#)

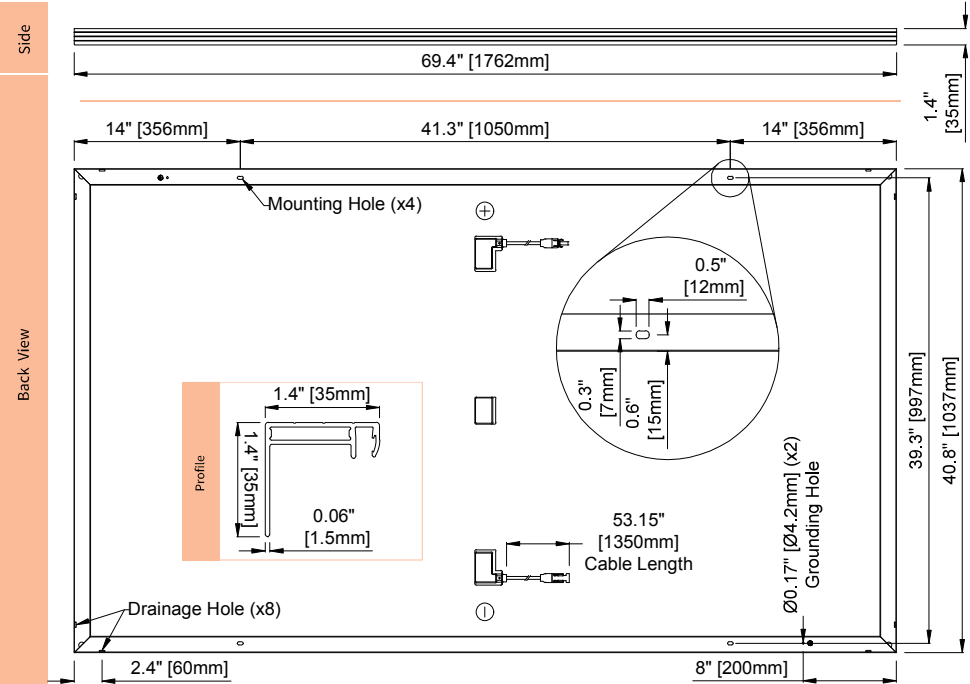

SILFAB SOLAR INC.

800 Cornwall Ave
Bellingham WA 98225 USA
T +1 360.569.4733
info@silfabsolar.com
[SILFABSOLAR.COM](#)

1770 Port Drive
Burlington WA 98233 USA
T +1 360.569.4733

240 Courtneypark Drive East
Mississauga ON L5T 2Y3 Canada
T +1 905.255.2501
F +1 905.696.0267

Silfab - SIL-370-HC-20210803
No reproduction of any kind is allowed without permission. Data and information is subject to modifications without notice. © Silfab Solar Inc., 2021. Silfab Solar™ is a trademark of Silfab Solar Inc.



IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters are the industry’s first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer’s instructions.

Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

High productivity and reliability

- Produce power even when the grid is down
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Complies with the latest advanced grid support
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

IQ8 and IQ8+ Microinverters

INPUT DATA (DC)		I08-60-2-US	I08PLUS-72-2-US
Commonly used module pairings¹	W	235 – 350	235 – 440
Module compatibility		60-cell/120 half-cell	60-cell/120 half-cell and 72-cell/144 half-cell
MPPT voltage range	V	27 – 37	29 – 45
Operating range	V	25 – 48	25 – 58
Min/max start voltage	V	30 / 48	30 / 58
Max input DC voltage	V	50	60
Max DC current² [module Isc]	A	15	
Overvoltage class DC port		II	
DC port backfeed current	mA	0	
PV array configuration		1x1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		I08-60-2-US	I08PLUS-72-2-US
Peak output power	VA	245	300
Max continuous output power	VA	240	290
Nominal (L-L) voltage/range³	V	240 / 211 – 264	
Max continuous output current	A	1.0	1.21
Nominal frequency	Hz	60	
Extended frequency range	Hz	50 – 68	
Max units per 20 A (L-L) branch circuit⁴		16	13
Total harmonic distortion		<5%	
Overvoltage class AC port		III	
AC port backfeed current	mA	30	
Power factor setting		1.0	
Grid-tied power factor (adjustable)		0.85 leading – 0.85 lagging	
Peak efficiency	%	97.5	97.6
CEC weighted efficiency	%	97	97
Night-time power consumption	mW	60	
MECHANICAL DATA			
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)	
Relative humidity range		4% to 100% (condensing)	
DC Connector type		MC4	
Dimensions (HxWxD)		212 mm (8.3”) x 175 mm (6.9”) x 30.2 mm (1.2”)	
Weight		1.08 kg (2.38 lbs)	
Cooling		Natural convection – no fans	
Approved for wet locations		Yes	
Acoustic noise at 1 m		<60 dBA	
Pollution degree		PD3	
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure	
Environ. category / UV exposure rating		NEMA Type 6 / outdoor	
COMPLIANCE			
		CA Rule 21 (UL 1741-SA), UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01	
Certifications		This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer’s instructions.	

(1) No enforced DC/AC ratio. See the compatibility calculator at <https://link.enphase.com/module-compatibility> (2) Maximum continuous input DC current is 10.6A (3) Nominal voltage range can be extended beyond nominal if required by the utility. (4) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

Enphase IQ Combiner 4/4C

X-IQ-AM1-240-4
X-IQ-AM1-240-4C



The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed

Enphase IQ Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shield to match the IQ Battery system and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS	
(not included, order separately)	
Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	- Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1



To learn more about Enphase offerings, visit enphase.com



To learn more about Enphase offerings, visit enphase.com

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 10-21-2021







XR Rail Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

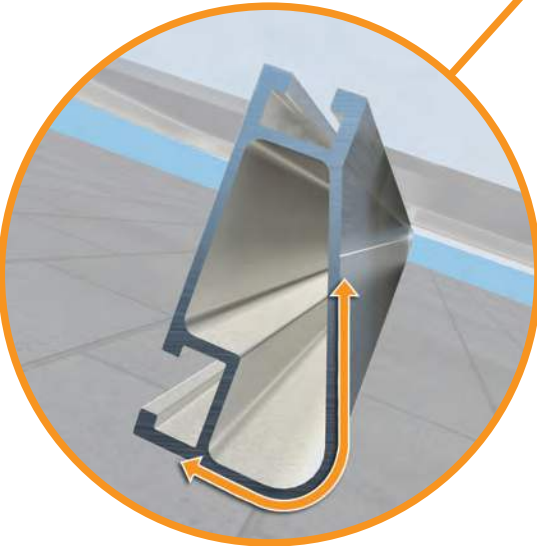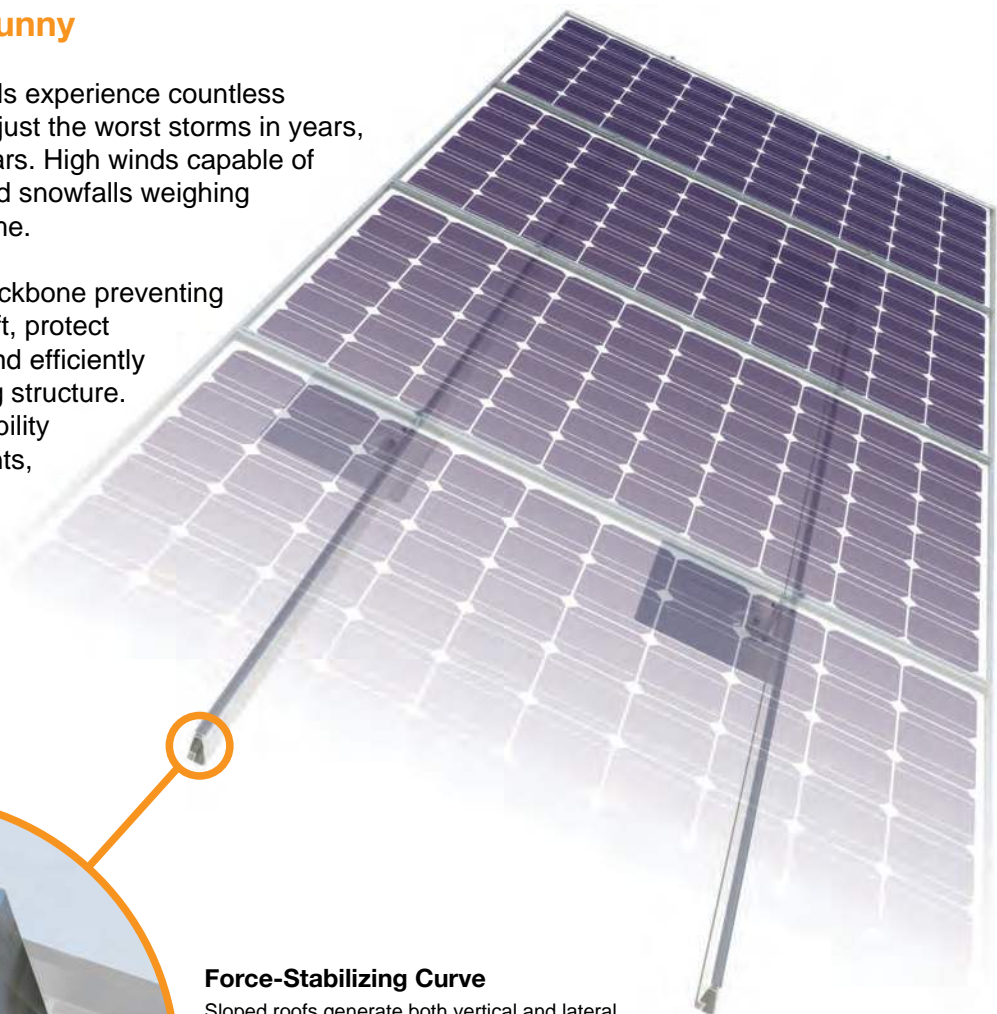

Force-Stabilizing Curve
Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs

- 

XR Rails are compatible with FlashFoot and other pitched roof attachments.
- 

IronRidge offers a range of tilt leg options for flat roof mounting applications.

Corrosion-Resistant Materials

All XR Rails are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



XR Rail Family

The XR Rail Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail to match.



XR10

XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while remaining light and economical.

- 6' spanning capability
- Moderate load capability
- Clear & black anodized finish
- Internal splices available



XR100

XR100 is the ultimate residential mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.

- 10' spanning capability
- Heavy load capability
- Clear & black anodized finish
- Internal splices available



XR1000

XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
- Clear anodized finish
- Internal splices available

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90	XR10		XR100		XR1000	
	120						
	140						
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
120	160						

*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.



GODWIN ENGINEERING AND DESIGN, LLC

8378 Foxtail Loop, Pensacola, FL 32526 | (850)712-4219 | chad@godwineng.com

May 13, 2022

To: Columbia County Building Department
135 NE Hernando Ave
Lake City, FL 32055

Re: Caudill – Residential PV Roof Mount Installation
634 SW Manatee Ter.
Fort White, FL 32038

Plan Reviewer,

This letter is regarding the installation of a new roof mounted Solar PV System on the existing residential structure at the address above. I have reviewed the attachment plan and have determined that the roof mounted PV system is in compliance with the applicable sections of the following Codes as amended and adopted by the jurisdiction:

2020 Florida Building Code 7th Edition, FBC
ASCE 7 Min. Design Loads for Buildings & Other Structures

Per 2020 FBC, the Roof Mounted PV system will be subject to the following design criteria:
Design Wind Speed (V_{ult}) - 120mph 3sec gust, Exposure Category – B

The PV System consist of the modules, railing, and connection hardware. The system will add a dead load of approximately 3 psf to the roof.

The existing roof covering is 24ga. Metal panel with min. ½" plywood decking and 2" x 4" roof trusses 24" O.C. The roofing, decking, and roof trusses are in good condition. The existing structure will be adequate for supporting the additional PV dead load and wind loads.

The securement method of the PV system is to be flush mounted to the metal panel roof with the Iron ridge railing and the S-5! Protea Brackets. The flashings/attachments can be attached up to 48" apart in roof zones 1, 2e, 2n, 2r, 3e & 3r. The mounts should be staggered, where possible, to allow distribution of the design loads evenly to the structure. The mounts shall be installed using (4) 6mm x 25mm BI-Metal Self-Piercing.

Please see attached documents and contact me should you have any questions.

Sincerely,

D. Chad Godwin, PE 81360
Exp. 02/28/2023



Donnie C Godwin
2022.05.12
'00'05- 17:44:09

ASCE 7-16 CHAPTER 29 WIND LOADS - Rooftop Solar Panels Minimum Design Loads - Part 1: Enclosed(Gable,Hip,Flat h<60ft, 0°<θ<45°)									
Wind Load Parameters - Inputs					Wind Load Parameters				
Risk Category	II	Table 1.5-1	Wind Speed (asd)	93	mph	FRC R301.2.1.3			
Basic Wind Speed (Ult)	120	mph	Effective Wind Area	19.66	ft²	26.20			
Roof Angle	28° to 45°		Wind Directionality	K _d	0.85	Table 26.6-1			
Roof Type	Gable		Topographic factor	K _{zt}	1.00	26.8 or 26.8.2			
Exposure Cat.	B, C, or D	P	Ground Elevation Factor	K _e	1.00	Table 26.9-1			
Mean Roof Height	h	15.00	Velocity Exposure Coefficient	K _z	0.70	Table 26.10-1			
Roof attachment	Proteabricket		Array Edge Factor	γ _e	1.50	29.4.4	*Modules are considered Exposed		
Rafter/Truss Spacing	24	in O.C.	Solar Panel Equalization Factor	γ _s	0.68	Fig. 29.4-8			
No. of Rails	2		Velocity Pressure	q _h	13.16	psf	q _h =0.00256 K _z K _{zt} K _e V ²		
No. of Modules - Portrait	28		Added Safety Factor		1.2				
No. of Modules - Landscape	3		Allowable Pullout per mount		633.0	lbs			
Module Model Number	SIL-370 HC		0.4h or 0.6h	6.00	ft	Flat - 0.6h, Gable, Hip - 0.4h			
bldg. least horizontal dim (typ.)	180	in	10% of least horizontal dim	1.50	ft	10% of least hor. Dim. Or 0.4h, whichever is smaller, but not less than either 4% of Least hor. Or 3ft. (flat roof - 0.6h)			
Elevation	<1000	ft	Roof Zone Set Back	a	3.00	ft			
Est. # of attachment points	63		h ₂	5	in	Not > 10in(panel height above roof)			
PV Dead Load			2h ₂	10	in	*min distance array shall be from the roof edge, Gable Ridge, or hip ridge			
Module and Racking Specs				0.25	in	min gap between all panels but not > 6.7ft			
# of Modules	31		Dimensions, LxWxH (in)	69.4 x 40.8 x 1.4					
Module	W _{mod}	43	Width	3.40	ft	d1	1.00	ft	Horizontal distance orthogonal to panel edge
Array	W _{mods}	1333	Length	5.78	ft	d2	0.25	ft	Horizontal distance from edge of one panel to the nearest edge in the next row
Micro/optimizer	W _{mic}	124	Module Area	19.66	ft²	0.5h	7.50	ft	*modules are considered exposed that are within 1.51p from roof edge
PV Rail	W _{PV rail}	24	Module load ratings			Notes			
Total Weight	W _{total}	1481	Ultimate Allowable						
Total Area	A _T	609.56	Load Rating - Snow(psf)	113.4	75.6	Eq.1 Point Load = Roof Zone psf * TA			
Dead Load	D _{PV}	2.43	Load Rating - Wind(psf)	-113.4	-75.6	Eq.2 TA = (Module Length / 2) * Max Span			
Weight/attachment		23.5				Eq.3 *Max span Equation, SF = Allowable pullout / Point Load			
PV Attachment - Results						Eq.4 Max Span = Allowable Pullout / (SF * Roof Zone psf * L/2)			
Roof Zones - Gable 28° to 45°									
	1	2e	2r	2n	3e	3r			
GC _p - Uplift	-1.5	-1.5	-1.5	-1.5	-1.8	-2.2			
GC _p - Down	0.9	0.9	0.9	0.9	0.9	0.9			
p = q _h (GC _p)(γ _d)(γ _w)	-17.8	-17.8	-17.8	-17.8	-21.8	-27.2	psf	29.4-7	
p = q _h (GC _p)(γ _d)(γ _w)	12.1	12.1	12.1	12.1	12.1	12.1	psf	29.4-7	
Max Allowable Span	6	6	6	6	6	6	ft	*notes	
Max Cantilever (in)	24	24	24	24	24	24	Max span * 33% (in)		

Donnie C
Godwin
2022.05.
12
17:44:23
'00'05-



THIS ITEM HAS BEEN ELECTRONICALLY
SIGNED AND SEALED BY DONNIE CHAD
GODWIN USING A DIGITAL SIGNATURE AND
DATE. PRINTED COPIES OF THIS DOCUMENT
ARE NOT CONSIDERED SIGNED AND SEALED
AND THE SIGNATURE MUST BE VERIFIED ON
ANY ELECTRONIC COPIES