


4/12 - 6/12 - 10/12 PITCH = 18" O/H

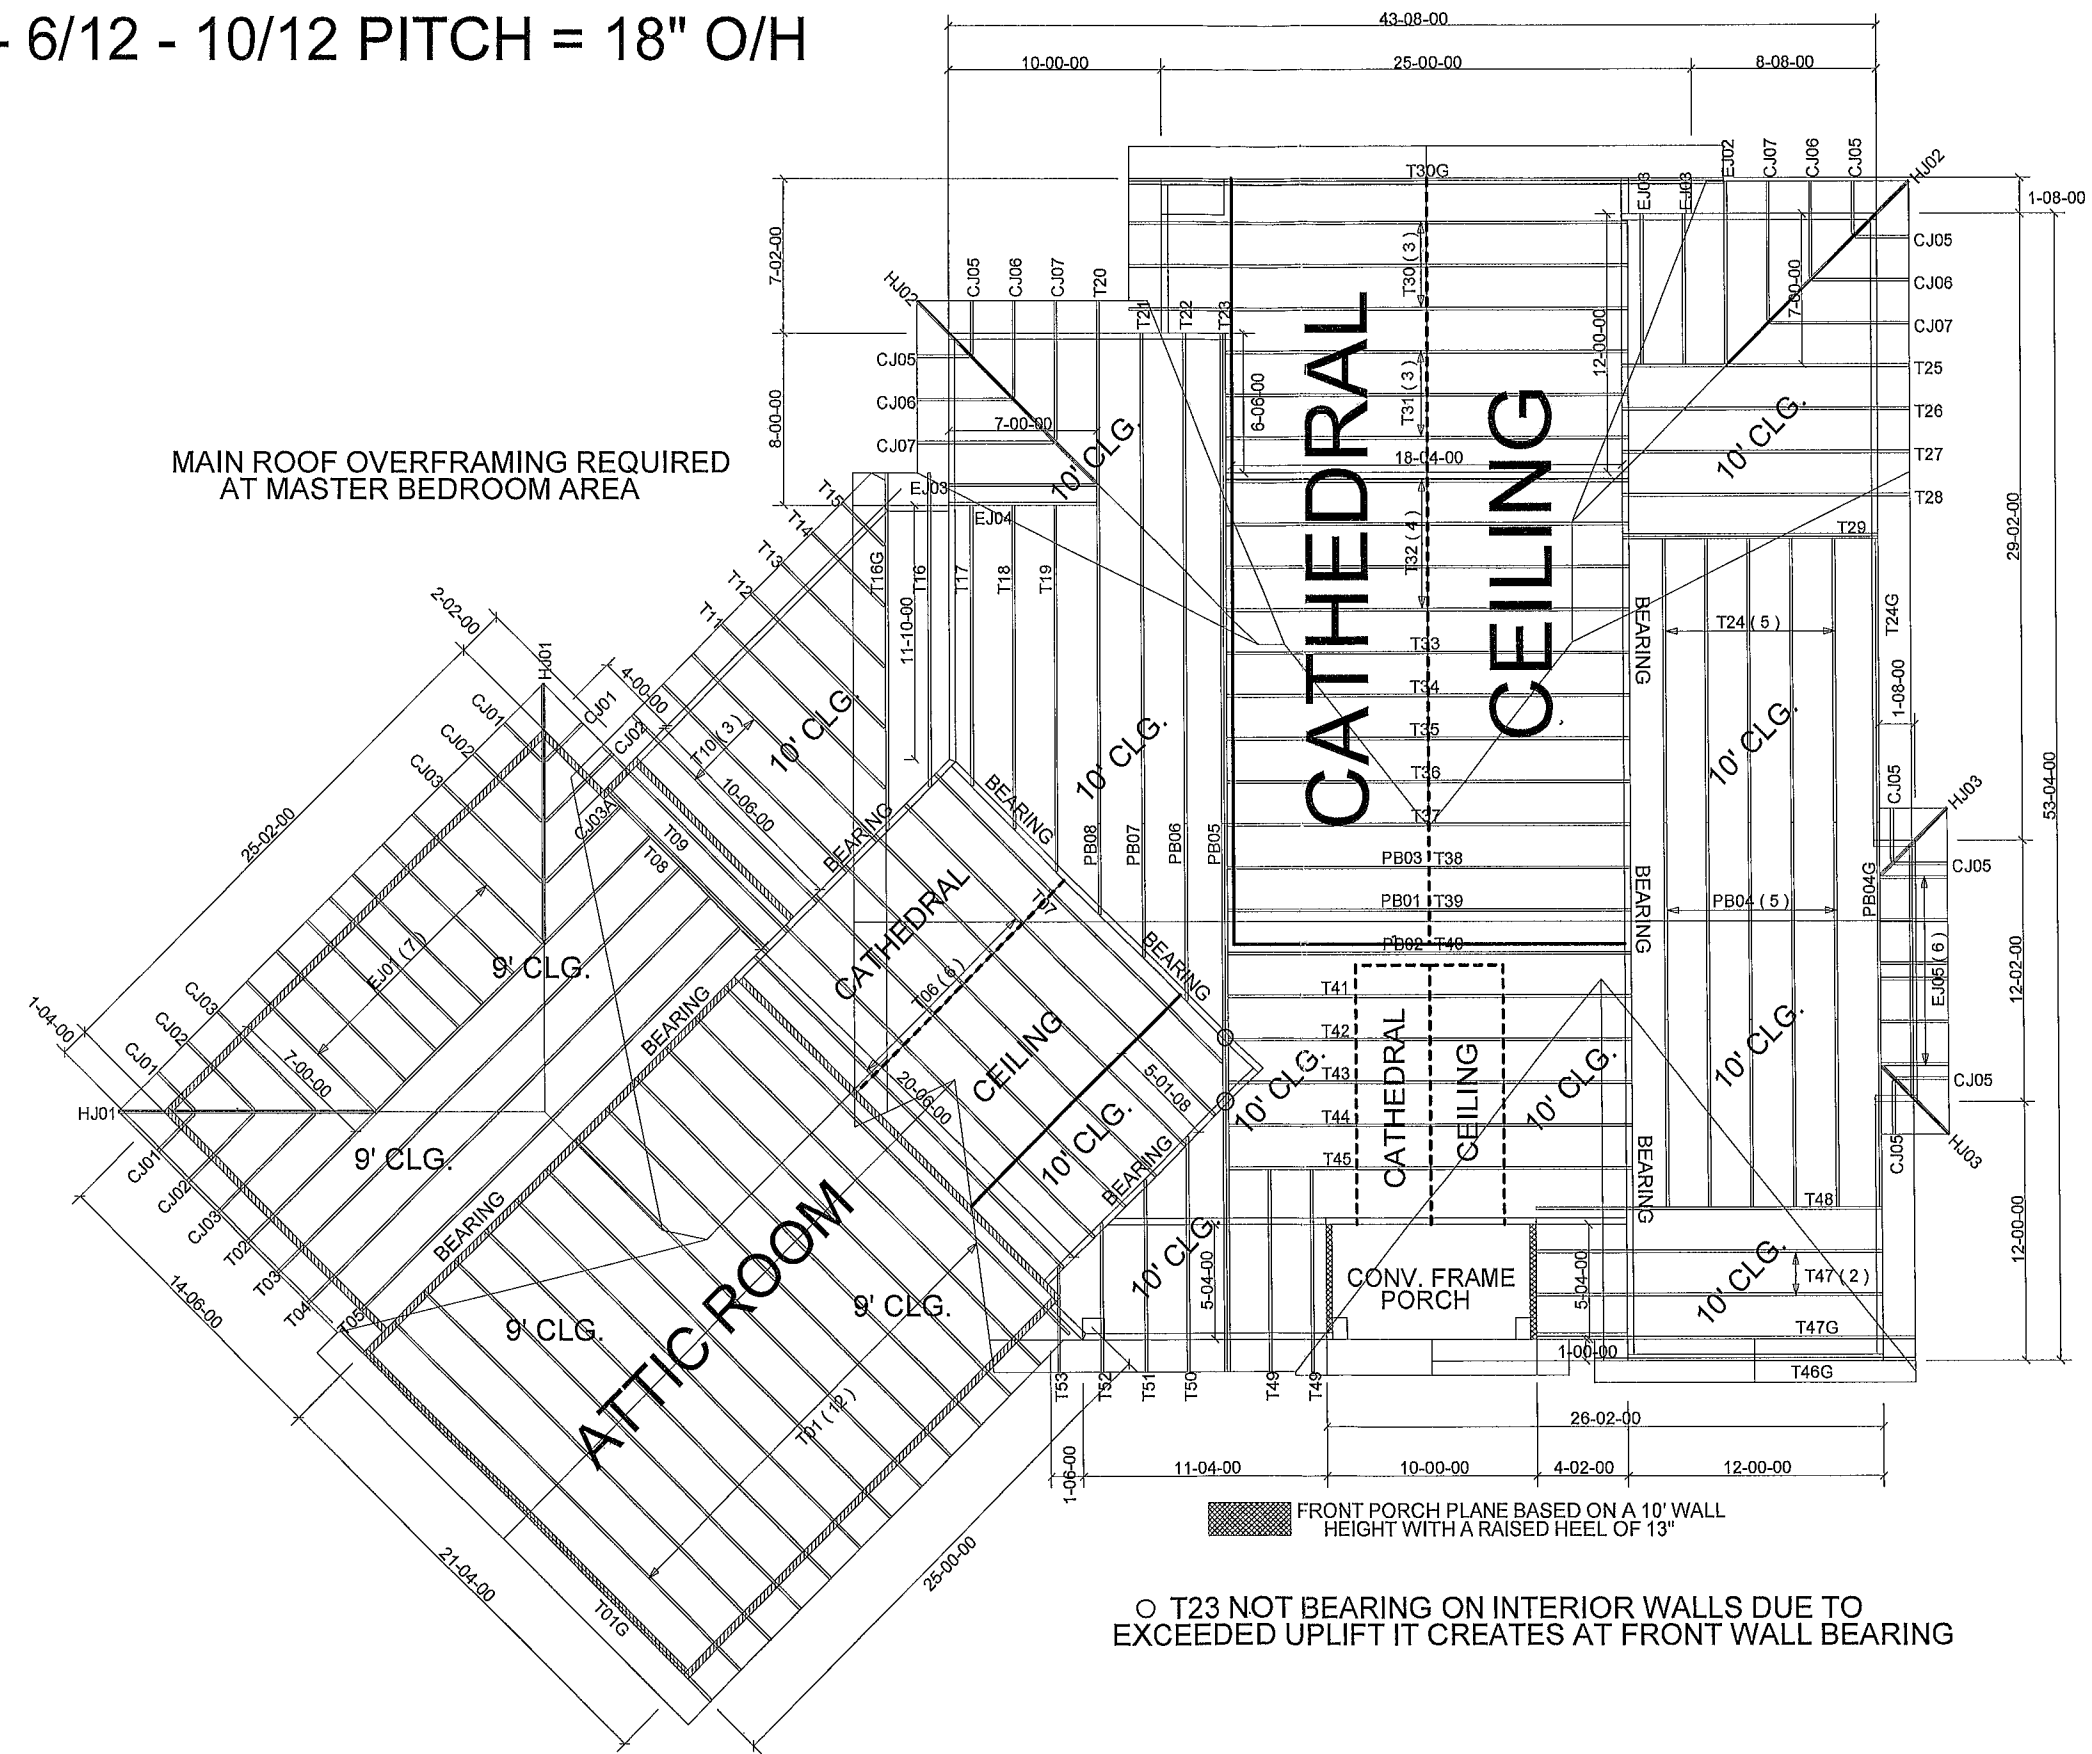

MAIN ROOF OVERFRAMING REQUIRED
AT MASTER BEDROOM AREA

○ T23 NOT BEARING ON INTERIOR WALLS DUE TO
EXCEEDED UPLIFT IT CREATES AT FRONT WALL BEARING

BEARING HEIGHT SCHEDULE

	9' 1-1/8"
	10' 1-1/8"

NOTES

- 1) REFER TO HIB 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED
- 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V105 FOR ALTERNATE BRACING REQUIREMENTS.
- 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.
- 4) ALL TRUSSES ARE DESIGNED FOR 2' o.c. MAXIMUM SPACING, UNLESS OTHERWISE NOTED
- 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED
- 6) SY42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP
- 7) BEAM/HEADER/LINTEL (HOR) TO BE FURNISHED BY BUILDER.

Builders
FirstSource

Jacksonville
PHONE 904 772 6100 FAX 904 772-1973

Tampa
PHONE 813-621-9831 FAX 813-628-8956

Freeport
PHONE 850 835-4541 FAX 850 835 6835

BUILDER:
SIMQUE RES.

LEGAL ADDRESS

MODEL	CUSTOM	Revision
DATE	2-6-14	KLH
Original Reference #	550284	
1st Level Job #	2nd Level Job #	3rd Level Job #
		550284

MITEK PLATE APPROVAL #'s 2197.2 - 2197.4, WEYERHAUSER PRODUCT #'s 1630.2 - 1630.10