



Lumber design values are in accordance with ANSI/TPI 1 section 6.3  
These truss designs rely on lumber values established by others.

RE: Brian\_Papka -

MiTek USA, Inc.  
6904 Parke East Blvd.  
Tampa, FL 33610-4115

**Site Information:**

Customer Info: Brian Papka Project Name: . Model: .  
Lot/Block: . Subdivision: .  
Address: ., .  
City: Lake City State: FL

**Name Address and License # of Structural Engineer of Record, If there is one, for the building.**

Name: License #:  
Address:  
City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.4  
Wind Code: N/A Wind Speed: 130 mph  
Roof Load: 40.0 psf Floor Load: N/A psf


This package includes 59 individual, Truss Design Drawings and 0 Additional Drawings.  
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T22646423	A1GE	1/29/21	23	T22646445	D1GE	1/29/21
2	T22646424	A2	1/29/21	24	T22646446	D2	1/29/21
3	T22646425	A3	1/29/21	25	T22646447	D3	1/29/21
4	T22646426	A4	1/29/21	26	T22646448	D4	1/29/21
5	T22646427	A5GIR	1/29/21	27	T22646449	D5	1/29/21
6	T22646428	A6GIR	1/29/21	28	T22646450	D6	1/29/21
7	T22646429	A7	1/29/21	29	T22646451	D7GIR	1/29/21
8	T22646430	A8	1/29/21	30	T22646452	E1GE	1/29/21
9	T22646431	A9GIR	1/29/21	31	T22646453	E2	1/29/21
10	T22646432	A10	1/29/21	32	T22646454	F1GE	1/29/21
11	T22646433	A11GIR	1/29/21	33	T22646455	F2	1/29/21
12	T22646434	A12	1/29/21	34	T22646456	GIR1	1/29/21
13	T22646435	A13	1/29/21	35	T22646457	GIR2	1/29/21
14	T22646436	A14GE	1/29/21	36	T22646458	GIR3	1/29/21
15	T22646437	B1GE	1/29/21	37	T22646459	J01	1/29/21
16	T22646438	B2	1/29/21	38	T22646460	J02	1/29/21
17	T22646439	B3	1/29/21	39	T22646461	K1	1/29/21
18	T22646440	B4	1/29/21	40	T22646462	K2	1/29/21
19	T22646441	B5	1/29/21	41	T22646463	K3	1/29/21
20	T22646442	C1GE	1/29/21	42	T22646464	M01	1/29/21
21	T22646443	C2	1/29/21	43	T22646465	M04	1/29/21
22	T22646444	C3GIR	1/29/21	44	T22646466	PB01	1/29/21

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc.  
under my direct supervision based on the parameters  
provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Lee, Julius  
My license renewal date for the state of Florida is February 28, 2021.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

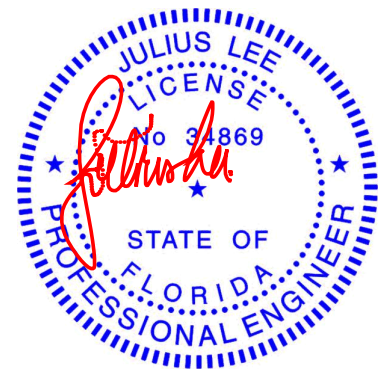

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021



RE: Brian\_Papka -

MiTek USA, Inc.  
6904 Parke East Blvd.  
Tampa, FL 33610-4115

**Site Information:**

Customer Info: Brian Papka   Project Name: .   Model: .  
Lot/Block: .   Subdivision: .  
Address: ., .  
City: Lake City   State: FL


No.	Seal#	Truss Name	Date
45	T22646467	PB01GE	1/29/21
46	T22646468	PB02	1/29/21
47	T22646469	PB03	1/29/21
48	T22646470	PB04	1/29/21
49	T22646471	PB05	1/29/21
50	T22646472	PB06	1/29/21
51	T22646473	PB07	1/29/21
52	T22646474	PB08	1/29/21
53	T22646475	PB09	1/29/21
54	T22646476	PB10	1/29/21
55	T22646477	PB11GE	1/29/21
56	T22646478	PB12	1/29/21
57	T22646479	PB13GE	1/29/21
58	T22646480	PB14	1/29/21
59	T22646481	PB15	1/29/21

Job	Truss	Truss Type	Qty	Ply	T22646423
BRIAN_PAPKA	A1GE	Piggyback Base Structural Gable Gable	1	1	
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:37 2021 Page 1

ID:mkUrRvu8rLIGNYOWf0CO?iyAQHF-KZ\_69dJ1XHP?BS1qDi2XQyuRGpCpCYOUSjxFowQzquW



Scale = 1:87.1

TOP CHORD UNDER PIGGYBACKS  
TO BE Laterally BRACED BY  
PURLINS AT 2'-0" OC. MAX.  
TYPICAL.

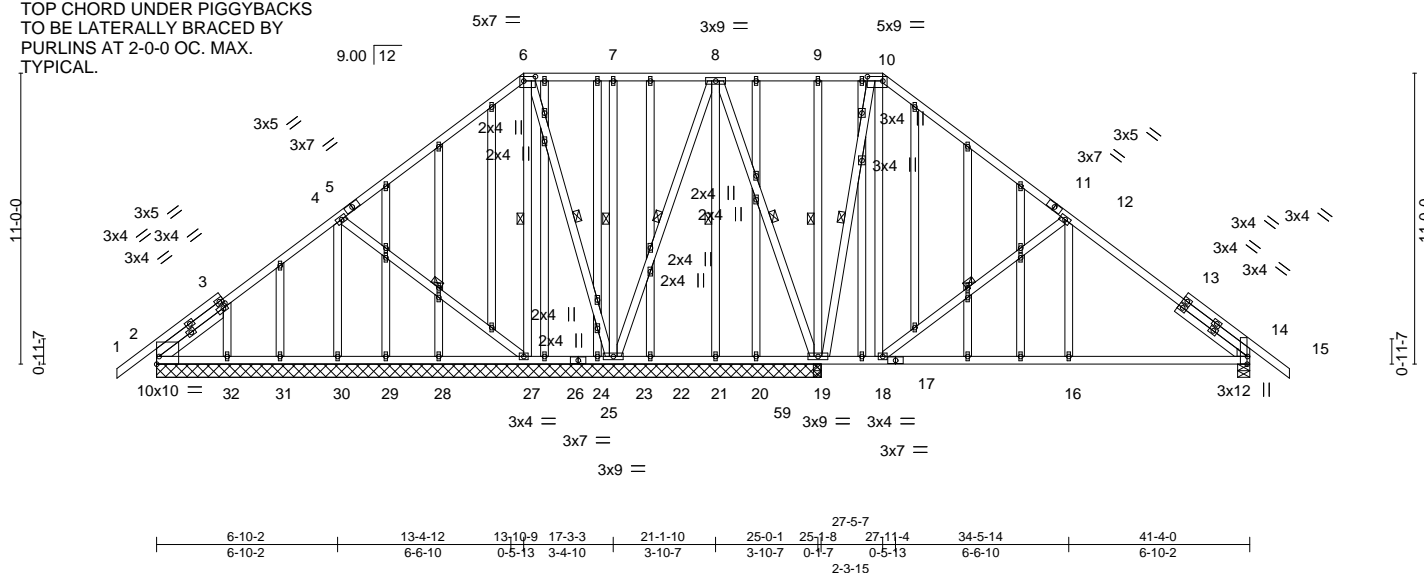


Plate Offsets (X,Y)--		[2:Edge,0-3-8], [3:0-1-15,0-1-8], [6:0-5-4,0-2-0], [10:0-7-0,0-2-0], [14:0-3-8,Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2'-0"	<b>CSI.</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.45
TCDL 10.0	Lumber DOL	1.25	BC 0.43
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.46
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-AS
			<b>DEFL.</b>
			in (loc) l/defl L/d
			Vert(LL) -0.05 16-18 >999 240
			Vert(CT) -0.11 16-18 >999 180
			Horz(CT) 0.01 14 n/a n/a
			<b>PLATES</b>
			MT20
			<b>GRIP</b>
			244/190
			Weight: 495 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2  
WEDGE  
Right: 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 4-27, 6-27, 6-23, 7-23, 8-23, 8-21, 8-19, 9-19, 10-19, 12-18

#### REACTIONS.

All bearings 25-1-8 except (jt=length) 14=0-5-8.  
(lb) - Max Horz 2=344(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 27, 21, 32 except 30=169(LC 12), 23=143(LC 12), 19=139(LC 12), 14=156(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 2, 21, 22, 24, 26, 28, 29, 31, 32, 20 except 30=572(LC 17), 27=360(LC 17), 23=418(LC 21), 19=1078(LC 18), 19=946(LC 1), 14=816(LC 18)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-210/306, 12-14=-785/138  
BOT CHORD 16-18=0/539, 14-16=0/543  
WEBS 4-30=-489/190, 10-19=-848/96, 10-18=-43/595, 12-18=-689/205, 12-16=0/288

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=41ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2'-0" oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 27, 21, 32 except (jt=lb) 30=169, 23=143, 19=139, 14=156.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646424
BRIAN_PAPKA	A2	Piggyback Base	7	1	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:38 2021 Page 1

ID:mkUrRvu8rLIGNYOWf0CO?iyAQHF-olXUNyKgHaXspcc0nQZmy9RXSptjHu?byb\_xTszqnuV

1-6-0	6-10-2	13-4-12	20-8-0	27-11-4	34-5-14	41-4-0
1-6-0	6-10-2	6-6-10	7-3-4	7-3-4	6-6-10	6-10-2

Scale = 1:78.6

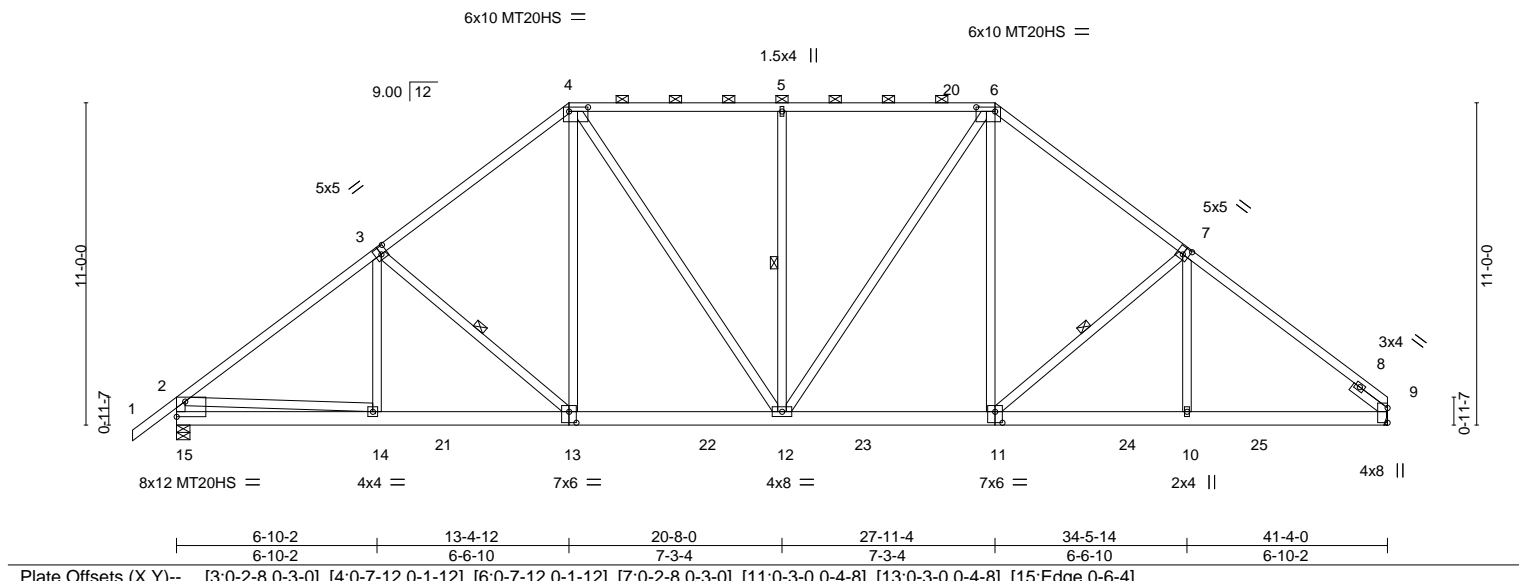

LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP			
TCLL	20.0	Plate Grip DOL 1.25		TC 0.74		Vert(LL)		-0.13	11-12	>999		240		MT20		244/190			
TCDL	10.0	Lumber DOL 1.25		BC 0.74		Vert(CT)		-0.22	11-12	>999		180		MT20HS		187/143			
BCLL	0.0 *	Rep Stress Incr YES		WB 0.31		Horz(CT)		0.08	9	n/a		n/a							
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS															
														Weight: 307 lb				FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Right 2x4 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-8-13 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 3-13, 5-12, 7-11

#### REACTIONS.


(size) 15=0-5-8, 9=Mechanical  
Max Horz 15=-343(LC 10)  
Max Uplift 15=-305(LC 12), 9=-234(LC 12)  
Max Grav 15=2062(LC 17), 9=1989(LC 18)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2572/341, 3-4=-2217/408, 4-5=-1910/417, 5-6=-1910/417, 6-7=-2240/411, 7-9=-2622/360, 2-15=-1928/340  
BOT CHORD 14-15=-221/815, 13-14=-163/2170, 12-13=-30/1811, 11-12=-33/1719, 10-11=-176/1979, 9-10=-175/1980  
WEBS 3-13=-478/177, 4-13=-38/628, 4-12=-69/537, 5-12=-480/174, 6-12=-64/499, 6-11=-42/665, 7-11=-502/190, 2-14=-41/1399

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=41ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 15=305, 9=234.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

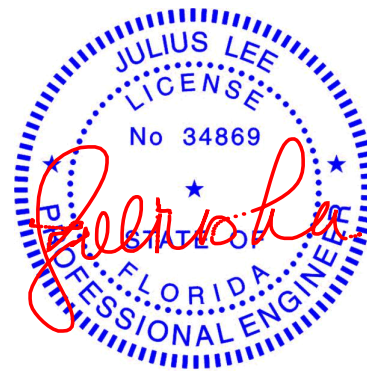

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	T22646425
BRIAN_PAPKA	A3	Piggyback Base	3	1	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:39 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-Gx5salKl2ufjRmBCL74?VNzfgCEIOGdlBFkU?IzqnuU

Job Reference (optional)

1-6-0	4-8-2	9-0-12	13-4-12	17-8-0	22-9-10	27-11-4	34-5-14	41-4-0
1-6-0	4-8-2	4-4-10	4-4-0	4-3-4	5-1-10	5-1-10	6-6-10	6-10-2

Scale = 1:75.2

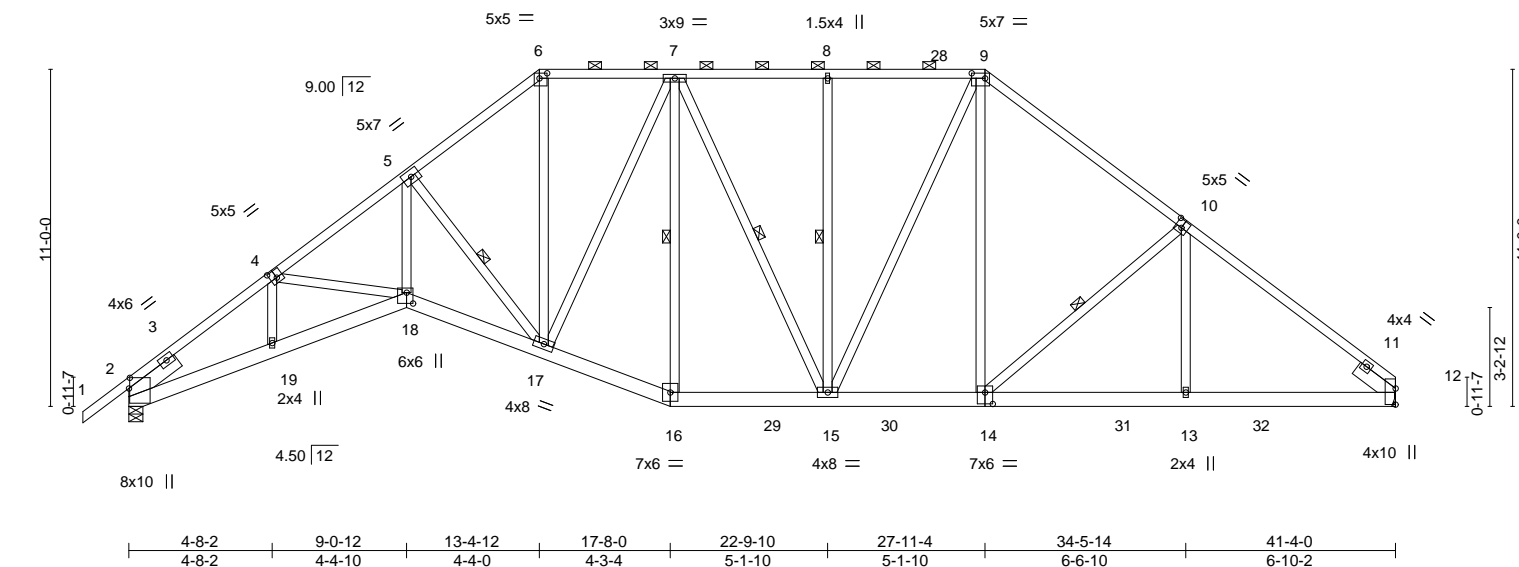


Plate Offsets (X,Y)-- [2:0-4-3,0-0-5], [4:0-2-8,0-3-0], [6:0-3-0,0-2-0], [9:0-5-4,0-2-0], [10:0-2-8,0-3-0], [12:0-6-5,0-0-1], [14:0-3-0,0-4-8], [18:0-4-4,0-2-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.90	Vert(LL)	-0.23	18	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.68	Vert(CT)	-0.43	18	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.28	12	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 335 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2 \*Except\*  
2-18: 2x6 SP SS  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 2-0-0, Right 2x6 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (4-1-14 max.): 6-9.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 5-17, 7-16, 7-15, 8-15, 10-14

#### REACTIONS.


(size) 2=0-5-8, 12=Mechanical  
Max Horz 2=331(LC 11)  
Max Uplift 2=300(LC 12), 12=235(LC 12)  
Max Grav 2=2008(LC 17), 12=1973(LC 18)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-4005/469, 4-5=-4331/506, 5-6=-2508/439, 6-7=-1984/394, 7-8=-1858/414,  
8-9=-1858/414, 9-10=-2208/413, 10-12=-2602/363  
BOT CHORD 2-19=-302/3405, 18-19=-320/3601, 17-18=-236/3863, 16-17=-68/2086, 15-16=-57/1934,  
14-15=-34/1693, 13-14=-177/1963, 12-13=-176/1965  
WEBS 4-19=-395/92, 4-18=0/370, 5-18=-158/2778, 5-17=-2527/291, 6-17=-160/1233,  
7-17=-93/354, 7-16=-532/72, 8-15=-319/110, 9-15=-59/525, 9-14=-54/628,  
10-14=-518/190

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=41ft; eave=5ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=300, 12=235.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

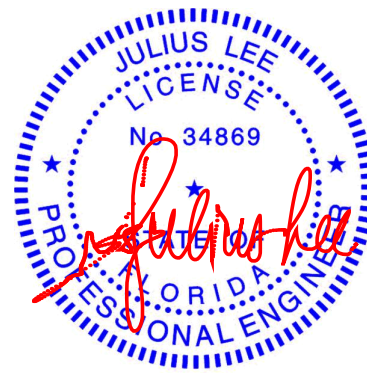

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610



Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	A4	Piggyback Base	4	1	T22646426

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:40 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-k8fEneLwpCna2wmPurcE2aWplcY6ll\_uPvT2XkzqnuT

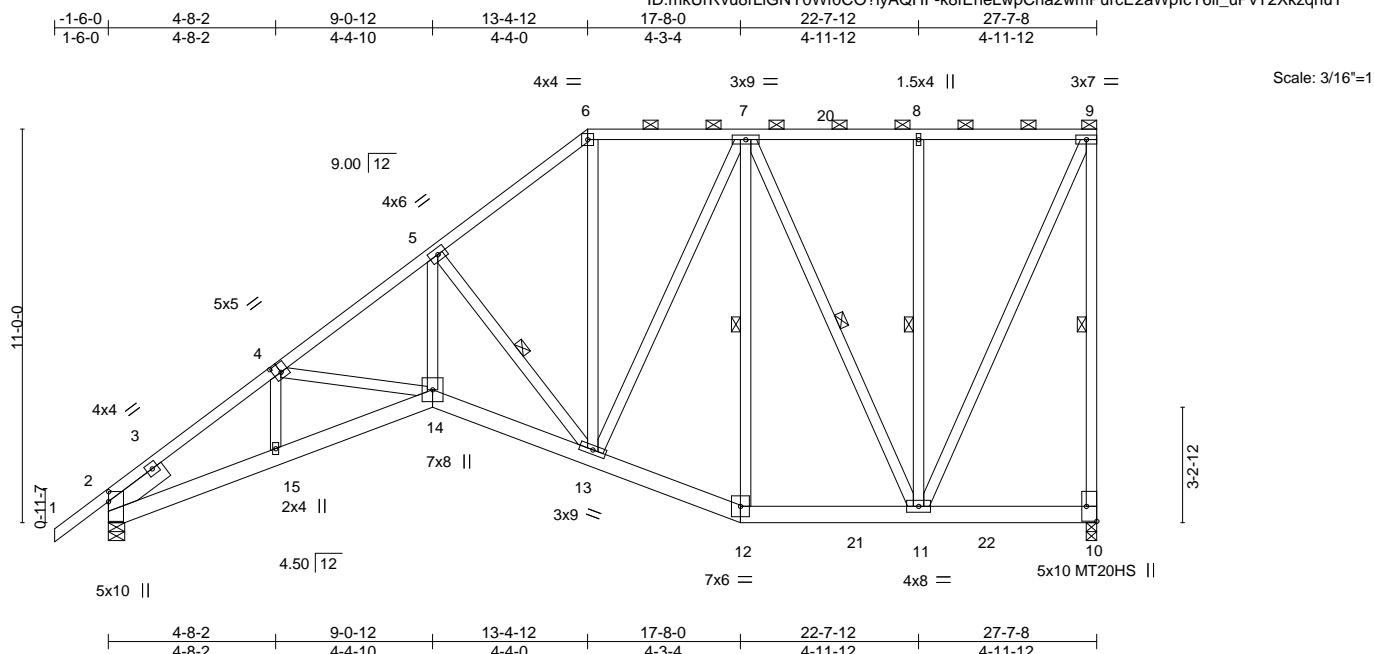


Plate Offsets (X,Y)-- [2:0-3-6,0-0-1], [4:0-2-8,0-3-0], [10:Edge,0-3-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.97	Vert(LL)	-0.12 14-15 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.80	Vert(CT)	-0.23 14-15 >999 180	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.15 10 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 253 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-9-8 max.): 6-9.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 9-10, 5-13, 7-12, 7-11, 8-11

#### REACTIONS.

(size) 10=0-3-8, 2=0-5-8  
Max Horz 2=488(LC 11)  
Max Uplift 10=224(LC 9), 2=208(LC 12)  
Max Grav 10=1331(LC 17), 2=1361(LC 17)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2579/308, 4-5=-2553/359, 5-6=-1316/280, 6-7=-1020/266, 7-8=-562/221, 8-9=-562/221, 9-10=-1211/246  
BOT CHORD 2-15=-681/2243, 14-15=-693/2349, 13-14=-652/2314, 12-13=-273/924, 11-12=-252/841  
WEBS 5-14=-420/1820, 5-13=-1741/442, 6-13=-66/518, 7-13=-191/596, 7-11=-701/155, 8-11=-316/164, 9-11=-200/1224

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=28ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=224, 2=208.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	A5GIR	Piggyback Base Girder	1	2	T22646427

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:42 2021 Page 1

ID:mkUrRvu8rLIGNY0WfOCO?iyAQHF-gWn?CKNALp1IIdvnoFei7?bH9QMfDXaBtDy9cdzqnuR

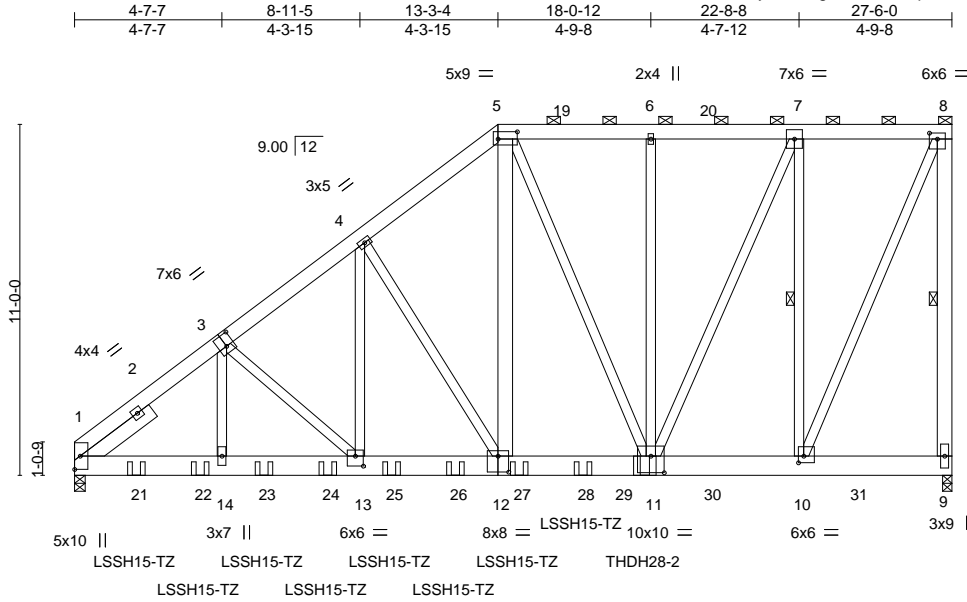

<div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div>									
--	--	--	--	--	--	--	--	--	--

**LUMBER-**  
TOP CHORD 2x6 SP No.2  
BOT CHORD 2x8 SP 2400F 2.0E  
WEBS 2x4 SP No.2 \*Except\*  
8-9,5-12: 2x6 SP No.2, 6-11,7-10: 2x4 SP No.1  
SLIDER Left 2x6 SP No.2 -1 2-8-4

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-7-14 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 8-9, 7-10


**REACTIONS.** (size) 9=0-3-8, 1=0-4-0  
Max Horz 1=350(LC 8)  
Max Uplift 9=-1369(LC 8), 1=-1215(LC 8)  
Max Grav 9=6721(LC 2), 1=6917(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-8795/1598, 3-4=-8068/1549, 4-5=-6876/1451, 5-6=-5463/1151, 6-7=-5463/1151, 7-8=-2849/586, 8-9=-6622/1387  
BOT CHORD 1-14=-1516/6799, 13-14=-1516/6797, 12-13=-1412/6455, 11-12=-1196/5404, 10-11=-586/2849  
WEBS 3-14=-105/918, 3-13=-463/140, 4-13=-287/2079, 4-12=-2033/418, 5-12=-860/3893, 5-11=-229/394, 6-11=-253/143, 7-11=-1393/6445, 7-10=-6094/1381, 8-10=-1451/7057

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, Except member 6-11 2x4 - 1 row at 0-6-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=28ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=1369, 1=1215.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Continued on page 2

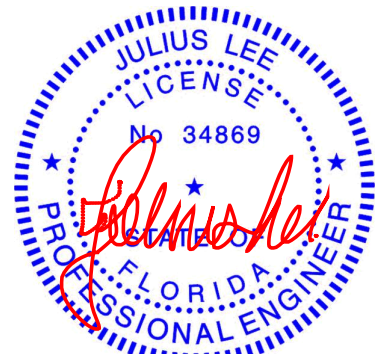

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646427
BRIAN_PAPKA	A5GIR	Piggyback Base Girder	1	2	Job Reference (optional)

- NOTES-**
- 11) Use USP LSSH15-TZ (With 6-10d HDG nails into Girder & 7-10d x 1-1/2 HDG nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 15-11-4 to connect truss(es) to front face of bottom chord.
  - 12) Use USP THDH28-2 (With 36-16d nails into Girder & 10-16d nails into Truss) or equivalent at 17-10-8 from the left end to connect truss(es) to front face of bottom chord.
  - 13) Fill all nail holes where hanger is in contact with lumber.

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
    - Uniform Loads (plf)
      - Vert: 1-5=-60, 5-8=-60, 9-15=-20
    - Concentrated Loads (lb)
      - Vert: 11=-5348(F) 21=-743(F) 22=-743(F) 23=-743(F) 24=-743(F) 25=-743(F) 26=-743(F) 27=-737(F) 28=-737(F)



Job	Truss	Truss Type	Qty	Ply	T22646428
BRIAN_PAPKA	A6GIR	Piggyback Base Girder	1	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:44 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-cvld0OQtQH0XX3A7ggACQgZfDs?hWcUKXRFgWzqnuP

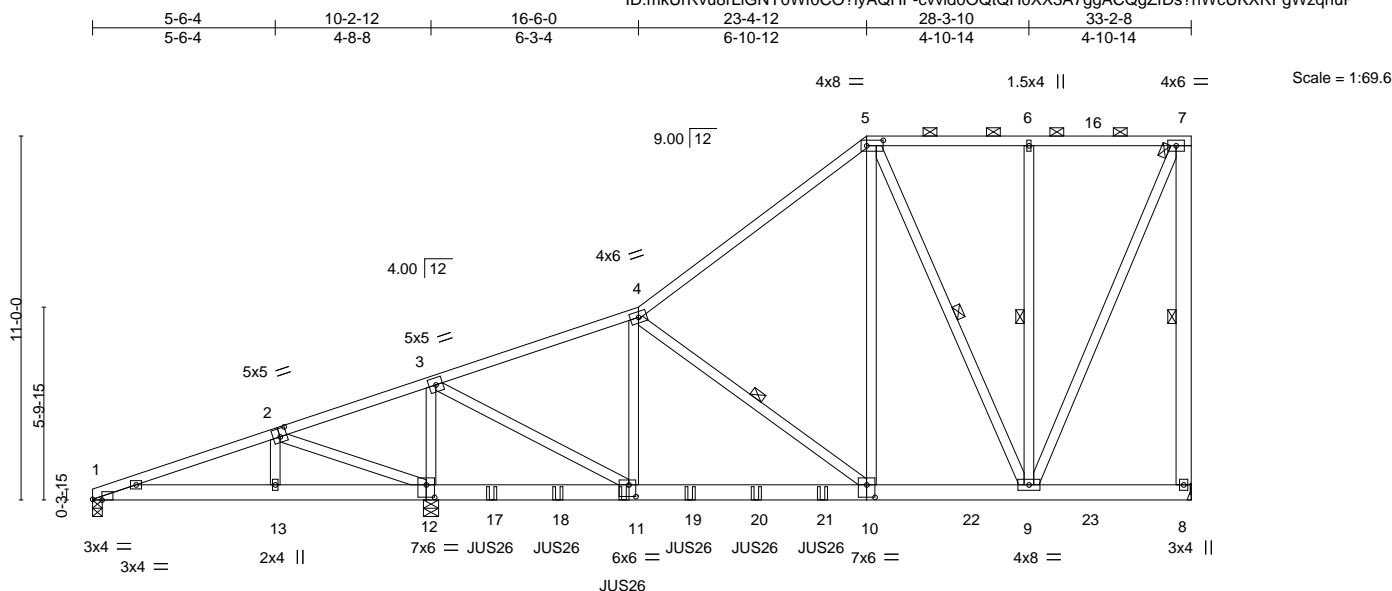


Plate Offsets (X, Y)--	[1:0-3-6,Edge], [2:0-2-8,0-3-0], [5:0-6-0,0-2-0], [10:0-3-0,0-4-8], [11:0-2-8,0-4-4], [12:0-3-0,0-4-8]
------------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.76	Vert(LL)	-0.12 10-11	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 1.00	Vert(CT)	-0.24 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.69	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 262 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2 \*Except\*  
4-5: 2x4 SP No.1  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.2 \*Except\*  
7-8: 2x6 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-7-15 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 7-8, 4-10, 5-9, 6-9

#### REACTIONS.

(size) 8=Mechanical, 1=0-3-8, 12=0-5-8  
Max Horz 1=376(LC 8)  
Max Uplift 8=246(LC 8), 1=183(LC 32), 12=569(LC 8)  
Max Grav 8=1592(LC 36), 1=191(LC 22), 12=3285(LC 36)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-140/484, 2-3=-348/837, 3-4=-2044/77, 4-5=-1420/140, 5-6=-606/96, 6-7=-606/96,  
7-8=-1465/264  
BOT CHORD 1-13=-667/131, 12-13=-657/125, 11-12=-593/28, 10-11=-286/1959, 9-10=-183/1086  
WEBS 2-12=-580/433, 3-12=-2583/423, 3-11=-341/2879, 4-11=-374/612, 4-10=-1113/131,  
5-10=-111/1477, 5-9=-1145/207, 6-9=-325/118, 7-9=-234/1482

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=33ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left exposed; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=246, 1=183, 12=569.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP JUS26 (With 4-10d nails into Girder & 4-10d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 12-0-12 from the left end to 22-0-12 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

Continued on page 2

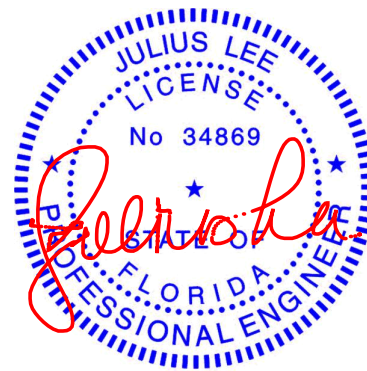

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	T22646428
BRIAN_PAPKA	A6GIR	Piggyback Base Girder	1	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:44 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-cvld0OQtQH0XX3A7ggACQgZfDs?hWcUKXRFgWzqnuP

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-60, 4-5=-60, 5-7=-60, 1-8=-20  
Concentrated Loads (lb)  
Vert: 11=-319(F) 17=-319(F) 18=-319(F) 19=-319(F) 20=-319(F) 21=-318(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	T22646429
BRIAN_PAPKA	A7	Piggyback Base	8	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:45 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-55S7rMP3ekPs9heMhOBPlDdCdL3QzedZBBpCyzqnuO

1-6-0	5-6-4	10-2-12	16-6-0	23-4-12	25-1-15	31-1-15	33-2-8
1-6-0	5-6-4	4-8-8	6-3-4	6-10-12	1-9-3	6-0-0	2-0-9

Scale = 1:78.6

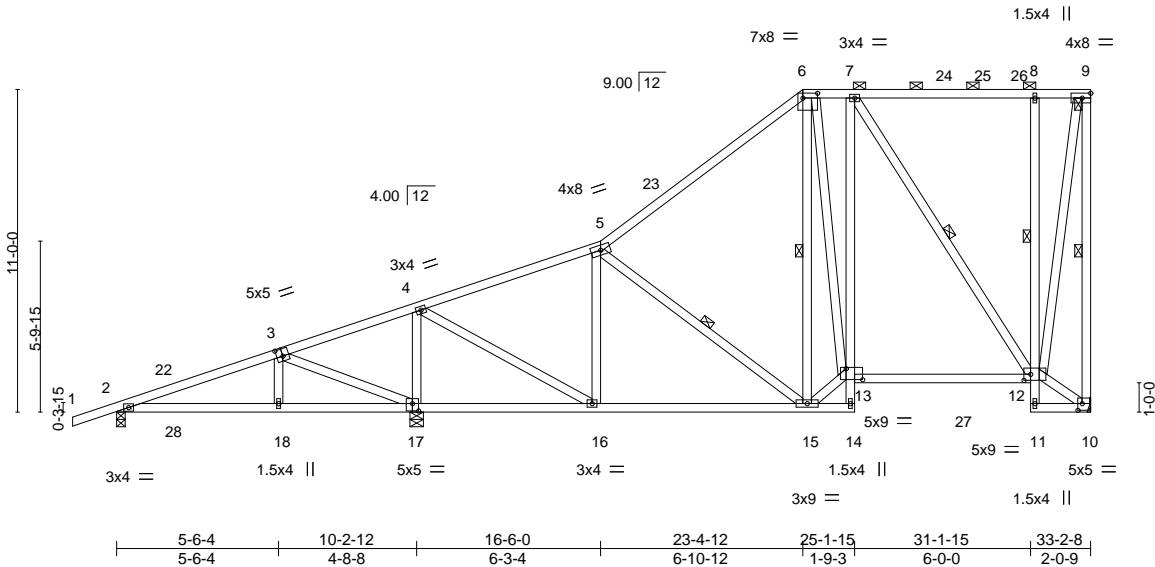


Plate Offsets (X,Y)-- [3:0-2-8,0-3-0], [6:0-6-0,0-2-0], [10:0-1-12,0-2-12], [12:0-2-12,0-2-8], [13:0-6-12,0-4-8], [17:0-2-8,0-3-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.84	Vert(LL)	-0.08	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.43	Vert(CT)	-0.14	12-13	>999	180		
BCLL	0.0 **	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.03	10	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 262 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-9.  
BOT CHORD Rigid ceiling directly applied. Except:  
1 Row at midpt 8-12  
WEBS 1 Row at midpt 9-10, 5-15, 6-15, 7-12

**REACTIONS.**

(size) 10=Mechanical, 2=0-3-8, 17=0-5-8  
Max Horz 2=481(LC 11)  
Max Uplift 10=151(LC 9), 2=193(LC 12), 17=384(LC 12)  
Max Grav 10=1024(LC 17), 2=343(LC 1), 17=1665(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-262/226, 3-4=-640/584, 4-5=-885/175, 5-6=-813/295, 6-7=-566/316, 7-8=-282/226, 8-9=-272/221, 9-10=-1000/310  
BOT CHORD 2-18=-512/236, 17-18=-503/233, 16-17=-455/239, 15-16=-358/809, 7-13=-191/434, 12-13=-336/618, 8-12=-308/279  
WEBS 3-17=-642/532, 4-17=-1308/478, 4-16=-364/1269, 5-16=-397/272, 5-15=-273/138, 6-15=-137/255, 13-15=-327/848, 7-12=-702/275, 10-12=-266/362, 9-12=-421/1051

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=33ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-9-14, Interior(1) 1-9-14 to 23-4-12, Exterior(2R) 23-4-12 to 28-1-2, Interior(1) 28-1-2 to 33-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=151, 2=193, 17=384.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646430
BRIAN_PAPKA	A8	Piggyback Base	1	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:46 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-Zl0V2iQhP2YjmrDZF5jeHrMsM1hh9P4norwMIOzquN

1-6-0	5-6-4	10-2-12	16-6-0	23-4-12	28-3-10	33-2-8
1-6-0	5-6-4	4-8-8	6-3-4	6-10-12	4-10-14	4-10-14

4x8 = 1.5x4 || 4x8 = Scale = 1:66.4

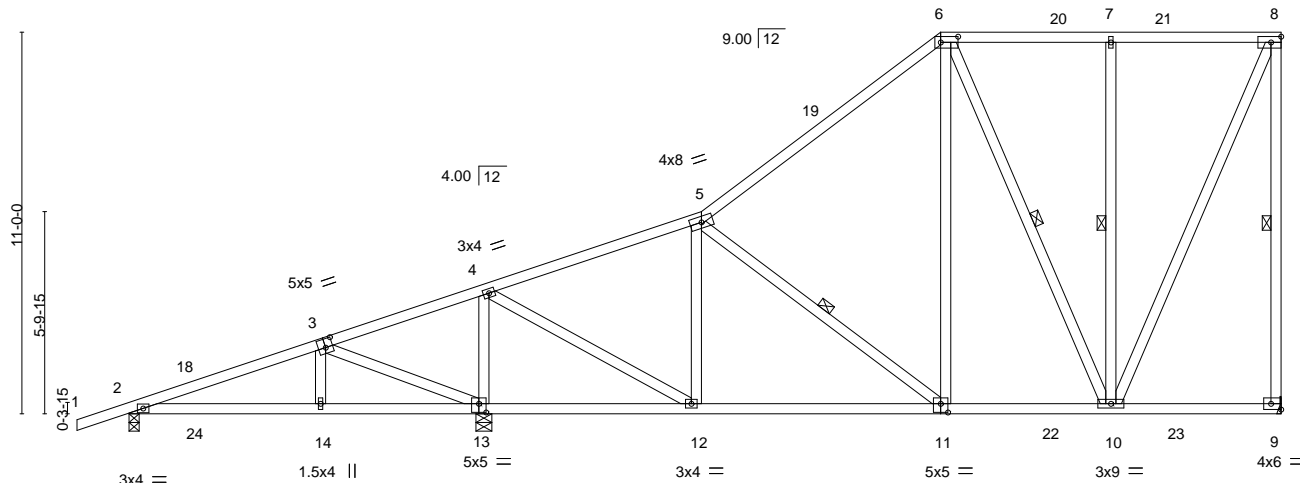


Plate Offsets (X, Y)--	[3:0-2-8,0-3-0], [6:0-6-0,0-2-0], [9:Edge,0-2-0], [11:0-2-8,0-3-0], [13:0-2-8,0-3-0]
------------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.94	Vert(LL)	-0.06 11-12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.41	Vert(CT)	-0.13 11-12	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.75	Horz(CT)	-0.01 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 230 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 8-9, 5-11, 6-10, 7-10

#### REACTIONS.


(size) 9=Mechanical, 2=0-3-8, 13=0-5-8  
Max Horz 2=481(LC 11)  
Max Uplift 9=151(LC 9), 2=192(LC 12), 13=385(LC 12)  
Max Grav 9=1055(LC 17), 2=344(LC 1), 13=1668(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-259/220, 3-4=-624/580, 4-5=-888/171, 5-6=-822/289, 6-7=-445/286, 7-8=-445/286, 8-9=-941/329  
BOT CHORD 2-14=-515/242, 13-14=-506/239, 12-13=-457/241, 11-12=-347/815, 10-11=-329/602  
WEBS 3-13=-641/531, 4-13=-1310/466, 4-12=-347/1272, 5-12=-396/264, 5-11=-274/140, 6-11=-0/420, 6-10=-441/220, 7-10=-328/188, 8-10=-313/923

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=33ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-9-14, Interior(1) 1-9-14 to 23-4-12, Exterior(2R) 23-4-12 to 26-8-10, Interior(1) 26-8-10 to 33-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=151, 2=192, 13=385.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

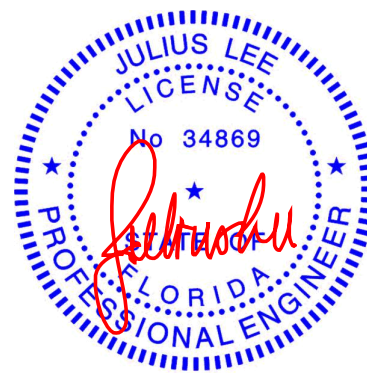

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.  
Tampa, FL 33610

Job BRIAN_PAPKA	Truss A9GIR	Truss Type Piggyback Base Girder	Qty 1	Ply 2	Job Reference (optional) T22646431
--------------------	----------------	-------------------------------------	----------	----------	---------------------------------------

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:47 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-1UauG1RJALgaO?olppEtq2l9ZR5Tuzrw0VgwHqzqnuM

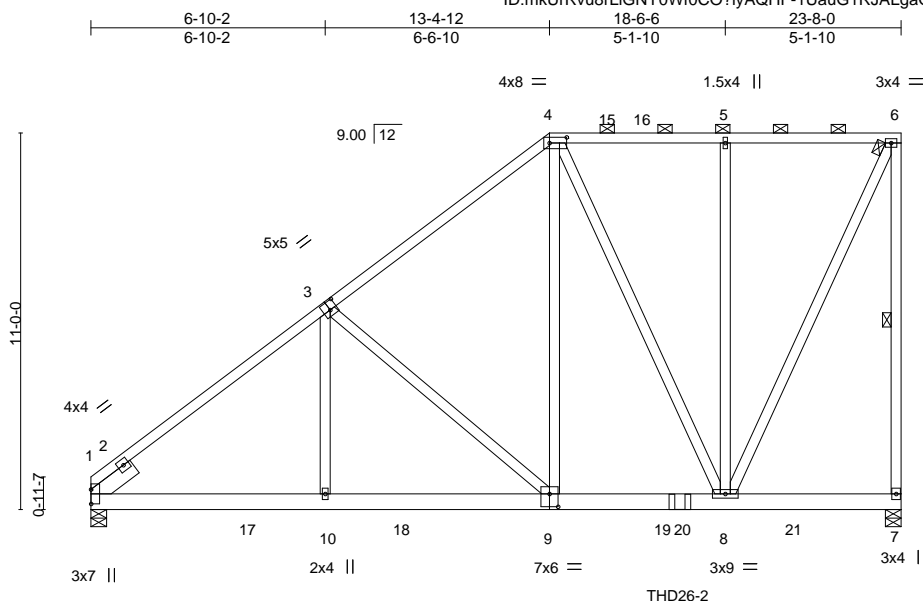

Scale = 1:67.3

Plate Offsets (X,Y)--	[1:0-5-1,0-0-1], [3:0-2-8,0-3-0], [4:0-6-0,0-2-0], [9:0-3-0,0-4-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.40	Vert(LL)	-0.03	8-9	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.05	9-10	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.27	Horz(CT)	0.01	7	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 398 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-7

#### REACTIONS.

(size) 7=0-5-8, 1=0-5-8  
Max Horz 1=467(LC 7)  
Max Uplift 7=381(LC 5), 1=178(LC 8)  
Max Grav 7=1390(LC 29), 1=1213(LC 29)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-3=-1482/277, 3-4=-1036/327, 4-5=-599/296, 5-6=-599/296, 6-7=-1294/392  
BOT CHORD 1-10=-402/1281, 9-10=-403/1279, 8-9=-320/831  
WEBS 3-10=0/309, 3-9=-628/227, 4-9=-100/720, 4-8=-541/131, 5-8=-354/174, 6-8=-393/1320

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=381, 1=178.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP THD26-2 (With 18-16d nails into Girder & 12-10d nails into Truss) or equivalent at 17-2-7 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

#### LOAD CASE(S) Standard

Continued on page 2

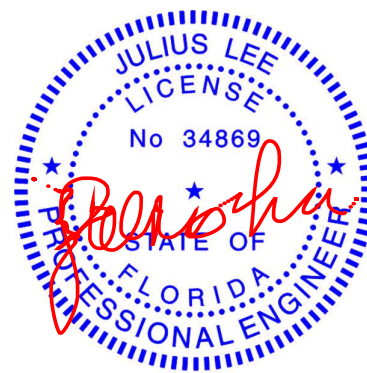

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.  
Tampa, FL 33610



Job	Truss	Truss Type	Qty	Ply	T22646431
BRIAN_PAPKA	A9GIR	Piggyback Base Girder	1	2	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:47 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-1UauG1RJALgaO?olppEtq2l9ZR5Tuzrw0VgwHqzqnuM

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-60, 4-6=-60, 7-11=-20

Concentrated Loads (lb)

Vert: 20=-266(B)

Job BRIAN_PAPKA	Truss A10	Truss Type Piggyback Base	Qty 2	Ply 1	Job Reference (optional) T22646432
--------------------	--------------	------------------------------	----------	----------	---------------------------------------

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:28 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-4qxiGYCOeWGHc4r5BJOQZ20pnnYtxH77f2ZP6Rzqnuf

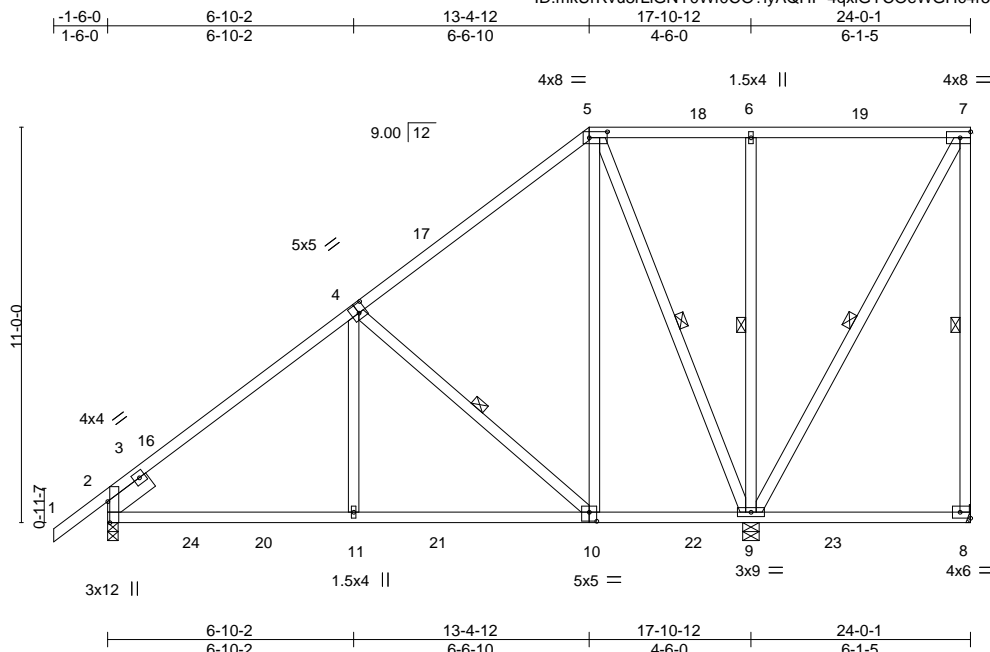


Plate Offsets (X,Y)-- [2:0-7-1,Edge], [4:0-2-8,0-3-0], [5:0-6-0,0-2-0], [8:Edge,0-2-0], [10:0-2-8,0-3-0]															
<b>LOADING</b> (psf)		<b>SPACING-</b>		2-0-0		<b>CSI.</b>		<b>DEFL.</b>		in (loc) l/defl L/d		<b>PLATES</b>		<b>GRIP</b>	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.82	Vert(LL)	0.09	11-14	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL		1.25		BC	0.45	Vert(CT)	-0.11	8-9	>638	180			
BCLL	0.0 *	Rep Stress Incr		YES		WB	0.66	Horz(CT)	-0.02	2	n/a	n/a			
BCDL	10.0	Code FBC2020/TPI2014				Matrix-AS							Weight: 185 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 7-8, 4-10, 5-9, 6-9, 7-9

#### REACTIONS.

(size) 8=Mechanical, 2=0-3-8, 9=0-5-8  
Max Horz 2=491(LC 11)  
Max Uplift 8=123(LC 9), 2=368(LC 12), 9=413(LC 12)  
Max Grav 8=155(LC 17), 2=821(LC 2), 9=1374(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-809/467, 4-5=-343/299  
BOT CHORD 2-11=-657/655, 10-11=-655/653, 9-10=-364/345  
WEBS 4-11=-231/357, 4-10=-542/392, 5-10=-322/557, 5-9=-718/435, 6-9=-370/186, 7-9=-271/102

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 13-4-12, Exterior(2R) 13-4-12 to 17-10-12, Interior(1) 17-10-12 to 23-10-5 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=123, 2=368, 9=413.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	A11GIR	Piggyback Base Girder	1	1	T22646433
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:30 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-1D2ShDDeA7X?sN?UJkQueT5DQaGXPdNq6L2WBKzqnuD

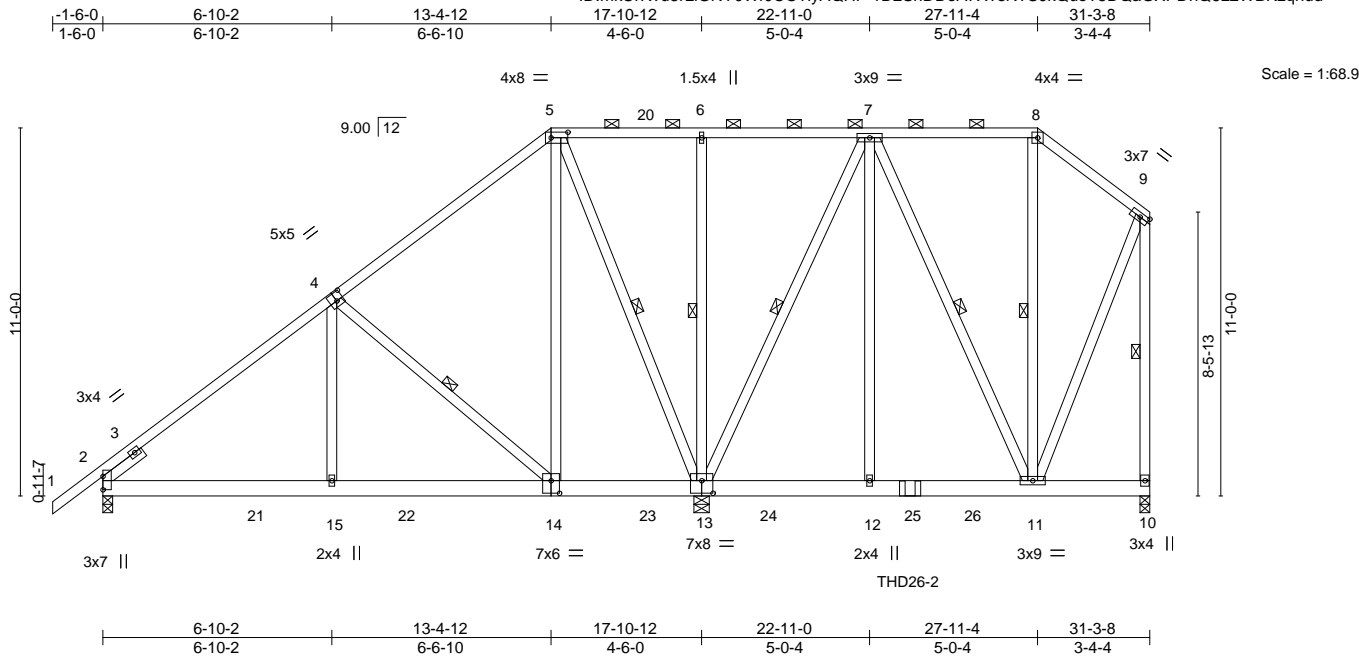


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0], [5:0-6-0,0-2-0], [13:0-4-0,0-4-8], [14:0-3-0,0-4-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.55	Vert(LL)	-0.03	14-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.24	Vert(CT)	-0.05	14-15	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.52	Horz(CT)	0.01	10	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 287 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x6 SP No.2  
 WEBS 2x4 SP No.2  
 SLIDER Left 2x4 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 4-14, 5-13, 6-13, 7-13, 7-11, 8-11, 9-10

#### REACTIONS.

(size) 2=0-3-8, 13=0-5-8, 10=0-3-8  
 Max Horz 2=452(LC 7)  
 Max Uplift 2=-157(LC 25), 13=-278(LC 8), 10=-128(LC 8)  
 Max Grav 2=863(LC 13), 13=1885(LC 29), 10=573(LC 20)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-823/142, 4-5=-337/184, 8-9=-338/228, 9-10=-555/189  
 BOT CHORD 2-15=-277/771, 14-15=-278/767, 13-14=-227/266  
 WEBS 4-15=0/360, 4-14=-668/205, 5-14=-61/636, 5-13=-886/101, 6-13=-301/102, 7-13=-761/155, 7-12=-54/400, 9-11=-146/405

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=31ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=157, 13=278, 10=128.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP THD26-2 (With 18-16d nails into Girder & 12-10d nails into Truss) or equivalent at 24-1-9 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
 Uniform Loads (plf)  
 Vert: 1-5=-60, 5-8=-60, 8-9=-60, 10-16=-20



Julius Lee PE No.34869  
 MiTek USA, Inc. FL Cert 6634  
 6904 Parke East Blvd. Tampa FL 33610  
 Date:

January 29,2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646433
BRIAN_PAPKA	A11GIR	Piggyback Base Girder	1	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:30 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-1D2ShDDeA7X?sN?UJkQueT5DQaGXPdNq6L2WBKzqnu

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 25=-209(B)

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	A12	Piggyback Base	4	1	T22646434
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:31 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-VPcqVZEHxRfSTxagtSx7AheQz\_Zg8fFZL?o3jmqznc

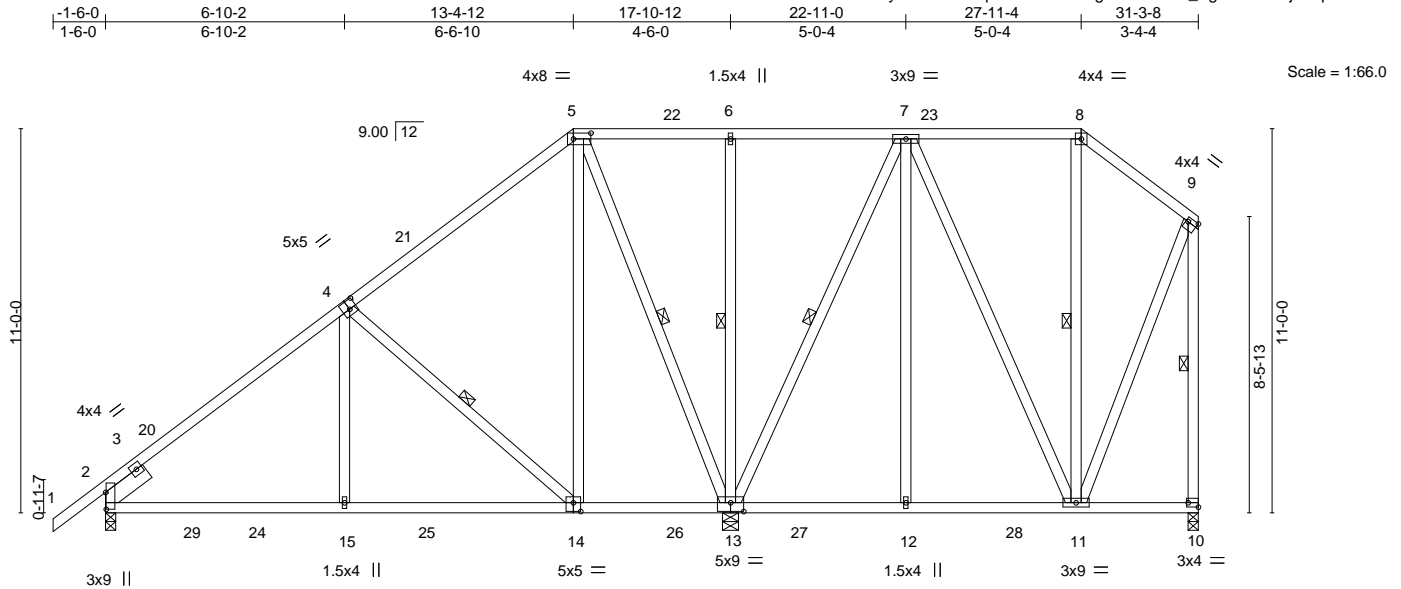


Plate Offsets (X,Y)-- [2:0-5-13,0-0-3], [4:0-2-8,0-3-0], [5:0-6-0,0-2-0], [9:Edge,0-1-8], [10:Edge,0-1-8], [13:0-4-8,0-3-0], [14:0-2-8,0-3-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	20.0	Plate Grip DOL	1.25	TC	0.44	Vert(LL)	0.08 15-18 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	-0.09 14-15 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.63	Horz(CT)	-0.02 2 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 264 lb	FT = 20%


**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 1-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 4-14, 5-13, 6-13, 7-13, 8-11, 9-10

**REACTIONS.** (size) 2=0-3-8, 13=0-5-8, 10=0-3-8  
Max Horz 2=454(LC 11)  
Max Uplift 2=-384(LC 12), 13=-416(LC 12), 10=-75(LC 12)  
Max Grav 2=782(LC 23), 13=1704(LC 2), 10=478(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-751/430, 4-5=-288/285, 8-9=-303/232, 9-10=-454/128  
BOT CHORD 2-15=-560/636, 14-15=-558/634, 13-14=-286/265  
WEBS 4-15=-203/357, 4-14=-551/366, 5-14=-310/572, 5-13=-790/352, 6-13=-298/110, 7-13=-640/67, 7-12=0/294, 9-11=-123/339

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=31ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-7-9, Interior(1) 1-7-9 to 13-4-12, Exterior(2R) 13-4-12 to 17-10-12, Interior(1) 17-10-12 to 27-11-4, Exterior(2E) 27-11-4 to 31-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 2=384, 13=416.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

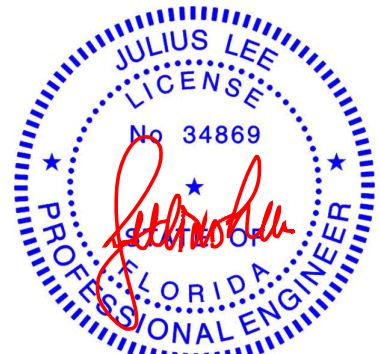

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610



Job	Truss	Truss Type	Qty	Ply	T22646435
BRIAN_PAPKA	A13	Piggyback Base	4	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:32 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-zbAD6vFvilni5h8sQ9SMjuBbbOvut6gjZfXdfCzqnuh

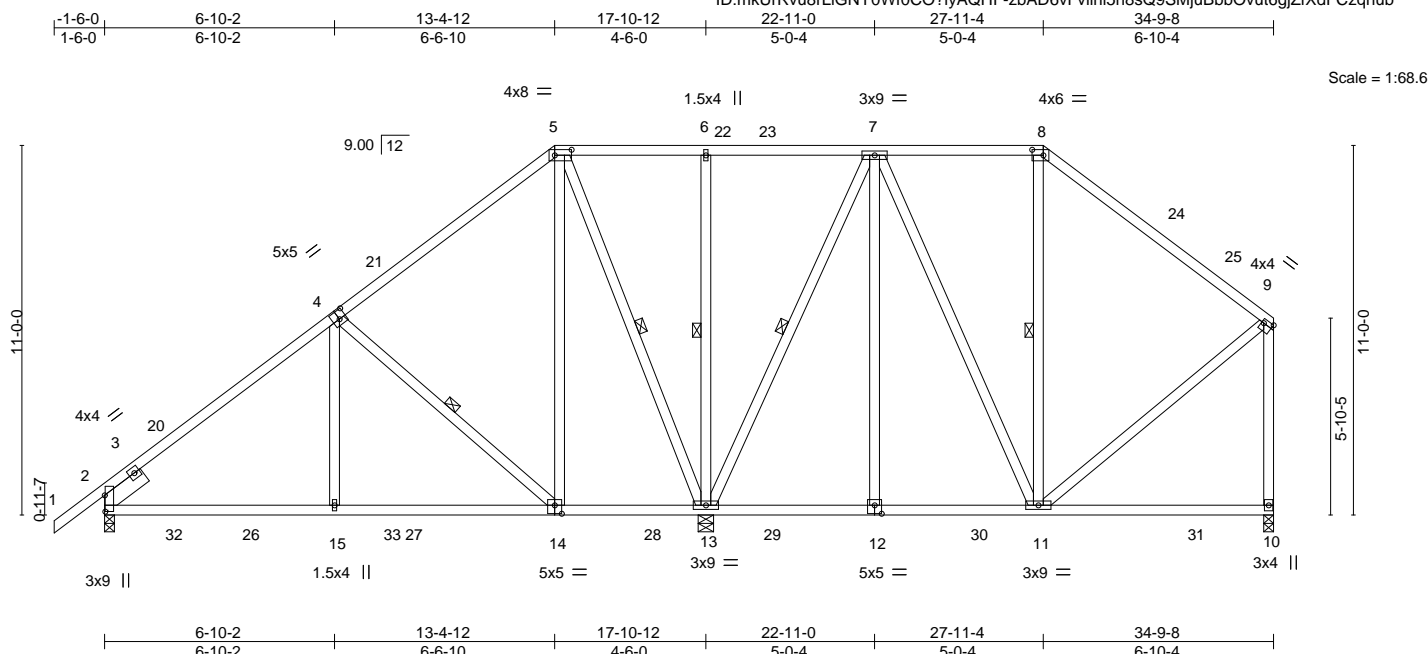


Plate Offsets (X,Y)-- [2:0-5-13,0-0-3], [4:0-2-8,0-3-0], [5:0-6-0,0-2-0], [8:0-4-0,0-2-0], [9:Edge,0-1-8], [12:0-2-8,0-3-0], [14:0-2-8,0-3-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.44	Vert(LL)	0.08 15-18 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	-0.13 10-11 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.62	Horz(CT)	-0.02 2 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 272 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
SLIDER Left 2x6 SP No.2 -t 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 4-14, 5-13, 6-13, 7-13, 8-11

#### REACTIONS.


(size) 2=0-3-8, 13=0-5-8, 10=0-3-8  
Max Horz 2=417(LC 11)  
Max Uplift 2=390(LC 12), 13=429(LC 12), 10=95(LC 12)  
Max Grav 2=785(LC 23), 13=1821(LC 2), 10=717(LC 18)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-755/419, 4-5=-292/295, 7-8=-340/231, 8-9=-487/190, 9-10=-582/152  
BOT CHORD 2-15=-454/654, 14-15=-453/652, 13-14=-257/239  
WEBS 4-15=-190/358, 4-14=-554/348, 5-14=-305/570, 5-13=-782/295, 6-13=-305/124,  
7-13=-766/89, 7-12=0/263, 7-11=-79/260, 9-11=-44/326

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-11-12, Interior(1) 1-11-12 to 13-4-12, Exterior(2R) 13-4-12 to 18-3-13, Interior(1) 18-3-13 to 27-11-4, Exterior(2R) 27-11-4 to 32-10-5, Interior(1) 32-10-5 to 34-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 2=390, 13=429.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

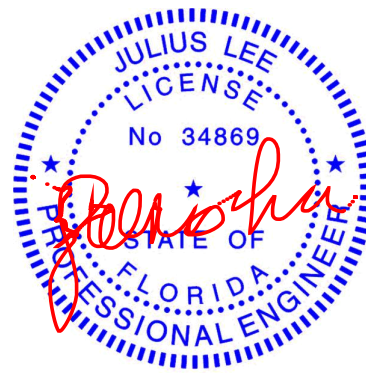

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	A14GE	Piggyback Base Supported Gable	1	1	T22646436
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:34 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-v\_lzXbG9EM1QK?IFYaVqoJG?ABgnL6q01z0kK5zquZ

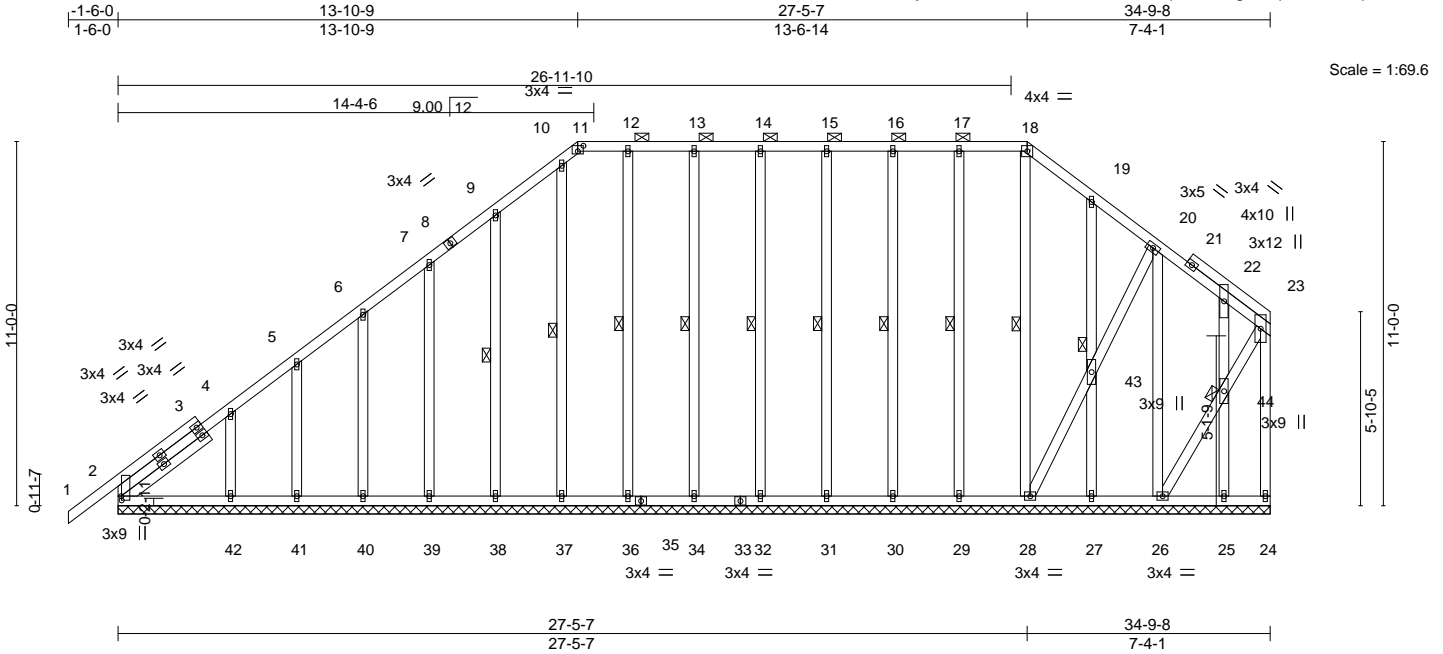


Plate Offsets (X,Y)--		[2'-0"-1'-8",0'-0"-3], [1'-10"-2'-0",0'-2'-0"]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2'-0'-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.10	Vert(CT)	-0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	-0.01	24	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S					Weight: 356 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6'-0'-0 oc purlins, except end verticals, and 2'-0'-0 oc purlins (6'-0'-0 max.): 11-18.  
BOT CHORD Rigid ceiling directly applied or 10'-0'-0 oc bracing, Except: 6'-0'-0 oc bracing: 25-26,24-25.  
WEBS 1 Row at midpt 13-34, 12-36, 10-37, 9-38, 14-32, 15-31, 16-30, 17-29, 18-28  
JOINTS 1 Brace at Jt(s): 43, 44

**REACTIONS.** All bearings 34-9-8.  
(lb) - Max Horz 2=411(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 24, 2, 34, 37, 38, 39, 40, 41, 42, 32, 31, 30, 29, 26, 25, 27  
Max Grav All reactions 250 lb or less at joint(s) 24, 34, 36, 37, 38, 39, 40, 41, 42, 32, 31, 30, 29, 28, 26, 25, 27 except 2=266(LC 18)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-281/258

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - All plates are 1.5x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 2'-0'-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6"-0 tall by 2'-0'-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 2, 34, 37, 38, 39, 40, 41, 42, 32, 31, 30, 29, 26, 25, 27.

Continued on page 2

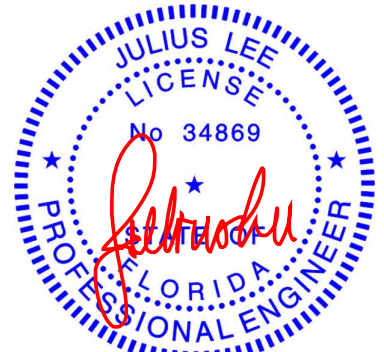

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646436
BRIAN_PAPKA	A14GE	Piggyback Base Supported Gable	1	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:34 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-v\_lzXbG9EM1QK?IFYaVqoJG?ABgnL6q01z0kK5zqnuZ

NOTES-

- 12) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	T22646437
BRIAN_PAPKA	B1GE	Attic	1	1	Job Reference (optional)

**NOTES-**  
 14) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
   Uniform Loads (plf)  
     Vert: 1-2=-60, 2-6=-60, 6-7=-70, 7-8=-60, 8-9=-60, 9-10=-60, 10-11=-70, 11-15=-60, 15-16=-60, 17-34=-20, 20-31=-30, 7-10=-10  
     Drag: 6-31=-10, 11-20=-10  
   Concentrated Loads (lb)  
     Vert: 28=-16(F) 26=-16(F) 24=-16(F) 22=-16(F) 30=-16(F) 39=-16(F) 40=-16(F)



Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	B2	Attic	9	1	T22646438

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:51 2021 Page 1

ID:mkUrRvu8rLIGNYOWf0CO?iyAQHF-vFqO5PUqEaA0tc5W2elp\_uTnx2KQqicWx7e7QczqnuI

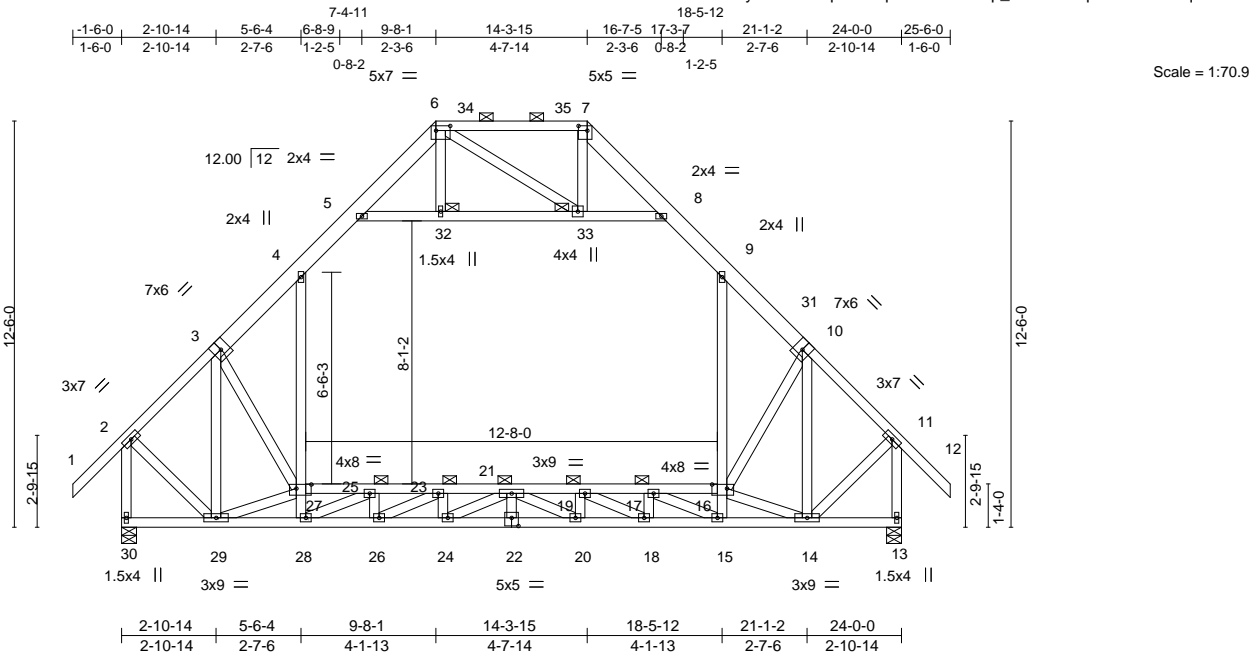


Plate Offsets (X,Y)-- [6:0-5-4,0-1-12], [7:0-3-4,0-1-12], [16:0-5-8,0-1-8], [22:0-2-8,0-3-0], [27:0-5-8,0-1-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	20.0	Plate Grip DOL	1.25	TC	0.69	Vert(LL)	-0.14 21 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.70	Vert(CT)	-0.25 22 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.04 13 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS		Attic	-0.09 16-27 1763 360	Weight: 255 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2 \*Except\*  
3-6,7-10: 2x6 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.  
BOT CHORD Rigid ceiling directly applied.  
JOINTS 1 Brace at Jt(s): 23, 21, 19, 17, 25, 32, 33

#### REACTIONS.


(size) 30=0-5-8, 13=0-5-8  
Max Horz 30=-457(LC 10)  
Max Grav 30=1659(LC 18), 13=1659(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1141/46, 3-4=-1630/0, 4-5=-1001/121, 5-6=-371/105, 7-8=-368/104, 8-9=-1012/121, 9-10=-1658/0, 10-11=-1141/46, 2-30=-1630/3, 11-13=-1630/2  
BOT CHORD 29-30=-432/412, 28-29=-795/992, 26-28=-31/1843, 24-26=0/2369, 22-24=0/2507, 20-22=0/2507, 18-20=0/2259, 15-18=0/1620, 14-15=-508/708, 25-27=-287/1383, 23-25=-708/176, 21-23=-1385/0, 19-21=-1385/0, 17-19=-843/354, 16-17=-481/1527  
WEBS 3-29=-1109/0, 3-27=-75/610, 27-28=0/832, 4-27=0/859, 5-32=-944/63, 32-33=-941/64, 8-33=-967/64, 15-16=0/835, 9-16=0/861, 16-31=-112/639, 14-31=-1148/0, 10-31=-643/0, 2-29=0/1080, 11-14=0/1088, 17-18=0/421, 27-29=-255/1105, 25-26=0/421, 25-28=-1692/0, 23-26=-978/0, 21-24=-425/160, 20-21=-414/147, 18-19=-980/0, 15-17=-1692/0, 14-16=-436/1216

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 8-9, 5-32, 32-33, 8-33; Wall dead load (5.0psf) on member(s). 4-27, 9-16
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 25-27, 23-25, 21-23, 19-21, 17-19, 16-17
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Attic room checked for L/360 deflection.

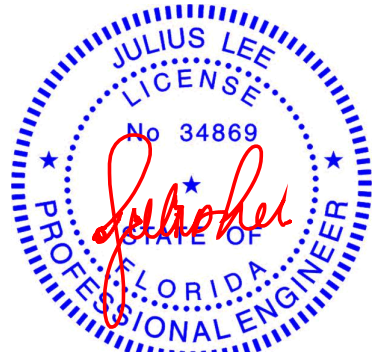

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	B3	Attic	2	2	T22646439

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:53 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-sex9W5V4lBQk6wFv93LH3JY7NryElbbpPQ7EVUzqnuG


**NOTES-**

- 5) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 6) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 7) Provide adequate drainage to prevent water ponding.
- 8) All plates are MT20 plates unless otherwise indicated.
- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 11) Ceiling dead load (5.0 psf) on member(s). 4-5, 8-9, 5-30, 30-31, 8-31; Wall dead load (5.0psf) on member(s).4-26, 9-16
- 12) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 24-26, 22-24, 20-22, 18-20, 17-18, 16-17
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 386 lb uplift at joint 29 and 360 lb uplift at joint 12.
- 14) Load case(s) 2, 12, 13, 14, 15, 16, 17, 20, 21, 30, 31, 32, 33 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 15) Use USP THD26-2 (With 18-16d nails into Girder & 12-10d nails into Truss) or equivalent at 18-4-0 from the left end to connect truss(es) to back face of bottom chord.
- 16) Fill all nail holes where hanger is in contact with lumber.
- 17) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
  - Uniform Loads (plf)
    - Vert: 1-2=-150, 6-34=-150, 6-7=-150, 7-8=-150, 8-9=-175, 9-11=-150, 27-29=-125, 12-27=-50, 16-26=-75, 5-8=-25
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=-572(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-453-to-4=-392, 4=-417-to-5=-399, 5=-374-to-34=-370
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.25, Plate Increase=1.25
  - Uniform Loads (plf)
    - Vert: 1-2=-125, 6-34=-125, 6-7=-125, 7-8=-125, 8-9=-150, 9-11=-125, 27-29=-322, 12-27=-50, 16-26=-225, 5-8=-25
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=-598(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-618-to-4=-519, 4=-544-to-5=-514, 5=-489-to-34=-483
- 12) Dead + Uninhab. Attic Storage + Attic Floor: Lumber Increase=1.00, Plate Increase=1.00
  - Uniform Loads (plf)
    - Vert: 1-2=-50, 6-34=-50, 6-7=-50, 7-8=-50, 8-9=-75, 9-11=-50, 27-29=-363, 12-27=-50, 16-26=-275, 5-8=-25
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=-399(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-505-to-4=-413, 4=-438-to-5=-411, 5=-386-to-34=-380
- 13) Dead: Lumber Increase=1.00, Plate Increase=1.00
  - Uniform Loads (plf)
    - Vert: 1-2=-50, 6-34=-50, 6-7=-50, 7-8=-50, 8-9=-75, 9-11=-50, 27-29=-363, 12-27=-50, 16-26=-275, 5-8=-25
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=-399(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-505-to-4=-413, 4=-438-to-5=-411, 5=-386-to-34=-380
- 14) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-2=-147, 6-34=-160, 6-7=-127, 7-8=-102, 8-9=-127, 9-11=-102, 27-29=-345, 12-27=-50, 16-26=-225, 5-8=-25
    - Horz: 1-2=22, 2-6=35, 7-11=23, 2-29=60, 11-12=17
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=303(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-745-to-4=-627, 4=-652-to-5=-616, 5=-591-to-34=-584
- 15) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-2=-89, 6-34=-102, 6-7=-127, 7-8=-160, 8-9=-185, 9-11=-160, 27-29=-335, 12-27=-50, 16-26=-225, 5-8=-25
    - Horz: 1-2=-36, 2-6=-23, 7-11=-35, 2-29=-17, 11-12=-60
    - Drag: 4-26=-25, 9-16=-25
  - Concentrated Loads (lb)
    - Vert: 14=303(B)
  - Trapezoidal Loads (plf)
    - Vert: 2=-648-to-4=-538, 4=-563-to-5=-530, 5=-505-to-34=-498
- 16) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

  
6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	B3	Attic	2	2	T22646439

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:53 2021 Page 3  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-sex9W5V4lBQk6wFv93LH3JY7NryElbbpPQ7EVUzqnuG

#### LOAD CASE(S) Standard

- Uniform Loads (plf)  
Vert: 1-2=-114, 6-34=-127, 6-7=-127, 7-8=-127, 8-9=-152, 9-11=-127, 27-29=-342, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=-11, 2-6=2, 7-11=-2, 2-29=-29, 11-12=29  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=303(B)
- Trapezoidal Loads (plf)  
Vert: 2=-702-to-4=-586, 4=-611-to-5=-577, 5=-552-to-34=-544
- 17) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)  
Vert: 1-2=-114, 6-34=-127, 6-7=-127, 7-8=-127, 8-9=-152, 9-11=-127, 27-29=-342, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=-11, 2-6=2, 7-11=-2, 2-29=-29, 11-12=29  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=303(B)
- Trapezoidal Loads (plf)  
Vert: 2=-702-to-4=-586, 4=-611-to-5=-577, 5=-552-to-34=-544
- 20) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)  
Vert: 1-2=-125, 6-34=-125, 6-7=-125, 7-8=-50, 8-9=-75, 9-11=-50, 27-29=-322, 12-27=-50, 16-26=-225, 5-8=-25  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=598(B)
- Trapezoidal Loads (plf)  
Vert: 2=-618-to-4=-519, 4=-544-to-5=-514, 5=-489-to-34=-483
- 21) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)  
Vert: 1-2=-50, 6-34=-50, 6-7=-125, 7-8=-125, 8-9=-150, 9-11=-125, 27-29=-322, 12-27=-50, 16-26=-225, 5-8=-25  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=598(B)
- Trapezoidal Loads (plf)  
Vert: 2=-543-to-4=-444, 4=-469-to-5=-439, 5=-414-to-34=-408
- 30) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)  
Vert: 1-2=-147, 6-34=-160, 6-7=-127, 7-8=-102, 8-9=-127, 9-11=-102, 27-29=-345, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=22, 2-6=35, 7-11=23, 2-29=60, 11-12=17  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=-841(B)
- Trapezoidal Loads (plf)  
Vert: 2=-745-to-4=-627, 4=-652-to-5=-616, 5=-591-to-34=-584
- 31) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)  
Vert: 1-2=-89, 6-34=-102, 6-7=-127, 7-8=-160, 8-9=-185, 9-11=-160, 27-29=-335, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=-36, 2-6=-23, 7-11=-35, 2-29=-17, 11-12=-60  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=-841(B)
- Trapezoidal Loads (plf)  
Vert: 2=-648-to-4=-538, 4=-563-to-5=-530, 5=-505-to-34=-498
- 32) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)  
Vert: 1-2=-114, 6-34=-127, 6-7=-127, 7-8=-127, 8-9=-152, 9-11=-127, 27-29=-342, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=-11, 2-6=2, 7-11=-2, 2-29=-29, 11-12=29  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=-841(B)
- Trapezoidal Loads (plf)  
Vert: 2=-702-to-4=-586, 4=-611-to-5=-577, 5=-552-to-34=-544
- 33) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)  
Vert: 1-2=-114, 6-34=-127, 6-7=-127, 7-8=-127, 8-9=-152, 9-11=-127, 27-29=-342, 12-27=-50, 16-26=-225, 5-8=-25  
Horz: 1-2=-11, 2-6=2, 7-11=-2, 2-29=-29, 11-12=29  
Drag: 4-26=-25, 9-16=-25
- Concentrated Loads (lb)  
Vert: 14=-841(B)
- Trapezoidal Loads (plf)  
Vert: 2=-702-to-4=-586, 4=-611-to-5=-577, 5=-552-to-34=-544

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601 **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 36610

Mayo, FL - 32066.

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:55 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?ivAQHF-o03vxxMKHpgSMDPHHUNl9keRJfILmWs5skcLZNzgnUE

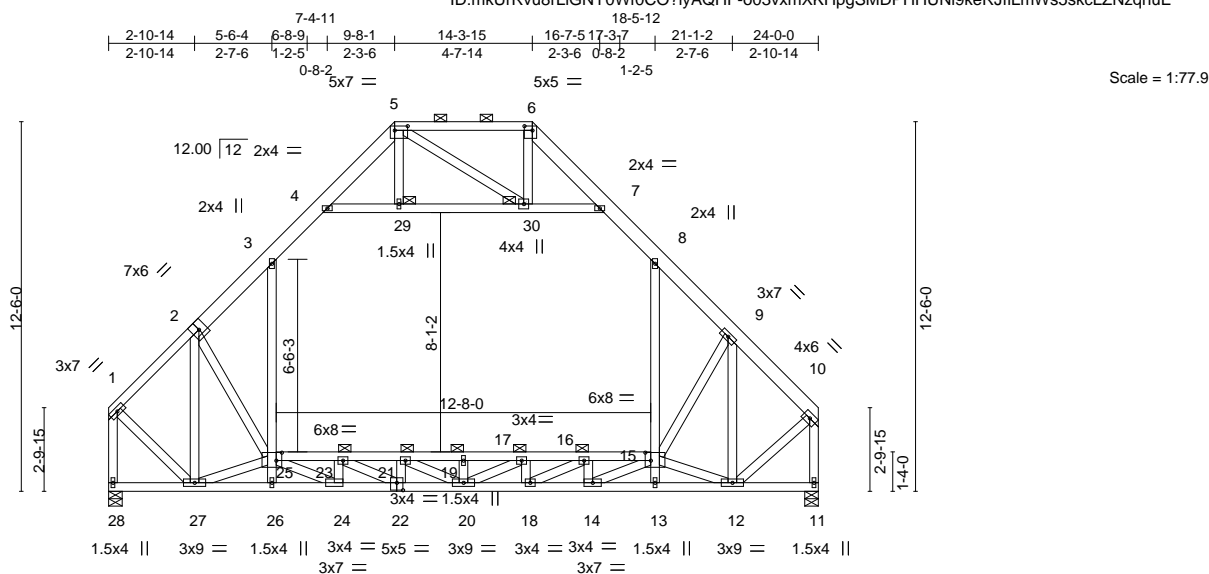

		<u>2-10-14</u>		<u>5-6-4</u>		<u>9-8-1</u>		<u>14-3-15</u>		<u>18-5-12</u>		<u>21-1-2</u>		<u>24-0-0</u>	
		2-10-14		2-7-6		4-1-13		4-7-14		4-1-13		2-7-6		2-10-14	
Plate Offsets (X,Y)--	[5:0-5-4,0-1-12].	[6:0-3-4,0-1-12].	[15:0-2-4,0-3-4].	[22:0-2-8,0-3-0].	[25:0-2-4,0-3-4]										

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.25	TC 0.73	Vert(LL) -0.12 19 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.63	Vert(CT) -0.21 19 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.53	Horz(CT) 0.02 11 n/a n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS	Attic -0.07 15-25 2199 360	Weight: 251 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2 *Except* 5-6,1-2: 2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.2	JOINTS	1 Brace at Jt(s): 21, 19, 17, 16, 23, 29, 30

**REACTIONS.** (size) 28=0-5-8, 11=0-5-8  
Max Horz 28=-406(LC 10)  
Max Grav 28=1565(LC 19), 11=1565(LC 18)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


**TOP CHORD** 1-2=-1131/1, 2-3=-1642/0, 3-4=-1012/111, 4-5=-364/106, 6-7=-361/105, 7-8=-1024/112, 8-9=-1715/0, 9-10=-1154/0, 1-28=-1530/0, 10-11=-1531/0

**BOT CHORD** 27-28=-387/370, 26-27=-677/906, 24-26=-707/904, 22-24=-89/1696, 20-22=0/2203, 18-20=0/2090, 14-18=0/1517, 13-14=-463/663, 12-13=-432/664, 23-25=-565/230, 21-23=-1150/0, 19-21=-1492/0, 17-19=-1492/0, 16-17=-1212/0, 15-16=-706/406

**WEBS** 2-27=1072/0, 2-25=-69/559, 3-25=0/864, 4-29=-970/47, 29-30=-967/49, 7-30=-994/48, 8-15=0/917, 9-15=-130/531, 9-12=-1110/12, 1-27=0/1063, 10-12=0/1076, 21-22=-388/2, 17-18=-382/3, 14-16=-656/0, 23-24=-660/0, 25-27=-194/1027, 24-25=0/1524, 22-23=0/911, 20-21=-119/469, 17-20=-133/476, 16-18=0/948, 14-15=0/1527, 12-15=-355/1171

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)  $V_{asd}=101\text{mph}$ ;  $TCDL=6.0\text{psf}$ ;  $BCDL=6.0\text{psf}$ ;  $h=15\text{ft}$ ;  $B=45\text{ft}$ ;  $L=24\text{ft}$ ;  $eave=4\text{ft}$ ; Cat. II; Exp C; Encl.,  $G_{Cp}=0.18$ ; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Ceiling dead load (5.0 psf) on member(s). 3-4, 7-8, 4-29, 29-30, 7-30; Wall dead load (5.0psf) on member(s). 3-25, 8-15
- 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 23-25, 21-23, 19-21, 17-19, 16-17, 15-16
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Attic room checked for L/360 deflection.

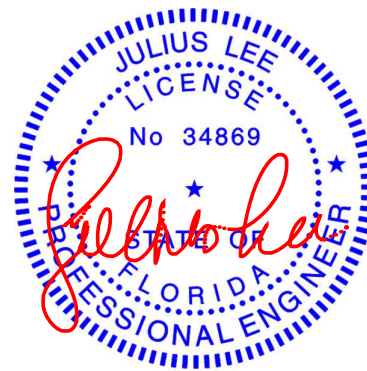

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd  
Tampa, FL 36610




Job	Truss	Truss Type	Qty	Ply	T22646441
BRIAN_PAPKA	B5	Attic	4	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:56 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-GDdH86Xy26oJzN\_UqCu\_hyAdp32TV\_zF5OLu5pzqnuD

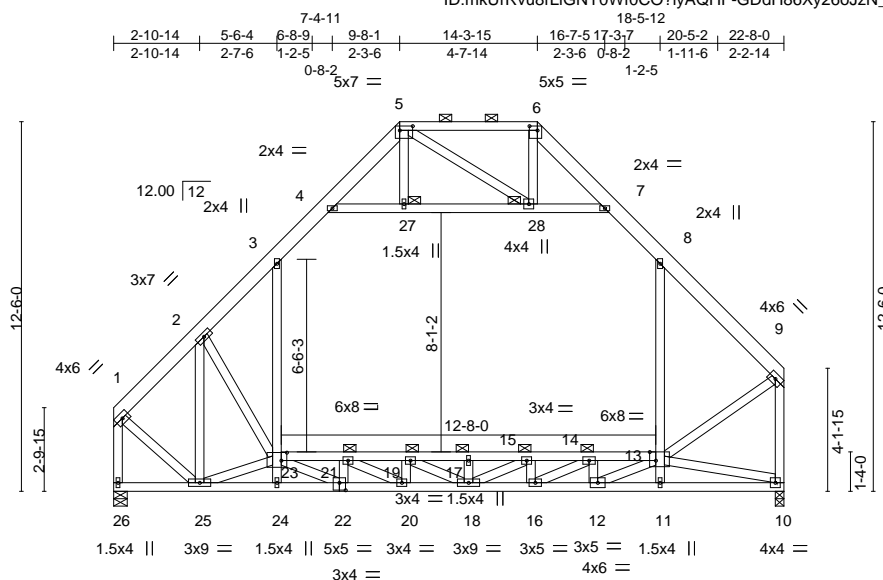

Scale = 1:77.9

Plate Offsets (X,Y)--	[5:0-5-4,0-1-12], [6:0-3-4,0-1-12], [13:0-2-8,Edge], [22:0-2-8,0-3-0], [23:0-2-4,0-3-4]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.68	Vert(LL)	-0.11 17-19	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.64	Vert(CT)	-0.19 17-19	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.47	Horz(CT)	0.02 10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS	Attic	-0.07 13-23	2176	360	Weight: 240 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SP No.2 \*Except\*  
5-6: 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-15 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
JOINTS 1 Brace at Jt(s): 27, 28, 21, 19, 17, 15, 14

#### REACTIONS.


(size) 26=0-5-8, 10=0-3-8  
Max Horz 26=423(LC 11)  
Max Grav 26=1478(LC 19), 10=1575(LC 18)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1087/0, 2-3=-1523/0, 3-4=-924/115, 4-5=-373/102, 6-7=-372/102, 7-8=-948/115, 8-9=-1475/0, 1-26=-1445/0, 9-10=-1767/0  
BOT CHORD 25-26=-405/366, 24-25=-555/1090, 22-24=-581/1094, 20-22=-101/1888, 18-20=0/2240, 16-18=0/1862, 12-16=0/1082, 11-12=-897/367, 10-11=-851/374, 21-23=-827/156, 19-21=-1327/0, 17-19=-1489/0, 15-17=-1489/0, 14-15=-1073/0, 13-14=-528/566  
WEBS 2-25=-888/9, 2-23=-164/390, 3-23=0/817, 4-27=-835/57, 27-28=-833/58, 7-28=-866/61, 8-13=-20/633, 1-25=0/1013, 9-13=0/1161, 21-22=-599/0, 19-20=-307/38, 15-16=-456/0, 12-14=-725/0, 22-23=0/1320, 20-21=-3/787, 18-19=-218/302, 15-18=-73/645, 14-16=0/1121, 12-13=0/1665, 23-25=-408/679, 10-13=-433/902

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Ceiling dead load (5.0 psf) on member(s). 3-4, 7-8, 4-27, 27-28, 7-28; Wall dead load (5.0psf) on member(s). 3-23, 8-13
- 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 21-23, 19-21, 17-19, 15-17, 14-15, 13-14
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Attic room checked for L/360 deflection.

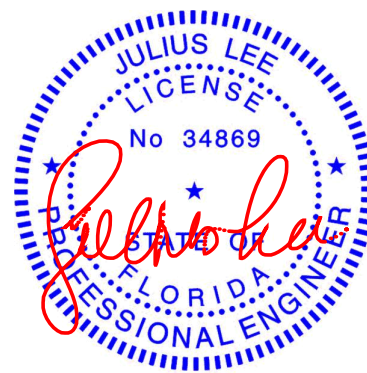

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646442
BRIAN_PAPKA	C1GE	Piggyback Base Structural Gable I	1	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:58 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-Cbl2ZoZDak20Dh8sycwSmNG2ksrlzyOYYiq?AizqnuB

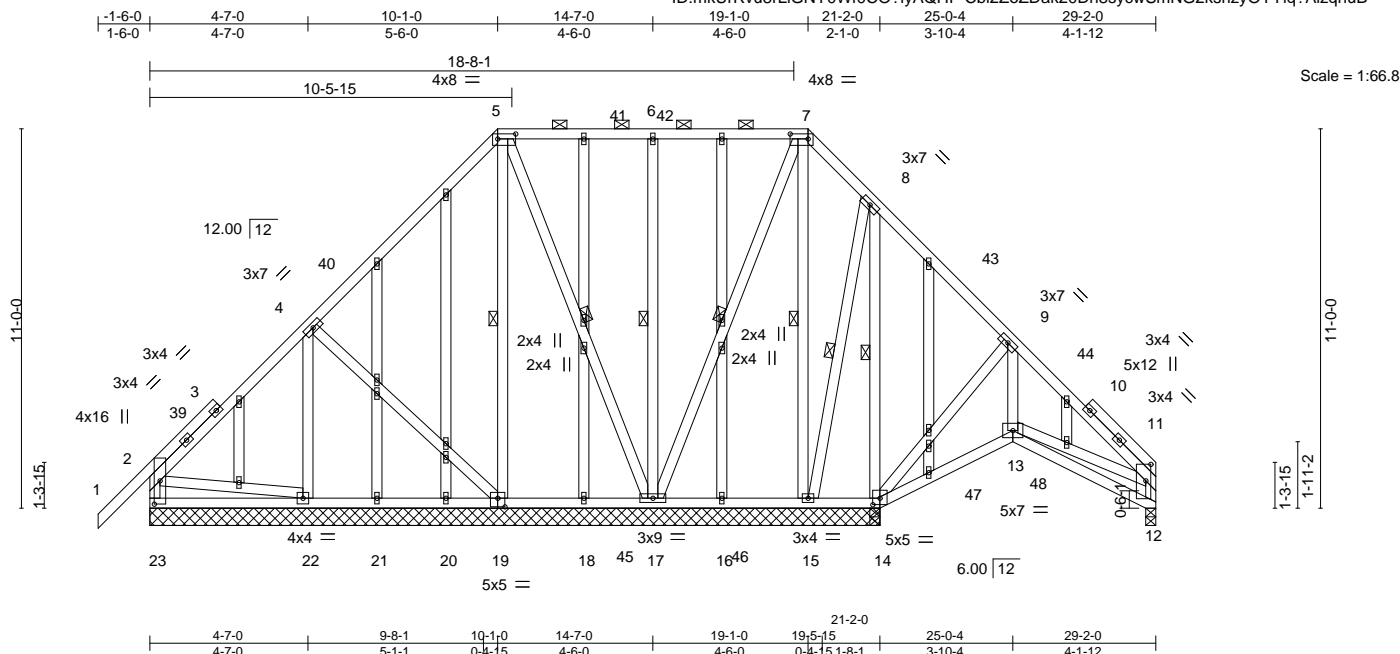


Plate Offsets (X,Y)-- [2:0-8-2,0-2-0], [5:0-6-4,0-1-12], [7:0-6-4,0-1-12], [11:0-5-12,0-1-12], [14:0-2-8,0-2-4], [19:0-2-8,0-3-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.34	Vert(LL)	0.02	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.14	Vert(CT)	-0.02	12-13	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.22	Horz(CT)	-0.01	12	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 333 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (10-0-0 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 22-23,13-14,12-13.  
WEBS 1 Row at midpt 5-19, 5-17, 6-17, 7-17, 7-15, 8-15, 8-14

#### REACTIONS.


All bearings 21-2-0 except (jt=length) 12=0-3-8.  
(lb) - Max Horz 23=375(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 23, 19, 12, 22, 15 except 14=272(LC 12), 17=103(LC 9)  
Max Grav All reactions 250 lb or less at joint(s) 12, 18, 20, 21, 16 except 23=315(LC 18), 19=364(LC 17), 14=447(LC 18), 14=401(LC 1), 22=375(LC 17), 17=569(LC 1), 15=309(LC 18)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-23=269/136  
BOT CHORD 22-23=-315/352  
WEBS 6-17=-314/124, 9-14=-335/185

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 10-1-0, Exterior(2R) 10-1-0 to 14-7-0, Interior(1) 14-7-0 to 19-1-0, Exterior(2R) 19-1-0 to 23-3-15, Interior(1) 23-3-15 to 29-1-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 23, 19, 12, 22, 15 except (jt=lb) 14=272, 17=103.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

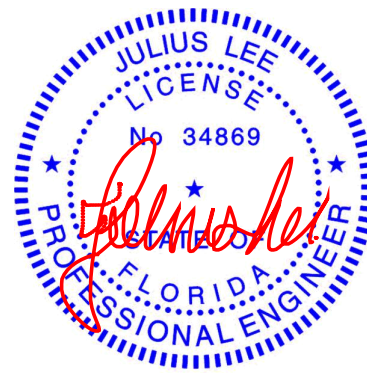

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646443
BRIAN_PAPKA	C2	Piggyback Base	4	1	
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:06:59 2021 Page 1

ID:mkUrRvu8rLIGNYOWfOCO?iyAQHF-goJQn8arL1Atqrj2WKRhJaoEoG9FiNhnMaYi8zqnuA

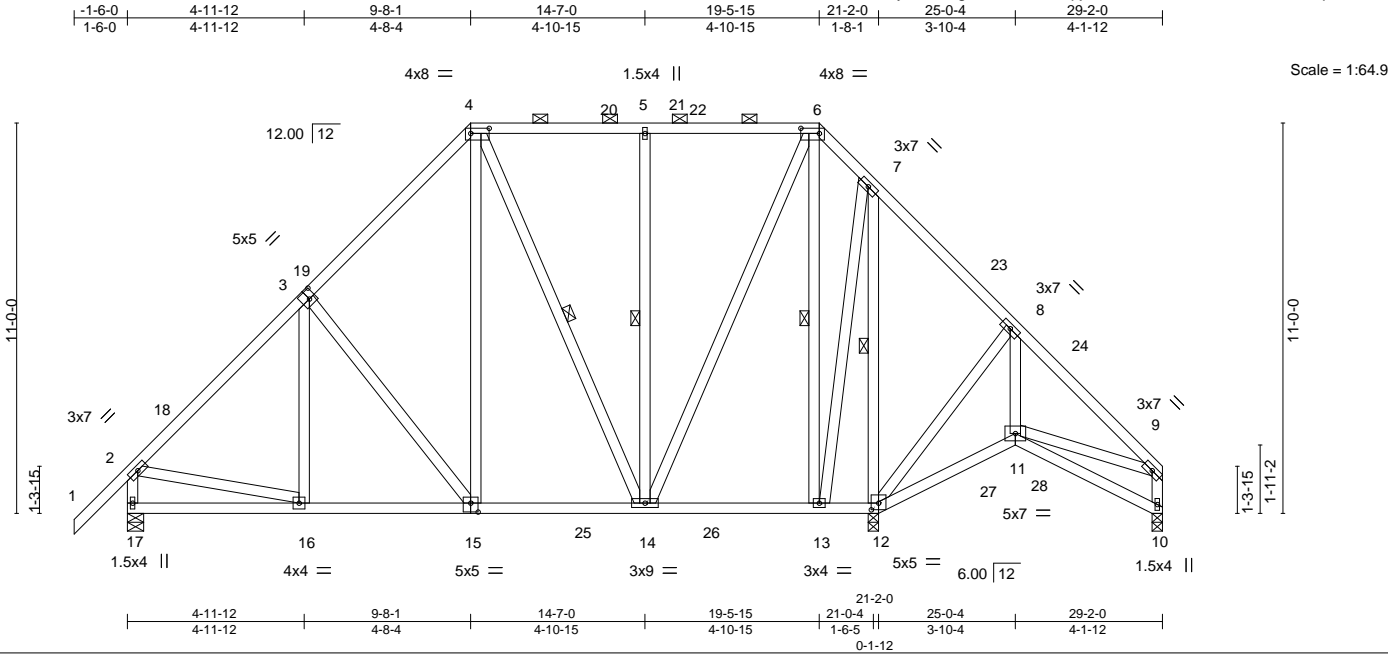


Plate Offsets (X,Y)--		[3:0-2-4,0-3-0], [4:0-6-4,0-1-12], [6:0-6-4,0-1-12], [12:0-2-8,0-2-4], [15:0-2-8,0-3-0]													
<b>LOADING</b> (psf)		<b>SPACING-</b>		2-0-0		<b>CSI.</b>		<b>DEFL.</b>				<b>PLATES</b>		<b>GRIP</b>	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.32	Vert(LL)	-0.04	14-15	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL		1.25		BC	0.31	Vert(CT)	-0.06	14-15	>999	180			
BCLL	0.0	Rep Stress Incr		YES		WB	0.35	Horz(CT)	0.03	10	n/a	n/a			
BCDL	10.0	Code FBC2020/TPI2014				Matrix-MS						Weight: 260 lb		FT = 20%	

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-8-4 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-14, 5-14, 6-13, 7-12

**REACTIONS.**

(size) 17=0-5-8, 12=0-3-8, 10=0-3-8  
Max Horz 17=383(LC 11)  
Max Uplift 17=171(LC 12), 12=334(LC 12), 10=93(LC 12)  
Max Grav 17=1129(LC 17), 12=1154(LC 2), 10=431(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1038/158, 3-4=-874/256, 4-5=-514/228, 5-6=-514/228, 6-7=-408/250, 8-9=-599/68, 2-17=-1050/223, 9-10=-385/92  
BOT CHORD 16-17=-335/405, 15-16=-142/877, 14-15=-64/678, 13-14=-74/318, 11-12=-24/495  
WEBS 3-15=-326/208, 4-15=-109/453, 5-14=-344/137, 6-14=-144/704, 6-13=-524/85, 7-13=-28/684, 7-12=-914/155, 8-12=-439/220, 8-11=-63/401, 2-16=0/622, 9-11=-13/378

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=29ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 9-8-1, Exterior(2R) 9-8-1 to 13-11-0, Interior(1) 13-11-0 to 19-5-15, Exterior(2R) 19-5-15 to 23-8-14, Interior(1) 23-8-14 to 29-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 17=171, 12=334.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	C3GIR	Piggyback Base Girder	1	3	T22646444

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:01 2021 Page 1

ID:mkUrRvu8rLIGNYOWfOCO?iyAQHF-dAQACqb5tfRb48sRdlU9O?iZL4glACR\_Eg3fn1zqnu8

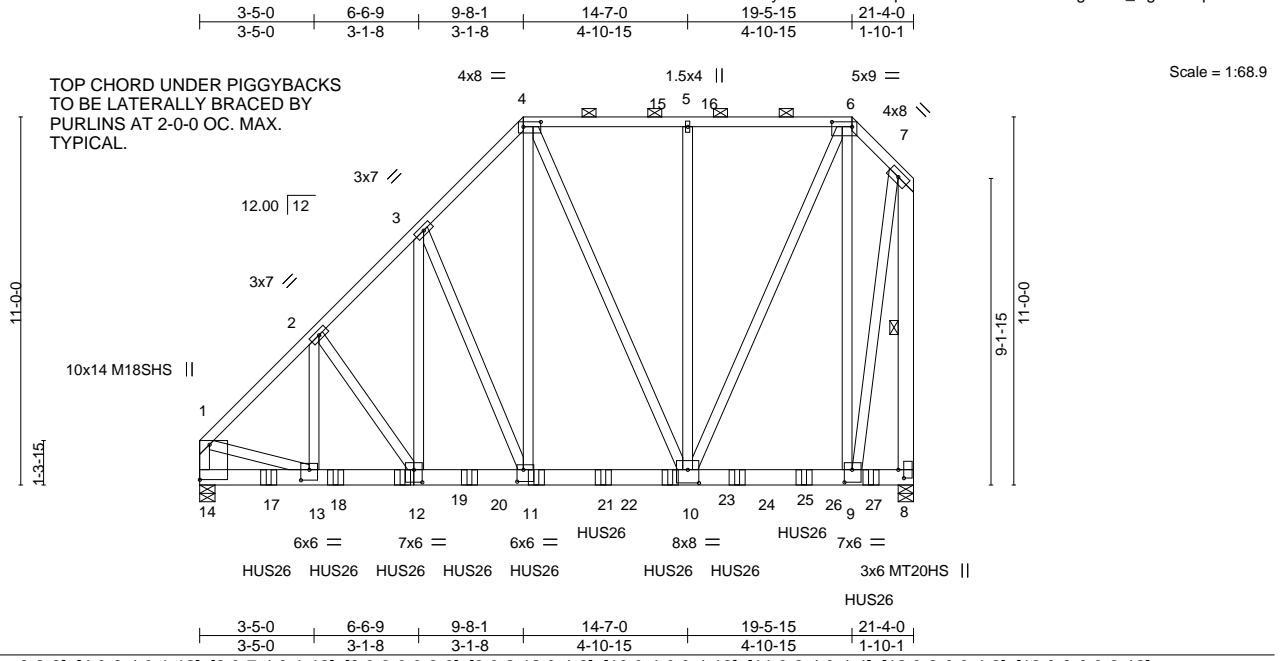


Plate Offsets (X,Y)--	[1:Edge,0-3-8], [4:0-6-4,0-1-12], [6:0-7-4,0-1-12], [8:0-3-0,0-2-0], [9:0-2-12,0-4-8], [10:0-4-0,0-4-12], [11:0-2-4,0-4-4], [12:0-3-0,0-4-8], [13:0-3-0,0-3-12]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.38	Vert(LL)	-0.10 10-11	>999	240	MT20	244/190	
TCDL 10.0	Lumber DOL	1.25	BC 0.98	Vert(CT)	-0.19 10-11	>999	180	MT20HS	187/143	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.65	Horz(CT)	0.03 8	n/a	n/a	M18SHS	244/190	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 731 lb	FT = 20%	

<b>LUMBER-</b>	<b>BRACING-</b>	
TOP CHORD 2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
BOT CHORD 2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS	1 Row at midpt 7-8
7-8: 2x6 SP No.2		


**REACTIONS.** (size) 14=0-5-8, 8=0-5-8  
Max Horz 14=448(LC 31)  
Max Uplift 14=1287(LC 8), 8=1445(LC 5)  
Max Grav 14=9761(LC 2), 8=10477(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-9774/1323, 2-3=-9136/1324, 3-4=-7491/1179, 4-5=-4663/793, 5-6=-4663/793, 6-7=-2436/547, 1-14=-9003/1210, 7-8=-10127/1448  
BOT CHORD 13-14=-475/643, 12-13=-1174/6853, 11-12=-1063/6360, 10-11=-887/5320, 9-10=-322/1563  
WEBS 2-13=-172/954, 2-12=-760/203, 3-12=-505/3539, 3-11=-2804/529, 4-11=-942/6527, 4-10=-1568/293, 5-10=-345/140, 6-10=-1080/7390, 6-9=-4998/879, 1-13=-819/6724, 7-9=-1212/8382

**NOTES-**

- 1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are MT20 plates unless otherwise indicated.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=1287, 8=1445.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Continued on page 2

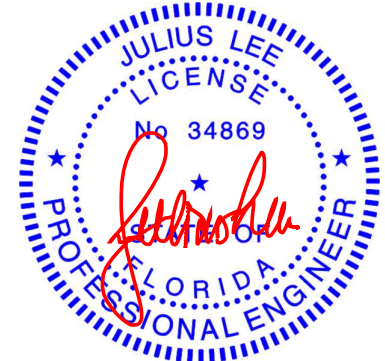

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646444
BRIAN_PAPKA	C3GIR	Piggyback Base Girder	1	3	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:01 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-dAQACqb5tfRb48sRdlU9O?tZL4glACR\_Eg3fn1zqnu8

NOTES-

- 12) Use USP HUS26 (With 14-16d nails into Girder & 6-16d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 20-0-12 to connect truss(es) to front face of bottom chord.
- 13) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
  - Uniform Loads (plf)
    - Vert: 1-4=-60, 4-6=-60, 6-7=-60, 8-14=-20
  - Concentrated Loads (lb)
    - Vert: 11=-1626(F) 17=-1626(F) 18=-1626(F) 19=-1626(F) 20=-1626(F) 21=-1626(F) 23=-1626(F) 24=-1632(F) 26=-1632(F) 27=-1632(F)




Job	Truss	Truss Type	Qty	Ply	T22646445
BRIAN_PAPKA	D1GE	Monopitch Supported Gable	2	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:02 2021 Page 1

ID:mkUrRvu8rLiGNY0Wf0CO?iyAQHF-5N\_ZPAcJeyZShIRdBS?OxDQivUBYvnc7TKoCJTzqnu7

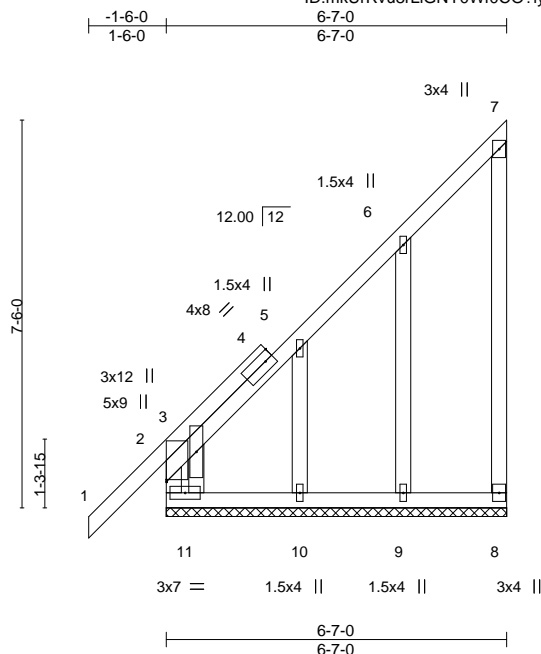

Scale = 1:44.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.45	Vert(LL)	0.01	1	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.21	Vert(CT)	-0.00	1	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	8	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-R						
								Weight: 55 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 6-7-0.

- (lb) - Max Horz 11=336(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 9 except 8=111(LC 11), 10=187(LC 9)  
Max Grav All reactions 250 lb or less at joint(s) 8, 9, 10 except 11=359(LC 18)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-11=599/343, 3-5=333/522, 5-6=222/328  
WEBS 5-10=315/173, 3-11=546/792

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Gable requires continuous bottom chord bearing.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 9 except (jt=lb) 8=111, 10=187.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610






Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	D3	Scissor	1	1	T22646447
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:04 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-116JqrezAapAxc0It1s0eV5vHsMNgjQweHJNLzqnu5

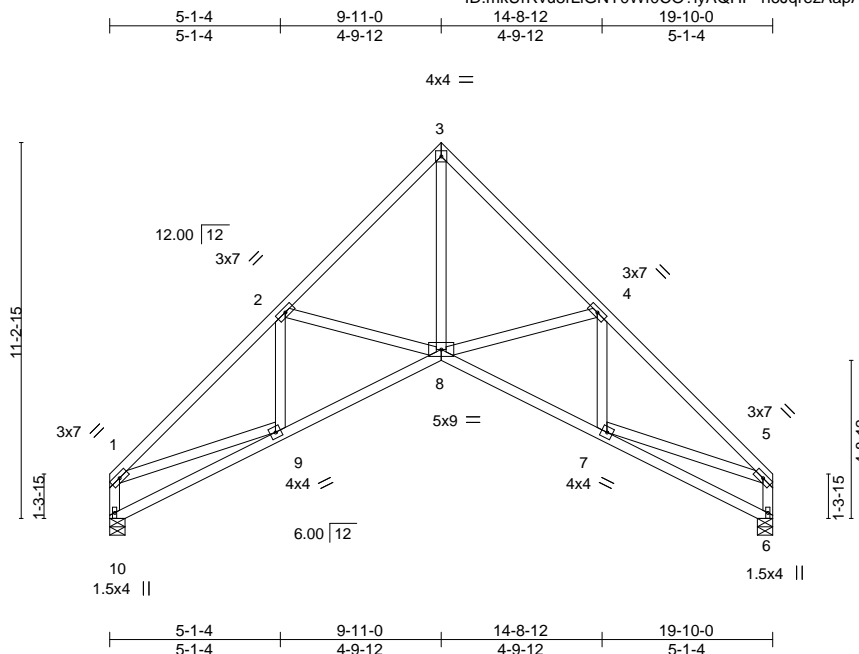

Scale = 1:68.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.04	8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.32	Vert(CT)	-0.09	8-9	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.23	Horz(CT)	0.11	6	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 127 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 9-5-1 oc bracing.

#### REACTIONS.


(size) 10=0-5-8, 6=0-5-8  
Max Horz 10=-356(LC 10)  
Max Uplift 10=-111(LC 12), 6=-111(LC 12)  
Max Grav 10=782(LC 1), 6=782(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1279/142, 2-3=-1014/114, 3-4=-1074/114, 4-5=-1259/142, 1-10=-807/145,  
5-6=-768/145  
BOT CHORD 9-10=-387/463, 8-9=-198/1197, 7-8=0/947  
WEBS 3-8=-49/1118, 4-8=-327/218, 2-8=-296/218, 1-9=0/778, 5-7=0/802

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 10, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=111, 6=111.

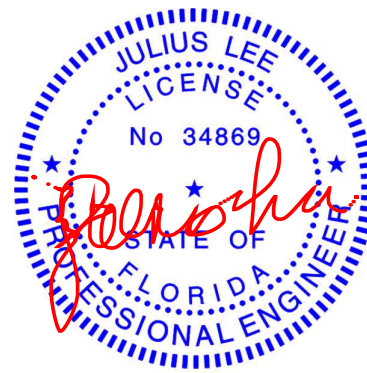

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.  
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	T22646448
BRIAN_PAPKA	D4	Scissor	6	1	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:05 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-Vygh1Becxtx1YmACsbY5Yr2GhhCf67Ba9l1twozqnu4

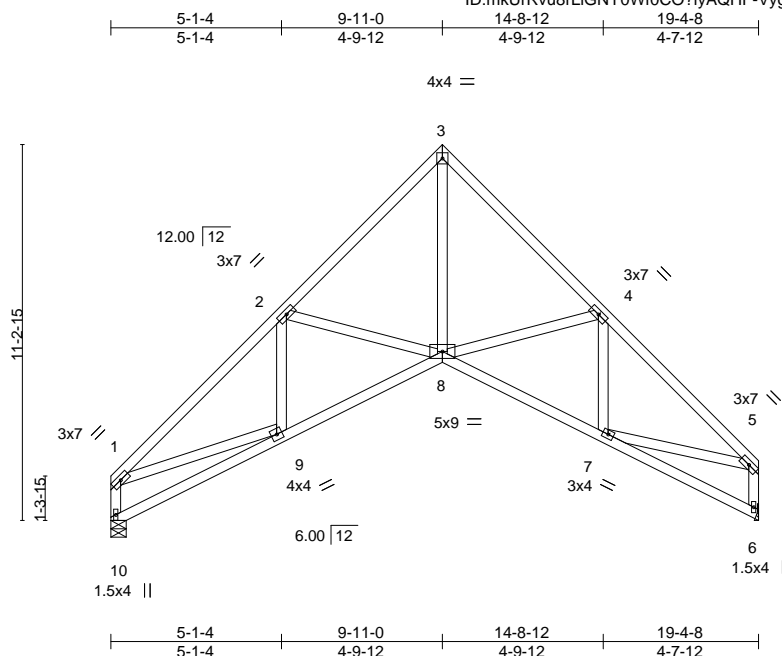

Scale = 1:68.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.04	8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.31	Vert(CT)	-0.08	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	0.09	6	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 125 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-11-13 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 9-5-5 oc bracing.

#### REACTIONS.

(size) 10=0-5-8, 6=Mechanical  
Max Horz 10=354(LC 11)  
Max Uplift 10=-109(LC 12), 6=-109(LC 12)  
Max Grav 10=763(LC 1), 6=763(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1245/145, 2-3=-973/118, 3-4=-1032/116, 4-5=-1136/138, 1-10=-789/147, 5-6=-743/131  
BOT CHORD 9-10=-386/459, 8-9=-213/1167, 7-8=-9/865  
WEBS 2-8=-299/217, 3-8=-62/1060, 4-8=-282/208, 1-9=0/753, 5-7=0/730

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=109, 6=109.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646449
BRIAN_PAPKA	D5	Roof Special	1	1	

Mayo Truss, Mayo, FL

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Jan 29 13:04:24 2021 Page 1

ID:mkUrRvu8rLiGNY0Wf0CO?iyAQHF-9GjNqIWGwIKjEV8nGNVjpP?BmcPZ5hhXKciHBkzqVTL

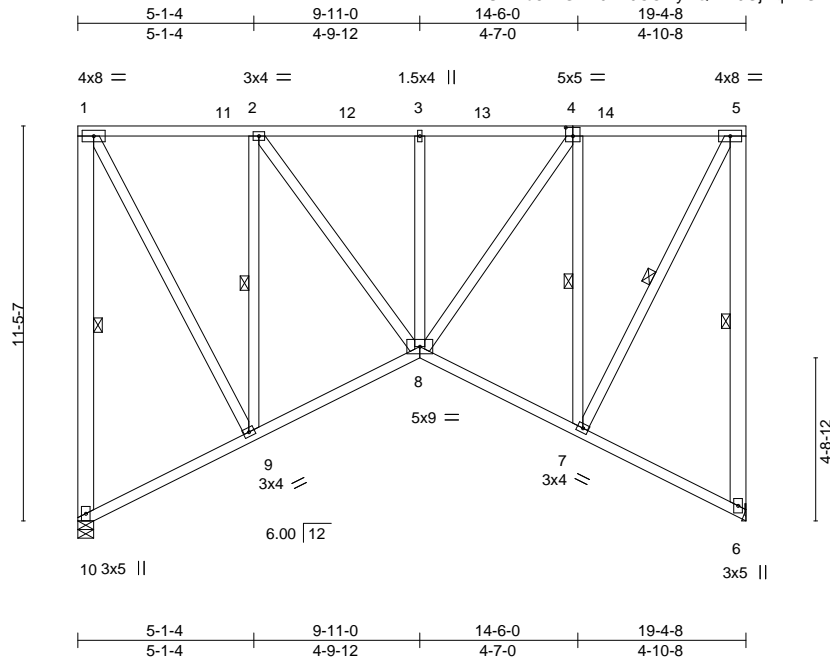


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.54	Vert(LL) 0.05	7-8	>999	240		MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.33	Vert(CT) -0.06	8-9	>999	180			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.74	Horz(CT) -0.06	6	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 198 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2 \*Except\*  
1-10,5-6: 2x6 SP No.2


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 1-10, 5-6, 2-9, 4-7, 5-7

**REACTIONS.** (lb/size) 10=757/0-5-8, 6=757/Mechanical  
Max Horz 10=-464(LC 10)  
Max Uplift 10=-256(LC 8), 6=-256(LC 9)  
Max Grav 10=773(LC 18), 6=773(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-10=-715/541, 1-11=-453/439, 2-11=-453/439, 2-12=-655/612, 3-12=-655/612,  
3-13=-655/612, 4-13=-655/612, 4-14=-325/237, 5-14=-325/237, 5-6=-745/725  
BOT CHORD 9-10=-654/672, 8-9=-787/857, 7-8=-551/619  
WEBS 1-9=-419/667, 2-9=-640/485, 2-8=-288/408, 3-8=-263/265, 4-8=-686/739, 4-7=-809/885,  
5-7=-705/779

- NOTES-**
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Refer to girder(s) for truss to truss connections.
  - Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 256 lb uplift at joint 10 and 256 lb uplift at joint 6.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

**LOAD CASE(S)** Standard

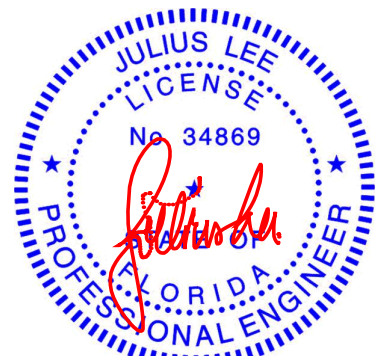

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 36610






Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	D7GIR	Piggyback Base Girder	1	2	Job Reference (optional)

T22646451

Mayo Truss, Mayo, FL

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-\_EgwnnC0VpWeaG?k6r04dRs\_xanDyUfwR\_0ohwzqVSS

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Jan 29 13:05:21 2021 Page 1

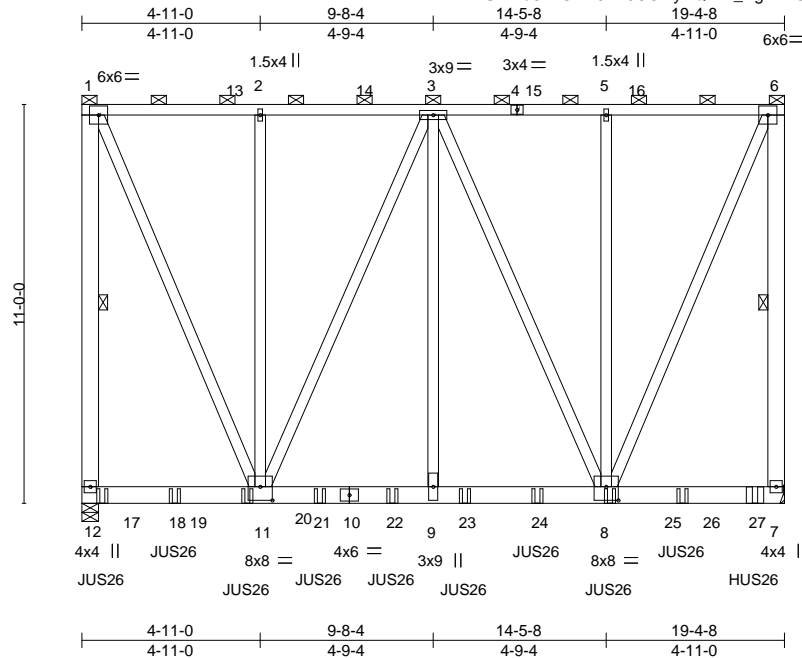



Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	D7GIR	Piggyback Base Girder	1	2	T22646451

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-6=-60, 7-12=-20

Concentrated Loads (lb)

Vert: 8=-830(F) 17=-837(F) 18=-830(F) 20=-830(F) 21=-830(F) 22=-830(F) 23=-830(F) 24=-830(F) 26=-830(F) 27=-1366(F)


Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	E1GE	Common Supported Gable	1	1	T22646452
Job Reference (optional)					

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:09 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-OjvCtZi6\_6RS1NTz5Qd1jhD\_Yldd2\_Y94w?43Zzqnu0



4x4 =

Scale = 1:33.4

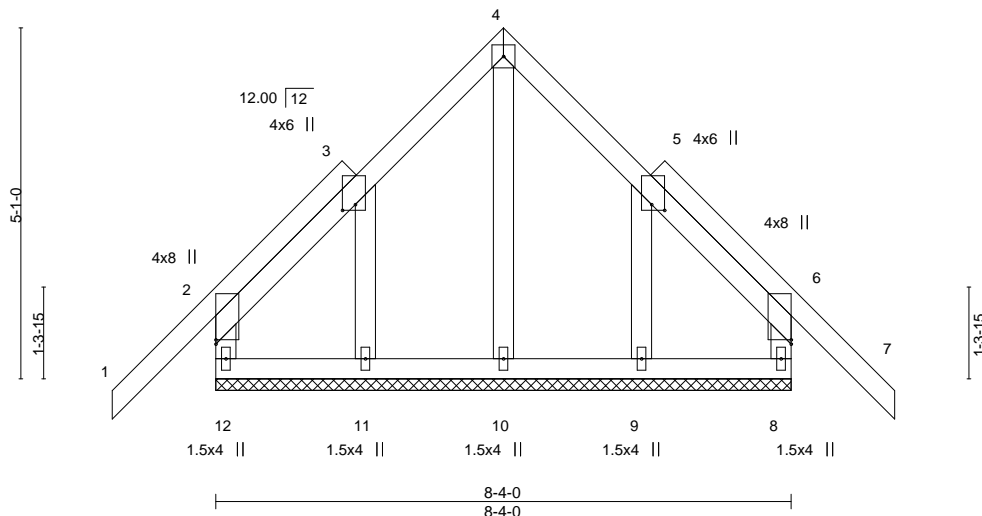


Plate Offsets (X,Y)--		[3:0-1-0,0-2-4], [5:0-1-0,0-2-4]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	-0.01	7	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	-0.02	7	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00	8	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-R					Weight: 61 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

All bearings 8-4-0.  
(lb) - Max Horz 12=199(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 9 except 12=151(LC 12), 8=151(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 12, 8, 10, 11, 9

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 9 except (jt=lb) 12=151, 8=151.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.  
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	T22646453
BRIAN_PAPKA	E2	Scissor	1	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:10 2021 Page 1  
ID:mkUrRvu8rLIGNYOWf0CO?iyAQHF-svTa4viklQZJfX2Af88GFvI5\_iuQnQ?JJakdb?zqnu?



Scale = 1:37.4

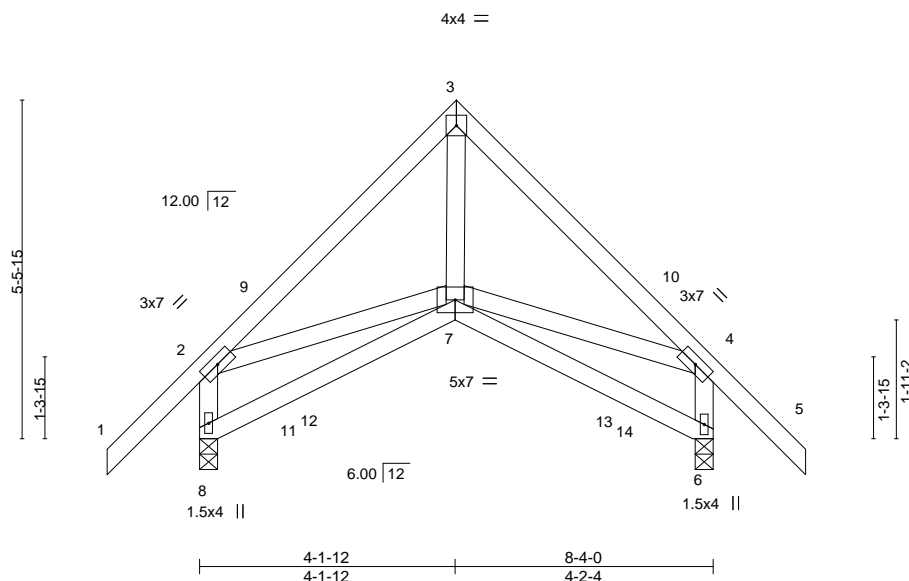

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.38	Vert(LL)	0.06 6-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.34	Vert(CT)	0.05 6-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.01 6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						
								Weight: 58 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 8=0-3-8, 6=0-3-8  
Max Horz 8=-225(LC 10)  
Max Uplift 8=-218(LC 12), 6=-218(LC 12)  
Max Grav 8=420(LC 1), 6=420(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-350/232, 3-4=-358/284, 2-8=-382/394, 4-6=-380/449  
BOT CHORD 7-8=-231/274  
WEBS 4-7=-131/250

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-2-0, Exterior(2R) 4-2-0 to 7-2-0, Interior(1) 7-2-0 to 9-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 8, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=218, 6=218.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610


Job BRIAN_PAPKA	Truss F1GE	Truss Type Common Supported Gable	Qty 1	Ply 1	T22646454
Job Reference (optional)					

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:11 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-K51yIFjMWjhAGhdMDrVo6lJY6JKWsmSXEUB7Rzqnu\_

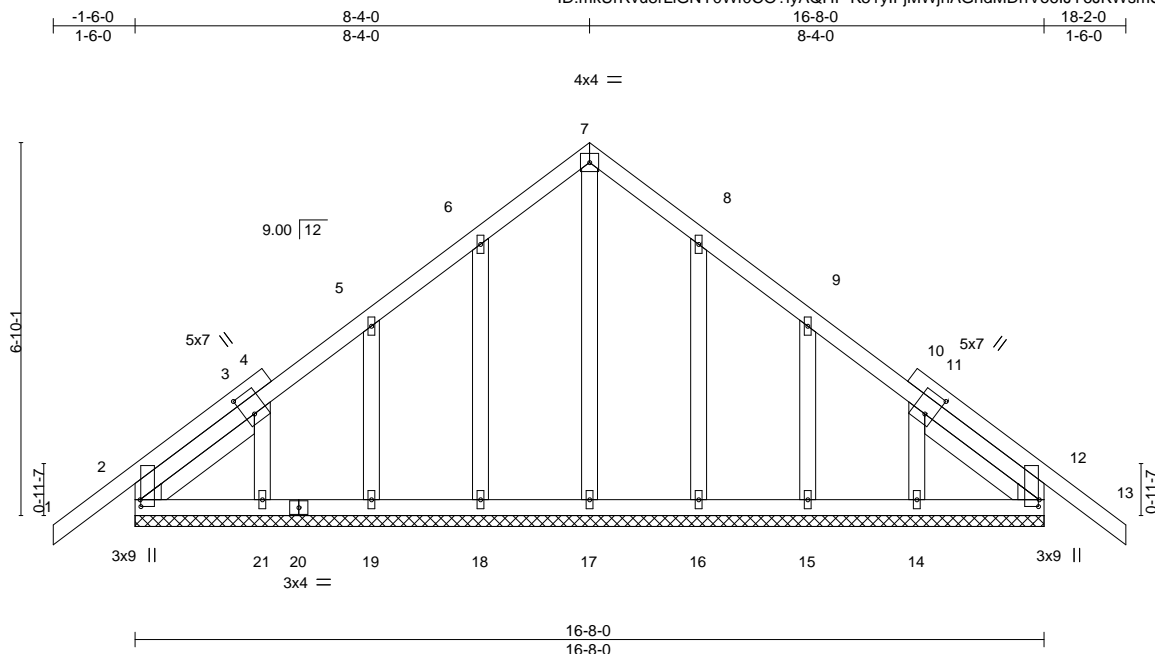

Scale = 1:42.2

Plate Offsets (X,Y)--		[2:0-1-8,0-0-3], [3:0-5-0,0-2-1], [11:0-5-0,0-2-1], [12:0-1-8,0-0-3]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.14	Vert(LL)	-0.00	13	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.01	13	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	12	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						
								Weight: 119 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2  
WEDGE

Left: 2x4 SP No.3 , Right: 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 16-8-0.

(lb) - Max Horz 2=199(LC 10)


Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 18, 19, 21, 16, 15, 14

Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 18, 19, 21, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 18, 19, 21, 16, 15, 14.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 12.

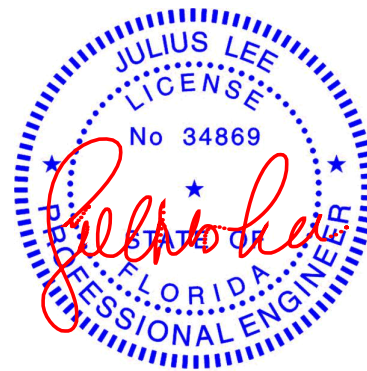

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.  
Tampa, FL 33610


Job BRIAN_PAPKA	Truss F2	Truss Type Common	Qty 3	Ply 1	Job Reference (optional)
--------------------	-------------	----------------------	----------	----------	--------------------------

T22646455

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:12 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-olbKVbk?H1p1uqCYmZAKLKrUkWdGFIgcmuKfuzqntz



Scale = 1:42.7

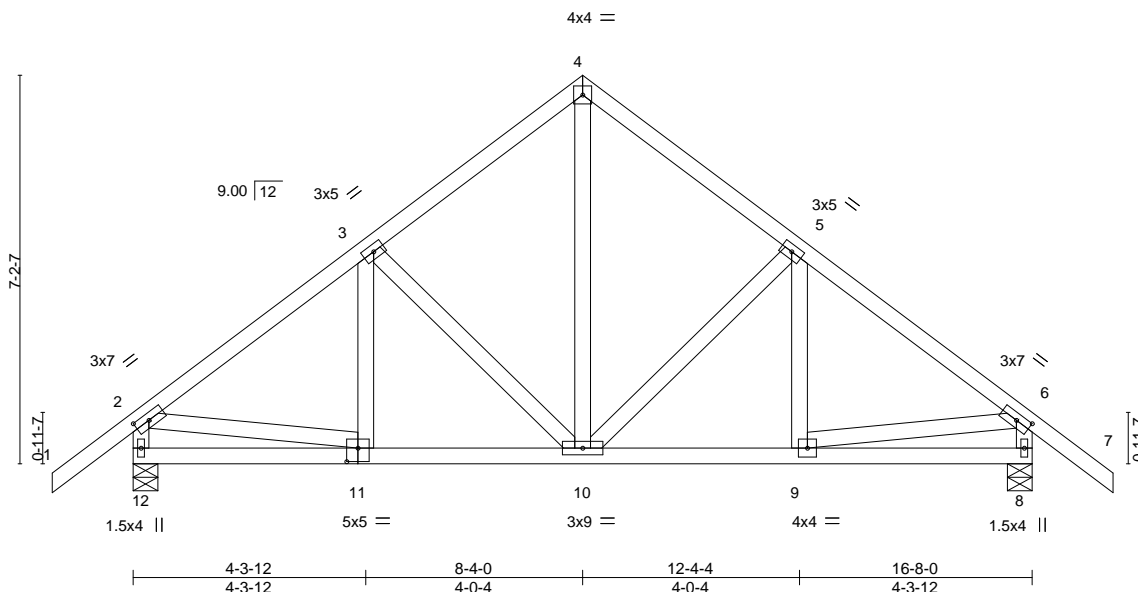


Plate Offsets (X,Y)--	[2:0-3-4,0-1-8], [6:0-3-4,0-1-8], [11:0-2-8,0-3-0]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	-0.01 10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.19	Vert(CT)	-0.03 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 111 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied.

**REACTIONS.**


(size) 12=0-5-8, 8=0-5-8  
 Max Horz 12=240(LC 11)  
 Max Uplift 12=163(LC 12), 8=163(LC 12)  
 Max Grav 12=754(LC 1), 8=754(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-740/122, 3-4=-564/168, 4-5=-564/168, 5-6=-742/124, 2-12=-711/184,  
 6-8=-709/186  
 BOT CHORD 11-12=-163/269, 10-11=0/612, 9-10=0/532  
 WEBS 4-10=-95/396, 2-11=-3/475, 6-9=-5/473

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=163, 8=163.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

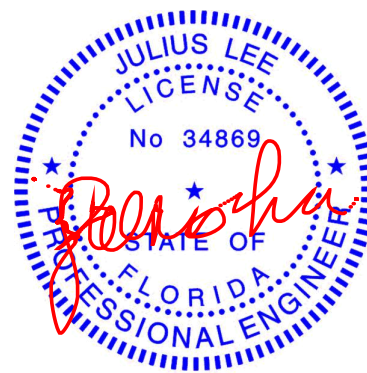

Julius Lee PE No.34869  
 MiTek USA, Inc. FL Cert 6634  
 6904 Parke East Blvd. Tampa FL 33610  
 Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.  
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	GIR1	Flat Girder	1	2	Job Reference (optional)

Mayo Truss, Mayo, FL

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Jan 29 13:07:27 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-ITHYEtk2qXOIhdeyUJHdk?4Z8NwuTdYTPbXS6dzqVQU

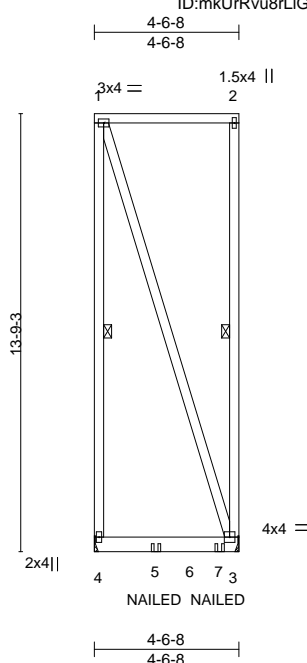

Scale = 1:72.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	-0.01	3-4	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.11	Vert(CT)	-0.01	3-4	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						Weight: 153 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-6-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 1-4, 2-3

**REACTIONS.** (lb/size) 4=229/Mechanical, 3=286/Mechanical  
Max Uplift 4=-123(LC 4), 3=-206(LC 4)  
Max Grav 4=281(LC 25), 3=344(LC 25)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 4 and 206 lb uplift at joint 3.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-2=-60, 3-4=-20  
Concentrated Loads (lb)  
Vert: 5=-84(B) 7=-90(B)

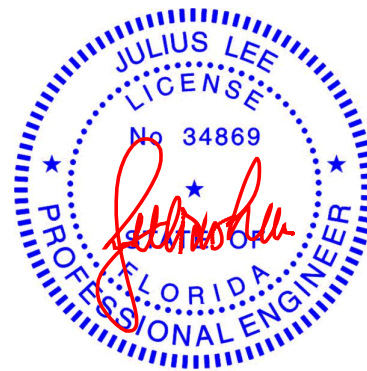

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610




Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	GIR2	Flat Girder	1	2	Job Reference (optional)

T22646457

Mayo Truss, Mayo, FL

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-nTQC8fMgaVxNwdcxXECqrzEPzLdgl0Y7Ng7CxczqVPg

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Jan 29 13:08:19 2021 Page 1

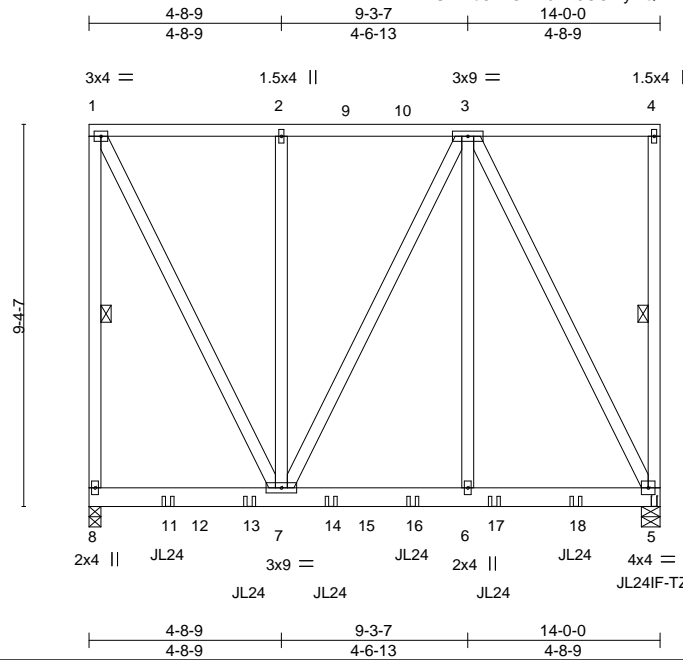

Scale = 1:56.5

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	I/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.31	Vert(LL)	0.03	5-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.26	Vert(CT)	-0.03	5-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.63	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 295 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 1-8, 4-5
<b>REACTIONS.</b> (lb/size) 8=1526/0-3-8, 5=1796/0-5-8	
Max Horz 8=-372(LC 4)	
Max Uplift 8=-772(LC 4), 5=-1072(LC 5)	
Max Grav 8=1841(LC 26), 5=2291(LC 25)	

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-8=-1591/722, 1-2=-784/420, 2-9=-784/420, 9-10=-784/420, 3-10=-784/420
BOT CHORD 8-11=-329/286, 11-12=-329/286, 12-13=-329/286, 7-13=-329/286, 7-14=-454/817, 14-15=-454/817, 15-16=-454/817, 6-16=-454/817, 6-17=-454/817, 17-18=-454/817, 5-18=-454/817
WEBS 1-7=-770/1677, 2-7=-290/159, 3-6=-550/1272, 3-5=-1717/803

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 772 lb uplift at joint 8 and 1072 lb uplift at joint 5.
  - Use USP JL24 (With 4-10d nails into Girder & 2-10d x 1-1/2 nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 11-11-4 to connect truss(es) to front face of bottom chord.
  - Use USP JL24IF-TZ (With 4-10d HDG nails into Girder & 2-10d x 1-1/2 HDG nails into Truss) or equivalent at 13-10-4 from the left end to connect truss(es) to front face of bottom chord.
  - Fill all nail holes where hanger is in contact with lumber.

**LOAD CASE(S)** Standard

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646457
BRIAN_PAPKA	GIR2	Flat Girder	1	2	Job Reference (optional)

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-60, 5-8=-20


Concentrated Loads (lb)

Vert: 5=-284(F) 11=-318(F) 13=-325(F) 14=-325(F) 16=-325(F) 17=-325(F) 18=-325(F)

Job	Truss	Truss Type	Qty	Ply	T22646458
BRIAN_PAPKA	GIR3	Flat Girder	1	2	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:15 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-CtGT8cmayBclx7ShkRyyTzLjewSfL2SsSOFDzqntw

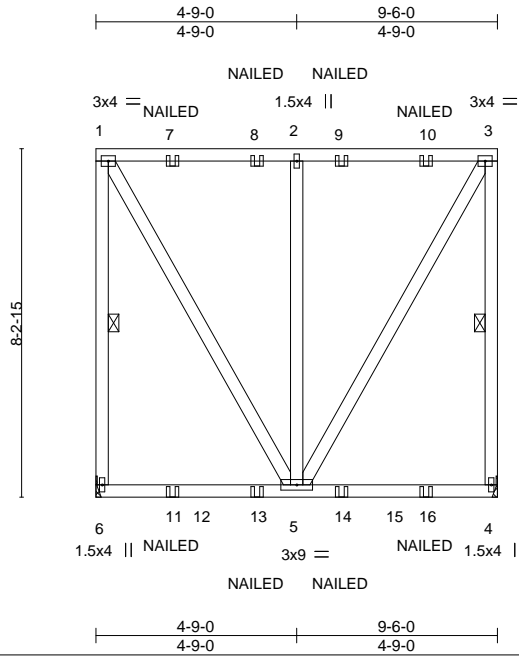

Scale = 1:54.5

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.28	Vert(LL)	0.02 4-5	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.19	Vert(CT)	-0.03 4-5	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.17	Horz(CT)	-0.00 4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 177 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 1-6, 3-4

#### REACTIONS.

(size) 6=Mechanical, 4=Mechanical  
Max Horz 6=329(LC 4)  
Max Uplift 6=642(LC 4), 4=654(LC 5)  
Max Grav 6=966(LC 26), 4=978(LC 25)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-6=-830/618, 1-2=-357/314, 2-3=-357/314, 3-4=-838/627  
BOT CHORD 5-6=-297/261  
WEBS 1-5=-552/746, 2-5=-699/600, 3-5=-552/746

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=642, 4=654.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-3=-60, 4-6=-20

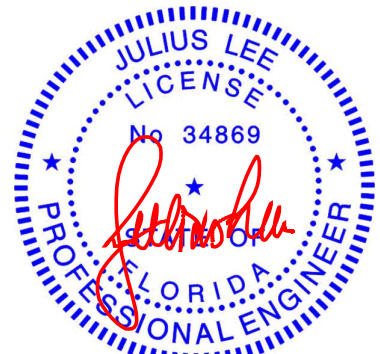

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	T22646458
BRIAN_PAPKA	GIR3	Flat Girder	1	2	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:15 2021 Page 2  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-CtGT8cmtayBcllx7ShkRyyTzLjewSfL2SsSOFDzqntw


**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 7=-88(F) 8=-88(F) 9=-88(F) 10=-88(F) 11=-40(F) 13=-40(F) 14=-40(F) 16=-40(F)

Job	Truss	Truss Type	Qty	Ply	T22646459
BRIAN_PAPKA	J01	Jack-Open	4	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:15 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-CtGT8cmtayBcllx7ShkRyyTsHjVPSH?2SsSOFDzqntw

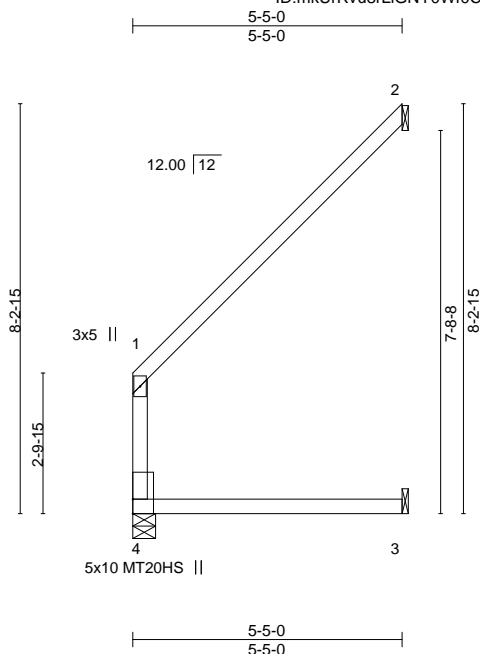

Scale = 1:46.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.73	Vert(LL)	0.15 3-4	>416	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.73	Vert(CT)	-0.15 3-4	>429	180	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.53 2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						
								Weight: 23 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=0-5-8, 2=Mechanical, 3=Mechanical  
Max Horz 4=260(LC 12)  
Max Uplift 2=193(LC 12), 3=41(LC 12)  
Max Grav 4=211(LC 18), 2=217(LC 17), 3=101(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) All plates are MT20 plates unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 2=193.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 33610

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MI1-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, strength, detailing and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
6904 Parke East Blvd.  
Tampa, FL 36610



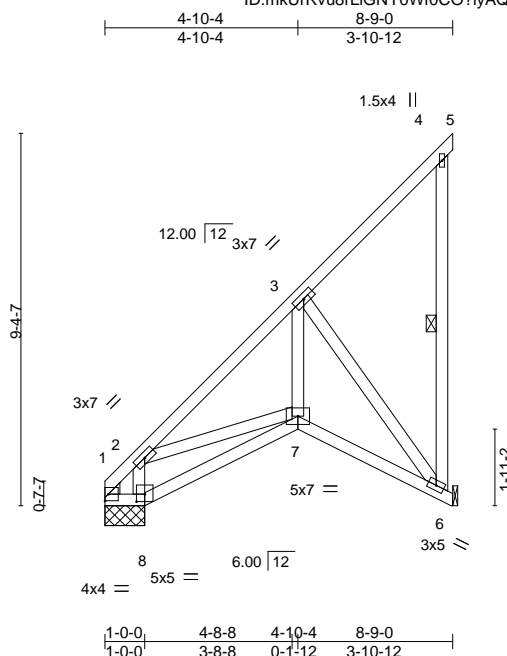

Scale = 1:58.0

Plate Offsets (X,Y)--		[8:0-2-8,0-2-4]									
<b>LOADING</b>	(psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	20.0	Plate Grip DOL	1.25	TC	0.77	Vert(LL)	-0.02 7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.19	Vert(CT)	-0.03 7-8	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.33	Horz(CT)	0.01 6	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MP						Weight: 67 lb	FT = 20%


<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.2 *Except*	WEBS	1 Row at midpt                      4-6
	4-6: 2x4 SP No.1		
WEDGE			
Left: 2x4 SP No.2			

**REACTIONS.** (size) 8=1-0-0, 1=1-0-0, 6=Mechanical, 1=1-0-0  
 Max Horz 1=388(LC 11)  
 Max Uplift 8=-195(LC 9), 1=-265(LC 10), 6=-193(LC 9), 1=-48(LC 1)  
 Max Grav 8=548(LC 17), 1=370(LC 9), 6=396(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**TOP CHORD** 1-2=-419/598, 2-3=-381/69, 3-4=-260/272, 4-6=-254/150  
**BOT CHORD** 6-7=-241/503  
**WEBS** 3-7=-132/409, 3-6=-513/217, 2-8=-560/255, 2-7=-111/361

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCdL=6.0psf; BCdL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat II; Exp C; Encl., GCp=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb)  
8=195, 1=265, 6=193, 1=265.

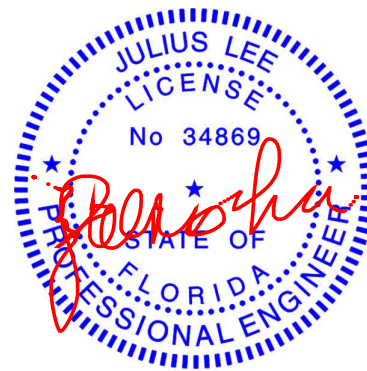

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Components**




6904 Parke East Blvd  
Tampa, FL 36610

Job BRIAN_PAPKA	Truss K2	Truss Type Jack-Closed	Qty 5	Ply 1	T22646462
--------------------	-------------	---------------------------	----------	----------	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:18 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-dSycmeplttabClfi7pH8ab5Mrwf4fyKU8pg3sXzqntt

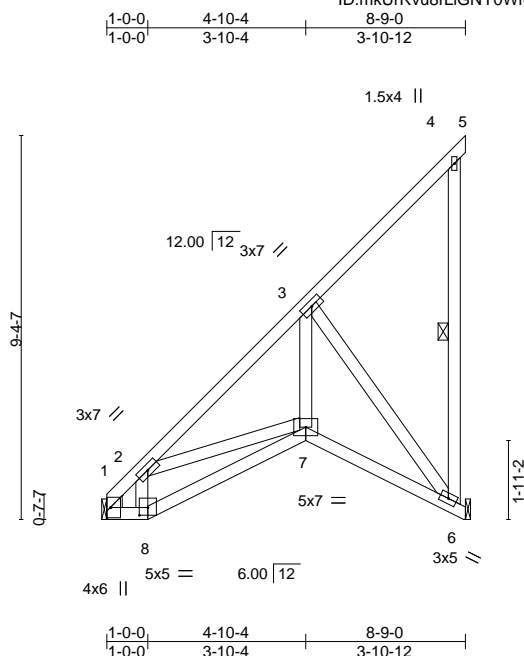

Scale = 1:56.2

Plate Offsets (X,Y)--	[8:0-2-8,0-2-4]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.77	Vert(LL)	-0.02	7-8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.22	Vert(CT)	-0.04	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.02	6	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP					Weight: 67 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2 \*Except\*  
4-6: 2x4 SP No.1

WEDGE  
Left: 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-6


**REACTIONS.** (size) 1=Mechanical, 6=Mechanical  
Max Horz 1=388(LC 11)  
Max Uplift 1=-22(LC 13), 6=-216(LC 9)  
Max Grav 1=412(LC 18), 6=461(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-461/133, 2-3=-432/31, 3-4=-260/272, 4-6=-253/150  
BOT CHORD 1-8=-260/540, 7-8=-279/584, 6-7=-270/592  
WEBS 3-7=-193/592, 3-6=-648/262

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 6=216.

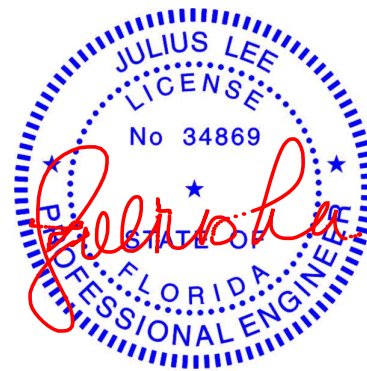

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646463
BRIAN_PAPKA	K3	Roof Special	1	1	

Mayo Truss, Mayo, FL

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Jan 29 13:08:44 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-45tHBSfwtyzpJRYxGeSp1EW60qHHwHfuPyUnCzqVPI

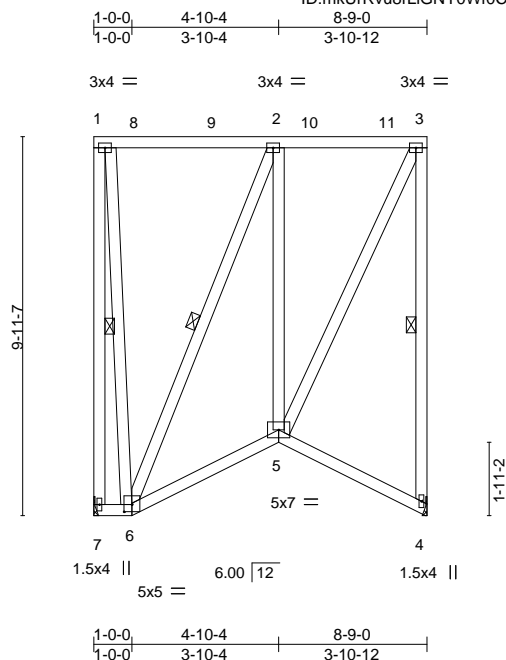

Scale = 1:60.5

Plate Offsets (X,Y)-- [6:0-2-8,0-2-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	-0.02	5-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.20	Vert(CT)	-0.04	5-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.33	Horz(CT)	0.01	4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 108 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 1-7, 3-4, 2-6

**REACTIONS.** (lb/size) 7=338/Mechanical, 4=338/Mechanical  
Max Uplift 7=-61(LC 8), 4=-61(LC 9)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-7=-330/339, 3-4=-301/357  
WEBS 3-5=-254/249, 2-6=-242/262

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 5-7-4, Corner(3) 5-7-4 to 8-7-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 7 and 61 lb uplift at joint 4.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

**LOAD CASE(S)** Standard



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 36610

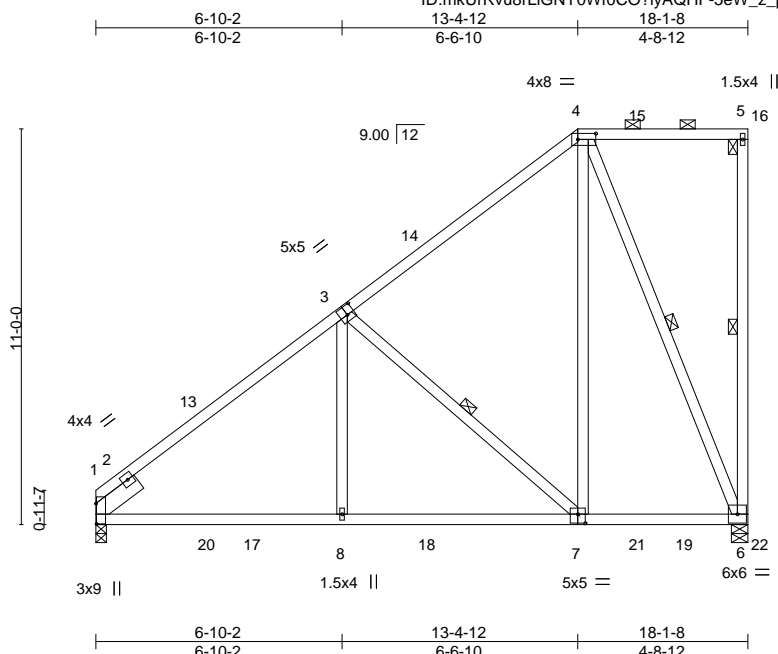


Plate Offsets (X,Y)-- [1:0-6-13,0-0-3], [3:0-2-8,0-3-0], [4:0-6-0,0-2-0], [7:0-2-8,0-3-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	0.10 8-11 >999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	-0.09 7-8 >999	180	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.79	Horz(CT)	-0.03 1 n/a	n/a	
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 131 lb FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD	2x4 SP No.2		
WEBS	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
SLIDER	Left 2x6 SP No.2 -t 1-6-0	WEBS	1 Row at midpt 5-6, 3-7, 4-6

**REACTIONS.** (size) 6=0-5-8, 1=0-3-8  
 Max Horz 1=357(LC 12)  
 Max Uplift 6=-444(LC 12), 1=-219(LC 12)  
 Max Grav 6=836(LC 20), 1=822(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-929/362, 3-4=-465/170  
BOT CHORD 1-8=-533/682, 7-8=-530/679, 6-7=-195/289  
WEBS 3-8=-248/348, 3-7=-536/457, 4-7=-390/594, 4-6=-723/494

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-4-12, Exterior(2R) 13-4-12 to 17-7-11, Interior(1) 17-7-11 to 17-11-12 zone; cantilever left and right exposed ; end vertical left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt-lb) 6=444, 1=219.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2607 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd  
Tampa, FL 36610





Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
BRIAN_PAPKA	PB01	Piggyback	1	2	

T22646466

Mayo Truss Company, Inc.,

Mayo, FL - 32066,


8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:21 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-11ekOfre9oymTDOHoyrsCDj?q8gzsPgwrnvjTszqntq



4x6 ||

Scale = 1:33.5

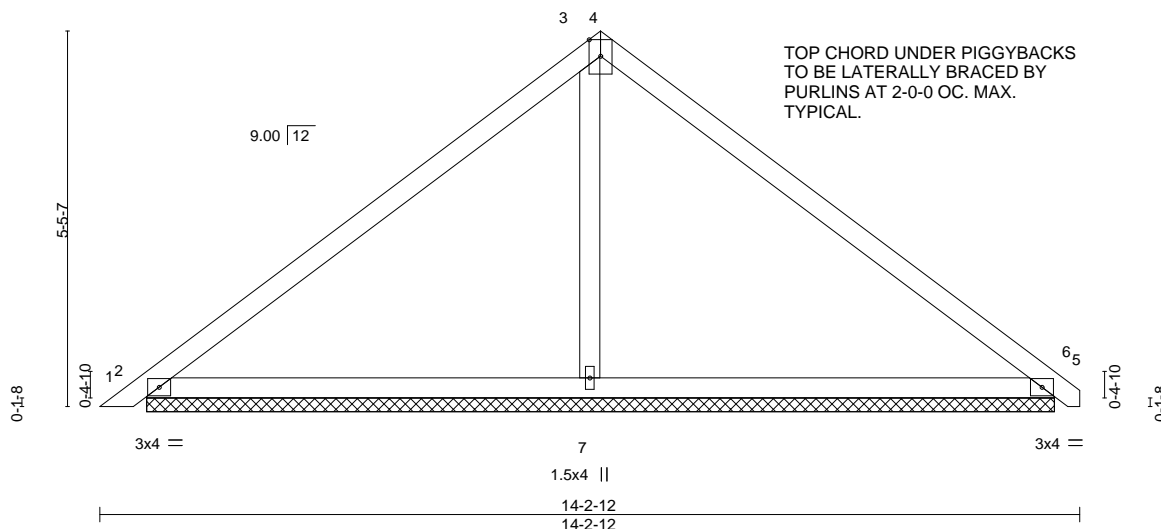

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.28	Vert(LL)	0.01	6	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.21	Vert(CT)	0.01	6	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014		Matrix-S						Weight: 106 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.**


(size) 2=13-2-3, 5=13-2-3, 7=13-2-3  
 Max Horz 2=149(LC 11)  
 Max Uplift 2=-33(LC 8), 5=-43(LC 8), 7=-143(LC 12)  
 Max Grav 2=263(LC 18), 5=321(LC 22), 7=766(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-264/302, 4-5=-264/237  
 WEBS 3-7=-572/203

**NOTES-**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5 except (jt=lb) 7=143.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

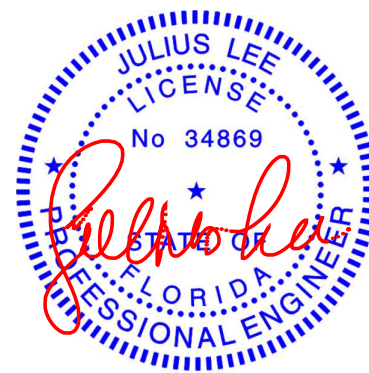

Julius Lee PE No.34869  
 MiTek USA, Inc. FL Cert 6634  
 6904 Parke East Blvd. Tampa FL 33610  
 Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.  
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646467
BRIAN_PAPKA	PB01GE	Piggyback	2	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:22 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-VDC6c?sGw64c5NzTMfM5IRFE?Y3\_bsE43ReG?Jzqntp

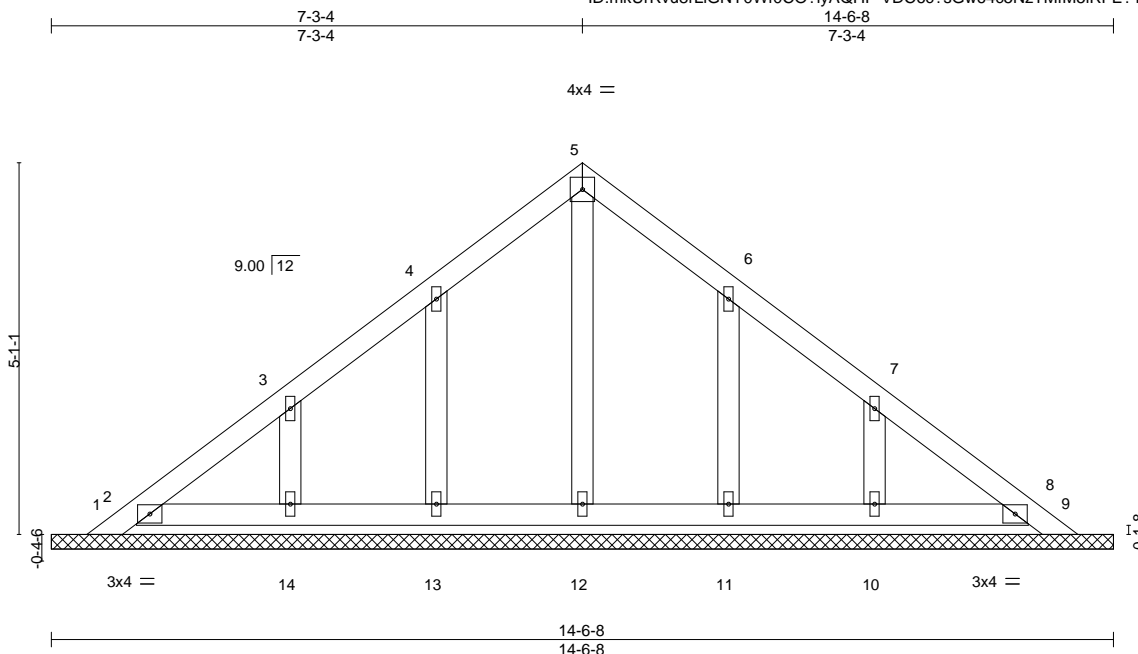

Scale = 1:31.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.03	Horz(CT)	0.00	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						
	Code FBC2020/TPI2014						Weight: 63 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 14-6-8.  
(lb) - Max Horz 1=-140(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 9, 2, 8, 13, 14, 11, 10 except 1=-109(LC 10)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 2, 8, 12, 13, 14, 11, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 2, 8, 13, 14, 11, 10 except (jt=lb) 1=109.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610




Job	Truss	Truss Type	Qty	Ply	T22646469
BRIAN_PAPKA	PB03	Piggyback	2	1	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:24 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-RcJt1htWSjKKKg7sT4OZqsKWuLjg3iUNXI7N4Bzqntn

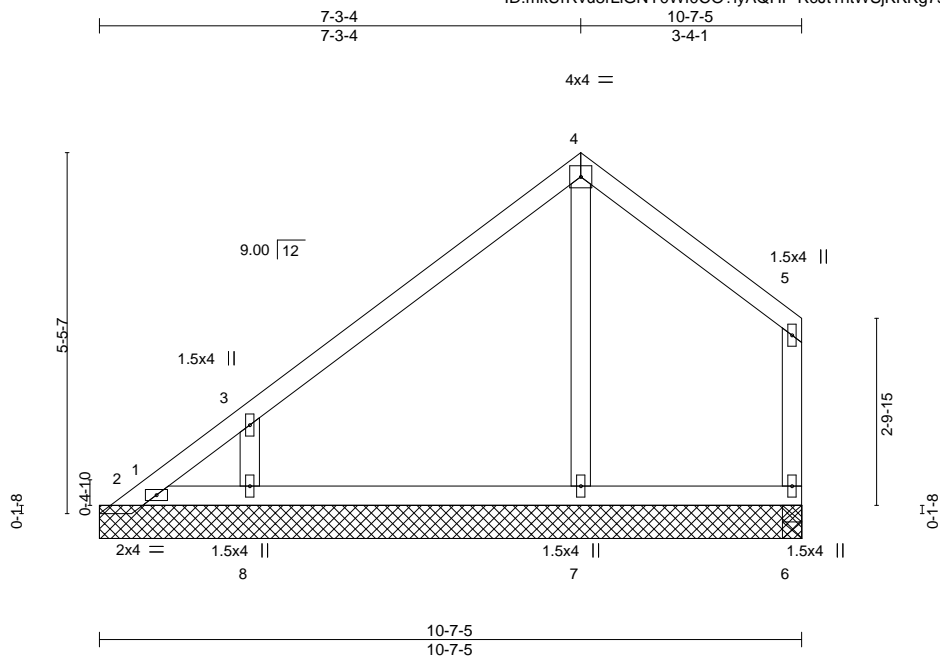

Scale = 1:34.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.01	7-8	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.15	Vert(CT)	-0.02	7-8	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						
								Weight: 47 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 10-7-5.

(lb) - Max Horz 1=188(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 1, 6, 7 except 2=143(LC 17), 8=169(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 1, 6, 6, 2 except 7=355(LC 17), 8=455(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 4-7=-264/75, 3-8=-374/228

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 1, 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6, 7 except (jt=lb) 2=143, 8=169.
- 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.  
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	T22646470
BRIAN_PAPKA	PB04	Piggyback	1	1	Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:25 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-wotFE1u8D1SBYqi21nvoM3tgCl11oCSWIPtwceqzntm

19-4-8  
19-4-8

Scale = 1:33.2

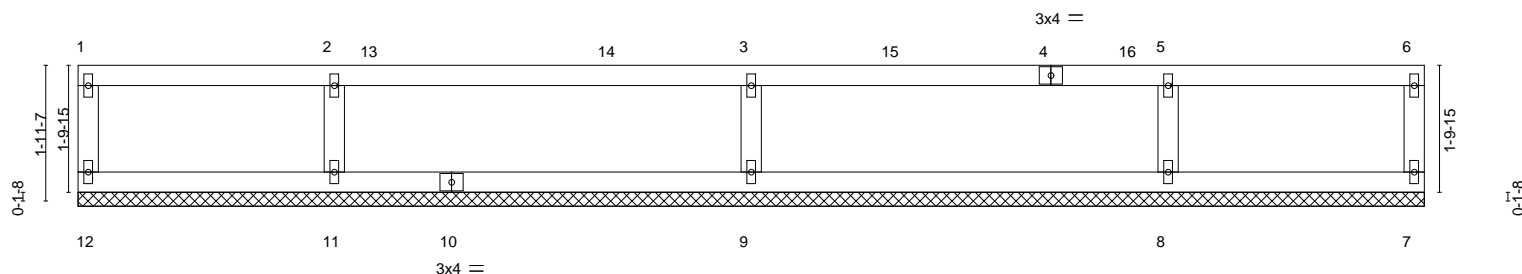

19-4-8  
19-4-8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.38	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	n/a	-	n/a	999	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	7	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-R						
									Weight: 67 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 19-4-8.  
(lb) - Max Horz 12=-64(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 12, 7, 9, 11, 8  
Max Grav All reactions 250 lb or less at joint(s) 12, 7 except 9=507(LC 1), 11=417(LC 1), 8=417(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 3-9=-380/375, 2-11=-313/315, 5-8=-313/314

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 7, 9, 11, 8.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 36610



Job BRIAN_PAPKA	Truss PB05	Truss Type Piggyback	Qty 2	Ply 2	Job Reference (optional) T22646471
--------------------	---------------	-------------------------	----------	----------	---------------------------------------

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:25 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-wotFE1u8D1SByqi21nvoM3tlcl5yoDRWlPtwezcqntm

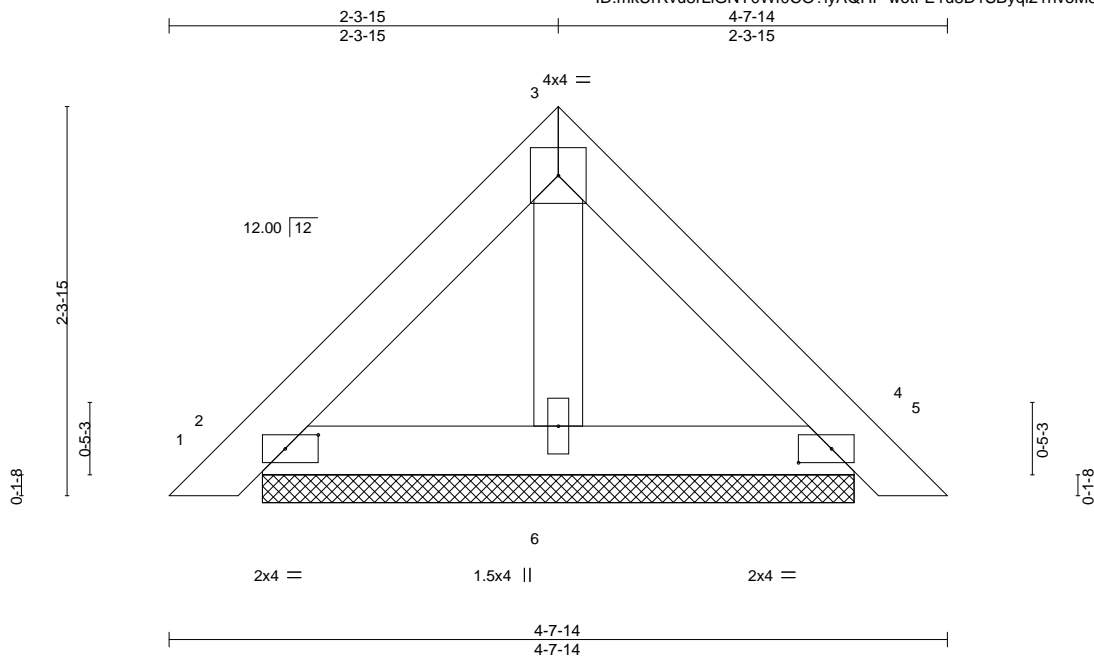

Scale = 1:13.8

Plate Offsets (X,Y)--		[2:0-2-6,0-1-0], [4:0-2-6,0-1-0]							
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.04	Vert(LL)	0.00 4 n/r 120	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.02	Vert(CT)	0.00 4 n/r 120		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.00	Horz(CT)	0.00 4 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-P				Weight: 35 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


#### REACTIONS.

(size) 2=3-6-8, 4=3-6-8, 6=3-6-8  
Max Horz 2=66(LC 11)  
Max Uplift 2=44(LC 12), 4=44(LC 12)  
Max Grav 2=108(LC 1), 4=108(LC 1), 6=111(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

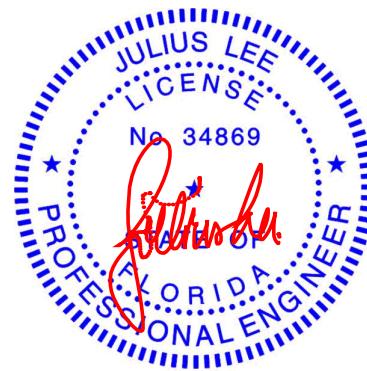

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646472
BRIAN_PAPKA	PB06	Piggyback	4	1	
Job Reference (optional)					

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:26 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-O\_RdRNvn\_Ka2a\_HFbVQ1vHQnw9LgXebf\_3cU84zqntll



Scale = 1:33.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.58	Vert(LL)	0.01	5	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.43	Vert(CT)	0.03	5	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 53 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.


(size) 2=13-2-3, 4=13-2-3, 6=13-2-3  
Max Horz 2=149(LC 11)  
Max Uplift 2=-80(LC 12), 4=-65(LC 12), 6=-28(LC 12)  
Max Grav 2=292(LC 1), 4=271(LC 1), 6=523(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-317/85

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

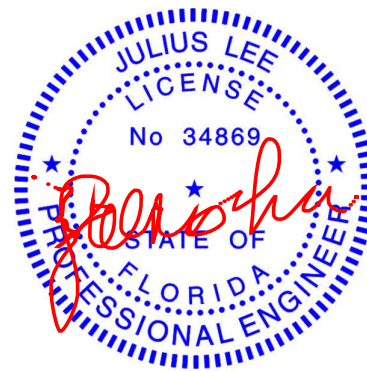

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646473
BRIAN_PAPKA	PB07	Piggyback	1	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:27 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-sA??fjvPleivB8sR9CyGSUy1oZkqG7\_pDjM1gWzqntk

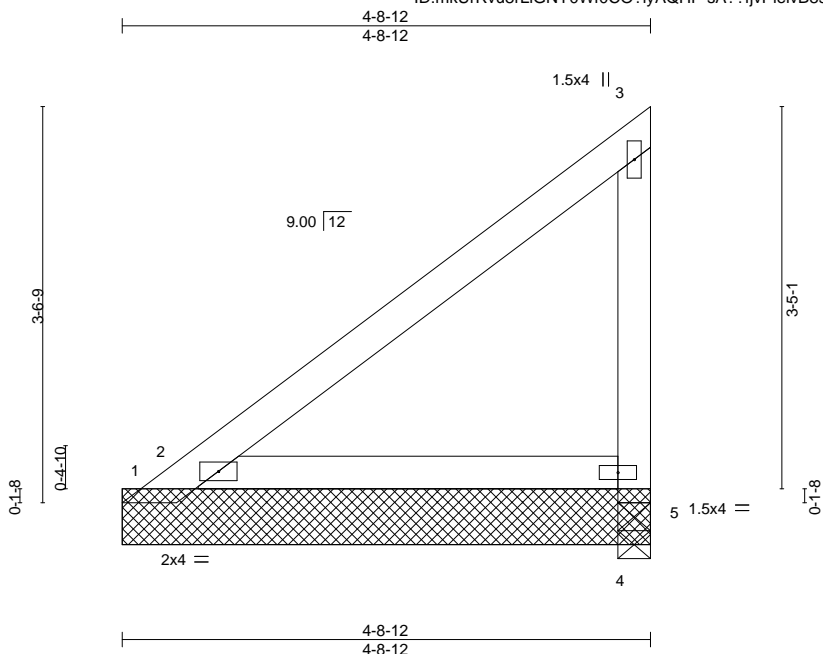

Scale = 1:20.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.25	Vert(LL)	-0.01 2-4	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.03 2-4	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P					Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-8-12, 5=4-8-12, 5=4-8-12, 2=4-8-12, 4=4-8-12  
Max Horz 1=145(LC 9)  
Max Uplift 1=291(LC 17), 2=220(LC 12), 4=42(LC 9)  
Max Grav 1=202(LC 9), 2=498(LC 17), 4=151(LC 17)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-229/404

#### NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 1, 5, 2, 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 1=291, 2=220.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
BRIAN_PAPKA	PB08	Piggyback	1	2	T22646474


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:28 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-KNZOs3w1WyqmplQdiwTV\_iVDRy4q?ZiySN5aDyzqntj

19-4-8  
19-4-8

Scale = 1:33.2

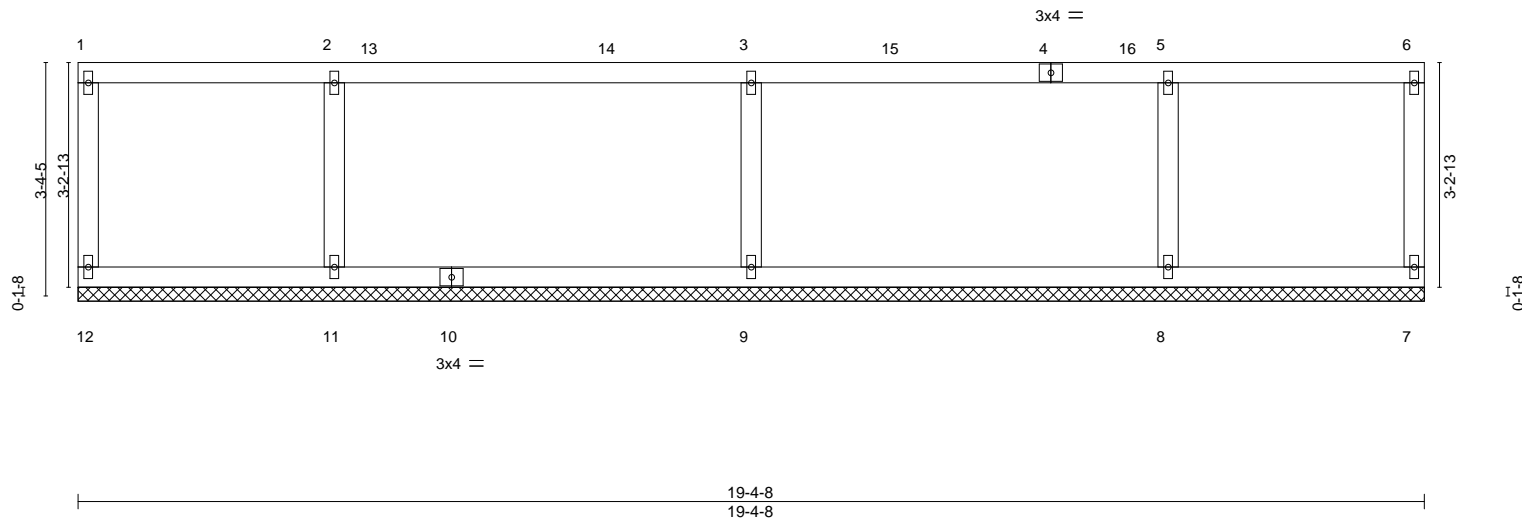

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.19	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	7	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-R					Weight: 155 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 19-4-8.

(lb) - Max Horz 12=-122(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 12, 7, 9, 11, 8


Max Grav All reactions 250 lb or less at joint(s) 12, 7 except 9=507(LC 1), 11=418(LC 1), 8=418(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-9=-380/375, 2-11=-313/331, 5-8=-313/330

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 7, 9, 11, 8.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

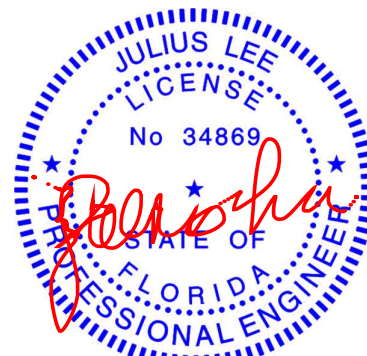

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	T22646475
BRIAN_PAPKA	PB09	Piggyback	10	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:28 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-KNZOs3w1WYqmplQdiwTV\_iVBsy4a?YVySN5aDyzqntj

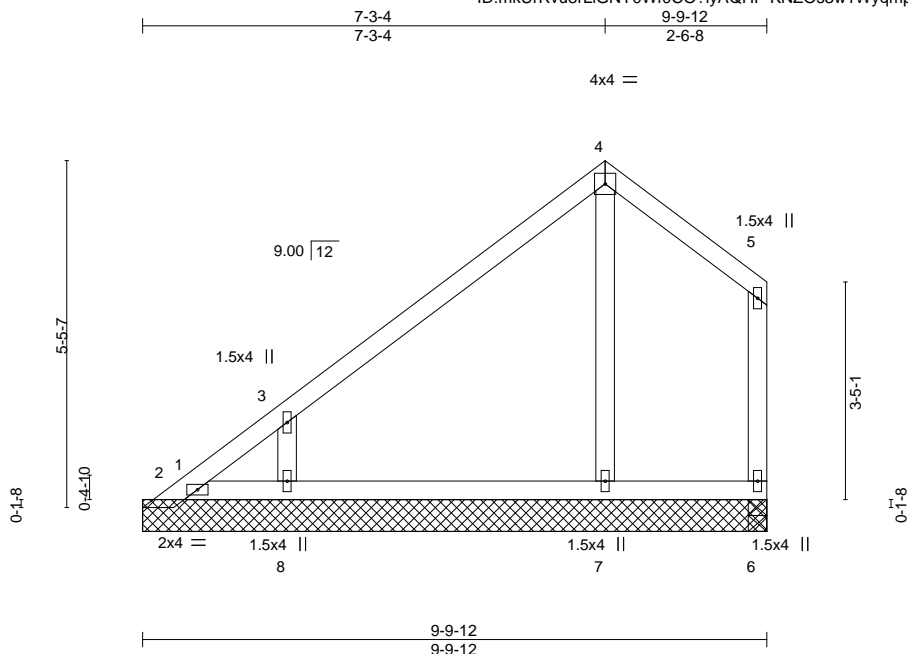

Scale = 1:36.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.01	7-8	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.15	Vert(CT)	-0.02	7-8	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						

Weight: 45 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

All bearings 9-9-12.

(lb) - Max Horz 1=197(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 1, 6, 7 except 2=145(LC 17), 8=170(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 1, 6, 6, 2 except 7=346(LC 17), 8=456(LC 17)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-191/256

WEBS 4-7=-260/95, 3-8=-387/230

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 1, 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6, 7 except (jt=lb) 2=145, 8=170.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.  
Tampa, FL 33610



Job	Truss	Truss Type	Qty	Ply	T22646476
BRIAN_PAPKA	PB10	Piggyback	1	2	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:29 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-oZ7m4PxfHfYdRS?pGd\_kXv2PIMR9k0C6g1r8IPzqnti

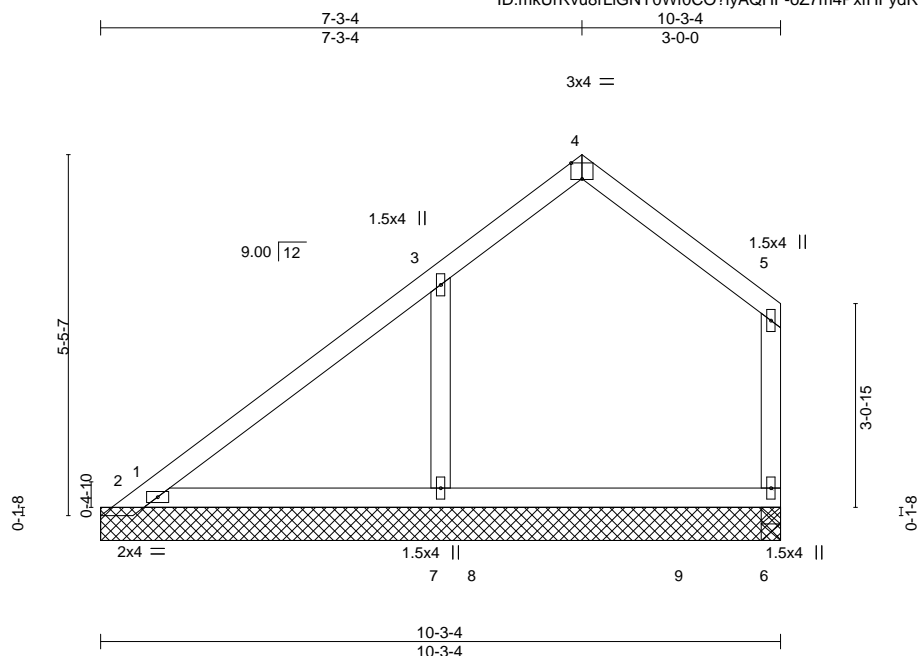


Plate Offsets (X,Y)--	[4:0-2-0,Edge]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.12	Vert(LL)	-0.02 6-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.13	Vert(CT)	-0.02 6-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	-0.00 6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S					Weight: 85 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.


All bearings 10-3-4.  
(lb) - Max Horz 1=192(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 6, 7 except 1=302(LC 17), 2=220(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 6, 6 except 2=508(LC 17), 7=528(LC 17)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-233/367  
WEBS 3-7=-308/123

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 1, 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7 except (jt=lb) 1=302, 2=220.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

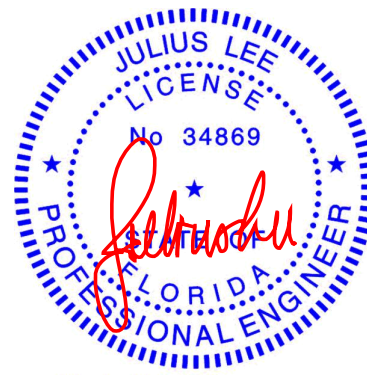

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.  
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	
BRIAN_PAPKA	PB11GE	Piggyback	1	1	T22646477
Job Reference (optional)					

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:30 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-Glg8HkyH2Z4U2ba0qLVz37abwmosTTMFvhahHrzqnth

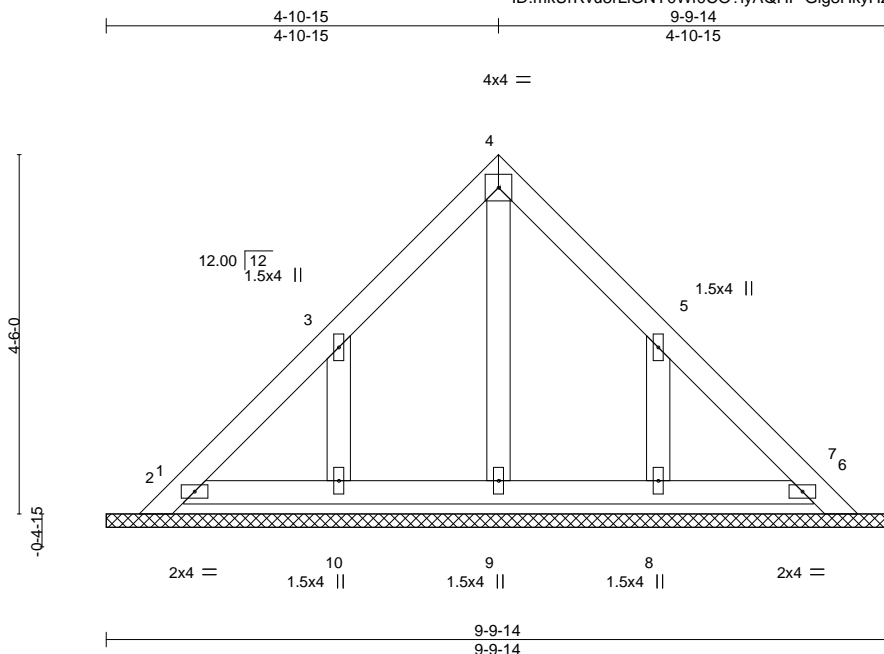

Scale = 1:28.9

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0		TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25		BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.25		WB 0.02	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Rep Stress Incr YES		Matrix-P						
	Code FBC2020/TPI2014							Weight: 41 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 9-9-14.  
(lb) - Max Horz 1=-133(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 7, 2, 6 except 1=-130(LC 10), 10=-107(LC 12), 8=-107(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 2, 6, 9, 10, 8

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 7, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2, 6 except (jt=lb) 1=130, 10=107, 8=107.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:31 2021 Page 1  
ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-kyEWW4zvpCLgl9CO20CcK7hAA6eCwCP8LKFqHzqntg  
4-10-15 9-9-14  
4-10-15 4-10-15  
Scale = 1:33.7

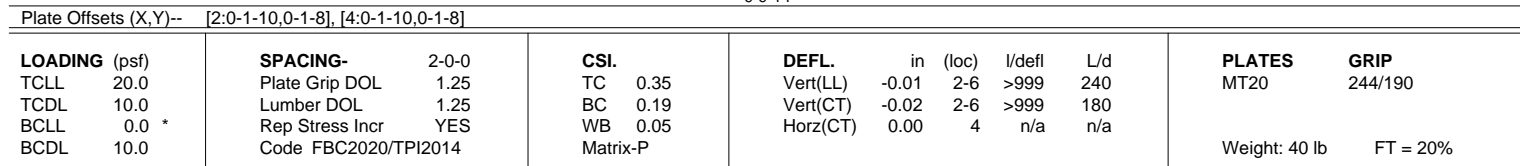

**REACTIONS.** All bearings 9-9-14.

(lb) - Max Horz	1=147(LC 11)
Max Uplift	All uplift 100 lb or less at joint(s) except 1=559(LC 17), 5=395(LC 18), 5=300(LC 1), 2=449(LC 12), 4=390(LC 12)
Max Grav	All reactions 250 lb or less at joint(s) except 1=369(LC 12), 5=311(LC 12), 2=791(LC 17), 4=651(LC 18), 6=266(LC 3)

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 559 lb uplift at joint 1, 395 lb uplift at joint 5, 449 lb uplift at joint 2 and 390 lb uplift at joint 4.
- 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021



Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd  
Tampa, FL 36610


Job	Truss	Truss Type	Qty	Ply	T22646479
BRIAN_PAPKA	PB13GE	Piggyback	1	1	Job Reference (optional)

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:32 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-C8ouiQzXaAKCivkOxlXR9YgxraUZxN9YN?3oMkzqntf

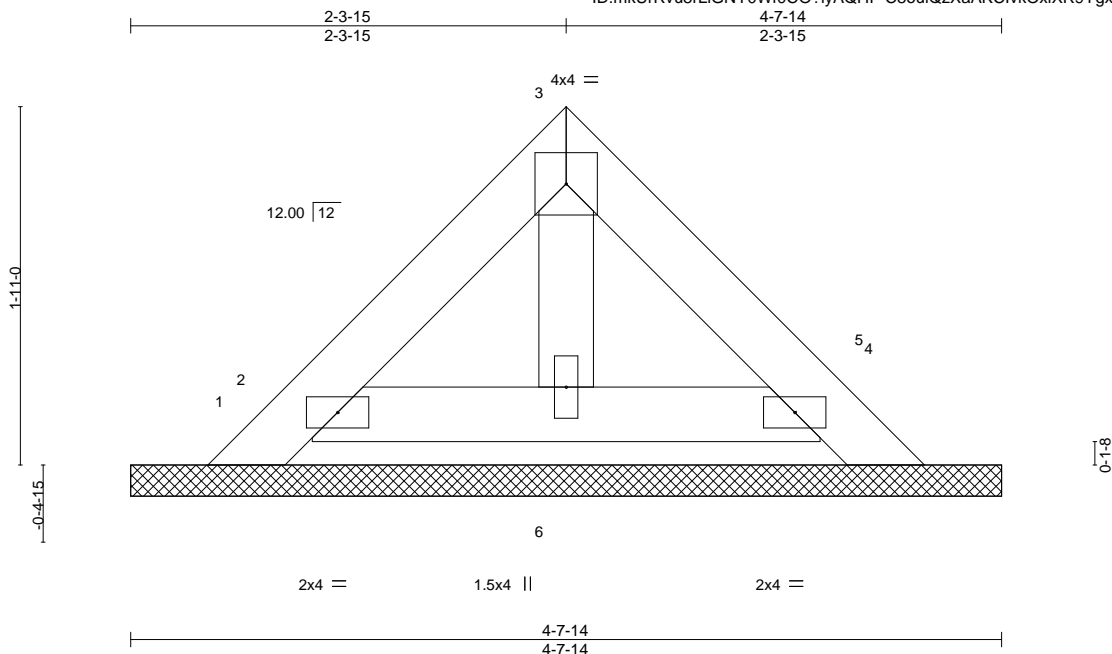

Scale = 1:12.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.04	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.02	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P						Weight: 14 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


#### REACTIONS.

All bearings 4-7-14.  
(lb) - Max Horz 1=53(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 1, 5, 2, 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

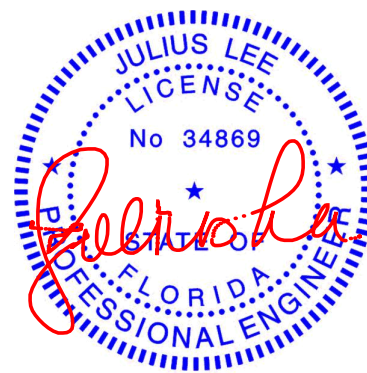

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.  
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	T22646480
BRIAN_PAPKA	PB14	Piggyback	14	1	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:33 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-hKMHvm\_ALUT3v3JbVT2ghlC6CzpagqNhbfLuAzqnte

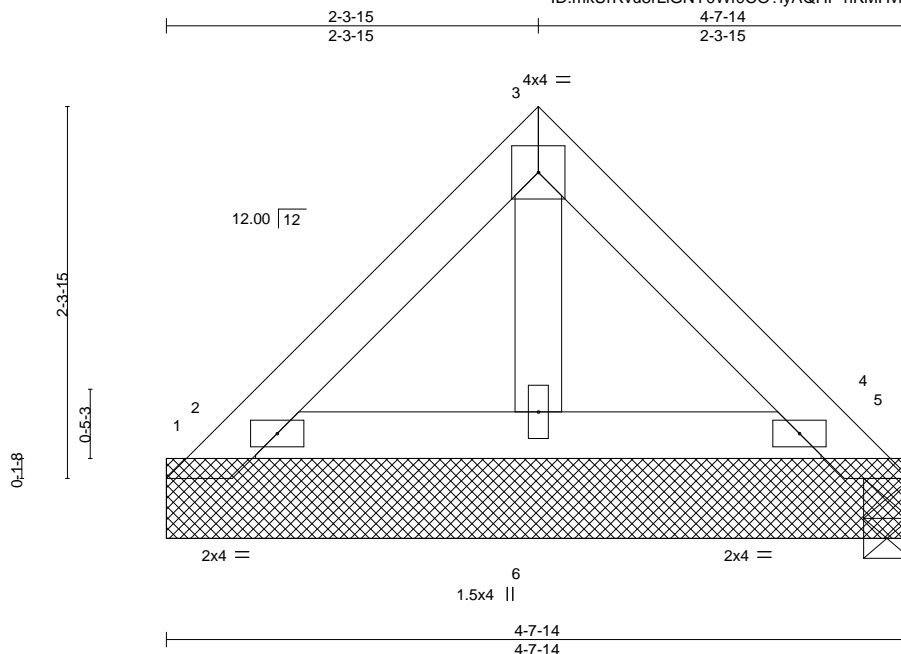

Scale = 1:14.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.06	Vert(LL)	-0.00 6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.03	Vert(CT)	-0.00 6	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.00 5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P						
								Weight: 17 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 4-7-14.

(lb) - Max Horz 1=67(LC 11)


Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4

Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

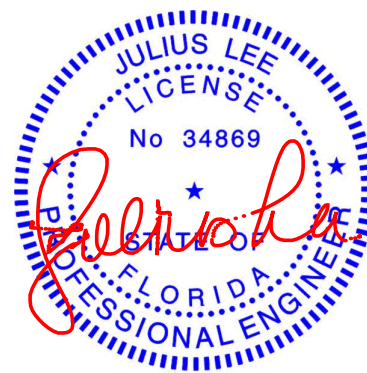

Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



6904 Parke East Blvd.  
Tampa, FL 33610




Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
BRIAN_PAPKA	PB15	Piggyback	1	3	T22646481


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.430 s Nov 30 2020 MiTek Industries, Inc. Thu Jan 28 15:07:33 2021 Page 1

ID:mkUrRvu8rLIGNY0Wf0CO?iyAQHF-hKMhvm\_ALUT3v3JbVT2ghlC5Kzp5gqOhbfpLuAzqnte



Scale = 1:33.7

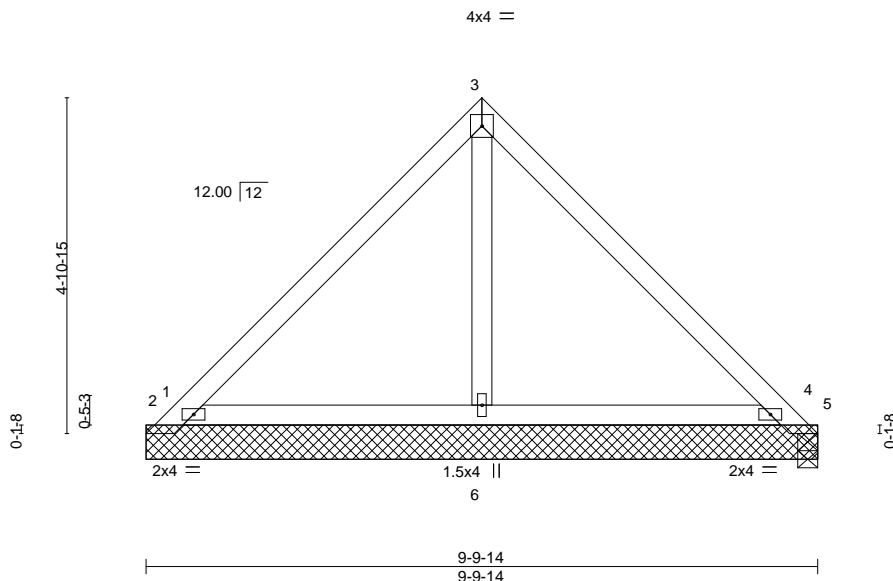

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.12	Vert(LL)	-0.00	2-6	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.06	Vert(CT)	-0.01	2-6	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2020/TP12014		Matrix-P						
								Weight: 119 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 9-9-14.  
(lb) - Max Horz 1=147(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) except 1=-559(LC 17), 5=-395(LC 18), 5=-300(LC 1), 2=-449(LC 12), 4=-390(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) except 1=369(LC 12), 5=311(LC 12), 2=791(LC 17), 4=651(LC 18), 6=266(LC 3)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-266/444, 4-5=-194/296

#### NOTES-

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 559 lb uplift at joint 1, 395 lb uplift at joint 5, 449 lb uplift at joint 2 and 390 lb uplift at joint 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Julius Lee PE No.34869  
MiTek USA, Inc. FL Cert 6634  
6904 Parke East Blvd. Tampa FL 33610  
Date:

January 29, 2021

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component**




6904 Parke East Blvd.  
Tampa, FL 33610




# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

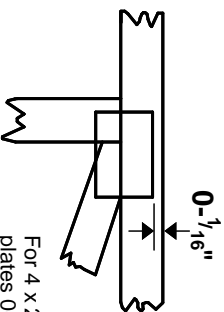

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in **MiTek 20/20** software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

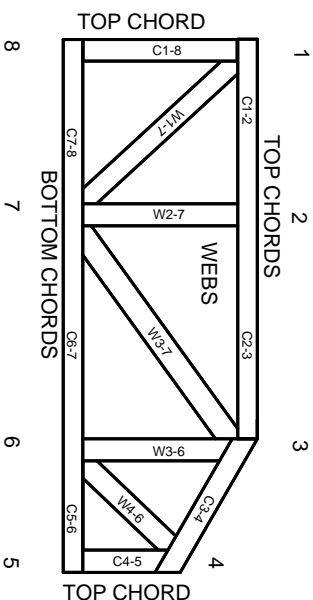

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020




# General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

Hatch Legend	
	8' 6" Walls
	10' Walls

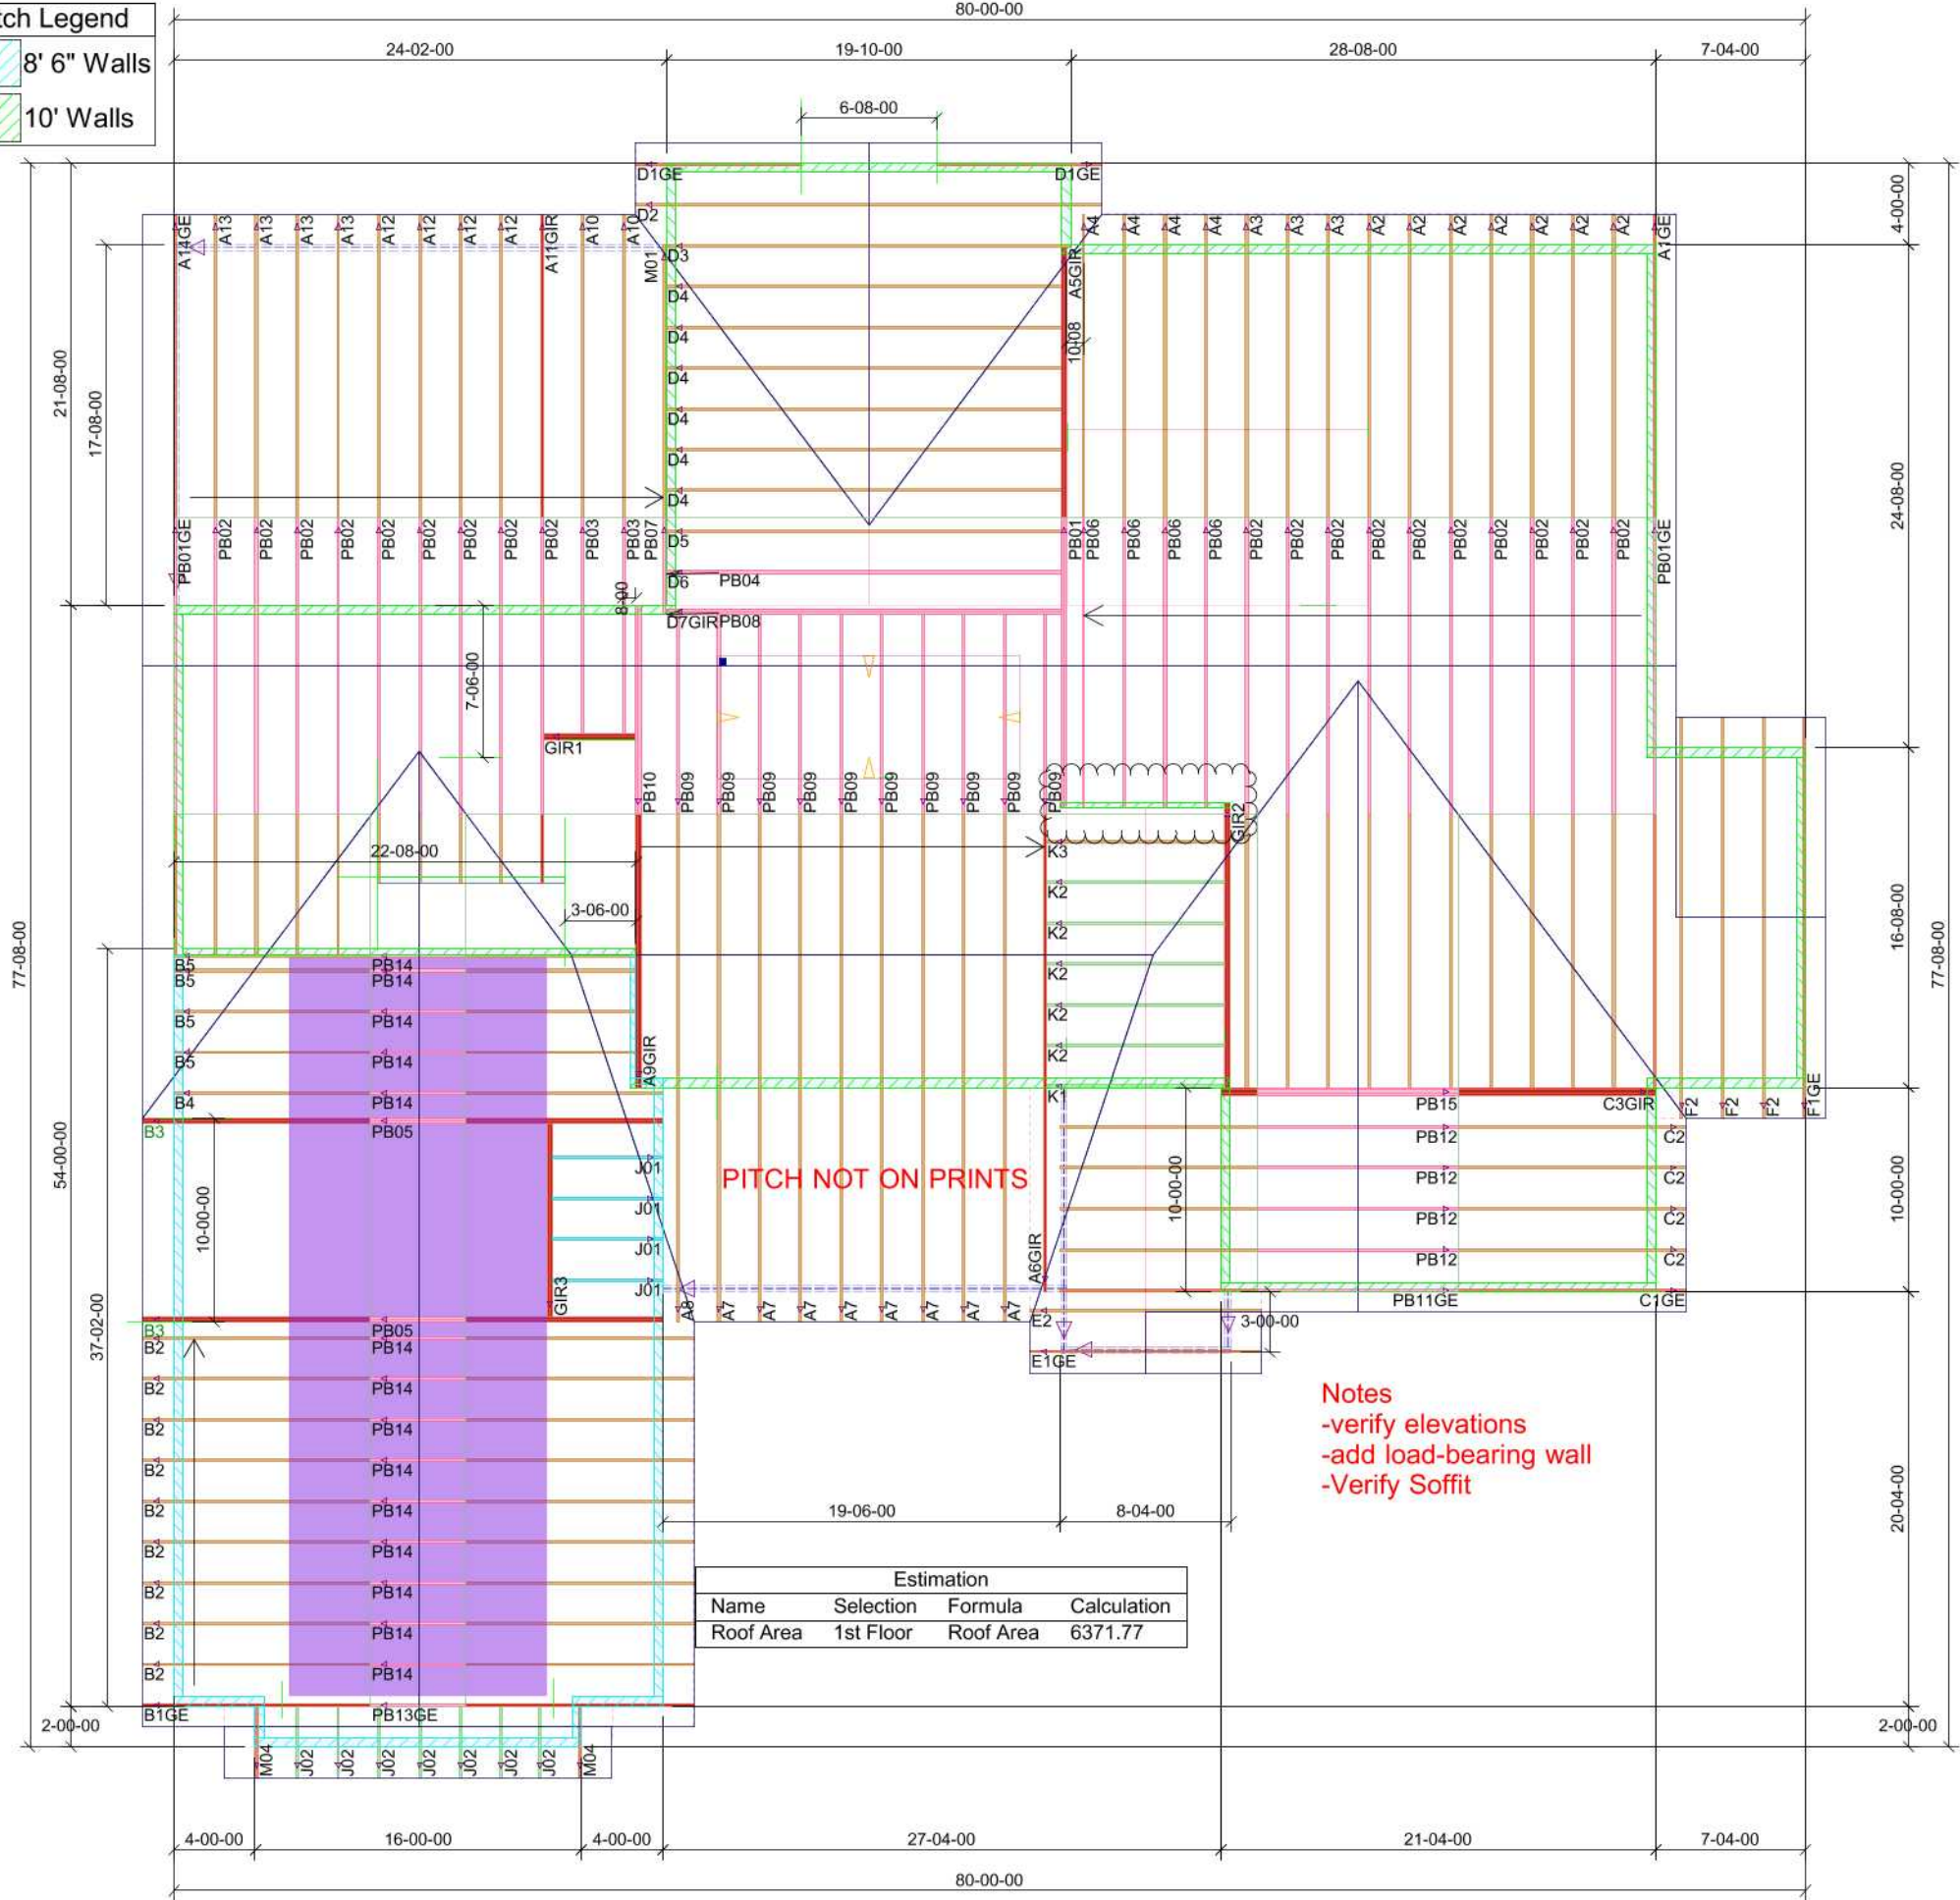


Estimation			
Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	6371.77

Notes  
 -verify elevations  
 -add load-bearing wall  
 -Verify Soffit

Brian Papka

Roof Loading  
 TC Live: 20.00 psf  
 TC Dead: 10.00 psf  
 BC Live: 0.00 psf  
 BC Dead: 10.00 psf  
 Spacing: 2.00 ft O.C.

Client: IND-RES  
 Date: 1/28/2021  
 Quote Date: 12/14/20  
 Seal Date: / /  
 Designer: Stephanie Ramirez  
 Job Number: 1220-024



Mayo Truss  
Company Inc.

Ph. (386) 294-3988  
 Fax (386) 294-3981  
 mayotruss@windstream.net