







FLORIDA BUILDING CODE

Compliance Summary

TYPE OF CONSTRUCTION

Roof: Gable & Hip Construction, Wood Trusses @ 24" O.C.  
Walls: 2x4 Wood Studs @ 16" O.C.  
Floor: 4" Thk. Concrete Slab W/ #4 rebar @ 24" O.C. ea. way.  
Foundation: Continuous monolithic footing w/ Stem Wall foundation system

ROOF DECKING

Material: 19/32" CDX Plywood or 7/16" O.S.B.  
Sheet Size: 48"x96" Sheets Perpendicular to Roof Framing  
Fasteners: 10d Ring-Shank nails per schedule on sheet S.4

SHEARWALLS

Material: 1/2" CD Plywood or 7/16" O.S.B.  
Sheet Size: 48"x96" Sheets Placed Vertical, stagger each sheet.  
Fasteners: 8d Common Nails @ 4" O.C. Edges & 6" O.C. Interior  
Dragstud: Double Top Plate (S.Y.P.) W/16d Nails @ 12" O.C.  
Wall Studs: 2x4 Wood Studs @ 16" O.C.

HURRICANE UPLIFT CONNECTORS

Truss Anchors: SIMPSON H2.5A (OR EQUIVALENT), W/ 6 - 10d NAILS  
Wall Tension: Wall Sheathing Nailing is Adequate - 8d @ 4" O.C. Top & Bot.  
Anchor Bolts: 1/2" A307 Bolts @ 48" O.C. - 1st Bolt 6" from corner  
Corner Hold-down Device: (1) DTTZZ (or equiv.) @ each corner  
Porch Column Base Connector: Simpson ABU44/ABU66 @ each column  
Porch Column to Beam Connector: Simpson EPC44/PC44 @ each column

FOOTINGS AND FOUNDATIONS

Footing: 20"x12" Cont. W/ (2) #5 Bars Cont. on chairs or (1) #3 Transverse @ 24" O.C.  
Stemwall: 8" C.M.U. W/1-#5 Vertical Dowel @ 48" O.C.

STRUCTURAL DESIGN CRITERIA:

1. THE DESIGN COMPLIES WITH THE REQUIREMENTS OF THE 2020 FLORIDA BUILDING CODE (FBC) (7TH EDITION) AND OTHER REFERENCED CODES AND SPECIFICATIONS. ALL CODES AND SPECIFICATIONS SHALL BE LATEST EDITION AT TIME OF PERMIT.

2. WIND LOAD CRITERIA: RISK CATEGORY: 2, EXPOSURE: "B"

BASED ON ANSI/ASCE 7-16, 2020 FBC 1609-A WIND VELOCITY:  $V_{WT} = 130$  MPH  
 $V_{ASCE} = 101$  MPH

3. ROOF DESIGN LOADS:  
SUPERIMPOSED DEAD LOADS: ..... 20 PSF  
SUPERIMPOSED LIVE LOADS: ..... 20 PSF

4. FLOOR DESIGN LOADS:  
SUPERIMPOSED DEAD LOADS: ..... 25 PSF  
SUPERIMPOSED LIVE LOADS:  
RESIDENTIAL ..... 40 PSF  
BALCONIES ..... 60 PSF

5. WIND NET UPLIFT: ARE AS INDICATED ON PLANS

TERMITE PROTECTION NOTES:

SOIL CHEMICAL BARRIER METHOD:

- A PERMANENT SIGN WHICH IDENTIFIES THE TERMITE TREATMENT PROVIDER AND NEED FOR REINSPECTION AND TREATMENT CONTRACT RENEWAL SHALL BE PROVIDED. THE SIGN SHALL BE POSTED NEAR THE WATER HEATER OR ELECTRIC PANEL. FBC 1503.2.6
- CONDENSATE AND ROOF DOWNSPOUTS SHALL DISCHARGE AT LEAST 1'-0" AWAY FROM BUILDING SIDE WALLS. FBC 1503.4.4
- IRRIGATION/SPRINKLER SYSTEMS INCLUDING ALL RISERS AND SPRAY HEADS SHALL NOT BE INSTALLED WITHIN 1'-0" FROM BUILDING SIDE WALLS. FBC 1503.4.4

4. TO PROVIDE FOR INSPECTION FOR TERMITE INFESTATION, BETWEEN WALL COVERINGS AND FINAL EARTH GRADE SHALL NOT BE LESS THAN 6".  
EXCEPTION: PAINT AND DECORATIVE CEMENTIOUS FINISH LESS THAN 5/8" THICK ADHERED DIRECTLY TO THE FOUNDATION WALL. FBC 1403.1.6

5. INITIAL TREATMENT SHALL BE DONE AFTER ALL EXCAVATION AND BACKFILL IS COMPLETE. FBC 1816.1.1

6. SOIL DISTURBED AFTER THE INITIAL TREATMENT SHALL BE RETREATED INCLUDING SPACES BOXED OR FORMED. FBC 1816.1.2

7. BOXED AREAS IN CONCRETE FLOOR FOR SUBSEQUENT INSTALLATION OF TRAPS, ETC., SHALL BE MADE WITH PERMANENT METAL OR PLASTIC FORMS. PERMANENT FORMS MUST BE OF A SIZE AND DEPTH THAT WILL ELIMINATE THE DISTURBANCE OF SOIL AFTER THE INITIAL TREATMENT. FBC 1816.1.3

8. MINIMUM 6 MIL VAPOR RETARDER MUST BE INSTALLED TO PROTECT AGAINST RAINFALL DILUTION. IF RAINFALL OCCURS BEFORE VAPOR RETARDER PLACEMENT, RETREATMENT IS REQUIRED. FBC 1816.1.4

9. CONCRETE OVERPOUR AND MORTAR ALONG THE FOUNDATION PERIMETER MUST BE REMOVED BEFORE EXTERIOR SOIL TREATMENT. FBC 1816.1.5

10. SOIL TREATMENT MUST BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRADE WITHIN 1'-0" OF THE STRUCTURE SIDEWALLS. FBC 1816.1.6

11. AN EXTERIOR VERTICAL CHEMICAL BARRIER MUST BE INSTALLED AFTER CONSTRUCTION IS COMPLETE INCLUDING LANDSCAPING AND IRRIGATION. ANY SOIL DISTURBED AFTER THE VERTICAL BARRIER IS APPLIED, SHALL BE RETREATED. FBC 1816.1.6

12. ALL BUILDINGS ARE REQUIRED TO HAVE PER-CONSTRUCTION TREATMENT. FBC 1816.1.7

13. A CERTIFICATE OF COMPLIANCE MUST BE ISSUED TO THE BUILDING DEPARTMENT BY A LICENSED PEST CONTROL COMPANY BEFORE A CERTIFICATE OF OCCUPANCY WILL BE ISSUED. THE CERTIFICATE OF COMPLIANCE SHALL STATE: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. THE TREATMENT IS IN ACCORDANCE WITH THE RULES AND LAWS OF THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES". FBC 1816.1.7

14. AFTER ALL WORK IS COMPLETED, LOOSE WOOD AND FILL MUST BE REMOVED FROM BELOW AND WITHIN 1'-0" OF THE BUILDING. THIS INCLUDES ALL GRADE STAKES, TUB TRAP BOXES, FORMS, SHORING OR OTHER CELLULOSE CONTAINING MATERIAL. FBC 2303.1.3

15. NO WOOD, VEGETATION, STUMPS, CARDBOARD, TRASH, ETC., SHALL BE BURIED WITHIN 15'-0" OF ANY BUILDING OR PROPOSED BUILDING. FBC 2303.1.4

FRAMING ANCHOR SCHEDULE

APPLICATION	MANUF'R/MODEL	CAP.
TRUSS TO WALL:	SIMPSON H2.5A (OR EQUIVALENT), W/ 6 - 10d NAILS	960#
GIRDER TRUSS TO POST/HEADER:	SIMPSON LGT, W/ 28 - 16d NAILS	1785#
HEADER TO KING STUD(S):	SIMPSON ST22	1370#
PLATE TO STUD:	SIMPSON SP2	1065#
STUD TO SILL:	SIMPSON SP1	585#
PORCH BEAM TO POST:	SIMPSON PC44/EPC44	1700#
PORCH POST TO FND.:	SIMPSON ABU44	2200#
MISC. JOINTS	SIMPSON A34	315#/240#


NOTE:  
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.

NOTE:  
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.

NOTE:  
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.

NOTE:  
"SEMCO" PRODUCT APPROVAL:  
MIAMI/DADE COUNTY REPORT #95-0818.15

NOTE:  
"SIMPSON" PRODUCT APPROVALS:  
MIAMI/DADE COUNTY REPORT #97-0107.05, #96-1126.11, #99-0623.04  
SBCC 1 NER-443, NER-393

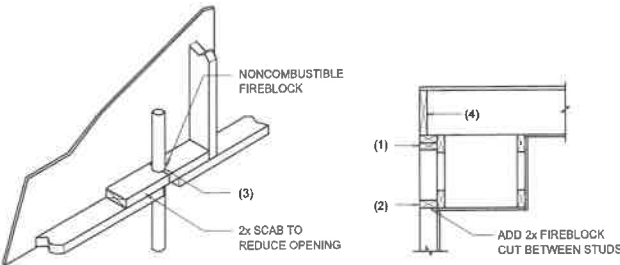

PENETRATIONS

SOFFIT/DROPPED CLG.

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH "PYRO PANEL MULTIFLEX SEALANT"
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

Fire Stopping DETAILS

SCALE: NONE

A

ZONE		AREA (ft <sup>2</sup> )		V <sub>W</sub> 1 115 MPH		V <sub>W</sub> 1 120 MPH		V <sub>W</sub> 1 130 MPH		V <sub>W</sub> 1 140 MPH	
				Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
ROOF 2T TO 45°	1	10	10.2	-28.3	11.1	-21.1	15	-26	15.1	-26.1	
	2	20	10	-9	10	-16	17.3	-23	15.1	-26.1	
	3	30	10	18	10	-16.3	10	-16.7	10.9	-22.2	
	4	120	10	-12.7	10	-12.8	10	-16.2	10	-16.8	
	5	10	10.2	-21.2	11.1	-20.3	11	-20.9	15.1	-26.9	
	6	20	10	10.1	10	-20.9	17.3	-24.4	15.1	-26.3	
	7	30	10	11.8	10	-12.8	10	-15.1	10.9	-17.6	
	8	150	10	-11.9	10	-12.8	10	-15.1	10	-17.6	
	9	10	10.2	-25.6	11.1	-23.2	11	-20.1	-15.1	-24.4	
	10	20	10	22.7	10	20	11.3	22.8	17.1	-16.1	
WALL	1	20	10	19.2	10	20.9	10	24.8	10.6	26.4	
	2	150	10	-14.3	10	-15.5	10	-18.2	10	-21.2	
	3	10	10.2	-27.7	11.1	-26.5	11	-21.7	15.1	-26.1	
	4	20	10	-24.6	10	-20.7	17.3	-24.1	15.1	-26.1	
	5	20	10	-14.3	10	-15.5	10	-18.2	10.9	-21.2	
	6	150	10	-14.1	10	-15.1	11	-18.2	10	-21.2	
	7	10	14.8	-15.5	11.8	-16.9	18.2	-18.8	21.2	-22.9	
	8	20	15.4	-14.8	11.8	-16.1	17.4	-18	20.1	-22	
	9	20	-12.8	14	12.8	-16.2	16.5	-17.9	16	-21.7	
	10	110	-12.1	-15.1	12.2	-11.3	16.5	-17.1	16	-18.8	

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING			
BLDG HEIGHT (ft)	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	.82	1.21	1.41
20	.89	1.28	1.58
25	.94	1.35	1.61
30	1.00	1.40	1.66

General Roofing NOTES:

DECK REQUIREMENTS:  
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:  
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12  
OR GREATER. PER R905, DOUBLE UNDERLAYMENT IS REQUIRED ON ROOF  
SLOPES GREATER THAN 4:12.

UNDERLAYMENT:  
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM W/ ASTM D 226,  
TYPE 1, OR ASTM D 4869, TYPE 1.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:  
SELF ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY W/ ASTM D 1870.

ASPHALT SHINGLES:  
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING,  
AND COMPLY WITH ASTM D 225 OR ASTM D 3462.

FASTENERS:  
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS  
STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH  
A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH  
THE ROOFING MATERIAL AND A MINIMUM 3/4" INTO THE ROOF SHEATHING.  
WHERE THE SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE  
THROUGH THE SHEATHING.

ATTACHMENT:  
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN  
FOUR FASTENERS PER STRIP SHINGLE OR TWO FASTENERS PER INDIVIDUAL  
SHINGLE. WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR  
GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS  
OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM  
WITH ASTM D 3161 OR M-DC PA 107-95.

UNDERLAYMENT APPLICATION:  
FOR ROOF SLOPES FROM 2:12 TO 4:12 AND GREATER, UNDERLAYMENT SHALL BE  
A MINIMUM OF TWO LAYERS APPLIED AS FOLLOWS:  
1. STARTING AT THE EAVE, A 19 INCH STRIP OF UNDERLAYMENT SHALL BE  
APPLIED PARALLEL WITH THE EAVE AND FASTENED SUFFICIENTLY TO  
STAY IN PLACE.

2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT  
SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 19 INCHES AND  
FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPED 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM  
OF TWO LAYERS OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:  
STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE  
FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED  
SUFFICIENTLY TO STAY IN PLACE.

BASE AND CAP FLASHINGS:  
BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE W/ MFG'S  
INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE OF EITHER CORROSION  
RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL  
SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 77 LBS PER 100 SQUARE  
FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM  
NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:  
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE W/ MANUFACTURER'S  
INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY  
LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED.  
1. FOR OPEN VALLEYS LINED WITH METAL, THE VALLEY LINING SHALL BE  
AT LEAST 16" WIDE AND OF ANY OF THE CORROSION RESISTANT METALS  
IN FBC TABLE 1507.3.9.2.  
2. FOR OPEN VALLEYS, VALLEY LINING OF TWO PLIES OF MINERAL SURFACE  
ROLL ROOFING SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 36  
INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.  
3. FOR CLOSED VALLEYS VALLEY LINING SHALL BE ONE OF THE FOLLOWING:  
1. BOTH TYPES 1 AND 2 ABOVE, COMBINED.  
2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND  
COMPLYING WITH ASTM D 224.  
3. SPECIALTY UNDERLAYMENT AT LEAST 36 INCHES WIDE AND COMPLYING  
WITH ASTM D 1970.

NOTE !!!  
ROOF SHINGLES SHALL BE AS MANUFACTURED BY \*TAMKO  
ROOFING PRODUCTS\* OF THE FOLLOWING MODELS:

GLASS-SEAL AR  
ELITE GLASS-SEAL AR  
HERITAGE 30 AR  
HERITAGE 40 AR  
HERITAGE 50 AR

THESE SHINGLES MEET THE REQUIREMENTS OF ASTM D-3161  
TYPE 1 MODIFIED TO 110 MPH WINDS & FBC TAS 100, USING  
4 NAIL/S/SHINGLE

REVISIONS  
January 27, 2022

SOFTPLAN  
ARCHITECTURAL DWG SOFTWARE

DETAILS SHEET  
SCALE: 1/4" = 1'-0"

A CUSTOM HOME FOR:  
**THE KERI MODEL**  
PROJECT ADDRESS: LOT 22, JEWELL LAKE, PHASE I, LAKE CITY, FLORIDA 32025  
**SORENSEN & SMITH, LLC.**  
LAKE CITY, FLORIDA


N.P. GEISLER  
ER  
Digitally signed by N.P. GEISLER  
DN: cn=N.P. GEISLER, o=US, ou=AR0007005, ou=AR0007005  
2022.02.06 17:07:07 -0500

NICHOLAS  
GEISLER  
ARCHITECT  
1758 NW Brown Rd.  
Lake City, FL 32055  
N.C.A.A. Certified (386) 565-4959

JOB NUMBER  
20220115

SHEET NUMBER  
**S.3**  
OF 4 SHEETS


NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

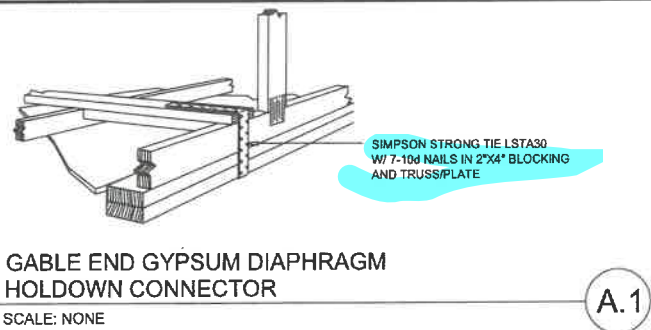

### GABLE END GYPSUM DIAPHRAGM HOLDOWN CONNECTOR

SCALE: NONE

A.1

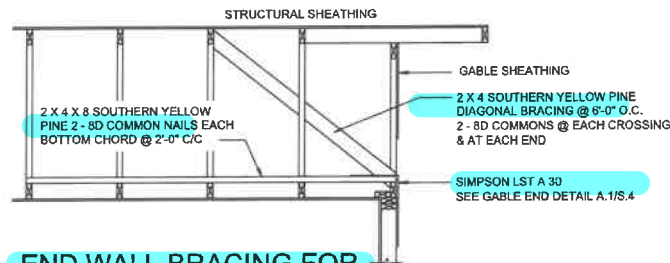

### END WALL BRACING FOR CEILING DIAPHRAGM


NTS

(ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

A

ZONE	AREA (sq ft)	Vult. 15 MPH		Vult. 30 MPH		Vult. 45 MPH		Vult. 60 MPH	
		Pos.	Neg.	Pos.	Neg.	Pos.	Neg.	Pos.	Neg.
1	10	10.7	-28.3	11.1	-29.1	11	-28	10.1	-28.1
2	30	10	-16	10	-16	11.3	-23	10.1	-28.7
3	60	10	-10	10	-10.3	10	-19.2	10.6	-22.2
4	100	10	-7.7	10	-7.3	10	-16.7	10	-18.8
5	150	10.2	-28.2	11.1	-29.2	11	-22.9	10.1	-28.9
6	200	10	-19.1	10	-20.8	11.3	-24.4	10.1	-28.1
7	250	10	-11.9	10	-12.9	10	-15.1	10.6	-17.6
8	300	10	-11.9	10	-12.6	10	-13.1	10	-17.8
9	350	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
10	400	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
11	450	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
12	500	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
13	550	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
14	600	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
15	650	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
16	700	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
17	750	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
18	800	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
19	850	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
20	900	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
21	950	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
22	1000	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
23	1050	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
24	1100	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
25	1150	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
26	1200	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
27	1250	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
28	1300	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
29	1350	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
30	1400	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
31	1450	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
32	1500	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
33	1550	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
34	1600	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
35	1650	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
36	1700	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
37	1750	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
38	1800	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
39	1850	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
40	1900	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
41	1950	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
42	2000	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
43	2050	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
44	2100	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
45	2150	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
46	2200	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
47	2250	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
48	2300	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
49	2350	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
50	2400	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
51	2450	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
52	2500	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
53	2550	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
54	2600	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
55	2650	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
56	2700	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
57	2750	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
58	2800	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
59	2850	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
60	2900	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
61	2950	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
62	3000	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
63	3050	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
64	3100	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
65	3150	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
66	3200	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
67	3250	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
68	3300	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
69	3350	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
70	3400	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
71	3450	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
72	3500	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
73	3550	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
74	3600	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
75	3650	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
76	3700	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
77	3750	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
78	3800	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
79	3850	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
80	3900	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
81	3950	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
82	4000	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
83	4050	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
84	4100	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
85	4150	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
86	4200	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
87	4250	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
88	4300	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
89	4350	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
90	4400	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
91	4450	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
92	4500	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
93	4550	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
94	4600	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
95	4650	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
96	4700	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
97	4750	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
98	4800	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
99	4850	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4
100	4900	10	-10.2	10	-10.3	10	-13.1	10.1	-16.4

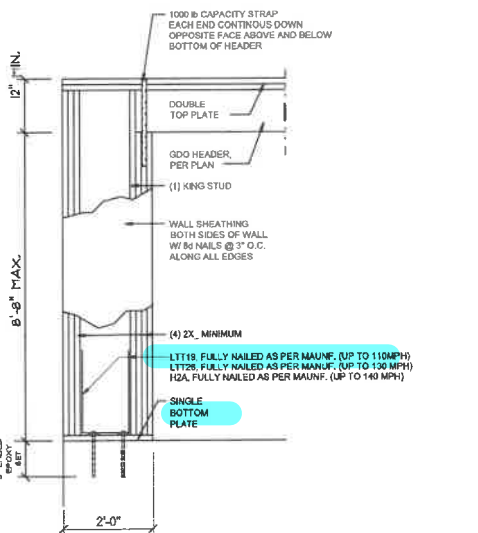


### Garage End Wall DETAIL

SCALE: NTS

G

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1	7/16" O.S.B. OR 19/32 CDX PLYWOOD	10d RING SHANK	8 in. o.c. EDGE 8 in. o.c. FIELD
2			4 in. o.c. EDGE 8 in. o.c. FIELD
3			4 in. o.c. GABLE ENDWALL OR GABLE TRUSS 8 in. o.c. EDGE 8 in. o.c. FIELD

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING			
BLDG HEIGHT (ft)	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	.62	1.21	1.41
20	.68	1.29	1.55
25	.74	1.35	1.61
30	1.00	1.40	1.66

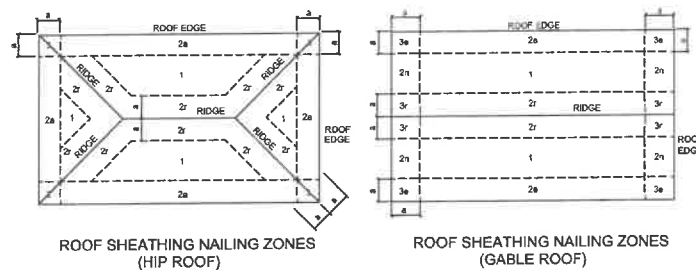


### Roof Nail Pattern DET.

SCALE: NONE

B

HEADERS SUPPORTING:		BUILDING WIDTH (FT)					
		20'		28'		36'	
		SPAN	# JACKS	SPAN	# JACKS	SPAN	# JACKS
ROOF, CEILING	2-2x4	3'-6"	1	3'-2"	1	2'-10"	1
	2-2x6	5'-5"	1	4'-8"	1	4'-2"	1
	2-2x8	6'-10"	1	5'-11"	2	5'-4"	1
	2-2x10	8'-5"	2	7'-3"	2	6'-6"	2
	2-2x12	9'-9"	2	8'-5"	2	7'-6"	2
	3-2x8	8'-4"	1	7'-5"	1	6'-8"	1
	3-2x10	10'-6"	1	9'-1"	2	8'-2"	1
	3-2x12	12'-2"	2	10'-7"	2	9'-5"	2
	4-2x8	9'-2"	1	8'-4"	1	9'-2"	1
	4-2x10	11'-8"	1	10'-8"	1	9'-5"	1
	4-2x12	14'-1"	1	12'-2"	2	10'-11"	1

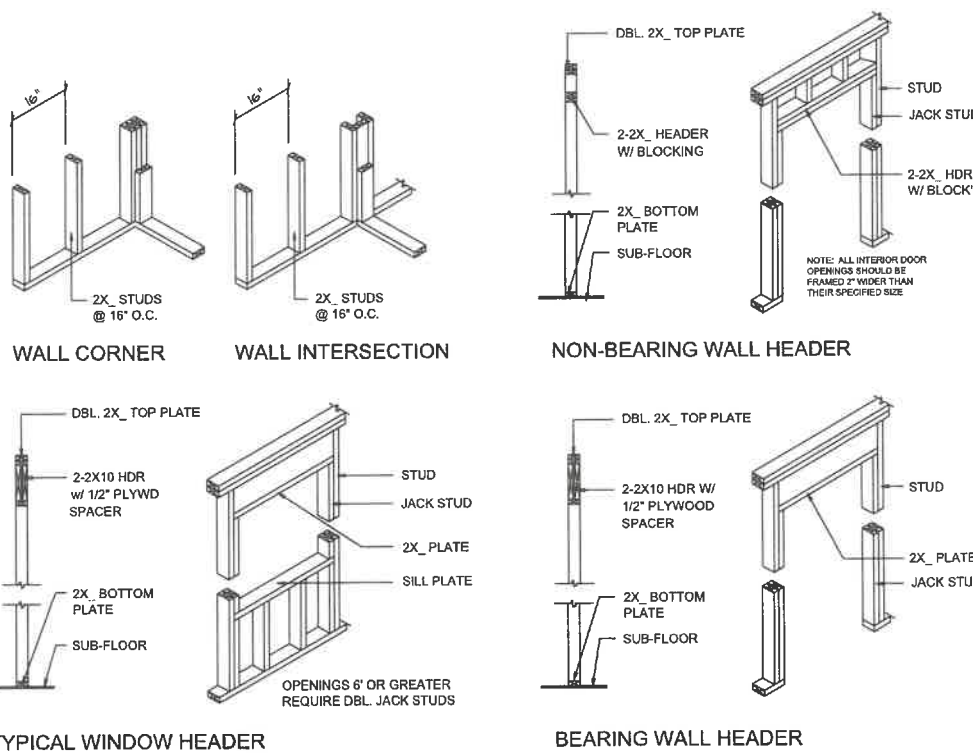


### Wall Framing/Header DETAILS

SCALE: NONE

F


NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

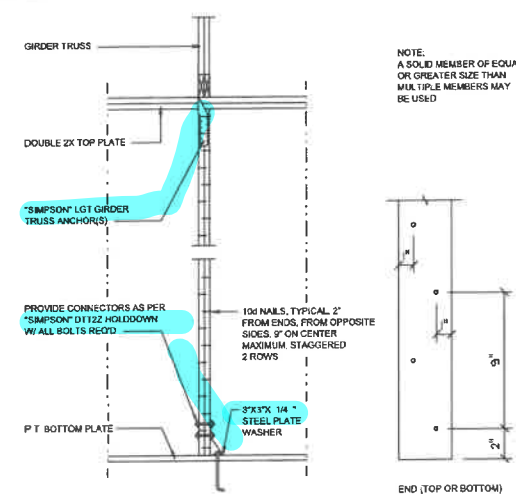

### Girder Truss Column DET.

SCALE: 1/2" = 1'-0"

"WindSTORM" ALT. SHEATHING METHOD:  
ALTERNATIVE METHOD FOR ANCHORING THE TOP WALL PLATE TO THE FOUNDATION IN LIEU OF THE SP15P2 OR SP4 STRAPS INDICATED IN THE CONSTRUCTION DOCUMENTS FOR THIS PROJECT SHALL ALLOWED AS FOLLOWS:  
1. APPLY VERTICALLY, "WindSTORM" 7/16" OSB 48" X 96", 100' 121" OR 142" SHEATHING FASTEN TO THE TOP PLATE AND THE SILL PLATE WITH EITHER 8d COMMONS @ 3' O.C. OR 8d COMMONS @ 4' O.C. FASTEN TO EACH STUD WITH EITHER 6d COMMONS @ 8' O.C. OR 8d COMMONS @ 8' O.C.  
NOTE:  
A SOLID MEMBER OF EQUAL OR GREATER SIZE THAN MULTIPLE MEMBERS MAY BE USED  
Alternate "Titan" bolt concrete anchor in stem  
ANCHOR SILL PLATE WITH 5/8" TITAN ANCHOR BOLT, PLACED AT 40" O.C. AROUND PERIMETER OF SLAB AND ALL INTERIOR BEARING WALLS (MIN 4" EMBED)

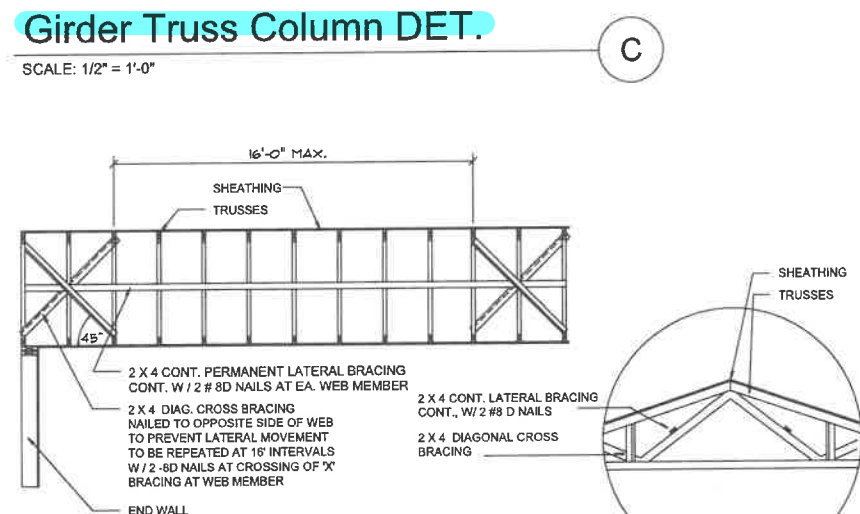

### TYP. PERMANENT TRUSS BRACING DIA.

NTS

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

### Truss Bracing DETAILS

SCALE: AS NOTED

