
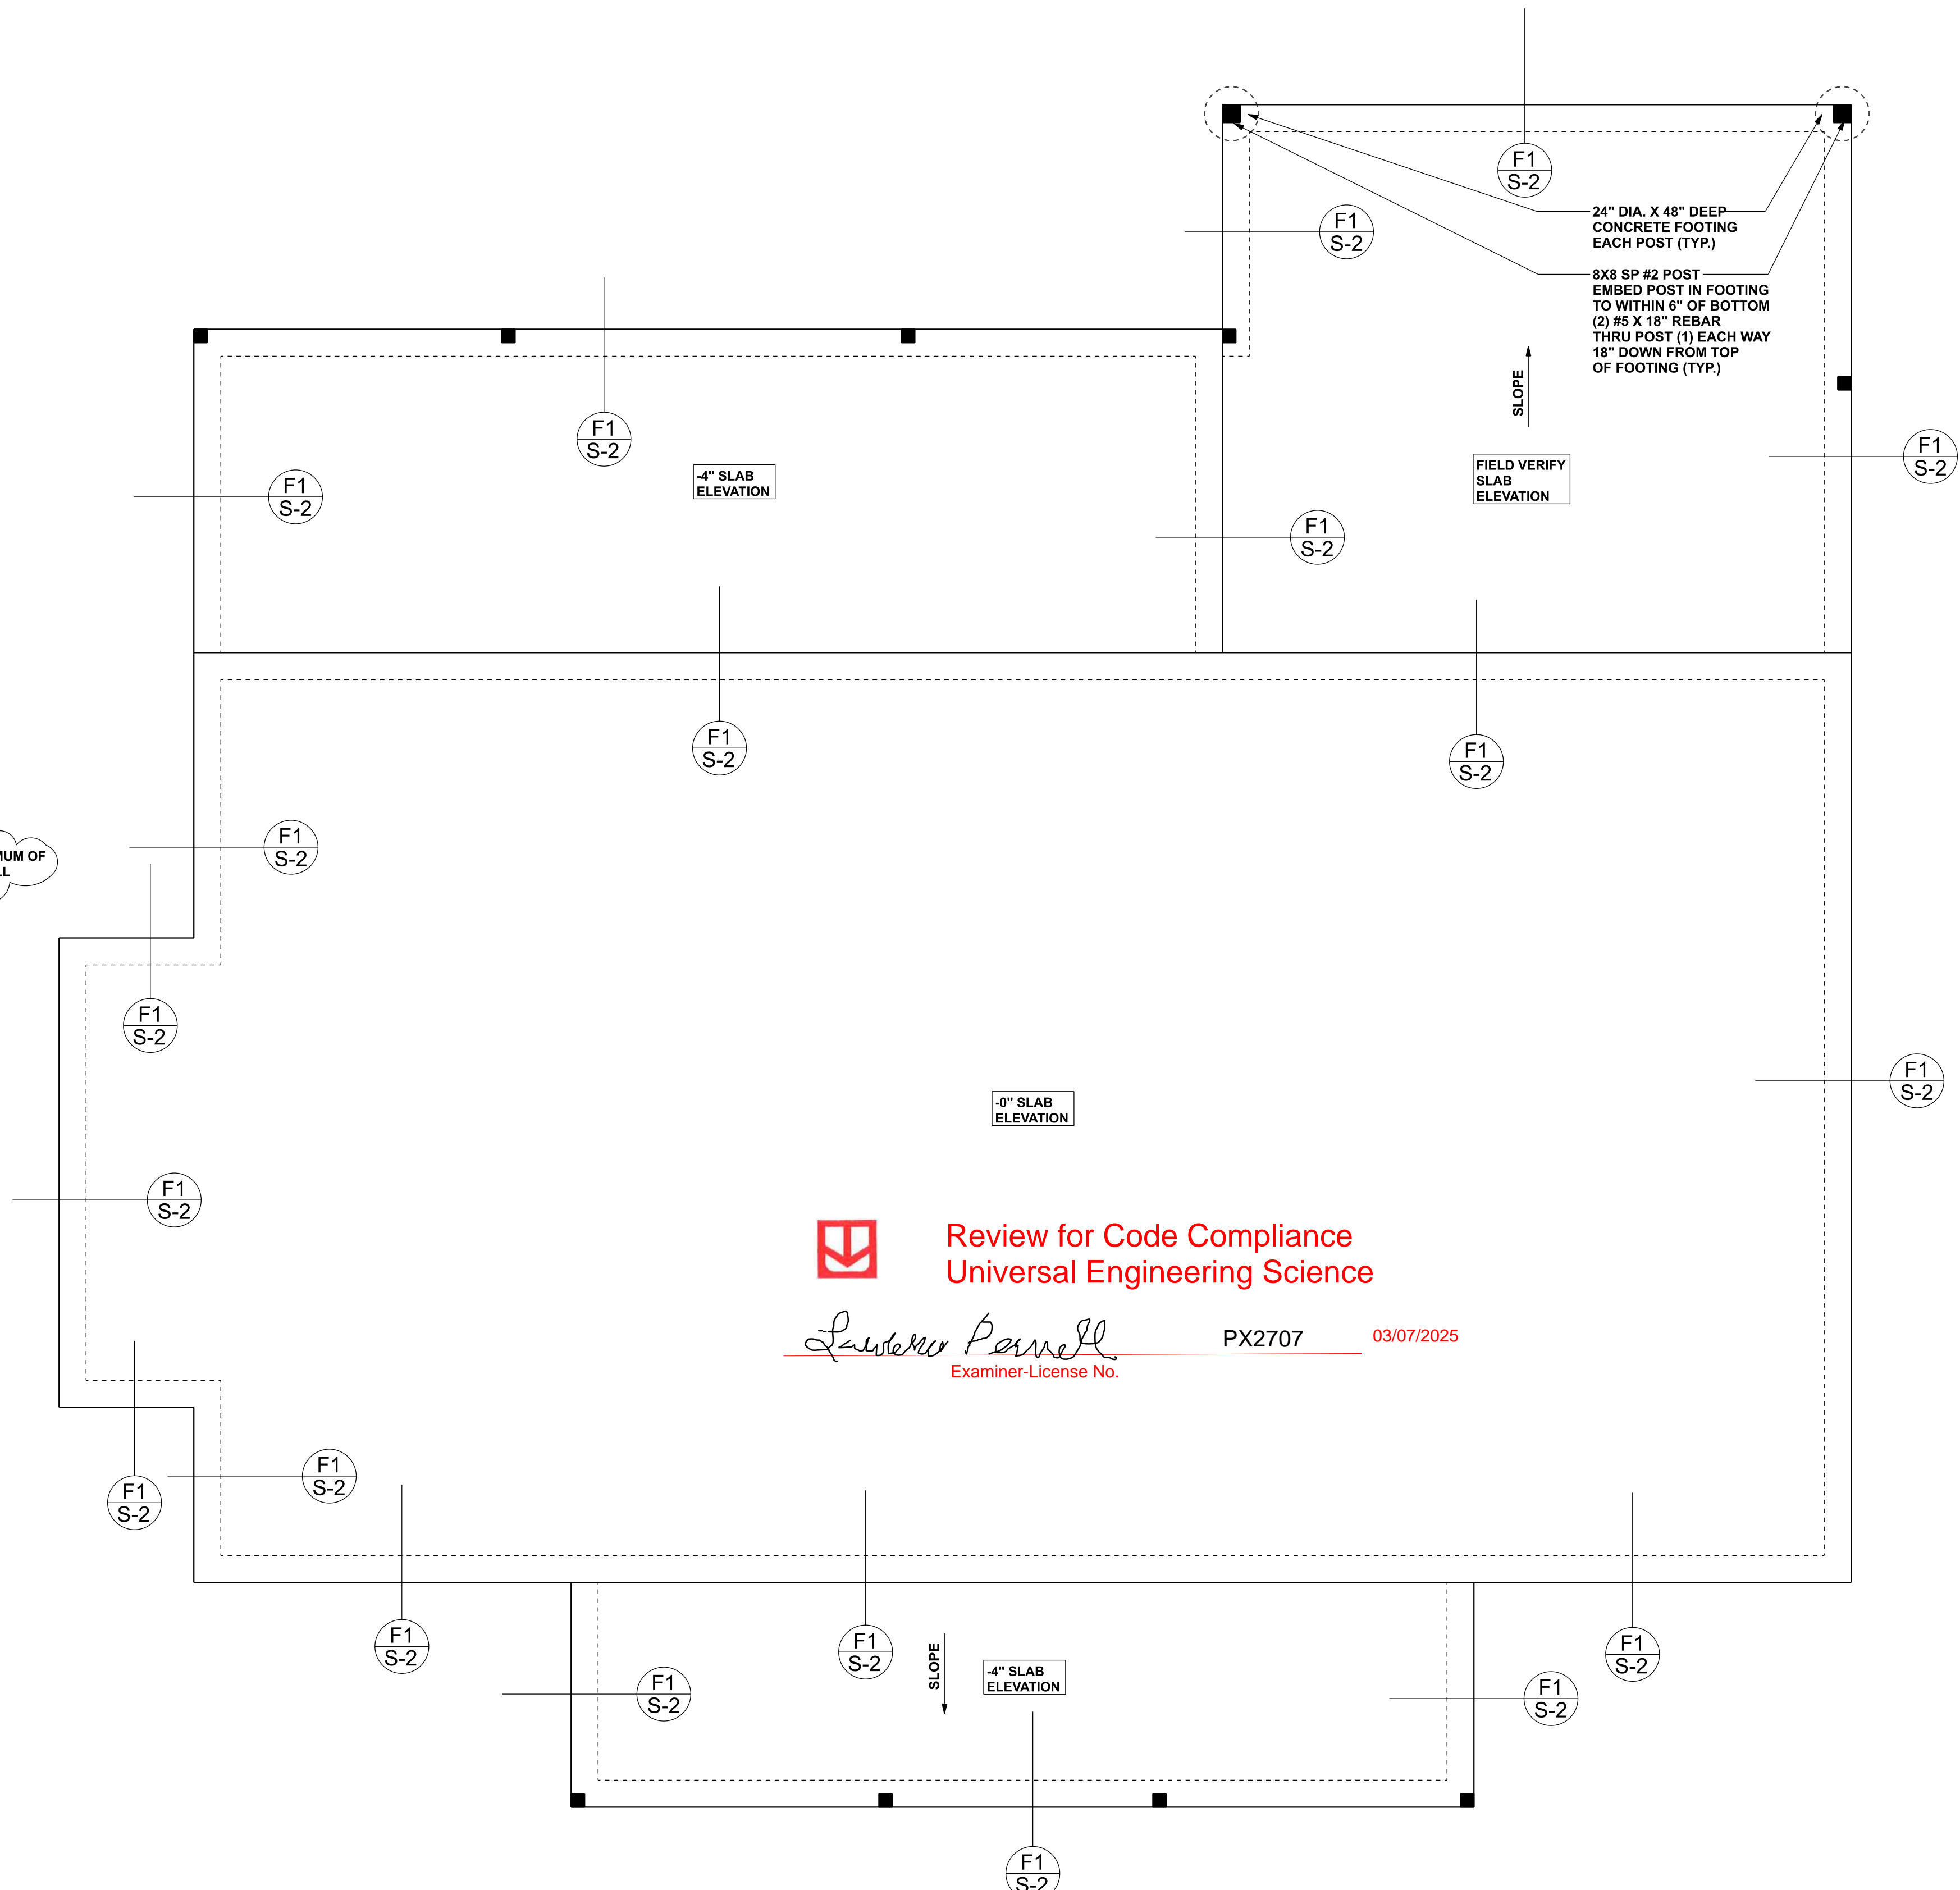
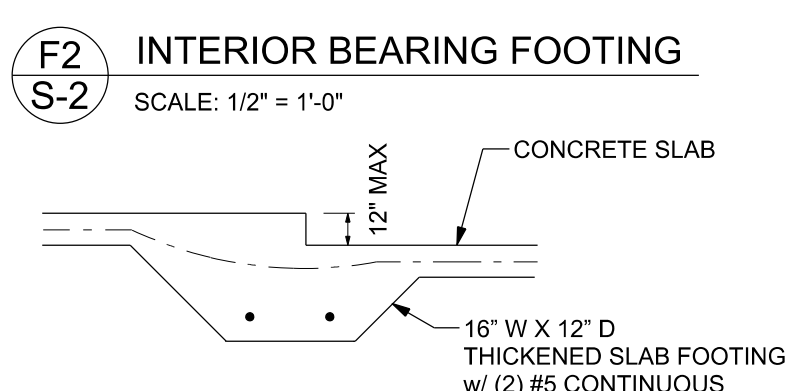
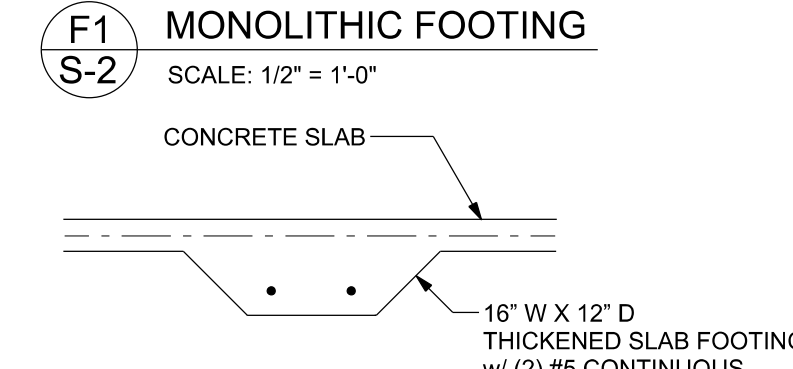
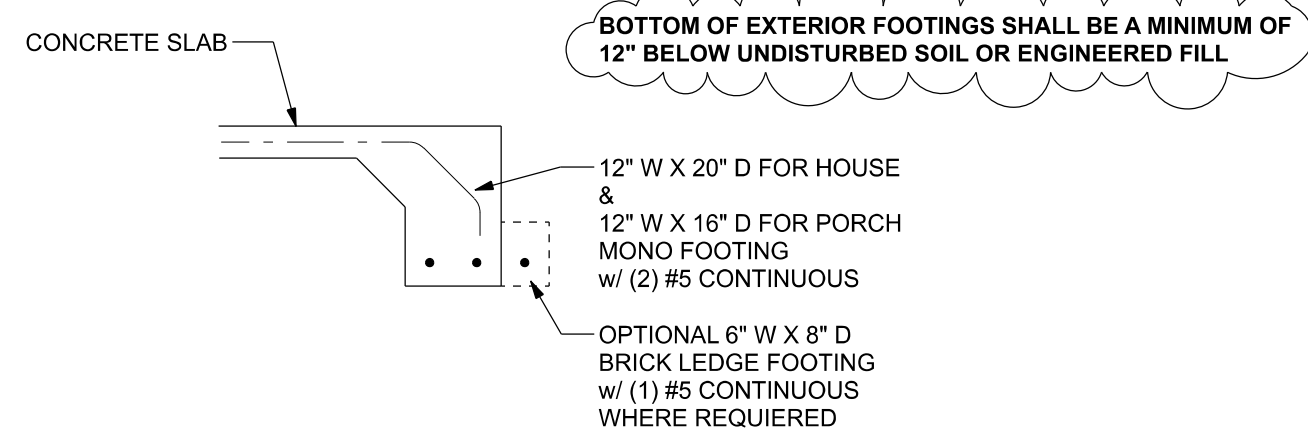


TALL STEM WALL TABLE:								
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed below the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior face of the wall). The wall is over 10' high. Durwall® exterior reinforcement is 180°C vertically or a horizontal bond beam with 195 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.								
STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)			
		#5	#7	#8	#5	#7	#8	
3.3	3.0	96	96	96	96	96	96	
4.0	3.7	96	96	96	96	96	96	
4.7	4.3	88	96	96	96	96	96	
5.3	5.0	56	96	96	96	96	96	
6.0	5.7	40	80	96	80	96	96	
6.7	6.3	32	56	80	56	96	96	
7.3	7.0	24	40	56	40	80	96	
8.0	7.7	16	32	48	32	64	80	
8.7	8.3	8	24	32	24	48	64	
9.3	9.0	8	16	24	16	40	48	

MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

	AC1030, 10-2 Section	Specific Requirements
1.4A	Compressive strength	8" block bearing walls Fm = 1500 psi
2.1	Mortar	ASTM C 270, Type N, UNO
2.2	Grout	ASTM C 478, admixture for cure approval
2.3	C/M standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"X8"x16" running bond and 12"x12" or 16"x16" column block
2.3	Clay brick, standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"X2.5"X12.5"
2.4	Reinforcing bars, #3 - #11	ASTM A615, Grade 40, Fy = 40 ksi, Lap splices min 40 bar dia, (25' for #6)
2.4	Coating for corrosion protection	Anchor, sheet steel mesh completely embedded in mortar or grout. ASTM A525, Class B0, 0.60 oz/ft ² or 304SS
2.4	Coating for corrosion protection	Joint reinforcement in walls exposed to moisture, wires, ties, anchors, sheet steel mesh is not completely embedded in mortar or grout. ASTM A164, Class B2, 1.50 oz/ft ² or 304SS
3.3.E.2	Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7	Movement joints	Contractor assumes responsibility for type and location of movement joints. Not detailed on project drawings.

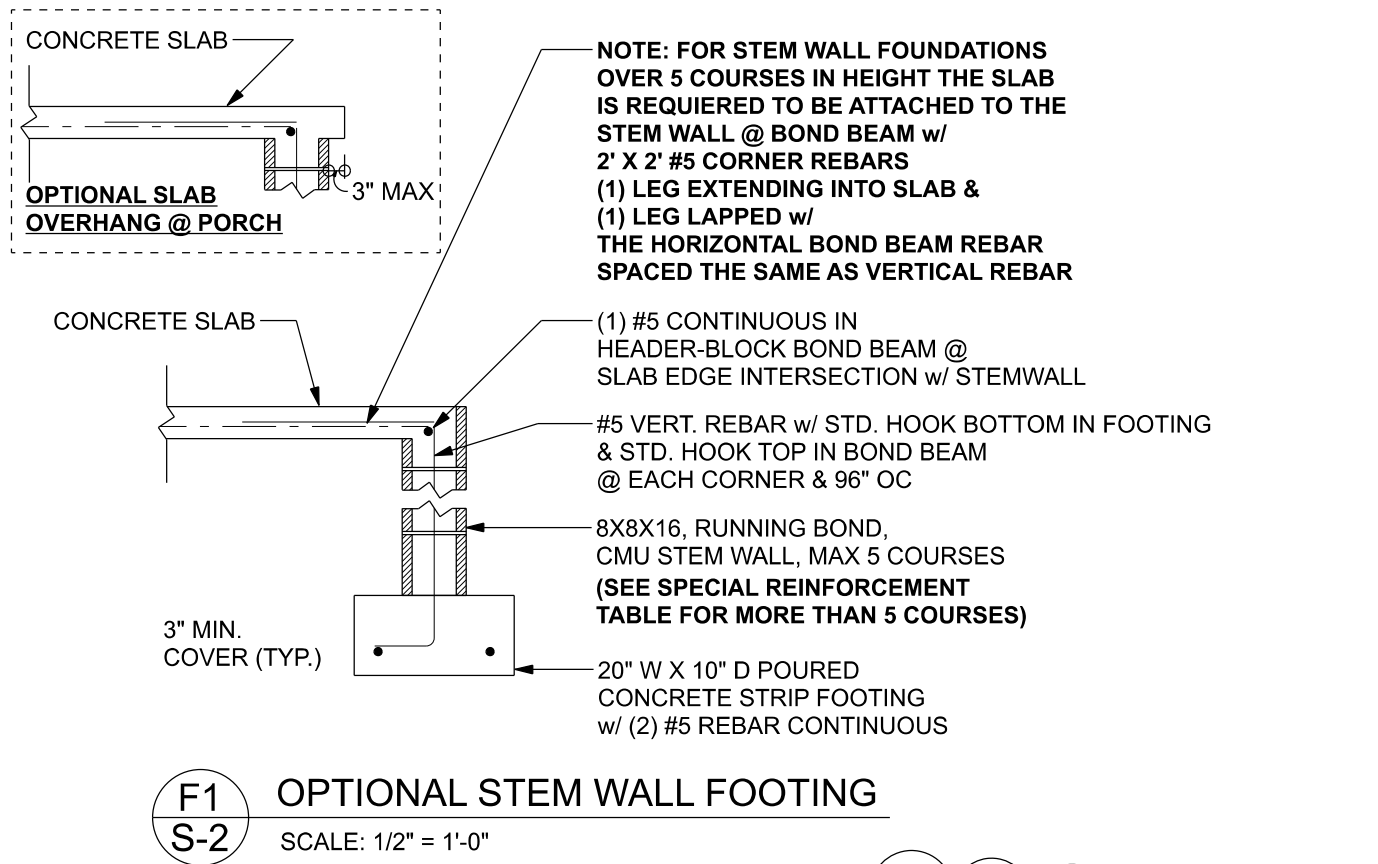

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, REINFORCING BARS, ETC. DIMENSIONS OF CURB OR MARK DISOWAY. PE IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING WALLS HAS BEEN PROVIDED FOR COAST TRUSS PLAN. (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED W/ 6X6-4 L4 WELDED WIRE MESH PLACED ON CHAIRS 6" DEPTH OR FIBER FIBER REINFORCED 6-MILL POLY LAPOR BARRIER W/ 8" M3S SEALED W/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL. (FOR OTHER FOUNDATION TREATMENT-TREATMENT METHOD CAN BE USED INSTEAD.)

03/07/2025

PROJECT ADDRESS:
1199 SW Marynik Drive, High Springs, FL

LIMITATION: This design is valid for one building, at specified location.

OF 3 SHEETS

VALLEY ROOF PLAN

CS20 RIDGE TENSION STRAP w/ 8 - 54 GR.204 COLLAR TIE 3-165 OR 4-131 KP

204 VALLEY RAFTER

206 RIDGE BOARD

SEE CRIPPLE, BRACING & BLOODING NOTES

4" MAX SPACING

CRIPPLES

EXISTING ROOF FRAMING 2" O/P & 24" O.C.

204 BLOCKING

204 PURLIN 24" O.C. (WHERE NO SHEATHING IS APPLIED)


EXISTING 1/2" SHEATHING

204 BLOCKING (NOT REQUIRED IF SLEEPERS ARE USED)

REVEL RAFTER CUT AS REQD FOR FITCH

* ATTACHMENT CAN BE MADE DIRECTLY OR THROUGH PLYWOOD SHEATHING BY CUTTING A 2" x 4" NOTCH IN SHEATHING

Diagram labels include: 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100.

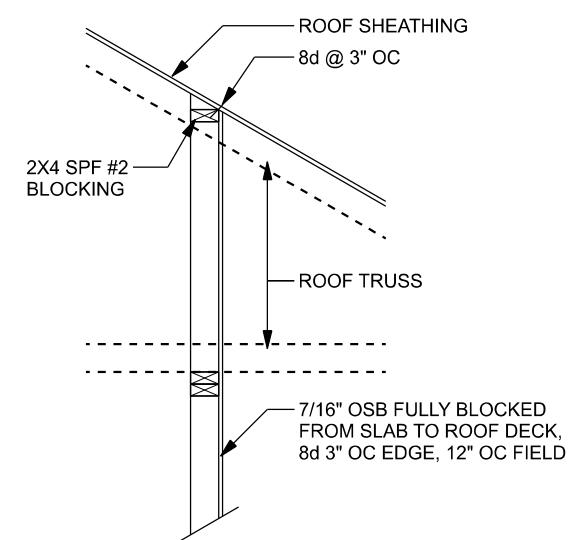

NOTE:
IF THE ABOVE DETAIL IS USED
ON THE FRONT & REAR PORCH WALL
THE FRONT & REAR PORCH CEILING DOES NOT
NEED TO BE SHEATHED



CONNECTION REQUIREMENT NOTES

1	2X4 RAFTERS TO RIDGE	3'-6" OR 6 - 131" x 3" TOE NAILS
2	CRIPPLE TO RIDGE	3'-6" OR 6 - 131" x 3" FACE NAILS
3	CRIPPLE TO RAFTERS	3'-6" OR 6 - 131" x 3" FACE NAILS
4	RAFTER TO SLEEPER OR BLOCKING	3'-6" OR 6 - 12 - 131" x 3" TOE NAILS
5	SLEEPER TO TRUSS	3'-6" OR 6 - 131" x 3" FACE NAILS EACH TRUSS
6	RIDGE BOARD TO ROOF BLOCK	3'-6" OR 6 - 131" x 3" TOE NAILS
7	RIDGE BOARD TO TRUSS	3'-6" OR 6 - 131" x 3" TOE NAILS
8	PURLIN TO TRUSS (TYP)	3'-6" OR 6 - 131" x 3" FACE NAILS
9	PURLIN TO TRUSS (IF CRIPPLE IS ATTACHED TO PURLIN)	3'-6" OR 6 - 131" x 3" FACE NAILS
10	TRUSS TO BLOCKING	3'-6" OR 6 - 131" x 3" END NAILS
11	CRIPPLE TO TRUSS	3'-6" OR 6 - 131" x 3" FACE NAILS
12	CRIPPLE TO PURLIN	3'-6" OR 6 - 131" x 3" FACE NAILS

GENERAL NOTES

MAXIMUM RAFTER SPANS
6'-0" FOR 2X4, 3'-0" FOR 2X8 SPF #2 OR SYP #2.
MAXIMUM ROOF AREA PER SUPPORT
1612 IN ZONES 2 & 3, 2482 IN ZONE 1. (EXAMPLE: 4'-0" O.C. X 4'-0" SPAN = 1612 OR 2'-0" X 8'-0" SPAN = 1612)
PURLINS REQUIRED 2'-0" O.C. IF EXISTING SHEATHING IS REMOVED.
PURLINS SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING A MINIMUM OF 8" AND NAIL INWARDS THROUGH SHEATHING INTO PURLIN WITH A

MINIMUM OF 8 - 8d COMMON WIRE NAILS

THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:

- SPANS (DISTANCES BETWEEN HEELS) 40'-0" OR LESS
- MAXIMUM VALLEY HEIGHT: 14'-0" OR LESS
- MAXIMUM WIND SPEED: 130 MPH
- MAXIMUM MEAN ROOF HEIGHT: 30 FEET
- MAXIMUM TOTAL LOADING: 40 psf
- MEETS FBC / ASCE 7 WIND REQUIREMENTS
- EXPOSURE CATEGORY "C", $I_e = 1.0$, $K_{zt} = 1.0$
- ENCLOSED BUILDING


CRIPPLE, BRACING, & BLOCKING NOTE

2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 5'-0" TO 10'-0" LONG. NAILS 2x4 - 2; 1x6 NAILS OR 2X4 "T" OR SCAB BRACE NAILD TO FLAT EDGE OF CRIPPLE WITH 16 NAILS @ 8" O.C. "T" OR SCAB MUST BE 90% OF CRIPPLE LENGTH. CRIPPLES OVER 10'-0" LONG REQUIRE 2X4 "T" OR SCAB WITH 16 NAILS @ 8" O.C. "T" OR SCAB. USE STRESS GRADED LUMBER & BOX OR COMMON NALS.

- NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER.
- AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD.
- INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED.
- INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN.
- LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED.
- APPLY ALL NAILING IN ACCORDANCE TO NDS-1999 SECTION 12. NAILS ARE COMMON WIRE NALS UNLESS NOTED OTHERWISE.

ROOF OVER FRAMING & BRACING DETAIL

SCALE: N.T.S

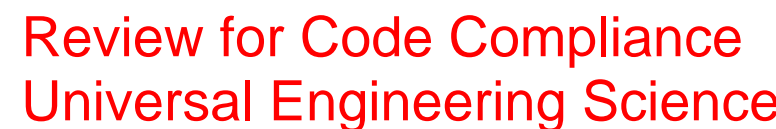

Lawrence Perrell
Examiner-License No. _____

PX2707

03/07/2025

STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

SN-1 DIMENSIONS ON STRUCTURAL SHEETS
ARE NOT EXACT. REFER TO ARCHITECTURAL
FLOOR PLAN FOR ACTUAL DIMENSIONS

PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. SN-2 LATERAL BRACING IS TO BE RESTRAINED PER BCSI-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

UNLESS NOTED OTHERWISE (MINIMUM REQUIREMENTS) ***SEE STRUCTURAL PLAN FOR ANY SPECIFIC CALL OUTS***	
BEAM / HEADERS (SIZE)	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (UNO)
HEADERS (JACK & KING STUDS)	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (UNO)
HEADERS (STRAPPING)	ALL HEADERS w/ UPLIFT TO BE STRAPPED DOWN @ EACH SIDE WITH (1) LSTA24, 14-10@ TOP & BOTTOM OF WALL WRAP UNDER BOTTOM PLATE & OVER TOP PLATE 1/2" X 10' ANCHOR BOLT w/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
JACK STUDS UNDER GIRDER TRUSS	USE ONE JACK STUD GIRDER SUPPORT PER 2000 LB LOAD

ACTUAL vs REQUIRED SHEARWALL

	TRANSVERSE	LONGITUDINAL
ACTUAL	22271 LBF	21796 LBF
REQUIRED	22038 LBF	14585 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING
FURNISHED BY BUILDER. BUILDERS FIRST SOURCE
JOB #4461241

HEADER LEGEND

(2) 2X6X0', 1J 1K ← HEADER/BEAM CALL-OUT (U.N.O.)

↑ NUMBER OF KING STUDS EACH SIDE OF OPENING (FULL LENGTH)

↑ NUMBER OF JACK STUDS EACH SIDE OF OPENING (UNDER HEADER)

↑ SPAN OF HEADER

↑ SIZE OF HEADER MATERIAL

↑ NUMBER OF PILES IN HEADER

Corey Amira Custom Homes


Blackburn Res.

PROJECT ADDRESS:
199 SW Marynik Drive, High Springs, FL

FL PE 5391:

This item has been digitally signed and sealed by Mark Disosway PE on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US Q=Florida


 c=US, o=Florida
 dnQualifier=A014
 10C0000017E97
 DE07CA000746F
 0, CN=Mark d
 Disosway
 2025-02-14 17:
 44:34

DIMENSIONS:

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to **Most Dimensions 25** for resolution.

COPYRIGHTS AND PROPERTY RIGHTS

Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
250169

S-3

OF 3 SHEETS