


PROJECT DESCRIPTION:

40X355 LG355N1C-N5 (355W) MODULES
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES
SYSTEM SIZE: 14.20 kW DC STC
ARRAY AREA # 1: 743.20 SQ FT
EQUIPMENT SUMMARY
40 LG355N1C-N5 (355W) MODULES
40 ENPHASE IQ7PLUS-72-2-US MICROINVERTERS
02 TESLA POWERWALL 2.0 LI-ION BATTERIES
01 TESLA POWERWALL BACKUP GATEWAY 2

- SHEET INDEX
- A-00 PLOT PLAN & VICINITY MAP
 - A-01 SYMBOLS & SYSTEM DESCRIPTION
 - S-01 ROOF PLAN & MODULES
 - S-01.1 PARTIAL PRESSURE AND MODULE EXPOSURE
 - S-02 STRUCTURAL ATTACHMENT DETAIL
 - S-02.1 STRUCTURAL ATTACHMENT CALCULATION
 - E-01 ELECTRICAL LINE DIAGRAM
 - E-02 WIRING CALCULATIONS
 - E-03 SYSTEM LABELING

- DS-01 MODULE DATA SHEET
- DS-01.1 WARRANTY LETTER DATA SHEET
- DS-02 INVERTER DATA SHEET
- DS-03 COMBINER BOX DATA SHEET
- DS-04 RAIL DATA SHEET
- DS-05 ATTACHMENT DATA SHEET
- DS-06 BATTERY & GATEWAY DATA SHEET

GOVERNING CODES :
FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 (FRC)
FLORIDA PLUMBING CODE, 7TH EDITION 2020 (FPC)
FLORIDA BUILDING CODE, 7TH EDITION 2020 EDITION (FBC)
FLORIDA MECHANICAL CODE, 7TH EDITION 2020 (FMC)
NEC 2017 CODE BOOK
ASCE 7-16

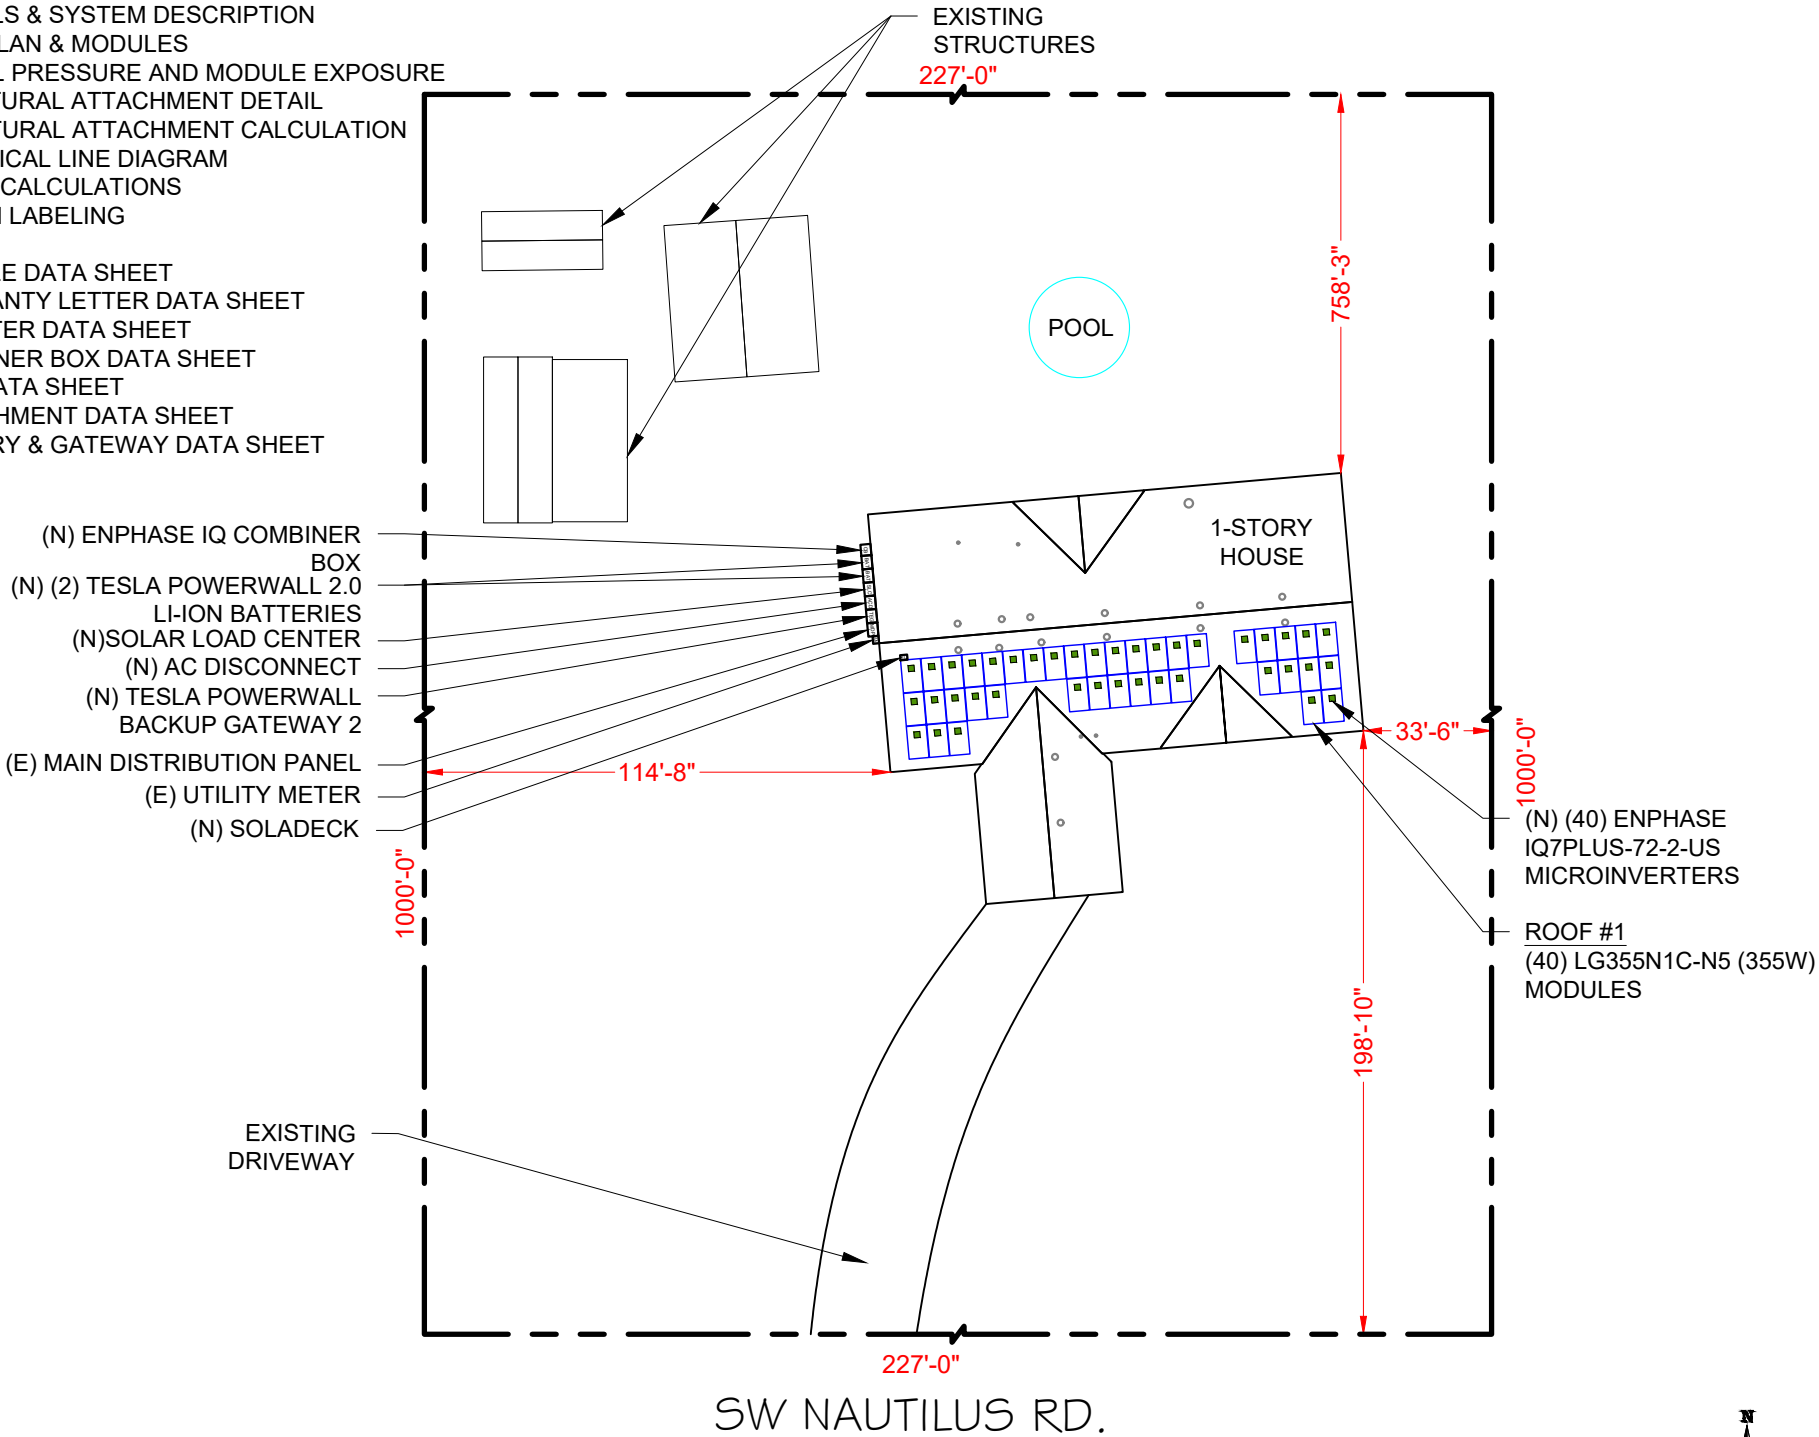

HOUSE PHOTO
SCALE: NTS



VICINITY MAP
SCALE: NTS

Castillo Engineering
DESIGNED TO PERMIT
CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD, SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature of Ermocrates E. Castillo
2021.02.15 17:08:05 -05'00'

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
PLOT PLAN & VICINITY MAP

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
A-00

Symbols:

Section.....

Sheet where section is located

Elevation

Detail ID Letter
Sheet where section is located

Detail

Detail ID Letter
Sheet where section is located

Detail

Detail ID Letter
Area to be enlarged
Sheet where section is located

Keyed Notes

1

Keyed note designation on applicable sheet

Ground Terminal

Grounding Point/rod....

Solar Panel

or 00

Module with Source Circuit number

Combiner Box

CB

DC Disconnect

DCD

Main Distribution Panel

MDP

Fuse

Overcurrent Breaker ..

Inverter

Transformer

Automatic

ATS


Transfer Switch

Abbreviations:

AC	Alternating Current
APPROX	Approximate
AWG	American Wire Gauge
CB	Combiner Box
DC	Direct Current
DCD	Direct Current Disconnect
DISC	Disconnect
(E)	Existing
EL	Elevation
EQ	Equal
JB	Junction Box
MCB	Main Combiner Box
MFR	Manufacturer
MIN	Minimum
MISC	Miscellaneous
(N)	New
OCPD	OverCurrent Protection Device
POCC	Point Of Common Coupling
PV	Photovoltaic
SF	Squarefoot/feet
STC	Standard Test Conditions
TBD	To Be Determined
TYP	Typical
VIF	Verify In Field
WP	Weather Proof

System Description

This system is a grid-tied, PV system, with PV generation consisting of 40 LG355N1C-N5 (355W) MODULES with a combined STC rated dc output power of 14,200W. The modules are connected into 40 ENPHASE IQ7PLUS-72-2-US MICROINVERTERS. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electric Code*

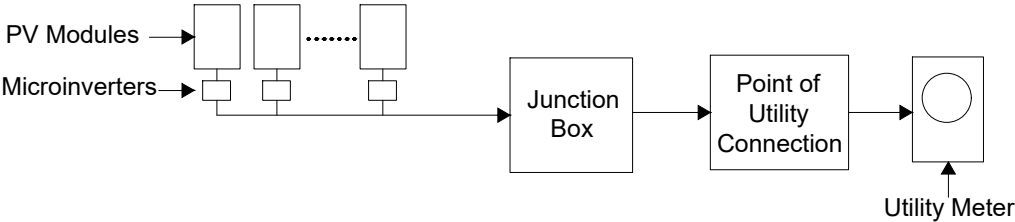

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

The inverter meets the requirements of IEEE 1547 and UL 1741. This means that if it detects a loss of utility power, it will automatically disconnect from the utility. When utility voltage is restored, the inverter automatically reconnects to the utility grid after verifying utility voltage and frequency stability.

On a day with average Florida sunshine, this system outputs 54.20 kWh per day on site.

Castillo Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature

Ermocrates E Castillo

2021.02.15 17:08:12

05'00'

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
SYMBOLS & SYSTEM DESCRIPTION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
A-01

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 40 MODULES
MODULE TYPE = LG355N1C-N5 (355W) MODULES
WEIGHT = 39.68 LBS / 18.0 KG.
MODULE DIMENSIONS = 66.9" x 40" = 18.58 SF
UNIT WEIGHT OF ARRAY = 2.14 PSF

ROOF	ROOF TYPE	ARRAY AREA (Sq. Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)	TILT	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	ASPHALT SHINGLE	743.20	1442.98	51.50	9.5°	175°	2"X4"	24" O.C.

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO SYP TRUSSES SHALL BE INSTALLED AS SHOWN IN SHEET S-02 AND AS FOLLOWS FOR EACH WIND ZONE:

SEE SHEET S-02.1 FOR SUPPORTING CALCULATIONS.

WIND ZONES	Non-Exposed Modules		Edge/Exposed Modules	
	Span	Cantilever	Span	Cantilever
Zone 1	4'-0"	1'-4"	4'-0"	1'-4"
Zone 1'	X	X	X	X
Zone 2e	4'-0"	1'-4"	4'-0"	1'-4"
Zone 2n	4'-0"	1'-4"	2'-0"	0'-8"
Zone 2r	4'-0"	1'-4"	2'-0"	0'-8"
Zone 3e	4'-0"	1'-4"	2'-0"	0'-8"
Zone 3r	4'-0"	1'-4"	2'-0"	0'-8"

2) EXISTING RESIDENTIAL BUILDING IS AN ASPHALT SHINGLE ROOF WITH MEAN ROOF HEIGHT 15 FT AND SYP 2X4 WOOD ROOF TRUSSES SPACED 24" O.C. EXISTING ROOF SLOPE FOR SOLAR SYSTEM RETROFIT IS 9.5 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS.

* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL CHAPTER 3.BUILDING STRUCTURE WILL SAFELY ACCOMMODATE LATERAL AND UPLIFT WIND LOADS, AND EQUIPMENT DEAD LOADS. *

Castillo
Engineering

DESIGNED TO PERMIT:

CASTILLO ENGINEERING
SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



ERMOCRATES E. CASTILLO

Professional Engineer

FLORIDA

No. 52590

DATE: 2021.02.15

TIME: 17:08:18

PROJECT NAME: MIRRA RESIDENCE




Ermocrates E Castillo
2021.02.15 17:08:18
-05'00"

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
ROOF PLAN &
MODULES

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
S-01

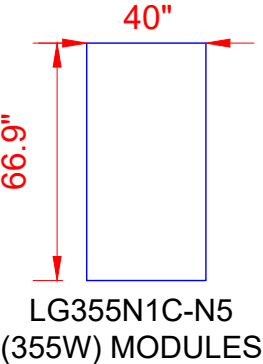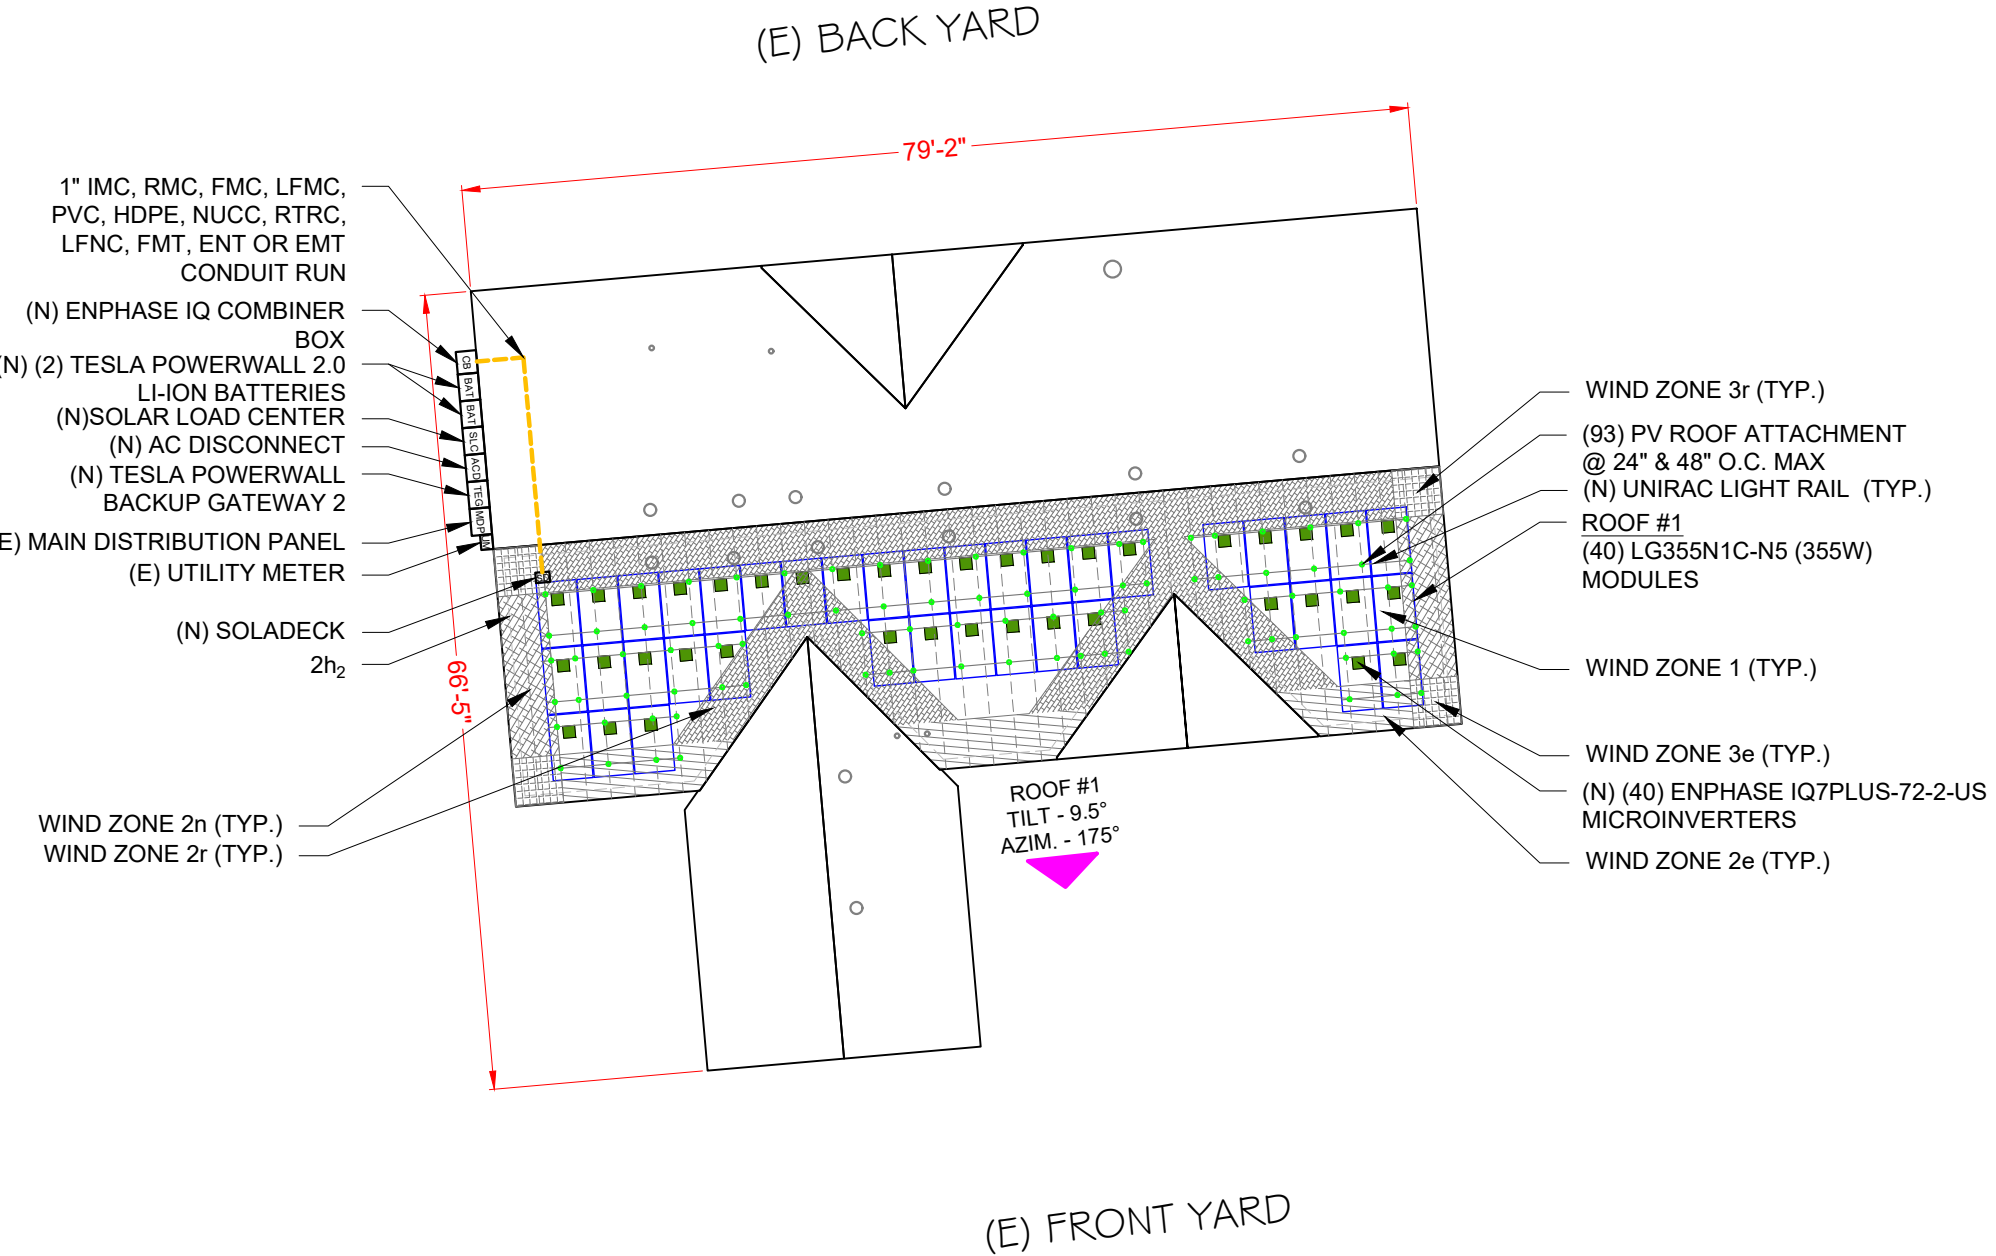

LEGEND

- UM - UTILITY METER
- SD - SOLADECK
- Micro Inverter
- ACD - AC DISCONNECT
- MDP - MAIN DISTRIBUTION PANEL
- SLC - SOLAR LOAD CENTER
- □ - VENT, ATTIC FAN (ROOF OBSTRUCTION)
- - PV ROOF ATTACHMENT
- TRUSSES
- BAT - BATTERY
- TEG - TESLA POWERWALL BACKUP GATEWAY 2
- CONDUIT
- CB - COMBINER BOX

1	1'	2e	2n	2r	3e	3r
36.4	0	36.4	45.2	45.2	45.2	53.3

Module Size 18.58 Sqft

Exposed modules								Partial Pressure
P5	11.32	0.00	7.26	0.00	0.00	0.00	0.00	36.40
P7	9.38	0.00	0.00	0.00	9.20	0.00	0.00	41.60
P8	9.78	0.00	0.00	0.00	8.80	0.00	0.00	41.40
P11	6.07	0.00	0.00	0.00	12.51	0.00	0.00	43.20
P12	8.48	0.00	0.00	0.00	10.10	0.00	0.00	42.03
P13	12.46	0.00	0.00	0.00	6.12	0.00	0.00	40.11
P14	10.66	0.00	0.00	0.00	7.92	0.00	0.00	40.98
P15	11.32	0.00	0.00	0.00	7.26	0.00	0.00	40.66


ALLOWABLE MODULE PRESSURE: 89 PSF

1	1'	2e	2n	2r	3e	3r
24.2	0	24.2	30.1	30.1	30.1	35.5

Module Size 18.58 Sqft

Non-Exposed modules								Partial Pressure
P1	12.37	0.00	0.00	3.28	2.32	0.00	0.61	26.35
P2	14.68	0.00	0.00	3.90	0.00	0.00	0.00	25.44
P3	8.95	0.00	5.73	2.38	0.00	1.52	0.00	25.44
P4	11.32	0.00	7.26	0.00	0.00	0.00	0.00	24.20
P6	18.42	0.00	0.00	0.00	0.16	0.00	0.00	24.25
P6	18.42	0.00	0.00	0.00	0.16	0.00	0.00	24.25
P9	18.47	0.00	0.00	0.00	0.11	0.00	0.00	24.23
P10	17.39	0.00	0.00	0.00	1.19	0.00	0.00	24.58
P16	8.09	0.00	5.19	3.23	0.00	2.07	0.00	25.88
P17	13.28	0.00	0.00	5.30	0.00	0.00	0.00	25.88
P18	11.18	0.00	0.00	4.47	2.09	0.00	0.84	26.79

ALLOWABLE MODULE PRESSURE: 89 PSF

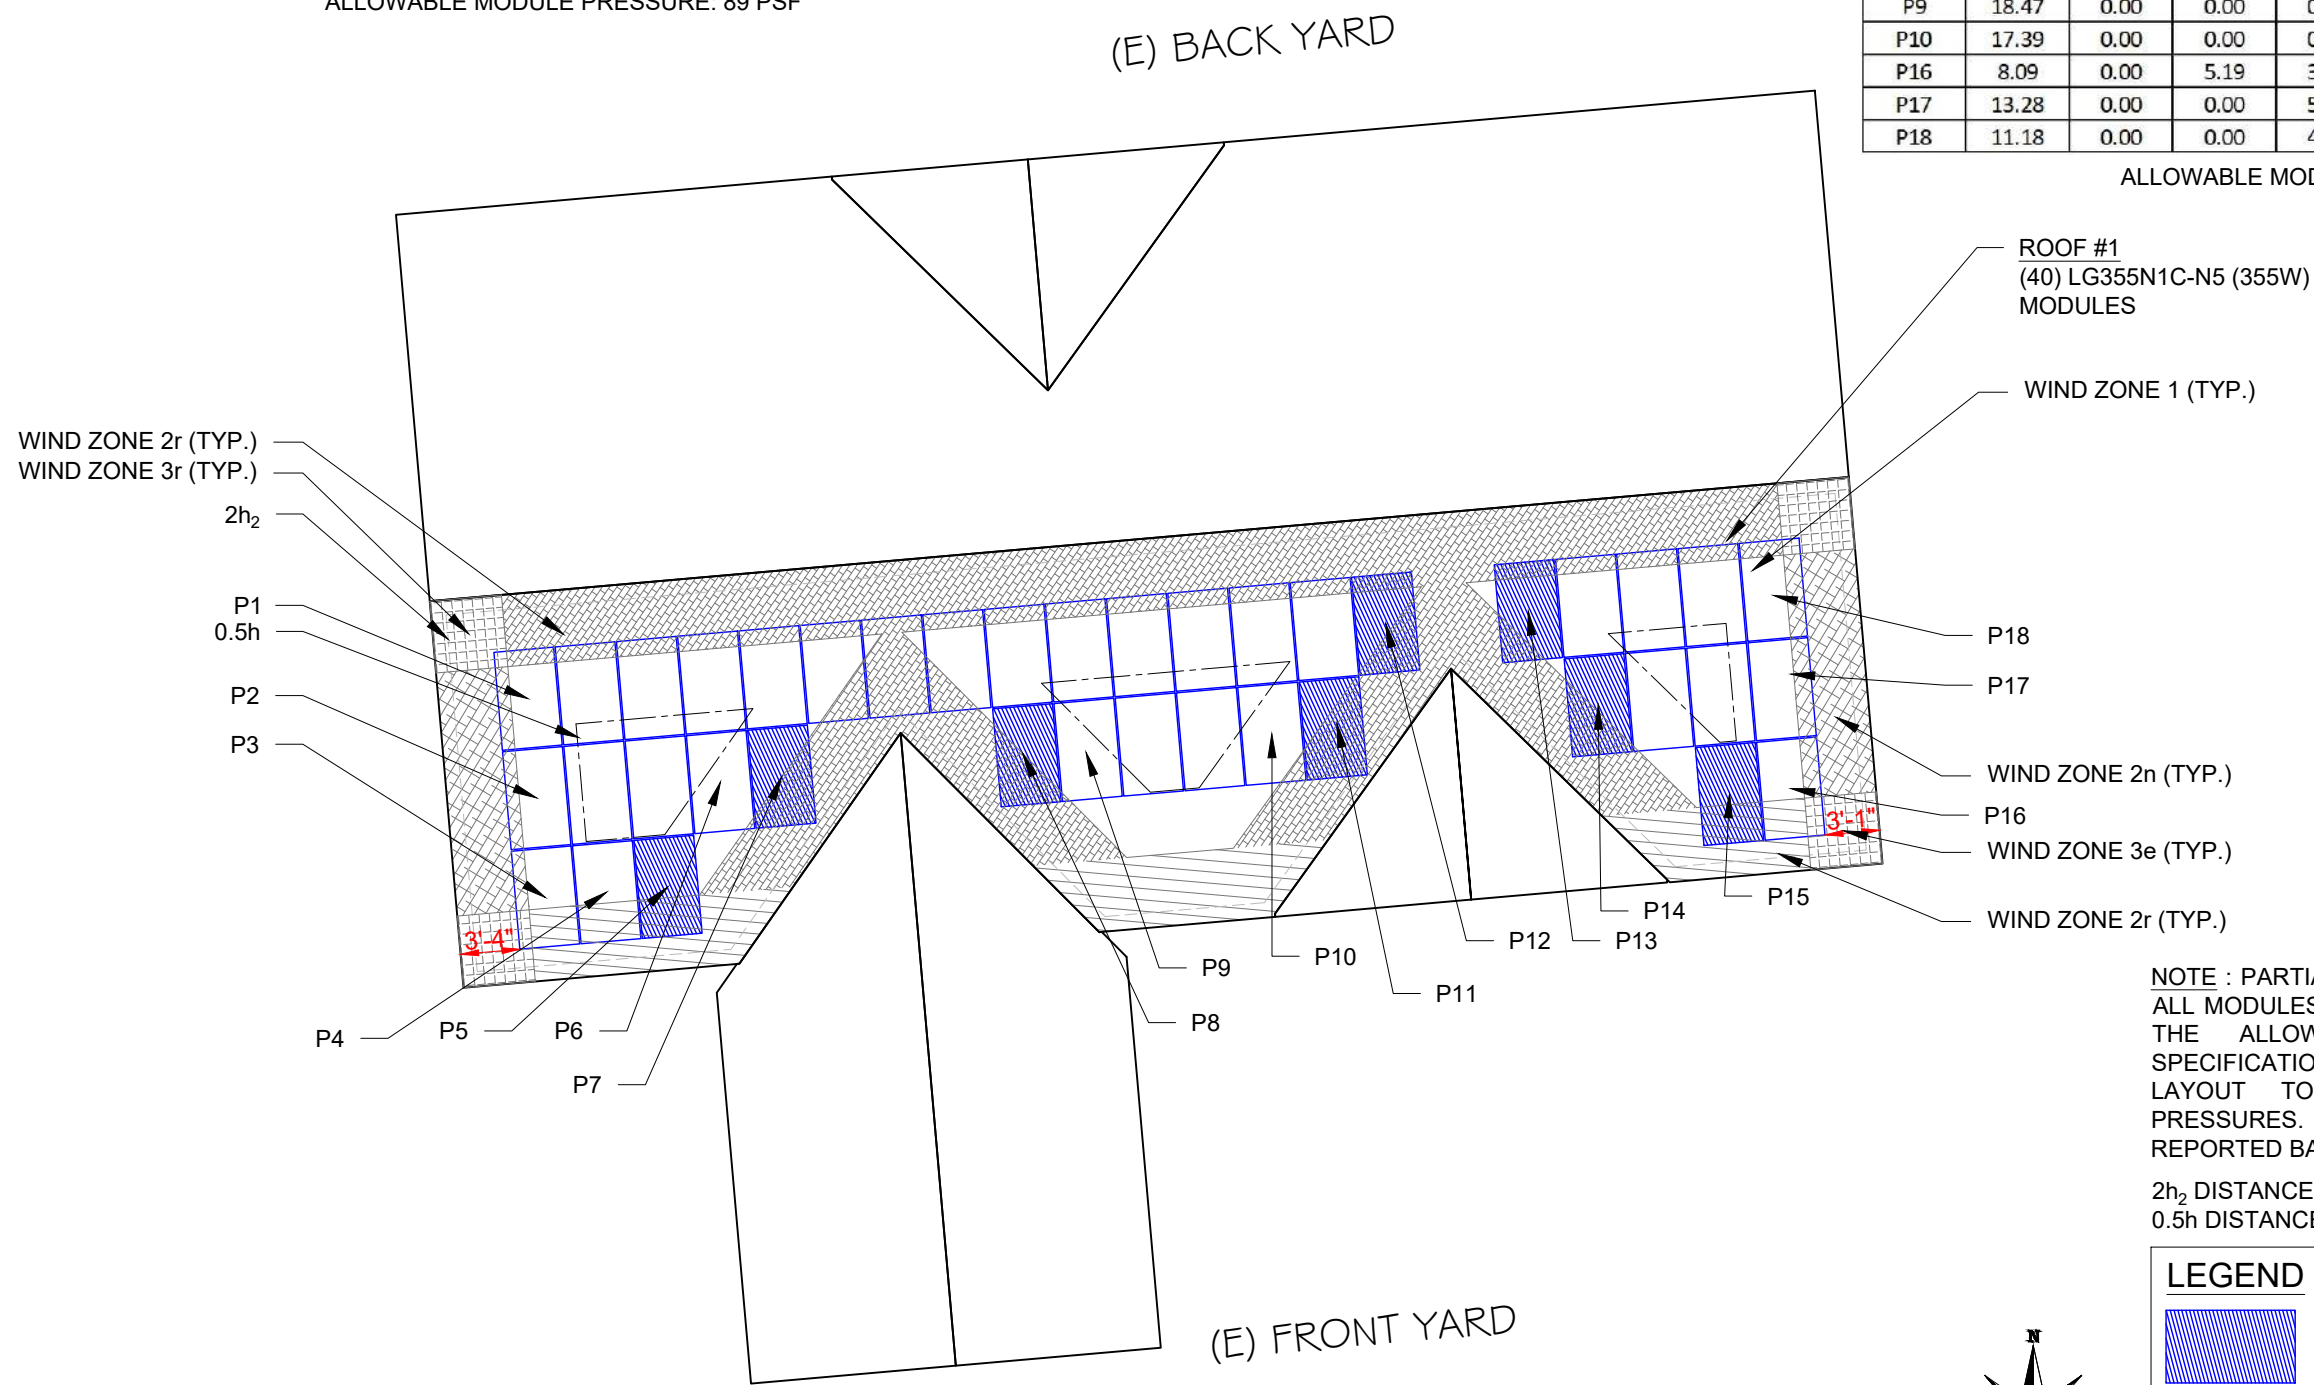

NOTE : PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

2h₂ DISTANCE : 10"
0.5h DISTANCE : 7'-6"

LEGEND

- EXPOSED MODULE
- NON-EXPOSED MODULE
- MIN PANEL EDGE DISTANCE LINE

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

Ermocrates E. Castillo
2021.02.11
5:17:08 PM
-05'00"

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME


PARTIAL PRESSURE AND
MODULE EXPOSURE


SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

S-01.1

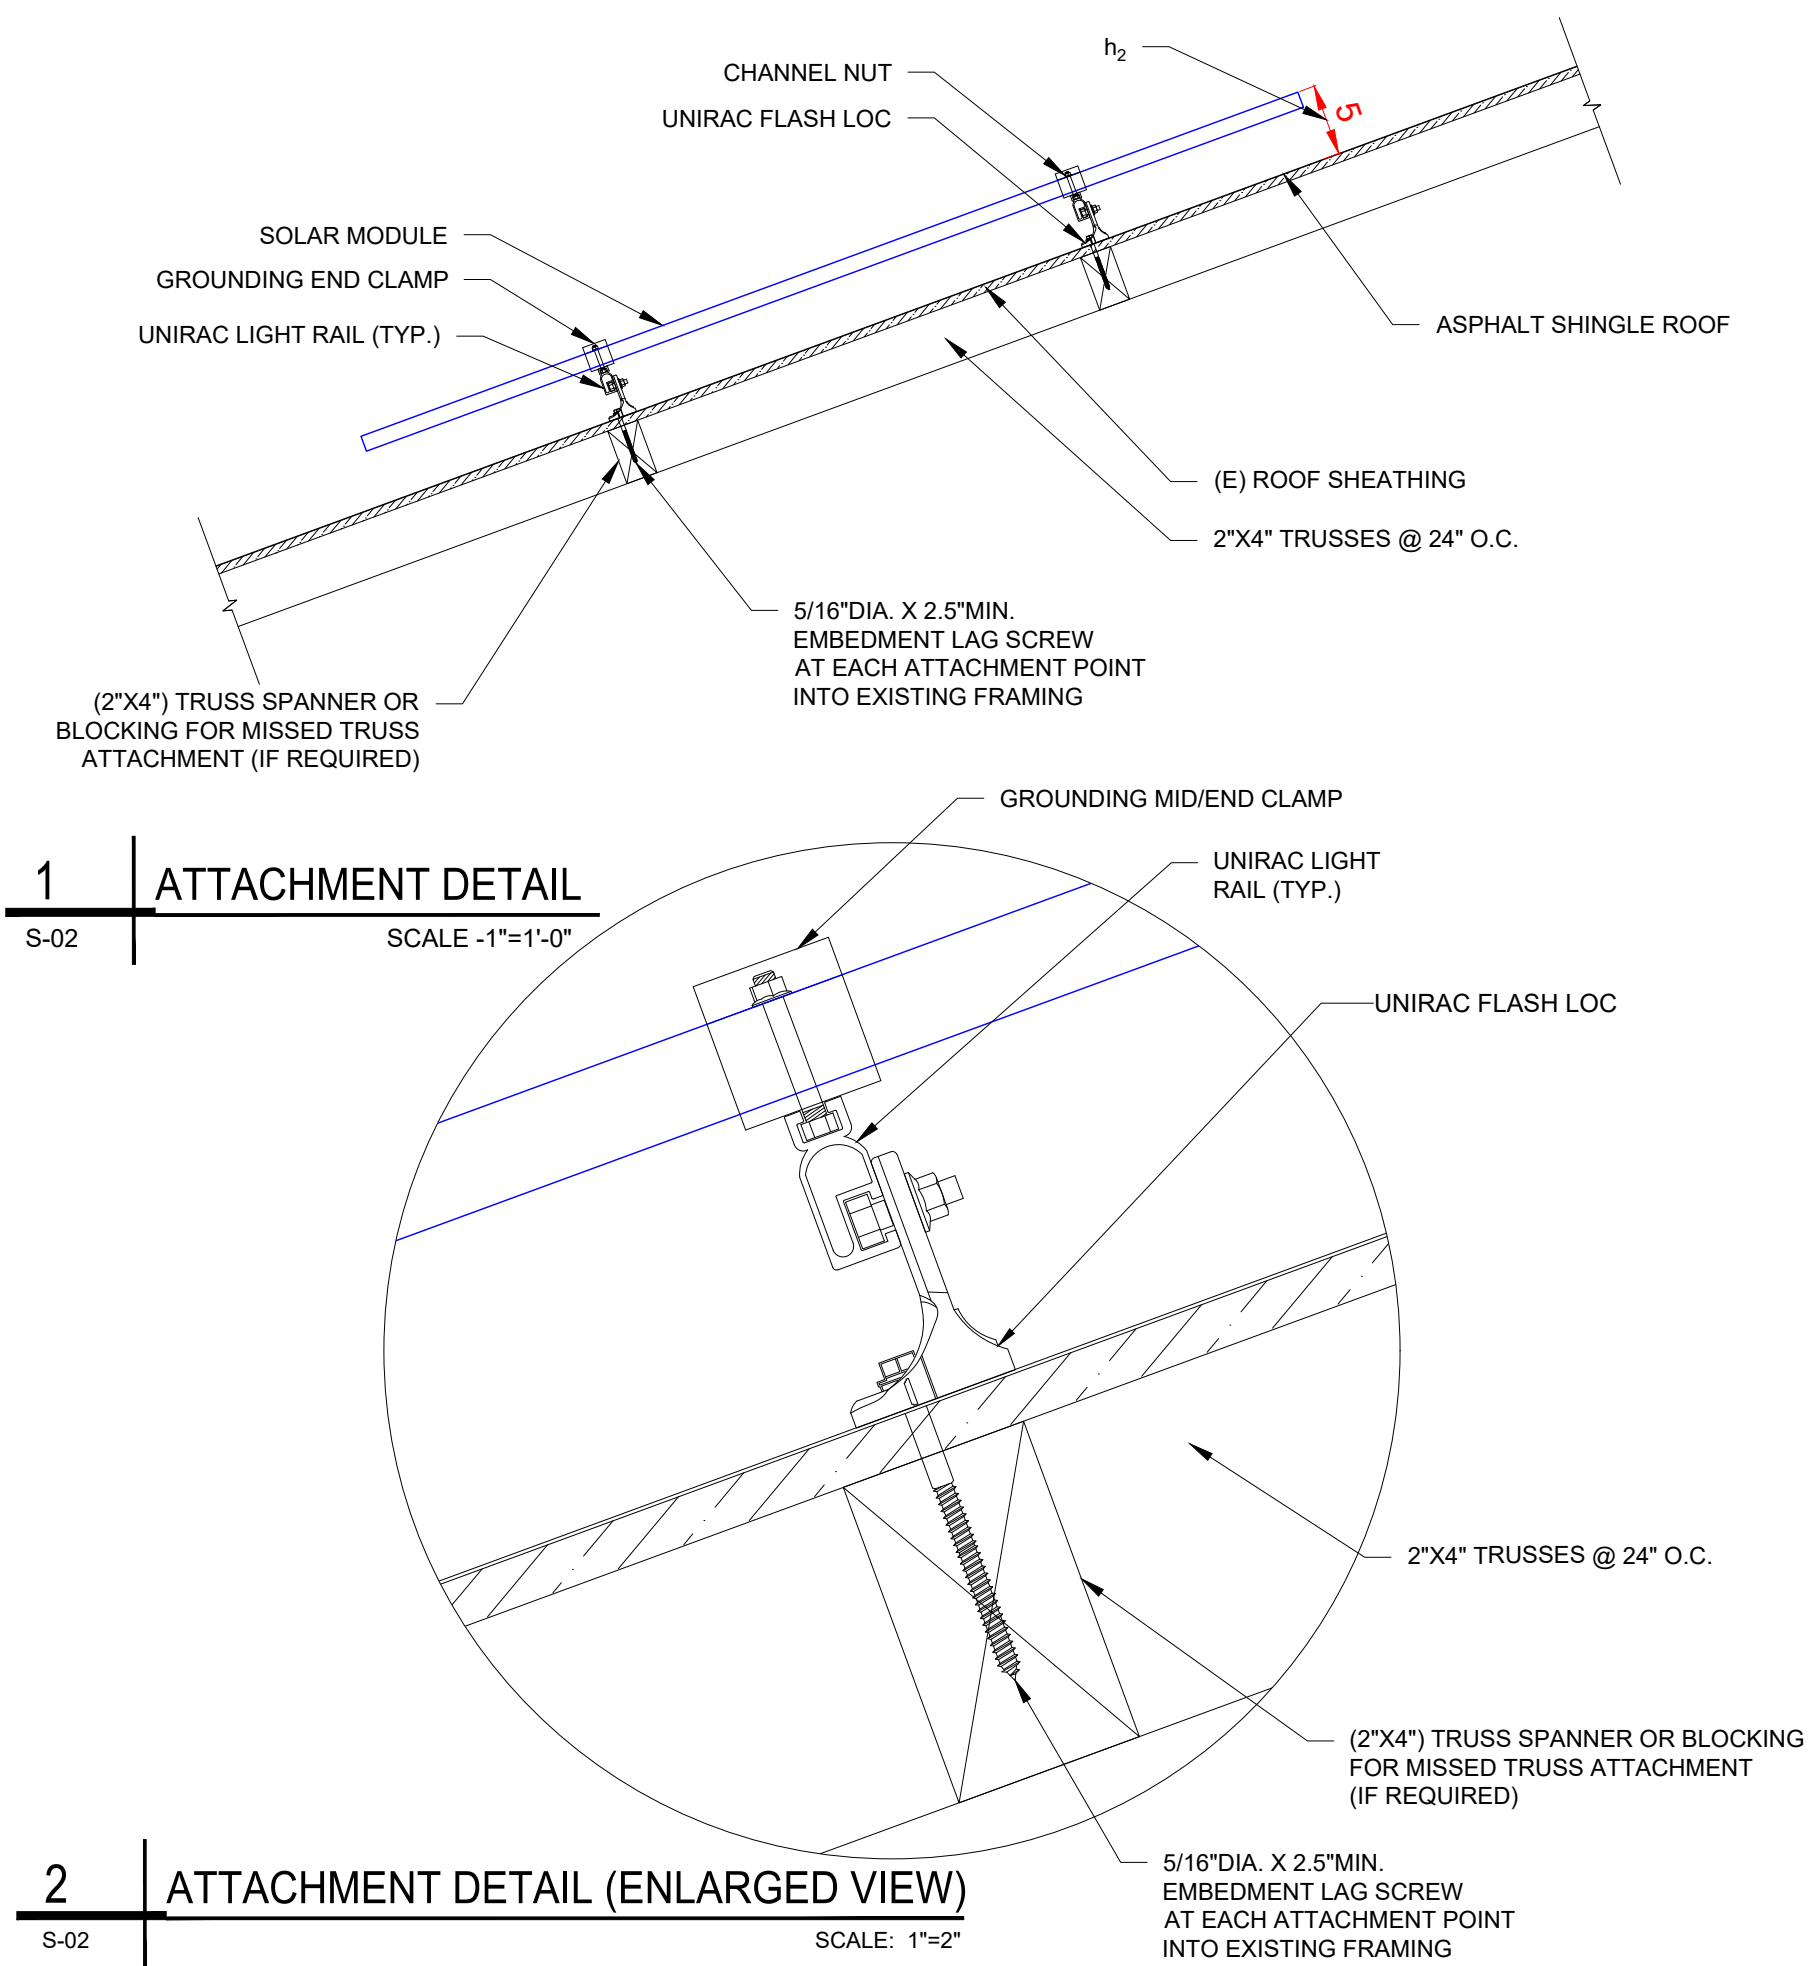



DESIGNED TO PERMIT


CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC


REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature of Ermocrates E. Castillo
Ermocrates E. Castillo
2021.02.11
5 17:08:32
-05'00'




PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
STRUCTURAL
ATTACHMENT
DETAILS

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
S-02

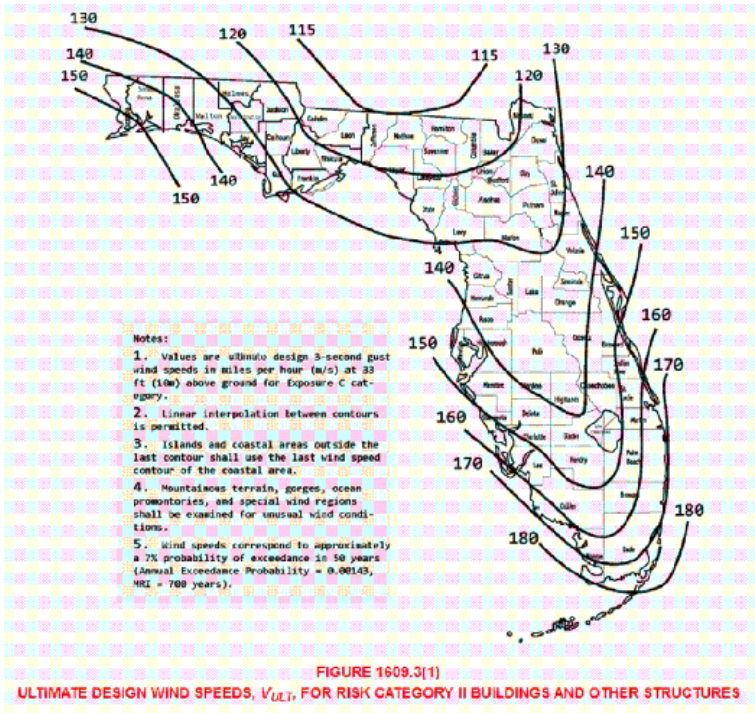

WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	15.0	EXPOSURE CATEGORY	B
ROOF LENGTH (ft)	79.0	ROOF SLOPE	2 / 12
ROOF WIDTH (ft)	66.0	ROOF SLOPE (°)	9.5
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	GABLE
MODULE LENGTH (in)	66.9	ULTIMATE WIND SPEED	120 mph
MODULE WIDTH (in)	40.00	NOMINAL WIND SPEED	93 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR (C_e)	1.000
MODULE AREA (sq. ft.)	18.58	TEMPERATURE FACTOR (C_t)	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR (I_s)	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR (C_s)	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	K_d	0.850
EFFECTIVE WIND AREA (ft ²)	18.6	K_{z7}	1.000
GROUND ELEVATION (ft)	69.0	K_e	0.998
HVHZ	NO	K_z	0.575

DESIGN CALCULATIONS			
VELOCITY PRESSURE (q) = $.00256 \cdot K_e K_z K_{zt} K_d V^2$			
VELOCITY PRESSURE (ASD) 10.8 psf			
WIDTH OF PRESSURE COEFFICIENT	66' * 10%	=	6.6'
	15' * 40%	=	6'
		ZONE WIDTH : 4 FT	
		ZONE 2 WIDTH N/A (FOR (°) < 7°)	
		ZONE 3 WIDTH N/A (FOR (°) < 7°)	
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	-2.068	-2.068
	ZONE 1'	X	X
	ZONE 2e	-2.068	-2.068
	ZONE 2n	-2.615	-2.615
	ZONE 2r	-2.615	-2.615
	ZONE 3e	-2.615	-2.615
	ZONE 3r	-3.116	-3.116
INTERNAL PRESSURE COEFFICIENT (+/-)		0.18	

DESIGN PRESSURES			
ROOF ZONE	DOWN	UP	
1	16.0	-24.2	psf
1'	X	X	psf
2e	16.0	-24.2	psf
2n	16.0	-30.1	psf
2r	16.0	-30.1	psf
3e	16.0	-30.1	psf
3r	16.0	-35.5	psf

Module allowable uplift 89 psf
Module allowable down 126 psf

ARRAY FACTORS			
ARRAY EDGE FACTOR (EXPOSED)	1.5	SOLAR PANEL PRESSURE	0.6924
ARRAY EDGE FACTOR (NON-EXPOSED)	1	EQUALIZATION FACTOR	

ADJUSTED DESIGN PRESSURES			
ROOF ZONE	DOWN	UP (Exposed)'	(N. Exposed)
1	16.0	-36.4	-24.2 psf
1'	X	X	X psf
2e	16.0	-36.4	-24.2 psf
2n	16.0	-45.2	-30.1 psf
2r	16.0	-45.2	-30.1 psf
3e	16.0	-45.2	-30.1 psf
3r	16.0	-53.3	-35.5 psf

ATTACHMENTS USED			
ATTACHMENT MODEL	Lag Bolts- Shingle		
ATTACHMENT STRENGTH	476	psf	

MAX DESIGN LOADS ALLOWABLE			
LIMIT MAX SPAN TO		48	in
RAFTER/SEAM SPACING		24	in
		NO. OF RAFTERS: 2 Non. Exp: 2	
ROOF ZONE	DOWN	UP (Exposed)'	(N. Exposed)
1	178.4	405.3	270.2 lbs
1'	X	X	X lbs
2e	178.4	405.3	270.2 lbs
2n	178.4	251.9	335.9 lbs
2r	178.4	251.9	335.9 lbs
3e	178.4	251.9	335.9 lbs
3r	178.4	297.0	396.1 lbs

SPANS (E)	SPANS (N. E)
48 in	48 in
X in	X in
48 in	48 in
24 in	48 in
24 in	48 in
24 in	48 in
24 in	48 in

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

Signature: ERMOCRATES E. CASTILLO

es E

Castillo

2021.02.1

5 17:08:37

PROJECT NAME: 05'00'

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024


SHEET NAME
STRUCTURAL
ATTACHMENT
CALCULATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

S-02.1

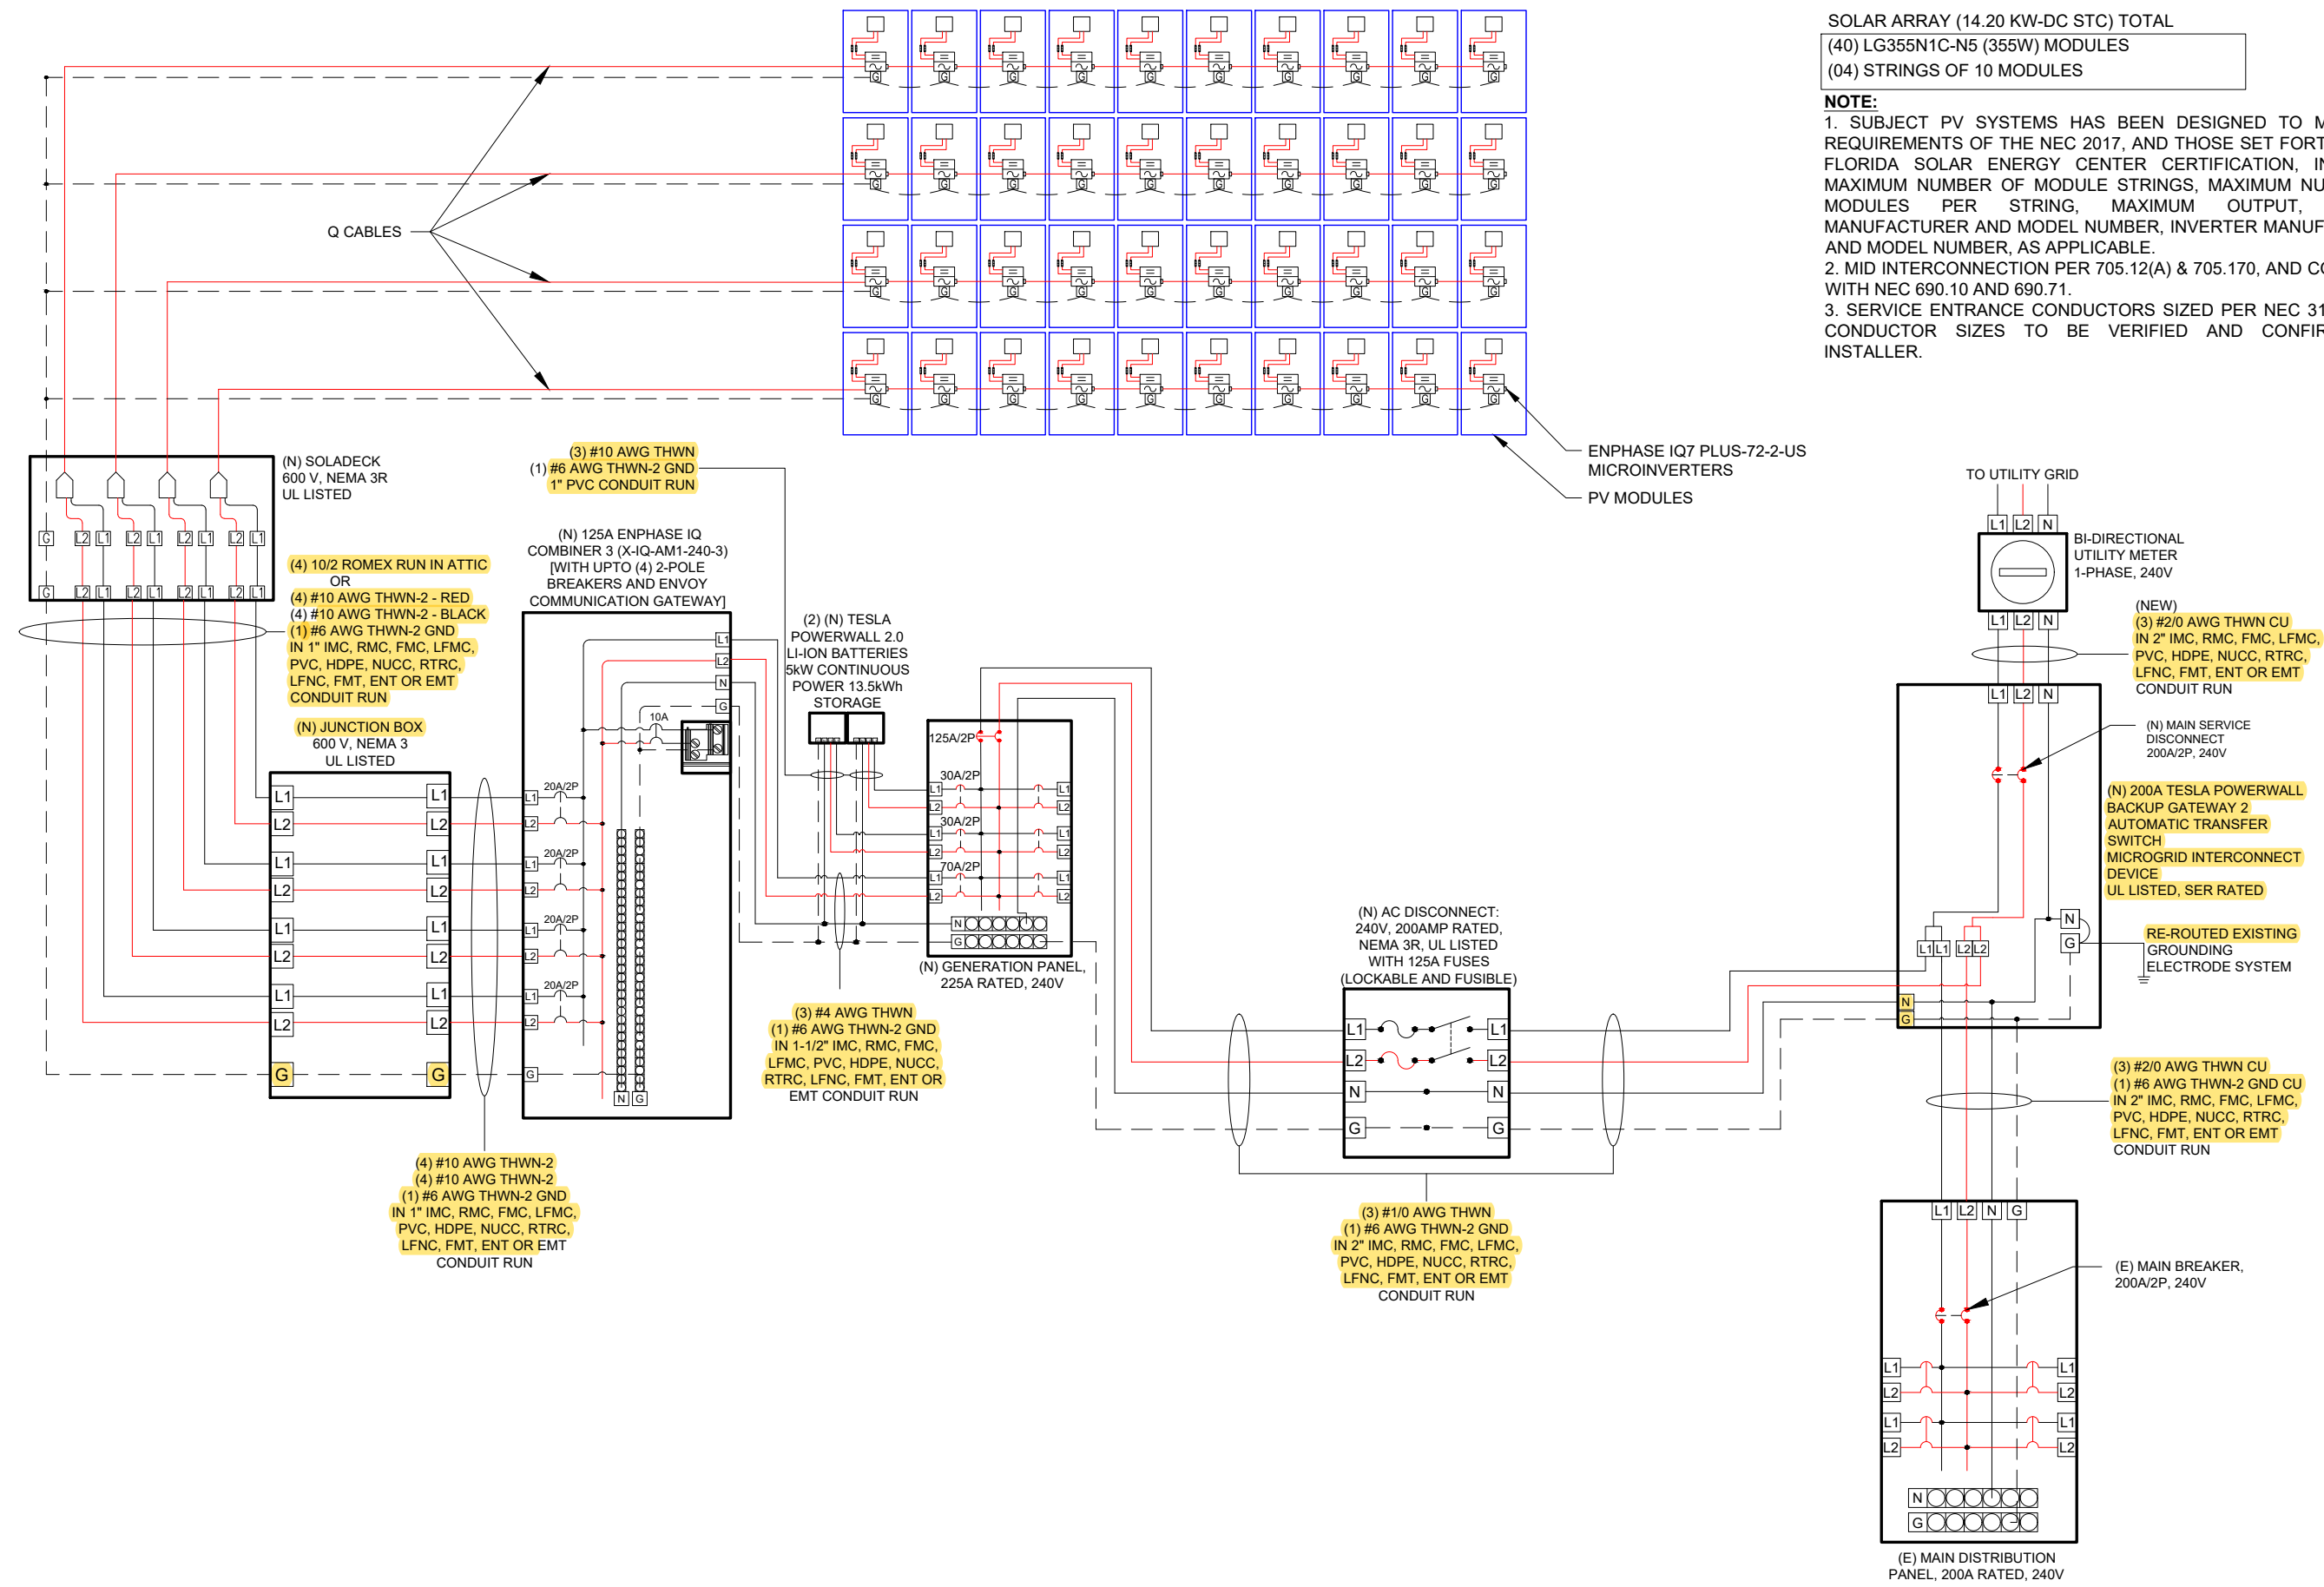

SOLAR ARRAY (14.20 KW-DC STC) TOTAL

(40) LG355N1C-N5 (355W) MODULES

(04) STRINGS OF 10 MODULES

NOTE:

1. SUBJECT PV SYSTEMS HAS BEEN DESIGNED TO MEET THE REQUIREMENTS OF THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION, INCLUDING MAXIMUM NUMBER OF MODULE STRINGS, MAXIMUM NUMBER OF MODULES PER STRING, MAXIMUM OUTPUT, MODULE MANUFACTURER AND MODEL NUMBER, INVERTER MANUFACTURER AND MODEL NUMBER, AS APPLICABLE.
2. MID INTERCONNECTION PER 705.12(A) & 705.170, AND COMPLIANT WITH NEC 690.10 AND 690.71.
3. SERVICE ENTRANCE CONDUCTORS SIZED PER NEC 310.15(B)(7). CONDUCTOR SIZES TO BE VERIFIED AND CONFIRMED BY INSTALLER.

ENPHASE IQ7 PLUS-72-2-US
MICROINVERTERS
PV MODULES

TO UTILITY GRID

BI-DIRECTIONAL
UTILITY METER
1-PHASE, 240V

(NEW)
(3) #2/0 AWG THWN CU
IN 2" IMC, RMC, FMC, LFMC,
PVC, HDPE, NUCC, RTRC,
LFNC, FMT, ENT OR EMT
CONDUIT RUN

(N) MAIN SERVICE
DISCONNECT
200A/2P, 240V

(N) 200A TESLA POWERWALL
BACKUP GATEWAY 2
AUTOMATIC TRANSFER
SWITCH
MICROGRID INTERCONNECT
DEVICE
UL LISTED, SER RATED

RE-ROUTED EXISTING
GROUNDING
ELECTRODE SYSTEM

(3) #2/0 AWG THWN CU
(1) #6 AWG THWN-2 GND CU
IN 2" IMC, RMC, FMC, LFMC,
PVC, HDPE, NUCC, RTRC,
LFNC, FMT, ENT OR EMT
CONDUIT RUN

(E) MAIN BREAKER,
200A/2P, 240V

(E) MAIN DISTRIBUTION
PANEL, 200A RATED, 240V

1 | ELECTRICAL LINE DIAGRAM

E-01

SCALE: NTS

Castillo
Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING
SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

es E

Castillo

2021.02.1

5 17:08:44

-05'00'

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME

ELECTRICAL
LINE DIAGRAM

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

E-01

AC CONDUCTOR AMPACITY CALCULATIONS:
FROM ROOF TOP SOLADECK TO COMBINER BOX

Module Manufacturer	LG
Module Model	LG355N1G-N5
Inverter Manufacturer	ENPHASE
Inverter Model	ENPHASE IQ 7 PLUS
Modules/Branch Circuit 1	10
Modules/Branch Circuit 2	10
Modules/Branch Circuit 3	10
Modules/Branch Circuit 4	10
TOTAL ARRAY POWER (kW)	14.20
SYSTEM AC VOLTAGE	240V 1-PHASE

DESIGN TEMPERATURE	
MIN. AMBIENT TEMP. °F	32
MAX. AMBIENT TEMP. °F	117
CALCULATED MAX. VOC	45
CALCULATED MIN VMP	27
CONDUIT FILL	
NUMBER OF CONDUITS	1

AMPACITY CALCULATIONS										
Circuit	Max Amps	1.25 X Max Amps	AWG	90 °C AMPACITY	AMBIENT TEMP °F	TEMP DERATE	CONDUIT FILL	FILL DERATE	DERATED AMPACITY	MAXIMUM CIRCUIT BREAKER
Circuit 1	12.1	15.1	#10	40	95	0.96	8	0.7	26.88	20 A
Circuit 2	12.1	15.1	#10	40	95	0.96	8	0.7	26.88	20 A
Circuit 3	12.1	15.1	#10	40	95	0.96	8	0.7	26.88	20 A
Circuit 4	12.1	15.1	#10	40	95	0.96	8	0.7	26.88	20 A
COMBINER BOX OUTPUT	48.4	60.5	#4	95	95	0.96	3	1	91.2	70 A
TESLA BATTERY 1 OUTPUT	22.0	27.5	#10	40	95	0.96	3	1	38.4	30 A
TESLA BATTERY 2 OUTPUT	22.0	27.5	#10	40	95	0.96	3	1	38.4	30 A
TESLA GATEWAY 2 OUTPUT	92.4	115.5	1/0	170	95	0.96	3	1	163.2	125 A

MAXIMUM CIRCUIT VOLTAGE DROP	2%
------------------------------	----

VOLTAGE DROP CALCULATIONS					
Circuit	AWG	CIRCULAR MILLS	I	V	MAX LENGTH
Circuit 1	#10	10380	12.1	240	160 FEET
Circuit 2	#10	10380	12.1	240	160 FEET
Circuit 3	#10	10380	12.1	240	160 FEET
Circuit 4	#10	10380	12.1	240	160 FEET
COMBINER BOX OUTPUT	#4	41740	48.4	240	160 FEET
TESLA BATTERY 1 OUTPUT	#10	10380	22.0	240	88 FEET
TESLA BATTERY 2 OUTPUT	#10	10380	22.0	240	88 FEET
TESLA GATEWAY 2 OUTPUT	1/0	105600	92.4	240	213 FEET

NOTES	
	TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)
	CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)
	MAXIMUM VOC CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A)
	UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER
	ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE
	IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS
	IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION
	INFORMATION INPUT BY SYSTEM DESIGNER
	INFORMATION OBTAINED FROM MANUFACTURER DATASHEETS

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107.

AC CONDUCTOR AMPACITY CALCULATIONS:
FROM AC COMBINER BOX TO MSP

MODULE PROPERTIES			
VOC	41.5	ISG	10.8
VMPP	34.7	IMP	10.25
TC VOC	-0.26%/°C	TC VMP	-0.34%/°C
PMP	355.0	NOCT	45 °C

INVERTER PROPERTIES	
OUTPUT VOLTAGE	240 L-L 1-PH
MAX INPUT DC VOLTAGE	60 VOC
OPERATING RANGE	16 - 60 VOC
MPPT VOLTAGE RANGE	27 - 45 VOC
START VOLTAGE	22 VOC
MAX INPUT POWER	440 Wdc
CONTINUOUS AC POWER	290 VA

ELECTRICAL NOTES

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
- THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
- THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
- UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
- MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
- RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
- CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
- CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).

ENPHASE IQ7PLUS-72-2-US MICROINVERTER		
Input Data (DC)		
	Recommended Input Power (STC)	235-400W +
	Maximum Input DC Voltage	60V
	Peak Power Tracking Voltage	27V-45V
	Operating Range	16V-60V
	Min. / Max. Start Voltage	22V / 60V
	Max DC Short Circuit Current	15A
Output Data (AC)		
	Maximum Output Power	290W
	Nominal Output Current	1.21A
	Nominal Voltage / Range	240V/211-264V
	Nominal Frequency / Range	60 Hz
	Extended Frequency / Range	47-68 Hz
	Power Factor at rated power	1.0
	Maximum unit per 20A Branch Circuit	13 (240 VAC)



DESIGNED TO PERMIT*

CASTILLO ENGINEERING
SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature of ERMOCRATES E. CASTILLO
2021.02.15 17:08:52
-05'00'

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME

WIRING
CALCULATIONS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

E-02

⚠

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC 690.13(B))

⚠

WARNING

DUAL POWER SOURCE
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(b))

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

LABEL LOCATION:
AC DISCONNECT
(PER CODE: NEC690.56(C)(3))

- ADHESIVE FASTENED SIGNS:
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
 - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].
 - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

SOLAR
BREAKER

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(b))

AC COMBINER BOX

LABEL LOCATION:
COMBINER BOX
(PER CODE: NEC690.52)

PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OPERATING CURRENT 48.40 AMPS

AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC690.54)

WARNING

INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(b))

DATA PER PANEL			
NOMINAL OPERATING AC VOLTAGE -	240	V	
NOMINAL OPERATING AC FREQUENCY-	60	Hz	
MAXIMUM AC POWER-	290	VA	
MAXIMUM AC CURRENT-	1.21	A	
MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION PER CIRCUIT-	20	A	

LABEL LOCATION:
COMBINER BOX
(PER CODE: NEC690.52)

AC DISCONNECT

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC690.54)

PHOTOVOLTAIC
SYSTEM
MICROINVERTERS
LOCATED UNDER EACH
PV MODULE IN
ROOF TOP ARRAY

LABEL LOCATION:
INVERTER
(PER CODE: NEC690.52)

14.20 KW SOLAR
DISCONNECT LOCATED

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC690.54)

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY

SOLAR ELECTRIC
PV PANELS

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC 690.56(C)(1)(a), IFC 605.11.3.1(1)

WARNING:

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(c))

Castillo
Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING
SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature of ERMOCRATES E. CASTILLO

ERMOCRATES E. CASTILLO
2021.02.15 17:09:05
-05'00'

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
SYSTEM LABELING

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
E-03

LG NeON[®]2

360W | 355W | 350W

The LG NeON[®] 2 is one of the most powerful and versatile modules on the market today. Featuring LG's Cello Technology in monocrystalline n-type solar cells, the LG NeON[®] 2 increases power output. Now includes a 25 years product and 90.1% performance warranty for higher performance and reliability. The new LG NeON[®] 2 has been designed with aesthetics in mind using new cell design.



Feature



Enhanced Performance Warranty

LG NeON[®] 2 has an enhanced performance warranty. After 25 years, LG NeON[®] 2 is guaranteed to perform at minimum 90.1% of initial performance.



Enhanced Product warranty

LG has extended the warranty of the NeON[®] 2 to 25 years, which is among the top of industry standards.

About LG Electronics

LG Electronics is a global big player, committed to expanding its operations with the solar market. The company first embarked on a solar energy source research program in 1985, supported by LG Group's vast experience in the semi-conductor, LCD, chemistry and materials industries. In 2010, LG Solar successfully released its first Mono[®] series to the market, which is now available in 32 countries. The NeON[®] (previous Mono[®] NeON), NeON[®]2, NeON[®]2 Bifacial won the "Intersolar AWARD" in 2013, 2015 and 2016, which demonstrates LG Solar's lead, innovation and commitment to the industry.



LG NeON[®]2

LG360N1C-N5 | **LG355N1C-N5** | LG350N1C-N5

General Data

Cell Properties(Material / Type)	Monocrystalline / N-type
Cell Maker	LG
Cell Configuration	60 Cells (6 x 10)
Number of Busbars	12EA
Module Dimensions (L x W x H)	1,700mm x 1,016mm x 40 mm
Weight	18.0 kg
Glass(Material)	Tempered Glass with AR Coating
Backsheet(Color)	White
Frame(Material)	Anodized Aluminium
Junction Box(Protection Degree)	IP 68 with 3 Bypass Diodes
Cables(Length)	1,000 mm x 2EA
Connector(Type / Maker)	MC 4 / MC

Certifications and Warranty

Certifications	IEC 61215-1/-1-1-1/2:2016, IEC 61730-1/2:2016 ISO 9001, ISO 14001, ISO 50001 OHSAS 18001
Salt Mist Corrosion Test	IEC 61701:2012 Severity 6
Ammonia Corrosion Test	IEC 62716 : 2013
Hail Test	25mm (1") diameter at 23 m/s (52 mph)
Fire Rating	Class C (UL 790)
Solar Module Product Warranty	25 Years
Solar Module Output Warranty	Linear Warranty*

* 1) First year : 98% 2) After 1st year : 0.33% annual degradation, 3) 90.1% for 25 years

Temperature Characteristics


NMOT [†]	[°C]	42 ± 3
Pmax	[%/°C]	-0.34
Voc	[%/°C]	-0.26
Isc	[%/°C]	0.03

* NMOT (Nominal Module Operating Temperature): Irradiance 800 W/m², Ambient temperature 20 °C, Wind speed 1 m/s, Spectrum AM 1.5

Electrical Properties (NMOT)

Model		LG360N1C-N5	LG355N1C-N5	LG350N1C-N5
Maximum Power (Pmax)	[W]	270	266	263
MPP Voltage (Vmpp)	[V]	33.0	32.6	32.2
MPP Current (Impp)	[A]	8.20	8.17	8.15
Open Circuit Voltage (Voc)	[V]	39.2	39.1	39.0
Short Circuit Current (Isc)	[A]	8.71	8.68	8.64

I-V Curves

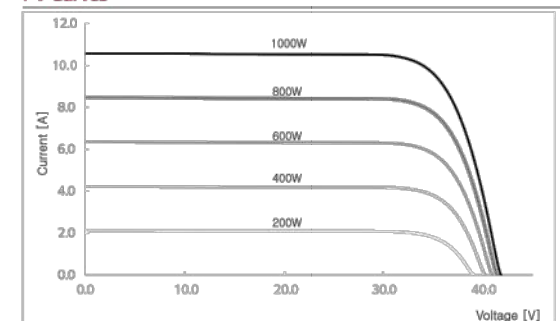

Electrical Properties (STC*)

Model		LG360N1C-N5	LG355N1C-N5	LG350N1C-N5
Maximum Power (Pmax)	[W]	360	355	350
MPP Voltage (Vmpp)	[V]	35.1	34.7	34.3
MPP Current (Impp)	[A]	10.28	10.25	10.22
Open Circuit Voltage(Voc, ± 5%)	[V]	41.6	41.5	41.4
Short Circuit Current(Isc, ± 5%)	[A]	10.84	10.80	10.76
Module Efficiency	[%]	20.8	20.6	20.3
Power Tolerance	[%]	0 ~ +3		

* STC (Standard Test Condition): Irradiance 1000 W/m², Cell temperature 25 °C, AM 1.5, Measurement Tolerance of Pmax : ± 3%

Operating Conditions


Operating Temperature	[°C]	-40 ~ +90
Maximum System Voltage	[V]	1000(IEC)
Maximum Series Fuse Rating	[A]	20
Mechanical Test Load [†] (Front)	[Pa / psf]	5,400 / 113
Mechanical Test Load [†] (Rear)	[Pa / psf]	4,000 / 84

* Based on IEC 61215-2 : 2016 (Test Load = Design Load x Safety Factor(1.5))
† Mechanical Test Loads 6,000Pa / 5,400Pa based on IEC 612152005

Packaging Configuration

Number of Modules per Pallet	[EA]	25
Number of Modules per 40ft HQ Container	[EA]	650
Packaging Box Dimensions (L x W x H)	[mm]	1,750 x 1,120 x 1,221
Packaging Box Gross Weight	[kg]	464

Dimensions (mm / inch)

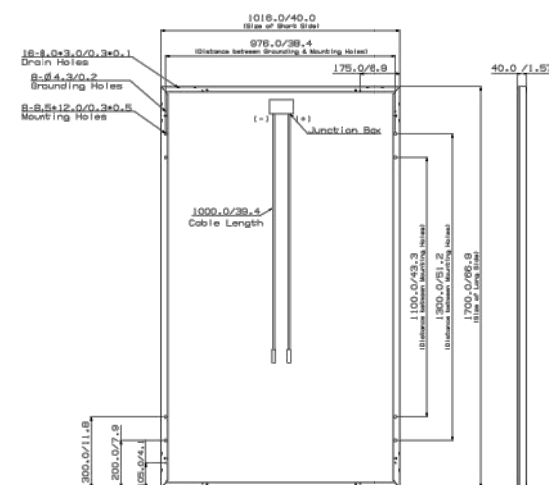

Castillo Engineering

DESIGNED TO PERMIT

CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
MODULE
DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
DS-01



LG Electronics Inc.
Energy Business Division
LG Twin Towers, 128 Yeoul-daero, Yeongdeungpo-gu, Seoul
07336, Korea
www.lg-solar.com

Product specifications are subject to change without notice.
DS-N5-60-C-G-F-EN-200507

© 2020 LG Electronics. All rights reserved.





LG Electronics U.S.A., Inc.
111 Sylvan Avenue
Englewood Cliffs, NJ 07632
201.816.2000

Friday, February 5, 2021

RE: Mechanical Load Testing to Determine Structural Performance under Uniform Static Pressure

To: Castillo Engineering,


Upon your request we have conducted in house tests to determine the structural performance of the LG Module frames listed below. Our test results meet the requirements you presented in our conference call on January 29th. We will present the test criteria, results, and product limitations that may result from these test conditions in this letter.

The specifications and conditions presented in this letter apply retroactively to the following LG module(s);

	2 Rails	3 Rails
Front	9,000Pa	9,000Pa
Rear	6,350Pa	9,000Pa
Model	LGxxxN1C(K)-N5(L5), LGxxxN1C(K)-A6(B6) LGxxxQ1C(K)-V5, LGxxxQ1C(K)-A6	

*The result is based on test load.

Our R&D department has tested these modules to determine the structural performance of under uniform static loading to represent the effects of a wind load on the module. This test was designed only to determine structural performance; the revised specifications apply only to the mechanical performance of the module. *A safety factor of 1.5 should be applied to these test loads for obtaining design loads. It is not recommend designing any system to the full test load.*

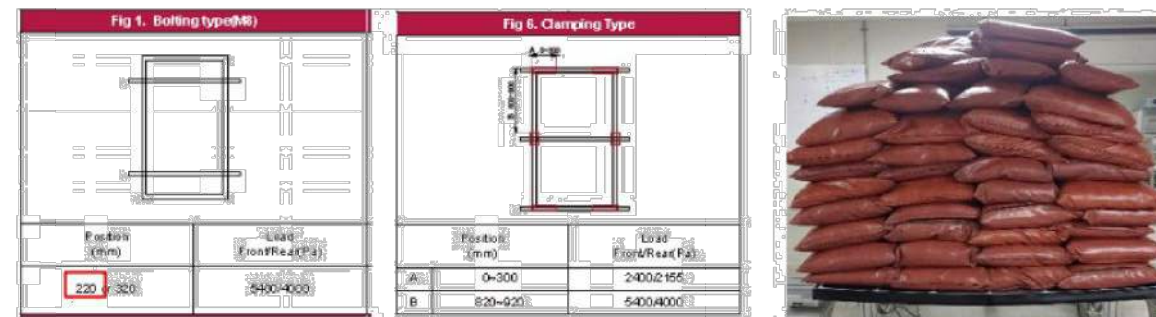

The scope of this test does not include electrical functionality or performance testing. Subjecting the module to these pressures may result in power degradation or total power loss. The electrical function and power generation warranties and specifications of these products are not altered by this document.

If you have any additional questions or concerns about this letter or the test protocol, contact your LG Solar Sales Representative.

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

PROJECT NAME

MIRRA RESIDENCE
793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME

TEST LETTER
DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-01.1

Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate seamlessly with the Enphase IQ Envoy™, Enphase Q Aggregator™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.

Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

Productive and Reliable

- Optimized for high powered 60-cell and 72-cell* modules
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

* The IQ 7+ Micro is required to support 72-cell modules.



To learn more about Enphase offerings, visit enphase.com



Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2-US	
Commonly used module pairings ¹	235 W - 350 W +		235 W - 440 W +	
Module compatibility	60-cell PV modules only		60-cell and 72-cell PV modules	
Maximum input DC voltage	48 V		60 V	
Peak power tracking voltage	27 V - 37 V		27 V - 45 V	
Operating range	16 V - 48 V		16 V - 60 V	
Min/Max start voltage	22 V / 48 V		22 V / 60 V	
Max DC short circuit current (module Isc)	15 A		15 A	
Overvoltage class DC port	II		II	
DC port backfeed current	0 A		0 A	
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit			
OUTPUT DATA (AC)	IQ 7 Microinverter		IQ 7+ Microinverter	
Peak output power	250 VA		295 VA	
Maximum continuous output power	240 VA		290 VA	
Nominal (L-L) voltage/range ²	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V
Maximum continuous output current	1.0 A	1.15 A	1.21 A	1.39 A
Nominal frequency	60 Hz		60 Hz	
Extended frequency range	47 - 68 Hz		47 - 68 Hz	
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms	
Maximum units per 20 A (L-L) branch circuit ³	16 (240 VAC) 13 (208 VAC)		13 (240 VAC) 11 (208 VAC)	
Overvoltage class AC port	III		III	
AC port backfeed current	0 A		0 A	
Power factor setting	1.0		1.0	
Power factor (adjustable)	0.7 leading ... 0.7 lagging		0.7 leading ... 0.7 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V
Peak CEC efficiency	97.6 %	97.6 %	97.5 %	97.3 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %
MECHANICAL DATA	IQ 7 Microinverter			
Ambient temperature range	-40°C to +65°C			
Relative humidity range	4% to 100% (condensing)			
Connector type	MC4 (or Amphenol F-4 UTX with additional Q-DCC-5 adapter)			
Dimensions (WxHxD)	212 mm x 175 mm x 30.2 mm (without bracket)			
Weight	1.08 kg (2.38 lbs)			
Cooling	Natural convection - No fans			
Approved for wet locations	Yes			
Pollution degree	PD3			
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure			
Environmental category / UV exposure rating	NEMA Type 6 / outdoor			
FEATURES				
Communication	Power Line Communication (PLC)			
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.			
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.			

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.
2. Nominal voltage range can be extended beyond nominal if required by the utility.
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.
2018-02-08



REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME

INVERTER
DATA SHEET

SHEET SIZE


ANSI B
11" X 17"

SHEET NUMBER

DS-02

Enphase
IQ Combiner 3
(X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

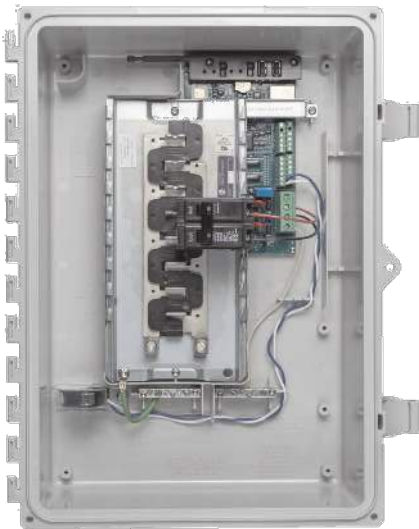

Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year warranty
- UL listed



To learn more about Enphase offerings, visit enphase.com



Enphase IQ Combiner 3

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (not included, order separately)	
Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (5,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)
COMPLIANCE	
Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1
* Consumption monitoring is required for Enphase Storage Systems.	

To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner.
2018-09-13



REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
COMBINER BOX
DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
DS-03

SolarMount Technical Datasheet

Pub 100602-1td V1.0 June 2010

SolarMount Module Connection Hardware 1

 Bottom Up Module Clip..... 1

 Mid Clamp 2

 End Clamp..... 2


SolarMount Beam Connection Hardware..... 3

 L-Foot..... 3


SolarMount Beams 4

SolarMount Module Connection Hardware

SolarMount Bottom Up Module Clip
Part No. 321001, 321002

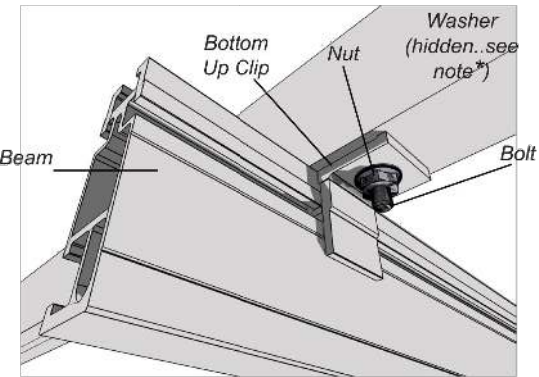


- **Bottom Up Clip material:** One of the following extruded aluminum alloys: 6005-T5, 6105-T5, 6061-T6
- **Ultimate tensile:** 38ksi, Yield: 35 ksi
- **Finish:** Clear Anodized
- **Bottom Up Clip weight:** ~0.031 lbs (14g)
- Allowable and design loads are valid when components are assembled with SolarMount series beams according to authorized UNIRAC documents
- Assemble with one ¼"-20 ASTM F593 bolt, one ¼"-20 ASTM F594 serrated flange nut, and one ¼" flat washer
- Use anti-seize and tighten to 10 ft-lbs of torque
- Resistance factors and safety factors are determined according to part 1 section 9 of the 2005 Aluminum Design Manual and third-party test results from an IAS accredited laboratory
- Module edge must be fully supported by the beam
- * **NOTE ON WASHER:** Install washer on bolt head side of assembly. **DO NOT** install washer under serrated flange nut




Dimensions specified in inches unless noted

Applied Load Direction	Average Ultimate lbs (N)	Allowable Load lbs (N)	Safety Factor, FS	Design Load lbs (N)	Resistance Factor, Φ
Tension, Y+	1566 (6967)	686 (3052)	2.28	1038 (4615)	0.662
Transverse, X±	1128 (5019)	329 (1463)	3.43	497 (2213)	0.441
Sliding, Z±	66 (292)	27 (119)	2.44	41 (181)	0.619

SolarMount Mid Clamp
Part No. 320008, 320009, 320019, 320020, 320021, 320084, 320085, 320086, 320087, 320120, 320122

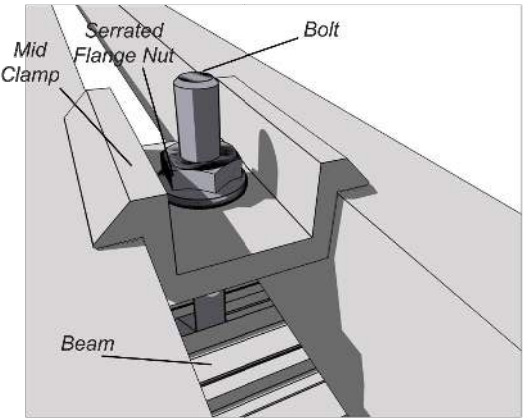


- **Mid clamp material:** One of the following extruded aluminum alloys: 6005-T5, 6105-T5, 6061-T6
- **Ultimate tensile:** 38ksi, Yield: 35 ksi
- **Finish:** Clear or Dark Anodized
- **Mid clamp weight:** 0.050 lbs (23g)
- Allowable and design loads are valid when components are assembled according to authorized UNIRAC documents
- Values represent the allowable and design load capacity of a single mid clamp assembly when used with a SolarMount series beam to retain a module in the direction indicated
- Assemble mid clamp with one Unirac ¼"-20 T-bolt and one ¼"-20 ASTM F594 serrated flange nut
- Use anti-seize and tighten to 10 ft-lbs of torque
- Resistance factors and safety factors are determined according to part 1 section 9 of the 2005 Aluminum Design Manual and third-party test results from an IAS accredited laboratory

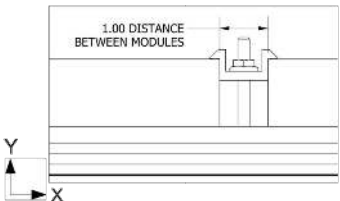


Dimensions specified in inches unless noted

Applied Load Direction	Average Ultimate lbs (N)	Allowable Load lbs (N)	Safety Factor, FS	Design Load lbs (N)	Resistance Factor, Φ
Tension, Y+	2020 (8987)	891 (3963)	2.27	1348 (5994)	0.667
Transverse, Z±	520 (2313)	229 (1017)	2.27	346 (1539)	0.665
Sliding, X±	1194 (5312)	490 (2179)	2.44	741 (3295)	0.620

SolarMount End Clamp
Part No. 320002, 320003, 320004, 320005, 320006, 320012, 320013, 320014, 320015, 320016, 320017, 320079, 320080, 320081, 320082, 320083, 320117, 320118, 320123, 320124, 320173, 320185, 320220, 320233, 320234, 320331

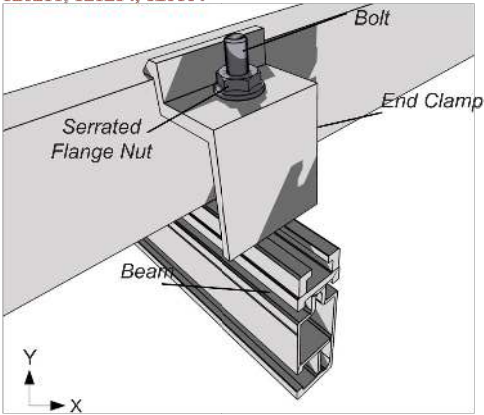

- **End clamp material:** One of the following extruded aluminum alloys: 6005-T5, 6105-T5, 6061-T6
- **Ultimate tensile:** 38ksi, Yield: 35 ksi
- **Finish:** Clear or Dark Anodized
- **End clamp weight:** varies based on height: ~0.058 lbs (26g)
- Allowable and design loads are valid when components are assembled according to authorized UNIRAC documents
- Values represent the allowable and design load capacity of a single end clamp assembly when used with a SolarMount series beam to retain a module in the direction indicated
- Assemble with one Unirac ¼"-20 T-bolt and one ¼"-20 ASTM F594 serrated flange nut
- Use anti-seize and tighten to 10 ft-lbs of torque
- Resistance factors and safety factors are determined according to part 1 section 9 of the 2005 Aluminum Design Manual and third-party test results from an IAS accredited laboratory
- Modules must be installed at least 1.5 in from either end of a beam



Dimensions specified in inches unless noted

Applied Load Direction	Average Ultimate lbs (N)	Allowable Load lbs (N)	Safety Factor, FS	Design Loads lbs (N)	Resistance Factor, Φ
Tension, Y+	1321 (5876)	529 (2352)	2.50	800 (3557)	0.605
Transverse, Z±	63 (279)	14 (61)	4.58	21 (92)	0.330
Sliding, X±	142 (630)	52 (231)	2.72	79 (349)	0.555

DESIGNED TO PERMIT

CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME

RAIL
DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-04

FLASH LOC



FLASHLOC is the ultimate attachment for composition shingle and rolled comp roofs. The all-in-one mount installs fast — no kneeling on hot roofs to install flashing, no prying or cutting shingles, no pulling nails. Simply drive the lag bolt and inject sealant into the base. **FLASHLOC's** patented **TRIPLE SEAL** technology preserves the roof and protects the penetration with a permanent pressure seal. Kitted with lag bolts, sealant, and hardware for maximum convenience. Don't just divert water, **LOC it out!**




#UNIRAC
25 YEAR
FULL-SYSTEM
WARRANTY

TESTED TO TAS-100
WIND DRIVEN RAIN TEST
AND UL441 RAIN TEST



PROTECT THE ROOF

Install a high-strength waterproof attachment without lifting, prying or damaging shingles.

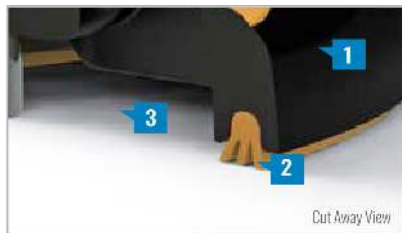

LOC OUT WATER

With an outer shield **1**, contour-conforming gasket **2** and pressurized sealant chamber **3** the Triple Seal technology delivers a 100% waterproof connection.



HIGH-SPEED INSTALL

Simply drive lag bolt and inject sealant into the port **4** to create a permanent pressure seal.

FASTER INSTALLATION. 25-YEAR WARRANTY.

FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR CALL (505) 248-2702

FLASH LOC

INSTALLATION GUIDE



PRE-INSTALL

Snap chalk lines for attachment rows. On shingle roofs, snap lines 1-3/4" below upslope edge of shingle course. Locate rafters and mark attachment locations.

At each location, drill a 7/32" pilot hole. Clean roof surface of dirt, debris, snow, and ice. Next, BACKFILL ALL PILOT HOLES WITH SEALANT.

NOTE: Space mounts per racking system install specifications.



STEP 1: SECURE

Place **FLASHLOC** over pilot hole with lag on down-slope side. Align indicator marks on sides of mount with chalk line. Pass included lag bolt and sealing washer through **FLASHLOC** into pilot hole. Drive lag bolt until mount is held firmly in place.

NOTE: The EPDM in the sealing washer will expand beyond the edge of the metal washer when proper torque is applied.



STEP 2: SEAL

Insert tip of UNIRAC provided sealant into port. Inject until sealant exits both vents.

Continue array installation, attaching rails to mounts with provided T-bolts.



NOTE: When **FLASHLOC** is installed over gap between shingle tabs or vertical joints, fill gap/joint with sealant between mount and upslope edge of shingle course.

NOTE: When installing included rail attachment hardware, torque nut to 30 ft/lbs.

USE ONLY UNIRAC APPROVED SEALANTS: Chemlink Duralink 50 (Included in kit) or Chemlink M-1

FASTER INSTALLATION. 25-YEAR WARRANTY.

FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR CALL (505) 248-2702



DESIGNED TO PERMIT

CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Signature with Seal

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
**ATTACHMENT
DATA SHEET**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
DS-05

POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy	14 kWh
Usable Energy	13.5 kWh
Real Power, max continuous	5 kW (charge and discharge)
Real Power, peak (10 s, off-grid/backup)	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10 s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	+/- 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency ^{1,3}	90%
Warranty	10 years

¹Values provided for 25°C (77°F), 3.3 kW charge/discharge power.
²In Backup mode, grid charge power is limited to 3.3 kW.
³AC to battery to AC, at beginning of life.


COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973, UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)

MECHANICAL SPECIFICATIONS

Dimensions ¹	1150 mm x 755 mm x 147 mm (45.3 in x 29.6 in x 5.75 in)
Weight ¹	114 kg (251.3 lbs)
Mounting options	Floor or wall mount

¹Dimensions and weight differ slightly if manufactured before March 2019. Contact Tesla for additional information.

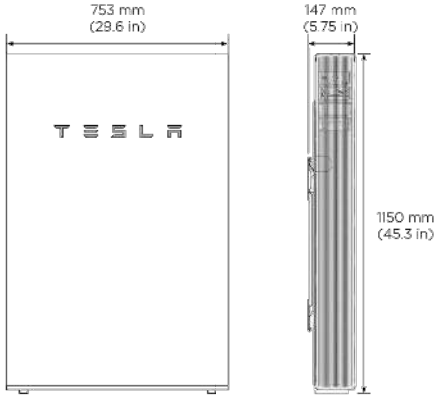

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Recommended Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F) Up to 95% RH, non-condensing State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)

POWERWALL
Backup Gateway 2

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA ¹
Overcurrent Protection Device	100-200A; Service Entrance Rated ¹
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) ²
User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, backup, and off-grid
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years


¹When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.
²The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount, Semi-flush mount

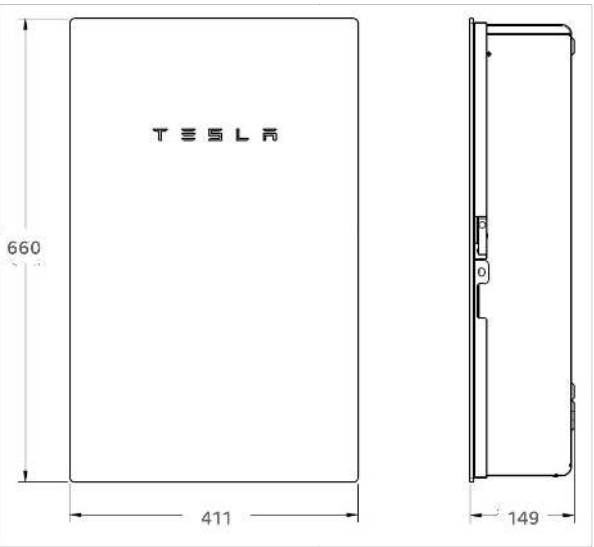

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

Castillo
Engineering

DESIGNED TO PERMIT*

CASTILLO ENGINEERING
SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

MIRRA RESIDENCE

793 SW NAUTILUS RD,
LAKE CITY, FL 32024

SHEET NAME
BATTERY &
GATEWAY
DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
DS-06