

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



COA #0 278
09/15/2020

Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com


Site Information:	Page 1:
Customer: Seminole Trusses, Inc.	Job Number: b51385aa
Job Description: -terrell floor plan Trademark Const Group	
Address: LAKE CITY, FL	

Job Engineering Criteria:			
Design Code: FBC 2017 RES		IntelliVIEW Version: 18.02.01A	
		JRef #: 1WYP8570001	
Wind Standard: ASCE 7-10	Wind Speed (mph): 130	Roof Load (psf): 20.00- 7.00- 0.00-10.00	
Building Type: Closed		Floor Load (psf): None	

This package contains general notes pages, 83 truss drawing(s) and 8 detail(s).

Item	Drawing Number	Truss
1	259.20.0954.19973	CJ10
3	259.20.1000.07680	CJ2A
5	259.20.1000.10080	CJ2C
7	259.20.1000.12483	CJ4B
9	259.20.1000.15080	CJ6A
11	259.20.1000.17457	CJ8A
13	259.20.1000.20590	CJG4A
15	259.20.1000.33967	EJ8
17	259.20.1000.37217	GE1
19	259.20.1000.40420	H10A
21	259.20.1000.43337	H12A
23	259.20.1000.51313	H18A
25	259.20.1001.15750	HG19A
27	259.20.1001.19763	HG8A
29	259.20.0956.06200	HJ11A
31	259.20.0956.56127	HJ6
33	259.20.0957.32980	MH1
35	259.20.0957.53000	MH3
37	259.20.1003.36530	MHG2
39	259.20.1003.42170	S1
41	259.20.1003.44933	S3
43	259.20.1003.49310	SG2
45	259.20.0952.10980	T-10
47	259.20.0952.14173	T-12
49	259.20.0952.18300	T-14
51	259.20.1003.52290	T-16

Item	Drawing Number	Truss
2	259.20.0954.21673	CJ2
4	259.20.1000.08957	CJ2B
6	259.20.1000.11263	CJ4A
8	259.20.1000.13773	CJ6
10	259.20.1000.16283	CJ8
12	259.20.1000.18950	CJG4
14	259.20.1000.22450	EJ4
16	259.20.1000.35430	EJ8A
18	259.20.1000.38943	H0A
20	259.20.1000.41943	H10B
22	259.20.1000.45703	H16A
24	259.20.1000.53570	H7A
26	259.20.1001.17690	HG4A
28	259.20.0955.09213	HJ11
30	259.20.0956.53520	HJ3
32	259.20.0956.57487	HJ6A
34	259.20.0957.36650	MH2
36	259.20.1003.33177	MHG1
38	259.20.1003.40380	MHG3
40	259.20.1003.43473	S2
42	259.20.1003.47010	SG1
44	259.20.0952.08280	T-1
46	259.20.0952.12620	T-11
48	259.20.0952.16303	T-13
50	259.20.0952.20370	T-15
52	259.20.1003.55667	T-17

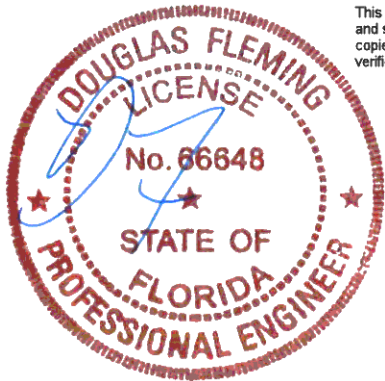

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com

COA #0 278
09/15/2020

Site Information:	Page 2:
Customer: Seminole Trusses, Inc.	Job Number: b51385aa
Job Description: -terrell floor plan Trademark Const Group	
Address: LAKE CITY, FL	

Item	Drawing Number	Truss
53	259.20.1003.59333	T-18
55	259.20.1004.04213	T-2
57	259.20.0952.32133	T-21
59	259.20.1004.09010	T-23
61	259.20.1004.12557	T-25
63	259.20.1004.19380	T-27
65	259.20.0958.08773	T-29
67	259.20.0958.13110	T-30
69	259.20.0958.20883	T-32
71	259.20.0958.43487	T-34
73	259.20.0958.47337	T-36
75	259.20.0958.51703	T-38
77	259.20.0959.26437	T-5
79	259.20.0959.39700	T-7
81	259.20.0959.59100	T-9
83	259.20.0954.17833	CJ4
85	PB180160118	
87	PB160101014	
89	CNNAILSP1014	
91	GBLLETIN0118	

Item	Drawing Number	Truss
54	259.20.1004.02190	T-19
56	259.20.1004.06017	T-20
58	259.20.0953.54987	T-22
60	259.20.1004.10523	T-24
62	259.20.1004.15400	T-26
64	259.20.1004.21480	T-28
66	259.20.0958.11013	T-3
68	259.20.0958.17357	T-31
70	259.20.0958.41857	T-33
72	259.20.0958.44917	T-35
74	259.20.0958.49987	T-37
76	259.20.0959.24297	T-4
78	259.20.0959.28533	T-6
80	259.20.0959.42830	T-8
82	259.20.1000.05767	TG-1
84	PB160160118	
86	REPCHRD1014	
88	BRCLBSUB0119	
90	A14015ENC101014	

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 514 Earth City Expressway, Suite 242, Earth City, MO 63045; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpinst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcindustry.com.

SEQN: 65863 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ10	Cust: R 857 JRef: 1WYP8570001 T33 DrwNo: 259.20.0954.19973 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

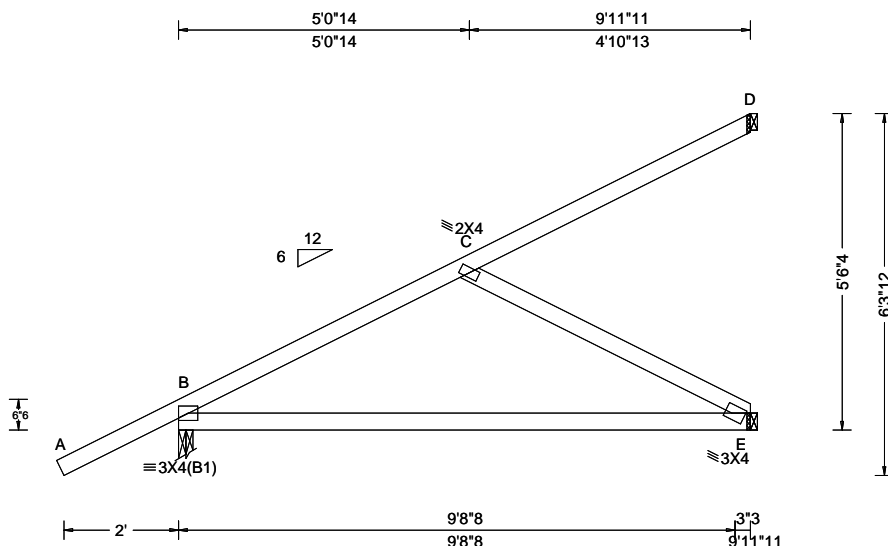

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): -0.006 C 999 360 VERT(CL): -0.019 C 999 240 HORZ(LL): -0.005 E - - HORZ(TL): 0.015 E - - Creep Factor: 2.0 Max TC CSI: 0.681 Max BC CSI: 0.388 Max Web CSI: 0.224 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 515 /- /- /297 /133 /139 E 252 /- /- /172 /86 /- D 112 /- /- /53 /60 /- Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP SS Dense;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	9.97
BC	75	0.17	9.81

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

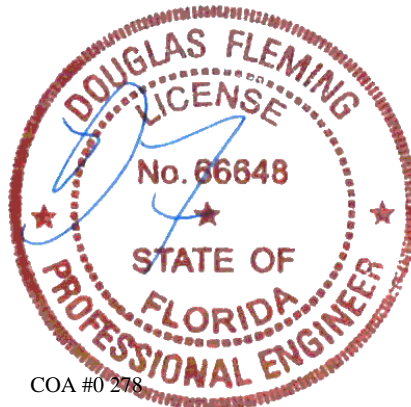

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65864 FROM: RNB	JACK Ply: 1 Qty: 14	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ2	Cust: R 857 JRef: 1WYP8570001 T16 DrwNo: 259.20.0954.21673 SSB / DF 09/15/2020
--------------------------	---------------------------	---	--

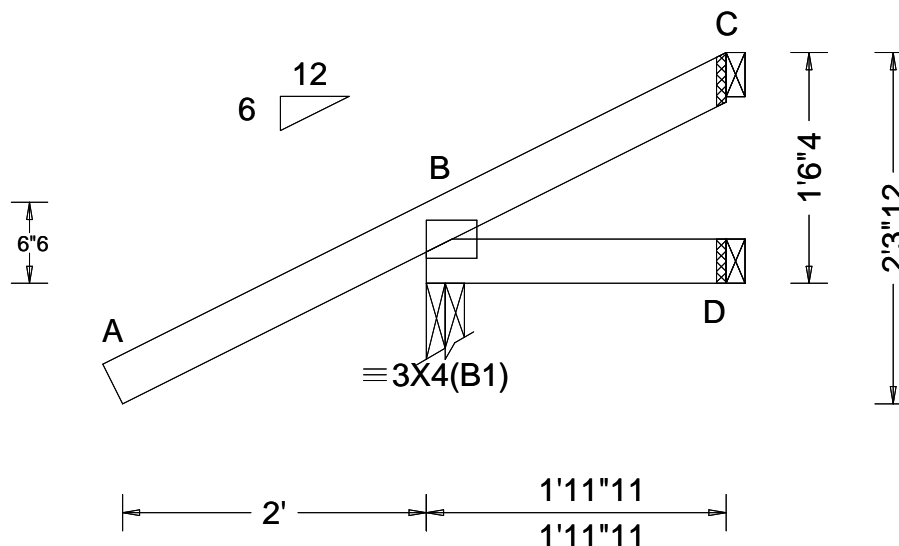

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.410 Max BC CSI: 0.057 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 276 /- /- /171 /89 /44 D 32 /- /- /16 /6 /- C - /-7 /- /25 /25 /- Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	54	-2.07	1.97
BC	22	0.17	1.97

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

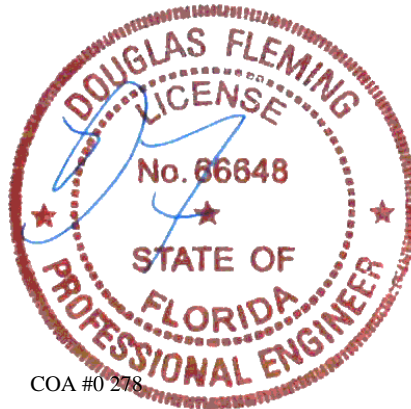

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65865 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ2A	Cust: R 857 JRef: 1WYP8570001 T36 DrwNo: 259.20.1000.07680 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

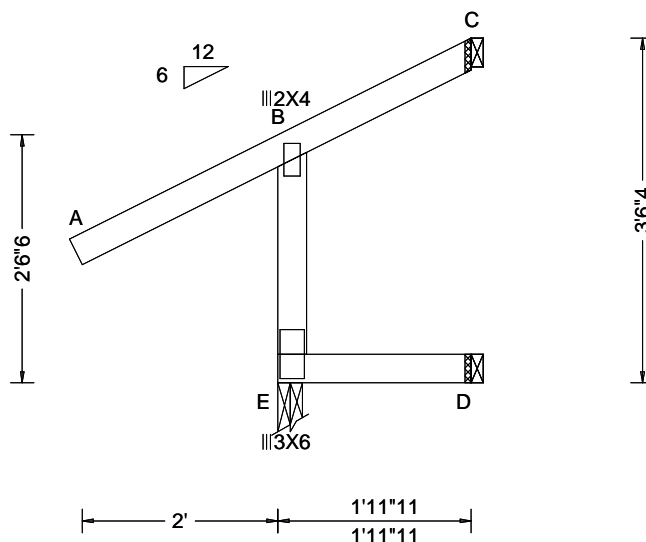

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 B 999 360 VERT(CL): 0.001 B 999 240 HORZ(LL): -0.000 B - - HORZ(TL): 0.001 B - - Creep Factor: 2.0 Max TC CSI: 0.244 Max BC CSI: 0.033 Max Web CSI: 0.157 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL E 264 /- /- /192 /115 /- D 39 /- /- /20 /- /21 C - /-10 /- /32 /47 /62 Wind reactions based on MWFRS E Brg Width = 3.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing E Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	54	-2.07	1.97
BC	24	0.00	1.97

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/180.

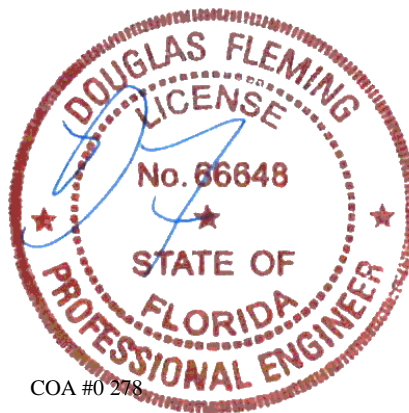

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65866 FROM: RNB	JACK Ply: 1 Qty: 2	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ2B	Cust: R 857 JRef: 1WYP8570001 T60 DrwNo: 259.20.1000.08957 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

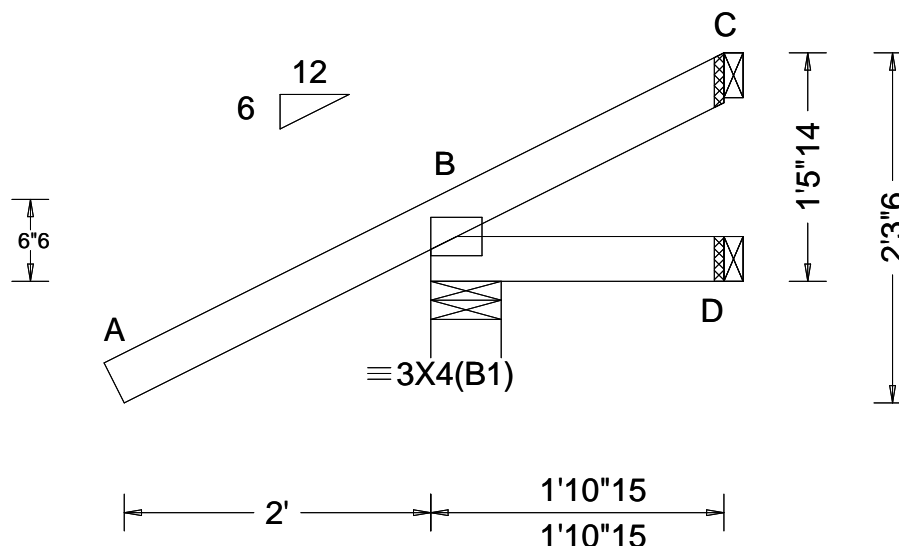

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.410 Max BC CSI: 0.057 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 276 /- /- /171 /90 /43 D 30 /- /- /15 /7 /- C - /-11 /- /26 /26 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	53	-2.07	1.91
BC	21	0.17	1.91

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

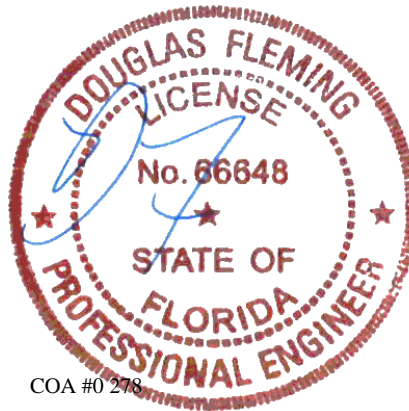

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65867 FROM: RNB	JACK Ply: 1 Qty: 2	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ2C	Cust: R 857 JRef: 1WYP8570001 T10 DrwNo: 259.20.1000.10080 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

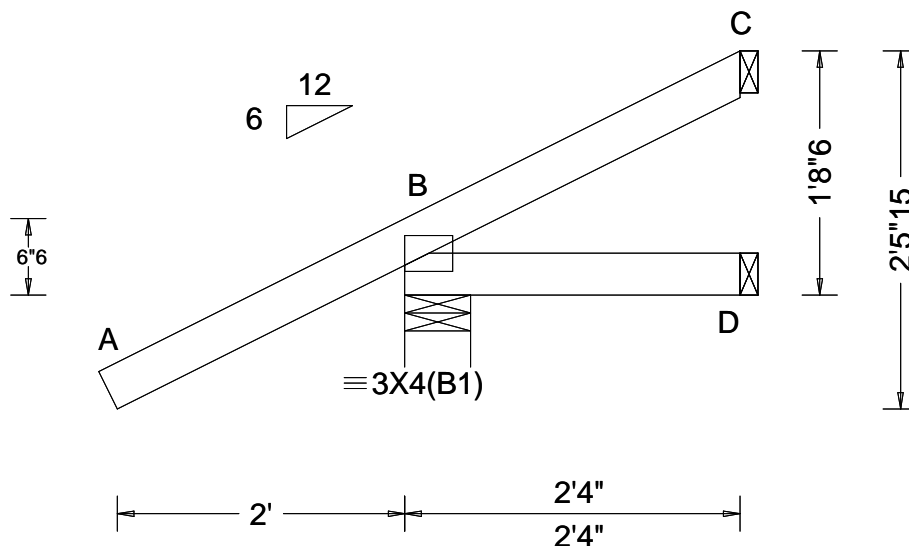

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.410 Max BC CSI: 0.060 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 277 /- /- /170 /85 /48 D 39 /- /- /20 /6 /- C 13 /- /- /20 /20 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	59	-2.07	2.33
BC	26	0.17	2.33

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

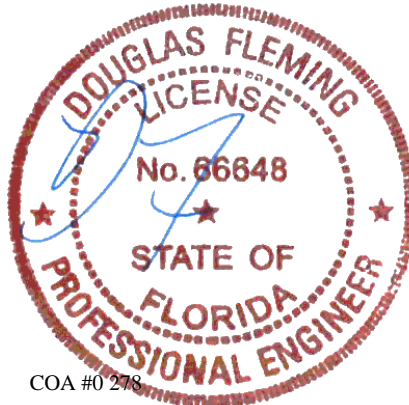

COA #0 278

09/15/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

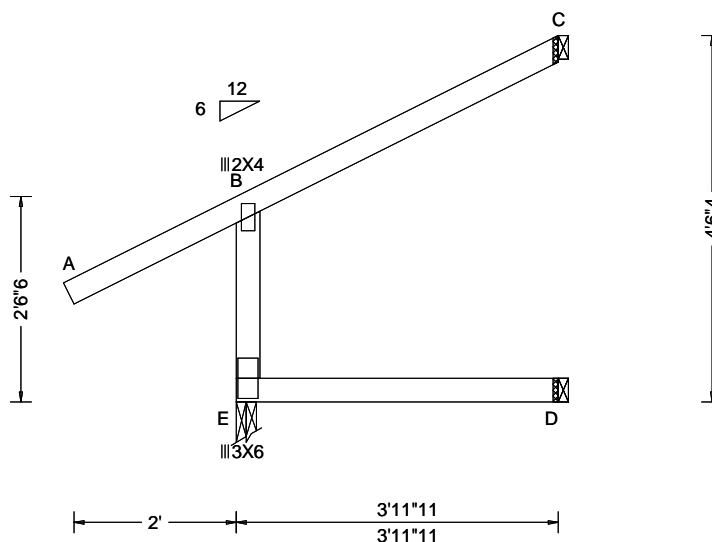

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Non-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 B 999 360	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.001 B 999 240	E 307 /- /- /215 /132 /-
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 B - -	D 79 /- /- /40 /- /21
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.001 B - -	C 78 /- /- /33 /32 /86
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.257	E Brg Width = 3.0 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.144	D Brg Width = 1.5 Min Req = -
Spacing: 24.0 "	MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes	Max Web CSI: 0.167	C Brg Width = 1.5 Min Req = -
	C&C Dist a: 3.00 ft	FT/RT:20(0)/0(0)		Bearing E Fcperp = 425psi.
	Loc. from endwall: not in 9.00 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE		
	Wind Duration: 1.60		VIEW Ver: 18.02.01A.0205.19	

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	3.97
BC	48	0.00	3.97

Apply purlins to any chords above or below fillers
at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets $L/180$.

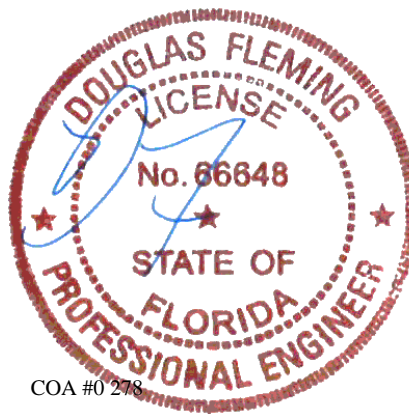

COA #0 278
09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65869 FROM: RNB	JACK Ply: 1 Qty: 5	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ4B	Cust: R 857 JRef: 1WYP8570001 T69 DrwNo: 259.20.1000.12483 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

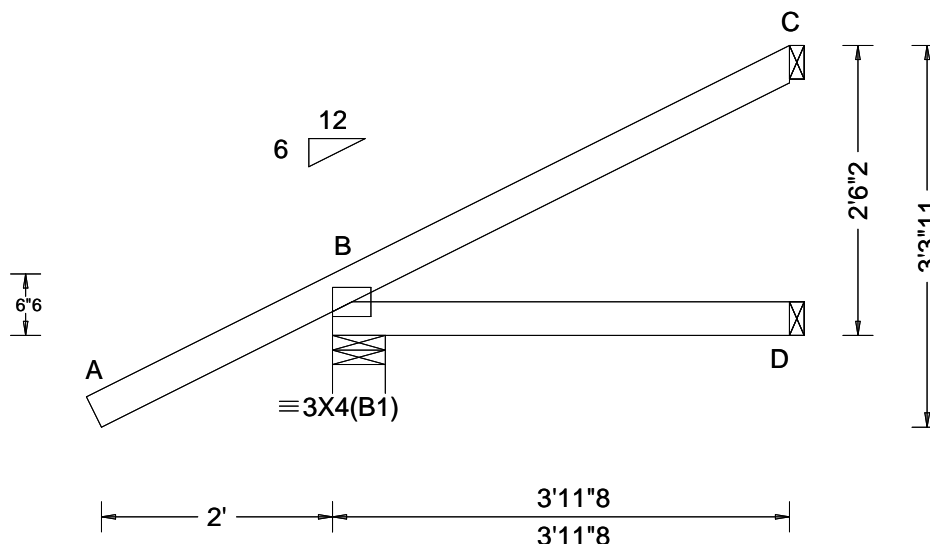

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.002 D - - HORZ(TL): 0.002 D - - Creep Factor: 2.0 Max TC CSI: 0.244 Max BC CSI: 0.115 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 313 - / - /187 /80 /48 D 71 - / - /37 /4 /- C 77 - / - /34 /34 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	3.96
BC	45	0.17	3.96

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

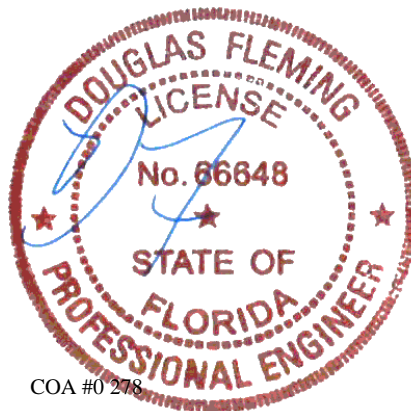

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.


For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

ALPINE
AN ITW COMPANY

6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65871 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ6A	Cust: R 857 JRef: 1WYP8570001 T38 DrwNo: 259.20.1000.15080 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

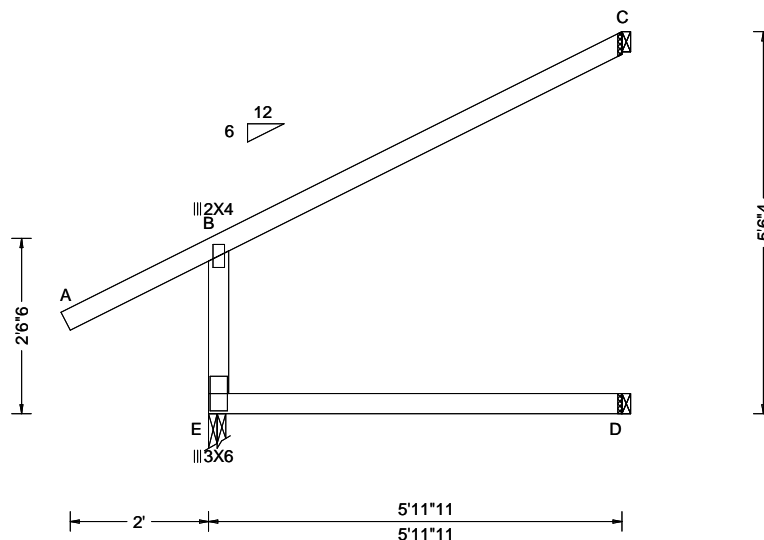

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 B 999 360 VERT(CL): 0.001 B 999 240 HORZ(LL): -0.001 B - - HORZ(TL): 0.001 B - - Creep Factor: 2.0 Max TC CSI: 0.372 Max BC CSI: 0.324 Max Web CSI: 0.171 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL E 372 /- /- /254 /157 /- D 119 /- /- /60 /- /21 C 145 /- /- /52 /27 /110 Wind reactions based on MWFRS E Brg Width = 3.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing E Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	5.97
BC	72	0.00	5.97

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/180.

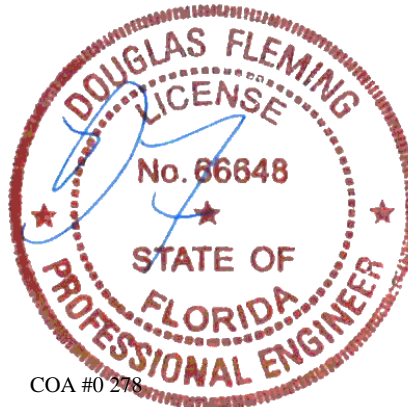

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65872 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ8	Cust: R 857 JRef: 1WYP8570001 T34 DrwNo: 259.20.1000.16283 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

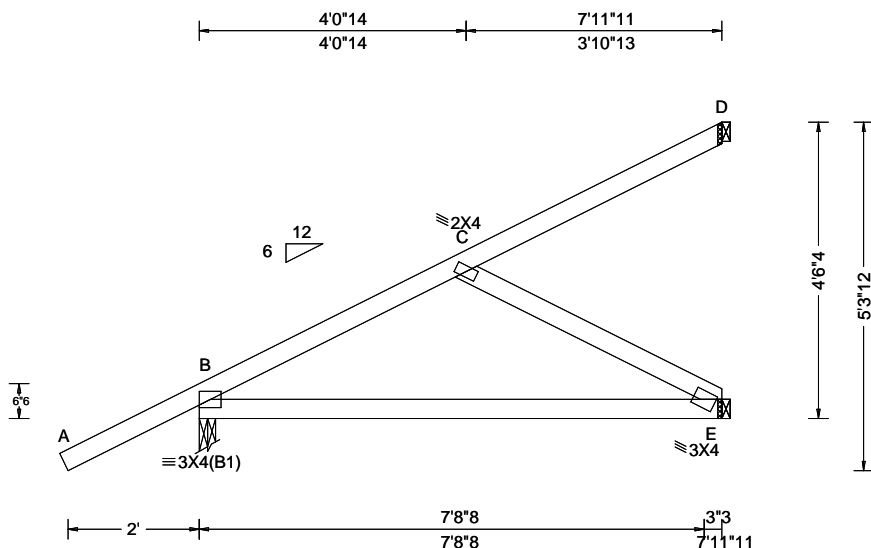

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): -0.004 C 999 360 VERT(CL): -0.009 C 999 240 HORZ(LL): -0.003 E - - HORZ(TL): 0.008 E - - Creep Factor: 2.0 Max TC CSI: 0.335 Max BC CSI: 0.439 Max Web CSI: 0.110 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 443 /- /- /257 /116 /115 E 194 /- /- /131 /66 /- D 94 /- /- /45 /49 /- Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	7.97
BC	75	0.17	7.81

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

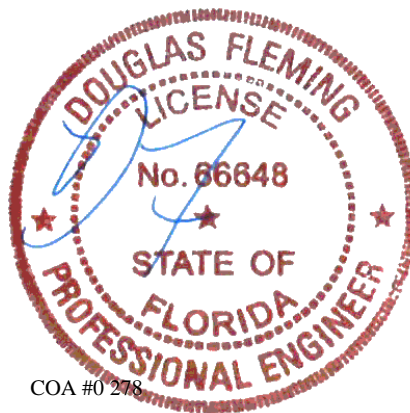

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65873 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ8A	Cust: R 857 JRef: 1WYP8570001 T26 DrwNo: 259.20.1000.17457 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

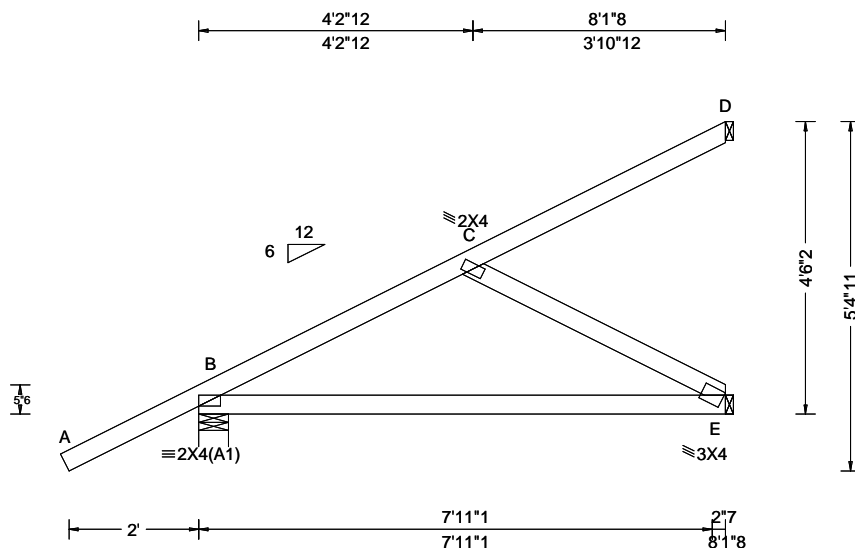

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.004 E 999 360 VERT(CL): 0.012 E 999 240 HORZ(LL): 0.003 E - - HORZ(TL): 0.008 E - - Creep Factor: 2.0 Max TC CSI: 0.386 Max BC CSI: 0.425 Max Web CSI: 0.114 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 451 /- /- /262 /88 /84 E 198 /- /- /133 /49 /- D 92 /- /- /44 /36 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	8.13
BC	75	0.15	7.96

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

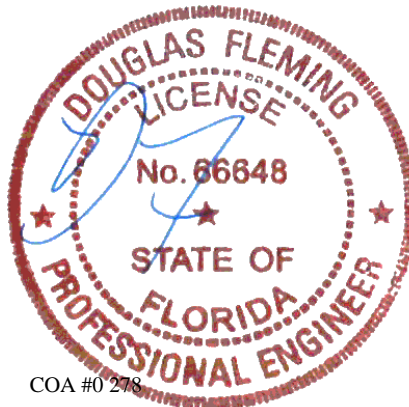

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65936 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJG4	Cust: R 857 JRef: 1WYP8570001 T12 DrwNo: 259.20.1000.18950 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

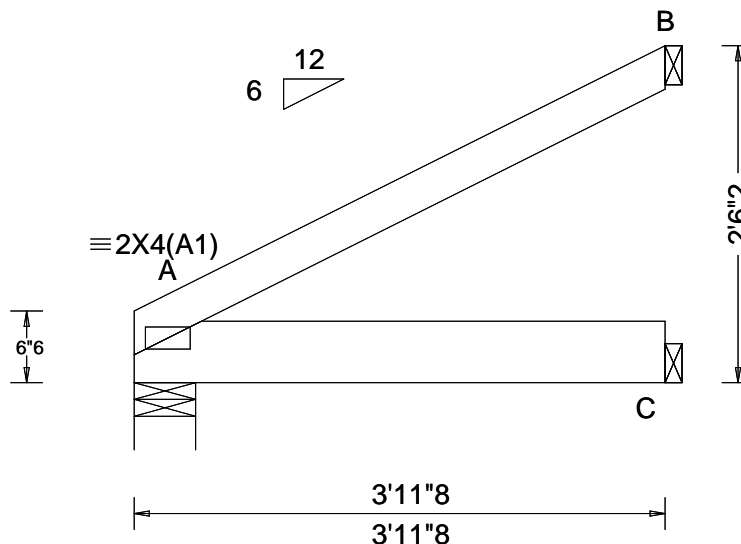

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.004 C - - HORZ(TL): 0.007 C - - Creep Factor: 2.0 Max TC CSI: 0.185 Max BC CSI: 0.354 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 569 -/- /- /183 -/ C 389 -/- /- /92 -/ B 112 -/- /- /43 -/ Wind reactions based on MWFRS A Brg Width = 5.5 Min Req = 1.5 C Brg Width = 1.5 Min Req = - B Brg Width = 1.5 Min Req = - Bearing A Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 56 plf at 0.00 to 56 plf at 2.60
TC: From 28 plf at 2.60 to 28 plf at 3.96
BC: From 10 plf at 0.00 to 10 plf at 3.96
TC: 35 lb Conc. Load at 3.96
BC: 357 lb Conc. Load at 0.60, 2.60
BC: 99 lb Conc. Load at 3.96

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	53	0.00	3.96
BC	46	0.15	3.96

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

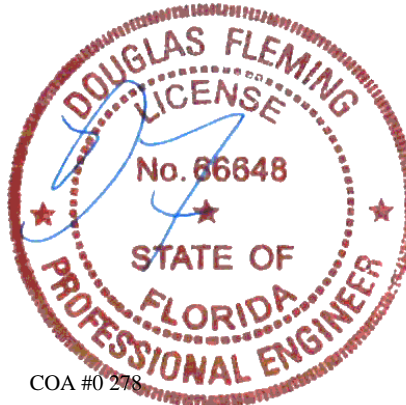

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65930 FROM: RNB	JACK Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJG4A	Cust: R 857 JRef: 1WYP8570001 T27 DrwNo: 259.20.1000.20590 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

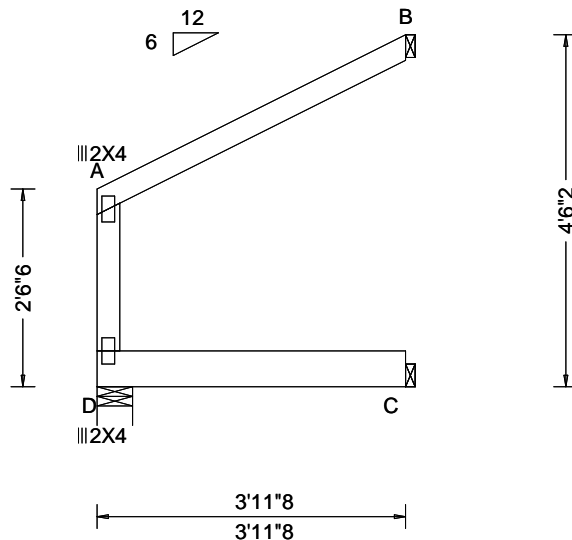

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.000 A 999 360 VERT(CL): 0.000 A 999 240 HORZ(LL): -0.000 A - - HORZ(TL): 0.000 A - - Creep Factor: 2.0 Max TC CSI: 0.222 Max BC CSI: 0.369 Max Web CSI: 0.041 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL D 550 -/- /- /187 -/ C 308 -/- /- /93 /13 B 110 -/- /- /41 /14 Wind reactions based on MWFRS D Brg Width = 5.5 Min Req = 1.5 C Brg Width = 1.5 Min Req = - B Brg Width = 1.5 Min Req = - Bearing D Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 56 plf at 0.00 to 56 plf at 3.96
BC: From 10 plf at 0.00 to 10 plf at 3.96
BC: 351 lb Conc. Load at 0.60
BC: 356 lb Conc. Load at 2.60

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	53	0.00	3.96
BC	47	0.00	3.96

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

Left end vertical exposed to wind pressure. Deflection meets L/180.

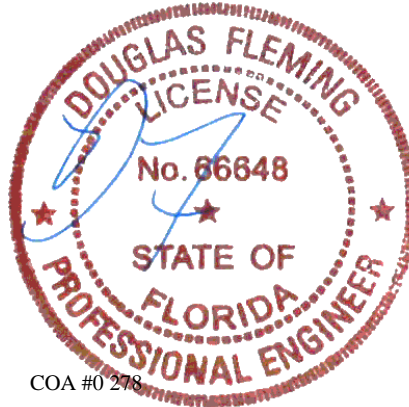

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65874 FROM: RNB	EJAC Ply: 1 Qty: 3	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: EJ4	Cust: R 857 JRef: 1WYP8570001 T80 DrwNo: 259.20.1000.22450 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

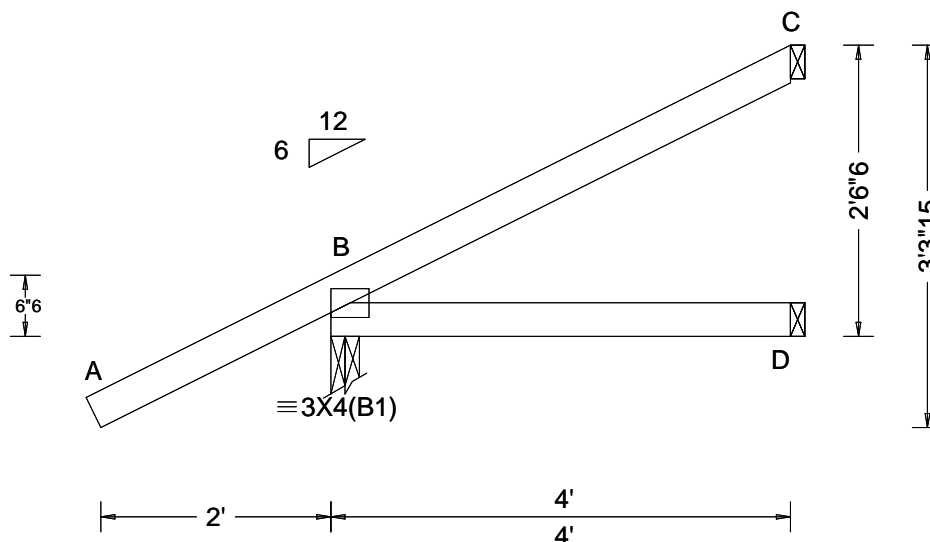

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.09 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.002 D - - HORZ(TL): 0.002 D - - Creep Factor: 2.0 Max TC CSI: 0.244 Max BC CSI: 0.118 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 314 - / - /188 /89 /68 D 72 - / - /37 /4 - C 79 - / - /34 /46 - Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	4.00
BC	46	0.17	4.00

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

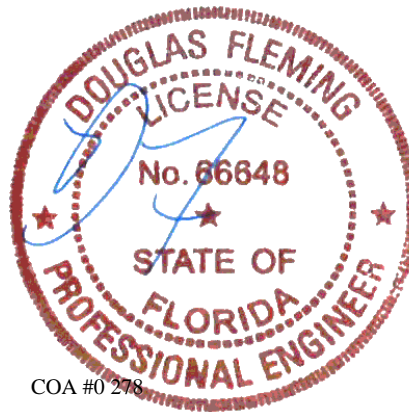

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65875 FROM: RNB	EJAC Ply: 1 Qty: 46	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: EJ8	Cust: R 857 JRRef: 1WYP8570001 T17 DrwNo: 259.20.1000.33967 SSB / DF 09/15/2020
--------------------------	---------------------------	---	---

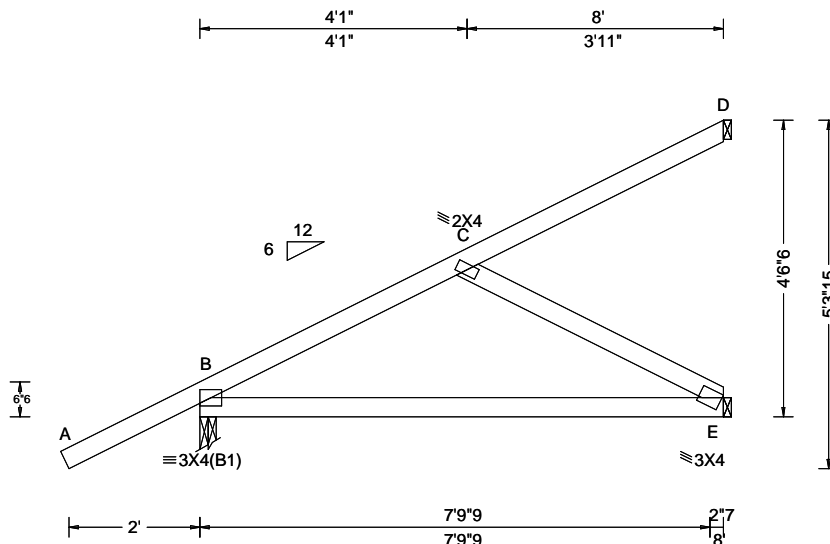

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): -0.004 C 999 360 VERT(CL): -0.009 C 999 240 HORZ(LL): -0.003 E - - HORZ(TL): 0.008 E - - Creep Factor: 2.0 Max TC CSI: 0.336 Max BC CSI: 0.442 Max Web CSI: 0.111 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 444 /- /- /257 /116 /116 E 194 /- /- /131 /66 /- D 94 /- /- /45 /49 /- Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	8.00
BC	75	0.17	7.84

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

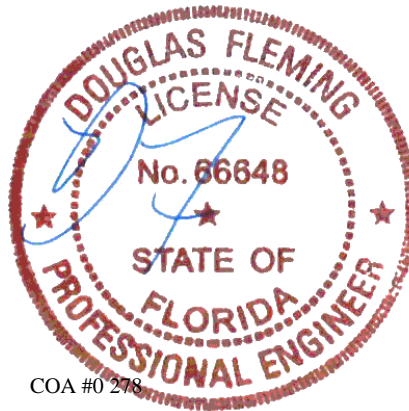

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65876 FROM: RNB	EJAC Ply: 1 Qty: 2	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: EJ8A	Cust: R 857 JRRef: 1WYP8570001 T32 DrwNo: 259.20.1000.35430 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

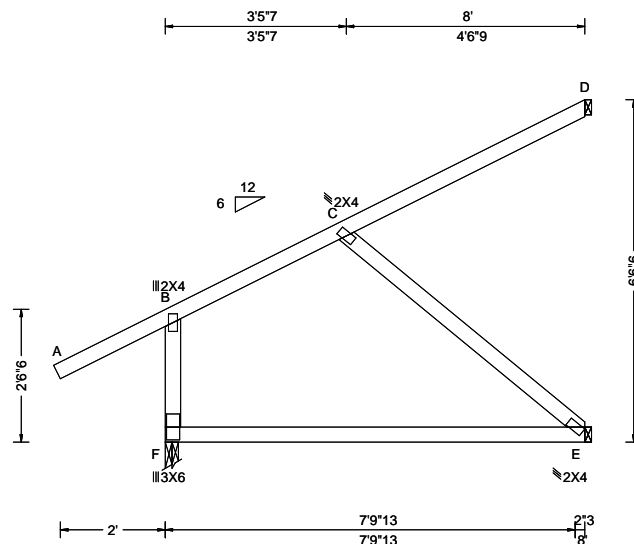

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.003 C 999 360 VERT(CL): 0.005 C 999 240 HORZ(LL): -0.001 C - - HORZ(TL): 0.002 E - - Creep Factor: 2.0 Max TC CSI: 0.257 Max BC CSI: 0.564 Max Web CSI: 0.163 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL F 322 - / - /176 /236 /106 /119 E 223 - / - /141 /82 - / - D 205 - / - /176 /71 /44 /68 Wind reactions based on MWFRS F Brg Width = 3.0 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing F Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	8.00
BC	94	0.00	7.83

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical exposed to wind pressure. Deflection meets L/180.

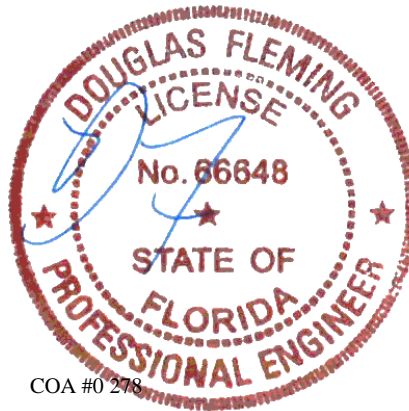

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65877 FROM: RNB	GABL Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: GE1	Cust: R 857 JRef: 1WYP8570001 T63 DrwNo: 259.20.1000.37217 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

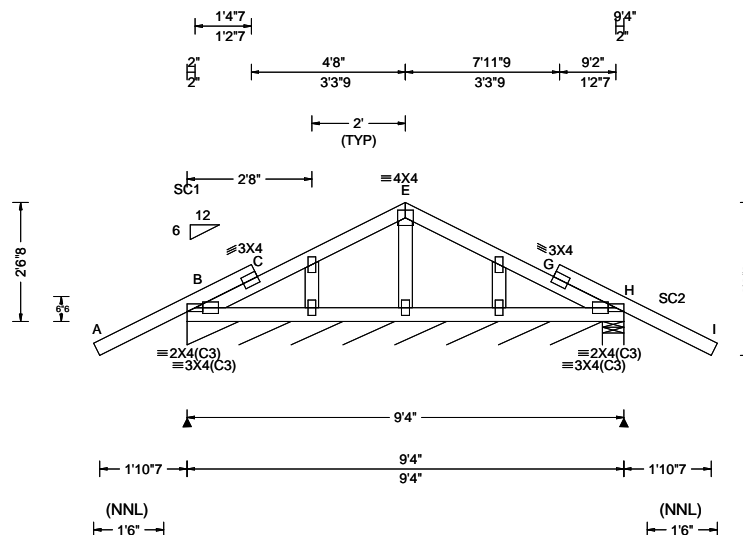

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): -0.002 C 999 360 VERT(CL): 0.003 L 999 240 HORZ(LL): 0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.312 Max BC CSI: 0.123 Max Web CSI: 0.025 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B* 76 -/- /- /42 /23 /8 H 268 -/- /- /169 /87 -/ Wind reactions based on MWFRS B Brg Width = 106 Min Req = - H Brg Width = 5.5 Min Req = 1.5 Bearings B & H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 603 -598 G - H 517 -501

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #1;
Stack Chord: SC2 2x4 SP #1;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	44	-1.93	1.50
TC	61	0.00	4.67
TC	61	4.67	9.33
TC	44	7.83	11.27
BC	75	0.00	9.33

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWGS A14015ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

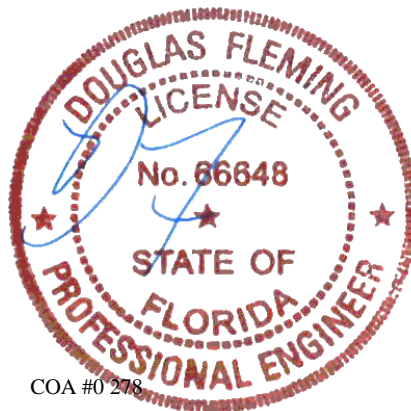

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65878 FROM: RNB	HIPS Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HOA	Cust: R 857 JRef: 1WYP8570001 T1 DrwNo: 259.20.1000.38943 SSB / DF 09/15/2020
--------------------------	--------------------------	---	---

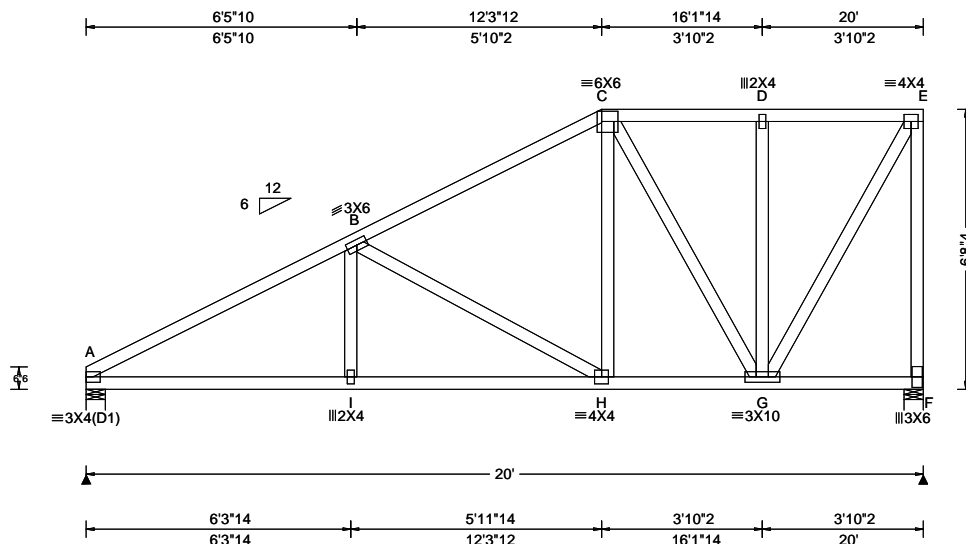

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.035 I 999 360 VERT(CL): 0.067 I 999 240 HORZ(LL): 0.012 G - - HORZ(TL): 0.023 G - - Creep Factor: 2.0 Max TC CSI: 0.987 Max BC CSI: 0.722 Max Web CSI: 0.840 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL A 760 -/- /- /417 /155 /186 F 753 -/- /- /397 /244 -/ Wind reactions based on MWFRS A Brg Width = 5.5 Min Req = 1.5 F Brg Width = 5.5 Min Req = 1.5 Bearings A & F Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 519 -1211 C - D 285 -380 B - C 367 -728 D - E 285 -379

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	65	0.10	12.31
TC	24	12.31	20.00
BC	120	0.17	20.00

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

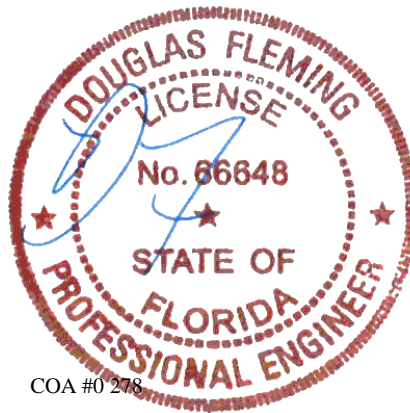

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65879 FROM: RNB	HIPS Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: H10A	Cust: R 857 JRRef: 1WYP8570001 T2 DrwNo: 259.20.1000.40420 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

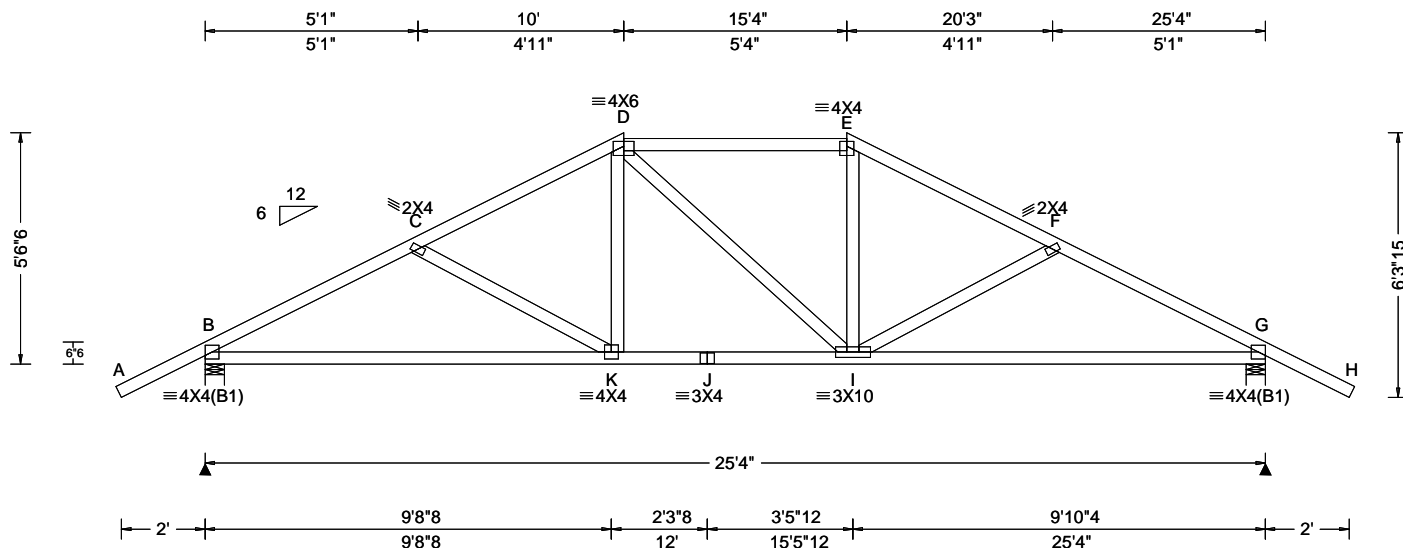

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 7.00 BCCL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.070 K 999 360 VERT(CL): 0.129 K 999 240 HORZ(LL): 0.033 I - - HORZ(TL): 0.060 I - - Creep Factor: 2.0 Max TC CSI: 0.995 Max BC CSI: 0.902 Max Web CSI: 0.132 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1082 - / - / 577 / 343 / 123 G 1082 - / - / 577 / 343 / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 697 - 1554 E - F 600 - 1307 C - D 603 - 1312 F - G 696 - 1553 D - E 590 - 1119

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	54	-2.07	10.00
TC	24	10.00	15.33
TC	54	15.33	27.40
BC	120	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

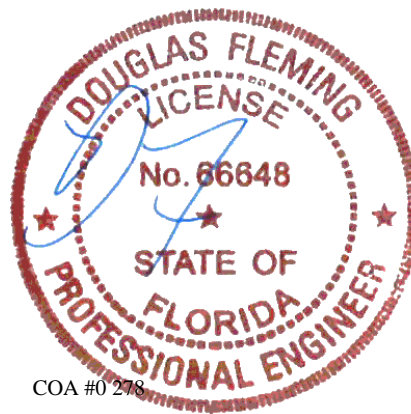


COA #0 278
09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65880 FROM: RNB	HIPS Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: H10B	Cust: R 857 JRef: 1WYP8570001 T6 DrwNo: 259.20.1000.41943 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

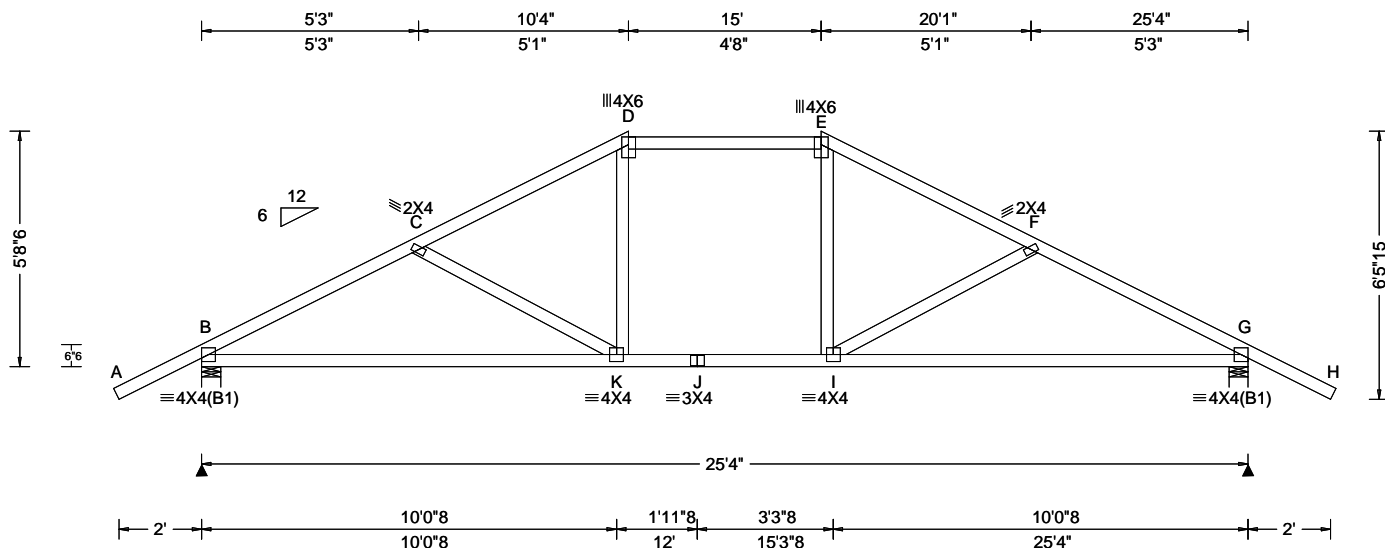

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.113 E 999 360 VERT(CL): 0.258 E 999 240 HORZ(LL): -0.046 D - - HORZ(TL): 0.103 D - - Creep Factor: 2.0 Max TC CSI: 0.983 Max BC CSI: 0.588 Max Web CSI: 0.192 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1082 - / - /577 /243 /126 G 1082 - / - /577 /243 - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 693 - 1551 E - F 590 - 1290 C - D 590 - 1290 F - G 692 - 1551 D - E 571 - 1092

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	54	-2.07	10.33
TC	24	10.33	15.00
TC	54	15.00	27.40
BC	120	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind


Wind loads based on MWFRS with additional C&C member design.



****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65881 FROM: RNB	HIPS Qty: 1	Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: H12A	Cust: R 857 JRef: 1WYP8570001 T3 DrwNo: 259.20.1000.43337 SSB / DF 09/15/2020
--------------------------	----------------	------------------	--	---

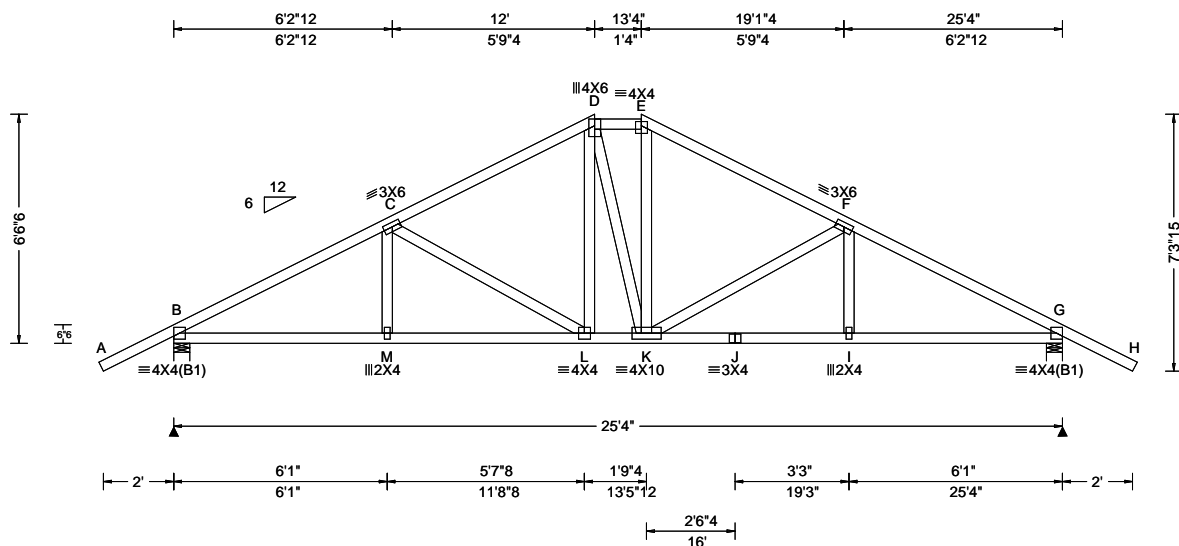

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.074 L 999 360 VERT(CL): 0.136 L 999 240 HORZ(LL): 0.036 I - - HORZ(TL): 0.066 I - - Creep Factor: 2.0 Max TC CSI: 0.969 Max BC CSI: 0.821 Max Web CSI: 0.329 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 1082 - / - / 577 / 343 / 141 G 1082 - / - / 577 / 343 / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 643 -1568 E - F 538 -1164 C - D 539 -1168 F - G 641 -1568 D - E 530 -974

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	52	-2.07	12.00
TC	24	12.00	13.33
TC	52	13.33	27.40
BC	120	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

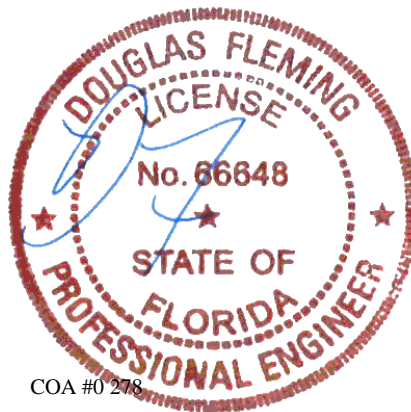


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

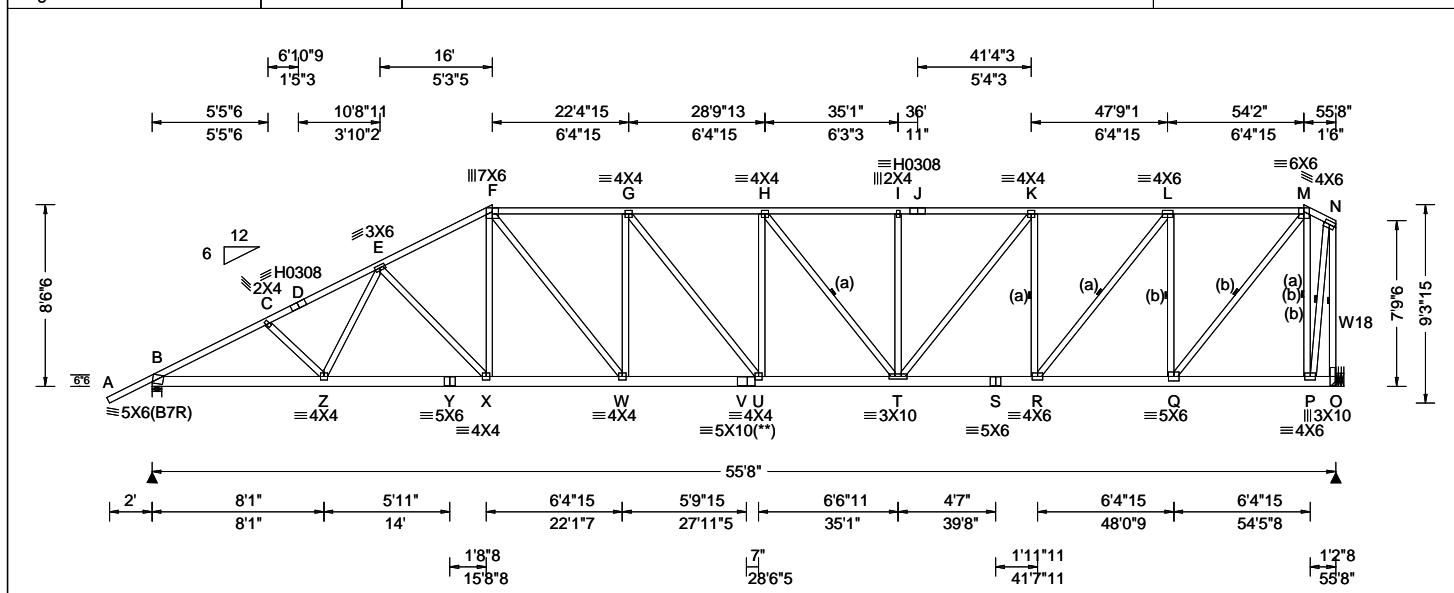


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCDL: 7.00 BCCL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.57 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.319 H 999 360 VERT(CL): 0.600 H 999 240 HORZ(LL): 0.074 F - - HORZ(TL): 0.140 F - - Creep Factor: 2.0 Max TC CSI: 0.983 Max BC CSI: 0.962 Max Web CSI: 0.975 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 2238 - / - / - /1204 /591 /246 O 2097 - / - / - /987 /642 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.8 O Brg Width = - Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
				B - C 1716 -3960 H - I 1656 -3411 C - D 1670 -3780 I - J 1656 -3411 D - E 1670 -3743 J - K 1656 -3411 E - F 1572 -3381 K - L 1369 -2762 F - G 1690 -3489 L - M 924 -1751 G - H 1758 -3646

Lumber	Wind
Top chord: 2x4 SP #1; Bot chord: 2x6 SP #1; Webs: 2x4 SP #3; W18 2x4 SP #1;	Wind loads based on MWFRS with additional C&C member design. Right end vertical exposed to wind pressure. Deflection meets L/180.

Bracing	Additional Notes	Maximum Bot Chord Forces Per Ply (lbs)
(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc. (b) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.	WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.	Chords Tens.Comp. Chords Tens. Comp. B - Z 3465 -1877 V - U 3508 -1795 Z - Y 3245 -1763 U - T 3648 -1830 Y - X 3245 -1763 T - S 2803 -1404 X - W 2962 -1581 S - R 2803 -1404 W - V 3508 -1795 R - Q 1809 -941

Plating Notes	Maximum Web Forces Per Ply (lbs)
(**) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements. Plates sized for a minimum of 3.50 sq.in./piece.	Webs Tens.Comp. Webs Tens. Comp. E - X 257 -392 R - L 1571 -728 X - F 501 -213 L - Q 832 -1649 F - W 870 -403 Q - M 2277 -1064 W - G 329 -583 M - P 997 -1916 H - T 215 -385 P - N 1892 -931 T - K 988 -477 N - O 939 -1993 K - R 582 -1127

Purlins
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:
Chord Spacing(in oc) Start(ft) End(ft)
TC 31 -2.07 16.00
TC 24 16.00 54.17
TC 20 54.17 55.67
BC 88 0.15 55.67
Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

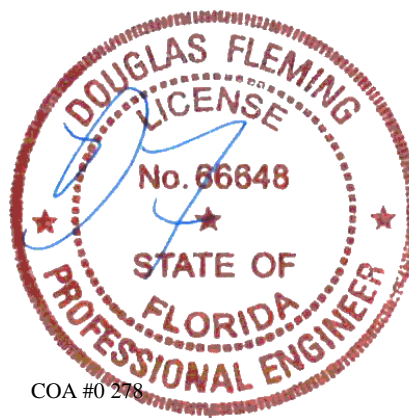

COA #0 278
09/15/2020

SEQN: 65882	HIPS	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T59
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1000.45703
Page 2 of 2			Truss Label: H16A	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing O (55'5", 10'1"2) HGUS28

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

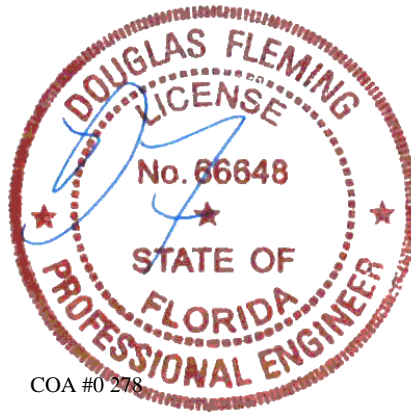

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

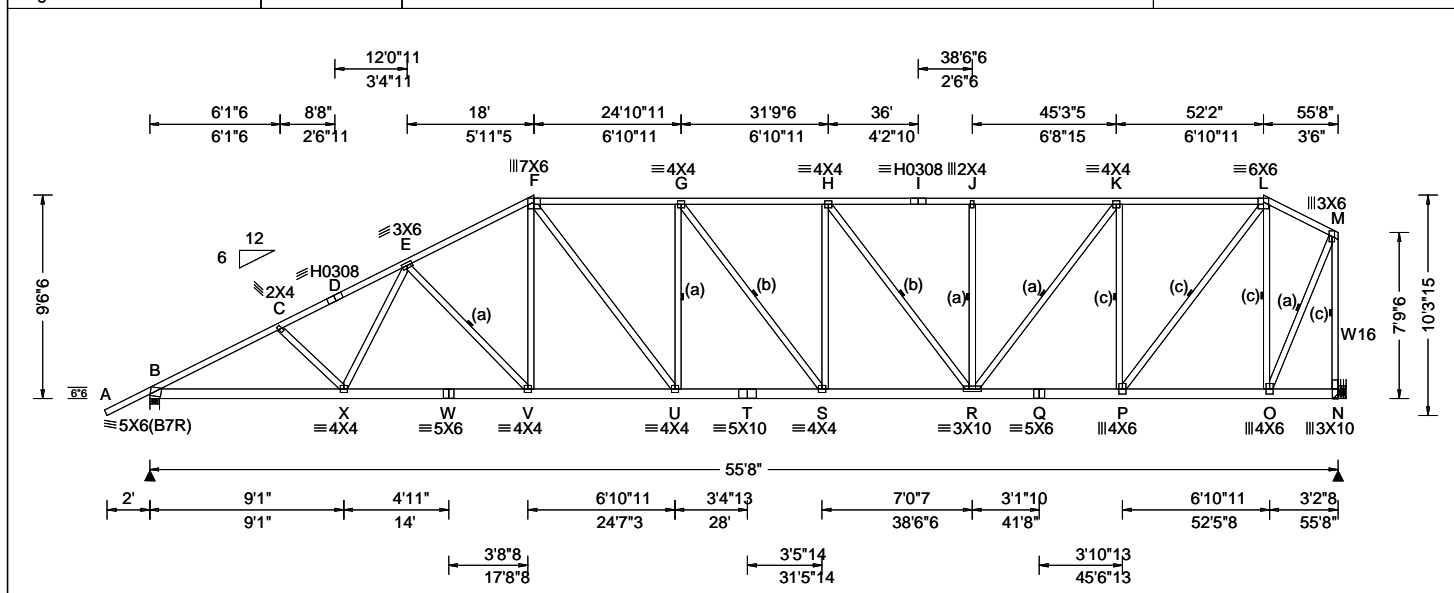


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.57 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.273 G 999 360 VERT(CL): 0.513 G 999 240 HORZ(LL): 0.070 O - - HORZ(TL): 0.131 O - - Creep Factor: 2.0 Max TC CSI: 0.993 Max BC CSI: 0.976 Max Web CSI: 0.999 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2238 - / - / - /1217 /580 /265 N 2097 - / - / - /983 /611 - /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.8 N Brg Width = - Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 1714 -3964 H - I 1400 -2781 C - D 1660 -3751 I - J 1400 -2781 D - E 1660 -3686 J - K 1400 -2781 E - F 1517 -3237 K - L 1037 -1950 F - G 1581 -3202 L - M 505 -831 G - H 1580 -3196

Lumber	Wind
Top chord: 2x4 SP #1; Bot chord: 2x6 SP #1; Webs: 2x4 SP #3; W16 2x4 SP #1;	Wind loads based on MWFRS with additional C&C member design. Right end vertical exposed to wind pressure. Deflection meets L/180.

Bracing	Additional Notes
(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc. (b) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc. (c) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.	WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Plating Notes	Maximum Bot Chord Forces Per Ply (lbs)
Plates sized for a minimum of 3.50 sq.in./piece.	Chords Tens.Comp. Chords Tens. Comp. B - X 3466 -1860 T - S 3213 -1644 X - W 3172 -1710 S - R 3190 -1611 W - V 3172 -1710 R - Q 1995 -1039 V - U 2822 -1496 Q - P 1995 -1039 U - T 3213 -1644 P - O 776 -467

Purlins	Maximum Web Forces Per Ply (lbs)
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows: Chord Spacing(in oc) Start(ft) End(ft) TC 31 -2.07 18.00 TC 24 18.00 52.17 TC 47 52.17 55.67 BC 89 0.15 55.67 Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.	Webs Tens.Comp. Webs Tens. Comp. X - E 385 -88 R - K 1312 -612 E - V 301 -487 K - P 752 -1466 V - F 571 -241 P - L 1994 -930 F - U 642 -306 L - O 828 -1561 U - G 254 -399 O - M 1822 -900 H - R 343 -683 M - N 1017 -2080



COA #0 278
09/15/2020

SEQN: 65883	HIPS	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T67
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1000.51313
Page 2 of 2			Truss Label: H18A	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing N (55'5", 10'1"2) HGUS28

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

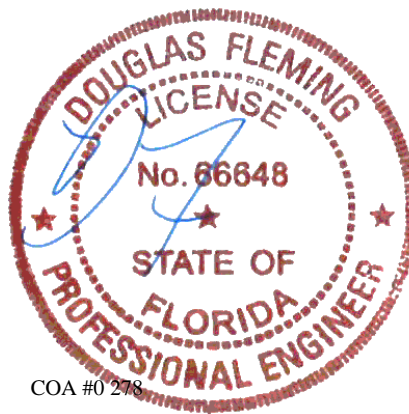

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

ALPINE
AN ITW COMPANY

6750 Forum Drive
Suite 305
Orlando FL, 32821

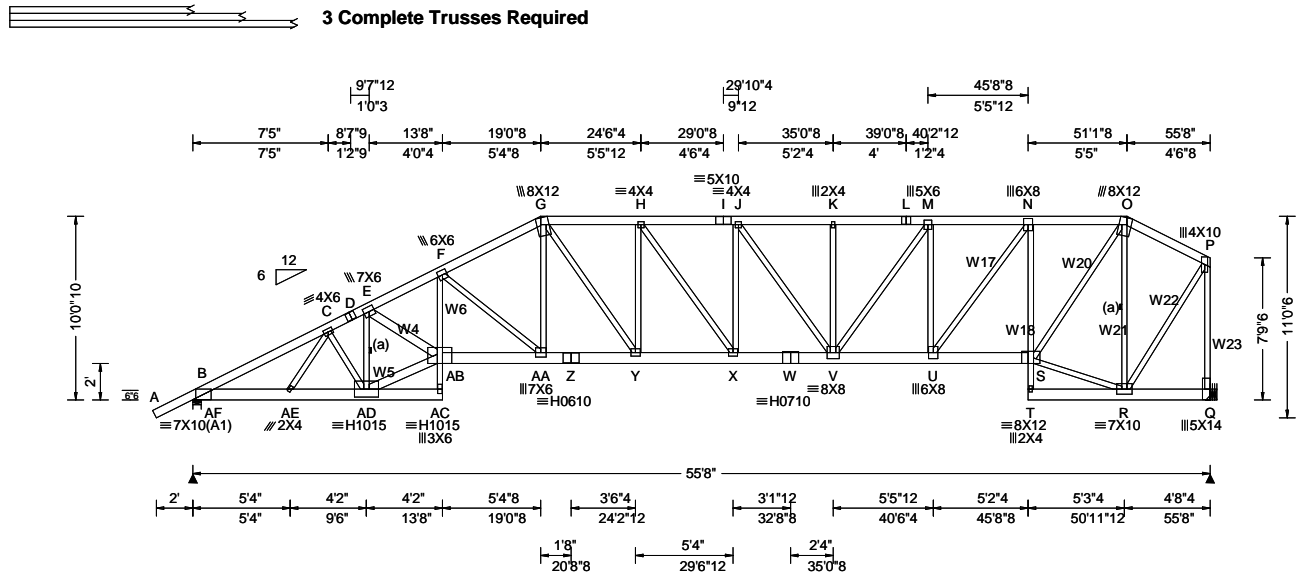

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Non-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.610 X 999 360	Loc R+ /R- /Rh /Rw /U /RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 1.122 X 593 240	AF 11343 /- /- /- /3390 /101
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.269 R - -	Q 11703 /- /- /- /3468 /-
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.495 R - -	Wind reactions based on MWFRS
NCBCLL: 0.00	Mean Height: 15.00 ft		Creep Factor: 2.0	AF Brg Width = 5.5 Min Req = 5.5
Soffit: 2.00	TCDL: 0.0 psf	Building Code:	Max TC CSI: 0.994	Q Brg Width = - Min Req = -
Load Duration: 1.25	BCDL: 0.0 psf	FBC 2017 RES	Max BC CSI: 0.593	Bearing AF Fcperp = 425psi.
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.956	Members not listed have forces less than 375#
	C&C Dist a: 5.57 ft	Rep Fac: Yes		Maximum Top Chord Forces Per Ply (lbs)
	Loc. from endwall: Any	FT/RT:20(0)/0(0)		Chords Tens.Comp. Chords Tens. Comp.
	GCpi: 0.18	Plate Type(s):		
	Wind Duration: 1.60	WAVE, HS	VIEW Ver: 18.02.01A.0205.19	B - C 2317 -7792 I - J 2763 -9333

DOUGLAS FLEMING
LICENSE
No. 66648
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

COA #0 278

AD- E	977 -3354	V - M	2434 - 716
AD-AB	8023 -2342	M - U	634 - 2108
E -AB	3511 - 1021	U - N	3992 - 1174
AB- F	2711 - 783	N - S	1005 - 3370
F -AA	766 -2633	S - R	1937 - 551
G -AA	2492 - 729	S - O	5375 - 1580
G - Y	1724 - 512	R - O	1052 - 3560
H - X	440 - 130	R - P	3474 - 1021
X - J	720 - 200	P - Q	1159 - 3898
J - V	302 - 1019		

09/15/2020

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org



SEQN: 65944	HIPS	Ply: 3	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T51
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1001.15750
Page 2 of 2			Truss Label: HG19A	SSB / DF 09/15/2020

Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 56 plf at -2.20 to 56 plf at 8.53
TC: From 28 plf at 8.53 to 28 plf at 26.10
TC: From 56 plf at 26.10 to 56 plf at 55.67
BC: From 4 plf at -2.20 to 4 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 8.19
BC: From 10 plf at 8.19 to 10 plf at 45.71
BC: From 20 plf at 45.71 to 20 plf at 55.67
BC: 608 lb Conc. Load at 8.19
BC: 384 lb Conc. Load at 10.10
BC: 374 lb Conc. Load at 12.10
BC: 769 lb Conc. Load at 14.10
BC: 767 lb Conc. Load at 16.10
BC: 1187 lb Conc. Load at 18.10
BC: 1191 lb Conc. Load at 20.10,22.10
BC: 1197 lb Conc. Load at 24.10,26.10,28.10,30.10
32.10,34.10,36.10,38.10
BC: 1174 lb Conc. Load at 40.10,42.10,44.10

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

It is the responsibility of the Building Designer and Truss Fabricator to review this drawing prior to cutting lumber to verify that all data, including dimensions and loads, conform to the architectural plans/specifications and fabricators truss layout.

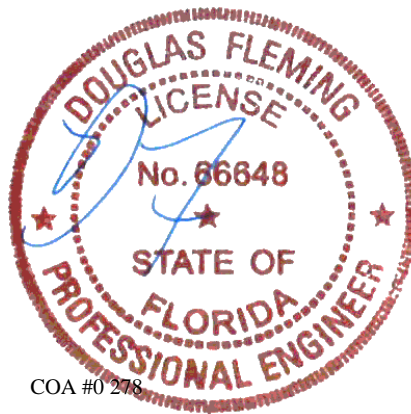

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!** ****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65937 FROM: RNB	HIPS Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HG4A	Cust: R 857 JRef: 1WYP8570001 T79 DrwNo: 259.20.1001.17690 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

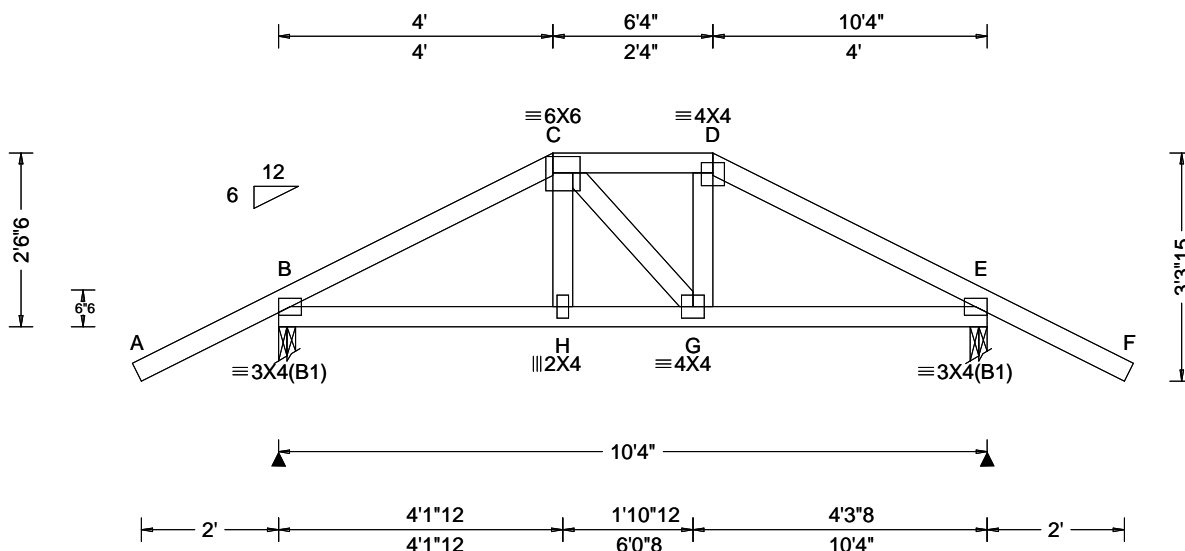

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.09 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.028 H 999 360 VERT(CL): 0.051 H 999 240 HORZ(LL): 0.014 G - - HORZ(TL): 0.026 G - - Creep Factor: 2.0 Max TC CSI: 0.996 Max BC CSI: 0.467 Max Web CSI: 0.080 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 833 -/- /- /- /254 -/ E 833 -/- /- /- /254 -/ Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 E Brg Width = 3.0 Min Req = 1.5 Bearings B & E Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 301 -1067 D - E 302 -1066 C - D 243 -913 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - H 886 -242 G - E 886 -243 H - G 899 -242

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From	56 plf at	-2.13 to	56 plf at	4.00
TC: From	28 plf at	4.00 to	28 plf at	6.33
TC: From	56 plf at	6.33 to	56 plf at	12.46
BC: From	4 plf at	-2.13 to	4 plf at	0.00
BC: From	20 plf at	0.00 to	20 plf at	4.03
BC: From	10 plf at	4.03 to	10 plf at	6.30
BC: From	20 plf at	6.30 to	20 plf at	10.33
BC: From	4 plf at	10.33 to	4 plf at	12.46
TC:	114 lb Conc. Load at	4.03, 6.30		
TC:	79 lb Conc. Load at	5.17		
BC:	172 lb Conc. Load at	4.03, 6.30		
BC:	72 lb Conc. Load at	5.17		

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	61	-2.07	4.00
TC	24	4.00	6.33
TC	61	6.33	12.40
BC	120	0.17	10.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

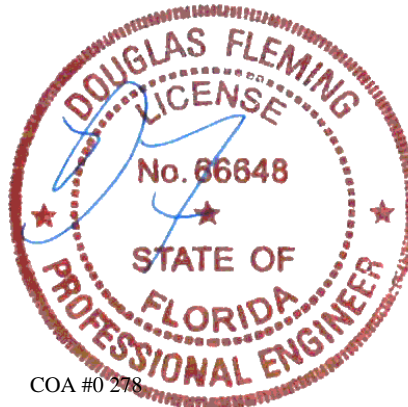

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65938 FROM: RNB	HIPS Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HG8A	Cust: R 857 JRRef: 1WYP8570001 T13 DrwNo: 259.20.1001.19763 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

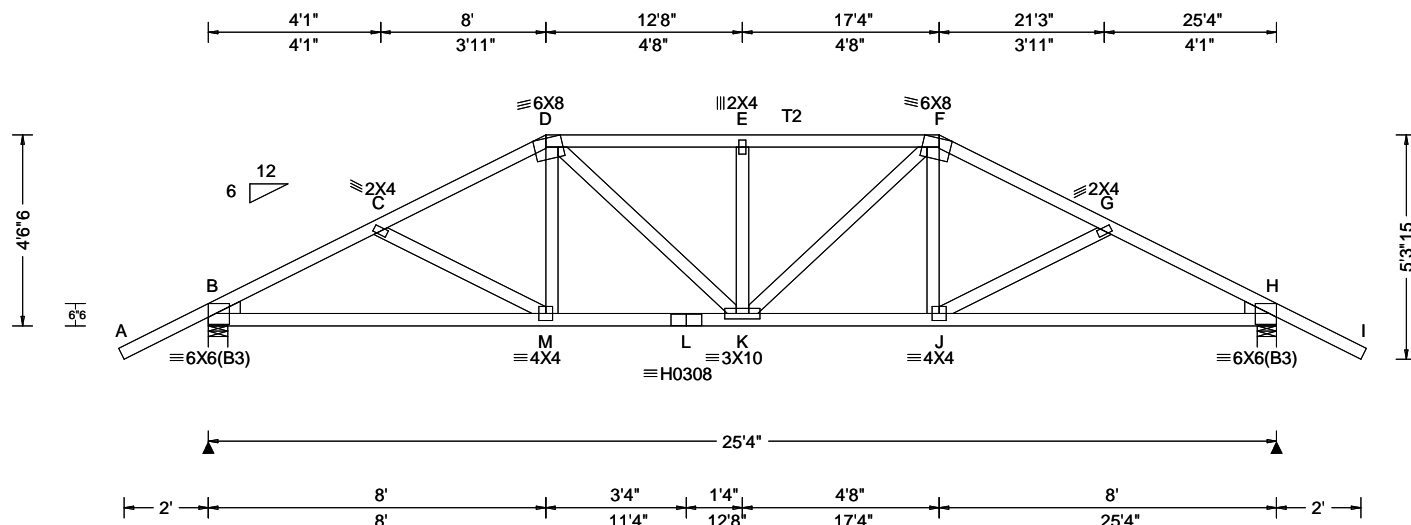

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.199 E 999 360 VERT(CL): 0.366 E 824 240 HORZ(LL): 0.083 J - - HORZ(TL): 0.152 J - - Creep Factor: 2.0 Max TC CSI: 0.966 Max BC CSI: 0.969 Max Web CSI: 0.297 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 2319 - / - / - / - /814 - / - H 2319 - / - / - / - /814 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.9 H Brg Width = 5.5 Min Req = 2.9 Bearings B & H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 1429 -4023 E - F 1469 -4101 C - D 1394 -3959 F - G 1394 -3959 D - E 1469 -4101 G - H 1429 -4023

Lumber

Top chord: 2x4 SP SS Dense; T2 2x4 SP #1;
Bot chord: 2x4 SP SS Dense;
Webs: 2x4 SP #3;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 56 plf at -2.13 to 56 plf at 8.00
TC: From 28 plf at 8.00 to 28 plf at 17.33
TC: From 56 plf at 17.33 to 56 plf at 27.46
BC: From 4 plf at -2.13 to 4 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 8.03
BC: From 10 plf at 8.03 to 10 plf at 17.30
BC: From 20 plf at 17.30 to 20 plf at 25.33
BC: From 4 plf at 25.33 to 4 plf at 27.46
TC: 217 lb Conc. Load at 8.03,17.30
TC: 94 lb Conc. Load at 10.06,12.06,13.27,15.27
BC: 619 lb Conc. Load at 8.03,17.30
BC: 194 lb Conc. Load at 10.06,12.06,13.27,15.27

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	29	-2.07	8.00
TC	24	8.00	17.33
TC	29	17.33	27.40
BC	70	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

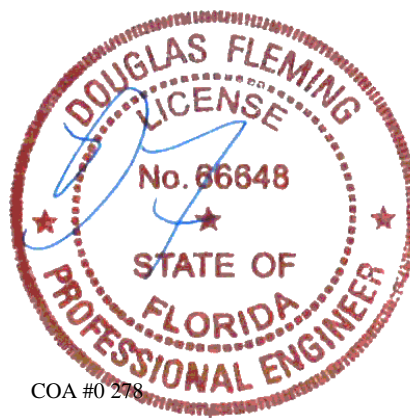

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65931 FROM: RNB	HIP_	Ply: 1 Qty: 5	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HJ11	Cust: R 857 JRRef: 1WYP8570001 T56 DrwNo: 259.20.0955.09213 SSB / DF 09/15/2020
--------------------------	------	------------------	--	---

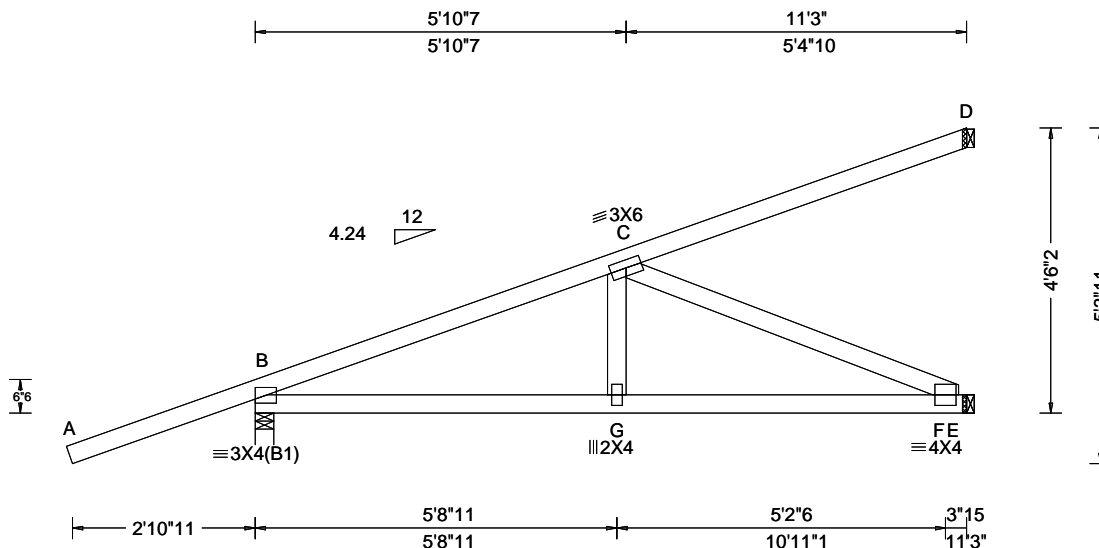

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.036 G 999 360 VERT(CL): 0.068 G 999 240 HORZ(LL): -0.010 D - - HORZ(TL): 0.019 D - - Creep Factor: 2.0 Max TC CSI: 0.992 Max BC CSI: 0.711 Max Web CSI: 0.581 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 436 /- /- /- /165 /- E 425 /- /- /- /118 /- D 124 /- /- /- /54 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 0 plf at -2.99 to 55 plf at -0.10
TC: From 2 plf at -0.10 to 2 plf at 11.25
BC: From 0 plf at -2.99 to 4 plf at -0.10
BC: From 2 plf at 0.00 to 2 plf at 11.25
TC: -8 lb Conc. Load at 2.79
TC: 156 lb Conc. Load at 5.62
TC: 278 lb Conc. Load at 8.45
BC: 63 lb Conc. Load at 2.79
BC: 143 lb Conc. Load at 5.62
BC: 221 lb Conc. Load at 8.45

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	73	-2.94	11.25
BC	120	0.19	11.25

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

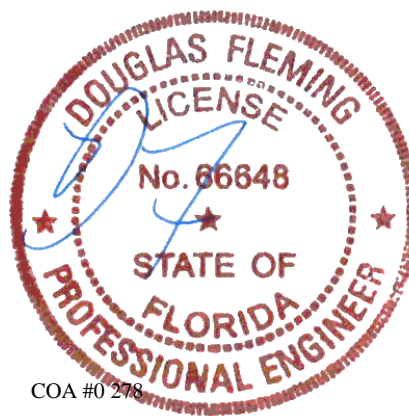


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65965 FROM: RNB	HIP_ Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HJ11A	Cust: R 857 JRef: 1WYP8570001 T37 DrwNo: 259.20.0956.06200 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

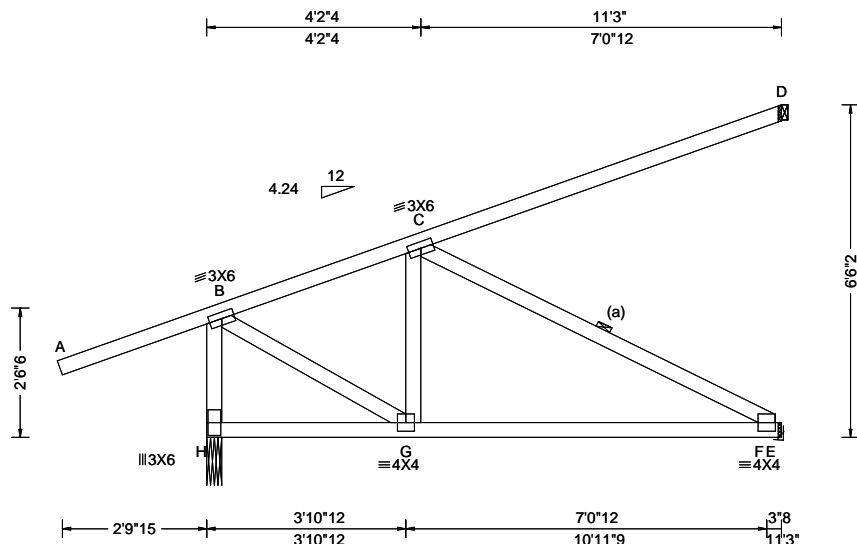

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.019 G 999 360 VERT(CL): 0.036 G 999 240 HORZ(LL): 0.010 C - - HORZ(TL): 0.018 C - - Creep Factor: 2.0 Max TC CSI: 0.995 Max BC CSI: 0.833 Max Web CSI: 0.683 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL H 706 /- /- /- /235 /42 E 626 /- /- /- /183 /- D 153 /- /- /- /44 /- Wind reactions based on MWFRS H Brg Width = 3.5 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP SS Dense;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 0 plf at -2.93 to 55 plf at -0.10
TC: From 2 plf at -0.10 to 2 plf at 11.25
BC: From 0 plf at -2.93 to 4 plf at -0.10
BC: From 2 plf at 0.00 to 2 plf at 11.25
TC: 133 lb Conc. Load at 2.79
TC: 172 lb Conc. Load at 5.62
TC: 257 lb Conc. Load at 8.45
BC: 150 lb Conc. Load at 2.79
BC: 273 lb Conc. Load at 5.62
BC: 372 lb Conc. Load at 8.45

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Wind

Wind loads and reactions based on MWFRS.

Left end vertical exposed to wind pressure. Deflection meets L/180.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	64	-2.88	11.25
BC	103	0.00	11.25

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Maximum Bot Chord Forces Per Ply (lbs)


Chords Tens.Comp.

G - F 764 -248

Maximum Web Forces Per Ply (lbs)

Webs Tens.Comp. Webs Tens. Comp.

H - B 268 -803 C - F 281 -864
B - G 841 -235



COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65933 FROM: RNB	HIP_	Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HJ3	Cust: R 857 JRef: 1WYP8570001 T87 DrwNo: 259.20.0956.53520 SSB / DF 09/15/2020
--------------------------	------	------------------	---	--

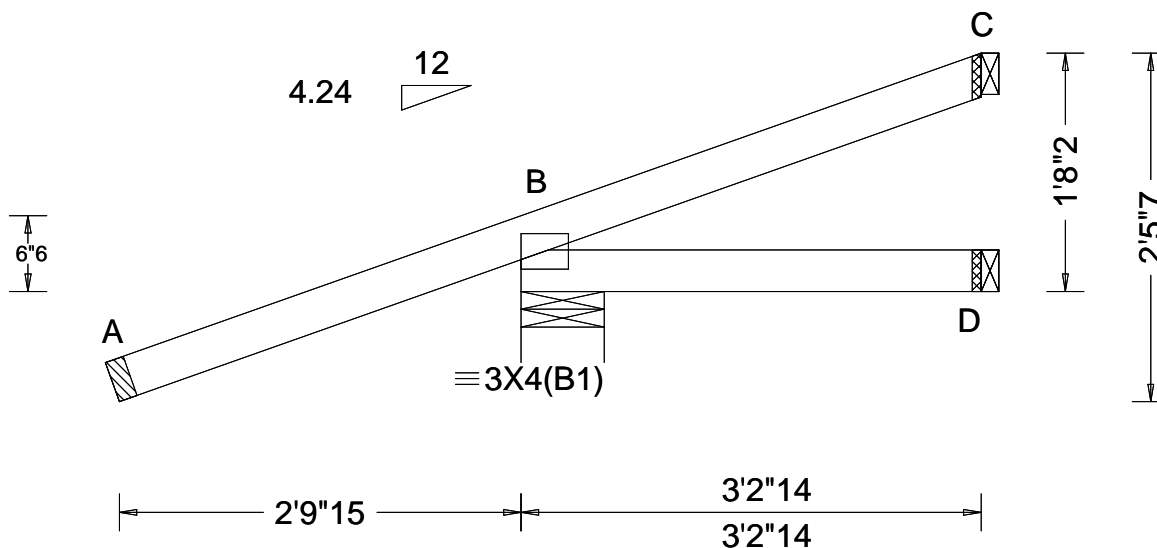

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.003 D - - HORZ(TL): 0.005 D - - Creep Factor: 2.0 Max TC CSI: 0.751 Max BC CSI: 0.135 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 378 - / - / 225 / 137 / 47 D 53 - / - / 27 / 9 / - C 22 - / - / 22 / 25 / - Wind reactions based on MWFRS B Brg Width = 7.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.88	3.24
BC	37	0.19	3.24

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

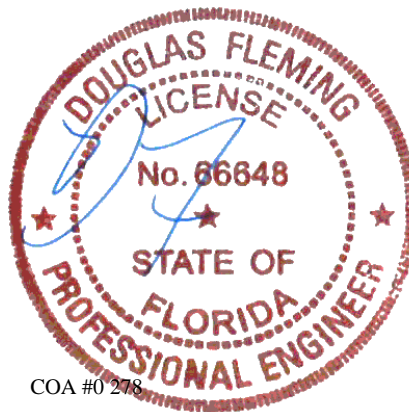

COA #0 278

09/15/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

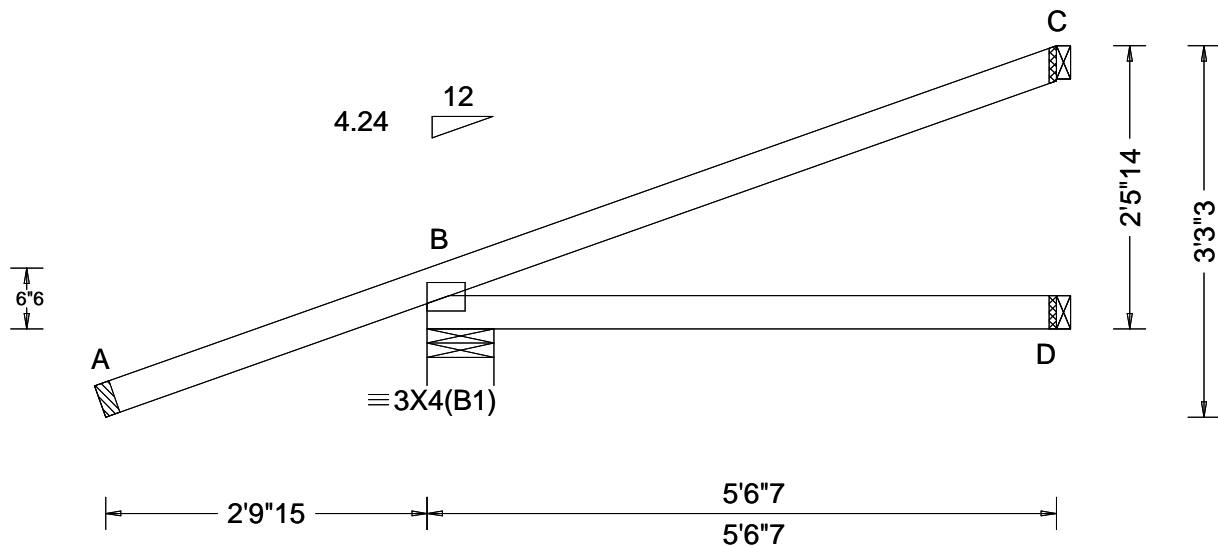

Leading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Non-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	B 225 /- /- /- /68 /-
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 D - -	D 99 /- /- /- /6 /-
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.004 D - -	C 35 /-7 /- /- /12 /-
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.186	B Brg Width = 7.0 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.221	D Brg Width = 1.5 Min Req = -
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2	Rep Fac: Varies by Ld Case	Max Web CSI: 0.000	C Brg Width = 1.5 Min Req = -
	C&C Dist a: 3.00 ft	FT/RT:20(0)/0(0)		Bearing B Fcperp = 425psi.
	Loc. from endwall: Any	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE	VIEW Ver: 18.02.01A.0205.19	
	Wind Duration: 1.60			

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

	TC: From	BC: From	TC: To	BC: To	Rate	Rate
TC: From	0 plf at	-2.93 to	55 plf at	-0.10		
TC: From	2 plf at	-0.10 to	2 plf at	5.54		
BC: From	0 plf at	-2.93 to	4 plf at	-0.10		
BC: From	2 plf at	0.00 to	2 plf at	5.54		
TC:	-10 lb Conc. Load at	2.70				
BC:	61 lb Conc. Load at	2.70				

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.88	5.54
BC	64	0.19	5.54

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

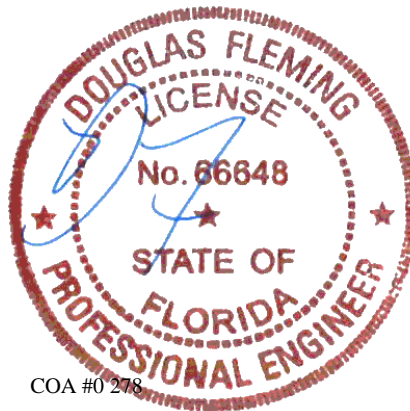

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65935 FROM: RNB	HIP_	Ply: 1 Qty: 2	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: HJ6A	Cust: R 857 JRef: 1WYP8570001 T81 DrwNo: 259.20.0956.57487 SSB / DF 09/15/2020
--------------------------	------	------------------	--	--

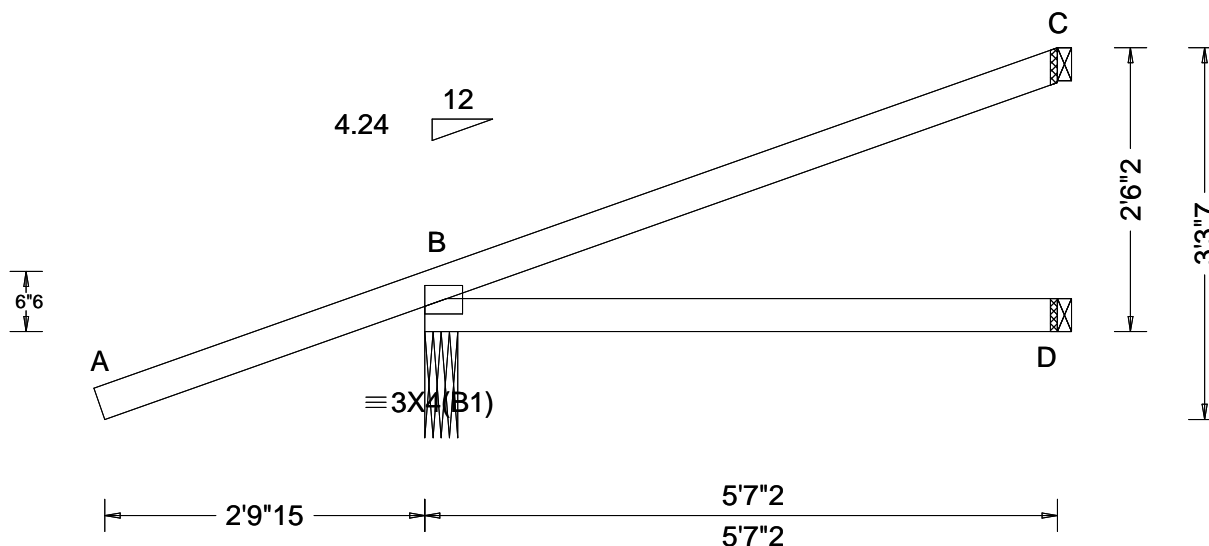

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.10 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 D - - HORZ(TL): 0.004 D - - Creep Factor: 2.0 Max TC CSI: 0.186 Max BC CSI: 0.226 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 226 /- /- /- /67 /- D 100 /- /- /- /6 /- C 36 /-6 /- /- /12 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 0 plf at -2.93 to 55 plf at -0.10
TC: From 2 plf at -0.10 to 2 plf at 5.59
BC: From 0 plf at -2.93 to 4 plf at -0.10
BC: From 2 plf at 0.00 to 2 plf at 5.59
TC: -8 lb Conc. Load at 2.79
BC: 63 lb Conc. Load at 2.79

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.88	5.59
BC	65	0.19	5.59

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

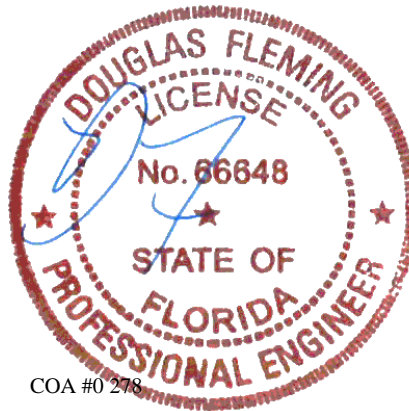

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

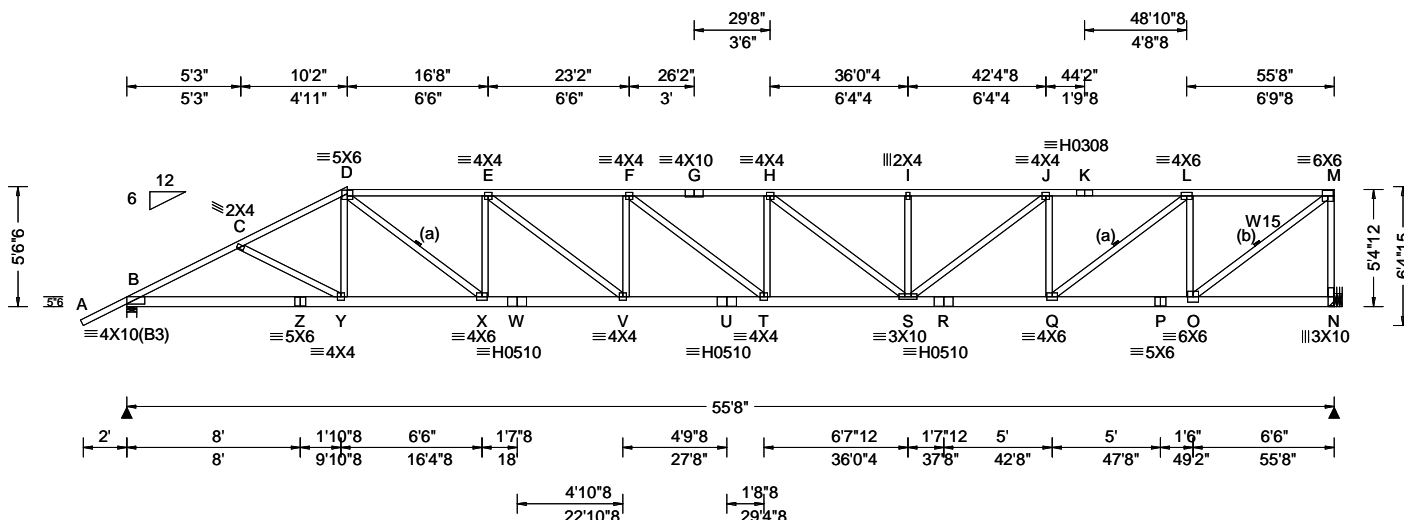

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.57 ft Loc. from endwall: not in 6.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.596 T 999 360 VERT(CL): 1.118 T 595 240 HORZ(LL): 0.127 D - - HORZ(TL): 0.239 D - - Creep Factor: 2.0 Max TC CSI: 0.975 Max BC CSI: 0.998 Max Web CSI: 0.996 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 2238 - / - / - /1157 /708 /161 N 2097 - / - / - /975 /666 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.8 N Brg Width = - Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
				B - C 1848 -4059 H - I 2456 -5335 C - D 1742 -3847 I - J 2456 -5335 D - E 2243 -4818 J - K 1946 -4188 E - F 2591 -5627 K - L 1946 -4188 F - G 2668 -5807 L - M 1174 -2447 G - H 2668 -5807

Lumber

Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W15 2x4 SP #1;

Bracing

- (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
- (b) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	33	-2.07	10.17
TC	24	10.17	55.67
BC	71	0.15	55.67

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
 Deflection meets L/180.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

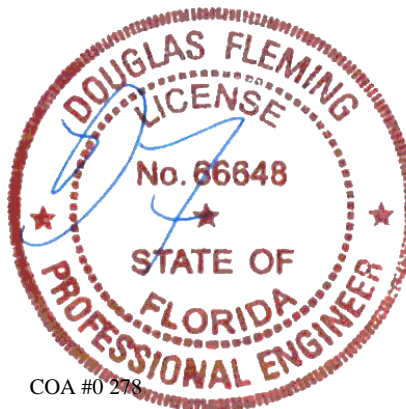

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCEA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65885	HIPM	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T45
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0957.32980
Page 2 of 2			Truss Label: MH1	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing N (55'5", 10'1"2) HGUS28

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

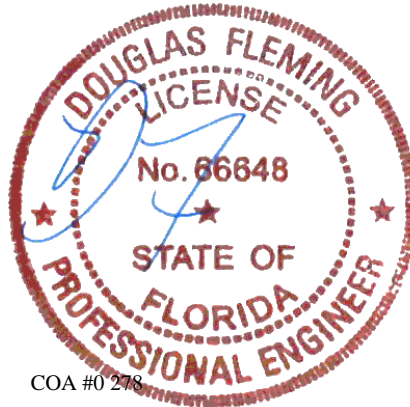

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

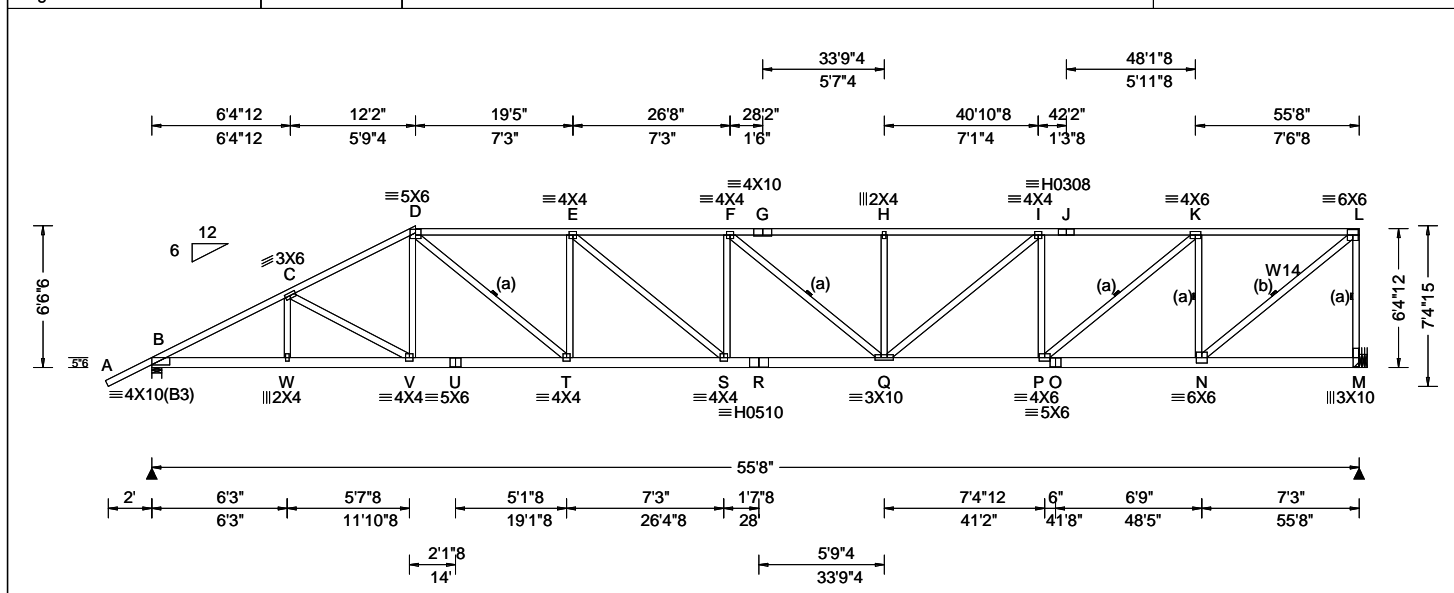

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 7.00 BCCL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.57 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.453 F 999 360 VERT(CL): 0.849 F 784 240 HORZ(LL): 0.104 D - - HORZ(TL): 0.195 D - - Creep Factor: 2.0 Max TC CSI: 0.956 Max BC CSI: 0.977 Max Web CSI: 0.989 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 2238 -/- /- /1175 /707 /192 M 2097 -/- /- /982 /666 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.8 M Brg Width = - Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
				B - C 1767 -4020 G - H 2174 -4660 C - D 1694 -3732 H - I 2174 -4660 D - E 2057 -4380 I - J 1776 -3766 E - F 2260 -4852 J - K 1776 -3766 F - G 2174 -4660 K - L 1105 -2251

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W14 2x4 SP #1;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
 (b) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
 Plates sized for a minimum of 3.50 sq.in./piece.


Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	33	-2.07	12.17
TC	24	12.17	55.67
BC	77	0.15	55.67

 Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical exposed to wind pressure.
 Deflection meets L/180.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

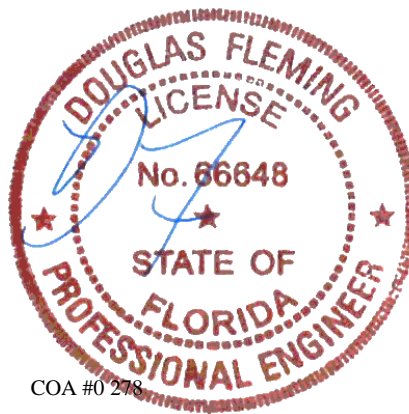

Maximum Bot Chord Forces Per Ply (lbs)			
Chords	Tens.Comp.	Chords	Tens. Comp.
B - W	3525 -1885	S - R	4863 -2352
W - V	3526 -1886	R - Q	4863 -2352
V - U	3278 -1717	Q - P	3819 -1831
U - T	3278 -1717	P - O	2334 -1150
T - S	4419 -2186	O - N	2334 -1150

Maximum Web Forces Per Ply (lbs)			
Webs	Tens.Comp.	Webs	Tens. Comp.
V - D	397 -122	I - P	564 -1096
D - T	1461 -658	P - K	1894 -864
T - E	440 -827	K - N	866 -1710
E - S	573 -241	N - L	2926 -1352
H - Q	239 -397	L - M	983 -2036
Q - I	1102 -524		

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBICA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65886	HIPM	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T43
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0957.36650
Page 2 of 2			Truss Label: MH2	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing M (55'5", 10'1"2) HGUS28

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

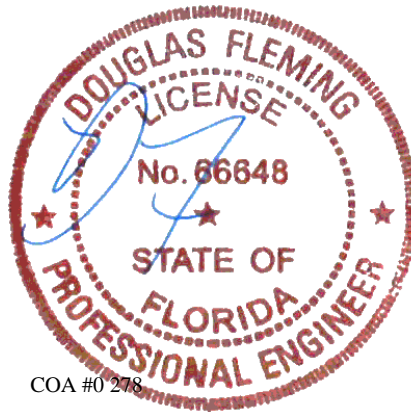

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

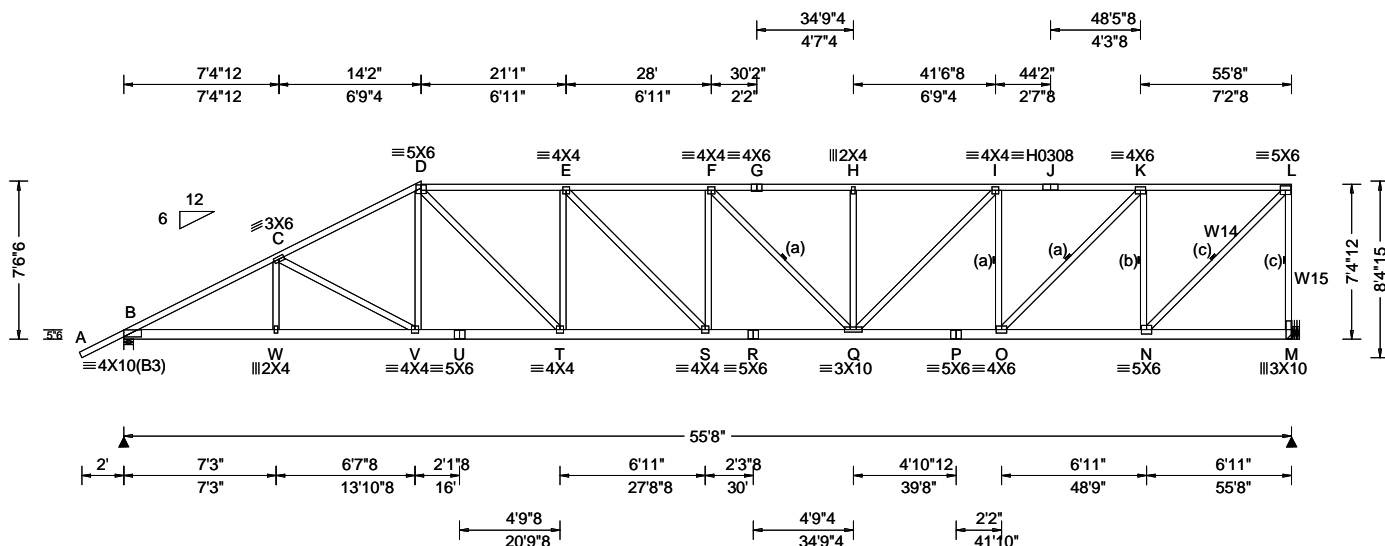

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity			Non-Gravity				
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.361 F 999 360	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.678 F 982 240	B	2238	-/-	-/-	/1191	/602	/223	
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.085 D - -	M	2097	-/-	-/-	/989	/666	-/-	
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.160 D - -	Wind reactions based on MWFRS							
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	Creep Factor: 2.0	B	Brg Width = 5.5		Min Req = 2.8				
Soffit: 2.00	TCDL: 0.0 psf		Max TC CSI: 0.994	M	Brg Width = -		Min Req = -				
Load Duration: 1.25	BCDL: 0.0 psf		Max BC CSI: 0.985	Bearing B Fcperp = 425psi.							
Spacing: 24.0 "	MWFRS Parallel Dist: h to 2h		Max Web CSI: 0.940	Members not listed have forces less than 375#							
	C&C Dist a: 5.57 ft			Maximum Top Chord Forces Per Ply (lbs)							
	Loc. from endwall: not in 13.00 ft			Chords		Tens.Comp.		Chords		Tens. Comp.	
	GCpi: 0.18		VIEW Ver: 18.02.01A.0205.19	B - C		1739 -4020		G - H		1863 -3926	
	Wind Duration: 1.60										

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W14,W15 2x4 SP #1;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
 (b) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.
 (c) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
 Plates sized for a minimum of 3.50 sq.in./piece.


Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	33	-2.07	14.17
TC	24	14.17	55.67
BC	83	0.15	55.67

 Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical exposed to wind pressure.
 Deflection meets L/180.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

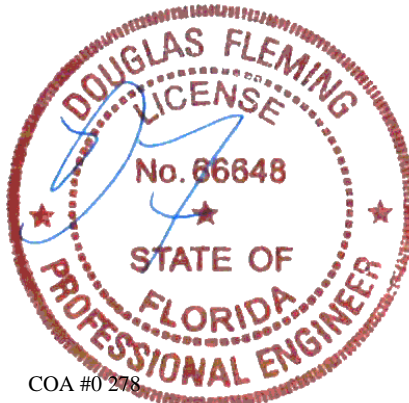

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65887	HIPM	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T50
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0957.53000
Page 2 of 2			Truss Label: MH3	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing M (55'5", 10'1"2) HGUS28

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

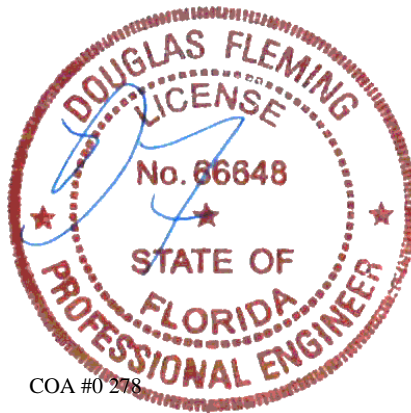

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

3 Complete Trusses Required

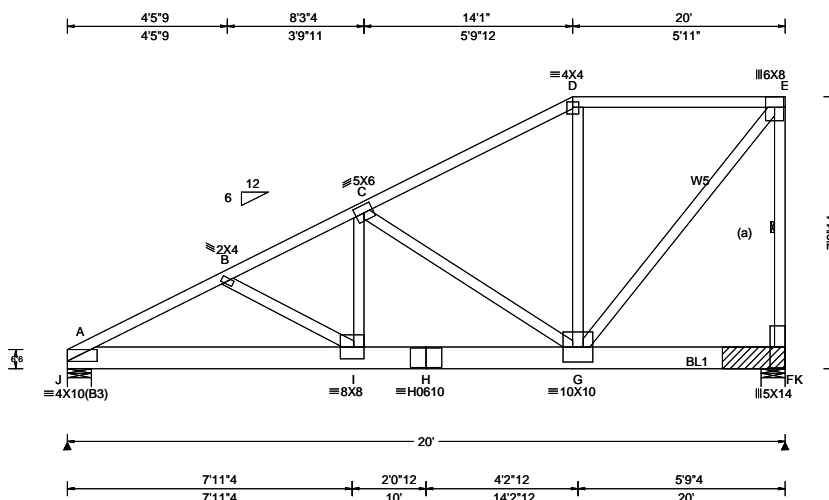

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.126 I 999 360 VERT(CL): 0.234 I 999 240 HORZ(LL): 0.028 B - - HORZ(TL): 0.052 B - - Creep Factor: 2.0 Max TC CSI: 0.999 Max BC CSI: 0.833 Max Web CSI: 0.979 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL J 7237 -/- /- /- /2488 /101 K 21188 -/- /- /- /6545 -/ Wind reactions based on MWFRS J Brg Width = 8.0 Min Req = 3.5 K Brg Width = 8.0 Min Req = - Bearings J & K Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 1726 -4991 C - D 974 -2947 B - C 1712 -4968 D - E 874 -2650

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x8 SP SS Dense;
Webs: 2x4 SP #3; W5 2x4 SP #1;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Nailnote

Nail Schedule: 0.128"x3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 3 Rows @ 3.00" o.c. (Each Row)
Webs: 1 Row @ 4" o.c.
Repeat nailing as each layer is applied. Use equal spacing between rows and stagger nails in each row to avoid splitting.
(1) 1/2" bolts may be used for
(2) 0.128"x3", min. nails on
The Bottom Chord Only.

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 56 plf at 0.00 to 56 plf at 8.13
TC: From 28 plf at 8.13 to 28 plf at 14.08
TC: From 56 plf at 14.08 to 56 plf at 20.00
BC: From 20 plf at 0.00 to 20 plf at 8.13
BC: From 10 plf at 8.13 to 10 plf at 20.00
BC: 5005 lb Conc. Load at 8.13
BC: 2097 lb Conc. Load at 10.06, 12.06, 14.06, 16.06
18.06
BC: 11703 lb Conc. Load at 19.23 +
+16-(0.131"x3.0") nails opposite hanger
after third ply is attached.

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	58	0.00	14.08
TC	24	14.08	20.00
BC	120	0.15	20.00


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
A - I	4427 - 1496	H - G	4329 - 1455
I - H	4329 - 1455		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
I - C	2006 - 730	G - E	4211 - 1362
C - G	757 - 2073	E - F	1078 - 3317
D - G	1220 - 393		

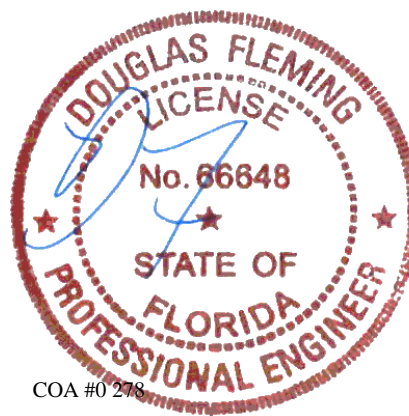

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65945	HIPM	Ply: 3	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T73
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1003.33177
Page 2 of 2			Truss Label: MHG1	SSB / DF 09/15/2020

Wind

Wind loads and reactions based on MWFRS.

Right end vertical exposed to wind pressure.

Deflection meets L/180.

Bearing Block(s)

Brg blocks: 0.128"x3", min. nails

brg x-loc #blocks length/blk #nails/blk wall plate

2 19.333' 1 21" 37 SPF Standard

Brg block to be same size and species as chord.

Refer to drawing CNNAILSP1014 for more information.

Blocking

Full Height Blocking reinforcement required to

prevent buckling of members over the bearings:

bearing 2 located at 19.3'


It is the responsibility of the Building Designer and

Truss Fabricator to review this drawing prior to

cutting lumber to verify that all data, including

dimensions and loads, conform to the architectural

plans/specifications and fabricators truss layout.

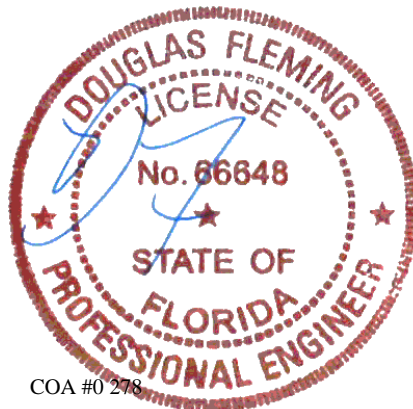

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

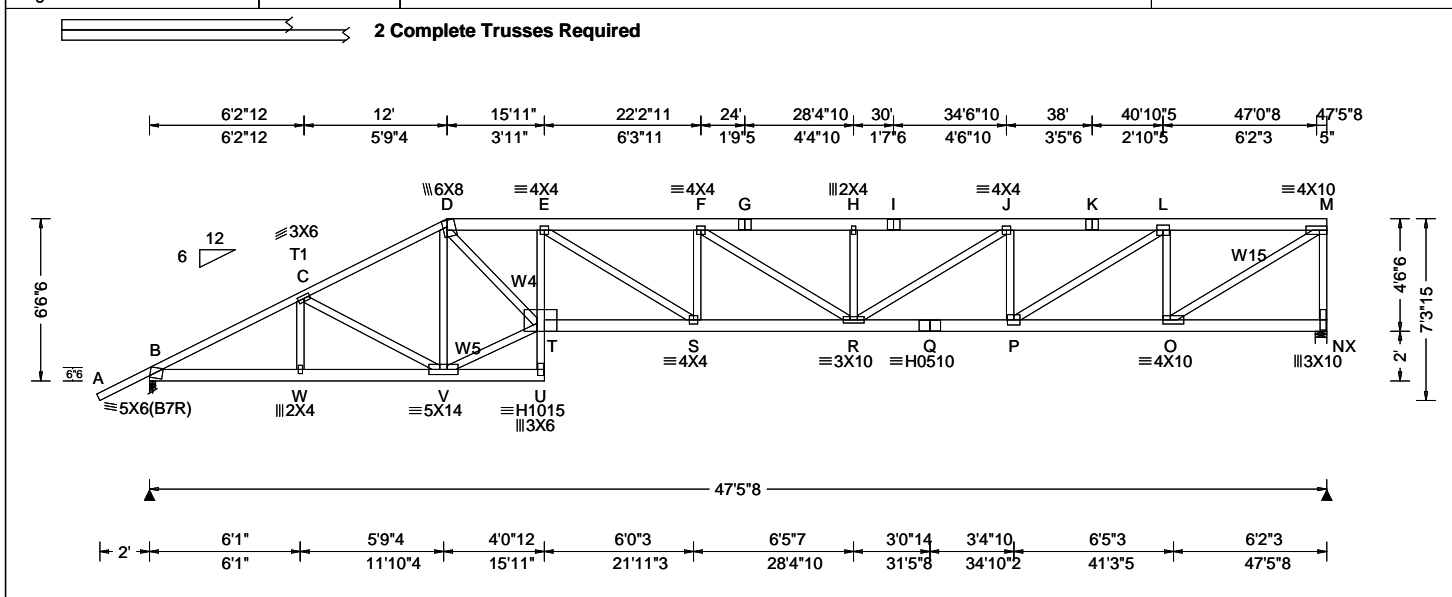


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 4.75 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: No FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.506 F 999 360 VERT(CL): 0.939 F 605 240 HORZ(LL): 0.148 O - - HORZ(TL): 0.274 O - - Creep Factor: 2.0 Max TC CSI: 0.993 Max BC CSI: 0.994 Max Web CSI: 0.904 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL B 4221 -/- /- /- /1455 /55 X 4400 -/- /- /- /1629 -/ Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 2.9 X Brg Width = 5.5 Min Req = 3.1 Bearings B & X Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
				B - C 1373 -3979 H - I 2334 -6390 C - D 1391 -4006 I - J 2334 -6390 D - E 2184 -6215 J - K 1900 -5146 E - F 2411 -6701 K - L 1900 -5146 F - G 2334 -6390 L - M 1145 -3066 G - H 2334 -6390

Lumber	Plating Notes
Top chord: 2x6 SP #1; T1 2x4 SP #1; Bot chord: 2x6 SP #1; Webs: 2x4 SP #3; W4,W5,W15 2x4 SP #1;	All plates are 5X6 except as noted. Plates sized for a minimum of 3.50 sq.in./piece.

Nailnote	Purlins	Maximum Bot Chord Forces Per Ply (lbs)
Nail Schedule: 0.128"x3", min. nails Top Chord: 1 Row @12.00" o.c. Bot Chord: 1 Row @12.00" o.c. Webs : 1 Row @ 4" o.c. Use equal spacing between rows and stagger nails in each row to avoid splitting. (1) 1/2" bolts may be used for (2) 0.128"x3", min. nails on The Bottom Chord Only.	In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows: Chord Spacing(in oc) Start(ft) End(ft) TC 40 -2.07 12.00 TC 24 12.00 47.46 BC 120 0.13 15.77 BC 91 15.82 47.46 Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.	Chords Tens.Comp. Chords Tens. Comp. B - W 3513 -1183 R - Q 5217 -1900 W - V 3517 -1184 Q - P 5217 -1900 T - S 6246 -2168 P - O 3181 -1162 S - R 6704 -2389

Special Loads	Maximum Web Forces Per Ply (lbs)
----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25) TC: From 56 plf at -2.13 to 56 plf at 12.00 TC: From 28 plf at 12.00 to 28 plf at 47.46 BC: From 4 plf at -2.13 to 4 plf at 0.00 BC: From 20 plf at 0.00 to 20 plf at 12.06 BC: From 10 plf at 12.06 to 10 plf at 47.46 TC: 359 lb Conc. Load at 12.06 TC: 205 lb Conc. Load at 14.13 TC: 94 lb Conc. Load at 16.13,18.13,20.13,22.13 24.13,26.13,28.13,30.13,32.13,34.13,36.13,38.13 40.13,42.13,44.13,46.13 BC: 849 lb Conc. Load at 12.06 BC: 223 lb Conc. Load at 14.13 BC: 194 lb Conc. Load at 16.13,18.13,20.13,22.13 24.13,26.13,28.13,30.13,32.13,34.13,36.13,38.13 40.13,42.13,44.13,46.13	Webs Tens.Comp. Webs Tens. Comp. V - D 470 -1310 R - J 1406 -489 V - T 4019 -1361 J - P 380 -1001 D - T 3798 -1361 P - L 2373 -858 T - E 242 -544 L - O 617 -1607 E - S 554 -262 O - M 3650 -1347 F - R 98 -377 M - N 777 -2076

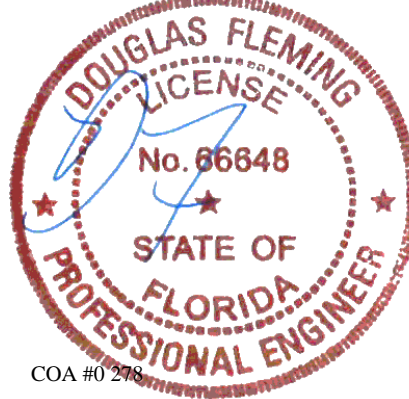

COA #0 278
09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65968	HIPM	Ply: 2	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T84
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1003.36530
Page 2 of 2			Truss Label: MHG2	SSB / DF 09/15/2020

Wind


Wind loads and reactions based on MWFRS.

Right end vertical exposed to wind pressure.

Deflection meets L/180.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

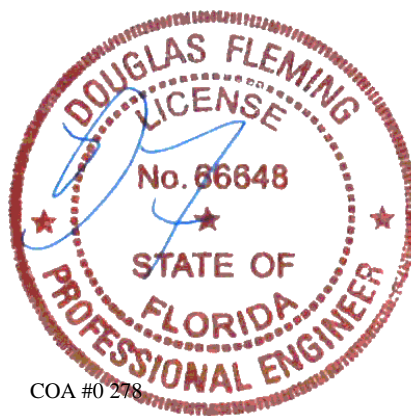

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65940	HIPM	Ply: 2	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T39
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1003.40380
Page 2 of 2			Truss Label: MHG3	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Bearing at location x=55'5" uses the following support conditions: 55'5"

Bearing N (55'5", 10'1"2) HGUS28-2

Supporting Member: (3)2x8 SP SS Dense

(36) 0.148"x3" nails into supporting member,

(12) 0.148"x3" nails into supported member.


Wind

Wind loads and reactions based on MWFRS.

Right end vertical not exposed to wind pressure.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

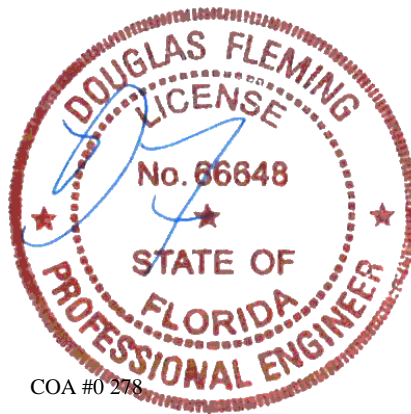

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65888 FROM: RNB	SPEC Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: S1	Cust: R 857 JRef: 1WYP8570001 T7 DrwNo: 259.20.1003.42170 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

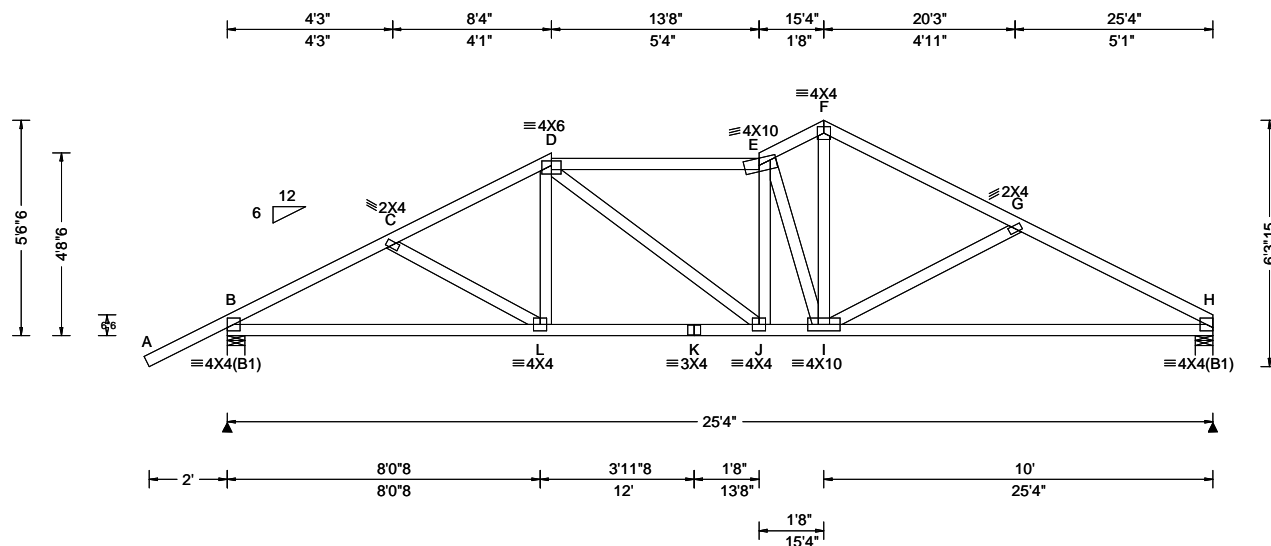

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.082 E 999 360 VERT(CL): 0.152 E 999 240 HORZ(LL): 0.031 I - - HORZ(TL): 0.057 I - - Creep Factor: 2.0 Max TC CSI: 0.980 Max BC CSI: 0.711 Max Web CSI: 0.365 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1088 - / - / - /573 /251 /110 H 953 - / - / - /492 /212 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 H Brg Width = 5.5 Min Req = 1.5 Bearings B & H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 735 - 1579 E - F 659 - 1286 C - D 677 - 1419 F - G 632 - 1317 D - E 721 - 1377 G - H 752 - 1597

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	48	-2.07	8.33
TC	24	8.33	13.67
TC	23	13.67	15.33
TC	56	15.33	25.23
BC	120	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

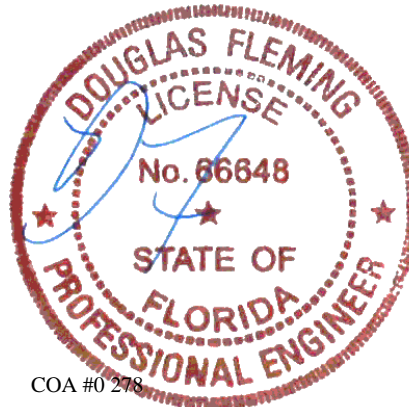


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65889 FROM: RNB	SPEC Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: S2	Cust: R 857 JRef: 1WYP8570001 T8 DrwNo: 259.20.1003.43473 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

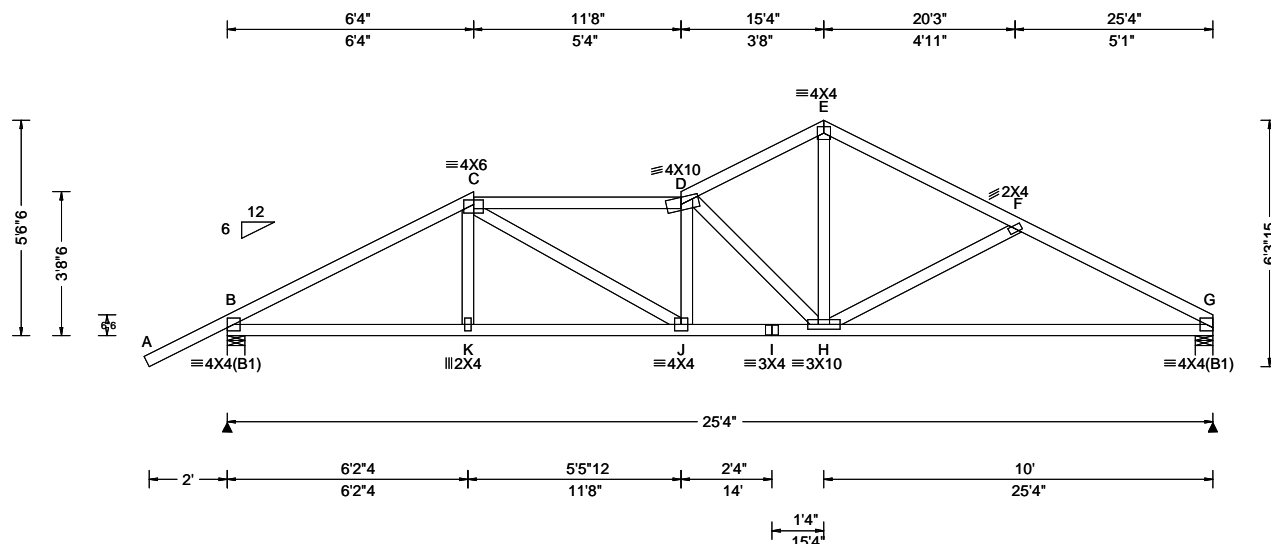

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.097 D 999 360 VERT(CL): 0.180 D 999 240 HORZ(LL): 0.032 H - - HORZ(TL): 0.060 H - - Creep Factor: 2.0 Max TC CSI: 0.964 Max BC CSI: 0.950 Max Web CSI: 0.427 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1088 -/- /- /568 /253 /110 G 953 -/- /- /489 /207 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 729 -1592 E - F 641 -1314 C - D 910 -1789 F - G 759 -1595 D - E 656 -1305

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	51	-2.07	6.33
TC	24	6.33	11.67
TC	50	11.67	15.33
TC	56	15.33	25.23
BC	120	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

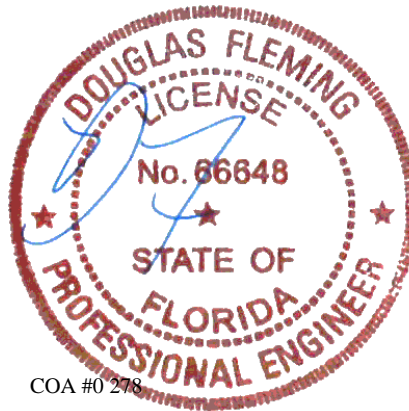


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinstr.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65890 FROM: RNB	SPEC Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: S3	Cust: R 857 JRef: 1WYP8570001 T9 DrwNo: 259.20.1003.44933 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

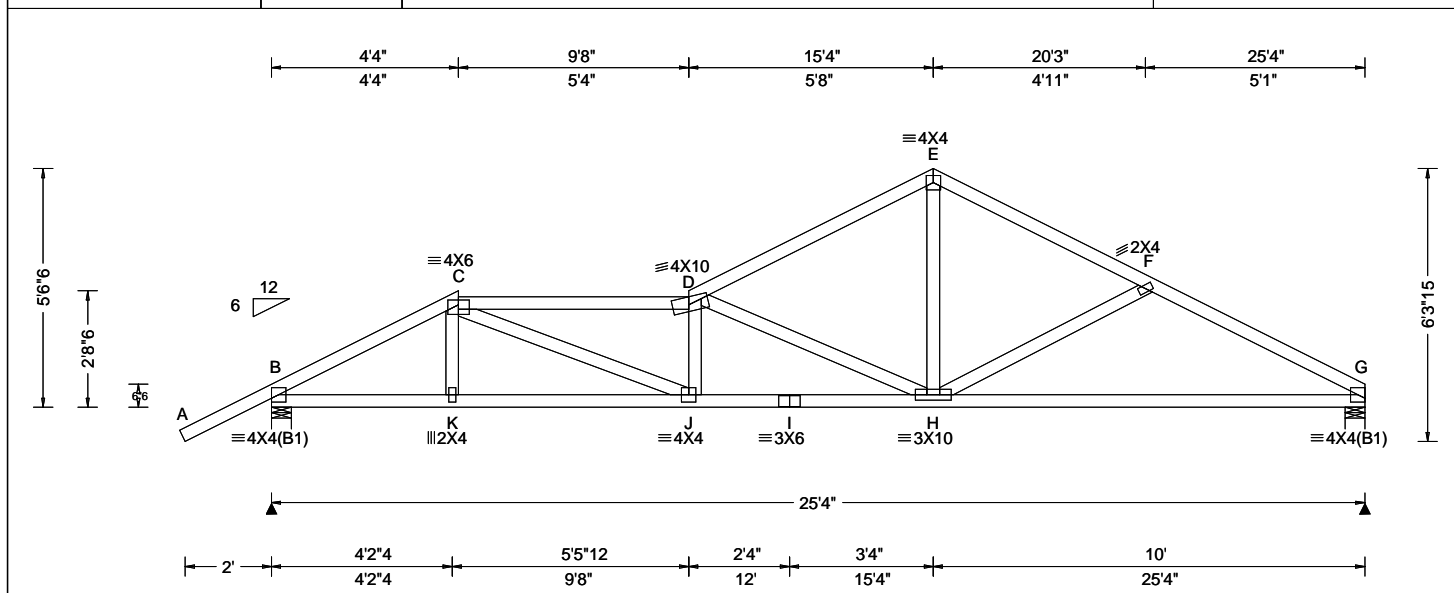

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.140 D 999 360 VERT(CL): 0.261 D 999 240 HORZ(LL): 0.035 H - - HORZ(TL): 0.065 H - - Creep Factor: 2.0 Max TC CSI: 0.970 Max BC CSI: 0.980 Max Web CSI: 0.987 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1088 - / - / /564 /252 /110 G 953 - / - / /486 /201 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 749 -1636 E - F 633 -1321 C - D 1188 -2440 F - G 745 -1593 D - E 638 -1340

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	51	-2.07	4.33
TC	24	4.33	9.67
TC	63	9.67	15.33
TC	56	15.33	25.23
BC	111	0.17	25.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Lumber	Wind	C - D 1217 - 3624 D - E 1464 - 4332	F - G 265 G - H 265	- 727 - 727
Top chord: 2x4 SP #1; Bot chord: 2x4 SP #1; Webs: 2x4 SP #3; W4 2x4 SP #1;	Wind loads and reactions based on MWFRS. Right end vertical exposed to wind pressure. Deflection meets L/180.			
Special Loads		Maximum Bot Chord Forces Per Ply (lbs)		
----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)		Chords	Tens.Comp.	Chords Tens. Comp.
TC: From 56 plf at -2.13 to 56 plf at 2.33		B - N	1490 - 454	L - K 1801 - 544
TC: From 28 plf at 2.33 to 28 plf at 4.40		N - M	1498 - 453	K - J 1099 - 297
TC: From 56 plf at 4.40 to 56 plf at 25.33		M - L	1801 - 544	
BC: From 4 plf at -2.13 to 4 plf at 0.00		Maximum Web Forces Per Ply (lbs)		
BC: From 20 plf at 0.00 to 20 plf at 2.36		Webs	Tens.Comp.	Webs Tens. Comp.
BC: From 10 plf at 2.36 to 10 plf at 4.40		C - M	2202 - 712	F - K 740 - 211
BC: From 20 plf at 4.40 to 20 plf at 25.33		M - D	752 - 2137	F - J 164 - 557
TC: 34 lb Conc. Load at 2.36		M - E	2649 - 873	J - H 1088 - 339
TC: 13 lb Conc. Load at 4.40		E - K	320 - 911	H - I 298 - 916
BC: 92 lb Conc. Load at 2.36				
BC: 39 lb Conc. Load at 4.40				


Purlins			
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:			
Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	44	-2.07	2.33
TC	24	2.33	7.67
TC	32	7.67	15.65
TC	24	15.65	25.33
BC	99	0.17	25.33
Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.			

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBICA: www.sbicindustry.com; ICC: www.iccsafe.org


6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65942 FROM: RNB	SPEC Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: SG2	Cust: R 857 JRef: 1WYP8570001 T18 DrwNo: 259.20.1003.49310 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

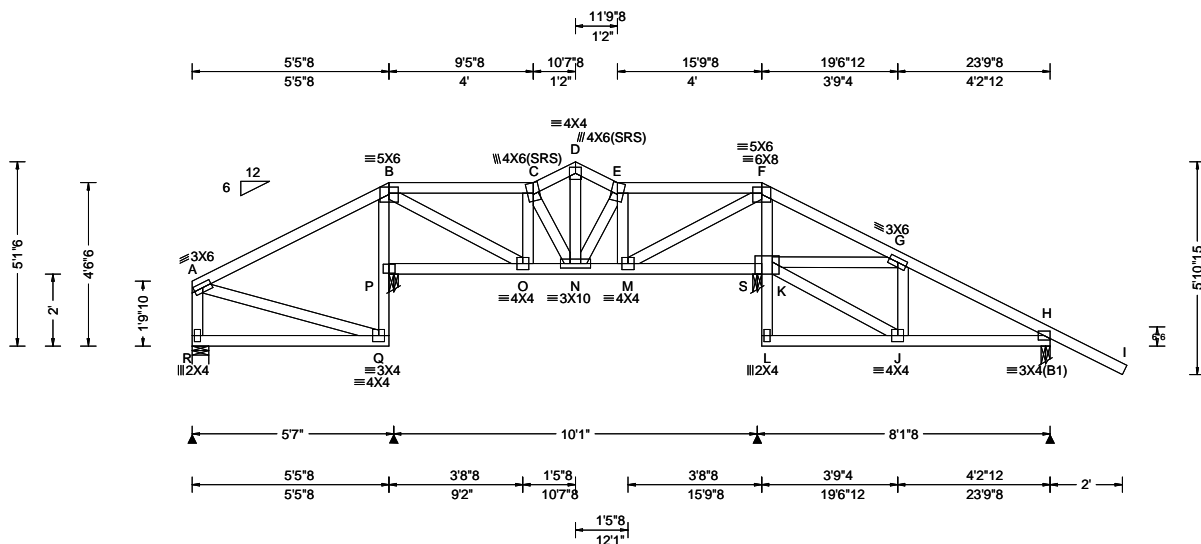

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCCL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.009 E 999 360 VERT(CL): 0.018 E 999 240 HORZ(LL): -0.004 J - - HORZ(TL): 0.007 J - - Creep Factor: 2.0 Max TC CSI: 0.326 Max BC CSI: 0.215 Max Web CSI: 0.223 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL R 184 -/- /- /53 -/ P 1147 -/- /- /360 -/ S 1337 -/- /- /418 -/ H 397 -/- /- /131 -/ Wind reactions based on MWFRS R Brg Width = 5.5 Min Req = 1.5 P Brg Width = 3.0 Min Req = 1.5 S Brg Width = 3.0 Min Req = 1.7 H Brg Width = 3.0 Min Req = 1.5 Bearings R, P, S, & H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. B - C 106 -389 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. O - N 402 -112 N - M 377 -100 Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. P - B 245 -647 M - F 585 -173 B - O 409 -108 F - K 277 -768

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 56 plf at 0.00 to 56 plf at 25.92
 BC: From 20 plf at 0.00 to 20 plf at 23.79
 BC: From 4 plf at 23.79 to 4 plf at 25.92
 TC: 124 lb Conc. Load at 5.46,15.79
 BC: 425 lb Conc. Load at 5.46,15.79

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	73	0.00	5.46
TC	24	5.46	9.46
TC	16	9.46	10.63
TC	16	10.63	11.79
TC	24	11.79	15.79
TC	75	15.79	25.86
BC	62	0.00	5.17
BC	75	5.30	15.86
BC	75	15.94	23.62

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads and reactions based on MWFRS.

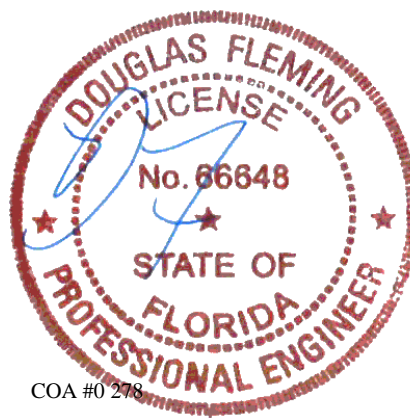

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65955 FROM: RNB	COMN Ply: 1 Qty: 4	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-1	Cust: R 857 JRef: 1WYP8570001 T4 DrwNo: 259.20.0952.08280 SSB / DF 09/15/2020
--------------------------	--------------------------	---	---

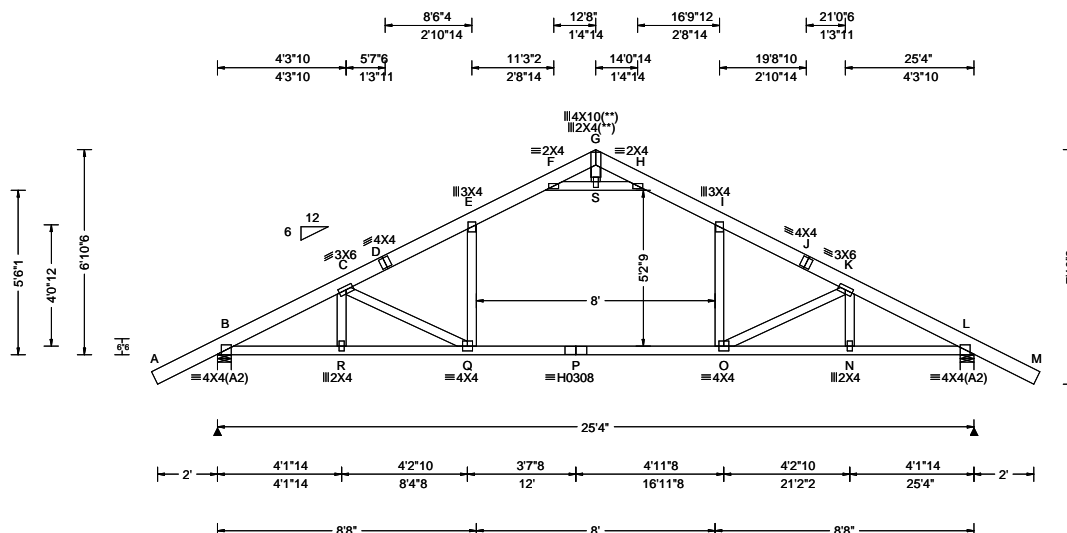

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.133 Q 999 360 VERT(CL): 0.339 Q 887 240 HORZ(LL): 0.061 E - - HORZ(TL): 0.159 E - - Creep Factor: 2.0 Max TC CSI: 0.999 Max BC CSI: 0.984 Max Web CSI: 0.254 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 1203 - / - / - / 580 / 344 / 148 L 1203 - / - / - / 580 / 344 / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 L Brg Width = 5.5 Min Req = 1.5 Bearings B & L Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 661 - 1876 H - I 529 - 1340 C - D 562 - 1675 I - J 562 - 1646 D - E 562 - 1646 J - K 562 - 1675 E - F 529 - 1339 K - L 659 - 1876

Lumber

Top chord: 2x6 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

(**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	63	-2.10	12.67
TC	64	12.67	27.44
BC	120	0.15	25.19
BC	36	11.16	14.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Collar-tie braced with continuous lateral bracing at 24" oc. or rigid ceiling.


Loading

Live loads applied in combination per ASCE 7 sec. 2.4.1 use 0.75 factor for multiple live loads.

BC attic loading: LL = 20.00 psf; DL = 5.00 psf; from 8-8-0 to 16-8-0.

Wind

Wind loads based on MWFRS with additional C&C member design.

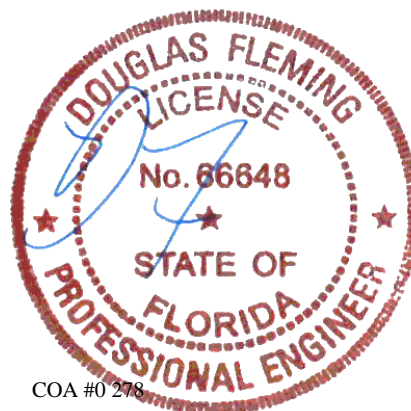

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

The drawing illustrates the structural layout of a bridge deck, including the main span and approach spans. Key features include:

- Top View:** Shows the plan view of the bridge deck with dimensions for the main span (27'1"15) and approach spans (11'5" and 5'8"). It also shows the location of various structural members (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P) and their connections.
- Bottom View:** Shows the underside of the bridge deck with dimensions for the main span (27'1"15) and approach spans (11'5" and 5'8"). It also shows the location of various structural members (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P) and their connections.
- Dimensions:** The main span length is 27'1"15. The approach spans are 11'5" and 5'8". The total length of the bridge is 34'0"10.
- Structural Members:** The bridge deck is composed of several members, including the main span (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P) and the approach spans (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P).
- Connections:** The bridge deck is connected to the approach spans at the main span (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P) and the approach spans (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P).

<p>Lumber</p> <p>Top chord: 2x4 SP #1; Bot chord: 2x4 SP #1; Webs: 2x4 SP #3;</p> <p>Plating Notes</p>	<p>J Brg Width = 1.5 Min Req = 1.5</p> <p>Bearings A, B, & J are a rigid surface.</p> <p>Members not listed have forces less than 375#</p> <p>Maximum Web Forces Per Ply (lbs)</p> <p>_____</p> <p>_____ Webs Tens.Comp.</p> <p>D - O 243 - 403</p>
--	--

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	36	-0.66	2.08
TC	24	2.08	25.08
TC	34	25.08	27.62
BC	75	0.15	27.02


Apply purlins to any chords above or below fillers
at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

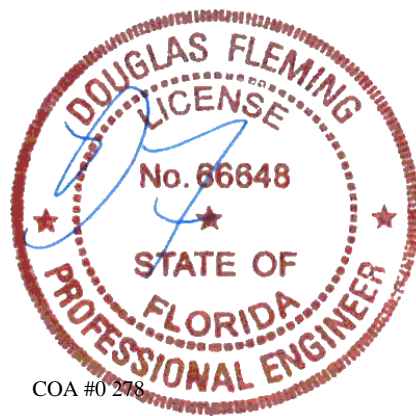


COA #0 278
09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBICA: www.sbcindustry.com; ICC: www.iccsafe.org


6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65893 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-11	Cust: R 857 JRef: 1WYP8570001 T66 DrwNo: 259.20.0952.12620 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

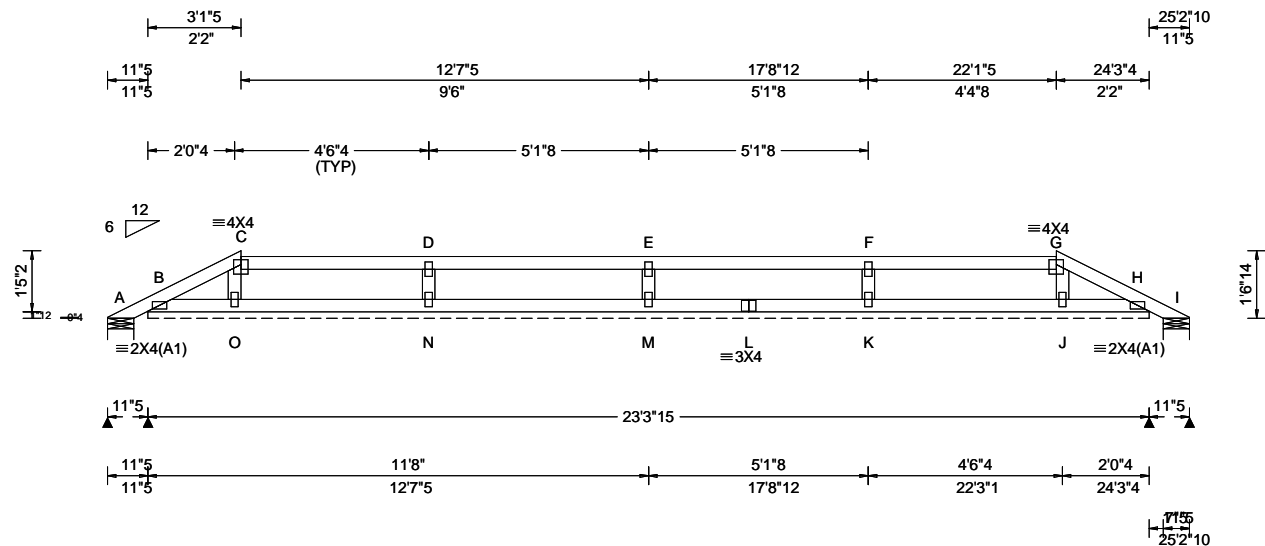

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCCL: 7.00 BCCL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCCL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCCL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.000 O 999 360 VERT(CL): 0.001 O 999 240 HORZ(LL): 0.001 J - - HORZ(TL): 0.001 J - - Creep Factor: 2.0 Max TC CSI: 0.196 Max BC CSI: 0.068 Max Web CSI: 0.056 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL A 14 /- /- /12 /11 /24 B* 79 /- /- /36 /23 /- I 15 /- /- /4 /2 /- O /-101 N /-184 M /-167 K /-184 J /-101 Non-Gravity Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - I Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	38	-0.66	2.16
TC	24	2.16	21.16
TC	38	21.16	23.99
BC	75	0.15	23.18


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

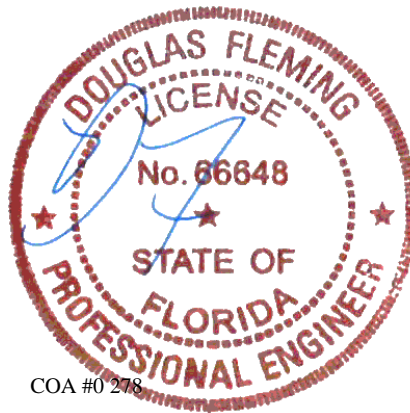

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65894 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-12	Cust: R 857 JRef: 1WYP8570001 T40 DrwNo: 259.20.0952.14173 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

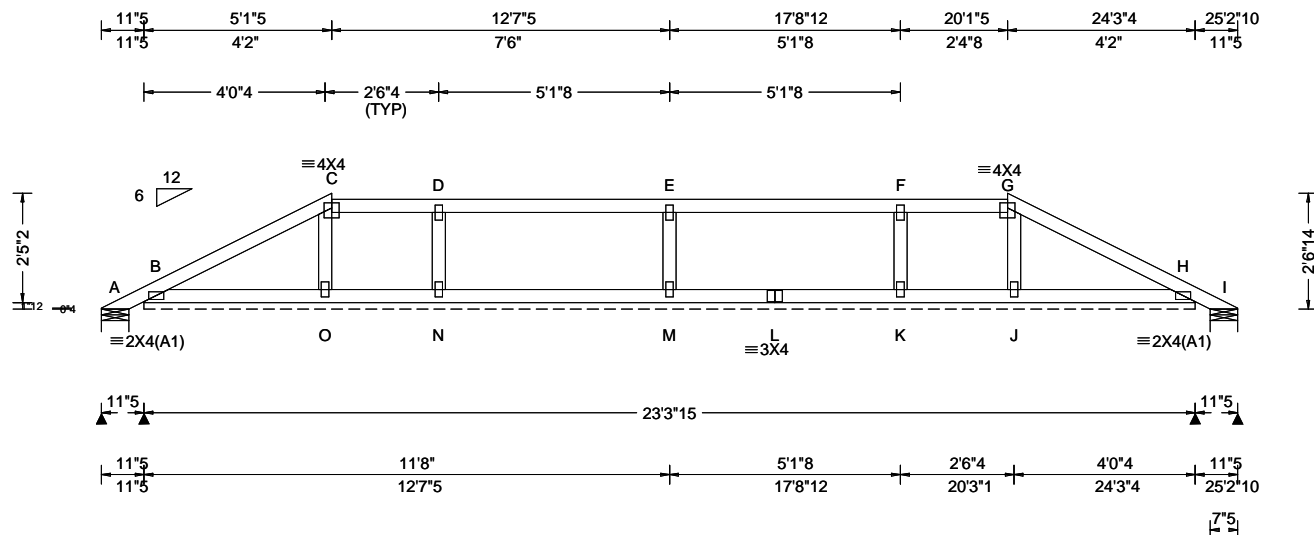

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.002 O 999 360 VERT(CL): 0.003 O 999 240 HORZ(LL): 0.001 J - - HORZ(TL): 0.002 J - - Creep Factor: 2.0 Max TC CSI: 0.196 Max BC CSI: 0.055 Max Web CSI: 0.059 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-58 /- /42 /61 /42 B* 68 /- /- /39 /23 /- I - /-58 /- /23 /42 /- N /-100 M /-130 K /-99 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - I Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	64	-0.66	4.16
TC	24	4.16	19.16
TC	64	19.16	23.99
BC	120	0.15	23.18


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

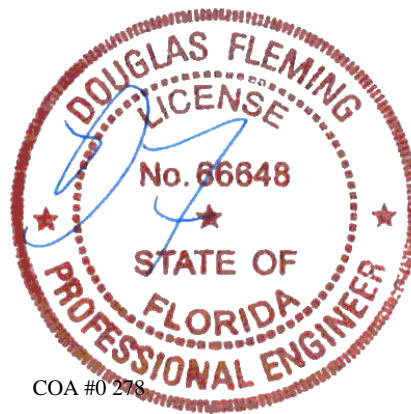

COA #0 278
09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65895 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-13	Cust: R 857 JRef: 1WYP8570001 T57 DrwNo: 259.20.0952.16303 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

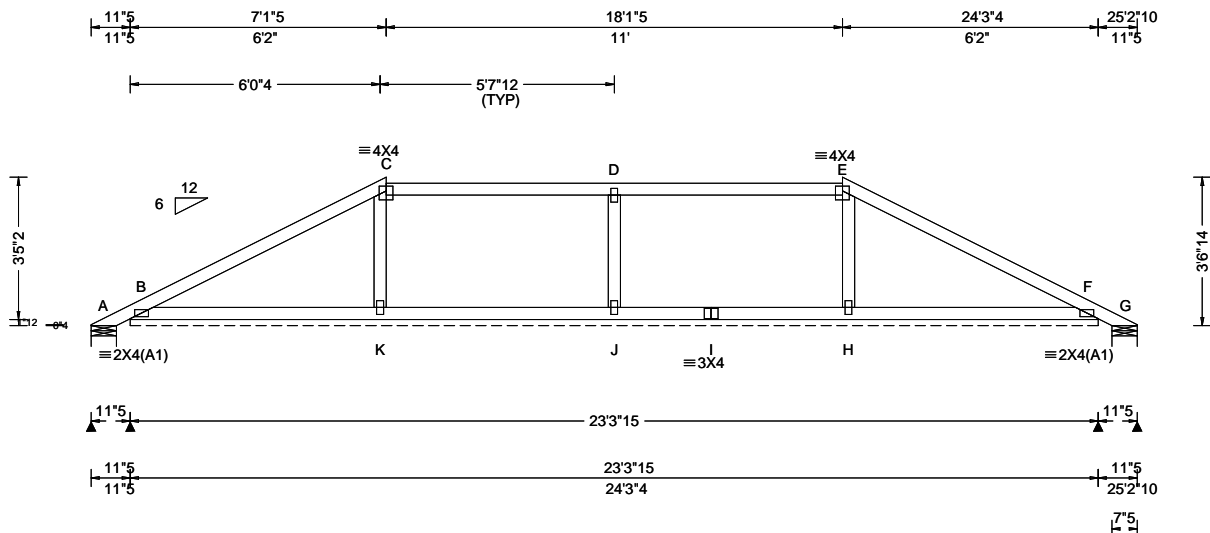

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.005 K 999 360 VERT(CL): 0.008 K 999 240 HORZ(LL): -0.003 H - - HORZ(TL): 0.005 H - - Creep Factor: 2.0 Max TC CSI: 0.324 Max BC CSI: 0.106 Max Web CSI: 0.091 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-185 - /99 /150 /59 B* 79 - /- /45 /25 - G - /-185 - /72 /128 - J - /-164 F - /-159 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. D - J 238 -382

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-0.66	6.16
TC	24	6.16	17.16
TC	75	17.16	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -185# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65896 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-14	Cust: R 857 JRRef: 1WYP8570001 T64 DrwNo: 259.20.0952.18300 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

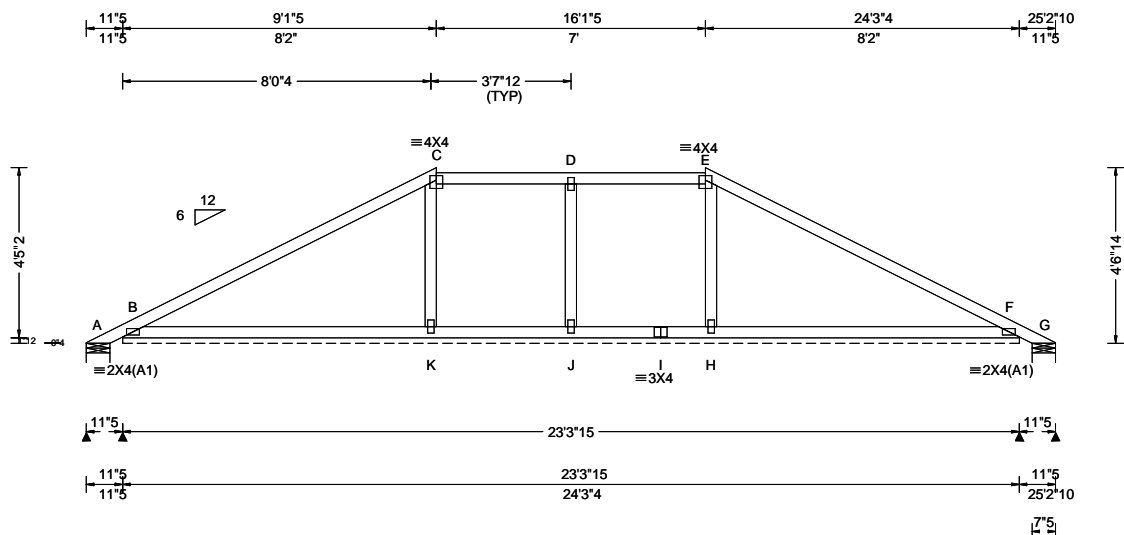

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.011 K 999 360 VERT(CL): 0.016 K 999 240 HORZ(LL): -0.006 H - - HORZ(TL): 0.010 H - - Creep Factor: 2.0 Max TC CSI: 0.630 Max BC CSI: 0.156 Max Web CSI: 0.083 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-378 /- /180 /294 /77 B* 95 /- /- /54 /28 /- G - /-376 /- /146 /257 /- B /-156 J /-103 F /-262 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-0.66	8.16
TC	24	8.16	15.16
TC	75	15.16	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -378# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65897 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-15	Cust: R 857 JRef: 1WYP8570001 T41 DrwNo: 259.20.0952.20370 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

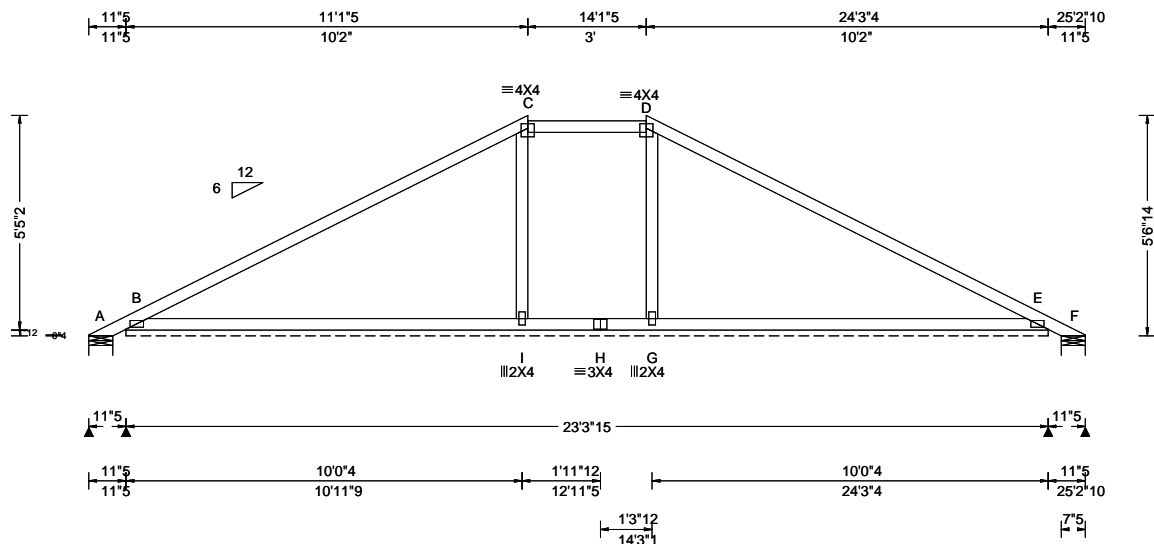

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.017 I 999 360 VERT(CL): 0.026 I 999 240 HORZ(LL): -0.011 G - - HORZ(TL): 0.016 G - - Creep Factor: 2.0 Max TC CSI: 0.997 Max BC CSI: 0.244 Max Web CSI: 0.108 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-636 /- /287 /475 /94 B* 117 /- /- /65 /33 /- F - /-635 /- /245 /432 /- B /-236 H /-114 E /-394 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - F Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & F are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4(A1) except as noted.

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	65	-0.66	10.16
TC	24	10.16	13.16
TC	65	13.16	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -636# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

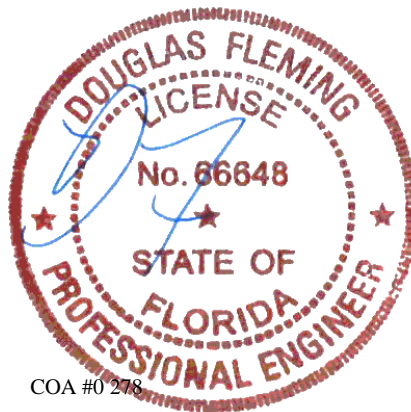

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

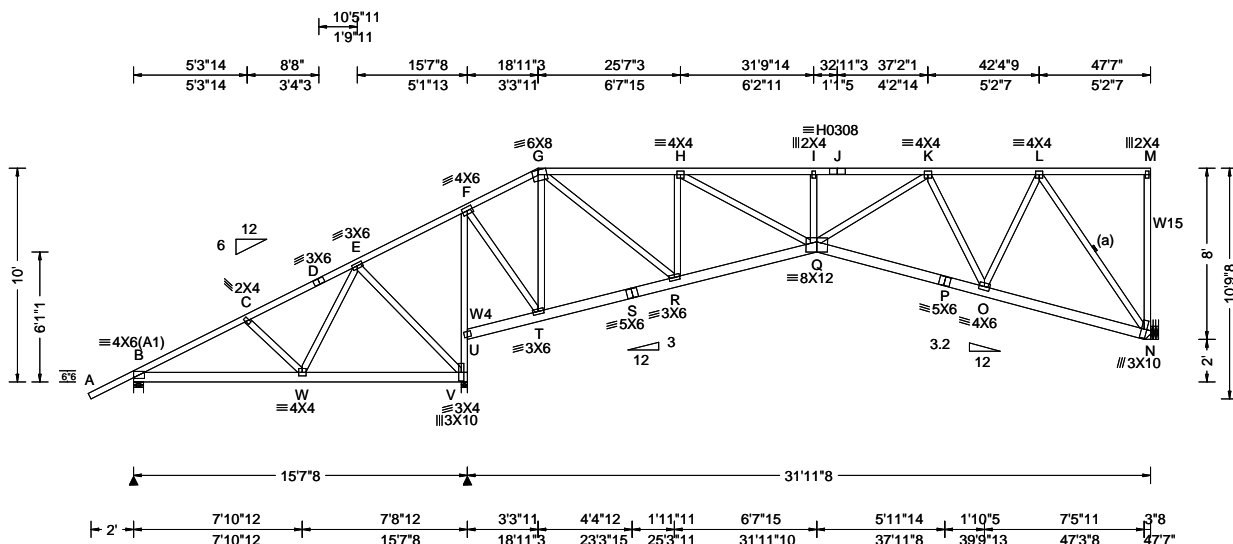

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	GravityNon-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.143 I 999 360	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.271 I 999 240	B 676 -/- /- /354 /136 /278
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.046 N - -	V 1910 -/- /- /1062 /599 -
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.094 N - -	N 1197 -/- /- /556 /362 -
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.762	B Brg Width = 5.5 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.844	V Brg Width = 3.5 Min Req = 2.4
Spacing: 24.0 "	MWFRS Parallel Dist: > 2h	Rep Fac: Yes	Max Web CSI: 0.808	N Brg Width = - Min Req = -
	C&C Dist a: 4.76 ft	FT/RT:20(0)/0(0)		Bearings B & V Fcperp = 425psi.
	Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE, HS	VIEW Ver: 18.02.01A.0205.19	Maximum Top Chord Forces Per Ply (lbs)
	Wind Duration: 1.60			Chords Tens.Comp. Chords Tens. Comp.

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W4 2x4 SP SS Dense;
 W15 2x4 SP #1;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
 Plates sized for a minimum of 3.50 sq.in./piece.


Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	18.93
TC	24	18.93	47.58
BC	120	0.15	15.33
BC	75	15.39	31.97
BC	120	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical exposed to wind pressure.
 Deflection meets L/180.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 Shim all supports to solid bearing.

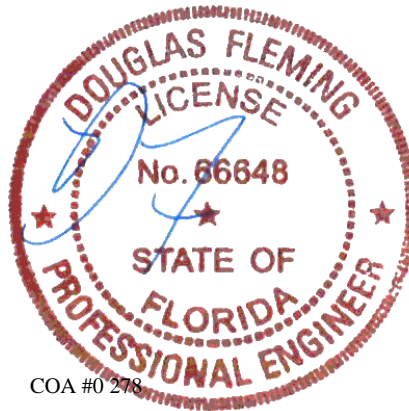

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - W	611 -309	Q - P	1781 -907
T - S	484 -273	P - O	1749 -907
S - R	495 -273	O - N	894 -500
R - Q	1652 -818		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
W - E	453 -140	R - H	533 -1003
E - V	278 -526	H - Q	1265 -621
V - U	855 -1470	Q - K	1181 -547
U - F	834 -1388	K - O	523 -1046
F - T	1043 -558	O - L	1012 -413
G - T	549 -918	L - N	710 -1499
G - R	1389 -648		

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65898	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T78
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1003.52290
Page 2 of 2			Truss Label: T-16	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing N (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

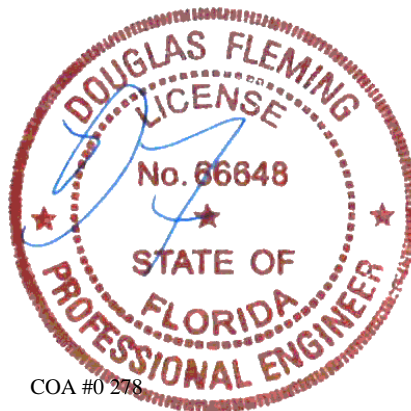

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Lumber	Members not listed have forces less than 375#
Top chord: 2x4 SP #1; Bot chord: 2x4 SP #1; Webs: 2x4 SP #3;	

All plates are 2X4(A1) except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	69	-0.66	10.04
TC	24	10.04	13.29
TC	69	13.29	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -618# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions

Refer to DWG PB160101014 for piggyback details.



COA #0 278
09/15/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.toinst.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org

SEQN: 65900 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-18	Cust: R 857 JRef: 1WYP8570001 T48 DrwNo: 259.20.1003.59333 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

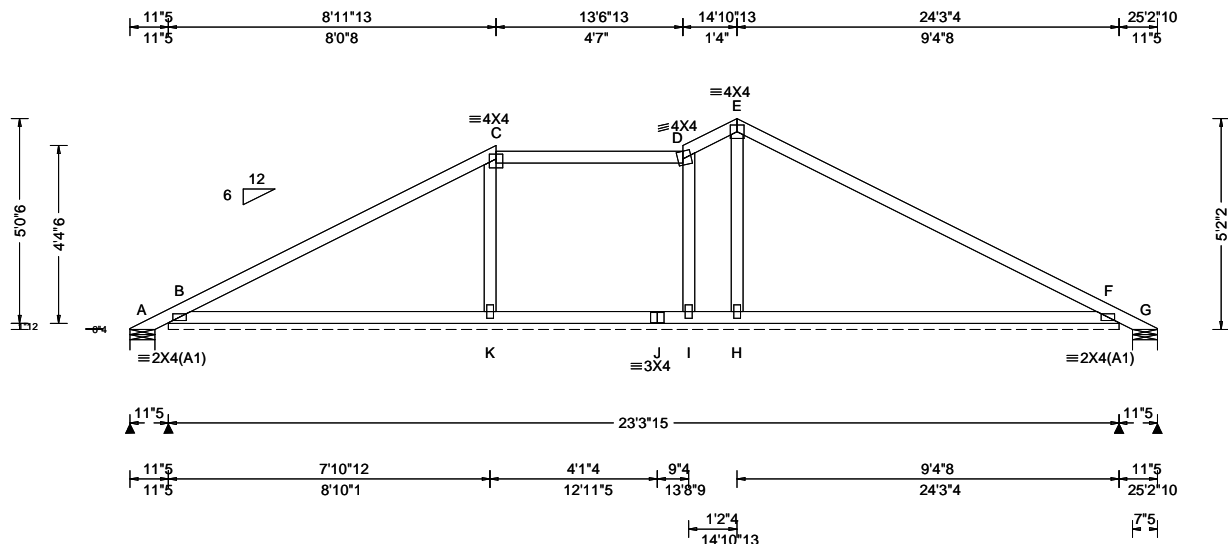

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.015 H 999 360 VERT(CL): 0.022 H 999 240 HORZ(LL): -0.009 H - - HORZ(TL): 0.014 H - - Creep Factor: 2.0 Max TC CSI: 0.855 Max BC CSI: 0.215 Max Web CSI: 0.109 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-364 /- /180 /288 /88 B* 101 /- /- /56 /28 /- G - /-530 /- /205 /364 /- B /-149 I /-117 F /-334 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-0.66	8.04
TC	24	8.04	12.62
TC	18	12.62	13.96
TC	75	13.96	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -530# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

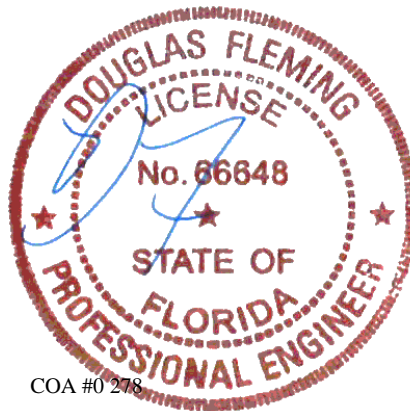

COA #0 278

09/15/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

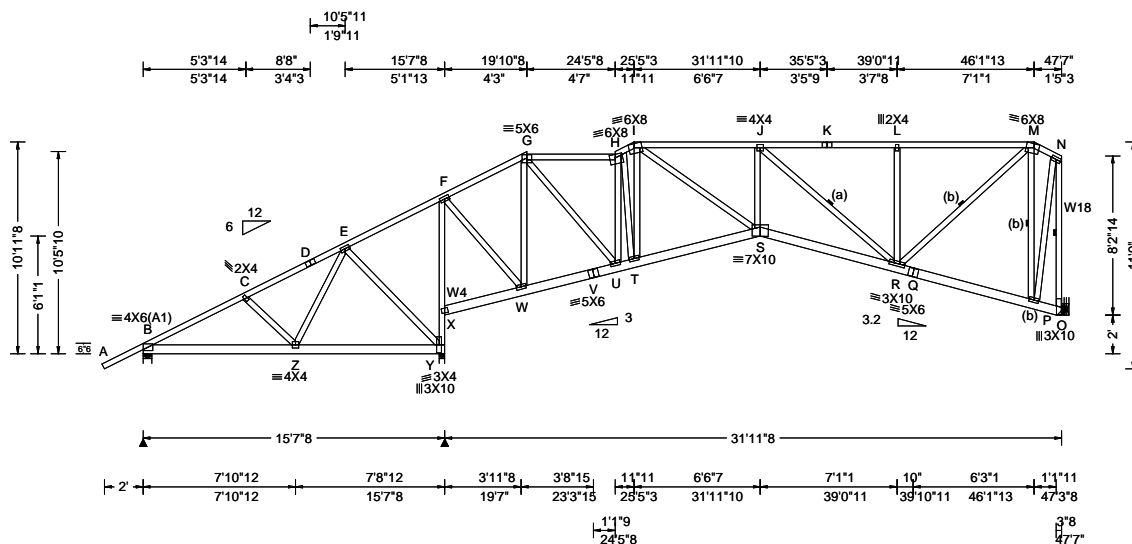

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 4.76 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.119 S 999 360 VERT(CL): 0.224 S 999 240 HORZ(LL): 0.040 O - - HORZ(TL): 0.075 O - - Creep Factor: 2.0 Max TC CSI: 0.689 Max BC CSI: 0.310 Max Web CSI: 0.969 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 648 -/- /- /349 /142 /298 Y 1899 -/- /- /1081 /591 -/ O 1197 -/- /- /569 /339 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 Y Brg Width = 3.5 Min Req = 2.4 O Brg Width = - Min Req = - Bearings B & Y Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber
Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3; W4 2x4 SP SS Dense;
W18 2x4 SP #1;

Bracing
(b) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
(a) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
All plates are 3X6 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.


Purlins
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	19.88
TC	24	19.88	24.46
TC	13	24.46	25.43
TC	24	25.43	46.15
TC	19	46.15	47.58
BC	120	0.15	15.33
BC	75	15.39	31.97
BC	75	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
Wind loads based on MWFRS with additional C&C member design.
Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
Shim all supports to solid bearing.

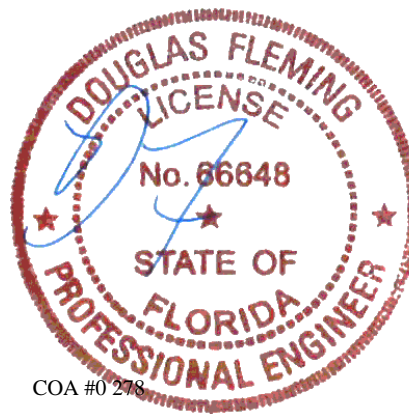

COA #0 278
09/15/2020

Maximum Bot Chord Forces Per Ply (lbs)			
Chords	Tens.Comp.	Chords	Tens. Comp.
B - Z	562 -312	U - T	1304 -710
W - V	597 -366	T - S	1354 -735
V - U	602 -366	S - R	2229 -1178

Maximum Web Forces Per Ply (lbs)			
Webs	Tens.Comp.	Webs	Tens. Comp.
Z - E	385 -141	I - S	1020 -516
E - Y	272 -520	J - S	442 -183
Y - X	884 -1461	J - R	614 -1228
X - F	867 -1378	R - L	262 -420
F - W	1008 -580	R - M	1365 -654
W - G	556 -867	P - M	637 -1100
G - U	1138 -555	P - N	1130 -587
H - U	478 -951	N - O	560 -1174

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65901	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T42
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1004.02190
Page 2 of 2			Truss Label: T-19	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing O (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

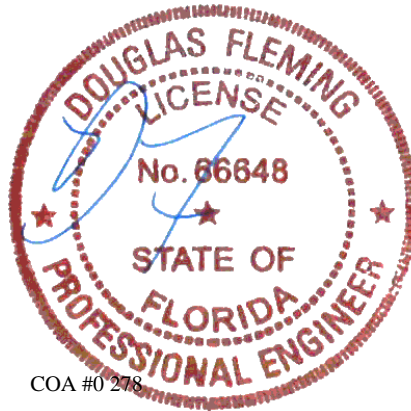

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65902 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-2	Cust: R 857 JRef: 1WYP8570001 T21 DrwNo: 259.20.1004.04213 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

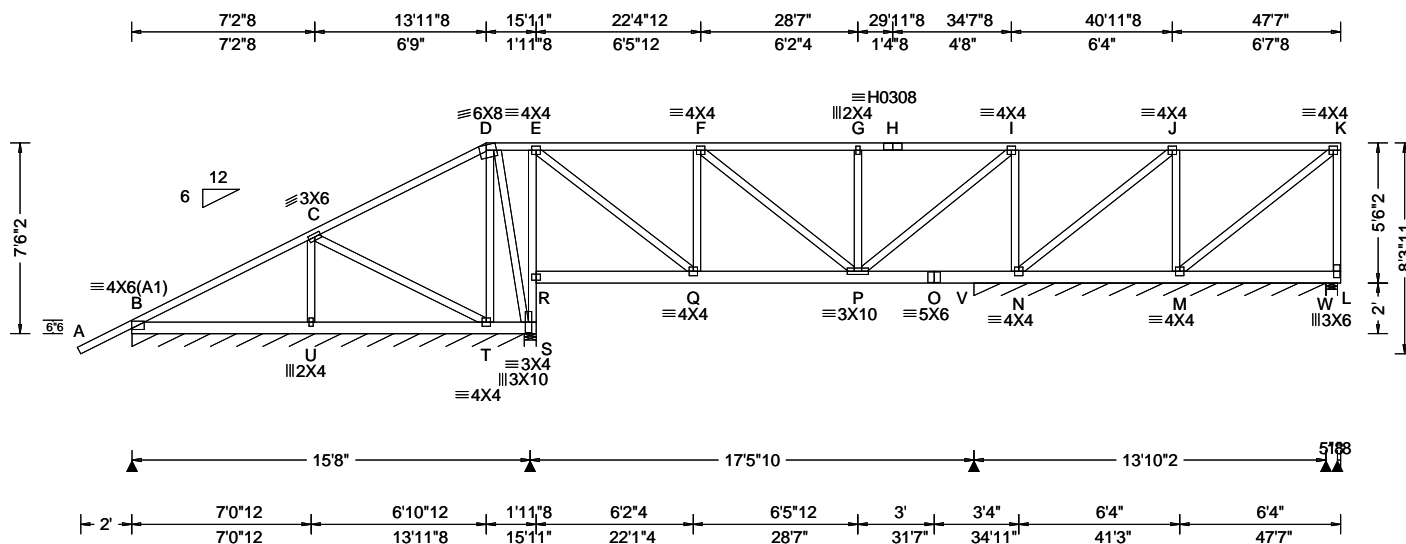

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 4.76 ft Loc. from endwall: not in 6.50 ft GCp: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.019 G 999 360 VERT(CL): 0.036 G 999 240 HORZ(LL): -0.006 L - - HORZ(TL): 0.011 I - - Creep Factor: 2.0 Max TC CSI: 0.497 Max BC CSI: 0.176 Max Web CSI: 0.497 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B* 76 -/- /- /46 /23 /13 S 842 -/- /- /380 /255 -/ V* 118 -/- /- /56 /39 -/ W 169 -/- /- /60 /48 -/ Wind reactions based on MWFRS B Brg Width = 185 Min Req = - S Brg Width = 5.5 Min Req = 1.5 V Brg Width = 166 Min Req = - W Brg Width = 5.5 Min Req = 1.5 Bearings B, S, V, & W Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	13.96
TC	24	13.96	47.58
BC	120	0.02	15.62
BC	75	15.71	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind


Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

Right cantilever is not exposed to wind

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

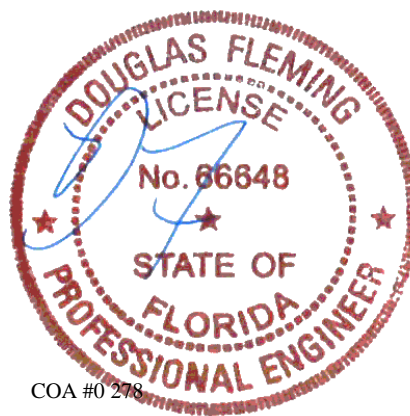


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65903 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-20	Cust: R 857 JRRef: 1WYP8570001 T52 DrwNo: 259.20.1004.06017 SSB / DF 09/15/2020
--------------------------	--------------------------	--	---

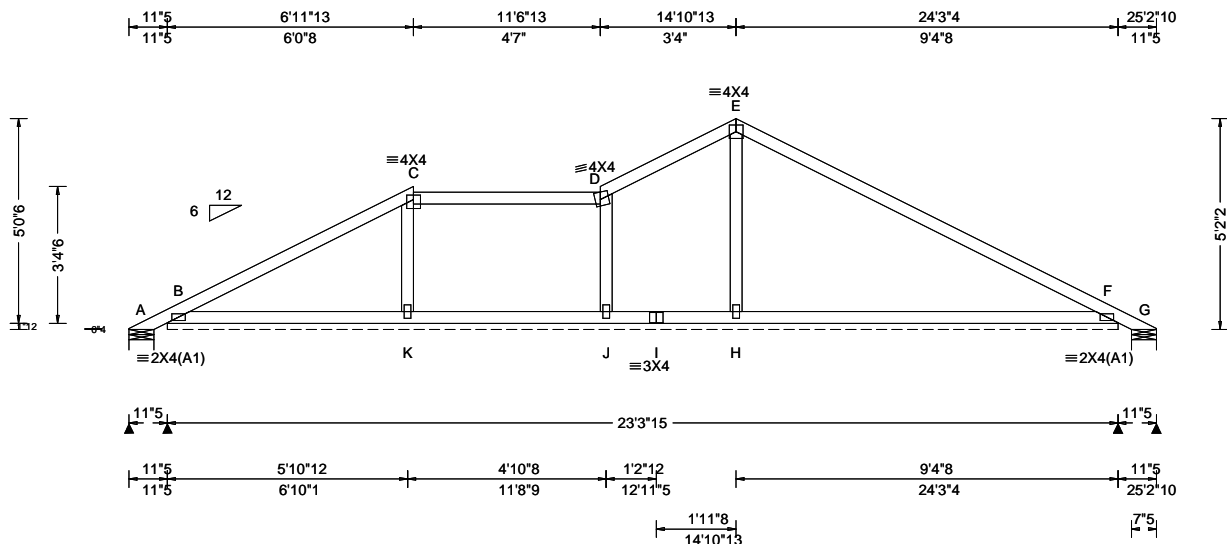

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.015 H 999 360 VERT(CL): 0.022 H 999 240 HORZ(LL): -0.009 H - - HORZ(TL): 0.013 H - - Creep Factor: 2.0 Max TC CSI: 0.846 Max BC CSI: 0.202 Max Web CSI: 0.080 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL A - /-172 - /108 /156 /88 B* 93 - /- /53 /26 - G - /-533 - /205 /367 - J - /-125 F - /-335 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-0.66	6.04
TC	24	6.04	10.62
TC	45	10.62	13.96
TC	75	13.96	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -533# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

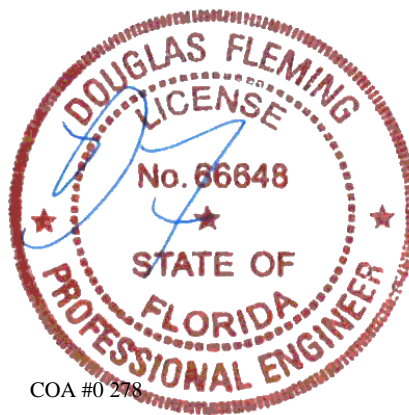

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

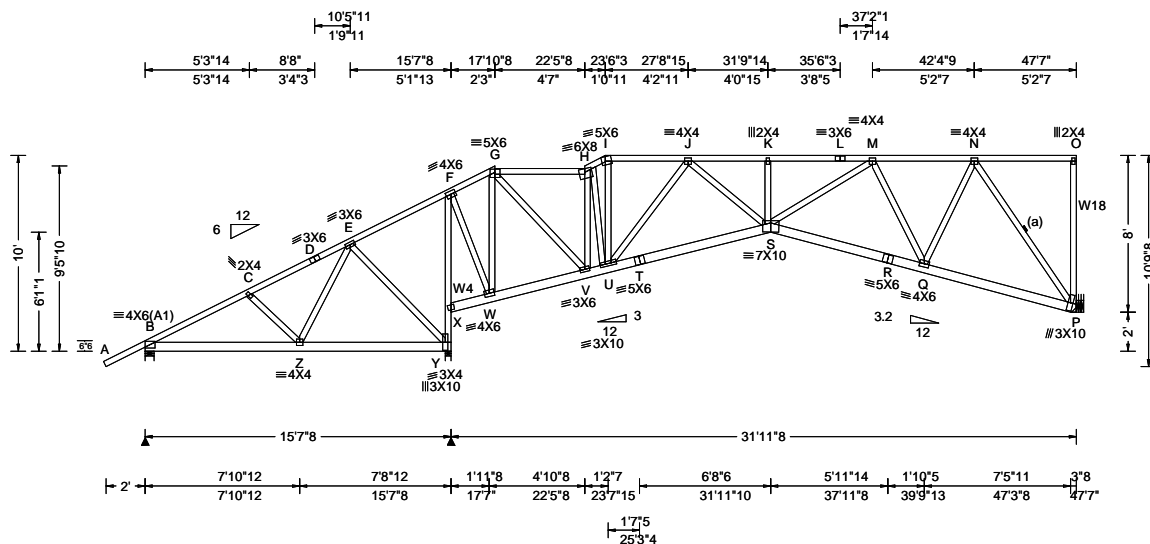

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.137 K 999 360 VERT(CL): 0.259 K 999 240 HORZ(LL): 0.046 P - - HORZ(TL): 0.086 P - - Creep Factor: 2.0 Max TC CSI: 0.662 Max BC CSI: 0.839 Max Web CSI: 0.999 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 638 -/- /- /353 /136 /277 Y 1914 -/- /- /1061 /597 -/ P 1191 -/- /- /555 /362 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 Y Brg Width = 3.5 Min Req = 2.4 P Brg Width = - Min Req = - Bearings B & Y Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber
Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3; W4 2x4 SP SS Dense;
W18 2x4 SP #1;

Bracing
(a) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	17.88
TC	24	17.88	22.46
TC	15	22.46	23.52
TC	24	23.52	47.58
BC	120	0.15	15.33
BC	75	15.33	31.97
BC	120	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind
Wind loads based on MWFRS with additional C&C member design.
Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
Shim all supports to solid bearing.

Chords	Tens.Comp.	Chords	Tens. Comp.
B - C	333 -668	I - J	739 -1219
C - D	284 -474	J - K	1280 -2671
D - E	284 -389	K - L	1273 -2660
E - F	231 -429	L - M	1273 -2660
G - H	712 -1136	M - N	672 -1258
H - I	821 -1387		

Chords	Tens.Comp.	Chords	Tens. Comp.
B - Z	543 -308	S - R	1774 -918
V - U	1163 -601	R - Q	1743 -918
U - T	1912 -997	Q - P	887 -503
T - S	1945 -997		

Webs	Tens.Comp.	Webs	Tens. Comp.
Z - E	387 -140	I - U	520 -292
E - Y	283 -522	U - J	565 -1111
Y - X	888 -1476	J - S	1046 -498
X - F	853 -1379	S - M	1164 -552
F - W	1019 -566	M - Q	534 -1049
W - G	615 -1029	Q - N	1004 -420
G - V	1305 -628	N - P	715 -1487
H - V	541 -1122		

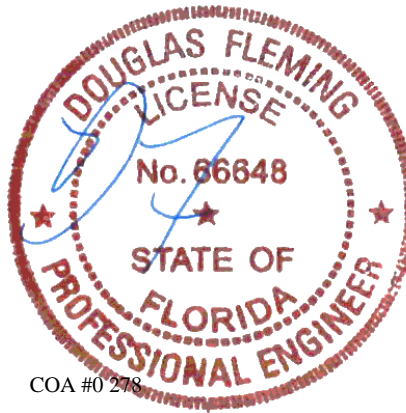

COA #0 278
09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65904	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T75
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0952.32133
Page 2 of 2			Truss Label: T-21	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing P (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

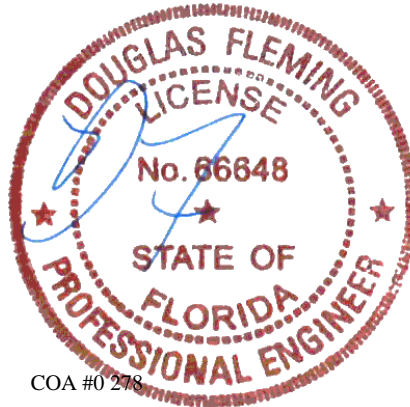

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65905 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-22	Cust: R 857 JRef: 1WYP8570001 T19 DrwNo: 259.20.0953.54987 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

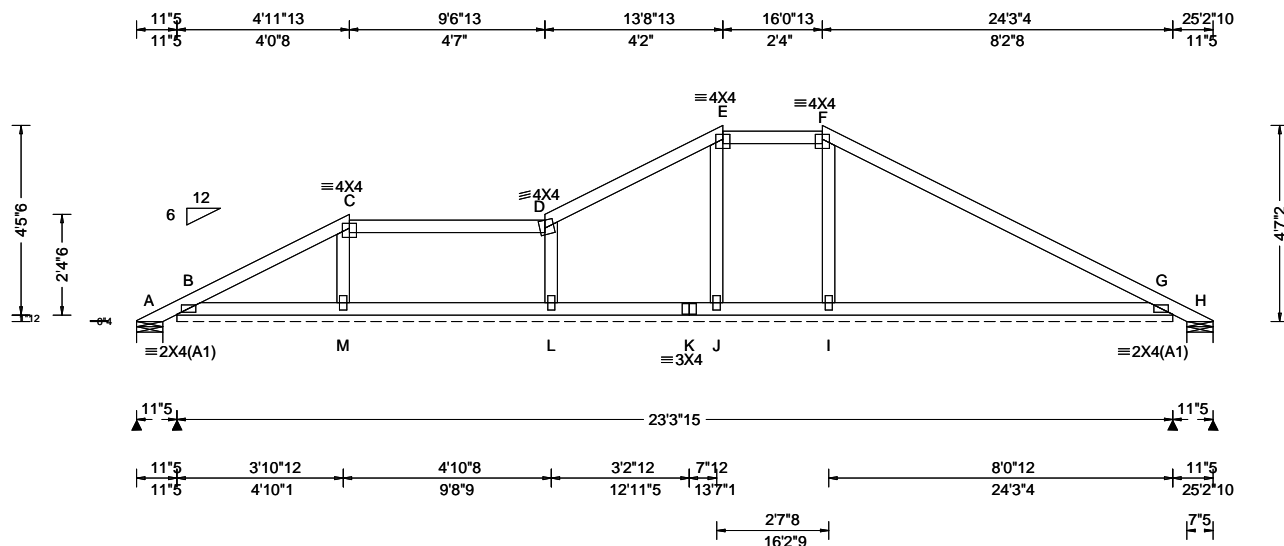

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.011 I 999 360 VERT(CL): 0.016 I 999 240 HORZ(LL): -0.006 I - - HORZ(TL): 0.009 I - - Creep Factor: 2.0 Max TC CSI: 0.610 Max BC CSI: 0.145 Max Web CSI: 0.077 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A - /-48 /- /56 /67 /77 B* 81 /- /- /47 /24 /- H - /-387 /- /149 /265 /- L /-119 G /-260 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - H Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & H are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	63	-0.66	4.04
TC	24	4.04	8.62
TC	56	8.62	12.79
TC	24	12.79	15.12
TC	75	15.12	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -387# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

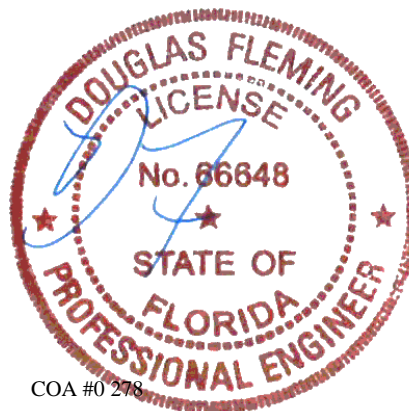

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

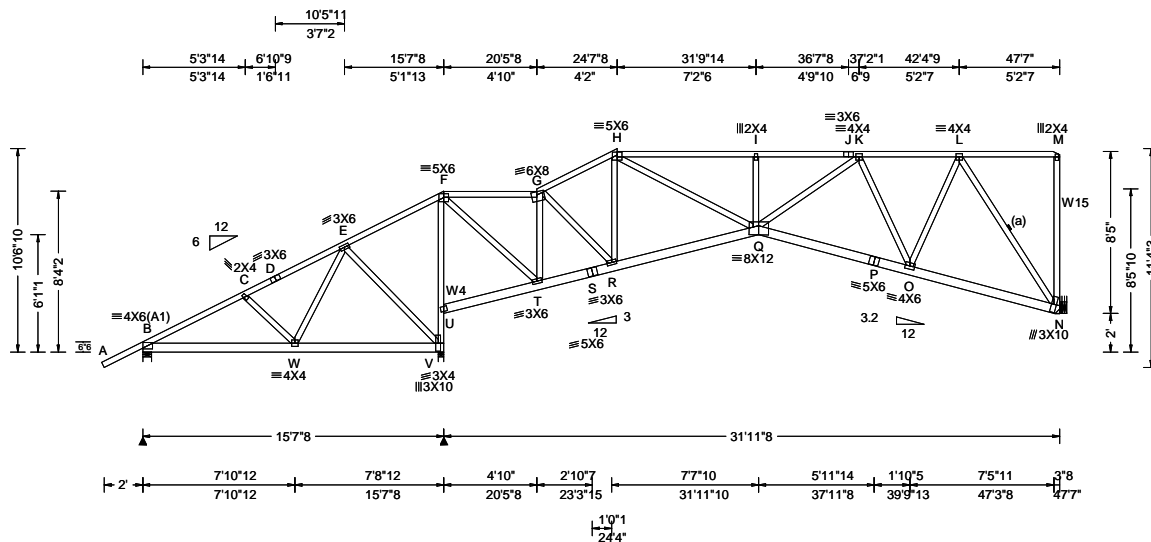

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	GravityNon-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.126 I 999 360	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.238 I 999 240	B 678 -/- /- /350 /139 /291
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.044 U - -	V 1910 -/- /- /1067 /596 -
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.083 U - -	N 1192 -/- /- /555 /355 -
NCBCLL: 10.00	Mean Height: 15.10 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.769	B Brg Width = 5.5 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.746	V Brg Width = 3.5 Min Req = 2.4
Spacing: 24.0 "	MWFRS Parallel Dist: > 2h	Rep Fac: Yes	Max Web CSI: 0.831	N Brg Width = - Min Req = -
	C&C Dist a: 4.76 ft	FT/RT:20(0)/0(0)		Bearings B & V Fcperp = 425psi.
	Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE	VIEW Ver: 18.02.01A.0205.19	Maximum Top Chord Forces Per Ply (lbs)
	Wind Duration: 1.60			Chords Tens.Comp. Chords Tens. Comp.

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W4 2x4 SP SS Dense;
 W15 2x4 SP #1;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
 Plates sized for a minimum of 3.50 sq.in./piece.


Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 Shim all supports to solid bearing.

Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	15.62
TC	24	15.62	20.46
TC	56	20.46	24.62
TC	24	24.62	47.53
BC	120	0.15	15.33
BC	75	15.41	31.97
BC	120	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical exposed to wind pressure.
 Deflection meets L/180.

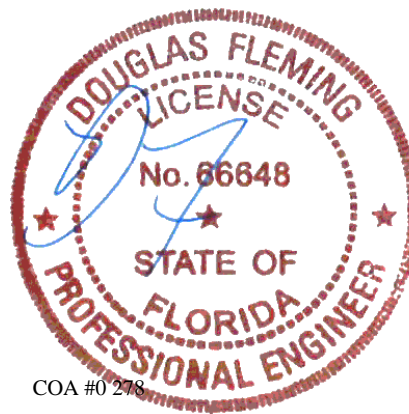

COA #0 278
 09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
 AN ITW COMPANY
 6750 Forum Drive
 Suite 305
 Orlando FL, 32821

SEQN: 65953	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T49
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1004.09010
Page 2 of 2			Truss Label: T-23	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing N (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

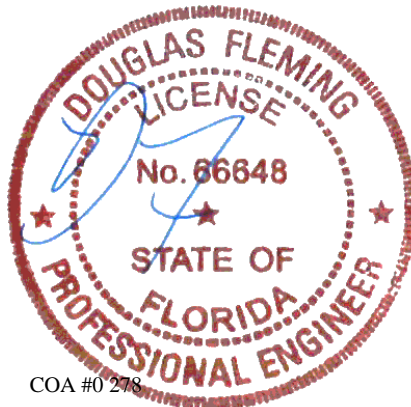

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65907 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-24	Cust: R 857 JRef: 1WYP8570001 T20 DrwNo: 259.20.1004.10523 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

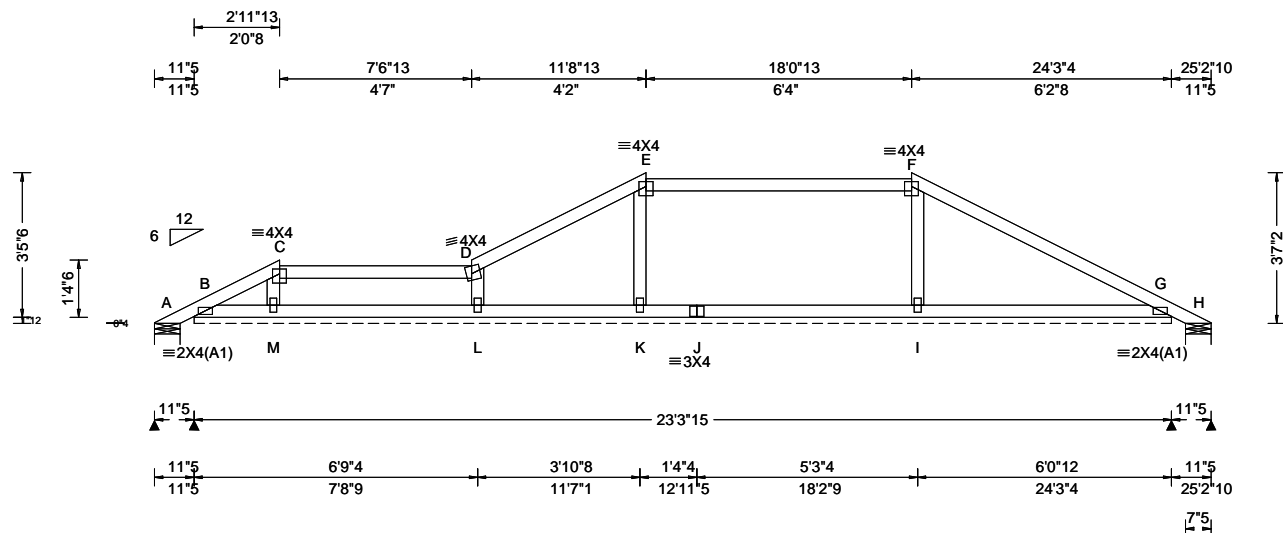

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.006 I 999 360 VERT(CL): 0.008 I 999 240 HORZ(LL): -0.003 I - - HORZ(TL): 0.004 I - - Creep Factor: 2.0 Max TC CSI: 0.516 Max BC CSI: 0.136 Max Web CSI: 0.073 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL A 13 /- /- /31 /28 /60 B* 70 /- /- /40 /22 /- H - /-191 /- /74 /128 /- L /-109 I /-111 G /-158 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 279 Min Req = - H Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & H are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	36	-0.66	2.04
TC	24	2.04	6.62
TC	56	6.62	10.79
TC	24	10.79	17.12
TC	75	17.12	23.99
BC	120	0.15	23.18

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -191# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

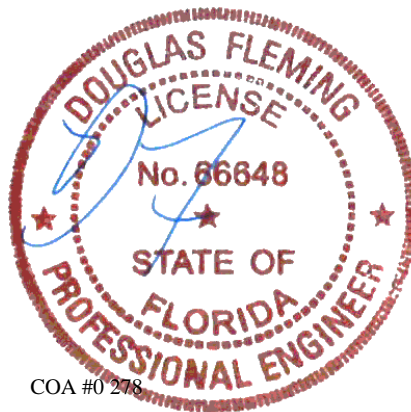

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65908 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-25	Cust: R 857 JRef: 1WYP8570001 T54 DrwNo: 259.20.1004.12557 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

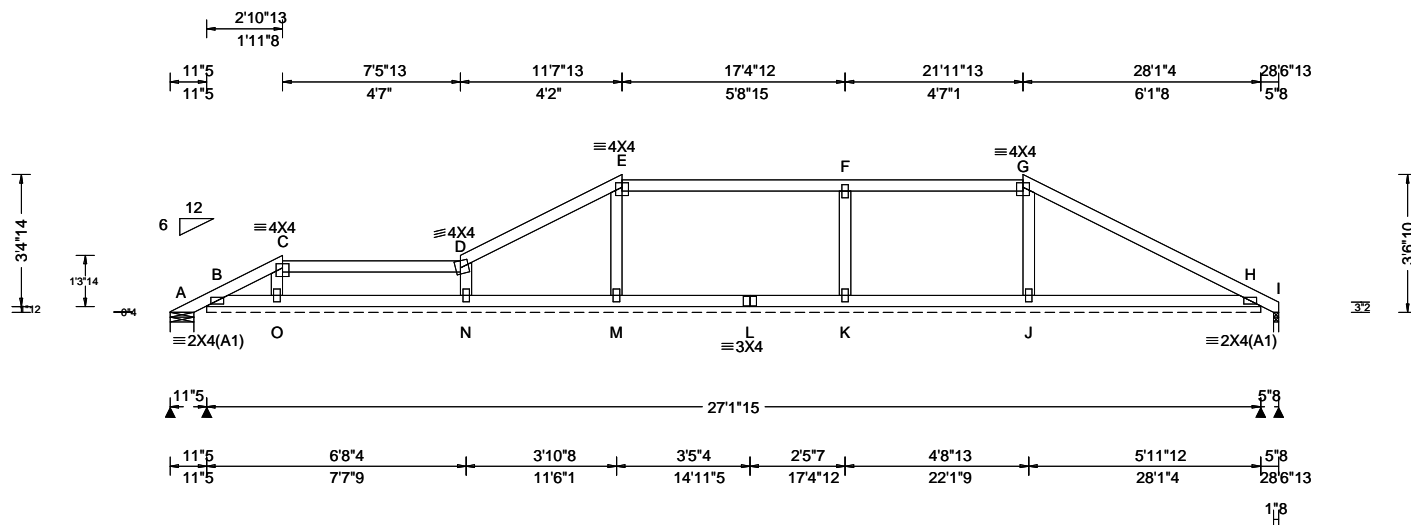

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.005 J 999 360 VERT(CL): 0.011 J 999 240 HORZ(LL): 0.003 J - - HORZ(TL): 0.005 J - - Creep Factor: 2.0 Max TC CSI: 0.309 Max BC CSI: 0.137 Max Web CSI: 0.086 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 22 - / - /30 /27 /58 B* 90 - / - /41 /23 - /- I - /-298 - /102 /174 - /- N - /-229 M - /-118 K - /-220 J - /-134 H - /-356 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 325 Min Req = - I Brg Width = 1.5 Min Req = 1.5 Bearings A, B, & I are a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	35	-0.66	1.96
TC	24	1.96	6.54
TC	56	6.54	10.71
TC	24	10.71	21.04
TC	75	21.04	27.62
BC	120	0.15	27.02

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -298# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

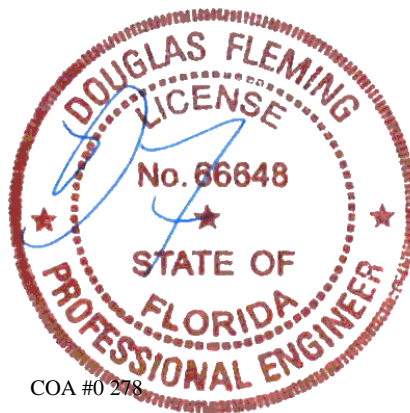

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

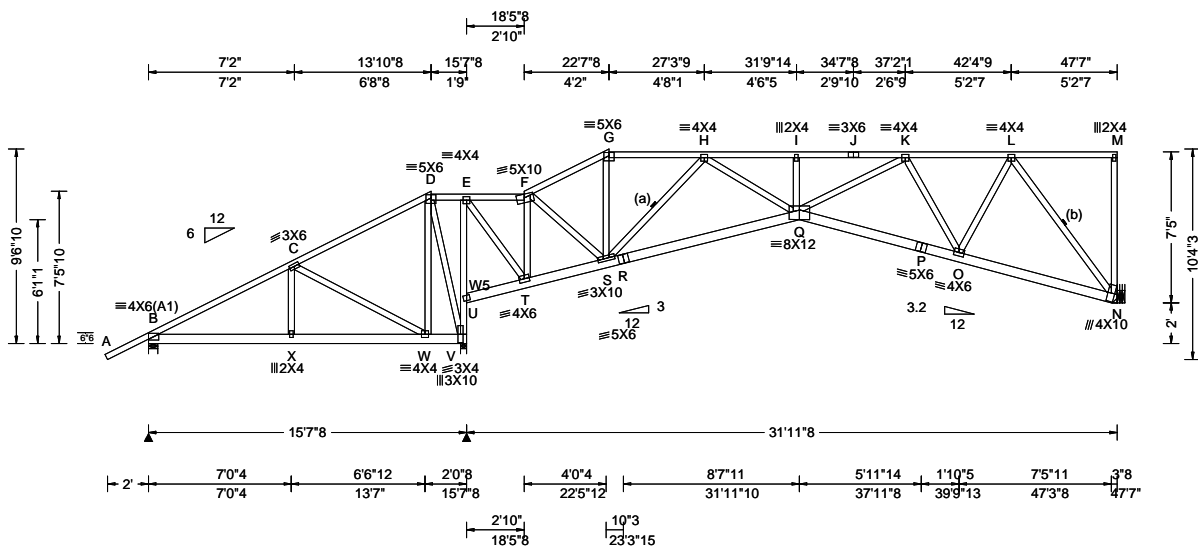

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	GravityNon-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.167 I 999 360	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.315 I 999 240	B 672 -/- -/ /354 /127 /261
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.056 N - -	V 1931 -/- -/ /1047 /588 -/
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.109 N - -	N 1187 -/- -/ /550 /366 -/
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.685	B Brg Width = 5.5 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.976	V Brg Width = 3.5 Min Req = 2.4
Spacing: 24.0 "	MWFRS Parallel Dist: > 2h	Rep Fac: Yes	Max Web CSI: 0.930	N Brg Width = - Min Req = -
	C&C Dist a: 4.76 ft	FT/RT:20(0)/0(0)		Bearings B & V Fcperp = 425psi.
	Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE	VIEW Ver: 18.02.01A.0205.19	Maximum Top Chord Forces Per Ply (lbs)
	Wind Duration: 1.60			Chords Tens.Comp. Chords Tens. Comp.

Lumber
 Top chord: 2x4 SP #1;
 Bot chord: 2x6 SP #1;
 Webs: 2x4 SP #3; W5 2x4 SP SS Dense;

Bracing
 (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
 (b) Continuous lateral restraint equally spaced on member. Or 2x6 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes
 Plates sized for a minimum of 3.50 sq.in./piece.


Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	13.88
TC	24	13.88	18.46
TC	56	18.46	22.62
TC	24	22.62	47.58
BC	75	0.15	15.33
BC	75	15.42	31.97
BC	117	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical exposed to wind pressure.
 Deflection meets L/180.

Additional Notes
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 Shim all supports to solid bearing.

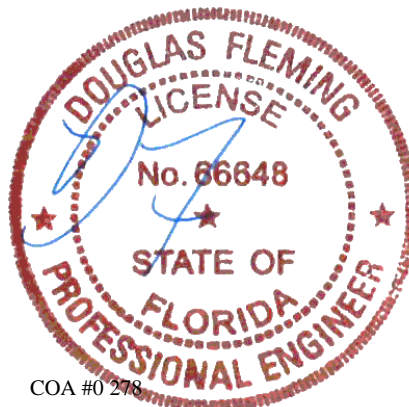

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org

SEQN: 65909	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T85
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1004.15400
Page 2 of 2			Truss Label: T-26	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing N (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

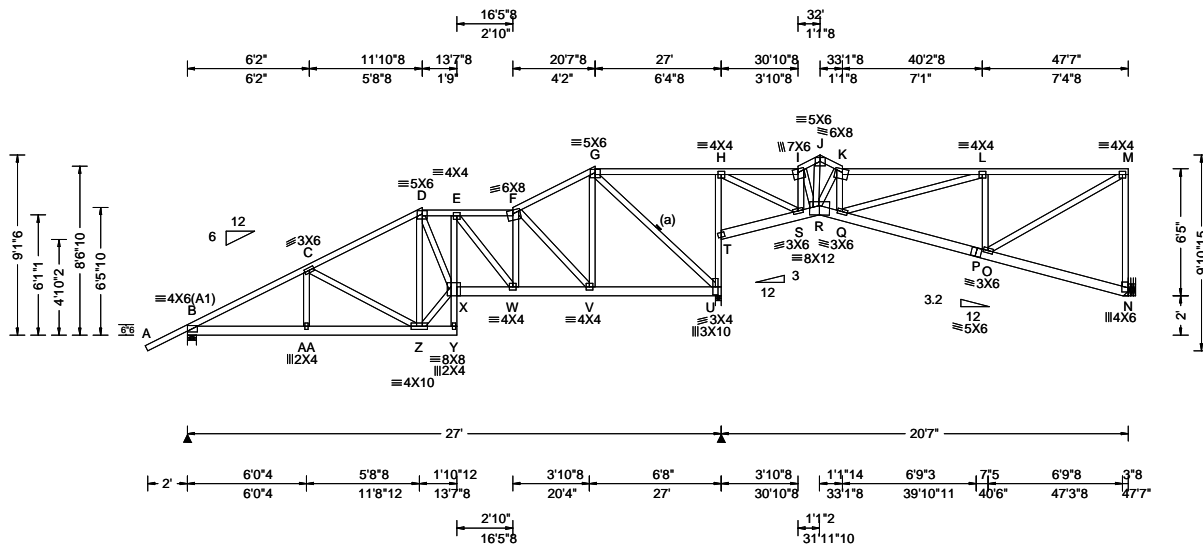

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 4.76 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.085 X 999 360 VERT(CL): 0.162 X 999 240 HORZ(LL): 0.035 U - - HORZ(TL): 0.068 U - - Creep Factor: 2.0 Max TC CSI: 0.999 Max BC CSI: 0.406 Max Web CSI: 0.991 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1125 -/- /- /632 /219 /238 U 1864 -/- /- /952 /475 -/ N 767 -/- /- /367 /219 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 U Brg Width = 3.5 Min Req = 2.3 N Brg Width = - Min Req = - Bearings B & U Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber
Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3;

Bracing
(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Plating Notes
Plates sized for a minimum of 3.50 sq.in./piece.

Wind
Wind loads based on MWFRS with additional C&C member design.
Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
Shim all supports to solid bearing.


Maximum Bot Chord Forces Per Ply (lbs)			
Chords	Tens.Comp.	Chords	Tens. Comp.
B - C	725 -1647	H - I	551 -958
C - D	655 -1279	I - J	624 -1161
D - E	920 -1678	J - K	658 -1190
E - F	865 -1490	K - L	759 -1394
F - G	562 -895	L - M	540 -930

Maximum Web Forces Per Ply (lbs)			
Webs	Tens.Comp.	Webs	Tens. Comp.
C - Z	219 -375	H - S	1170 -552
Z - D	721 -986	I - S	393 -768
Z - X	1719 -1125	R - J	1096 -591
D - X	1424 -808	R - K	428 -781
F - V	625 -1067	Q - L	448 -207
V - G	901 -452	L - O	366 -627
G - U	676 -1095	O - M	1079 -494
U - T	551 -1039	M - N	358 -708
T - H	528 -949		

Purlins
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	55	-2.07	11.88
TC	24	11.88	16.46
TC	56	16.46	20.62
TC	24	20.62	30.87
TC	15	30.87	32.00
TC	15	32.00	33.12
TC	24	33.12	47.58
BC	120	0.15	13.48
BC	120	13.53	26.71
BC	63	26.85	31.97
BC	75	31.97	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

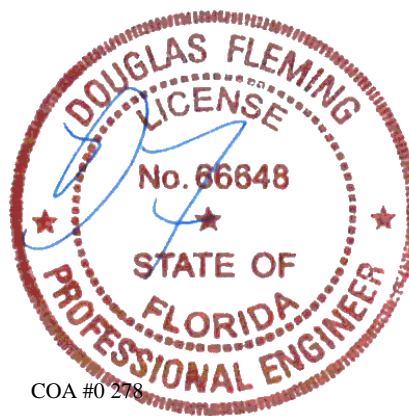

COA #0 278
09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
an ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65950	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T71
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1004.19380
Page 2 of 2			Truss Label: T-27	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing N (47'4", 12'1"2) LUS26

Supporting Member: (3)2x8 SP SS Dense

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

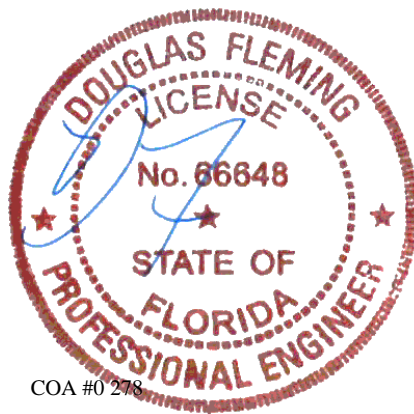

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65911 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-28	Cust: R 857 JRef: 1WYP8570001 T30 DrwNo: 259.20.1004.21480 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

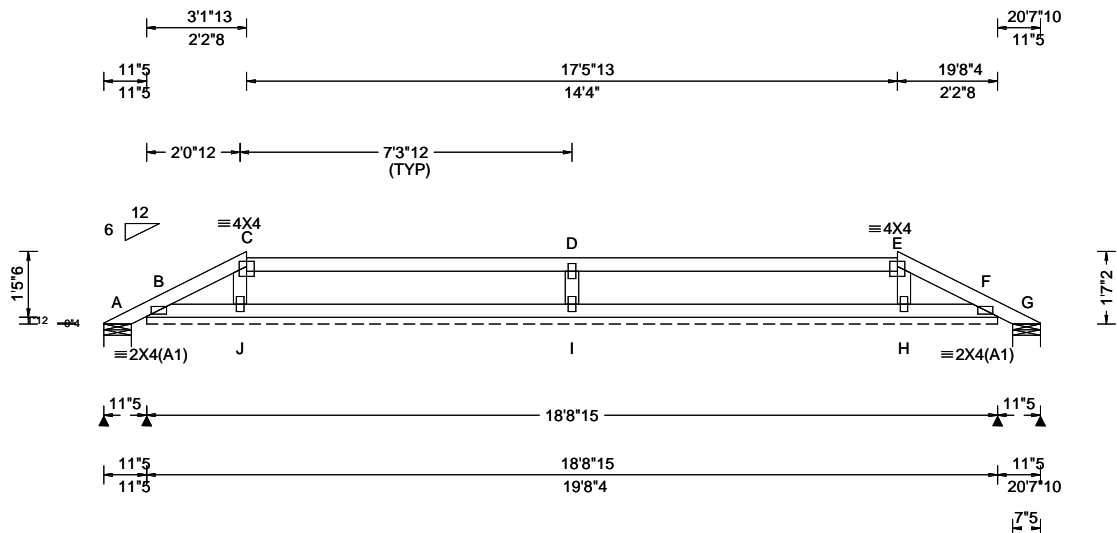

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 D 999 360 VERT(CL): 0.001 D 999 240 HORZ(LL): 0.001 H - - HORZ(TL): 0.001 H - - Creep Factor: 2.0 Max TC CSI: 0.505 Max BC CSI: 0.136 Max Web CSI: 0.091 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 7 /- /- /18 /11 /25 B* 63 /- /- /36 /23 /- G 7 /- /- /8 /2 /- I /-213 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 224 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp.

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	38	-0.66	2.21
TC	24	2.21	16.54
TC	38	16.54	19.40
BC	75	0.15	18.60


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

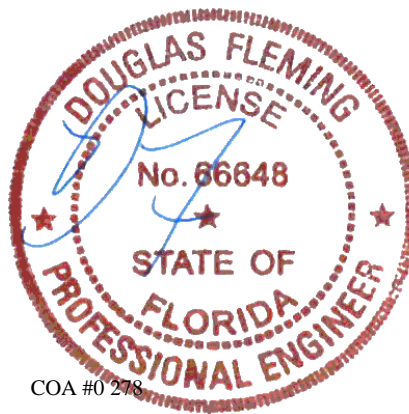

COA #0 278
09/15/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

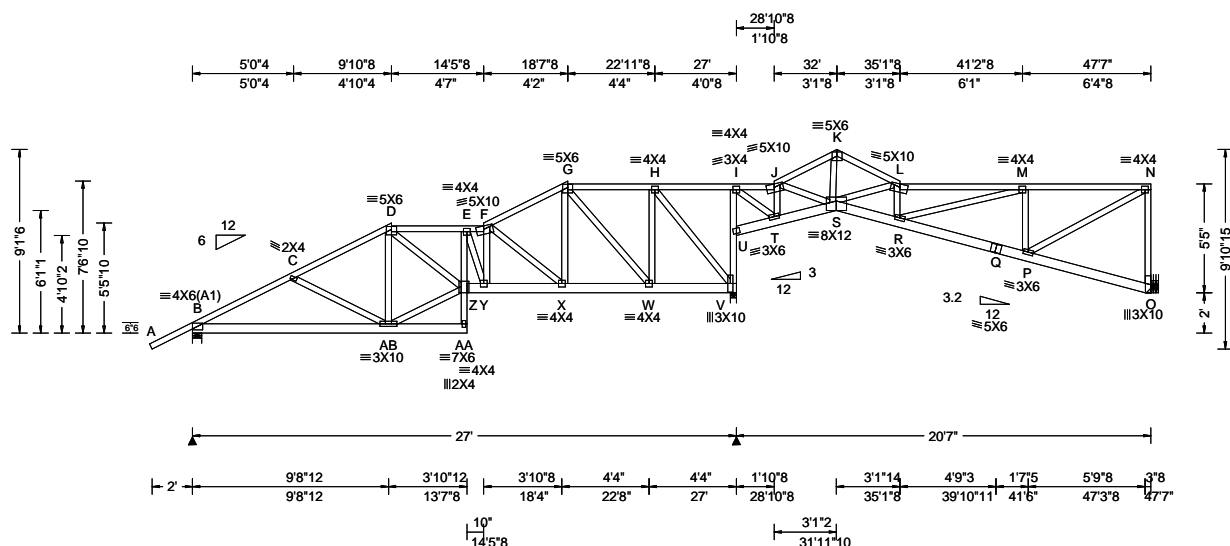

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Non-Gravity
TCDL: 7.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.094 Z 999 360	Loc R+ / R- / Rh / Rw / U / RL
BCLL: 0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.181 Z 999 240	B 1130 -/- /- /624 /226 /225
BCDL: 10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.030 V - -	V 1853 -/- /- /942 /441 -/
Des Ld: 37.00	EXP: B Kzt: NA		HORZ(TL): 0.058 V - -	O 770 -/- /- /368 /216 -/
NCBCLL: 10.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS
Soffit: 2.00	TCDL: 0.0 psf	FBC 2017 RES	Max TC CSI: 0.959	B Brg Width = 5.5 Min Req = 1.5
Load Duration: 1.25	BCDL: 0.0 psf	TPI Std: 2014	Max BC CSI: 0.606	V Brg Width = 3.5 Min Req = 2.3
Spacing: 24.0 "	MWFRS Parallel Dist: > 2h	Rep Fac: Yes	Max Web CSI: 0.841	O Brg Width = - Min Req = -
	C&C Dist a: 4.76 ft	FT/RT:20(0)/0(0)		Bearings B & V Fcperp = 425psi.
	Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#
	GCpi: 0.18	WAVE	VIEW Ver: 18.02.01A.0205.19	Maximum Top Chord Forces Per Ply (lbs)
	Wind Duration: 1.60			Chords Tens.Comp. Chords Tens. Comp.

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3:

Plates sized for a minimum of 3.50 sq.in./piece.

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	54	-2.07	9.88
TC	24	9.88	14.46
TC	56	14.46	18.62
TC	24	18.62	28.87
TC	42	28.87	32.00
TC	42	32.00	35.12
TC	24	35.12	47.58
BC	120	0.15	13.48
BC	120	13.54	26.71
BC	63	26.87	31.97
BC	75	31.97	47.58

Apply purlins to any chords above or below fillers
at 24" OC unless shown otherwise above

Right end vertical exposed to wind pressure.
Deflection meets $L/180$.

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

Shim all supports to solid bearing.

PP Deflection in	loc	L/defl	L/#
VERT(LL): 0.094	Z	999	360
VERT(CL): 0.181	Z	999	240
HORZ(LL): 0.030	V	-	-
HORZ(TL): 0.058	V	-	-
Creep Factor: 2.0			
Max TC CSI:	0.959		
Max BC CSI:	0.606		
Max Web CSI:	0.841		

Loc	Gravity			Non-Gravity		
	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
B	1130	/-	/-	/624	/226	/225
V	1853	/-	/-	/942	/441	-
O	770	/-	/-	/368	/216	/-

Wind reactions based on MWFRS

B	Brg Width = 5.5	Min Req = 1.5
V	Brg Width = 3.5	Min Req = 2.3
O	Brg Width = -	Min Req = -

Bearings B & V Fcper = 425Psi.

Chords	Tens.	Comp.	Chords	Tens.	Comp.
--------	-------	-------	--------	-------	-------


B - C	779 - 1669	I - J	427 - 604
C - D	688 - 1416	J - K	630 - 1214
D - E	1189 - 2216	K - L	631 - 1209
E - F	1144 - 2110	L - M	1068 - 1989
F - G	726 - 1285	M - N	584 - 1030
G - H	458 - 624		

Chords	Tens.Comp.	Chords	Tens. Comp.
---------------	-------------------	---------------	--------------------

B - AB	1435	- 957	T - S	602	- 290
Z - Y	2232	- 1314	S - R	2055	- 1040
Y - X	2105	- 1230	R - Q	1125	- 586
X - W	1057	- 629	Q - P	1099	- 586
W - V	585	- 317			

Webs Tens.Comp. Webs Tens. Comp.

AB- D	352	-420	I - T	921	-465
AB- Z	1376	-873	J - T	411	-757
D - Z	1255	-671	J - S	520	-329
E - Y	281	-419	S - K	901	-442
F - X	729	-1266	S - L	559	-984
X - G	866	-448	R - L	279	-448
G - W	468	-715	R - M	947	-474
W - H	660	-371	M - P	404	-701
H - V	630	-1095	P - N	1183	-561
V - U	515	-949	N - O	373	-721
U - I	479	-957			

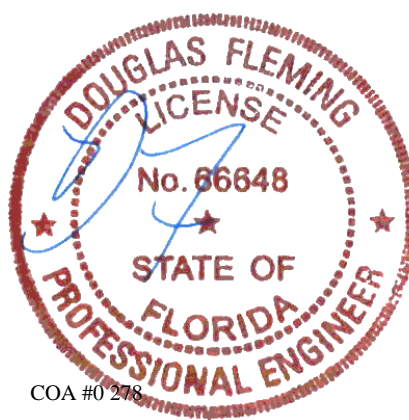

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCE) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org



6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65948	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T82
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0958.08773
Page 2 of 2			Truss Label: T-29	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing O (47'4", 12'1"2) LUS26

Supporting Member: (3)2x8 SP SS Dense

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65913 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-3	Cust: R 857 JRef: 1WYP8570001 T22 DrwNo: 259.20.0958.11013 SSB / DF 09/15/2020
--------------------------	--------------------------	---	--

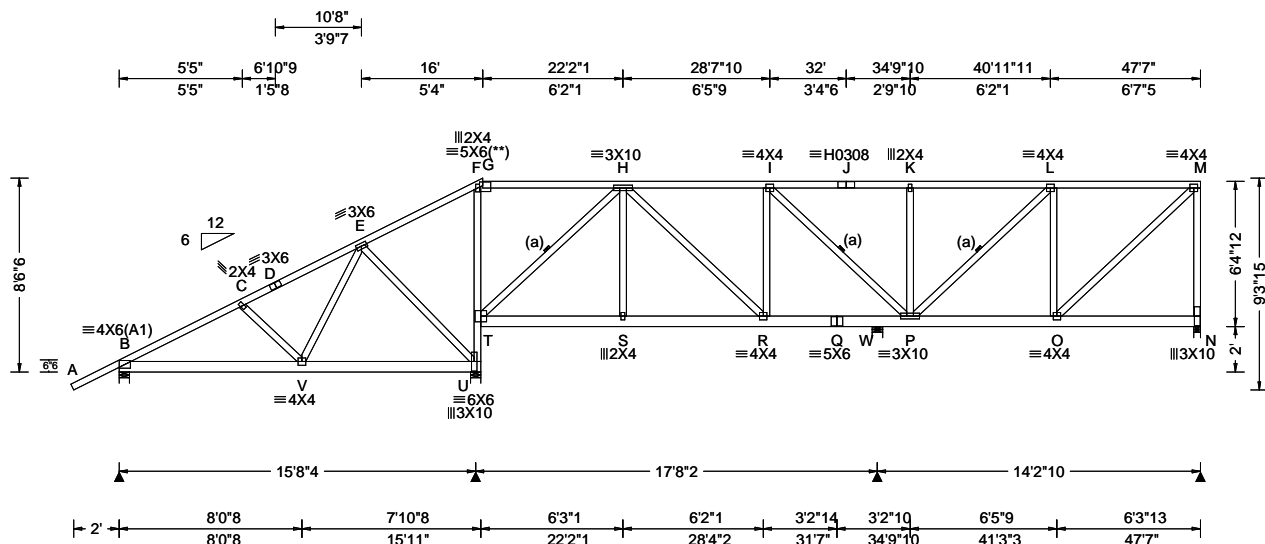

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 4.76 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.036 I 999 360 VERT(CL): 0.067 I 999 240 HORZ(LL): -0.017 M - - HORZ(TL): 0.031 M - - Creep Factor: 2.0 Max TC CSI: 0.869 Max BC CSI: 0.514 Max Web CSI: 0.873 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 714 /- /- /400 /229 /228 U 1494 /- /- /816 /507 /- W 743 /- /0 /364 /242 /0 N 786 /- /- /358 /254 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 U Brg Width = 5.5 Min Req = 1.9 W Brg Width = 5.5 Min Req = 1.5 N Brg Width = 3.5 Min Req = 1.5 Bearings B, U, W, & N Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x6 SP #1;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5", min.) nails @ 6" oc.

Plating Notes

(**) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	16.00
TC	24	16.00	47.58
BC	120	0.15	15.62
BC	120	15.65	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

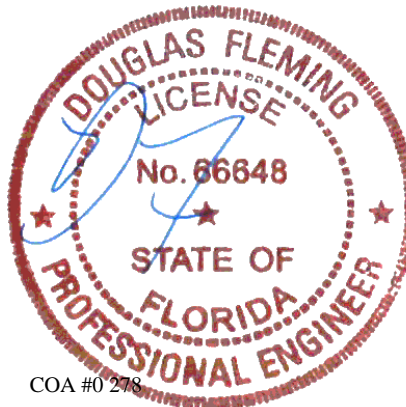

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - C	388 -820	I - J	402 -624
C - D	337 -622	J - K	402 -624
D - E	337 -584	K - L	402 -624
H - I	509 -807	L - M	396 -627

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - V	677 -370	R - Q	815 -411
T - S	697 -327	Q - P	1631 -822
S - R	695 -327	P - O	646 -363

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
V - E	456 -134	I - P	156 -387
E - U	299 -532	L - O	241 -384
U - T	631 -1052	O - M	866 -393
T - H	447 -964	M - N	375 -745

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65914 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-30	Cust: R 857 JRef: 1WYP8570001 T29 DrwNo: 259.20.0958.13110 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

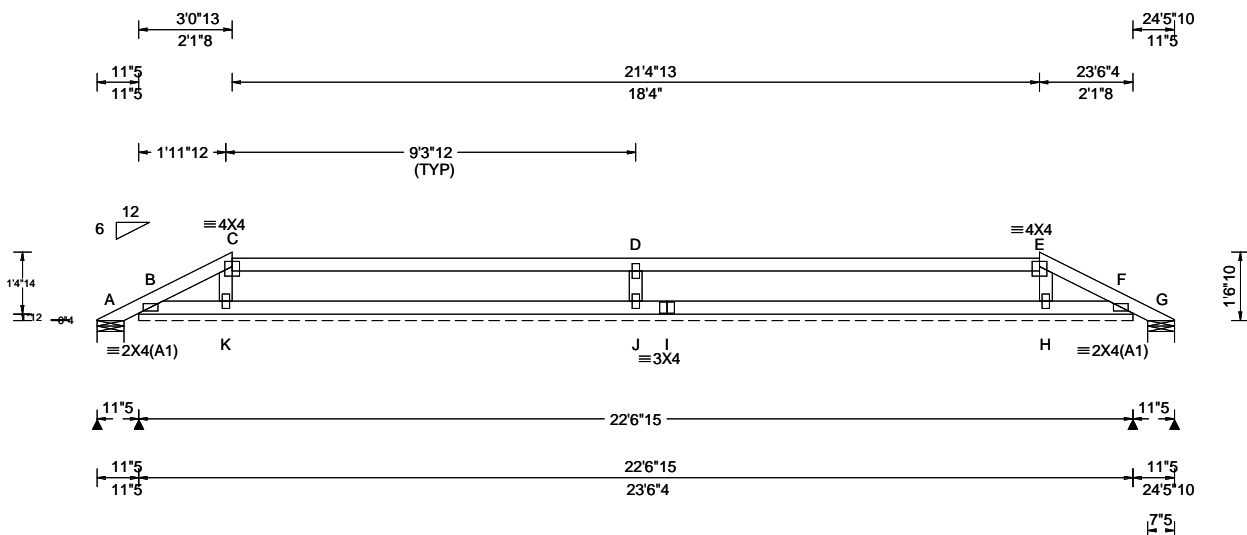

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: > 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 D 999 360 VERT(CL): 0.001 D 999 240 HORZ(LL): 0.001 H - - HORZ(TL): 0.001 H - - Creep Factor: 2.0 Max TC CSI: 0.861 Max BC CSI: 0.196 Max Web CSI: 0.115 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity A 9 /- /- /24 /11 /24 B* 62 /- /- /35 /23 /- G 9 /- /- /14 /2 /- J /-273 H /-99 Wind reactions based on MWFRS A Brg Width = 7.3 Min Req = 1.5 B Brg Width = 270 Min Req = - G Brg Width = 7.3 Min Req = 1.5 Bearings A, B, & G are a rigid surface. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. D - J 386 -637

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	37	-0.66	2.12
TC	24	2.12	20.46
TC	37	20.46	23.24
BC	75	0.15	22.43


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

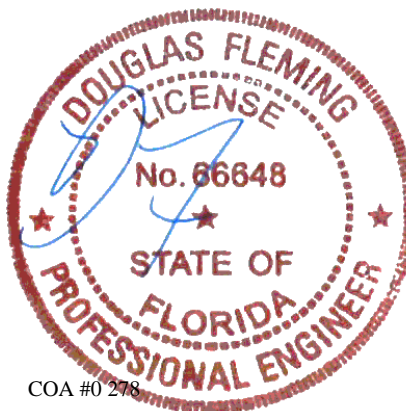

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Lumber Top chord: 2x4 SP #1; Bot chord: 2x6 SP #1; B3,B4 2x4 SP #1; Webs: 2x4 SP #3; W12 2x4 SP #1;	Wind Wind loads based on MWFRS with additional C&C member design. Right end vertical exposed to wind pressure. Deflection meets L/180.	Maximum Top Chord Forces Per Ply (lbs) <table><tr><th>Chords</th><th>Tens.Comp.</th><th>Chords</th><th>Tens. Comp.</th></tr><tr><td>B - C</td><td>831 - 1745</td><td>F - G</td><td>661 - 1084</td></tr><tr><td>C - D</td><td>784 - 1588</td><td>H - I</td><td>237 - 519</td></tr><tr><td>D - E</td><td>1699 - 3254</td><td>I - J</td><td>236 - 517</td></tr><tr><td>E - F</td><td>991 - 1882</td><td></td><td></td></tr></table>	Chords	Tens.Comp.	Chords	Tens. Comp.	B - C	831 - 1745	F - G	661 - 1084	C - D	784 - 1588	H - I	237 - 519	D - E	1699 - 3254	I - J	236 - 517	E - F	991 - 1882		
Chords	Tens.Comp.	Chords	Tens. Comp.																			
B - C	831 - 1745	F - G	661 - 1084																			
C - D	784 - 1588	H - I	237 - 519																			
D - E	1699 - 3254	I - J	236 - 517																			
E - F	991 - 1882																					
Bracing (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.	Additional Notes WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.	Maximum Bot Chord Forces Per Ply (lbs) <table><tr><th>Chords</th><th>Tens.Comp.</th><th>Chords</th><th>Tens. Comp.</th></tr><tr><td>B - Z</td><td>1502 - 1027</td><td>U - T</td><td>1576 - 960</td></tr><tr><td>X - W</td><td>3291 - 1946</td><td>T - S</td><td>1045 - 605</td></tr><tr><td>W - U</td><td>3287 - 1945</td><td>R - Q</td><td>416 - 320</td></tr></table>	Chords	Tens.Comp.	Chords	Tens. Comp.	B - Z	1502 - 1027	U - T	1576 - 960	X - W	3291 - 1946	T - S	1045 - 605	W - U	3287 - 1945	R - Q	416 - 320				
Chords	Tens.Comp.	Chords	Tens. Comp.																			
B - Z	1502 - 1027	U - T	1576 - 960																			
X - W	3291 - 1946	T - S	1045 - 605																			
W - U	3287 - 1945	R - Q	416 - 320																			
Plating Notes Plates sized for a minimum of 3.50 sq.in./piece.																						

Purlins				Maximum Web Forces Per Ply (lbs)			
In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:				Webs	Tens.Comp.	Webs	Tens. Comp.
Chord	Spacing(in oc)	Start(ft)	End(ft)	Z - D	314 - 381	G - S	685 - 1278
TC	53	-2.07	7.88	Z - X	1481 - 963	S - R	311 - 496
TC	24	7.88	12.46	D - X	2002 - 1098	R - H	347 - 531
TC	55	12.46	16.62	E - U	1070 - 1851	Q - J	445 - 354
TC	24	16.62	26.87	U - F	963 - 502	J - P	314 - 505
TC	69	26.87	32.00	F - T	435 - 648	P - O	338 - 584
TC	69	32.00	37.12	T - G	520 - 269		
TC	24	37.12	47.58				
BC	120	0.15	13.62				
BC	111	12.53	26.71				
BC	64	26.82	31.97				
BC	64	31.97	37.16				
BC	120	37.29	47.58				

A circular red ink seal for a Professional Engineer in the State of Florida. The outer ring contains the text "DOUGLAS FLEMING" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by three stars. Inside the ring, the word "LICENSE" is at the top and "STATE OF FLORIDA" is at the bottom. In the center, the license number "No. 66648" is printed. A blue ink signature is written across the seal, overlapping the "LICENSE" and "No. 66648" text.

COA #0 278
09/15/2020

ALPINE
AN ITW COMPANY

6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65915	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T44
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0958.17357
Page 2 of 2			Truss Label: T-31	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing M (47'4", 10'1"2) LUS24

Supporting Member: (3)2x8 SP SS Dense

(4) 0.148"x3" nails into supporting member,

(2) 0.148"x3" nails into supported member.



COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org


ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Plating Notes	D - E	1573 - 2933	I - J	212 - 480
	E - F	1341 - 2389		

Purlins	Maximum Bot Chord Forces Per Ply (lbs)			
	Chords	Tens.Comp.	Chords	Tens. Comp.

In lieu of structural panels or rigid ceiling use purlins

TC	43	10.48	14.62
TC	24	14.62	24.87
TC	75	24.87	32.00
TC	75	32.00	39.12
TC	24	39.12	47.58
BC	120	0.15	13.48
BC	120	13.52	26.71
BC	63	26.86	31.97
BC	65	31.97	37.23
BC	120	37.29	47.58



DOUGLAS FLEMING
LICENSE
No. 66648

Maximum Web Forces Per Ply (lbs)				
Webs	Tens.	Comp.	Webs	Tens. Comp.
C - AB	713	- 434	G - W	757 - 1339
D - AB	959	- 1728	H - W	796 - 406
D - Z	609	- 379	H - V	578 - 1080
AB - Z	2392	- 1328	V - U	350 - 549
Z - F	1400	935	U - L	335 - 470

Wind	Y - F	1010	-562	J - S	271	-455
	F - X	380	-537	S - R	329	-486

Right end vertical exposed to wind pressure.
Deflection meets L/180.

COA #0 278


09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org Orlando FL, 32821

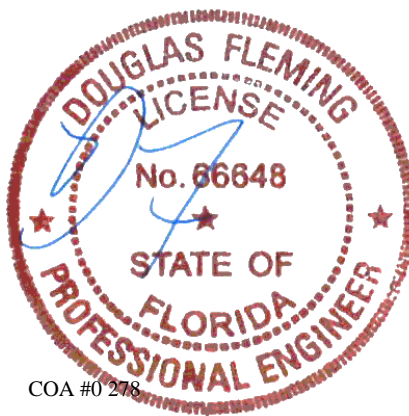

COA #0 278

09/15/2020

▲ Maximum Reactions (lbs)							
	Gravity			Non-Gravity			
Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	
B	1136	/-	/-	/602	/275	/226	
V	1440	/-	/-	/774	/322	/-	
R	793	/-	/-	/387	/176	/-	
O	384	/-	/-	/207	/99	/-	
Wind reactions based on MWFRS							
B	Brg Width = 5.5			Min Req = 1.5			
V	Brg Width = 3.5			Min Req = 1.8			
R	Brg Width = 3.5			Min Req = 1.5			
O	Brg Width = -			Min Req = -			
Bearings B, V, & R Fcperp = 425psi.							
Members not listed have forces less than 375#							
Maximum Top Chord Forces Per Ply (lbs)							
Chords		Tens.Comp.		Chords		Tens. Comp.	
B - C		828 - 1698		F - G		1002 - 1670	
C - D		1148 - 2057		G - H		448 - 500	
D - E		1573 - 2933		I - J		212 - 480	
E - F		1341 - 2389					

Maximum Bot Chord Forces Per Ply (lbs)							
Chords		Tens.Comp.		Chords		Tens. Comp.	
B -AC	1459	- 922	X - W	1634	- 856		
AC-AB	1456	- 923	W - V	499	- 264		
Z - Y	2548	- 1456	T - S	393	- 228		
Y - X	2118	- 1196					

Maximum Web Forces Per Ply (lbs)					
Webbs	Tens.Comp.		Webbs	Tens.	Comp.
C - AB	713	- 434	G - W	757	- 1339
D - AB	959	- 1728	H - W	796	- 406
D - Z	609	- 379	H - V	578	- 1080
AB - Z	2392	- 1328	V - U	350	- 549
Z - E	1490	- 825	U - I	335	- 472
E - Y	716	- 1176	I - T	447	- 253
Y - F	1010	- 562	J - S	271	- 455
F - X	380	- 537	S - R	329	- 486
X - G	408	- 182			



SEQN: 65916	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T55
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0958.20883
Page 2 of 2			Truss Label: T-32	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing O (47'4", 10'1"2) LUS24

Supporting Member: (3)2x8 SP SS Dense

(4) 0.148"x3" nails into supporting member,

(2) 0.148"x3" nails into supported member.

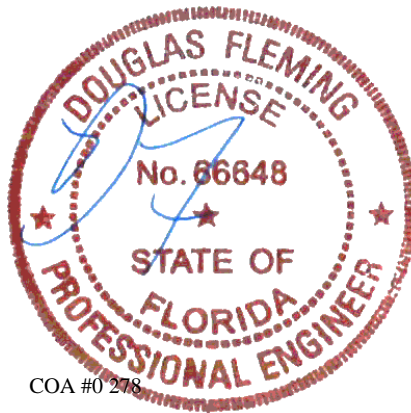

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65917 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-33	Cust: R 857 JRef: 1WYP8570001 T46 DrwNo: 259.20.0958.41857 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

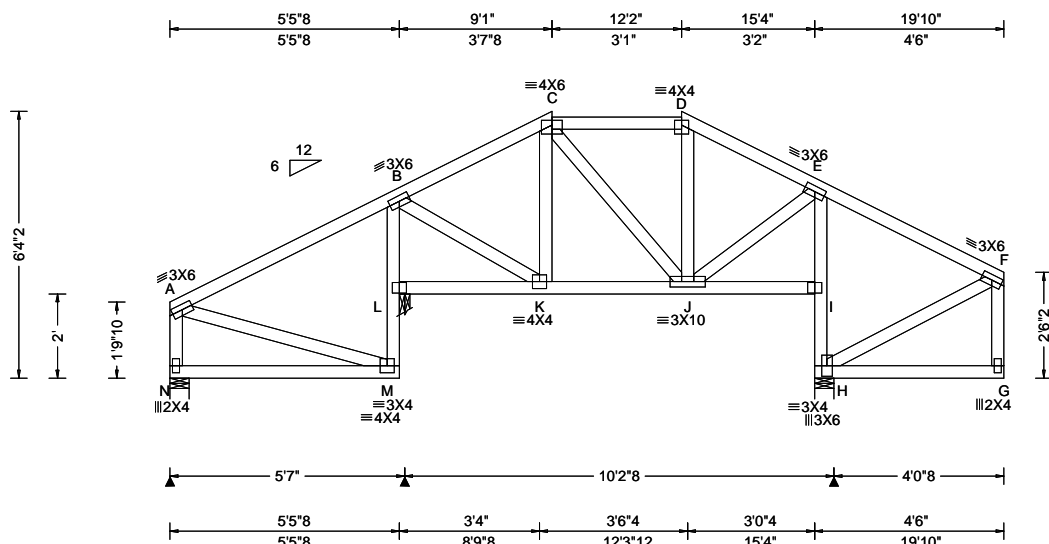

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 16.17 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.070 G 721 360 VERT(CL): 0.148 G 340 240 HORZ(LL): -0.070 H - - HORZ(TL): 0.150 H - - Creep Factor: 2.0 Max TC CSI: 0.316 Max BC CSI: 0.214 Max Web CSI: 0.926 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL N 183 -/- /104 /75 /97 L 592 -/- /372 /170 -/ H 771 -/- /362 /193 -/ Non-Gravity N Brg Width = 5.5 Min Req = 1.5 L Brg Width = 3.0 Min Req = 1.5 H Brg Width = 5.5 Min Req = 1.5 Wind reactions based on MWFRS Bearings N, L, & H Fcperp = 425psi. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. L - B 283 -506 I - H 332 -667 E - I 317 -623

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	0.00	9.08
TC	24	9.08	12.17
TC	75	12.17	19.83
BC	62	0.00	5.17
BC	75	5.27	15.52
BC	50	15.63	19.83


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

Right cantilever is not exposed to wind

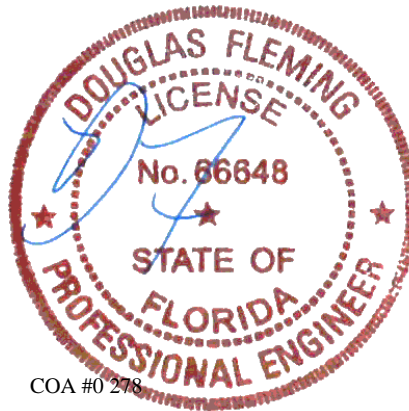

COA #0 278

09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65918 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-34	Cust: R 857 JRef: 1WYP8570001 T11 DrwNo: 259.20.0958.43487 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

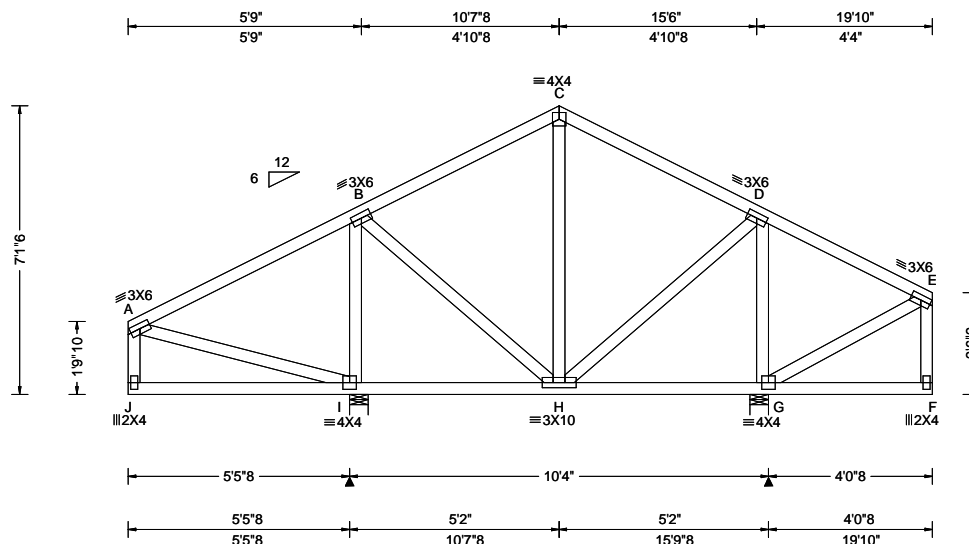

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 16.55 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.008 J 999 360 VERT(CL): 0.016 J 999 240 HORZ(LL): -0.003 B - - HORZ(TL): 0.006 B - - Creep Factor: 2.0 Max TC CSI: 0.368 Max BC CSI: 0.214 Max Web CSI: 0.272 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL I 885 - / - /454 /184 /127 G 705 - / - /342 /138 - Wind reactions based on MWFRS I Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings I & G Fcperp = 425psi. Members not listed have forces less than 375# Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. I - B 368 -697 D - G 289 -535

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	0.00	10.63
TC	75	10.63	19.83
BC	75	0.00	19.83


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

Left and right cantilevers are not exposed to wind

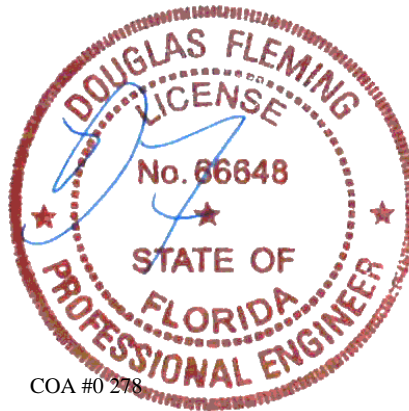

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65919 FROM: RNB	COMN Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-35	Cust: R 857 JRef: 1WYP8570001 T65 DrwNo: 259.20.0958.44917 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

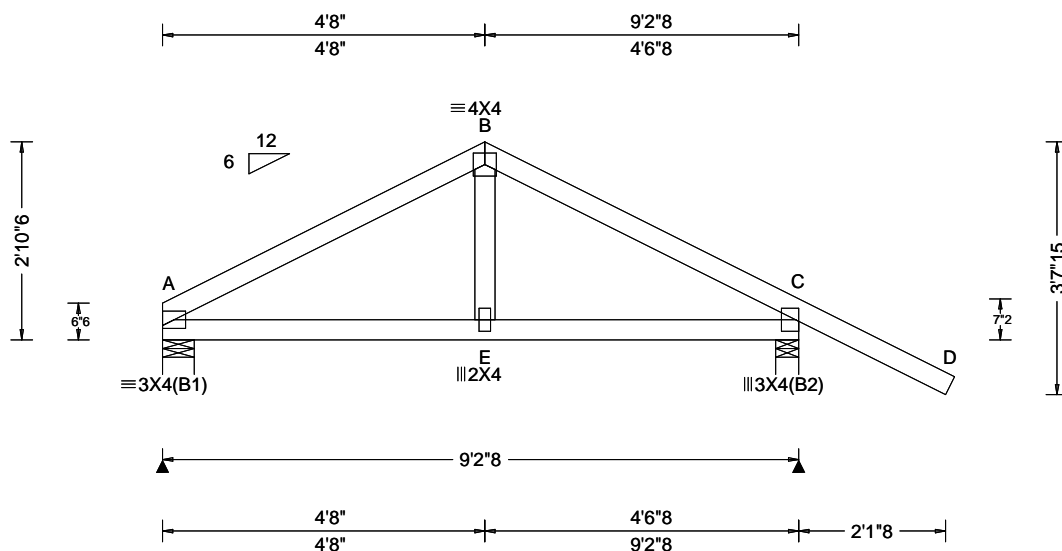

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.008 E 999 360 VERT(CL): 0.014 E 999 240 HORZ(LL): 0.005 E - - HORZ(TL): 0.010 E - - Creep Factor: 2.0 Max TC CSI: 0.422 Max BC CSI: 0.171 Max Web CSI: 0.073 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 335 -/- /- /181 /103 /65 C 494 -/- /- /272 /158 -/ Wind reactions based on MWFRS A Brg Width = 5.5 Min Req = 1.5 C Brg Width = 4.0 Min Req = 1.5 Bearings A & C Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 346 -403 B - C 341 -414

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	61	0.10	4.67
TC	75	4.67	11.40
BC	108	0.17	9.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

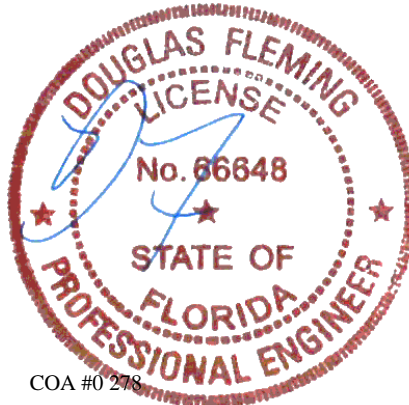

COA #0 278

09/15/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

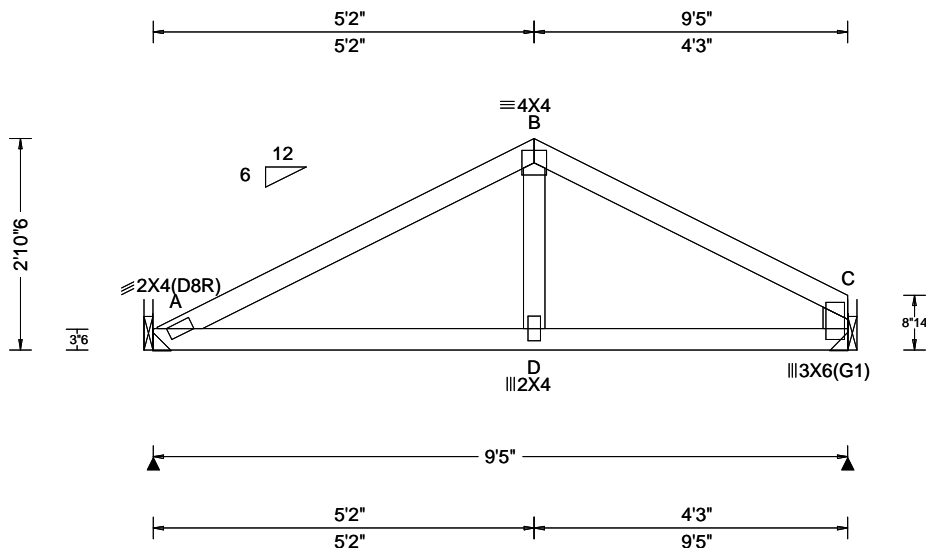

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.009 D 999 360 VERT(CL): 0.018 D 999 240 HORZ(LL): 0.005 D - - HORZ(TL): 0.009 D - - Creep Factor: 2.0 Max TC CSI: 0.298 Max BC CSI: 0.188 Max Web CSI: 0.075 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 357 -/- /188 /110 /44 C 351 -/- /177 /110 -/ Wind reactions based on MWFRS A Brg Width = - Min Req = - C Brg Width = - Min Req = - Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 257 -462 B - C 270 -468

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;
Rt Stub Wedge: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	68	0.13	5.17
TC	57	5.17	9.42
BC	113	0.00	9.42

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

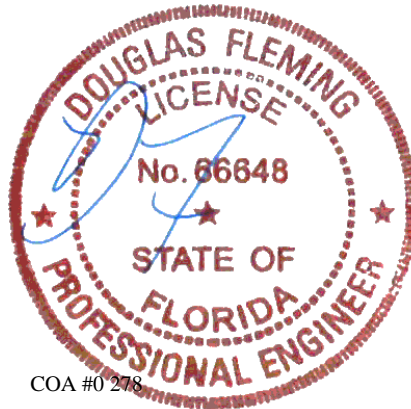

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65920	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T72
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0958.47337
Page 2 of 2			Truss Label: T-36	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Bearing at location x=0' uses the following support conditions: 0'

Bearing A (0', 10'1"2) LUS24

Supporting Member: (1)2x6 SP #1

(4) 0.148"x3" nails into supporting member,


(2) 0.148"x3" nails into supported member.

Bearing C (9'2", 10'1"2) LUS24

Supporting Member: (1)2x6 SP #1

(4) 0.148"x3" nails into supporting member,

(2) 0.148"x3" nails into supported member.

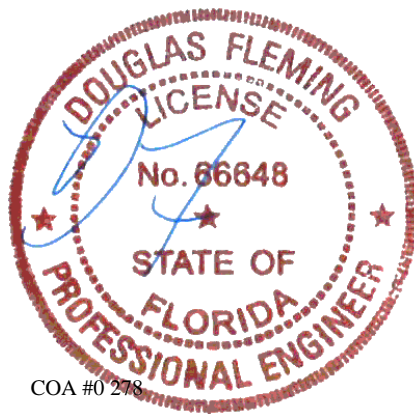

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

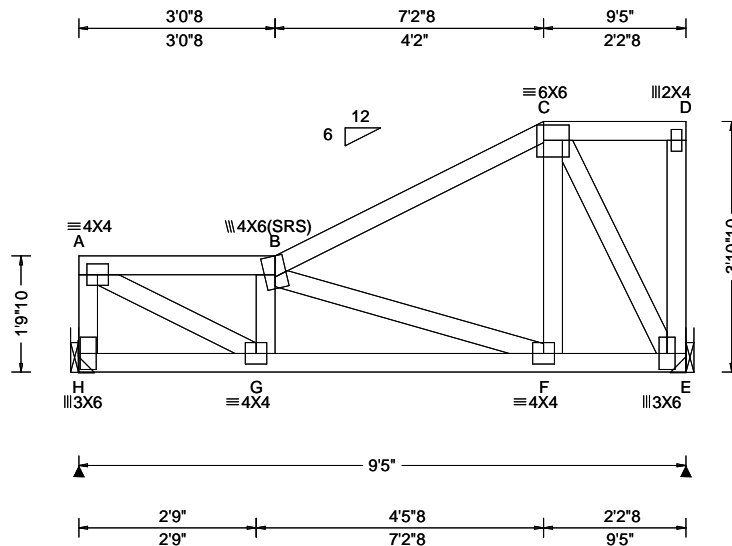

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.010 B 999 360 VERT(CL): 0.018 B 999 240 HORZ(LL): 0.003 A - - HORZ(TL): 0.005 A - - Creep Factor: 2.0 Max TC CSI: 0.179 Max BC CSI: 0.156 Max Web CSI: 0.231 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL H 356 - / - /173 /111 /89 E 356 - / - /194 /116 - Wind reactions based on MWFRS H Brg Width = - Min Req = - E Brg Width = - Min Req = - Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. A - B 354 -493 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. G - F 530 -472 Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. A - G 557 -399 B - F 324 -377

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:


Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	24	0.00	3.04
TC	56	3.04	7.21
TC	24	7.21	9.42
BC	113	0.00	9.42

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

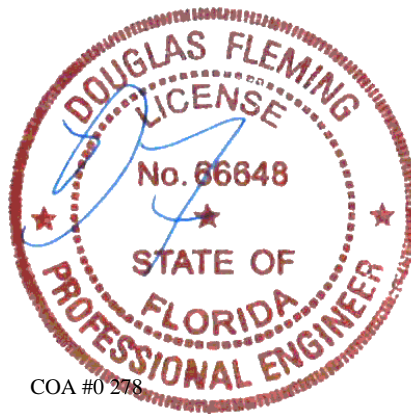

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

SEQN: 65921	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T5
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0958.49987
Page 2 of 2			Truss Label: T-37	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Bearing at location x=0' uses the following support conditions: 0'

Bearing H (0', 10'1"2) LUS24

Supporting Member: (1)2x6 SP #1

(4) 0.148"x3" nails into supporting member,


(2) 0.148"x3" nails into supported member.

Bearing E (9'2", 10'1"2) LUS24

Supporting Member: (1)2x6 SP #1

(4) 0.148"x3" nails into supporting member,

(2) 0.148"x3" nails into supported member.

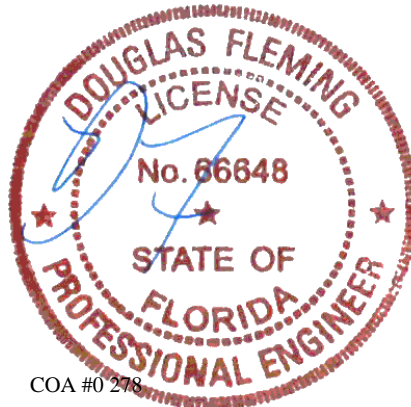

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65922 FROM: RNB	COMN Ply: 1 Qty: 3	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-38	Cust: R 857 JRef: 1WYP8570001 T70 DrwNo: 259.20.0958.51703 SSB / DF 09/15/2020
--------------------------	--------------------------	--	--

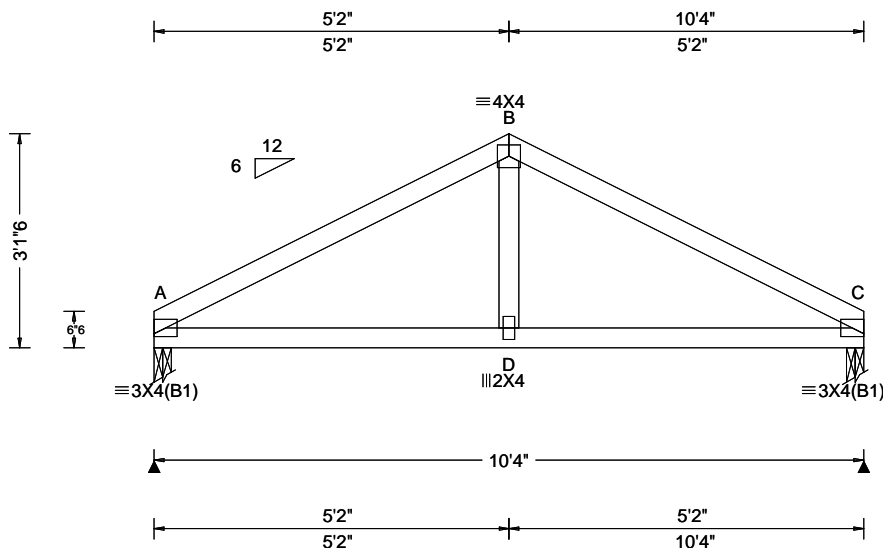

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.92 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.006 D 999 360 VERT(CL): 0.012 D 999 240 HORZ(LL): 0.003 D - - HORZ(TL): 0.006 D - - Creep Factor: 2.0 Max TC CSI: 0.276 Max BC CSI: 0.188 Max Web CSI: 0.084 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL A 391 -/- /- /201 /123 /45 C 391 -/- /- /201 /123 /- Wind reactions based on MWFRS A Brg Width = 3.0 Min Req = 1.5 C Brg Width = 3.0 Min Req = 1.5 Bearings A & C Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - B 272 -511 B - C 272 -511 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - D 404 -189 D - C 404 -189

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	68	0.10	5.17
TC	68	5.17	10.23
BC	120	0.17	10.16

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

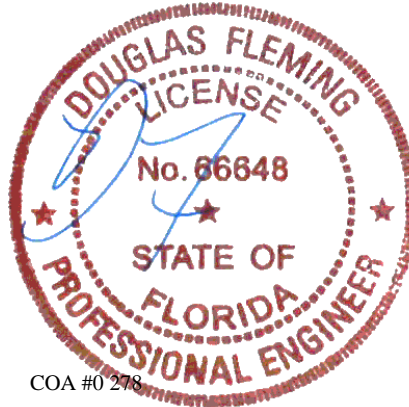

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Lumber Top chord: 2x4 SP #1; Bot chord: 2x4 SP #1; Webs: 2x4 SP #3; W7 2x4 SP SS Dense; W17 2x4 SP #1;	Additional Notes WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.	Maximum Top Chord Forces Per Ply (lbs)							
		Chords		Tens. Comp.		Chords		Tens. Comp.	
		B - C	123	-425	I - J	431	-644		
		C - D	387	-757	J - K	431	-644		
		F - G	231	-396	K - L	431	-644		
Bracing		H - I	496	-738	L - M	410	-620		

Maximum Web Forces Per Ply (lbs)					
Webs	Tens.Comp.		Webs	Tens. Comp.	
D - V	343	- 666	S - H	488	- 777
V - F	434	- 188	H - R	788	- 373
F - U	280	- 520	K - P	223	- 377
U - T	703	- 1156	L - O	295	- 481
T - G	684	- 1131	O - M	859	- 389
G - S	895	- 488	M - N	376	- 766

ALPINE
AN ITW COMPANY

6750 Forum Drive
Suite 305
Orlando FL, 32821

The drawing illustrates a roof truss system with the following details:

- Top Chord Members:** 5X6 (H), 4X4 (I), 2X4 (J), 3X6 (K), 4X4 (L), 4X4 (M).
- Bottom Chord Members:** 3X6 (B2) (AA), 2X4 (Z), 2X4 (Y), 3X6 (U), 3X6 (T), 4X4 (S), 4X4 (R), 3X10 (Q), 3X10 (P), 4X4 (O), 3X6 (N).
- Vertical Members:** 2X4 (X), 4X6 (V), 2X4 (W), 4X6 (F), 4X6 (G).
- Diagonal Members:** 3X6 (DE), 3X6 (a), 3X6 (b), 3X6 (b).
- Connections:** Various types of connections are shown, including gusset plates (AA, Z, Y), and bolts (B, C, D, E, F, G, H, I, J, K, L, M, N, O, P, Q, R, S, T, U, V, W, X, Y, Z).
- Dimensions:**
 - Overall height: 10'6"
 - Overall width: 11'3"15
 - Horizontal dimensions: 15'8"4, 17'8"2, 14'2"10.
 - Vertical dimensions: 8'4"12, 2'.
 - Member lengths: 7'11"8, 8'8", 12'9"4, 15'11"3, 20', 26'10"12, 33'7"12, 36', 40'4"12, 47'7".
 - Member heights: 1'10"8, 3'5"8.

Lumber	Wind	Maximum Top Chord Forces Per Ply (lbs)					
Top chord: 2x4 SP #1; Bot chord: 2x4 SP #1; Webs: 2x4 SP #3; W7 2x4 SP SS Dense; W17 2x4 SP #1;	Wind loads based on MWFRS with additional C&C member design. Right end vertical exposed to wind pressure. Deflection meets L/180.	Chords	Tens.	Comp.	Chords	Tens.	Comp.
		B - C	142	-481	E - F	220	-403
		C - D	397	-763	F - G	236	-457
		D - E	220	-403	H - I	344	-393

member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
------	------------	------	-------------

Purlins

In lieu of structural panels or rigid ceiling use purlins to lateral bracing chords of the frame.

V - V	434 - 150	S - H	334 - 413
F - U	260 - 523	I - P	236 - 438
U - T	640 - 955	O - M	491 - 214
T - G	635 - 917	M - N	262 - 527

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	70	-2.07	20.00
TC	24	20.00	47.57
BC	39	0.17	3.46
BC	120	1.52	12.62
BC	36	12.60	15.62
BC	75	15.68	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

COA #0 278


09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpinetw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org


6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65925 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-6	Cust: R 857 JRRef: 1WYP8570001 T28 DrwNo: 259.20.0959.28533 SSB / DF 09/15/2020
--------------------------	--------------------------	---	---

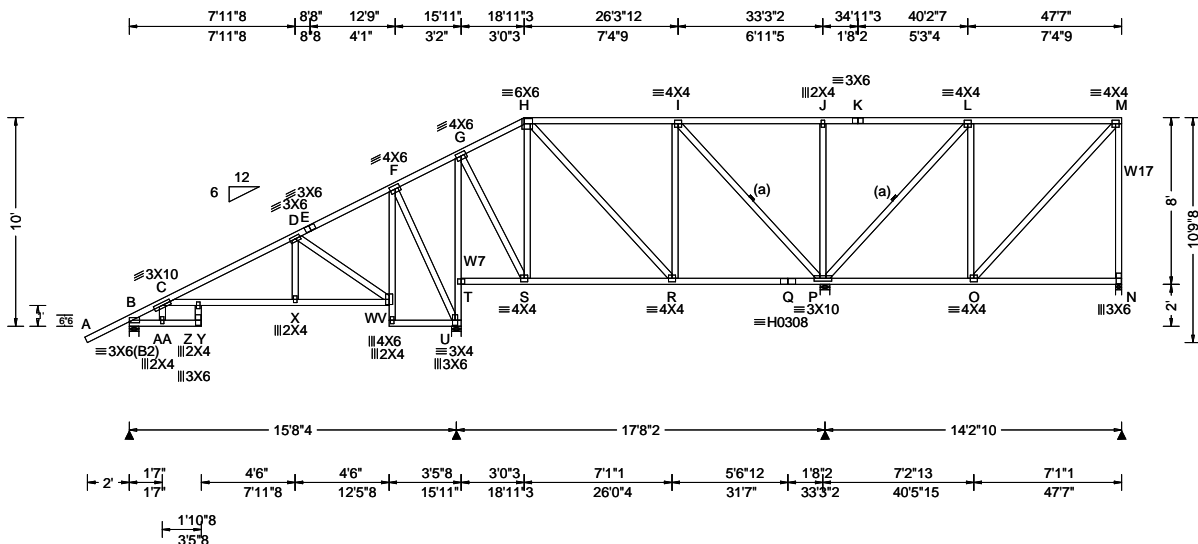

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.76 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.211 Y 883 360 VERT(CL): 0.398 Y 469 240 HORZ(LL): 0.107 U - - HORZ(TL): 0.203 U - - Creep Factor: 2.0 Max TC CSI: 0.991 Max BC CSI: 0.661 Max Web CSI: 0.693 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 651 -/- /- /346 /154 /280 U 1318 -/- /- /803 /418 -/ P 1398 -/- /- /630 /414 -/ N 458 -/- /- /202 /128 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 U Brg Width = 5.5 Min Req = 1.7 P Brg Width = 5.5 Min Req = 1.8 N Brg Width = 3.5 Min Req = 1.5 Bearings B, U, P, & N Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W7 2x4 SP SS Dense;
W17 2x4 SP #1;

Bracing

(a) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	70	-2.07	18.93
TC	24	18.93	47.58
BC	39	0.17	3.46
BC	120	1.52	12.62
BC	36	12.60	15.62
BC	75	15.68	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.


Wind

Wind loads based on MWFRS with additional C&C member design.

Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

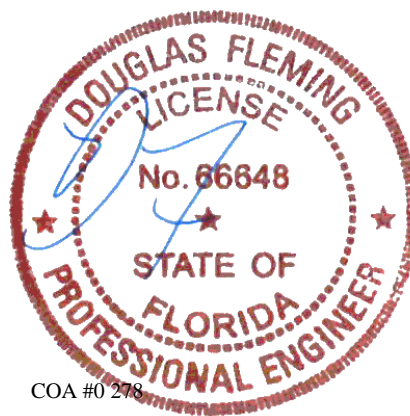

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
C - Z	577 -289	X - V	646 -334
Z - X	641 -334		


Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
D - V	346 -667	G - S	565 -348
V - F	435 -190	H - S	318 -400
F - U	272 -523	I - P	339 -641
U - T	558 -831	P - L	281 -566
T - G	550 -800	M - N	194 -402

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65926 FROM: RNB	COMM Ply: 1 Qty: 1	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: T-7	Cust: R 857 JRRef: 1WYP8570001 T25 DrwNo: 259.20.0959.39700 SSB / DF 09/15/2020
--------------------------	--------------------------	---	---

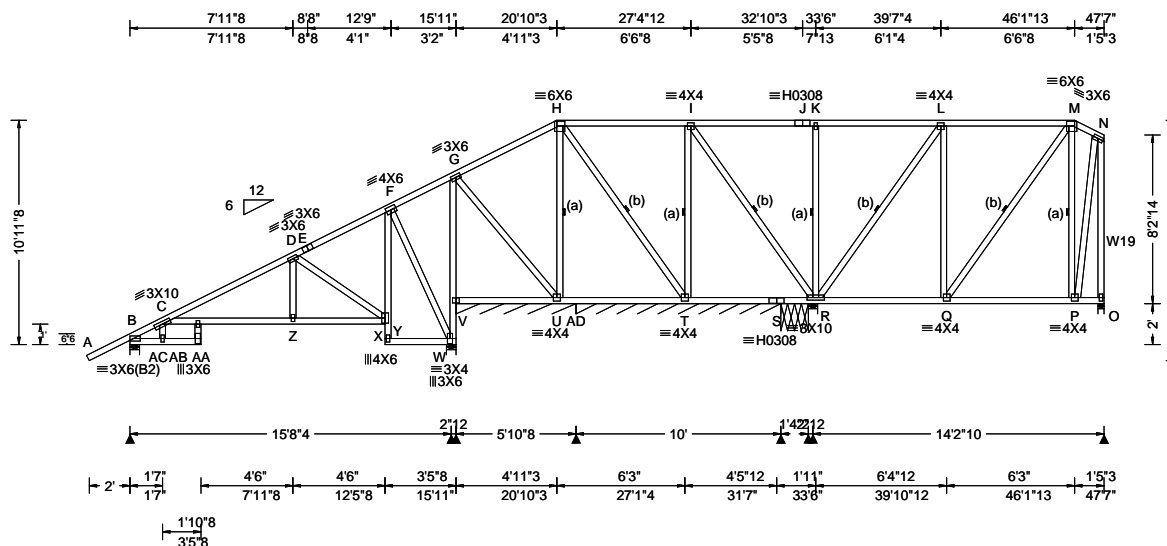

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *PLF
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 4.76 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.212 AA 878 360 VERT(CL): 0.400 AA 465 240 HORZ(LL): 0.109 W - - HORZ(TL): 0.209 W - - Creep Factor: 2.0 Max TC CSI: 0.985 Max BC CSI: 0.666 Max Web CSI: 0.905 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 654 -/- /- /340 /154 /300 W 1934 -/- /- /1210 /527 -/ V* - /-166 -/- /48 /70 -/ AD*53 -/- /- /28 /14 -/ S* - /-83 -/- /1 /42 -/ R 1032 -/- /- /460 /329 -/ O 425 -/- /- /215 /92 -/ V -/1159 S -/111 Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 W Brg Width = 5.5 Min Req = 2.4 V Brg Width = 70.5 Min Req = - AD Brg Width = 120 Min Req = - S Brg Width = 16.1 Min Req = - R Brg Width = 5.5 Min Req = 1.5 O Brg Width = 3.5 Min Req = 1.5 Bearings B, W, V, AD, S, R, & O Fcperp = 425psi. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 153 -459 F - G 239 -429 C - D 412 -777

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;
Webs: 2x4 SP #3; W19 2x4 SP #1;

Bracing

- (a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.
- (b) Continuous lateral restraint equally spaced on member. Or 2x4 #3 or better "T" reinforcement. 80% length of web member. Attached with 10d Box or Gun (0.128"x3",min.)nails @ 6" oc.

Plating Notes

All plates are 2X4 except as noted.
Plates sized for a minimum of 3.50 sq.in./piece.

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	69	-2.07	20.85
TC	24	20.85	46.15
TC	19	46.15	47.58
BC	39	0.17	3.46
BC	120	1.52	12.62
BC	36	12.60	15.62
BC	75	15.68	47.58


Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.
Right end vertical exposed to wind pressure.
Deflection meets L/180.

Additional Notes

Negative reaction(s) of -978# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

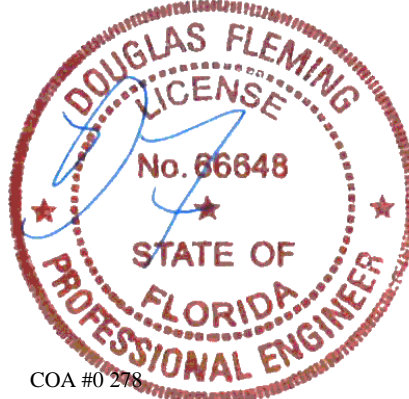


COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

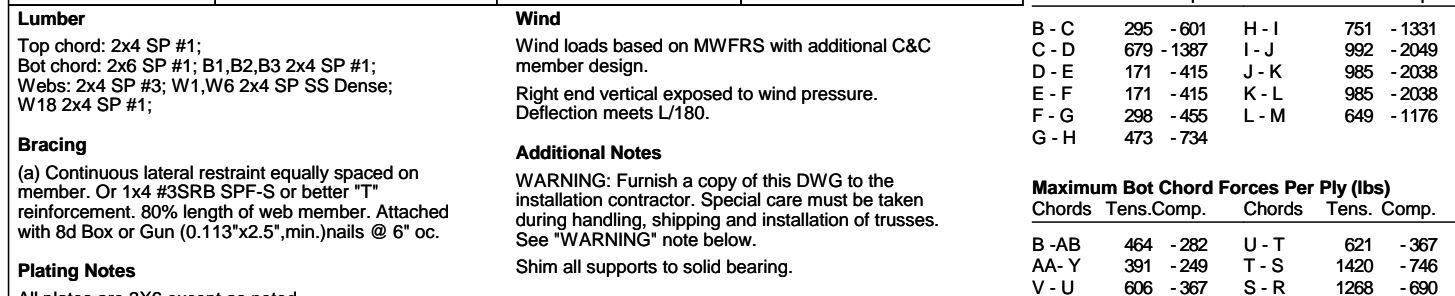


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org


6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65927	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T62
FROM: RNB		Qty: 3	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0959.42830
Page 2 of 2			Truss Label: T-8	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing O (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

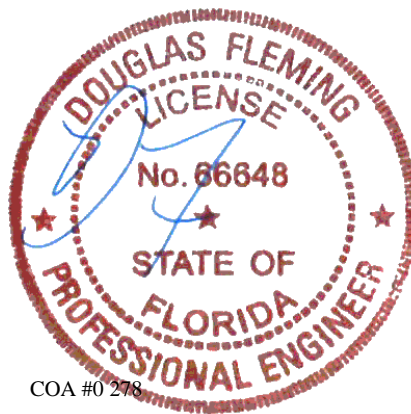

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

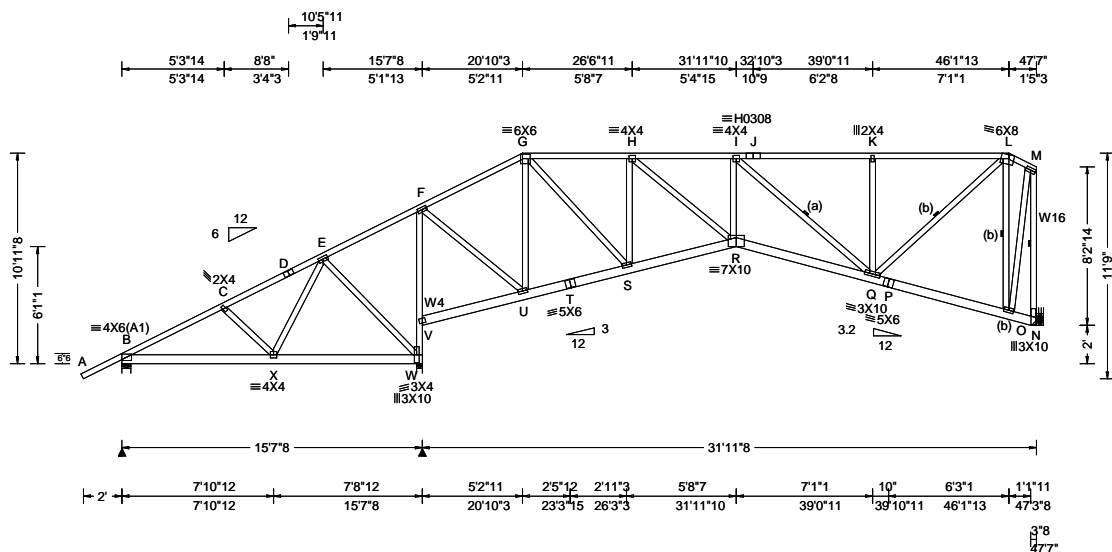

SEQN: 65928	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T77
FROM: RNB		Qty: 6	-terrell floor plan Trademark Const Group	DrwNo: 259.20.0959.59100
Page 2 of 2			Truss Label: T-9	SSB / DF 09/15/2020

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing N (47'4", 12'1"2) HGUS26

Supporting Member: (3)2x8 SP SS Dense

(20) 0.148"x3" nails into supporting member,

(6) 0.148"x3" nails into supported member.

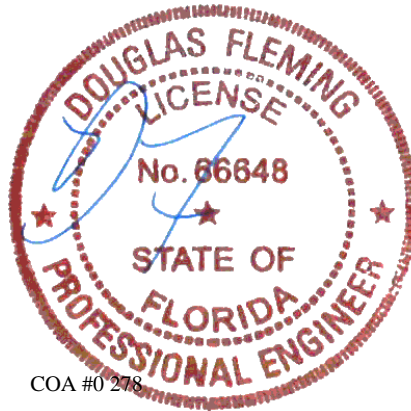

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

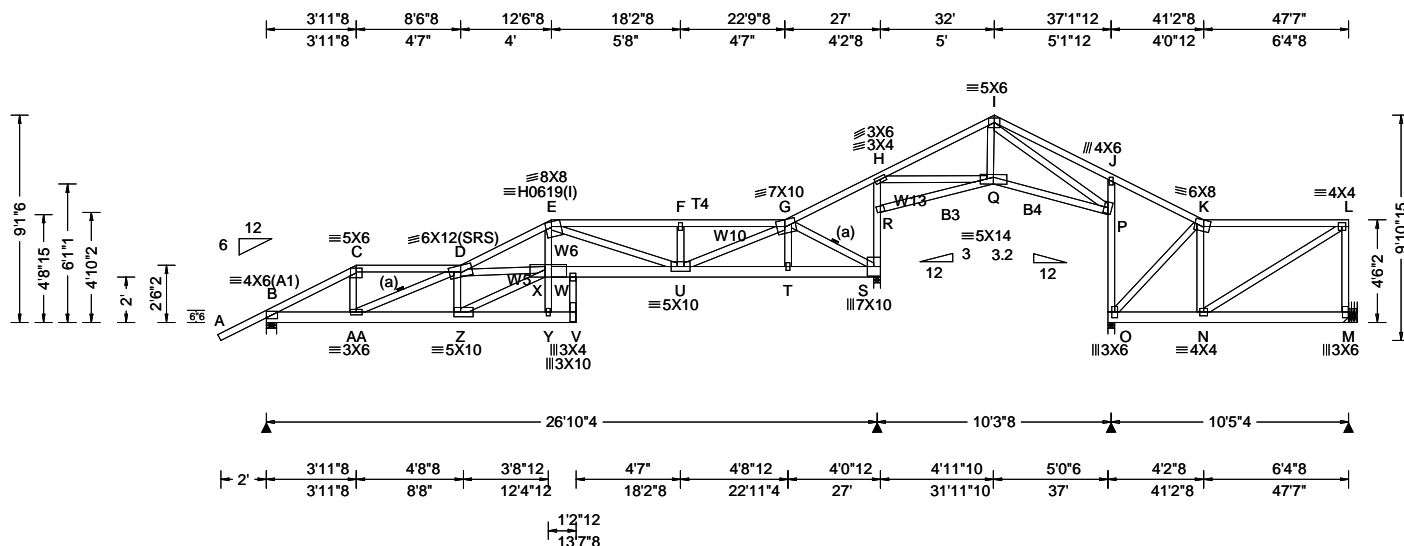

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 4.76 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT:20(0)/0(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.380 V 838 360 VERT(CL): 0.713 V 447 240 HORZ(LL): 0.096 S - - HORZ(TL): 0.180 S - - Creep Factor: 2.0 Max TC CSI: 0.979 Max BC CSI: 0.961 Max Web CSI: 0.936 VIEW Ver: 18.02.01A.0205.19	Gravity Loc R+ / R- / Rh / Rw / U / RL B 1975 - / - / - / - /615 /57 S 2308 - / - / - / - /681 - /- O 822 - / - / - / - /232 - /- M 608 - / - / - / - /206 - /- Non-Gravity Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 2.5 S Brg Width = 3.5 Min Req = 2.9 O Brg Width = 3.5 Min Req = 1.5 M Brg Width = - Min Req = - Bearings B, S, & O Fcperp = 425psi. Members not listed have forces less than 375#

Lumber
Top chord: 2x4 SP #1; T4 2x4 SP SS Dense;
Bot chord: 2x6 SP #1; B3,B4 2x4 SP #1;
Webs: 2x4 SP #3; W5,W6,W10,W13 2x4 SP #1;


Bracing
(a) Continuous lateral restraint equally spaced on member. Or 1x4 #3SRB SPF-S or better "T" reinforcement. 80% length of web member. Attached with 8d Box or Gun (0.113"x2.5",min.)nails @ 6" oc.

Special Loads
----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 56 plf at -2.13 to 56 plf at 47.58
BC: From 4 plf at -2.13 to 4 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 27.00
BC: From 21 plf at 27.00 to 21 plf at 31.97
BC: From 21 plf at 31.97 to 21 plf at 37.00
BC: From 20 plf at 37.00 to 20 plf at 47.58
TC: 112 lb Conc. Load at 4.02
TC: 110 lb Conc. Load at 13.56
TC: 77 lb Conc. Load at 14.73,16.73,18.73,20.73
22.73
TC: 92 lb Conc. Load at 45.23
BC: 389 lb Conc. Load at 4.02
BC: 308 lb Conc. Load at 13.56
BC: 71 lb Conc. Load at 14.73,16.73,18.73,20.73
22.73
BC: 198 lb Conc. Load at 45.23

Wind
Wind loads and reactions based on MWFRS.
Right end vertical exposed to wind pressure.
Deflection meets L/180.

Plating Notes
All plates are 2X4 except as noted.
(l) - plates so marked were sized using 0% Fabrication Tolerance, 0 degrees Rotational Tolerance, and/or zero Positioning Tolerance.
Plates sized for a minimum of 3.50 sq.in./piece.

Additional Notes
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

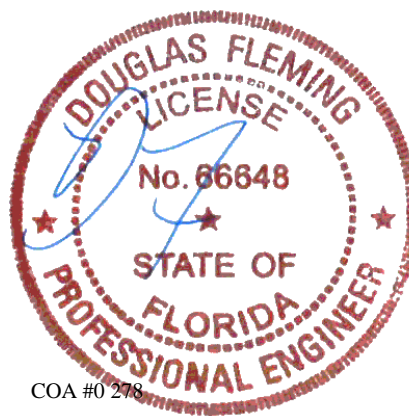

COA #0 278
09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCS (Building Component Safety Information, by TPI and SBGA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCS. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCS sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBGA: www.sbgindustry.com; ICC: www.iccsafe.org

Maximum Top Chord Forces Per Ply (lbs)				
Chords	Tens.Comp.	Chords	Tens. Comp.	
B - C	1011 -3312	F - G	1599 -5234	
C - D	880 -2899	H - I	122 -409	
D - E	2102 -6925	K - L	172 -375	
E - F	1599 -5234			

Maximum Bot Chord Forces Per Ply (lbs)				
Chords	Tens.Comp.	Chords	Tens. Comp.	
B - AA	2899 -823	W - U	6139 -1803	
AA - Z	4841 -1443	U - T	2759 -827	
X - W	6176 -1814	T - S	2773 -827	

Maximum Web Forces Per Ply (lbs)				
Webs	Tens.Comp.	Webs	Tens. Comp.	
C - AA	1169 -316	U - G	2743 -789	
AA - D	683 -2141	G - S	998 -3331	
D - Z	739 -2402	S - R	205 -713	
D - X	1319 -365	R - H	172 -558	
Z - X	5407 -1613	H - Q	611 -130	
X - E	2978 -847	P - O	114 -436	
E - U	279 -976	O - K	170 -550	
W - V	478 -155	N - L	447 -170	
F - U	237 -544	M - L	178 -445	

SEQN: 65943	COMN	Ply: 1	Job Number: b51385aa	Cust: R 857 JRef: 1WYP8570001 T68
FROM: RNB		Qty: 1	-terrell floor plan Trademark Const Group	DrwNo: 259.20.1000.05767
Page 2 of 2			Truss Label: TG-1	SSB / DF 09/15/2020

Purlins

In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	34	-2.07	3.96
TC	24	3.96	8.54
TC	22	8.54	12.54
TC	24	12.54	22.79
TC	75	22.79	32.00
TC	75	32.00	41.21
TC	24	41.21	47.58
BC	75	0.15	13.62
BC	68	12.47	26.71
BC	63	26.86	31.97
BC	65	31.97	37.23
BC	120	37.29	47.58

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.


Bearing at location x=47'4" uses the following support conditions: 47'4"

Bearing M (47'4", 10'1"2) LUS26

Supporting Member: (3)2x8 SP SS Dense

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

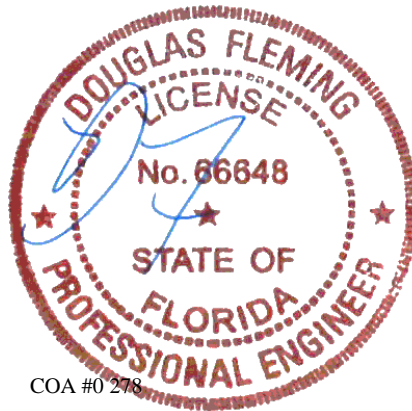

COA #0 278

09/15/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 65929 FROM: RNB	JACK Ply: 1 Qty: 10	Job Number: b51385aa -terrell floor plan Trademark Const Group Truss Label: CJ4	Cust: R 857 JRef: 1WYP8570001 T15 DrwNo: 259.20.0954.17833 SSB / DF 09/15/2020
--------------------------	---------------------------	---	--

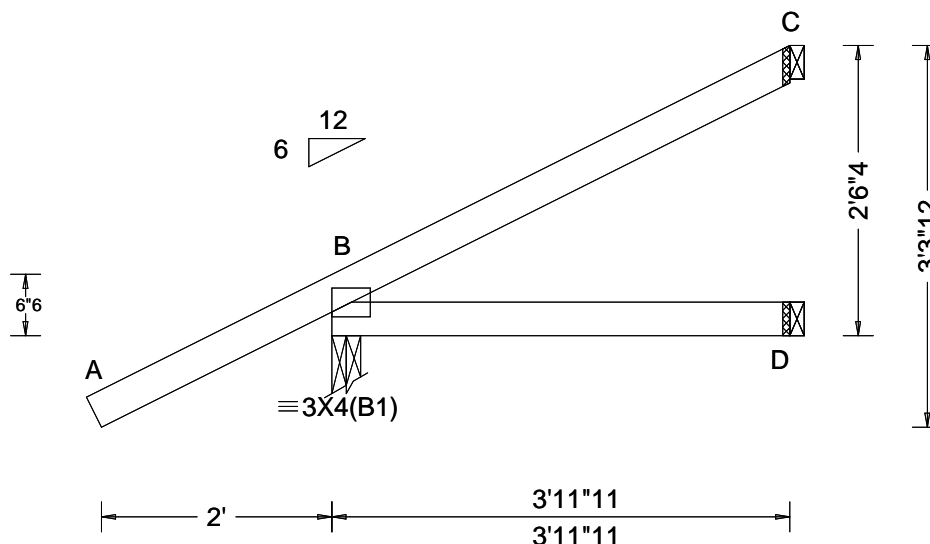

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 7.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 37.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: B Kzt: NA Mean Height: 15.00 ft TCDL: 0.0 psf BCDL: 0.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/0(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.002 D - - HORZ(TL): 0.002 D - - Creep Factor: 2.0 Max TC CSI: 0.410 Max BC CSI: 0.116 Max Web CSI: 0.000 VIEW Ver: 18.02.01A.0205.19	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 313 - / - /187 /88 /68 D 72 - / - /37 /4 - C 78 - / - /34 /46 - Wind reactions based on MWFRS B Brg Width = 3.0 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B Fcperp = 425psi. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #1;
Bot chord: 2x4 SP #1;

Plating Notes

Plates sized for a minimum of 3.50 sq.in./piece.

Purlins


In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	75	-2.07	3.97
BC	46	0.17	3.97

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

Wind

Wind loads based on MWFRS with additional C&C member design.

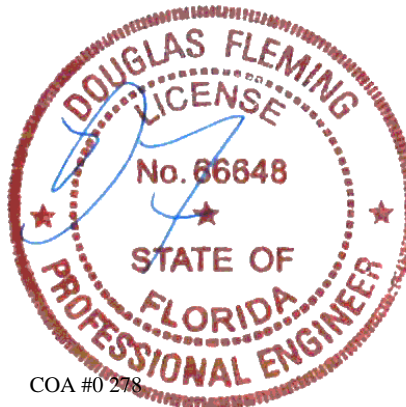

COA #0 278
09/15/2020

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

Piggyback Detail - ASCE 7-16: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.
Or 140 mph wind, 30.00 ft Mean Hgt, ASCE 7-16, Enclosed Bldg. located anywhere in roof, Exp D, wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Detail A : Purlin Spacing = 24" o.c. or less

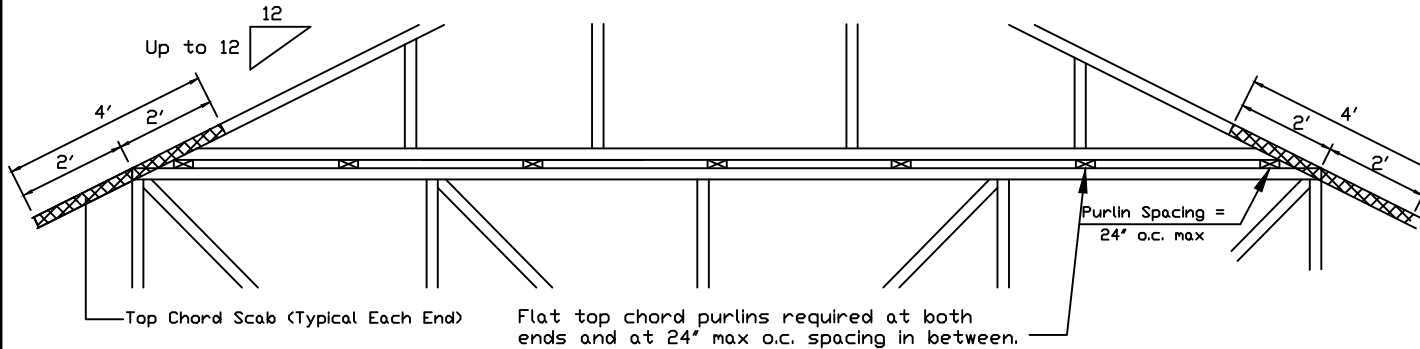


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (8) 0.120"x1.375" nails, (4) into cap TC & (4) into base truss TC or (1) 28PB wave piggyback plate plated to the piggyback truss TC and attached to the base truss TC with (4) 0.120"x1.375" nails. Note: Nailing thru holes of wave plate is acceptable.

Detail B : Purlin Spacing > 24" o.c.

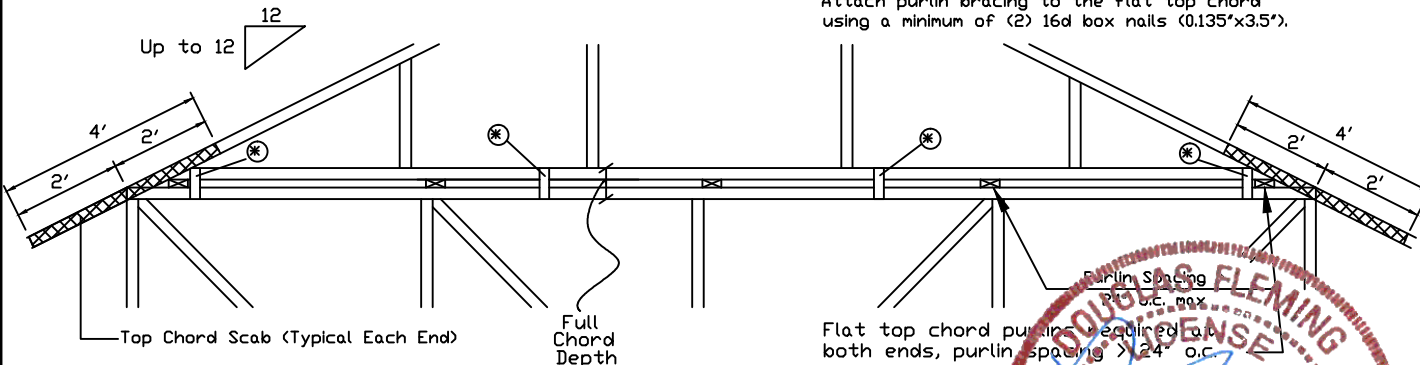

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

* In addition, provide connection with one of the following methods:


Trulox Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120"x1.375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.
APA Rated Gusset 8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces.
2x4 Vertical Scabs 2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.
28PB Wave Piggyback Plate One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120"x1.375" nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24' o.c. max. and use Detail A.



13723 Riverport Drive
Suite 200
Maryland Heights, MO 63043

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.
A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org

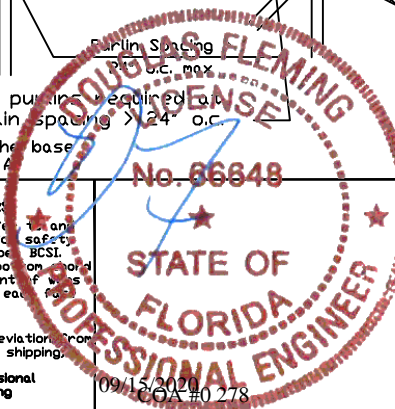

REF PIGGYBACK
DATE 01/02/2018
DRWG PB160160118

SPACING 24.0"

Piggyback Detail - ASCE 7-16: 180 mph, 30' Mean Hgt, Partially Enclosed, Exp. C, Kzt=1.00

180 mph Wind, 30.00 ft Mean Hgt, ASCE 7-16, Part. Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.
Or 160 mph wind, 30.00 ft Mean Hgt, ASCE 7-16, Part. Enclosed Bldg. located anywhere in roof, Exp D, wind DL= 5.0 psf (min), Kzt=1.0.


Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

++ Flat top chord purlins required at both ends and at a maximum of 24' intervals unless otherwise noted on base truss design drawing. Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

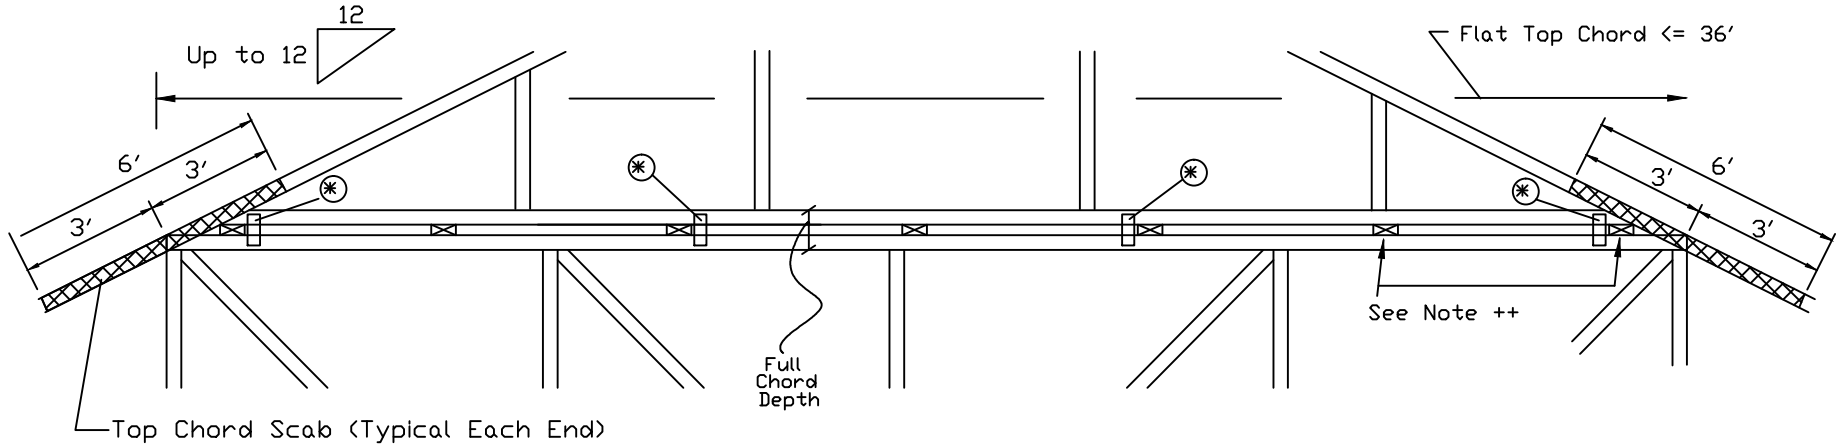

* In addition, provide connection with one of the following methods:

Trulox

Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120"x1.375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.

28PB Wave Piggyback Plate

One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120"x1.375" nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.

APA Rated Gusset

8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces.

2x4 Vertical Scabs

2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcindustry.org ICC: www.iccsafe.org



514 Earth City Expressway
Suite 242
Earth City, MO 63045

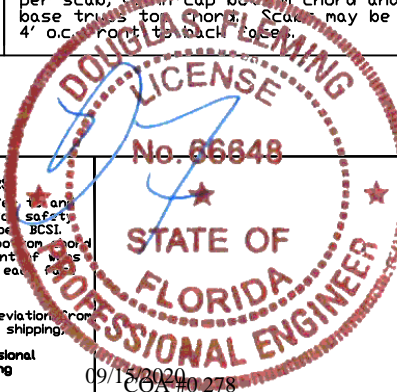

09/13/2020
COA #0278

REF PIGGYBACK

DATE 01/02/2018

DRWG PB180160118

SPACING 24.0"

Cracked or Broken Member Repair Detail

This drawing specifies repairs for a truss with broken chord or web member.

This design is valid only for single ply trusses with 2x4 or 2x6 broken members. No more than one break per chord panel and no more than two breaks per truss are allowed. Contact the truss manufacturer for any repairs that do not comply with this detail.

(B) = Damaged area, 12" max length of damaged section
(L) = Minimum nailing distance on each side of damaged area (B)
(S) = Two 2x4 or two 2x6 side members, same size, grade, and species as damaged member. Apply one scab per face.
Minimum side member length(s) = (2)(L) + (B)

Scab member length (S) must be within the broken panel.

Nail into 2x4 members using two (2) rows at 4" o.c., rows staggered.
Nail into 2x6 members using three (3) rows at 4" o.c., rows staggered.

Nail using 10d box or gun nails (0.128"x3", min) into each side member.

The maximum permitted lumber grade for use with this detail is limited to Visual grade #1 and MSR grade 1650f.

This repair detail may be used for broken connector plate at mid-panel splices.


This repair detail may not be used for damaged chord or web sections occurring within the connector plate area.

Broken chord may not support any tie-in loads.


Load Duration = 0%

Member forces may be increased for Duration of Load

Member	Size	L	Maximum Member Axial Force			
			SPF-C	HF	DF-L	SYP
Web Only	2x4	12"	620#	635#	730#	800#
Web Only	2x4	18"	975#	1055#	1295#	1415#
Web or Chord	2x4	24"	975#	1055#	1495#	1745#
Web or Chord	2x6		1465#	1585#	2245#	2620#
Web or Chord	2x4	30"	1910#	1960#	2315#	2555#
Web or Chord	2x6		2230#	2365#	3125#	3575#
Web or Chord	2x4	36"	2470#	2530#	2930#	3210#
Web or Chord	2x6		3535#	3635#	4295#	4745#
Web or Chord	2x4	42"	2975#	3045#	3505#	3835#
Web or Chord	2x6		4395#	4500#	5225#	5725#
Web or Chord	2x4	48"	3460#	3540#	4070#	4445#
Web or Chord	2x6		5165#	5280#	6095#	6660#

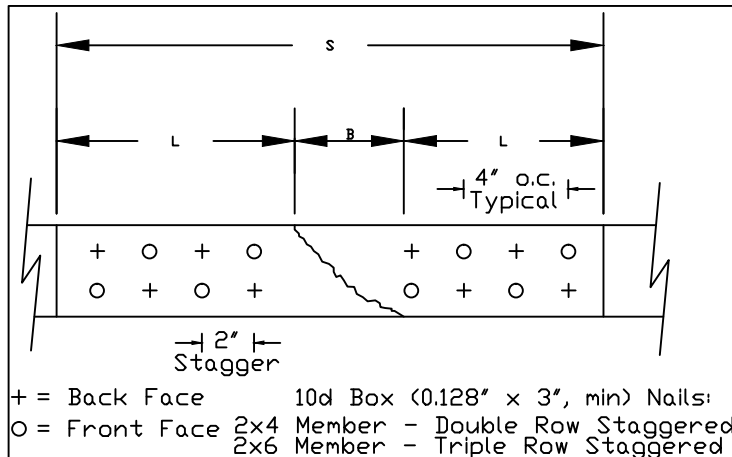

Nail Spacing Detail

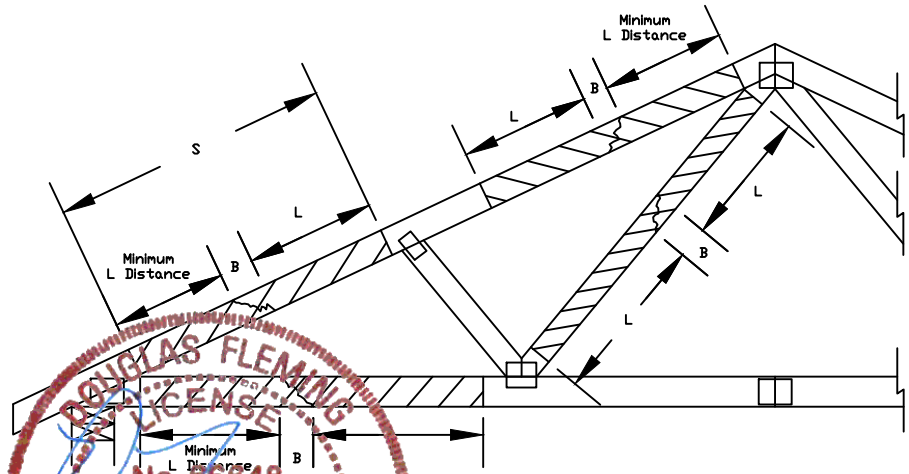

514 Earth City Expressway
Suite 242
Earth City, MO 63045


WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING!
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec2.

For more information see this Job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org

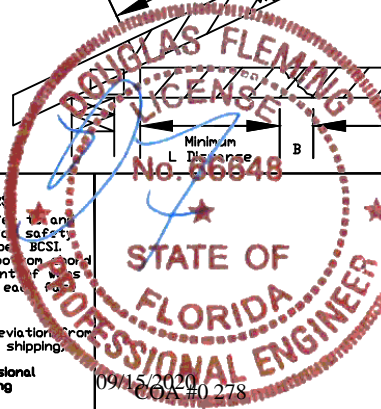

REF MEMBER REPAIR
DATE 10/01/14
DRWG REPCHRD1014

SPACING 24.0" MAX

Piggyback Detail - ASCE 7-10: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-10, Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.
Or 140 mph wind, 30.00 ft Mean Hgt, ASCE 7-10, Enclosed Bldg. located anywhere in roof, Exp D, wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Detail A : Purlin Spacing = 24" o.c. or less

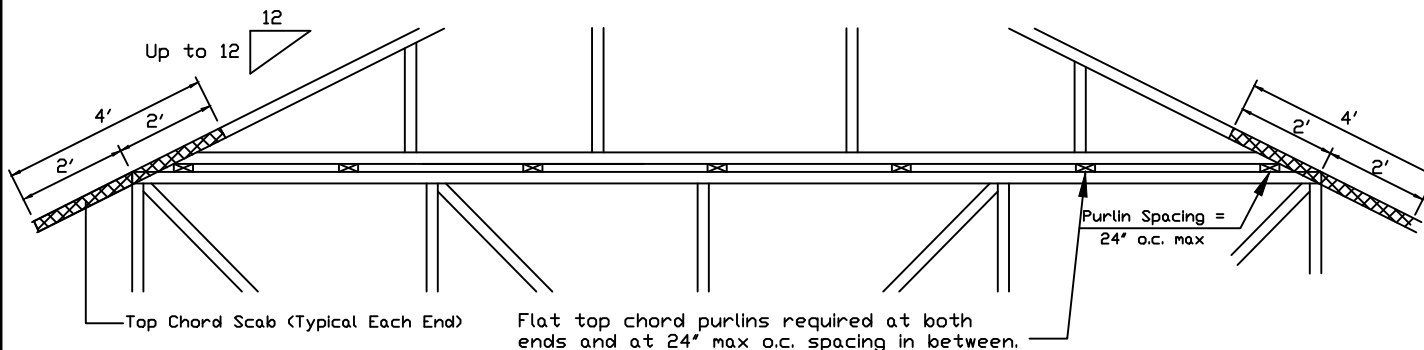


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (8) 0.120"x1.375" nails, (4) into cap TC & (4) into base truss TC or (1) 28PB wave piggyback plate plated to the piggyback truss TC and attached to the base truss TC with (4) 0.120"x1.375" nails. Note: Nailing thru holes of wave plate is acceptable.

Detail B : Purlin Spacing > 24" o.c.

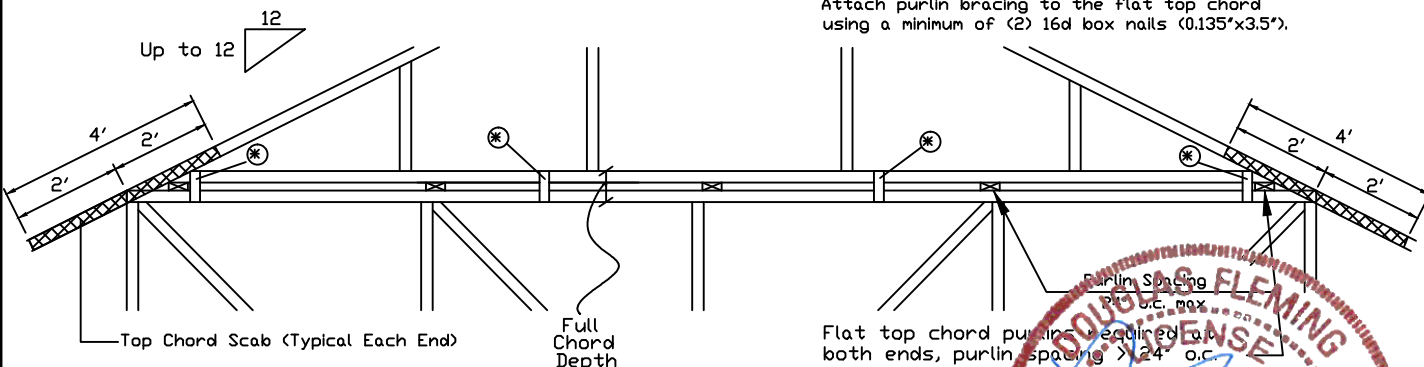

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4' o.c.

Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0.135"x3.5").

* In addition, provide connection with one of the following methods:

Trulox
Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120"x1.375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.

APA Rated Gusset
8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces.

2x4 Vertical Scabs
2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.

28PB Wave Piggyback Plate
One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120"x1.375" nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24' o.c. max. and use Detail A.

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
Suite 242
Earth City, MO 63045

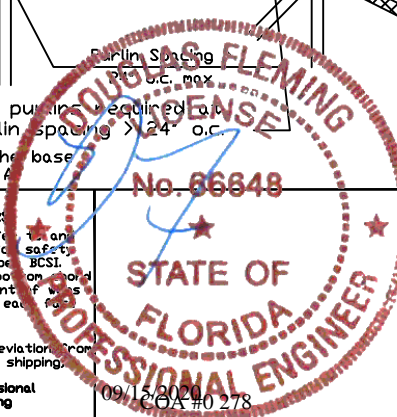

REF PIGGYBACK

DATE 10/01/14

DRWG PB160101014

SPACING

24.0"

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.


Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 row	2x4	1-2x4
2x3 or 2x4	2 rows	2x6	2-2x4
2x6	1 row	2x4	1-2x6
2x6	2 rows	2x6	2-2x4(X)
2x8	1 row	2x6	1-2x8
2x8	2 rows	2x6	2-2x6(X)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

(X) Center scab on wide face of web. Apply (1) scab to each face of web.


T-Reinforcement or L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

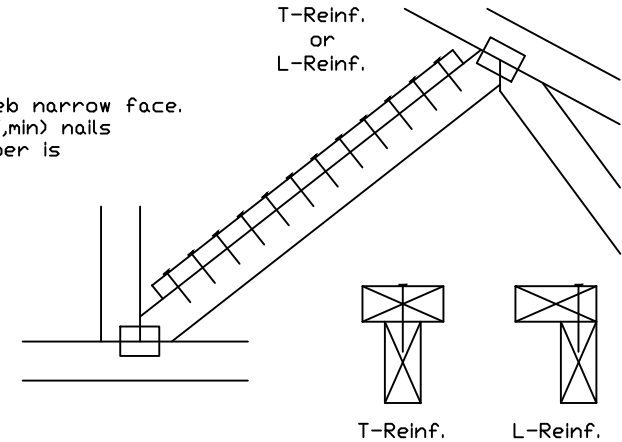


Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

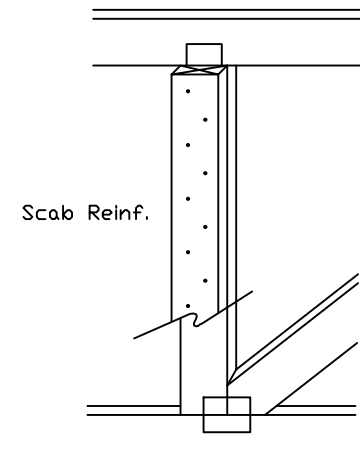

514 Earth City Expressway
Suite 242
Earth City, MO 63045

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.
A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org

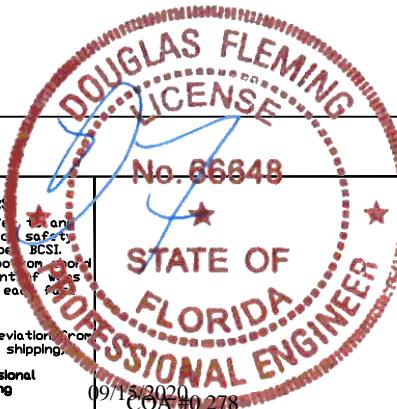

TC LL	PSF	REF CLR Subst.
TC DL	PSF	DATE 01/02/19
BC DL	PSF	DRWG BRCLBSUB0119
BC LL	PSF	
TOT. LD.	PSF	
DUR. FAC.		
SPACING		

NAIL SPACING DETAIL

MINIMUM SPACING FOR SINGLE BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

BLOCK LOCATION, SIZE, LENGTH, GRADE AND TOTAL NUMBER AND TYPE OF NAILS ARE TO BE SPECIFIED ON SEALED DESIGN REFERENCING THIS DETAIL.

LOAD PERPENDICULAR TO GRAIN

A - EDGE DISTANCE AND SPACING BETWEEN STAGGERED ROWS OF NAILS (6 NAIL DIAMETERS)

B - SPACING OF NAILS IN A ROW (12 NAIL DIAMETERS)

C - END DISTANCE (15 NAIL DIAMETERS)

LOAD PARALLEL TO GRAIN

A - EDGE DISTANCE (6 NAIL DIAMETERS)

C - SPACING OF NAILS IN A ROW AND END DISTANCE (15 NAIL DIAMETERS)

D - SPACING BETWEEN STAGGERED ROWS OF NAILS (7 1/2 NAIL DIAMETERS)


IF NAIL HOLES ARE PREBORED, SOME SPACING MAY BE REDUCED BY THE AMOUNTS GIVEN BELOW:

* SPACING MAY BE REDUCED BY 50%

** SPACING MAY BE REDUCED BY 33%

MINIMUM NAIL SPACING DISTANCES

NAIL TYPE	DISTANCES			
	A	B*	C**	D
8d BOX (0.113"X 2.5",MIN)	3/4"	1 3/8"	1 3/4"	7/8"
10d BOX (0.128"X 3",MIN)	7/8"	1 5/8"	2"	1"
12d BOX (0.128"X 3.25",MIN)	7/8"	1 5/8"	2"	1"
16d BOX (0.135"X 3.5",MIN)	7/8"	1 5/8"	2 1/8"	1 1/8"
20d BOX (0.148"X 4",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
8d COMMON (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
10d COMMON (0.148"X 3",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
12d COMMON (0.148"X 3.25",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
16d COMMON (0.162"X 3.5",MIN)	1"	2"	2 1/2"	1 1/4"
GUN (0.120"X 2.5",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
GUN (0.120"X 3",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 3",MIN)	7/8"	1 5/8"	2"	1"

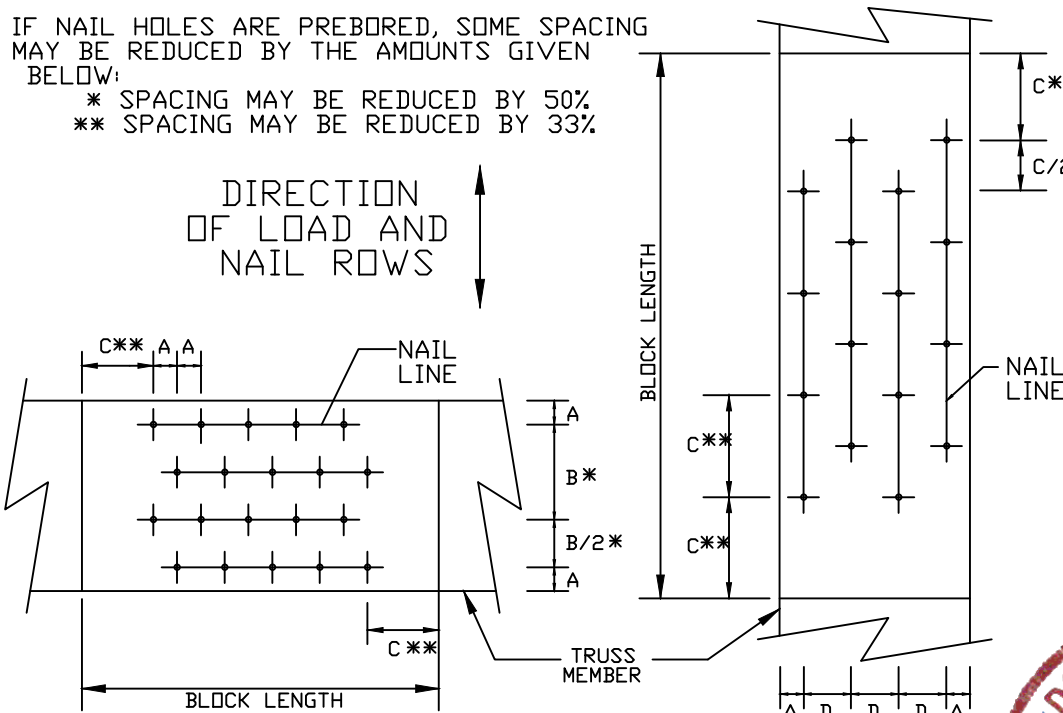

LOAD APPLIED PERPENDICULAR TO GRAIN LOAD APPLIED PARALLEL TO GRAIN

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each end of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcindustry.org ICC: www.iccsafe.org



514 Earth City Expressway
 Suite 242
 Earth City, MO 63045

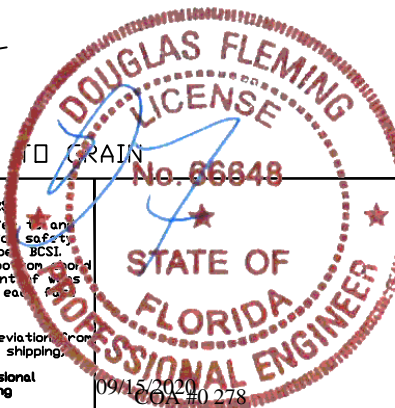

REF NAIL SPACE
 DATE 10/01/14
 DRWG CNNAILSP1014

Gable Stud Reinforcement Detail

ASCE 7-10: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Max Gable Vertical Length	2x4 Gable Vertical		Brace Grade	No Braces	(1) 1x4 "L" Brace *		(1) 2x4 "L" Brace *		(2) 2x4 "L" Brace **		(1) 2x6 "L" Brace *		(2) 2x6 "L" Brace **	
	Spacing	Species			Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B
24" O.C.	SPF	#1 / #2	#1	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
			#3	4' 1"	6' 7"	7' 1"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
			Stud	4' 1"	6' 7"	7' 0"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
		Standard	#1	4' 1"	5' 8"	6' 0"	7' 7"	8' 1"	10' 1"	10' 6"	11' 10"	12' 8"	14' 0"	14' 0"
			#2	4' 6"	7' 4"	7' 8"	8' 8"	9' 0"	10' 4"	10' 9"	13' 8"	14' 0"	14' 0"	14' 0"
			#3	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
	SP	DFL	#1	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
			Stud	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
			Standard	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	9' 6"	10' 2"	11' 0"	11' 10"	14' 0"	14' 0"
		Standard	#1 / #2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 8"	8' 1"	8' 8"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 8"	8' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF	#1 / #2	#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 9"	7' 4"	7' 9"	9' 9"	10' 3"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"
	SP	#1 / #2	#1	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
12" O.C.	SPF	#1 / #2	#1	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	#1 / #2	#1	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"

Bracing Group Species and Grades:

Group A:			
Spruce-Pine-Fir		Hem-Fir	
#1 / #2	Standard	#2	Stud
#3	Stud	#3	Standard
Douglas Fir-Larch		Southern Pine***	
#3		#3	
Stud		Stud	
Standard		Standard	

Group B:			
Hem-Fir			
#1 & Btr			
#1			
Douglas Fir-Larch		Southern Pine***	
#1		#1	
#2		#2	

1x4 Braces shall be SRB (Stress-Rated Board).

***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach "L" braces with 10d (0.128"x3.0" min) nails.

* For (1) "L" brace: space nails at 2' o.c.

in 18' end zones and 4' o.c. between zones.

** For (2) "L" braces: space nails at 3' o.c.

in 18' end zones and 6' o.c. between zones.

"L" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes

Vertical Length	No Splice
Less than 4' 0"	1X4 or 2X3
Greater than 4' 0"	3X4



+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 450# at each end. Max web total length is 14'.

Vertical length shown in table above.

Connect diagonal at midpoint of vertical web.

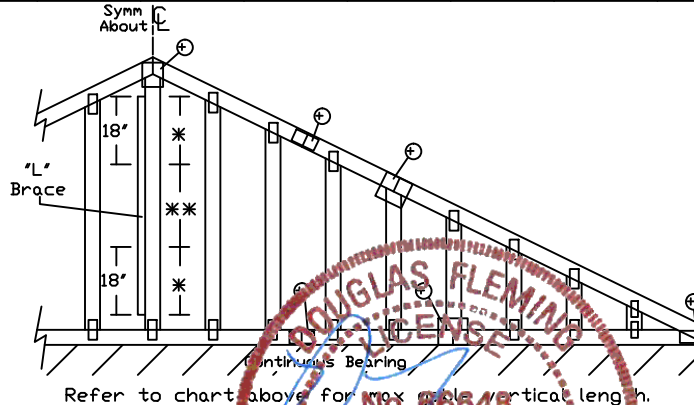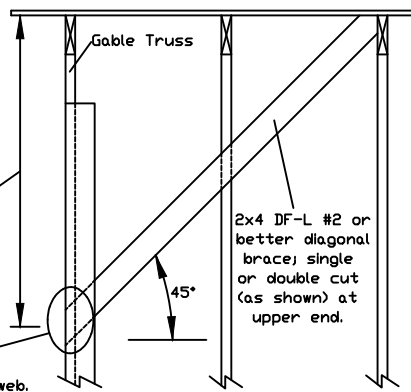

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each end of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this Job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
Suite 242
Earth City, MO 63045

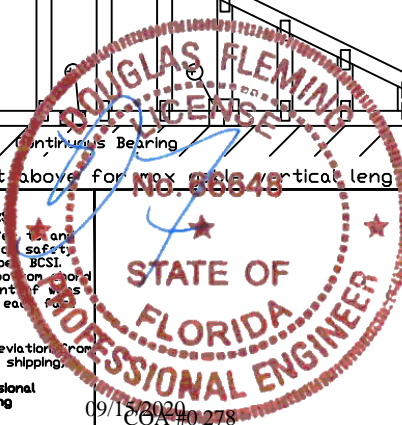

MAX. TOT. LD. 60 PSF


MAX. SPACING 24.0"

REF ASCE7-10-GAB14015

DATE 10/01/14

DRWG A14015ENC101014

Gable Detail For Let-in Verticals

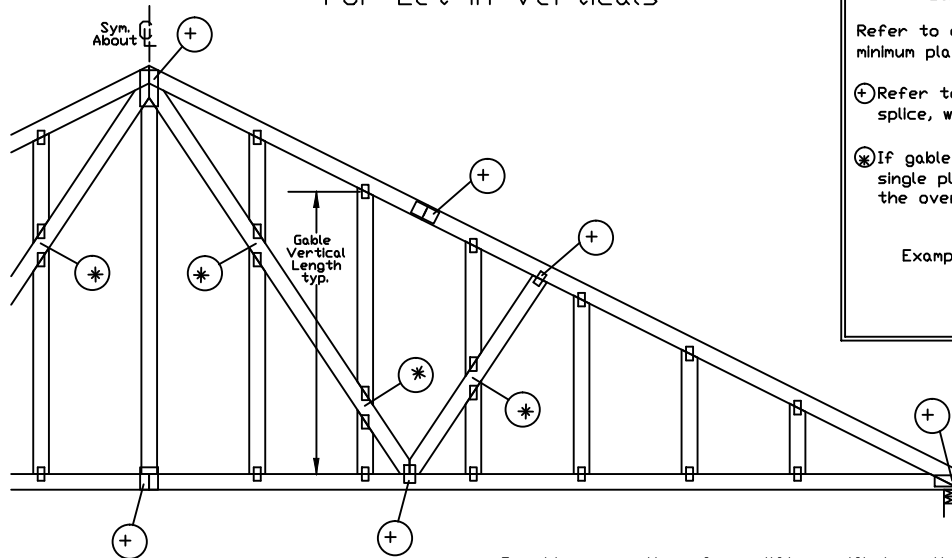


Gable Truss Plate Sizes


Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.

(+) Refer to Engineered truss design for peak, splice, web, and heel plates.

(*) If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.



"T" Reinforcement Attachment Detail

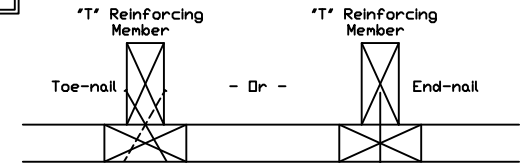

To convert from "L" to "T" reinforcing members, multiply "T" increase by length (based on appropriate Alpine gable detail).

Maximum allowable "T" reinforced gable vertical length is 14' from top to bottom chord.

"T" reinforcing member material must match size, specie, and grade of the "L" reinforcing member.

Web Length Increase w/ "T" Brace

"T" Reinf. Mbr. Size	"T" Increase
2x4	30 %
2x6	20 %

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24' o.c. SP #3

"T" Reinforcing Member Size = 2x4

"T" Brace Increase (From Above) = 30% = 1.30

(1) 2x4 "L" Brace Length = 8' 7"

Maximum "T" Reinforced Gable Vertical Length
1.30 x 8' 7" = 11' 2"

Provide connections for uplift specified on the engineered truss design.

Attach each "T" reinforcing member with

End Driven Nails:

10d Common (0.148"x3",min) Nails at 4' o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148"x3",min) Toenails at 4' o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.


ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,
A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A16015ENC100118,
A18015ENC100118, A20015ENC100118, A20015END100118, A20015PED100118,
A11530ENC100118, A12030ENC100118, A14030ENC100118, A16030ENC100118,
A18030ENC100118, A20030ENC100118, A20030END100118, A20030PED100118,
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,
S18015ENC100118, S20015ENC100118, S20015END100118, S20015PED100118,
S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,
S18030ENC100118, S20030ENC100118, S20030END100118, S20030PED100118

See appropriate Alpine gable detail for maximum reinforced gable vertical length.

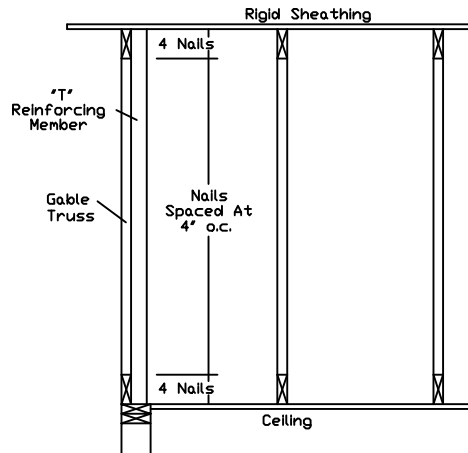

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLER

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of trusses shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each end of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org



514 Earth City Expressway
Suite 242
Earth City, MO 63045

No. 66848

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

09/15/2020
CON # 278

REF LET-IN VERT


DATE 01/02/2018

DRWG GBLLETIN0118

MAX. TOT. LD. 60 PSF

DUR. FAC. ANY

MAX. SPACING 24.0"

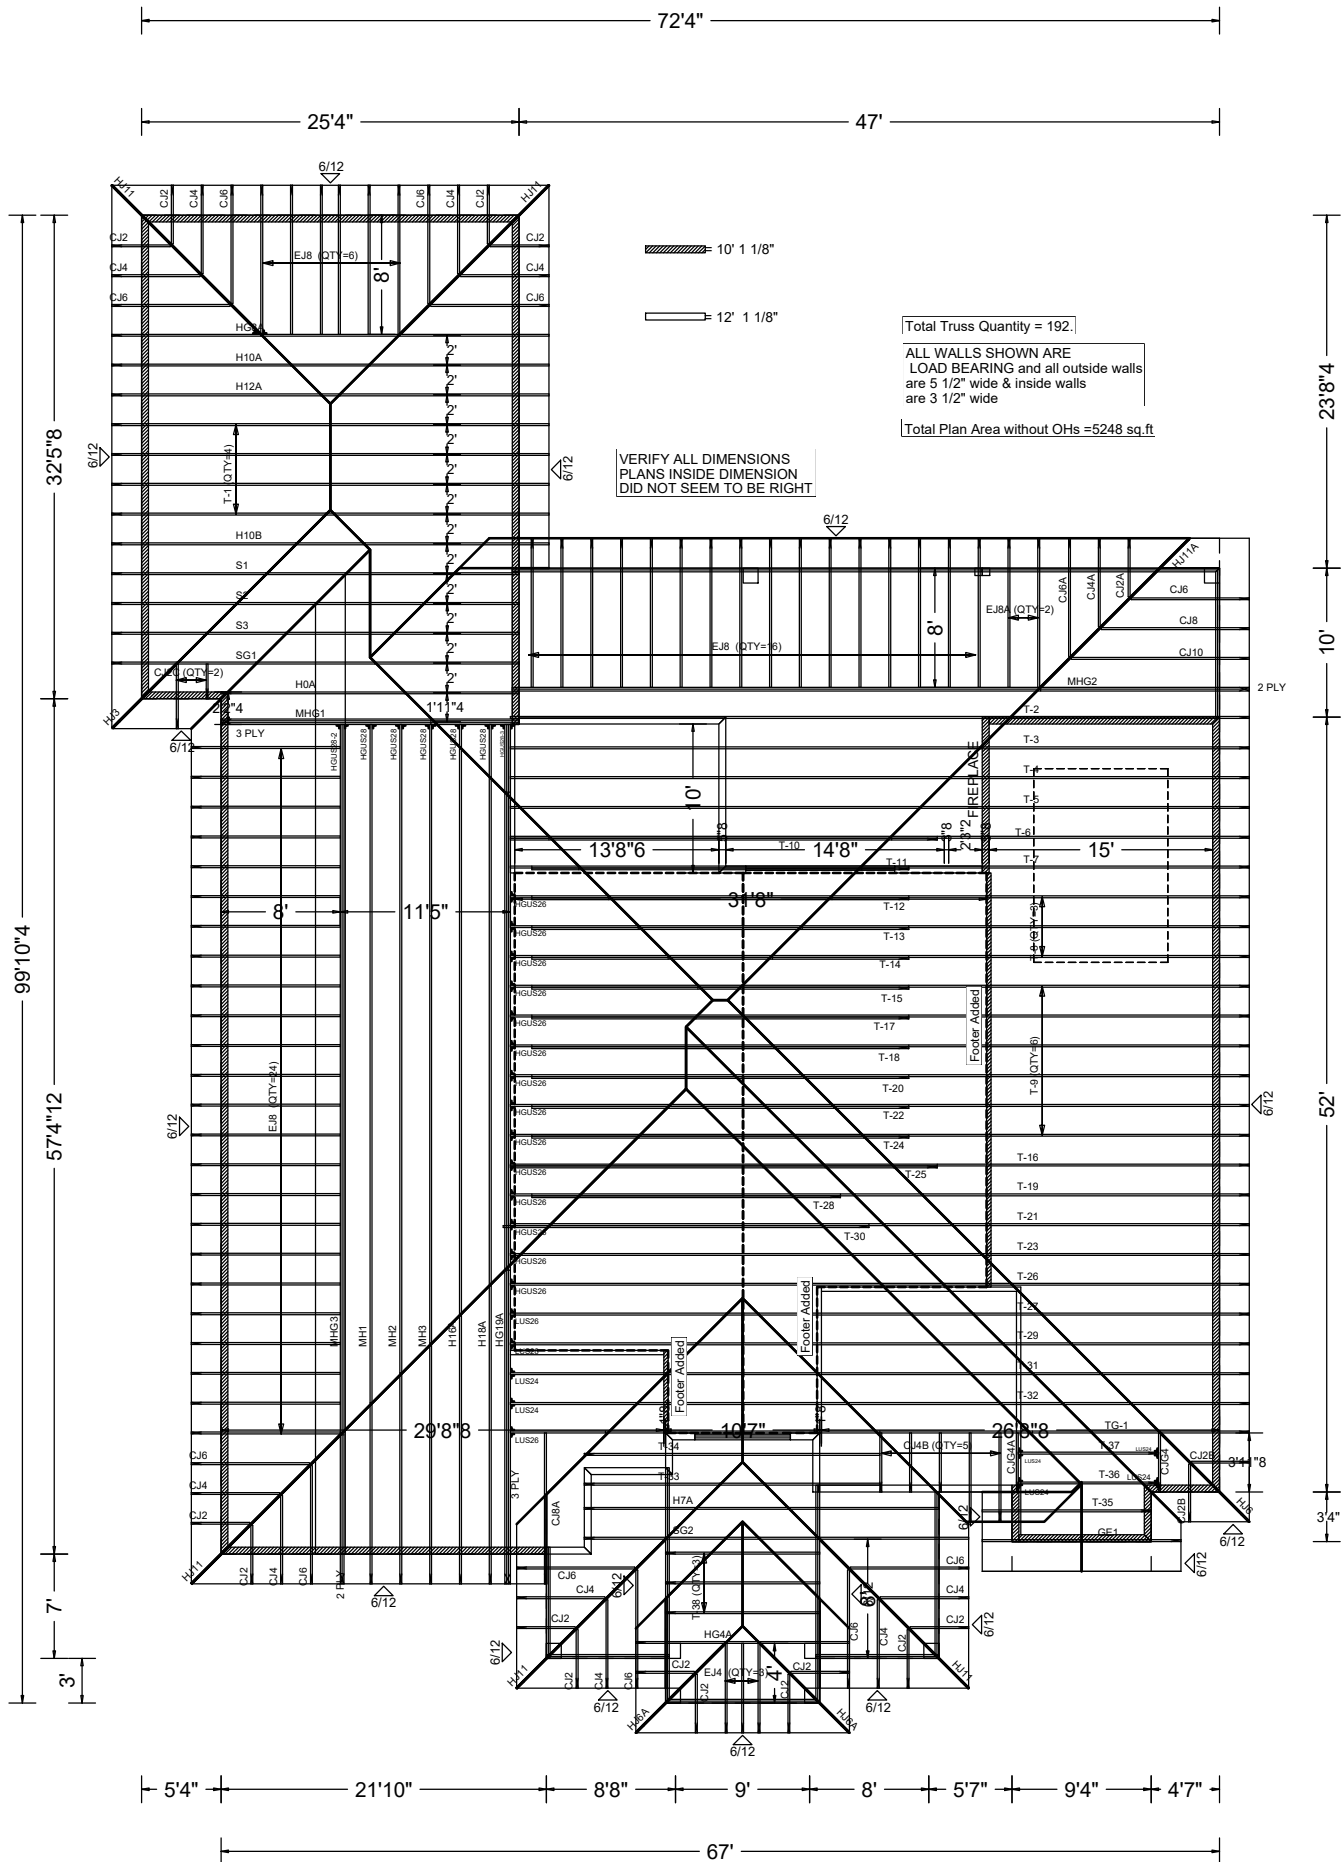

Job Name: terrell floor plan
Customer: Trademark Const Group
Designer: Rodney Barone
PlanName:
Created : 07-23-2020
SemRef#: b51385aa

JOB NO:
b51385aa

PAGE NO:
1 OF 1