
Mobile Home Permit Worksheet

	New Home Used Home
Installer: 505tos Lariccia License # I H/1127039	Home installed to the Manufacturer's Installation Manual
Address of home being installed	Home is installed in accordance with Rule 15-C
WHITE SPRINGS FL 320%	Single wide Wind Zone II Wind Zone III
Manufacturer CLAYTON Length x width 56 x 28	Double wide Installation Decal # 75274
NOTE: If home is a single wide fill out one half of the blocking plan	Triple/Quad Serial# 25878
if home is a triple or quad wide sketch in remainder of home I understand Lateral Arm Systems cannot be used on any home (new or used) where the sidewall ties exceed 5 ft 4 in.	PIER SPACING TABLE FOR USED HOMES
Installer's initials	Load Footer bearing size 16" x 16" 18 1/2" x 18 20" x 20" 22" x 22" 24" X 24" 26" x 26"
Typical pier spacing	bearing size 10 x 10 16 172 x 16 20 x 20 22 x 22 24 x 22 26 26 x 26 capacity (sq in) (256) 1/2" (342) (400) (484)* (576)* (676)
2'	1000 psf 3' 4' 5' 6' 7' 8'
Show locations of Longitudinal and Lateral Systems longitudinal (use dark lines to show these locations)	1500 psf 4' 6" 6' 7' 8' 8' 8' 2000 psf 6' 8' 8' 8' 8' 8'
	2500 psf 7' 6" 8' 8' 8' 8' 8'
	3500 psf 8' 8' 8' 8' 8' 8'
	* interpolated from Rule 15C-1 pier spacing table. PIER PAD SIZES POPULAR PAD SIZES
	I been signed signed along 241+2/1
	16 x 16 256
	185 × 185 342
	Other pier pad sizes 16 x 22.5 360 (required by the mfg.) 17 x 22 374
	13 1/4 x 26 1/4 348
	Wall openings 4 foot or greater. Use this 17.3/16 x 25.3/16 441
narriage wall piers within 2' of end of home per Rule 15C	symbol to show the piers. 17 1/2 x 25 1/2 446 24 x 24 576
	List all marriage wall openings greater than 4 foot and their pier pad sizes below.
	ANCHORS
	Opening Pier pad size
Building Comments of the Comment of	2774
The state of the s	FRAME TIES
Reviewed R	within 2' of end of home spaced at 5' 4" oc
for Gode S	TIEDOWN COMPONENTS OTHER TIES
Compliance S	Longitudinal Stabilizing Device (LSD) Sidewall
18/27/2020	Manufacturer OLIVEV Longitudinal
Se of Floridate	Longitudinal Stabilizing Device w/ Lateral Arms Manufacturer


FASE 10f2 Application Number:

Mobile Home Permit Worksheet

Mobile Home Permit Worksheet	FASE 2052 Application Number:
	Date:
POCKET PENETROMETER TEST	Site Preparation
The pocket penetrometer tests are rounded down to psf or check here to declare 1000 lb. soil without testing.	Debris and organic material removed Water drainage: Natural Swale Pad Other
x x x	Fastening multi wide units
POCKET PENETROMETER TESTING METHOD 1. Test the perimeter of the home at 6 locations. 2. Take the reading at the depth of the footer. 3. Using 500 lb. increments, take the lowest reading and round down to that increment.	Type Fastener: Type F
XXXX TORQUE PROBE TEST	of Floridan a properly installed gasket is a requirement of all new and used the properly installed gasket is a requirement of all new and used of Floridan and that condensation, mold, meldew and buckled marriage walls are result of a poorly installed or no gasket being installed. I understand a strip of tape will not serve as a gasket. Installer's initials
The results of the torque probe test is 25 inch pounds or check here if you are declaring 5' anchors without testing	Type gasket Manufacturer Installed: Between Floors Yes Between Walls Yes Bottom of ridgebeam Yes
Note: A state approved lateral arm system is being used and 4 ft.	Weatherproofing
anchors are allowed at the sidewall locations. I understand 5 ft anchors are required at all centerline tie points where the torque te reading is 275 or less and where the mobile home manufacturer m requires anchors with 1000 lb holding capacity. Installer's initials	The bottomboard will be repaired and/or taped. Yes Pgst Siding on units is installed to manufacturer's specifications. Yes Fireplace chimney installed so as not to allow intrusion of rain water. Yes
	Miscellaneous
Installer Name Date Tested ALL TESTS MUST BE PERFORMED BY A LICENSED INSTALLER Installer Name District District	Skirting to be installed. Yes No Dryer vent installed outside of skirting. Yes N/A Range downflow vent installed outside of skirting. Yes N/A Drain lines supported at 4 foot intervals. Yes Electrical crossovers protected. Yes Other:
Electrical	
Connect electrical conductors between multi-wide units, but not to the main pow source. This includes the bonding wire between multi-wide units. Pg	Installer verifies all information given with this permit worksheet
Plumbing	is accurate and true based on the
Connect all sewer drains to an existing sewer tap or septic tank. Pg	manufacturer's installation instructions and or Rule 15C-1 & 2
Connect all potable water supply piping to an existing water meter, water tap, or independent water supply systems. Pg	other Installer Signature Date 0/06/20

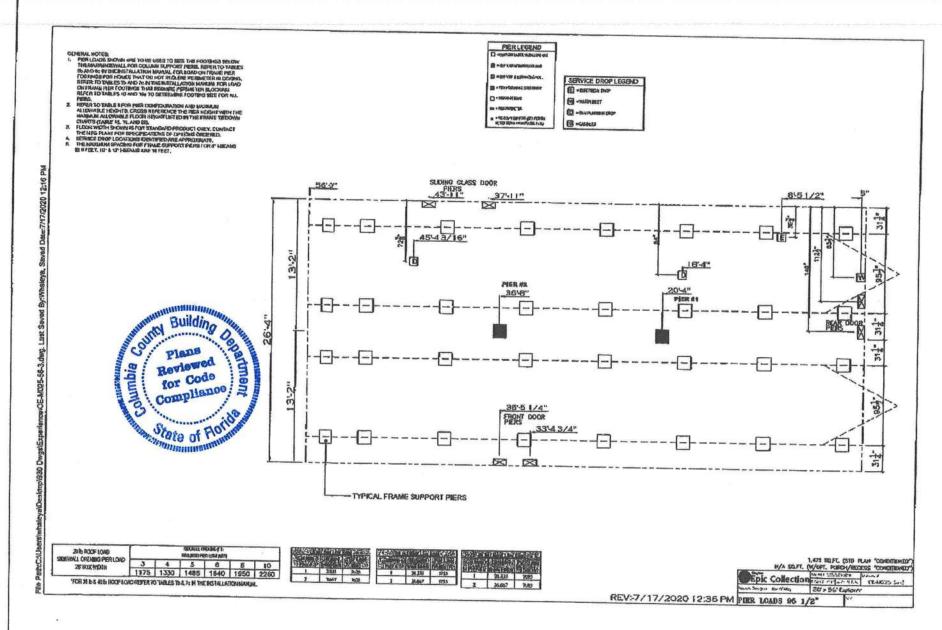



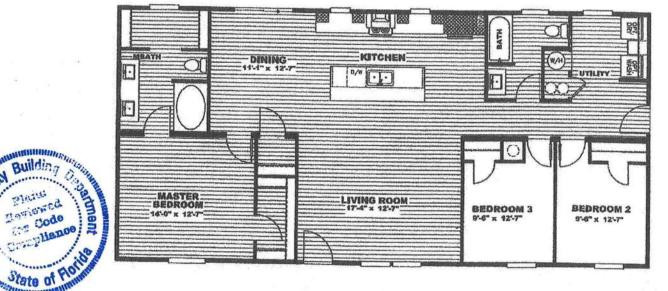

MODEL #CEE28563BH DRAWING # CE-M025-56-3

28'x56' EXPERIENCE